

# Technical Guide: ZQ, ZX, ZY, and ZL SERIES 3 to 12.5 Ton, 60 Hertz



York International Corporation, 5005  
York Drive, Norman, OK 73069

1068153-BTG-LL-0623

2023-06-18

---







# Contents

Product highlights.....	7
Patents.....	7
Options and accessories.....	8
Component location.....	9
Features and benefits.....	11
Factory installed options.....	17
Field installed accessories.....	20
Nomenclature.....	22
Accessories.....	23
AHRI cooling rating table.....	27
AHRI 270 outdoor sound power levels.....	28
Physical data.....	29
ZQ04 to ZQ06 physical data.....	29
ZXA7 physical data.....	35
ZY04 to ZY12 physical data.....	36
ZL04 to ZL06 physical data.....	51
ZL08 to ZL14 physical data.....	58
ZQ/ZX/ZY/ZL 04 to 14, A7 unit limitations.....	66
Capacity performance.....	67
ZQ04 to 06 cooling capacities.....	67
ZXA7 cooling capacities.....	73
ZY04 to 12 cooling capacities.....	76
ZL04 to 06 cooling capacities.....	90
ZL08 to 14 cooling capacities.....	96
Reheat performance.....	104
ZY04 to 12 reheat capacities.....	104
ZL04 to 14 reheat capacities.....	118
Drive selection.....	132
Airflow performance.....	133
Altitude and temperature correction for cfm, static pressure, and power.....	133
Altitude/temperature correction factors.....	134
Indoor blower specifications.....	135
RPM selection.....	137
Additional static resistance.....	138
Airflow performance.....	141
ZQ04 to 06 side duct application (belt drive).....	141
ZQ04 to 06 bottom duct application (belt drive).....	143
ZXA7 side duct application (belt drive).....	145
ZXA7 bottom duct application (belt drive).....	146
ZY04 to 12 side duct application (belt drive).....	147

ZY04 to 12 bottom duct application (belt drive).....	151
ZL04 to ZL06 side duct application (belt drive).....	155
ZL04 to ZL06 bottom duct application (belt drive).....	157
ZL08 to 14 side duct application (belt drive).....	159
ZL08 to 14 bottom duct application (belt drive).....	161
ZQ04 to 06 side duct application (direct drive).....	163
ZQ04 to 06 bottom duct application (direct drive).....	164
ZY04 to 06 side duct application (direct drive).....	165
ZY04 to 06 bottom duct application (direct drive).....	166
ZL04 to ZL06 side duct application (direct drive).....	167
ZL04 to ZL06 bottom duct application (direct drive).....	168
Power exhaust blower curves.....	169
Electrical data.....	171
ZQ04 to 06 standard indoor blower - without powered convenience outlet.....	171
ZQ04 to 06 standard indoor blower - with powered convenience outlet.....	173
ZQ04 to 06 medium indoor blower - without powered convenience outlet.....	175
ZQ04 to 06 medium indoor blower - with powered convenience outlet.....	177
ZQ04 to 06 high indoor blower - without powered convenience outlet.....	179
ZQ04 to 06 high indoor blower - with powered convenience outlet.....	181
ZXA7 standard indoor blower - without powered convenience outlet.....	182
ZXA7 standard indoor blower - with powered convenience outlet.....	183
ZXA7 medium indoor blower - without powered convenience outlet.....	184
ZXA7 medium indoor blower - with powered convenience outlet.....	185
ZXA7 high indoor blower - without powered convenience outlet.....	186
ZXA7 high indoor blower - with powered convenience outlet.....	187
ZY04 to 12 standard static indoor blower - without powered convenience outlet.....	188
ZY04 to 12 standard indoor blower - with powered convenience outlet.....	192
ZY04 to 12 medium indoor blower - without powered convenience outlet.....	196
ZY04 to 12 medium indoor blower - with powered convenience outlet.....	200
ZY04 to 12 high indoor blower - without powered convenience outlet.....	204
ZY04 to 12 high indoor blower - with powered convenience outlet.....	207
ZL04 to 06 standard indoor blowers - without powered convenience outlet.....	211
ZL04 to 06 standard indoor blower.....	213
ZL04 to 06 medium indoor blower - without powered convenience outlet.....	217
ZL04 to 06 medium indoor blower.....	219
ZL04 to 06 high indoor blower - without powered convenience outlet.....	223
ZL04 to 06 high indoor blower.....	225
ZL08 to 14 static indoor blowers - without powered convenience outlet.....	228
ZL08 to 14 standard indoor blower - with powered convenience outlet.....	230
ZL08 to 14 medium indoor blower - without powered convenience outlet.....	232
ZL08 to 14 medium indoor blower - with powered convenience outlet.....	234

ZL08 to 14 high indoor blower - without powered convenience outlet.....	236
ZL08 to 14 high indoor blower - with powered convenience outlet.....	238
Weights and dimensions.....	240
ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 unit weights.....	240
ZQ04-06, ZXA7, ZY04-12, ZL04-06 and ZL08-14 unit dimensions.....	244
ZQ04-06, ZXA7, ZY04-12, ZL04-06 and ZL08-14 unit roof curb dimensions.....	250
Economizer options.....	252
Guide specifications.....	255



## Product highlights

- Assembled in Norman, OK
  - ASHRAE 90.1 Compliant
  - R-410A Refrigerant
  - Cooling only and gas/electric configurations available
  - Scroll compressors
  - Up to 17.2 SEER on 3-5 ton ZL level
  - Up to 16.3 IEER and 12.2 EER on the 3 stage cooling advanced building code compliant level.
  - Up to 15.4 SEER and 12.2 EER on the Energy Star Compliant Energy Level
  - Up to 14.0 SEER and 11.2 EER on the ASHRAE 90.1 Compliant Standard Efficiency Level
  - Department of Energy (DOE) compliant - All models meet minimum DOE efficiencies for cooling and fan efficiencies. Single-phase gas heating products are fan energy rated (FER) to meet DOE requirements.
  - Ultra-Low NOx (ULN) models meet California SCAQMD 14 ng/J NOx level requirements.
  - State-of-the-art microprocessor controls with specific programming for product applications
  - MicroChannel condenser coils
  - Evaporator coils use copper tube/aluminum fin design for proven reliability and performance.
  - Thermostatic Expansion Valve (TXV) Standard on: ASHRAE 90.1 Compliant Standard Efficiency Level 5 ton to 12.5 ton models, Energy Star Compliant Efficiency Level 3 ton to 10 ton models and advanced building code compliant efficiency level 7.5 ton to 12.5 ton models.
  - Single-stage cooling (3 ton to 6 ton models)
  - Two-stage cooling (3 ton to 5 ton ZL models and 6 ton to 12.5 ton models)
  - Three-stage cooling available (7.5 ton to 12.5 ton models)
  - Alternate motor and drives
- ① **Note:** All single-phase 3 ton to 5 ton gas heating units are equipped with an ECM motor on direct drive units.

## Patents

**Patents:** <https://jccipat.com>

## Options and accessories

- Economizers with barometric relief
- Louvered hail guards
- Non-fused disconnect (verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat may exceed the factory installed disconnect amperage rating.)
- Power exhaust
- Propane conversion kits (except Ultra-Low NOx (ULN) models)
- High altitude heating conversion kits (except Ultra-Low NOx (ULN) models)
- Flue exhaust extension kit
- Flue heat shield
- Smoke detectors
- Manual and motorized dampers
- Hinged cabinet doors
- Low ambient head pressure control kit
- Optional stainless steel heat exchanger (standard on 3 ton to 5 ton Low NOx Models)
- Thru-the-base connections for power, gas and control wiring.
- IntelliSpeed™ with premium efficiency indoor motors to meet ASHRAE 90.1 requirements (3 ton to 5 ton ZL belt drive models and 6 ton to 12.5 ton models)
- *Field Installed Electric Heat Kit - Installation Instructions* for the Electric Heat Kits may be found in the Electric Heat Kits
- Factory Standard with the Smart Equipment™ Board with the option to downgrade to the Everyday Thermostat Control (ETC) board on ZQ/ZX/ZY models.
- MagnaDry dehumidification system - Available on ZY 3 ton to 10 ton units and ZL 3 ton to 12.5 ton units - Smart Equipment board only.

## Component location

Figure 1: Cooling with gas heat (3 ton through 5 ton) front


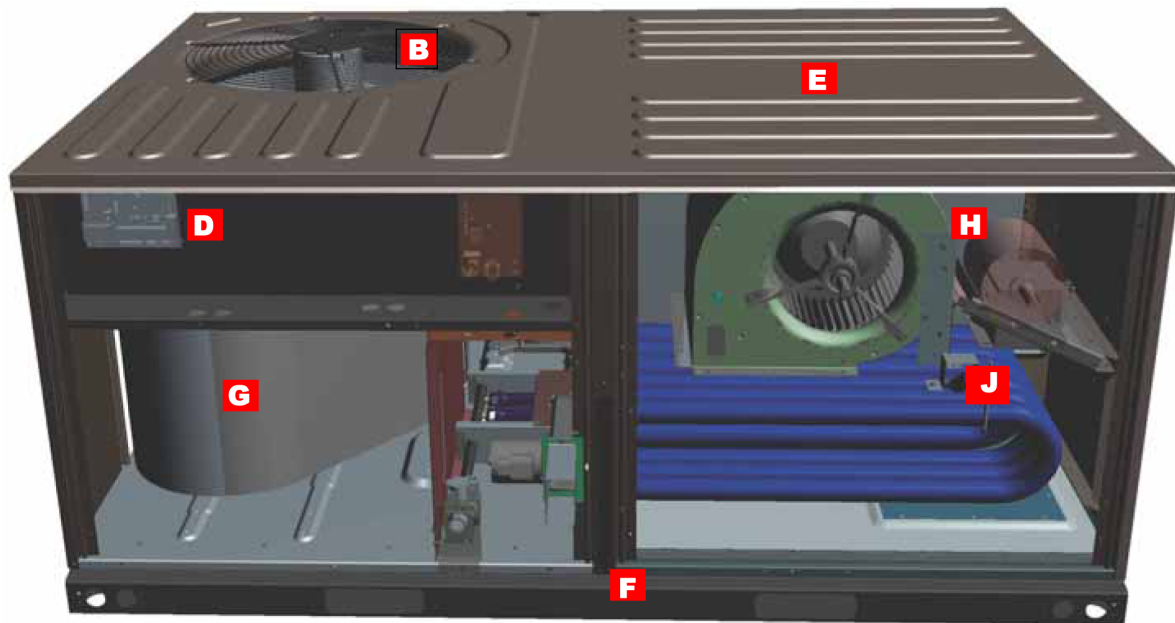


Figure 2: Cooling with gas heat (3 ton through 5 ton) back



Letter	Features
A	Scroll compressor
B	Outdoor fan
C	Filter rack
D	Everyday Thermostat Control (ETC) board

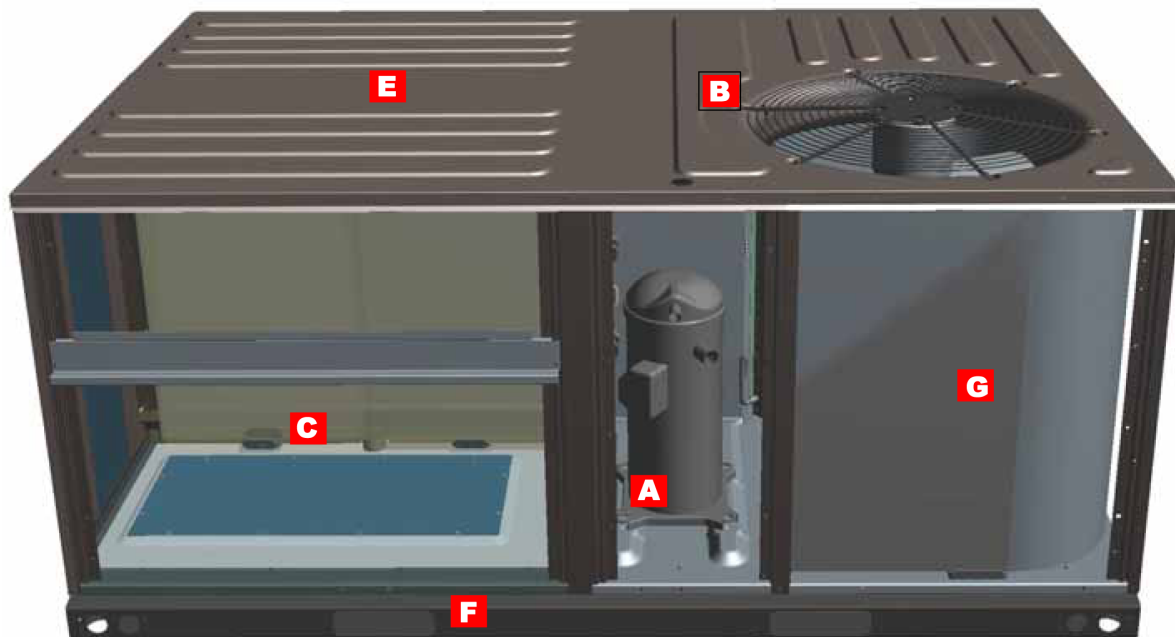

Letter	Features
E	Embossed top
F	Perimeter base rail
G	Coils
H	Indoor fans
J	Two-stage gas heating

See letters in [Features and benefits](#) for further description of the features.

## Features and benefits

The letters in brackets in the text correspond to the letters in Figure 1 and Figure 2.

### Three tiers of efficiency

14 SEER standard efficiency provides a cost effective 14 SEER/11.0 EER product that meets ASHRAE 90.1 requirements. The high-efficiency meets the requirements for Energy Star that exceeds 15 SEER and 12 EER. The 17 SEER ZL units contain two-stage compressors and multi-stage blower control to achieve advanced rebate codes. The high efficiency 3-stage cooling units are available from 7.5 tons to 12.5 tons to meet advanced building code requirements. Gas/electric units have electronic spark ignition and power vented combustion steady state efficiencies of 80%. These efficiencies meet or exceed all legislated minimum levels providing lower operating costs.

**(A) All models use scroll compressors** that are environmentally friendly by using R-410A refrigerant. Using the scroll compressor technology means a simple internal design, fewer moving parts, equating to a quiet, reliable, easy to service and efficient system. Internal compressor protection is standard and compressors include protection to prevent liquid damage.



### Total system design

A TXV is used for precise metering on the 6 ton to 12.5 ton and high SEER 3 ton to 5 ton products and a fixed orifice is used to keep the cost of the product down on the 3 ton to 5 ton product. Two independent refrigerant circuits and compressors are used on the 7.5 ton to 12.5 ton units for economical and precise control. A single circuit, single compressor design is used on the 3 ton to 6 ton units for cost effectiveness and reliability without compromising quality.


### System protection

Liquid line filter-driers, high and low pressure safeties are standard on each independent refrigerant circuit. Suction line sensors monitor temperature to prevent possible liquid flood back to the compressors and also protect against loss of charge and coil frosting.


**(B) Balanced outdoor fan design makes for a quieter unit** - The outdoor condenser fans are dynamically balanced for better performance and reliability. The direct drive fan design mounted to the fan grill allows for quick and easy service. Where other's components might fail at extreme temperatures, our units are tested and rated up to 125°F ambient cooling operation.



**(C) Filter rack** - Units ship with MERV 4 throwaway filters standard; however MERV 8 and MERV 13 filters can be easily added through the tool-free filter access panel to meet LEED requirements. Refer to physical data tables for filter size details.

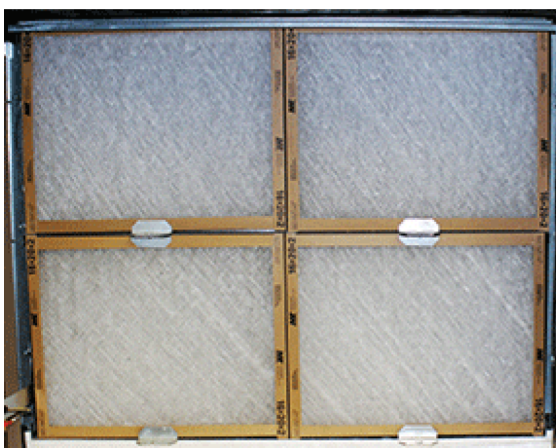

**(D) ZQ, ZX, and ZY units optionally come with the Everyday Thermostat Control (ETC) board.** The ETC comes in the same footprint as the Smart Equipment™ Control board and uses the same cutting edge technology. The ETC board focuses on providing the quickest field install, start-up, and service possible. All units are factory run tested.

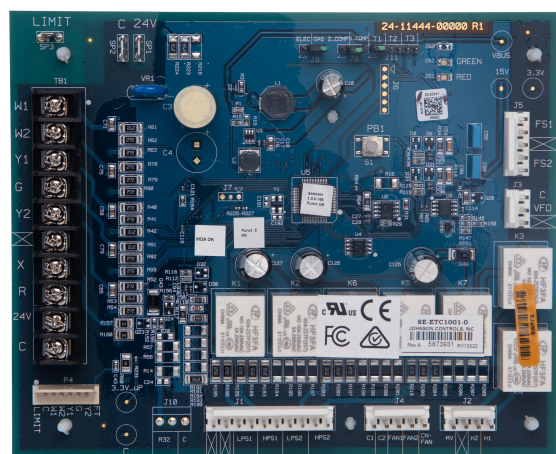

**Intuitive** – The ETC board can **only** be commanded by a traditional thermostat, using common screw terminal blocks for connection, and as a result minimizing complexity or the need for advanced service training.

**Simple diagnostics** - The ETC board has two simple colored LEDs and these LEDs display flash codes for fault condition states. A table of these flash codes is mounted on each unit to aid in troubleshooting and diagnostics in the field.

**Equipment protection** - The ETC board, similar to Smart Equipment™, monitors high and low pressure switch status on the independent refrigerant circuits, and freeze stat status. On units with heating, the gas valve and high temperature limit switches are monitored on gas and electric heating units. The control also monitors the voltage supplied to the unit and protects the unit if low voltage occurs due to a brown out, or other electrical issue.

**Anti-short cycle protection** - An anti-short cycle delay is incorporated into the standard control to aid compressor life. Compressor reliability is further ensured by programmable minimum run times. For testing, you can temporarily override the anti-short cycle delay with the push of a button.

**Fan delay versatility** - The ETC board offers three field selectable heating fan delay options based off simple jumper positions, allowing quick adjustment in the field.

---

**All units as factory standard come with the state-of-the-art Smart Equipment™ control system.** The unit control incorporates the best of the already proven Smart Equipment™ controls and creates a more robust, intelligent control. The goal of this control is to utilize cutting edge technology making the equipment easier to install, operate, and service. All units are Factory run tested.



## Versatile

You can configure the Smart Equipment™ control to work with a standard thermostat (easy to connect screw terminals), a zone sensor, or you can set it up to communicate with multiple BAS communication protocols to integrate with building automation systems.

## Reduce field installed complexity

Each unit comes equipped with factory-installed supply air, return air, and outdoor air temperature sensors providing key temperature readings, reducing field installed complexity.

## On-board USB port

The control comes with a long list of features including data logging, current and previous system faults and software update capabilities using the on board USB port and common flash drive. Energy use monitoring capabilities allow custom tailoring to allow a system to work more efficiently at all times and occupancy levels. Self test and start-up reports also available from the board VIA the USB port.

## Embedded LCD display

The board has an easy to read, built-in LCD display and easy to use navigation joystick and buttons allowing the user to quickly navigate the menus displaying unit status, options, current function, supply, return and outdoor temperatures, fault codes and other information.

## Safety monitoring

The control monitors the outdoor, supply, and return air temperatures and the high and low pressure switch status on the independent refrigerant circuits. On units with heating the gas valve and high temperature limit switches are monitored on gas and electric heating units. The control also monitors the voltage supplied to the unit and will protect the unit if low voltage due to a brown out, or other electrical issue occurs.

## Low ambient

An integrated low-ambient control allows units to operate in the cooling mode down to 0°F outdoor ambient without additional components or intervention. Optionally, you can program the control board to lockout the compressors when the outdoor air temperature is low or when free cooling is available.

## Anti-short cycle protection

To aid compressor life, an antishort cycle delay is incorporated into the standard control. Compressor reliability is further ensured by programmable minimum run times. For testing, you can temporarily override the anti-short cycle delay can be temporarily overridden with the push of a button.

## Fan delays

Fan on and fan off delays are fully programmable. Furthermore, the heating and cooling fan delay times are independent of one another. All units are programmed with default values based upon their configuration of cooling and/or heating capacity.

## Nuisance trip protection and three strikes

To prevent nuisance calls, the control board uses a three times, you're out philosophy. The high, low-pressure switch, anti-freeze protection, low voltage or heating high limit must trip three times within two hours before the unit control board locks out the associated compressor. The same safety must trip three times before a hard lockout occurs.

**(E) Robust design** - Each unit is designed with an embossed top to increase structural support and ensure rigidity. The unit has a powder paint exterior finish including a industry leading 750 hour salt spray rating. All units are painted with a long lasting, powder paint that stands up over the life of the unit.



**(F) Full perimeter base rail that fits on many existing curbs** -This product was designed with the replacement market in mind, which is why it fits on many existing curbs in the field. It also takes into account the new construction market by being versatile and sturdy. This unit is equipped with heavier gauge and innovatively designed base rails to prevent damage from transporting and rigging.





**(G) Coils** -All units use Microchannel "all-aluminum" condenser coils that provide improved heat transfer capabilities and reduced refrigerant charge volumes. This equates to all units meeting LEED EA Credit 4 Requirements for Enhanced Refrigerant Management. Microchannel coils are also much easier to clean than your typical fin/tube designs.

**Optional MagnaDry™ dehumidification system**


Units optioned with Micro-channel all-aluminum type reheat coils provide superior dehumidification at a wide range of outdoor temperatures. This system provides comfort without over-cooling the space. Available on ZY 3 ton to 10 ton and ZL 3 ton to 12.5 ton high efficiency units only.



All evaporator coils use copper tube with aluminum fin design for proven reliability and performance.

**(H) Rigid mounted blower assembly -**

Dynamically balanced indoor fans ensure better performance and reliability. Large access panels for easier access, service, and maintenance. X13 Direct drive (Standard Static Option) and belt drive (Medium Static and High Static Options) options available on 3 ton to 5 ton products. The belt drive option is standard on 6 ton to 12.5 ton products. Low, medium, and high Static drive options for airflow versatility up to 2 in. ESP with no field installed drive packages necessary. The X13 motor technology offers several benefits w/ respect to efficiency, operation, comfort, and cost when compared to other motors. Premium efficiency indoor motors are standard on ZY06 and ZX14. The IntelliSpeed™ option is available on 6 ton to 12.5 ton products and standard on the belt drive 17 SEER units and the 3 stage cooling models to meet ASHRAE 90.1 and Title 24 Requirements. The blower section includes a dual density insulation for indoor air quality.

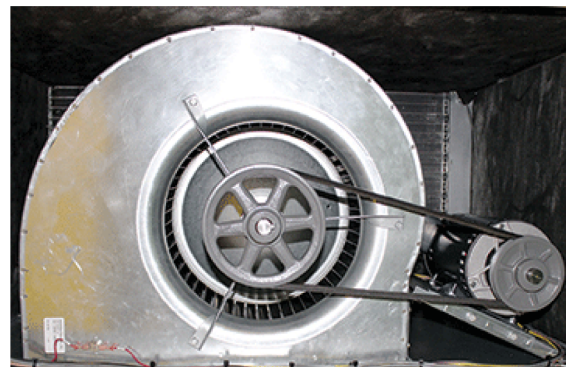

**(J) Balanced heating** - The two-stage gas heating offers ultimate heating comfort with a balance between first and second stage gas heating. The first stage of a two stage gas heat option provides approximately 70% of the heating capacity in all 3 tons to 12.5 tons two stage gas heat models. Balanced heating allows the unit to better maintain required temperatures and helps save energy. Low NOx comes standard with a stainless steel heat exchanger to meet California environmental requirements. The heat exchanger section includes foil faced insulation that is not only environmentally friendly but meets all NFPA codes.



### **Warranty**

All models include a 1-year limited warranty on the complete unit. Compressors carry a 5-year warranty. Aluminized steel heat exchangers carry a 10-year warranty and stainless steel heat exchangers carry a 15-year warranty.



# Factory installed options

## (Nomenclature digit position)

### Airflow options (8)

**Alternate indoor blower motor** - For applications with high static restrictions, units are offered with optional indoor motors providing higher external static capability and/or higher airflow, depending upon the installer's needs.

- A=Standard static (direct drive for 3 ton to 5 ton; Belt Drive for 6 ton to 12.5 ton)
- B=Medium static (belt drive for 3 ton to 12.5 ton)
- C=High static (belt drive for 3 ton to 12.5 ton; 3 Phase Models Only)

### VFD/VAV options (9)

**IntelliSpeed™ supply fan control option (ASHRAE 90.1 compliant)** - Units configured with the IntelliSpeed™ supply fan option contains a VFD for variable volume supply fan operation. This option allows the supply fan RPM to vary based on the number of compressors or heating stages energized. The economizer's minimum position is also configurable.

- 1=None (Comes with standard constant volume controls)
- 2=VFD/VAV (ZL 3-Stage only)
- 3=VFD IntelliSpeed™ (17 SEER belt drive models and standard on ZL High Efficiency 3-stage cooling models)

### Coil options (10)

**E-coat coils** - Coils are coated with an epoxy polymer coating to protect against corrosion. A 3-year warranty is added when this option is selected.

- A=Standard indoor and outdoor coils (fin/tube design on indoor coil and MicroChannel design used on outdoor coil with no E-coat coating added).
- B=Standard indoor coil and E-coat coil outdoor coil (fin/ tube design on indoor coil and MicroChannel design used on outdoor coil. E-coat coating added to outdoor coil)
- C= E-coat indoor coil and standard outdoor coil (fin/tube design on indoor coil and MicroChannel design used on outdoor coil. E-coat coating added to indoor coil)
- D= E-coat indoor coil and outdoor coil (fin/tube design on indoor coil and MicroChannel design used on outdoor coil. E-coat coating added to indoor and outdoor coil)
- E=Standard indoor and outdoor coils (fin/tube design on indoor coil and MicroChannel design used on outdoor coil with no E-coat coating added) with reheat
- F=Standard indoor coil and E-coat coil outdoor coil (fin/ tube design on indoor coil and MicroChannel design used on outdoor coil. E-coat coating added to outdoor coil) with reheat
- G= E-coat indoor coil and standard outdoor coil (fin/tube design on indoor coil and MicroChannel design used on outdoor coil. E-coat coating added to indoor coil) with reheat
- H= E-coat indoor coil and outdoor coil (fin/tube design on indoor coil and MicroChannel design used on outdoor coil. E-coat coating added to indoor and outdoor coil) with reheat

## Controls (11)

**Everyday Thermostat Control (ETC)** - ZQ, ZX and ZY units optionally may come with the ETC board. The ETC comes in the same footprint as the Smart Equipment™ Control board and uses the same cutting edge technology. The ETC board focuses on providing the quickest field install, start-up, and service possible.

**Smart Equipment™** - This is the Standard microprocessor control for all units, with capabilities to work with a sensor or thermostat only. Smart Equipment™ with BAS includes communication board with BACnet open-protocol system. Required for units equipped with reheat option.

**Verasys** - Verasys provides a simple user experience with configurable self-recognizing controllers without the need for any additional tools. Verasys creates enhanced integration of HVACR equipment, zoning, and controls. Contractors are able to offer a complete bundled solution of equipment and controls to serve the light commercial market.

- A=Smart Equipment™
- B=Smart Equipment™ + BACnet MSTP, Mdb, N2 COM Card
- E=Everyday Thermostat Control (ETC)
- J=Verasys single zone
- K=Verasys change over bypass

## Sensor options (12)

- 1=None (Units come standard with factory installed supply air, return air, and outdoor air temperature sensors)
- 2=RA<sup>1</sup> smoke detector
- 3=SA smoke detector
- 4=RA<sup>1</sup> & SA Smoke Detector

1 Return air smoke detector sensor must be relocated in the field. (See Unit Installation manual.)

## Economizer/Damper (13) (Smart Equipment™ models only)

**Down flow economizers (with barometric relief)** - All units offer a variety of optional factory installed economizers that are shipped, installed and wired with AMCA 511 Licensed Class 1A low leak dampers designed to exceed ASHRAE 90.1 and the International Energy Conservation Code (IECC) certification requirements by achieving leakage rates of 3 cfm/ ft<sup>2</sup> at 1 in. of static pressure. Each economizer goes through a rigorous 60,000 cycle test. Dry bulb, single enthalpy, and dual enthalpy (with field installed kit) can be selected. All economizer options are fully integrated into the Smart Equipment™ controls. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the outdoor air dry bulb temperature or the outdoor air enthalpy input. The dual enthalpy kit provides a second input used to monitor the return air (field installed). The installer needs only to assemble the outdoor air hood, attach the enthalpy control the hood and mount the hood to the unit (Hood and control are provided).

**Dry bulb economizer** - Economizer operation is enabled by the outdoor air temperature being less than the setpoint of the economizer module.

**Enthalpy economizer** - The added outdoor air enthalpy sensor enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.

- A=None
- B=Dry bulb economizer
- C=Enthalpy economizer

#### Convenience outlet (14)

**Convenience outlet** - (Powered and non-powered) - This option locates a 120 V single-phase GFCI outlet with cover, on the corner of the unit housing adjacent to the compressors. The non-powered option requires the installer to provide the 120 V single-phase power source and wiring. Factory installed option only.

- 1=None
- 2=Non-powered convenience outlet
- 3=Powered convenience outlet

#### Electrical options (15)

**Disconnect switch** - For units with field installed electric heat kits, two factory installed disconnect sizes are available (60 A or 100 A non-fused disconnect). Depending on the field installed heater kit selected, the factory installed disconnect may not be sufficient. Always refer to the unit nameplate or unit electrical data for the proper disconnect size. If the heater application requires a disconnect above 100 A, you should remove the factory installed disconnect and install an appropriately sized external disconnect.

- 1=None
- 2=Non-fused Disconnect<sup>1</sup>

<sup>1</sup> Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat may exceed the factory installed disconnect amperage rating.

#### Cabinet options (16)

**Louvered hail guard** - This kit includes a decorative louvered panel that installs over the outside condenser coil and prevents damage to the coil fins from hail strikes.

**Hinged cabinet doors** - The factory installed hinged panel option saves time, money, and labor while allowing easy servicing of blower components, filters, and controls. With this option there is no longer a need to remove panels to access these critical sections and running the risk of losing panels or causing roof damage from loose panels and materials. Extra care was taken to design a durable hinged panel with leak tight seal.

- 1=None
- 2=Louvered panels
- 3=Hinged cabinet doors
- 4=Hinged cabinet doors and louvered panels

**FDD (Fault Detection and Diagnostics), refrigerant side** - A modification shop offering for an additional installed control system for commercial equipment that constantly monitors refrigerant circuit pressures, refrigerant circuit temperatures, the environmental temperatures and humidity using multiple sensor inputs.


## Field installed accessories

- **Down flow economizers/horizontal economizers (with barometric relief)** - All units offer a variety of field installed economizers that are installed and wired with AMCA 511 Licensed Class 1A low leak dampers designed to exceed ASHRAE 90.1 and the International Energy Conservation Code (IECC) certification requirements by achieving leakage rates of 3 cfm/sq. ft. at 1 in. of static pressure. Each economizer goes through a rigorous 60,000 cycle test. Dry bulb, single enthalpy, and dual enthalpy (with field installed kit) can be selected. All economizer options are fully integrated into the Smart Equipment™ controls or the Everyday Thermostat Control board. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the outdoor air dry bulb temperature or the outdoor air enthalpy input. The dual enthalpy kit provides a second input used to monitor the return air (field installed). The installer needs only to assemble the outdoor air hood, attach the enthalpy control the hood and mount the hood to the unit (Hood and control are provided).
- **Dry bulb economizer** - Economizer operation is enabled by the outdoor air temperature being less than the setpoint of the economizer module.
- **Single enthalpy control, accessory for economizer** - All field installed economizers will come standard as a dry bulb economizer. This kit adds an outdoor air enthalpy sensor which enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.
- **Dual enthalpy control, accessory for economizer** - All field installed economizers will come standard as a dry bulb economizer. This kit adds an outdoor air enthalpy sensor and return air enthalpy sensor which enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.
- **Power exhaust** - This accessory installs in the unit with a down flow economizer or in the ductwork for a horizontal application.
- **Louvered hail guard** - This kit includes a decorative louvered panel which installs over the outside condenser coil and prevents damage to the coil fins from hail strikes.
- **Flue exhaust extension kit** - In locations where wind or weather conditions may interfere with proper exhausting of furnace combustion products, this kit can be installed to prevent the flue exhaust from entering nearby fresh air intakes.
- **Propane conversion kit** - This kit converts a gas heat unit to operate with propane gas at altitudes up to 2,000 feet (except Ultra-Low NOX (ULN) models).
- **Gas heat high altitude kit** - This kit converts a gas heat unit to operate at high altitudes, 2,000 ft to 10,000 ft. Conversion kits are available for natural gas and propane (except Ultra-Low NOX (ULN) models).
- **Roof curbs** - The roof curbs have insulated decks and are shipped disassembled. The roof curbs are available in 14 and 24 heights.
- **Thermostat** - The units are designed to operate with 24-V electronic and electro-mechanical thermostats. All 7.5 ton through 12.5 ton units operate with two-stage heat/ two-stage cool or two-stage cooling only thermostats and two-stage heat / three-stage cool on ZL tier products, depending upon unit configuration.
- **Smoke detectors** - The smoke detectors stop operation of the unit by interrupting power and providing a fault message to the control board if smoke is detected within the air compartment. Smoke detectors are available for both the supply and/or return air configurations.
- **Hinged filter access panel for use with horizontal flow economizer** - Allows hinged access to the filter section when used with a horizontal economizer.

- **Low ambient head pressure control kit** - The Electronic Low Ambient Controller is designed to regulate condenser head pressure at low ambient temperatures by varying the amount of airflow through the condenser.
- **Manual outdoor air damper** - Like the motorized outdoor air damper, each manual outdoor air damper includes a slide-in damper assembly with an outdoor air hood and filters. Customers have a choice of dampers with ranges of 0% to 100% or 0% to 35% outdoor air entry.
- **Thru the base connection** - Kits are available to provide a way to route wiring to the unit through the base of the unit and gas supplied to the unit through the base or through the curb. These kits provide a seal tight way to bring power and gas to the unit without additional roof penetrations.
- **Electric heat (field installed option only)** - Select heater sizes for 3 ton to 12.5 ton units available. Necessary hardware and connectors are included with the heaters.

# Nomenclature

## 3-12.5 Ton Model Number Nomenclature

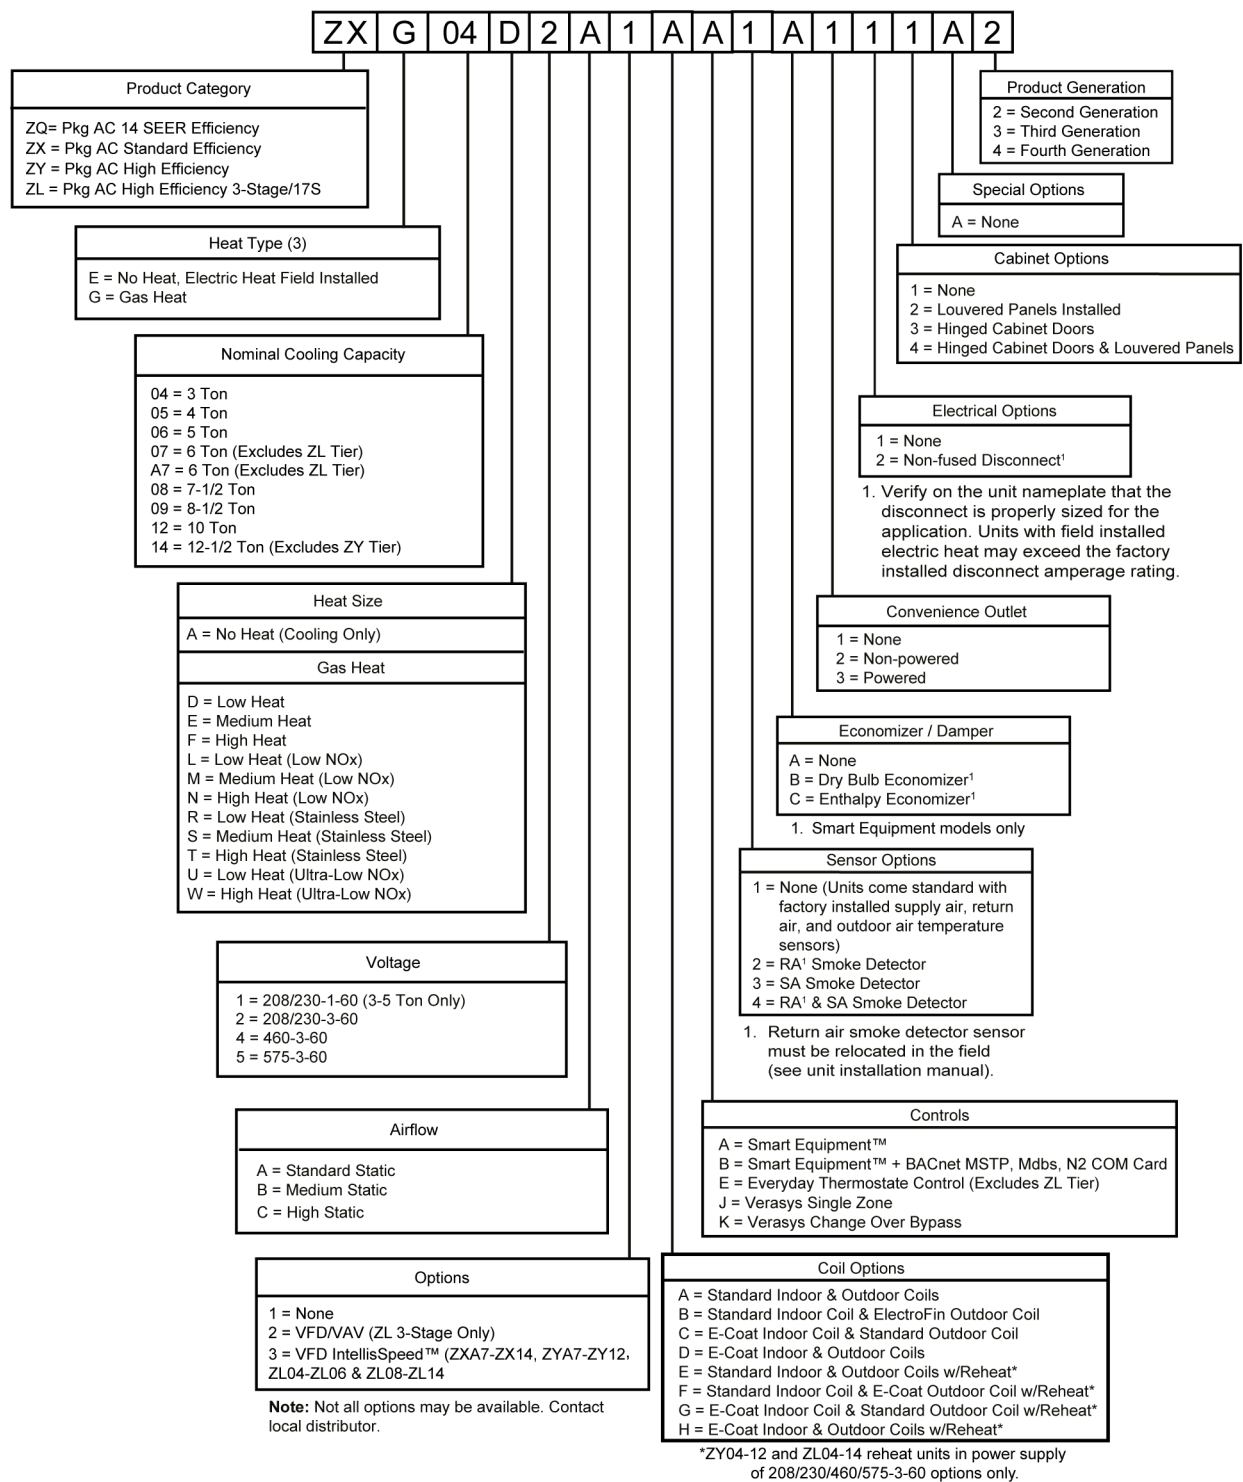

# Accessories

**Table 1: Accessories**

Accessory kit number	Description	Where used	Voltage
2EE04706725	Econ, DB, vertical flow, small footprint with barometric relief with ETC	ZY04, ZY05, ZY06, ZQ04, ZQ5, ZQ06, ZXA7	All
2EE04706825	Econ, DB, vertical flow, large footprint with barometric relief with ETC	ZYA7, ZY08, ZY09, ZY12	All
2EE04707025	Econ, DB, horizontal flow, small footprint, short cabinet with barometric relief with ETC	ZY04, ZQ04, ZQ05	All
2EE04707125	Econ, DB, horizontal flow, small footprint, tall cabinet with barometric relief with ETC	ZXA7, ZY05, ZY06, ZQ06	All
2EE04707225	Econ, DB, horizontal flow, large footprint, short cabinet with barometric relief with ETC	ZYA7	All
2EE04707325	Econ, DB, horizontal flow, large footprint, tall cabinet with barometric relief with ETC	ZY08, ZY09, ZY12	All
2EE04706724	Econ, DB, vertical flow, small footprint with SE	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ5, ZQ06, ZXA7	All
2EE04706824	Econ, DB, vertical flow, large footprint with SE	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
2EE04707024	Econ, DB, horizontal flow, small footprint, short cabinet with SE	ZL04, ZY04, ZQ04, ZQ05	All
2EE04707124	Econ, DB, horizontal flow, small footprint, tall cabinet with SE	ZL05, ZL06, ZX07, ZXA7, ZY05, ZY06, ZQ06	All
2EE04707224	Econ, DB, horizontal flow, large footprint, short cabinet with SE	ZYA7	All
2EE04707324	Econ, DB, horizontal flow, large footprint, tall cabinet with SE	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1FA0415	Manual outside air damper 0-35%	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
1FA0416	Manual outside air damper 0-35%	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1FA0417	Manual outside air damper 0-100%	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
1FA0418	Manual outside air damper 0-100%	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
2MD04704424	0-35% motorized outside air damper	ZXA7, ZQ04-06, ZY04-06, ZL04-06,	All
2MD04704524	0-35% motorized outside air damper	ZYA7-ZY12	All
2MD04704224	Motorized outside air damper 0-100%	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZXA7	All
2MD04704324	Motorized outside air damper 0-100%	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
2EC0401	Kit, single enthalpy field installed	All	All
2EC0402	Kit, dual enthalpy field installed	All	All
1HD0401	Hinged filter access panel for units with a horizontal economizer	ZQ04, ZQ05, ZY04, ZL04	All
1HD0402	Hinged filter access panel for units with a horizontal economizer	ZQ06, ZL05, ZL06, ZY05, ZY06, ZXA7	All
1HD0403	Hinged filter access panel for units with a horizontal economizer	ZYA7	All
1HD0404	Hinged filter access panel for units with a horizontal economizer	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1HG0419	Hail guard kit small footprint, short cabinet	ZY04, ZL04, ZQ04, ZQ05	All
1HG0420	Hail guard kit small footprint, tall cabinet	ZL05, ZL06, ZY05, ZY06, ZQ06, ZXA7	All
1HG0423	Hail guard kit large footprint, short cabinet	ZYA7	All



**Table 1: Accessories**

Accessory kit number	Description	Where used	Voltage
1HG0424	Hail guard kit large footprint, tall cabinet	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1RC0456	Curb rigid 14 in. small footprint	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
1RC0457	Curb rigid 14 in. large footprint	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1RC0458	Curb rigid 24 in. small footprint	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
1RC0459	Curb rigid 24 in. large footprint	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
2PE04704206	Power exhaust vertical flow small footprint 208 V to 230 V 1-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-1-60
2PE04704225	Power exhaust vertical flow small footprint 208 V to 230 V 3-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-3-60
2PE04704246	Power exhaust vertical flow small footprint 460 V 3-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	460-3-60
2PE04704258	Power exhaust vertical flow small footprint 575 V 3-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	575-3-60
2PE04704306	Power exhaust vertical flow large footprint 208 V to 230 V 1-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-1-60
2PE04704325	Power exhaust vertical flow large footprint 208 V to 230 V 3-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-3-60
2PE04704346	Power exhaust vertical flow large footprint 460 V 3-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	460-3-60
2PE04704358	Power exhaust vertical flow large footprint 575 V 3-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	575-3-60
2PE04704406	Power exhaust horizontal flow small footprint 208 V to 230 V 1-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-1-60
2PE04704425	Power exhaust horizontal flow small footprint 208 V to 230 V 3-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-3-60
2PE04704446	Power exhaust horizontal flow small footprint 460 V 3-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	460-3-60
2PE04704458	Power exhaust horizontal flow small footprint 575 V 3-ph	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	575-3-60
2PE04704506	Power exhaust horizontal flow large footprint 208 V to 230 V 1-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-1-60
2PE04704525	Power exhaust horizontal flow large footprint 208 V to 230 V 3-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-3-60
2PE04704546	Power exhaust horizontal flow large footprint 460 V 3-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	460-3-60
2PE04704558	Power exhaust horizontal flow large footprint 575 V 3-ph	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	575-3-60
1HA0454	High altitude kit for natural gas (2,000-10,000 ft) <b>Note:</b> Not for use with Ultra-Low NOx (ULN) models	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 - Low, Med, High Heat ZYA7 - Low Heat	All
1HA0455	High altitude kit for natural gas (2,000-10,000 ft)	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 - Low, Med, High Heat ZYA7 - Med, High Heat	All
1NP0456	Propane conversion kit. <b>Note:</b> Not for use with low NOx or Ultra-Low NOx (ULN) models	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 - Low, Med, High Heat ZYA7 - Low Heat	All
1NP0457	Propane conversion kit	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 - Low, Med, High Heat ZYA7 - Med, High Heat	All

**Table 1: Accessories**

Accessory kit number	Description	Where used	Voltage
1HA0458	High altitude kit for propane (2,000-10,000 ft) <b>Note:</b> Not for use with low NOx or Ultra-Low NOx (ULN) models	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 - Low, Med, High Heat ZYA7 - Low Heat	All
1HA0459	High altitude kit for propane (2,000-10,000 ft)	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 - Low, Med, High Heat ZYA7 - Med, High Heat	All
1FE0414	Flue exhaust kit	ZLG04, ZYG04, ZQG04, ZQG05	All
1FE0415	Flue exhaust kit	ZXGA7, ZLG05, ZLG06, ZYG05, ZYG06, ZYGA7, ZQG06	All
1FE0416	Flue exhaust kit	ZYG08, ZYG09, ZYG12, ZL08, ZL09, ZL12, ZL14	All
1HS0401	Flue heat shield accessory	ZQ04, ZQ05, ZQ06, ZXA7, ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
2EK04510625	6.5 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-(1 or 3)-60
2EK04510646	6.0 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	460-3-60
2EK04510725	6.5 kW electric heat	ZYA7	208/230-3-60
2EK04510746	6.0 kW electric heat	ZYA7	460-3-60
2EK04511058	9.2 kW electric heat	ZL04, ZL05, ZY04, ZY05, ZQ04, ZQ05	575-3-60
2EK04511125	10.5 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-(1 or 3)-60
2EK04511146	11.5 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	460-3-60
2EK04511458	13.8 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06	575-3-60
2EK04511446	14 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	460-3-60
2EK04511625	16 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-3-60
2EK04511725	16 kW electric heat	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-3-60
2EK04511746	16.5 kW electric heat	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	460-3-60
2EK04511758	17 kW electric heat	ZYA7, ZY08, ZY09, ZL08, ZL09, ZL14	575-3-60
2EK04512358	23 kW electric heat	ZL06, ZX06, ZY06, ZQ06	575-3-60
2EK04510625	6.5 kW electric heat	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	208/230-(1 or 3)-60
2EK04512525	24.8 kW electric heat	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-3-60
2EK04512646	25.5kW electric heat	ZYA7	460-3-60
2EK04512658	25.7kW electric heat	ZYA7	575-3-60
2EK04512846	27.8 kW electric heat	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	460-3-60
2EK04513225	32 kW electric heat	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-3-60
2EK04513346	33 kW electric heat	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	460-3-60
2EK04513458	34 kW electric heat	ZY08, ZY09, ZL08, ZL09, ZL14	575-3-60
2EK04514225	42.4 kW electric heat	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	208/230-3-60
2EK04514246	41.7 kW electric heat	ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	460-3-60

**Table 1: Accessories**

Accessory kit number	Description	Where used	Voltage
2LA04704725	Low ambient accessory kit	ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06	208 V/230 V-1-60 or 208 V/230 V-3-60
2LA04704746	Low ambient accessory kit	ZY04, ZY05, ZYA7, ZQ04, ZQ05, ZQ06	460 V-3-60
2LA04704758	Low ambient accessory kit	ZY04, ZY05, ZY08, ZQ04, ZQ05, ZQ06	575 V-3-60
2LA04704825	Low ambient accessory kit	ZYA7, ZY08, ZY09, ZL08, ZL09	208 V/230 V-1-60 or 208 V/230 V-3-60
2LA04704846	Low ambient accessory kit	ZYA7, ZY08, ZY09, ZL08, ZL09	460 V-3-60
2LA04704858	Low ambient accessory kit	ZYA7, ZY08, ZY09, ZL08, ZL09	575 V-3-60
2LA04704925	Low ambient accessory kit	ZY12, ZL12, ZL14	208 V/230 V-3-60
2LA04704946	Low ambient accessory kit	ZY12, ZL12, ZL14	460 V-3-60
2LA04704958	Low ambient accessory kit	ZY12, ZL12, ZL14	575 V-3-60
2SD04701224	Supply air stream smoke detector	ZXA7, ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZYA7, ZY08, ZY09, ZY12, ZQ04, ZQ05, ZQ06, ZL08, ZL09, ZL12, ZL14	All
2SD04701124	Return air stream smoke detector	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
2SD04701424	Return air stream smoke detector	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
2SD04701324	Combination supply and return air stream smoke detector	ZY04, ZY05, ZY06, ZL04, ZL05, ZL06, ZQ04, ZQ05, ZQ06, ZXA7	All
2SD04701624	Combination supply and return air stream smoke detector	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1TB0401	Small footprint through the base electrical and through the curb gas	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
1TB0402	Large footprint through the base electrical and through the curb gas	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1TB0403	Small footprint through the base electrical and gas	ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7	All
1TB0404	Large footprint through the base electrical and gas	ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14	All
1LD0420	High speed drive kit	ZQ05	3-phase only

# AHRI cooling rating table

**Table 2: AHRI cooling rating table**

Unit	Cooling stages	Nom. cooling capacity (tons)	Net cooling capacity (MBH)	Total power (kW)	SEER	SEER2	EER/EER2 (cooling only)	EER/ EER2 (A/C with gas heat)	IEER (A/C with gas heat/ cooling only)	IEER with Intelli Speed (cooling only)	IEER with Intelli Speed (gas heat)
ZQ04	1	3	34.6	2.9	14.0	13.4	12.2/11.7	12.2/11.7	—	—	—
ZQ05	1	4	47.0	4.1	14.0	13.4	12.0/11.3	12.0/11.3	—	—	—
ZQ06	1	5	58.0	5.0	14.1	13.4	12.1/11.5	12.1/11.5	—	—	—
ZXA7	2	6	67.0	6.0	—	—	11.2	11.0	—	14.8	14.8
ZY04	1	3	36.0	2.9	15.0	14.5	12.0/12.0	12.0/12.0	—	—	—
ZY05	1	4	49.0	4.0	15.4	14.5	12.0/12.0	12.0/12.0	—	—	—
ZY06	1	5	56.0	4.5	15.0	14.3	12.0/12.0	12.0/12.0	—	—	—
ZYA7	2	6	71.0	5.89	—	—	12.2	12.0	14.8/14.6	16.0	16.0
ZY08	2	7.5	89.0	7.4	—	—	12.2	12.0	—	14.8	14.6
ZY09	2	8.5	98.0	7.3	—	—	12.2	12.0	—	14.8	14.6
ZY12	2	10.0	116.0	8.9	—	—	12.2	12.0	—	14.8	14.6
ZL04 <sup>1</sup>	2	3	34.8	2.8	17.2	16.0	13.2/12.2	13.2/12.2	—	—	—
ZL05 <sup>1</sup>	2	4	48.0	3.9	17.1	16.5	12.7/12.2	12.7/12.2	—	—	—
ZL06 <sup>1</sup>	2	5	58.5	4.8	17.0	16.0	12.8/12.0	12.8/12.0	—	—	—
ZL08	3	7.5	89.0	7.4	—	—	12.2	12.0	—	15.8	15.6
ZL09	3	8.5	98.0	8.0	—	—	12.2	12.0	—	16.3	16.1
ZL12	3	10.0	116.0	9.6	—	—	12.2	12.0	—	15.6	15.4
ZL14	3	12.5	135.0	11.9	—	—	11.2	11.0	—	14.9	14.7

1 208/230V & 460V direct drive units

**Table 3: AHRI cooling ratings for two-stage cooling with multistage direct blower**

Voltage	Model	Tonnage	Cooling stage	KW	SEER/ SEER2	EER/EER2	AHRI capacity	Blower type
230 V/460 V	ZL04	3	2	2.8	17.2/16.0	13.2/12.2	34,800	Multistage direct
	ZL05	4	2	3.9	17.1/16.5	12.7/12.2	48,000	Multistage direct
	ZL06	5	2	4.8	17.0/16.0	12.8/12.0	58,500	Multistage direct
575 V	ZL04	3	2	2.8	16.5	12.8	36,000	Multistage direct
	ZL05	4	2	3.8	16	12.5	47,000	Multistage direct
	ZL06	5	2	4.8	15.6	12.2	58,500	Multistage direct

**Table 4: AHRI cooling ratings: Two-stage cooling with belt drive and VFD blower**

Voltage	Model	Tonnage	Cooling stage	KW	SEER/SEER2	EER/EER2	AHRI capacity	Blower type
230 V/460 V	ZL04	3	2	3.0	16.0/14.0	12.5/11.2	34,000	Belt drive +VFD
	ZL05	4	2	4.2	15.6/15.0	12.0/11.5	47,500	Belt drive +VFD
	ZL06	5	2	4.9	15.8/14.8	12.4/11.5	58,000	Belt drive +VFD
575 V	ZL04	3	2	3.0	15.1	12.2	36,000	Belt drive +VFD
	ZL05	4	2	4.2	14.4	11.2	47,000	Belt drive +VFD
	ZL06	5	2	4.9	14.9	11.9	58,000	Belt drive +VFD

# AHRI 270 outdoor sound power levels

**Table 5: Outdoor sound power levels**

Size (ton)	Sound rating <sup>1</sup> dB(A)	Octave bands (Hz)							
		63	125	250	500	1000	2000	4000	8000
ZQ04 (3)	81	79.0	83.0	77.5	76.0	76.0	76.0	71.0	66.5
ZQ05 (4)	79	81.5	84.0	78.0	75.0	74.0	69.5	66.0	61.5
ZQ06 (5)	80	85.0	83.0	77.0	76.0	76.5	72.0	67.5	65.5
ZXA7 (6)	79	84.0	82.0	77.0	75.0	74.5	71.0	66.5	63.0
ZY04 (3)	79	81.0	86.5	77.0	76.0	75.0	70.5	66.5	63.5
ZY05 (4)	79	84.0	83.0	76.0	75.0	74.0	70.0	66.0	63.5
ZY06 (5)	79	83.0	83.0	76.0	75.0	75.0	69.5	66.0	63.0
ZY08 (7.5)	81	87.0	81.5	80.0	78.0	76.5	72.0	67.0	63.0
ZY09 (8.5)	83	92.0	87.0	81.0	80.5	79.0	74.0	69.0	66.0
ZY12 (10)	84	89.5	86.5	82.5	81.0	79.0	75.5	73.5	69.5
ZL04 (3)	75	76.5	80.0	74.5	71.0	71.0	65.0	63.5	63.0
ZL05 (4)	76	83.0	79.0	74.5	72.0	73.0	66.5	62.0	59.5
ZL06 (5)	78	84.0	84.5	76.5	75.5	73.5	68.5	65.0	60.5
ZL08 (7.5)	82	85.0	85.5	79.5	78.5	77.5	72.5	68.0	64.0
ZL09 (8.5)	82	88.5	83.0	81.0	79.0	78.0	73.5	69.0	65.5
ZL12 (10)	86	82.0	88.5	85.0	82.5	80.5	76.0	73.5	69.5
ZL14 (12.5)	86	84.0	88.5	84.5	83.5	81.0	76.5	73.5	69.5

<sup>1</sup> Rated in accordance with AHRI 270-2015.

# Physical data

## ZQ04 to ZQ06 physical data

**Table 6: ZQ04 physical data**

Component		Models							Models
		ZQG04							ZQE04
Nominal tonnage		3							3
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	35,600							35,600
	AHRI net capacity (BTU)	34,600							34,600
	EER/EER2	12.2/11.7							12.2/11.7
	SEER	14							14
	SEER2	13.4							13.4
	Nominal cfm	1,200							1,200
	System power (kW)	2.9							2.9
	Refrigerant type	R-410A							R-410A
	Refrigerant charge (lb-oz)								
System 1	3-6							3-6	
System 2	-							-	
AHRI heating performance single-phase	Heating option	L	D	—	M	E	—	-	
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—	-	
	First stage heat input (kBtu)	-	-	—	-	-	—	-	
	Second stage heat input (kBtu)	56	70	—	90	112	—	-	
	First stage heat output (kBtu)	-	-	—	-	-	—	-	
	Second stage heat output (kBtu)	45	56	—	72	90	—	-	
	AFUE %	-	-	—	-	81	—	-	
	FER compliant	-	-	—	-	Yes	—	-	
	Number of burners	2	2	—	3	3	—	-	
	Number of stages	1	1	—	1	1	—	-	
	Temperature rise range (°F)	10-40	20-50	—	35-65	50-80	—	-	
	Gas limit setting (°F)	150	150	—	140	140	—	-	
	Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—	-	
AHRI heating performance three-phase	Heating option	L	D	U	M	E	W	-	
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low NOx)	Med (Low NOx)	Med	High (Ultra-Low NOx)	-	
	First stage heat input (kBtu)	-	-	—	-	82	—	-	
	Second stage heat input (kBtu)	56	70	60	90	112	100	-	
	First stage heat output (kBtu)	-	-	—	-	66	—	-	
	Second stage heat output (kBtu)	45	56	48	72	90	80	-	
	Steady state efficiency (%)	80	80	80	80	80	80	-	
	Number of burners	2	2	1	3	3	1	-	
	Number of stages	1	1	1	1	2	1	-	
	Temperature rise range (°F)	28-46	35-58	20-50	44-74	55-78	45-75	-	
	Gas limit setting (°F)	150	150	150	140	140	170	-	
Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	-		
Dimensions (in.)	Length	74.1							74.1
	Width	48.9							48.9
	Height	32.5							32.5
Operating weight (lb)		498							450
Compressors	Type	Scroll							Scroll
	Quantity	1							1
	Unit capacity steps (%)	100							100
Condenser coil data	Face area (sq ft)	16.3							16.3
	Rows	1							1
	Fins per in.	23							23
	Tube diameter (in./mm)	0.63/16							0.63/16
	Circuitry type	2-pass Microchannel							2-pass Microchannel

**Table 6: ZQ04 physical data**

Component		Models		Models	
		ZQG04		ZQE04	
Nominal tonnage		3		3	
Evaporator coil data	Face area (sq ft)	5.5		5.5	
	Rows	2		2	
	Fins per in.	15		15	
	Tube diameter	0.375		0.375	
	Circuitry type	Intertwined		Intertwined	
	Refrigerant control	Orifice		Orifice	
Condenser fan data	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/4		1/4	
	Number of speeds	1		1	
	rpm	1,100		1,100	
Evaporator fan data - Direct drive	Nominal total cfm	3,800		3,800	
	Airflow option	A		A	
	Quantity	1		1	
	Fan size (in.)	10 x 10		10 x 10	
	Type	Centrifugal		Centrifugal	
	Motor hp	3/4		3/4	
Evaporator fan data - Belt drive	Motor rpm	1,050		1,050	
	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan Size (in.)	10 x 10	10 x 10	10 x 10	10 x 10
	Type	Centrifugal	Centrifugal	Centrifugal	Centrifugal
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A39	A40	A39	A40
	Motor hp, 1-phase	1.5	--	1.5	--
	Frame size, 1-phase	56 Hz	--	56 Hz	--
	Motor hp, 3-phase	2.4	2.4	2.4	2.4
	Frame size, 3-phase	56Y	56Y	56Y	56Y
Filters	Motor rpm	1,725	1,725	1,725	1,725
	Quantity - size	2 - (16 x 25 x 2) <sup>1</sup>		2 - (16 x 25 x 2) <sup>1</sup>	

1 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)



**Table 7: ZQ05 physical data**

Component		Models								Models
		ZQG05								ZQE05
Nominal tonnage		4								4
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	49,500								49,500
	AHRI net capacity (BTU)	47,000								47,000
	EER/EER2	12.0/11.3								12.0/11.3
	SEER	14								14
	SEER2	13.4								13.4
	Nominal cfm	1,575								1,575
	System power (kW)	4.1								4.1
	Refrigerant type	R-410A								R-410A
	Refrigerant charge (lb-oz)									
AHRI heating performance single-phase	System 1	4-6								4-6
	System 2	-								-
	Heating option	L	D	—	M	E	—	N	F	
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—	High, (Low NOx)	High	
	First stage heat input (kBTU)	-	-	—	-	-	—	-	-	
	Second stage heat input (kBTU)	56	70	—	90	112	—	116	142	
	First stage heat output (kBTU)	-	-	—	-	-	—	-	-	
	Second stage heat output (kBTU)	45	56	—	72	90	—	93	114	
	AFUE %	-	-	—	-	81	—	-	-	
	FER compliant	-	-	—	-	Yes	—	-	-	
	Number of burners	2	2	—	3	3	—	3	3	
	Number of stages	1	1	—	1	1	—	1	1	
	Temperature rise range (°F)	05-35	15-45	—	25-55	40-70	—	35-65	45-75	
AHRI heating performance three-phase	Gas limit setting (°F)	150	150	—	140	140	—	150	145	
	Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—	1/2	1/2	
	Heating option	L	D	U	M	E	W	N	F	
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low NOx)	Med (Low NOx)	Med	High (Ultra-Low NOx)	High, (Low NOx)	High	
	First stage heat input (kBTU)	-	-	—	-	-	—	-	100	
	Second stage heat input (kBTU)	56	70	60	90	112	100	118	145	
	First stage heat output (kBTU)	-	-	—	-	-	—	-	80	
	Second stage heat output (kBTU)	45	56	48	72	90	80	94	116	
	Steady state efficiency (%)	80	80	80	80	80	80	80	80	
	Number of burners	2	2	1	3	3	1	3	3	
	Number of stages	1	1	1	1	1	1	1	2	
	Temperature rise range (°F)	21-35	26-43	20-50	33-56	41-69	30-60	44-73	49-77	
	Gas limit setting (°F)	150	150	150	140	140	160	150	145	
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	
Dimensions (in.)	Length	74.1								74.1
	Width	48.9								48.9
	Height	32.5								32.5
Operating weight (lb)		538								487
Compressors	Type	Scroll								Scroll
	Quantity	1								1
	Unit capacity steps (%)	100								100
Condenser coil data	Face area (sq ft)	16.3								16.3
	Rows	1								1
	Fins per in.	23								23
	Tube diameter (in./mm)	.63/16								.63/16
	Circuitry type	2-pass Microchannel								2-pass Microchannel
Evaporator coil data	Face area (sq ft)	5.5								5.5
	Rows	3								3
	Fins per in.	15								15
	Tube diameter	0.375								0.375
	Circuitry type	Intertwined								Intertwined
	Refrigerant control	Orifice								Orifice

**Table 7: ZQ05 physical data**

Component		Models		Models	
		ZQG05		ZQE05	
Nominal tonnage		4		4	
Condenser fan data	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/4		1/4	
	Number of speeds	1		1	
	rpm	1,100		1,100	
Evaporator fan data - Direct drive	Nominal total cfm	3,800		3,800	
	Airflow option	A		A	
	Quantity	1		1	
	Fan Size (in.)	10 x 10		10 x 10	
	Type	Centrifugal		Centrifugal	
	Motor hp	1		1	
Evaporator fan data - Belt drive	Motor rpm	1,050		1,050	
	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	10 x 10	10 x 10	10 x 10	10 x 10
	Type	Centrifugal	Centrifugal	Centrifugal	Centrifugal
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A39	A40	A39	A40
	Motor hp, 1-phase	1.5	--	1.5	--
	Frame size, 1-phase	56 Hz	--	56 Hz	--
	Motor hp, 3-phase	2.4	2.4	2.4	2.4
	Frame size, 3-phase	56Y	56Y	56Y	56Y
	Motor rpm	1,725	1,725	1,725	1,725
Filters	Quantity - size	2 - (16 x 25 x 2) <sup>1</sup>		2 - (16 x 25 x 2) <sup>1</sup>	

1 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

**Table 8: ZQ06 physical data**

Component		Models									Models
		ZQG06									ZQE06
Nominal tonnage		5									5
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	60,500									60,500
	AHRI net capacity (BTU)	58,000									58,000
	EER/EER2	12.1/11.5									12.1/11.5
	SEER	14.1									14.1
	SEER2	13.4									13.4
	Nominal cfm	1,800									1,800
	System power (kW)	5.0									5.0
	Refrigerant type	R-410A									R-410A
	Refrigerant charge (lb-oz)	—									—
AHRI heating performance single-phase	System 1	5-10									5-10
	System 2	—									—
	Heating option	L	D	—	M	E	—	N	F	—	
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—	High, (Low NOx)	High	—	
	First stage heat input (kBTU)	—	—	—	—	—	—	—	—	—	
	Second stage heat input (kBTU)	56	70	—	90	112	—	116	142	—	
	First stage heat output (kBTU)	—	—	—	—	—	—	—	—	—	
	Second stage heat output (kBTU)	45	56	—	72	90	—	93	114	—	
	AFUE %	—	—	—	—	81	—	—	—	—	
	FER compliant	—	—	—	—	Yes	—	—	—	—	
	Number of burners	2	2	—	3	3	—	3	3	—	
	Number of stages	1	1	—	1	1	—	1	1	—	
	Temperature rise range (°F)	05-35	10-40	—	15-45	30-60	—	30-60	40-70	—	
AHRI heating performance three-phase	Gas limit setting (°F)	150	150	—	140	140	—	145	140	—	
	Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—	1/2	1/2	—	
	Heating option	L	D	U	M	E	W	N	F	—	
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low NOx)	Med (Low NOx)	Med	High (Ultra-Low NOx)	High, (Low NOx)	High	—	
	First stage heat input (kBTU)	—	—	—	—	—	—	—	100	—	
	Second stage heat input (kBTU)	56	70	60	90	112	100	118	145	—	
	First stage heat output (kBTU)	—	—	—	—	—	—	—	80	—	
	Second stage heat output (kBTU)	45	56	48	72	90	80	94	116	—	
	Steady state efficiency (%)	80	80	80	80	80	80	80	80	—	
	Number of burners	2	2	1	3	3	1	3	3	—	
	Number of stages	1	1	1	1	1	1	1	2	—	
	Temperature rise range (°F)	17-28	21-35	10-40	27-44	33-55	25-55	35-58	43-72	—	
	Gas limit setting (°F)	150	150	150	140	140	160	145	140	—	
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	—	
Dimensions (in.)	Length	74.1									74.1
	Width	48.9									48.9
	Height	40.6									40.6
Operating weight (lb)		610									561
Compressors	Type	Scroll									Scroll
	Quantity	1									1
	Unit capacity steps (%)	100									100
Condenser coil data	Face area (sq ft)	21.1									21.1
	Rows	1									1
	Fins per in.	23									23
	Tube diameter (in./mm)	.71/18									.71/18
	Circuitry type	2-pass Microchannel									2-pass Microchannel

**Table 8: ZQ06 physical data**

Component		Models		Models	
		ZQG06		ZQE06	
Nominal tonnage		5		5	
Evaporator coil data	Face area (sq ft)	7.3		7.3	
	Rows	3		3	
	Fins per in.	15		15	
	Tube diameter	0.375		0.375	
	Circuitry type	Intertwined		Intertwined	
	Refrigerant control	Orifice		Orifice	
Condenser fan data	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/2		1/2	
	Number of speeds	1		1	
	rpm	1,085		1,085	
Evaporator fan data - Direct drive	Nominal total cfm	4,500		4,500	
	Airflow option	A		A	
	Quantity	1		1	
	Fan size (in.)	11 x 10		11 x 10	
	Type	Centrifugal		Centrifugal	
	Motor hp	1		1	
Evaporator fan data - Belt drive	Motor rpm	1,050		1,050	
	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	11 x 10	11 x 10	11 x 10	11 x 10
	Type	Centrifugal	Centrifugal	Centrifugal	Centrifugal
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A37	A39	A37	A39
	Motor hp, 1-phase	1.5	--	1.5	--
	Frame size, 1-phase	56 Hz	--	56 Hz	--
	Motor hp, 3-phase	2.4	2.9	2.4	2.9
	Frame size, 3-phase	56Y	56 Hz	56Y	56 Hz
	Motor rpm	1,725	1,725	1,725	1,725
Filters	Quantity - size	4 - (16 x 16 x 2) <sup>1</sup>		4 - (16 x 16 x 2) <sup>1</sup>	

1 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

# ZXA7 physical data

**Table 9: ZXA7 physical data**

Component		Models			
		ZXGA7			ZXEA7
Nominal tonnage		6			6
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	70,000			70,000
	AHRI net capacity (BTU)	67,000			67,000
	EER	11.0			11.2
	SEER	—			-
	IEER IntelliSpeed	14.8			14.8
	Nominal cfm	2,200			2,200
	System power (kW)	6.0			6.0
	Refrigerant type	R-410A			R-410A
	Refrigerant charge (lb-oz)				
	System 1	7-4			7-4
	System 2				
AHRI heating performance	Heating option	D	E	F	—
	Heating model	Low	Med	High	—
	First stage heat input (kBTU)	—	—	100	—
	Second stage heat input (kBTU)	70	114	145	—
	First stage heat output (kBTU)	—	—	80	—
	Second stage heat output (kBTU)	56	91	116	—
	AFUE %	—	—	—	—
	Steady state efficiency (%)	80	80	80	—
	Number of burners	2	3	3	—
	Number of stages	1	1	2	—
	Temperature rise range (°F)	17-29	28-47	36-60	—
	Gas limit setting (°F)	150	140	140	—
	Gas piping connection (in.)	1/2	1/2	1/2	—
Dimensions (in.)	Length	74.1			74.1
	Width	48.9			48.9
	Height	40.6			40.6
Operating weight (lb)		668			614
Compressors	Type	Scroll			Scroll
	Quantity	1			1
	Unit capacity steps (%)	67/100			67/100
Condenser coil data	Face area (sq ft)	21.1			21.1
	Rows	1			1
	Fins per in.	23			23
	Tube diameter (in./mm)	.79/20			.79/20
Evaporator coil data	Circuitry type	2-pass Microchannel			2-pass Microchannel
	Face area (sq ft)	7.3			7.3
	Rows	4			4
	Fins per in.	15			15
	Tube diameter	0.375			0.375
	Circuitry type	Intertwined			Intertwined
	Refrigerant control	TXV			TXV
Condenser fan data	Quantity of fans	1			1
	Fan diameter (in.)	22			22
	Type	Prop			Prop
	Drive type	Direct			Direct
	Quantity of motors	1			1
	Motor hp each	1/2			1/2
	Number of speeds	2			2
	rpm	900 / 1,150			900 / 1,150
	Nominal total cfm	3,600 / 4,600			3,600 / 4,600

**Table 9: ZXA7 physical data**

Component		Models					
		ZXGA7			ZXEA7		
Nominal tonnage		6			6		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	11 x 10	11 x 10	11 x 10	11 x 10	11 x 10	11 x 10
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
	Blower sheave	AK51	AK51	AK51	AK51	AK51	AK51
	Belt	A39	A40	A41	A39	A40	A41
	Motor max bhp, 3 phase	2.4	2.9	3.7	2.4	2.9	3.7
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56HZ	56Y	56Y	56HZ
Filters	Quantity - size	4 - (16 x 16 x 2) <sup>1</sup>			4 - (16 x 16 x 2) <sup>1</sup>		

1 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

## ZY04 to ZY12 physical data

**Table 10: ZY04 physical data**

Component		Models					
		ZYG04					ZYE04
Nominal tonnage		3					3
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	37,900					37,900
	AHRI net capacity (BTU)	36,000					36,000
	EER/EER2	12.0/12.0					12.0/12.0
	SEER	15					15
	SEER2	14.5					14.5
	Nominal cfm	1,200					1,200
	System power (kW)	2.9					2.9
	Refrigerant type	R-410A					R-410A
	Refrigerant charge (lb-oz)						
	System 1	4-10					4-10
	System 2	—					—
	Refrigerant charge MagnaDRY option (lb-oz) <sup>1</sup>						
System 1	3-12					3-12	
System 2	—					—	
AHRI heating performance single phase	Heating option	L	D	—	M	E	—
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—
	1st stage heat input (kBTU)	—	—	—	—	—	—
	2nd stage heat input (kBTU)	56	70	—	90	112	—
	1st stage heat output (kBTU)	—	—	—	—	—	—
	2nd stage heat output (kBTU)	45	56	—	72	90	—
	AFUE %	—	—	—	—	81	—
	FER compliant	—	—	—	—	Yes	—
	No. burners	2	2	—	3	3	—
	No. stages	1	1	—	1	1	—
	Temperature rise range (°F)	10-40	20-50	—	35-65	50-80	—
	Gas limit setting (°F)	150	150	—	140	140	—
	Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—

**Table 10: ZY04 physical data**

Component		Models						
		ZYG04						ZYE04
Nominal tonnage		3						3
AHRI heating performance three phase	Heating option	L	D	U	M	E	W	—
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low Nox)	Med (Low NOx)	Med	High (Ultra-Low Nox)	—
	1st stage heat input (kBTU)	—	49	—	—	82	—	—
	2nd stage heat input (kBTU)	56	70	60	90	112	100	—
	1st stage heat output (kBTU)	—	39	—	—	66	—	—
	2nd stage heat output (kBTU)	45	56	48	72	90	80	—
	Steady state efficiency (%)	80	80	80	80	80	80	—
	No. burners	2	2	1	3	3	1	—
	No. stages	1	2	1	1	2	1	—
	Temperature rise range (°F)	28-46	35-58	20-50	44-74	55-78	45-75	—
	Gas limit setting (°F)	150	150	150	140	140	170	—
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	—
Dimensions (in.)	Length	74.1						74.1
	Width	48.9						48.9
	Height	32.5						32.5
Operating weight (lb)		527						481
	With MagnaDRY	535						489
Compressors	Type	Scroll						Scroll
	Quantity	1						1
	Unit capacity steps (%)	100						100
Condenser coil data	Face area (sq ft)	16.3						16.3
	Rows	1						1
	Fins per in.	23						23
	Tube diameter (in./mm)	.63/16						.63/16
	Circuitry type	2-pass Microchannel						2-pass Microchannel
Evaporator coil data	Face area (sq ft)	5.5						5.5
	Rows	3						3
	Fins per in.	15						15
	Tube diameter	0.375						0.375
	Circuitry type	Intertwined						Intertwined
	Refrigerant control	TXV						TXV
Reheat option coil data	Face area (sq ft)	3.5						3.5
	Rows	1						1
	Fins per in.	23						23
	Tube diameter (in./mm)	.63/16						.63/16
Condenser fan data	Quantity of fans	1						1
	Fan diameter (in.)	22						22
	Type	Prop						Prop
	Drive type	Direct						Direct
	Quantity of motors	1						1
	Motor hp each	1/4						1/4
	No. speeds	1						1
	rpm	1,100						1,100
	Nominal total cfm	3,800						3,800
Evaporator fan data direct drive	Airflow option	A						A
	Quantity	1						1
	Fan size (in.)	10 x 10						10 x 10
	Type	Centrifugal						Centrifugal
	Motor hp	3/4						3/4
	rpm	1,050						1,050

**Table 10: ZY04 physical data**

Component		Models			
		ZYG04		ZYE04	
Nominal tonnage		3		3	
Evaporator fan data belt drive	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	10 x 10	10 x 10	10 x 10	10 x 10
	Type	Centrifugal		Centrifugal	
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A39	A40	A39	A40
	Motor hp, 1 phase	1.5	—	1.5	—
	Motor Max bhp, 3 phase	2.4	2.4	2.4	2.4
	rpm	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56Y	56Y
Filters	Quantity - size	2 - (16 x 25 x 2) <sup>2</sup>		2 - (16 x 25 x 2) <sup>3</sup>	

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).



**Table 11: ZY05 physical data**

Component		Models									
		ZYG05								ZYE05	
Nominal tonnage		4								4	
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	51,000								51,000	
	AHRI net capacity (BTU)	49,000								49,000	
	EER/EER2	12.0/12.0								12.0/12.0	
	SEER	15.4								15.4	
	SEER2	14.5								14.5	
	Nominal cfm	1,600								1,600	
	System power (kW)	4.0								4.0	
	Refrigerant type	R-410A								R-410A	
	Refrigerant charge (lb-oz)										
	System 1	6-8								6-8	
	System 2	—								—	
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)										
	System 1	6-6								6-6	
System 2	—								—		
AHRI heating performance single phase	Heating options	L	D	—	M	E	—	N	F	—	
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—	High, (Low NOx)	High	—	
	1st stage heat input (kBtu)	—	—	—	—	—	—	—	—	—	
	2nd stage heat input (kBtu)	56	70	—	90	112	—	116	142	—	
	1st stage heat output (kBtu)	—	—	—	—	—	—	—	—	—	
	2nd stage heat output (kBtu)	45	56	—	72	90	—	93	114	—	
	AFUE %	—	—	—	—	81	—	—	—	—	
	FER Compliant	—	—	—	—	Yes	—	—	—	—	
	No. burners	2	2	—	3	3	—	3	3	—	
	No. stages	1	1	—	1	1	—	1	1	—	
	Temperature rise range (°F)	05-35	15-45	—	25-55	40-70	—	35-65	45-75	—	
	Gas limit setting (°F)	150	150	—	140	140	—	150	145	—	
Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—	1/2	1/2	—		
AHRI heating performance three phase	Heating options	L	D	U	M	E	W	N	F	—	
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low Nox)	Med (Low NOx)	Med	High (Ultra-Low Nox)	High, (Low NOx)	High	—	
	1st stage heat input (kBtu)	—	49	—	—	82	—	—	100	—	
	2nd stage heat input (kBtu)	56	70	60	90	112	100	118	145	—	
	1st stage heat output (kBtu)	—	39	—	—	66	—	—	80	—	
	2nd stage heat output (kBtu)	45	56	48	72	90	80	94	116	—	
	Steady state efficiency (%)	80	80	80	80	80	80	80	80	—	
	No. burners	2	2	1	3	3	1	3	3	—	
	No. stages	1	2	1	1	2	1	1	2	—	
	Temperature rise range (°F)	21-35	26-43	15-45	33-56	41-69	30-60	44-73	49-77	—	
	Gas limit setting (°F)	150	150	150	140	140	160	150	145	—	
Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	—		
Dimensions (in.)	Length	74.1								74.1	
	Width	48.9								48.9	
	Height	40.6								40.6	
Operating weight (lb)		618								564	
	With MagnaDRY	628								574	
Compressors	Type	Scroll								Scroll	
	Quantity	1								1	
	Unit capacity steps (%)	100								100	
Condenser coil data	Face area (sq ft)	21.1								21.1	
	Rows	1								1	
	Fins per in.	23								23	
	Tube diameter (in./mm)	.79/20								.79/20	
	Circuitry type	2-pass Microchannel								2-pass Microchannel	

**Table 11: ZY05 physical data**

Component		Models			
		ZYG05		ZYE05	
Nominal tonnage		4		4	
Evaporator coil data	Face area (sq ft)	7.3		7.3	
	Rows	3		3	
	Fins per in.	15		15	
	Tube diameter	0.375		0.375	
	Circuitry type	Intertwined		Intertwined	
	Refrigerant control	TXV		TXV	
Reheat option coil data	Face area (sq ft)	4.4		4.4	
	Rows	1		1	
	Fins per in.	23		23	
	Tube diameter (in./mm)	.79/20		.79/20	
Condenser fan data	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/4		1/4	
	No. speeds	1		1	
	rpm	1,100		1,100	
	Nominal total cfm	4,000		4,000	
Evaporator fan data direct drive	Airflow option	A		A	
	Quantity	1		1	
	Fan size (in.)	10 x 10		10 x 10	
	Type	Centrifugal		Centrifugal	
	Motor hp	1		1	
	rpm	1,050		1,050	
Evaporator fan data belt drive	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	10 x 10	10 x 10	10 x 10	10 x 10
	Type	Centrifugal		Centrifugal	
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A39	A40	A39	A40
	Motor Hp, 1 phase	1.5	—	1.5	—
	Motor max bhp, 3 Phase	2.4	2.9	2.4	2.9
	rpm	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56Y	56Y
Filters	Quantity - size	4 - (16 x 16 x 2) <sup>2</sup>		4 - (16 x 16 x 2) <sup>2</sup>	

1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.

2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 12: ZY06 physical data**

Component		Models								
		ZYG06								ZYE06
Nominal tonnage		5								5
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	57,300								57,300
	AHRI net capacity (BTU)	56,000								56,000
	EER/EER2	12.0/12.0								12.0/12.0
	SEER	15.0								15.0
	SEER2	14.3								14.3
	Nominal cfm	1,600								1,600
	System power (kW)	4.5								4.5
	Refrigerant type	R-410A								R-410A
	Refrigerant charge (lb-oz)									
	System 1	7-10								7-10
	System 2	—								—
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)									
System 1	7-4								7-4	
System 2	—								—	
AHRI heating performance single phase	Heating options	L	D	—	M	E	—	N	F	—
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—	High, (Low NOx)	High	—
	1st stage heat input (kBTU)	—	—	—	—	—	—	—	—	—
	2nd stage heat input (kBTU)	56	70	—	90	112	—	116	142	—
	1st stage heat output (kBTU)	—	—	—	—	—	—	—	—	—
	2nd stage heat output (kBTU)	45	56	—	72	90	—	93	114	—
	AFUE %			—		81	—			—
	FER compliant			—		Yes	—			—
	No. burners	2	2	—	3	3	—	3	3	—
	No. stages	1	1	—	1	1	—	1	1	—
	Temperature rise range (°F)	05-35	10-40	—	15-45	30-60	—	30-60	40-70	—
	Gas limit setting (°F)	150	150	—	140	140	—	145	140	—
Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—	1/2	1/2	—	
AHRI heating performance three phase	Heating options	L	D	U	M	E	W	N	F	—
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low Nox)	Med (Low NOx)	Med	High (Ultra-Low Nox)	High, (Low NOx)	High	—
	1st stage heat input (kBTU)	—	49	—	—	82	—	—	100	—
	2nd stage heat input (kBTU)	56	70	60	90	112	100	118	145	—
	1st stage heat output (kBTU)	—	39	—	—	66	—	—	80	—
	2nd stage heat output (kBTU)	45	56	48	72	90	80	94	116	—
	Steady state efficiency (%)	80	80	80	80	80	80	80	80	—
	No. burners	2	2	1	3	3	1	3	3	—
	No. stages	1	2	1	1	2	1	1	2	—
	Temperature rise range (°F)	17-28	21-35	10-40	27-44	33-55	25-55	35-58	43-72	—
	Gas limit setting (°F)	150	150	150	140	140	160	145	140	—
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	—
Dimensions (in.)	Length	74.1								74.1
	Width	48.9								48.9
	Height	40.6								40.6
Operating weight (lb)		636								582
	With MagnaDRY	646								592
Compressors	Type	Scroll								Scroll
	Quantity	1								1
	Unit capacity steps (%)	100								100
Condenser coil data	Face area (sq ft)	21.1								21.1
	Rows	1								1
	Fins per inch	23								23
	Tube diameter (in./mm)	.79/20								.79/20
	Circuitry type	2-pass Microchannel								2-pass Microchannel

**Table 12: ZY06 physical data**

Component		Models			
		ZYG06		ZYE06	
Nominal tonnage		5		5	
Evaporator coil data	Face area (sq ft)	7.3		7.3	
	Rows	4		4	
	Fins per in.	15		15	
	Tube diameter	0.375		0.375	
	Circuitry type	Intertwined		Intertwined	
	Refrigerant control	TXV		TXV	
Reheat option coil data	Face area (sq ft)	4.4		4.4	
	Rows	1		1	
	Fins per in.	23		23	
	Tube diameter (in./mm)	.79/20		.79/20	
Condenser fan data	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/2		1/2	
	No. speeds	1		1	
	rpm	1,085		1,085	
	Nominal total cfm	4,600		4,600	
Evaporator fan data direct drive	Airflow option	A		A	
	Quantity	1		1	
	Fan size (in.)	11 x 10		11 x 10	
	Type	Centrifugal		Centrifugal	
	Motor hp	1		1	
	rpm	1,050		1,050	
Evaporator fan data belt drive	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	11 x 10	11 x 10	11 x 10	11 x 10
	Type	Centrifugal		Centrifugal	
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A37	A39	A37	A39
	Motor Hp, 1 phase	1.5	—	1.5	—
	Motor max bhp, 3 Phase	2.4	2.9	2.4	2.9
	rpm	1,750	1,750	1,750	1,750
	Frame size	56HZ	56Z	56HZ	56Z
Filters	Quantity - size	4 - (16 x 16 x 2) <sup>2</sup>		4 - (16 x 16 x 2) <sup>2</sup>	

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 2 in. Throwaway, Standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 13: ZYA7 physical data**

Component		Models		
		ZYGA7		ZYEA7
Nominal tonnage		6		6
AHRI cooling performance	Gross Capacity @ AHRI A point (BTU)	73,000		73,000
	AHRI net capacity (BTU)	71,000		71,000
	EER	12		12.2
	CV IEER	14.6		14.8
	IEER IntelliSpeed	16		16
	Nominal cfm	2,350		2,350
	System power (kW)	5.87		5.89
	Refrigerant type	R-410A		R-410A
	Refrigerant charge (lb-oz)			
	System 1	7-11		7-11
	System 2	—		—
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)			
	System 1	9-0		9-0
System 2	—		—	
AHRI heating performance <sup>2</sup>	Heating Option	D	E	F
	Heating model	Low	Med	High
	1st stage heat input (kBTU)	57	90	110
	2nd stage heat input (kBTU)	72	125	150
	1st stage heat output (kBTU)	46	72	88
	2nd stage heat output (kBTU)	58	100	120
	AFUE %			
	Steady state efficiency (%)	80	80	80
	No. burners	2	3	3
	No. stages	2	2	2
	Temperature rise range (°F)	18-30	31-51	37-62
	Gas limit setting (°F)	140	140	160
Gas piping connection (in.)	1/2	3/4	3/4	
Dimensions (in.)	Length	87.2		87.2
	Width	61.7		61.7
	Height	40.6		40.6
Operating weight (lb)	899		829	
Operating weight with MagnaDRY (lb)	913		843	
Compressors	Type	Scroll		Scroll
	Quantity	1		1
	Unit capacity steps (%)	67/100		67/100
Condenser coil data	Face area (sq ft)	21.1		21.1
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	1/25		1/25
	Circuitry type	2-pass Microchannel		2-pass Microchannel
Evaporator coil data	Face area (sq ft)	8.9		8.9
	Rows	3		3
	Fins per in.	15		15
	Tube diameter	0.375		0.375
	Circuitry type	Intertwined		Intertwined
	Refrigerant control	TXV		TXV
Reheat option coil data	Face area (sq ft)	6.5		6.5
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	.79/20		.79/20
Condenser fan data	Quantity of fans	2		2
	Fan diameter (in.)	22		22
	Type	Prop		Prop
	Drive type	Direct		Direct
	Quantity of motors	2		2
	Motor hp each	1/2		1/2
	No. speeds	1		1
	rpm	1,085		1,085
Nominal total cfm		7,600		7,600

**Table 13: ZYA7 physical data**

Component		Models					
		ZYGA7			ZYEA7		
Nominal tonnage		6			6		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
	Blower sheave	AK74	AK74	AK74	AK74	AK74	AK74
	Belt	A47	A48	A48	A47	A48	A48
	Motor Max bhp, 3 phase	2.4	2.9	3.7	2.4	2.9	3.7
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56HZ	56Y	56Y	56HZ
Filters	Quantity - size	4 - (16 x 20 x 2) <sup>3</sup>			4 - (16 x 20 x 2) <sup>3</sup>		

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 1st Stage 60% of 2nd Stage.
- 3 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 14: ZY08 physical data**

Component		Models		
		ZYG08		ZYE08
Nominal tonnage		7.5		7.5
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	93,000		93,000
	AHRI net capacity (BTU)	89,000		89,000
	EER	12.0		12.2
	IEER IntelliSpeed	14.6		14.8
	Nominal cfm	2,900		2,900
	System power (kW)	7.1		7.1
	Refrigerant type	R-410A		R-410A
	Refrigerant charge (lb-oz)			
	System 1	6-0		6-0
	System 2	6-0		6-0
	Refrigerant charge MagnaDRY <sup>l</sup> option (lb-oz)			
	System 1	6-4		6-4
System 2	5-14		5-14	
AHRI heating performance three phase	Heating Option	D	E	F
	Heating model	Low	Med	High
	1st stage heat input (kBTU)	90	125	176
	2nd stage heat input (kBTU)	125	180	220
	1st stage heat output (kBTU)	72	100	141
	2nd stage heat output (kBTU)	100	144	176
	Steady state efficiency (%)	80	80	80
	No. burners	3	4	5
	No. stages	2	2	2
	Temperature rise range (°F)	25-41	36-59	43-72
	Gas limit setting (°F)	140	150	140
Gas piping connection (in.)	3/4	3/4	3/4	
Dimensions (in.)	Length	87.2		87.2
	Width	61.7		61.7
	Height	48.6		48.6
Operating weight (lb)	—	970		868
Operating weight with MagnaDRY (lb)		985		883
Compressors	Type	Scroll		Scroll
	Quantity	2		2
	Unit capacity steps (%)	50/100		50/100
Condenser coil data	Face area (sq ft)	25.5		25.5
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	1/25		1/25
Evaporator coil data	Circuitry type	2-pass Microchannel		2-pass Microchannel
	Face area (sq ft)	11.1		11.1
	Rows	4		4
	Fins per in.	15		15
	Tube diameter	0.375		0.375
	Circuitry type	Intertwined		Intertwined
	Refrigerant control	TXV		TXV
Reheat option coil data	Face area (sq ft)	6.6		6.6
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	1/25		1/25
Condenser fan data	Quantity of fans	2		2
	Fan diameter (in.)	22		22
	Type	Prop		Prop
	Drive type	Direct		Direct
	Quantity of motors	2		2
	Motor hp each	1/2		1/2
	No. speeds	1		1
	rpm	1,085		1,085
Nominal total cfm		8,200		8,200



**Table 14: ZY08 physical data**

Component		Models					
		ZYG08			ZYE08		
Nominal tonnage		7.5			7.5		
Evap fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
	Blower sheave	AK74	AK74	AK74	AK74	AK74	AK74
	Belt	A47	A48	A50	A47	A48	A50
	Motor max bhp, 3 phase	2.4	2.4	3.7	2.4	2.4	3.7
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56HZ	56Y	56Y	56HZ
Filters	Quantity - size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.

2 2 in. Throwaway, Standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 15: ZY09 physical data**

Component		Model		
		ZYG09		ZYE09
Nominal tonnage		8.5		8.5
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	109,500		109,500
	AHRI net capacity (BTU)	98,000		98,000
	EER	12		12.2
	IEER IntelliSpeed	14.6		14.8
	Nominal cfm	3,300		3,300
	System power (kW)	7.30		7.30
	Refrigerant type	R-410A		R-410A
	Refrigerant charge (lb-oz)			
	System 1	6-8		6-8
	System 2	6-0		6-0
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)			
	System 1	6-6		6-6
System 2	6-0		6-0	
AHRI heating performance	Heating options	D	E	F
	Heating model	Low	Med	High
	1st stage heat input (kBTU)	90	125	176
	2nd stage heat input (kBTU)	125	180	220
	1st stage heat output (kBTU)	72	100	141
	2nd stage heat output (kBTU)	100	144	176
	AFUE %	—	—	—
	Steady state efficiency (%)	80	80	80
	No. burners	3	4	5
	No. stages	2	2	2
	Temperature rise range (°F)	22-36	31-52	38-64
	Gas limit setting (°F)	140	150	140
	Gas piping connection (in.)	3/4	3/4	3/4
Dimensions (in.)	Length	87.2		87.2
	Width	61.7		61.7
	Height	48.6		48.6
Operating weight (lb)	980		878	
Operating weight with MagnaDRY (lb)	995		893	
Compressors	Type	Scroll		Scroll
	Quantity	2		2
	Unit capacity steps (%)	50/100		50/100
Condenser coil data	Face area (sq ft)	25.5		25.5
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	1/25		1/25
	Circuitry type	2-pass Microchannel		2-pass Microchannel
Evaporator coil data	Face area (sq ft)	11.1		11.1
	Rows	4		4
	Fins per in.	15		15
	Tube diameter	0.375		0.375
	Circuitry type	Intertwined		Intertwined
	Refrigerant control	TXV		TXV
Reheat option coil data	Face area (sq ft)	6.6		6.6
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	1/25		1/25
Condenser fan data	Quantity of fans	2		2
	Fan diameter (in.)	22		22
	Type	Prop		Prop
	Drive type	Direct		Direct
	Quantity of motors	2		2
	Motor hp each	1/2		1/2
	No. speeds	1		1
	rpm	1,085		1,085
	Nominal total cfm	8,600		8,600

**Table 15: ZY09 physical data**

Component		Model					
		ZYG09			ZYE09		
Nominal tonnage		8.5			8.5		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
	Blower sheave	AK74	AK74	AK74	AK74	AK74	AK74
	Belt	A47	A48	A50	A47	A48	A50
	Motor Max bhp, 3 phase	2.4	2.4	3.7	2.4	2.4	3.7
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56HZ	56Y	56Y	56HZ
Filters	Quantity - size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.

2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 16: ZY12 physical data**

Component		Model		
		ZYG12		ZYE12
Nominal tonnage		10		10
AHRI cooling performance	Gross capacity @ AHRI A point (BTU)	120,000		120,000
	AHRI net capacity (BTU)	116,000		116,000
	EER	12.0		12.2
	IEER IntelliSpeed	14.6		14.8
	Nominal cfm	3,300		3,300
	System power (kW)	9.7		9.7
	Refrigerant type	R-410A		R-410A
	Refrigerant charge (lb-oz)			
	System 1	6-2		6-2
	System 2	6-10		6-10
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)			
	System 1	6-8		6-8
	System 2	7-2		7-2
AHRI heating performance	Heating options	D	E	F
	Heating model	Low	Med	High
	1st stage heat input (kBTU)	125	176	200
	2nd stage heat input (kBTU)	180	220	250
	1st stage heat output (kBTU)	100	141	162
	2nd stage heat output (kBTU)	144	176	203
	AFUE %	—	—	—
	Steady state efficiency (%)	80	80	81
	No. burners	4	5	5
	No. stages	2	2	2
	Temperature rise range (°F)	27-44	33-54	37-62
	Gas limit setting (°F)	150	140	160
	Gas piping connection (in.)	3/4	3/4	3/4
Dimensions (in.)	Length	87.2		87.2
	Width	61.7		61.7
	Height	55.3		55.3
Operating weight (lb)		1,008		902
Operating weight with MagnaDRY (lb)		1,026		920
Compressors	Type	Scroll		Scroll
	Quantity	2		2
	Unit capacity steps (%)	50/100		50/100
Condenser coil data	Face area (sq ft)	24.9		24.9
	Rows	1		1
	Fins per in.	21		21
	Tube diameter (in./mm)	1.26/32		1.26/32
	Circuitry type	2-pass Microchannel		2-pass Microchannel
Evaporator coil data	Face area (sq ft)	11.1		11.1
	Rows	4		4
	Fins per in.	15		15
	Tube diameter	0.375		0.375
	Circuitry type	Intertwined		Intertwined
	Refrigerant control	TXV		TXV
Reheat option coil data	Face area (sq ft)	8.2		8.2
	Rows	1		1
	Fins per in.	23		23
	Tube diameter (in./mm)	1/25		1/25
Condenser fan data	Quantity of fans	1		1
	Fan diameter (in.)	30		30
	Type	Prop		Prop
	Drive type	Direct		Direct
	Quantity of motors	1		1
	Motor hp each	1 1/2		1 1/2
	No. speeds	1		1
	rpm	1,140		1,140
	Nominal total cfm	7,700		7,700

**Table 16: ZY12 physical data**

Component		Model					
		ZYG12			ZYE12		
Nominal tonnage		10			10		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL44	1VP50	1VP56	1VL44	1VP50	1VP56
	Blower sheave	AK79	AK79	BK85	AK79	AK79	BK85
	Belt	A50	A50	BX52	A50	A50	BX52
	Motor max bhp, 3 phase	2.4	3.7	5.25	2.4	3.7	5.25
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56HZ	145TY	56Y	56HZ	145TY
Filters	Quantity - Size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.

2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

## ZL04 to ZL06 physical data

**Table 17: ZL04 physical data**

Component		Models							
		ZLG04					ZLE04		
Nominal tonnage		3					3		
AHRI cooling performance direct drive	Gross capacity at AHRI A point (BTU)	36,300					36,300		
	AHRI net capacity (BTU)	34,800					34,800		
	EER/EER2 230 V/460 V	13.2/12.2					13.2/12.2		
	SEER/SEER2 230 V/460 V	17.2/16.0					17.2/16.0		
	EER 575 V	12.8					12.8		
	SEER 575 V	16.5					16.5		
	Nominal cfm	1,300					1,300		
	System power 230 V/460 V (kW)	2.8					2.8		
	System power 575 V (kW)	2.8					2.8		
	Refrigerant type	R-410A					R-410A		
	Refrigerant charge (lb-oz)								
	System 1	4-3					4-3		
	System 2	—					—		
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)								
	System 1	4-6					4-6		
System 2	—					—			
AHRI cooling performance belt drive	Gross capacity at AHRI A point (BTU)	36,300					36,300		
	AHRI net capacity (BTU)	34,000					34,000		
	EER/EER2 230 V/460 V	12.5/11.2					12.5/11.2		
	SEER/SEER2 230 V/460 V	16.0/14.0					16.0/14.0		
	EER 575 V	12.2					12.2		
	SEER 575 V	15.1					15.1		
	Nominal cfm	1,300					1,300		
	System power 230 V/460 V (kW)	3.0					3.0		
	System power 575 V (kW)	3.0					3.0		
	Refrigerant type	R-410A					R-410A		
	Refrigerant charge (lb-oz)								
	System 1	4-3					4-3		
	System 2	—					—		
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)								
	System 1	4-6					4-6		
System 2	—					—			
AHRI heating performance single phase	Heating option	L	D	—	M	E	—	—	
	Heating model	Low (Low NOx)	Low	—	Med (Low NOx)	Med	—	—	
	First stage heat input (kBtu)	—	—	—	—	—	—	—	
	Second stage heat input (kBtu)	56	70	—	90	112	—	—	
	First stage heat output (kBtu)	—	—	—	—	—	—	—	
	Second stage heat output (kBtu)	45	56	—	72	90	—	—	
	AFUE %	—	—	—	—	81	—	—	
	FER compliant	—	—	—	—	Yes	—	—	
	Number of burners	2	2	—	3	3	—	—	
	Number of stages	1	1	—	1	1	—	—	
	Temperature rise range (°F)	10-40	20-50	—	35-65	50-80	—	—	
	Gas limit setting (°F)	150	150	—	140	140	—	—	
	Gas piping connection (in.)	1/2	1/2	—	1/2	1/2	—	—	

**Table 17: ZL04 physical data**

Component		Models						
		ZLG04						ZLE04
Nominal tonnage		3						3
AHRI heating performance three phase	Heating option	L	D	U	M	E	W	—
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low NOx)	Med (Low NOx)	Med	High (Ultra-Low NOx)	—
	First stage heat input (kBtu)	—	49	—	—	82	—	—
	Second stage heat input (kBtu)	56	70	60	90	112	100	—
	First stage heat output (kBtu)	—	39	—	—	66	—	—
	Second stage heat output (kBtu)	45	56	48	72	90	80	—
	Steady state efficiency (%)	80	80	80	80	80	80	—
	Number of burners	2	2	1	3	3	1	—
	Number of stages	1	2	1	1	2	1	—
	Temperature rise range (°F)	28-46	35-58	20-50	44-74	55-78	45-75	—
	Gas limit setting (°F)	150	150	150	140	140	170	—
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	—
Dimensions (in.)	Length	74.1						74.1
	Width	48.9						48.9
	Height	32.5						32.5
Operating weight (lb)		555						481
	with MagnaDRY	563						489
Compressors	Type	Scroll						Scroll
	Quantity	1						1
	Unit capacity steps (%)	67/100						67/100
Condenser coil data	Face area (sq ft)	16.3						16.3
	Rows	1						1
	Fins per in.	23						23
	Tube diameter (in./mm)	0.63/16						0.63/16
	Circuitry type	2-pass Microchannel						2-pass Microchannel
Evaporator coil data	Face area (sq ft)	5.5						5.5
	Rows	3						3
	Fins per in.	15						15
	Tube diameter	0.375						0.375
	Circuitry type	Intertwined						Intertwined
	Refrigerant control	TXV						TXV
Reheat option coil data	Face area (sq ft)	3.5						3.5
	Rows	1						1
	Fins per inch	23						23
	Tube diameter (in./mm)	.63/16						.63/16
Condenser fan data	Quantity of fans	1						1
	Fan diameter (in.)	22						22
	Type	Prop						Prop
	Drive type	Direct						Direct
	Quantity of motors	1						1
	Motor hp each	1/3						1/3
	Number of speeds	2						2
	rpm	800/1,000						800/1,000
Evaporator fan data direct drive	Nominal total cfm	3,800						3,800
	Airflow option	A						A
	Quantity	1						1
	Fan size (in.)	10 x 10						10 x 10
	Type	Centrifugal						1,100 Centrifugal
	Motor hp	3/4						3/4
	rpm	1,050						1,050



**Table 17: ZL04 physical data**

Component		Models			
		ZLG04		ZLE04	
Nominal tonnage		3		3	
Evaporator fan data belt drive	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	10 x 10	10 x 10	10 x 10	10 x 10
	Type	Centrifugal		Centrifugal	
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A39	A40	A39	A40
	Motor hp, 1 phase	1.5	—	1.5	—
	Motor max Bhp, 3 phase	2.4	2.4	2.4	2.4
Filters	rpm	1,750	1,750	1,750	1,750
	Frame size	56Y	56Y	56Y	56Y
Quantity - size		2 - (16 x 25 x 2) <sup>2</sup>		2 - (16 x 25 x 2) <sup>2</sup>	

1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.

2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 18: ZL05 physical data**

Component		Models								
		ZLG05								ZLE05
Nominal tonnage		4								
AHRI cooling performance direct drive	Gross capacity at AHRI A point (BTU)	50,000								50,000
	AHRI net capacity (BTU)	48,000								48,000
	EER/EER2 230 V/460 V	12.7/12.2								12.7/12.2
	SEER/SEER2 230 V/460 V	17.1/16.5								17.1/16.5
	EER 575 V	12.5								12.5
	SEER 575 V	16.0								16.0
	Nominal cfm	1,600								1,600
	System power 230 V/460 V (kW)	3.9								3.9
	System power 575 V (kW)	3.8								3.8
	Refrigerant type	R-410A								R-410A
	Refrigerant charge (lb-oz)									
	System 1	6-4								6-4
	System 2	—								—
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)									
System 1	6-8								6-8	
System 2	—								—	
AHRI cooling performance belt drive	Gross capacity at AHRI A point (BTU)	50,000								50,000
	AHRI net capacity (BTU)	47,500								47,500
	EER/EER2 230 V/460 V	12.0/11.5								12.0/11.5
	SEER/SEER2 230 V/460 V	15.6/15.0								15.6/15.0
	EER 575 V	11.2								11.2
	SEER 575 V	14.4								14.4
	Nominal cfm	1,600								1,600
	System power 230V/460V (kW)	4.2								4.2
	System power 575 V (kW)	4.2								4.2
	Refrigerant type	R-410A								R-410A
	Refrigerant charge (lb-oz)									
	System 1	6-4								6-4
	System 2	—								—
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)									
System 1	6-8								6-8	
System 2	—								—	
AHRI heating performance three phase	Heating options	L	D	U	M	E	W	N	F	—
	Heating model	Low (Low NOx)	Low	Low (Ultra-Low NOx)	Med (Low NOx)	Med	High (Ultra-Low NOx)	High, (Low NOx)	High	—
	First stage heat input (kBtu)	—	49	—	—	82	—	—	100	—
	Second stage heat input (kBtu)	56	70	60	90	112	100	118	145	—
	First stage heat output (kBtu)	—	39	—	—	66	—	—	80	—
	Second stage heat output (kBtu)	45	56	48	72	90	80	94	116	—
	Steady state efficiency (%)	80	80	80	80	80	80	80	80	—
	Number of burners	2	2	1	3	3	1	3	3	—
	Number of stages	1	2	1	1	2	1	1	2	—
	Temperature rise range (°F)	21-35	26-43	15-45	33-56	41-69	30-60	44-73	49-77	—
	Gas limit setting (°F)	150	150	150	140	140	160	150	145	—
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	—
Dimensions (in.)	Length	74.1								74.1
	Width	48.9								48.9
	Height	40.6								40.6
Operating weight (lb)		602								564
	with MagnaDRY	612								574
Compressors	Type	Scroll								Scroll
	Quantity	1								1
	Unit capacity steps (%)	67/100								67/100
Condenser coil data	Face area (sq ft)	21.1								21.1
	Rows	1								1
	Fins per in.	23								23
	Tube diameter (in./mm)	0.79/20								0.79/20
	Circuitry Type	2-pass Microchannel								2-pass Microchannel

**Table 18: ZL05 physical data**

Component		Models			
		ZLG05		ZLE05	
<b>Nominal tonnage</b>		<b>4</b>		<b>4</b>	
Evaporator coil data	Face area (sq ft)	7.3		7.3	
	Rows	3		3	
	Fins per in.	15		15	
	Tube diameter	0.375		0.375	
	Circuitry type	Intertwined		Intertwined	
	Refrigerant control	TXV		TXV	
Reheat option coil data	Face area (sq ft)	4.4		4.4	
	Rows	1		1	
	Fins per inch	23		23	
	Tube diameter (in./mm)	.79/20		.79/20	
Condenser fan data	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/3		1/3	
	Number of speeds	1		1	
	rpm	1,100		1,100	
Evaporator fan data direct drive	Nominal total cfm	4,000		4,000	
	Airflow option	A		A	
	Quantity	1		1	
	Fan size (in.)	10 x 10		10 x10	
	Type	Centrifugal		Centrifugal	
	Motor hp	1		1	
Evaporator fan data belt drive	rpm	1,050		1,050	
	Airflow option	B	C	B	C
	Quantity	1	1	1	1
	Fan size (in.)	10 x 10	10 x 10	10 x 10	10 x 10
	Type	Centrifugal		Centrifugal	
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A39	A40	A39	A40
	Motor hp, 1 phase	1.5	—	1.5	—
	Motor max Bhp, 3 phase	2.4	2.9	2.4	2.9
Filters	rpm	1,725		1,725	
	Frame size	56Y		56Y	
	Quantity - size	4 - (16 x 16 x 2) <sup>2</sup>		4 - (16 x 16 x 2) <sup>2</sup>	

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

**Table 19: ZL06 physical data**

Component		Models								
		ZLG06								ZLE06
Nominal tonnage		5								
AHRI cooling performance direct drive	Gross capacity at AHRI A point (BTU)	60,700								60,700
	AHRI net capacity (BTU)	58,500								58,500
	EER/EER2 230 V/460 V	12.8/12.0								12.8/12.0
	SEER/SEER2 230 V/460 V	17.0/16.0								17.0/16.0
	EER 575 V	12.2								12.2
	SEER 575 V	15.6								15.6
	Nominal cfm	1,825								1,825
	System power 230 V/460 V (kW)	4.8								4.8
	System power 575 V (kW)	4.8								4.8
	Refrigerant type	R-410A								R-410A
	Refrigerant charge (lb-oz)									
	System 1	8-8								8-8
	System 2	—								—
	Refrigerant charge MagnaDRY <sup>®</sup> option (lb-oz)									
System 1	9-10								9-10	
System 2	—								—	
AHRI cooling performance belt drive	Gross capacity at AHRI A point (BTU)	60,100								60,100
	AHRI net capacity (BTU)	58,000								58,000
	EER/EER2 230 V/460 V	12.4/11.5								12.4/11.5
	SEER/SEER2 230 V/460 V	15.8/14.8								15.8/14.8
	EER 575 V	11.9								11.9
	SEER 575 V	14.9								14.9
	Nominal cfm	1,825								1,825
	System power 230 V/460 V (kW)	4.9								4.9
	System power 575 V (kW)	4.9								4.9
	Refrigerant type	R-410A								R-410A
	Refrigerant charge (lb-oz)									
	System 1	8-8								8-8
	System 2	—								—
	Refrigerant charge MagnaDRY <sup>®</sup> option (lb-oz)									
System 1	9-10								9-10	
System 2	—								—	
AHRI heating performance three phase	Heating options	L	D	U	M	E	L	W	F	—
	Heating model	Low (Low NOx)	Low	Low (Low NOx)	Low (Ultra-Low NOx)	Med	Low (Low NOx)	High (Ultra-Low NOx)	High	—
	First stage heat input (kBTU)	—	49	—	—	82	—	—	100	—
	Second stage heat input (kBTU)	56	70	60	90	112	100	118	145	—
	First stage heat output (kBTU)	—	39	—	—	66	—	—	80	—
	Second stage heat output (kBTU)	45	56	48	72	90	80	94	116	—
	Steady state efficiency (%)	80	80	80	80	80	80	80	80	—
	Number of burners	2	2	1	3	3	1	3	3	—
	Number of stages	1	2	1	1	2	1	1	2	—
	Temperature rise range (°F)	17-28	21-35	10-40	27-44	33-55	25-55	25-55	43-72	—
	Gas limit setting (°F)	150	150	150	140	140	140	160	140	—
	Gas piping connection (in.)	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	—
Dimensions (in.)	Length	74.1								74.1
	Width	48.9								48.9
	Height	40.6								40.6
Operating weight (lb)		631								582
	With MagnaDRY	643								594
Compressors	Type	Scroll								Scroll
	Quantity	1								1
	Unit capacity steps (%)	67/100								67/100
Condenser coil data	Face area (sq ft)	21.1								21.1
	Rows	2								2
	Fins per in	23								23
	Tube diameter (in./mm)	0.79/20								0.79/20
	Circuitry type	3-pass Microchannel								3-pass Microchannel

**Table 19: ZL06 physical data**

Component		Models			
		ZLG06		ZLE06	
Nominal tonnage		5		5	
Evaporator coil data	Face area (sq ft)	7.3		7.3	
	Rows	4		4	
	Fins per in.	15		15	
	Tube diameter	0.375		0.375	
	Circuitry type	Intertwined		Intertwined	
Reheat option coil data	Refrigerant control	TXV		TXV	
	Face area (sq ft)	4.6		4.6	
	Rows	1		1	
	Fins per inch	23		23	
Condenser fan data	Tube diameter (in./mm)	1/25		1/25	
	Quantity of fans	1		1	
	Fan diameter (in.)	22		22	
	Type	Prop		Prop	
	Drive type	Direct		Direct	
	Quantity of motors	1		1	
	Motor hp each	1/3		1/3	
	Number of speeds	2		2	
	rpm	1,000/1,100		1,000/1,100	
Evaporator fan data direct drive	Nominal total cfm	4,600		4,600	
	Airflow option	A		A	
	Quantity	1		1	
	Fan size (in.)	11 x 10		11 x 10	
	Type	Centrifugal		Centrifugal	
	Motor hp	1		1	
Evaporator fan data belt drive	rpm	1,050		1,050	
	Airflow option	B	C	B	C
	quantity	1	1	1	1
	Fan size (in.)	11 x 10	11 x 10	11 x 10	11 x 10
	Type	Centrifugal		Centrifugal	
	Motor sheave	1VL34	1VL44	1VL34	1VL44
	Blower sheave	AK46	AK46	AK46	AK46
	Belt	A37	A39	A37	A39
	Motor hp, 1 phase	1.5	—	1.5	—
	Motor Max Bhp, 3 Phase	2.4	2.9	2.4	2.9
	rpm	1,750	1,750	1,750	1,750
	Frame size	56HZ	56Z	56HZ	56Z
Filters	Quantity - size	4 - (16 x 16 x 2) <sup>2</sup>		4 - (16 x 16 x 2) <sup>2</sup>	

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.  
2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

# ZL08 to ZL14 physical data

**Table 20: ZL08 physical data**

Component		Models			
		ZLG08		ZLE08	
Nominal tonnage		7.5			7.5
AHRI cooling performance	Gross capacity at AHRI A point (BTU)	93,000			93,000
	AHRI net capacity (BTU)	89,000			89,000
	EER	12			12.2
	SEER	—			—
	IEER IntelliSpeed	15.6			15.8
	VAV IEER	15.2			15.4
	Nominal cfm	2,900			2,900
	System power (kW)	7.40			7.40
	Refrigerant type	R-410A			R-410A
	Refrigerant charge (lb-oz)				
	System 1	6-0			6-0
	System 2	6-6			6-6
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)				
System 1	6-6			6-6	
System 2	6-6			6-6	
AHRI heating performance three phase	Heating option	D	E	F	—
	Heating model	Low	Med	High	—
	First stage heat input (kBTU)	90	125	176	—
	Second stage heat input (kBTU)	125	180	220	—
	First stage heat output (kBTU)	72	100	141	—
	Second stage heat output (kBTU)	100	144	176	—
	Steady state efficiency (%)	80	80	80	—
	Number of burners	3	4	5	—
	Number of stages	2	2	2	—
	Temperature rise range (°F)	25-41	36-59	43-72	—
	Gas limit setting (°F)	140	150	140	—
	Gas piping connection (in.)	3/4	3/4	3/4	—
Dimensions (in.)	Length	87.2			87.2
	Width	61.7			61.7
	Height	48.6			48.6
Operating weight (lb)		1,040			920
	with MagnaDRY	1,055			935
Compressors	Type	Scroll			Scroll
	Quantity	2			2
	Unit capacity steps (%)	34 / 67 / 1 00			34 / 67 / 1 00
Condenser coil data	Face area (sq ft)	25.5			25.5
	Rows	1			1
	Fins per in.	23			23
	Tube diameter (in./mm)	1/25			1/25
	Circuitry Type	2-pass Microchannel			2-pass Microchannel
Evaporator coil data	Face area (sq ft)	11.1			11.1
	Rows	4			4
	Fins per in.	15			15
	Tube diameter	0.375			0.375
	Circuitry type	Intertwined			Intertwined
	Refrigerant control	TXV			TXV

**Table 20: ZL08 physical data**

Component		Models					
		ZLG08			ZLE08		
Nominal tonnage		7.5			7.5		
Reheat option coil data	Face area (sq ft)	6.6			6.6		
	Rows	1			1		
	Fins per in.	23			23		
	Tube diameter (in./mm)	1/25			1/25		
Condenser fan data	Quantity of fans	2			2		
	Fan diameter (in.)	22			22		
	Type	Prop			Prop		
	Drive type	Direct			Direct		
	Quantity of motors	2			2		
	Motor hp each	1/2			1/2		
	Number of speeds	1			1		
	rpm	1,085			1,085		
	Nominal total cfm	8,600			8,600		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan Size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
	Blower sheave	AK74	AK74	AK74	AK74	AK74	AK74
	Belt	A47	A48	A50	A47	A48	A50
	Motor max bhp, 3 phase	2.4	2.4	3.7	2.4	2.4	3.7
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56HZ	56Y	56Y	56HZ
Filters	Quantity - size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.

2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)



**Table 21: ZL09 physical data**

Component		Models			
		ZLG09		ZLE09	
Nominal tonnage		8.5			8.5
AHRI cooling performance	Gross capacity at AHRI A point (BTU)	101,000			101,000
	AHRI net capacity (BTU)	98,000			98,000
	EER	12			12.2
	SEER	—			—
	IEER IntelliSpeed	16.1			16.3
	VAV IEER	15.7			15.9
	Nominal cfm	3,000			3,000
	System power (kW)	8.00			8.00
	Refrigerant type	R-410A			R-410A
	Refrigerant charge (lb-oz)				
	System 1	6-4			6-4
	System 2	6-4			6-4
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)				
	System 1	6-2			6-2
System 2	6-4			6-4	
AHRI heating performance three phase	Heating option	D	E	F	—
	Heating model	Low	Med	High	—
	First stage heat input (kBTU)	90	125	176	—
	Second stage heat input (kBTU)	125	180	220	—
	First stage heat output (kBTU)	72	100	141	—
	Second stage heat output (kBTU)	100	144	176	—
	Steady state efficiency (%)	80	80	80	—
	Number of burners	3	4	5	—
	Number of stages	2	2	2	—
	Temperature rise range (°F)	22-36	31-52	38-64	—
	Gas limit setting (°F)	140	150	140	—
	Gas piping connection (in.)	3/4	3/4	3/4	—
Dimensions (in.)	Length	87.2			87.2
	Width	61.7			61.7
	Height	48.6			48.6
Operating weight (lb)		1,030			925
	with MagnaDRY	1,045			940
Compressors	Type	Scroll			Scroll
	Quantity	2			2
	Unit capacity steps (%)	34 / 67 /100			34 / 67 /100
Condenser coil data	Face area (sq ft)	25.5			25.5
	Rows	1			1
	Fins per in.	23			23
	Tube diameter (in./mm)	1/25			1/25
	Circuitry type	2-pass Microchannel			2-pass Microchannel
Evaporator coil data	Face area (sq ft)	11.1			11.1
	Rows	4			4
	Fins per in.	15			15
	Tube diameter	0.375			0.375
	Circuitry type	Intertwined			Intertwined
	Refrigerant control	TXV			TXV
Reheat option coil data	Face area (sq ft)	6.6			6.6
	Rows	1			1
	Fins per in.	23			23
	Tube diameter (in./mm)	1/25			1/25

**Table 21: ZL09 physical data**

Component		Models					
		ZLG09			ZLE09		
Nominal tonnage		8.5			8.5		
Condenser fan data	Quantity of fans	2			2		
	Fan diameter (in.)	22			22		
	Type	Prop			Prop		
	Drive type	Direct			Direct		
	Quantity of motors	2			2		
	Motor hp each	1/2			1/2		
	Number of speeds	1			1		
	rpm	1,085			1,085		
	Nominal total cfm	8,600			8,600		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL34	1VL44	1VP50	1VL34	1VL44	1VP50
	Blower sheave	AK74	AK74	AK74	AK74	AK74	AK74
	Belt	A47	A48	A50	A47	A48	A50
	Motor max bhp, 3 phase	2.4	2.4	3.7	2.4	2.4	3.7
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56Y	56HZ	56Y	56Y	56HZ
Filters	Quantity - size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

**Table 22: ZL12 physical data**

Component		Models			
		ZLG12		ZLE12	
Nominal tonnage		10			10
AHRI cooling performance	Gross capacity at AHRI A point (BTU)	120,200			120,200
	AHRI net capacity (BTU)	116,000			116,000
	EER	12			12.2
	SEER	—			—
	IEER IntelliSpeed	15.4			15.6
	VAV IEER	15.2			15.4
	Nominal cfm	3,100			3,100
	System power (kW)	9.60			9.60
	Refrigerant type	R-410A			R-410A
	Refrigerant charge (lb-oz)				
	System 1	6-0			6-0
	System 2	6-10			6-10
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)				
System 1	6-14			6-14	
System 2	6-10			6-10	
AHRI heating performance three phase	Heating Option	D	E	F	—
	Heating model	Low	Med	High	—
	First stage heat input (kBTU)	125	176	200	—
	Second stage heat input (kBTU)	180	220	250	—
	First stage heat output (kBTU)	100	141	162	—
	Second stage heat output (kBTU)	144	176	203	—
	Steady state efficiency (%)	80	80	81	—
	Number of burners	4	5	5	—
	Number of stages	2	2	2	—
	Temperature rise range (°F)	27-44	33-54	37-62	—
	Gas limit setting (°F)	150	140	160	—
	Gas piping connection (in.)	3/4	3/4	3/4	—
Dimensions (in.)	Length	87.2			87.2
	Width	61.7			61.7
	Height	55.3			55.3
Operating weight (lb)		1,050			955
	with MagnaDRY	1,068			973
Compressors	Type	Scroll			Scroll
	Quantity	2			2
	Unit Capacity Steps (%)	34 / 67 /100			34 / 67 /100
Condenser coil data	Face area (sq ft)	24.9			24.9
	Rows	1			1
	Fins per in.	21			21
	Tube diameter (in./mm)	1.26/32			1.26/32
	Circuitry type	2-pass Microchannel			2-pass Microchannel
Evaporator coil data	Face area (sq ft)	11.1			11.1
	Rows	4			4
	Fins per in.	15			15
	Tube diameter	0.375			0.375
	Circuitry type	Intertwined			Intertwined
Reheat option coil data	Refrigerant control	TXV			TXV
	Face area (sq ft)	8.2			8.2
	Rows	1			1
	Fins per in.	23			23
	Tube diameter(in. / mm)	1/25			1/25

**Table 22: ZL12 physical data**

Component		Models					
		ZLG12			ZLE12		
Nominal tonnage		10			10		
Condenser fan data	Quantity of fans	1			1		
	Fan diameter (in.)	30			30		
	Type	Prop			Prop		
	Drive type	Direct			Direct		
	Quantity of motors	1			1		
	Motor hp each	1 1/2			1 1/2		
	Number of speeds	1			1		
	rpm	1,140			1,140		
	Nominal total cfm	9,700			9,700		
Evaporator fan data belt drive	Airflow Option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan Size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal					
	Motor sheave	1VL44	1VP50	1VP56	1VL44	1VP50	1VP56
	Blower sheave	AK79	AK79	BK85	AK79	AK79	BK85
	Belt	A50	A50	BX52	A50	A50	BX52
	Motor max bhp, 3 phase	2.4	3.7	5.25	2.4	3.7	5.25
	rpm	1,725	1,725	1,725	1,725	1,725	1,725
	Frame size	56Y	56HZ	145TY	56Y	56HZ	145TY
Filters	Quantity - size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

**Table 23: ZL14 physical data**

Component		Models			
		ZLG14		ZLE14	
Nominal tonnage		12.5			12.5
AHRI cooling performance	Gross capacity at AHRI A point (BTU)	139,500			139,500
	AHRI net capacity (BTU)	135,000			135,000
	EER	11.0			11.2
	SEER	—			—
	IEER IntelliSpeed	14.7			14.9
	VAV IEER	14.5			14.7
	Nominal cfm	3,900			3,900
	System power (kW)	11.90			11.90
	Refrigerant type	R-410A			R-410A
	Refrigerant charge (lb-oz)				
	System 1	6-2			6-2
	System 2	6-8			6-8
	Refrigerant charge MagnaDRY <sup>1</sup> option (lb-oz)				
System 1	7-2			7-2	
System 2	6-8			6-8	
AHRI heating performance three phase	Heating option	D	E	F	—
	Heating model	Low	Med	High	—
	First stage heat input (kBTU)	125	176	200	—
	Second stage heat input (kBTU)	180	220	250	—
	First stage heat output (kBTU)	100	141	162	—
	Second stage heat output (kBTU)	144	176	203	—
	Steady state efficiency (%)	80	80	81	—
	Number of burners	4	5	5	—
	Number of stages	2	2	2	—
	Temperature rise range (°F)	21-36	26-43	30-49	—
	Gas limit setting (°F)	150	140	160	—
	Gas piping connection (in.)	3/4	3/4	3/4	—
Dimensions (in.)	Length	87.2			87.2
	Width	61.7			61.7
	Height	55.3			55.3
Operating weight (lb)		1,070			980
	with MagnaDRY	1,088			998
Compressors	Type	Scroll			Scroll
	Quantity	2			2
	Unit capacity steps (%)	34 / 67 /100			34 / 67 /100
Condenser coil data	Face area (sq ft)	24.9			24.9
	Rows	1			1
	Fins per in.	21			21
	Tube diameter (in./mm)	1.26/32			1.26/32
	Circuitry Type	2-pass Microchannel			2-pass Microchannel
Evaporator coil data	Face area (sq ft)	11.1			11.1
	Rows	4			4
	Fins per in.	15			15
	Tube diameter	0.375			0.375
	Circuitry Type	Intertwined			Intertwined
	Refrigerant control	TXV			TXV
Reheat option coil data	Face area (sq ft)	8.2			8.2
	Rows	1			1
	Fins per in.	23			23
	Tube diameter (in./mm)	1/25			1/25

**Table 23: ZL14 physical data**

Component		Models					
		ZLG14			ZLE14		
Nominal tonnage		12.5			12.5		
Condenser fan data	Quantity of fans	1			1		
	Fan diameter (in.)	30			30		
	Type	Prop			Prop		
	Drive type	Direct			Direct		
	Quantity of motors	1			1		
	Motor hp each	1 1/2			1 1/2		
	Number of speeds	1			1		
	rpm	1,140			1,140		
	Nominal total cfm	9,700			9,700		
Evaporator fan data belt drive	Airflow option	A	B	C	A	B	C
	Quantity	1	1	1	1	1	1
	Fan size (in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Type	Centrifugal			Centrifugal		
	Motor sheave	1VL44	1VP50	1VP56	1VL44	1VP50	1VP56
	Blower sheave	AK79	AK79	BK85	AK79	AK79	BK85
	Belt	A50	A50	BX54	A50	A50	BX54
	Motor max bhp, 3 phase	2.9	3.7	5.25	2.9	3.7	5.25
	rpm	1,750	1,750	1,750	1,750	1,750	1,750
	Frame size	56Y	182TZ	184TZ	56Y	182TZ	184TZ
Filters	Quantity - size	4 - (20 x 20 x 2) <sup>2</sup>			4 - (20 x 20 x 2) <sup>2</sup>		

- 1 MagnaDRY reheat option is available in power supply of 208/230/460/575-3-60 options only.
- 2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

## ZQ/ZX/ZY/ZL 04 to 14, A7 unit limitations

**Table 24: ZQ/ZX/ZY/ZL 04 to 14, A7 unit limitations**

Model	Size (ton)	Unit voltage	SCCR (kVA)	Unit limitations		
				Applied voltage		Outdoor DB temp
				Min	Max	Max (°F)
ZQ/ZY/ZL	04 (3)	208/230-1-60	5	187	252	125
		208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZQ/ZY	05 (4)	208/230-1-60	5	187	252	125
		208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZQ/ZY	06 (5)	208/230-1-60	5	187	252	125
		208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZL	05 (4)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZL	06 (5)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZX/ZY	A7 (6)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZY/ZL	08 (7.5)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZY/ZL	09 (8.5)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZY/ZL	12 (10)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125
ZL	14 (12.5)	208/230-3-60	5	187	252	125
		460-3-60	5	432	504	125
		575-3-60	5	540	630	125

# Capacity performance

## ZQ04 to 06 cooling capacities

**Table 25: ZQ04 (3.0 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM		WB (°F)	Total capacity <sup>1</sup> (MBh)	Total Input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						
					Return dry bulb (°F)								Return dry bulb (°F)						
					90	85	80	75	70	65			90	85	80	75	70	65	
		75°F									85°F								
750	77	42.7	2.1	22.8	19.1	15.4	-	-	-	41.4	2.4	22.1	18.3	14.6	-	-	-		
	72	39.9	2.1	27.3	23.3	19.3	15.4	-	-	38.3	2.4	26.5	22.5	18.4	14.4	-	-		
	67	37.1	2.1	31.5	27.6	23.3	19.2	15.4	-	35.2	2.3	30.8	26.6	22.3	18.2	14.3	-		
	62	34.3	2.1	31.5	29.4	27.3	23.4	19.5	15.5	33.1	2.3	31.9	29.0	26.2	22.3	18.3	14.4		
900	77	42.7	2.1	24.0	19.5	14.9	-	-	-	41.4	2.4	23.7	19.0	14.2	-	-	-		
	72	40.3	2.1	28.7	24.3	19.9	15.4	-	-	38.7	2.4	28.1	23.6	19.1	14.5	-	-		
	67	37.9	2.1	33.3	29.1	24.8	20.2	15.8	-	36.1	2.3	32.5	28.2	23.9	19.3	14.7	-		
	62	35.7	2.1	33.3	31.5	29.8	25.2	20.6	16.0	34.5	2.3	33.4	31.1	28.7	24.1	19.5	14.9		
	57	33.5	2.0	33.3	33.3	33.3	30.0	25.3	20.7	33.4	2.3	33.4	33.4	33.4	28.9	24.2	19.6		
	1050	77	42.6	2.1	25.3	19.9	14.5	-	-	-	41.3	2.4	25.3	19.6	13.9	-	-	-	
		72	40.6	2.1	30.1	25.2	20.4	15.5	-	-	39.2	2.4	29.7	24.7	19.7	14.7	-	-	
		67	38.7	2.1	34.8	30.6	26.3	21.1	16.2	-	37.0	2.3	34.1	29.8	25.5	20.3	15.2	-	
62		37.1	2.1	35.2	33.7	32.2	27.0	21.7	16.4	35.9	2.3	34.9	33.1	31.3	26.0	20.7	15.4		
	57	35.5	2.1	35.5	35.5	35.5	32.7	27.2	21.8	35.2	2.3	35.2	35.2	35.2	31.6	26.2	20.7		
	1200	77	42.5	2.1	26.5	20.3	14.0	-	-	-	41.3	2.4	26.9	20.2	13.5	-	-	-	
		72	41.0	2.1	31.5	26.2	20.9	15.6	-	-	39.6	2.4	31.3	25.8	20.3	14.8	-	-	
		67	39.4	2.1	36.4	32.1	27.8	22.1	16.6	-	38.0	2.3	35.7	31.4	27.1	21.3	15.6	-	
62		38.5	2.1	37.0	35.8	34.6	28.7	22.8	16.9	37.3	2.3	36.5	35.2	33.8	27.9	21.8	15.8		
	57	37.6	2.1	37.6	37.6	37.6	35.3	29.1	22.9	36.9	2.3	36.9	36.9	36.9	34.4	28.1	21.9		
	1350	72	41.3	2.1	32.8	27.1	21.4	15.7	-	-	40.1	2.4	32.9	26.9	20.9	14.9	-	-	
		67	40.2	2.1	37.9	33.6	29.2	23.0	16.9	-	38.9	2.3	37.3	33.0	28.7	22.3	16.0	-	
		62	39.9	2.1	38.8	37.9	37.1	30.5	23.9	17.4	38.8	2.3	38.0	37.2	36.4	29.7	23.0	16.3	
57		39.7	2.1	39.7	39.7	39.7	37.9	30.9	24.0	38.7	2.3	38.7	38.7	38.7	37.1	30.1	23.0		
	72	41.7	2.1	34.2	28.1	21.9	15.7	-	-	40.5	2.3	34.5	28.0	21.5	15.1	-	-		
	1500	67	41.0	2.1	39.4	35.1	30.7	24.0	17.3	-	39.8	2.3	38.8	34.5	30.2	23.3	16.4	-	
		62	41.4	2.1	40.7	40.1	39.5	32.3	25.1	17.8	40.2	2.3	39.5	39.2	39.0	31.6	24.2	16.8	
		57	41.7	2.1	41.7	41.7	41.7	40.5	32.8	25.1	40.5	2.4	40.2	40.2	40.2	39.8	32.0	24.2	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



**Table 26: ZQ04 (3.0 ton, 95°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		95°F								105°F							
750	77	40.2	2.7	21.4	17.6	13.8	-	-	-	37.0	3.1	20.2	16.4	12.6	-	-	-
	72	36.7	2.6	25.8	21.7	17.5	13.4	-	-	33.8	3.0	24.5	20.4	16.4	12.3	-	-
	67	33.2	2.6	30.2	25.7	21.3	17.3	13.2	-	30.7	3.0	28.7	24.4	20.1	16.1	12.1	-
	62	31.9	2.6	31.9	28.7	25.0	21.1	17.2	13.3	30.0	2.9	30.0	27.0	23.9	19.9	15.9	11.9
900	77	40.1	2.7	23.4	18.5	13.6	-	-	-	37.1	3.0	22.4	17.4	12.4	-	-	-
	72	37.2	2.6	27.6	22.9	18.3	13.6	-	-	34.5	3.0	26.3	21.7	17.1	12.5	-	-
	67	34.3	2.6	31.8	27.4	23.0	18.3	13.7	-	31.9	3.0	30.2	26.0	21.8	17.2	12.5	-
	62	33.3	2.6	33.3	30.6	27.7	23.0	18.4	13.8	31.3	2.9	31.3	28.9	26.5	21.8	17.1	12.4
	57	33.3	2.6	33.3	33.3	32.4	27.8	23.1	18.5	31.3	2.9	31.3	31.3	31.2	26.5	21.7	16.9
1050	77	40.1	2.7	25.3	19.3	13.3	-	-	-	37.2	3.0	24.6	18.4	12.2	-	-	-
	72	37.7	2.6	29.4	24.2	19.0	13.8	-	-	35.1	3.0	28.1	23.0	17.8	12.7	-	-
	67	35.4	2.6	33.4	29.0	24.7	19.4	14.1	-	33.0	3.0	31.6	27.6	23.5	18.2	12.9	-
	62	34.7	2.6	34.7	32.6	30.4	25.0	19.6	14.3	32.6	2.9	32.5	30.9	29.2	23.7	18.3	12.8
	57	34.8	2.6	34.8	34.8	34.8	30.6	25.2	19.7	32.7	2.9	32.7	32.7	32.7	28.8	23.6	18.5
1200	77	40.1	2.6	27.3	20.1	13.0	-	-	-	37.4	3.0	26.7	19.3	11.9	-	-	-
	72	38.3	2.6	31.1	25.4	19.7	14.0	-	-	35.8	3.0	29.9	24.2	18.5	12.9	-	-
	67	36.5	2.6	35.0	30.7	26.4	20.5	14.6	-	34.2	3.0	33.1	29.1	25.2	19.2	13.3	-
	62	36.1	2.6	35.9	34.5	33.1	27.0	20.9	14.8	33.9	3.0	33.7	32.8	31.8	25.6	19.5	13.3
	57	36.3	2.6	36.3	36.3	36.3	33.5	27.2	20.9	34.0	3.0	34.0	34.0	34.0	31.1	25.6	20.1
1350	72	38.8	2.6	32.9	26.7	20.4	14.2	-	-	36.5	3.0	31.7	25.5	19.3	13.0	-	-
	67	37.6	2.6	36.6	32.4	28.1	21.6	15.0	-	35.4	3.0	34.6	30.7	26.9	20.3	13.7	-
	62	37.6	2.6	37.1	36.5	35.8	28.9	22.1	15.3	35.2	3.0	34.9	34.7	34.4	27.5	20.7	13.8
	57	37.8	2.6	37.7	37.7	37.7	36.3	29.2	22.1	35.4	3.0	35.3	35.3	35.3	33.4	27.6	21.8
1500	72	39.3	2.6	34.7	27.9	21.2	14.4	-	-	37.1	3.0	33.6	26.8	20.0	13.2	-	-
	67	38.7	2.6	38.3	34.0	29.8	22.6	15.5	-	36.6	3.0	36.0	32.3	28.5	21.3	14.1	-
	62	39.0	2.6	38.4	38.4	38.4	30.9	23.3	15.8	36.5	3.0	36.1	36.1	36.1	29.5	21.9	14.2
	57	39.3	2.6	38.4	38.4	38.4	38.4	31.2	23.3	36.7	3.0	36.2	36.2	36.2	35.7	29.6	23.4
		115°F								125°F							
750	77	33.9	3.4	19.0	15.2	11.4	-	-	-	30.7	3.8	17.8	14.0	10.2	-	-	-
	72	31.0	3.4	23.1	19.2	15.2	11.2	-	-	28.2	3.7	21.8	17.9	14.0	10.1	-	-
	67	28.1	3.3	27.3	23.1	19.0	15.0	10.9	-	25.6	3.7	25.6	21.8	17.8	13.8	9.8	-
	62	28.0	3.3	28.0	25.4	22.8	18.7	14.6	10.5	26.1	3.7	25.9	23.8	21.7	17.5	13.3	9.1
900	77	34.1	3.4	21.4	16.3	11.2	-	-	-	31.1	3.7	20.4	15.2	10.0	-	-	-
	72	31.8	3.4	25.0	20.5	15.9	11.4	-	-	29.1	3.7	23.7	19.2	14.8	10.3	-	-
	67	29.4	3.3	28.6	24.6	20.6	16.0	11.3	-	27.0	3.7	27.0	23.2	19.5	14.8	10.1	-
	62	29.2	3.3	29.2	27.3	25.4	20.6	15.8	11.0	27.2	3.7	27.0	25.6	24.2	19.3	14.4	9.5
	57	29.4	3.3	29.4	29.4	29.4	25.1	20.2	15.3	27.4	3.6	27.0	27.0	27.0	23.8	18.7	13.6
1050	77	34.4	3.4	23.8	17.4	11.0	-	-	-	31.5	3.7	23.1	16.5	9.9	-	-	-
	72	32.5	3.3	26.9	21.8	16.7	11.5	-	-	30.0	3.7	25.6	20.5	15.5	10.4	-	-
	67	30.7	3.3	29.9	26.1	22.3	17.0	11.7	-	28.4	3.7	28.1	24.6	21.1	15.8	10.4	-
	62	30.5	3.3	30.3	29.1	27.9	22.4	16.9	11.4	28.3	3.7	28.1	27.4	26.7	21.1	15.5	9.9
	57	30.6	3.3	30.6	30.6	30.6	26.9	22.1	17.3	28.5	3.7	28.2	28.2	28.2	25.1	20.6	16.1
1200	77	34.7	3.4	26.2	18.5	10.8	-	-	-	31.9	3.7	25.7	17.7	9.7	-	-	-
	72	33.3	3.3	28.7	23.0	17.4	11.7	-	-	30.8	3.7	27.5	21.9	16.2	10.6	-	-
	67	32.0	3.3	31.2	27.6	24.0	18.0	12.1	-	29.7	3.7	29.3	26.0	22.7	16.8	10.8	-
	62	31.7	3.3	31.5	31.0	30.5	24.3	18.1	11.8	29.4	3.7	29.3	29.3	29.3	23.0	16.6	10.3
	57	31.8	3.3	31.8	31.8	31.8	28.7	24.1	19.4	29.5	3.7	29.4	29.4	29.4	26.4	22.5	18.6
1350	72	34.1	3.3	30.6	24.3	18.1	11.9	-	-	31.7	3.7	29.4	23.2	16.9	10.7	-	-
	67	33.3	3.3	32.5	29.1	25.6	19.0	12.4	-	31.1	3.7	30.4	27.4	24.4	17.7	11.1	-
	62	32.9	3.3	32.7	32.7	32.7	26.2	19.2	12.3	30.5	3.7	30.4	30.4	30.4	24.8	17.8	10.7
	57	33.0	3.4	32.9	32.9	32.9	30.5	26.0	21.4	30.6	3.7	30.5	30.5	30.5	27.7	24.4	21.1
1500	72	34.9	3.3	32.4	25.6	18.8	12.0	-	-	32.6	3.7	31.3	24.5	17.7	10.9	-	-
	67	34.6	3.3	33.8	30.5	27.3	20.0	12.8	-	32.5	3.7	31.6	28.8	26.0	18.7	11.5	-
	62	34.1	3.3	33.8	33.8	33.8	28.0	20.4	12.7	31.6	3.7	31.6	31.6	31.6	26.6	18.9	11.1
	57	34.2	3.4	33.9	33.9	33.9	32.3	27.9	23.5	31.6	3.8	31.6	31.6	31.6	28.9	26.3	23.6

- These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 27: ZQ05 (4.0 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
1000	77	61.7	2.8	31.1	23.1	15.0	-	-	-	59.0	3.2	29.6	21.7	13.7	-	-	-
	72	56.3	2.8	37.3	30.4	23.5	16.6	-	-	53.4	3.1	35.9	29.0	22.1	15.2	-	-
	67	50.9	2.7	43.4	37.7	32.0	26.6	21.4	-	47.9	3.1	42.2	36.3	30.5	25.2	20.1	-
	62	47.7	2.7	43.4	41.9	40.5	37.2	33.1	29.5	45.8	3.0	43.4	41.1	38.8	35.6	32.0	28.6
1200	77	62.7	2.8	34.0	25.1	16.2	-	-	-	59.9	3.2	33.0	23.9	14.9	-	-	-
	72	57.7	2.8	40.1	32.6	25.2	17.7	-	-	54.8	3.1	38.9	31.3	23.8	16.3	-	-
	67	52.6	2.7	46.2	40.2	34.2	27.9	21.7	-	49.8	3.1	44.8	38.8	32.8	26.6	20.4	-
	62	49.8	2.7	46.2	44.7	43.2	38.5	33.3	28.3	47.9	3.1	45.7	43.7	41.7	37.0	32.0	27.2
1400	57	47.0	2.7	46.2	46.2	46.2	46.2	44.8	41.1	46.1	3.0	46.1	46.1	46.1	46.1	43.7	40.2
	77	63.7	2.8	36.8	27.1	17.3	-	-	-	60.7	3.2	36.3	26.1	16.0	-	-	-
	72	59.0	2.8	42.9	34.8	26.8	18.8	-	-	56.2	3.1	41.8	33.7	25.5	17.4	-	-
	67	54.3	2.7	48.9	42.6	36.3	29.1	22.1	-	51.7	3.1	47.3	41.2	35.1	27.9	20.7	-
1600	62	52.0	2.7	48.9	47.4	45.9	39.8	33.4	27.1	49.9	3.1	48.1	46.4	44.6	38.5	32.1	25.8
	57	49.6	2.7	48.9	48.9	48.9	48.9	44.6	39.3	48.4	3.1	48.4	48.4	48.4	48.4	43.5	38.2
	77	64.7	2.9	39.6	29.0	18.5	-	-	-	61.5	3.2	39.6	28.4	17.1	-	-	-
	72	60.4	2.8	45.7	37.1	28.5	19.9	-	-	57.6	3.2	44.8	36.0	27.3	18.5	-	-
1800	67	56.0	2.7	51.7	45.1	38.5	30.4	22.4	-	53.6	3.1	49.9	43.7	37.4	29.2	21.0	-
	62	54.1	2.7	51.7	50.1	48.6	41.2	33.5	25.9	52.0	3.1	50.4	49.0	47.6	39.9	32.2	24.5
	57	52.2	2.7	51.7	51.7	51.7	51.6	44.5	37.5	50.7	3.1	50.7	50.7	50.7	50.5	43.4	36.2
	72	61.8	2.8	48.5	39.3	30.2	21.0	-	-	59.0	3.2	47.7	38.4	29.0	19.6	-	-
2000	67	57.8	2.8	54.5	47.6	40.7	31.7	22.7	-	55.5	3.1	52.5	46.1	39.7	30.5	21.2	-
	62	56.3	2.8	54.5	52.9	51.3	42.5	33.6	24.7	54.1	3.1	52.8	51.6	50.5	41.4	32.2	23.1
	57	54.8	2.8	54.5	54.5	54.5	53.1	44.4	35.7	52.9	3.1	52.9	52.9	52.9	52.2	43.2	34.3
	72	63.1	2.8	51.3	41.5	31.8	22.1	-	-	60.3	3.2	50.7	40.7	30.7	20.7	-	-
1000	67	59.5	2.8	57.2	50.1	42.9	33.0	23.0	-	57.4	3.1	55.1	48.6	42.0	31.8	21.5	-
	62	58.4	2.8	57.2	55.6	54.0	43.8	33.7	23.5	56.1	3.1	55.1	54.2	53.4	42.8	32.3	21.8
	57	57.4	2.8	57.2	57.2	57.2	54.7	44.3	33.9	55.2	3.2	55.1	55.1	55.1	53.9	43.1	32.3
	95°F										105°F						
1200	77	56.3	3.5	28.1	20.3	12.5	-	-	-	51.7	4.1	28.9	21.2	13.5	-	-	-
	72	50.6	3.5	34.5	27.6	20.7	13.8	-	-	47.7	4.0	34.0	27.4	20.8	14.2	-	-
	67	44.8	3.4	40.9	34.9	29.0	23.9	18.9	-	43.7	3.9	39.1	33.6	28.1	23.3	18.5	-
	62	43.9	3.4	43.3	40.2	37.2	34.0	30.8	27.6	42.9	3.9	41.5	38.4	35.4	32.4	29.5	26.5
1400	77	57.0	3.5	31.9	22.8	13.6	-	-	-	52.3	4.1	32.2	23.3	14.3	-	-	-
	72	52.0	3.5	37.6	30.1	22.5	14.9	-	-	48.8	4.0	36.8	29.5	22.1	14.8	-	-
	67	46.9	3.4	43.3	37.4	31.4	25.3	19.1	-	45.3	3.9	41.3	35.6	30.0	24.2	18.4	-
	62	45.9	3.4	45.2	42.8	40.3	35.6	30.8	26.1	44.4	4.0	43.2	40.5	37.8	33.6	29.3	25.1
1600	57	45.2	3.4	45.2	45.2	45.2	45.2	42.6	39.3	43.8	4.0	43.8	43.8	43.8	42.9	40.2	37.5
	77	57.7	3.6	35.8	25.2	14.7	-	-	-	53.0	4.1	35.6	25.4	15.1	-	-	-
	72	53.4	3.5	40.8	32.5	24.3	16.0	-	-	49.9	4.0	39.5	31.5	23.5	15.5	-	-
	67	49.1	3.4	45.7	39.8	33.8	26.6	19.3	-	46.9	3.9	43.4	37.6	31.8	25.1	18.3	-
1800	62	47.9	3.4	47.2	45.3	43.4	37.1	30.9	24.6	45.9	4.0	44.8	42.5	40.2	34.7	29.2	23.7
	57	47.2	3.4	47.2	47.2	47.2	47.2	42.4	37.1	45.3	4.0	45.3	45.3	45.3	44.3	40.0	35.8
	77	58.4	3.6	39.6	27.7	15.8	-	-	-	53.6	4.1	39.0	27.5	15.9	-	-	-
	72	54.8	3.5	43.9	35.0	26.0	17.1	-	-	51.1	4.0	42.3	33.5	24.8	16.1	-	-
2000	67	51.2	3.5	48.2	42.2	36.3	27.9	19.5	-	48.5	4.0	45.6	39.6	33.7	26.0	18.2	-
	62	49.9	3.5	49.1	47.8	46.5	38.7	30.9	23.1	47.4	4.0	46.5	44.6	42.6	35.8	29.0	22.2
	57	49.1	3.5	49.1	49.1	49.1	49.1	42.2	35.0	46.7	4.0	46.7	46.7	46.7	45.7	39.8	34.0
	72	56.2	3.5	47.0	37.4	27.8	18.2	-	-	52.2	4.0	45.0	35.6	26.2	16.8	-	-
1000	67	53.3	3.5	50.6	44.7	38.7	29.3	19.8	-	50.1	4.0	47.7	41.6	35.6	26.8	18.1	-
	62	51.8	3.5	51.1	50.4	49.6	40.3	30.9	21.6	48.9	4.0	48.2	46.6	45.0	36.9	28.9	20.8
	57	51.1	3.5	51.1	51.1	51.1	51.1	42.1	32.8	48.2	4.0	48.2	48.2	48.2	47.0	39.6	32.3
	72	57.6	3.5	50.1	39.9	29.6	19.3	-	-	53.3	4.0	47.8	37.6	27.5	17.4	-	-
1200	67	55.4	3.5	53.0	47.1	41.2	30.6	20.0	-	51.7	4.0	49.8	43.6	37.4	27.7	18.0	-
	62	53.8	3.5	53.0	52.9	52.8	41.9	30.9	20.0	50.4	4.0	49.9	48.6	47.4	38.1	28.7	19.4
	57	53.0	3.5	53.0	53.0	53.0	53.0	41.9	30.7	49.9	4.0	49.9	49.9	49.9	48.4	39.5	30.5

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 28: ZQ05 (4.0 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		115°F								125°F							
1000	77	47.1	4.6	29.7	22.1	14.5	-	-	-	42.4	5.1	30.4	23.0	15.5	-	-	-
	72	44.8	4.5	33.5	27.2	20.9	14.6	-	-	41.9	5.0	33.0	27.0	20.9	14.9	-	-
	67	42.6	4.4	37.3	32.3	27.2	22.7	18.2	-	41.4	4.9	35.6	31.0	26.4	22.1	17.8	-
	62	42.0	4.5	39.7	36.6	33.6	30.8	28.1	25.3	41.0	5.0	37.9	34.8	31.8	29.3	26.7	24.2
1200	77	47.7	4.6	32.6	23.8	15.0	-	-	-	43.0	5.1	32.9	24.3	15.8	-	-	-
	72	45.7	4.5	35.9	28.8	21.8	14.7	-	-	42.5	5.0	35.0	28.2	21.4	14.6	-	-
	67	43.6	4.4	39.2	33.9	28.5	23.1	17.7	-	42.0	5.0	37.1	32.1	27.1	22.1	17.1	-
	62	43.0	4.5	41.1	38.2	35.3	31.5	27.8	24.0	41.5	5.0	39.0	35.9	32.8	29.5	26.3	23.0
	57	42.4	4.5	42.4	42.4	42.0	39.9	37.8	35.7	41.0	5.1	40.9	39.6	38.4	36.9	35.5	34.0
1400	77	48.3	4.6	35.4	25.5	15.6	-	-	-	43.6	5.1	35.3	25.6	16.0	-	-	-
	72	46.5	4.5	38.3	30.5	22.7	14.9	-	-	43.1	5.0	37.0	29.5	21.9	14.4	-	-
	67	44.7	4.5	41.1	35.5	29.8	23.6	17.3	-	42.6	5.0	38.7	33.3	27.8	22.1	16.3	-
	62	44.0	4.5	42.5	39.7	37.0	32.2	27.5	22.7	42.0	5.0	40.2	36.9	33.7	29.8	25.8	21.8
	57	43.4	4.5	43.4	43.4	43.4	40.9	37.6	34.4	41.5	5.1	41.5	40.6	39.6	37.4	35.2	33.0
1600	77	48.9	4.6	38.3	27.2	16.1	-	-	-	44.2	5.1	37.7	27.0	16.3	-	-	-
	72	47.4	4.5	40.6	32.1	23.6	15.1	-	-	43.7	5.0	39.0	30.7	22.4	14.1	-	-
	67	45.8	4.5	42.9	37.0	31.1	24.0	16.9	-	43.2	5.0	40.3	34.4	28.6	22.0	15.5	-
	62	45.0	4.5	43.9	41.3	38.6	32.9	27.2	21.4	42.5	5.0	41.3	38.0	34.7	30.0	25.3	20.6
	57	44.3	4.5	44.3	44.3	44.3	41.8	37.4	33.1	41.9	5.0	41.9	41.6	40.8	37.9	35.0	32.1
1800	72	48.2	4.5	43.0	33.8	24.5	15.3	-	-	44.2	5.0	41.0	31.9	22.9	13.8	-	-
	67	46.9	4.5	44.8	38.6	32.4	24.4	16.4	-	43.7	5.0	41.9	35.6	29.3	22.0	14.8	-
	62	46.0	4.5	45.3	42.8	40.3	33.6	26.8	20.1	43.1	5.0	42.5	39.1	35.7	30.2	24.8	19.4
	57	45.3	4.5	45.3	45.3	45.3	42.7	37.2	31.7	42.5	5.0	42.5	42.5	42.0	38.4	34.8	31.2
2000	72	49.1	4.5	45.4	35.4	25.4	15.5	-	-	44.8	5.0	43.0	33.2	23.4	13.6	-	-
	67	48.0	4.5	46.7	40.2	33.7	24.9	16.0	-	44.3	5.0	43.5	36.7	30.0	22.0	14.0	-
	62	47.0	4.5	46.7	44.4	42.0	34.3	26.5	18.8	43.6	5.0	43.6	40.1	36.6	30.5	24.3	18.2
	57	46.7	4.5	46.7	46.7	46.7	43.7	37.0	30.4	43.6	5.0	43.6	43.5	43.3	38.9	34.6	30.3

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 29: ZQ06 (5.0 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil																
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						
				Return dry bulb (°F)								Return dry bulb (°F)						
				90	85	80	75	70	65			90	85	80	75	70	65	
		75°F									85°F							
1250	77	75.2	3.6	38.2	32.6	26.9	—	—	—	72.1	4.0	36.7	31.2	25.7	—	—	—	
	72	69.4	3.5	46.6	40.0	33.5	26.9	—	—	66.0	4.0	45.2	38.6	32.1	25.6	—	—	
	67	63.6	3.4	55.0	47.5	40.0	33.4	26.9	—	59.9	3.9	53.6	46.0	38.5	31.9	25.3	—	
	62	60.2	3.4	60.2	53.6	46.6	38.7	33.4	26.9	57.1	3.8	57.1	51.3	44.8	37.6	31.6	24.9	
1500	77	76.2	3.6	42.0	34.3	26.7	—	—	—	72.8	4.1	41.0	33.2	25.5	—	—	—	
	72	70.9	3.5	50.3	42.6	34.9	27.1	—	—	67.5	4.0	49.1	41.3	33.5	25.7	—	—	
	67	65.7	3.5	58.7	50.9	43.1	35.2	27.4	—	62.1	3.9	57.2	49.4	41.6	33.6	25.7	—	
	62	63.0	3.4	60.0	57.3	51.3	42.3	35.4	27.4	59.9	3.9	57.5	55.0	49.6	41.1	33.6	25.5	
1750	57	60.3	3.4	60.3	60.3	59.5	51.4	43.4	35.3	57.7	3.8	57.7	57.7	57.7	49.5	41.4	33.2	
	77	77.1	3.6	45.8	36.1	26.4	—	—	—	73.5	4.1	45.4	35.3	25.2	—	—	—	
	72	72.4	3.6	54.1	45.2	36.3	27.4	—	—	68.9	4.0	53.1	44.0	34.9	25.9	—	—	
	67	67.8	3.5	62.4	54.3	46.2	37.0	27.9	—	64.3	3.9	60.7	52.7	44.7	35.4	26.2	—	
2000	62	65.7	3.5	63.5	61.0	56.1	45.9	37.3	28.0	62.7	3.9	60.8	58.7	54.4	44.6	35.6	26.1	
	57	63.6	3.5	63.6	63.6	63.2	56.4	46.8	37.2	61.1	3.9	61.1	61.1	61.1	54.6	44.9	35.3	
	77	78.0	3.7	49.5	37.8	26.1	—	—	—	74.2	4.1	49.7	37.3	24.9	—	—	—	
	72	73.9	3.6	57.9	47.8	37.7	27.6	—	—	70.4	4.0	57.0	46.7	36.4	26.1	—	—	
2250	67	69.9	3.5	66.2	57.7	49.2	38.8	28.4	—	66.6	4.0	64.0	56.1	47.8	37.2	26.7	—	
	62	68.4	3.5	66.5	64.6	60.8	49.6	39.3	28.5	65.5	3.9	64.3	62.5	59.2	48.2	37.6	26.7	
	57	66.9	3.5	66.9	66.9	66.9	61.3	50.2	39.1	64.5	3.9	64.5	64.5	64.5	59.6	48.5	37.4	
	72	75.5	3.6	61.6	50.3	39.1	27.8	—	—	71.8	4.0	60.9	49.4	37.8	26.2	—	—	
2500	67	72.0	3.6	69.9	61.1	52.3	40.6	28.9	—	68.8	4.0	67.8	59.4	50.9	39.0	27.1	—	
	62	71.1	3.6	70.0	68.3	65.6	53.2	41.3	29.1	68.3	4.0	67.8	66.2	64.1	51.7	39.6	27.4	
	57	70.3	3.5	70.3	70.3	70.3	66.2	53.6	41.0	67.9	4.0	67.9	67.9	67.9	64.6	52.0	39.5	
	72	77.0	3.6	65.4	52.9	40.5	28.0	—	—	73.2	4.1	64.9	52.0	39.2	26.4	—	—	
1250	67	74.1	3.6	73.6	64.5	55.4	42.4	29.4	—	71.0	4.0	70.8	62.7	54.0	40.8	27.6	—	
	62	73.9	3.6	73.6	72.0	70.3	56.8	43.2	29.7	71.1	4.0	70.9	69.9	68.9	55.2	41.6	28.0	
	57	73.6	3.6	73.6	73.6	73.6	71.1	57.0	42.9	71.3	4.0	71.3	71.3	71.3	69.6	55.6	41.6	
			95°F									105°F						
1250	77	69.0	4.5	35.2	29.9	24.5	—	—	—	64.1	5.1	33.4	28.1	22.8	—	—	—	
	72	62.6	4.4	43.8	37.2	30.7	24.2	—	—	57.9	5.0	42.0	35.3	28.5	21.8	—	—	
	67	56.3	4.3	52.3	44.6	36.9	30.3	23.7	—	51.7	4.9	50.6	42.4	34.3	27.8	21.2	—	
	62	54.0	4.3	54.0	49.0	43.1	36.4	29.7	23.0	50.8	4.9	50.8	45.9	40.1	33.7	27.4	21.0	
1500	77	69.4	4.5	40.1	32.2	24.3	—	—	—	64.5	5.1	38.4	30.3	22.3	—	—	—	
	72	64.0	4.4	47.9	40.0	32.2	24.3	—	—	59.3	5.0	45.9	37.9	29.9	21.9	—	—	
	67	58.6	4.3	54.9	47.9	40.1	32.1	24.1	—	54.2	4.9	52.0	45.5	37.6	29.6	21.7	—	
	62	56.9	4.3	55.0	52.8	48.0	39.9	31.8	23.7	53.5	4.9	52.5	49.7	45.3	37.3	29.4	21.4	
1750	57	55.2	4.3	55.2	55.2	55.2	47.6	39.4	31.2	52.8	4.9	52.8	52.8	52.8	45.0	37.1	29.2	
	77	69.8	4.5	45.0	34.5	24.0	—	—	—	64.9	5.1	43.3	32.5	21.7	—	—	—	
	72	65.4	4.4	52.0	42.8	33.6	24.4	—	—	60.7	5.0	49.8	40.5	31.3	22.1	—	—	
	67	60.9	4.3	58.3	51.1	43.2	33.9	24.5	—	56.6	5.0	54.9	48.5	40.9	31.5	22.1	—	
2000	62	59.8	4.3	58.5	56.5	52.8	43.3	33.8	24.3	56.1	5.0	55.5	53.5	50.4	40.9	31.4	21.8	
	57	58.6	4.3	58.6	58.6	58.6	52.8	43.1	33.4	55.7	5.0	55.7	55.7	55.7	50.3	40.6	31.0	
	77	70.3	4.5	49.8	36.8	23.8	—	—	—	65.2	5.1	48.3	34.8	21.2	—	—	—	
	72	66.8	4.4	56.1	45.6	35.1	24.5	—	—	62.1	5.1	53.6	43.2	32.7	22.2	—	—	
2250	67	63.2	4.4	61.8	54.4	46.4	35.7	24.9	—	59.0	5.0	58.5	51.6	44.1	33.3	22.5	—	
	62	62.6	4.4	61.9	60.3	57.7	46.8	35.9	25.0	58.8	5.0	58.6	57.3	55.6	44.5	33.4	22.3	
	57	62.0	4.4	62.0	62.0	62.0	57.9	46.8	35.7	58.6	5.0	58.6	58.6	58.6	55.6	44.2	32.8	
	72	68.1	4.5	60.2	48.4	36.5	24.7	—	—	63.5	5.1	57.5	45.8	34.1	22.3	—	—	
2500	67	65.6	4.4	65.2	57.7	49.5	37.5	25.4	—	61.7	5.1	61.2	54.6	47.4	35.2	23.0	—	
	62	65.5	4.4	65.5	64.0	62.5	50.2	37.9	25.6	61.6	5.1	61.4	61.1	60.7	48.0	35.4	22.7	
	57	65.5	4.4	65.5	65.5	65.5	63.0	50.5	38.0	61.5	5.1	61.5	61.5	61.5	60.9	47.7	34.6	
	72	69.5	4.5	64.4	51.2	38.0	24.8	—	—	64.9	5.1	61.4	48.4	35.5	22.5	—	—	
1250	67	69.2	4.4	68.0	60.9	52.7	39.2	25.8	—	64.4	5.1	63.7	57.7	50.7	37.1	23.4	—	
	62	69.0	4.4	68.2	67.8	67.4	53.7	40.0	26.3	64.1	5.1	63.9	63.9	63.9	51.6	37.4	23.1	
	57	68.9	4.5	68.8	68.8	68.8	68.1	54.2	40.2	64.0	5.1	63.9	63.9	63.9	63.9	51.3	36.3	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 30: ZQ06 (5.0 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		115°F								125°F							
1250	77	59.3	5.7	31.6	26.3	21.0	—	—	—	54.5	6.4	29.9	24.6	19.2	—	—	—
	72	53.3	5.6	40.2	33.3	26.4	19.4	—	—	48.6	6.2	38.5	31.3	24.2	17.1	—	—
	67	48.2	5.5	47.5	40.3	31.7	25.3	18.8	—	45.0	6.1	44.2	38.1	29.2	22.7	16.3	—
	62	47.7	5.5	47.7	42.8	37.1	31.1	25.1	19.0	44.5	6.2	44.5	39.7	34.1	28.4	22.8	17.1
1500	77	59.6	5.7	36.7	28.5	20.2	—	—	—	54.7	6.4	35.0	26.6	18.2	—	—	—
	72	54.6	5.7	43.9	35.8	27.7	19.6	—	—	50.0	6.3	41.9	33.7	25.4	17.2	—	—
	67	51.2	5.6	50.0	43.1	35.1	27.2	19.2	—	48.2	6.2	45.4	40.7	32.7	24.7	16.8	—
	62	50.8	5.6	50.1	46.6	42.6	34.8	27.0	19.2	46.7	6.2	46.0	43.6	39.9	32.2	24.6	17.0
	57	50.5	5.6	50.3	50.2	50.0	42.4	34.8	27.1	46.2	6.2	46.1	46.1	46.1	39.8	32.4	25.1
1750	77	59.9	5.8	41.7	30.6	19.5	—	—	—	54.9	6.4	40.1	28.6	17.2	—	—	—
	72	56.0	5.7	47.5	38.3	29.0	19.7	—	—	51.4	6.3	45.3	36.0	26.7	17.4	—	—
	67	52.9	5.6	51.9	45.9	38.5	29.1	19.7	—	50.7	6.2	49.0	43.3	36.2	26.7	17.3	—
	62	52.5	5.6	52.0	50.5	48.0	38.5	28.9	19.4	50.2	6.3	49.3	47.5	45.6	36.1	26.5	16.9
	57	52.2	5.6	52.2	52.2	52.2	47.9	38.2	28.5	50.0	6.3	49.8	49.8	49.8	45.4	35.7	26.0
2000	77	60.1	5.8	46.7	32.7	18.7	—	—	—	55.1	6.4	45.2	30.7	16.2	—	—	—
	72	57.4	5.7	51.2	40.7	30.3	19.9	—	—	52.8	6.3	48.7	38.3	27.9	17.5	—	—
	67	54.7	5.7	54.7	48.7	41.9	31.0	20.1	—	51.8	6.3	50.2	45.9	39.7	28.7	17.7	—
	62	55.2	5.7	54.8	54.3	53.5	42.2	30.9	19.5	51.1	6.3	50.3	50.3	50.3	39.9	28.4	16.8
	57	55.0	5.7	54.8	54.8	54.8	53.3	41.6	29.8	50.5	6.3	50.5	50.5	50.5	50.5	39.0	26.9
2250	72	58.8	5.7	54.8	43.2	31.6	20.0	—	—	54.1	6.4	52.1	40.6	29.1	17.7	—	—
	67	57.6	5.7	57.0	51.6	45.3	32.9	20.6	—	53.6	6.3	52.4	48.5	43.2	30.7	18.2	—
	62	57.4	5.7	57.2	57.2	57.2	45.9	32.8	19.7	53.3	6.4	52.6	52.6	52.6	43.7	30.2	16.8
	57	57.2	5.7	57.2	57.2	57.2	57.2	45.0	31.2	53.0	6.4	52.9	52.9	52.9	52.9	42.2	27.8
2500	72	60.2	5.8	58.4	45.7	32.9	20.2	—	—	55.7	6.4	55.2	42.9	30.4	17.8	—	—
	67	59.9	5.7	59.0	54.4	48.7	34.9	21.1	—	55.6	6.4	55.3	51.1	46.7	32.7	18.7	—
	62	59.8	5.8	59.4	59.4	59.4	49.6	34.7	19.9	55.5	6.4	55.4	55.4	55.4	47.5	32.1	16.7
	57	59.7	5.8	59.6	59.6	59.6	59.6	48.4	32.5	55.4	6.4	55.4	55.4	55.4	55.4	45.5	28.6

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

# ZXA7 cooling capacities

**Table 31: ZXA7 (6 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM		WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity (MBh)¹	Total input (kW)²	Sensible capacity (MBh)						
					Return dry bulb (°F)								Return dry bulb (°F)						
					90	85	80	75	70	65			90	85	80	75	70	65	
		75°F									85°F								
1500	77	89.8	4.1	45.1	37.4	29.8	-	-	-		84.7	4.6	41.2	34.3	27.5	-	-	-	
	72	82.1	4.0	55.6	47.1	38.5	30.0	-	-		76.7	4.5	52.7	44.4	36.1	27.9	-	-	
	67	74.3	3.9	66.1	56.7	47.3	38.1	30.4	-		68.8	4.4	64.2	54.5	44.8	36.2	28.4	-	
	62	74.4	3.9	72.9	63.5	56.0	45.6	39.4	31.1		70.8	4.4	68.1	60.3	53.5	44.3	37.2	29.0	
1800	77	91.0	4.1	51.6	40.8	29.9	-	-	-		85.5	4.6	48.6	38.0	27.4	-	-	-	
	72	84.1	4.0	59.7	50.0	40.3	30.5	-	-		78.8	4.5	57.1	47.5	37.8	28.2	-	-	
	67	77.2	4.0	67.8	59.2	50.6	40.3	31.1	-		72.1	4.5	65.5	56.9	48.3	38.3	28.9	-	
	62	74.7	4.0	73.8	67.4	60.9	49.4	41.3	31.5		71.2	4.5	69.9	64.3	58.7	48.0	39.1	29.3	
2100	57	60.7	3.9	60.7	60.7	60.7	60.7	51.6	41.7		59.4	4.5	59.4	59.4	59.4	59.2	49.3	39.5	
	77	92.2	4.1	58.1	44.1	30.1	-	-	-		86.4	4.6	56.0	41.7	27.4	-	-	-	
	72	86.2	4.1	63.9	52.9	42.0	31.1	-	-		80.9	4.6	61.5	50.5	39.5	28.6	-	-	
	67	80.1	4.0	69.6	61.8	54.0	42.4	31.7	-		75.4	4.5	66.9	59.3	51.7	40.3	29.3	-	
	62	75.1	4.0	74.6	71.2	65.9	53.3	43.2	31.9		71.6	4.5	71.6	68.3	63.8	51.8	41.1	29.7	
2400	57	61.4	4.0	61.4	61.4	61.4	61.4	54.7	43.2		59.6	4.5	59.6	59.6	59.6	59.6	52.8	41.2	
	77	93.4	4.1	64.7	47.5	30.3	-	-	-		87.2	4.6	63.5	45.4	27.4	-	-	-	
	72	88.2	4.1	68.0	55.9	43.8	31.7	-	-		83.0	4.6	65.9	53.5	41.2	28.9	-	-	
	67	83.0	4.0	71.3	64.3	57.3	44.5	32.3	-		78.7	4.5	68.2	61.7	55.1	42.3	29.8	-	
	62	75.4	4.0	75.4	75.1	70.8	57.1	45.1	32.3		72.0	4.5	72.0	72.0	69.0	55.6	43.0	30.0	
2700	57	62.1	4.0	62.1	62.1	62.1	62.1	57.9	44.7		59.7	4.5	59.7	59.7	59.7	59.7	56.2	42.8	
	72	90.2	4.1	72.1	58.8	45.5	32.3	-	-		85.1	4.6	70.3	56.6	42.9	29.3	-	-	
	67	85.9	4.0	73.1	66.8	60.6	46.7	33.0	-		82.1	4.6	69.6	64.1	58.6	44.4	30.3	-	
	62	75.8	4.0	75.8	75.8	75.7	61.0	47.0	32.7		72.3	4.6	72.3	72.3	72.3	59.4	45.0	30.4	
	57	62.8	4.1	62.8	62.8	62.8	62.8	61.0	46.1		59.9	4.6	59.9	59.9	59.9	59.9	59.6	44.5	
3000	72	92.3	4.1	76.2	61.8	47.3	32.8	-	-		87.2	4.6	74.7	59.6	44.6	29.6	-	-	
	67	88.8	4.1	74.8	69.4	64.0	48.8	33.6	-		85.4	4.6	71.0	66.5	62.0	46.4	30.8	-	
	62	76.2	4.1	76.2	76.2	76.2	64.8	48.9	33.0		72.7	4.6	72.7	72.7	72.7	63.1	46.9	30.7	
	57	63.5	4.1	63.5	63.5	63.5	63.5	63.5	47.6		60.0	4.6	60.0	60.0	60.0	60.0	60.0	46.2	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 32: ZXA7 (6 ton, 95°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		95°F									105°F								
1500	77	79.5	5.1	37.2	31.2	25.1	-	-	-	76.5	5.8	35.3	29.1	23.0	-	-	-		
	72	71.4	5.0	49.7	41.7	33.8	25.8	-	-	67.1	5.7	47.4	39.5	31.6	23.6	-	-		
	67	63.2	4.9	62.2	52.3	42.4	34.4	26.4	-	57.7	5.7	57.7	49.9	40.2	32.1	24.1	-		
	62	67.3	4.9	63.3	57.2	51.0	43.0	34.9	26.8	63.8	5.7	59.9	54.3	48.7	40.6	32.4	24.3		
1800	77	80.0	5.1	45.6	35.2	24.9	-	-	-	75.3	5.8	43.6	33.2	22.7	-	-	-		
	72	73.5	5.0	54.4	44.9	35.4	25.9	-	-	68.5	5.8	52.0	42.5	33.1	23.7	-	-		
	67	67.0	5.0	63.2	54.6	45.9	36.3	26.7	-	61.6	5.7	60.3	51.9	43.5	33.9	24.4	-		
	62	67.7	5.0	66.1	61.3	56.4	46.7	36.9	27.1	64.0	5.7	62.4	58.2	53.9	44.2	34.5	24.7		
	57	58.2	5.0	58.2	58.2	57.0	47.1	37.2		59.6	5.7	59.6	59.6	59.6	54.4	44.5	34.6		
2100	77	80.5	5.1	53.9	39.3	24.7	-	-	-	74.2	5.8	52.0	37.2	22.5	-	-	-		
	72	75.6	5.1	59.1	48.1	37.1	26.1	-	-	69.8	5.8	56.5	45.6	34.7	23.8	-	-		
	67	70.7	5.0	64.2	56.8	49.4	38.2	27.0	-	65.4	5.7	61.0	54.0	46.9	35.8	24.7	-		
	62	68.1	5.0	68.1	65.4	61.8	50.4	38.9	27.4	64.3	5.7	64.3	62.0	59.1	47.8	36.5	25.1		
	57	57.8	5.0	57.8	57.8	57.8	57.8	50.8	39.1	58.0	5.7	58.0	58.0	58.0	58.0	47.6	35.7		
2400	77	81.1	5.1	62.3	43.4	24.4	-	-	-	73.0	5.8	60.3	41.3	22.2	-	-	-		
	72	77.8	5.1	63.7	51.2	38.7	26.2	-	-	71.2	5.8	61.0	48.6	36.2	23.9	-	-		
	67	74.5	5.0	65.2	59.1	53.0	40.1	27.3	-	69.3	5.8	61.7	56.0	50.3	37.6	25.0	-		
	62	68.5	5.0	68.5	68.5	67.2	54.1	40.9	27.7	64.5	5.7	64.5	64.5	64.3	51.4	38.5	25.6		
	57	57.4	5.0	57.4	57.4	57.4	57.4	54.5	41.0	56.4	5.7	56.4	56.4	56.4	56.4	50.6	36.7		
2700	72	79.9	5.1	68.4	54.4	40.3	26.3	-	-	72.5	5.8	65.5	51.7	37.8	23.9	-	-		
	67	78.2	5.1	66.1	61.3	56.5	42.0	27.6	-	73.2	5.8	62.4	58.0	53.6	39.5	25.3	-		
	62	68.9	5.1	68.9	68.9	68.9	57.8	42.9	28.0	64.8	5.8	64.8	64.8	64.8	55.0	40.5	26.0		
	57	57.0	5.1	57.0	57.0	57.0	57.0	57.0	42.9	54.7	5.8	54.7	54.7	54.7	54.7	53.6	37.8		
3000	72	82.0	5.1	73.1	57.5	42.0	26.4	-	-	73.8	5.8	70.1	54.7	39.4	24.0	-	-		
	67	81.9	5.1	67.1	63.5	60.0	43.9	27.9	-	77.0	5.8	63.1	60.1	57.0	41.3	25.6	-		
	62	69.3	5.1	69.3	69.3	69.3	61.5	44.9	28.4	65.0	5.8	65.0	65.0	65.0	58.6	42.5	26.5		
	57	56.6	5.1	56.6	56.6	56.6	56.6	56.6	44.9	53.1	5.8	53.1	53.1	53.1	53.1	53.1	38.8		
		115°F									125°F								
1500	77	73.4	6.5	33.3	27.1	20.8	-	-	-	70.4	7.2	31.4	25.0	18.6	-	-	-		
	72	62.9	6.5	45.2	37.3	29.4	21.5	-	-	58.6	7.2	42.9	35.0	27.2	19.3	-	-		
	67	52.3	6.4	52.3	47.4	37.9	29.8	21.8	-	46.8	7.2	46.8	45.0	35.7	27.6	19.5	-		
	62	60.3	6.4	56.4	51.5	46.5	38.2	30.0	21.7	56.8	7.1	53.0	48.6	44.2	35.9	27.5	19.2		
1800	77	70.6	6.5	41.7	31.1	20.6	-	-	-	65.9	7.2	39.7	29.0	18.4	-	-	-		
	72	63.4	6.5	49.5	40.2	30.8	21.5	-	-	58.4	7.2	47.1	37.8	28.6	19.3	-	-		
	67	56.2	6.5	56.2	49.3	41.1	31.6	22.1	-	50.9	7.2	50.9	46.6	38.7	29.3	19.8	-		
	62	60.4	6.4	58.7	55.0	51.4	41.7	32.0	22.3	56.7	7.1	54.9	51.9	48.9	39.2	29.6	19.9		
	57	61.1	6.4	59.9	59.9	59.9	51.8	41.9	32.0	62.6	7.1	55.3	55.3	55.3	49.2	39.3	29.5		
2100	77	67.8	6.5	50.0	35.1	20.3	-	-	-	61.4	7.2	48.0	33.0	18.1	-	-	-		
	72	64.0	6.5	53.9	43.1	32.3	21.5	-	-	58.2	7.2	51.3	40.6	30.0	19.3	-	-		
	67	60.2	6.5	57.9	51.1	44.3	33.4	22.4	-	54.9	7.2	54.7	48.2	41.8	30.9	20.1	-		
	62	60.5	6.4	60.5	58.6	56.4	45.2	34.0	22.9	56.7	7.2	56.7	55.2	53.6	42.6	31.6	20.6		
	57	58.2	6.4	58.2	58.2	58.2	56.3	44.3	32.2	58.5	7.1	58.5	58.5	58.5	53.3	41.0	28.8		
2400	77	64.9	6.5	58.3	39.2	20.0	-	-	-	56.9	7.2	56.3	37.0	17.8	-	-	-		
	72	64.5	6.5	58.3	46.0	33.8	21.6	-	-	57.9	7.2	55.6	43.5	31.4	19.2	-	-		
	67	64.1	6.5	58.3	52.9	47.6	35.1	22.7	-	59.0	7.2	54.9	49.9	44.9	32.6	20.4	-		
	62	60.6	6.5	60.6	60.6	60.6	48.7	36.1	23.4	56.7	7.2	56.7	56.7	56.7	46.0	33.6	21.3		
	57	55.3	6.4	55.3	55.3	55.3	46.6	32.4		54.3	7.1	54.3	54.3	54.3	54.3	42.7	28.1		
2700	72	65.1	6.5	62.7	49.0	35.3	21.6	-	-	57.7	7.2	57.7	46.3	32.8	19.2	-	-		
	67	68.1	6.5	58.7	54.8	50.8	36.9	23.0	-	63.1	7.2	55.1	51.5	47.9	34.3	20.7	-		
	62	60.7	6.5	60.7	60.7	60.7	52.2	38.1	24.0	56.6	7.2	56.6	56.6	56.6	49.4	35.7	22.0		
	57	52.5	6.5	52.5	52.5	52.5	52.5	49.0	32.6	50.2	7.2	50.2	50.2	50.2	50.2	44.4	27.4		
3000	72	65.7	6.5	65.7	51.9	36.8	21.6	-	-	57.5	7.2	57.5	49.1	34.1	19.2	-	-		
	67	72.1	6.5	59.2	56.6	54.0	38.6	23.3	-	67.1	7.2	55.2	53.1	51.0	36.0	21.0	-		
	62	60.8	6.5	60.8	60.8	60.8	55.7	40.1	24.6	56.6	7.2	56.6	56.6	56.6	52.8	37.7	22.7		
	57	49.6	6.5	49.6	49.6	49.6	49.6	49.6	32.8	46.1	7.2	46.1	46.1	46.1	46.1	46.1	26.8		

1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.

- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



## ZY04 to 12 cooling capacities

**Table 33: ZY04 (3.0 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
750	77	47.1	2.1	23.2	19.7	16.3	-	-	-	45.3	2.4	22.2	18.7	15.1	-	-	-
	72	43.9	2.1	28.3	24.1	19.9	15.8	-	-	41.7	2.4	27.4	23.1	18.9	14.7	-	-
	67	40.8	2.1	33.3	28.5	23.6	19.9	15.7	-	38.1	2.4	32.5	27.6	22.7	18.8	14.6	-
	62	36.2	2.1	34.8	31.0	27.2	22.8	19.8	16.2	35.0	2.4	33.6	30.1	26.6	22.3	18.7	14.8
900	77	47.9	2.1	26.0	21.3	16.7	-	-	-	46.0	2.4	25.2	20.5	15.7	-	-	-
	72	45.1	2.1	31.0	26.1	21.2	16.4	-	-	42.8	2.4	30.0	25.1	20.3	15.4	-	-
	67	42.2	2.1	35.9	30.8	25.8	21.2	16.4	-	39.7	2.4	34.8	29.8	24.8	20.1	15.3	-
	62	38.3	2.1	37.1	33.7	30.4	25.2	21.2	16.6	37.0	2.4	35.8	32.6	29.4	24.4	20.0	15.3
	57	38.3	2.1	38.3	36.6	34.9	30.5	26.0	21.5	36.6	2.4	36.6	35.4	34.0	29.4	24.8	20.2
1050	77	48.7	2.1	28.9	23.0	17.0	-	-	-	46.6	2.4	28.2	22.3	16.3	-	-	-
	72	46.2	2.1	33.7	28.1	22.5	17.0	-	-	44.0	2.4	32.7	27.1	21.6	16.1	-	-
	67	43.6	2.1	38.4	33.2	28.0	22.6	17.0	-	41.3	2.4	37.1	32.0	26.9	21.5	15.9	-
	62	40.4	2.1	39.4	36.5	33.5	27.6	22.5	17.0	39.0	2.4	37.9	35.1	32.2	26.5	21.3	15.9
	57	40.1	2.1	40.1	39.3	38.5	33.5	28.1	22.6	38.6	2.4	38.6	37.9	37.2	32.1	26.7	21.3
1200	77	49.6	2.1	31.7	24.6	17.4	-	-	-	47.3	2.4	31.2	24.1	16.9	-	-	-
	72	47.3	2.1	36.4	30.1	23.8	17.6	-	-	45.1	2.4	35.3	29.1	23.0	16.8	-	-
	67	45.0	2.1	41.0	35.6	30.2	24.0	17.6	-	42.8	2.4	39.4	34.2	29.0	22.8	16.6	-
	62	42.5	2.1	41.7	39.2	36.7	30.0	23.9	17.5	41.0	2.3	40.1	37.5	35.0	28.7	22.6	16.5
	57	42.0	2.1	42.0	42.0	42.0	36.6	30.1	23.7	40.5	2.3	40.5	40.5	40.5	34.9	28.7	22.5
1350	72	48.4	2.1	39.1	32.1	25.1	18.2	-	-	46.2	2.4	38.0	31.1	24.3	17.5	-	-
	67	46.4	2.1	43.5	38.0	32.5	25.4	18.2	-	44.4	2.3	41.7	36.4	31.1	24.2	17.3	-
	62	44.6	2.1	44.0	41.9	39.8	32.3	25.2	17.9	43.0	2.3	42.2	40.0	37.8	30.8	24.0	17.0
	57	43.8	2.1	43.8	43.8	43.8	39.7	32.2	24.7	42.4	2.3	42.4	42.4	42.4	37.6	30.6	23.6
1500	72	49.5	2.1	41.8	34.1	26.4	18.7	-	-	47.4	2.4	40.6	33.1	25.7	18.2	-	-
	67	47.8	2.1	46.1	40.4	34.7	26.7	18.8	-	46.0	2.3	44.0	38.6	33.1	25.6	18.0	-
	62	46.7	2.1	46.3	44.6	43.0	34.7	26.5	18.3	45.0	2.3	44.4	42.5	40.6	33.0	25.3	17.6
	57	45.7	2.1	45.7	45.7	45.7	42.7	34.3	25.8	44.3	2.3	44.3	44.3	44.3	40.3	32.6	24.8

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 34: ZY04 (3.0 ton, 95°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		95°F								105°F							
750	77	43.5	2.6	21.3	17.6	13.8	-	-	-	39.8	3.1	20.9	16.8	12.8	-	-	-
	72	39.4	2.6	26.5	22.2	17.9	13.6	-	-	36.7	3.1	25.1	20.9	16.7	12.5	-	-
	67	35.4	2.6	31.7	26.8	21.9	17.7	13.4	-	33.6	3.1	29.4	25.0	20.7	16.5	12.3	-
	62	33.8	2.6	32.4	29.2	25.9	21.8	17.6	13.4	32.1	3.0	30.7	27.7	24.6	20.5	16.3	12.2
900	77	44.0	2.6	24.5	19.6	14.7	-	-	-	40.2	3.1	23.9	18.6	13.3	-	-	-
	72	40.6	2.6	29.1	24.2	19.3	14.4	-	-	37.6	3.1	27.6	22.8	17.9	13.1	-	-
	67	37.1	2.6	33.7	28.8	23.9	19.0	14.2	-	35.0	3.0	31.3	26.9	22.5	17.7	12.9	-
	62	35.7	2.6	34.5	31.4	28.4	23.6	18.9	14.1	33.6	3.0	32.5	29.8	27.2	22.3	17.5	12.7
1050	57	35.0	2.6	35.0	34.1	33.0	28.3	23.6	18.9	32.8	3.0	32.8	32.7	31.8	27.0	22.2	17.4
	77	44.6	2.6	27.6	21.6	15.6	-	-	-	40.7	3.1	26.9	20.3	13.8	-	-	-
	72	41.7	2.6	31.7	26.2	20.7	15.2	-	-	38.5	3.1	30.1	24.6	19.1	13.6	-	-
	67	38.9	2.6	35.8	30.8	25.8	20.3	14.9	-	36.4	3.0	33.3	28.9	24.4	18.9	13.4	-
1200	62	37.5	2.6	36.5	33.7	30.9	25.5	20.2	14.8	35.2	3.0	34.2	32.0	29.7	24.2	18.8	13.3
	57	37.0	2.6	37.0	36.6	36.0	30.7	25.4	20.1	34.6	3.0	34.6	34.6	34.6	29.5	24.1	18.6
	77	45.1	2.6	30.8	23.6	16.4	-	-	-	41.1	3.1	29.9	22.1	14.3	-	-	-
	72	42.9	2.6	34.3	28.2	22.1	16.0	-	-	39.4	3.1	32.6	26.4	20.3	14.2	-	-
1350	67	40.7	2.6	37.8	32.8	27.7	21.7	15.7	-	37.8	3.0	35.3	30.8	26.3	20.1	14.0	-
	62	39.4	2.6	38.5	35.9	33.4	27.4	21.4	15.5	36.8	3.0	36.0	34.1	32.2	26.1	20.0	13.8
	57	39.0	2.6	39.0	39.0	39.0	33.1	27.2	21.3	36.3	3.0	36.3	36.3	36.3	32.1	25.9	19.8
	72	44.0	2.6	36.9	30.2	23.5	16.8	-	-	40.4	3.1	35.0	28.3	21.5	14.7	-	-
1500	67	42.4	2.6	39.9	34.8	29.7	23.0	16.4	-	39.2	3.0	37.2	32.7	28.1	21.3	14.6	-
	62	41.3	2.6	40.5	38.2	35.8	29.3	22.7	16.2	38.4	3.0	37.7	36.3	34.8	28.0	21.2	14.4
	57	41.0	2.6	41.0	41.0	41.0	35.5	29.0	22.6	38.1	3.0	38.1	38.1	38.1	34.6	27.8	21.0
	72	45.2	2.6	39.5	32.2	24.9	17.6	-	-	41.3	3.1	37.5	30.1	22.7	15.3	-	-
750	67	44.2	2.6	42.0	36.8	31.6	24.4	17.1	-	40.6	3.0	39.2	34.6	30.0	22.6	15.1	-
	62	43.2	2.6	42.5	40.4	38.3	31.2	24.0	16.8	40.0	3.0	39.5	38.4	37.3	29.9	22.4	15.0
	57	43.0	2.6	43.0	43.0	43.0	37.9	30.9	23.8	39.8	3.0	39.8	39.8	39.8	37.2	29.7	22.2
	115°F								125°F								
750	77	36.2	3.6	20.4	16.1	11.7	-	-	-	32.5	4.2	20.0	15.3	10.7	-	-	-
	72	34.0	3.5	23.8	19.7	15.6	11.5	-	-	31.2	4.0	22.4	18.4	14.4	10.4	-	-
	67	31.7	3.5	27.1	23.3	19.4	15.3	11.2	-	29.9	3.9	24.9	21.5	18.2	14.2	10.1	-
	62	30.3	3.5	29.0	26.2	23.3	19.2	15.1	10.9	28.6	3.9	27.3	24.6	22.0	17.9	13.8	9.7
900	77	36.5	3.6	23.3	17.6	11.9	-	-	-	32.7	4.1	22.7	16.6	10.5	-	-	-
	72	34.6	3.5	26.1	21.3	16.6	11.8	-	-	31.7	4.0	24.6	19.9	15.2	10.5	-	-
	67	32.8	3.5	29.0	25.1	21.2	16.4	11.6	-	30.7	3.9	26.6	23.3	19.9	15.1	10.3	-
	62	31.6	3.5	30.5	28.2	25.9	21.1	16.2	11.4	29.6	3.9	28.5	26.6	24.6	19.8	14.9	10.0
1050	57	30.7	3.4	30.7	30.7	30.6	25.7	20.8	16.0	28.5	3.9	28.5	28.5	28.5	24.4	19.4	14.5
	77	36.8	3.5	26.1	19.1	12.0	-	-	-	32.9	4.0	25.4	17.8	10.3	-	-	-
	72	35.3	3.5	28.5	23.0	17.5	12.1	-	-	32.1	4.0	26.8	21.4	16.0	10.5	-	-
	67	33.9	3.5	30.8	26.9	23.0	17.5	12.0	-	31.4	3.9	28.3	25.0	21.6	16.1	10.5	-
1200	62	32.9	3.4	32.0	30.2	28.5	22.9	17.4	11.8	30.6	3.9	29.8	28.5	27.3	21.6	16.0	10.3
	57	32.2	3.4	32.2	32.2	32.2	28.4	22.7	17.1	29.8	3.8	29.8	29.8	29.8	27.2	21.4	15.7
	77	37.1	3.5	29.0	20.6	12.2	-	-	-	33.0	3.9	28.0	19.1	10.1	-	-	-
	72	36.0	3.5	30.8	24.7	18.5	12.4	-	-	32.6	4.0	29.1	22.9	16.7	10.5	-	-
1350	67	35.0	3.4	32.7	28.7	24.8	18.6	12.4	-	32.1	3.8	30.1	26.7	23.3	17.0	10.7	-
	62	34.2	3.4	33.5	32.3	31.1	24.8	18.5	12.2	31.5	3.8	31.0	30.5	29.9	23.5	17.1	10.6
	57	33.7	3.4	33.7	33.7	33.7	31.0	24.7	18.3	31.0	3.8	31.0	31.0	31.0	30.0	23.4	16.8
	72	36.7	3.5	33.2	26.3	19.5	12.6	-	-	33.0	4.0	31.3	24.4	17.5	10.6	-	-
1500	67	36.0	3.4	34.5	30.5	26.6	19.7	12.7	-	32.8	3.8	31.8	28.4	25.0	18.0	10.9	-
	62	35.5	3.4	35.0	34.3	33.7	26.7	19.7	12.7	32.5	3.8	32.3	32.3	32.3	25.4	18.1	10.9
	57	35.1	3.4	35.1	35.1	35.1	33.7	26.6	19.5	32.2	3.8	32.2	32.2	32.2	32.2	25.4	18.0
	72	37.4	3.5	35.5	28.0	20.5	12.9	-	-	33.5	3.9	33.5	25.9	18.2	10.6	-	-
750	67	37.1	3.4	36.4	32.4	28.4	20.7	13.1	-	33.5	3.8	33.5	30.1	26.7	18.9	11.1	-
	62	36.7	3.4	36.5	36.4	36.3	28.6	20.8	13.1	33.5	3.8	33.5	33.5	33.5	27.2	19.2	11.2
	57	36.6	3.4	36.6	36.6	36.6	36.4	28.5	20.7	33.5	3.8	33.5	33.5	33.5	33.5	27.4	19.1

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 35: ZY05 (4.0 ton, 75°F to 105°F)**

Air on Evaporator Coil		Temperature of air on condenser coil															
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1000	77	64.9	2.8	32.3	27.2	22.1	-	-	-	59.9	3.1	30.9	26.2	21.5	-	-	-
	72	58.5	2.8	38.1	32.7	27.3	21.9	-	-	55.5	3.1	36.9	31.7	26.5	21.2	-	-
	67	52.1	2.8	44.0	38.3	32.6	26.9	21.8	-	51.2	3.1	43.0	37.2	31.5	26.0	20.8	-
	62	49.9	2.7	49.3	43.6	37.9	31.5	27.1	21.7	48.9	3.1	47.3	41.9	36.5	30.6	25.7	20.3
1200	77	65.4	2.8	35.9	29.1	22.4	-	-	-	60.6	3.1	34.8	28.2	21.5	-	-	-
	72	59.9	2.8	41.6	35.3	28.9	22.5	-	-	56.8	3.1	40.4	34.1	27.8	21.6	-	-
	67	54.4	2.8	47.4	41.4	35.4	28.7	22.5	-	53.1	3.1	45.9	40.1	34.2	27.7	21.4	-
	62	52.5	2.7	51.8	46.9	42.0	34.6	28.9	22.3	51.1	3.1	49.7	45.1	40.6	33.6	27.5	20.9
1400	57	51.8	2.7	51.8	51.8	48.5	41.9	35.2	28.6	49.7	3.1	49.7	49.7	47.0	40.3	33.5	26.8
	77	66.0	2.8	39.5	31.1	22.7	-	-	-	61.3	3.2	38.8	30.1	21.5	-	-	-
	72	61.3	2.8	45.1	37.8	30.5	23.1	-	-	58.1	3.2	43.8	36.5	29.2	21.9	-	-
	67	56.7	2.8	50.8	44.5	38.3	30.6	23.2	-	55.0	3.1	48.9	42.9	37.0	29.4	21.9	-
1600	62	55.1	2.8	54.4	50.2	46.1	37.8	30.7	22.9	53.3	3.1	52.0	48.4	44.7	36.7	29.3	21.5
	57	54.4	2.7	54.4	54.4	52.8	46.0	38.1	30.2	52.1	3.1	52.1	52.1	51.9	44.5	36.6	28.6
	77	66.6	2.8	43.1	33.0	22.9	-	-	-	62.0	3.2	42.7	32.1	21.4	-	-	-
	72	62.8	2.8	48.6	40.3	32.0	23.7	-	-	59.4	3.2	47.3	38.9	30.6	22.2	-	-
1800	67	58.9	2.8	54.2	47.6	41.1	32.4	23.9	-	56.9	3.2	51.8	45.8	39.7	31.0	22.5	-
	62	57.7	2.8	56.9	53.5	50.2	40.9	32.4	23.6	55.6	3.2	54.4	51.6	48.9	39.8	31.0	22.1
	57	57.0	2.8	57.0	57.0	57.0	50.1	40.9	31.8	54.6	3.1	54.6	54.6	54.6	48.8	39.6	30.4
	72	64.2	2.8	52.1	42.9	33.6	24.3	-	-	60.7	3.2	50.7	41.3	32.0	22.6	-	-
2000	67	61.2	2.8	57.6	50.7	43.9	34.2	24.6	-	58.8	3.2	54.8	48.6	42.5	32.7	23.0	-
	62	60.3	2.8	59.4	56.9	54.3	44.0	34.2	24.2	57.8	3.2	56.8	54.9	53.0	42.8	32.8	22.8
	57	59.6	2.8	59.6	59.6	59.6	54.2	43.8	33.4	57.0	3.2	57.0	57.0	57.0	53.1	42.7	32.2
	72	65.6	2.8	55.7	45.4	35.1	24.9	-	-	62.0	3.2	54.2	43.8	33.3	22.9	-	-
1000	67	63.5	2.8	61.0	53.9	46.8	36.0	25.3	-	60.7	3.2	57.7	51.5	45.3	34.4	23.6	-
	62	62.9	2.8	62.0	60.2	58.4	47.2	36.0	24.8	60.0	3.2	59.2	58.2	57.2	45.9	34.6	23.4
	57	62.2	2.8	62.2	62.2	62.2	58.3	46.6	35.0	59.4	3.2	59.4	59.4	59.4	57.4	45.7	34.0
			95°F								105°F						
1000	77	55.0	3.5	29.5	25.2	20.9	-	-	-	51.7	4.1	28.6	24.4	20.3	-	-	-
	72	52.6	3.5	35.8	30.7	25.6	20.5	-	-	48.7	4.1	34.4	29.4	24.5	19.6	-	-
	67	50.2	3.5	42.0	36.2	30.3	25.1	19.8	-	46.1	4.1	40.2	34.5	28.8	23.7	18.7	-
	62	47.8	3.5	45.3	40.2	35.0	29.6	24.2	18.8	44.5	4.1	42.8	37.9	33.0	27.9	22.7	17.6
1200	77	55.8	3.5	33.8	27.2	20.6	-	-	-	52.2	4.1	32.7	26.2	19.7	-	-	-
	72	53.8	3.5	39.1	33.0	26.8	20.6	-	-	50.0	4.1	37.6	31.6	25.6	19.5	-	-
	67	51.8	3.5	44.5	38.8	33.0	26.6	20.2	-	47.7	4.1	42.5	36.9	31.4	25.2	19.0	-
	62	49.7	3.5	47.5	43.4	39.2	32.6	26.0	19.4	46.3	4.1	44.8	41.0	37.2	30.8	24.5	18.1
1400	57	47.6	3.6	47.6	47.6	45.4	38.6	31.8	25.0	44.9	4.1	44.9	44.9	43.0	36.5	29.9	23.4
	77	56.6	3.5	38.1	29.2	20.3	-	-	-	52.7	4.1	36.9	28.0	19.2	-	-	-
	72	54.9	3.5	42.5	35.3	28.0	20.7	-	-	51.2	4.1	40.8	33.7	26.6	19.5	-	-
	67	53.3	3.5	47.0	41.3	35.7	28.2	20.6	-	49.3	4.1	44.8	39.4	34.0	26.6	19.3	-
1600	62	51.6	3.5	49.7	46.6	43.4	35.6	27.9	20.1	48.1	4.1	46.9	44.1	41.3	33.8	26.2	18.6
	57	49.9	3.5	49.9	49.9	49.9	43.1	35.1	27.1	47.0	4.1	47.0	47.0	47.0	40.9	33.1	25.3
	77	57.4	3.5	42.3	31.1	19.9	-	-	-	53.3	4.1	41.0	29.9	18.7	-	-	-
	72	56.1	3.5	45.9	37.5	29.2	20.8	-	-	52.4	4.1	44.1	35.8	27.6	19.4	-	-
1800	67	54.8	3.5	49.5	43.9	38.4	29.7	21.0	-	50.9	4.1	47.1	41.8	36.6	28.1	19.5	-
	62	53.4	3.5	51.9	49.8	47.6	38.6	29.7	20.7	50.0	4.1	48.9	47.2	45.5	36.7	27.9	19.1
	57	52.1	3.5	52.1	52.1	47.6	38.3	29.1		49.1	4.1	49.1	49.1	49.1	45.4	36.3	27.2
	72	57.3	3.5	49.3	39.8	30.3	20.9	-	-	53.6	4.1	47.3	38.0	28.7	19.3	-	-
2000	67	56.3	3.5	52.0	46.5	41.1	31.2	21.4	-	52.5	4.1	49.5	44.3	39.2	29.5	19.8	-
	62	55.3	3.5	54.1	53.0	51.8	41.6	31.5	21.3	51.8	4.1	51.0	50.3	49.7	39.6	29.6	19.6
	57	54.3	3.5	54.3	54.3	54.3	52.0	41.5	31.1	51.2	4.1	51.2	51.2	51.2	49.8	39.5	29.1
	72	58.4	3.5	52.7	42.1	31.5	20.9	-	-	54.8	4.1	50.5	40.1	29.7	19.3	-	-
1000	67	57.8	3.5	54.5	49.1	43.8	32.8	21.8	-	54.1	4.2	51.8	46.8	41.8	30.9	20.1	-
	62	57.2	3.5	56.3	56.2	56.0	44.6	33.3	22.0	53.7	4.1	53.1	53.1	53.1	42.6	31.4	20.2
	57	56.6	3.5	56.6	56.6	56.6	56.5	44.8	33.1	53.2	4.1	53.2	53.2	53.2	53.2	42.6	31.0

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 36: ZY05 (4.0 ton, 115°F to 125°F)**

Air on Evaporator Coil		Temperature of air on condenser coil															
CFM      WB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		115°F								125°F							
1000	77	48.4	4.8	27.7	23.6	19.6	-	-	-	45.1	5.4	26.7	22.9	19.0	-	-	-
	72	44.9	4.7	33.0	28.2	23.4	18.7	-	-	41.0	5.3	31.6	27.0	22.4	17.7	-	-
	67	41.9	4.7	38.3	32.8	27.2	22.4	17.6	-	37.8	5.2	36.5	31.1	25.7	21.1	16.4	-
	62	41.1	4.6	40.3	35.6	31.0	26.1	21.2	16.3	37.8	5.2	37.8	33.4	29.0	24.4	19.7	15.1
1200	77	48.6	4.8	31.7	25.3	18.9	-	-	-	45.1	5.4	30.6	24.3	18.1	-	-	-
	72	46.1	4.7	36.1	30.2	24.3	18.4	-	-	42.3	5.3	34.5	28.8	23.1	17.4	-	-
	67	43.6	4.7	40.5	35.1	29.7	23.7	17.7	-	39.5	5.3	38.4	33.3	28.1	22.3	16.5	-
	62	42.9	4.7	42.2	38.7	35.1	29.0	22.9	16.7	39.5	5.2	39.5	36.3	33.1	27.2	21.3	15.4
1400	57	42.2	4.6	42.2	42.2	40.6	34.3	28.0	21.8	39.5	5.2	39.5	39.3	38.1	32.1	26.1	20.1
	77	48.9	4.7	35.7	26.9	18.2	-	-	-	45.0	5.3	34.5	25.8	17.1	-	-	-
	72	47.4	4.7	39.1	32.2	25.2	18.2	-	-	43.6	5.3	37.5	30.6	23.8	17.0	-	-
	67	45.3	4.7	42.6	37.4	32.2	25.1	17.9	-	41.3	5.3	40.4	35.5	30.5	23.5	16.5	-
1600	62	44.7	4.7	44.1	41.7	39.3	31.9	24.5	17.1	41.3	5.2	41.2	39.2	37.2	30.0	22.8	15.7
	57	44.1	4.6	44.1	44.1	44.1	38.7	31.1	23.6	41.3	5.2	41.3	41.3	41.3	36.5	29.2	21.8
	77	49.1	4.7	39.7	28.6	17.4	-	-	-	44.9	5.3	38.4	27.3	16.2	-	-	-
	72	48.7	4.7	42.2	34.2	26.1	18.0	-	-	44.9	5.3	40.4	32.5	24.6	16.6	-	-
1800	67	47.0	4.7	44.8	39.8	34.7	26.4	18.1	-	43.1	5.3	42.4	37.7	32.9	24.7	16.6	-
	62	46.5	4.7	46.0	44.7	43.4	34.8	26.2	17.5	43.1	5.2	43.0	42.1	41.3	32.9	24.4	16.0
	57	46.1	4.6	46.1	46.1	46.1	43.2	34.3	25.4	43.0	5.2	43.0	43.0	43.0	41.0	32.2	23.5
	72	49.9	4.7	45.3	36.1	27.0	17.8	-	-	46.3	5.3	43.3	34.3	25.3	16.3	-	-
2000	67	48.7	4.7	46.9	42.1	37.2	27.7	18.2	-	44.9	5.3	44.4	39.9	35.3	26.0	16.6	-
	62	48.3	4.7	47.9	47.7	47.5	37.7	27.8	17.9	44.8	5.3	44.7	44.7	44.7	35.7	26.0	16.2
	57	48.0	4.6	48.0	48.0	48.0	47.6	37.4	27.2	44.8	5.2	44.8	44.8	44.8	44.8	35.3	25.2
	72	51.2	4.7	48.4	38.1	27.9	17.6	-	-	47.6	5.3	46.2	36.1	26.0	15.9	-	-
2000	67	50.4	4.8	49.1	44.4	39.8	29.1	18.4	-	46.7	5.4	46.4	42.1	37.8	27.2	16.7	-
	62	50.1	4.7	49.8	49.8	49.8	40.5	29.4	18.3	46.6	5.3	46.5	46.5	46.5	38.5	27.5	16.5
	57	49.9	4.6	49.9	49.9	49.9	49.9	40.5	29.0	46.5	5.2	46.5	46.5	46.5	46.5	38.4	26.9

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 37: ZY06 (5.0 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1250	77	78.9	3.4	37.6	31.8	26.0	-	-	-	75.5	4.1	39.5	32.5	25.4	-	-	-
	72	71.2	3.4	46.4	39.6	32.9	26.1	-	-	67.9	3.8	46.5	39.2	31.8	24.5	-	-
	67	63.4	3.4	55.1	47.4	39.8	33.1	26.3	-	60.2	3.5	53.5	45.9	38.3	31.4	24.5	-
	62	60.2	3.3	56.9	51.8	46.7	38.1	33.2	26.5	57.8	3.7	54.7	49.7	44.7	37.3	31.8	25.3
1500	77	79.2	3.4	43.0	34.9	26.9	-	-	-	75.3	3.9	43.0	33.7	24.4	-	-	-
	72	72.7	3.4	51.1	43.0	34.9	26.9	-	-	69.0	3.8	49.4	41.2	33.0	24.8	-	-
	67	66.3	3.4	59.1	51.1	43.0	35.1	27.0	-	62.8	3.8	55.8	48.7	41.6	33.4	25.2	-
	62	63.6	3.3	60.8	55.9	51.0	41.7	35.3	27.4	60.7	3.8	58.2	54.2	50.2	41.2	33.7	25.4
1750	57	62.5	3.3	62.5	60.8	59.1	51.3	43.5	35.7	59.4	3.7	59.4	59.4	58.8	50.5	42.2	33.9
	77	79.5	3.5	48.4	38.1	27.8	-	-	-	75.1	3.6	46.6	35.0	23.4	-	-	-
	72	74.3	3.4	55.8	46.4	37.0	27.6	-	-	70.2	3.8	52.3	43.3	34.2	25.1	-	-
	67	69.2	3.4	63.1	54.7	46.2	37.0	27.8	-	65.3	4.0	58.1	51.5	44.9	35.4	25.8	-
2000	62	67.1	3.4	64.7	60.1	55.4	45.3	37.3	28.3	63.7	3.8	61.6	58.6	55.7	45.1	35.6	25.6
	57	66.1	3.3	66.1	65.3	64.4	55.8	46.9	38.0	62.6	3.5	62.6	62.6	62.6	55.9	45.4	34.9
	77	79.7	3.5	53.8	41.2	28.7	-	-	-	74.9	3.4	50.1	36.3	22.4	-	-	-
	72	75.9	3.4	60.5	49.8	39.1	28.3	-	-	71.4	3.9	55.2	45.3	35.4	25.4	-	-
2250	67	72.0	3.4	67.2	58.3	49.4	39.0	28.5	-	67.8	4.3	60.4	54.3	48.3	37.4	26.5	-
	62	70.5	3.4	68.7	64.2	59.8	48.8	39.4	29.1	66.6	3.8	65.0	63.1	61.2	49.0	37.5	25.7
	57	69.8	3.4	69.8	69.8	69.8	60.2	50.2	40.2	65.8	3.3	65.8	65.8	65.8	61.4	48.6	35.8
	72	77.5	3.5	65.2	53.1	41.1	29.1	-	-	72.5	3.9	58.1	47.3	36.5	25.7	-	-
2500	67	74.9	3.4	71.2	61.9	52.7	41.0	29.2	-	70.4	4.5	62.6	57.1	51.6	39.4	27.2	-
	62	74.0	3.4	72.6	68.4	64.2	52.4	41.4	30.0	69.6	3.8	68.4	67.6	66.7	52.9	39.5	25.8
	57	73.4	3.4	73.4	73.4	73.4	64.7	53.6	42.5	68.9	3.1	68.9	68.9	68.9	66.8	51.7	36.7
	72	79.0	3.5	69.9	56.5	43.2	29.8	-	-	73.7	3.9	61.0	49.4	37.7	26.1	-	-
2500	67	77.8	3.4	75.2	65.5	55.9	42.9	30.0	-	72.9	4.8	64.9	60.0	55.0	41.4	27.9	-
	62	77.4	3.4	76.5	72.6	68.6	56.0	43.5	30.9	72.5	3.8	71.9	71.9	71.9	56.8	41.4	26.0
	57	77.0	3.4	77.0	77.0	77.0	69.1	56.9	44.8	72.1	2.9	72.1	72.1	72.1	72.1	54.9	37.6
		95°F								105°F							
1250	77	72.1	4.7	41.5	33.1	24.8	-	-	-	65.0	5.3	38.6	30.7	22.7	-	-	-
	72	64.6	4.2	46.6	38.7	30.8	22.9	-	-	59.3	4.9	43.9	36.3	28.7	21.2	-	-
	67	57.0	3.7	51.8	44.3	36.8	29.7	22.6	-	53.9	4.6	49.2	42.0	34.8	27.8	20.8	-
	62	55.3	4.1	52.6	47.7	42.7	36.5	30.3	24.1	52.2	4.8	49.7	45.3	40.8	34.4	28.0	21.6
1500	77	71.4	4.3	43.1	32.5	22.0	-	-	-	65.0	5.0	41.1	30.9	20.6	-	-	-
	72	65.3	4.2	47.8	39.4	31.1	22.8	-	-	60.5	4.9	45.8	37.6	29.4	21.2	-	-
	67	59.2	4.2	52.4	46.3	40.2	31.7	23.3	-	55.9	4.9	50.4	44.3	38.1	29.8	21.4	-
	62	57.8	4.2	55.5	52.4	49.4	40.7	32.1	23.5	54.5	4.8	52.5	49.7	46.9	38.4	29.8	21.2
1750	57	56.4	4.1	56.4	56.4	56.4	49.7	40.9	32.2	53.2	4.8	53.2	53.2	53.2	47.0	38.2	29.5
	77	70.8	3.8	44.8	31.9	19.1	-	-	-	65.0	4.7	43.7	31.1	18.5	-	-	-
	72	66.1	4.3	48.9	40.1	31.4	22.6	-	-	61.6	4.9	47.6	38.8	30.0	21.2	-	-
	67	61.4	4.7	53.0	48.3	43.7	33.8	23.9	-	58.0	5.2	51.6	46.5	41.5	31.7	22.0	-
2000	62	60.2	4.2	58.4	57.2	56.0	44.9	33.9	22.9	56.9	4.8	55.3	54.1	53.0	42.3	31.6	20.9
	57	59.1	3.7	59.1	59.1	59.1	56.1	43.9	31.7	55.8	4.5	55.8	55.8	55.8	52.9	41.3	29.6
	77	70.1	3.4	46.4	31.3	16.2	-	-	-	65.1	4.3	46.2	31.3	16.3	-	-	-
	72	66.8	4.3	50.0	40.8	31.7	22.5	-	-	62.7	4.9	49.5	40.0	30.6	21.2	-	-
2250	67	63.6	5.2	53.6	50.3	47.1	35.8	24.5	-	60.0	5.5	52.8	48.8	44.9	33.7	22.6	-
	62	62.7	4.2	61.4	61.4	61.4	49.2	35.7	22.3	59.2	4.8	58.0	58.0	58.0	46.3	33.5	20.6
	57	61.8	3.3	61.8	61.8	61.8	46.9	31.3	-	58.3	4.2	58.3	58.3	58.3	58.3	44.3	29.8
	72	67.6	4.3	51.1	41.5	32.0	22.4	-	-	63.8	4.9	51.4	41.3	31.2	21.1	-	-
2500	67	65.8	5.6	54.1	52.4	50.6	37.9	25.2	-	62.0	5.8	54.0	51.1	48.2	35.7	23.2	-
	62	65.1	4.2	64.3	64.3	64.3	53.4	37.5	21.7	61.5	4.9	60.8	60.8	60.8	50.3	35.3	20.3
	57	64.5	2.8	64.5	64.5	64.5	64.5	49.9	30.9	60.9	3.9	60.9	60.9	60.9	60.9	47.4	29.9
2500	72	68.3	4.3	52.2	42.2	32.3	22.3	-	-	64.9	4.9	53.2	42.5	31.8	21.1	-	-
	67	68.0	6.1	54.7	54.4	54.1	39.9	25.8	-	64.1	6.1	55.2	53.4	51.6	37.7	23.8	-
	62	67.6	4.3	67.2	67.2	67.2	57.6	39.3	21.1	63.8	4.9	63.5	63.5	63.5	54.2	37.1	20.0
	57	67.2	2.4	67.2	67.2	67.2	67.2	52.9	30.5	63.5	3.6	63.5	63.5	63.5	63.5	50.4	30.1

- These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 38: ZY06 (5.0 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65					90	85	80	75	70	65
		115°F									125°F								
1250	77	57.8	5.9	35.8	28.2	20.6	-	-	-	50.6	6.4	33.0	25.7	18.5	-	-	-		
	72	54.1	5.7	41.2	33.9	26.7	19.5	-	-	48.9	6.4	38.4	31.5	24.6	17.8	-	-		
	67	50.8	5.4	46.5	39.7	32.8	25.9	18.9	-	47.6	6.3	43.9	37.3	30.8	23.9	17.1	-		
	62	49.1	5.5	46.9	42.9	38.9	32.3	25.6	19.0	46.0	6.2	44.1	40.5	36.9	30.1	23.3	16.5		
1500	77	58.5	5.7	39.2	29.2	19.2	-	-	-	52.1	6.4	37.2	27.5	17.9	-	-	-		
	72	55.6	5.6	43.8	35.7	27.6	19.6	-	-	50.7	6.3	41.8	33.9	25.9	18.0	-	-		
	67	52.6	5.6	48.4	42.2	36.1	27.8	19.5	-	49.4	6.2	46.4	40.2	34.0	25.8	17.6	-		
	62	51.3	5.5	49.5	47.0	44.5	36.0	27.5	19.0	48.0	6.2	46.5	44.3	42.0	33.6	25.2	16.8		
1750	57	49.9	5.4	49.9	49.9	49.9	44.2	35.5	26.8	46.7	6.1	46.6	46.6	46.6	41.4	32.8	24.1		
	77	59.3	5.5	42.6	30.2	17.8	-	-	-	53.6	6.3	41.5	29.4	17.2	-	-	-		
	72	57.1	5.6	46.4	37.5	28.6	19.7	-	-	52.5	6.2	45.2	36.2	27.2	18.2	-	-		
	67	54.5	5.7	50.2	44.8	39.3	29.7	20.0	-	51.1	6.2	48.8	43.0	37.1	27.6	18.1	-		
2000	62	53.5	5.5	52.1	51.1	50.1	39.7	29.3	19.0	50.1	6.1	48.9	48.0	47.1	37.1	27.0	17.0		
	57	52.4	5.3	52.4	52.4	52.4	49.7	38.6	27.5	49.1	6.1	49.0	49.0	49.0	46.5	36.0	25.4		
	77	60.1	5.3	46.0	31.2	16.4	-	-	-	55.0	6.2	45.8	31.2	16.6	-	-	-		
	72	58.5	5.5	49.0	39.3	29.5	19.8	-	-	54.4	6.2	48.5	38.5	28.4	18.4	-	-		
2250	67	56.4	5.8	52.0	47.3	42.6	31.6	20.6	-	52.8	6.2	51.3	45.8	40.3	29.5	18.6	-		
	62	55.6	5.5	54.7	54.7	54.7	43.4	31.2	18.9	52.1	6.1	51.4	51.4	51.4	40.6	28.9	17.2		
	57	54.9	5.1	54.9	54.9	54.9	54.9	41.7	28.2	51.5	6.1	51.4	51.4	51.4	51.4	39.2	26.7		
	72	60.0	5.5	51.6	41.0	30.5	19.9	-	-	56.2	6.1	51.9	40.8	29.7	18.6	-	-		
2500	67	58.3	6.0	53.9	49.9	45.9	33.5	21.2	-	54.5	6.1	53.7	48.6	43.5	31.3	19.2	-		
	62	57.8	5.5	57.3	57.3	57.3	47.1	33.0	18.9	54.2	6.1	53.8	53.8	53.8	44.0	30.8	17.5		
	57	57.4	5.0	57.4	57.4	57.4	57.4	44.9	29.0	53.8	6.1	53.8	53.8	53.8	53.8	42.4	28.0		
	72	61.4	5.5	54.2	42.8	31.4	20.0	-	-	58.0	6.0	55.3	43.1	31.0	18.8	-	-		
2500	67	60.1	6.1	55.7	52.4	49.1	35.4	21.7	-	56.2	6.1	56.2	51.4	46.7	33.2	19.7	-		
	62	60.0	5.5	59.9	59.9	59.9	50.9	34.9	18.9	56.2	6.1	56.2	56.2	56.2	47.5	32.6	17.7		
	57	59.9	4.8	59.9	59.9	59.9	59.9	48.0	29.7	56.2	6.1	56.2	56.2	56.2	56.2	45.6	29.3		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 39: ZYA7 (6.0 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		75°F									85°F								
1500	77	91.7	4.2	43.9	38.2	32.4	-	-	-	88.0	4.7	40.2	34.9	29.5	-	-	-		
	72	83.7	4.1	56.4	48.2	40.0	31.8	-	-	79.7	4.6	53.8	45.6	37.5	29.4	-	-		
	67	75.6	4.1	68.9	58.2	47.6	39.7	31.9	-	71.4	4.6	67.3	56.4	45.5	37.4	29.4	-		
	62	73.2	4.1	73.2	64.2	55.2	46.2	40.2	32.7	70.8	4.5	70.3	61.5	53.5	44.8	37.7	29.8		
1800	77	93.1	4.2	52.0	42.2	32.4	-	-	-	88.4	4.7	50.1	40.2	30.3	-	-	-		
	72	85.7	4.2	61.0	51.5	41.914	32.4	-	-	81.4	4.6	59.1	49.4	39.8	30.2	-	-		
	67	78.4	4.1	70.1	60.7	51.4	42.0	32.7	-	74.3	4.6	68.0	58.7	49.4	39.8	30.3	-		
	62	73.8	4.1	73.8	67.8	60.9	50.5	42.5	33.3	71.2	4.6	71.2	65.4	58.9	48.9	40.0	30.6		
	57	60.7	4.1	60.7	60.7	60.7	60.7	52.4	43.4	59.4	4.6	59.4	59.4	59.4	59.1	49.8	40.4		
2100	77	94.5	4.2	60.1	46.3	32.4	-	-	-	88.9	4.7	59.9	45.5	31.0	-	-	-		
	72	87.8	4.2	65.7	54.8	43.8	32.9	-	-	83.1	4.6	64.3	53.2	42.1	31.0	-	-		
	67	81.1	4.1	71.2	63.2	55.2	44.3	33.4	-	77.2	4.6	68.8	61.0	53.2	42.2	31.2	-		
	62	74.4	4.1	74.4	71.4	66.6	54.9	44.8	34.0	71.6	4.6	71.6	69.2	64.3	52.9	42.4	31.4		
	57	61.3	4.1	61.3	61.3	61.3	61.3	56.3	45.4	59.4	4.6	59.4	59.4	59.4	59.4	53.6	42.7		
2400	77	95.9	4.3	68.2	50.3	32.5	-	-	-	89.4	4.7	69.7	50.8	31.8	-	-	-		
	72	89.9	4.2	70.3	58.0	45.7	33.5	-	-	84.8	4.7	69.6	57.0	44.5	31.9	-	-		
	67	83.8	4.2	72.4	65.7	59.0	46.6	34.2	-	80.2	4.6	69.5	63.3	57.1	44.6	32.0	-		
	62	75.0	4.2	75.0	75.0	72.3	59.2	47.2	34.6	71.9	4.6	71.9	71.9	69.8	57.0	44.8	32.3		
	57	61.9	4.1	61.9	61.9	61.9	61.9	60.2	47.5	59.4	4.6	59.4	59.4	59.4	59.4	57.5	45.1		
2700	72	91.9	4.2	75.0	61.3	47.7	34.0	-	-	86.5	4.7	74.9	60.8	46.8	32.7	-	-		
	67	86.5	4.2	73.6	68.2	62.8	48.9	34.9	-	83.1	4.6	70.2	65.6	61.0	46.9	32.9	-		
	62	75.6	4.2	75.6	75.6	75.6	63.5	49.5	35.3	72.3	4.6	72.3	72.3	72.3	61.0	47.1	33.1		
	57	62.5	4.2	62.5	62.5	62.5	62.5	62.5	49.6	59.4	4.6	59.4	59.4	59.4	59.4	59.4	47.4		
3000	72	94.0	4.3	79.6	64.6	49.578	34.6	-	-	88.2	4.7	80.2	64.6	49.1	33.5	-	-		
	67	89.2	4.2	74.8	70.7	66.6	51.2	35.7	-	86.0	4.7	71.0	67.9	64.8	49.3	33.7	-		
	62	76.2	4.2	76.2	76.2	76.2	67.8	51.9	35.9	72.7	4.7	72.7	72.7	72.7	65.1	49.5	33.9		
	57	63.1	4.2	63.1	63.1	63.1	63.1	63.1	51.6	59.4	4.6	59.4	59.4	59.4	59.4	59.4	49.7		
		95°F									105°F								
1500	77	84.3	5.1	36.5	31.6	26.7	-	-	-	82.7	5.8	36.9	31.0	25.2	-	-	-		
	72	75.7	5.1	51.2	43.1	35.0	26.9	-	-	71.6	5.8	49.9	41.6	33.4	25.1	-	-		
	67	67.1	5.0	65.8	54.6	43.4	35.2	27.0	-	60.5	5.7	60.5	52.3	41.5	33.1	24.7	-		
	62	68.3	5.0	66.1	58.9	51.7	43.4	35.2	26.9	64.6	5.7	62.5	56.1	49.7	41.1	32.6	24.0		
1800	77	83.8	5.1	48.1	38.1	28.2	-	-	-	80.4	5.8	47.1	36.5	26.0	-	-	-		
	72	77.0	5.1	57.1	47.4	37.728	28.1	-	-	72.1	5.8	55.1	45.3	35.6	25.9	-	-		
	67	70.3	5.0	66.0	56.7	47.3	37.6	28.0	-	63.8	5.7	63.0	54.1	45.2	35.4	25.5	-		
	62	68.5	5.0	68.5	62.9	56.9	47.2	37.5	27.9	64.7	5.7	64.7	60.0	54.9	44.9	35.0	25.0		
	57	58.2	5.0	58.2	58.2	58.2	56.8	47.1	37.5	59.8	5.7	59.8	59.8	59.8	54.4	44.4	34.3		
2100	77	83.3	5.1	59.7	44.7	29.6	-	-	-	78.1	5.8	57.3	42.0	26.7	-	-	-		
	72	78.3	5.1	63.0	51.7	40.4	29.2	-	-	72.6	5.8	60.2	49.0	37.8	26.6	-	-		
	67	73.4	5.1	66.3	58.8	51.2	40.1	28.9	-	67.1	5.8	63.0	56.0	48.9	37.6	26.4	-		
	62	68.7	5.1	68.7	67.0	62.0	51.0	39.9	28.9	64.8	5.8	64.8	63.9	60.0	48.7	37.4	26.0		
	57	57.5	5.0	57.5	57.5	57.5	57.5	51.0	40.0	58.1	5.8	58.1	58.1	58.1	58.1	47.7	36.0		
2400	77	82.8	5.1	71.2	51.2	31.1	-	-	-	75.8	5.8	67.5	47.5	27.4	-	-	-		
	72	79.7	5.1	68.9	56.0	43.2	30.3	-	-	73.1	5.8	65.3	52.7	40.0	27.4	-	-		
	67	76.5	5.1	66.6	60.9	55.2	42.5	29.9	-	70.3	5.8	63.1	57.8	52.6	39.9	27.2	-		
	62	68.9	5.1	68.9	68.9	67.2	54.8	42.3	29.9	64.9	5.8	64.9	64.9	64.9	52.5	39.8	27.0		
	57	56.9	5.1	56.9	56.9	56.9	56.9	54.8	42.6	56.5	5.8	56.5	56.5	56.5	56.5	51.0	37.6		
2700	72	81.0	5.1	74.8	60.3	45.9	31.4	-	-	73.5	5.8	70.4	56.3	42.2	28.1	-	-		
	67	79.6	5.1	66.8	63.0	59.1	45.0	30.8	-	73.6	5.8	63.1	59.7	56.3	42.2	28.1	-		
	62	69.1	5.1	69.1	69.1	69.1	58.6	44.7	30.9	64.9	5.8	64.9	64.9	64.9	56.3	42.2	28.1		
	57	56.3	5.1	56.3	56.3	56.3	56.3	56.3	45.2	54.8	5.8	54.8	54.8	54.8	54.8	54.3	39.3		
3000	72	82.3	5.1	80.7	64.7	48.591	32.5	-	-	74.0	5.8	74.0	60.0	44.4	28.9	-	-		
	67	82.8	5.1	67.1	65.1	63.1	47.4	31.8	-	76.9	5.8	63.1	61.6	60.0	44.5	28.9	-		
	57	69.3	5.1	69.3	69.3	69.3	62.3	47.1	32.0	65.0	5.8	65.0	65.0	65.0	60.1	44.6	29.1		
	57	55.7	5.1	55.7	55.7	55.7	55.7	55.7	47.8	53.2	5.8	53.2	53.2	53.2	53.2	53.2	41.0		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 40: ZYA7 (6.0 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		115°F									125°F								
1500	77	81.1	6.4	37.2	30.5	23.8	-	-	-	79.5	7.1	37.5	29.9	22.3	-	-	-		
	72	67.5	6.4	48.7	40.2	31.7	23.3	-	-	63.4	7.1	47.4	38.8	30.1	21.4	-	-		
	67	53.9	6.4	53.9	49.9	39.7	31.0	22.4	-	47.3	7.1	47.3	47.3	37.9	29.0	20.0	-		
	62	60.8	6.4	58.9	53.3	47.7	38.8	30.0	21.1	57.1	7.2	55.3	50.5	45.6	36.5	27.4	18.2		
1800	77	77.0	6.4	46.1	34.9	23.7	-	-	-	73.5	7.1	45.1	33.3	21.5	-	-	-		
	72	67.1	6.4	53.0	43.2	33.4	23.7	-	-	62.2	7.1	51.0	41.2	31.3	21.4	-	-		
	67	57.3	6.4	57.3	51.6	43.1	33.1	23.1	-	50.9	7.1	50.9	49.0	41.1	30.9	20.7	-		
	62	60.8	6.5	60.8	57.0	52.8	42.6	32.4	22.1	57.0	7.2	57.0	54.1	50.8	40.3	29.8	19.3		
	57	61.5	6.5	61.5	61.5	61.5	52.1	41.6	31.2	63.1	7.2	57.7	57.7	57.7	49.7	38.9	28.0		
	77	72.8	6.4	55.0	39.3	23.7	-	-	-	67.6	7.1	52.6	36.7	20.8	-	-	-		
	72	66.8	6.4	57.4	46.3	35.2	24.0	-	-	61.0	7.1	54.6	43.5	32.5	21.5	-	-		
	67	60.8	6.4	59.8	53.2	46.6	35.2	23.9	-	54.4	7.1	54.4	50.4	44.2	32.8	21.3	-		
2100	62	60.8	6.5	60.8	60.8	58.0	46.4	34.8	23.1	56.9	7.2	56.9	56.9	56.0	44.1	32.2	20.3		
	57	58.7	6.5	58.7	58.7	58.7	56.9	44.4	31.9	59.3	7.2	59.3	59.3	59.3	54.4	41.1	27.8		
	77	68.7	6.5	63.8	43.8	23.7	-	-	-	61.7	7.1	60.1	40.1	20.0	-	-	-		
	72	66.5	6.5	61.7	49.3	36.9	24.4	-	-	59.8	7.1	58.1	45.9	33.7	21.5	-	-		
2400	67	64.2	6.5	59.6	54.8	50.0	37.3	24.6	-	58.0	7.1	56.1	51.8	47.4	34.7	22.0	-		
	62	60.8	6.5	60.8	60.8	60.8	50.2	37.2	24.2	56.8	7.2	56.8	56.8	56.8	47.9	34.6	21.3		
	57	56.0	6.5	56.0	56.0	56.0	56.0	47.2	32.7	55.6	7.2	55.6	55.6	55.6	55.6	43.4	27.7		
	72	66.1	6.5	66.1	52.3	38.6	24.8	-	-	58.7	7.1	58.7	48.3	34.9	21.6	-	-		
2700	67	67.6	6.5	59.4	56.4	53.5	39.4	25.3	-	61.6	7.1	55.7	53.2	50.6	36.6	22.6	-		
	62	60.8	6.5	60.8	60.8	60.8	54.0	39.6	25.2	56.7	7.2	56.7	56.7	56.7	51.7	37.0	22.3		
	57	53.3	6.5	53.3	53.3	53.3	53.3	50.0	33.4	51.8	7.2	51.8	51.8	51.8	51.8	45.7	27.5		
	72	65.8	6.5	65.8	55.3	40.3	25.2	-	-	57.5	7.1	57.5	50.7	36.1	21.6	-	-		
3000	67	71.0	6.5	59.2	58.0	56.9	41.5	26.1	-	65.2	7.2	55.2	54.5	53.8	38.5	23.2	-		
	62	60.8	6.5	60.8	60.8	60.8	57.8	42.0	26.2	56.6	7.2	56.6	56.6	56.6	55.5	39.4	23.3		
	57	50.6	6.5	50.6	50.6	50.6	50.6	50.6	34.2	48.0	7.2	48.0	48.0	48.0	48.0	48.0	27.4		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



**Table 41: ZY08 (7.5 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1875	77	117.2	4.7	61.5	50.6	39.6	—	—	—	111.2	5.4	56.7	47.1	37.4	—	—	—
	72	105.3	4.8	70.0	59.8	49.6	39.3	—	—	100.1	5.5	67.7	57.6	47.4	37.3	—	—
	67	93.5	4.8	78.5	69.0	59.5	48.3	39.2	—	88.9	5.5	78.6	68.1	57.5	46.8	37.1	—
	62	89.1	4.8	89.1	81.2	69.4	58.0	49.3	39.3	84.3	5.6	84.3	77.6	67.5	56.6	47.0	36.8
2250	77	119.1	4.7	67.6	53.9	40.2	—	—	—	112.4	5.4	64.2	51.1	38.1	—	—	—
	72	108.0	4.8	76.6	64.5	52.5	40.5	—	—	102.5	5.5	74.3	62.3	50.3	38.3	—	—
	67	96.8	4.8	85.5	75.1	64.8	51.8	40.6	—	92.5	5.5	84.5	73.5	62.5	49.9	38.3	—
	62	94.2	4.8	94.2	87.0	77.0	63.8	52.8	40.6	89.3	5.5	89.3	83.2	74.7	61.9	50.3	38.0
	57	91.5	4.8	91.5	91.5	89.3	77.1	64.9	52.7	86.0	5.6	86.0	86.0	86.0	74.6	62.3	49.9
2625	77	121.1	4.7	73.8	57.3	40.9	—	—	—	113.6	5.4	71.6	55.2	38.8	—	—	—
	72	110.6	4.8	83.1	69.3	55.4	41.6	—	—	104.8	5.5	81.0	67.1	53.1	39.2	—	—
	67	100.2	4.8	92.5	81.2	70.0	55.4	42.0	—	96.1	5.5	90.4	78.9	67.5	53.1	39.4	—
	62	99.2	4.8	99.2	92.8	84.6	69.6	56.2	42.0	94.2	5.5	94.2	88.8	81.8	67.3	53.5	39.3
	57	98.3	4.8	98.3	98.3	97.2	84.8	70.4	56.0	92.3	5.5	92.3	92.3	92.3	81.9	67.6	53.3
3000	77	123.1	4.8	79.9	60.7	41.5	—	—	—	114.7	5.4	79.0	59.3	39.5	—	—	—
	72	113.3	4.8	89.7	74.0	58.4	42.8	—	—	107.2	5.5	87.7	71.8	56.0	40.2	—	—
	67	103.5	4.8	99.4	87.4	75.3	58.9	43.4	—	99.7	5.5	96.3	84.4	72.5	56.3	40.5	—
	62	104.3	4.8	104.3	98.6	92.2	75.4	59.7	43.4	99.1	5.5	99.1	94.4	89.0	72.6	56.7	40.6
	57	105.0	4.8	105.0	105.0	105.0	92.5	75.9	59.3	98.6	5.5	98.6	98.6	98.6	89.2	72.9	56.6
3375	72	116.0	4.8	96.2	78.8	61.3	43.9	—	—	109.6	5.4	94.3	76.6	58.8	41.1	—	—
	67	106.9	4.8	106.4	93.5	80.6	62.5	44.8	—	103.3	5.5	102.2	89.8	77.5	59.5	41.7	—
	62	109.4	4.8	108.6	104.4	99.8	81.2	63.1	44.7	104.1	5.5	103.7	100.0	96.1	77.9	60.0	41.9
	57	111.8	4.8	108.8	108.8	108.8	100.2	81.4	62.6	104.8	5.5	104.1	104.1	104.1	96.5	78.2	60.0
3750	72	118.7	4.8	102.8	83.5	64.3	45.0	—	—	112.0	5.4	101.0	81.3	61.7	42.1	—	—
	67	110.3	4.8	110.3	99.6	85.8	66.0	46.2	—	106.9	5.5	106.9	95.3	82.5	62.6	42.8	—
	62	114.4	4.8	112.9	110.2	107.4	87.0	66.6	46.1	109.0	5.4	107.9	105.6	103.3	83.2	63.2	43.1
	57	118.6	4.7	112.5	112.5	112.5	108.0	86.9	65.9	111.1	5.4	107.6	107.6	107.6	103.8	83.6	63.3
		95°F								105°F							
1875	77	105.3	6.1	51.9	43.6	35.2	—	—	—	97.1	7.2	51.4	42.5	33.7	—	—	—
	72	94.8	6.2	65.3	55.3	45.3	35.3	—	—	88.2	7.1	63.4	53.2	43.0	32.8	—	—
	67	84.4	6.2	78.7	67.1	55.5	45.2	35.0	—	79.3	7.1	75.5	63.9	52.4	42.2	32.1	—
	62	79.6	6.3	79.6	74.1	65.6	55.2	44.7	34.3	75.9	7.2	75.9	69.9	61.7	51.6	41.5	31.4
2250	77	105.6	6.1	60.7	48.3	36.0	—	—	—	97.6	7.2	59.5	46.6	33.7	—	—	—
	72	96.9	6.1	72.1	60.1	48.1	36.1	—	—	90.3	7.1	69.6	57.5	45.4	33.3	—	—
	67	88.2	6.2	83.5	71.9	60.2	48.1	35.9	—	83.0	7.1	79.7	68.4	57.2	45.0	32.9	—
	62	84.4	6.2	84.4	79.5	72.3	60.0	47.7	35.4	80.2	7.1	80.2	75.4	68.9	56.7	44.5	32.4
	57	80.5	6.3	80.5	80.5	80.5	72.0	59.6	47.2	77.5	7.2	77.5	77.5	77.5	68.4	56.2	44.0
2625	77	106.0	6.1	69.4	53.1	36.7	—	—	—	98.2	7.1	67.6	50.7	33.7	—	—	—
	72	99.0	6.1	78.9	64.9	50.8	36.8	—	—	92.4	7.1	75.8	61.8	47.8	33.9	—	—
	67	92.0	6.2	88.4	76.6	64.9	50.9	36.8	—	86.6	7.1	83.9	72.9	61.9	47.8	33.7	—
	62	89.2	6.2	89.2	84.8	79.0	64.9	50.8	36.6	84.6	7.1	84.6	80.8	76.1	61.8	47.6	33.4
	57	86.3	6.2	86.3	86.3	86.3	78.9	64.8	50.6	82.5	7.1	82.5	82.5	82.5	75.8	61.4	47.1
3000	77	106.4	6.1	78.2	57.8	37.5	—	—	—	98.7	7.1	75.7	54.7	33.7	—	—	—
	72	101.1	6.1	85.7	69.6	53.6	37.6	—	—	94.5	7.1	82.0	66.1	50.2	34.4	—	—
	67	95.9	6.1	93.2	81.4	69.7	53.7	37.7	—	90.3	7.1	88.2	77.5	66.7	50.7	34.6	—
	62	94.0	6.2	94.0	90.2	85.7	69.8	53.8	37.8	89.0	7.1	89.0	86.2	83.2	66.9	50.6	34.3
	57	92.1	6.2	92.1	92.1	92.1	85.9	69.9	54.0	87.6	7.1	87.6	87.6	87.6	83.2	66.7	50.2
3375	72	103.2	6.1	92.5	74.4	56.4	38.3	—	—	96.6	7.1	88.1	70.4	52.6	34.9	—	—
	67	99.7	6.1	98.0	86.2	74.4	56.5	38.5	—	94.0	7.1	92.4	82.0	71.5	53.5	35.4	—
	62	98.8	6.1	98.7	95.6	92.4	74.6	56.8	39.0	93.3	7.1	92.9	91.7	90.4	72.1	53.7	35.3
	57	97.9	6.2	97.9	97.9	97.9	92.8	75.1	57.4	92.7	7.1	92.7	92.7	92.7	90.6	72.0	53.3
3750	72	105.3	6.1	99.2	79.2	59.1	39.1	—	—	98.7	7.1	94.3	74.7	55.0	35.4	—	—
	67	103.6	6.1	102.8	91.0	79.1	59.3	39.4	—	97.6	7.1	96.7	86.5	76.3	56.3	36.2	—
	62	103.6	6.1	102.8	100.9	99.1	79.5	59.8	40.2	97.7	7.1	96.6	96.6	96.6	77.2	56.7	36.3
	57	103.7	6.1	102.7	102.7	102.7	99.7	80.2	60.8	97.7	7.1	96.6	96.6	96.6	96.6	77.2	56.4

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 42: ZY08 (7.5 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																
CFM		WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
					Return dry bulb (°F)								Return dry bulb (°F)					
					90	85	80	75	70	65			90	85	80	75	70	65
				115°F						125°F								
1875	77	88.9	8.3	50.8	41.5	32.3	—	—	—	80.7	9.3	50.2	40.5	30.8	—	—	—	
	72	81.6	8.1	61.5	51.1	40.7	30.4	—	—	74.9	9.1	59.6	49.0	38.5	27.9	—	—	
	67	74.3	8.0	72.2	60.7	49.3	39.2	29.1	—	69.2	8.9	68.9	57.5	46.1	36.2	26.2	—	
	62	72.2	8.0	72.2	65.8	57.8	48.0	38.3	28.5	68.5	8.9	68.5	61.6	53.8	44.4	35.0	25.6	
2250	77	89.6	8.2	58.3	44.9	31.5	—	—	—	81.6	9.3	57.1	43.2	29.2	—	—	—	
	72	83.7	8.1	67.1	54.9	42.8	30.6	—	—	77.0	9.1	64.6	52.4	40.1	27.9	—	—	
	67	77.7	8.0	75.9	65.0	54.1	42.0	29.9	—	72.5	8.9	72.0	61.5	51.1	39.0	26.9	—	
	62	76.1	8.0	76.1	71.3	65.4	53.4	41.3	29.3	72.0	8.9	72.0	67.2	62.0	50.1	38.1	26.2	
2625	57	74.4	8.1	74.4	74.4	74.4	64.8	52.8	40.8	71.4	9.0	71.4	71.4	71.4	61.1	49.4	37.6	
	77	90.3	8.2	65.8	48.3	30.7	—	—	—	82.5	9.2	64.0	45.8	27.7	—	—	—	
	72	85.8	8.1	72.7	58.7	44.8	30.9	—	—	79.2	9.1	69.6	55.7	41.8	27.9	—	—	
	67	81.2	8.0	79.5	69.2	59.0	44.8	30.7	—	75.8	8.9	75.1	65.5	56.0	41.8	27.7	—	
3000	62	80.0	8.0	80.0	76.8	73.1	58.8	44.4	30.1	75.4	8.9	75.4	72.7	70.1	55.7	41.2	26.8	
	57	78.8	8.1	78.8	78.8	78.8	72.7	58.1	43.6	75.0	9.0	75.0	75.0	75.0	69.5	54.8	40.1	
	77	91.0	8.1	73.3	51.6	29.9	—	—	—	83.4	9.2	70.9	48.5	26.1	—	—	—	
	72	87.9	8.1	78.3	62.6	46.9	31.2	—	—	81.3	9.1	74.5	59.0	43.5	28.0	—	—	
3375	67	84.7	8.0	83.2	73.5	63.8	47.6	31.5	—	79.2	8.9	78.2	69.5	60.9	44.6	28.4	—	
	62	83.9	8.0	83.8	82.3	80.8	64.1	47.5	30.9	78.9	9.0	78.3	78.3	78.3	61.3	44.3	27.4	
	57	83.1	8.0	83.1	83.1	83.1	80.6	63.5	46.4	78.6	9.0	78.5	78.5	78.5	78.0	60.3	42.6	
	72	90.0	8.1	83.8	66.4	48.9	31.4	—	—	83.4	9.0	79.5	62.4	45.2	28.0	—	—	
3750	67	88.2	8.0	86.8	77.7	68.7	50.5	32.3	—	82.5	9.0	81.3	73.5	65.8	47.5	29.1	—	
	62	87.8	8.0	87.1	87.1	87.1	69.5	50.6	31.6	82.4	9.0	81.3	81.3	81.3	66.9	47.4	28.0	
	57	87.5	8.0	87.4	87.4	87.4	87.4	68.9	49.2	82.3	9.0	81.4	81.4	81.4	81.4	65.8	45.1	
	72	92.1	8.1	89.4	70.2	50.9	31.7	—	—	85.5	9.0	84.5	65.7	46.9	28.0	—	—	
3750	67	91.7	8.0	90.5	82.0	73.5	53.3	33.1	—	85.8	9.0	84.3	77.5	70.7	50.3	29.9	—	
	62	91.8	8.0	90.5	90.5	90.5	74.9	53.6	32.4	85.8	9.0	84.3	84.3	84.3	72.6	50.5	28.5	
	57	91.8	8.0	90.4	90.4	90.4	90.4	74.2	52.0	85.9	9.0	84.3	84.3	84.3	84.3	71.2	47.6	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 43: ZY09 (8.5 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
2125	77	129.6	5.9	67.0	57.1	47.1	-	-	-	123.8	6.5	64.6	54.4	44.2	-	-	-
	72	121.7	5.8	83.1	71.2	59.2	47.2	-	-	116.0	6.5	80.7	68.5	56.3	44.1	-	-
	67	113.7	5.8	99.3	85.3	71.2	58.7	46.8	-	108.2	6.5	96.7	82.6	68.4	56.0	43.9	-
	62	112.3	5.7	107.4	95.3	83.3	67.6	58.5	46.0	106.3	6.5	102.3	91.4	80.6	66.6	55.9	43.6
2550	77	132.2	5.9	75.2	60.8	46.4	-	-	-	125.7	6.6	73.3	58.6	43.9	-	-	-
	72	124.6	5.9	90.1	75.9	61.6	47.3	-	-	118.6	6.5	87.7	73.3	58.9	44.6	-	-
	67	117.1	5.8	105.1	90.9	76.8	61.9	47.6	-	111.5	6.5	102.0	88.0	74.0	59.3	44.8	-
	62	115.5	5.8	111.5	101.8	92.1	74.4	62.1	47.1	109.8	6.5	106.5	97.8	89.1	72.9	59.4	44.5
	57	113.9	5.7	113.9	110.6	107.3	91.9	76.5	61.2	108.0	6.4	108.0	106.1	104.2	89.0	73.9	58.8
2975	77	134.7	6.0	83.4	64.5	45.6	-	-	-	127.6	6.6	82.0	62.8	43.6	-	-	-
	72	127.6	5.9	97.1	80.6	64.0	47.5	-	-	121.3	6.6	94.6	78.1	61.6	45.1	-	-
	67	120.5	5.8	110.8	96.6	82.4	65.2	48.3	-	114.9	6.5	107.2	93.4	79.6	62.5	45.7	-
	62	118.7	5.8	115.7	108.3	100.8	81.3	65.7	48.1	113.2	6.5	110.6	104.1	97.6	79.2	62.8	45.3
	57	117.5	5.8	117.5	115.8	114.2	101.1	83.0	64.9	111.8	6.5	111.8	111.8	111.8	97.7	79.9	62.0
3400	77	137.3	6.0	91.5	68.2	44.8	-	-	-	129.5	6.6	90.7	67.0	43.3	-	-	-
	72	130.6	5.9	104.1	85.2	66.4	47.6	-	-	123.9	6.6	101.6	82.9	64.2	45.6	-	-
	67	123.9	5.8	116.6	102.3	88.0	68.4	49.0	-	118.3	6.6	112.4	98.8	85.2	65.8	46.5	-
	62	121.9	5.8	119.9	114.7	109.6	88.1	69.3	49.1	116.7	6.5	114.8	110.4	106.1	85.5	66.2	46.2
	57	121.1	5.8	121.1	121.1	121.1	110.3	89.5	68.7	115.7	6.5	115.6	115.6	115.6	106.4	85.8	65.2
3825	72	133.6	6.0	111.0	89.9	68.8	47.7	-	-	126.5	6.6	108.5	87.7	66.9	46.1	-	-
	67	127.3	5.9	122.4	108.0	93.6	71.6	49.7	-	121.6	6.6	117.6	104.2	90.7	69.0	47.4	-
	62	125.1	5.9	124.1	121.2	118.3	94.9	72.8	50.1	120.1	6.6	118.9	116.8	114.6	91.7	69.6	47.1
	57	124.6	5.9	124.6	124.6	124.6	119.5	96.0	72.4	119.5	6.5	119.5	119.5	119.5	115.1	91.7	68.4
4250	72	136.6	6.0	118.0	94.6	71.2	47.8	-	-	129.2	6.6	115.5	92.5	69.5	46.5	-	-
	67	130.7	5.9	128.2	113.6	99.1	74.8	50.4	-	125.0	6.6	122.8	109.6	96.3	72.3	48.3	-
	62	128.2	5.9	128.2	127.6	127.0	101.7	76.4	51.1	123.5	6.6	123.1	123.1	123.1	98.0	73.0	47.9
	57	128.2	5.9	128.2	128.2	128.2	128.2	102.4	76.2	123.3	6.6	123.3	123.3	123.3	123.3	97.7	71.6
		95°F								105°F							
2125	77	118.0	7.2	62.3	51.7	41.2	-	-	-	110.3	8.4	62.5	50.8	39.2	-	-	-
	72	110.3	7.2	78.2	65.8	53.4	41.0	-	-	103.8	8.4	76.1	63.6	51.0	38.4	-	-
	67	102.6	7.3	94.2	79.9	65.6	53.3	41.0	-	97.2	8.4	89.8	76.3	62.8	50.4	38.0	-
	62	100.4	7.2	97.3	87.6	77.9	65.7	53.4	41.2	94.8	8.3	91.9	83.2	74.6	62.4	50.3	38.1
2550	77	119.2	7.2	71.5	56.4	41.4	-	-	-	111.4	8.4	70.7	54.7	38.6	-	-	-
	72	112.6	7.2	85.2	70.7	56.3	41.8	-	-	105.7	8.4	82.3	67.8	53.4	38.9	-	-
	67	106.0	7.3	98.9	85.0	71.2	56.6	42.0	-	100.1	8.4	93.9	81.0	68.1	53.5	38.9	-
	62	104.1	7.2	101.4	93.8	86.1	71.4	56.7	41.9	98.1	8.3	95.7	89.3	82.9	68.1	53.4	38.6
	57	102.2	7.2	102.0	101.5	101.0	86.2	71.3	56.4	96.1	8.3	96.1	96.1	96.1	82.7	67.8	53.0
2975	77	120.5	7.2	80.7	61.1	41.6	-	-	-	112.5	8.4	78.9	58.5	38.1	-	-	-
	72	114.9	7.3	92.1	75.6	59.2	42.7	-	-	107.7	8.4	88.5	72.1	55.8	39.5	-	-
	67	109.3	7.3	103.5	90.2	76.8	59.9	43.0	-	102.9	8.4	98.0	85.7	73.5	56.7	39.8	-
	62	107.8	7.2	105.5	99.9	94.4	77.1	59.9	42.6	101.4	8.3	99.4	95.3	91.2	73.8	56.5	39.2
	57	106.2	7.2	106.1	106.1	106.1	94.3	76.7	59.1	99.8	8.3	99.8	99.8	99.8	91.0	73.2	55.4
3400	77	121.8	7.3	89.9	65.8	41.8	-	-	-	113.6	8.4	87.2	62.4	37.6	-	-	-
	72	117.2	7.3	99.1	80.6	62.1	43.5	-	-	109.7	8.4	94.6	76.4	58.2	40.0	-	-
	67	112.6	7.3	108.2	95.3	82.3	63.2	44.1	-	105.8	8.4	102.1	90.5	78.8	59.8	40.7	-
	62	111.4	7.2	109.7	106.1	102.6	82.8	63.1	43.3	104.6	8.4	103.1	101.3	99.5	79.6	59.7	39.7
	57	110.3	7.2	110.2	110.2	110.2	102.5	82.1	61.7	103.5	8.3	103.5	103.5	103.5	99.3	78.6	57.8
3825	72	119.5	7.3	106.0	85.5	64.9	44.4	-	-	111.6	8.4	100.8	80.7	60.6	40.6	-	-
	67	116.0	7.3	112.9	100.4	87.9	66.5	45.1	-	108.6	8.4	106.2	95.2	84.2	62.9	41.6	-
	62	115.1	7.3	113.8	112.3	110.8	88.6	66.3	44.0	107.9	8.4	106.8	106.8	106.8	85.3	62.8	40.3
	57	114.3	7.2	114.3	114.3	114.3	110.7	87.5	64.4	107.2	8.3	107.2	107.2	107.2	107.2	83.9	60.2
4250	72	121.8	7.3	112.9	90.4	67.8	45.3	-	-	113.6	8.4	107.0	85.0	63.1	41.1	-	-
	67	119.3	7.3	117.5	105.5	93.5	69.8	46.1	-	111.5	8.4	110.3	99.9	89.6	66.1	42.6	-
	62	118.8	7.3	117.9	117.9	117.9	94.3	69.5	44.7	111.2	8.4	110.6	110.6	110.6	91.0	65.9	40.8
	57	118.4	7.2	118.4	118.4	118.4	118.4	92.9	67.0	110.8	8.3	110.8	110.8	110.8	110.8	89.3	62.6

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 44: ZY09 (8.5 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																
CFM		WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
					Return dry bulb (°F)								Return dry bulb (°F)					
					90	85	80	75	70	65			90	85	80	75	70	65
			115°F							125°F								
2125	77	102.7	9.5	62.7	49.9	37.1	-	-	-	95.1	10.7	62.9	49.0	35.1	-	-	-	
	72	97.3	9.5	74.1	61.3	48.5	35.7	-	-	90.7	10.6	72.0	59.0	46.1	33.1	-	-	
	67	91.8	9.5	85.4	72.7	59.9	47.5	35.0	-	86.4	10.6	81.0	69.0	57.0	44.5	32.0	-	
	62	89.3	9.4	86.6	78.9	71.3	59.2	47.1	35.0	83.7	10.6	81.3	74.6	67.9	55.9	43.9	31.9	
2550	77	103.6	9.5	69.9	52.9	35.9	-	-	-	95.8	10.7	69.1	51.2	33.2	-	-	-	
	72	98.9	9.5	79.4	65.0	50.5	36.0	-	-	92.0	10.6	76.6	62.1	47.6	33.1	-	-	
	67	94.1	9.5	89.0	77.0	65.0	50.4	35.8	-	88.2	10.6	84.0	73.0	62.0	47.3	32.7	-	
	62	92.1	9.4	89.9	84.8	79.6	64.9	50.1	35.4	86.2	10.6	84.2	80.3	76.4	61.6	46.9	32.1	
2975	57	90.1	9.4	90.1	90.1	90.1	79.3	64.4	49.5	84.1	10.5	84.1	84.1	84.1	75.9	61.0	46.1	
	77	104.5	9.5	77.2	55.9	34.7	-	-	-	96.5	10.6	75.4	53.3	31.2	-	-	-	
	72	100.5	9.5	84.8	68.6	52.4	36.2	-	-	93.3	10.6	81.2	65.1	49.1	33.0	-	-	
	67	96.5	9.5	92.5	81.3	70.2	53.4	36.6	-	90.1	10.6	87.0	76.9	66.9	50.2	33.4	-	
3400	62	95.0	9.5	93.2	90.6	88.0	70.6	53.2	35.8	88.6	10.6	87.1	85.9	84.8	67.3	49.8	32.3	
	57	93.4	9.4	93.4	93.4	93.4	87.7	69.7	51.7	87.0	10.5	87.0	87.0	87.0	84.4	66.2	48.0	
	77	105.4	9.5	84.4	58.9	33.4	-	-	-	97.1	10.6	81.7	55.5	29.3	-	-	-	
	72	102.1	9.5	90.2	72.3	54.4	36.5	-	-	94.6	10.6	85.8	68.2	50.6	33.0	-	-	
3825	67	98.9	9.5	96.0	85.7	75.4	56.4	37.4	-	92.0	10.6	89.9	80.9	71.9	53.0	34.1	-	
	62	97.8	9.5	96.5	96.4	96.3	76.3	56.2	36.2	91.0	10.6	90.0	90.0	90.0	73.0	52.8	32.6	
	57	96.7	9.4	96.7	96.7	96.7	96.2	75.0	53.9	89.9	10.5	89.9	89.9	89.9	89.9	71.5	50.0	
	72	103.8	9.5	95.6	76.0	56.4	36.8	-	-	95.9	10.6	90.4	71.2	52.1	32.9	-	-	
4250	67	101.3	9.5	99.5	90.0	80.5	59.4	38.2	-	93.9	10.6	92.9	84.8	76.8	55.8	34.8	-	
	62	100.6	9.5	99.9	99.9	99.9	82.0	59.3	36.6	93.4	10.6	92.9	92.9	92.9	78.7	55.7	32.8	
	57	100.0	9.4	100.0	100.0	100.0	80.3	56.1	36.1	92.9	10.5	92.9	92.9	92.9	92.9	76.7	51.9	
	72	105.4	9.5	101.0	79.7	58.3	37.0	-	-	97.2	10.6	95.0	74.3	53.6	32.9	-	-	
4250	67	103.6	9.5	103.0	94.4	85.7	62.3	39.0	-	95.8	10.6	95.8	88.8	81.8	58.6	35.4	-	
	62	103.5	9.5	103.2	103.2	103.2	87.7	62.3	36.9	95.8	10.6	95.8	95.8	95.8	84.4	58.7	33.0	
	57	103.3	9.4	103.3	103.3	103.3	85.6	58.2	36.2	95.8	10.5	95.8	95.8	95.8	95.8	82.0	53.8	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 45: ZY12 (10 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
2500	77	154.5	6.7	76.5	65.2	53.9	—	—	—	146.7	7.6	73.6	61.6	49.6	—	—	—
	72	140.5	6.6	93.7	80.2	66.6	53.1	—	—	133.6	7.5	90.5	76.8	63.1	49.4	—	—
	67	126.4	6.5	110.9	95.1	79.4	66.3	53.0	—	120.6	7.5	107.4	92.0	76.6	63.0	49.2	—
	62	118.5	6.5	118.5	105.3	92.1	76.5	66.4	53.6	115.0	7.4	114.1	102.1	90.1	75.0	62.8	49.1
3000	77	157.6	6.7	87.0	70.8	54.6	—	—	—	148.4	7.6	83.9	67.0	50.0	—	—	—
	72	144.7	6.6	102.7	86.6	70.4	54.3	—	—	136.9	7.5	99.1	82.9	66.6	50.3	—	—
	67	131.7	6.5	118.4	102.3	86.3	70.4	54.4	—	125.4	7.5	114.4	98.8	83.2	66.9	50.4	—
	62	125.2	6.5	118.5	113.3	102.1	84.1	70.7	55.0	120.9	7.5	116.0	109.7	99.8	82.2	66.8	50.4
3500	57	118.7	6.4	118.7	118.7	117.9	102.4	86.9	71.5	116.4	7.4	116.4	116.4	116.3	99.8	83.2	66.6
	77	159.2	6.7	97.5	76.5	55.4	—	—	—	150.2	7.6	94.2	72.3	50.4	—	—	—
	72	148.9	6.6	111.7	93.0	74.3	55.5	—	—	140.2	7.5	107.8	88.9	70.1	51.2	—	—
	67	137.0	6.5	125.9	109.5	93.1	74.5	55.8	—	130.2	7.5	121.4	105.6	89.8	70.7	51.6	—
4000	62	131.8	6.5	126.2	121.3	112.0	91.8	74.9	56.3	126.8	7.5	123.0	117.3	109.5	89.3	70.9	51.6
	57	126.7	6.5	126.7	126.7	126.3	112.4	94.0	75.5	123.3	7.4	123.3	123.3	123.3	109.6	90.2	70.7
	77	160.8	6.7	108.0	82.1	56.1	—	—	—	151.9	7.6	104.5	77.7	50.8	—	—	—
	72	153.1	6.6	120.8	99.4	78.1	56.7	—	—	143.5	7.5	116.4	95.0	73.6	52.1	—	—
4500	67	142.4	6.6	133.5	116.8	100.0	78.7	57.2	—	135.1	7.5	128.4	112.4	96.4	74.6	52.8	—
	62	138.5	6.5	134.0	129.3	122.0	99.5	79.1	57.7	132.6	7.5	130.0	124.9	119.1	96.5	75.0	52.9
	57	134.6	6.5	134.6	134.6	134.6	122.5	101.0	79.6	130.2	7.5	130.2	130.2	130.2	119.5	97.1	74.7
	72	161.6	6.6	129.8	105.8	81.9	57.9	—	—	152.1	7.6	125.1	101.1	77.0	53.0	—	—
5000	67	147.7	6.6	141.0	124.0	106.9	82.8	58.7	—	139.9	7.5	135.3	119.1	102.9	78.5	54.0	—
	62	145.1	6.6	142.1	137.3	132.0	107.1	83.4	59.1	138.5	7.5	136.2	132.5	128.8	103.7	79.0	54.1
	57	142.6	6.5	142.4	142.4	142.4	132.5	108.1	83.6	137.1	7.5	136.4	136.4	136.4	129.4	104.1	78.7
	72	163.9	6.6	138.8	112.2	85.7	59.1	—	—	152.5	7.6	133.7	107.1	80.5	53.9	—	—
5500	67	153.0	6.6	148.5	131.2	113.8	86.9	60.1	—	144.7	7.5	142.3	125.9	109.5	82.4	55.2	—
	62	151.8	6.6	148.8	145.3	141.9	114.8	87.6	60.4	144.4	7.5	142.6	140.1	138.5	110.8	83.1	55.4
	57	150.6	6.5	149.0	149.0	149.0	142.6	115.1	87.6	144.0	7.5	143.0	143.0	143.0	139.3	111.0	82.8
		95°F								105°F							
2500	77	138.8	8.4	70.6	58.0	45.4	—	—	—	127.5	9.9	68.6	55.8	43.1	—	—	—
	72	126.8	8.4	87.3	73.4	59.6	45.8	—	—	117.2	9.8	84.2	70.4	56.5	42.6	—	—
	67	114.7	8.4	104.0	88.9	73.8	59.7	45.5	—	107.0	9.8	99.9	84.9	69.9	55.9	41.9	—
	62	111.5	8.4	109.7	98.9	88.0	73.6	59.1	44.6	105.5	9.7	103.3	93.3	83.3	69.2	55.0	40.9
3000	77	139.2	8.5	80.7	63.1	45.4	—	—	—	128.3	9.9	78.2	60.3	42.3	—	—	—
	72	129.1	8.5	95.6	79.2	62.8	46.4	—	—	119.6	9.8	91.7	75.5	59.2	42.9	—	—
	67	119.1	8.4	110.4	95.2	80.1	63.3	46.5	—	110.9	9.8	105.3	90.7	76.1	59.4	42.8	—
	62	116.6	8.4	113.8	106.1	97.5	80.2	63.0	45.7	109.6	9.7	107.9	100.4	92.9	75.9	58.9	41.9
3500	57	114.0	8.4	114.0	114.0	114.0	97.1	79.5	61.8	108.2	9.7	108.2	108.2	108.2	92.4	75.0	57.6
	77	139.5	8.5	90.9	68.2	45.4	—	—	—	129.1	9.9	87.9	64.7	41.5	—	—	—
	72	131.5	8.5	103.8	84.9	65.9	46.9	—	—	122.0	9.8	99.3	80.6	61.9	43.2	—	—
	67	123.4	8.5	116.8	101.6	86.4	66.9	47.4	—	114.9	9.8	110.6	96.4	82.2	62.9	43.6	—
4000	62	121.7	8.4	119.7	113.3	106.9	86.9	66.9	46.9	113.7	9.8	112.4	107.5	102.6	82.7	62.7	42.8
	57	119.9	8.4	119.9	119.9	119.9	106.8	86.3	65.8	112.5	9.7	112.5	112.5	112.5	102.4	81.8	61.2
	77	139.9	8.5	101.0	73.2	45.5	—	—	—	129.9	9.9	97.6	69.1	40.7	—	—	—
	72	133.8	8.5	112.1	90.6	69.1	47.5	—	—	124.4	9.8	106.8	85.7	64.6	43.5	—	—
4500	67	127.8	8.5	123.2	108.0	92.7	70.5	48.4	—	118.9	9.8	116.0	102.2	88.4	66.4	44.5	—
	62	126.7	8.4	124.7	120.5	116.3	93.5	70.8	48.1	117.8	9.8	116.6	114.6	112.3	89.4	66.6	43.7
	57	125.7	8.4	125.7	125.7	125.7	116.6	93.2	69.8	116.7	9.7	116.7	116.7	116.7	112.4	88.6	64.9
	72	140.4	8.5	120.4	96.3	72.2	48.1	—	—	130.2	9.8	114.3	90.8	67.3	43.8	—	—
5000	67	132.1	8.5	129.6	114.3	99.0	74.2	49.4	—	122.9	9.8	120.5	108.0	94.6	70.0	45.3	—
	62	131.8	8.5	129.7	127.7	125.7	100.2	74.7	49.2	121.9	9.8	120.7	120.7	120.7	96.2	70.4	44.6
	57	131.5	8.4	129.8	129.8	129.8	126.3	100.1	73.9	120.9	9.7	120.9	120.9	120.9	120.9	95.4	68.5
	72	141.2	8.5	128.7	102.0	75.4	48.7	—	—	130.6	9.8	121.8	95.9	70.0	44.1	—	—
5500	67	137.4	8.5	134.5	120.7	105.2	77.8	50.3	—	126.8	9.8	124.6	113.7	100.8	73.5	46.2	—
	62	136.9	8.5	134.7	134.7	134.7	106.9	78.6	50.4	126.0	9.8	125.0	125.0	125.0	102.9	74.2	45.5
	57	136.5	8.4	136.2	136.2	136.2	136.0	106.9	77.9	125.1	9.7	125.1	125.1	125.1	125.1	102.3	72.1

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 46: ZY12 (10 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		115°F									125°F								
2500	77	116.2	11.4	66.6	53.7	40.8	—	—	—	104.9	12.8	64.5	51.5	38.5	—	—	—		
	72	107.7	11.2	81.2	67.3	53.4	39.5	—	—	102.1	12.6	78.2	64.2	50.3	36.3	—	—		
	67	99.2	11.1	95.9	80.9	65.9	52.1	38.3	—	93.5	12.5	91.0	76.9	62.0	48.3	34.7	—		
	62	99.5	11.1	97.0	87.7	78.5	64.8	51.0	37.3	91.4	12.4	91.2	82.2	73.7	60.4	47.0	33.7		
3000	77	117.5	11.3	75.7	57.5	39.2	—	—	—	106.6	12.8	73.2	54.7	36.1	—	—	—		
	72	110.1	11.2	87.9	71.8	55.6	39.4	—	—	101.6	12.6	84.1	68.1	52.0	36.0	—	—		
	67	102.8	11.1	100.1	86.1	72.0	55.5	39.0	—	96.6	12.5	94.3	81.5	68.0	51.6	35.3	—		
	62	102.6	11.1	101.0	94.7	88.4	71.6	54.8	38.0	95.6	12.4	95.0	89.0	83.9	67.3	50.7	34.1		
3500	57	102.4	11.0	101.9	101.9	101.9	87.7	70.5	53.4	95.4	12.4	95.3	95.3	95.3	82.9	66.1	49.2		
	77	118.7	11.3	84.9	61.2	37.6	—	—	—	108.3	12.7	81.9	57.8	33.7	—	—	—		
	72	112.6	11.2	94.7	76.2	57.8	39.4	—	—	104.2	12.6	90.1	71.9	53.8	35.7	—	—		
	67	106.4	11.1	104.4	91.3	78.1	58.9	39.8	—	100.1	12.5	97.7	86.1	73.9	55.0	36.0	—		
4000	62	105.7	11.1	104.9	101.7	98.4	78.4	58.5	38.6	99.5	12.4	98.2	95.9	94.1	74.2	54.4	34.5		
	57	105.0	11.0	105.0	105.0	105.0	98.0	77.3	56.7	99.0	12.4	99.0	99.0	99.0	93.5	72.8	52.1		
	77	120.0	11.3	94.1	65.0	36.0	—	—	—	110.1	12.6	90.6	60.9	31.2	—	—	—		
	72	115.0	11.2	101.4	80.7	60.1	39.4	—	—	105.6	12.6	96.0	75.8	55.6	35.4	—	—		
4500	67	110.0	11.1	107.5	96.4	84.2	62.4	40.5	—	101.1	12.5	99.2	90.7	79.9	58.3	36.6	—		
	62	108.8	11.1	107.8	107.8	107.8	85.3	62.3	39.3	99.9	12.4	99.3	99.3	99.3	81.2	58.1	34.9		
	57	108.3	11.0	108.3	108.3	108.3	108.2	84.1	59.9	99.4	12.3	99.4	99.4	99.4	99.4	79.5	54.9		
	72	120.5	11.2	108.1	85.2	62.3	39.4	—	—	110.5	12.5	100.9	79.6	57.3	35.0	—	—		
5000	67	114.5	11.1	112.1	101.6	90.3	65.8	41.3	—	104.3	12.5	101.0	95.3	85.9	61.6	37.2	—		
	62	113.2	11.1	112.3	112.3	112.3	92.1	66.1	40.0	102.0	12.4	101.0	101.0	101.0	88.1	61.7	35.3		
	57	112.5	11.0	112.5	112.5	112.5	112.5	90.8	63.2	101.2	12.3	101.2	101.2	101.2	101.2	86.2	57.8		
	72	121.1	11.2	113.5	89.7	64.5	39.4	—	—	112.2	12.5	103.1	83.5	59.1	34.7	—	—		
5000	67	117.2	11.2	114.0	106.8	96.3	69.2	42.0	—	108.6	12.5	103.3	99.8	91.9	64.9	37.9	—		
	62	115.1	11.1	114.1	114.1	114.1	99.0	69.8	40.6	106.4	12.4	103.4	103.4	103.4	95.0	65.4	35.8		
	57	114.2	11.0	114.2	114.2	114.2	114.2	97.6	66.4	103.5	12.3	103.5	103.5	103.5	103.5	92.9	60.7		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

## ZL04 to 06 cooling capacities

**Table 47: ZL04 (3.0 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
750	77	47.2	2	20.4	17.2	13.9	—	—	—	44.6	2.3	19.4	16.1	12.9	—	—	—
	72	42.9	1.9	25.3	22	18.7	15.5	—	—	40.6	2.2	24.2	20.9	17.7	14.5	—	—
	67	38.5	1.9	30.1	26.8	23.6	20.3	17.1	—	36.5	2.2	29	25.7	22.5	19.3	16	—
	62	35	1.9	35	32.7	28	24.8	21.5	18.3	33.3	2.2	33.3	32.1	27.2	23.9	20.7	17.5
900	77	48.9	2	22.9	19.1	15.3	—	—	—	46	2.3	21.7	17.9	14.1	—	—	—
	72	44.4	1.9	28.2	24.4	20.6	16.7	—	—	41.8	2.2	27	23.2	19.4	15.6	—	—
	67	39.9	1.9	33.5	29.7	25.8	22	18.2	—	37.7	2.2	32.2	28.4	24.6	20.8	17.1	—
	62	36.3	1.9	36.3	34.7	30.8	26.9	23.1	19.3	34.3	2.2	34.3	33.5	29.7	26	22.2	18.4
	57	33.1	1.9	33.1	33.1	30.1	26.3	22.5	18.7	32.7	2.2	32.7	32.7	29.5	25.8	22	18.2
1050	77	50.6	2	25.4	21	16.6	—	—	—	47.4	2.3	24	19.7	15.4	—	—	—
	72	45.9	2	31.2	26.8	22.4	18	—	—	43.1	2.2	29.7	25.4	21.1	16.7	—	—
	67	41.3	1.9	36.9	32.5	28.1	23.7	19.3	—	38.8	2.2	35.4	31.1	26.8	22.4	18.1	—
	62	37.5	1.9	37.5	36.8	33.5	29.1	24.7	20.3	35.3	2.2	35.3	34.9	32.3	28	23.6	19.3
	57	34.3	1.9	34.3	34.3	32.8	28.4	24	19.6	33.7	2.2	33.7	33.7	32.1	27.8	23.4	19.1
1200	77	52.3	2	27.9	23	18	—	—	—	48.8	2.3	26.4	21.5	16.6	—	—	—
	72	47.5	2	34.1	29.2	24.2	19.2	—	—	44.3	2.2	32.5	27.6	22.7	17.9	—	—
	67	42.7	1.9	40.4	35.4	30.4	25.4	20.5	—	39.9	2.2	38.7	33.8	28.9	24	19.1	—
	62	38.8	1.9	38.8	38.8	36.2	31.2	26.3	21.3	36.4	2.2	36.4	36.4	34.9	30	25.1	20.2
	57	35.5	1.9	35.5	35.5	35.5	30.5	25.5	20.6	34.7	2.2	34.7	34.7	34.7	29.8	24.9	20
1350	72	48.4	2	36.5	31.1	25.7	20.3	—	—	45.1	2.3	35	29.6	24.3	18.9	—	—
	67	43.5	1.9	42.3	37.7	32.3	26.8	21.4	—	40.6	2.2	40	36.2	30.8	25.5	20.1	—
	62	39.6	1.9	39.6	39.6	38.3	32.8	27.4	22	37	2.2	37	37	36.3	30.9	25.6	20.2
	57	36.2	1.9	36.2	36.2	36.2	30.8	25.3	19.9	35.3	2.2	35.3	35.3	35.3	29.9	24.6	19.2
1500	72	49.3	2	38.8	33	27.1	21.3	—	—	45.9	2.3	37.4	31.6	25.8	20	—	—
	67	44.3	2	44.3	39.9	34.1	28.3	22.4	—	41.4	2.2	41.4	38.6	32.8	26.9	21.1	—
	62	40.3	1.9	40.3	40.3	40.3	34.5	28.6	22.8	37.7	2.2	37.7	37.7	37.7	31.9	26	20.2
	57	36.8	1.9	36.8	36.8	36.8	31	25.2	19.3	35.9	2.2	35.9	35.9	35.9	30.1	24.3	18.5

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 48: ZL04 (3.0 ton, 95°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		95°F								105°F							
750	77	42	2.5	18.3	15.1	11.9	—	—	—	39	2.9	16.4	13.9	10.7	—	—	—
	72	38.3	2.5	23.1	19.9	16.7	13.4	—	—	35.5	2.9	21.8	18.6	15.5	12.3	—	—
	67	34.6	2.5	27.9	24.6	21.4	18.2	15	—	32.1	2.8	27.1	23.4	20.2	17	13.9	—
	62	31.5	2.5	31.5	31.5	26.3	23.1	19.9	16.6	29.3	2.8	29.3	29.3	24.2	21	17.9	14.7
900	77	43.1	2.5	20.5	16.7	13	—	—	—	39.9	2.9	19.2	15.5	11.8	—	—	—
	72	39.3	2.5	25.7	21.9	18.2	14.5	—	—	36.4	2.9	24.4	20.7	17	13.3	—	—
	67	35.4	2.5	30.9	27.2	23.4	19.7	15.9	—	32.9	2.9	29.6	25.9	22.2	18.5	14.8	—
	62	32.3	2.5	32.3	32.3	28.7	25	21.2	17.5	30	2.8	30	30	26.5	22.8	19.2	15.5
1050	57	32.3	2.5	32.3	32.3	29	25.2	21.5	17.7	30.3	2.8	30.3	30.3	27	23.3	19.6	15.9
	77	44.1	2.6	22.6	18.4	14.1	—	—	—	40.9	2.9	21.9	17.1	12.8	—	—	—
	72	40.2	2.5	28.3	24	19.7	15.5	—	—	37.3	2.9	26.9	22.7	18.5	14.3	—	—
	67	36.3	2.5	34	29.7	25.4	21.1	16.8	—	33.7	2.9	32	28.4	24.1	19.9	15.7	—
	62	33.1	2.5	33.1	33.1	31.2	26.9	22.6	18.3	30.7	2.9	30.7	30.7	28.9	24.7	20.4	16.2
1200	57	33.1	2.5	33.1	33.1	31.4	27.1	22.8	18.6	31.1	2.8	31.1	31.1	29.4	25.2	20.9	16.7
	77	45.2	2.6	24.8	20	15.2	—	—	—	41.8	2.9	24.7	18.6	13.9	—	—	—
	72	41.2	2.5	30.9	26.1	21.3	16.5	—	—	38.1	2.9	29.5	24.8	20	15.2	—	—
	67	37.2	2.5	37	32.2	27.4	22.6	17.8	—	34.4	2.9	34.4	30.9	26.1	21.3	16.6	—
	62	33.9	2.5	33.9	33.9	33.6	28.8	24	19.2	31.4	2.9	31.4	31.4	31.2	26.5	21.7	16.9
1350	57	33.9	2.5	33.9	33.9	33.9	29.1	24.2	19.4	31.8	2.9	31.8	31.8	31.8	27	22.3	17.5
	72	41.9	2.5	33.5	28.2	22.9	17.5	—	—	38.6	2.9	32	26.7	21.5	16.2	—	—
	67	37.8	2.5	37.7	34.7	29.4	24.1	18.8	—	34.9	2.9	34.9	32.8	28.1	22.8	17.5	—
	62	34.5	2.5	34.5	34.5	34.3	29	23.7	18.4	31.8	2.9	31.8	31.8	31.7	26.5	21.2	16
1500	57	34.4	2.5	34.4	34.4	34.4	29.1	23.8	18.5	32.2	2.9	32.2	32.2	32.2	27	21.7	16.4
	72	42.6	2.5	36	30.2	24.4	18.6	—	—	39.2	2.9	34.5	28.7	23	17.2	—	—
	67	38.4	2.5	38.4	37.2	31.4	25.6	19.8	—	35.4	2.9	35.4	34.8	30	24.3	18.5	—
	62	35	2.5	35	35	35	29.2	23.4	17.7	32.2	2.9	32.2	32.2	32.2	26.5	20.7	15
	57	35	2.5	35	35	35	29.2	23.4	17.6	32.6	2.9	32.6	32.6	32.6	26.9	21.1	15.4
		115°F								125°F							
750	77	35.9	3.3	14.5	12.7	9.6	—	—	—	32.9	3.6	12.6	11.5	8.5	—	—	—
	72	32.8	3.2	20.5	17.4	14.3	11.2	—	—	30	3.6	19.2	16.1	13.1	10.1	—	—
	67	29.6	3.2	26.4	22.1	19	15.9	12.8	—	27.2	3.6	25.7	20.8	17.7	14.7	11.7	—
	62	27	3.2	27	27	22.1	19	15.9	12.8	24.7	3.6	24.7	24.7	20	16.9	13.9	10.9
900	77	36.8	3.3	17.9	14.2	10.6	—	—	—	33.6	3.6	16.6	13	9.4	—	—	—
	72	33.5	3.2	23	19.4	15.8	12.1	—	—	30.7	3.6	21.7	18.1	14.5	11	—	—
	67	30.3	3.2	28.2	24.6	20.9	17.3	13.6	—	27.8	3.6	26.8	23.2	19.7	16.1	12.5	—
	62	27.6	3.2	27.6	27.6	24.4	20.7	17.1	13.4	25.3	3.6	25.3	25.3	22.2	18.6	15	11.4
	57	28.4	3.2	28.4	28.4	25	21.4	17.8	14.1	26.5	3.6	26.5	26.5	23.1	19.5	15.9	12.3
1050	77	37.6	3.3	21.2	15.8	11.6	—	—	—	34.3	3.6	20.5	14.5	10.3	—	—	—
	72	34.3	3.3	25.6	21.4	17.2	13	—	—	31.4	3.6	24.2	20.1	16	11.8	—	—
	67	31	3.2	29.9	27	22.9	18.7	14.5	—	28.4	3.6	27.9	25.7	21.6	17.5	13.4	—
	62	28.3	3.2	28.3	28.3	26.6	22.4	18.3	14.1	25.8	3.6	25.8	25.8	24.3	20.2	16.1	12
	57	29.1	3.2	29.1	29.1	27.4	23.2	19	14.8	27.1	3.6	27.1	27.1	25.4	21.2	17.1	13
1200	77	38.4	3.3	24.6	17.3	12.6	—	—	—	35.1	3.6	24.5	15.9	11.3	—	—	—
	72	35.1	3.3	28.1	23.4	18.7	14	—	—	32	3.6	26.7	22.1	17.4	12.7	—	—
	67	31.7	3.2	31.7	29.5	24.8	20.1	15.4	—	29	3.6	29	28.2	23.5	18.9	14.2	—
	62	28.9	3.2	28.9	28.9	28.9	24.2	19.5	14.7	26.4	3.6	26.4	26.4	26.4	21.9	17.2	12.5
	57	29.7	3.2	29.7	29.7	29.7	25	20.3	15.5	27.6	3.6	27.6	27.6	27.6	23	18.3	13.6
1350	72	35.4	3.3	30.5	25.3	20.1	14.9	—	—	32.2	3.6	29.1	23.9	18.8	13.6	—	—
	67	32	3.2	32	30.9	26.7	21.5	16.3	—	29.1	3.6	29.1	29	25.4	20.2	15.1	—
	62	29.2	3.2	29.2	29.2	29.2	24	18.8	13.5	26.5	3.6	26.5	26.5	26.5	21.4	16.3	11.1
	57	30	3.2	30	30	30	24.8	19.6	14.4	27.8	3.6	27.8	27.8	27.8	22.6	17.5	12.3
1500	72	35.7	3.3	33	27.3	21.6	15.9	—	—	32.3	3.6	31.4	25.8	20.1	14.5	—	—
	67	32.3	3.3	32.3	32.3	28.6	22.9	17.2	—	29.3	3.6	29.3	29.3	27.2	21.6	15.9	—
	62	29.5	3.2	29.5	29.5	29.5	23.8	18.1	12.4	26.7	3.6	26.7	26.7	26.7	21	15.4	9.7
	57	30.3	3.2	30.3	30.3	30.3	24.6	18.9	13.2	27.9	3.6	27.9	27.9	27.9	22.3	16.6	11

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



**Table 49: ZL05 (4.0 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65					90	85	80	75	70	65
		75°F								85°F									
1000	77	59.6	2.9	27.1	21.8	17.1	—	—	—	57.1	3.2	25.5	20.8	16.1	—	—	—		
	72	56.0	2.8	34.4	29.7	25.0	20.3	—	—	53.2	3.1	33.0	28.3	23.7	19.0	—	—		
	67	52.5	2.6	41.8	37.7	33.0	28.3	23.6	—	49.2	3.0	40.5	35.9	31.2	26.5	21.9	—		
	62	48.2	2.6	48.2	48.2	40.6	35.9	31.2	26.5	44.8	2.9	44.8	44.8	37.8	33.1	28.5	23.8		
1200	77	60.8	2.9	28.7	23.5	18.3	—	—	—	58.4	3.2	27.9	22.7	17.4	—	—	—		
	72	57.2	2.8	37.2	32.0	26.8	21.6	—	—	54.4	3.1	36.0	30.8	25.5	20.3	—	—		
	67	53.6	2.6	45.7	40.5	35.3	30.1	24.9	—	50.3	3.0	44.1	38.9	33.6	28.4	23.1	—		
	62	49.3	2.5	49.3	49.3	43.4	38.2	33.0	27.8	45.8	2.9	45.8	45.8	40.8	35.5	30.2	25.0		
1400	57	48.9	2.5	48.9	48.9	45.0	39.8	34.6	29.4	45.5	2.9	45.5	45.5	41.5	36.2	31.0	25.7		
	77	62.1	2.9	30.3	25.2	19.4	—	—	—	59.7	3.2	30.4	24.5	18.7	—	—	—		
	72	58.4	2.8	39.9	34.2	28.5	22.8	—	—	55.6	3.1	39.1	33.2	27.4	21.5	—	—		
	67	54.7	2.6	49.6	43.3	37.6	31.9	26.2	—	51.4	3.0	47.8	41.9	36.1	30.2	24.4	—		
1600	62	50.3	2.5	50.3	50.3	46.3	40.6	34.9	29.1	46.8	2.9	46.8	46.8	43.7	37.9	32.0	26.2		
	57	49.9	2.5	49.9	49.9	48.0	42.3	36.6	30.9	46.5	2.9	46.5	46.5	44.5	38.6	32.8	26.9		
	77	63.4	2.9	31.9	26.9	20.6	—	—	—	61.0	3.2	32.8	26.4	19.9	—	—	—		
	72	59.6	2.8	42.7	36.5	30.3	24.0	—	—	56.8	3.1	42.1	35.7	29.2	22.8	—	—		
1800	67	55.8	2.6	53.5	46.1	39.9	33.7	27.4	—	52.5	3.0	51.4	45.0	38.5	32.1	25.6	—		
	62	51.3	2.5	51.3	51.3	49.1	42.9	36.7	30.5	47.8	2.9	47.8	47.8	46.7	40.2	33.8	27.4		
	57	51.0	2.5	51.0	51.0	51.0	44.8	38.5	32.3	47.5	2.9	47.5	47.5	47.5	41.1	34.6	28.2		
	72	61.5	2.8	46.3	39.4	32.5	25.7	—	—	58.2	3.1	45.6	38.5	31.4	24.2	—	—		
2000	67	57.6	2.6	56.4	49.8	42.9	36.0	29.1	—	53.9	3.0	53.3	48.4	41.3	34.2	27.1	—		
	62	52.9	2.6	52.9	52.9	51.8	44.9	38.1	31.2	49.0	2.9	49.0	49.0	48.5	41.3	34.2	27.1		
	57	52.6	2.5	52.6	52.6	45.7	38.8	31.9	—	48.7	2.9	48.7	48.7	48.7	41.6	34.5	27.4		
	72	63.3	2.8	49.9	42.4	34.8	27.3	—	—	59.7	3.1	49.1	41.3	33.5	25.7	—	—		
2000	67	59.3	2.7	59.3	53.4	45.9	38.4	30.8	—	55.3	3.0	55.3	51.9	44.1	36.4	28.6	—		
	62	54.5	2.6	54.5	54.5	54.5	47.0	39.4	31.9	50.2	3.0	50.2	50.2	50.2	42.4	34.7	26.9		
	57	54.1	2.6	54.1	54.1	54.1	46.6	39.0	31.5	49.9	2.9	49.9	49.9	49.9	42.2	34.4	26.6		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 50: ZL05 (4.0 ton, 95°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	<sup>1</sup> Total capacity <sup>1</sup> (MBh)	<sup>2</sup> Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		95°F									105°F								
1000	77	54.7	3.4	23.9	19.9	15.2	—	—	—	50.0	3.8	21.4	18.3	13.6	—	—	—		
	72	50.4	3.4	31.6	26.9	22.3	17.7	—	—	45.7	3.8	29.7	25.0	20.4	15.7	—	—		
	67	46.0	3.3	39.2	34.0	29.4	24.8	20.2	—	41.4	3.7	38.0	31.8	27.2	22.5	17.9	—		
	62	41.3	3.2	41.3	41.3	35.0	30.4	25.8	21.1	37.5	3.6	37.5	37.5	31.2	26.6	21.9	17.3		
1200	77	56.0	3.5	27.2	21.9	16.6	—	—	—	51.4	3.9	25.8	20.3	15.0	—	—	—		
	72	51.5	3.4	34.9	29.6	24.3	19.0	—	—	47.0	3.8	33.1	27.8	22.4	17.1	—	—		
	67	47.1	3.3	42.6	37.3	32.0	26.7	21.4	—	42.5	3.7	40.3	35.2	29.9	24.6	19.3	—		
	62	42.3	3.3	42.3	42.3	38.1	32.8	27.5	22.2	38.5	3.7	38.5	38.5	34.3	29.0	23.7	18.4		
1400	57	42.1	3.3	42.1	42.1	37.9	32.6	27.3	22.0	39.0	3.7	39.0	39.0	34.7	29.4	24.1	18.8		
	77	57.3	3.5	30.5	23.9	17.9	—	—	—	52.8	3.9	30.3	22.3	16.3	—	—	—		
	72	52.7	3.4	38.2	32.2	26.2	20.3	—	—	48.2	3.8	36.4	30.5	24.5	18.5	—	—		
	67	48.2	3.3	45.9	40.5	34.6	28.6	22.6	—	43.7	3.8	42.5	38.6	32.7	26.7	20.7	—		
1600	62	43.3	3.3	43.3	43.3	41.2	35.2	29.2	23.2	39.6	3.7	39.6	39.6	37.5	31.5	25.5	19.6		
	57	43.1	3.3	43.1	43.1	41.0	35.0	29.0	23.0	40.1	3.7	40.1	40.1	37.9	31.9	26.0	20.0		
	77	58.5	3.5	33.7	25.9	19.2	—	—	—	54.1	3.9	34.8	24.3	17.7	—	—	—		
	72	53.9	3.4	41.5	34.8	28.2	21.5	—	—	49.5	3.9	39.8	33.2	26.5	19.9	—	—		
1800	67	49.3	3.3	49.3	43.8	37.1	30.5	23.8	—	44.8	3.8	44.8	42.0	35.4	28.8	22.2	—		
	62	44.2	3.3	44.2	44.2	44.2	37.6	30.9	24.3	40.6	3.7	40.6	40.6	40.6	34.0	27.3	20.7		
	57	44.0	3.3	44.0	44.0	44.0	37.4	30.7	24.0	41.1	3.8	41.1	41.1	41.1	34.5	27.8	21.2		
	72	55.0	3.4	44.9	37.5	30.2	22.8	—	—	50.5	3.9	43.2	35.9	28.5	21.2	—	—		
2000	67	50.2	3.4	50.2	47.1	39.8	32.4	25.1	—	45.7	3.8	45.7	44.2	38.0	30.7	23.3	—		
	62	45.1	3.3	45.1	45.1	45.1	37.8	30.4	23.1	41.5	3.8	41.5	41.5	41.5	34.1	26.8	19.4		
	57	44.9	3.3	44.9	44.9	44.9	37.5	30.2	22.8	42.0	3.8	42.0	42.0	42.0	34.6	27.3	19.9		
	72	56.0	3.4	48.3	40.2	32.2	24.1	—	—	51.6	3.9	46.6	38.5	30.5	22.4	—	—		
1000	67	51.2	3.4	51.2	50.4	42.4	34.4	26.3	—	46.7	3.8	46.7	46.3	40.6	32.6	24.5	—		
	62	46.0	3.3	46.0	46.0	46.0	37.9	29.9	21.9	42.3	3.8	42.3	42.3	42.3	34.2	26.2	18.1		
	57	45.8	3.3	45.8	45.8	45.8	37.7	29.7	21.6	42.9	3.8	42.9	42.9	42.9	34.8	26.7	18.6		
	115°F									125°F									
1200	77	45.4	4.2	18.9	16.7	12.0	—	—	—	40.8	4.6	19.7	13.7	10.3	—	—	—		
	72	41.1	4.1	27.8	23.2	18.5	13.8	—	—	36.5	4.5	26.0	21.3	16.6	11.9	—	—		
	67	36.8	4.1	36.8	29.7	25.0	20.3	15.6	—	32.2	4.5	32.2	27.6	22.8	18.1	13.4	—		
	62	33.7	4.0	33.7	33.7	27.4	22.7	18.1	13.4	29.9	4.4	29.9	29.9	23.6	18.9	14.2	9.5		
1400	77	46.9	4.3	24.5	18.7	13.4	—	—	—	42.3	4.7	25.4	17.1	11.8	—	—	—		
	72	42.4	4.2	31.2	25.9	20.6	15.3	—	—	37.9	4.6	29.4	24.1	18.8	13.5	—	—		
	67	38.0	4.1	38.0	33.2	27.9	22.6	17.2	—	33.4	4.6	33.4	31.1	25.8	20.5	15.2	—		
	62	34.8	4.1	34.8	34.8	30.6	25.3	20.0	14.7	31.1	4.5	31.1	31.1	26.9	21.5	16.2	10.9		
1600	57	36.0	4.1	36.0	36.0	31.6	26.3	21.0	15.6	32.9	4.5	32.9	32.9	28.4	23.1	17.8	12.5		
	77	48.3	4.3	30.2	20.7	14.8	—	—	—	43.8	4.7	31.2	20.4	13.2	—	—	—		
	72	43.7	4.3	34.7	28.7	22.8	16.8	—	—	39.2	4.7	32.9	27.0	21.0	15.1	—	—		
	67	39.1	4.2	39.1	36.7	30.8	24.8	18.9	—	34.6	4.6	34.6	34.6	28.9	22.9	17.0	—		
1800	62	35.9	4.1	35.9	35.9	33.8	27.8	21.9	15.9	32.2	4.6	32.2	32.2	30.1	24.2	18.2	12.3		
	57	37.1	4.1	37.1	37.1	34.9	28.9	23.0	17.0	34.1	4.6	34.1	34.1	31.8	25.9	20.0	14.0		
	77	49.7	4.4	35.8	22.7	16.1	—	—	—	45.3	4.8	36.9	23.8	14.6	—	—	—		
	72	45.0	4.3	38.1	31.5	24.9	18.3	—	—	40.6	4.8	36.4	29.8	23.3	16.7	—	—		
2000	67	40.3	4.3	40.3	40.2	33.7	27.1	20.5	—	35.8	4.7	35.8	35.8	31.9	25.4	18.8	—		
	62	37.0	4.2	37.0	37.0	30.4	23.8	17.2	—	33.3	4.6	33.3	33.3	33.3	26.8	20.2	13.7		
	57	38.2	4.2	38.2	38.2	38.1	31.6	25.0	18.4	35.3	4.6	35.3	35.3	35.2	28.7	22.1	15.6		
	72	46.1	4.3	41.5	34.2	26.8	19.5	—	—	41.6	4.8	39.8	32.5	25.1	17.8	—	—		
1000	67	41.3	4.3	41.3	41.2	36.3	28.9	21.6	—	36.8	4.7	36.8	36.8	34.5	27.2	19.8	—		
	62	37.8	4.2	37.8	37.8	37.8	30.5	23.1	15.8	34.2	4.6	34.2	34.2	34.2	26.8	19.5	12.1		
	57	39.1	4.2	39.1	39.1	39.1	31.7	24.4	17.0	36.2	4.6	36.2	36.2	36.1	28.8	21.4	14.1		
	72	47.1	4.3	45.0	36.9	28.7	20.6	—	—	42.7	4.8	42.7	35.2	27.0	18.9	—	—		
1200	67	42.2	4.3	42.2	42.2	38.9	30.7	22.6	—	37.7	4.7	37.7	37.7	37.1	28.9	20.8	—		
	62	38.7	4.2	38.7	38.7	38.7	30.6	22.4	14.3	35.0	4.6	35.0	35.0	35.0	26.9	18.7	10.6		
	57	40.0	4.2	40.0	40.0	40.0	31.8	23.7	15.6	37.1	4.7	37.1	37.1	37.1	28.9	20.8	12.6		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 51: ZL06 (5.0 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65					90	85	80	75	70	65
		75°F									85°F								
1250	77	79.5	3.6	36.1	29.8	23.9	—	—	—	75.8	3.9	33.5	27.7	21.9	—	—	—		
	72	72.1	3.4	44.5	38.6	32.7	26.7	—	—	69.0	3.8	42.3	36.4	30.6	24.8	—	—		
	67	64.8	3.3	53.0	47.4	41.5	35.5	29.6	—	62.2	3.7	51.0	45.2	39.3	33.5	27.7	—		
	62	58.8	3.2	58.8	58.8	49.8	43.9	38.0	32.0	56.5	3.7	56.5	56.5	47.6	41.8	35.9	30.1		
1500	77	82.5	3.6	39.5	32.7	25.8	—	—	—	78.1	3.9	37.2	30.5	23.7	—	—	—		
	72	74.9	3.4	49.0	42.1	35.3	28.4	—	—	71.1	3.8	46.7	40.0	33.2	26.5	—	—		
	67	67.3	3.3	58.5	51.6	44.7	37.9	31.0	—	64.1	3.7	56.2	49.4	42.7	35.9	29.2	—		
	62	61.1	3.2	61.1	61.1	53.8	46.9	40.1	33.2	58.3	3.7	58.3	58.3	51.6	44.9	38.1	31.4		
1750	57	60.1	3.2	60.1	60.1	56.3	49.4	42.6	35.7	58.0	3.7	58.0	58.0	53.2	46.4	39.7	32.9		
	77	85.6	3.6	42.9	35.5	27.7	—	—	—	80.4	4.0	40.9	33.3	25.6	—	—	—		
	72	77.7	3.5	53.4	45.7	37.9	30.1	—	—	73.2	3.9	51.1	43.5	35.8	28.2	—	—		
	67	69.8	3.3	63.9	55.8	48.0	40.2	32.5	—	66.0	3.8	61.4	53.7	46.0	38.4	30.7	—		
2000	62	63.4	3.3	63.4	63.4	57.7	49.9	42.2	34.4	60.0	3.7	60.0	60.0	55.7	48.0	40.4	32.7		
	57	62.3	3.2	62.3	62.3	60.4	52.6	44.9	37.1	59.8	3.7	59.8	59.8	57.3	49.7	42.0	34.4		
	77	88.6	3.6	46.3	38.3	29.6	—	—	—	82.8	4.0	44.6	36.1	27.5	—	—	—		
	72	80.4	3.5	57.9	49.2	40.5	31.8	—	—	75.4	3.9	55.6	47.0	38.4	29.9	—	—		
2250	67	72.2	3.3	69.4	60.0	51.3	42.6	33.9	—	67.9	3.8	66.5	58.0	49.4	40.8	32.2	—		
	62	65.6	3.3	65.6	65.6	61.7	53.0	44.3	35.6	61.8	3.7	61.8	61.8	59.7	51.2	42.6	34.0		
	57	64.6	3.3	64.6	64.6	64.6	55.9	47.1	38.4	61.5	3.7	61.5	61.5	61.5	52.9	44.4	35.8		
	72	82.0	3.5	61.9	52.4	42.9	33.3	—	—	76.6	3.9	59.7	50.3	40.9	31.5	—	—		
2500	67	73.6	3.3	72.2	63.9	54.3	44.8	35.3	—	69.0	3.8	68.3	62.0	52.6	43.2	33.8	—		
	62	66.9	3.3	66.9	66.9	64.9	55.4	45.9	36.3	62.8	3.7	62.8	62.8	61.8	52.4	43.0	33.6		
	57	65.8	3.3	65.8	65.8	65.8	56.3	46.8	37.2	62.5	3.7	62.5	62.5	62.5	53.1	43.8	34.4		
	72	83.5	3.5	65.9	55.6	45.2	34.9	—	—	77.8	3.9	63.7	53.6	43.4	33.2	—	—		
2500	67	75.0	3.3	75.0	67.7	57.4	47.0	36.7	—	70.1	3.8	70.1	65.9	55.8	45.6	35.4	—		
	62	68.2	3.3	68.2	68.2	68.2	57.8	47.5	37.1	63.8	3.7	63.8	63.8	63.8	53.6	43.4	33.2		
	57	67.1	3.3	67.1	67.1	67.1	56.7	46.4	36.0	63.5	3.7	63.5	63.5	63.5	53.3	43.2	33.0		
		95°F									105°F								
1250	77	72.0	4.3	31.0	25.6	19.9	—	—	—	66.8	4.8	28.5	24.3	18.6	—	—	—		
	72	65.8	4.2	40.0	34.3	28.6	22.8	—	—	61.0	4.8	38.6	32.8	27.1	21.4	—	—		
	67	59.6	4.2	49.0	43.0	37.2	31.5	25.8	—	55.3	4.7	48.6	41.4	35.7	30.0	24.3	—		
	62	54.2	4.1	54.2	54.2	45.3	39.6	33.9	28.2	51.1	4.7	51.1	51.1	42.9	37.1	31.4	25.7		
1500	77	73.7	4.3	35.0	28.3	21.7	—	—	—	68.4	4.9	33.4	26.8	20.3	—	—	—		
	72	67.3	4.3	44.4	37.8	31.2	24.5	—	—	62.5	4.8	42.8	36.2	29.6	23.0	—	—		
	67	60.9	4.2	53.9	47.3	40.7	34.0	27.4	—	56.6	4.7	52.1	45.5	38.9	32.4	25.8	—		
	62	55.5	4.2	55.5	55.5	49.5	42.9	36.2	29.6	52.3	4.7	52.3	52.3	46.8	40.2	33.6	27.0		
1750	57	56.0	4.1	56.0	56.0	50.1	43.4	36.8	30.2	52.6	4.7	52.6	52.6	47.0	40.4	33.9	27.3		
	77	75.3	4.3	38.9	31.1	23.5	—	—	—	70.0	4.9	38.3	29.4	21.9	—	—	—		
	72	68.8	4.3	48.9	41.3	33.8	26.3	—	—	63.9	4.8	47.0	39.5	32.1	24.6	—	—		
	67	62.3	4.2	58.8	51.6	44.1	36.5	29.0	—	57.9	4.8	55.7	49.7	42.2	34.7	27.2	—		
2000	62	56.7	4.2	56.7	56.7	53.6	46.1	38.6	31.0	53.5	4.7	53.5	53.5	50.6	43.2	35.7	28.2		
	57	57.2	4.1	57.2	57.2	54.3	46.7	39.2	31.7	53.8	4.7	53.8	53.8	51.0	43.5	36.0	28.5		
	77	76.9	4.3	42.9	33.8	25.3	—	—	—	71.6	4.9	43.2	32.0	23.6	—	—	—		
	72	70.3	4.3	53.3	44.9	36.4	28.0	—	—	65.4	4.8	51.2	42.9	34.5	26.2	—	—		
2250	67	63.6	4.3	63.6	55.9	47.5	39.0	30.6	—	59.2	4.8	59.2	53.8	45.4	37.1	28.7	—		
	62	57.9	4.2	57.9	57.9	57.8	49.4	40.9	32.5	54.7	4.7	54.7	54.7	54.5	46.2	37.8	29.5		
	57	58.5	4.2	58.5	58.5	58.0	50.0	41.6	33.2	55.0	4.7	55.0	55.0	54.9	46.5	38.2	29.8		
	72	71.2	4.3	57.4	48.2	39.0	29.7	—	—	66.0	4.8	55.2	46.1	36.9	27.8	—	—		
2500	67	64.5	4.2	64.5	60.0	50.8	41.6	32.4	—	59.8	4.8	59.8	56.8	48.6	39.5	30.4	—		
	62	58.7	4.2	58.7	58.7	58.6	49.4	40.1	30.9	55.3	4.7	55.3	55.3	55.2	46.0	36.9	27.8		
	57	59.2	4.2	59.2	59.2	59.2	50.0	40.8	31.5	55.6	4.7	55.6	55.6	55.5	46.4	37.2	28.1		
	72	72.1	4.3	61.6	51.6	41.5	31.5	—	—	66.6	4.8	59.2	49.3	39.4	29.5	—	—		
2500	67	65.3	4.2	65.3	64.2	54.2	44.2	34.1	—	60.4	4.8	60.4	59.8	51.8	41.9	32.0	—		
	62	59.4	4.2	59.4	59.4	59.4	49.4	39.4	29.3	55.8	4.7	55.8	55.8	55.8	45.9	36.0	26.1		
	57	60.0	4.2	60.0	60.0	60.0	49.9	39.9	29.9	56.1	4.7	56.1	56.1	56.1	46.2	36.3	26.4		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 52: ZL06 (5.0 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																
CFMWB (°F)		Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)						
				Return dry bulb (°F)								Return dry bulb (°F)						
				90	85	80	75	70	65			90	85	80	75	70	65	
		115°F									125°F							
1250	77	61.6	5.4	26.1	23.0	17.3	—	—	—	56.3	5.9	24.7	21.7	16.0	—	—	—	
	72	56.3	5.3	37.1	31.4	25.7	20.0	—	—	51.5	5.8	35.7	30.0	24.3	18.6	—	—	
	67	50.9	5.2	48.1	39.9	34.2	28.5	22.8	—	46.6	5.8	46.6	38.3	32.6	26.9	21.3	—	
	62	47.9	5.2	47.9	47.9	40.4	34.7	29.0	23.3	44.8	5.7	44.8	44.8	37.9	32.2	26.5	20.9	
1500	77	63.1	5.4	31.9	25.4	18.8	—	—	—	57.8	6.0	31.1	23.9	17.4	—	—	—	
	72	57.7	5.3	41.1	34.6	28.0	21.5	—	—	52.8	5.9	39.5	33.0	26.5	19.9	—	—	
	67	52.2	5.3	50.3	43.8	37.2	30.7	24.1	—	47.9	5.8	47.9	42.0	35.5	29.0	22.5	—	
	62	49.1	5.2	49.1	49.1	44.0	37.5	30.9	24.4	46.0	5.8	46.0	46.0	41.3	34.8	28.3	21.7	
1750	57	49.2	5.2	49.2	49.2	44.0	37.5	30.9	24.4	45.8	5.8	45.8	45.8	41.0	34.5	28.0	21.5	
	77	64.6	5.4	37.7	27.8	20.4	—	—	—	59.3	6.0	37.5	26.1	18.8	—	—	—	
	72	59.1	5.4	45.1	37.7	30.3	22.9	—	—	54.2	5.9	43.3	36.0	28.6	21.3	—	—	
	67	53.5	5.3	52.6	47.7	40.3	32.9	25.5	—	49.1	5.8	49.1	45.8	38.4	31.1	23.8	—	
2000	62	50.3	5.3	50.3	50.3	47.6	40.2	32.8	25.4	47.2	5.8	47.2	47.2	44.6	37.3	30.0	22.6	
	57	50.4	5.3	50.4	50.4	47.6	40.2	32.8	25.4	47.0	5.8	47.0	47.0	44.3	37.0	29.7	22.3	
	77	66.2	5.4	43.6	30.2	21.9	—	—	—	60.8	6.0	43.9	28.4	20.2	—	—	—	
	72	60.5	5.4	49.2	40.9	32.7	24.4	—	—	55.6	5.9	47.1	38.9	30.8	22.6	—	—	
2250	67	54.8	5.3	54.8	51.6	43.4	35.1	26.9	—	50.3	5.8	50.3	49.5	41.3	33.2	25.0	—	
	62	51.5	5.3	51.5	51.5	51.3	43.0	34.8	26.5	48.3	5.8	48.3	48.3	48.0	39.9	31.7	23.5	
	57	51.6	5.3	51.6	51.6	51.3	43.0	34.8	26.5	48.1	5.8	48.1	48.1	47.7	39.5	31.4	23.2	
	72	60.8	5.4	53.0	43.9	34.9	25.9	—	—	55.7	5.9	50.7	41.8	32.9	24.0	—	—	
2500	67	55.1	5.3	55.1	53.5	46.4	37.4	28.3	—	50.4	5.9	50.4	50.3	44.2	35.3	26.3	—	
	62	51.9	5.3	51.9	51.9	51.7	42.7	33.7	24.7	48.4	5.8	48.4	48.4	48.3	39.4	30.4	21.5	
	57	51.9	5.3	51.9	51.9	51.7	42.7	33.7	24.7	48.2	5.9	48.2	48.2	48.0	39.1	30.2	21.2	
	72	61.2	5.4	56.8	47.0	37.2	27.4	—	—	55.8	6.0	54.4	44.7	35.0	25.3	—	—	
2500	67	55.4	5.3	55.4	55.4	49.4	39.6	29.8	—	50.5	5.9	50.5	50.5	47.0	37.3	27.7	—	
	62	52.2	5.3	52.2	52.2	52.2	42.4	32.6	22.8	48.5	5.9	48.5	48.5	48.5	38.9	29.2	19.5	
	57	52.2	5.3	52.2	52.2	52.2	42.4	32.6	22.8	48.3	5.9	48.3	48.3	48.3	38.7	29.0	19.3	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

# ZL08 to 14 cooling capacities

**Table 53: ZL08 (7.5 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1875	77	120.1	5.3	61.8	51.4	41.1	—	—	—	114.6	5.6	59.1	49.2	39.3	—	—	—
	72	108.3	5.3	71.0	61.1	51.3	41.4	—	—	104.2	5.6	69.9	59.6	49.2	38.9	—	—
	67	96.5	5.3	80.3	70.9	61.4	50.1	41.0	—	93.8	5.6	80.7	69.9	59.2	48.2	38.3	—
	62	88.7	5.2	88.7	80.6	71.6	58.1	50.6	40.1	84.9	5.6	84.9	77.9	69.1	57.1	48.0	37.5
2250	77	121.3	5.3	67.9	54.5	41.1	—	—	—	115.6	5.6	65.1	52.1	39.2	—	—	—
	72	111.0	5.3	77.5	65.6	53.6	41.8	—	—	106.4	5.6	75.8	63.7	51.6	39.4	—	—
	67	100.7	5.3	87.0	76.6	66.3	53.2	41.9	—	97.1	5.6	85.2	75.2	63.9	51.1	39.3	—
	62	94.4	5.2	92.9	86.6	78.8	64.0	53.9	41.4	90.5	5.6	85.9	83.8	76.3	62.6	51.2	38.6
	57	88.2	5.2	93.4	93.4	91.4	78.6	65.8	53.1	86.1	5.6	86.1	86.1	86.1	75.9	63.1	50.3
2625	77	122.4	5.3	74.1	57.6	41.1	—	—	—	116.5	5.6	71.1	55.1	39.0	—	—	—
	72	113.7	5.3	83.9	70.0	56.1	42.2	—	—	108.5	5.6	81.6	67.7	53.9	40.0	—	—
	67	105.0	5.3	93.7	82.4	71.1	56.2	42.7	—	100.5	5.6	92.1	80.4	68.7	54.1	40.2	—
	62	100.2	5.3	95.5	92.7	86.1	69.9	57.2	42.7	96.1	5.6	93.1	89.6	83.6	68.1	54.3	39.7
	57	97.8	5.2	97.8	97.8	97.1	86.4	71.6	56.8	94.5	5.6	94.5	94.5	94.5	83.4	68.5	53.5
3000	77	123.6	5.3	80.2	60.6	41.1	—	—	—	117.5	5.6	77.2	58.0	38.8	—	—	—
	72	116.4	5.3	90.3	74.4	58.5	42.6	—	—	110.7	5.6	87.5	71.8	56.2	40.5	—	—
	67	109.2	5.3	100.4	88.2	75.9	59.3	43.6	—	103.9	5.6	97.8	85.6	73.5	57.1	41.2	—
	62	106.0	5.3	102.4	98.7	93.4	75.7	60.5	44.0	101.6	5.6	99.1	95.5	90.8	73.6	57.5	40.8
	57	102.8	5.3	102.8	102.8	102.8	94.1	77.3	60.6	99.4	5.6	99.4	99.4	99.4	91.0	73.8	56.6
3375	72	119.1	5.3	96.7	78.8	60.9	43.0	—	—	112.8	5.6	93.3	75.9	58.5	41.0	—	—
	67	113.5	5.3	107.1	94.0	80.8	62.4	44.4	—	107.2	5.6	103.4	90.9	78.3	60.1	42.1	—
	62	111.8	5.3	108.2	104.8	100.7	81.6	63.8	45.3	107.2	5.6	104.7	101.4	98.1	79.1	60.6	41.9
	57	110.1	5.3	108.9	108.9	108.9	101.8	83.1	64.4	107.2	5.6	104.7	104.7	104.7	98.5	79.2	59.8
3750	72	121.8	5.3	103.2	83.3	63.332	43.4	—	—	115.0	5.6	99.2	80.0	60.8	41.6	—	—
	67	117.7	5.3	113.5	99.7	85.6	65.4	45.3	—	113.9	5.6	109.1	96.1	83.0	63.1	43.1	—
	62	117.6	5.3	113.7	110.8	107.9	87.5	67.1	46.6	112.8	5.6	109.2	107.2	105.3	84.5	63.8	43.0
	57	117.4	5.3	113.7	113.7	113.7	109.5	88.8	68.1	112.7	5.6	109.2	109.2	109.2	106.0	84.5	63.0

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 54: ZL08 (7.5 ton, 95°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						
				Return dry bulb (°F)								Return dry bulb (°F)						
				90	85	80	75	70	65			90	85	80	75	70	65	
		95°F									105°F							
1875	77	109.2	5.9	56.4	47.0	37.6	—	—	—	100.5	6.4	54.3	44.6	34.9	—	—	—	
	72	100.1	5.9	68.8	58.0	47.2	36.5	—	—	92.6	6.4	66.0	55.2	44.4	33.6	—	—	
	67	91.1	5.9	81.1	69.0	56.9	46.3	35.6	—	84.7	6.4	77.7	65.8	54.0	43.4	32.8	—	
	62	82.2	5.9	82.2	75.2	66.6	56.0	45.5	35.0	80.1	6.4	79.8	71.6	63.5	53.2	42.8	32.5	
2250	77	109.9	5.9	62.3	49.8	37.2	—	—	—	101.4	6.4	60.8	47.6	34.4	—	—	—	
	72	101.7	5.9	74.1	61.7	49.431	37.1	—	—	94.4	6.4	71.3	58.9	46.6	34.2	—	—	
	67	93.6	5.9	84.9	73.7	61.6	49.1	36.7	—	87.5	6.4	79.7	70.2	58.7	46.2	33.8	—	
	62	86.5	5.9	85.1	80.9	73.8	61.2	48.5	35.9	82.1	6.4	80.0	77.1	70.8	58.3	45.8	33.3	
2625	57	85.3	5.9	85.3	85.3	85.3	73.2	60.4	47.6	80.9	6.4	80.9	80.9	80.9	70.4	57.8	45.2	
	77	110.6	5.9	68.2	52.6	36.9	—	—	—	102.2	6.4	67.3	50.6	34.0	—	—	—	
	72	103.3	5.9	79.3	65.5	51.6	37.8	—	—	96.3	6.4	76.6	62.6	48.7	34.7	—	—	
	67	96.0	5.9	88.0	78.4	66.3	52.0	37.7	—	90.3	6.4	85.0	74.7	63.4	49.1	34.8	—	
3000	62	91.9	5.9	88.5	86.6	81.0	66.3	51.5	36.8	87.0	6.4	85.9	82.7	78.1	63.4	48.7	34.1	
	57	89.1	5.9	89.1	89.1	89.1	80.5	65.3	50.1	86.0	6.4	86.0	86.0	86.0	77.8	62.7	47.7	
	77	111.4	5.9	74.1	55.4	36.6	—	—	—	103.0	6.4	73.8	53.6	33.5	—	—	—	
	72	104.9	5.9	84.6	69.2	53.8	38.4	—	—	98.1	6.4	81.9	66.4	50.8	35.3	—	—	
3375	67	98.5	5.9	95.1	83.1	71.0	54.9	38.8	—	93.1	6.4	90.0	79.1	68.1	51.9	35.7	—	
	62	97.3	5.9	96.3	92.3	88.3	71.4	54.5	37.6	92.0	6.4	90.6	88.2	85.4	68.6	51.7	34.8	
	57	96.4	5.9	96.4	96.4	96.4	87.9	70.3	52.7	90.8	6.4	90.8	90.8	90.8	85.2	67.7	50.1	
	72	106.6	5.9	89.9	73.0	56.0	39.1	—	—	99.9	6.4	87.2	70.1	52.9	35.8	—	—	
3750	67	104.3	5.9	99.8	87.8	75.7	57.8	39.8	—	97.8	6.4	94.1	83.5	72.8	54.8	36.7	—	
	62	102.7	5.9	100.5	98.0	95.5	76.5	57.5	38.5	96.9	6.4	94.7	93.7	92.7	73.7	54.6	35.6	
	57	101.9	5.9	101.3	101.3	101.3	95.2	75.2	55.2	96.5	6.4	95.2	95.2	95.2	92.6	72.6	52.6	
	72	112.6	5.9	95.2	76.7	58.208	39.7	—	—	104.8	6.4	92.5	73.8	55.1	36.4	—	—	
	67	108.2	5.9	104.4	92.4	80.5	60.7	40.9	—	101.8	6.4	98.2	87.9	77.5	57.6	37.6	—	
	62	108.0	5.9	104.7	103.7	102.7	81.6	60.5	39.4	101.0	6.4	98.4	98.4	98.4	78.8	57.6	36.4	
	57	106.0	5.9	105.0	105.0	105.0	102.6	80.2	57.8	98.8	6.4	98.6	98.6	98.6	98.6	77.6	55.1	
			115°F									125°F						
1875	77	91.9	6.8	52.2	42.2	32.2	—	—	—	83.3	7.3	50.1	39.8	29.5	—	—	—	
	72	85.1	6.8	63.2	52.4	41.6	30.8	—	—	77.6	7.3	60.5	49.6	38.8	27.9	—	—	
	67	78.2	6.8	74.3	62.6	51.0	40.5	30.1	—	71.8	7.3	68.8	59.5	48.1	37.7	27.3	—	
	62	74.5	6.8	74.5	68.1	60.4	50.3	40.1	30.0	69.3	7.3	69.3	64.5	57.4	47.4	37.5	27.5	
2250	77	92.8	6.8	59.3	45.4	31.6	—	—	—	84.3	7.3	57.7	43.2	28.8	—	—	—	
	72	87.1	6.8	68.5	56.1	43.7	31.2	—	—	79.8	7.3	65.8	53.3	40.8	28.3	—	—	
	67	81.4	6.8	75.6	66.8	55.7	43.3	30.9	—	75.3	7.3	72.5	63.3	52.8	40.4	28.1	—	
	62	77.7	6.8	76.0	73.4	67.8	55.4	43.1	30.7	73.3	7.3	72.7	69.7	64.8	52.6	40.3	28.1	
2625	57	76.5	6.8	76.5	76.5	76.5	67.5	55.2	42.8	72.8	7.3	72.8	72.8	72.8	64.7	52.6	40.4	
	77	93.8	6.8	66.3	48.7	31.0	—	—	—	85.3	7.3	65.4	46.7	28.1	—	—	—	
	72	89.2	6.8	73.8	59.8	45.7	31.7	—	—	82.1	7.3	71.1	57.0	42.8	28.6	—	—	
	67	84.6	6.8	81.4	70.9	60.5	46.1	31.8	—	78.9	7.3	76.2	67.2	57.5	43.2	28.8	—	
3000	62	82.2	6.8	81.6	78.7	75.2	60.6	46.0	31.3	77.3	7.3	76.4	74.8	72.3	57.7	43.2	28.6	
	57	82.0	6.8	82.0	82.0	82.0	75.0	60.1	45.2	76.5	7.3	76.5	76.5	76.5	72.3	57.5	42.8	
	77	94.7	6.8	73.4	51.9	30.4	—	—	—	86.4	7.3	73.0	50.2	27.3	—	—	—	
	72	91.2	6.8	79.2	63.5	47.8	32.1	—	—	84.4	7.3	76.4	60.6	44.8	29.0	—	—	
3375	67	87.8	6.8	84.9	75.1	65.2	48.9	32.7	—	82.4	7.3	79.8	71.1	62.3	45.9	29.6	—	
	62	86.7	6.8	85.5	84.1	82.6	65.7	48.9	32.0	81.3	7.3	80.1	79.9	79.7	62.9	46.0	29.2	
	57	85.5	6.8	85.5	85.5	85.5	82.5	65.1	47.6	80.3	7.3	80.3	80.3	80.3	79.8	62.5	45.1	
	72	93.3	6.8	84.5	67.2	49.9	32.6	—	—	86.7	7.3	81.7	64.3	46.8	29.4	—	—	
3750	67	91.3	6.8	88.5	79.2	69.9	51.7	33.5	—	85.9	7.3	82.9	74.9	67.0	48.7	30.4	—	
	62	91.1	6.8	88.8	88.8	88.8	70.9	51.8	32.7	85.4	7.3	83.0	83.0	83.0	68.0	48.9	29.8	
	57	90.9	6.8	89.1	89.1	89.1	89.1	70.0	50.0	84.8	7.3	83.1	83.1	83.1	83.1	67.4	47.4	
	72	97.1	6.9	89.8	70.9	52.0	33.0	—	—	90.3	7.3	85.5	67.9	48.8	29.7	—	—	
	67	95.6	6.8	92.0	83.3	74.6	54.5	34.4	—	89.4	7.3	85.7	78.8	71.7	51.5	31.2	—	
	62	95.3	6.8	92.1	92.1	92.1	76.0	54.7	33.4	89.4	7.3	85.8	85.8	85.8	73.2	51.8	30.3	
	57	95.0	6.8	92.2	92.2	92.2	92.2	75.0	52.4	89.3	7.3	85.9	85.9	85.9	85.9	72.4	49.8	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 55: ZL09 (8.5 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
2125	77	123.4	5.7	61.3	53.9	46.6	—	—	—	118.9	6.1	58.2	50.7	43.3	—	—	—
	72	117.7	5.6	79.3	68.0	56.7	45.5	—	—	112.1	6.0	76.9	65.5	54.0	42.6	—	—
	67	112.0	5.6	97.3	82.1	66.9	57.7	45.1	—	105.3	6.0	95.6	80.2	64.8	54.4	42.3	—
	62	108.6	5.6	102.9	89.7	77.1	65.0	56.1	45.6	99.2	6.0	98.3	86.8	75.6	63.7	53.5	42.4
2550	77	124.9	5.7	66.8	56.1	45.4	—	—	—	120.0	6.1	65.0	53.8	42.6	—	—	—
	72	119.9	5.7	85.4	72.1	58.8	45.6	—	—	114.3	6.0	83.2	69.8	56.4	43.0	—	—
	67	114.9	5.6	102.8	88.1	72.3	60.5	46.0	—	108.6	6.0	97.8	85.8	70.2	57.4	43.2	—
	62	107.6	5.6	103.2	96.2	85.7	71.4	59.7	46.7	102.1	6.0	98.0	93.2	84.0	69.8	56.9	43.3
	57	106.2	5.6	106.2	104.3	99.1	86.2	73.4	60.5	98.1	6.0	98.1	98.1	97.7	84.1	70.5	56.9
2975	77	126.4	5.7	72.3	58.3	44.3	—	—	—	121.2	6.1	71.9	56.9	41.9	—	—	—
	72	122.1	5.7	91.4	76.2	60.9	45.7	—	—	116.6	6.1	89.5	74.1	58.7	43.3	—	—
	67	117.8	5.6	110.6	94.1	77.6	63.2	46.8	—	111.9	6.0	100.8	91.3	75.5	60.3	44.1	—
	62	109.6	5.6	109.6	102.6	94.2	77.8	63.3	47.8	106.6	6.0	101.1	99.5	92.3	75.9	60.3	44.3
	57	108.7	5.6	108.7	106.1	103.5	95.3	79.7	64.1	101.3	6.0	101.3	101.3	101.3	92.8	76.5	60.1
3400	77	127.9	5.8	77.7	60.4	43.1	—	—	—	122.4	6.1	78.7	59.9	41.2	—	—	—
	72	124.3	5.7	97.5	80.3	63.0	45.8	—	—	118.8	6.1	95.8	78.4	61.1	43.7	—	—
	67	120.7	5.7	117.3	100.1	82.9	66.0	47.7	—	115.1	6.0	106.0	96.9	80.9	63.3	45.0	—
	62	114.3	5.7	114.3	109.0	102.8	84.2	66.8	48.8	111.1	6.0	106.8	105.8	100.7	81.9	63.7	45.2
	57	111.2	5.7	110.8	110.8	110.8	104.4	86.0	67.6	107.0	6.0	106.9	106.9	106.9	101.5	82.4	63.3
3825	72	126.5	5.7	103.6	84.3	65.1	45.9	—	—	121.0	6.1	102.1	82.7	63.4	44.1	—	—
	67	123.6	5.7	114.1	106.1	88.3	68.7	48.5	—	118.4	6.1	112.4	102.5	86.3	66.3	45.9	—
	62	119.0	5.7	115.5	115.5	111.4	90.6	70.4	49.9	115.6	6.1	113.2	112.2	109.1	88.0	67.1	46.2
	57	116.2	5.7	115.8	115.8	115.8	113.4	92.3	71.2	113.9	6.1	113.8	113.8	113.8	110.2	88.4	66.5
4250	72	128.7	5.8	109.6	88.4	67.2	46.0	—	—	123.3	6.1	108.4	87.1	65.7	44.4	—	—
	67	126.5	5.7	121.0	112.1	93.6	71.5	49.4	—	121.7	6.1	119.0	108.0	91.6	69.2	46.8	—
	62	123.7	5.7	122.5	121.9	120.0	97.0	74.0	51.0	120.1	6.1	119.4	118.5	117.5	94.0	70.6	47.1
	57	122.8	5.7	122.8	122.8	122.8	122.5	98.6	74.7	119.5	6.1	119.5	119.5	119.5	118.8	94.3	69.8
		95°F								105°F							
2125	77	114.3	6.5	55.2	47.6	40.0	—	—	—	105.1	7.1	54.3	45.4	36.6	—	—	—
	72	106.5	6.4	74.5	62.9	51.3	39.7	—	—	98.6	7.1	71.9	60.1	48.4	36.6	—	—
	67	98.7	6.4	93.9	78.3	62.7	51.1	39.5	—	92.2	7.0	89.5	74.9	60.2	48.4	36.5	—
	62	95.1	6.4	94.5	83.9	74.1	62.4	50.8	39.2	90.4	7.0	89.6	80.3	72.0	60.1	48.2	36.3
2550	77	115.2	6.5	63.3	51.5	39.7	—	—	—	106.5	7.1	63.0	49.7	36.4	—	—	—
	72	108.8	6.4	81.0	67.5	53.91	40.4	—	—	101.1	7.1	78.4	64.6	50.9	37.1	—	—
	67	102.3	6.4	95.5	83.4	68.1	54.3	40.4	—	95.8	7.1	91.4	79.5	65.3	51.3	37.3	—
	62	99.3	6.4	96.0	90.1	82.2	68.2	54.1	40.0	93.4	7.0	92.2	86.1	79.8	65.6	51.3	37.0
	57	96.3	6.4	96.3	96.3	96.3	82.1	67.7	53.4	92.4	7.0	92.4	92.4	92.4	79.8	65.3	50.7
2975	77	116.1	6.5	71.5	55.5	39.5	—	—	—	107.9	7.1	71.8	54.0	36.2	—	—	—
	72	111.0	6.4	87.5	72.0	56.5	41.0	—	—	103.7	7.1	84.8	69.1	53.4	37.6	—	—
	67	106.0	6.4	102.0	88.5	73.5	57.4	41.4	—	99.4	7.1	95.8	84.2	70.5	54.3	38.1	—
	62	103.6	6.4	102.3	96.4	90.4	73.9	57.3	40.8	97.5	7.0	96.2	91.9	87.6	71.0	54.4	37.7
	57	102.8	6.4	102.8	102.8	102.8	90.3	73.3	56.2	96.5	7.0	96.5	96.5	96.5	87.7	70.6	53.5
3400	77	117.0	6.5	79.6	59.5	39.3	—	—	—	109.4	7.1	80.5	58.3	36.0	—	—	—
	72	113.3	6.4	94.1	76.6	59.1	41.6	—	—	106.2	7.1	91.3	73.6	55.8	38.1	—	—
	67	109.6	6.4	105.6	93.7	78.9	60.6	42.4	—	103.0	7.1	99.9	88.9	75.7	57.3	38.9	—
	62	107.9	6.4	105.7	102.6	98.6	79.6	60.6	41.6	102.0	7.1	100.1	97.8	95.5	76.4	57.4	38.4
	57	106.1	6.4	105.8	105.8	105.8	98.6	78.8	59.1	100.9	7.0	100.9	100.9	100.9	95.6	76.0	56.3
3825	72	115.5	6.5	100.6	81.1	61.7	42.2	—	—	108.7	7.1	97.7	78.0	58.3	38.6	—	—
	67	113.2	6.4	109.4	98.8	84.3	63.8	43.3	—	106.6	7.1	103.6	93.5	80.8	60.3	39.7	—
	62	112.1	6.4	110.0	108.9	106.8	85.4	63.9	42.4	105.6	7.1	104.0	103.6	103.3	81.9	60.5	39.1
	57	111.0	6.4	110.4	110.4	110.4	106.9	84.4	61.9	104.7	7.1	104.7	104.7	104.7	103.5	81.3	59.1
4250	72	117.8	6.5	107.1	85.7	64.3	42.9	—	—	111.2	7.1	104.2	82.5	60.8	39.1	—	—
	67	116.9	6.5	115.5	104.0	89.6	67.0	44.3	—	110.3	7.1	106.9	98.2	86.0	63.2	40.5	—
	62	116.4	6.5	115.6	115.1	115.0	91.1	67.1	43.2	109.7	7.1	107.8	107.8	107.8	87.3	63.6	39.8
	57	115.9	6.5	115.7	115.7	115.7	115.2	90.0	64.8	109.2	7.1	109.2	109.2	109.2	109.2	86.7	61.9

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 56: ZL09 (8.5 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		115°F									125°F								
2125	77	95.8	7.7	53.4	43.3	33.2	—	—	—	86.6	8.3	52.5	41.2	29.8	—	—	—		
	72	90.7	7.7	69.3	57.4	45.4	33.5	—	—	82.9	8.3	66.7	54.6	42.5	30.4	—	—		
	67	86.3	7.7	83.5	71.4	57.7	45.6	33.6	—	79.1	8.3	77.5	68.0	55.2	42.9	30.7	—		
	62	84.1	7.7	84.1	76.6	70.0	57.8	45.6	33.5	77.9	8.3	77.9	73.0	67.9	55.5	43.0	30.6		
2550	77	97.8	7.7	62.7	47.9	33.0	—	—	—	89.1	8.3	62.4	46.1	29.7	—	—	—		
	72	93.5	7.7	75.7	61.8	47.8	33.9	—	—	85.9	8.3	73.0	58.9	44.8	30.6	—	—		
	67	89.2	7.7	85.0	75.6	62.6	48.4	34.2	—	82.7	8.3	79.8	71.7	59.9	45.5	31.1	—		
	62	87.5	7.7	85.4	82.1	77.4	63.0	48.5	34.1	81.6	8.3	80.1	78.0	75.0	60.3	45.7	31.1		
2975	57	85.7	7.7	85.6	85.6	85.6	77.5	62.8	48.1	80.4	8.3	80.4	80.4	80.4	75.2	60.3	45.5		
	77	99.8	7.7	72.1	52.5	32.9	—	—	—	91.6	8.3	72.4	51.0	29.6	—	—	—		
	72	96.3	7.7	82.1	66.1	50.2	34.3	—	—	89.0	8.3	79.4	63.2	47.1	30.9	—	—		
	67	92.8	7.7	89.0	79.8	67.5	51.2	34.9	—	86.3	8.3	83.6	75.5	64.5	48.1	31.6	—		
3400	62	91.4	7.7	89.4	87.5	84.8	68.1	51.4	34.7	85.3	8.3	84.1	83.0	82.0	65.2	48.4	31.6		
	57	89.9	7.7	89.9	89.9	89.9	85.0	67.9	50.8	84.3	8.3	84.2	84.2	84.2	82.4	65.3	48.1		
	77	101.8	7.7	81.4	57.1	32.7	—	—	—	94.1	8.3	82.3	55.9	29.5	—	—	—		
	72	99.1	7.7	88.5	70.5	52.6	34.6	—	—	92.0	8.3	85.7	67.5	49.3	31.2	—	—		
3825	67	96.4	7.7	93.3	84.0	72.4	54.0	35.5	—	89.9	8.3	87.6	79.2	69.2	50.6	32.0	—		
	62	95.3	7.7	93.6	92.9	92.3	73.3	54.3	35.3	89.0	8.3	87.8	87.8	87.8	70.1	51.1	32.1		
	57	94.1	7.7	94.1	94.1	94.1	92.6	73.1	53.5	88.1	8.3	88.1	88.1	88.1	88.1	70.2	50.8		
	72	102.4	7.7	94.9	74.9	55.0	35.0	—	—	95.1	8.3	91.0	71.8	51.6	31.4	—	—		
4250	67	100.1	7.7	96.7	88.2	77.4	56.7	36.1	—	93.5	8.3	91.4	82.9	73.9	53.2	32.5	—		
	62	99.2	7.7	97.0	97.0	97.0	78.4	57.2	35.9	92.7	8.3	91.7	91.7	91.7	75.0	53.8	32.6		
	57	98.3	7.7	98.2	98.2	98.2	98.2	78.2	56.3	91.9	8.3	91.9	91.9	91.9	91.9	75.1	53.4		
	72	104.7	7.7	101.3	79.3	57.4	35.4	—	—	98.1	8.3	94.1	76.2	53.9	31.7	—	—		
4250	67	103.7	7.7	102.0	92.4	82.3	59.5	36.7	—	97.1	8.3	94.7	86.7	78.6	55.8	33.0	—		
	62	103.1	7.7	102.1	102.1	102.1	83.6	60.0	36.5	96.4	8.3	95.4	95.4	95.4	79.9	56.5	33.1		
	57	102.5	7.7	102.5	102.5	102.5	102.5	83.3	59.0	95.8	8.3	95.8	95.8	95.8	95.8	80.0	56.1		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



**Table 57: ZL12 (10 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
2500	77	153.2	7.2	76.1	64.3	52.4	—	—	—	145.4	7.6	74.7	62.6	50.5	—	—	—
	72	139.3	7.1	93.0	79.6	66.1	52.7	—	—	133.8	7.5	92.5	78.4	64.3	50.2	—	—
	67	125.4	7.0	109.8	94.8	79.9	65.4	52.2	—	122.2	7.4	110.2	94.1	78.0	63.5	49.5	—
	62	117.3	7.0	117.3	105.8	93.6	75.2	65.2	51.0	117.7	7.4	116.9	104.3	91.7	75.3	63.0	48.6
3000	77	155.1	7.2	85.6	68.9	52.2	—	—	—	146.7	7.6	84.1	67.0	50.0	—	—	—
	72	143.1	7.1	101.6	85.5	69.3	53.2	—	—	136.8	7.5	100.4	83.8	67.2	50.6	—	—
	67	131.1	7.0	117.6	102.0	86.5	69.5	53.4	—	126.9	7.4	116.7	100.6	84.4	67.3	50.7	—
	62	124.4	7.0	119.1	113.8	103.6	83.3	69.8	52.9	123.2	7.4	119.2	111.8	101.6	82.8	67.4	50.2
3500	57	119.6	7.0	119.6	119.6	119.6	103.5	86.1	68.8	119.4	7.4	119.4	119.4	118.8	101.4	84.0	66.6
	77	157.0	7.2	95.1	73.5	52.0	—	—	—	148.0	7.7	93.4	71.4	49.5	—	—	—
	72	146.9	7.1	110.2	91.4	72.5	53.7	—	—	139.8	7.6	108.3	89.2	70.2	51.1	—	—
	67	136.7	7.0	125.3	109.2	93.1	73.5	54.6	—	131.7	7.5	123.3	107.1	90.9	71.2	51.9	—
4000	62	131.4	7.0	126.0	121.9	113.6	91.5	74.4	54.8	128.7	7.5	125.2	119.3	111.5	90.4	71.7	51.8
	57	126.2	7.0	126.2	126.2	126.2	114.2	94.2	74.2	125.7	7.5	125.7	125.7	125.7	111.9	91.6	71.3
	77	158.9	7.2	104.6	78.2	51.8	—	—	—	149.3	7.7	102.7	75.8	48.9	—	—	—
	72	150.6	7.1	118.8	97.3	75.7	54.2	—	—	142.9	7.6	116.3	94.7	73.1	51.5	—	—
4500	67	142.3	7.0	133.0	116.4	99.7	77.5	55.8	—	136.4	7.5	129.8	113.6	97.3	75.0	53.0	—
	62	138.5	7.0	134.2	129.9	123.6	99.6	79.0	56.7	134.1	7.5	131.8	126.7	121.5	97.9	76.1	53.4
	57	134.7	7.0	134.7	134.7	134.7	124.9	102.2	79.5	131.9	7.5	131.9	131.9	131.9	122.4	99.1	75.9
	72	154.4	7.1	127.4	103.2	78.9	54.7	—	—	145.9	7.6	124.2	100.1	76.1	52.0	—	—
5000	67	148.0	7.1	140.8	123.5	106.3	81.5	57.0	—	141.1	7.5	136.4	120.0	103.7	78.9	54.2	—
	62	145.6	7.1	142.3	138.0	133.6	107.8	83.6	58.6	139.6	7.5	137.1	134.2	131.4	105.5	80.4	55.0
	57	143.2	7.1	143.2	143.2	143.2	135.6	110.2	84.8	138.1	7.5	138.0	138.0	138.0	132.9	106.7	80.5
	72	158.2	7.2	136.0	109.1	82.1	55.2	—	—	148.9	7.6	132.1	105.6	79.0	52.5	—	—
5000	67	153.6	7.1	148.5	130.7	112.9	85.5	58.2	—	145.8	7.5	142.9	126.5	110.1	82.7	55.4	—
	62	152.6	7.1	149.6	146.0	143.6	115.9	88.2	60.5	145.1	7.5	143.0	141.7	141.3	113.0	84.8	56.6
	57	151.6	7.1	150.2	150.2	150.2	146.3	118.2	90.1	144.3	7.5	143.2	143.2	143.2	143.2	114.2	85.2
		95°F								105°F							
2500	77	137.5	8.1	73.3	61.0	48.7	—	—	—	128.1	8.7	71.4	58.4	45.5	—	—	—
	72	128.3	8.0	92.0	77.2	62.4	47.6	—	—	119.3	8.6	87.8	73.2	58.6	44.1	—	—
	67	119.0	7.9	110.6	93.4	76.1	61.5	46.8	—	110.5	8.5	104.2	88.0	71.8	57.5	43.2	—
	62	118.1	7.9	115.9	102.9	89.8	75.3	60.8	46.3	110.2	8.5	107.4	96.2	85.0	71.0	56.9	42.9
3000	77	138.3	8.1	82.5	65.2	47.8	—	—	—	128.9	8.7	80.4	62.2	44.1	—	—	—
	72	130.5	8.0	99.2	82.2	65.1	48.0	—	—	121.7	8.6	94.7	77.9	61.1	44.2	—	—
	67	122.8	7.9	115.9	99.2	82.4	65.2	48.0	—	114.4	8.5	109.0	93.5	78.0	61.1	44.2	—
	62	122.0	7.9	119.9	109.8	99.7	82.3	64.9	47.6	114.1	8.5	111.4	103.2	95.0	78.0	61.0	44.0
3500	57	121.1	7.9	121.1	120.4	116.9	99.4	81.9	64.4	113.9	8.5	113.8	112.9	111.9	94.9	77.8	60.7
	77	139.0	8.1	91.6	69.3	47.0	—	—	—	129.7	8.7	89.3	66.1	42.8	—	—	—
	72	132.8	8.0	106.5	87.1	67.8	48.5	—	—	124.0	8.6	101.6	82.5	63.5	44.4	—	—
	67	126.6	7.9	121.3	105.0	88.6	68.9	49.1	—	118.3	8.5	113.9	99.0	84.2	64.7	45.2	—
4000	62	125.9	7.9	123.9	116.7	109.5	89.3	69.0	48.8	118.1	8.5	115.4	110.2	104.9	85.0	65.1	45.2
	57	125.1	7.9	125.1	125.1	125.1	109.7	89.0	68.4	117.8	8.5	117.0	117.0	117.0	105.3	85.0	64.6
	77	139.7	8.1	100.8	73.5	46.1	—	—	—	130.5	8.7	98.3	69.9	41.4	—	—	—
	72	135.1	8.0	113.7	92.1	70.5	48.9	—	—	126.4	8.6	108.5	87.2	65.9	44.6	—	—
4500	67	130.5	7.9	126.6	110.8	94.9	72.6	50.2	—	122.2	8.6	118.7	104.6	90.4	68.3	46.2	—
	62	129.8	7.9	127.9	123.6	119.3	96.2	73.2	50.1	122.0	8.6	119.4	117.2	114.9	92.0	69.2	46.3
	57	129.1	7.9	129.1	129.1	129.1	119.9	96.1	72.3	121.8	8.5	120.2	120.2	120.2	115.8	92.1	68.4
	72	137.4	8.0	121.0	97.1	73.2	49.3	—	—	128.7	8.6	115.4	91.9	68.3	44.8	—	—
5000	67	134.3	7.9	131.9	116.5	101.2	76.3	51.4	—	126.1	8.6	123.5	110.1	96.6	71.9	47.2	—
	62	133.7	7.9	131.9	130.5	129.1	103.2	77.3	51.4	125.9	8.6	124.7	124.2	124.7	99.1	73.2	47.4
	57	133.0	7.9	131.9	131.9	131.9	130.1	103.2	76.2	125.7	8.6	125.3	125.3	125.3	125.3	99.2	72.3
	72	139.6	8.0	128.2	102.1	75.9	49.8	—	—	131.1	8.6	122.3	96.5	70.8	45.0	—	—
5000	67	138.1	8.0	136.0	122.3	107.4	80.0	52.5	—	130.0	8.6	127.6	115.6	102.8	75.5	48.2	—
	62	137.6	8.0	136.4	136.4	136.4	110.1	81.4	52.6	129.8	8.6	128.4	128.4	128.4	106.1	77.3	48.6
	57	137.0	8.0	136.9	136.9	136.9	136.9	110.3	80.2	129.7	8.6	129.5	129.5	129.5	129.5	106.4	76.1

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 58: ZL12 (10 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM		WB (°F)	Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						
					Return dry bulb (°F)								Return dry bulb (°F)						
					90	85	80	75	70	65			90	85	80	75	70	65	
		115°F									125°F								
2500	77	118.7	9.3	69.5	55.8	42.2	—	—	—	109.2	9.8	67.5	53.3	39.0	—	—	—		
	72	110.3	9.2	83.6	69.3	54.9	40.5	—	—	101.4	9.8	79.5	65.3	51.1	37.0	—	—		
	67	102.6	9.1	97.8	82.7	67.6	53.6	39.6	—	94.5	9.7	91.4	77.3	63.3	49.6	36.0	—		
	62	102.3	9.1	99.0	89.6	80.2	66.6	53.1	39.5	93.5	9.7	91.9	83.0	75.4	62.3	49.2	36.1		
3000	77	119.5	9.3	78.3	59.3	40.4	—	—	—	110.2	9.8	76.1	56.4	36.7	—	—	—		
	72	112.8	9.2	90.2	73.6	57.0	40.5	—	—	103.9	9.8	85.7	69.3	53.0	36.7	—	—		
	67	107.2	9.1	102.1	87.9	73.7	57.1	40.5	—	99.3	9.8	95.2	82.3	69.3	53.0	36.7	—		
	62	106.8	9.1	103.0	96.6	90.3	73.7	57.1	40.5	99.0	9.8	95.6	90.1	85.6	69.4	53.2	36.9		
3500	57	106.6	9.1	103.8	103.8	103.8	90.3	73.7	57.1	98.8	9.8	95.9	95.9	95.9	85.8	69.6	53.4		
	77	120.4	9.3	87.1	62.8	38.5	—	—	—	111.1	9.9	84.8	59.5	34.3	—	—	—		
	72	115.2	9.2	96.8	78.0	59.2	40.4	—	—	106.4	9.8	91.9	73.4	54.9	36.3	—	—		
	67	110.5	9.2	106.5	93.1	79.8	60.6	41.4	—	103.9	9.8	99.9	87.2	75.4	56.4	37.5	—		
4000	62	110.3	9.2	107.0	103.7	100.4	80.8	61.1	41.5	103.5	9.8	100.5	97.2	95.9	76.5	57.2	37.8		
	57	110.0	9.1	107.5	107.5	107.5	101.0	80.9	60.8	103.3	9.8	101.2	101.2	101.2	96.6	76.9	57.1		
	77	121.3	9.3	95.8	66.3	36.7	—	—	—	112.0	9.9	93.4	62.7	32.0	—	—	—		
	72	117.6	9.2	103.3	82.3	61.3	40.3	—	—	108.9	9.9	98.1	77.4	56.7	36.0	—	—		
4500	67	115.0	9.2	110.8	98.4	85.9	64.1	42.2	—	108.2	9.8	102.9	92.2	81.4	59.8	38.3	—		
	62	114.7	9.2	111.0	110.8	110.5	87.9	65.2	42.5	107.6	9.8	103.3	103.3	103.3	83.7	61.2	38.7		
	57	114.5	9.2	111.2	111.2	111.2	111.2	88.1	64.6	107.2	9.8	104.2	104.2	104.2	104.2	84.1	60.7		
	72	120.0	9.3	109.9	86.7	63.5	40.2	—	—	113.4	9.9	104.3	81.5	58.6	35.7	—	—		
5000	67	118.6	9.2	115.1	103.6	92.0	67.6	43.1	—	111.7	9.9	106.7	97.1	87.5	63.3	39.0	—		
	62	118.5	9.2	115.5	115.5	115.5	94.9	69.2	43.5	111.4	9.9	107.5	107.5	107.5	90.8	65.2	39.6		
	57	118.2	9.2	116.2	116.2	116.2	116.2	95.3	68.3	111.1	9.8	108.2	108.2	108.2	108.2	91.4	64.4		
	72	123.1	9.3	116.4	91.0	65.6	40.2	—	—	115.9	9.9	110.6	85.5	60.4	35.4	—	—		
5000	67	122.3	9.3	118.5	108.8	98.2	71.1	44.0	—	115.6	9.9	112.7	102.0	93.6	66.7	39.8	—		
	62	122.1	9.3	119.0	119.0	119.0	102.0	73.3	44.5	115.4	9.9	113.1	113.1	113.1	97.9	69.2	40.5		
	57	121.9	9.2	119.5	119.5	119.5	119.5	102.5	72.1	115.0	9.9	113.1	113.1	113.1	113.1	98.6	68.0		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 59: ZL14 (12.5 ton, 75°F to 105°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
3200	77	182.4	8.3	93.6	76.6	59.5	—	—	—	170.5	8.8	88.2	73.1	58.1	—	—	—
	72	166.6	8.2	113.7	96.1	78.4	60.8	—	—	158.2	8.7	111.0	93.4	75.8	58.3	—	—
	67	150.8	8.1	133.8	115.6	97.3	78.2	61.7	—	146.0	8.7	133.7	113.7	93.6	75.5	58.7	—
	62	147.2	8.1	142.3	129.3	116.2	92.1	80.2	62.2	142.1	8.6	137.0	124.2	111.4	91.0	76.7	59.3
3750	77	182.9	8.4	104.3	82.5	60.7	—	—	—	171.2	8.8	99.3	78.5	57.8	—	—	—
	72	169.8	8.2	122.6	102.5	82.4	62.3	—	—	161.1	8.8	119.3	99.2	79.1	59.0	—	—
	67	156.7	8.1	140.9	122.5	104.1	82.7	63.3	—	151.1	8.7	139.4	119.9	100.3	79.6	59.8	—
	62	153.8	8.1	147.7	136.7	125.8	100.2	84.4	63.7	148.3	8.7	141.9	131.7	121.6	98.7	80.7	60.3
4300	57	150.9	8.1	150.9	150.9	147.5	126.5	105.5	84.5	145.5	8.7	144.4	143.6	142.8	122.2	101.7	81.1
	77	183.4	8.4	115.0	88.5	61.9	—	—	—	171.9	8.8	110.3	84.0	57.6	—	—	—
	72	173.0	8.3	131.5	108.9	86.4	63.9	—	—	164.1	8.8	127.7	105.0	82.3	59.7	—	—
	67	162.6	8.2	147.9	129.4	110.9	87.2	65.0	—	156.2	8.7	145.1	126.1	107.1	83.6	60.9	—
4900	62	160.4	8.1	153.0	144.2	135.4	108.3	88.6	65.2	154.5	8.7	146.7	139.3	131.8	106.4	84.8	61.3
	57	158.3	8.1	158.1	158.1	156.6	136.1	112.3	88.5	152.9	8.7	148.4	148.4	148.4	132.6	108.7	84.8
	77	183.9	8.4	125.7	94.4	63.1	—	—	—	172.7	8.9	121.3	89.4	57.4	—	—	—
	72	176.2	8.3	140.3	115.4	90.4	65.4	—	—	167.0	8.8	136.0	110.8	85.6	60.4	—	—
5400	67	168.4	8.2	154.9	136.3	117.7	91.6	66.6	—	161.3	8.8	150.7	132.3	113.8	87.6	62.0	—
	62	167.1	8.2	158.4	151.7	144.9	116.4	92.8	66.7	160.7	8.7	151.6	146.8	142.0	114.2	88.8	62.3
	57	165.7	8.2	161.8	161.8	161.8	145.6	119.0	92.4	160.2	8.7	152.5	152.5	152.5	142.9	115.7	88.4
	72	179.3	8.3	149.2	121.8	94.4	66.9	—	—	169.9	8.8	144.4	116.6	88.8	61.1	—	—
6000	67	174.3	8.2	162.0	143.2	124.4	96.1	68.3	—	167.7	8.8	156.4	138.5	120.5	91.7	63.1	—
	62	173.7	8.2	163.8	159.1	154.5	124.5	97.0	68.3	167.0	8.8	156.5	154.3	152.2	121.9	92.9	63.2
	57	173.1	8.2	165.5	165.5	165.5	155.2	125.7	96.3	166.8	8.8	156.6	156.6	156.6	153.3	122.7	92.1
	72	182.5	8.3	158.1	128.2	98.4	68.5	—	—	172.8	8.9	152.8	122.4	92.1	61.7	—	—
	67	180.4	8.3	169.0	150.1	131.2	100.6	69.9	—	172.1	8.8	162.1	144.7	127.2	95.7	64.2	—
	62	180.3	8.3	169.1	166.6	164.1	132.6	101.2	69.8	171.9	8.8	162.3	162.3	162.3	129.7	96.9	64.2
	57	180.1	8.3	169.3	169.3	169.3	164.7	132.5	100.3	171.7	8.8	162.4	162.4	162.4	162.4	129.7	95.8
			95°F								105°F						
3200	77	158.5	9.3	82.8	69.7	56.6	—	—	—	146.5	9.9	83.7	68.1	52.6	—	—	—
	72	149.8	9.2	108.2	90.7	73.3	55.8	—	—	139.4	9.9	104.5	87.1	69.6	52.1	—	—
	67	141.1	9.2	133.6	111.7	89.9	72.8	55.7	—	132.4	9.9	125.4	106.0	86.6	69.2	51.8	—
	62	137.0	9.2	134.4	119.1	106.5	89.8	73.1	56.4	129.7	9.9	126.5	113.9	103.7	86.3	69.0	51.6
3750	77	159.5	9.3	94.2	74.6	55.0	—	—	—	147.8	10.0	93.9	72.2	50.6	—	—	—
	72	152.5	9.3	116.0	95.9	75.769	55.6	—	—	142.1	10.0	111.6	91.6	71.6	51.5	—	—
	67	145.4	9.3	137.2	117.2	96.6	76.4	56.3	—	136.4	9.9	129.3	110.9	92.6	72.3	52.1	—
	62	142.8	9.2	137.8	126.7	117.3	97.2	77.0	56.9	134.7	9.9	129.5	120.8	113.6	93.1	72.7	52.3
4300	57	140.1	9.2	138.6	136.2	138.1	118.0	97.8	77.6	133.0	9.9	129.6	129.6	129.6	114.0	93.4	72.8
	77	160.5	9.3	105.6	79.5	53.3	—	—	—	149.1	10.0	104.2	76.4	48.6	—	—	—
	72	155.1	9.3	123.9	101.1	78.3	55.5	—	—	144.8	10.0	118.7	96.1	73.5	50.9	—	—
	67	149.8	9.3	140.1	122.7	103.2	80.0	56.8	—	140.5	10.0	133.3	115.9	98.5	75.4	52.4	—
4900	62	148.6	9.3	143.2	134.3	128.2	104.6	80.9	57.3	139.8	10.0	133.4	127.7	123.4	99.9	76.5	53.0
	57	147.4	9.2	145.6	145.6	145.6	129.1	105.1	81.1	139.1	9.9	133.6	133.6	133.6	124.5	100.6	76.7
	77	161.4	9.4	117.0	84.3	51.7	—	—	—	150.4	10.0	114.4	80.5	46.6	—	—	—
	72	157.8	9.3	131.7	106.3	80.8	55.3	—	—	147.5	10.0	125.8	100.6	75.5	50.3	—	—
5400	67	154.5	9.3	145.1	128.2	109.9	83.6	57.4	—	144.8	10.0	136.0	120.8	104.4	78.5	52.7	—
	62	154.4	9.3	147.6	141.9	139.0	111.9	84.9	57.8	144.6	10.0	137.0	134.7	133.3	106.8	80.2	53.7
	57	154.3	9.3	150.5	150.5	150.5	140.2	112.4	84.5	144.5	10.0	137.3	137.3	137.3	135.0	107.8	80.6
	72	161.1	9.4	139.6	111.4	83.3	55.2	—	—	150.2	10.0	132.9	105.2	77.4	49.7	—	—
6000	67	160.5	9.4	150.2	133.7	116.6	87.2	57.9	—	149.8	10.0	140.0	125.7	110.3	81.6	53.0	—
	62	160.2	9.3	150.6	149.5	149.8	119.3	88.8	58.2	149.7	10.0	141.1	141.1	141.1	113.6	84.0	54.4
	57	160.1	9.3	150.9	150.9	150.9	150.9	119.6	87.9	149.3	10.0	141.2	141.2	141.2	141.2	115.0	84.5
	72	168.2	9.4	147.4	116.6	85.8	55.0	—	—	154.8	10.0	140.0	109.7	79.4	49.1	—	—
	67	166.5	9.4	153.4	139.2	123.2	90.8	58.4	—	153.8	10.0	142.3	130.6	116.2	84.7	53.2	—
	62	166.0	9.4	155.2	155.2	155.2	126.7	92.7	58.7	153.5	10.0	144.0	144.0	144.0	120.4	87.7	55.1
	57	165.5	9.3	156.5	156.5	156.5	156.5	126.9	91.3	153.3	10.0	144.2	144.2	144.2	144.2	122.2	88.4

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 60: ZL14 (12.5 ton, 115°F to 125°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFMWB (°F)		Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input (kW)²	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		115°F									125°F								
3200	77	134.4	10.6	84.5	66.5	48.5	—	—	—	122.4	11.3	85.4	64.9	44.4	—	—	—		
	72	129.0	10.6	100.9	83.4	65.9	48.5	—	—	118.7	11.3	97.3	79.8	62.3	44.8	—	—		
	67	123.6	10.6	117.3	100.3	83.4	65.7	47.9	—	115.3	11.3	109.1	94.6	80.2	62.1	44.0	—		
	62	122.4	10.6	117.4	108.6	100.9	82.9	64.8	46.8	115.1	11.3	109.2	103.4	98.1	79.4	60.7	42.0		
3750	77	136.1	10.7	93.7	69.9	46.1	—	—	—	124.4	11.3	93.4	67.5	41.7	—	—	—		
	72	131.8	10.6	107.2	87.3	67.3	47.4	—	—	121.4	11.3	102.8	83.0	63.1	43.3	—	—		
	67	127.4	10.6	119.8	104.7	88.6	68.3	47.9	—	118.4	11.3	112.3	98.4	84.6	64.2	43.8	—		
	62	126.7	10.6	120.0	114.9	109.8	89.1	68.4	47.8	118.2	11.3	112.5	109.0	106.0	85.1	64.1	43.2		
4300	57	125.9	10.6	120.9	120.9	120.9	110.0	88.9	67.9	118.1	11.3	112.6	112.6	112.6	105.9	84.5	63.0		
	77	137.7	10.7	102.8	73.3	43.8	—	—	—	126.4	11.3	101.4	70.2	39.0	—	—	—		
	72	134.5	10.6	113.6	91.2	68.8	46.3	—	—	124.2	11.3	108.4	86.2	64.0	41.8	—	—		
	67	131.2	10.6	123.6	109.0	93.7	70.8	48.0	—	122.4	11.3	115.4	102.2	89.0	66.3	43.6	—		
	62	131.0	10.6	124.4	121.2	118.7	95.3	72.0	48.7	122.2	11.3	115.6	114.6	113.9	90.7	67.5	44.3		
4900	57	130.7	10.6	124.6	124.6	124.6	119.8	96.0	72.2	121.9	11.3	115.9	115.9	115.9	115.2	91.5	67.8		
	77	139.4	10.7	111.9	76.7	41.4	—	—	—	128.3	11.3	109.3	72.8	36.3	—	—	—		
	72	137.2	10.7	119.9	95.0	70.2	45.3	—	—	126.9	11.3	114.0	89.4	64.8	40.3	—	—		
	67	135.4	10.6	127.2	113.4	98.9	73.4	48.0	—	125.9	11.3	118.3	106.0	93.4	68.3	43.3	—		
	62	135.3	10.6	127.4	127.4	127.4	101.6	75.6	49.6	125.7	11.3	118.4	118.4	118.4	96.4	71.0	45.5		
5400	57	135.1	10.6	127.5	127.5	127.5	127.5	103.2	76.6	125.5	11.3	118.6	118.6	118.6	118.6	98.6	72.7		
	72	139.9	10.7	126.2	98.9	71.6	44.2	—	—	129.6	11.3	119.5	92.6	65.7	38.8	—	—		
	67	138.8	10.7	130.8	117.7	104.0	76.0	48.0	—	129.4	11.3	121.7	109.8	97.7	70.4	43.1	—		
	62	138.5	10.7	131.1	131.1	131.1	107.8	79.2	50.5	129.2	11.3	121.9	121.9	121.9	102.1	74.4	46.7		
6000	57	138.4	10.7	131.3	131.3	131.3	131.3	110.3	81.0	129.1	11.3	122.0	122.0	122.0	122.0	105.6	77.5		
	72	145.1	10.7	132.6	102.8	73.0	43.2	—	—	132.9	11.3	125.1	95.8	66.5	37.3	—	—		
	67	144.2	10.7	135.0	122.1	109.2	78.6	48.1	—	132.7	11.3	125.3	113.6	102.1	72.5	42.9	—		
	62	143.8	10.7	135.8	135.8	135.8	114.1	82.8	51.4	132.5	11.3	125.4	125.4	125.4	107.8	77.8	47.8		
	57	143.5	10.7	136.0	136.0	136.0	117.4	85.4	—	132.2	11.3	125.5	125.5	125.5	125.5	112.7	82.4		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

# Reheat performance

## ZY04 to 12 reheat capacities

**Table 61: ZY04 reheat capacity (3 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
35°F										45°F							
750	72	26.1	2.0	8.6	7.4	6.1	4.9	—	—	26.0	2.1	6.1	5.1	4.1	3.1	—	—
	67	24.8	1.9	12.3	11.0	9.8	8.5	7.3	—	23.5	1.9	10.1	9.1	8.1	7.1	6.1	—
	62	22.9	1.8	17.1	15.8	14.6	13.4	12.1	10.9	20.1	1.9	14.3	13.3	12.3	11.3	10.2	9.2
900	77	26.8	2.1	5.4	4.2	2.9	—	—	—	28.3	2.2	2.3	1.2	0.1	—	—	—
	72	25.6	2.0	9.2	7.9	6.7	5.4	—	—	25.9	2.0	6.8	5.6	4.5	3.4	—	—
	67	24.4	1.8	13.0	11.7	10.4	9.1	7.9	—	23.4	1.9	11.2	10.1	8.9	7.8	6.6	—
	62	22.6	1.7	18.1	16.8	15.5	14.3	13.0	11.7	20.0	1.8	15.8	14.7	13.5	12.4	11.2	10.1
1050	57	20.1	1.7	19.4	18.1	16.8	15.6	14.3	13.0	17.7	1.8	16.9	15.7	14.6	13.5	12.3	11.2
	77	26.3	2.1	5.9	4.6	3.3	—	—	—	28.2	2.1	2.6	1.3	0.1	—	—	—
	72	25.1	1.9	9.8	8.5	7.2	5.9	—	—	25.8	2.0	7.4	6.2	4.9	3.6	—	—
	67	24.0	1.8	13.7	12.4	11.1	9.8	8.4	—	23.4	1.9	12.3	11.0	9.7	8.5	7.2	—
	62	22.2	1.7	19.1	17.8	16.5	15.2	13.9	12.6	20.0	1.8	17.3	16.0	14.8	13.5	12.3	11.0
1200	57	19.8	1.7	19.4	18.8	17.9	16.6	15.3	13.9	17.6	1.7	17.2	16.7	15.9	14.7	13.4	12.2
	77	25.7	2.0	6.3	5.0	3.7	—	—	—	28.0	2.1	2.8	1.5	0.1	—	—	—
	72	24.6	1.9	10.4	9.0	7.7	6.3	—	—	25.6	1.9	8.1	6.7	5.3	3.9	—	—
	67	23.5	1.7	14.4	13.1	11.7	10.4	9.0	—	23.3	1.8	13.3	11.9	10.6	9.2	7.8	—
	62	21.9	1.7	20.1	18.8	17.4	16.1	14.7	13.4	19.9	1.7	18.8	17.4	16.0	14.7	13.3	11.9
1350	57	19.5	1.6	19.5	19.5	18.9	17.6	16.2	14.9	17.6	1.7	17.6	17.6	17.3	15.9	14.5	13.2
	72	24.1	1.8	10.3	9.1	7.9	6.7	—	—	25.6	1.9	8.4	7.0	5.6	4.2	—	—
	67	23.1	1.7	14.2	12.9	11.7	10.5	9.2	—	23.2	1.8	14.0	12.5	11.1	9.7	8.3	—
	62	21.5	1.6	20.6	19.4	17.4	16.1	14.9	13.7	19.8	1.7	19.3	18.3	16.9	15.4	14.0	12.6
	57	19.2	1.6	19.2	19.2	18.9	17.6	16.4	15.2	17.5	1.7	17.5	17.5	17.4	16.0	14.5	13.1
1500	72	23.6	1.8	10.3	9.2	8.1	7.0	—	—	25.5	1.9	8.8	7.3	5.9	4.4	—	—
	67	22.7	1.7	13.9	12.8	11.7	10.6	9.4	—	23.1	1.8	14.6	13.1	11.7	10.2	8.7	—
	62	21.2	1.6	21.2	19.9	17.3	16.2	15.1	14.0	19.7	1.7	19.7	19.1	17.7	16.2	14.7	13.3
	57	18.9	1.6	18.9	18.9	18.9	17.7	16.6	15.5	17.5	1.7	17.5	17.5	17.5	16.0	14.5	13.1
55°F										65°F							
750	72	25.8	2.2	3.6	2.8	2.0	1.2	—	—	23.2	2.2	1.6	1.0	0.4	—	—	—
	67	22.2	2.0	8.0	7.2	6.4	5.6	4.8	—	19.7	2.1	5.7	5.1	4.6	4.0	3.5	—
	62	17.3	1.9	11.6	10.8	10.0	9.2	8.4	7.6	15.1	2.0	9.2	8.7	8.1	7.6	7.0	6.4
900	72	26.1	2.1	4.3	3.3	2.3	1.3	—	—	23.4	2.2	1.9	1.2	0.5	—	—	—
	67	22.5	2.0	9.4	8.4	7.4	6.4	5.4	—	19.9	2.1	6.9	6.1	5.4	4.7	4.0	—
	62	17.5	1.9	13.5	12.5	11.5	10.5	9.5	8.5	15.2	2.0	11.1	10.4	9.6	8.9	8.2	7.5
	57	15.3	1.8	14.3	13.3	12.3	11.3	10.3	9.3	13.1	1.9	11.5	10.8	10.1	9.4	8.7	7.9
1050	72	26.4	2.1	5.1	3.9	2.7	1.4	—	—	23.6	2.1	2.3	1.4	0.5	—	—	—
	67	22.7	1.9	10.8	9.6	8.4	7.2	6.0	—	20.1	2.0	8.0	7.1	6.2	5.4	4.5	—
	62	17.7	1.8	15.5	14.3	13.1	11.9	10.7	9.5	15.3	1.9	13.0	12.1	11.2	10.3	9.4	8.5
	57	15.5	1.8	15.0	14.5	14.0	12.8	11.6	10.4	13.2	1.9	12.4	12.1	11.7	10.8	9.9	9.0
1200	72	26.7	2.0	5.8	4.4	3.0	1.6	—	—	23.8	2.1	2.6	1.6	0.5	—	—	—
	67	23.0	1.9	12.2	10.8	9.4	8.0	6.6	—	20.2	2.0	9.2	8.1	7.1	6.0	5.0	—
	62	17.9	1.8	17.4	16.0	14.6	13.2	11.8	10.4	15.4	1.9	14.8	13.8	12.7	11.7	10.6	9.6
	57	15.7	1.8	15.7	15.7	15.7	14.3	12.8	11.4	13.3	1.9	13.3	13.3	13.3	12.2	11.2	10.1
1350	72	27.0	2.0	6.5	4.9	3.3	1.7	—	—	23.8	2.1	3.0	1.8	0.6	—	—	—
	67	23.3	1.9	13.7	12.1	10.5	8.9	7.3	—	20.2	2.0	10.3	9.1	7.9	6.7	5.5	—
	62	18.1	1.8	17.9	17.2	16.3	14.7	13.1	11.5	15.4	1.9	15.1	14.6	14.0	12.8	11.6	10.4
	57	15.9	1.7	15.9	15.9	15.9	14.3	12.6	11.0	13.3	1.8	13.3	13.3	13.3	12.1	10.9	9.7
1500	72	27.3	2.0	7.3	5.5	3.7	1.8	—	—	23.7	2.1	3.3	2.0	0.6	—	—	—
	67	23.6	1.9	15.2	13.4	11.6	9.8	8.0	—	20.2	1.9	11.4	10.1	8.7	7.4	6.0	—
	62	18.3	1.8	18.3	18.3	18.0	16.2	14.4	12.6	15.4	1.8	15.4	15.4	15.3	13.9	12.6	11.2
	57	16.1	1.7	16.1	16.1	16.1	14.2	12.4	10.6	13.3	1.8	13.3	13.3	13.3	11.9	10.6	9.3

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 62: ZY04 reheat capacity (3 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM		WB (°F)	Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)					Total capacity¹ (MBh)	Total input²(kW)	Sensible capacity (MBh)					
					Return dry bulb (°F)							Return dry bulb (°F)					
					90	85	80	75	70			65	90	85	80	75	70
75°F										85°F							
750	72	20.7	2.3	—	—	—	—	—	—	18.1	2.3	—	—	—	—	—	—
	67	17.2	2.2	3.4	3.0	2.7	2.4	2.1	—	14.8	2.2	1.0	1.0	0.9	0.8	0.8	—
	62	12.8	2.1	6.9	6.6	6.3	5.9	5.6	5.3	10.6	2.2	4.5	4.5	4.4	4.3	4.3	4.2
900	67	17.3	2.1	4.3	3.8	3.4	3.0	2.5	—	14.7	2.2	1.7	1.6	1.4	1.2	1.1	—
	62	12.9	2.0	8.6	8.2	7.8	7.3	6.9	6.5	10.6	2.1	6.2	6.1	5.9	5.7	5.6	5.4
	57	10.8	2.0	8.7	8.3	7.9	7.4	7.0	6.5	8.6	2.1	5.9	5.8	5.6	5.5	5.3	5.1
1050	67	17.4	2.1	5.2	4.6	4.1	3.5	2.9	—	14.7	2.2	2.4	2.1	1.9	1.7	1.4	—
	62	12.9	2.0	10.4	9.9	9.3	8.7	8.2	7.6	10.5	2.1	7.9	7.7	7.4	7.2	6.9	6.7
	57	10.9	2.0	9.8	9.6	9.4	8.8	8.3	7.7	8.6	2.1	7.2	7.2	7.1	6.8	6.6	6.4
1200	67	17.4	2.1	6.1	5.4	4.7	4.0	3.4	—	14.7	2.1	3.1	2.7	2.4	2.1	1.7	—
	62	13.0	2.0	12.2	11.5	10.8	10.1	9.4	8.7	10.5	2.1	9.6	9.2	8.9	8.6	8.2	7.9
	57	10.9	2.0	10.9	10.9	10.9	10.2	9.5	8.9	8.6	2.0	8.6	8.6	8.6	8.2	7.9	7.6
1350	67	17.1	2.0	6.9	6.1	5.3	4.5	3.7	—	14.0	2.1	3.4	3.0	2.7	2.3	1.9	—
	62	12.7	2.0	12.4	12.0	11.7	10.9	10.1	9.3	10.1	2.0	9.6	9.4	9.3	8.9	8.6	8.2
	57	10.7	1.9	10.7	10.7	10.7	9.9	9.2	8.4	8.2	2.0	8.2	8.2	8.2	7.8	7.4	7.0
1500	67	16.8	2.0	7.6	6.7	5.8	5.0	4.1	—	13.4	2.1	3.8	3.4	2.9	2.5	2.1	—
	62	12.5	1.9	12.5	12.5	12.5	11.6	10.7	9.8	9.6	2.0	9.6	9.6	9.6	9.3	8.9	8.5
	57	10.5	1.9	10.5	10.5	10.5	9.6	8.8	7.9	7.8	2.0	7.8	7.8	7.8	7.3	6.9	6.5

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 63: ZY05 reheat capacity (4 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65					90	85	80	75	70	65
35°F										45°F									
1000	77	44.6	2.5	11.3	8.9	6.6	—	—	—	41.5	2.8	6.5	4.6	2.6	—	—	—		
	72	41.5	2.5	17.3	15.0	12.6	10.3	—	—	38.3	2.7	12.7	10.8	8.8	6.9	—	—		
	67	38.5	2.4	23.4	21.1	18.7	16.4	14.0	—	35.0	2.6	19.0	17.0	15.1	13.1	11.2	—		
	62	33.7	2.4	30.5	27.5	25.1	22.8	20.4	18.1	29.8	2.5	25.4	22.9	21.0	19.0	17.1	15.1		
1200	77	42.4	2.5	11.8	9.4	7.1	—	—	—	41.0	2.7	7.0	4.9	2.8	—	—	—		
	72	39.5	2.4	17.7	15.4	13.0	10.7	—	—	37.7	2.6	13.6	11.5	9.4	7.3	—	—		
	67	36.7	2.4	23.7	21.3	19.0	16.7	14.3	—	34.5	2.5	20.2	18.1	16.0	13.9	11.8	—		
	62	32.2	2.4	30.1	27.7	25.4	23.1	20.7	18.4	29.4	2.5	26.4	24.3	22.2	20.1	18.0	15.9		
	57	31.5	2.4	31.5	30.3	28.0	25.7	23.3	21.0	27.9	2.5	27.9	26.4	24.3	22.2	20.1	18.0		
	77	40.2	2.4	12.2	9.9	7.6	—	—	—	40.4	2.7	7.4	5.2	2.9	—	—	—		
	72	37.5	2.4	18.1	15.8	13.4	11.1	—	—	37.2	2.6	14.4	12.2	9.9	7.7	—	—		
	67	34.8	2.3	23.9	21.6	19.3	16.9	14.6	—	34.0	2.5	21.5	19.2	16.9	14.7	12.4	—		
	62	30.7	2.3	29.6	28.0	25.7	23.3	21.0	18.7	29.0	2.4	27.5	25.8	23.5	21.3	19.0	16.8		
	57	30.1	2.4	30.1	29.5	28.3	26.0	23.7	21.3	27.5	2.4	27.5	26.7	25.7	23.4	21.2	18.9		
	77	38.0	2.4	12.7	10.4	8.1	—	—	—	39.8	2.6	7.9	5.5	3.1	—	—	—		
	72	35.5	2.3	18.5	16.1	13.8	11.5	—	—	36.7	2.5	15.3	12.9	10.5	8.1	—	—		
	67	33.0	2.3	24.2	21.9	19.5	17.2	14.9	—	33.6	2.4	22.7	20.3	17.9	15.5	13.1	—		
	62	29.1	2.3	29.1	28.2	25.9	23.6	21.3	19.0	28.6	2.4	28.6	27.2	24.8	22.4	20.0	17.6		
	57	28.7	2.3	28.7	28.7	28.7	26.3	24.0	21.7	27.1	2.4	27.1	27.1	27.1	24.7	22.3	19.9		
	72	34.5	2.4	17.6	15.5	13.5	11.4	—	—	36.6	2.5	15.5	13.1	10.7	8.2	—	—		
	67	32.1	2.3	22.7	20.6	18.6	16.5	14.5	—	33.5	2.4	23.0	20.6	18.2	15.7	13.3	—		
	62	28.4	2.3	28.4	27.6	24.4	22.4	20.3	18.3	28.5	2.4	28.5	27.7	25.2	22.8	20.4	18.0		
	57	28.0	2.3	28.0	28.0	28.0	25.9	23.9	21.8	27.1	2.4	27.1	27.1	27.1	24.6	22.2	19.8		
	72	33.6	2.4	16.7	14.9	13.1	11.3	—	—	36.6	2.5	15.7	13.3	10.8	8.4	—	—		
	67	31.3	2.3	21.2	19.4	17.6	15.8	14.0	—	33.5	2.4	23.4	20.9	18.5	16.0	13.6	—		
	62	27.7	2.3	27.7	26.9	23.0	21.2	19.4	17.6	28.5	2.3	28.5	28.1	25.6	23.2	20.8	18.3		
	57	27.3	2.3	27.3	27.3	27.3	25.5	23.7	22.0	27.0	2.4	27.0	27.0	27.0	24.6	22.1	19.7		
55°F										65°F									
1000	77	38.5	3.1	1.7	0.2	—	—	—	—	37.0	3.2	—	—	—	—	—	—		
	72	35.0	2.9	8.2	6.6	5.1	3.5	—	—	32.6	3.1	4.8	3.6	2.4	1.3	—	—		
	67	31.5	2.8	14.6	13.0	11.5	9.9	8.4	—	28.2	2.9	11.2	10.0	8.9	7.7	6.5	—		
	62	25.9	2.7	20.2	18.3	16.8	15.2	13.7	12.1	23.1	2.8	17.3	15.9	14.7	13.5	12.3	11.2		
1200	77	39.5	3.0	2.2	0.3	—	—	—	—	37.4	3.1	—	—	—	—	—	—		
	72	36.0	2.9	9.5	7.6	5.7	3.9	—	—	33.0	3.0	5.6	4.2	2.8	1.4	—	—		
	67	32.4	2.7	16.8	14.9	13.0	11.2	9.3	—	28.6	2.9	12.8	11.4	9.9	8.5	7.1	—		
	62	26.6	2.6	22.8	21.0	19.1	17.2	15.4	13.5	23.4	2.8	19.3	17.9	16.5	15.1	13.7	12.3		
	57	24.3	2.6	24.3	22.4	20.6	18.7	16.8	15.0	21.6	2.7	21.0	19.6	18.2	16.8	15.4	14.0		
1400	77	40.6	3.0	2.6	0.4	—	—	—	—	37.9	3.1	—	—	—	—	—	—		
	72	36.9	2.8	10.8	8.6	6.4	4.3	—	—	33.4	2.9	6.4	4.8	3.1	1.5	—	—		
	67	33.2	2.7	19.0	16.8	14.6	12.4	10.3	—	28.9	2.8	14.3	12.7	11.0	9.4	7.8	—		
	62	27.3	2.5	25.4	23.6	21.4	19.2	17.1	14.9	23.7	2.7	21.4	19.9	18.3	16.6	15.0	13.4		
	57	24.9	2.5	24.9	24.0	23.1	20.9	18.7	16.5	21.8	2.7	21.6	20.9	20.2	18.5	16.9	15.3		
1600	77	41.6	2.9	3.1	0.6	—	—	—	—	38.3	3.0	—	—	—	—	—	—		
	72	37.9	2.7	12.1	9.6	7.1	4.7	—	—	33.8	2.9	7.2	5.3	3.5	1.6	—	—		
	67	34.1	2.6	21.2	18.7	16.2	13.7	11.2	—	29.3	2.7	15.8	14.0	12.1	10.3	8.4	—		
	62	28.0	2.5	28.0	26.2	23.7	21.2	18.7	16.3	24.0	2.6	23.4	21.9	20.0	18.2	16.3	14.5		
	57	25.5	2.5	25.5	25.5	25.5	23.1	20.6	18.1	22.1	2.6	22.1	22.1	22.1	20.2	18.4	16.5		
1800	72	38.7	2.7	13.4	10.6	7.8	5.0	—	—	34.0	2.8	7.8	5.8	3.8	1.8	—	—		
	67	34.9	2.6	23.4	20.6	17.8	15.0	12.2	—	29.5	2.7	17.1	15.0	13.0	11.0	9.0	—		
	62	28.7	2.4	28.7	27.8	26.0	23.2	20.4	17.7	24.2	2.6	23.9	22.9	21.4	19.4	17.4	15.4		
	57	26.1	2.4	26.1	26.1	26.1	23.3	20.5	17.7	22.3	2.6	22.3	22.3	22.3	20.3	18.2	16.2		
2000	72	39.6	2.7	14.7	11.6	8.5	5.4	—	—	34.3	2.8	8.5	6.3	4.2	2.0	—	—		
	67	35.6	2.5	25.5	22.5	19.4	16.3	13.2	—	29.8	2.7	18.3	16.1	13.9	11.7	9.6	—		
	62	29.3	2.4	29.3	29.3	28.3	25.2	22.1	19.0	24.4	2.6	24.4	23.9	22.8	20.6	18.4	16.2		
	57	26.7	2.4	26.7	26.7	26.7	23.6	20.5	17.4	22.5	2.6	22.5	22.5	22.5	20.3	18.1	15.9		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 64: ZY05 reheat capacity (4 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)						Total capacity¹ (MBh)	Total input² (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
1000	72	30.3	3.2	1.5	0.7	—	—	—	—	27.9	3.4	—	—	—	—	—	—
	67	24.9	3.1	7.9	7.1	6.2	5.4	4.6	—	21.6	3.3	4.6	4.1	3.6	3.2	2.7	—
	62	20.3	3.0	14.3	13.5	12.7	11.8	11.0	10.2	17.5	3.2	11.4	11.1	10.6	10.1	9.7	9.2
1200	72	30.1	3.2	1.7	0.8	—	—	—	—	27.1	3.3	—	—	—	—	—	—
	67	24.8	3.0	8.8	7.8	6.8	5.9	4.9	—	21.0	3.2	4.7	4.2	3.7	3.2	2.7	—
	62	20.2	2.9	15.8	14.8	13.9	12.9	12.0	11.0	17.0	3.1	12.3	11.8	11.3	10.8	10.3	9.8
1400	72	29.9	3.1	17.8	16.8	15.8	14.9	13.9	13.0	16.2	3.0	14.5	14.0	13.5	13.0	12.5	12.0
	67	24.6	3.0	2.0	0.9	—	—	—	—	26.4	3.2	—	—	—	—	—	—
	62	20.1	2.9	9.6	8.5	7.4	6.4	5.3	—	20.3	3.1	4.9	4.4	3.9	3.3	2.8	—
1600	72	29.7	3.0	17.3	16.2	15.1	14.0	12.9	11.9	16.4	3.0	13.2	12.5	12.0	11.4	10.9	10.4
	67	24.5	2.8	18.2	17.7	17.3	16.2	15.1	14.0	15.7	3.0	14.9	14.6	14.3	13.8	13.3	12.7
	62	19.9	2.8	18.2	17.7	17.3	16.2	15.1	14.0	15.7	3.0	14.9	14.6	14.3	13.8	13.3	12.7
1800	72	29.7	3.0	2.2	1.0	—	—	—	—	25.6	3.2	—	—	—	—	—	—
	67	24.5	2.9	10.5	9.3	8.1	6.8	5.6	—	19.6	3.1	5.1	4.6	4.0	3.4	2.8	—
	62	19.9	2.8	18.8	17.6	16.3	15.1	13.9	12.7	15.9	3.0	14.2	13.2	12.7	12.1	11.5	10.9
2000	72	29.3	3.0	18.7	18.7	18.7	17.4	16.2	15.0	15.2	2.9	15.2	15.2	15.2	14.6	14.1	13.5
	67	24.2	2.9	2.3	1.0	—	—	—	—	24.6	3.1	—	—	—	—	—	—
	62	19.7	2.8	10.8	9.5	8.3	7.0	5.8	—	18.8	3.0	4.5	4.0	3.5	3.1	2.6	—
2200	72	29.0	3.0	19.1	18.0	16.8	15.6	14.3	13.1	15.2	2.9	14.4	13.2	12.2	11.7	11.3	10.8
	67	23.9	2.8	18.4	18.4	18.4	17.2	16.0	14.7	14.6	2.9	14.6	14.6	14.6	14.1	13.7	13.2
	62	19.5	2.7	18.4	18.4	18.4	17.2	16.0	14.7	14.6	2.9	14.6	14.6	14.6	14.1	13.7	13.2
2400	72	29.0	3.0	2.3	1.0	—	—	—	—	23.7	3.1	—	—	—	—	—	—
	67	23.9	2.8	11.0	9.8	8.5	7.2	6.0	—	18.0	3.0	3.8	3.4	3.1	2.7	2.3	—
	62	19.5	2.7	19.5	18.5	17.3	16.0	14.7	13.4	14.6	2.9	14.6	13.2	11.7	11.4	11.0	10.6
2600	72	28.7	2.9	18.2	18.2	18.2	17.0	15.7	14.4	14.0	2.9	14.0	14.0	14.0	13.6	13.3	12.9
	67	23.7	2.8	11.2	10.0	8.7	7.4	6.2	—	17.8	3.0	3.9	3.5	3.2	2.8	2.4	—
	62	19.3	2.7	19.7	18.7	17.5	16.2	14.9	13.6	14.5	2.9	14.7	13.3	11.8	11.5	11.1	10.7

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



**Table 65: ZY06 reheat capacity (5 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFMWB (°F)		Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65					90	85	80	75	70	65
35°F										45°F									
1250	77	40.8	3.0	8.8	6.1	3.3	—	—	—	39.9	3.5	2.8	0.8	—	—	—	—	—	—
	72	41.8	3.0	17.3	14.6	11.8	9.1	—	—	38.6	3.4	10.8	8.9	6.9	4.9	—	—	—	—
	67	42.8	3.0	25.9	23.1	20.4	17.6	14.9	—	37.3	3.2	18.9	16.9	14.9	13.0	11.0	—	—	—
	62	41.2	2.9	37.0	34.3	31.5	28.8	26.0	23.3	34.5	3.1	27.5	25.6	23.6	21.6	19.7	17.7	—	—
1500	77	39.9	3.0	9.7	7.0	4.3	—	—	—	40.5	3.4	3.0	0.9	—	—	—	—	—	—
	72	41.1	3.0	18.0	15.3	12.7	10.0	—	—	39.2	3.3	11.7	9.6	7.5	5.4	—	—	—	—
	67	42.3	3.0	26.3	23.6	21.0	18.3	15.6	—	37.8	3.2	20.5	18.4	16.3	14.2	12.0	—	—	—
	62	40.8	2.8	37.6	34.9	32.3	29.6	26.9	24.3	35.0	3.0	30.0	27.8	25.7	23.6	21.5	19.4	—	—
1750	57	36.3	2.7	36.3	36.3	33.9	31.2	28.6	25.9	32.0	2.9	32.0	30.2	28.1	26.0	23.8	21.7	—	—
	77	39.0	3.0	10.6	8.0	5.4	—	—	—	41.1	3.4	3.2	0.9	—	—	—	—	—	—
	72	40.3	2.9	18.6	16.0	13.5	10.9	—	—	39.7	3.2	12.7	10.4	8.1	5.9	—	—	—	—
	67	41.7	2.9	26.7	24.1	21.5	19.0	16.4	—	38.3	3.1	22.2	19.9	17.6	15.4	13.1	—	—	—
2000	62	40.4	2.8	38.2	35.6	33.0	30.5	27.9	25.3	35.5	3.0	32.4	30.1	27.9	25.6	23.3	21.1	—	—
	57	35.8	2.7	35.8	35.8	34.5	31.9	29.3	26.7	32.4	2.9	32.4	31.5	30.4	28.1	25.9	23.6	—	—
	77	38.1	2.9	11.4	8.9	6.4	—	—	—	41.7	3.3	3.4	1.0	—	—	—	—	—	—
	72	39.6	2.9	19.3	16.8	14.3	11.8	—	—	40.3	3.2	13.6	11.2	8.8	6.3	—	—	—	—
2250	67	41.1	2.9	27.1	24.6	22.1	19.6	17.1	—	38.9	3.1	23.8	21.4	19.0	16.5	14.1	—	—	—
	62	39.9	2.8	38.8	36.3	33.8	31.3	28.8	26.3	36.0	2.9	34.8	32.4	30.0	27.6	25.2	22.7	—	—
	57	35.4	2.7	35.4	35.4	35.1	32.6	30.1	27.6	32.9	2.8	32.9	32.9	32.7	30.3	27.9	25.5	—	—
	72	38.7	2.8	19.1	16.8	14.5	12.2	—	—	40.4	3.1	13.9	11.5	9.0	6.6	—	—	—	—
2500	67	40.3	2.8	26.3	24.0	21.7	19.4	17.1	—	39.0	3.0	24.5	22.1	19.6	17.2	14.7	—	—	—
	62	39.2	2.7	38.6	35.7	33.0	30.7	28.4	26.1	36.1	2.9	35.5	33.4	31.0	28.5	26.1	23.6	—	—
	57	34.7	2.6	34.7	34.7	34.5	32.2	29.9	27.6	33.0	2.8	33.0	33.0	32.9	30.5	28.0	25.6	—	—
	72	37.7	2.7	18.9	16.8	14.7	12.7	—	—	40.6	3.0	14.3	11.8	9.3	6.9	—	—	—	—
1250	67	39.5	2.7	25.4	23.3	21.2	19.2	17.1	—	39.1	2.9	25.2	22.7	20.2	17.8	15.3	—	—	—
	62	38.5	2.6	38.5	35.1	32.2	30.1	28.0	25.9	36.2	2.8	36.2	34.5	32.0	29.5	27.0	24.6	—	—
	57	34.0	2.5	34.0	34.0	34.0	31.9	29.8	27.7	33.1	2.7	33.1	33.1	33.1	30.6	28.2	25.7	—	—
	55°F										65°F								
1250	72	35.4	3.8	4.3	3.1	1.9	0.8	—	—	30.3	4.0	2.0	1.4	0.9	0.4	—	—	—	—
	67	31.7	3.5	11.8	10.6	9.5	8.3	7.1	—	26.7	3.8	5.9	5.4	4.9	4.3	3.8	—	—	—
	62	27.7	3.3	18.0	16.9	15.7	14.5	13.3	12.1	22.5	3.7	9.2	8.6	8.1	7.6	7.0	6.5	—	—
1500	72	37.2	3.6	5.5	3.9	2.4	0.8	—	—	32.3	3.9	2.2	1.3	0.4	—	—	—	—	—
	67	33.3	3.4	14.7	13.1	11.6	10.0	8.5	—	28.5	3.6	8.9	8.0	7.1	6.2	5.3	—	—	—
	62	29.1	3.2	22.3	20.7	19.2	17.6	16.0	14.5	24.0	3.5	14.3	13.3	12.4	11.5	10.6	9.7	—	—
1750	57	27.7	3.1	25.4	23.8	22.2	20.7	19.1	17.5	23.4	3.4	16.9	15.9	15.0	14.1	13.2	12.3	—	—
	72	39.1	3.5	6.7	4.7	2.8	0.8	—	—	34.2	3.7	2.5	1.2	—	—	—	—	—	—
	67	35.0	3.3	17.6	15.7	13.7	11.7	9.8	—	30.2	3.5	11.9	10.6	9.3	8.0	6.7	—	—	—
2000	62	30.5	3.2	26.6	24.6	22.7	20.7	18.8	16.8	25.4	3.4	19.4	18.1	16.8	15.5	14.2	12.8	—	—
	57	29.1	3.1	27.9	27.1	26.3	24.4	22.4	20.5	24.9	3.3	21.6	21.1	20.6	19.3	18.0	16.7	—	—
	72	40.9	3.4	7.9	5.6	3.2	0.9	—	—	36.2	3.6	2.8	1.1	—	—	—	—	—	—
2250	67	36.6	3.2	20.5	18.2	15.8	13.5	11.1	—	31.9	3.4	14.9	13.3	11.6	9.9	8.2	—	—	—
	62	32.0	3.1	30.9	28.5	26.2	23.9	21.5	19.2	26.8	3.2	24.5	22.8	21.1	19.4	17.7	16.0	—	—
	57	30.4	3.0	30.4	30.4	30.4	28.0	25.7	23.4	26.3	3.2	26.3	26.3	26.2	24.5	22.8	21.1	—	—
2500	72	42.2	3.4	8.8	6.2	3.6	1.0	—	—	36.9	3.5	3.1	1.2	—	—	—	—	—	—
	67	37.7	3.2	22.7	20.1	17.5	14.9	12.3	—	32.6	3.3	16.7	14.8	12.9	11.0	9.1	—	—	—
	62	32.9	3.0	32.4	31.2	29.0	26.4	23.8	21.2	27.4	3.2	26.2	25.2	23.5	21.6	19.8	17.9	—	—
1250	57	31.4	2.9	31.4	31.4	31.3	28.7	26.1	23.5	26.8	3.1	26.8	26.8	26.8	24.9	23.0	21.1	—	—
	72	43.4	3.4	9.7	6.8	3.9	1.0	—	—	37.6	3.5	3.4	1.3	—	—	—	—	—	—
	67	38.8	3.1	25.0	22.1	19.2	16.4	13.5	—	33.2	3.3	18.4	16.3	14.2	12.1	10.0	—	—	—
1500	62	33.9	3.0	33.9	33.9	31.8	29.0	26.1	23.2	27.9	3.1	27.9	27.7	26.0	23.9	21.8	19.7	—	—
	57	32.3	2.9	32.3	32.3	32.3	29.4	26.5	23.6	27.3	3.1	27.3	27.3	27.3	25.3	23.2	21.1	—	—

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 66: ZY06 reheat capacity (5 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
1250	72	25.2	4.3	—	—	—	—	—	—	20.1	4.6	—	—	—	—	—	—
	67	21.8	4.1	0.0	0.1	0.2	0.3	0.5	—	16.9	4.4	0.0	0.0	0.1	0.2	0.3	—
	62	17.4	4.0	0.3	0.4	0.5	0.6	0.7	0.9	12.2	4.3	0.2	0.3	0.4	0.5	0.6	0.8
1500	72	27.3	4.1	—	—	—	—	—	—	22.3	4.3	—	—	—	—	—	—
	67	23.6	3.9	3.1	2.9	2.6	2.3	2.1	—	18.8	4.1	2.7	2.3	1.9	1.5	1.2	—
	62	18.8	3.8	6.2	5.9	5.7	5.4	5.1	4.9	13.7	4.1	3.8	3.4	3.1	2.7	2.3	1.5
	57	19.2	3.7	8.3	8.1	7.8	7.5	7.3	7.0	14.9	4.0	5.2	4.8	4.3	3.9	3.3	2.6
1750	72	29.4	3.9	1.7	2.3	3.0	3.6	—	—	24.5	4.1	0.3	0.3	0.3	0.2	—	—
	67	25.4	3.7	6.3	5.6	5.0	4.3	3.6	—	20.7	3.9	3.6	3.1	2.5	2.1	1.6	—
	62	20.2	3.6	12.1	11.5	10.8	10.2	9.5	8.9	15.1	3.8	4.9	4.9	4.9	4.9	4.9	4.9
	57	20.7	3.5	15.2	15.1	14.9	14.2	13.6	12.9	16.5	3.8	9.4	9.3	9.2	9.2	9.2	9.2
2000	72	31.5	3.7	2.3	3.3	4.4	5.4	—	—	26.8	3.8	1.2	1.1	1.0	0.8	—	—
	67	27.3	3.5	9.4	8.4	7.3	6.3	5.2	—	22.6	3.6	3.8	3.5	3.1	2.7	2.3	—
	62	21.7	3.4	18.1	17.0	16.0	15.0	13.9	12.9	16.6	3.6	11.7	11.3	10.9	10.5	10.1	9.7
	57	22.2	3.3	22.2	22.2	22.0	20.9	19.9	18.9	18.0	3.5	17.7	17.7	17.5	17.4	17.0	16.6
2250	72	31.7	3.6	2.6	3.8	5.0	6.1	—	—	26.5	3.8	2.4	2.2	1.8	1.6	—	—
	67	27.4	3.4	10.6	9.4	8.3	7.1	5.9	—	22.3	3.6	4.5	4.1	3.6	3.2	2.7	—
	62	21.8	3.4	20.0	19.2	18.1	16.9	15.7	14.5	16.3	3.5	13.8	13.2	12.6	12.1	11.7	11.2
	57	22.3	3.3	22.3	22.3	22.2	21.0	19.9	18.7	17.8	3.5	17.8	17.8	17.6	17.5	17.3	17.2
2500	72	31.9	3.6	2.9	4.2	5.5	6.8	—	—	26.1	3.7	2.7	2.5	2.1	1.6	—	—
	67	27.6	3.4	11.8	10.5	9.2	7.9	6.6	—	22.0	3.5	5.2	4.7	4.2	3.7	3.1	—
	62	22.0	3.3	22.0	21.4	20.1	18.8	17.5	16.2	16.0	3.5	16.0	15.2	14.3	13.7	13.2	12.7
	57	22.4	3.2	22.4	22.4	22.4	21.1	19.8	18.5	17.5	3.4	17.9	17.9	17.9	17.8	17.5	17.3

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 67: ZYA7 reheat capacity (6 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
35°F										45°F							
1500	77	53.4	2.9	9.5	7.3	5.0	—	—	—	56.9	3.6	5.4	3.6	1.8	—	—	—
	72	49.2	3.0	15.6	13.3	11.1	8.8	—	—	50.3	3.5	11.6	9.8	8.0	6.2	—	—
	67	44.9	3.1	21.7	19.4	17.2	14.9	12.6	—	43.6	3.4	17.7	15.9	14.1	12.3	10.5	—
	62	43.4	3.2	34.1	31.9	29.6	27.3	25.1	22.8	39.1	3.4	27.8	26.0	24.2	22.4	20.6	18.8
1800	77	52.1	2.9	10.2	7.9	5.6	—	—	—	57.0	3.6	5.9	3.9	1.9	—	—	—
	72	48.0	3.0	16.2	13.9	11.6	9.4	—	—	50.3	3.5	12.7	10.7	8.7	6.7	—	—
	67	44.0	3.1	22.3	20.0	17.7	15.4	13.1	—	43.7	3.4	19.4	17.4	15.4	13.4	11.4	—
	62	42.6	3.2	35.1	32.8	30.5	28.2	26.0	23.7	39.1	3.4	30.5	28.5	26.5	24.5	22.5	20.5
2100	57	38.9	3.2	38.9	37.7	35.4	33.1	30.8	28.5	36.0	3.3	34.8	32.9	30.9	28.9	26.9	24.9
	77	50.8	2.9	10.8	8.5	6.2	—	—	—	57.0	3.6	6.5	4.3	2.1	—	—	—
	72	46.9	3.0	16.8	14.5	12.2	9.9	—	—	50.4	3.5	13.8	11.6	9.4	7.2	—	—
	67	43.1	3.1	22.9	20.5	18.2	15.9	13.6	—	43.7	3.4	21.1	18.9	16.7	14.5	12.3	—
2400	62	41.9	3.2	36.1	33.8	31.5	29.1	26.8	24.5	39.2	3.4	33.1	30.9	28.7	26.5	24.3	22.1
	57	38.2	3.2	38.2	37.6	36.4	34.1	31.8	29.5	36.0	3.3	35.4	34.4	33.4	31.3	29.1	26.9
	77	49.4	2.9	11.5	9.1	6.8	—	—	—	57.1	3.5	7.1	4.7	2.3	—	—	—
	72	45.8	3.0	17.5	15.1	12.8	10.4	—	—	50.4	3.4	14.9	12.5	10.1	7.8	—	—
2700	67	42.1	3.1	23.4	21.1	18.8	16.4	14.1	—	43.8	3.4	22.8	20.4	18.0	15.6	13.2	—
	62	41.1	3.2	37.1	34.7	32.4	30.1	27.7	25.4	39.2	3.3	35.7	33.3	30.9	28.5	26.1	23.7
	57	37.5	3.1	37.5	37.5	37.5	35.2	32.8	30.5	36.0	3.3	36.0	36.0	36.0	33.6	31.3	28.9
	72	44.2	2.9	18.6	16.2	13.8	11.3	—	—	49.9	3.4	16.3	13.7	11.1	8.5	—	—
3000	67	40.8	3.0	24.9	22.4	20.0	17.6	15.2	—	43.3	3.3	24.9	22.3	19.7	17.1	14.5	—
	62	39.9	3.2	37.9	36.8	34.6	32.2	29.8	27.4	38.8	3.3	37.0	35.8	33.8	31.2	28.6	26.0
	57	36.4	3.1	36.4	36.4	36.4	34.0	31.6	29.2	35.6	3.3	35.6	35.6	35.6	33.0	30.4	27.8
	72	42.7	2.9	19.7	17.2	14.7	12.3	—	—	49.3	3.4	17.7	14.9	12.0	9.2	—	—
3300	67	39.5	3.0	26.3	23.8	21.3	18.9	16.4	—	42.8	3.3	27.0	24.2	21.4	18.6	15.8	—
	62	38.8	3.1	38.8	38.8	36.9	34.4	31.9	29.5	38.3	3.3	38.3	38.3	36.7	33.9	31.1	28.2
	57	35.4	3.1	35.4	35.4	35.4	32.9	30.4	28.0	35.2	3.3	35.2	35.2	35.2	32.4	29.6	26.8
	55°F										65°F						
1500	77	60.4	4.2	1.2	—	—	—	—	—	54.2	4.3	—	—	—	—	—	—
	72	51.4	3.9	7.5	6.2	4.8	3.5	—	—	46.4	4.1	3.4	2.5	1.5	0.6	—	—
	67	42.4	3.7	13.8	12.4	11.1	9.8	8.4	—	38.6	3.9	10.0	9.0	8.1	7.2	6.2	—
	62	34.8	3.5	21.6	20.2	18.9	17.6	16.2	14.9	31.7	3.8	17.4	16.4	15.5	14.5	13.6	12.7
1800	77	61.9	4.2	1.7	0.0	—	—	—	—	55.2	4.3	3.6	2.5	1.4	—	—	—
	72	52.6	3.9	9.1	7.4	5.7	4.0	—	—	47.3	4.1	4.2	2.9	1.7	0.4	—	—
	67	43.4	3.6	16.6	14.9	13.2	11.5	9.8	—	39.4	3.9	12.5	11.3	10.0	8.7	7.5	—
	62	35.6	3.5	25.8	24.1	22.4	20.7	19.0	17.3	32.3	3.8	21.8	20.6	19.3	18.0	16.7	15.5
2100	57	33.0	3.5	29.7	28.0	26.3	24.6	22.9	21.2	30.5	3.8	25.2	23.9	22.6	21.4	20.1	18.8
	77	63.3	4.2	2.2	0.1	—	—	—	—	56.2	4.3	4.3	2.9	1.6	—	—	—
	72	53.8	3.9	10.8	8.7	6.6	4.6	—	—	48.1	4.1	5.0	3.4	1.8	0.2	—	—
	67	44.4	3.6	19.4	17.3	15.2	13.1	11.1	—	40.1	3.9	15.1	13.5	11.9	10.3	8.7	—
2400	62	36.5	3.5	30.0	28.0	25.9	23.8	21.8	19.7	32.9	3.8	26.3	24.7	23.1	21.5	19.9	18.3
	57	33.8	3.5	32.2	31.3	30.5	28.4	26.3	24.2	31.0	3.7	28.4	27.7	27.1	25.5	23.9	22.3
	77	64.7	4.2	2.6	0.2	—	—	—	—	57.2	4.3	5.0	3.3	1.7	—	—	—
	72	55.1	3.9	12.4	10.0	7.5	5.1	—	—	49.0	4.1	5.8	3.9	2.0	—	—	—
2700	67	45.4	3.6	22.2	19.7	17.3	14.8	12.4	—	40.8	3.9	17.6	15.7	13.8	11.8	9.9	—
	62	37.3	3.5	34.3	31.9	29.4	27.0	24.5	22.1	33.5	3.8	30.7	28.8	26.9	25.0	23.0	21.1
	57	34.6	3.5	34.6	34.6	34.6	32.1	29.7	27.3	31.6	3.7	31.6	31.6	31.6	29.6	27.7	25.8
	72	55.5	3.9	14.0	11.2	8.4	5.6	—	—	49.0	4.1	6.6	4.4	2.1	—	—	—
3000	67	45.7	3.6	25.0	22.2	19.4	16.6	13.8	—	40.8	3.9	20.2	17.9	15.7	13.4	11.2	—
	62	37.6	3.5	36.1	34.9	33.0	30.2	27.4	24.6	33.5	3.8	32.1	31.2	29.9	27.6	25.4	23.1
	57	34.9	3.5	34.9	34.9	34.9	32.1	29.2	26.4	31.6	3.7	31.6	31.6	31.6	29.3	27.1	24.8
	72	55.9	3.9	15.7	12.5	9.3	6.2	—	—	49.1	4.1	7.5	4.9	2.3	—	—	—
3300	67	46.1	3.6	27.8	24.6	21.5	18.3	15.1	—	40.9	3.9	22.8	20.2	17.6	15.0	12.4	—
	62	37.9	3.5	37.9	37.9	36.5	33.4	30.2	27.0	33.5	3.8	33.5	33.5	32.9	30.3	27.7	25.1
	57	35.1	3.5	35.1	35.1	35.1	32.0	28.8	25.6	31.6	3.7	31.6	31.6	31.6	29.1	26.5	23.9

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 68: ZYA7 reheat capacity (6 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
1500	72	41.5	4.3	5.2	4.7	4.3	3.8	—	—	36.5	4.4	2.0	1.9	1.8	1.7	—	—
	67	34.9	4.1	6.2	5.6	5.1	4.6	4.0	—	31.2	4.4	2.4	2.2	2.1	2.0	1.8	—
	62	28.6	4.0	13.2	12.6	12.1	11.5	11.0	10.5	25.6	4.3	9.0	8.8	8.7	8.5	8.4	8.2
1800	72	41.9	4.3	7.2	6.5	5.7	5.0	—	—	36.6	4.4	3.8	3.5	3.1	2.8	—	—
	67	35.3	4.1	8.5	7.7	6.8	6.0	5.2	—	31.3	4.4	4.5	4.1	3.7	3.3	2.9	—
	62	29.0	4.0	17.8	17.0	16.2	15.3	14.5	13.7	25.6	4.3	13.9	13.5	13.1	12.7	12.3	11.9
2100	72	42.4	4.3	9.1	8.2	7.2	6.3	—	—	36.7	4.4	5.6	5.0	4.5	3.9	—	—
	67	35.7	4.1	10.8	9.7	8.6	7.4	6.3	—	31.4	4.4	6.5	5.9	5.2	4.6	3.9	—
	62	29.3	4.0	22.5	21.4	20.3	19.1	18.0	16.9	25.7	4.3	18.8	18.1	17.4	16.8	16.1	15.5
2400	72	42.9	4.3	11.1	9.9	8.7	7.5	—	—	36.8	4.4	7.4	6.6	5.8	5.0	—	—
	67	36.1	4.1	13.1	11.7	10.3	8.9	7.4	—	31.5	4.4	8.6	7.7	6.8	5.9	5.0	—
	62	29.6	4.0	27.2	25.8	24.4	22.9	21.5	20.1	25.8	4.3	23.7	22.8	21.8	20.9	20.0	19.1
2700	72	42.6	4.3	13.0	11.6	10.1	8.7	—	—	36.1	4.4	9.1	8.1	7.1	6.1	—	—
	67	35.9	4.1	15.4	13.7	12.0	10.3	8.6	—	30.9	4.4	10.6	9.5	8.3	7.1	6.0	—
	62	29.4	4.0	28.2	27.5	26.8	25.1	23.3	21.6	25.3	4.3	24.3	23.8	23.7	22.5	21.3	20.2
3000	72	42.3	4.3	14.9	13.2	11.6	9.9	—	—	35.4	4.4	10.9	9.7	8.4	7.2	—	—
	67	35.6	4.1	17.7	15.7	13.7	11.7	9.7	—	30.4	4.4	12.7	11.3	9.8	8.4	7.0	—
	62	29.2	4.0	29.2	29.2	29.2	27.2	25.2	23.2	24.8	4.2	24.8	24.8	24.8	24.1	22.7	21.3

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 69: ZY08 reheat capacity (7.5 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
35°F										45°F							
1875	77	78.5	3.2	7.0	4.0	1.1	—	—	—	70.5	3.4	1.7	—	—	—	—	
	72	70.8	3.0	18.1	15.2	12.2	9.2	—	—	63.9	3.2	11.7	9.5	7.4	5.2	—	
	67	63.1	2.8	29.3	26.3	23.3	20.3	17.3	—	57.3	3.1	21.6	19.5	17.3	15.2	13.1	
	62	59.2	2.8	40.8	37.9	34.9	31.9	28.9	25.9	51.4	2.9	32.4	30.3	28.1	26.0	23.9	
2250	77	79.6	3.2	8.4	5.1	1.9	—	—	—	72.7	3.3	2.0	—	—	—	—	
	72	71.8	3.0	20.7	17.4	14.2	10.9	—	—	65.9	3.2	13.8	11.3	8.7	6.2	—	
	67	63.9	2.8	33.0	29.8	26.5	23.3	20.0	—	59.1	3.0	25.7	23.1	20.6	18.0	15.5	
	62	60.1	2.7	45.8	42.5	39.3	36.0	32.8	29.5	53.0	2.9	38.5	35.9	33.4	30.8	28.3	
2625	57	52.7	2.8	50.9	47.6	44.4	41.1	37.9	34.6	47.3	2.9	43.2	40.7	38.1	35.6	33.1	
	77	80.7	3.1	9.7	6.2	2.7	—	—	—	74.9	3.2	2.3	—	—	—	—	
	72	72.7	2.9	23.2	19.7	16.2	12.7	—	—	67.9	3.1	16.0	13.1	10.1	7.2	—	
	67	64.8	2.7	36.7	33.2	29.7	26.2	22.7	—	60.9	2.9	29.7	26.8	23.8	20.9	17.9	
3000	62	61.0	2.7	50.7	47.2	43.7	40.2	36.6	33.1	54.6	2.8	44.5	41.6	38.6	35.7	32.8	
	57	53.4	2.7	52.5	50.9	49.3	45.8	42.3	38.7	48.7	2.8	46.7	45.4	44.1	41.2	38.3	
	77	81.8	3.1	11.0	7.3	3.5	—	—	—	77.1	3.1	2.6	—	—	—	—	
	72	73.7	2.9	25.8	22.0	18.2	14.5	—	—	69.9	3.0	18.2	14.8	11.5	8.2	—	
3375	67	65.6	2.7	40.5	36.7	32.9	29.2	25.4	—	62.7	2.9	33.7	30.4	27.0	23.7	20.4	
	62	61.9	2.6	55.6	51.8	48.0	44.3	40.5	36.7	56.2	2.7	50.6	47.2	43.9	40.5	37.2	
	57	54.2	2.7	54.2	54.2	54.2	50.4	46.6	42.9	50.1	2.7	50.1	50.1	50.1	46.8	43.5	
	72	74.8	2.9	27.6	23.8	20.0	16.2	—	—	70.7	3.0	20.2	16.5	12.8	9.1	—	
3750	67	66.6	2.7	42.9	39.1	35.2	31.4	27.6	—	63.4	2.8	37.6	33.9	30.1	26.4	22.7	
	62	62.7	2.6	59.6	57.7	52.3	48.5	44.7	40.8	56.8	2.7	54.0	52.4	48.9	45.2	41.5	
	57	55.0	2.7	55.0	55.0	55.0	51.1	47.3	43.5	50.7	2.7	50.7	50.7	50.7	47.0	43.3	
	72	75.8	2.8	29.5	25.6	21.7	17.9	—	—	71.5	2.9	22.3	18.2	14.1	10.0	—	
3750	67	67.5	2.7	45.3	41.4	37.5	33.6	29.8	—	64.2	2.8	41.4	37.3	33.2	29.1	25.1	
	62	63.6	2.6	63.6	63.6	56.6	52.7	48.8	44.9	57.5	2.7	57.5	57.5	53.9	49.8	45.8	
	57	55.7	2.7	55.7	55.7	55.7	51.9	48.0	44.1	51.3	2.7	51.3	51.3	51.3	47.2	43.1	
	39.0																
55°F										65°F							
1875	77	62.4	3.5	—	—	—	—	—	—	58.9	3.8	—	—	—	—	—	
	72	57.0	3.4	5.2	3.9	2.6	1.3	—	—	52.8	3.6	2.6	1.7	0.7	—	—	
	67	51.6	3.4	14.0	12.7	11.4	10.1	8.8	—	46.8	3.4	10.6	9.7	8.7	7.8	6.9	
	62	43.5	3.1	24.0	22.7	21.4	20.1	18.8	17.5	39.7	3.2	19.2	18.3	17.4	16.4	15.5	
2250	62	43.5	3.1	24.0	22.7	21.4	20.1	18.8	17.5	39.7	3.2	19.2	18.3	17.4	16.4	15.5	
	77	65.8	3.4	6.4	4.7	3.0	—	—	—	62.1	3.6	3.4	2.1	0.7	—	—	
	72	60.0	3.3	7.0	5.1	3.3	1.5	—	—	55.7	3.5	3.8	2.3	0.8	—	—	
	67	54.3	3.3	18.3	16.5	14.6	12.8	11.0	—	49.4	3.3	15.2	13.6	12.1	10.6	9.1	
2625	62	45.8	3.0	31.2	29.3	27.5	25.7	23.8	22.0	41.9	3.1	27.3	25.8	24.3	22.7	21.2	
	57	41.9	3.0	35.6	33.8	31.9	30.1	28.2	26.4	39.3	3.0	30.7	29.2	27.7	26.2	24.7	
	77	69.1	3.3	8.0	5.9	3.7	—	—	—	65.3	3.5	4.5	2.6	0.8	—	—	
	72	63.1	3.2	8.8	6.4	4.0	1.7	—	—	58.6	3.3	5.0	2.9	0.9	—	—	
3000	67	57.1	3.2	22.6	20.3	17.9	15.5	13.1	—	51.9	3.2	19.7	17.6	15.5	13.4	11.3	
	62	48.2	2.9	38.4	36.0	33.6	31.2	28.9	26.5	44.0	3.0	35.3	33.2	31.1	29.0	26.9	
	57	44.0	2.9	40.9	39.9	39.0	36.6	34.3	31.9	41.3	2.9	37.1	36.3	35.5	33.4	31.4	
	77	72.4	3.2	9.7	7.0	4.4	—	—	—	68.5	3.3	5.6	3.2	0.8	—	—	
3375	72	66.1	3.1	10.6	7.7	4.8	1.9	—	—	61.5	3.2	6.3	3.6	0.9	—	—	
	67	59.8	3.1	27.0	24.1	21.1	18.2	15.3	—	54.5	3.0	24.2	21.6	18.9	16.2	13.5	
	62	50.5	2.8	45.6	42.6	39.7	36.8	33.9	31.0	46.2	2.8	43.4	40.7	38.0	35.4	32.7	
	57	46.1	2.8	46.1	46.1	46.1	43.2	40.3	37.4	43.4	2.8	43.4	43.4	43.4	40.7	38.0	
3750	35.3																
	72	66.7	3.1	12.9	9.3	5.7	2.1	—	—	62.4	3.1	7.7	4.4	1.0	—	—	
	67	60.3	3.0	32.3	28.7	25.0	21.4	17.8	—	55.2	3.0	29.5	26.2	22.8	19.5	16.1	
	62	50.9	2.8	48.4	47.0	45.5	41.9	38.3	34.7	46.8	2.8	45.4	44.1	42.8	39.4	36.0	
3750	57	46.5	2.7	46.5	46.5	46.5	42.9	39.3	35.7	44.0	2.7	44.0	44.0	44.0	40.6	37.3	
	72	67.2	3.0	15.2	10.8	6.5	2.2	—	—	63.2	3.1	9.2	5.1	1.1	—	—	
	67	60.8	2.9	37.6	33.3	29.0	24.6	20.3	—	56.0	2.9	34.8	30.8	26.8	22.7	18.7	
	62	51.3	2.7	51.3	51.3	51.3	47.0	42.7	38.4	47.5	2.7	47.5	47.5	47.5	43.4	39.4	
3750	35.3																
	57	46.9	2.6	46.9	46.9	46.9	42.6	38.3	34.0	44.6	2.7	44.6	44.6	44.6	40.5	36.5	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 70: ZY08 reheat capacity (7.5 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> ( MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
1875	72	48.7	3.8	6.2	5.8	5.3	4.8	4.3	—	44.5	3.9	3.2	3.1	2.9	2.7	2.6	—
	67	42.0	3.5	7.2	6.7	6.1	5.5	5.0	—	37.2	3.5	3.8	3.7	3.5	3.3	3.1	—
	62	35.9	3.3	14.5	13.9	13.3	12.8	12.2	11.7	32.0	3.3	9.7	9.5	9.3	9.1	8.9	8.7
2250	72	51.4	3.6	10.4	9.3	8.3	7.3	6.2	—	47.1	3.7	7.4	6.7	5.9	5.2	4.5	—
	67	44.4	3.3	12.0	10.8	9.6	8.4	7.2	—	39.4	3.4	8.8	8.0	7.1	6.2	5.4	—
	62	37.9	3.1	23.4	22.2	21.0	19.8	18.6	17.4	33.9	3.1	19.5	18.6	17.8	16.9	16.0	15.2
	57	36.7	3.1	25.9	24.7	23.5	22.3	21.1	19.9	34.2	3.2	21.0	20.2	19.3	18.4	17.6	16.7
2625	72	54.1	3.4	14.5	12.9	11.3	9.8	8.2	—	49.7	3.5	11.6	10.3	9.0	7.7	6.4	—
	67	46.7	3.2	16.8	14.9	13.1	11.3	9.5	—	41.6	3.2	13.8	12.3	10.7	9.2	7.7	—
	62	39.9	3.0	32.3	30.5	28.7	26.9	25.0	23.2	35.8	3.0	29.3	27.7	26.2	24.7	23.1	21.6
	57	38.7	3.0	33.3	32.7	32.1	30.3	28.4	26.6	36.0	3.0	29.5	29.0	28.6	27.1	25.5	24.0
3000	72	56.9	3.3	18.6	16.5	14.4	12.2	10.1	—	52.3	3.3	15.7	13.9	12.0	10.2	8.3	—
	67	49.1	3.0	21.5	19.1	16.6	14.2	11.7	—	43.8	3.0	18.8	16.6	14.4	12.2	10.0	—
	62	41.9	2.8	41.2	38.8	36.3	33.9	31.4	29.0	37.6	2.8	37.6	36.8	34.6	32.4	30.2	28.0
	57	40.7	2.8	40.7	40.7	40.7	38.2	35.8	33.3	37.9	2.8	37.9	37.9	37.9	35.7	33.5	31.3
3375	72	58.0	3.2	23.2	20.5	17.8	15.1	12.4	—	53.7	3.3	20.2	17.8	15.4	13.0	10.6	—
	67	50.1	3.0	26.8	23.7	20.6	17.5	14.3	—	45.0	2.9	24.1	21.2	18.4	15.5	12.6	—
	62	42.8	2.8	42.4	41.2	40.0	36.9	33.7	30.6	38.7	2.8	38.7	38.3	37.2	34.3	31.5	28.6
	57	41.5	2.8	41.5	41.5	41.5	38.4	35.2	32.1	39.0	2.8	39.0	39.0	39.0	36.1	33.2	30.4
3750	72	59.2	3.1	27.7	24.5	21.2	17.9	14.6	—	55.2	3.2	24.6	21.7	18.7	15.8	12.8	—
	67	51.1	2.9	32.1	28.3	24.5	20.8	17.0	—	46.3	2.9	29.4	25.9	22.3	18.8	15.3	—
	62	43.6	2.7	43.6	43.6	43.6	39.8	36.0	32.3	39.8	2.7	39.8	39.8	39.8	36.3	32.7	29.2
	57	42.3	2.7	42.3	42.3	42.3	38.5	34.7	30.9	40.0	2.7	40.0	40.0	40.0	36.5	33.0	29.4

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 71: ZY09 reheat capacity (8.5 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
35°F										45°F							
2125	77	66.9	3.5	2.4	0.9	—	—	—	—	62.0	3.8	2.2	0.8	—	—	—	—
	72	59.8	3.4	13.9	11.3	8.8	6.2	—	—	56.5	3.6	8.0	6.1	4.2	2.3	—	—
	67	52.8	3.3	25.4	22.9	20.3	17.7	15.1	—	51.0	3.5	19.0	17.1	15.2	13.3	11.4	—
	62	49.3	3.2	38.7	36.1	33.5	30.9	28.4	25.8	48.3	3.3	30.8	28.9	27.0	25.0	23.1	21.2
2550	77	70.0	3.4	3.6	1.0	0.0	—	—	—	64.6	3.7	3.6	1.3	0.0	—	—	—
	72	62.7	3.3	15.8	13.1	10.5	7.8	—	—	58.9	3.5	9.5	7.2	5.0	2.7	—	—
	67	55.3	3.2	27.9	25.3	22.6	19.9	17.3	—	53.2	3.4	22.6	20.3	18.1	15.8	13.5	—
	62	51.7	3.1	42.1	39.5	36.8	34.1	31.5	28.8	50.3	3.2	36.5	34.2	32.0	29.7	27.5	25.2
	57	51.9	3.1	49.8	47.1	44.4	41.8	39.1	36.4	50.7	3.2	44.0	41.7	39.5	37.2	35.0	32.7
2975	77	73.2	3.3	4.9	2.1	—	—	—	—	67.2	3.6	4.2	2.5	—	—	—	—
	72	65.5	3.2	17.7	14.9	12.1	9.4	—	—	61.3	3.4	10.9	8.3	5.7	3.1	—	—
	67	57.8	3.1	30.4	27.7	24.9	22.1	19.4	—	55.3	3.3	26.1	23.5	20.9	18.3	15.7	—
	62	54.1	3.1	45.6	42.9	40.1	37.3	34.6	31.8	52.3	3.2	42.2	39.6	37.0	34.4	31.8	29.2
	57	54.2	3.0	53.2	51.8	48.3	45.5	42.7	40.0	52.8	3.1	49.4	48.3	45.7	43.1	40.5	37.9
3400	77	76.4	3.2	6.2	3.3	0.4	—	—	—	69.8	3.5	4.8	2.6	0.5	—	—	—
	72	68.3	3.2	19.6	16.7	13.8	11.0	—	—	63.7	3.3	12.4	9.5	6.5	3.6	—	—
	67	60.3	3.1	33.0	30.1	27.2	24.3	21.5	—	57.5	3.2	29.6	26.7	23.7	20.8	17.8	—
	62	56.4	3.0	49.1	46.3	43.4	40.5	37.7	34.8	54.4	3.1	47.9	44.9	42.0	39.1	36.1	33.2
	57	56.6	3.0	56.6	56.5	52.1	49.2	46.4	43.5	54.8	3.0	54.8	54.8	51.9	48.9	46.0	43.1
3825	72	70.4	3.1	22.3	19.3	16.2	13.1	—	—	65.8	3.3	14.4	11.0	7.6	4.3	—	—
	67	62.1	3.0	37.0	33.9	30.9	27.8	24.8	—	59.4	3.1	34.5	31.1	27.7	24.4	21.0	—
	62	58.1	3.0	54.4	53.0	49.7	46.7	43.6	40.6	56.2	3.0	53.0	51.5	49.1	45.7	42.4	39.0
	57	58.3	2.9	58.3	58.2	56.0	53.0	49.9	46.8	56.7	3.0	56.7	56.7	55.2	51.9	48.5	45.1
4250	72	72.4	3.1	25.1	21.8	18.6	15.3	—	—	68.0	3.2	16.3	12.5	8.7	4.9	—	—
	67	63.9	3.0	41.1	37.8	34.6	31.3	28.1	—	61.4	3.1	39.4	35.6	31.8	28.0	24.2	—
	62	59.8	2.9	59.8	59.8	56.1	52.8	49.6	46.3	58.1	3.0	58.1	58.1	56.2	52.4	48.6	44.8
	57	60.0	2.9	60.0	60.0	56.7	53.5	50.2	—	58.6	2.9	58.6	58.6	58.6	54.8	51.0	47.2
55°F										65°F							
2125	77	57.1	4.0	—	—	—	—	—	—	54.7	4.1	—	—	—	—	—	—
	72	53.2	3.8	2.1	0.8	0.4	—	—	—	51.2	3.9	1.1	0.4	0.0	—	—	—
	67	49.3	3.7	12.7	11.4	10.2	8.9	7.7	—	47.7	3.7	11.1	10.0	8.9	7.8	6.6	—
	62	47.2	3.5	22.9	21.7	20.4	19.2	17.9	16.7	44.8	3.5	20.6	19.5	18.4	17.3	16.2	15.1
2550	77	59.2	3.9	2.9	1.2	—	—	—	—	57.1	4.0	0.3	—	—	—	—	—
	72	55.1	3.7	3.1	1.3	0.4	0.1	—	—	53.5	3.8	2.2	0.0	—	—	—	—
	67	51.1	3.5	17.2	15.3	13.5	11.7	9.8	—	49.8	3.6	15.8	14.1	12.4	10.7	9.0	—
	62	48.9	3.4	30.8	29.0	27.1	25.3	23.5	21.6	46.8	3.4	29.2	27.5	25.9	24.2	22.5	20.8
	57	49.6	3.3	38.2	36.4	34.5	32.7	30.9	29.0	47.1	3.3	34.2	32.5	30.8	29.1	27.4	25.7
2975	77	61.2	3.8	3.9	1.6	—	—	—	—	59.5	3.9	0.7	0.0	—	—	—	—
	72	57.1	3.6	4.2	1.8	0.7	0.4	—	—	55.7	3.6	2.4	0.1	0.1	—	—	—
	67	52.9	3.4	21.7	19.3	16.9	14.4	12.0	—	51.9	3.4	20.5	18.2	16.0	13.7	11.4	—
	62	50.6	3.3	38.7	36.3	33.9	31.4	29.0	26.6	48.7	3.3	37.8	35.5	33.3	31.0	28.8	26.5
	57	51.4	3.2	45.6	44.7	43.1	40.7	38.3	35.8	49.0	3.2	42.6	41.4	39.6	37.3	35.0	32.8
3400	77	63.3	3.7	4.9	2.1	—	—	—	—	61.9	3.7	0.9	0.0	—	—	—	—
	72	59.0	3.5	5.2	2.2	1.2	0.9	—	—	57.9	3.5	3.1	0.2	0.1	—	—	—
	67	54.7	3.3	26.2	23.2	20.2	17.2	14.2	—	54.0	3.3	25.1	22.3	19.5	16.7	13.9	—
	62	52.4	3.1	46.6	43.6	40.6	37.6	34.6	31.6	50.7	3.1	46.4	43.5	40.7	37.9	35.1	32.2
	57	53.1	3.1	53.1	53.1	51.7	48.7	45.7	42.6	51.0	3.1	51.0	50.3	48.3	45.5	42.7	39.8
3825	72	61.3	3.4	6.4	2.7	—	—	—	—	59.1	3.4	3.9	0.4	—	—	—	—
	67	56.8	3.3	31.9	28.3	24.6	20.9	17.2	—	55.0	3.2	30.9	27.4	23.9	20.3	16.8	—
	62	54.4	3.1	51.5	50.0	48.5	44.8	41.1	37.5	51.7	3.1	49.6	48.1	46.7	43.2	39.7	36.1
	57	55.1	3.0	55.1	55.1	54.4	50.7	47.1	43.4	52.0	3.0	52.0	51.7	50.7	47.2	43.6	40.1
4250	72	63.6	3.4	7.6	3.2	—	—	—	—	60.2	3.4	4.7	0.5	—	—	—	—
	67	58.9	3.2	37.6	33.3	29.0	24.6	20.3	—	56.1	3.2	36.7	32.4	28.2	24.0	19.7	—
	62	56.4	3.0	56.4	56.4	56.4	52.0	47.7	43.4	52.7	3.0	52.7	52.7	52.7	48.5	44.3	40.1
	57	57.2	2.9	57.2	57.2	57.2	52.8	48.5	44.1	53.1	3.0	53.1	53.1	53.1	48.8	44.6	40.4

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 72: ZY09 reheat capacity (8.5 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
2125	72	49.2	4.0	0.2	8.0	—	—	—	—	47.2	4.1	0.1	0.0	—	—	—	—
	67	46.1	3.7	9.5	8.5	7.6	6.6	5.6	—	44.5	3.8	7.9	7.1	6.2	5.4	4.6	—
	62	42.5	3.5	18.4	17.4	16.4	15.5	14.5	13.5	40.1	3.5	16.1	15.3	14.4	13.6	12.8	11.9
2550	72	51.8	3.8	0.4	—	—	—	—	—	50.1	3.9	—	—	—	—	—	—
	67	48.5	3.6	14.3	12.8	11.3	9.8	8.2	—	47.1	3.6	12.9	11.6	10.2	8.8	7.4	—
	62	44.7	3.4	27.6	26.1	24.6	23.0	21.5	20.0	42.5	3.4	26.0	24.6	23.3	21.9	20.5	19.2
	57	44.6	3.4	30.1	28.6	27.0	25.5	24.0	22.5	42.0	3.4	26.0	24.7	23.3	21.9	20.5	19.2
2975	72	54.3	3.7	0.7	—	—	—	—	—	52.9	3.7	—	—	—	—	—	—
	67	50.8	3.4	19.2	17.1	15.0	13.0	10.9	—	49.8	3.4	18.0	16.0	14.1	12.2	10.3	—
	62	46.8	3.3	36.9	34.8	32.7	30.6	28.5	26.5	44.9	3.3	36.0	34.0	32.1	30.2	28.3	26.4
	57	46.7	3.2	39.5	38.1	36.0	33.9	31.8	29.7	44.4	3.3	36.4	34.8	32.5	30.5	28.6	26.7
3400	72	56.8	3.5	0.9	—	—	—	—	—	55.8	3.6	—	—	—	—	—	—
	67	53.2	3.3	24.1	21.4	18.8	16.1	13.5	—	52.5	3.3	23.0	20.5	18.1	15.6	13.1	—
	62	49.0	3.1	46.1	43.5	40.8	38.2	35.6	32.9	47.4	3.1	45.9	43.4	41.0	38.5	36.1	33.6
	57	48.9	3.1	48.9	47.6	45.0	42.3	39.7	37.0	46.8	3.1	46.8	44.9	41.6	39.2	36.7	34.2
3825	72	56.9	3.5	1.4	—	—	—	—	—	54.7	3.5	—	—	—	—	—	—
	67	53.2	3.2	29.9	26.5	23.1	19.7	16.4	—	51.5	3.2	28.9	25.6	22.4	19.2	15.9	—
	62	49.1	3.1	47.6	46.3	45.0	41.6	38.2	34.8	46.4	3.0	45.7	44.4	43.2	40.0	36.7	33.5
	57	49.0	3.0	49.0	48.3	47.0	43.6	40.2	36.8	45.9	3.1	45.9	44.9	43.2	40.0	36.8	33.6
4250	72	56.9	3.4	1.9	—	—	—	—	—	53.6	3.4	—	—	—	—	—	—
	67	53.3	3.2	35.7	31.6	27.5	23.4	19.2	—	50.5	3.2	34.7	30.7	26.7	22.7	18.7	—
	62	49.1	3.0	49.1	49.1	49.1	45.0	40.9	36.7	45.4	3.0	45.4	45.4	45.4	41.4	37.4	33.4
	57	49.0	3.0	49.0	49.0	49.0	44.9	40.7	36.6	44.9	3.0	44.9	44.9	44.9	40.9	36.9	32.9



**Table 73: ZY12 reheat capacity (10 ton, 35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFMWB (°F)		Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
35°F										45°F							
2500	77	83.9	3.9	4.4	2.0	—	—	—	—	83.0	4.0	4.3	2.0	—	—	—	—
	72	79.7	3.8	14.0	11.6	9.2	6.8	—	—	76.7	3.9	7.6	5.9	4.2	2.6	—	—
	67	75.5	3.6	23.7	21.3	18.9	16.4	14.0	—	70.4	3.7	17.5	15.9	14.2	12.5	10.9	—
	62	67.7	3.5	34.6	32.2	29.8	27.4	25.0	22.6	62.1	3.6	28.2	26.5	24.9	23.2	21.5	19.9
3000	77	88.0	3.8	6.5	3.4	0.3	—	—	—	86.8	4.0	6.4	3.4	0.3	—	—	—
	72	83.6	3.7	19.3	16.2	13.0	9.9	—	—	80.3	3.8	10.7	8.3	5.9	3.6	—	—
	67	79.1	3.5	32.0	28.9	25.8	22.7	19.5	—	73.7	3.7	24.8	22.4	20.0	17.6	15.2	—
	62	71.0	3.5	46.6	43.5	40.4	37.2	34.1	31.0	65.0	3.5	39.8	37.4	35.0	32.6	30.2	27.9
3500	57	59.5	3.6	49.1	45.9	42.8	39.7	36.6	33.5	57.0	3.6	44.1	41.7	39.3	36.9	34.5	32.1
	77	92.1	3.7	8.7	4.8	1.0	—	—	—	90.7	3.9	8.5	4.8	1.0	—	—	—
	72	87.4	3.6	24.5	20.7	16.9	13.0	—	—	83.9	3.8	13.9	10.8	7.7	4.6	—	—
	67	82.8	3.5	40.4	36.5	32.7	28.9	25.1	—	77.0	3.6	32.0	28.9	25.8	22.7	19.6	—
4000	62	74.2	3.4	58.6	54.8	50.9	47.1	43.3	39.4	67.9	3.5	51.4	48.3	45.2	42.1	38.9	35.8
	57	62.2	3.5	57.0	55.4	53.9	50.0	46.2	42.4	59.5	3.5	53.1	51.9	50.7	47.6	44.4	41.3
	77	96.1	3.7	10.8	6.2	1.7	—	—	—	94.6	3.8	10.6	6.1	1.7	—	—	—
	72	91.3	3.5	29.8	25.2	20.7	16.1	—	—	87.4	3.7	17.1	13.2	9.4	5.6	—	—
4500	67	86.4	3.4	48.7	44.2	39.6	35.1	30.6	—	80.3	3.5	39.3	35.4	31.6	27.8	23.9	—
	62	77.5	3.3	70.6	66.1	61.5	57.0	52.4	47.9	70.8	3.4	63.0	59.2	55.3	51.5	47.7	43.8
	57	64.9	3.5	64.9	64.9	64.9	60.4	55.9	51.3	62.1	3.4	62.1	62.1	62.1	58.2	54.4	50.6
	72	89.7	3.6	23.2	24.8	26.4	27.9	—	—	88.3	3.7	18.9	14.6	10.4	6.1	—	—
5000	67	84.6	3.5	45.3	40.9	36.5	32.0	27.6	—	81.1	3.5	43.4	39.2	34.9	30.7	26.4	—
	62	76.9	3.4	40.5	37.8	30.8	32.4	34.0	35.6	71.4	3.4	67.6	65.4	61.1	56.9	52.6	48.4
	57	68.6	3.6	33.9	33.9	33.9	33.9	33.9	33.9	62.7	3.4	62.7	62.7	62.7	58.4	54.1	49.9
	72	93.0	3.8	21.6	16.7	11.9	3.6	—	—	89.1	3.7	20.7	16.0	11.4	6.7	—	—
5500	67	88.0	3.6	51.2	46.2	41.2	36.1	31.1	—	81.8	3.5	47.6	42.9	38.3	33.6	28.9	—
	62	79.0	3.6	79.0	78.4	73.3	68.2	63.1	58.0	72.1	3.4	72.1	71.6	67.0	62.3	57.6	52.9
	57	66.2	3.7	66.2	66.2	66.2	61.3	56.4	51.5	63.2	3.4	63.2	63.2	63.2	58.6	53.9	49.2
55°F										65°F							
2500	77	82.0	4.2	1.0	0.1	—	—	—	—	77.5	4.2	0.9	0.1	—	—	—	—
	72	73.7	4.0	1.1	0.2	—	—	—	—	68.9	4.0	1.0	0.1	—	—	—	—
	67	65.4	3.8	11.4	10.5	9.6	8.6	7.7	—	60.2	3.8	7.4	6.8	6.3	5.8	5.3	—
	62	56.4	3.6	21.8	20.9	20.0	19.0	18.1	17.2	51.8	3.6	14.7	14.2	13.7	13.1	12.6	12.1
3000	77	85.7	4.1	1.9	0.5	—	—	—	—	80.8	4.2	1.8	0.5	—	—	—	—
	72	77.0	3.9	2.2	0.5	—	—	—	—	71.7	4.0	2.0	0.5	—	—	—	—
	67	68.3	3.8	17.5	15.9	14.2	12.6	10.9	—	62.7	3.8	13.6	12.3	11.1	9.8	8.6	—
	62	59.0	3.6	33.0	31.3	29.7	28.0	26.4	24.7	54.0	3.6	26.8	25.5	24.3	23.0	21.8	20.5
3500	57	54.5	3.5	39.1	37.4	35.7	34.1	32.4	30.8	51.0	3.5	31.9	30.6	29.4	28.1	26.9	25.6
	77	89.3	4.1	2.9	0.8	—	—	—	—	84.0	4.1	2.8	0.8	—	—	—	—
	72	80.3	3.9	3.3	0.9	—	—	—	—	74.6	3.9	3.0	0.8	—	—	—	—
	67	71.2	3.7	23.7	21.3	18.9	16.5	14.1	—	65.2	3.7	19.8	17.8	15.8	13.8	11.8	—
4000	62	61.5	3.5	44.2	41.8	39.4	37.0	34.6	32.2	56.1	3.5	38.8	36.8	34.9	32.9	30.9	28.9
	57	56.8	3.5	49.1	48.3	47.5	45.1	42.7	40.3	53.0	3.5	43.5	42.8	42.2	40.2	38.3	36.3
	77	93.0	4.0	3.9	1.2	—	—	—	—	87.2	4.1	3.7	1.1	—	—	—	—
	72	83.6	3.9	4.3	1.2	—	—	—	—	77.5	3.9	4.0	1.1	—	—	—	—
4500	67	74.2	3.7	29.8	26.7	23.6	20.4	17.3	—	67.7	3.7	25.9	23.2	20.5	17.8	15.1	—
	62	64.1	3.5	55.4	52.2	49.1	46.0	42.9	39.8	58.3	3.5	50.9	48.2	45.5	42.8	40.0	37.3
	57	59.2	3.4	59.2	59.2	59.2	56.1	52.9	49.8	55.1	3.4	55.1	55.1	55.1	52.4	49.6	46.9
	72	129.1	3.7	14.6	4.5	—	—	—	—	122.3	3.9	13.8	4.3	—	—	—	—
5000	67	114.6	3.5	89.6	79.5	69.4	59.3	49.2	—	106.9	3.7	83.6	74.2	66.3	56.2	46.1	—
	62	98.9	3.3	94.6	93.0	91.5	81.4	71.3	61.2	92.0	3.5	88.3	86.9	85.5	75.4	65.3	55.2
	57	91.4	3.3	91.4	91.4	91.4	81.3	71.2	61.1	86.9	3.4	86.9	86.9	86.9	76.8	66.7	56.6
	72	174.7	3.6	24.8	7.8	—	—	—	—	167.2	3.9	23.8	7.4	—	—	—	—
5500	67	155.0	3.4	149.4	132.4	115.3	98.2	81.2	—	146.0	3.7	140.8	124.8	112.1	94.6	77.1	—
	62	133.8	3.2	133.8	133.8	133.8	116.8	99.7	82.6	125.6	3.5	125.6	125.6	125.6	108.1	90.6	73.2
	57	123.6	3.2	123.6	123.6	123.6	106.6	89.5	72.4	118.8	3.5	118.8	118.8	118.8	101.3	83.8	66.3

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 74: ZY12 reheat capacity (10 ton, 75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)						Total capacity <sup>1</sup> (MBh)	Total input <sup>2</sup> (kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
75°F										85°F							
2500	72	64.1	4.1	1.6	1.4	1.3	1.2	—	—	59.3	4.1	1.4	1.3	1.2	1.1	—	—
	67	55.0	3.8	3.3	3.2	3.1	3.0	2.9	—	49.9	3.9	3.0	2.9	2.8	2.7	0.4	—
	62	47.1	3.6	7.6	7.5	7.4	7.3	7.1	7.0	42.5	3.7	0.5	0.8	1.1	1.4	1.7	1.9
3000	72	66.5	4.0	1.6	1.4	—	—	—	—	61.3	4.0	1.5	1.3	—	—	—	—
	67	57.1	3.8	9.6	8.7	7.9	7.0	6.2	—	51.5	3.8	5.6	5.2	4.7	4.3	3.8	—
	62	48.9	3.6	20.5	19.7	18.8	18.0	17.2	16.3	43.9	3.6	14.3	13.9	13.4	13.0	12.6	12.1
	57	47.5	3.5	24.7	23.8	23.0	22.1	21.3	20.4	44.0	3.5	17.5	17.0	16.6	16.2	15.7	15.3
3500	72	68.9	4.0	11.6	9.1	—	—	—	—	63.3	4.0	10.6	8.4	—	—	—	—
	67	59.2	3.7	15.8	14.3	12.7	11.1	9.6	—	53.2	3.7	11.9	10.8	9.6	8.4	7.3	—
	62	50.7	3.5	33.5	31.9	30.3	28.8	27.2	25.6	45.3	3.5	28.1	26.9	25.8	24.6	23.5	22.3
	57	49.2	3.5	37.8	37.4	37.0	35.4	33.8	32.3	45.4	3.5	32.2	31.9	31.7	30.6	29.4	28.2
4000	72	71.4	3.9	19.1	14.9	—	—	—	—	65.2	3.9	17.5	13.6	—	—	—	—
	67	61.3	3.7	22.1	19.8	17.5	15.2	12.9	—	54.9	3.7	18.2	16.4	14.5	12.6	10.7	—
	62	52.5	3.5	46.4	44.1	41.8	39.5	37.2	34.9	46.7	3.5	41.9	40.0	38.1	36.3	34.4	32.5
	57	51.0	3.4	51.0	51.0	51.0	48.7	46.4	44.1	46.8	3.4	46.8	46.8	46.8	45.0	43.1	41.2
4500	72	115.5	4.1	30.9	15.7	—	—	—	—	108.7	4.3	29.1	14.7	—	—	—	—
	67	99.2	3.9	79.6	73.3	63.2	53.1	43.0	—	91.5	4.0	74.6	70.2	60.0	49.9	39.8	—
	62	85.0	3.7	81.9	80.8	79.6	69.5	59.4	49.3	78.0	3.8	75.6	74.6	73.7	63.6	53.5	43.3
	57	82.5	3.6	82.5	82.5	82.5	72.4	62.3	52.2	78.0	3.7	78.0	78.0	78.0	67.9	57.8	47.7
5000	72	159.7	4.3	42.7	16.4	—	—	—	—	152.2	4.6	40.7	15.6	—	—	—	—
	67	137.1	4.0	137.1	126.8	108.8	90.9	73.0	—	128.2	4.3	128.2	124.0	105.6	87.3	68.9	—
	62	117.4	3.8	117.4	117.4	117.4	99.5	81.6	63.7	109.3	4.1	109.3	109.3	109.3	90.9	72.6	54.2
	57	114.0	3.8	114.0	114.0	114.0	96.1	78.2	60.2	109.2	4.1	109.2	109.2	109.2	90.9	72.5	54.2

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

## ZL04 to 14 reheat capacities

**Table 75: ZL04 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		35°F								45°F							
750	77	29.5	2.1	7.7	6.5	5.9	—	—	—	29.6	2.0	7.5	4.4	—	—	—	—
	72	28.2	2.0	12.0	11.2	10.4	9.6	—	—	27.9	1.9	12.5	10.0	9.3	8.0	—	—
	67	27.0	1.9	13.6	12.5	11.1	10.7	9.3	—	26.3	1.8	14.6	13.4	12.2	10.2	9.9	—
	62	26.3	1.8	15.8	14.3	13.6	12.1	10.8	9.7	22.3	1.8	15.6	15.6	13.4	12.1	11.4	10.9
900	77	26.4	2.0	8.1	7.2	6.7	—	—	—	27.9	1.8	8.0	4.6	—	—	—	—
	72	25.3	1.9	12.9	11.3	10.6	9.8	—	—	26.3	1.7	12.0	11.7	10.3	9.9	—	—
	67	24.2	1.8	13.8	13.0	12.5	11.3	10.4	—	24.8	1.6	16.4	14.0	13.5	12.8	11.7	—
	62	23.1	1.7	16.2	15.1	14.6	13.4	12.5	10.6	21.0	1.5	17.9	16.3	15.2	14.7	13.2	11.1
1050	57	20.8	1.6	18.2	16.9	15.8	14.1	13.0	11.1	19.6	1.4	19.6	19.6	19.6	16.2	14.7	12.3
	77	26.5	1.8	7.1	5.5	6.8	—	—	—	26.2	1.4	7.8	4.0	—	—	—	—
	72	25.5	1.7	13.2	12.4	11.7	10.3	—	—	24.7	1.4	13.4	12.9	11.3	10.8	—	—
	67	24.5	1.6	15.3	14.8	13.1	12.6	11.5	—	23.3	1.3	17.7	16.9	16.6	14.0	11.5	—
1200	62	22.0	1.6	18.0	17.1	16.5	14.4	13.2	11.5	19.7	1.2	19.7	19.1	18.3	15.7	13.2	11.6
	57	20.9	1.5	20.9	19.2	18.4	17.5	16.4	12.4	18.4	1.2	18.4	18.4	18.4	15.8	13.3	12.7
	77	25.8	1.6	6.9	5.1	4.2	—	—	—	27.2	1.9	6.1	4.5	—	—	—	—
	72	24.9	1.6	14.6	14.5	12.4	10.3	—	—	25.7	1.8	14.7	13.0	11.7	10.9	—	—
1350	67	23.9	1.6	16.9	18.7	16.7	14.6	12.5	—	24.2	1.7	16.0	14.3	12.6	11.0	9.3	—
	62	20.2	1.5	18.7	19.1	17.0	15.9	14.6	13.1	18.4	1.6	18.4	17.2	15.5	13.9	12.2	10.5
	57	18.4	1.5	20.4	20.4	20.4	18.5	16.5	14.4	17.2	1.6	17.2	17.2	17.2	15.5	13.8	12.1
	72	24.0	1.5	14.9	13.2	11.5	9.8	—	—	24.1	1.8	9.2	7.6	5.9	4.3	—	—
1500	67	23.2	1.6	17.1	15.4	13.7	12.0	10.3	—	22.7	1.7	15.0	13.4	11.8	10.2	8.6	—
	62	19.9	1.5	19.2	19.8	18.5	16.7	15.2	14.1	17.3	1.6	17.3	16.1	14.5	12.9	11.3	9.7
	57	18.0	1.5	20.3	20.9	20.5	19.1	18.3	15.0	16.1	1.6	16.1	16.1	16.1	14.4	12.8	11.2
	72	20.4	1.5	15.1	14.0	12.5	11.3	—	—	22.6	1.8	8.6	7.1	5.5	4.0	—	—
1500	67	19.8	1.5	17.6	15.6	14.8	13.5	11.6	—	21.3	1.7	14.1	12.5	11.0	9.4	7.9	—
	62	17.3	1.4	19.2	19.0	18.1	17.4	16.3	15.4	16.2	1.6	16.2	15.0	13.5	11.9	10.4	8.8
	57	15.6	1.4	19.8	19.8	19.1	18.9	17.8	15.5	15.1	1.5	15.1	15.1	14.9	13.4	11.8	10.3
			55°F								65°F						
750	72	21.7	2.1	1.9	1.0	—	—	—	—	19.2	2.2	—	—	—	—	—	—
	67	20.0	2.0	7.8	6.9	6.1	5.3	4.5	—	17.5	2.1	4.8	4.3	3.9	3.4	2.9	—
	62	18.3	1.8	13.8	12.9	12.1	11.3	10.5	9.6	15.1	1.9	9.2	8.7	8.2	7.7	7.2	6.7
900	72	22.4	2.1	2.2	1.2	—	—	—	—	19.7	2.2	—	—	—	—	—	—
	67	20.6	1.9	8.9	7.9	7.0	6.0	5.0	—	17.9	2.0	5.9	5.3	4.6	4.0	3.4	—
	62	18.9	1.8	15.7	14.8	13.8	12.8	11.8	10.8	15.4	1.9	11.3	10.7	10.0	9.4	8.8	8.1
1050	57	13.2	1.7	13.0	12.1	11.1	10.1	9.1	8.1	12.3	1.9	10.4	9.8	9.1	8.5	7.9	7.2
	72	23.1	2.1	2.5	1.4	—	—	—	—	20.1	2.2	—	—	—	—	—	—
	67	21.2	1.9	10.1	8.9	7.8	6.7	5.5	—	18.3	2.0	7.0	6.2	5.4	4.6	3.9	—
1200	62	19.4	1.8	17.7	16.6	15.5	14.3	13.2	12.1	15.8	1.9	13.4	12.6	11.8	11.1	10.3	9.5
	57	13.6	1.7	13.5	13.0	12.4	11.3	10.2	9.0	12.6	1.8	11.6	11.3	10.9	10.2	9.4	8.6
	72	23.7	2.1	2.9	1.6	—	—	—	—	20.6	2.1	—	—	—	—	—	—
1350	67	21.8	1.9	11.2	9.9	8.6	7.3	6.1	—	18.7	2.0	8.0	7.1	6.2	5.3	4.4	—
	62	20.0	1.7	19.7	18.4	17.1	15.8	14.5	13.3	16.2	1.8	15.5	14.5	13.6	12.7	11.8	10.9
	57	14.0	1.7	14.0	14.0	13.8	12.5	11.2	9.9	12.8	1.8	12.8	12.8	12.7	11.8	10.9	10.0
1500	72	24.3	2.0	3.4	1.9	—	—	—	—	20.8	2.1	—	—	—	—	—	—
	67	22.3	1.9	13.0	11.4	9.9	8.4	6.8	—	18.9	1.9	9.5	8.4	7.3	6.2	5.1	—
	62	20.4	1.7	20.3	19.6	19.0	17.5	15.9	14.4	16.3	1.8	16.0	15.5	15.1	14.0	12.9	11.7
1500	57	14.3	1.7	14.3	14.3	14.2	12.6	11.1	9.6	13.0	1.8	13.0	13.0	12.9	11.8	10.7	9.6
	72	24.8	2.0	3.9	2.2	0.4	—	—	—	21.0	2.1	—	—	—	—	—	—
	67	22.8	1.9	14.7	12.9	11.2	9.4	7.6	—	19.1	1.9	11.0	9.7	8.4	7.1	5.8	—
1500	62	20.9	1.7	20.9	20.9	20.9	19.1	17.3	15.6	16.5	1.8	16.5	16.5	16.5	15.2	13.9	12.6
	57	14.6	1.7	14.6	14.6	14.6	12.8	11.0	9.3	13.1	1.8	13.1	13.1	13.1	11.8	10.4	9.1

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 76: ZL04 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
750	72	16.7	2.4	—	—	—	—	—	—	14.2	2.5	—	—	—	—	—	—
	67	15.1	2.2	1.9	1.8	1.6	1.4	1.3	—	12.6	2.3	1.0	1.0	0.9	0.9	0.8	—
	62	11.9	2.1	4.6	4.5	4.3	4.1	4.0	3.8	8.6	2.2	2.1	2.1	2.2	2.4	2.3	2.2
900	67	15.3	2.1	2.9	2.6	2.3	2.0	1.7	—	12.6	2.2	—	—	—	—	—	—
	62	12.0	2.0	6.8	6.5	6.2	6.0	5.7	5.4	8.6	2.1	2.4	2.4	2.5	2.5	2.6	2.7
	57	11.4	2.0	7.8	7.5	7.2	6.9	6.6	6.3	10.5	2.1	5.1	5.2	5.3	5.3	5.4	5.4
1050	67	15.5	2.1	3.9	3.4	3.0	2.6	2.2	—	12.6	2.1	0.8	0.7	0.7	0.6	0.6	—
	62	12.2	2.0	9.0	8.6	8.2	7.8	7.4	7.0	8.5	2.1	4.7	4.6	4.6	4.5	4.5	4.4
	57	11.5	1.9	9.7	9.6	9.4	9.0	8.6	8.2	10.5	2.1	7.8	7.9	8.0	7.9	7.9	7.8
1200	67	15.7	2.0	4.8	4.3	3.8	3.2	2.7	—	12.6	2.1	1.6	1.5	1.3	1.2	1.0	—
	62	12.3	1.9	11.2	10.7	10.1	9.6	9.1	8.5	8.5	2.0	7.0	6.8	6.7	6.5	6.3	6.2
	57	11.7	1.9	11.7	11.7	11.7	11.2	10.6	10.1	10.5	2.0	10.5	10.5	10.5	10.5	10.3	10.2
1350	67	15.6	2.0	6.1	5.4	4.7	4.0	3.3	—	12.2	2.1	2.7	2.4	2.1	1.8	1.5	—
	62	12.3	1.9	11.7	11.4	11.2	10.5	9.8	9.1	8.2	2.0	7.4	7.3	7.3	7.0	6.7	6.4
	57	11.6	1.9	11.6	11.6	11.6	10.9	10.2	9.5	10.3	2.0	10.3	10.3	10.3	10.1	9.8	9.5
1500	67	15.5	2.0	7.4	6.5	5.6	4.8	3.9	—	11.9	2.0	3.7	3.3	2.9	2.5	2.1	—
	62	12.2	1.9	12.2	12.2	12.2	11.3	10.5	9.6	7.9	2.0	7.9	7.9	7.9	7.4	7.0	6.6
	57	11.6	1.9	11.6	11.6	11.6	10.7	9.8	9.0	10.1	2.0	10.1	10.1	10.1	9.7	9.3	8.8

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 77: ZL05 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		35°F								45°F							
1000	77	35.4	2.4	11.9	9.8	7.7	—	—	—	36.4	2.8	5.5	3.6	1.7	—	—	—
	72	35.7	2.4	16.4	14.3	12.1	10.0	—	—	35.2	2.7	11.8	9.9	8.1	6.2	—	—
	67	36.0	2.4	20.8	18.7	16.6	14.4	12.3	—	33.9	2.5	18.2	16.3	14.4	12.5	10.6	—
	62	35.9	2.3	26.7	24.7	22.5	20.4	18.3	16.1	32.3	2.4	25.0	23.1	21.2	19.3	17.4	15.5
1200	77	36.2	2.4	13.2	10.9	8.5	—	—	—	37.2	2.7	6.2	4.1	1.9	—	—	—
	72	36.5	2.3	18.4	16.1	13.7	11.4	—	—	36.0	2.6	13.3	11.2	9.1	6.9	—	—
	67	36.8	2.3	23.6	21.3	18.9	16.6	14.2	—	34.7	2.5	20.4	18.3	16.2	14.0	11.9	—
	62	36.7	2.3	30.5	28.1	25.8	23.4	21.1	18.7	33.0	2.4	28.1	26.0	23.8	21.7	19.6	17.4
1400	57	27.6	2.1	26.6	24.2	21.9	19.5	17.2	14.8	28.6	2.3	27.2	25.1	22.9	20.8	18.7	16.6
	77	37.1	2.3	14.6	12.0	9.4	—	—	—	38.0	2.7	6.9	4.5	2.2	—	—	—
	72	37.3	2.3	20.5	17.9	15.3	12.8	—	—	36.7	2.5	14.8	12.4	10.1	7.7	—	—
	67	37.6	2.3	26.4	23.8	21.3	18.7	16.1	—	35.4	2.4	22.7	20.3	18.0	15.6	13.2	—
1600	62	37.5	2.2	34.3	31.6	29.0	26.5	23.9	21.3	33.7	2.3	31.2	28.8	26.5	24.1	21.7	19.4
	57	28.3	2.1	27.7	26.5	24.7	22.1	19.6	17.0	29.2	2.2	28.5	27.5	25.5	23.1	20.8	18.4
	77	37.9	2.2	15.9	13.1	10.3	—	—	—	38.8	2.6	7.6	5.0	2.4	—	—	—
	72	38.1	2.2	22.5	19.7	16.9	14.1	—	—	37.5	2.5	16.3	13.7	11.1	8.5	—	—
1800	67	38.4	2.2	29.2	26.4	23.6	20.8	18.0	—	36.2	2.4	25.0	22.4	19.8	17.2	14.6	—
	62	38.4	2.2	38.1	35.1	32.3	29.5	26.7	23.9	34.5	2.3	34.3	31.7	29.1	26.5	23.9	21.3
	57	28.9	2.0	28.9	28.9	27.6	24.8	22.0	19.2	29.9	2.2	29.9	29.9	28.0	25.4	22.8	20.2
	72	35.1	2.1	21.0	18.5	15.9	13.4	—	—	36.2	2.4	16.0	13.4	10.8	8.2	—	—
2000	67	35.5	2.1	26.3	23.8	21.2	18.7	16.1	—	35.0	2.3	24.5	21.9	19.3	16.7	14.0	—
	62	35.6	2.1	35.5	32.1	28.6	26.1	23.5	20.9	33.3	2.2	33.2	31.0	28.4	25.8	23.1	20.5
	57	26.4	1.9	26.4	26.4	24.6	22.0	19.5	16.9	28.8	2.1	28.8	28.8	27.3	24.7	22.1	19.5
	72	32.0	2.0	19.5	17.2	14.9	12.6	—	—	34.9	2.4	15.8	13.1	10.5	7.9	—	—
1000	67	32.5	2.0	23.5	21.2	18.9	16.6	14.3	—	33.7	2.2	24.0	21.4	18.8	16.1	13.5	—
	62	32.8	2.0	32.8	29.2	24.9	22.6	20.3	18.0	32.1	2.1	32.1	30.3	27.6	25.0	22.4	19.8
	57	24.0	1.9	24.0	24.0	21.6	19.3	17.0	14.7	27.8	2.1	27.8	27.8	26.6	24.0	21.4	18.7
			55°F								65°F						
1000	72	34.6	2.9	7.3	5.6	4.0	2.3	—	—	31.1	3.1	3.9	2.7	1.5	—	—	—
	67	31.9	2.7	15.5	13.8	12.2	10.5	8.9	—	27.7	2.9	11.3	10.1	8.9	7.7	6.5	—
	62	28.7	2.5	23.3	21.5	19.8	18.2	16.5	14.9	24.1	2.8	18.2	16.9	15.7	14.4	13.2	12.0
1200	72	35.4	2.9	8.2	6.3	4.4	2.5	—	—	31.6	3.0	4.4	3.0	1.6	—	—	—
	67	32.6	2.6	17.3	15.3	13.4	11.5	9.6	—	28.2	2.8	12.8	11.4	9.9	8.5	7.1	—
	62	29.3	2.5	25.7	23.8	21.9	19.9	18.0	16.1	24.5	2.7	20.4	19.0	17.6	16.1	14.7	13.3
1400	57	29.6	2.4	27.9	25.9	24.0	22.1	20.2	18.3	24.3	2.7	22.5	21.1	19.6	18.2	16.8	15.4
	72	36.1	2.8	9.1	7.0	4.8	2.6	—	—	32.1	3.0	5.0	3.3	1.7	—	—	—
	67	33.3	2.6	19.0	16.9	14.7	12.5	10.4	—	28.6	2.8	14.3	12.6	11.0	9.4	7.7	—
	62	29.9	2.4	28.1	26.1	23.9	21.7	19.6	17.4	25.0	2.6	22.7	21.1	19.5	17.8	16.2	14.6
1600	57	30.2	2.4	29.3	28.4	26.3	24.1	21.9	19.8	24.7	2.6	23.8	23.1	21.8	20.1	18.5	16.9
	72	36.9	2.7	10.1	7.6	5.2	2.8	—	—	32.6	2.9	5.5	3.7	1.8	—	—	—
	67	34.0	2.5	20.8	18.4	15.9	13.5	11.1	—	29.1	2.7	15.7	13.9	12.1	10.2	8.4	—
1800	62	30.5	2.3	30.5	28.4	25.9	23.5	21.1	18.7	25.4	2.5	24.9	23.2	21.4	19.5	17.7	15.9
	57	30.8	2.3	30.8	30.8	28.5	26.1	23.7	21.3	25.2	2.5	25.2	25.2	23.9	22.1	20.2	18.4
	72	37.4	2.7	11.0	8.3	5.7	3.0	—	—	32.9	2.8	6.1	4.0	2.0	—	—	—
	67	34.4	2.5	22.7	20.0	17.3	14.6	11.9	—	29.4	2.6	17.3	15.3	13.2	11.2	9.1	—
2000	62	30.9	2.3	30.9	29.9	28.1	25.5	22.8	20.1	25.6	2.5	25.4	24.5	23.4	21.3	19.3	17.2
	57	31.2	2.3	31.2	31.2	30.1	27.4	24.7	22.0	25.4	2.5	25.4	25.4	24.8	22.7	20.7	18.6
	72	37.9	2.7	12.0	9.0	6.1	3.2	—	—	33.3	2.8	6.6	4.4	2.1	—	—	—
	67	34.9	2.5	24.5	21.6	18.7	15.7	12.8	—	29.7	2.6	19.0	16.7	14.4	12.1	9.9	—
2000	62	31.3	2.3	31.3	31.3	30.4	27.4	24.5	21.5	25.9	2.5	25.9	25.9	25.4	23.1	20.8	18.6
	57	31.6	2.3	31.6	31.6	31.6	28.7	25.8	22.8	25.6	2.4	25.6	25.6	25.6	23.4	21.1	18.8

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 78: ZL05 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1000	72	27.5	3.3	0.5	—	—	—	—	—	23.9	3.5	—	—	—	—	—	—
	67	23.5	3.1	7.2	6.4	5.6	4.8	4.0	—	19.2	3.3	3.0	2.7	2.3	2.0	1.6	—
	62	19.6	3.0	13.1	12.3	11.5	10.7	9.9	9.2	15.0	3.3	8.0	7.7	7.3	7.0	6.6	6.3
1200	72	27.8	3.2	0.6	—	—	—	—	—	24.0	3.4	—	—	—	—	—	—
	67	23.7	3.0	8.3	7.4	6.5	5.5	4.6	—	19.3	3.2	3.9	3.4	3.0	2.5	2.1	—
	62	19.8	2.9	15.1	14.2	13.3	12.3	11.4	10.4	15.0	3.1	9.9	9.4	9.0	8.5	8.1	7.6
	57	19.1	2.9	17.1	16.2	15.2	14.3	13.4	12.4	13.8	3.1	11.7	11.3	10.8	10.4	9.9	9.5
1400	72	28.1	3.1	0.8	—	—	—	—	—	24.1	3.3	—	—	—	—	—	—
	67	24.0	2.9	9.5	8.4	7.3	6.2	5.1	—	19.3	3.1	4.7	4.2	3.6	3.1	2.5	—
	62	20.0	2.8	17.2	16.1	15.0	13.9	12.8	11.7	15.0	3.0	11.8	11.1	10.6	10.0	9.5	8.9
	57	19.3	2.8	18.3	17.8	17.3	16.2	15.1	14.0	13.8	3.0	12.8	12.6	12.8	12.2	11.6	11.1
1600	72	28.4	3.0	0.9	—	—	—	—	—	24.2	3.1	—	—	—	—	—	—
	67	24.2	2.8	10.7	9.4	8.2	6.9	5.7	—	19.4	3.0	5.6	5.0	4.3	3.6	3.0	—
	62	20.2	2.7	19.3	18.0	16.8	15.5	14.3	13.0	15.0	2.9	13.6	12.9	12.2	11.5	10.9	10.2
	57	19.5	2.7	19.5	19.5	19.3	18.0	16.8	15.5	13.8	2.9	13.8	13.8	13.8	13.8	13.4	12.7
1800	72	28.5	2.9	1.1	—	—	—	—	—	24.1	3.1	—	—	—	—	—	—
	67	24.3	2.8	12.0	10.6	9.2	7.8	6.3	—	19.3	2.9	6.7	5.9	5.1	4.3	3.5	—
	62	20.3	2.7	19.8	19.2	18.6	17.2	15.7	14.3	15.0	2.8	14.3	13.9	13.8	13.0	12.2	11.4
	57	19.6	2.6	19.6	19.6	19.5	18.1	16.6	15.2	13.7	2.8	13.7	13.7	13.7	13.4	12.6	11.8
2000	72	28.6	2.9	1.3	—	—	—	—	—	24.0	3.0	—	—	—	—	—	—
	67	24.4	2.7	13.4	11.8	10.2	8.6	7.0	—	19.2	2.8	7.8	6.9	5.9	5.0	4.1	—
	62	20.4	2.6	20.4	20.4	20.4	18.8	17.2	15.6	14.9	2.8	14.9	14.9	14.9	14.5	13.6	12.6
	57	19.7	2.6	19.7	19.7	19.7	18.1	16.5	14.9	13.7	2.7	13.7	13.7	13.7	12.7	11.8	10.9

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 79: ZL06 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		35°F									45°F								
1250	77	38.0	3.5	5.2	3.7	2.3	—	—	—	38.3	3.6	—	—	—	—	—	—		
	72	35.7	3.1	9.7	8.2	6.7	5.2	—	—	35.5	3.3	6.1	4.8	3.5	2.3	—	—		
	67	33.4	2.7	14.1	12.6	11.1	9.6	8.1	—	32.8	3.0	12.3	11.0	9.8	8.5	7.3	—		
	62	31.9	2.6	20.6	19.1	17.6	16.1	14.7	13.2	30.1	2.8	20.8	19.5	18.3	17.0	15.8	14.5		
1500	77	38.1	3.4	5.7	4.0	2.4	—	—	—	38.9	3.5	—	—	—	—	—	—		
	72	35.8	3.0	11.1	9.4	7.8	6.1	—	—	36.0	3.2	7.0	5.6	4.1	2.6	—	—		
	67	33.5	2.6	16.5	14.8	13.2	11.5	9.8	—	33.2	2.9	14.3	12.8	11.4	9.9	8.4	—		
	62	32.0	2.6	24.4	22.7	21.1	19.4	17.7	16.1	30.5	2.8	24.1	22.7	21.2	19.7	18.3	16.8		
1750	57	28.0	2.5	24.4	22.7	21.1	19.4	17.7	16.1	28.0	2.7	25.4	24.0	22.5	21.1	19.6	18.1		
	77	38.1	3.3	6.2	4.3	2.5	—	—	—	39.4	3.4	—	—	—	—	—	—		
	72	35.9	2.9	12.5	10.7	8.9	7.0	—	—	36.6	3.1	8.0	6.3	4.7	3.0	—	—		
	67	33.6	2.5	18.9	17.1	15.2	13.4	11.5	—	33.7	2.8	16.2	14.6	12.9	11.3	9.6	—		
2000	62	32.1	2.5	28.2	26.3	24.5	22.7	20.8	19.0	31.0	2.7	27.5	25.8	24.1	22.5	20.8	19.2		
	57	28.0	2.5	26.2	25.4	24.6	22.7	20.9	19.1	28.3	2.7	27.1	26.4	25.6	24.0	22.3	20.6		
	77	38.2	3.2	6.7	4.6	2.6	—	—	—	39.9	3.4	—	—	—	—	—	—		
	72	35.9	2.8	14.0	12.0	9.9	7.9	—	—	37.1	3.1	9.0	7.1	5.2	3.4	—	—		
2250	67	33.6	2.4	21.3	19.3	17.3	15.3	13.2	—	34.2	2.8	18.2	16.4	14.5	12.6	10.8	—		
	62	32.2	2.4	32.0	30.0	27.9	25.9	23.9	21.9	31.4	2.6	30.8	28.9	27.1	25.2	23.3	21.5		
	57	28.1	2.4	28.1	28.1	28.1	26.1	24.0	22.0	28.7	2.6	28.7	28.7	28.7	26.9	25.0	23.2		
	72	36.2	2.8	14.8	12.8	10.8	8.9	—	—	37.4	3.0	9.7	7.7	5.7	3.7	—	—		
2500	67	33.9	2.4	21.8	19.8	17.9	15.9	13.9	—	34.5	2.7	19.9	17.9	15.8	13.8	11.8	—		
	62	32.5	2.3	32.4	31.4	30.3	28.4	26.4	24.4	31.7	2.6	31.4	30.5	29.5	27.5	25.5	23.5		
	57	28.3	2.3	28.3	28.3	28.3	26.4	24.4	22.4	29.0	2.6	29.0	29.0	29.0	27.0	25.0	23.0		
	72	36.6	2.7	15.6	13.6	11.7	9.8	—	—	37.7	3.0	10.5	8.4	6.2	4.1	—	—		
1250	67	34.2	2.4	22.3	20.4	18.5	16.5	14.6	—	34.8	2.7	21.5	19.4	17.2	15.1	12.9	—		
	62	32.7	2.3	32.7	32.7	32.7	30.8	28.9	27.0	32.0	2.6	32.0	32.0	32.0	29.8	27.7	25.5		
	57	28.6	2.3	28.6	28.6	28.6	26.7	24.7	22.8	29.3	2.5	29.3	29.3	29.3	27.1	25.0	22.8		
			55°F									65°F							
1250	72	35.4	3.5	2.5	1.4	—	—	—	—	32.1	3.7	—	—	—	—	—	—		
	67	32.1	3.3	10.5	9.5	8.4	7.4	6.4	—	28.3	3.5	6.8	6.2	5.5	4.9	4.2	—		
	62	28.3	3.0	21.0	20.0	18.9	17.9	16.9	15.8	24.4	3.3	17.1	16.4	15.8	15.1	14.5	13.8		
1500	72	36.3	3.4	3.0	1.7	0.4	—	—	—	32.5	3.6	—	—	—	—	—	—		
	67	33.0	3.2	12.0	10.8	9.5	8.3	7.0	—	28.7	3.4	7.7	6.9	6.2	5.4	4.6	—		
	62	29.1	3.0	23.9	22.6	21.4	20.1	18.8	17.6	24.7	3.2	19.0	18.2	17.4	16.7	15.9	15.1		
1750	57	27.9	2.9	26.5	25.2	23.9	22.7	21.4	20.2	22.9	3.1	21.3	20.5	19.7	18.9	18.2	17.4		
	72	37.3	3.4	3.5	2.0	0.5	—	—	—	32.8	3.5	—	—	—	—	—	—		
	67	33.8	3.2	13.6	12.1	10.6	9.1	7.7	—	29.0	3.3	8.6	7.7	6.8	5.9	5.0	—		
	62	29.9	2.9	26.7	25.3	23.8	22.3	20.8	19.3	25.0	3.1	20.9	20.0	19.1	18.2	17.3	16.4		
2000	57	28.7	2.9	27.9	27.3	26.7	25.2	23.7	22.2	23.2	3.0	22.4	22.0	21.6	20.7	19.8	18.9		
	72	38.2	3.3	3.9	2.2	0.5	—	—	—	33.2	3.5	—	—	—	—	—	—		
	67	34.7	3.1	15.1	13.4	11.7	10.0	8.3	—	29.3	3.3	9.5	8.5	7.4	6.4	5.3	—		
	62	30.6	2.9	29.6	27.9	26.2	24.5	22.8	21.1	25.3	3.1	22.8	21.8	20.8	19.7	18.7	17.6		
2250	57	29.4	2.8	29.4	29.4	29.4	27.7	26.0	24.3	23.5	3.0	23.5	23.5	23.5	22.4	21.4	20.3		
	72	38.6	3.3	4.7	2.7	0.6	—	—	—	33.3	3.4	—	—	—	—	—	—		
	67	35.0	3.1	17.9	15.9	13.8	11.8	9.7	—	29.4	3.2	11.5	10.2	8.9	7.6	6.4	—		
	62	30.9	2.9	30.4	29.6	28.7	26.7	24.6	22.6	25.4	3.0	24.2	23.6	23.1	21.8	20.6	19.3		
2500	57	29.7	2.8	29.7	29.7	29.7	27.6	25.6	23.5	23.6	3.0	23.6	23.6	23.6	22.3	21.0	19.7		
	72	38.9	3.2	5.5	3.1	0.7	—	—	—	33.4	3.4	—	—	—	—	—	—		
	67	35.4	3.1	20.7	18.3	16.0	13.6	11.2	—	29.5	3.2	13.5	11.9	10.4	8.9	7.4	—		
	62	31.2	2.8	31.2	31.2	31.2	28.8	26.4	24.0	25.5	3.0	25.5	25.5	25.5	24.0	22.4	20.9		
2500	57	29.9	2.8	29.9	29.9	29.9	27.6	25.2	22.8	23.7	2.9	23.7	23.7	23.7	22.2	20.6	19.1		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 80: ZL06 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1250	72	28.9	3.9	—	—	—	—	—	—	25.7	4.1	—	—	—	—	—	—
	67	24.5	3.6	3.2	2.9	2.6	2.3	2.0	—	20.7	3.8	—	—	—	—	—	—
	62	20.4	3.5	13.2	12.9	12.7	12.4	12.1	11.8	16.5	3.7	9.3	9.4	9.5	9.6	9.7	9.8
1500	67	24.3	3.6	3.4	3.1	2.8	2.5	2.1	—	20.0	3.7	—	—	—	—	—	—
	62	20.3	3.4	14.2	13.9	13.5	13.2	12.9	12.6	15.9	3.6	9.3	9.5	9.6	9.8	9.9	10.1
	57	17.8	3.3	16.1	15.8	15.5	15.2	14.9	14.6	12.8	3.4	11.0	11.1	11.3	11.4	11.6	11.7
1750	67	24.1	3.5	3.7	3.3	3.0	2.6	2.3	—	19.3	3.6	—	—	—	—	—	—
	62	20.1	3.3	15.1	14.8	14.4	14.1	13.7	13.4	15.2	3.5	9.3	9.5	9.7	10.0	10.2	10.4
	57	17.7	3.2	16.8	16.7	16.5	16.2	15.8	15.5	12.2	3.3	11.3	11.4	11.4	11.7	11.9	12.1
2000	67	23.9	3.4	3.9	3.5	3.1	2.8	2.4	—	18.5	3.6	—	—	—	—	—	—
	62	19.9	3.3	16.1	15.7	15.3	14.9	14.6	14.2	14.6	3.4	9.3	9.6	9.9	10.1	10.4	10.7
	57	17.5	3.1	17.5	17.5	17.5	17.2	16.8	16.4	11.6	3.3	11.6	11.6	11.6	11.6	11.6	11.6
2250	67	23.8	3.4	5.0	4.5	4.0	3.5	3.0	—	18.2	3.5	—	—	—	—	—	—
	62	19.8	3.2	17.9	17.7	17.5	17.0	16.5	16.0	14.3	3.4	11.7	11.8	12.0	12.2	12.5	12.7
	57	17.5	3.1	17.5	17.5	17.5	16.9	16.4	15.9	11.3	3.2	11.3	11.3	11.3	11.3	11.3	11.3
2500	67	23.7	3.3	6.2	5.5	4.9	4.3	3.6	—	17.9	3.4	—	—	—	—	—	—
	62	19.8	3.2	19.8	19.8	19.8	19.1	18.5	17.8	14.0	3.3	14.0	14.0	14.0	14.0	14.0	14.0
	57	17.4	3.0	17.4	17.4	17.4	16.7	16.1	15.5	11.1	3.2	11.1	11.1	11.1	11.1	11.1	11.1

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.



**Table 81: ZL08 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		35°F								45°F							
1875	77	71.8	3.4	3.8	1.4	—	—	—	—	66.4	3.7	—	—	—	—	—	—
	72	64.5	3.2	13.2	10.8	8.4	6.0	—	—	59.7	3.6	7.8	6.1	4.5	2.8	—	—
	67	57.3	3.1	22.6	20.2	17.8	15.4	13.1	—	53.0	3.4	16.5	14.8	13.2	11.5	9.9	—
	62	50.0	3.3	30.3	27.9	25.5	23.1	20.7	18.3	46.3	3.4	24.6	22.9	21.3	19.6	18.0	16.3
2250	77	74.2	3.3	5.3	2.5	—	—	—	—	69.5	3.6	—	—	—	—	—	—
	72	66.8	3.2	16.3	13.5	10.7	8.0	—	—	62.5	3.5	10.0	7.9	5.7	3.6	—	—
	67	59.3	3.1	27.3	24.6	21.8	19.0	16.2	—	55.5	3.3	21.2	19.0	16.9	14.8	12.6	—
	62	51.7	3.3	36.1	33.3	30.5	27.7	24.9	22.1	48.5	3.3	31.6	29.4	27.3	25.1	23.0	20.9
2625	57	49.3	3.1	44.2	41.4	38.6	35.8	33.0	30.3	44.7	3.2	37.7	35.5	33.4	31.3	29.1	27.0
	77	76.7	3.3	6.8	3.6	—	—	—	—	72.5	3.5	—	—	—	—	—	—
	72	69.0	3.1	19.4	16.2	13.1	9.9	—	—	65.2	3.4	12.2	9.6	7.0	4.4	—	—
	67	61.3	3.0	32.0	28.9	25.7	22.5	19.4	—	57.9	3.2	25.9	23.2	20.6	18.0	15.4	—
3000	62	53.4	3.2	41.8	38.6	35.5	32.3	29.1	25.9	50.6	3.2	38.6	35.9	33.3	30.7	28.0	25.4
	57	51.0	3.1	48.4	47.0	45.1	41.9	38.7	35.6	46.7	3.1	43.2	42.1	40.7	38.1	35.5	32.9
	77	79.2	3.2	8.3	4.7	1.1	—	—	—	75.6	3.4	—	—	—	—	—	—
	72	71.2	3.1	22.5	18.9	15.4	11.8	—	—	68.0	3.3	14.5	11.4	8.2	5.1	—	—
3375	67	63.3	3.0	36.8	33.2	29.6	26.1	22.5	—	60.4	3.1	30.6	27.5	24.3	21.2	18.1	—
	62	55.1	3.1	47.6	44.0	40.5	36.9	33.3	29.8	52.7	3.1	45.5	42.4	39.3	36.2	33.1	29.9
	57	52.7	3.0	52.7	52.7	51.5	48.0	44.4	40.9	48.7	3.0	48.7	48.7	48.1	45.0	41.9	38.7
	72	74.1	3.1	25.2	21.4	17.6	13.8	—	—	70.5	3.2	16.4	12.9	9.4	5.9	—	—
3750	67	65.8	2.9	41.4	37.6	33.8	30.0	26.2	—	62.6	3.1	34.8	31.3	27.8	24.3	20.8	—
	62	57.4	3.1	53.6	49.9	46.1	42.3	38.5	34.6	54.7	3.1	51.1	48.4	44.9	41.4	37.9	34.4
	57	54.8	3.0	54.8	54.8	54.2	50.4	46.6	42.8	50.5	3.0	50.5	50.5	50.2	46.7	43.2	39.7
	72	77.0	3.0	27.9	23.9	19.8	15.7	—	—	73.0	3.2	18.4	14.5	10.6	6.7	—	—
1875	67	68.4	2.9	46.1	42.0	38.0	33.9	29.8	—	64.8	3.0	39.1	35.2	31.3	27.4	23.6	—
	62	59.6	3.1	59.6	55.8	51.7	47.7	43.6	39.5	56.6	3.0	56.6	54.5	50.6	46.7	42.8	38.9
	57	56.9	2.9	56.9	56.9	56.9	52.9	48.8	44.7	52.3	3.0	52.3	52.3	52.3	48.4	44.5	40.6
			55°F								65°F						
1875	72	54.9	3.9	2.3	1.4	0.5	—	—	—	50.6	4.0	0.7	—	—	—	—	—
	67	48.7	3.8	10.3	9.4	8.5	7.6	6.7	—	44.4	3.8	6.8	6.3	5.7	5.2	4.6	—
	62	42.7	3.5	18.9	18.0	17.0	16.1	15.2	14.3	38.5	3.6	13.0	12.5	11.9	11.4	10.8	10.3
2250	72	58.2	3.8	3.7	2.2	0.7	—	—	—	53.6	3.8	1.1	—	—	—	—	—
	67	51.6	3.6	15.0	13.5	12.0	10.5	9.0	—	47.1	3.6	11.6	10.5	9.4	8.2	7.1	—
	62	45.2	3.4	27.1	25.6	24.1	22.6	21.1	19.6	40.7	3.4	22.0	20.9	19.7	18.6	17.5	16.3
2625	57	40.1	3.4	31.2	29.7	28.2	26.7	25.2	23.7	37.6	3.4	25.6	24.5	23.3	22.2	21.0	19.9
	72	61.5	3.6	5.1	3.0	0.9	—	—	—	56.6	3.7	1.6	—	—	—	—	—
	67	54.6	3.5	19.7	17.6	15.5	13.5	11.4	—	49.7	3.5	16.5	14.7	13.0	11.2	9.5	—
	62	47.8	3.2	35.3	33.2	31.1	29.0	26.9	24.9	43.0	3.3	31.0	29.3	27.5	25.8	24.1	22.3
3000	57	42.4	3.2	37.9	37.2	36.4	34.3	32.3	30.2	39.7	3.2	33.7	33.1	32.6	30.8	29.1	27.3
	72	64.7	3.5	6.5	3.8	1.1	—	—	—	59.7	3.5	2.1	—	—	—	—	—
	67	57.5	3.3	24.4	21.7	19.1	16.4	13.7	—	52.4	3.3	21.3	18.9	16.6	14.2	11.9	—
	62	50.4	3.1	43.5	40.8	38.2	35.5	32.8	30.1	45.3	3.1	40.0	37.7	35.4	33.0	30.7	28.3
3375	57	44.7	3.1	44.7	44.7	44.7	42.0	39.3	36.6	41.8	3.1	41.8	41.8	41.8	39.5	37.1	34.8
	72	66.9	3.4	7.7	4.5	1.3	—	—	—	61.6	3.4	2.4	—	—	—	—	—
	67	59.4	3.2	28.2	25.1	21.9	18.7	15.5	—	54.1	3.2	25.9	22.9	20.0	17.1	14.1	—
	62	52.0	3.0	48.6	47.0	43.8	40.6	37.4	34.2	46.8	3.0	44.2	42.9	40.8	37.8	34.9	32.0
3750	57	46.1	3.0	46.1	46.1	46.1	42.9	39.7	36.6	43.2	3.0	43.2	43.2	43.2	40.3	37.3	34.4
	72	69.0	3.3	8.9	5.1	1.4	—	—	—	63.6	3.4	2.8	—	—	—	—	—
	67	61.3	3.2	32.1	28.4	24.7	21.0	17.3	—	55.8	3.2	30.5	27.0	23.4	19.9	16.4	—
	62	53.7	3.0	53.7	53.1	49.4	45.7	42.0	38.3	48.3	3.0	48.3	48.0	46.2	42.7	39.1	35.6
3750	57	47.6	3.0	47.6	47.6	47.6	43.9	40.2	36.5	44.6	2.9	44.6	44.6	44.6	41.0	37.5	34.0

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 82: ZL08 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
1875	72	46.3	4.1	1.0	0.5	—	—	—	—	42.0	4.2	1.3	0.9	—	—	—	—
	67	40.1	3.8	3.3	3.1	3.0	2.8	2.6	—	35.8	3.8	1.8	1.5	1.1	1.0	0.5	—
	62	34.2	3.6	7.2	7.0	6.8	6.6	6.4	6.3	30.0	3.6	2.2	2.0	1.9	1.7	1.5	1.3
2250	72	49.1	3.9	1.8	0.6	—	—	—	—	44.5	4.0	2.5	1.6	—	—	—	—
	67	42.5	3.6	8.3	7.5	6.7	5.9	5.1	—	37.9	3.7	4.9	4.4	4.0	3.6	3.1	—
	62	36.3	3.4	17.0	16.2	15.4	14.6	13.8	13.0	31.8	3.4	11.9	11.5	11.0	10.6	10.2	9.7
	57	35.0	3.4	20.0	19.2	18.4	17.6	16.9	16.1	32.5	3.4	14.4	14.0	13.6	13.1	12.7	12.2
2625	72	51.8	3.7	2.7	0.8	—	—	—	—	47.0	3.8	4.2	2.9	—	—	—	—
	67	44.9	3.5	13.2	11.8	10.4	9.0	7.6	—	40.0	3.5	9.9	8.9	7.8	6.8	5.7	—
	62	38.3	3.3	26.8	25.4	24.0	22.6	21.2	19.8	33.5	3.3	22.5	21.5	20.4	19.4	18.3	17.2
	57	37.0	3.2	29.5	29.1	28.7	27.3	25.9	24.5	34.3	3.2	25.3	25.1	24.9	23.8	22.7	21.7
3000	72	54.6	3.6	3.5	1.1	—	—	—	—	49.5	3.6	6.8	3.7	—	—	—	—
	67	47.3	3.3	18.1	16.1	14.1	12.1	10.1	—	42.2	3.3	15.0	13.3	11.7	10.0	8.3	—
	62	40.3	3.1	36.6	34.6	32.6	30.6	28.5	26.5	35.3	3.1	33.1	31.4	29.8	28.1	26.4	24.7
	57	39.0	3.1	39.0	39.0	39.0	37.0	35.0	33.0	36.2	3.1	36.2	36.2	36.2	34.5	32.8	31.1
3375	72	56.4	3.5	4.8	1.5	—	—	—	—	51.1	3.5	9.3	5.5	—	—	—	—
	67	48.8	3.2	23.5	20.8	18.2	15.5	12.8	—	43.5	3.2	21.1	18.7	16.3	13.9	11.5	—
	62	41.6	3.0	39.8	38.8	37.8	35.1	32.4	29.7	36.5	3.0	35.4	34.7	34.7	32.3	29.9	27.5
	57	40.3	3.0	40.3	40.3	40.3	37.6	34.9	32.2	37.3	3.0	37.3	37.3	37.3	34.9	32.5	30.1
3750	72	58.1	3.4	6.1	1.9	—	—	—	—	52.7	3.4	13.9	8.6	—	—	—	—
	67	50.3	3.2	28.9	25.5	22.2	18.8	15.5	—	44.9	3.2	27.2	24.1	20.9	17.8	14.6	—
	62	43.0	3.0	43.0	43.0	43.0	39.6	36.3	32.9	37.6	3.0	37.6	37.6	37.6	36.6	33.4	30.3
	57	41.5	2.9	41.5	41.5	41.5	38.2	34.9	31.5	38.5	2.9	38.5	38.5	38.5	35.3	32.2	29.0

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 83: ZL09 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
				35°F								45°F					
2125	77	86.6	3.2	10.8	7.3	3.8	—	—	—	81.7	3.6	2.5	—	—	—	—	
	72	78.8	3.1	22.1	18.6	15.1	11.6	—	—	73.9	3.4	13.9	11.4	8.9	6.4	—	
	67	71.0	3.1	33.3	29.8	26.3	22.8	19.3	—	66.0	3.3	25.3	22.7	20.2	17.7	15.2	
	62	61.9	3.3	41.1	37.6	34.1	30.6	27.1	23.6	57.3	3.3	33.8	31.3	28.8	26.3	23.8	
2550	77	89.0	3.1	12.9	9.2	5.5	—	—	—	85.1	3.5	3.0	—	—	—	—	
	72	81.0	3.1	25.0	21.3	17.5	13.8	—	—	76.9	3.3	16.5	13.5	10.5	7.5	—	
	67	73.0	3.1	37.1	33.3	29.6	25.9	22.2	—	68.7	3.2	30.0	27.0	24.0	21.0	18.0	
	62	63.7	3.3	45.1	41.4	37.7	34.0	30.2	26.5	59.7	3.3	40.1	37.1	34.1	31.1	28.1	
2975	57	62.3	3.1	58.4	54.6	50.9	47.2	43.5	39.7	55.4	3.1	49.7	46.8	43.8	40.8	37.8	
	77	91.5	3.0	15.1	11.1	7.2	—	—	—	88.4	3.4	3.5	—	—	—	—	
	72	83.3	3.0	27.9	24.0	20.0	16.1	—	—	79.9	3.3	19.1	15.6	12.2	8.7	—	
	67	75.1	3.0	40.8	36.8	32.9	28.9	25.0	—	71.4	3.1	34.7	31.2	27.7	24.3	20.8	
3400	62	65.5	3.2	49.2	45.3	41.3	37.4	33.4	29.5	62.0	3.2	46.4	42.9	39.5	36.0	32.5	
	57	64.1	3.1	62.1	60.3	56.1	52.2	48.2	44.3	57.5	3.1	54.7	53.2	50.6	47.1	43.7	
	77	93.9	3.0	17.2	13.0	8.9	—	—	—	91.7	3.3	4.0	—	—	—	—	
	72	85.5	3.0	30.8	26.7	22.5	18.3	—	—	82.9	3.2	21.7	17.8	13.8	9.9	—	
3825	67	77.1	2.9	44.5	40.3	36.1	32.0	27.8	—	74.1	3.1	39.4	35.5	31.5	27.5	23.6	
	62	67.3	3.1	53.3	49.1	44.9	40.8	36.6	32.4	64.3	3.1	52.7	48.7	44.8	40.8	36.9	
	57	65.9	3.0	65.9	65.9	61.4	57.2	53.0	48.9	59.7	3.0	59.7	59.7	57.5	53.5	49.5	
	72	92.3	2.9	34.8	30.3	25.8	21.3	—	—	88.1	3.1	24.8	20.3	15.9	11.4	—	
4250	67	83.2	2.9	50.2	45.7	41.2	36.7	32.2	—	78.7	3.0	45.1	40.7	36.2	31.7	27.3	
	62	72.6	3.1	61.3	55.6	51.1	46.6	42.1	37.6	68.3	3.0	60.4	55.9	51.5	47.0	42.5	
	57	71.0	3.0	71.0	71.0	68.7	64.2	59.7	55.2	63.4	2.9	63.4	63.4	62.3	57.8	53.4	
	72	99.1	2.9	38.7	33.9	29.1	24.3	—	—	93.3	3.1	27.9	22.9	17.9	13.0	—	
2125	67	89.3	2.8	55.9	51.1	46.3	41.5	36.6	—	83.3	3.0	50.8	45.8	40.9	35.9	30.9	
	62	77.9	3.0	69.3	62.1	57.3	52.5	47.7	42.8	72.4	3.0	68.1	63.1	58.1	53.1	48.2	
	57	76.1	2.9	76.1	76.1	76.1	71.3	66.4	61.6	67.2	2.9	67.2	67.2	67.2	62.2	57.2	
					55°F								65°F				
2125	72	69.0	3.7	5.7	4.2	2.7	1.2	—	—	64.1	3.8	3.5	2.3	1.0	—	—	
	67	61.0	3.5	17.2	15.6	14.1	12.6	11.1	—	55.7	3.5	14.0	12.7	11.5	10.3	9.0	
	62	52.7	3.3	26.5	25.0	23.5	22.0	20.5	19.0	47.3	3.4	22.4	21.2	20.0	18.7	17.5	
2550	72	72.8	3.6	8.0	5.8	3.5	1.3	—	—	67.3	3.6	5.1	3.2	1.3	—	—	
	67	64.4	3.4	22.9	20.6	18.4	16.1	13.9	—	58.5	3.4	19.2	17.3	15.4	13.5	11.6	
	62	55.6	3.2	35.1	32.8	30.5	28.3	26.0	23.8	49.7	3.3	30.6	28.7	26.8	24.9	23.1	
2975	57	48.5	3.1	41.1	38.9	36.6	34.4	32.1	29.8	45.3	3.2	36.5	34.6	32.7	30.8	28.9	
	72	76.5	3.5	10.3	7.3	4.3	1.3	—	—	70.5	3.5	6.7	4.1	1.6	—	—	
	67	67.7	3.3	28.6	25.6	22.6	19.6	16.6	—	61.3	3.3	24.4	21.9	19.3	16.8	14.2	
	62	58.5	3.1	43.6	40.6	37.6	34.6	31.6	28.6	52.0	3.2	38.8	36.2	33.7	31.1	28.6	
3400	57	51.0	3.0	47.3	46.2	45.1	42.1	39.1	36.1	47.5	3.1	43.0	42.1	41.0	38.5	36.0	
	72	80.3	3.4	12.6	8.9	5.1	1.4	—	—	73.7	3.4	8.3	5.1	1.9	—	—	
	67	71.1	3.2	34.4	30.6	26.9	23.1	19.4	—	64.0	3.2	29.6	26.4	23.2	20.0	16.8	
	62	61.4	3.0	52.1	48.4	44.6	40.9	37.1	33.4	54.4	3.1	47.0	43.8	40.5	37.3	34.1	
3825	57	53.5	3.0	53.5	53.5	53.5	49.8	46.0	42.3	49.6	3.0	49.6	49.6	49.4	46.2	43.0	
	72	83.9	3.4	14.8	10.4	5.9	1.5	—	—	76.9	3.4	10.0	6.0	2.1	—	—	
	67	74.2	3.1	40.0	35.6	31.2	26.7	22.3	—	66.8	3.1	35.7	31.8	27.8	23.9	19.9	
	62	64.1	3.0	59.5	56.2	51.8	47.3	42.9	38.5	56.8	3.0	53.1	50.8	47.9	43.9	40.0	
4250	57	55.9	2.9	55.9	55.9	55.9	51.4	47.0	42.6	51.8	2.9	51.8	51.8	51.7	47.7	43.8	
	72	87.4	3.3	17.0	11.9	6.8	1.6	—	—	80.1	3.3	11.7	7.0	2.3	—	—	
	67	77.3	3.1	45.7	40.6	35.5	30.3	25.2	—	69.6	3.1	41.8	37.1	32.4	27.7	23.1	
	62	66.8	2.9	66.8	64.1	58.9	53.8	48.7	43.6	59.1	3.0	59.1	57.8	55.2	50.5	45.9	
	57	58.2	2.9	58.2	58.2	58.2	53.1	48.0	42.9	54.0	2.9	54.0	54.0	54.0	49.3	44.6	

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 84: ZL09 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
2125	72	59.2	3.8	1.3	—	—	—	—	—	54.4	3.8	—	—	—	—	—	—
	67	50.4	3.6	10.7	9.8	8.8	7.9	7.0	—	45.0	3.6	7.5	6.9	6.2	5.5	4.9	—
	62	41.9	3.5	18.3	17.4	16.4	15.5	14.6	13.6	36.5	3.5	14.3	13.6	12.9	12.3	11.6	10.9
2550	72	61.8	3.7	2.2	0.6	—	—	—	—	56.4	3.7	—	—	—	—	—	—
	67	52.6	3.5	15.5	14.0	12.4	10.9	9.4	—	46.7	3.5	11.8	10.6	9.5	8.3	7.2	—
	62	43.7	3.4	26.2	24.6	23.1	21.6	20.1	18.6	37.8	3.4	21.7	20.6	19.4	18.3	17.1	16.0
2975	72	64.4	3.6	3.0	0.9	—	—	—	—	58.4	3.6	—	—	—	—	—	—
	67	54.8	3.3	20.2	18.1	16.0	13.9	11.8	—	48.3	3.4	16.0	14.4	12.7	11.1	9.5	—
	62	45.6	3.2	34.0	31.9	29.8	27.7	25.6	23.5	39.1	3.3	29.2	27.5	25.9	24.3	22.6	21.0
3400	72	67.1	3.4	3.9	1.3	—	—	—	—	60.4	3.5	—	—	—	—	—	—
	67	57.0	3.2	24.9	22.3	19.6	16.9	14.3	—	50.0	3.3	20.2	18.1	16.0	13.9	11.7	—
	62	47.4	3.1	41.8	39.1	36.5	33.8	31.1	28.5	40.4	3.2	36.6	34.5	32.4	30.3	28.1	26.0
3825	72	69.9	3.4	5.2	1.7	—	—	—	—	63.0	3.4	—	—	—	—	—	—
	67	59.5	3.2	31.4	27.9	24.5	21.0	17.6	—	52.1	3.2	27.1	24.1	21.1	18.2	15.2	—
	62	49.5	3.1	46.7	45.3	44.0	40.5	37.1	33.6	42.2	3.1	40.2	39.9	40.1	37.1	34.2	31.2
4250	72	72.8	3.3	6.4	2.1	—	—	—	—	65.6	3.3	1.1	—	—	—	—	—
	67	61.9	3.1	37.8	33.6	29.4	25.1	20.9	—	54.2	3.1	33.9	30.1	26.3	22.5	18.7	—
	62	51.5	3.0	51.5	51.5	51.5	47.3	43.0	38.8	43.9	3.0	43.9	43.9	43.9	43.9	40.2	36.4
	57	49.7	2.9	49.7	49.7	49.7	45.4	41.2	37.0	45.4	2.9	45.4	45.4	45.4	41.6	37.8	34.0

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 85: ZL12 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil																	
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)							
				Return dry bulb (°F)								Return dry bulb (°F)							
				90	85	80	75	70	65			90	85	80	75	70	65		
		35°F									45°F								
2500	77	78.5	4.7	3.7	2.9	2.1	—	—	—	78.1	4.6	—	—	—	—	—	—		
	72	75.0	4.6	7.6	6.7	5.9	5.1	—	—	73.9	4.4	2.7	1.9	1.0	—	—	—		
	67	71.4	4.5	11.4	10.6	9.7	8.9	8.1	—	69.7	4.3	11.6	10.7	9.8	8.9	8.0	—		
	62	67.4	4.9	16.2	15.4	14.6	13.8	13.0	12.2	64.6	4.4	20.2	19.3	18.4	17.5	16.7	15.8		
3000	77	81.0	4.3	3.4	1.6	—	—	—	—	79.9	4.4	—	—	—	—	—	—		
	72	77.3	4.2	11.9	10.2	8.4	6.6	—	—	75.6	4.2	4.7	3.1	1.5	—	—	—		
	67	73.6	4.1	20.5	18.7	17.0	15.2	13.4	—	71.3	4.0	18.4	16.8	15.2	13.6	12.0	—		
	62	69.4	4.5	30.4	28.6	26.8	25.1	23.3	21.6	66.1	4.2	31.7	30.1	28.5	26.9	25.3	23.7		
3500	57	60.3	4.6	36.9	35.1	33.3	31.6	29.8	28.1	58.4	4.2	38.9	37.3	35.7	34.1	32.5	30.9		
	77	83.4	3.9	3.0	—	—	—	—	—	81.7	4.1	—	—	—	—	—	—		
	72	79.6	3.8	16.3	13.6	10.9	8.2	—	—	77.3	4.0	6.7	4.4	2.0	—	—	—		
	67	75.7	3.8	29.6	26.9	24.2	21.5	18.8	—	72.9	3.8	25.2	22.9	20.5	18.2	15.9	—		
4000	62	71.5	4.2	44.5	41.8	39.1	36.4	33.7	31.0	67.5	3.9	43.3	40.9	38.6	36.3	34.0	31.6		
	57	62.1	4.2	50.4	49.5	48.6	45.9	43.2	40.5	59.6	4.0	49.9	49.1	48.3	46.0	43.6	41.3		
	77	85.8	3.5	2.7	—	—	—	—	—	83.4	3.9	—	—	—	—	—	—		
	72	81.9	3.5	20.7	17.0	13.4	9.7	—	—	78.9	3.8	8.7	5.6	2.6	—	—	—		
4500	67	77.9	3.4	38.7	35.1	31.4	27.8	24.1	—	74.4	3.6	32.0	29.0	25.9	22.9	19.8	—		
	62	73.5	3.8	58.6	55.0	51.3	47.7	44.0	40.4	69.0	3.7	54.8	51.8	48.7	45.7	42.6	39.6		
	57	63.9	3.8	63.9	63.9	63.9	60.2	56.5	52.9	60.9	3.8	60.9	60.9	60.9	57.9	54.8	51.8		
	72	83.0	3.4	23.8	19.7	15.7	11.7	—	—	80.3	3.7	9.9	6.5	3.0	—	—	—		
5000	67	79.0	3.4	44.6	40.6	36.5	32.5	28.5	—	75.7	3.6	37.2	33.8	30.3	26.9	23.4	—		
	62	74.6	3.8	67.1	63.6	59.6	55.6	51.6	47.5	70.2	3.7	63.1	60.5	57.0	53.5	50.1	46.6		
	57	64.7	3.8	64.7	64.7	64.7	60.7	56.7	52.7	62.0	3.7	62.0	62.0	62.0	58.5	55.1	51.6		
	72	84.2	3.4	26.9	22.5	18.1	13.7	—	—	81.7	3.7	11.2	7.3	3.5	—	—	—		
5500	67	80.1	3.3	50.5	46.1	41.7	37.3	32.9	—	77.1	3.6	42.5	38.6	34.7	30.8	27.0	—		
	62	75.6	3.7	75.6	72.3	67.9	63.5	59.1	54.7	71.4	3.7	71.4	69.1	65.3	61.4	57.5	53.6		
	57	65.6	3.7	65.6	65.6	65.6	61.3	56.9	52.5	63.1	3.7	63.1	63.1	63.1	59.2	55.3	51.4		
			55°F									65°F							
2500	72	72.9	4.3	—	—	—	—	—	—	68.8	4.3	—	—	—	—	—	—		
	67	68.1	4.0	11.8	10.8	9.9	8.9	7.9	—	62.5	4.0	7.6	7.0	6.5	5.9	5.3	—		
	62	61.9	3.8	24.2	23.2	22.3	21.3	20.3	19.4	55.1	3.8	16.6	16.0	15.5	14.9	14.4	13.8		
3000	72	73.9	4.2	—	—	—	—	—	—	70.2	4.2	—	—	—	—	—	—		
	67	69.0	4.0	16.3	14.8	13.4	11.9	10.5	—	63.8	4.0	12.2	11.1	10.1	9.0	8.0	—		
	62	62.7	3.8	33.1	31.7	30.2	28.8	27.3	25.9	56.2	3.8	26.9	25.8	24.8	23.7	22.7	21.6		
3500	57	56.4	3.8	40.9	39.4	38.0	36.5	35.1	33.6	50.9	3.8	32.5	31.5	30.4	29.3	28.3	27.2		
	72	75.0	4.1	—	—	—	—	—	—	71.7	4.2	—	—	—	—	—	—		
	67	70.0	3.9	20.8	18.8	16.9	15.0	13.0	—	65.1	3.9	16.8	15.3	13.7	12.1	10.6	—		
	62	63.6	3.7	42.0	40.1	38.2	36.2	34.3	32.3	57.4	3.7	37.2	35.6	34.1	32.5	31.0	29.4		
4000	57	57.2	3.7	49.4	48.7	48.0	46.0	44.1	42.2	51.9	3.7	42.7	42.2	41.7	40.1	38.6	37.0		
	72	76.0	4.1	—	—	—	—	—	—	73.1	4.1	—	—	—	—	—	—		
	67	71.0	3.9	25.3	22.9	20.4	18.0	15.6	—	66.4	3.8	21.4	19.4	17.3	15.2	13.2	—		
	62	64.5	3.7	51.0	48.6	46.1	43.7	41.2	38.8	58.5	3.7	47.5	45.5	43.4	41.3	39.3	37.2		
4500	57	58.0	3.7	58.0	58.0	58.0	55.6	53.1	50.7	52.9	3.7	52.9	52.9	52.9	50.9	48.8	46.8		
	72	77.6	4.1	—	—	—	—	—	—	74.0	4.1	—	—	—	—	—	—		
	67	72.5	3.8	29.9	27.0	24.1	21.2	18.3	—	67.2	3.8	26.8	24.2	21.6	19.0	16.4	—		
	62	65.9	3.6	59.1	57.3	54.4	51.5	48.6	45.7	59.3	3.6	53.8	52.4	50.6	48.0	45.4	42.8		
5000	57	59.2	3.7	59.2	59.2	59.2	56.3	53.4	50.5	53.7	3.7	53.7	53.7	53.7	51.0	48.4	45.8		
	72	79.2	4.0	—	—	—	—	—	—	75.0	4.0	—	—	—	—	—	—		
	67	74.0	3.8	34.5	31.1	27.7	24.4	21.0	—	68.1	3.8	32.2	29.0	25.9	22.7	19.6	—		
	62	67.2	3.6	67.2	66.0	62.6	59.3	55.9	52.5	60.1	3.6	60.1	59.4	57.8	54.6	51.5	48.3		
5500	57	60.5	3.6	60.5	60.5	60.5	57.1	53.8	50.4	54.4	3.6	54.4	54.4	54.4	51.2	48.1	44.9		

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 86: ZL12 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
2500	72	64.7	4.3	—	—	—	—	—	—	60.6	4.3	—	—	—	—	—	—
	67	56.9	4.0	3.3	3.2	3.0	2.9	2.8	—	51.3	4.0	1.8	1.6	1.3	1.0	0.5	—
	62	48.4	3.8	9.0	8.9	8.7	8.6	8.4	8.3	41.6	3.8	2.7	2.5	2.2	2.0	1.7	1.4
3000	72	66.5	4.2	—	—	—	—	—	—	62.8	4.2	—	—	—	—	—	—
	67	58.5	4.0	8.1	7.4	6.8	6.1	5.4	—	53.3	4.0	4.0	3.7	3.5	3.2	2.9	—
	62	49.7	3.8	20.7	20.0	19.4	18.7	18.0	17.4	43.2	3.8	14.5	14.2	13.9	13.7	13.4	13.1
	57	45.4	3.8	24.1	23.5	22.8	22.2	21.5	20.8	39.8	3.8	15.8	15.5	15.2	15.0	14.7	14.4
3500	72	68.4	4.2	—	—	—	—	—	—	65.1	4.2	—	—	—	—	—	—
	67	60.2	3.9	12.8	11.7	10.5	9.3	8.1	—	55.2	3.9	8.9	8.1	7.3	6.5	5.7	—
	62	51.1	3.7	32.4	31.2	30.0	28.8	27.7	26.5	44.9	3.7	27.5	26.7	25.9	25.1	24.4	23.6
	57	46.6	3.8	36.0	35.7	35.4	34.2	33.0	31.8	41.3	3.8	29.3	29.2	29.0	28.2	27.5	26.7
4000	72	70.2	4.1	—	—	—	—	—	—	67.4	4.1	—	—	—	—	—	—
	67	61.8	3.8	17.6	15.9	14.2	12.5	10.8	—	57.2	3.8	13.7	12.4	11.1	9.8	8.4	—
	62	52.5	3.6	44.0	42.4	40.7	39.0	37.3	35.6	46.5	3.6	40.6	39.3	37.9	36.6	35.3	34.0
	57	47.9	3.7	47.9	47.9	47.9	46.2	44.5	42.8	42.9	3.7	42.9	42.9	42.9	41.5	40.2	38.9
4500	72	70.5	4.1	—	—	—	—	—	—	66.9	4.1	—	—	—	—	—	—
	67	62.0	3.8	23.7	21.4	19.1	16.8	14.5	—	56.8	3.8	20.6	18.6	16.6	14.6	12.6	—
	62	52.7	3.6	48.5	47.6	46.8	44.5	42.1	39.8	46.1	3.6	43.1	42.8	43.0	41.0	38.9	36.9
	57	48.1	3.7	48.1	48.1	48.1	45.8	43.4	41.1	42.5	3.7	42.5	42.5	42.5	40.5	38.5	36.4
5000	72	70.7	4.0	—	—	—	—	—	—	66.5	4.0	—	—	—	—	—	—
	67	62.2	3.8	29.8	26.9	24.0	21.1	18.1	—	56.3	3.7	27.5	24.8	22.1	19.4	16.7	—
	62	52.9	3.6	52.9	52.9	52.9	50.0	47.0	44.1	45.7	3.6	45.7	45.7	45.7	45.3	42.6	39.9
	57	48.2	3.6	48.2	48.2	48.2	45.3	42.4	39.5	42.1	3.6	42.1	42.1	42.1	39.4	36.7	34.0

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 87: ZL14 reheat capacity (35°F to 65°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
				35°F								45°F					
3125	77	134.9	4.7	11.4	9.3	7.2	—	—	—	114.5	4.7	4.0	2.2	0.5	—	—	—
	72	115.1	4.6	17.4	15.3	13.2	11.2	—	—	100.9	4.6	11.9	10.1	8.4	6.6	—	—
	67	95.2	4.6	23.3	21.3	19.2	17.2	15.1	—	87.4	4.5	19.8	18.0	16.3	14.6	12.8	—
	62	86.6	4.9	32.8	30.8	28.7	26.7	24.6	22.5	78.1	4.5	30.9	29.1	27.4	25.6	23.9	22.2
3750	77	136.3	4.4	16.8	13.7	10.6	—	—	—	117.7	4.6	6.0	3.3	0.7	—	—	—
	72	116.1	4.4	25.1	22.0	18.9	15.8	—	—	103.8	4.5	17.4	14.7	12.0	9.4	—	—
	67	95.9	4.4	33.4	30.3	27.2	24.1	21.0	—	89.8	4.4	28.7	26.1	23.4	20.7	18.1	—
	62	87.2	4.6	46.7	43.6	40.5	37.4	34.3	31.2	80.3	4.4	44.7	42.0	39.3	36.7	34.0	31.3
4375	57	72.3	4.8	53.4	50.3	47.2	44.1	41.0	37.9	70.2	4.4	51.4	48.7	46.1	43.4	40.7	38.1
	77	137.7	4.1	22.2	18.1	13.9	—	—	—	120.9	4.4	8.1	4.5	0.9	—	—	—
	72	117.1	4.1	32.8	28.7	24.6	20.4	—	—	106.6	4.3	22.9	19.3	15.7	12.1	—	—
	67	96.6	4.1	43.4	39.3	35.2	31.1	27.0	—	92.3	4.2	37.7	34.1	30.5	26.9	23.3	—
	62	87.9	4.4	60.5	56.4	52.2	48.1	44.0	39.9	82.5	4.2	58.5	54.9	51.3	47.7	44.1	40.5
	57	72.6	4.5	63.2	61.7	60.9	56.8	52.7	48.5	72.1	4.3	62.7	61.4	60.0	56.4	52.9	49.3
5000	77	139.1	3.9	27.6	22.4	17.3	—	—	—	124.1	4.3	10.1	5.6	1.1	—	—	—
	72	118.2	3.9	40.5	35.4	30.2	25.1	—	—	109.4	4.2	28.4	23.9	19.3	14.8	—	—
	67	97.2	3.9	53.5	48.3	43.2	38.0	32.9	—	94.7	4.1	46.6	42.1	37.6	33.1	28.6	—
	62	88.6	4.1	74.3	69.1	64.0	58.8	53.7	48.5	84.7	4.1	72.2	67.7	63.2	58.7	54.2	49.7
	57	73.0	4.3	73.0	73.0	73.0	69.5	64.3	59.1	74.0	4.1	74.0	74.0	74.0	69.5	65.0	60.5
5625	72	122.9	3.8	44.0	38.7	33.4	28.1	—	—	111.5	4.2	31.5	26.5	21.5	16.6	—	—
	67	101.3	3.8	57.6	52.3	47.0	41.7	36.3	—	96.5	4.1	51.8	46.9	41.9	36.9	32.0	—
	62	92.2	4.1	85.1	77.7	69.7	64.4	59.0	53.7	86.3	4.1	80.0	75.4	70.4	65.4	60.5	55.5
	57	76.2	4.3	76.2	76.2	71.7	66.4	61.0	57.4	75.4	4.1	75.4	75.4	75.4	70.4	65.5	60.5
6250	72	127.6	3.8	47.5	42.0	36.5	31.0	—	—	113.5	4.1	34.6	29.2	23.7	18.3	—	—
	67	105.4	3.8	61.8	56.3	50.8	45.3	39.8	—	98.2	4.0	57.0	51.6	46.2	40.7	35.3	—
	62	95.9	4.1	95.9	86.2	75.4	69.9	64.4	58.9	87.8	4.0	87.8	83.0	77.6	72.2	66.7	61.3
	57	79.5	4.2	79.5	79.5	79.5	74.0	68.5	62.9	76.8	4.1	76.8	76.8	76.8	71.3	65.9	60.5
				55°F								65°F					
3125	72	86.8	4.6	6.4	5.0	3.5	2.1	—	—	82.3	4.6	2.8	1.7	0.5	—	—	—
	67	79.5	4.4	16.2	14.8	13.4	11.9	10.5	—	74.1	4.4	13.3	12.1	11.0	9.8	8.7	—
	62	69.7	4.2	28.9	27.5	26.0	24.6	23.2	21.8	64.3	4.2	25.4	24.2	23.1	21.9	20.8	19.6
3750	72	91.4	4.6	9.7	7.4	5.2	2.9	—	—	86.2	4.6	4.4	2.5	0.6	—	—	—
	67	83.7	4.4	24.1	21.8	19.6	17.3	15.1	—	77.5	4.4	20.5	18.6	16.7	14.7	12.8	—
	62	73.4	4.1	42.7	40.4	38.2	35.9	33.7	31.4	67.3	4.1	39.0	37.1	35.2	33.3	31.3	29.4
4375	57	68.1	4.1	49.4	47.2	44.9	42.7	40.4	38.2	64.1	4.1	44.7	42.8	40.9	39.0	37.1	35.2
	72	96.1	4.5	12.9	9.9	6.8	3.8	—	—	90.0	4.6	6.0	3.3	0.7	—	—	—
	67	88.0	4.3	31.9	28.9	25.8	22.8	19.7	—	81.0	4.3	27.7	25.0	22.3	19.7	17.0	—
	62	77.2	4.1	56.4	53.4	50.3	47.2	44.2	41.1	70.3	4.1	52.6	49.9	47.2	44.6	41.9	39.3
5000	57	71.6	4.0	62.2	61.1	59.2	56.1	53.1	50.0	66.9	4.0	57.3	56.3	54.9	52.3	49.6	47.0
	72	100.7	4.5	16.2	12.3	8.5	4.6	—	—	93.8	4.5	7.6	4.2	0.8	—	—	—
	67	92.2	4.3	39.8	35.9	32.0	28.2	24.3	—	84.4	4.3	34.8	31.4	28.0	24.6	21.2	—
	62	80.9	4.1	70.2	66.3	62.4	58.6	54.7	50.8	73.3	4.1	66.1	62.7	59.3	55.9	52.5	49.1
5625	57	75.0	4.0	75.0	75.0	73.5	69.6	65.7	61.8	69.8	4.0	69.8	69.8	69.0	65.6	62.2	58.8
	72	100.0	4.5	18.9	14.3	9.7	5.1	—	—	93.1	4.5	8.9	4.7	0.5	—	—	—
	67	91.6	4.3	46.0	41.4	36.8	32.2	27.6	—	83.8	4.3	41.8	37.6	33.4	29.2	25.0	—
	62	80.3	4.0	75.0	73.1	71.1	66.5	61.9	57.3	72.8	4.0	69.2	67.5	65.8	61.6	57.4	53.2
	57	74.5	4.0	74.5	74.5	73.8	69.1	64.5	59.9	69.2	4.0	69.2	69.2	68.8	64.6	60.4	56.3
6250	72	99.4	4.4	21.7	16.3	11.0	5.6	—	—	92.3	4.4	10.3	5.3	—	—	—	—
	67	91.0	4.2	52.3	46.9	41.6	36.2	30.9	—	83.1	4.2	48.7	43.8	38.8	33.8	28.8	—
	62	79.8	4.0	79.8	79.8	79.8	74.5	69.1	63.8	72.2	4.0	72.2	72.2	72.2	67.2	62.2	57.2
	57	74.1	3.9	74.1	74.1	74.1	68.7	63.4	58.0	68.7	3.9	68.7	68.7	68.7	63.7	58.7	53.7

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

**Table 88: ZL14 reheat capacity (75°F to 85°F)**

Air on evaporator coil		Temperature of air on condenser coil															
CFM	WB (°F)	Total capacity (MBh) <sup>1</sup>	Total input (kW) <sup>2</sup>	Sensible capacity (MBh)						Total capacity (MBh)	Total input(kW)	Sensible capacity (MBh)					
				Return dry bulb (°F)								Return dry bulb (°F)					
				90	85	80	75	70	65			90	85	80	75	70	65
		75°F								85°F							
3125	72	77.9	4.6	—	—	—	—	—	—	73.4	4.7	—	—	—	—	—	—
	67	68.7	4.4	10.4	9.5	8.6	7.7	6.8	—	63.3	4.4	7.4	6.8	6.2	5.6	4.9	—
	62	59.0	4.2	21.9	21.0	20.1	19.2	18.3	17.4	53.6	4.1	18.4	17.8	17.1	16.5	15.9	15.2
3750	72	80.9	4.6	—	—	—	—	—	—	75.6	4.6	—	—	—	—	—	—
	67	71.3	4.4	16.9	15.3	13.7	12.1	10.6	—	65.1	4.3	13.3	12.0	10.8	9.5	8.3	—
	62	61.3	4.1	35.3	33.7	32.1	30.6	29.0	27.4	55.2	4.1	31.6	30.4	29.1	27.9	26.6	25.4
4375	72	83.9	4.6	—	—	—	—	—	—	77.8	4.6	—	—	—	—	—	—
	67	74.0	4.3	23.4	21.1	18.9	16.6	14.3	—	67.0	4.3	19.1	17.2	15.4	13.5	11.7	—
	62	63.5	4.1	48.7	46.4	44.2	41.9	39.7	37.4	56.7	4.1	44.8	43.0	41.1	39.3	37.4	35.6
5000	72	86.9	4.5	—	—	—	—	—	—	80.0	4.5	—	—	—	—	—	—
	67	76.7	4.3	29.9	26.9	24.0	21.1	18.1	—	68.9	4.3	24.9	22.4	20.0	17.5	15.1	—
	62	65.8	4.0	62.1	59.1	56.2	53.3	50.3	47.4	58.3	4.0	58.0	55.6	53.1	50.6	48.2	45.7
5625	72	86.1	4.5	—	—	—	—	—	—	79.1	4.5	—	—	—	—	—	—
	67	75.9	4.2	37.5	33.8	30.0	26.2	22.4	—	68.1	4.2	33.3	29.9	26.6	23.2	19.9	—
	62	65.2	4.0	63.3	61.8	60.4	56.6	52.8	49.1	57.6	4.0	57.5	56.2	55.0	51.7	48.3	45.0
6250	72	85.2	4.5	—	—	—	—	—	—	78.2	4.5	—	—	—	—	—	—
	67	75.2	4.2	45.2	40.6	36.0	31.4	26.8	—	67.3	4.2	41.7	37.4	33.2	29.0	24.7	—
	62	64.6	4.0	64.6	64.6	64.6	59.9	55.3	50.7	56.9	4.0	56.9	56.9	56.9	52.7	48.4	44.2
6250	72	85.2	4.5	—	—	—	—	—	—	78.2	4.5	—	—	—	—	—	—
	67	75.2	4.2	45.2	40.6	36.0	31.4	26.8	—	67.3	4.2	41.7	37.4	33.2	29.0	24.7	—
	62	64.6	4.0	64.6	64.6	64.6	59.9	55.3	50.7	56.9	4.0	56.9	56.9	56.9	52.7	48.4	44.2



## Drive selection

1. Determine the side or bottom supply duct application.
2. Determine the required airflow.
3. Calculate or measure the amount of external static pressure.
  - Add or deduct any additional static resistance from [Additional static resistance](#).
4. Using the operating point determined from Steps 1, 2, and 3, locate this point on the appropriate supply air blower performance table. (Linear interpolation may be necessary.)
5. Noting the RPM and BHP from Step 4, locate the appropriate motor and, or drive on the RPM selection table.
6. Review the BHP compared to the motor options available. Select the appropriate motor and, or drive.
7. Review the RPM range for the motor options available. Select the appropriate drive if multiple drives are available for the chosen motor.
8. Determine the number of turns required open to obtain the required operation point.

### Example

1. 3200 SCFM, bottom supply duct application
2. 1.8 IWG
3. Using the airflow performance table below, the following data point was located: 1071 RPM and 2.52 BHP.
4. Using the RPM selection table below, model ZY and size 08 (7.5 tons) is found.
5. 2.52 BHP exceeds the maximum continuous BHP rating of the 2.4 HP motor. The 3.7 HP motor is required.
6. 1071 RPM is within the range of the 3.7 HP motor.
7. Using the 3.7-HP motor and high-static drive, 0.5 turns open achieves the required 1071 RPM.

# Airflow performance

Example supply air blower performance

**Table 89: ZY08 (7.5 ton) bottom duct**

cfm	Available external static, IWG																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	556	0.45	621	0.65	683	0.83	742	1.00	798	1.18	852	1.34	904	1.51	954	1.69	1003	1.87	1050	2.06
2400	567	0.53	632	0.73	694	0.91	753	1.09	809	1.26	863	1.43	914	1.60	964	1.77	1013	1.95	1060	2.14
2600	580	0.65	646	0.85	707	1.03	766	1.21	823	1.38	876	1.55	928	1.72	978	1.89	1027	2.07	1074	2.27
2800	595	0.79	660	0.99	722	1.17	780	1.35	837	1.52	890	1.69	942	1.86	992	2.03	1041	2.21	1088	2.40
3000	609	0.94	674	1.14	736	1.32	795	1.50	851	1.67	905	1.83	957	2.00	1007	2.18	1056	2.36	1100	2.55
3200	625	1.10	690	1.30	752	1.48	810	1.66	867	1.83	921	2.00	972	2.17	1022	2.34	1071	2.52	--	--
3400	641	1.28	706	1.47	768	1.66	827	1.83	883	2.00	937	2.17	989	2.34	1039	2.52	1087	2.70	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

**Table 90: Example rpm selection**

Model	Size (ton)	Airflow Option	Phase	Max bhp	Blower Sheave	Motor Sheave	6 Turns open	5 Turns open	4 Turns open	3 Turns open	2 Turns open	1 Turns open	Fully closed
ZY	08 (7.5)	Std.	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med.	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100

**Table 91: Example additional static resistance**

Model	Size (ton)	cfm	Cooling only <sup>1</sup>	Economizer <sup>2,3</sup>	4 in. filters <sup>2</sup>	Electric heat kW <sup>2</sup>							
						6/6.5	9.2/10.5/11	13.8/14/16	16/16.5/17	23	24.8/25.5/27.8	32/33/34	41.7/42.4
ZY	08 (7.5), 09 (8.5), 12 (10.0)	2200	0.04	0.11	---	---	---	---	0.07	---	0.09	0.10	0.12
		2600	0.06	0.13	---	---	---	---	0.09	---	0.11	0.12	0.15
		3000	0.10	0.17	---	---	---	---	0.12	---	0.14	0.15	0.19
		3400	0.13	0.20	---	---	---	---	0.15	---	0.18	0.19	0.23
		3800	0.16	0.25	---	---	---	---	0.19	---	0.22	0.23	0.27
		4000	0.17	0.28	---	---	---	---	0.21	---	0.24	0.25	0.30
		4400	0.20	0.33	---	---	---	---	0.25	---	0.29	0.30	0.35
		4800	0.22	0.38	---	---	---	---	0.30	---	0.34	0.35	0.41
		5200	0.24	0.43	---	---	---	---	0.35	---	0.39	0.41	0.47
		5600	0.26	0.46	---	---	---	---	0.41	---	0.45	0.47	0.54
		6000	0.28	0.50	---	---	---	---	0.48	---	0.52	0.54	0.60

## Altitude and temperature correction for cfm, static pressure, and power

Use the following information to assist in application of product when being applied at altitudes at or exceeding 1000 ft above sea level.


The air flow rates listed in the standard blower performance tables are based on standard air at sea level. As the altitude or temperature increases, the density of air decreases. In order to use the indoor blower tables for high altitude applications, certain corrections are necessary.

A centrifugal fan is a "constant volume" device. This means that, if the RPM remains constant, the CFM delivered is the same regardless of the density of the air. However, because the air at high altitude is less dense, less static pressure is generated and less power is required than a similar application at sea level. See [Altitude/temperature correction factors](#) for air density correction factors.

## Altitude/temperature correction factors

**Table 92: Altitude/temperature correction factors**

Air temp.	Altitude (ft)										
	0	1000	2000	3000	4000	5000	6000	7000	8000	9000	10000
40	1.060	1.022	0.986	0.950	0.916	0.882	0.849	0.818	0.788	0.758	0.729
50	1.039	1.002	0.966	0.931	0.898	0.864	0.832	0.802	0.772	0.743	0.715
60	1.019	0.982	0.948	0.913	0.880	0.848	0.816	0.787	0.757	0.729	0.701
70	1.000	0.964	0.930	0.896	0.864	0.832	0.801	0.772	0.743	0.715	0.688
80	0.982	0.947	0.913	0.880	0.848	0.817	0.787	0.758	0.730	0.702	0.676
90	0.964	0.929	0.897	0.864	0.833	0.802	0.772	0.744	0.716	0.689	0.663
100	0.946	0.912	0.880	0.848	0.817	0.787	0.758	0.730	0.703	0.676	0.651

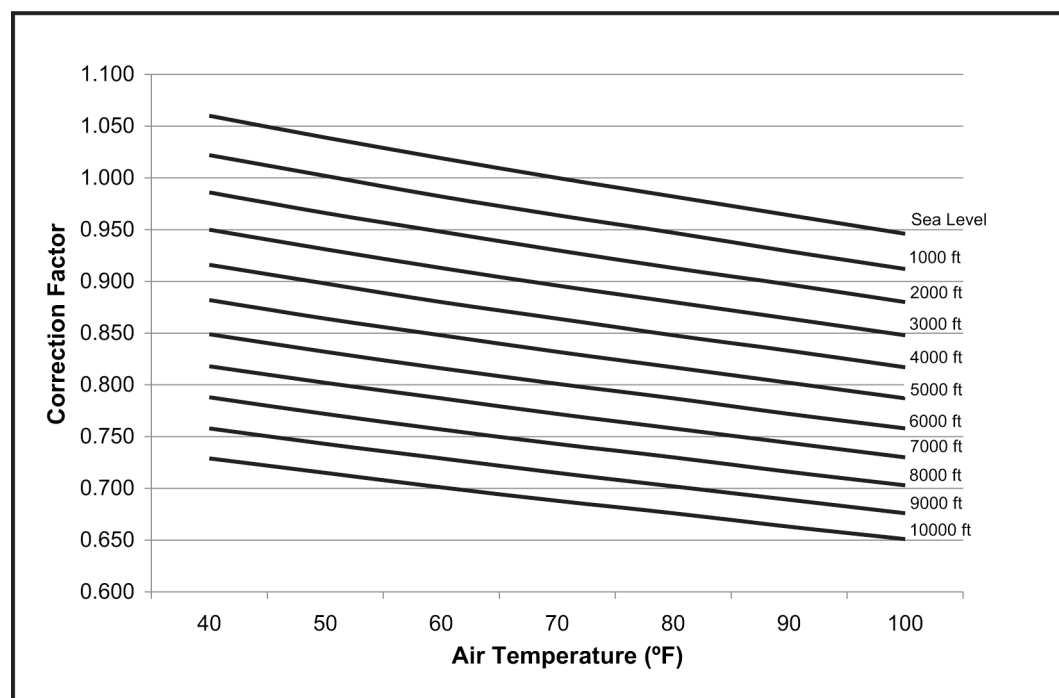

Use the following examples to determine the airflow performance of the product at altitude.

**Example 1:** What are the corrected CFM, static pressure, and BHP at an elevation of 5,000 ft if the airflow performance data is 3,000 CFM, 1.4 IWC, and 2.0 BHP?

**Solution:** At an elevation of 5,000 ft, the indoor blower still delivers 3,000 CFM if the rpm is unchanged. However, the Altitude correction must be used to determine the static pressure and BHP. Because no temperature data is given, we assume an air temperature of 70°F. The altitude/temperature factors show the correction factor to be 0.832.

Corrected static pressure =  $1.4 \times 0.832 = 1.16$  IWC

Corrected BHP =  $2.0 \times 0.832 = 1.66$

**Example 2:** A system, located at 5,000 feet of elevation, is to deliver 3,000 CFM at a static pressure of 1.4 in. Use the unit blower tables to select the blower speed and the BHP requirement.

**Solution:** As in the example above, no temperature information is given so 70°F is assumed. The 1.4 in. static pressure given is at an elevation of 5,000 ft. The first step is to convert this static pressure to equivalent sea level conditions.

Sea level static pressure =  $1.4 \text{ in.} / 0.832 = 1.68 \text{ in.}$

Enter the supply air blower performance table at 3,000 CFM and static pressure of 1.68 in. The RPM listed is the same RPM needed at 5,000 ft. If the corresponding BHP listed in the table is 2.0. Correct this value for elevation.

BHP at 5,000 ft. = 2.0 x 0.832 = 1.66

## Indoor blower specifications

**Table 93: Indoor blower specifications**

Model	Size (ton)	Airflow option	Motor						Motor sheave			Blower sheave			Belt
			Phase	HP	RPM	Eff.	SF	Frame	Datum dia. (in.)	Bore (in.)	Model	Datum Dia. (in.)	Bore (in.)	Model	
ZQ	04 (3)	Std.	Direct Drive												
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
ZQ	05 (4)	Std.	Direct Drive												
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
ZQ	06 (5)	Std.	Direct Drive												
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		H. static	3	2.9	1725	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A39
ZX	A7 (6)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.7	3/4	AK51	A39
		Med.	3	2.9	1725	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	4.7	3/4	AK51	A40
		H. static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	4.7	3/4	AK51	A41
ZY	04 (3)	Std.	Direct Drive												
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. static	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
ZY	05 (4)	Std.	Direct Drive												
		Med.	1	1.5	1725	0.79	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		Med.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. static	3	2.9	1725	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A40
ZY	06 (5)	Std.	Direct Drive												
		Med.	1	1.5	1750	0.83	1.15	56H	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		Med.	3	2.4	1750	0.87	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		H. static	3	2.9	1750	0.87	1.15	56Z	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A39
ZY	A7 (6)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.9	1725	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	7.0	1	AK74	A48
		H. static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A48
ZY	08 (7.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
ZY	09 (8.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
ZY	12 (10)	Std.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.5	1	AK79	A50
		Med.	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.5	1	AK79	A50
		H. static	3	5.25	1725	0.84	1.15	145TY	4.3 - 5.3	7/8	1VP56	7.9	1	BK85	BX52
ZL	04 (3)	Std.	Direct Drive												
		Med.	3	2.4	1750	0.87	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. static	3	2.4	1750	0.87	1.15	56Y	2.8 - 3.8	5/8	1VL44	4.2	3/4	AK46	A40
ZL	05 (4)	Std.	Direct Drive												
		Med.	3	2.4	1750	0.87	1.15	56Y	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A39
		H. static	3	2.9	1750	0.81	1.15	56Y	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A40
ZL	06 (5)	Std.	Direct Drive												
		Med.	3	2.4	1750	0.87	1.15	56HZ	1.9 - 2.9	5/8	1VL34	4.2	3/4	AK46	A37
		H. static	3	2.9	1750	0.87	1.15	56Z	2.8 - 3.8	7/8	1VL44	4.2	3/4	AK46	A39
ZL	08 (7.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50
ZL	09 (8.5)	Std.	3	2.4	1725	0.80	1.15	56Y	1.9 - 2.9	5/8	1VL34	7.0	1	AK74	A47
		Med.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.0	1	AK74	A48
		H. static	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.0	1	AK74	A50

**Table 93: Indoor blower specifications**

Model	Size (ton)	Airflow option	Motor						Motor sheave			Blower sheave			Belt
			Phase	HP	RPM	Eff.	SF	Frame	Datum dia. (in.)	Bore (in.)	Model	Datum Dia. (in.)	Bore (in.)	Model	
ZL	12 (10)	Std.	3	2.4	1725	0.80	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.5	1	AK79	A50
		Med.	3	3.7	1725	0.84	1.15	56HZ	3.4 - 4.4	7/8	1VP50	7.5	1	AK79	A50
		H. static	3	5.25	1725	0.84	1.15	145TY	4.3 - 5.3	7/8	1VP56	7.9	1	BK85	BX52
ZL	14 (12.5)	Std.	3	2.9	1750	0.87	1.15	56Y	2.8 - 3.8	5/8	1VL44	7.5	1	AK79	A50
		Med.	3	3.7	1750	0.90	1.15	184TZ	3.4 - 4.4	7/8	1VP50	7.5	1	AK79	A52
		H. static	3	5.25	1750	0.90	1.15	184TZ	4.3 - 5.3	7/8	1VP56	7.9	1	BK85	BX54

# RPM selection

**Table 94: RPM selection**

Model	Size (Tons)	Airflow Option	Phase	MAX BHP	Blower Sheave	Motor Sheave	6 Turns Open	5 Turns Open	4 Turns Open	3 Turns Open	2 Turns Open	1 Turns Open	Fully Closed
ZQ	04 (3)	Std.	Direct Drive										
		Med.	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZQ	05 (4)	Std.	Direct Drive										
		Med.	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZQ	06 (5)	Std.	Direct Drive										
		Med.	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZX	A7 (6)	Std.	3	2.4	AK51	1VL34	N/A	707	782	856	931	1005	1080
		Med.	3	2.9	AK51	1VL44	N/A	1043	1117	1191	1266	1340	1415
		H. Static	3	3.7	AK51	1VP50	N/A	1266	1340	1415	1489	1564	1638
ZY	04 (3)	Std.	Direct Drive										
		Med.	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZY	05 (4)	Std.	Direct Drive										
		Med.	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZY	06 (5)	Std.	Direct Drive										
		Med.	1	1.5	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZY	A7 (6)	Std.	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med.	3	2.9	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
ZY	08 (7.5)	Std.	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med.	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
ZY	09 (8.5)	Std.	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med.	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
ZY	12 (10)	Std.	3	2.4	AK79	1VL44	N/A	653	700	747	793	840	887
		Med.	3	3.7	AK79	1VP50	N/A	793	840	887	933	980	1027
		H. Static	3	5.25	BK85	1VP56	953	997	1041	1085	1130	1174	N/A
ZL	04 (3)	Std.	Direct Drive										
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.4	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZL	05 (4)	Std.	Direct Drive										
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZL	06 (5)	Std.	Direct Drive										
		Med.	3	2.4	AK46	1VL34	N/A	792	875	958	1042	1125	1208
		H. Static	3	2.9	AK46	1VL44	N/A	1167	1250	1333	1417	1500	1593
ZL	08 (7.5)	Std.	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med.	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
ZL	09 (8.5)	Std.	3	2.4	AK74	1VL34	N/A	475	525	575	625	675	725
		Med.	3	2.4	AK74	1VL44	N/A	700	750	800	850	900	950
		H. Static	3	3.7	AK74	1VP50	N/A	850	900	950	1000	1050	1100
ZL	12 (10)	Std.	3	2.4	AK79	1VL44	N/A	653	700	747	793	840	887
		Med.	3	3.7	AK79	1VP50	N/A	793	840	887	933	980	1027
		H. Static	3	5.25	BK85	1VP56	953	997	1041	1085	1130	1174	N/A
ZL	14 (12.5)	Std.	3	2.9	AK79	1VL44	N/A	653	700	747	793	840	887
		Med.	3	3.7	AK79	1VP50	N/A	793	840	887	933	980	1027
		H. Static	3	5.25	BK85	1VP56	953	997	1041	1085	1130	1174	N/A

## Additional static resistance

**Table 95: Additional static resistance - ZQ04-06**

Model	Size (ton)	CFM	Cooling only <sup>1</sup>	Economizer <sup>2,3</sup>	4 in. filter <sup>2</sup>	Electric heat kW <sup>2</sup>			
						6/6.5	9.2/10.5/11	13.8/14/16	23
ZQ	04 (3.0), 05 (4.0)	900	0.04	0.15	—	0.00	0.00	0.01	0.01
		1000	0.05	0.18	—	0.00	0.00	0.02	0.02
		1100	0.06	0.21	—	0.01	0.01	0.02	0.03
		1200	0.07	0.24	—	0.01	0.01	0.02	0.03
		1300	0.10	0.28	—	0.01	0.01	0.03	0.03
		1400	0.12	0.33	—	0.02	0.02	0.03	0.04
		1500	0.14	0.44	—	0.02	0.02	0.04	0.04
		1600	0.16	0.52	—	0.02	0.02	0.04	0.05
		1700	0.18	0.59	—	0.03	0.03	0.05	0.05
		1800	0.22	0.66	—	0.03	0.03	0.05	0.06
		1900	0.25	0.74	—	0.04	0.04	0.06	0.07
		2000	0.28	0.81	—	0.04	0.04	0.07	0.08
		2100	0.33	0.88	—	0.05	0.05	0.07	0.08
		2200	0.36	0.95	—	0.06	0.06	0.08	0.09
		2300	0.41	1.03	—	0.06	0.06	0.09	0.10
		2400	0.45	1.10	—	0.07	0.07	0.10	0.11
		2500	0.50	1.17	—	0.08	0.08	0.11	0.12
	06 (5.0)	1800	0.23	0.66	—	0.03	0.03	0.05	0.06
		2000	0.28	0.81	—	0.04	0.04	0.07	0.08
		2200	0.32	0.95	—	0.06	0.06	0.08	0.09
		2400	0.37	1.10	—	0.07	0.07	0.10	0.11

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

**Table 96: Additional static resistance - ZXA7**

Model	Size (ton)	CFM	Cooling only <sup>1</sup>	Economizer <sup>2,3</sup>	4 in. filter <sup>2</sup>	Electric heat kW <sup>2</sup>							
						6/6.5	9.2/10.5/11	13.8/14/16	16/16.5/17	23	24.8/25.5/27.8	32/33/34	41.7/42.4
ZX	A7 (6)	1800	0.23	0.66	—	0.03	0.03	0.05	—	—	—	—	—
		2000	0.28	0.81	—	0.04	0.04	0.06	—	—	—	—	—
		2200	0.32	0.95	—	0.06	0.06	0.07	—	—	—	—	—
		2400	0.37	1.10	—	0.07	0.07	0.08	—	—	—	—	—
		2600	0.38	1.25	—	0.08	0.08	0.09	—	—	—	—	—
		2800	0.41	1.39	—	0.09	0.09	0.10	—	—	—	—	—
		3000	0.45	1.54	—	0.11	0.11	0.12	—	—	—	—	—

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

**Table 97: Additional static resistance - ZY04-12**

Model	Size (ton)	CFM	<sup>1</sup> Cooling only <sup>1</sup>	<sup>2,3</sup> Reheat coil <sup>2,3</sup>	Economizer <sup>2</sup> <sup>3</sup>	4 in. filters <sup>2</sup>	Electric heat kW <sup>2</sup>							
							6/6.5	9.2/10.5/11	13.8/14/16	16/16.5/17	23	24.8/25.5/27.8	32/33/34	41.7/42.4
ZY	04 (3.0)	900	0.04	0.03	0.15	—	0.00	0.00	0.01	—	0.01	—	—	—
		1000	0.05	0.03	0.18	—	0.00	0.00	0.02	—	0.02	—	—	—
		1100	0.06	0.04	0.21	—	0.01	0.01	0.02	—	0.03	—	—	—
		1200	0.07	0.04	0.24	—	0.01	0.01	0.02	—	0.03	—	—	—
		1300	0.10	0.04	0.28	—	0.01	0.01	0.03	—	0.03	—	—	—
		1400	0.12	0.05	0.33	—	0.02	0.02	0.03	—	0.04	—	—	—
	05 (4.0)	1500	0.14	0.06	0.44	—	0.02	0.02	0.04	—	0.04	—	—	—
		1200	0.06	0.02	0.24	—	0.01	0.01	0.02	—	0.03	—	—	—
		1300	0.06	0.03	0.28	—	0.01	0.01	0.03	—	0.03	—	—	—
		1400	0.06	0.03	0.33	—	0.02	0.02	0.03	—	0.04	—	—	—
		1500	0.07	0.03	0.44	—	0.02	0.02	0.04	—	0.04	—	—	—
		1600	0.08	0.03	0.52	—	0.02	0.02	0.04	—	0.05	—	—	—
		1700	0.11	0.04	0.59	—	0.03	0.03	0.05	—	0.05	—	—	—
		1800	0.13	0.04	0.66	—	0.03	0.03	0.05	—	0.06	—	—	—
	06 (5.0)	1900	0.16	0.05	0.74	—	0.04	0.04	0.06	—	0.07	—	—	—
		2000	0.20	0.05	0.81	—	0.04	0.04	0.07	—	0.08	—	—	—
		1800	0.23	0.05	0.66	—	0.03	0.03	0.05	—	0.06	—	—	—
		2000	0.28	0.05	0.81	—	0.04	0.04	0.07	—	0.08	—	—	—
		2200	0.32	0.06	0.95	—	0.06	0.06	0.08	—	0.09	—	—	—
	A7 (6.0)	2400	0.37	0.06	1.10	—	0.07	0.07	0.10	—	0.11	—	—	—
		2500	0.50	0.07	1.17	—	0.08	0.08	0.11	—	0.12	—	—	—
		1800	0.23	0.06	0.13	—	0.03	—	—	0.05	—	0.06	—	—
		2000	0.28	0.07	0.15	—	0.04	—	—	0.06	—	0.07	—	—
		2200	0.32	0.08	0.18	—	0.06	—	—	0.07	—	0.09	—	—
		2400	0.37	0.09	0.21	—	0.07	—	—	0.08	—	0.1	—	—
		2600	0.38	0.10	0.24	—	0.08	—	—	0.09	—	0.11	—	—
	08 (7.5), 09 (8.5), 12 (10.0)	2800	0.41	0.11	0.29	—	0.09	—	—	0.10	—	0.12	—	—
		3000	0.45	0.12	0.35	—	0.11	—	—	0.12	—	0.14	—	—
		2200	0.04	0.04	0.18	—	—	—	—	0.07	—	0.09	0.10	0.12
		2600	0.06	0.05	0.24	—	—	—	—	0.09	—	0.11	0.12	0.15
		3000	0.10	0.07	0.35	—	—	—	—	0.12	—	0.14	0.15	0.19
		3400	0.13	0.08	0.47	—	—	—	—	0.15	—	0.18	0.19	0.23
		3800	0.16	0.10	0.59	—	—	—	—	0.19	—	0.22	0.23	0.27
		4000	0.17	0.11	0.66	—	—	—	—	0.21	—	0.24	0.25	0.30
		4400	0.20	0.12	0.79	—	—	—	—	0.25	—	0.29	0.30	0.35
		4800	0.22	0.14	0.91	—	—	—	—	0.30	—	0.34	0.35	0.41
		5200	0.24	0.15	1.04	—	—	—	—	0.35	—	0.39	0.41	0.47
		5600	0.26	0.15	1.17	—	—	—	—	0.41	—	0.45	0.47	0.54
		6000	0.28	0.16	1.30	—	—	—	—	0.48	—	0.52	0.54	0.60

1 Add these values to the available static resistance in the respective blower performance tables.

2 Deduct these values from the available external static pressure shown in the respective blower performance tables.

3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.



**Table 98: Additional static resistance - ZL04-14**

Model	Size (ton)	CFM	Cooling only <sup>1</sup>	Reheat coil <sup>2,3</sup>	Economizer <sup>2,3</sup>	4 in. filters <sup>2</sup>	Electric heat kW <sup>2</sup>							
							6/6.5	9.2/10.5/11	13.8/14/16	16/16.5/17	23	24.8/25.5/27.8	32/33/34	41.7/42.4
ZL	04 (3.0)	900	0.04	0.03	0.15	—	0.00	0.00	0.01	—	0.01	—	—	—
		1000	0.05	0.03	0.18	—	0.00	0.00	0.02	—	0.02	—	—	—
		1100	0.06	0.04	0.21	—	0.01	0.01	0.02	—	0.03	—	—	—
		1200	0.07	0.04	0.24	—	0.01	0.01	0.02	—	0.03	—	—	—
		1300	0.10	0.04	0.28	—	0.01	0.01	0.03	—	0.03	—	—	—
		1400	0.12	0.05	0.33	—	0.02	0.02	0.03	—	0.04	—	—	—
		1500	0.14	0.06	0.44	—	0.02	0.02	0.04	—	0.04	—	—	—
	05 (4.0)	1200	0.06	0.02	0.24	—	0.01	0.01	0.02	—	0.03	—	—	—
		1300	0.06	0.03	0.28	—	0.01	0.01	0.03	—	0.03	—	—	—
		1400	0.06	0.03	0.33	—	0.02	0.02	0.03	—	0.04	—	—	—
		1500	0.07	0.03	0.44	—	0.02	0.02	0.04	—	0.04	—	—	—
		1600	0.08	0.03	0.52	—	0.02	0.02	0.04	—	0.05	—	—	—
		1700	0.11	0.04	0.59	—	0.03	0.03	0.05	—	0.05	—	—	—
		1800	0.13	0.04	0.66	—	0.03	0.03	0.05	—	0.06	—	—	—
		1900	0.16	0.05	0.74	—	0.04	0.04	0.06	—	0.07	—	—	—
		2000	0.20	0.05	0.81	—	0.04	0.04	0.07	—	0.08	—	—	—
	06 (5.0)	1800	0.23	0.07	0.66	—	0.03	0.03	0.05	—	0.06	—	—	—
		2000	0.28	0.08	0.81	—	0.04	0.04	0.07	—	0.08	—	—	—
		2200	0.32	0.10	0.95	—	0.06	0.06	0.08	—	0.09	—	—	—
		2400	0.37	0.11	1.10	—	0.07	0.07	0.10	—	0.11	—	—	—
		2500	0.50	0.12	1.17	—	0.08	0.08	0.11	—	0.12	—	—	—
	08 (7.5), 09 (8.5), 12 (10.0), 14 (12.5)	2200	0.04	0.04	0.18	—	—	—	—	0.07	—	0.09	0.10	0.12
		2600	0.06	0.05	0.24	—	—	—	—	0.09	—	0.11	0.12	0.15
		3000	0.10	0.07	0.35	—	—	—	—	0.12	—	0.14	0.15	0.19
		3400	0.13	0.08	0.47	—	—	—	—	0.15	—	0.18	0.19	0.23
		3800	0.16	0.10	0.59	—	—	—	—	0.19	—	0.22	0.23	0.27
		4000	0.17	0.11	0.66	—	—	—	—	0.21	—	0.24	0.25	0.30
		4400	0.20	0.12	0.79	—	—	—	—	0.25	—	0.29	0.30	0.35
		4800	0.22	0.14	0.91	—	—	—	—	0.30	—	0.34	0.35	0.41
		5200	0.24	0.15	1.04	—	—	—	—	0.35	—	0.39	0.41	0.47
		5600	0.26	0.15	1.17	—	—	—	—	0.41	—	0.45	0.47	0.54
		6000	0.28	0.16	1.30	—	—	—	—	0.48	—	0.52	0.54	0.60

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

# Airflow performance

## ZQ04 to 06 side duct application (belt drive)

**Table 99: ZQ04 (3.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
900	n/a	n/a	877	0.25	965	0.34	1050	0.44	1133	0.54	1213	0.64	1292	0.74	1371	0.83	1450	0.92	1531	1.01
1000	795	0.21	887	0.29	976	0.38	1061	0.48	1143	0.58	1224	0.68	1303	0.78	1382	0.87	1461	0.96	1541	1.05
1100	806	0.25	899	0.34	988	0.43	1073	0.53	1155	0.63	1236	0.73	1315	0.83	1394	0.92	1473	1.01	1553	1.09
1200	820	0.31	913	0.39	1002	0.48	1087	0.58	1169	0.68	1249	0.78	1329	0.88	1407	0.97	1487	1.06	1567	1.15
1300	836	0.37	929	0.45	1018	0.54	1103	0.64	1185	0.74	1265	0.84	1345	0.94	1423	1.03	1503	1.12	1583	1.21
1400	855	0.43	948	0.52	1036	0.61	1121	0.70	1204	0.80	1284	0.90	1363	1.00	1442	1.10	1521	1.19	--	--
1500	876	0.50	969	0.58	1058	0.68	1143	0.77	1225	0.87	1305	0.97	1385	1.07	1464	1.17	1543	1.26	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.4-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 100: ZQ05 (4.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1200	893	0.37	976	0.46	1054	0.56	1128	0.66	1199	0.75	1268	0.85	1336	0.94	1404	1.03	1474	1.12	1545	1.20
1300	910	0.43	993	0.52	1071	0.62	1144	0.72	1216	0.81	1285	0.91	1353	1.00	1421	1.09	1491	1.18	1562	1.26
1400	931	0.49	1014	0.59	1092	0.69	1166	0.78	1237	0.88	1306	0.97	1374	1.06	1442	1.15	1512	1.24	1583	1.33
1500	956	0.56	1039	0.66	1117	0.76	1191	0.85	1262	0.95	1331	1.04	1399	1.14	1467	1.23	1537	1.31	1608	1.40
1600	985	0.64	1067	0.74	1145	0.83	1219	0.93	1290	1.03	1359	1.12	1428	1.21	1496	1.30	1565	1.39	1637	1.47
1700	1016	0.73	1099	0.82	1177	0.92	1251	1.02	1322	1.11	1391	1.21	1459	1.30	1528	1.39	1597	1.48	--	--
1800	1051	0.82	1134	0.92	1212	1.02	1286	1.11	1357	1.21	1426	1.30	1494	1.40	1562	1.49	1632	1.57	--	--
1900	1088	0.93	1171	1.02	1249	1.12	1323	1.22	1394	1.31	1463	1.41	1532	1.50	1600	1.59	--	--	--	--
2000	1128	1.04	1211	1.14	1289	1.23	1363	1.33	1434	1.43	1503	1.52	1571	1.61	1640	1.70	--	--	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.4-hp																			
	Field supplied AK41 x ¾ in. fixed blower pulley with motor rated at 2.4-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 101: ZQ06 (5.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1500	806	0.35	885	0.47	961	0.60	1034	0.73	1104	0.86	1170	1.00	1233	1.13	1292	1.26	1346	1.39	1396	1.52
1600	825	0.44	904	0.56	980	0.68	1053	0.81	1123	0.95	1189	1.08	1252	1.22	1311	1.35	1365	1.48	1415	1.61
1700	846	0.52	925	0.64	1001	0.76	1074	0.89	1144	1.03	1210	1.16	1273	1.30	1332	1.43	1386	1.56	1436	1.69
1800	869	0.60	947	0.72	1023	0.84	1096	0.97	1166	1.11	1233	1.24	1295	1.38	1354	1.51	1409	1.64	1459	1.77
1900	892	0.68	971	0.80	1047	0.93	1120	1.06	1190	1.19	1256	1.32	1319	1.46	1378	1.59	1432	1.72	1482	1.85
2000	916	0.77	995	0.89	1071	1.01	1144	1.14	1214	1.28	1280	1.41	1343	1.55	1402	1.68	1456	1.81	1506	1.94
2100	941	0.86	1019	0.98	1095	1.11	1168	1.24	1238	1.37	1305	1.50	1367	1.64	1426	1.77	1481	1.90	1531	2.03
2200	966	0.96	1044	1.08	1120	1.21	1193	1.34	1263	1.47	1329	1.61	1392	1.74	1451	1.87	1505	2.01	1555	2.13
2300	990	1.07	1069	1.19	1145	1.32	1218	1.45	1287	1.58	1354	1.72	1417	1.85	1476	1.98	1530	2.11	1580	2.24
2400	1015	1.19	1093	1.31	1169	1.44	1242	1.57	1312	1.70	1379	1.83	1441	1.97	1500	2.10	1555	2.23	--	--
2500	1039	1.32	1118	1.44	1193	1.56	1266	1.69	1336	1.83	1403	1.96	1466	2.10	1524	2.23	1579	2.36	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $kW = 0.929 \times bhp$

## ZQ04 to 06 bottom duct application (belt drive)

**Table 102: ZQ04 (3.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
900	792	0.14	879	0.25	968	0.37	1055	0.49	1141	0.61	1226	0.73	1308	0.84	1388	0.93	1466	1.01	1541	1.06
1000	804	0.18	893	0.29	981	0.41	1069	0.53	1155	0.66	1239	0.77	1322	0.88	1402	0.98	1480	1.05	1554	1.10
1100	819	0.23	909	0.34	997	0.46	1084	0.58	1171	0.71	1255	0.82	1337	0.93	1418	1.03	1495	1.10	1570	1.15
1200	837	0.29	926	0.40	1015	0.52	1102	0.64	1188	0.76	1273	0.88	1355	0.99	1435	1.08	1513	1.16	1588	1.21
1300	857	0.36	946	0.46	1035	0.58	1122	0.70	1208	0.83	1293	0.94	1375	1.05	1455	1.15	1533	1.22	--	--
1400	880	0.43	969	0.53	1058	0.65	1145	0.77	1231	0.90	1315	1.02	1398	1.12	1478	1.22	1556	1.29	--	--
1500	905	0.50	994	0.61	1082	0.73	1170	0.85	1256	0.97	1340	1.09	1423	1.20	1503	1.30	1581	1.37	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.4-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 103: ZQ05 (4.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1200	908	0.34	994	0.45	1072	0.55	1145	0.64	1214	0.74	1283	0.83	1352	0.92	1424	1.01	1502	1.11	1586	1.20
1300	921	0.40	1007	0.51	1085	0.61	1158	0.70	1227	0.80	1296	0.89	1365	0.98	1437	1.07	1514	1.17	1599	1.26
1400	938	0.47	1023	0.58	1101	0.68	1174	0.77	1244	0.86	1312	0.96	1382	1.05	1454	1.14	1531	1.23	1616	1.33
1500	959	0.55	1044	0.65	1122	0.75	1195	0.85	1265	0.94	1333	1.03	1403	1.12	1475	1.21	1552	1.31	1637	1.41
1600	985	0.63	1070	0.73	1148	0.83	1221	0.93	1290	1.02	1359	1.11	1428	1.20	1500	1.29	1578	1.39	--	--
1700	1015	0.71	1100	0.82	1179	0.92	1251	1.01	1321	1.11	1389	1.20	1459	1.29	1531	1.38	1608	1.48	--	--
1800	1050	0.81	1136	0.91	1214	1.01	1287	1.11	1356	1.20	1425	1.29	1494	1.39	1566	1.48	1644	1.57	--	--
1900	1091	0.91	1176	1.02	1254	1.12	1327	1.21	1397	1.31	1465	1.40	1534	1.49	1607	1.58	--	--	--	--
2000	1136	1.02	1222	1.13	1300	1.23	1372	1.32	1442	1.42	1510	1.51	1580	1.60	--	--	--	--	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.4-hp																			
	Field supplied AK41 x ¾ in. fixed blower pulley with motor rated at 2.4-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 104: ZQ06 (5.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1500	846	0.34	914	0.48	983	0.62	1052	0.75	1120	0.89	1188	1.02	1254	1.16	1318	1.29	1378	1.43	1435	1.56
1600	868	0.41	936	0.55	1004	0.68	1073	0.82	1142	0.95	1210	1.09	1276	1.23	1339	1.36	1400	1.50	1457	1.63
1700	889	0.49	957	0.62	1026	0.76	1095	0.90	1164	1.03	1231	1.17	1297	1.30	1361	1.44	1422	1.57	1479	1.71
1800	911	0.57	979	0.71	1048	0.85	1117	0.98	1186	1.12	1253	1.25	1319	1.39	1383	1.53	1443	1.66	1501	1.79
1900	934	0.67	1002	0.81	1071	0.94	1140	1.08	1208	1.21	1276	1.35	1342	1.48	1405	1.62	1466	1.75	1523	1.89
2000	958	0.77	1026	0.91	1094	1.04	1164	1.18	1232	1.32	1300	1.45	1366	1.59	1429	1.72	1490	1.86	1547	1.99
2100	983	0.88	1051	1.02	1120	1.15	1189	1.29	1258	1.42	1325	1.56	1391	1.69	1455	1.83	1516	1.96	1573	2.10
2200	1010	0.99	1078	1.13	1147	1.26	1216	1.40	1285	1.54	1352	1.67	1418	1.81	1482	1.94	1543	2.08	--	--
2300	1039	1.11	1107	1.25	1176	1.38	1245	1.52	1314	1.65	1381	1.79	1447	1.93	1511	2.06	1572	2.20	--	--
2400	1070	1.23	1138	1.37	1207	1.50	1276	1.64	1345	1.78	1412	1.91	1478	2.05	1542	2.18	--	--	--	--
2500	1103	1.36	1171	1.49	1240	1.63	1309	1.77	1378	1.90	1445	2.04	1511	2.17	1575	2.31	--	--	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $kW = 0.929 \times bhp$

## ZXA7 side duct application (belt drive)

**Table 105: ZXA7 (6.0 ton) side duct**

cfm	Available external static																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1800	915	0.67	979	0.77	1041	0.89	1102	1.02	1162	1.16	1221	1.31	1278	1.45	1334	1.59	1389	1.72	1442	1.82
1900	939	0.78	1003	0.87	1065	0.99	1126	1.12	1186	1.27	1244	1.41	1302	1.56	1358	1.69	1412	1.82	1466	1.93
2000	964	0.89	1028	0.99	1090	1.11	1151	1.24	1211	1.38	1269	1.52	1327	1.67	1383	1.81	1437	1.93	1491	2.04
2100	990	1.01	1054	1.11	1116	1.23	1177	1.36	1237	1.50	1296	1.65	1353	1.79	1409	1.93	1464	2.05	1517	2.16
2200	1018	1.14	1081	1.24	1143	1.36	1204	1.49	1264	1.63	1323	1.78	1380	1.92	1436	2.06	1491	2.18	1544	2.29
2300	1046	1.28	1110	1.37	1172	1.49	1233	1.62	1293	1.77	1351	1.91	1409	2.05	1465	2.19	1519	2.32	1573	2.43
2400	1076	1.42	1139	1.52	1201	1.63	1262	1.76	1322	1.91	1381	2.05	1438	2.20	1494	2.33	1549	2.46	1602	2.57
2500	1106	1.56	1170	1.66	1232	1.78	1293	1.91	1353	2.05	1411	2.20	1469	2.34	1525	2.48	1579	2.60	1633	2.71
2600	1138	1.71	1201	1.81	1263	1.93	1324	2.06	1384	2.20	1443	2.35	1500	2.49	1556	2.63	1611	2.75	—	—
2700	1170	1.87	1234	1.96	1296	2.08	1357	2.21	1417	2.35	1475	2.50	1533	2.64	1589	2.78	1638	2.91	—	—
2800	1203	2.02	1267	2.12	1329	2.24	1390	2.37	1450	2.51	1509	2.66	1566	2.80	1622	2.94	—	—	—	—
2900	1238	2.18	1301	2.28	1364	2.40	1425	2.53	1484	2.67	1543	2.81	1600	2.96	--	--	--	--	--	--
3000	1273	2.34	1337	2.44	1399	2.56	1460	2.69	1520	2.83	1578	2.97	1635	3.12	--	--	--	--	--	--
	Standard static option with motor rated at 2.4 hp																			
	Static option with motor rated at 2.9 hp																			
	Static option with motor rated at 3.7 hp																			
--	Exceeds recommended blower speed																			

## ZXA7 bottom duct application (belt drive)

**Table 106: ZXA7 (6.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1800	933	0.64	1000	0.79	1064	0.94	1126	1.09	1185	1.24	1243	1.38	1300	1.52	1356	1.64	1411	1.76	1466	1.86
1900	961	0.74	1028	0.89	1092	1.04	1153	1.19	1213	1.34	1271	1.49	1328	1.62	1384	1.75	1439	1.86	1494	1.97
2000	989	0.85	1055	1.00	1119	1.15	1181	1.31	1241	1.45	1299	1.60	1356	1.73	1411	1.86	1467	1.98	1521	2.08
2100	1017	0.97	1083	1.12	1147	1.27	1209	1.42	1269	1.57	1327	1.72	1384	1.85	1439	1.98	1495	2.09	1549	2.20
2200	1045	1.10	1112	1.25	1176	1.40	1238	1.55	1297	1.70	1355	1.84	1412	1.98	1468	2.10	1523	2.22	1578	2.32
2300	1075	1.23	1141	1.38	1205	1.53	1267	1.68	1327	1.83	1385	1.97	1441	2.11	1497	2.24	1552	2.35	1607	2.45
2400	1105	1.37	1171	1.52	1235	1.67	1297	1.82	1357	1.97	1415	2.11	1472	2.25	1527	2.38	1583	2.49	1637	2.59
2500	1136	1.52	1202	1.67	1266	1.82	1328	1.97	1388	2.12	1446	2.26	1503	2.40	1559	2.53	1614	2.64	—	—
2600	1168	1.67	1234	1.82	1298	1.97	1360	2.13	1420	2.27	1478	2.42	1535	2.55	1591	2.68	1638	2.80	—	—
2700	1201	1.84	1268	1.99	1332	2.14	1393	2.29	1453	2.44	1511	2.58	1568	2.72	1624	2.84	—	—	—	—
2800	1235	2.01	1302	2.16	1366	2.31	1428	2.46	1488	2.61	1546	2.75	1602	2.89	—	—	—	—	—	—
2900	1271	2.18	1338	2.33	1402	2.49	1463	2.64	1523	2.79	1581	2.93	1638	3.07	—	—	—	—	—	—
3000	1308	2.37	1374	2.52	1438	2.67	1500	2.82	1560	2.97	1618	3.12	—	—	—	—	—	—	—	—
	Standard static option with motor rated at 2.4 hp																			
	Static option with motor rated at 2.9 hp																			
	Static option with motor rated at 3.7 hp																			
--	Exceeds recommended blower speed																			

## ZY04 to 12 side duct application (belt drive)

**Table 107: ZY04 (3.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
900	n/a	n/a	874	0.31	972	0.40	1065	0.50	1153	0.60	1236	0.70	1315	0.80	1390	0.89	1460	0.97	1526	1.05
1000	n/a	n/a	887	0.36	985	0.45	1078	0.55	1165	0.65	1249	0.75	1328	0.85	1402	0.94	1472	1.03	1539	1.10
1100	797	0.33	900	0.42	998	0.51	1091	0.61	1179	0.71	1263	0.81	1341	0.91	1416	1.00	1486	1.08	1553	1.16
1200	813	0.40	916	0.48	1014	0.57	1107	0.67	1195	0.77	1279	0.87	1357	0.97	1432	1.06	1502	1.15	1569	1.22
1300	831	0.46	935	0.55	1033	0.64	1126	0.74	1214	0.84	1297	0.94	1376	1.03	1450	1.13	1520	1.21	1583	1.28
1400	852	0.53	956	0.61	1054	0.71	1146	0.80	1234	0.90	1318	1.00	1396	1.10	1471	1.19	1541	1.28	—	—
1500	876	0.59	979	0.68	1077	0.77	1170	0.87	1258	0.97	1341	1.07	1420	1.17	1494	1.26	1565	1.34	—	—
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 108: ZY05 (4.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1200	840	0.30	927	0.41	1012	0.53	1096	0.65	1177	0.77	1257	0.89	1334	1.01	1411	1.12	1485	1.22	1558	1.31
1300	857	0.35	944	0.47	1029	0.59	1112	0.71	1194	0.83	1273	0.95	1351	1.07	1427	1.18	1502	1.28	1574	1.37
1400	875	0.42	962	0.53	1048	0.65	1131	0.77	1212	0.89	1292	1.01	1370	1.13	1446	1.24	1520	1.34	1593	1.43
1500	897	0.49	984	0.60	1069	0.72	1152	0.84	1233	0.96	1313	1.08	1391	1.20	1467	1.31	1542	1.41	—	—
1600	921	0.56	1008	0.67	1093	0.79	1176	0.91	1258	1.04	1337	1.16	1415	1.27	1491	1.38	1566	1.49	—	—
1700	948	0.64	1035	0.76	1120	0.87	1204	1.00	1285	1.12	1365	1.24	1442	1.36	1518	1.47	1593	1.57	—	—
1800	979	0.73	1066	0.85	1151	0.96	1234	1.08	1315	1.21	1395	1.33	1473	1.44	1549	1.56	—	—	—	—
1900	1012	0.83	1099	0.94	1185	1.06	1268	1.18	1349	1.30	1429	1.42	1507	1.54	1583	1.65	—	—	—	—
2000	1049	0.93	1136	1.04	1222	1.16	1305	1.28	1386	1.40	1466	1.52	1544	1.64	—	—	—	—	—	—
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp



**Table 109: ZY06 (5.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1500	810	0.49	883	0.60	954	0.70	1023	0.80	1089	0.91	1152	1.02	1213	1.14	1269	1.26	1323	1.40	1373	1.55
1600	831	0.58	904	0.68	975	0.79	1044	0.89	1110	1.00	1173	1.11	1233	1.22	1290	1.35	1344	1.49	1394	1.64
1700	854	0.66	927	0.77	998	0.87	1067	0.98	1133	1.08	1196	1.19	1256	1.31	1313	1.44	1367	1.57	1417	1.72
1800	878	0.75	952	0.86	1023	0.96	1091	1.07	1157	1.17	1221	1.28	1281	1.40	1338	1.52	1391	1.66	1441	1.81
1900	904	0.84	977	0.95	1048	1.05	1117	1.16	1183	1.26	1246	1.37	1306	1.49	1363	1.61	1417	1.75	1467	1.90
2000	931	0.93	1004	1.04	1075	1.15	1144	1.25	1210	1.36	1273	1.47	1333	1.58	1390	1.71	1444	1.84	1494	1.99
2100	959	1.03	1032	1.14	1103	1.24	1172	1.35	1238	1.45	1301	1.56	1361	1.68	1418	1.81	1472	1.94	1522	2.09
2200	988	1.13	1061	1.24	1132	1.35	1201	1.45	1267	1.56	1330	1.67	1390	1.78	1447	1.91	1501	2.04	1550	2.19
2300	1017	1.24	1091	1.35	1162	1.45	1230	1.56	1296	1.66	1359	1.77	1420	1.89	1477	2.02	1530	2.15	1580	2.30
2400	1047	1.36	1121	1.46	1192	1.57	1260	1.67	1326	1.78	1390	1.89	1450	2.01	1507	2.13	1560	2.27	—	—
2500	1078	1.48	1151	1.58	1222	1.69	1291	1.79	1357	1.90	1420	2.01	1480	2.13	1537	2.25	1591	2.39	—	—
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

**Table 111: ZY08 (7.5 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	547	0.39	610	0.60	670	0.81	727	1.01	783	1.21	836	1.41	888	1.59	939	1.78	989	1.96	1038	2.13
2400	556	0.47	619	0.69	679	0.90	736	1.10	792	1.30	845	1.49	897	1.68	948	1.86	998	2.04	1047	2.22
2600	568	0.60	631	0.81	691	1.02	749	1.22	804	1.42	857	1.61	909	1.80	960	1.99	1010	2.17	1059	2.34
2800	581	0.73	644	0.95	704	1.16	762	1.36	817	1.56	871	1.75	923	1.94	973	2.13	1023	2.31	1073	2.48
3000	595	0.89	658	1.10	718	1.31	776	1.51	831	1.71	885	1.91	937	2.09	988	2.28	1038	2.46	1087	2.63
3200	610	1.05	673	1.27	733	1.48	791	1.68	846	1.88	900	2.07	952	2.26	1003	2.44	1053	2.62	—	—
3400	627	1.23	689	1.45	750	1.66	807	1.86	863	2.06	916	2.25	968	2.44	1019	2.62	1069	2.80	—	—
3600	644	1.42	707	1.64	767	1.85	824	2.05	880	2.25	933	2.44	985	2.63	1036	2.82	1086	3.00	—	—
3750	657	1.58	720	1.79	780	2.00	838	2.20	893	2.40	947	2.60	999	2.78	1049	2.97	1099	3.15	—	—
	Standard static option with motor rated at 2.4-hp>																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 112: ZY09 (8.5 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	565	0.56	628	0.78	688	0.99	745	1.19	801	1.39	854	1.58	906	1.77	957	1.95	1007	2.13	1056	2.31
2600	568	0.60	631	0.81	691	1.02	749	1.22	804	1.42	857	1.61	909	1.80	960	1.99	1010	2.17	1059	2.34
2800	581	0.73	644	0.95	704	1.16	762	1.36	817	1.56	871	1.75	923	1.94	973	2.13	1023	2.31	1073	2.48
3000	595	0.89	658	1.10	718	1.31	776	1.51	831	1.71	885	1.91	937	2.09	988	2.28	1038	2.46	1087	2.63
3200	610	1.05	673	1.27	733	1.48	791	1.68	846	1.88	900	2.07	952	2.26	1003	2.44	1053	2.62	1100	2.80
3400	627	1.23	689	1.45	750	1.66	807	1.86	863	2.06	916	2.25	968	2.44	1019	2.62	1069	2.80	—	—
3600	644	1.42	707	1.64	767	1.85	824	2.05	880	2.25	933	2.44	985	2.63	1036	2.82	1086	3.00	—	—
3800	662	1.63	725	1.84	785	2.05	842	2.26	898	2.46	951	2.65	1003	2.84	1054	3.02	1100	3.20	—	—
4000	681	1.85	744	2.06	804	2.27	861	2.47	917	2.67	970	2.87	1022	3.05	1073	3.24	—	—	—	—
4200	701	2.08	764	2.29	824	2.50	881	2.70	937	2.90	990	3.09	1042	3.28	1093	3.47	—	—	—	—
4250	706	2.14	769	2.35	829	2.56	887	2.76	942	2.96	996	3.15	1048	3.34	1098	3.53	—	—	—	—
	Standard static option with motor rated at 2.4-hp>																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
<b>Bold</b>	Field-supplied AK79 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 113: ZY12 (10 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3000	653	0.79	706	1.02	758	1.25	808	1.49	858	1.72	907	1.95	955	2.18	1003	2.40	1049	2.62	1095	2.82
3200	667	0.94	720	1.17	771	1.40	822	1.64	872	1.88	921	2.11	969	2.34	1016	2.56	1063	2.77	1109	2.97
3400	682	1.11	734	1.34	786	1.57	837	1.81	887	2.04	936	2.28	984	2.50	1031	2.73	1078	2.94	1124	3.14
3600	697	1.29	750	1.52	802	1.76	853	1.99	903	2.23	952	2.46	1000	2.69	1047	2.91	1094	3.12	1140	3.32
3800	714	1.50	767	1.73	819	1.96	870	2.20	920	2.43	969	2.67	1017	2.90	1064	3.12	1111	3.33	1157	3.53
4000	733	1.73	786	1.96	837	2.19	888	2.43	938	2.66	987	2.90	1035	3.12	1083	3.34	1129	3.56	1174	3.76
4200	753	1.98	806	2.21	857	2.44	908	2.68	958	2.91	1007	3.15	1055	3.37	1102	3.60	1149	3.81	—	—
4400	774	2.25	827	2.48	879	2.72	930	2.95	979	3.19	1028	3.42	1076	3.65	1124	3.87	1170	4.08	—	—
4600	797	2.55	850	2.78	902	3.02	952	3.25	1002	3.49	1051	3.72	1099	3.95	1147	4.17	—	—	—	—
4800	822	2.88	874	3.11	926	3.34	977	3.58	1027	3.81	1076	4.05	1124	4.27	1171	4.50	—	—	—	—
5000	848	3.23	901	3.46	952	3.69	1003	3.93	1053	4.16	1102	4.40	1150	4.62	—	—	—	—	—	—
	Standard static option with motor rated at 2.4-hp>																			
	Medium static option with motor rated at 3.7-hp																			
	High static option with motor rated at 5.25-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $\text{kW} = 0.929 \times \text{bhp}$

## ZY04 to 12 bottom duct application (belt drive)

**Table 114: ZY04 (3.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
900	n/a	n/a	878	0.26	976	0.37	1070	0.47	1161	0.58	1247	0.67	1329	0.76	1405	0.85	1477	0.93	1543	1.00
1000	792	0.20	894	0.31	992	0.42	1087	0.52	1177	0.62	1263	0.72	1345	0.81	1422	0.90	1493	0.98	1560	1.05
1100	810	0.26	912	0.37	1010	0.47	1104	0.58	1195	0.68	1281	0.77	1363	0.87	1439	0.95	1511	1.03	1577	1.11
1200	829	0.32	931	0.43	1029	0.54	1124	0.64	1214	0.74	1300	0.84	1382	0.93	1459	1.02	1530	1.10	1593	1.17
1300	850	0.39	952	0.50	1050	0.61	1145	0.71	1235	0.81	1321	0.91	1403	1.00	1480	1.09	1552	1.17	—	—
1400	874	0.47	975	0.58	1073	0.69	1168	0.79	1258	0.89	1344	0.99	1426	1.08	1503	1.17	1575	1.25	—	—
1500	899	0.56	1000	0.67	1098	0.77	1193	0.88	1283	0.98	1370	1.07	1451	1.17	1528	1.25	1600	1.33	—	—
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 115: ZY05 (4.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1200	840	0.37	929	0.46	1016	0.56	1101	0.68	1184	0.80	1265	0.93	1345	1.04	1423	1.14	1500	1.22	1576	1.28
1300	858	0.43	947	0.52	1035	0.62	1120	0.74	1203	0.86	1284	0.99	1364	1.10	1442	1.20	1519	1.28	1593	1.34
1400	879	0.49	968	0.58	1055	0.69	1140	0.81	1224	0.93	1305	1.05	1385	1.17	1463	1.27	1540	1.35	—	—
1500	903	0.56	992	0.65	1079	0.76	1164	0.88	1247	1.00	1328	1.12	1408	1.24	1486	1.34	1563	1.42	—	—
1600	929	0.64	1018	0.73	1105	0.83	1190	0.95	1273	1.07	1354	1.20	1434	1.31	1512	1.41	1589	1.49	—	—
1700	957	0.72	1047	0.81	1134	0.91	1219	1.03	1302	1.15	1383	1.28	1463	1.39	1541	1.49	—	—	—	—
1800	989	0.80	1078	0.89	1165	1.00	1250	1.12	1333	1.24	1415	1.36	1494	1.47	1572	1.58	—	—	—	—
1900	1023	0.89	1112	0.98	1199	1.08	1284	1.20	1367	1.33	1449	1.45	1528	1.56	—	—	—	—	—	—
2000	1059	0.98	1149	1.07	1236	1.18	1321	1.29	1404	1.42	1485	1.54	1565	1.65	—	—	—	—	—	—
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 116: ZY06 (5.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1500	840	0.48	910	0.58	977	0.67	1042	0.77	1106	0.87	1166	0.98	1225	1.08	1280	1.19	1334	1.30	1384	1.41
1600	866	0.55	935	0.65	1003	0.74	1068	0.84	1131	0.94	1192	1.04	1250	1.15	1306	1.26	1359	1.37	1410	1.48
1700	892	0.63	961	0.72	1029	0.82	1094	0.92	1157	1.02	1218	1.12	1276	1.23	1332	1.33	1385	1.44	1436	1.56
1800	918	0.71	987	0.81	1055	0.90	1120	1.00	1183	1.10	1244	1.21	1302	1.31	1358	1.42	1411	1.53	1462	1.64
1900	944	0.80	1014	0.90	1081	1.00	1146	1.09	1209	1.19	1270	1.30	1329	1.40	1384	1.51	1438	1.62	1488	1.73
2000	971	0.90	1041	1.00	1108	1.09	1174	1.19	1237	1.29	1297	1.39	1356	1.50	1412	1.61	1465	1.72	1516	1.83
2100	999	1.01	1069	1.10	1136	1.20	1202	1.30	1265	1.40	1326	1.50	1384	1.60	1440	1.71	1493	1.82	1544	1.93
2200	1028	1.12	1098	1.21	1165	1.31	1231	1.41	1294	1.51	1355	1.61	1413	1.72	1469	1.82	1522	1.93	1573	2.05
2300	1058	1.24	1128	1.33	1195	1.43	1261	1.53	1324	1.63	1385	1.73	1443	1.83	1499	1.94	1552	2.05	—	—
2400	1090	1.36	1159	1.46	1227	1.55	1292	1.65	1355	1.75	1416	1.85	1474	1.96	1530	2.07	1583	2.18	—	—
2500	1122	1.49	1191	1.59	1259	1.68	1324	1.78	1387	1.88	1448	1.98	1506	2.09	1562	2.20	1615	2.31	—	—
Medium static option with motor rated at 2.4-hp																				
High static option with motor rated at 2.9-hp																				
Exceeds recommended blower speed																				

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.857 x bhp

**Table 117: ZYA7 (6.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1800	525	0.31	590	0.48	653	0.65	713	0.82	770	0.98	825	1.15	878	1.31	928	1.48	976	1.65	1022	1.83
1900	534	0.36	599	0.53	661	0.71	721	0.87	779	1.03	834	1.20	886	1.36	936	1.53	984	1.70	1030	1.88
2000	542	0.41	607	0.59	670	0.76	730	0.93	787	1.09	842	1.25	895	1.42	945	1.58	993	1.75	1039	1.93
2100	551	0.47	616	0.65	678	0.82	738	0.99	796	1.15	850	1.31	903	1.47	953	1.64	1001	1.81	1047	1.99
2200	559	0.53	624	0.71	687	0.88	747	1.05	804	1.21	859	1.37	912	1.54	962	1.70	1010	1.88	1056	2.05
2300	568	0.60	634	0.78	696	0.95	756	1.11	813	1.28	868	1.44	921	1.60	971	1.77	1019	1.94	1065	2.12
2400	578	0.66	643	0.84	705	1.01	765	1.18	823	1.34	878	1.51	930	1.67	981	1.84	1029	2.01	1074	2.19
2500	588	0.74	653	0.91	715	1.08	775	1.25	833	1.41	888	1.58	940	1.74	991	1.91	1039	2.08	1084	2.26
2600	598	0.81	663	0.99	725	1.16	785	1.32	843	1.49	898	1.65	950	1.81	1001	1.98	1049	2.15	1094	2.33
2700	609	0.88	674	1.06	736	1.23	796	1.40	853	1.56	908	1.72	961	1.89	1011	2.05	1059	2.23	—	—
2800	620	0.96	685	1.14	747	1.31	807	1.47	864	1.64	919	1.80	972	1.96	1022	2.13	1070	2.30	—	—
2900	631	1.04	696	1.22	759	1.39	819	1.55	876	1.72	931	1.88	984	2.04	1034	2.21	1082	2.38	—	—
3000	643	1.12	708	1.30	771	1.47	830	1.64	888	1.80	943	1.96	996	2.12	1046	2.29	1094	2.46	—	—
Standard static option with motor rated at 2.4-hp																				
Medium static option with motor rated at 2.9-hp																				
High static option with motor rated at 3.7-hp																				
Exceeds recommended blower speed																				

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 118: ZY08 (7.5 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	556	0.45	621	0.65	683	0.83	742	1.00	798	1.18	852	1.34	904	1.51	954	1.69	1003	1.87	1050	2.06
2400	567	0.53	632	0.73	694	0.91	753	1.09	809	1.26	863	1.43	914	1.60	964	1.77	1013	1.95	1060	2.14
2600	580	0.65	646	0.85	707	1.03	766	1.21	823	1.38	876	1.55	928	1.72	978	1.89	1027	2.07	1074	2.27
2800	595	0.79	660	0.99	722	1.17	780	1.35	837	1.52	890	1.69	942	1.86	992	2.03	1041	2.21	1088	2.40
3000	609	0.94	674	1.14	736	1.32	795	1.50	851	1.67	905	1.83	957	2.00	1007	2.18	1056	2.36	1100	2.55
3200	625	1.10	690	1.30	752	1.48	810	1.66	867	1.83	921	2.00	972	2.17	1022	2.34	1071	2.52	—	—
3400	641	1.28	706	1.47	768	1.66	827	1.83	883	2.00	937	2.17	989	2.34	1039	2.52	1087	2.70	—	—
3600	658	1.47	723	1.66	785	1.85	844	2.02	900	2.19	954	2.36	1006	2.53	1056	2.70	1100	2.89	—	—
3750	672	1.61	737	1.81	799	1.99	858	2.17	914	2.34	968	2.51	1019	2.68	1069	2.85	—	—	—	—
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 119: ZY09 (8.5 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	577	0.62	642	0.82	704	1.00	763	1.18	819	1.35	873	1.52	925	1.69	975	1.86	1023	2.04	1071	2.23
2600	580	0.65	646	0.85	707	1.03	766	1.21	823	1.38	876	1.55	928	1.72	978	1.89	1027	2.07	1074	2.27
2800	595	0.79	660	0.99	722	1.17	780	1.35	837	1.52	890	1.69	942	1.86	992	2.03	1041	2.21	1088	2.40
3000	609	0.94	674	1.14	736	1.32	795	1.50	851	1.67	905	1.83	957	2.00	1007	2.18	1056	2.36	1103	2.55
3200	625	1.10	690	1.30	752	1.48	810	1.66	867	1.83	921	2.00	972	2.17	1022	2.34	1071	2.52	—	—
3400	641	1.28	706	1.47	768	1.66	827	1.83	883	2.00	937	2.17	989	2.34	1039	2.52	1087	2.70	—	—
3600	658	1.47	723	1.66	785	1.85	844	2.02	900	2.19	954	2.36	1006	2.53	1056	2.70	1104	2.89	—	—
3800	676	1.67	742	1.86	803	2.04	862	2.22	918	2.39	972	2.56	1024	2.73	1074	2.90	—	—	—	—
4000	696	1.88	761	2.07	823	2.26	882	2.43	938	2.60	992	2.77	1043	2.94	1093	3.12	—	—	—	—
4200	716	2.10	781	2.29	843	2.48	902	2.65	958	2.82	1012	2.99	1064	3.16	1114	3.34	—	—	—	—
4250	721	2.16	786	2.35	848	2.53	907	2.71	963	2.88	1017	3.05	1069	3.22	1119	3.39	—	—	—	—
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
<b>Bold</b>	Field-supplied AK79 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 120: ZY12 (10 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2600	626	0.50	679	0.73	731	0.97	782	1.20	831	1.44	880	1.67	928	1.90	976	2.12	1022	2.33	1068	2.53
2800	639	0.64	692	0.87	744	1.11	795	1.34	845	1.58	894	1.81	942	2.04	989	2.26	1036	2.47	1082	2.67
3000	653	0.79	706	1.02	758	1.25	808	1.49	858	1.72	907	1.95	955	2.18	1003	2.40	1049	2.62	1095	2.82
3200	667	0.94	720	1.17	771	1.40	822	1.64	872	1.88	921	2.11	969	2.34	1016	2.56	1063	2.77	1109	2.97
3400	682	1.11	734	1.34	786	1.57	837	1.81	887	2.04	936	2.28	984	2.50	1031	2.73	1078	2.94	1124	3.14
3600	697	1.29	750	1.52	802	1.76	853	1.99	903	2.23	952	2.46	1000	2.69	1047	2.91	1094	3.12	1140	3.32
3800	714	1.50	767	1.73	819	1.96	870	2.20	920	2.43	969	2.67	1017	2.90	1064	3.12	1111	3.33	1157	3.53
4000	733	1.73	786	1.96	837	2.19	888	2.43	938	2.66	987	2.90	1035	3.12	1083	3.34	1129	3.56	1175	3.76
4200	753	1.98	806	2.21	857	2.44	908	2.68	958	2.91	1007	3.15	1055	3.37	1102	3.60	1149	3.81	1195	4.01
4400	774	2.25	827	2.48	879	2.72	930	2.95	979	3.19	1028	3.42	1076	3.65	1124	3.87	1170	4.08	1216	4.28
4600	797	2.55	850	2.78	902	3.02	952	3.25	1002	3.49	1051	3.72	1099	3.95	1147	4.17	1193	4.38	1239	4.58
4800	822	2.88	874	3.11	926	3.34	977	3.58	1027	3.81	1076	4.05	1124	4.27	1171	4.50	1218	4.71	—	—
5000	848	3.23	901	3.46	952	3.69	1003	3.93	1053	4.16	1102	4.40	1150	4.62	1197	4.84	1242	5.06	—	—
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 3.7-hp																			
	High static option with motor rated at 5.25-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $\text{kW} = 0.929 \times \text{bhp}$

## ZL04 to ZL06 side duct application (belt drive)

**Table 121: ZL04 (3.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
900	n/a	n/a	874	0.31	972	0.40	1065	0.50	1153	0.60	1236	0.70	1315	0.80	1390	0.89	1460	0.97	1526	1.05
1000	n/a	n/a	887	0.36	985	0.45	1078	0.55	1165	0.65	1249	0.75	1328	0.85	1402	0.94	1472	1.03	1539	1.10
1100	797	0.33	900	0.42	998	0.51	1091	0.61	1179	0.71	1263	0.81	1341	0.91	1416	1.00	1486	1.08	1553	1.16
1200	813	0.40	916	0.48	1014	0.57	1107	0.67	1195	0.77	1279	0.87	1357	0.97	1432	1.06	1502	1.15	1569	1.22
1300	831	0.46	935	0.55	1033	0.64	1126	0.74	1214	0.84	1297	0.94	1376	1.03	1450	1.13	1520	1.21	1583	1.28
1400	852	0.53	956	0.61	1054	0.71	1146	0.80	1234	0.90	1318	1.00	1396	1.10	1471	1.19	1541	1.28	--	--
1500	876	0.59	979	0.68	1077	0.77	1170	0.87	1258	0.97	1341	1.07	1420	1.17	1494	1.26	1565	1.34	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 122: ZL05 (4.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1200	840	0.30	927	0.41	1012	0.53	1096	0.65	1177	0.77	1257	0.89	1334	1.01	1411	1.12	1485	1.22	1558	1.31
1300	857	0.35	944	0.47	1029	0.59	1112	0.71	1194	0.83	1273	0.95	1351	1.07	1427	1.18	1502	1.28	1574	1.37
1400	875	0.42	962	0.53	1048	0.65	1131	0.77	1212	0.89	1292	1.01	1370	1.13	1446	1.24	1520	1.34	1593	1.43
1500	897	0.49	984	0.60	1069	0.72	1152	0.84	1233	0.96	1313	1.08	1391	1.20	1467	1.31	1542	1.41	--	--
1600	921	0.56	1008	0.67	1093	0.79	1176	0.91	1258	1.04	1337	1.16	1415	1.27	1491	1.38	1566	1.49	--	--
1700	948	0.64	1035	0.76	1120	0.87	1204	1.00	1285	1.12	1365	1.24	1442	1.36	1518	1.47	1593	1.57	--	--
1800	979	0.73	1066	0.85	1151	0.96	1234	1.08	1315	1.21	1395	1.33	1473	1.44	1549	1.56	--	--	--	--
1900	1012	0.83	1099	0.94	1185	1.06	1268	1.18	1349	1.30	1429	1.42	1507	1.54	1583	1.65	--	--	--	--
2000	1049	0.93	1136	1.04	1222	1.16	1305	1.28	1386	1.40	1466	1.52	1544	1.64	--	--	--	--	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp



**Table 123: ZL06 (5.0 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1500	810	0.49	883	0.60	954	0.70	1023	0.80	1089	0.91	1152	1.02	1213	1.14	1269	1.26	1323	1.40	1373	1.55
1600	831	0.58	904	0.68	975	0.79	1044	0.89	1110	1.00	1173	1.11	1233	1.22	1290	1.35	1344	1.49	1394	1.64
1700	854	0.66	927	0.77	998	0.87	1067	0.98	1133	1.08	1196	1.19	1256	1.31	1313	1.44	1367	1.57	1417	1.72
1800	878	0.75	952	0.86	1023	0.96	1091	1.07	1157	1.17	1221	1.28	1281	1.40	1338	1.52	1391	1.66	1441	1.81
1900	904	0.84	977	0.95	1048	1.05	1117	1.16	1183	1.26	1246	1.37	1306	1.49	1363	1.61	1417	1.75	1467	1.90
2000	931	0.93	1004	1.04	1075	1.15	1144	1.25	1210	1.36	1273	1.47	1333	1.58	1390	1.71	1444	1.84	1494	1.99
2100	959	1.03	1032	1.14	1103	1.24	1172	1.35	1238	1.45	1301	1.56	1361	1.68	1418	1.81	1472	1.94	1522	2.09
2200	988	1.13	1061	1.24	1132	1.35	1201	1.45	1267	1.56	1330	1.67	1390	1.78	1447	1.91	1501	2.04	1550	2.19
2300	1017	1.24	1091	1.35	1162	1.45	1230	1.56	1296	1.66	1359	1.77	1420	1.89	1477	2.02	1530	2.15	1580	2.30
2400	1047	1.36	1121	1.46	1192	1.57	1260	1.67	1326	1.78	1390	1.89	1450	2.01	1507	2.13	1560	2.27	--	--
2500	1078	1.48	1151	1.58	1222	1.69	1291	1.79	1357	1.90	1420	2.01	1480	2.13	1537	2.25	1591	2.39	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $kW = 0.857 \times bhp$

## ZL04 to ZL06 bottom duct application (belt drive)

**Table 124: ZL04 (3.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
900	n/a	n/a	878	0.26	976	0.37	1070	0.47	1161	0.58	1247	0.67	1329	0.76	1405	0.85	1477	0.93	1543	1.00
1000	792	0.20	894	0.31	992	0.42	1087	0.52	1177	0.62	1263	0.72	1345	0.81	1422	0.90	1493	0.98	1560	1.05
1100	810	0.26	912	0.37	1010	0.47	1104	0.58	1195	0.68	1281	0.77	1363	0.87	1439	0.95	1511	1.03	1577	1.11
1200	829	0.32	931	0.43	1029	0.54	1124	0.64	1214	0.74	1300	0.84	1382	0.93	1459	1.02	1530	1.10	1593	1.17
1300	850	0.39	952	0.50	1050	0.61	1145	0.71	1235	0.81	1321	0.91	1403	1.00	1480	1.09	1552	1.17	--	--
1400	874	0.47	975	0.58	1073	0.69	1168	0.79	1258	0.89	1344	0.99	1426	1.08	1503	1.17	1575	1.25	--	--
1500	899	0.56	1000	0.67	1098	0.77	1193	0.88	1283	0.98	1370	1.07	1451	1.17	1528	1.25	1600	1.33	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 125: ZL05 (4.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1200	840	0.37	929	0.46	1016	0.56	1101	0.68	1184	0.80	1265	0.93	1345	1.04	1423	1.14	1500	1.22	1576	1.28
1300	858	0.43	947	0.52	1035	0.62	1120	0.74	1203	0.86	1284	0.99	1364	1.10	1442	1.20	1519	1.28	1593	1.34
1400	879	0.49	968	0.58	1055	0.69	1140	0.81	1224	0.93	1305	1.05	1385	1.17	1463	1.27	1540	1.35	--	--
1500	903	0.56	992	0.65	1079	0.76	1164	0.88	1247	1.00	1328	1.12	1408	1.24	1486	1.34	1563	1.42	--	--
1600	929	0.64	1018	0.73	1105	0.83	1190	0.95	1273	1.07	1354	1.20	1434	1.31	1512	1.41	1589	1.49	--	--
1700	957	0.72	1047	0.81	1134	0.91	1219	1.03	1302	1.15	1383	1.28	1463	1.39	1541	1.49	--	--	--	--
1800	989	0.80	1078	0.89	1165	1.00	1250	1.12	1333	1.24	1415	1.36	1494	1.47	1572	1.58	--	--	--	--
1900	1023	0.89	1112	0.98	1199	1.08	1284	1.20	1367	1.33	1449	1.45	1528	1.56	--	--	--	--	--	--
2000	1059	0.98	1149	1.07	1236	1.18	1321	1.29	1404	1.42	1485	1.54	1565	1.65	--	--	--	--	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 126: ZL06 (5.0 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
1500	840	0.48	910	0.58	977	0.67	1042	0.77	1106	0.87	1166	0.98	1225	1.08	1280	1.19	1334	1.30	1384	1.41
1600	866	0.55	935	0.65	1003	0.74	1068	0.84	1131	0.94	1192	1.04	1250	1.15	1306	1.26	1359	1.37	1410	1.48
1700	892	0.63	961	0.72	1029	0.82	1094	0.92	1157	1.02	1218	1.12	1276	1.23	1332	1.33	1385	1.44	1436	1.56
1800	918	0.71	987	0.81	1055	0.90	1120	1.00	1183	1.10	1244	1.21	1302	1.31	1358	1.42	1411	1.53	1462	1.64
1900	944	0.80	1014	0.90	1081	1.00	1146	1.09	1209	1.19	1270	1.30	1329	1.40	1384	1.51	1438	1.62	1488	1.73
2000	971	0.90	1041	1.00	1108	1.09	1174	1.19	1237	1.29	1297	1.39	1356	1.50	1412	1.61	1465	1.72	1516	1.83
2100	999	1.01	1069	1.10	1136	1.20	1202	1.30	1265	1.40	1326	1.50	1384	1.60	1440	1.71	1493	1.82	1544	1.93
2200	1028	1.12	1098	1.21	1165	1.31	1231	1.41	1294	1.51	1355	1.61	1413	1.72	1469	1.82	1522	1.93	1573	2.05
2300	1058	1.24	1128	1.33	1195	1.43	1261	1.53	1324	1.63	1385	1.73	1443	1.83	1499	1.94	1552	2.05	--	--
2400	1090	1.36	1159	1.46	1227	1.55	1292	1.65	1355	1.75	1416	1.85	1474	1.96	1530	2.07	1583	2.18	--	--
2500	1122	1.49	1191	1.59	1259	1.68	1324	1.78	1387	1.88	1448	1.98	1506	2.09	1562	2.20	1615	2.31	--	--
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 2.9-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $\text{kW} = 0.857 \times \text{bhp}$

# ZL08 to 14 side duct application (belt drive)

**Table 127: ZL 08 (7.5 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	547	0.39	610	0.60	670	0.81	727	1.01	783	1.21	836	1.41	888	1.59	939	1.78	989	1.96	1038	2.13
2400	556	0.47	619	0.69	679	0.90	736	1.10	792	1.30	845	1.49	897	1.68	948	1.86	998	2.04	1047	2.22
2600	568	0.60	631	0.81	691	1.02	749	1.22	804	1.42	857	1.61	909	1.80	960	1.99	1010	2.17	1059	2.34
2800	581	0.73	644	0.95	704	1.16	762	1.36	817	1.56	871	1.75	923	1.94	973	2.13	1023	2.31	1073	2.48
3000	595	0.89	658	1.10	718	1.31	776	1.51	831	1.71	885	1.91	937	2.09	988	2.28	1038	2.46	1087	2.63
3200	610	1.05	673	1.27	733	1.48	791	1.68	846	1.88	900	2.07	952	2.26	1003	2.44	1053	2.62	--	--
3400	627	1.23	689	1.45	750	1.66	807	1.86	863	2.06	916	2.25	968	2.44	1019	2.62	1069	2.80	--	--
3600	644	1.42	707	1.64	767	1.85	824	2.05	880	2.25	933	2.44	985	2.63	1036	2.82	1086	3.00	--	--
3750	657	1.58	720	1.79	780	2.00	838	2.20	893	2.40	947	2.60	999	2.78	1049	2.97	1099	3.15	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 128: ZL 09 (8.5 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	565	0.56	628	0.78	688	0.99	745	1.19	801	1.39	854	1.58	906	1.77	957	1.95	1007	2.13	1056	2.31
2600	568	0.60	631	0.81	691	1.02	749	1.22	804	1.42	857	1.61	909	1.80	960	1.99	1010	2.17	1059	2.34
2800	581	0.73	644	0.95	704	1.16	762	1.36	817	1.56	871	1.75	923	1.94	973	2.13	1023	2.31	1073	2.48
3000	595	0.89	658	1.10	718	1.31	776	1.51	831	1.71	885	1.91	937	2.09	988	2.28	1038	2.46	1087	2.63
3200	610	1.05	673	1.27	733	1.48	791	1.68	846	1.88	900	2.07	952	2.26	1003	2.44	1053	2.62	1100	2.80
3400	627	1.23	689	1.45	750	1.66	807	1.86	863	2.06	916	2.25	968	2.44	1019	2.62	1069	2.80	--	--
3600	644	1.42	707	1.64	767	1.85	824	2.05	880	2.25	933	2.44	985	2.63	1036	2.82	1086	3.00	--	--
3800	662	1.63	725	1.84	785	2.05	842	2.26	898	2.46	951	2.65	1003	2.84	1054	3.02	1100	3.20	--	--
4000	681	1.85	744	2.06	804	2.27	861	2.47	917	2.67	970	2.87	1022	3.05	1073	3.24	--	--	--	--
4200	701	2.08	764	2.29	824	2.50	881	2.70	937	2.90	990	3.09	1042	3.28	1093	3.47	--	--	--	--
4250	706	2.14	769	2.35	829	2.56	887	2.76	942	2.96	996	3.15	1048	3.34	1098	3.53	--	--	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.4-hp																			
	High static option with motor rated at 3.7-hp																			
<b>Bold</b>	Field-supplied BK95 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 129: ZL 12 (10 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3000	653	0.79	706	1.02	758	1.25	808	1.49	858	1.72	907	1.95	955	2.18	1003	2.4	1049	2.62	1095	2.82
3200	667	0.94	720	1.17	771	1.40	822	1.64	872	1.88	921	2.11	969	2.34	1016	2.56	1063	2.77	1109	2.97
3400	682	1.11	734	1.34	786	1.57	837	1.81	887	2.04	936	2.28	984	2.5	1031	2.73	1078	2.94	1124	3.14
3600	697	1.29	750	1.52	802	1.76	853	1.99	903	2.23	952	2.46	1000	2.69	1047	2.91	1094	3.12	1140	3.32
3800	714	1.50	767	1.73	819	1.96	870	2.20	920	2.43	969	2.67	1017	2.90	1064	3.12	1111	3.33	1157	3.53
4000	733	1.73	786	1.96	837	2.19	888	2.43	938	2.66	987	2.90	1035	3.12	1083	3.34	1129	3.56	1174	3.76
4200	753	1.98	806	2.21	857	2.44	908	2.68	958	2.91	1007	3.15	1055	3.37	1102	3.6	1149	3.81	--	--
4400	774	2.25	827	2.48	879	2.72	930	2.95	979	3.19	1028	3.42	1076	3.65	1124	3.87	1170	4.08	--	--
4600	797	2.55	850	2.78	902	3.02	952	3.25	1002	3.49	1051	3.72	1099	3.95	1147	4.17	--	--	--	--
4800	822	2.88	874	3.11	926	3.34	977	3.58	1027	3.81	1076	4.05	1124	4.27	1171	4.50	--	--	--	--
5000	848	3.23	901	3.46	952	3.69	1003	3.93	1053	4.16	1102	4.4	1150	4.62	--	--	--	--	--	--
Standard static option with motor rated at 2.4-hp																				
Medium static option with motor rated at 2.9-hp																				
High static option with motor rated at 3.7-hp																				
-- Exceeds recommended blower speed																				

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 130: ZL14 (12.5 ton) side duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	684	1.33	741	1.56	792	1.81	840	2.07	884	2.33	927	2.60	971	2.85	1017	3.09	1066	3.30	1121	3.49
3800	688	1.38	745	1.61	797	1.85	844	2.12	888	2.38	932	2.65	976	2.90	1021	3.14	1071	3.35	1125	3.54
4000	706	1.58	763	1.81	814	2.06	861	2.32	906	2.59	949	2.85	993	3.11	1039	3.35	1088	3.56	1142	3.74
4200	724	1.81	781	2.04	832	2.29	879	2.55	924	2.82	967	3.08	1011	3.34	1057	3.57	1106	3.79	1160	3.97
4400	742	2.06	799	2.29	850	2.54	897	2.80	942	3.06	985	3.33	1029	3.58	1075	3.82	1124	4.03	1178	4.22
4600	760	2.32	817	2.55	869	2.80	916	3.06	960	3.33	1004	3.59	1048	3.85	1093	4.08	1143	4.30	--	--
4800	779	2.60	836	2.83	888	3.08	935	3.34	979	3.61	1023	3.88	1067	4.13	1112	4.37	1162	4.58	--	--
5000	799	2.91	856	3.14	907	3.39	954	3.65	999	3.91	1042	4.18	1086	4.43	1132	4.67	--	--	--	--
5200	819	3.23	876	3.46	927	3.71	974	3.97	1019	4.23	1062	4.50	1106	4.75	1152	4.99	--	--	--	--
5400	839	3.57	896	3.80	953	4.04	995	4.31	1039	4.57	1083	4.84	1127	5.09	--	--	--	--	--	--
5600	860	3.92	917	4.15	969	4.40	1016	4.66	1060	4.93	1104	5.19	--	--	--	--	--	--	--	--
5800	882	4.30	939	4.53	990	4.77	1037	5.04	--	--	--	--	--	--	--	--	--	--	--	--
6000	904	4.69	961	4.92	1012	5.17	--	--	--	--	--	--	--	--	--	--	--	--	--	--
Standard static option with motor rated at 2.9-hp																				
Medium static option with motor rated at 3.7-hp																				
High static option with motor rated at 5.25-hp																				
-- Exceeds recommended blower speed																				

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

## ZL08 to 14 bottom duct application (belt drive)

**Table 131: ZL08 (7.5 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2250	556	0.45	621	0.65	683	0.83	742	1.00	798	1.18	852	1.34	904	1.51	954	1.69	1003	1.87	1050	2.06
2400	567	0.53	632	0.73	694	0.91	753	1.09	809	1.26	863	1.43	914	1.60	964	1.77	1013	1.95	1060	2.14
2600	580	0.65	646	0.85	707	1.03	766	1.21	823	1.38	876	1.55	928	1.72	978	1.89	1027	2.07	1074	2.27
2800	595	0.79	660	0.99	722	1.17	780	1.35	837	1.52	890	1.69	942	1.86	992	2.03	1041	2.21	1088	2.40
3000	609	0.94	674	1.14	736	1.32	795	1.50	851	1.67	905	1.83	957	2.00	1007	2.18	1056	2.36	1100	2.55
3200	625	1.10	690	1.30	752	1.48	810	1.66	867	1.83	921	2.00	972	2.17	1022	2.34	1071	2.52	--	--
3400	641	1.28	706	1.47	768	1.66	827	1.83	883	2.00	937	2.17	989	2.34	1039	2.52	1087	2.70	--	--
3600	658	1.47	723	1.66	785	1.85	844	2.02	900	2.19	954	2.36	1006	2.53	1056	2.70	1100	2.89	--	--
3750	672	1.61	737	1.81	799	1.99	858	2.17	914	2.34	968	2.51	1019	2.68	1069	2.85	--	--	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.9-hp																			
	High static option with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 132: ZL09 (8.5 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2550	577	0.62	642	0.82	704	1.00	763	1.18	819	1.35	873	1.52	925	1.69	975	1.86	1023	2.04	1071	2.23
2600	580	0.65	646	0.85	707	1.03	766	1.21	823	1.38	876	1.55	928	1.72	978	1.89	1027	2.07	1074	2.27
2800	595	0.79	660	0.99	722	1.17	780	1.35	837	1.52	890	1.69	942	1.86	992	2.03	1041	2.21	1088	2.40
3000	609	0.94	674	1.14	736	1.32	795	1.50	851	1.67	905	1.83	957	2.00	1007	2.18	1056	2.36	1103	2.55
3200	625	1.10	690	1.30	752	1.48	810	1.66	867	1.83	921	2.00	972	2.17	1022	2.34	1071	2.52	--	--
3400	641	1.28	706	1.47	768	1.66	827	1.83	883	2.00	937	2.17	989	2.34	1039	2.52	1087	2.70	--	--
3600	658	1.47	723	1.66	785	1.85	844	2.02	900	2.19	954	2.36	1006	2.53	1056	2.7	1104	2.89	--	--
3800	676	1.67	742	1.86	803	2.04	862	2.22	918	2.39	972	2.56	1024	2.73	1074	2.90	--	--	--	--
4000	696	1.88	761	2.07	823	2.26	882	2.43	938	2.6	992	2.77	1043	2.94	1093	3.12	--	--	--	--
4200	716	2.1	781	2.29	843	2.48	902	2.65	958	2.82	1012	2.99	1064	3.16	1114	3.34	--	--	--	--
4250	721	2.16	786	2.35	848	2.53	907	2.71	963	2.88	1017	3.05	1069	3.22	1119	3.39	--	--	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 2.9-hp																			
	High static option with motor rated at 3.7-hp																			
<b>Bold</b>	Field-supplied BK95 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp. kW = 0.929 x bhp

**Table 133: ZL12 (10 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
2600	626	0.5	679	0.73	731	0.97	782	1.20	831	1.44	880	1.67	928	1.9	976	2.12	1022	2.33	1068	2.53
2800	639	0.64	692	0.87	744	1.11	795	1.34	845	1.58	894	1.81	942	2.04	989	2.26	1036	2.47	1082	2.67
3000	653	0.79	706	1.02	758	1.25	808	1.49	858	1.72	907	1.95	955	2.18	1003	2.40	1049	2.62	1095	2.82
3200	667	0.94	720	1.17	771	1.40	822	1.64	872	1.88	921	2.11	969	2.34	1016	2.56	1063	2.77	1109	2.97
3400	682	1.11	734	1.34	786	1.57	837	1.81	887	2.04	936	2.28	984	2.50	1031	2.73	1078	2.94	1124	3.14
3600	697	1.29	750	1.52	802	1.76	853	1.99	903	2.23	952	2.46	1000	2.69	1047	2.91	1094	3.12	1140	3.32
3800	714	1.5	767	1.73	819	1.96	870	2.20	920	2.43	969	2.67	1017	2.90	1064	3.12	1111	3.33	1157	3.53
4000	733	1.73	786	1.96	837	2.19	888	2.43	938	2.66	987	2.90	1035	3.12	1083	3.34	1129	3.56	1175	3.76
4200	753	1.98	806	2.21	857	2.44	908	2.68	958	2.91	1007	3.15	1055	3.37	1102	3.6	1149	3.81	1195	4.01
4400	774	2.25	827	2.48	879	2.72	930	2.95	979	3.19	1028	3.42	1076	3.65	1124	3.87	1170	4.08	1216	4.28
4600	797	2.55	850	2.78	902	3.02	952	3.25	1002	3.49	1051	3.72	1099	3.95	1147	4.17	1193	4.38	1239	4.58
4800	822	2.88	874	3.11	926	3.34	977	3.58	1027	3.81	1076	4.05	1124	4.27	1171	4.5	1218	4.71	--	--
5000	848	3.23	901	3.46	952	3.69	1003	3.93	1053	4.16	1102	4.40	1150	4.62	1197	4.84	1242	5.06	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 3.7-hp																			
	High static option with motor rated at 5.25-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $\text{kW} = 0.929 \times \text{bhp}$

**Table 134: ZL14 (12.5 ton) bottom duct**

cfm	Available external static pressure - IWG <sup>1</sup>																			
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
3750	715	1.46	762	1.68	810	1.91	858	2.13	907	2.36	957	2.58	1008	2.80	1060	3.02	1113	3.24	1167	3.46
3800	720	1.51	766	1.73	814	1.96	862	2.18	911	2.41	961	2.63	1012	2.85	1064	3.07	1117	3.29	1171	3.51
4000	737	1.72	784	1.94	832	2.17	880	2.39	929	2.62	979	2.84	1030	3.07	1082	3.29	1135	3.51	--	--
4200	756	1.95	803	2.17	851	2.40	899	2.63	948	2.85	998	3.07	1049	3.30	1101	3.52	1154	3.74	--	--
4400	777	2.20	824	2.42	871	2.65	920	2.87	969	3.10	1019	3.32	1069	3.55	1121	3.77	1174	3.98	--	--
4600	799	2.47	846	2.69	893	2.92	941	3.14	990	3.37	1040	3.59	1091	3.81	1143	4.04	--	--	--	--
4800	822	2.75	869	2.98	916	3.20	965	3.43	1014	3.65	1064	3.88	1114	4.10	1166	4.32	--	--	--	--
5000	846	3.06	893	3.28	941	3.51	989	3.73	1038	3.96	1088	4.18	1139	4.41	--	--	--	--	--	--
5200	872	3.39	919	3.61	966	3.83	1015	4.06	1064	4.28	1114	4.51	1164	4.73	--	--	--	--	--	--
5400	899	3.73	946	3.95	993	4.18	1042	4.40	1091	4.63	1141	4.85	--	--	--	--	--	--	--	--
5600	927	4.09	974	4.32	1021	4.54	1070	4.77	1119	4.99	1169	5.22	--	--	--	--	--	--	--	--
5800	956	4.47	1003	4.70	1051	4.92	1099	5.15	--	--	--	--	--	--	--	--	--	--	--	--
6000	987	4.87	1034	5.10	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--
	Standard static option with motor rated at 2.4-hp																			
	Medium static option with motor rated at 3.7-hp																			
	High static option with motor rated at 5.25-hp																			
--	Exceeds recommended blower speed																			

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous bhp.  $\text{kW} = 0.929 \times \text{bhp}$

## ZQ04 to 06 side duct application (direct drive)

**Table 135: ZQ04 to 06 side duct (cooling)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZQ04 (3)	1 (Low)	1147	152	659	988	181	787	901	203	891	800	226	987	682	247	1071
	2 (Med/Low)	1214	175	683	1094	206	810	965	232	896	898	258	1003	794	276	1084
	3 (Med)	1402	234	735	1324	264	835	1161	302	947	1074	329	1034	986	351	1114
	4 (Med/Hi)	1570	310	791	1512	348	884	1429	381	977	1253	420	1079	1130	423	1148
	5 (Hi)	1825	448	866	1769	487	946	1705	521	1023	1610	559	1107	1229	472	1159
ZQ05 (4)	1 (Low)	1412	261	793	1322	290	884	1244	321	966	1109	347	1059	1035	369	1131
	2 (Med/Low)	1521	313	831	1461	349	920	1382	374	989	1283	400	1072	1166	426	1150
	3 (Med)	1636	376	874	1574	413	959	1487	441	1034	1413	465	1099	1184	446	1164
	4 (Med/Hi)	1813	484	937	1747	522	1013	1668	552	1088	1581	565	1141	1212	458	1170
	5 (Hi)	2351	920	1111	2129	819	1138	1912	718	1153	1678	622	1164	1378	513	1176
ZQ06 (5)	1 (Low)	1692	345	727	1583	374	797	1482	403	866	1380	437	939	1262	462	1000
	2 (Med/Low)	1849	438	779	1755	468	843	1667	495	902	1552	530	971	1439	558	1033
	3 (Med)	1989	532	818	1904	564	877	1828	598	935	1738	628	994	1633	664	1058
	4 (Med/Hi)	2159	673	876	2087	713	931	2010	729	985	1933	778	1035	1859	812	1091
	5 (Hi)	2349	852	928	2270	887	978	2195	922	1028	2118	947	1075	1973	914	1109

**Table 136: ZQ04 to 06 side duct (gas heat)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZQ04 (3)	1 (Low)	1094	165	715	956	187	828	851	213	932	752	237	1026	638	253	1100
	2 (Med/Low)	1180	189	735	1064	216	842	940	242	945	849	263	1029	748	286	1116
	3 (Med)	1353	251	790	1271	280	883	1138	310	979	1036	338	1068	958	362	1144
	4 (Med/Hi)	1517	340	863	1450	374	940	1364	398	1021	1232	434	1114	1022	393	1163
	5 (Hi)	1763	490	953	1690	520	1020	1619	549	1086	1442	525	1140	1070	413	1168
ZQ05 (4)	1 (Low)	1356	285	870	1280	308	939	1185	332	1019	1074	364	1113	850	343	1179
	2 (Med/Low)	1459	349	920	1390	371	985	1306	393	1050	1195	421	1133	862	350	1182
	3 (Med)	1553	412	973	1475	442	1039	1415	462	1092	1289	469	1155	880	357	1182
	4 (Med/Hi)	1718	530	1040	1645	562	1102	1534	555	1147	1377	510	1165	961	390	1183
	5 (Hi)	1955	737	1146	1780	665	1156	1587	599	1168	1407	529	1175	902	366	1186
ZQ06 (5)	1 (Low)	1570	372	791	1463	399	855	1358	425	918	1260	456	983	1161	481	1044
	2 (Med/Low)	1740	468	845	1638	496	903	1543	529	965	1454	553	1015	1360	578	1070
	3 (Med)	1882	569	889	1786	601	947	1687	629	1002	1587	660	1053	1487	680	1105
	4 (Med/Hi)	2052	732	955	1967	749	999	1883	778	1049	1788	808	1099	1621	778	1130
	5 (Hi)	2227	905	1004	2138	937	1051	2038	947	1091	1869	887	1118	1662	811	1137



## ZQ04 to 06 bottom duct application (direct drive)

**Table 137: ZQ04 to 06 bottom duct (cooling)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZQ04 (3)	1 (Low)	1086	165	721	929	192	837	861	211	927	769	235	1023	636	253	1108
	2 (Med/Low)	1171	192	745	1035	221	856	946	241	944	868	267	1037	771	290	1119
	3 (Med)	1328	257	806	1255	280	890	1106	316	993	1038	336	1068	944	354	1148
	4 (Med/Hi)	1509	340	867	1449	376	953	1309	407	1046	1210	436	1121	1002	387	1162
	5 (Hi)	1740	490	959	1683	522	1033	1618	555	1101	1315	500	1149	1037	404	1168
ZQ05 (4)	1 (Low)	1330	284	863	1261	302	929	1172	329	1006	1053	353	1088	970	376	1162
	2 (Med/Low)	1458	349	917	1385	372	981	1307	395	1047	1174	421	1129	1023	398	1170
	3 (Med)	1553	414	965	1477	440	1033	1427	461	1086	1334	480	1148	1017	400	1175
	4 (Med/Hi)	1714	532	1041	1638	563	1107	1555	563	1143	1374	503	1161	1033	406	1176
	5 (Hi)	1935	740	1150	1768	667	1160	1610	610	1167	1421	536	1175	1061	421	1183
ZQ06 (5)	1 (Low)	1600	355	759	1518	390	831	1437	418	897	1324	445	961	1224	469	1020
	2 (Med/Low)	1760	449	811	1676	486	879	1587	514	938	1497	547	999	1414	574	1057
	3 (Med)	1898	554	859	1809	587	921	1735	619	977	1641	647	1035	1549	675	1088
	4 (Med/Hi)	2072	708	923	1991	741	977	1917	775	1029	1836	802	1079	1702	794	1122
	5 (Hi)	2228	884	980	2151	919	1031	2072	944	1077	1945	914	1109	1731	822	1131

**Table 138: ZQ04 to 06 bottom duct (gas heat)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZQ04 (3)	1 (Low)	1047	167	733	903	195	854	808	220	956	693	238	1042	567	254	1115
	2 (Med/Low)	1122	197	769	995	225	876	899	252	979	804	276	1065	682	294	1143
	3 (Med)	1275	262	829	1197	291	916	1058	324	1025	963	350	1108	792	334	1165
	4 (Med/Hi)	1461	353	895	1391	381	972	1279	415	1064	1123	432	1146	854	355	1169
	5 (Hi)	1674	506	993	1620	538	1061	1533	555	1123	1179	463	1161	885	369	1176
ZQ05 (4)	1 (Low)	1301	300	911	1211	324	986	1112	349	1062	1007	371	1144	738	318	1184
	2 (Med/Low)	1408	366	970	1331	390	1041	1232	416	1117	1061	401	1169	693	306	1184
	3 (Med)	1496	436	1019	1425	459	1079	1331	482	1146	1083	415	1171	717	316	1184
	4 (Med/Hi)	1641	553	1091	1566	566	1138	1392	520	1160	1104	429	1176	738	321	1185
	5 (Hi)	1779	680	1160	1630	621	1167	1428	547	1174	1144	447	1184	761	332	1191
ZQ06 (5)	1 (Low)	1572	373	802	1466	402	868	1378	434	935	1264	461	999	1183	484	1055
	2 (Med/Low)	1718	475	859	1632	508	920	1531	535	980	1438	562	1036	1344	592	1094
	3 (Med)	1868	578	908	1777	606	961	1687	639	1019	1591	666	1074	1474	678	1122
	4 (Med/Hi)	2019	740	976	1944	770	1023	1859	797	1070	1743	796	1114	1528	728	1139
	5 (Hi)	2182	927	1035	2089	949	1080	1961	918	1109	1808	854	1128	1552	737	1144

## ZY04 to 06 side duct application (direct drive)

**Table 139: ZY04 to 06 side duct (cooling)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZY04 (3)	1 (Low)	987	120	651	813	145	774	698	162	864	541	180	959	383	201	1047
	2 (Med/Low)	1079	144	677	936	171	795	793	190	886	692	214	975	521	232	1063
	3 (Med)	1153	166	701	1037	195	812	875	221	913	786	239	986	654	263	1076
	4 (Med/Hi)	1191	178	712	1086	206	815	927	233	916	837	257	998	711	278	1083
	5 (Hi)	1728	484	959	1649	515	1027	1579	544	1089	1425	524	1138	1001	405	1168
ZY05 (4)	1 (Low)	1302	207	727	1188	240	841	1037	266	933	941	296	1022	882	318	1098
	2 (Med/Low)	1421	247	757	1323	282	861	1209	315	958	1064	346	1043	993	368	1116
	3 (Med)	1538	297	795	1453	332	888	1343	367	982	1216	396	1058	1093	427	1146
	4 (Med/Hi)	1571	315	809	1496	352	898	1385	389	996	1288	420	1072	1135	444	1147
	5 (Hi)	1779	432	878	1707	470	960	1615	511	1042	1516	544	1123	1165	468	1160
ZY06 (5)	1 (Low)	1588	298	695	1517	330	761	1409	358	835	1273	393	913	1167	418	973
	2 (Med/Low)	1624	321	713	1557	352	777	1464	383	845	1315	418	924	1224	446	983
	3 (Med)	1942	504	792	1881	536	852	1800	565	908	1714	605	969	1611	644	1038
	4 (Med/Hi)	2146	631	840	2064	692	908	2001	713	954	1932	757	1007	1843	794	1065
	5 (Hi)	2316	812	892	2240	861	954	2181	894	1000	2113	938	1045	2003	946	1093

**Table 140: ZY04 to 06 side duct (gas heat)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZY04 (3)	1 (Low)	978	125	684	853	149	797	734	172	906	596	190	998	445	203	1068
	2 (Med/Low)	1078	153	721	962	175	817	846	200	922	726	226	1026	599	241	1098
	3 (Med)	1153	178	748	1045	199	837	934	226	937	831	251	1031	709	272	1114
	4 (Med/Hi)	1315	248	819	1239	272	895	1138	300	980	1037	323	1062	922	343	1144
	5 (Hi)	1728	484	959	1649	515	1027	1579	544	1089	1425	524	1138	1001	405	1168
ZY05 (4)	1 (Low)	1299	223	786	1226	249	871	1137	273	956	1031	303	1051	923	329	1143
	2 (Med/Low)	1413	272	832	1349	299	906	1266	325	982	1160	352	1070	1042	370	1155
	3 (Med)	1514	327	878	1456	353	942	1389	381	1014	1298	408	1089	1133	405	1165
	4 (Med/Hi)	1751	472	972	1698	502	1033	1639	534	1088	1543	536	1142	1156	420	1172
	5 (Hi)	2093	768	1116	1944	717	1137	1764	651	1152	1506	552	1163	1146	441	1177
ZY06 (5)	1 (Low)	1528	328	781	1427	356	850	1346	386	912	1256	410	969	1181	434	1022
	2 (Med/Low)	1575	362	803	1488	391	871	1401	419	929	1319	445	985	1247	469	1037
	3 (Med)	1867	572	902	1795	601	963	1709	628	1015	1633	652	1061	1544	671	1110
	4 (Med/Hi)	2049	718	968	1969	768	1026	1902	788	1070	1808	802	1110	1637	744	1132
	5 (Hi)	2218	899	1021	2138	928	1074	2007	907	1105	1846	842	1123	1671	767	1139

## ZY04 to 06 bottom duct application (direct drive)

**Table 141: ZY04 to 06 bottom duct (cooling)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZY04 (3)	1 (Low)	929	128	699	782	148	794	663	164	880	514	187	976	377	202	1053
	2 (Med/Low)	1036	157	732	870	177	827	803	198	905	649	217	996	508	236	1074
	3 (Med)	1106	181	760	956	204	849	878	225	928	755	245	1010	616	266	1092
	4 (Med/Hi)	1147	197	776	1042	218	860	916	243	944	820	262	1017	671	286	1103
	5 (Hi)	1680	501	997	1622	526	1056	1538	546	1119	1296	485	1153	939	374	1176
ZY05 (4)	1 (Low)	1256	220	776	1170	242	851	1077	266	931	988	298	1025	872	321	1113
	2 (Med/Low)	1350	272	828	1279	292	893	1196	320	966	1105	347	1048	1003	372	1131
	3 (Med)	1449	323	866	1380	350	937	1303	370	996	1223	402	1071	1133	428	1149
	4 (Med/Hi)	1488	345	882	1418	374	954	1357	394	1006	1264	424	1083	1160	442	1155
	5 (Hi)	1677	471	966	1602	507	1034	1543	525	1083	1475	545	1131	1209	465	1162
ZY06 (5)	1 (Low)	1548	310	720	1441	336	792	1337	370	864	1213	397	928	1097	421	988
	2 (Med/Low)	1593	337	738	1488	363	805	1381	394	875	1271	425	937	1150	451	997
	3 (Med)	1880	532	827	1792	563	890	1719	588	944	1632	629	1006	1527	652	1061
	4 (Med/Hi)	2066	689	895	1999	712	942	1907	761	999	1830	773	1048	1734	809	1100
	5 (Hi)	2237	862	949	2163	882	996	2097	929	1036	1998	946	1085	1815	883	1115

**Table 142: ZY04 to 06 bottom duct (gas heat)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZY04 (3)	1 (Low)	969	130	703	839	151	810	717	174	916	569	191	1006	444	204	1069
	2 (Med/Low)	1063	158	741	955	180	834	828	204	938	709	227	1030	583	242	1100
	3 (Med)	1135	182	769	1041	208	858	919	229	952	805	254	1045	681	275	1127
	4 (Med/Hi)	1310	256	842	1225	279	917	1123	307	1001	1029	334	1083	863	335	1155
	5 (Hi)	1680	501	997	1622	526	1056	1538	546	1119	1296	485	1153	939	374	1176
ZY05 (4)	1 (Low)	1277	228	801	1196	251	878	1096	278	967	983	305	1062	873	329	1156
	2 (Med/Low)	1382	278	847	1307	302	916	1217	327	994	1108	355	1083	949	359	1164
	3 (Med)	1486	331	888	1417	359	957	1331	385	1028	1237	410	1103	1023	385	1169
	4 (Med/Hi)	1717	473	991	1653	509	1052	1586	538	1107	1443	521	1150	1052	394	1175
	5 (Hi)	2006	738	1132	1854	682	1147	1704	621	1154	1504	552	1168	1073	418	1177
ZY06 (5)	1 (Low)	1488	335	787	1400	363	851	1320	389	910	1242	416	969	1160	440	1027
	2 (Med/Low)	1536	364	803	1453	392	864	1363	419	924	1293	447	981	1212	471	1037
	3 (Med)	1822	586	914	1752	602	966	1666	632	1017	1586	656	1066	1503	676	1113
	4 (Med/Hi)	1999	726	982	1932	761	1030	1860	809	1076	1753	799	1114	1598	749	1134
	5 (Hi)	2170	932	1040	2091	930	1084	1965	910	1109	1798	843	1127	1618	763	1139

## ZL04 to ZL06 side duct application (direct drive)

**Table 143: ZL04 to ZL06 side duct (cooling)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZL04 (3)	1 (Low)	894	104	646	707	127	777	578	137	855	—	—	—	—	—	—
	2 (Med/Low)	1079	144	677	936	171	795	793	190	886	692	214	975	521	232	1063
	3 (Med)	1153	166	701	1037	195	812	875	221	913	786	239	986	654	263	1076
	4 (Med/Hi)	1303	224	769	1211	258	876	1097	286	972	924	313	1059	839	326	1117
	5 (Hi)	1728	484	959	1649	515	1027	1579	544	1089	1425	524	1138	1001	405	1168
ZL05 (4)	1 (Low)	1063	130	651	900	158	783	698	183	900	—	—	—	—	—	—
	2 (Med/Low)	1421	247	757	1323	282	861	1209	315	958	1064	346	1043	993	368	1116
	3 (Med)	1571	315	809	1496	352	898	1385	389	996	1288	420	1072	1135	444	1147
	4 (Med/Hi)	1669	376	869	1552	416	974	1438	446	1055	1358	472	1113	1045	432	1160
	5 (Hi)	1779	432	878	1707	470	960	1615	511	1042	1516	544	1123	1165	468	1160
ZL06 (5)	1 (Low)	1220	120	544	1117	150	634	974	172	728	—	—	—	—	—	—
	2 (Med/Low)	1624	321	713	1557	352	777	1464	383	845	1315	418	924	1224	446	983
	3 (Med)	1875	404	729	1800	443	792	1709	476	863	1608	525	941	1500	572	1017
	4 (Med/Hi)	2146	631	840	2064	692	908	2001	713	954	1932	757	1007	1843	794	1065
	5 (Hi)	2316	812	892	2240	861	954	2181	894	1000	2113	938	1045	2003	946	1093

**Table 144: ZL04 to ZL06 side duct (gas heat)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZL04 (3)	1 (Low)	885	109	679	747	131	800	614	147	897	—	—	—	—	—	—
	2 (Med/Low)	1078	153	721	962	175	817	846	200	922	726	226	1026	599	241	1098
	3 (Med)	1153	178	748	1045	199	837	934	226	937	831	251	1031	709	272	1114
	4 (Med/Hi)	1292	243	831	1215	269	915	1111	295	1001	988	317	1086	865	333	1162
	5 (Hi)	1728	484	959	1649	515	1027	1579	544	1089	1425	524	1138	1001	405	1168
ZL05 (4)	1 (Low)	1060	146	710	938	167	813	798	190	923	—	—	—	—	—	—
	2 (Med/Low)	1413	272	832	1349	299	906	1266	325	982	1160	352	1070	1042	370	1155
	3 (Med)	1612	388	938	1512	417	1018	1442	438	1073	1368	460	1130	1043	393	1178
	4 (Med/Hi)	1751	472	972	1698	502	1033	1639	534	1088	1543	536	1142	1156	420	1172
	5 (Hi)	2093	768	1116	1944	717	1137	1764	651	1152	1506	552	1163	1146	441	1177
ZL06 (5)	1 (Low)	1207	184	652	1088	211	744	966	233	822	847	254	891	722	271	948
	2 (Med/Low)	1575	362	803	1488	391	871	1401	419	929	1319	445	985	1247	469	1037
	3 (Med)	1800	472	839	1714	508	903	1618	539	970	1527	572	1033	1433	599	1089
	4 (Med/Hi)	2049	718	968	1969	768	1026	1902	788	1070	1808	802	1110	1637	744	1132
	5 (Hi)	2218	899	1021	2138	928	1074	2007	907	1105	1846	842	1123	1671	767	1139

**Note:** 24 V wires 261/orange, 267/red, 238/white can be moved up to different taps depending on the airflow and static requirements of the application. See the relevant unit's wiring diagram.

## ZL04 to ZL06 bottom duct application (direct drive)

**Table 145: ZL04 to ZL06 bottom duct (cooling)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZL04 (3)	1 (Low)	836	112	694	676	130	797	543	139	871	—	—	—	—	—	—
	2 (Med/Low)	1036	157	732	870	177	827	803	198	905	649	217	996	508	236	1074
	3 (Med)	1106	181	760	956	204	849	878	225	928	755	245	1010	616	266	1092
	4 (Med/Hi)	1249	247	842	1153	274	929	1010	299	1007	926	317	1077	815	337	1143
	5 (Hi)	1680	501	997	1622	526	1056	1538	546	1119	1296	485	1153	939	374	1176
ZL05 (4)	1 (Low)	1017	143	700	882	160	793	738	183	898	—	—	—	—	—	—
	2 (Med/Low)	1350	272	828	1279	292	893	1196	320	966	1105	347	1048	1003	372	1131
	3 (Med)	1586	406	942	1474	438	1030	1410	451	1065	1334	476	1124	1070	430	1168
	4 (Med/Hi)	1488	345	882	1418	374	954	1357	394	1006	1264	424	1083	1160	442	1155
	5 (Hi)	1677	471	966	1602	507	1034	1543	525	1083	1475	545	1131	1209	465	1162
ZL06 (5)	1 (Low)	1180	132	569	1041	156	665	902	184	757	—	—	—	—	—	—
	2 (Med/Low)	1593	337	738	1488	363	805	1381	394	875	1271	425	937	1150	451	997
	3 (Med)	1813	432	764	1711	470	830	1628	499	899	1526	549	978	1416	580	1040
	4 (Med/Hi)	2066	689	895	1999	712	942	1907	761	999	1830	773	1048	1734	809	1100
	5 (Hi)	2237	862	949	2163	882	996	2097	929	1036	1998	946	1085	1815	883	1115

**Table 146: ZL04 to ZL06 bottom duct (gas heat)**

Unit (ton)	Motor speed	Available external static														
		0.2			0.4			0.6			0.8			1.0		
		cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm	cfm	watts	rpm
ZL04 (3)	1 (Low)	876	114	698	733	133	813	597	149	907	—	—	—	—	—	—
	2 (Med/Low)	1063	158	741	955	180	834	828	204	938	709	227	1030	583	242	1100
	3 (Med)	1135	182	769	1041	208	858	919	229	952	805	254	1045	681	275	1127
	4 (Med/Hi)	1287	251	854	1201	276	937	1096	302	1022	980	328	1107	806	325	1173
	5 (Hi)	1680	501	997	1622	526	1056	1538	546	1119	1296	485	1153	939	374	1176
ZL05 (4)	1 (Low)	1038	151	725	908	169	820	757	195	934	—	—	—	—	—	—
	2 (Med/Low)	1382	278	847	1307	302	916	1217	327	994	1108	355	1083	949	359	1164
	3 (Med)	1584	392	948	1473	423	1033	1384	442	1087	1307	462	1144	933	373	1182
	4 (Med/Hi)	1717	473	991	1653	509	1052	1586	538	1107	1443	521	1150	1052	394	1175
	5 (Hi)	2006	738	1132	1854	682	1147	1704	621	1154	1504	552	1168	1073	418	1177
ZL06 (5)	1 (Low)	1167	191	658	1061	218	745	940	236	820	833	260	891	701	277	953
	2 (Med/Low)	1536	364	803	1453	392	864	1363	419	924	1293	447	981	1212	471	1037
	3 (Med)	1755	486	851	1671	509	906	1575	543	972	1480	576	1038	1392	604	1092
	4 (Med/Hi)	1999	726	982	1932	761	1030	1860	809	1076	1753	799	1114	1598	749	1134
	5 (Hi)	2170	932	1040	2091	930	1084	1965	910	1109	1798	843	1127	1618	763	1139

① **Note:** 24 V wires 261/orange, 267/red, 238/white can be moved up to different taps depending on the airflow and static requirements of the application. See the relevant unit's wiring diagram.

# Power exhaust blower curves

Figure 3: 208/280-1-60 power exhaust fan curve

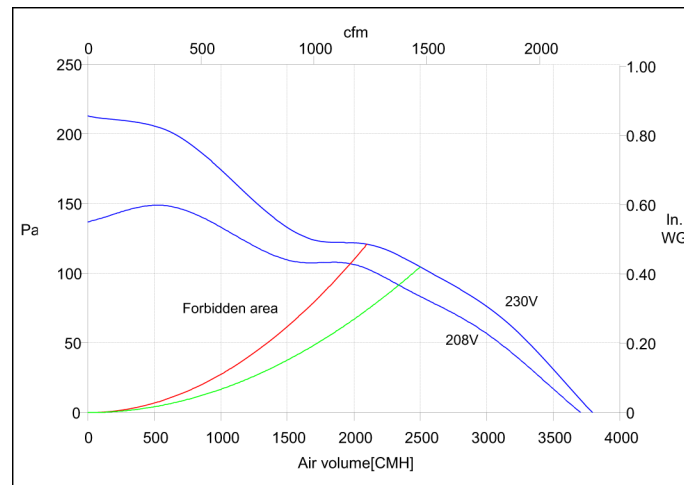


Figure 4: 460-3-60 power exhaust fan curve



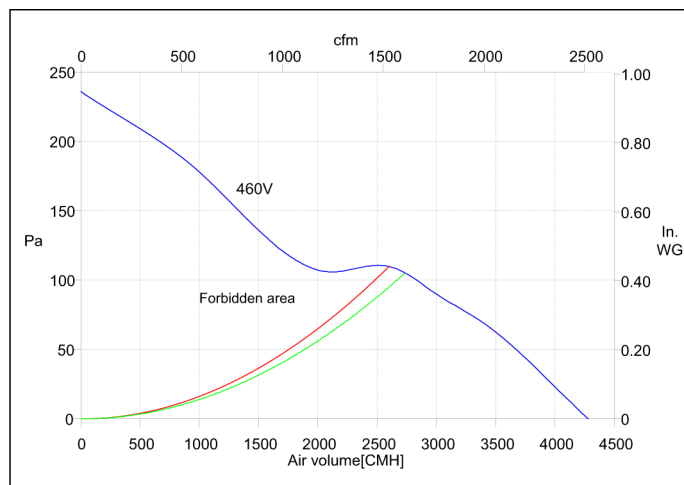


Figure 5: 208/280-3-60 power exhaust fan curve

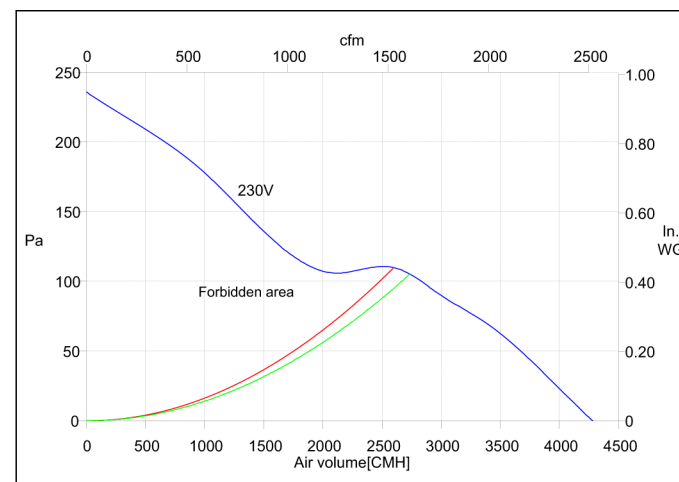

**Figure 6: 575-3-50 power exhaust fan curve**

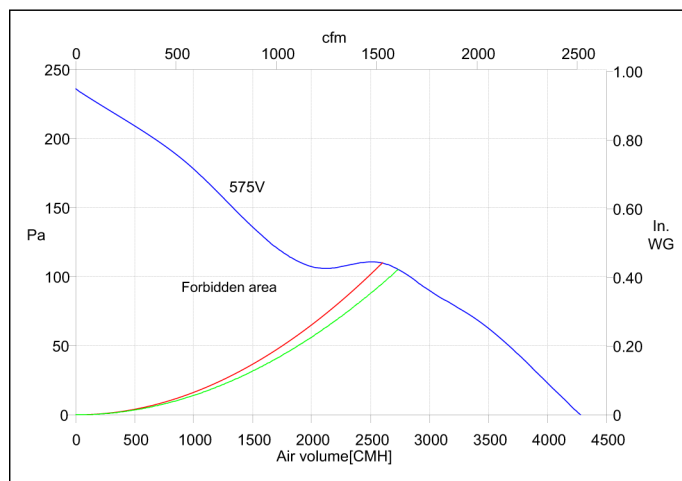

# Electrical data

## ZQ04 to 06 standard indoor blower - without powered convenience outlet

**Table 147: ZQ04 to 06 standard indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA								
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	6.6	1.5	—	None	—	—	—	27.2	30	40	27	89	28.7	30	40	29	92	36	92	40	40	36	92
												10625	4.9	1	23.6	37.8	40	40	35	89	39.6	40	40	36	92	40	40				
												11125	7.9	1	38	55.8	60	60	51	89	57.6	60	60	53	92	60	60				
	230-1-60	15.4	83.9	24	—	—	—	1.4	6	1.3	—	None	—	—	—	26.7	30	40	26	89	28	30	40	28	92	40	40	28	92		
												10625	6.5	1	27.1	41.4	45	45	38	89	43	45	45	40	92	45	45				
												11125	10.5	1	43.8	62.3	70	70	57	89	63.9	70	70	59	92	70	70				
	208-3-60	10.4	73	16	—	—	—	1.3	6.6	1.1	—	None	—	—	—	20.9	25	30	21	78	22	25	30	22	80	30	30	24	80		
												10625	4.9	1	13.6	25.3	30	30	23	78	26.6	30	30	24	80	30	30				
												11125	7.9	1	21.9	35.6	40	40	33	78	37	40	40	34	80	40	40				
	230-3-60	10.4	73	16	—	—	—	1.4	6	1	—	11625	12	1	33.3	49.9	50	50	46	78	51.3	60	60	47	80	60	60				
												None	—	—	—	20.4	25	30	20	78	21.4	25	30	22	81	25	30				
												10625	6.5	1	15.6	27	30	30	25	78	28.3	30	30	26	81	30	30				
	460-3-60	5.8	38	9	—	—	—	0.8	3.2	0.5	—	11125	10.5	1	25.3	39.1	40	40	36	78	40.4	45	45	37	81	45	45				
												11625	16	1	38.5	55.6	60	60	51	78	56.9	60	60	52	81	60	60				
												None	—	—	—	11.3	15	15	11	42	11.8	15	15	12	43	15	15				
	575-3-60	3.8	36.5	6	—	—	—	0.6	6	0.4	—	10646	6	1	7.2	13	15	15	12	42	13.6	15	15	13	43	15	15				
												11146	11.5	1	13.8	21.3	25	25	20	42	21.9	25	25	20	43	25	25				
												11446	14	1	16.8	25	25	25	23	42	25.6	30	30	24	43	30	30				
05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	8.4	1.5	—	None	—	—	—	34.2	35	50	34	135	35.7	40	50	35	138	45	50				
												10625	4.9	1	23.6	40	40	50	37	135	41.9	45	50	39	138	45	50				
												11125	7.9	1	38	58	60	60	53	135	59.9	60	60	55	138	60	60				
	230-1-60	19.6	130	31	—	—	—	1.4	7.6	1.3	—	None	—	—	—	33.5	35	50	33	135	34.8	35	50	34	138	45	50				
												10625	6.5	1	27.1	43.4	45	50	40	135	45	45	50	41	138	45	50				
												11125	10.5	1	43.8	64.3	70	70	59	135	65.9	70	70	61	138	70	70				
	208-3-60	13.7	83.1	21	—	—	—	1.3	8.4	1.1	—	None	—	—	—	26.8	30	40	27	88	27.9	30	40	28	91	30	40				
												10625	4.9	1	13.6	27.5	30	40	27	88	28.9	30	40	28	91	30	40				
												11125	7.9	1	21.9	37.9	40	40	35	88	39.3	40	40	36	91	40	40				
	230-3-60	13.7	83.1	21	—	—	—	1.4	7.6	1	—	11625	12	1	33.3	52.1	60	60	48	88	53.5	60	60	49	91	60	60				
												None	—	—	—	26.1	30	35	26	88	27.1	30	40	27	91	30	40				
												10625	6.5	1	15.6	29	30	35	27	88	30.3	35	40	28	91	35	40				
	460-3-60	6.2	41	10	—	—	—	0.8	4	0.5	—	11125	10.5	1	25.3	41.1	45	45	38	88	42.4	45	45	39	91	45	45				
												11625	16	1	38.5	57.6	60	60	53	88	58.9	60	60	54	91	60	60				
												None	—	—	—	12.6	15	15	13	45	13.1	15	15	13	46	15	15				
	575-3-60	4.8	33	8	—	—	—	0.6	7.6	0.4	—	10646	6	1	7.2	14	15	15	13	45	14.6	15	15	13	46	15	15				
												11146	11.5	1	13.8	22.3	25	25	20	45	22.9	25	25	21	46	25	25				
												11446	14	1	16.8	26	30	30	24	45	26.6	30	30	24	46	30	30				



**Table 147: ZQ04 to 06 standard indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	24.4	144	38	—	—	—	2	8.4	1.5	—	None	—	—	—	40.9	45	60	40	151	42.4	45	60	42	154
												10625	4.9	1	23.6	40.9	45	60	40	151	42.4	45	60	42	154
												11125	7.9	1	38	58	60	60	53	151	59.9	60	60	55	154
	230-1-60	24.4	144	38	—	—	—	2.3	7.6	1.3	—	None	—	—	—	40.4	45	60	39	151	41.7	45	60	41	154
												10625	6.5	1	27.1	43.4	45	60	40	151	45	45	60	41	154
												11125	10.5	1	43.8	64.3	70	70	59	151	65.9	70	70	61	154
	208-3-60	16	110	25	—	—	—	2	8.4	1.1	—	None	—	—	—	30.4	35	45	30	116	31.5	35	45	32	119
												10625	4.9	1	13.6	30.4	35	45	30	116	31.5	35	45	32	119
												11125	7.9	1	21.9	37.9	40	45	35	116	39.3	40	45	36	119
	230-3-60	16	110	25	—	—	—	2.3	7.6	1	—	11625	12	1	33.3	52.1	60	60	48	116	53.5	60	60	49	119
												None	—	—	—	29.9	30	45	30	117	30.9	35	45	31	119
												10625	6.5	1	15.6	29.9	30	45	30	117	30.9	35	45	31	119
	460-3-60	7.8	52	12	—	—	—	1.3	4	0.5	—	11125	10.5	1	25.3	41.1	45	45	38	117	42.4	45	45	39	119
												11625	16	1	38.5	57.6	60	60	53	117	58.9	60	60	54	119
												None	—	—	—	15.1	20	20	15	57	15.6	20	20	16	58
	575-3-60	5.7	38.9	9	—	—	—	1	7.6	0.4	—	10646	6	1	7.2	15.1	20	20	13	57	15.6	20	20	13	58
												11146	11.5	1	13.8	22.3	25	25	20	57	22.9	25	25	21	58
												11446	14	1	16.8	26	30	30	24	57	26.6	30	30	24	58
		5.7	38.9	9	—	—	—	1	7.6	0.4	—	None	—	—	—	11.1	15	15	11	42	11.5	15	15	12	43
												11458	13.8	1	13.3	20.4	25	25	19	42	20.9	25	25	19	43
												12358	23	1	22.1	31.4	35	35	29	42	31.9	35	35	29	43

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory-installed disconnect amperage rating.

# ZQ04 to 06 standard indoor blower - with powered convenience outlet

**Table 148: ZQ04 to 06 standard indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	6.6	1.5	8.6	None	—	—	—	31.5	35	45	32	93	33	35	45	33	97
												10625	4.9	1	23.6	43.1	45	45	40	93	45	45	45	41	97
												11125	7.9	1	38	61.1	70	70	56	93	63	70	70	58	97
	230-1-60	15.4	83.9	24	—	—	—	1.4	6	1.3	8.6	None	—	—	—	31	35	45	31	93	32.3	35	45	33	96
												10625	6.5	1	27.1	46.8	50	50	43	93	48.4	50	50	45	96
												11125	10.5	1	43.8	67.6	70	70	62	93	69.3	70	70	64	96
	208-3-60	10.4	73	16	—	—	—	1.3	6.6	1.1	8.6	None	—	—	—	25.2	30	35	26	82	26.3	30	35	27	85
												10625	4.9	1	13.6	30.6	35	35	28	82	32	35	35	29	85
												11125	7.9	1	21.9	41	45	45	38	82	42.4	45	45	39	85
	230-3-60	10.4	73	16	—	—	—	1.4	6	1	8.6	11625	12	1	33.3	55.3	60	60	51	82	56.6	60	60	52	85
												None	—	—	—	24.7	25	35	25	83	25.7	30	35	27	85
												10625	6.5	1	15.6	32.4	35	35	30	83	33.6	35	35	31	85
	460-3-60	5.8	38	9	—	—	—	0.8	3.2	0.5	8.6	11125	10.5	1	25.3	44.5	45	45	41	83	45.8	50	50	42	85
												11625	16	1	38.5	61	70	70	56	83	62.3	70	70	57	85
												None	—	—	—	13.5	15	15	14	44	14	15	15	14	45
	575-3-60	3.8	36.5	6	—	—	—	0.6	6	0.4	8.6	10646	6	1	7.2	15.7	20	20	14	44	16.3	20	20	15	45
												11146	11.5	1	13.8	23.9	25	25	22	44	24.6	25	25	23	45
												11446	14	1	16.8	27.7	30	30	25	44	28.3	30	30	26	45
05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	8.4	1.5	8.6	None	—	—	—	38.5	40	50	39	139	40	40	50	40	143
												10625	4.9	1	23.6	45.4	50	50	42	139	47.3	50	50	43	143
												11125	7.9	1	38	63.4	70	70	58	139	65.3	70	70	60	143
	230-1-60	19.6	130	31	—	—	—	1.4	7.6	1.3	8.6	None	—	—	—	37.8	40	50	38	140	39.1	40	50	39	142
												10625	6.5	1	27.1	48.8	50	50	45	140	50.4	60	60	46	142
												11125	10.5	1	43.8	69.6	70	70	64	140	71.3	80	80	66	142
	208-3-60	13.7	83.1	21	—	—	—	1.3	8.4	1.1	8.6	None	—	—	—	31.1	35	40	32	92	32.2	35	45	33	95
												10625	4.9	1	13.6	32.9	35	40	32	92	34.3	35	45	33	95
												11125	7.9	1	21.9	43.3	45	45	40	92	44.6	45	45	41	95
	230-3-60	13.7	83.1	21	—	—	—	1.4	7.6	1	8.6	11625	12	1	33.3	57.5	60	60	53	92	58.9	60	60	54	95
												None	—	—	—	30.4	35	40	31	93	31.4	35	45	32	95
												10625	6.5	1	15.6	34.4	35	40	32	93	35.6	40	45	33	95
	460-3-60	6.2	41	10	—	—	—	0.8	4	0.5	8.6	11125	10.5	1	25.3	46.5	50	50	43	93	47.8	50	50	44	95
												11625	16	1	38.5	63	70	70	58	93	64.3	70	70	59	95
												None	—	—	—	14.8	15	20	15	47	15.3	20	20	16	48
	575-3-60	4.8	33	8	—	—	—	0.6	7.6	0.4	8.6	10646	6	1	7.2	16.7	20	20	15	47	17.3	20	20	16	48
												11146	11.5	1	13.8	24.9	25	25	23	47	25.6	30	30	24	48
												11446	14	1	16.8	28.7	30	30	26	47	29.3	30	30	27	48
												None	—	—	—	11.4	15	15	12	37	11.8	15	15	12	38
												11058	9.2	1	8.9	17.1	20	20	16	37	17.6	20	20	16	38
												11458	13.8	1	13.3	22.6	25	25	21	37	23.1	25	25	21	38

**Table 148: ZQ04 to 06 standard indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse / breaker size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>3</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	24.4	144	38	—	—	—	2	8.4	1.5	8.6	None	—	—	—	45.2	50	60	45	155	46.7	50	70	47	158
												10625	4.9	1	23.6	45.4	50	60	45	155	47.3	50	70	47	158
												11125	7.9	1	38	63.4	70	70	58	155	65.3	70	70	60	158
	230-1-60	24.4	144	38	—	—	—	2.3	7.6	1.3	8.6	None	—	—	—	44.7	45	60	44	155	46	50	70	46	158
												10625	6.5	1	27.1	48.8	50	60	45	155	50.4	60	70	46	158
												11125	10.5	1	43.8	69.6	70	70	64	155	71.3	80	80	66	158
	208-3-60	16	110	25	—	—	—	2	8.4	1.1	8.6	None	—	—	—	34.7	35	50	35	121	35.8	40	50	37	123
												10625	4.9	1	13.6	34.7	35	50	35	121	35.8	40	50	37	123
												11125	7.9	1	21.9	43.3	45	50	40	121	44.6	45	50	41	123
	230-3-60	16	110	25	—	—	—	2.3	7.6	1	8.6	11625	12	1	33.3	57.5	60	60	53	121	58.9	60	60	54	123
												None	—	—	—	34.2	35	50	35	121	35.2	40	50	36	124
												10625	6.5	1	15.6	34.4	35	50	35	121	35.6	40	50	36	124
	460-3-60	7.8	52	12	—	—	—	1.3	4	0.5	8.6	11125	10.5	1	25.3	46.5	50	50	43	121	47.8	50	50	44	124
												11625	16	1	38.5	63	70	70	58	121	64.3	70	70	59	124
												None	—	—	—	17.3	20	25	18	59	17.8	20	25	18	60
	575-3-60	5.7	38.9	9	—	—	—	1	7.6	0.4	8.6	10646	6	1	7.2	17.3	20	25	15	59	17.8	20	25	16	60
												11146	11.5	1	13.8	24.9	25	25	23	59	25.6	30	30	24	60
												11446	14	1	16.8	28.7	30	30	26	59	29.3	30	30	27	60
												None	—	—	—	12.9	15	15	13	44	13.3	15	15	14	45
												11458	13.8	1	13.3	22.6	25	25	21	44	23.1	25	25	21	45
												12358	23	1	22.1	33.6	35	35	31	44	34.1	35	35	31	45

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory-installed disconnect amperage rating.

# ZQ04 to 06 medium indoor blower - without powered convenience outlet

**Table 149: ZQ04 to 06 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh					
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA				
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	7.6	1.5	—	None	—	—	—	28.2	30	40	28	120	29.7	30	45	30	123	30	123		
												10625	4.9	1	23.6	39	40	40	36	120	40.9	45	45	38	123	45	45	38	123
												11125	7.9	1	38	57	60	60	52	120	58.9	60	60	54	123	60	60	54	123
	230-1-60	15.4	83.9	24	—	—	—	1.4	7	1.3	—	None	—	—	—	27.7	30	40	27	123	29	30	40	29	126	30	126		
												10625	6.5	1	27.1	42.6	45	45	39	123	44.3	45	45	41	126	45	45	41	126
												11125	10.5	1	43.8	63.5	70	70	58	123	65.1	70	70	60	126	70	70	60	126
	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	—	None	—	—	—	19.5	20	25	19	98	20.6	25	30	21	101	25	101		
												10625	4.9	1	13.6	23.5	25	25	22	98	24.9	25	30	23	101	25	30	23	101
												11125	7.9	1	21.9	33.9	35	35	31	98	35.3	40	40	32	101	40	40	32	101
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	—	None	—	—	—	19.6	20	30	20	101	20.6	25	30	21	104	25	104		
												10625	6.5	1	15.6	26	30	30	24	101	27.3	30	30	25	104	30	30	25	104
												11125	10.5	1	25.3	38.1	40	40	35	101	39.4	40	40	36	104	40	40	36	104
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	—	None	—	—	—	10.7	15	15	11	52	11.2	15	15	11	54	15	54		
												10646	6	1	7.2	12.3	15	15	11	52	12.9	15	15	12	54	15	15	12	54
												11146	11.5	1	13.8	20.5	25	25	19	52	21.1	25	25	19	54	25	25	19	54
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	—	None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	15	49		
												11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	15	15	13	49
												11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49	20	20	18	49
05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	7.6	1.5	—	None	—	—	—	33.4	35	50	33	166	34.9	35	50	35	169	35	169		
												10625	4.9	1	23.6	39	40	50	36	166	40.9	45	50	38	169	45	50	38	169
												11125	7.9	1	38	57	60	60	52	166	58.9	60	60	54	169	60	60	54	169
	230-1-60	19.6	130	31	—	—	—	1.4	7	1.3	—	None	—	—	—	32.9	35	50	32	169	34.2	35	50	34	172	35	172		
												10625	6.5	1	27.1	42.6	45	50	39	169	44.3	45	50	41	172	45	50	41	172
												11125	10.5	1	43.8	63.5	70	70	58	169	65.1	70	70	60	172	70	70	60	172
	208-3-60	13.7	83.1	21	—	—	—	1.3	5.2	1.1	—	None	—	—	—	23.6	25	35	23	108	24.7	25	35	24	111	25	111		
												10625	4.9	1	13.6	23.6	25	35	23	108	24.9	25	35	24	111	25	35	24	111
												11125	7.9	1	21.9	33.9	35	35	31	108	35.3	40	40	32	111	40	40	32	111
	230-3-60	13.7	83.1	21	—	—	—	1.4	5.2	1	—	None	—	—	—	23.7	25	35	23	111	24.7	25	35	24	114	25	114		
												10625	6.5	1	15.6	26	30	35	24	111	27.3	30	35	25	114	30	35	25	114
												11125	10.5	1	25.3	38.1	40	40	35	111	39.4	40	40	36	114	40	40	36	114
	460-3-60	6.2	41	10	—	—	—	0.8	2.6	0.5	—	None	—	—	—	11.2	15	15	11	55	11.7	15	15	12	57	15	57		
												10646	6	1	7.2	12.3	15	15	11	55	12.9	15	15	12	57	15	15	12	57
												11146	11.5	1	13.8	20.5	25	25	19	55	21.1	25	25	19	57	25	25	19	57
	575-3-60	4.8	33	8	—	—	—	0.6	2	0.4	—	None	—	—	—	8.6	15	15	9	45	9	15	15	9	45	15	45		
												11058	9.2	1	8.9	13.6	15	15	13	45	14.1	15	15	13	45	15	15	13	45
												11458	13.8	1	13.3	19.1	20	20	18	45	19.6	20	20	18	45	20	20	18	45

**Table 149: ZQ04 to 06 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA¹ (amps)	Min fuse² / breaker³ size (amps)	Max fuse² / breaker³ size (amps)	Min disconnect⁴ rating		MCA¹ w/pwr exh (amps)	Min fuse² / breaker³ size w/ pwr exh (amps)	Max fuse² / breaker³ size w/ pwr exh (amps)	Min disconnect⁴ rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	24.4	144	38	—	—	—	2	7.6	1.5	—	None	—	—	—	40.1	45	60	39	182	41.6	45	60	41	185
												10625	4.9	1	23.6	40.1	45	60	39	182	41.6	45	60	41	185
												11125	7.9	1	38	57	60	60	52	182	58.9	60	60	54	185
	230-1-60	24.4	144	38	—	—	—	2.3	7	1.3	—	None	—	—	—	39.8	40	60	39	185	41.1	45	60	40	188
												10625	6.5	1	27.1	42.6	45	60	39	185	44.3	45	60	41	188
												11125	10.5	1	43.8	63.5	70	70	58	185	65.1	70	70	60	188
	208-3-60	16	110	25	—	—	—	2	5.2	1.1	—	None	—	—	—	27.2	30	40	27	137	28.3	30	40	28	139
												10625	4.9	1	13.6	27.2	30	40	27	137	28.3	30	40	28	139
												11125	7.9	1	21.9	33.9	35	40	31	137	35.3	40	40	32	139
	230-3-60	16	110	25	—	—	—	2.3	5.2	1	—	11625	12	1	33.3	48.1	50	50	44	137	49.5	50	50	46	139
												None	—	—	—	27.5	30	40	27	140	28.5	30	40	28	142
												10625	6.5	1	15.6	27.5	30	40	27	140	28.5	30	40	28	142
	460-3-60	7.8	52	12	—	—	—	1.3	2.6	0.5	—	11125	10.5	1	25.3	38.1	40	40	35	140	39.4	40	40	36	142
												11625	16	1	38.5	54.6	60	60	50	140	55.9	60	60	51	142
												None	—	—	—	13.7	15	20	13	67	14.2	15	20	14	69
	575-3-60	5.7	38.9	9	—	—	—	1	2	0.4	—	10646	6	1	7.2	13.7	15	20	11	67	14.2	15	20	12	69
												11146	11.5	1	13.8	20.5	25	25	19	67	21.1	25	25	19	69
												11446	14	1	16.8	24.3	25	25	22	67	24.9	25	25	23	69
												None	—	—	—	10.1	15	15	10	51	10.5	15	15	10	52
												11458	13.8	1	13.3	19.1	20	20	18	51	19.6	20	20	18	52
												12358	23	1	22.1	30.1	35	35	28	51	30.6	35	35	28	52

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

# ZQ04 to 06 medium indoor blower - with powered convenience outlet

**Table 150: ZQ04 to 06 medium indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh			
		RLA	LRA	MCC	RLA	LRA	MCC					FLA	LRA	FLA	LRA												
		Model	kW	Stages	Amps																						
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	7.6	1.5	8.6	None	—	—	—	32.5	35	45	33	124	34	35	45	35	128		
		10625	4.9	1	23.6	44.4	45	45	41	124	46.3	50	50	43	128												
		11125	7.9	1	38	62.4	70	70	57	124	64.3	70	70	59	128												
	230-1-60	15.4	83.9	24	—	—	—	1.4	7	1.3	8.6	None	—	—	—	32	35	45	32	127	33.3	35	45	34	130		
		10625	6.5	1	27.1	48	50	50	44	127	49.6	50	50	46	130												
		11125	10.5	1	43.8	68.9	70	70	63	127	70.5	80	80	65	130												
	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	23.8	25	30	24	103	24.9	25	35	26	105		
		10625	4.9	1	13.6	28.9	30	30	27	103	30.3	35	35	28	105												
		11125	7.9	1	21.9	39.3	40	40	36	103	40.6	45	45	37	105												
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	8.6	None	—	—	—	23.9	25	30	24	106	24.9	25	35	26	108		
		10625	6.5	1	15.6	31.4	35	35	29	106	32.6	35	35	30	108												
		11125	10.5	1	25.3	43.5	45	45	40	106	44.8	45	45	41	108												
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	12.9	15	15	13	55	13.4	15	15	14	56		
		10646	6	1	7.2	14.9	15	15	14	55	15.6	20	20	14	56												
		11146	11.5	1	13.8	23.2	25	25	21	55	23.8	25	25	22	56												
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	8.6	None	—	—	—	9.1	15	15	9	50	9.5	15	15	10	51		
		11058	9.2	1	8.9	15.8	20	20	15	50	16.3	20	20	15	51												
		11458	13.8	1	13.3	21.3	25	25	20	50	21.8	25	25	20	51												
	05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	7.6	1.5	8.6	None	—	—	—	37.7	40	50	38	170	39.2	40	50	39	174	
			10625	4.9	1	23.6	44.4	45	50	41	170	46.3	50	50	43	174											
			11125	7.9	1	38	62.4	70	70	57	170	64.3	70	70	59	174											
		230-1-60	19.6	130	31	—	—	—	1.4	7	1.3	8.6	None	—	—	—	37.2	40	50	37	173	38.5	40	50	39	176	
			10625	6.5	1	27.1	48	50	50	44	173	49.6	50	50	46	176											
			11125	10.5	1	43.8	68.9	70	70	63	173	70.5	80	80	65	176											
208-3-60		13.7	83.1	21	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	27.9	30	40	28	113	29	30	40	29	115		
		10625	4.9	1	13.6	28.9	30	40	28	113	30.3	35	40	29	115												
		11125	7.9	1	21.9	39.3	40	40	36	113	40.6	45	45	37	115												
230-3-60		13.7	83.1	21	—	—	—	1.4	5.2	1	8.6	None	—	—	—	28	30	40	28	116	29	30	40	29	118		
		10625	6.5	1	15.6	31.4	35	40	29	116	32.6	35	40	30	118												
		11125	10.5	1	25.3	43.5	45	45	40	116	44.8	45	45	41	118												
460-3-60		6.2	41	10	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	13.4	15	15	14	58	13.9	15	15	14	59		
		10646	6	1	7.2	14.9	15	15	14	58	15.6	20	20	14	59												
		11146	11.5	1	13.8	23.2	25	25	21	58	23.8	25	25	22	59												
575-3-60		4.8	33	8	—	—	—	0.6	2	0.4	8.6	None	—	—	—	10.3	15	15	10	46	10.7	15	15	11	47		
		11058	9.2	1	8.9	15.8	20	20	15	46	16.3	20	20	15	47												
		11458	13.8	1	13.3	21.3	25	25	20	46	21.8	25	25	20	47												

**Table 150: ZQ04 to 06 medium indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA¹ (amps)	Min fuse² / breaker³ size (amps)	Max fuse² / breaker³ size (amps)	Min disconnect⁴ rating		MCA¹ w/pwr exh (amps)	Min fuse² / breaker³ size w/ pwr exh (amps)	Max fuse² / breaker³ size w/ pwr exh (amps)	Min disconnect⁴ rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	24.4	144	38	—	—	—	2	7.6	1.5	8.6	None	—	—	—	44.4	45	60	44	186	45.9	50	70	46	189
												10625	4.9	1	23.6	44.4	45	60	44	186	46.3	50	70	46	189
												11125	7.9	1	38	62.4	70	70	57	186	64.3	70	70	59	189
	230-1-60	24.4	144	38	—	—	—	2.3	7	1.3	8.6	None	—	—	—	44.1	45	60	44	189	45.4	50	60	45	192
												10625	6.5	1	27.1	48	50	60	44	189	49.6	50	60	46	192
												11125	10.5	1	43.8	68.9	70	70	63	189	70.5	80	80	65	192
	208-3-60	16	110	25	—	—	—	2	5.2	1.1	8.6	None	—	—	—	31.5	35	45	32	141	32.6	35	45	33	144
												10625	4.9	1	13.6	31.5	35	45	32	141	32.6	35	45	33	144
												11125	7.9	1	21.9	39.3	40	45	36	141	40.6	45	45	37	144
	230-3-60	16	110	25	—	—	—	2.3	5.2	1	8.6	11625	12	1	33.3	53.5	60	60	49	141	54.9	60	60	50	144
												None	—	—	—	31.8	35	45	32	144	32.8	35	45	33	147
												10625	6.5	1	15.6	31.8	35	45	32	144	32.8	35	45	33	147
	460-3-60	7.8	52	12	—	—	—	1.3	2.6	0.5	8.6	11125	10.5	1	25.3	43.5	45	45	40	144	44.8	45	45	41	147
												11625	16	1	38.5	60	60	60	55	144	61.3	70	70	56	147
												None	—	—	—	15.9	20	20	16	70	16.4	20	20	17	71
	575-3-60	5.7	38.9	9	—	—	—	1	2	0.4	8.6	10646	6	1	7.2	15.9	20	20	14	70	16.4	20	20	14	71
												11146	11.5	1	13.8	23.2	25	25	21	70	23.8	25	25	22	71
												11446	14	1	16.8	26.9	30	30	25	70	27.6	30	30	25	71
												None	—	—	—	11.8	15	15	12	53	12.2	15	15	12	54
												11458	13.8	1	13.3	21.3	25	25	20	53	21.8	25	25	20	54
												12358	23	1	22.1	32.3	35	35	30	53	32.8	35	35	30	54

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory-installed disconnect amperage rating.

**Table 151: ZQ04 to 06 high indoor blower - without powered convenience outlet**

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.



- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

# ZQ04 to 06 high indoor blower - with powered convenience outlet

**Table 152: ZQ04 to 06 high indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply/blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh			
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA		
04 (3)	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	23.8	25	30	24	103	24.9	25	35	26	105		
												10625	4.9	1	13.6	28.9	30	30	27	103	30.3	35	35	28	105		
												11125	7.9	1	21.9	39.3	40	40	36	103	40.6	45	45	37	105		
												11625	12	1	33.3	53.5	60	60	49	103	54.9	60	60	50	105		
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	8.6	None	—	—	—	23.9	25	30	24	106	24.9	25	35	26	108		
												10625	6.5	1	15.6	31.4	35	35	29	106	32.6	35	35	30	108		
												11125	10.5	1	25.3	43.5	45	45	40	106	44.8	45	45	41	108		
												11625	16	1	38.5	60	60	60	55	106	61.3	70	70	56	108		
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	12.9	15	15	13	55	13.4	15	15	14	56		
												10646	6	1	7.2	14.9	15	15	14	55	15.6	20	20	14	56		
												11146	11.5	1	13.8	23.2	25	25	21	55	23.8	25	25	22	56		
												11446	14	1	16.8	26.9	30	30	25	55	27.6	30	30	25	56		
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	8.6	None	—	—	—	9.1	15	15	9	50	9.5	15	15	10	51		
												11058	9.2	1	8.9	15.8	20	20	15	50	16.3	20	20	15	51		
												11458	13.8	1	13.3	21.3	25	25	20	50	21.8	25	25	20	51		
												11625	12	1	33.3	53.5	60	60	49	113	54.9	60	60	50	115		
05 (4)	208-3-60	13.7	83.1	21	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	27.9	30	40	28	113	29	30	40	29	115		
												10625	4.9	1	13.6	28.9	30	40	28	113	30.3	35	40	29	115		
												11125	7.9	1	21.9	39.3	40	40	36	113	40.6	45	45	37	115		
												11625	12	1	33.3	53.5	60	60	49	113	54.9	60	60	50	115		
	230-3-60	13.7	83.1	21	—	—	—	1.4	5.2	1	8.6	None	—	—	—	28	30	40	28	116	29	30	40	29	118		
												10625	6.5	1	15.6	31.4	35	40	29	116	32.6	35	40	30	118		
												11125	10.5	1	25.3	43.5	45	45	40	116	44.8	45	45	41	118		
												11625	16	1	38.5	60	60	60	55	116	61.3	70	70	56	118		
	460-3-60	6.2	41	10	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	13.4	15	15	14	58	13.9	15	15	14	59		
												10646	6	1	7.2	14.9	15	15	14	58	15.6	20	20	14	59		
												11146	11.5	1	13.8	23.2	25	25	21	58	23.8	25	25	22	59		
												11446	14	1	16.8	26.9	30	30	25	58	27.6	30	30	25	59		
	575-3-60	4.8	33	8	—	—	—	0.6	2	0.4	8.6	None	—	—	—	10.3	15	15	10	46	10.7	15	15	11	47		
												11058	9.2	1	8.9	15.8	20	20	15	46	16.3	20	20	15	47		
												11458	13.8	1	13.3	21.3	25	25	20	46	21.8	25	25	20	47		
												11625	12	1	33.3	53.5	60	60	49	167	54.9	60	60	50	170		
06 (5)	208-3-60	16	110	25	—	—	—	2	7.5	1.1	8.6	None	—	—	—	33.8	35	45	34	167	34.9	35	50	36	170		
												10625	4.9	1	13.6	33.8	35	45	34	167	34.9	35	50	36	170		
												11125	7.9	1	21.9	42.1	45	45	39	167	43.5	45	50	40	170		
												11625	12	1	33.3	56.4	60	60	52	167	57.8	60	60	53	170		
	230-3-60	16	110	25	—	—	—	2.3	7.5	1	8.6	None	—	—	—	34.1	35	50	35	174	35.1	40	50	36	177		
												10625	6.5	1	15.6	34.3	35	50	35	174	35.5	40	50	36	177		
												11125	10.5	1	25.3	46.4	50	50	43	174	47.6	50	50	44	177		
												11625	16	1	38.5	62.9	70	70	58	174	64.1	70	70	59	177		
	460-3-60	7.8	52	12	—	—	—	1.3	3.4	0.5	8.6	None	—	—	—	16.7	20	20	17	85	17.2	20	20	17	86		
												10646	6	1	7.2	16.7	20	20	15	85	17.2	20	20	15	86		
												11146	11.5	1	13.8	24.2	25	25	22	85	24.8	25	25	23	86		
												11446	14	1	16.8	27.9	30	30	26	85	28.6	30	30	26	86		
	575-3-60	5.7	38.9	9	—	—	—	1	2.8	0.4	8.6	None	—	—	—	12.6	15	15	13	65	13	15	15	13	66		
												11458	13.8	1	13.3	22.3	25	25	20	65	22.8	25	25	21	66		
												12358	23	1	22.1	33.3	35	35	31	65	33.8	35	35	31	66		

- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

## ZXA7 standard indoor blower - without powered convenience outlet

**Table 153: ZXA7 standard indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2ek045*				MCA` (amps)	Min fuse`/breaker` size (amps)	Max fuse`/ breaker` size (amps)	Min disconnect` rating		MCA` w/pwr exh (amps)	Min fuse`/breaker` size w/ pwr exh (amps)	Max fuse`/breaker` size w/ pwr exh (amps)	Min disconnect` rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	4.4	7	1.1	—	None	—	—	—	33.4	35	50	33	196	34.5	35	50	35	199
												10625	4.9	1	13.6	33.4	35	50	33	196	34.5	35	50	35	199
												11125	7.9	1	21.9	36.1	40	50	33	196	37.5	40	50	35	199
												11625	12	1	33.3	50.4	60	60	46	196	51.8	60	60	48	199
	230-3-60	17.6	136	27	—	—	—	4.4	7.2	1	—	None	—	—	—	33.6	35	50	34	198	34.6	35	50	35	200
												10625	6.5	1	15.6	33.6	35	50	34	198	34.6	35	50	35	200
												11125	10.5	1	25.3	40.6	45	50	37	198	41.9	45	50	39	200
												11625	16	1	38.5	57.1	60	60	53	198	58.4	60	60	54	200
	460-3-60	8.5	66.1	13	—	—	—	2.5	3.6	0.5	—	None	—	—	—	16.7	20	25	17	97	17.2	20	25	17	98
												10646	6	1	7.2	16.7	20	25	12	97	17.2	20	25	13	98
												11146	11.5	1	13.8	21.8	25	25	20	97	22.4	25	25	21	98
												11446	14	1	16.8	25.5	30	30	23	97	26.1	30	30	24	98
	575-3-60	6.3	55.3	10	—	—	—	4.4	2.5	0.4	—	None	—	—	—	14.8	15	20	15	73	15.2	20	20	16	74

- 1 Minimum circuit ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZXA7 standard indoor blower - with powered convenience outlet

**Table 154: ZXA7 standard indoor blower - with powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	4.4	7	1.1	8.6	None	—	—	—	37.7	40	50	38	200	38.8	40	50	40	203
												10625	4.9	1	13.6	37.7	40	50	38	200	38.8	40	50	40	203
												11125	7.9	1	21.9	41.5	45	50	38	200	42.9	45	50	40	203
												11625	12	1	33.3	55.8	60	60	51	200	57.1	60	60	53	203
	230-3-60	17.6	136	27	—	—	—	4.4	7.2	1	8.6	None	—	—	—	37.9	40	50	39	202	38.9	40	50	40	204
												10625	6.5	1	15.6	37.9	40	50	39	202	38.9	40	50	40	204
												11125	10.5	1	25.3	46	50	50	42	202	47.3	50	50	43	204
												11625	16	1	38.5	62.5	70	70	58	202	63.8	70	70	59	204
	460-3-60	8.5	66.1	13	—	—	—	2.5	3.6	0.5	8.6	None	—	—	—	18.9	20	25	19	99	19.4	20	25	20	100
												10646	6	1	7.2	18.9	20	25	15	99	19.4	20	25	15	100
												11146	11.5	1	13.8	24.4	25	25	22	99	25.1	30	30	23	100
												11446	14	1	16.8	28.2	30	30	26	99	28.8	30	30	27	100
	575-3-60	6.3	55.3	10	—	—	—	4.4	2.5	0.4	8.6	None	—	—	—	16.5	20	20	17	75	16.9	20	20	18	76

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZXA7 medium indoor blower - without powered convenience outlet

**Table 155: ZXA7 medium indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	4.4	8.9	1.1	—	None	—	—	—	35.3	40	50	36	198	36.4	40	50	37	200
												10625	4.9	1	13.6	35.3	40	50	36	198	36.4	40	50	37	200
												11125	7.9	1	21.9	38.5	40	50	36	198	39.9	40	50	37	200
												11625	12	1	33.3	52.8	60	60	49	198	54.1	60	60	50	200
	230-3-60	17.6	136	27	—	—	—	4.4	8.2	1	—	None	—	—	—	34.6	35	50	35	205	35.6	40	50	36	207
												10625	6.5	1	15.6	34.6	35	50	35	205	35.6	40	50	36	207
												11125	10.5	1	25.3	41.9	45	50	39	205	43.1	45	50	40	207
												11625	16	1	38.5	58.4	60	60	54	205	59.6	60	60	55	207
	460-3-60	8.5	66.1	13	—	—	—	2.5	4.1	0.5	—	None	—	—	—	17.2	20	25	17	101	17.7	20	25	18	102
												10646	6	1	7.2	17.2	20	25	13	101	17.7	20	25	14	102
												11146	11.5	1	13.8	22.4	25	25	21	101	23	25	25	21	102
												11446	14	1	16.8	26.1	30	30	24	101	26.8	30	30	25	102
	575-3-60	6.3	55.3	10	—	—	—	4.4	3.2	0.4	—	None	—	—	—	15.5	20	20	16	81	15.9	20	20	16	82

- 1 Minimum circuit ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZXA7 medium indoor blower - with powered convenience outlet

**Table 156: ZXA7 medium indoor blower - with powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	4.4	8.9	1.1	8.6	None	—	—	—	39.6	40	50	40	202	40.7	45	50	42	205
												10625	4.9	1	13.6	39.6	40	50	40	202	40.7	45	50	42	205
												11125	7.9	1	21.9	43.9	45	50	40	202	45.3	50	50	42	205
												11625	12	1	33.3	58.1	60	60	53	202	59.5	60	60	55	205
	230-3-60	17.6	136	27	—	—	—	4.4	8.2	1	8.6	None	—	—	—	38.9	40	50	40	209	39.9	40	50	41	212
												10625	6.5	1	15.6	38.9	40	50	40	209	39.9	40	50	41	212
												11125	10.5	1	25.3	47.3	50	50	43	209	48.5	50	50	45	212
												11625	16	1	38.5	63.8	70	70	59	209	65	70	70	60	212
	460-3-60	8.5	66.1	13	—	—	—	2.5	4.1	0.5	8.6	None	—	—	—	19.4	20	25	20	103	19.9	20	25	20	104
												10646	6	1	7.2	19.4	20	25	15	103	19.9	20	25	16	104
												11146	11.5	1	13.8	25.1	30	30	23	103	25.7	30	30	24	104
												11446	14	1	16.8	28.8	30	30	27	103	29.4	30	30	27	104
	575-3-60	6.3	55.3	10	—	—	—	4.4	3.2	0.4	8.6	None	—	—	—	17.2	20	20	18	83	17.6	20	20	18	84

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZXA7 high indoor blower - without powered convenience outlet

**Table 157: ZXA7 indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	4.4	9.9	1.1	—	None	—	—	—	36.3	40	50	37	209	37.4	40	50	38	211
												10625	4.9	1	13.6	36.3	40	50	37	209	37.4	40	50	38	211
												11125	7.9	1	21.9	39.8	40	50	37	209	41.1	45	50	38	211
												11625	12	1	33.3	54	60	60	50	209	55.4	60	60	51	211
	230-3-60	17.6	136	27	—	—	—	4.4	9.4	1	—	None	—	—	—	35.8	40	50	36	217	36.8	40	50	37	219
												10625	6.5	1	15.6	35.8	40	50	36	217	36.8	40	50	37	219
												11125	10.5	1	25.3	43.4	45	50	40	217	44.6	45	50	41	219
												11625	16	1	38.5	59.9	60	60	55	217	61.1	70	70	56	219
	460-3-60	8.5	66.1	13	—	—	—	2.5	4.7	0.5	—	None	—	—	—	17.8	20	25	18	106	18.3	20	25	19	108
												10646	6	1	7.2	17.8	20	25	14	106	18.3	20	25	14	108
												11146	11.5	1	13.8	23.1	25	25	21	106	23.8	25	25	22	108
												11446	14	1	16.8	26.9	30	30	25	106	27.5	30	30	25	108
575-3-60	6.3	55.3	10	—	—	—	4.4	4.3	0.4	—	None	—	—	—	16.6	20	20	17	95	17	20	20	18	96	

- 1 Minimum circuit ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZXA7 high indoor blower - with powered convenience outlet

**Table 158: ZXA7 high indoor blower - with powered convenience outlet (with VFD)**

Size (tons)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	4.4	9.9	1.1	8.6	None	—	—	—	40.6	45	50	42	213	41.7	45	50	43	215
												10625	4.9	1	13.6	40.6	45	50	42	213	41.7	45	50	43	215
												11125	7.9	1	21.9	45.1	50	50	42	213	46.5	50	50	43	215
												11625	12	1	33.3	59.4	60	60	55	213	60.8	70	70	56	215
	230-3-60	17.6	136	27	—	—	—	4.4	9.4	1	8.6	None	—	—	—	40.1	45	50	41	221	41.1	45	50	42	223
												10625	6.5	1	15.6	40.1	45	50	41	221	41.1	45	50	42	223
												11125	10.5	1	25.3	48.8	50	50	45	221	50	50	50	46	223
												11625	16	1	38.5	65.3	70	70	60	221	66.5	70	70	61	223
	460-3-60	8.5	66.1	13	—	—	—	2.5	4.7	0.5	8.6	None	—	—	—	20	25	25	21	109	20.5	25	25	21	110
												10646	6	1	7.2	20	20	25	16	109	20.5	25	25	17	110
												11146	11.5	1	13.8	25.8	30	30	24	109	26.4	30	30	24	110
												11446	14	1	16.8	29.6	30	30	27	109	30.2	35	35	28	110
	575-3-60	6.3	55.3	10	—	—	—	4.4	4.3	0.4	8.6	None	—	—	—	18.3	20	20	19	97	18.7	20	20	20	98

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.



# ZY04 to 12 standard static indoor blower - without powered convenience outlet

**Table 159: ZY04 to 12 standard static indoor blower - without powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed Kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA						
04 (03)	208-1-60	15.4	83.9	24	—	—	—	1.3	6.6	1.5	—	None	—	—	—	27.2	30	40	27	89	28.7	30	40	29	92	40	40	36	92	
												10625	4.9	1	23.6	37.8	40	40	35	89	39.6	40	40	36	92	40	40	36	92	
												11125	7.9	1	38	55.8	60	60	51	89	57.6	60	60	53	92	60	60	53	92	
	230-1-60	15.4	83.9	24	—	—	—	1.4	6	1.3	—	None	—	—	—	26.7	30	40	26	89	28	30	40	28	92	30	40	28	92	
												10625	6.5	1	27.1	41.4	45	45	38	89	43	45	45	40	92	45	45	40	92	
												11125	10.5	1	43.8	62.3	70	70	57	89	63.9	70	70	59	92	70	70	59	92	
	208-3-60	10.4	73	16	—	—	—	1.3	6.6	1.1	—	None	—	—	—	20.9	25	30	21	78	22	25	30	22	80	30	30	24	80	
												10625	4.9	1	13.6	25.3	30	30	23	78	26.6	30	30	24	80	30	30	24	80	
												11125	7.9	1	21.9	35.6	40	40	33	78	37	40	40	34	80	40	40	34	80	
	230-3-60	10.4	73	16	—	—	—	1.4	6	1	—	11625	12	1	33.3	49.9	50	50	46	78	51.3	60	60	47	80	60	60	47	80	
												None	—	—	—	20.4	25	30	20	78	21.4	25	30	22	81	30	30	22	81	
												10625	6.5	1	15.6	27	30	30	25	78	28.3	30	30	26	81	30	30	26	81	
	460-3-60	5.8	38	9	—	—	—	0.8	3.2	0.5	—	11125	10.5	1	25.3	39.1	40	40	36	78	40.4	45	45	37	81	45	45	37	81	
												11625	16	1	38.5	55.6	60	60	51	78	56.9	60	60	52	81	60	60	52	81	
												None	—	—	—	11.3	15	15	11	42	11.8	15	15	12	43	15	15	12	43	
	575-3-60	3.8	36.5	6	—	—	—	0.6	6	0.4	—	10646	6	1	7.2	13	15	15	12	42	13.6	15	15	13	43	15	15	13	43	
												11146	11.5	1	13.8	21.3	25	25	20	42	21.9	25	25	20	43	25	25	20	43	
												11446	14	1	16.8	25	25	25	23	42	25.6	30	30	24	43	30	30	24	43	
05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	8.4	1.5	—	None	—	—	—	34.2	35	50	34	135	35.7	40	50	35	138	40	50	35	138	
												10625	4.9	1	23.6	40	40	50	37	135	41.9	45	50	39	138	45	50	39	138	
												11125	7.9	1	38	58	60	60	53	135	59.9	60	60	55	138	60	60	55	138	
	230-1-60	19.6	130	31	—	—	—	1.4	7.6	1.3	—	None	—	—	—	33.5	35	50	33	135	34.8	35	50	34	138	35	50	34	138	
												10625	6.5	1	27.1	43.4	45	50	40	135	45	45	50	41	138	45	50	41	138	
												11125	10.5	1	43.8	64.3	70	70	59	135	65.9	70	70	61	138	70	70	61	138	
	208-3-60	13.7	83.1	21	—	—	—	1.3	8.4	1.1	—	None	—	—	—	26.8	30	40	27	88	27.9	30	40	28	91	30	40	28	91	
												10625	4.9	1	13.6	27.5	30	40	27	88	28.9	30	40	28	91	30	40	28	91	
												11125	7.9	1	21.9	37.9	40	40	35	88	39.3	40	40	36	91	40	40	36	91	
	230-3-60	13.7	83.1	21	—	—	—	1.4	7.6	1	—	11625	12	1	33.3	52.1	60	60	48	88	53.5	60	60	49	91	60	60	49	91	
												None	—	—	—	26.1	30	35	26	88	27.1	30	40	27	91	30	40	27	91	
												10625	6.5	1	15.6	29	30	35	27	88	30.3	35	40	28	91	35	40	28	91	
	460-3-60	6.2	41	10	—	—	—	0.8	4	0.5	—	11125	10.5	1	25.3	41.1	45	45	38	88	42.4	45	45	39	91	45	45	39	91	
												11625	16	1	38.5	57.6	60	60	53	88	58.9	60	60	54	91	60	60	54	91	
												None	—	—	—	12.6	15	15	13	45	13.1	15	15	13	46	15	15	13	46	
	575-3-60	4.8	33	8	—	—	—	0.6	7.6	0.4	—	10646	6	1	7.2	14	15	15	13	45	14.6	15	15	13	46	15	15	13	46	
												11146	11.5	1	13.8	22.3	25	25	20	45	22.9	25	25	21	46	25	25	21	46	
												11446	14	1	16.8	26	30	30	24	45	26.6	30	30	24	46	30	30	24	46	
											None	—	—	—	9.6	15	15	10	35	10	15	15	10	36	15	15	10	36		
											11058	9.2	1	8.9	14.9	15	15	14	35	15.4	20	20	14	36	20	20	14	36		
											11458	13.8	1	13.3	20.4	25	25	19	35	20.9	25	25	19	36	25	25	19	36		

**Table 159: ZY04 to 12 standard static indoor blower - without powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed Kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA		
06 (5)	208-1-60	23.7	152.5	37	—	—	—	2	8.4	1.5	—	None	—	—	—	40	40	60	39	159	41.5	45	60	41	162		
												10625	4.9	1	23.6	40	40	60	39	159	41.9	45	60	41	162		
												11125	7.9	1	38	58	60	60	53	159	59.9	60	60	55	162		
	230-1-60	23.7	152.5	37	—	—	—	2.3	7.6	1.3	—	None	—	—	—	39.5	40	60	39	159	40.8	45	60	40	162		
												10625	6.5	1	27.1	43.4	45	60	40	159	45	45	60	41	162		
												11125	10.5	1	43.8	64.3	70	70	59	159	65.9	70	70	61	162		
	208-3-60	15.9	110	25	—	—	—	2	8.4	1.1	—	None	—	—	—	30.3	35	45	30	116	31.4	35	45	32	119		
												10625	4.9	1	13.6	30.3	35	45	30	116	31.4	35	45	32	119		
												11125	7.9	1	21.9	37.9	40	45	35	116	39.3	40	45	36	119		
	230-3-60	15.9	110	25	—	—	—	2.3	7.6	1	—	11625	12	1	33.3	52.1	60	60	48	116	53.5	60	60	49	119		
												None	—	—	—	29.8	30	45	30	117	30.8	35	45	31	119		
												10625	6.5	1	15.6	29.8	30	45	30	117	30.8	35	45	31	119		
	460-3-60	7.1	52	11	—	—	—	1.3	4	0.5	—	11125	10.5	1	25.3	41.1	45	45	38	117	42.4	45	45	39	119		
												11625	16	1	38.5	57.6	60	60	53	117	58.9	60	60	54	119		
												None	—	—	—	14.2	15	20	14	57	14.7	15	20	15	58		
	575-3-60	5.1	39.5	8	—	—	—	1	7.6	0.4	—	10646	6	1	7.2	14.2	15	20	13	57	14.7	15	20	13	58		
												11146	11.5	1	13.8	22.3	25	25	20	57	22.9	25	25	21	58		
												11446	14	1	16.8	26	30	30	24	57	26.6	30	30	24	58		
	575-3-60	5.1	39.5	8	—	—	—	1	7.6	0.4	—	None	—	—	—	10.4	15	15	10	43	10.8	15	15	11	44		
												11458	13.8	1	13.3	20.4	25	25	19	43	20.9	25	25	19	44		
												12358	23	1	22.1	31.4	35	35	29	43	31.9	35	35	29	44		
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	5.2	1.1	—	None	—	—	—	31.2	35	45	31	167	33.4	35	45	33	172		
												10725	4.9	1	13.6	31.2	35	45	31	167	33.4	35	45	33	172		
												11725	12	1	33.3	48.1	50	50	44	167	50.9	60	60	47	172		
												12525	18.6	1	51.6	71	80	80	65	167	73.8	80	80	68	172		
	230-3-60	17.6	136	27	—	—	—	2.3	5.2	1	—	None	—	—	—	31.8	35	45	32	171	33.8	35	50	34	175		
												10725	6.5	1	15.6	31.8	35	45	32	171	33.8	35	50	34	175		
												11725	16	1	38.5	54.6	60	60	50	171	57.1	60	60	53	175		
												12525	24.8	1	59.7	81.1	90	90	75	171	83.6	90	90	77	175		
	460-3-60	8.5	66.1	13	—	—	—	1.3	2.6	0.5	—	None	—	—	—	15.8	20	20	16	84	16.8	20	20	17	87		
												10746	6	1	7.2	15.8	20	20	11	84	16.8	20	20	12	87		
												11746	16.5	1	19.8	28	30	30	26	84	29.3	30	30	27	87		
												12646	25.5	1	30.7	41.6	45	45	38	84	42.9	45	45	39	87		
	575-3-60	6.3	55.3	10	—	—	—	1	2	0.4	—	None	—	—	—	11.9	15	15	12	70	12.7	15	15	13	72		
												11758	17	1	16.4	23	25	25	21	70	24	25	25	22	72		
												12658	25.7	1	24.7	33.4	35	35	31	70	34.4	35	35	32	72		

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 160: ZY04 to 12 standard static indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed Kit 2EK045*				MCA¹ (amps)	Min fuse² / breaker³ size (amps)	Max fuse² / breaker³ size (amps)	Min disconnect⁴ rating		MCA¹ w/pwr exh (amps)	Min fuse⁵ / breaker⁶ size w/ pwr exh (amps)	Max fuse⁵ / breaker⁶ size w/ pwr exh (amps)	Min disconnect⁴ rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
		With VFD																							
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	7	1.1	—	None	—	—	—	33	35	50	33	205	35.2	40	50	35	210
												10725	4.9	1	13.6	33	35	50	33	205	35.2	40	50	35	210
												11725	12	1	33.3	50.4	60	60	46	205	53.1	60	60	49	210
												12525	18.6	1	51.6	73.3	80	80	67	205	76	80	80	70	210
	230-3-60	17.6	136	27	—	—	—	2.3	7.2	1	—	None	—	—	—	33.8	35	50	34	208	35.8	40	50	36	212
												10725	6.5	1	15.6	33.8	35	50	34	208	35.8	40	50	36	212
												11725	16	1	38.5	57.1	60	60	53	208	59.6	60	60	55	212
												12525	24.8	1	59.7	83.6	90	90	77	208	86.1	90	90	79	212
	460-3-60	8.5	66.1	13	—	—	—	1.3	3.6	0.5	—	None	—	—	—	16.8	20	25	17	103	17.8	20	25	18	105
												10746	6	1	7.2	16.8	20	25	12	103	17.8	20	25	14	105
												11746	16.5	1	19.8	29.3	30	30	27	103	30.5	35	35	28	105
												12646	25.5	1	30.7	42.9	45	45	39	103	44.1	45	45	41	105
	575-3-60	6.3	55.3	10	—	—	—	1	2.5	0.4	—	None	—	—	—	12.4	15	15	12	78	13.2	15	15	13	79
												11758	17	1	16.4	23.6	25	25	22	78	24.6	25	25	23	79
												12658	25.7	1	24.7	34	35	35	31	78	35	35	35	32	79
												None	—	—	—	39.8	40	50	42	310	42	45	50	45	315
08 (7.5)	208-3-60	12.8	120.4	20	12.8	120.4	20	2	7	1.1	—	11725	12	1	33.3	50.4	60	60	46	310	53.1	60	60	49	315
												12525	18.6	1	51.6	73.3	80	80	67	310	76	80	80	70	315
												13225	24	1	66.6	92	100	100	85	310	94.8	100	100	87	315
												14225	31.8	2	88.3	119.1	125	125	110	310	121.9	125	125	112	315
	230-3-60	12.8	120.4	20	12.8	120.4	20	2.3	7.2	1	—	None	—	—	—	40.6	45	50	43	312	42.6	45	50	45	317
												11725	16	1	38.5	57.1	60	60	53	312	59.6	60	60	55	317
												12525	24.8	1	59.7	83.6	90	90	77	312	86.1	90	90	79	317
												13225	32	1	77	105.3	110	110	97	312	107.8	110	110	99	317
	460-3-60	6.4	55.1	10	6.4	55.1	10	1.3	3.6	0.5	—	14225	42.4	2	102	136.5	150	150	126	312	139	150	150	128	317
												None	—	—	—	20.6	25	25	22	147	21.6	25	25	23	149
												11746	16.5	1	19.8	29.3	30	30	27	147	30.5	35	35	28	149
												12846	27.8	1	33.4	46.3	50	50	43	147	47.5	50	50	44	149
	575-3-60	5.4	41	9	5.4	41	9	1	2.5	0.4	—	13346	33	1	39.7	54.1	60	60	50	147	55.4	60	60	51	149
												14246	41.7	2	50.2	67.3	70	70	62	147	68.5	70	70	63	149
												None	—	—	—	16.7	20	20	18	104	17.5	20	20	19	106
												11758	17	1	16.4	23.6	25	25	22	104	24.6	25	25	23	106
												13458	34	1	32.7	44	45	45	40	104	45	45	45	41	106

**Table 160: ZY04 to 12 standard static indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed Kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA		
09 (8.5)	208-3-60	13.7	83.1	21	13.7	83.1	21	2	7	1.1	—	None	—	—	—	41.8	45	50	44	235	44	45	50	47	240		
												11725	12	1	33.3	50.4	60	60	46	235	53.1	60	60	49	240		
												12525	18.6	1	51.6	73.3	80	80	67	235	76	80	80	70	240		
												13225	24	1	66.6	92	100	100	85	235	94.8	100	100	87	240		
												14225	31.8	2	88.3	119.1	125	125	110	235	121.9	125	125	112	240		
	230-3-60	13.7	83.1	21	13.7	83.1	21	2.3	7.2	1	—	None	—	—	—	42.6	45	50	45	238	44.6	45	50	47	242		
												11725	16	1	38.5	57.1	60	60	53	238	59.6	60	60	55	242		
												12525	24.8	1	59.7	83.6	90	90	77	238	86.1	90	90	79	242		
												13225	32	1	77	105.3	110	110	97	238	107.8	110	110	99	242		
												14225	42.4	2	102	136.5	150	150	126	238	139	150	150	128	242		
	460-3-60	6.2	41	10	6.2	41	10	1.3	3.6	0.5	—	None	—	—	—	20.2	25	25	21	119	21.2	25	25	23	121		
												11746	16.5	1	19.8	29.3	30	30	27	119	30.5	35	35	28	121		
												12846	27.8	1	33.4	46.3	50	50	43	119	47.5	50	50	44	121		
												13346	33	1	39.7	54.1	60	60	50	119	55.4	60	60	51	121		
												14246	41.7	2	50.2	67.3	70	70	62	119	68.5	70	70	63	121		
	575-3-60	4.8	33	8	4.8	33	8	1	2.5	0.4	—	None	—	—	—	15.3	20	20	16	88	16.1	20	20	17	90		
												11758	17	1	16.4	23.6	25	25	22	88	24.6	25	25	23	90		
												13458	34	1	32.7	44	45	45	40	88	45	45	45	41	90		
												None	—	—	—	47.5	50	60	50	392	49.7	50	60	53	397		
												11725	12	1	33.3	50.4	60	60	50	392	53.1	60	60	53	397		
12 (10)	208-3-60	15.4	155	24	15.4	155	24	5.8	7	1.1	—	None	—	—	—	47.5	50	60	50	392	49.7	50	60	53	397		
												11725	12	1	33.3	50.4	60	60	50	392	53.1	60	60	53	397		
												12525	18.6	1	51.6	73.3	80	80	67	392	76	80	80	70	397		
												13225	24	1	66.6	92	100	100	85	392	94.8	100	100	87	397		
												14225	31.8	2	88.3	119.1	125	125	110	392	121.9	125	125	112	397		
	230-3-60	15.4	155	24	15.4	155	24	5.2	7.2	1	—	None	—	—	—	47.1	50	60	50	391	49.1	50	60	52	395		
												11725	16	1	38.5	57.1	60	60	53	391	59.6	60	60	55	395		
												12525	24.8	1	59.7	83.6	90	90	77	391	86.1	90	90	79	395		
												13225	32	1	77	105.3	110	110	97	391	107.8	110	110	99	395		
												14225	42.4	2	102	136.5	150	150	126	391	139	150	150	128	395		
	460-3-60	7.1	62	11	7.1	62	11	2.9	3.6	0.5	—	None	—	—	—	22.5	25	25	24	166	23.5	25	25	25	168		
												11746	16.5	1	19.8	29.3	30	30	27	166	30.5	35	35	28	168		
												12846	27.8	1	33.4	46.3	50	50	43	166	47.5	50	50	44	168		
												13346	33	1	39.7	54.1	60	60	50	166	55.4	60	60	51	168		
												14246	41.7	2	50.2	67.3	70	70	62	166	68.5	70	70	63	168		
	575-3-60	6	47.8	9	6	47.8	9	2.2	2.5	0.4	—	None	—	—	—	18.2	20	20	19	125	19	20	20	20	126		
												11758	17	1	16.4	23.6	25	25	22	125	24.6	25	25	23	126		
												13458	34	1	32.7	44	45	45	40	125	45	45	45	41	126		

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect ampereage rating.

# ZY04 to 12 standard indoor blower - with powered convenience outlet

**Table 161: ZY04 to 12 standard indoor blower - with powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCAw/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA		
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	6.6	1.5	8.6	None	—	—	—	31.5	35	45	32	93	33	35	45	33	97		
												10625	4.9	1	23.6	43.1	45	45	40	93	45	45	45	41	97		
												11125	7.9	1	38	61.1	70	70	56	93	63	70	70	58	97		
	230-1-60	15.4	83.9	24	—	—	—	1.4	6	1.3	8.6	None	—	—	—	31	35	45	31	93	32.3	35	45	33	96		
												10625	6.5	1	27.1	46.8	50	50	43	93	48.4	50	50	45	96		
												11125	10.5	1	43.8	67.6	70	70	62	93	69.3	70	70	64	96		
	208-3-60	10.4	73	16	—	—	—	1.3	6.6	1.1	8.6	None	—	—	—	25.2	30	35	26	82	26.3	30	35	27	85		
												10625	4.9	1	13.6	30.6	35	35	28	82	32	35	35	29	85		
												11125	7.9	1	21.9	41	45	45	38	82	42.4	45	45	39	85		
	230-3-60	10.4	73	16	—	—	—	1.4	6	1	8.6	11625	12	1	33.3	55.3	60	60	51	82	56.6	60	60	52	85		
												None	—	—	—	24.7	25	35	25	83	25.7	30	35	27	85		
												10625	6.5	1	15.6	32.4	35	35	30	83	33.6	35	35	31	85		
	460-3-60	5.8	38	9	—	—	—	0.8	3.2	0.5	8.6	11125	10.5	1	25.3	44.5	45	45	41	83	45.8	50	50	42	85		
												11625	16	1	38.5	61	70	70	56	83	62.3	70	70	57	85		
												None	—	—	—	13.5	15	15	14	44	14	15	15	14	45		
	575-3-60	3.8	36.5	6	—	—	—	0.6	6	0.4	8.6	10646	6	1	7.2	15.7	20	20	14	44	16.3	20	20	15	45		
												11146	11.5	1	13.8	23.9	25	25	22	44	24.6	25	25	23	45		
												11446	14	1	16.8	27.7	30	30	25	44	28.3	30	30	26	45		
05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	8.4	1.5	8.6	None	—	—	—	38.5	40	50	39	139	40	40	50	40	143		
												10625	4.9	1	23.6	45.4	50	50	42	139	47.3	50	50	43	143		
												11125	7.9	1	38	63.4	70	70	58	139	65.3	70	70	60	143		
	230-1-60	19.6	130	31	—	—	—	1.4	7.6	1.3	8.6	None	—	—	—	37.8	40	50	38	140	39.1	40	50	39	142		
												10625	6.5	1	27.1	48.8	50	50	45	140	50.4	60	60	46	142		
												11125	10.5	1	43.8	69.6	70	70	64	140	71.3	80	80	66	142		
	208-3-60	13.7	83.1	21	—	—	—	1.3	8.4	1.1	8.6	None	—	—	—	31.1	35	40	32	92	32.2	35	45	33	95		
												10625	4.9	1	13.6	32.9	35	40	32	92	34.3	35	45	33	95		
												11125	7.9	1	21.9	43.3	45	45	40	92	44.6	45	45	41	95		
	230-3-60	13.7	83.1	21	—	—	—	1.4	7.6	1	8.6	11625	12	1	33.3	57.5	60	60	53	92	58.9	60	60	54	95		
												None	—	—	—	30.4	35	40	31	93	31.4	35	45	32	95		
												10625	6.5	1	15.6	34.4	35	40	32	93	35.6	40	45	33	95		
	460-3-60	6.2	41	10	—	—	—	0.8	4	0.5	8.6	11125	10.5	1	25.3	46.5	50	50	43	93	47.8	50	50	44	95		
												11625	16	1	38.5	63	70	70	58	93	64.3	70	70	59	95		
												None	—	—	—	14.8	15	20	15	47	15.3	20	20	16	48		
	575-3-60	4.8	33	8	—	—	—	0.6	7.6	0.4	8.6	10646	6	1	7.2	16.7	20	20	15	47	17.3	20	20	16	48		
												11146	11.5	1	13.8	24.9	25	25	23	47	25.6	30	30	24	48		
												11446	14	1	16.8	28.7	30	30	26	47	29.3	30	30	27	48		
												None	—	—	—	11.4	15	15	12	37	11.8	15	15	12	38		
												11058	9.2	1	8.9	17.1	20	20	16	37	17.6	20	20	16	38		
												11458	13.8	1	13.3	22.6	25	25	21	37	23.1	25	25	21	38		

**Table 161: ZY04 to 12 standard indoor blower - with powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCAw/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	23.7	152.5	37	—	—	—	2	8.4	1.5	8.6	None	—	—	—	44.3	45	60	44	163	45.8	50	60	46	167
												10625	4.9	1	23.6	45.4	50	60	44	163	47.3	50	60	46	167
												11125	7.9	1	38	63.4	70	70	58	163	65.3	70	70	60	167
	230-1-60	23.7	152.5	37	—	—	—	2.3	7.6	1.3	8.6	None	—	—	—	43.8	45	60	44	164	45.1	50	60	45	167
												10625	6.5	1	27.1	48.8	50	60	45	164	50.4	60	60	46	167
												11125	10.5	1	43.8	69.6	70	70	64	164	71.3	80	80	66	167
	208-3-60	15.9	110	25	—	—	—	2	8.4	1.1	8.6	None	—	—	—	34.6	35	50	35	121	35.7	40	50	36	123
												10625	4.9	1	13.6	34.6	35	50	35	121	35.7	40	50	36	123
												11125	7.9	1	21.9	43.3	45	50	40	121	44.6	45	50	41	123
	230-3-60	15.9	110	25	—	—	—	2.3	7.6	1	8.6	11625	12	1	33.3	57.5	60	60	53	121	58.9	60	60	54	123
												None	—	—	—	34.1	35	45	35	121	35.1	40	50	36	124
												10625	6.5	1	15.6	34.4	35	45	35	121	35.6	40	50	36	124
	460-3-60	7.1	52	11	—	—	—	1.3	4	0.5	8.6	11125	10.5	1	25.3	46.5	50	50	43	121	47.8	50	50	44	124
												11625	16	1	38.5	63	70	70	58	121	64.3	70	70	59	124
												None	—	—	—	16.4	20	20	17	59	16.9	20	20	17	60
	575-3-60	5.1	39.5	8	—	—	—	1	7.6	0.4	8.6	10646	6	1	7.2	16.7	20	20	15	59	17.3	20	20	16	60
												11146	11.5	1	13.8	24.9	25	25	23	59	25.6	30	30	24	60
												11446	14	1	16.8	28.7	30	30	26	59	29.3	30	30	27	60
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	5.2	1.1	8.6	None	—	—	—	35.5	40	50	36	172	37.7	40	50	38	177
												10725	4.9	1	13.6	35.5	40	50	36	172	37.7	40	50	38	177
												11725	12	1	33.3	53.5	60	60	49	172	56.3	60	60	52	177
												12525	18.6	1	51.6	76.4	80	80	70	172	79.1	80	80	73	177
	230-3-60	17.6	136	27	—	—	—	2.3	5.2	1	8.6	None	—	—	—	36.1	40	50	36	175	38.1	40	50	39	180
												10725	6.5	1	15.6	36.1	40	50	36	175	38.1	40	50	39	180
												11725	16	1	38.5	60	60	60	55	175	62.5	70	70	58	180
												12525	24.8	1	59.7	86.5	90	90	80	175	89	90	90	82	180
	460-3-60	8.5	66.1	13	—	—	—	1.3	2.6	0.5	8.6	None	—	—	—	18	20	25	18	87	19	20	25	19	89
												10746	6	1	7.2	18	20	25	14	87	19	20	25	15	89
												11746	16.5	1	19.8	30.7	35	35	28	87	31.9	35	35	29	89
												12646	25.5	1	30.7	44.3	45	45	41	87	45.6	50	50	42	89
	575-3-60	6.3	55.3	10	—	—	—	1	2	0.4	8.6	None	—	—	—	13.6	15	15	14	72	14.4	15	15	15	73
												11758	17	1	16.4	25.2	30	30	23	72	26.2	30	30	24	73
												12658	25.7	1	24.7	35.5	40	40	33	72	36.5	40	40	34	73

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect ampereage rating.

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Min disconnect rating <sup>4</sup>		MCAw/pwr exh (amps)				Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect rating <sup>4</sup> / pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA										
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	7	1.1	8.6	None	—	—	—	37.3	40	50	38	209	39.5	40	50	40	214	40	50	40	214			
												10725	4.9	1	13.6	37.3	40	50	38	209	39.5	40	50	40	214							
												11725	12	1	33.3	55.8	60	60	51	209	58.5	60	60	54	214							
												12525	18.6	1	51.6	78.6	80	80	72	209	81.4	90	90	75	214							
	230-3-60	17.6	136	27	—	—	—	2.3	7.2	1	8.6	None	—	—	—	38.1	40	50	39	212	40.1	45	50	41	217	40.1	45	50	41	217		
												10725	6.5	1	15.6	38.1	40	50	39	212	40.1	45	50	41	217							
												11725	16	1	38.5	62.5	70	70	58	212	65	70	70	60	217							
												12525	24.8	1	59.7	89	90	90	82	212	91.5	100	100	84	217							
	460-3-60	8.5	66.1	13	—	—	—	1.3	3.6	0.5	8.6	None	—	—	—	19	20	25	19	105	20	20	25	21	107	20	20	25	21	107		
												10746	6	1	7.2	19	20	25	15	105	20	20	25	16	107							
												11746	16.5	1	19.8	31.9	35	35	29	105	33.2	35	35	31	107							
												12646	25.5	1	30.7	45.6	50	50	42	105	46.8	50	50	43	107							
	575-3-60	6.3	55.3	10	—	—	—	1	2.5	0.4	8.6	None	—	—	—	14.1	15	20	14	79	14.9	15	20	15	81	15	20	15	81			
												11758	17	1	16.4	25.8	30	30	24	79	26.8	30	30	25	81							
												12658	25.7	1	24.7	36.2	40	40	33	79	37.2	40	40	34	81							
												None	—	—	—	44.1	45	50	47	314	46.3	50	50	50	319							
08 (7.5)	208-3-60	12.8	120.4	20	12.8	120.4	20	2	7	1.1	8.6	11725	12	1	33.3	55.8	60	60	51	314	58.5	60	60	54	319	60	60	54	319			
												12525	18.6	1	51.6	78.6	80	80	72	314	81.4	90	90	75	319							
												13225	24	1	66.6	97.4	100	100	90	314	100.1	110	110	92	319							
												14225	31.8	2	88.3	124.5	125	125	115	314	127.3	150	150	117	319							
	230-3-60	12.8	120.4	20	12.8	120.4	20	2.3	7.2	1	8.6	None	—	—	—	44.9	45	50	48	317	46.9	50	50	50	321	50	50	50	321			
												11725	16	1	38.5	62.5	70	70	58	317	65	70	70	60	321							
												12525	24.8	1	59.7	89	90	90	82	317	91.5	100	100	84	321							
												13225	32	1	77	110.6	125	125	102	317	113.											

**Table 162: ZY04 to 12 standard indoor blower - with powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect rating <sup>4</sup>		MCAw/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect rating <sup>4</sup> / pwr exh			
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA
12 (10)	208-3-60	15.4	155	24	15.4	155	24	5.8	7	1.1	8.6	None	—	—	—	51.8	60	60	55	396	54	60	60	58	401		
												11725	12	1	33.3	55.8	60	60	55	396	58.5	60	60	58	401		
												12525	18.6	1	51.6	78.6	80	80	72	396	81.4	90	90	75	401		
												13225	24	1	66.6	97.4	100	100	90	396	100.1	110	110	92	401		
												14225	31.8	2	88.3	124.5	125	125	115	396	127.3	150	150	117	401		
	230-3-60	15.4	155	24	15.4	155	24	5.2	7.2	1	8.6	None	—	—	—	51.4	60	60	55	395	53.4	60	60	57	400		
												11725	16	1	38.5	62.5	70	70	58	395	65	70	70	60	400		
												12525	24.8	1	59.7	89	90	90	82	395	91.5	100	100	84	400		
												13225	32	1	77	110.6	125	125	102	395	113.1	125	125	104	400		
												14225	42.4	2	102	141.9	150	150	131	395	144.4	150	150	133	400		
	460-3-60	7.1	62	11	7.1	62	11	2.9	3.6	0.5	8.6	None	—	—	—	24.7	25	30	26	168	25.7	30	30	27	170		
												11746	16.5	1	19.8	31.9	35	35	29	168	33.2	35	35	31	170		
												12846	27.8	1	33.4	48.9	50	50	45	168	50.2	60	60	46	170		
												13346	33	1	39.7	56.8	60	60	52	168	58.1	60	60	53	170		
												14246	41.7	2	50.2	69.9	70	70	64	168	71.2	80	80	65	170		
	575-3-60	6	47.8	9	6	47.8	9	2.2	2.5	0.4	8.6	None	—	—	—	19.9	20	25	21	126	20.7	25	25	22	128		
												11758	17	1	16.4	25.8	30	30	24	126	26.8	30	30	25	128		
												13458	34	1	32.7	46.2	50	50	42	126	47.2	50	50	43	128		

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.



**Table 163: ZY04 to 12 medium indoor blower - without powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA	
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	7.6	1.5	—	None	—	—	—	28.2	30	40	28	120	29.7	30	45	30	123	
												10625	4.9	1	23.6	39	40	40	36	120	40.9	45	45	38	123	
												11125	7.9	1	38	57	60	60	52	120	58.9	60	60	54	123	
	230-1-60	15.4	83.9	24	—	—	—	1.4	7	1.3	—	None	—	—	—	27.7	30	40	27	123	29	30	40	29	126	
												10625	6.5	1	27.1	42.6	45	45	39	123	44.3	45	45	41	126	
												11125	10.5	1	43.8	63.5	70	70	58	123	65.1	70	70	60	126	
	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	—	None	—	—	—	19.5	20	25	19	98	20.6	25	30	21	101	
												10625	4.9	1	13.6	23.5	25	25	22	98	24.9	25	30	23	101	
												11125	7.9	1	21.9	33.9	35	35	31	98	35.3	40	40	32	101	
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	—	11625	12	1	33.3	48.1	50	50	44	98	49.5	50	50	46	101	
												None	—	—	—	19.6	20	30	20	101	20.6	25	30	21	104	
												10625	6.5	1	15.6	26	30	30	24	101	27.3	30	30	25	104	
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	—	11125	10.5	1	25.3	38.1	40	40	35	101	39.4	40	40	36	104	
												11625	16	1	38.5	54.6	60	60	50	101	55.9	60	60	51	104	
												None	—	—	—	10.7	15	15	11	52	11.2	15	15	11	53	
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	—	10646	6	1	7.2	12.3	15	15	11	52	12.9	15	15	12	53	
												11146	11.5	1	13.8	20.5	25	25	19	52	21.1	25	25	19	53	
												11446	14	1	16.8	24.3	25	25	22	52	24.9	25	25	23	53	
	05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	7.6	1.5	—	None	—	—	—	33.4	35	50	33	166	34.9	35	50	35	169
													10625	4.9	1	23.6	39	40	50	36	166	40.9	45	50	38	169
													11125	7.9	1	38	57	60	60	52	166	58.9	60	60	54	169
		230-1-60	19.6	130	31	—	—	—	1.4	7	1.3	—	None	—	—	—	32.9	35	50	32	169	34.2	35	50	34	172
													10625	6.5	1	27.1	42.6	45	50	39	169	44.3	45	50	41	172
													11125	10.5	1	43.8	63.5	70	70	58	169	65.1	70	70	60	172
208-3-60		13.7	83.1	21	—	—	—	1.3	5.2	1.1	—	None	—	—	—	23.6	25	35	23	108	24.7	25	35	24	111	
												10625	4.9	1	13.6	23.6	25	35	23	108	24.9	25	35	24	111	
												11125	7.9	1	21.9	33.9	35	35	31	108	35.3	40	40	32	111	
230-3-60		13.7	83.1	21	—	—	—	1.4	5.2	1	—	11625	12	1	33.3	48.1	50	50	44	108	49.5	50	50	46	111	
												None	—	—	—	23.7	25	35	23	111	24.7	25	35	24	114	
												10625	6.5	1	15.6	26	30	35	24	111	27.3	30	35	25	114	
460-3-60		6.2	41	10	—	—	—	0.8	2.6	0.5	—	11125	10.5	1	25.3	38.1	40	40	35	111	39.4	40	40	36	114	
												11625	16	1	38.5	54.6	60	60	50	111	55.9	60	60	51	114	
												None	—	—	—	11.2	15	15	11	55	11.7	15	15	12	56	
575-3-60		4.8	33	8	—	—	—	0.6	2	0.4	—	10646	6	1	7.2	12.3	15	15	11	55	12.9	15	15	12	56	
												11146	11.5	1	13.8	20.5	25	25	19	55	21.1	25	25	19	56	
												11446	14	1	16.8	24.3	25	25	22	55	24.9	25	25	23	56	

**Table 163: ZY04 to 12 medium indoor blower - without powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	23.7	152.5	37	—	—	—	2	6.8	1.5	—	None	—	—	—	38.4	40	60	37	189	39.9	40	60	39	193
												10625	4.9	1	23.6	38.4	40	60	37	189	39.9	40	60	39	193
												11125	7.9	1	38	56	60	60	52	189	57.9	60	60	53	193
	230-1-60	23.7	152.5	37	—	—	—	2.3	6.2	1.3	—	None	—	—	—	38.1	40	60	37	190	39.4	40	60	39	193
												10625	6.5	1	27.1	41.6	45	60	38	190	43.3	45	60	40	193
												11125	10.5	1	43.8	62.5	70	70	58	190	64.1	70	70	59	193
	208-3-60	15.9	110	25	—	—	—	2	7	1.1	—	None	—	—	—	28.9	30	40	29	175	30	30	45	30	177
												10625	4.9	1	13.6	28.9	30	40	29	175	30	30	45	30	177
												11125	7.9	1	21.9	36.1	40	40	33	175	37.5	40	45	35	177
	230-3-60	15.9	110	25	—	—	—	2.3	7.2	1	—	11625	12	1	33.3	50.4	60	60	46	175	51.8	60	60	48	177
												None	—	—	—	29.4	30	45	29	177	30.4	35	45	30	179
												10625	6.5	1	15.6	29.4	30	45	29	177	30.4	35	45	30	179
	460-3-60	7.1	52	11	—	—	—	1.3	3.6	0.5	—	11125	10.5	1	25.3	40.6	45	45	37	177	41.9	45	45	39	179
												11625	16	1	38.5	57.1	60	60	53	177	58.4	60	60	54	179
												None	—	—	—	13.8	15	20	14	86	14.3	15	20	14	87
	575-3-60	5.1	39.5	8	—	—	—	1	2.5	0.4	—	10646	6	1	7.2	13.8	15	20	12	86	14.3	15	20	13	87
												11146	11.5	1	13.8	21.8	25	25	20	86	22.4	25	25	21	87
												11446	14	1	16.8	25.5	30	30	23	86	26.1	30	30	24	87
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	7.5	1.1	—	None	—	—	—	33.5	35	50	33	193	35.7	40	50	36	198
												10725	4.9	1	13.6	33.5	35	50	33	193	35.7	40	50	36	198
												11725	12	1	33.3	51	60	60	47	193	53.8	60	60	49	198
												12525	18.6	1	51.6	73.9	80	80	68	193	76.6	80	80	70	198
	230-3-60	17.6	136	27	—	—	—	2.3	7.5	1	—	None	—	—	—	34.1	35	50	34	201	36.1	40	50	36	205
												10725	6.5	1	15.6	34.1	35	50	34	201	36.1	40	50	36	205
												11725	16	1	38.5	57.5	60	60	53	201	60	60	60	55	205
												12525	24.8	1	59.7	84	90	90	77	201	86.5	90	90	80	205
	460-3-60	8.5	66.1	13	—	—	—	1.3	3.4	0.5	—	None	—	—	—	16.6	20	25	17	99	17.6	20	25	18	102
												10746	6	1	7.2	16.6	20	25	12	99	17.6	20	25	13	102
												11746	16.5	1	19.8	29	30	30	27	99	30.3	35	35	28	102
												12646	25.5	1	30.7	42.6	45	45	39	99	43.9	45	45	40	102
	575-3-60	6.3	55.3	10	—	—	—	1	2.8	0.4	—	None	—	—	—	12.7	15	15	13	82	13.5	15	15	14	84
												11758	17	1	16.4	24	25	25	22	82	25	25	25	23	84
												12658	25.7	1	24.7	34.4	35	35	32	82	35.4	40	40	33	84

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 164: ZY04 to 12 medium indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		FLA	LRA		
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	8.9	1.1	—	None	—	—	—	34.9	35	50	35	207	37.1	40	50	38	212
												10725	4.9	1	13.6	34.9	35	50	35	207	37.1	40	50	38	212
												11725	12	1	33.3	52.8	60	60	49	207	55.5	60	60	51	212
												12525	18.6	1	51.6	75.6	80	80	70	207	78.4	80	80	72	212
	230-3-60	17.6	136	27	—	—	—	2.3	8.2	1	—	None	—	—	—	34.8	35	50	35	215	36.8	40	50	37	219
												10725	6.5	1	15.6	34.8	35	50	35	215	36.8	40	50	37	219
												11725	16	1	38.5	58.4	60	60	54	215	60.9	70	70	56	219
												12525	24.8	1	59.7	84.9	90	90	78	215	87.4	90	90	80	219
	460-3-60	8.5	66.1	13	—	—	—	1.3	4.1	0.5	—	None	—	—	—	17.3	20	25	17	106	18.3	20	25	19	109
												10746	6	1	7.2	17.3	20	25	13	106	18.3	20	25	14	109
												11746	16.5	1	19.8	29.9	30	30	27	106	31.1	35	35	29	109
												12646	25.5	1	30.7	43.5	45	45	40	106	44.8	45	45	41	109
	575-3-60	6.3	55.3	10	—	—	—	1	3.2	0.4	—	None	—	—	—	13.1	15	15	13	86	13.9	15	15	14	88
												11758	17	1	16.4	24.5	25	25	23	86	25.5	30	30	23	88
												12658	25.7	1	24.7	34.9	35	35	32	86	35.9	40	40	33	88
												None	—	—	—	39.8	40	50	42	310	42	45	50	45	315
08 (7.5)	208-3-60	12.8	120.4	20	12.8	120.4	20	2	7	1.1	—	11725	12	1	33.3	50.4	60	60	46	310	53.1	60	60	49	315
												12525	18.6	1	51.6	73.3	80	80	67	310	76	80	80	70	315
												13225	24	1	66.6	92	100	100	85	310	94.8	100	100	87	315
												14225	31.8	2	88.3	119.1	125	125	110	310	121.9	125	125	112	315
												None	—	—	—	40.6	45	50	43	312	42.6	45	50	45	317
	230-3-60	12.8	120.4	20	12.8	120.4	20	2.3	7.2	1	—	11725	16	1	38.5	57.1	60	60	53	312	59.6	60	60	55	317
												12525	24.8	1	59.7	83.6	90	90	77	312	86.1	90	90	79	317
												13225	32	1	77	105.3	110	110	97	312	107.8	110	110	99	317
												14225	42.4	2	102	136.5	150	150	126	312	139	150	150	128	317
												None	—	—	—	20.6	25	25	22	147	21.6	25	25	23	149
	460-3-60	6.4	55.1	10	6.4	55.1	10	1.3	3.6	0.5	—	11746	16.5	1	19.8	29.3	30	30	27	147	30.5	35	35	28	149
												12846	27.8	1	33.4	46.3	50	50	43	147	47.5	50	50	44	149
												13346	33	1	39.7	54.1	60	60	50	147	55.4	60	60	51	149
												14246	41.7	2	50.2	67.3	70	70	62	147	68.5	70	70	63	149
												None	—	—	—	16.7	20	20	18	104	17.5	20	20	19	106
	575-3-60	5.4	41	9	5.4	41	9	1	2.5	0.4	—	11758	17	1	16.4	23.6	25	25	22	104	24.6	25	25	23	106
												13458	34	1	32.7	44	45	45	40	104	45	45	45	41	106
												None	—	—	—	41.8	45	50	44	235	44	45	50	47	240
												11725	12	1	33.3	50.4	60	60	46	235	53.1	60	60	49	240
												12525	18.6	1	51.6	73.3	80	80	67	235	76	80	80	70	240
09 (8.5)	208-3-60	13.7	83.1	21	13.7	83.1	21	2	7	1.1	—	13225	24	1	66.6	92	100	100	85	235	94.8	100	100	87	240
												14225	31.8	2	88.3	119.1	125	125	110	235	121.9	125	125	112	240
												None	—	—	—	42.6	45	50	45	238	44.6	45	50	47	242
												11725	16	1	38.5	57.1	60	60	53	238	59.6	60	60	55	242
												12525	24.8	1	59.7	83.6	90	90	77	238	86.1	90	90	79	242
	230-3-60	13.7	83.1	21	13.7	83.1	21	2.3	7.2	1	—	13225	32	1	77	105.3	110	110	97	238	107.8	110	110	99	242
												14225	42.4	2	102	136.5	150	150	126	238	139	150	150	128	242
												None	—	—	—	20.2	25	25	21	119	21.2	25	25	23	121
												11746	16.5	1	19.8	29.3	30	30	27	119	30.5	35	35	28	121
												12846	27.8	1	33.4	46.3	50	50	43	119	47.5	50	50	44	121
	460-3-60	6.2	41	10	6.2	41	10	1.3	3.6	0.5	—	13346	33	1	39.7	54.1	60	60	50	119	55.4	60	60	51	121
												14246	41.7	2	50.2	67.3	70	70	62	119	68.5	70	70	63	121
None												—	—	—	15.3	20	20	16	88	16.1	20	20	17	90	
11758												17	1	16.4	23.6	25	25	22	88	24.6	25	25	23	90	
575-3-60	4.8	33	8	4.8	33	8	1	2.5	0.4	—	13458	34	1	32.7	44	45	45	40	88	45	45	45	41	90	

**Table 164: ZY04 to 12 medium indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*	MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh				
		RLA	LRA	MCC	RLA	LRA	MCC									FLA	LRA				FLA	LRA			
12 (10)	208-3-60	15.4	155	24	15.4	155	24	5.8	9.9	1.1	—	None	—	—	—	50.4	60	60	53	405	52.6	60	60	56	410
												11725	12	1	33.3	54	60	60	53	405	56.8	60	60	56	410
												12525	18.6	1	51.6	76.9	80	80	71	405	79.6	80	80	73	410
												13225	24	1	66.6	95.6	100	100	88	405	98.4	100	100	91	410
												14225	31.8	2	88.3	122.8	125	125	113	405	125.5	150	150	115	410
	230-3-60	15.4	155	24	15.4	155	24	5.2	9.4	1	—	None	—	—	—	49.3	50	60	52	410	51.3	60	60	55	414
												11725	16	1	38.5	59.9	60	60	55	410	62.4	70	70	57	414
												12525	24.8	1	59.7	86.4	90	90	79	410	88.9	90	90	82	414
												13225	32	1	77	108	110	110	99	410	110.5	125	125	102	414
												14225	42.4	2	102	139.3	150	150	128	410	141.8	150	150	130	414
	460-3-60	7.1	62	11	7.1	62	11	2.9	4.7	0.5	—	None	—	—	—	23.6	25	30	25	175	24.6	25	30	26	178
												11746	16.5	1	19.8	30.6	35	35	28	175	31.9	35	35	29	178
												12846	27.8	1	33.4	47.6	50	50	44	175	48.9	50	50	45	178
												13346	33	1	39.7	55.5	60	60	51	175	56.8	60	60	52	178
												14246	41.7	2	50.2	68.6	70	70	63	175	69.9	70	70	64	178
	575-3-60	6	47.8	9	6	47.8	9	2.2	4.3	0.4	—	None	—	—	—	20	25	25	21	147	20.8	25	25	22	149
												11758	17	1	16.4	25.9	30	30	24	147	26.9	30	30	25	149
												13458	34	1	32.7	46.3	50	50	43	147	47.3	50	50	43	149

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect ampereage rating.

# ZY04 to 12 medium indoor blower - with powered convenience outlet

**Table 165: ZY04 to 12 medium indoor blower - with powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA							
04 (3)	208-1-60	15.4	83.9	24	—	—	—	1.3	7.6	1.5	8.6	None	—	—	—	32.5	35	45	33	124	34	35	45	35	45	35	43	128	
												10625	4.9	1	23.6	44.4	45	45	41	124	46.3	50	50	43	128				
												11125	7.9	1	38	62.4	70	70	57	124	64.3	70	70	59	128				
	230-1-60	15.4	83.9	24	—	—	—	1.4	7	1.3	8.6	None	—	—	—	32	35	45	32	127	33.3	35	45	34	130				
												10625	6.5	1	27.1	48	50	50	44	127	49.6	50	50	46	130				
												11125	10.5	1	43.8	68.9	70	70	63	127	70.5	80	80	65	130				
	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	23.8	25	30	24	103	24.9	25	35	26	105				
												10625	4.9	1	13.6	28.9	30	30	27	103	30.3	35	35	28	105				
												11125	7.9	1	21.9	39.3	40	40	36	103	40.6	45	45	37	105				
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	8.6	None	—	—	—	23.9	25	30	24	106	24.9	25	35	26	108				
												10625	6.5	1	15.6	31.4	35	35	29	106	32.6	35	35	30	108				
												11125	10.5	1	25.3	43.5	45	45	40	106	44.8	45	45	41	108				
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	12.9	15	15	13	54	13.4	15	15	14	56				
												10646	6	1	7.2	14.9	15	15	14	54	15.6	20	20	14	56				
												11146	11.5	1	13.8	23.2	25	25	21	54	23.8	25	25	22	56				
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	8.6	None	—	—	—	9.1	15	15	9	50	9.5	15	15	10	51				
												11058	9.2	1	8.9	15.8	20	20	15	50	16.3	20	20	15	51				
												11458	13.8	1	13.3	21.3	25	25	20	50	21.8	25	25	20	51				
05 (4)	208-1-60	19.6	130	31	—	—	—	1.3	7.6	1.5	8.6	None	—	—	—	37.7	40	50	38	170	39.2	40	50	39	174				
												10625	4.9	1	23.6	44.4	45	50	41	170	46.3	50	50	43	174				
												11125	7.9	1	38	62.4	70	70	57	170	64.3	70	70	59	174				
	230-1-60	19.6	130	31	—	—	—	1.4	7	1.3	8.6	None	—	—	—	37.2	40	50	37	173	38.5	40	50	39	176				
												10625	6.5	1	27.1	48	50	50	44	173	49.6	50	50	46	176				
												11125	10.5	1	43.8	68.9	70	70	63	173	70.5	80	80	65	176				
	208-3-60	13.7	83.1	21	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	27.9	30	40	28	113	29	30	40	29	115				
												10625	4.9	1	13.6	28.9	30	40	28	113	30.3	35	40	29	115				
												11125	7.9	1	21.9	39.3	40	40	36	113	40.6	45	45	37	115				
	230-3-60	13.7	83.1	21	—	—	—	1.4	5.2	1	8.6	None	—	—	—	28	30	40	28	116	29	30	40	29	118				
												10625	6.5	1	15.6	31.4	35	40	29	116	32.6	35	40	30	118				
												11125	10.5	1	25.3	43.5	45	45	40	116	44.8	45	45	41	118				
	460-3-60	6.2	41	10	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	13.4	15	15	14	57	13.9	15	15	14	59				
												10646	6	1	7.2	14.9	15	15	14	57	15.6	20	20	14	59				
												11146	11.5	1	13.8	23.2	25	25	21	57	23.8	25	25	22	59				
	575-3-60	4.8	33	8	—	—	—	0.6	2	0.4	8.6	None	—	—	—	10.3	15	15	10	46	10.7	15	15	11	47				
												11058	9.2	1	8.9	15.8	20	20	15	46	16.3	20	20	15	47				
												11458	13.8	1	13.3	21.3	25	25	20	46	21.8	25	25	20	47				

**Table 165: ZY04 to 12 medium indoor blower - with powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-1-60	23.7	152.5	37	—	—	—	2	6.8	1.5	8.6	None	—	—	—	42.7	45	60	42	194	44.2	45	60	44	197
												10625	4.9	1	23.6	43.4	45	60	42	194	45.3	50	60	44	197
												11125	7.9	1	38	61.4	70	70	56	194	63.3	70	70	58	197
	230-1-60	23.7	152.5	37	—	—	—	2.3	6.2	1.3	8.6	None	—	—	—	42.4	45	60	42	195	43.7	45	60	43	198
												10625	6.5	1	27.1	47	50	60	43	195	48.6	50	60	45	198
												11125	10.5	1	43.8	67.9	70	70	62	195	69.5	70	70	64	198
	208-3-60	15.9	110	25	—	—	—	2	7	1.1	8.6	None	—	—	—	33.2	35	45	34	179	34.3	35	50	35	181
												10625	4.9	1	13.6	33.2	35	45	34	179	34.3	35	50	35	181
												11125	7.9	1	21.9	41.5	45	45	38	179	42.9	45	50	39	181
	230-3-60	15.9	110	25	—	—	—	2.3	7.2	1	8.6	11625	12	1	33.3	55.8	60	60	51	179	57.1	60	60	53	181
												None	—	—	—	33.7	35	45	34	181	34.7	35	50	35	183
												10625	6.5	1	15.6	33.9	35	45	34	181	35.1	40	50	35	183
	460-3-60	7.1	52	11	—	—	—	1.3	3.6	0.5	8.6	11125	10.5	1	25.3	46	50	50	42	181	47.3	50	50	43	183
												11625	16	1	38.5	62.5	70	70	58	181	63.8	70	70	59	183
												None	—	—	—	16	20	20	16	88	16.5	20	20	17	89
	575-3-60	5.1	39.5	8	—	—	—	1	2.5	0.4	8.6	10646	6	1	7.2	16.2	20	20	15	88	16.8	20	20	15	89
												11146	11.5	1	13.8	24.4	25	25	22	88	25.1	30	30	23	89
												11446	14	1	16.8	28.2	30	30	26	88	28.8	30	30	27	89
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	7.5	1.1	8.6	None	—	—	—	37.8	40	50	38	198	40	40	50	41	203
												10725	4.9	1	13.6	37.8	40	50	38	198	40	40	50	41	203
												11725	12	1	33.3	56.4	60	60	52	198	59.1	60	60	54	203
												12525	18.6	1	51.6	79.3	80	80	73	198	82	90	90	75	203
	230-3-60	17.6	136	27	—	—	—	2.3	7.5	1	8.6	None	—	—	—	38.4	40	50	39	205	40.4	45	50	41	210
												10725	6.5	1	15.6	38.4	40	50	39	205	40.4	45	50	41	210
												11725	16	1	38.5	62.9	70	70	58	205	65.4	70	70	60	210
												12525	24.8	1	59.7	89.4	90	90	82	205	91.9	100	100	85	210
	460-3-60	8.5	66.1	13	—	—	—	1.3	3.4	0.5	8.6	None	—	—	—	18.8	20	25	19	102	19.8	20	25	20	104
												10746	6	1	7.2	18.8	20	25	15	102	19.8	20	25	16	104
												11746	16.5	1	19.8	31.7	35	35	29	102	32.9	35	35	30	104
												12646	25.5	1	30.7	45.3	50	50	42	102	46.6	50	50	43	104
	575-3-60	6.3	55.3	10	—	—	—	1	2.8	0.4	8.6	None	—	—	—	14.4	15	20	15	84	15.2	20	20	16	85
												11758	17	1	16.4	26.2	30	30	24	84	27.2	30	30	25	85
												12658	25.7	1	24.7	36.5	40	40	34	84	37.5	40	40	35	85

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>1</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>1</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	8.9	1.1	8.6	None	—	—	—	39.2	40	50	40	211	41.4	45	50	43	216
		10725	4.9	1	13.6	39.2	40	50	40	211	41.4	45	50	43	216										
		11725	12	1	33.3	58.1	60	60	53	211	60.9	70	70	56	216										
		12525	18.6	1	51.6	81	90	90	75	211	83.8	90	90	77	216										
	230-3-60	17.6	136	27	—	—	—	2.3	8.2	1	8.6	None	—	—	—	39.1	40	50	40	219	41.1	45	50	42	224
		10725	6.5	1	15.6	39.1	40	50	40	219	41.1	45	50	42	224										
		11725	16	1	38.5	63.8	70	70	59	219	66.3	70	70	61	224										
		12525	24.8	1	59.7	90.3	100	100	83	219	92.8	100	100	85	224										
	460-3-60	8.5	66.1	13	—	—	—	1.3	4.1	0.5	8.6	None	—	—	—	19.5	20	25	20	109	20.5	25	25	21	111
		10746	6	1	7.2	19.5	20	25	15	109	20.5	25	25	17	111										
		11746	16.5	1	19.8	32.6	35	35	30	109	33.8	35	35	31	111										
		12646	25.5	1	30.7	46.2	50	50	42	109	47.4	50	50	44	111										
575-3-60	6.3	55.3	10	—	—	—	1	3.2	0.4	8.6	None	—	—	—	14.8	15	20	15	88	15.6	20	20	16	90	
	11758	17	1	16.4	26.7	30	30	25	88	27.7	30	30	25	90											
	12658	25.7	1	24.7	37	40	40	34	88	38	40	40	35	90											
	None	—	—	—	44.1	45	50	47	314	46.3	50	50	50	319											
08 (7.5)	208-3-60	12.8	120.4	20	12.8	120.4	20	2	7	1.1	8.6	11725	12	1	33.3	55.8	60	60	51	314	58.5	60	60	54	319
		12525	18.6	1	51.6	78.6	80	80	72	314	81.4	90	90	75	319										
		13225	24	1	66.6	97.4	100	100	90	314	100.1	110	110	92	319										
		14225	31.8	2	88.3	124.5	125	125	115	314	127.3	150	150	117	319										
		None	—	—	—	44.9	45	50	48	317	46.9	50	50	50	321										
	230-3-60	12.8	120.4	20	12.8	120.4	20	2.3	7.2	1	8.6	11725	16	1	38.5	62.5	70	70	58	317	65	70	70	60	321
		12525	24.8	1	59.7	89	90	90	82	317	91.5	100	100	84	321										
		13225	32	1	77	110.6	125	125	102	317	113.1	125	125	104	321										
		14225	42.4	2	102	141.9	150	150	131	317	144.4	150	150	133	321										
		None	—	—	—	22.8	25	25	24	149	23.8	25	25	26	151										
	460-3-60	6.4	55.1	10	6.4	55.1	10	1.3	3.6	0.5	8.6	11746	16.5	1	19.8	31.9	35	35	29						

**Table 166: ZY04 to 12 medium indoor blower - with powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA¹ (amps)	Min fuse² / breaker³ size (amps)	Max fuse² / breaker³ size (amps)	Min disconnect⁴ rating		MCA¹ w/pwr exh (amps)		Min fuse² / breaker³ size w/ pwr exh (amps)	Max fuse² / breaker³ size w/ pwr exh (amps)	Min disconnect⁴ rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	FLA	LRA				
12 (10)	208-3-60	15.4	155	24	15.4	155	24	5.8	9.9	1.1	8.6	None	—	—	—	54.7	60	70	58	409	56.9	60	70	61	414	
												11725	12	1	33.3	59.4	60	70	58	409	62.1	70	70	61	414	
												12525	18.6	1	51.6	82.3	90	90	76	409	85	90	90	78	414	
												13225	24	1	66.6	101	110	110	93	409	103.8	110	110	95	414	
												14225	31.8	2	88.3	128.1	150	150	118	409	130.9	150	150	120	414	
	230-3-60	15.4	155	24	15.4	155	24	5.2	9.4	1	8.6	None	—	—	—	53.6	60	60	57	414	55.6	60	70	59	419	
												11725	16	1	38.5	65.3	70	70	60	414	67.8	70	70	62	419	
												12525	24.8	1	59.7	91.8	100	100	84	414	94.3	100	100	87	419	
												13225	32	1	77	113.4	125	125	104	414	115.9	125	125	107	419	
												14225	42.4	2	102	144.6	150	150	133	414	147.1	150	150	135	419	
	460-3-60	7.1	62	11	7.1	62	11	2.9	4.7	0.5	8.6	None	—	—	—	25.8	30	30	28	177	26.8	30	30	29	180	
												11746	16.5	1	19.8	33.3	35	35	31	177	34.6	35	35	32	180	
												12846	27.8	1	33.4	50.3	60	60	46	177	51.6	60	60	47	180	
												13346	33	1	39.7	58.2	60	60	54	177	59.4	60	60	55	180	
												14246	41.7	2	50.2	71.3	80	80	66	177	72.6	80	80	67	180	
	575-3-60	6	47.8	9	6	47.8	9	2.2	4.3	0.4	8.6	None	—	—	—	21.7	25	25	23	149	22.5	25	25	24	150	
												11758	17	1	16.4	28	30	30	26	149	29	30	30	27	150	
												13458	34	1	32.7	48.4	50	50	45	149	49.4	50	50	45	150	

1 Minimum circuit ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect ampere rating.



# ZY04 to 12 high indoor blower - without powered convenience outlet

**Table 167: ZY04 to 12 high indoor blower - without powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh																																											
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA																																										
04 (3)	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	—	None	—	—	—	19.5	20	25	19	98	20.6	25	30	21	101	10625	4.9	1	13.6	23.5	25	25	22	98	24.9	25	30	23	101	11125	7.9	1	21.9	33.9	35	35	31	98	35.3	40	40	32	101	11625	12	1	33.3	48.1	50	50	44	98	49.5	50	50	46	101
												None	—	—	—	19.6	20	30	20	101	20.6	25	30	21	104	10625	6.5	1	15.6	26	30	30	24	101	27.3	30	30	25	104	11125	10.5	1	25.3	38.1	40	40	35	101	39.4	40	40	36	104	11625	16	1	38.5	54.6	60	60	50	101	55.9	60	60	51	104
												None	—	—	—	10.7	15	15	11	52	11.2	15	15	11	53	10646	6	1	7.2	12.3	15	15	11	52	12.9	15	15	12	53	11146	11.5	1	13.8	20.5	25	25	19	52	21.1	25	25	19	53	11446	14	1	16.8	24.3	25	25	22	52	24.9	25	25	23	53
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	—	None	—	—	—	19.6	20	30	20	101	20.6	25	30	21	104	10625	6.5	1	15.6	26	30	30	24	101	27.3	30	30	25	104	11125	10.5	1	25.3	38.1	40	40	35	101	39.4	40	40	36	104	11625	16	1	38.5	54.6	60	60	50	101	55.9	60	60	51	104
												None	—	—	—	10.7	15	15	11	52	11.2	15	15	11	53	10646	6	1	7.2	12.3	15	15	11	52	12.9	15	15	12	53	11146	11.5	1	13.8	20.5	25	25	19	52	21.1	25	25	19	53	11446	14	1	16.8	24.3	25	25	22	52	24.9	25	25	23	53
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	—	None	—	—	—	10.7	15	15	11	52	11.2	15	15	11	53	10646	6	1	7.2	12.3	15	15	11	52	12.9	15	15	12	53	11146	11.5	1	13.8	20.5	25	25	19	52	21.1	25	25	19	53	11446	14	1	16.8	24.3	25	25	22	52	24.9	25	25	23	53
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	—	None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
												None	—	—	—	7.4	15	15	7	48	7.8	15	15	8	49	11058	9.2	1	8.9	13.6	15	15	13	48	14.1	15	15	13	49	11458	13.8	1	13.3	19.1	20	20	18	48	19.6	20	20	18	49														
05 (4)	208-3-60	13.7	83.1	21	—	—	—	1.3	7.5	1.1	—	None	—	—	—	25.9	30	35	26	135	27	30	40	27	137	10625	4.9	1	13.6	26.4	30	35	26	135	27.8	30	40	27	137	11125	7.9	1	21.9	36.8	40	40	34	135	38.1	40	40	35	137	11625	12	1	33.3	51	60	60	47	135	52.4	60	60	48	137
												None	—	—	—	26	30	35	26	141	27	30	40	27	144	10625	6.5	1	15.6	28.9	30	35	27	141	30.1	35	40	28	144	11125	10.5	1	25.3	41	45	45	38	141	42.3	45	45	39	144	11625	16	1	38.5	57.5	60	60	53	141	58.8	60	60	54	144
												None	—	—	—	12	15	15	12	70	12.5	15	15	13	71	10646	6	1	7.2	13.3	15	15	12	70	13.9	15	15	13	71	11146	11.5	1	13.8	21.5	25	25	20	70	22.1	25	25	20	71	11446	14	1	16.8	25.3	30	30	23	70	25.9	30	30	24	71
												None	—	—	—	9.4	15	15	9	56	9.8	15	15	10	57	11058	9.2	1	8.9	14.6	15	15	13	56	15.1	20	20	14	57	11458	13.8	1	13.3	20.1	25	25	19	56	20.6	25	25	19	57														
	230-3-60	13.7	83.1	21	—	—	—	1.4	7.5	1	—	None	—	—	—	25.9	30	35	26	135	27	30	40	27	137	10625	4.9	1	13.6	26.4	30	35	26	135	27.8	30	40	27	137	11125	7.9	1	21.9	36.8	40	40	34	135	38.1	40	40	35	137	11625	12	1	33.3	51	60	60	47	135	52.4	60	60	48	137
												None	—	—	—	26	30	35	26	141	27	30	40	27	144	10625	6.5	1	15.6	28.9	30	35	27	141	30.1	35	40	28	144	11125	10.5	1	25.3	41	45	45	38	141	42.3	45	45	39	144	11625	16	1	38.5	57.5	60	60	53	141	58.8	60	60	54	144
												None	—	—	—	12	15	15	12	70	12.5	15	15	13	71	10646	6	1	7.2	13.3	15	15	12	70	13.9	15	15	13	71	11146	11.5	1	13.8	21.5	25	25	20	70	22.1	25	25	20	71	11446	14	1	16.8	25.3	30	30	23	70	25.9	30	30	24	71
												None	—	—	—	9.4	15	15	9	56	9.8	15	15	10	57	11058	9.2	1	8.9	14.6	15	15	13	56	15.1	20	20	14	57	11458	13.8	1	13.3	20.1	25	25	19	56	20.6	25	25	19	57														
	460-3-60	6.2	41	10	—	—	—	0.8	3.4	0.5	—	None	—	—	—	12	15	15	12	70	12.5	15	15	13	71	10646	6	1	7.2	13.3	15	15	12	70	13.9	15	15	13	71	11146	11.5	1	13.8	21.5	25	25	20	70	22.1	25	25	20	71	11446	14	1	16.8	25.3	30	30	23	70	25.9	30	30	24	71
												None	—	—	—	12	15	15	12	70	12.5	15	15	13	71	10646	6	1	7.2	13.3	15	15	12	70	13.9	15	15	13	71	11146	11.5	1	13.8	21.5	25	25	20	70	22.1	25	25	20	71	11446	14	1	16.8	25.3	30	30	23	70	25.9	30	30	24	71
												None	—	—	—	12	15	15	12	70	12.5	15	15	13	71	10646	6	1	7.2	13.3	15	15	12	70	13.9	15	15	13	71	11146	11.5	1	13.8	21.5	25	25	20	70	22.1	25	25	20	71	11446	14	1	16.8	25.3	30	30	23	70	25.9	30	30	24	71
												None	—	—	—	9.4	15	15	9	56	9.8	15	15	10	57	11058	9.2	1	8.9	14.6	15	15	13	56	15.1	20	20	14	57	11458	13.8	1	13.3	20.1	25	25	19	56	20.6	25	25	19	57														
	575-3-60	4.8	33	8	—	—	—	0.6	2.8	0.4	—	None	—	—	—	9.4	15	15	9	56	9.8	15	15	10	57	11058	9.2	1	8.9	14.6	15	15	13	56	15.1	20	20	14	57	11458	13.8	1	13.3	20.1	25	25	19	56	20.6	25	25	19	57														
												None	—	—	—	9.4	15	15	9	56	9.8	15	15	10	57	11058	9.2	1	8.9	14.6	15	15	13	56	15.1	20	20	14	57	11458	13.8	1	13.3	20.1	25	25	19	56																			

- 3 HACR type per NEC.
- 4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 168: ZY04 to 12 high indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)		Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)		Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)		Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps						FLA	LRA								
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	9.9	1.1	—	None	—	—	—	35.9	40	50	36	217	38.1	217	38.1	40	50	39	222	222	222	222
												10725	4.9	1	13.6	35.9	40	50	36	217	38.1	217	38.1	40	50	39	222	222	222	222
												11725	12	1	33.3	54	60	60	50	217	56.8	217	56.8	60	60	52	222	222	222	222
												12525	18.6	1	51.6	76.9	80	80	71	217	79.6	217	79.6	80	80	73	222	222	222	222
	230-3-60	17.6	136	27	—	—	—	2.3	9.4	1	—	None	—	—	—	36	40	50	36	226	38	226	38	40	50	39	231	231	231	231
												10725	6.5	1	15.6	36	40	50	36	226	38	226	38	40	50	39	231	231	231	231
												11725	16	1	38.5	59.9	60	60	55	226	62.4	226	62.4	70	70	57	231	231	231	231
												12525	24.8	1	59.7	86.4	90	90	79	226	88.9	226	88.9	90	90	82	231	231	231	231
	460-3-60	8.5	66.1	13	—	—	—	1.3	4.7	0.5	—	None	—	—	—	17.9	20	25	18	112	18.9	112	18.9	20	25	19	114	114	114	114
												10746	6	1	7.2	17.9	20	25	14	112	18.9	112	18.9	20	25	15	114	114	114	114
												11746	16.5	1	19.8	30.6	35	35	28	112	31.9	112	31.9	35	35	29	114	114	114	114
												12646	25.5	1	30.7	44.3	45	45	41	112	45.5	112	45.5	50	50	42	114	114	114	114
	575-3-60	6.3	55.3	10	—	—	—	1	4.3	0.4	—	None	—	—	—	14.2	15	20	14	100	15	100	15	15	20	15	102	102	102	102
												11758	17	1	16.4	25.9	30	30	24	100	26.9	100	26.9	30	30	25	102	102	102	102
												12658	25.7	1	24.7	36.3	40	40	33	100	37.3	100	37.3	40	40	34	102	102	102	102
												12658	25.7	1	24.7	36.3	40	40	33	100	37.3	100	37.3	40	40	34	102	102	102	102
08 (7.5)	208-3-60	12.8	120.4	20	12.8	120.4	20	2	9.9	1.1	—	None	—	—	—	42.7	45	50	45	322	44.9	322	44.9	45	50	48	327	327	327	327
												11725	12	1	33.3	54	60	60	50	322	56.8	322	56.8	60	60	52	327	327	327	327
												12525	18.6	1	51.6	76.9	80	80	71	322	79.6	322	79.6	80	80	73	327	327	327	327
												13225	24	1	66.6	95.6	100	100	88	322	98.4	322	98.4	100	100	91	327	327	327	327
	230-3-60	12.8	120.4	20	12.8	120.4	20	2.3	9.4	1	—	None	—	—	—	42.8	45	50	46	331	44.8	331	44.8	45	50	48	336	336	336	336
												11725	16	1	38.5	59.9	60	60	55	331	62.4	331	62.4	70	70	57	336	336	336	336
												12525	24.8	1	59.7	86.4	90	90	79	331	88.9	331	88.9	90	90	82	336	336	336	336
												13225	32	1	77	108	110	110	99	331	110.5	331	110.5	125	125	102	336	336	336	336
	460-3-60	6.4	55.1	10	6.4	55.1	10	1.3	4.7	0.5	—	None	—	—	—	21.7	25	25	23	156	22.7	156	22.7	25	25	24	159	159	159	159
												11746	16.5	1	19.8	30.6	35	35	28	156	31.9	156	31.9	35	35	29	159	159	159	159
												12846	27.8	1	33.4	47.6	50	50	44	156	48.9	156	48.9	50	50	45	159	159	159	159
												13346	33	1	39.7	55.5	60	60	51	156	56.8	156	56.8	60	60	52	159	159	159	159
	575-3-60	5.4	41	9	5.4	41	9	1	4.3	0.4	—	None	—	—	—	18.5	20	20	20	127	19.3	127	19.3	20	20	21	128	128	128	128
												11758	17	1	16.4	25.9	30	30	24	127	26.9	127	26.9	30	30	25	128	128	128	128
												13458	34	1	32.7	46.3	50	50	43	127	47.3	127	47.3	50	50	43	128	128	128	128
												13458	34	1	32.7	46.3	50	50	43	127	47.3	127	47.3	50	50	43	128	128	128	128

**Table 168: ZY04 to 12 high indoor blower - without powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
09 (8.5)	208-3-60	13.7	83.1	21	13.7	83.1	21	2	9.9	1.1	—	None	—	—	—	44.7	45	50	47	248	46.9	50	50	50	253
												11725	12	1	33.3	54	60	60	50	248	56.8	60	60	52	253
												12525	18.6	1	51.6	76.9	80	80	71	248	79.6	80	80	73	253
												13225	24	1	66.6	95.6	100	100	88	248	98.4	100	100	91	253
												14225	31.8	2	88.3	122.8	125	125	113	248	125.5	150	150	115	253
	230-3-60	13.7	83.1	21	13.7	83.1	21	2.3	9.4	1	—	None	—	—	—	44.8	45	50	48	257	46.8	50	60	50	261
												11725	16	1	38.5	59.9	60	60	55	257	62.4	70	70	57	261
												12525	24.8	1	59.7	86.4	90	90	79	257	88.9	90	90	82	261
												13225	32	1	77	108	110	110	99	257	110.5	125	125	102	261
												14225	42.4	2	102	139.3	150	150	128	257	141.8	150	150	130	261
	460-3-60	6.2	41	10	6.2	41	10	1.3	4.7	0.5	—	None	—	—	—	21.3	25	25	23	128	22.3	25	25	24	130
												11746	16.5	1	19.8	30.6	35	35	28	128	31.9	35	35	29	130
												12846	27.8	1	33.4	47.6	50	50	44	128	48.9	50	50	45	130
												13346	33	1	39.7	55.5	60	60	51	128	56.8	60	60	52	130
												14246	41.7	2	50.2	68.6	70	70	63	128	69.9	70	70	64	130
	575-3-60	4.8	33	8	4.8	33	8	1	4.3	0.4	—	None	—	—	—	17.1	20	20	18	111	17.9	20	20	19	112
												11758	17	1	16.4	25.9	30	30	24	111	26.9	30	30	25	112
												13458	34	1	32.7	46.3	50	50	43	111	47.3	50	50	43	112
12 (10)	208-3-60	15.4	155	24	15.4	155	24	5.8	13.5	1.1	—	None	—	—	—	54	60	60	58	435	56.2	60	70	60	440
												11725	12	1	33.3	58.5	60	60	58	435	61.3	70	70	60	440
												12525	18.6	1	51.6	81.4	90	90	75	435	84.1	90	90	77	440
												13225	24	1	66.6	100.1	110	110	92	435	102.9	110	110	95	440
												14225	31.8	2	88.3	127.3	150	150	117	435	130	150	150	120	440
	230-3-60	15.4	155	24	15.4	155	24	5.2	13.4	1	—	None	—	—	—	53.3	60	60	57	431	55.3	60	70	59	436
												11725	16	1	38.5	64.9	70	70	60	431	67.4	70	70	62	436
												12525	24.8	1	59.7	91.4	100	100	84	431	93.9	100	100	86	436
												13225	32	1	77	113	125	125	104	431	115.5	125	125	106	436
												14225	42.4	2	102	144.3	150	150	133	431	146.8	150	150	135	436
	460-3-60	7.1	62	11	7.1	62	11	2.9	6.7	0.5	—	None	—	—	—	25.6	30	30	27	186	26.6	30	30	29	188
												11746	16.5	1	19.8	33.1	35	35	30	186	34.4	35	35	32	188
												12846	27.8	1	33.4	50.1	60	60	46	186	51.4	60	60	47	188
												13346	33	1	39.7	58	60	60	53	186	59.3	60	60	55	188
												14246	41.7	2	50.2	71.1	80	80	65	186	72.4	80	80	67	188
	575-3-60	6	47.8	9	6	47.8	9	2.2	5.4	0.4	—	None	—	—	—	21.1	25	25	23	147	21.9	25	25	23	149
												11758	17	1	16.4	27.3	30	30	25	147	28.3	30	30	26	149
												13458	34	1	32.7	47.6	50	50	44	147	48.6	50	50	45	149

- 1 Minimum circuit ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZY04 to 12 high indoor blower - with powered convenience outlet

**Table 169: ZY04 to 12 high indoor blower - with powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
04 (3)	208-3-60	10.4	73	16	—	—	—	1.3	5.2	1.1	8.6	None	—	—	—	23.8	25	30	24	103	24.9	25	35	26	105
												10625	4.9	1	13.6	28.9	30	30	27	103					
												11125	7.9	1	21.9	39.3	40	40	36	103					
												11625	12	1	33.3	53.5	60	60	49	103					
	230-3-60	10.4	73	16	—	—	—	1.4	5.2	1	8.6	None	—	—	—	23.9	25	30	24	106	24.9	25	35	26	108
												10625	6.5	1	15.6	31.4	35	35	29	106					
												11125	10.5	1	25.3	43.5	45	45	40	106					
												11625	16	1	38.5	60	60	60	55	106					
	460-3-60	5.8	38	9	—	—	—	0.8	2.6	0.5	8.6	None	—	—	—	12.9	15	15	13	54	13.4	15	15	14	56
												10646	6	1	7.2	14.9	15	15	14	54					
												11146	11.5	1	13.8	23.2	25	25	21	54					
												11446	14	1	16.8	26.9	30	30	25	54					
	575-3-60	3.8	36.5	6	—	—	—	0.6	2	0.4	8.6	None	—	—	—	9.1	15	15	9	50	9.5	15	15	10	51
												11058	9.2	1	8.9	15.8	20	20	15	50					
												11458	13.8	1	13.3	21.3	25	25	20	50					
												None	—	—	—	30.2	35	40	31	139	31.3	35	45	32	141
05 (4)	208-3-60	13.7	83.1	21	—	—	—	1.3	7.5	1.1	8.6	10625	4.9	1	13.6	31.8	35	40	31	139					
												11125	7.9	1	21.9	42.1	45	45	39	139					
												11625	12	1	33.3	56.4	60	60	52	139					
												None	—	—	—	30.3	35	40	31	146	31.3	35	45	32	148
	230-3-60	13.7	83.1	21	—	—	—	1.4	7.5	1	8.6	10625	6.5	1	15.6	34.3	35	40	32	146					
												11125	10.5	1	25.3	46.4	50	50	43	146					
												11625	16	1	38.5	62.9	70	70	58	146					
												None	—	—	—	14.2	15	20	14	72	14.7	15	20	15	74
	460-3-60	6.2	41	10	—	—	—	0.8	3.4	0.5	8.6	10646	6	1	7.2	15.9	20	20	15	72					
												11146	11.5	1	13.8	24.2	25	25	22	72					
												11446	14	1	16.8	27.9	30	30	26	72					
	575-3-60	4.8	33	8	—	—	—	0.6	2.8	0.4	8.6	None	—	—	—	11.1	15	15	11	58	11.5	15	15	12	59
												11058	9.2	1	8.9	16.8	20	20	15	58					
												11458	13.8	1	13.3	22.3	25	25	20	58					
												None	—	—	—	35.1	40	50	36	196	36.2	40	50	37	198
06 (5)	208-3-60	15.9	110	25	—	—	—	2	8.9	1.1	8.6	10625	4.9	1	13.6	35.1	40	50	36	196					
												11125	7.9	1	21.9	43.9	45	50	40	196					
												11625	12	1	33.3	58.1	60	60	53	196					
												None	—	—	—	34.7	35	50	35	198	35.7	40	50	36	201
	230-3-60	15.9	110	25	—	—	—	2.3	8.2	1	8.6	10625	6.5	1	15.6	35.1	40	50	35	198					
												11125	10.5	1	25.3	47.3	50	50	43	198					
												11625	16	1	38.5	63.8	70	70	59	198					
												None	—	—	—	16.5	20	20	17	92	17	20	20	17	93
	460-3-60	7.1	52	11	—	—	—	1.3	4.1	0.5	8.6	10646	6	1	7.2	16.8	20	20	15	92					
												11146	11.5	1	13.8	25.1	30	30	23	92					
												11446	14	1	16.8	28.8	30	30	27	92					
	575-3-60	5.1	39.5	8	—	—	—	1	3.2	0.4	8.6	None	—	—	—	12.3	15	15	13	70	12.7	15	15	13	71
												11458	13.8	1	13.3	22.8	25	25	21	70					
												12358	23	1	22.1	33.8	35	35	31	70					
												None	—	—	—	35.1	40	50	36	196					

**Table 169: ZY04 to 12 high indoor blower - with powered convenience outlet (without VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	10.2	1.1	8.6	None	—	—	—	40.5	45	50	42	212	42.7	45	50	44	217
												10725	4.9	1	13.6	40.5	45	50	42	212	42.7	45	50	44	217
												11725	12	1	33.3	59.8	60	60	55	212	62.5	70	70	58	217
												12525	18.6	1	51.6	82.6	90	90	76	212	85.4	90	90	79	217
	230-3-60	17.6	136	27	—	—	—	2.3	10.2	1	8.6	None	—	—	—	41.1	45	50	42	219	43.1	45	60	45	224
												10725	6.5	1	15.6	41.1	45	50	42	219	43.1	45	60	45	224
												11725	16	1	38.5	66.3	70	70	61	219	68.8	70	70	63	224
												12525	24.8	1	59.7	92.8	100	100	85	219	95.3	100	100	88	224
	460-3-60	8.5	66.1	13	—	—	—	1.3	4.8	0.5	8.6	None	—	—	—	20.2	25	25	21	109	21.2	25	25	22	111
												10746	6	1	7.2	20.2	25	25	16	109	21.2	25	25	17	111
												11746	16.5	1	19.8	33.4	35	35	31	109	34.7	35	35	32	111
												12646	25.5	1	30.7	47.1	50	50	43	109	48.3	50	50	44	111
	575-3-60	6.3	55.3	10	—	—	—	1	3.4	0.4	8.6	None	—	—	—	15	20	20	15	89	15.8	20	20	16	91
												11758	17	1	16.4	26.9	30	30	25	89	27.9	30	30	26	91
												12658	25.7	1	24.7	37.3	40	40	34	89	38.3	40	40	35	91

- 1 Minimum Circuit Ampacity.
- 2 Dual Element, Time Delay Type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 170: ZY04 to 12 high indoor blower - with powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
A7 (6)	208-3-60	17.6	136	27	—	—	—	2	9.9	1.1	8.6	None	—	—	—	40.2	45	50	41	222	42.4	45	50	44	227
												10725	4.9	1	13.6	40.2	45	50	41	222	42.4	45	50	44	227
												11725	12	1	33.3	59.4	60	60	55	222	62.1	70	70	57	227
												12525	18.6	1	51.6	82.3	90	90	76	222	85	90	90	78	227
	230-3-60	17.6	136	27	—	—	—	2.3	9.4	1	8.6	None	—	—	—	40.3	45	50	41	231	42.3	45	50	44	235
												10725	6.5	1	15.6	40.3	45	50	41	231	42.3	45	50	44	235
												11725	16	1	38.5	65.3	70	70	60	231	67.8	70	70	62	235
												12525	24.8	1	59.7	91.8	100	100	84	231	94.3	100	100	87	235
	460-3-60	8.5	66.1	13	—	—	—	1.3	4.7	0.5	8.6	None	—	—	—	20.1	25	25	21	114	21.1	25	25	22	117
												10746	6	1	7.2	20.1	25	25	16	114	21.1	25	25	17	117
												11746	16.5	1	19.8	33.3	35	35	31	114	34.6	35	35	32	117
												12646	25.5	1	30.7	46.9	50	50	43	114	48.2	50	50	44	117
	575-3-60	6.3	55.3	10	—	—	—	1	4.3	0.4	8.6	None	—	—	—	15.9	20	20	16	102	16.7	20	20	17	103
												11758	17	1	16.4	28	30	30	26	102	29	30	30	27	103
												12658	25.7	1	24.7	38.4	40	40	35	102	39.4	40	40	36	103
												None	—	—	—	47	50	50	50	326	49.2	50	60	53	331
08 (7.5)	208-3-60	12.8	120.4	20	12.8	120.4	20	2	9.9	1.1	8.6	11725	12	1	33.3	59.4	60	60	55	326	62.1	70	70	57	331
												12525	18.6	1	51.6	82.3	90	90	76	326	85	90	90	78	331
												13225	24	1	66.6	101	110	110	93	326	103.8	110	110	95	331
												14225	31.8	2	88.3	128.1	150	150	118	326	130.9	150	150	120	331
												None	—	—	—	47.1	50	50	50	336	49.1	50	60	53	340
	230-3-60	12.8	120.4	20	12.8	120.4	20	2.3	9.4	1	8.6	11725	16	1	38.5	65.3	70	70	60	336	67.8	70	70	62	340
												12525	24.8	1	59.7	91.8	100	100	84	336	94.3	100	100	87	340
												13225	32	1	77	113.4	125	125	104	336	115.9	125	125	107	340
												14225	42.4	2	102	144.6	150	150	133	336	147.1	150	150	135	340
												None	—	—	—	23.9	25	30	26	158	24.9	25	30	27	161
	460-3-60	6.4	55.1	10	6.4	55.1	10	1.3	4.7	0.5	8.6	11746	16.5	1	19.8	33.3	35	35	31	158	34.6	35	35	32	161
												12846	27.8	1	33.4	50.3	60	60	46	158	51.6	60	60	47	161
												13346	33	1	39.7	58.2	60	60	54	158	59.4	60	60	55	161
												14246	41.7	2	50.2	71.3	80	80	66	158	72.6	80	80	67	161
												None	—	—	—	20.2	25	25	22	128	21	25	25	23	130
	575-3-60	5.4	41	9	5.4	41	9	1	4.3	0.4	8.6	11758	17	1	16.4	28	30	30	26	128	29	30	30	27	130
												13458	34	1	32.7	48.4	50	50	45	128	49.4	50	50	45	130
												None	—	—	—	49	50	60	52	252	51.2	60	60	55	257
												11725	12	1	33.3	59.4	60	60	55	252	62.1	70	70	57	257
												12525	18.6	1	51.6	82.3	90	90	76	252	85	90	90	78	257
09 (8.5)	208-3-60	13.7	83.1	21	13.7	83.1	21	2	9.9	1.1	8.6	13225	24	1	66.6	101	110	110	93	252	103.8	110	110	95	257
												14225	31.8	2	88.3	128.1	150	150	118	252	130.9	150	150	120	257
												None	—	—	—	49.1	50	60	53	261	51.1	60	60	55	266
												11725	16	1	38.5	65.3	70	70	60	261	67.8	70	70	62	266
												12525	24.8	1	59.7	91.8	100	100	84	261	94.3	100	100	87	266
	230-3-60	13.7	83.1	21	13.7	83.1	21	2.3	9.4	1	8.6	13225	32	1	77	113.4	125	125	104	261	115.9	125	125	107	266
												14225	42.4	2	102	144.6	150	150	133	261	147.1	150	150	135	266
												None	—	—	—	23.5	25	25	25	130	24.5	25	25	26	132
												11746	16.5	1	19.8	33.3	35	35	31	130	34.6	35	35	32	132
												12846	27.8	1	33.4	50.3	60	60	46	130	51.6	60	60	47	132
	460-3-60	6.2	41	10	6.2	41	10	1.3	4.7	0.5	8.6	13346	33	1	39.7	58.2	60	60	54	130	59.4	60	60	55	132
												14246	41.7	2	50.2	71.3	80	80	66	130	72.6	80	80	67	132
												None	—	—	—	18.8	20	20	20	112	19.6	20	20	21	114
												11758	17	1	16.4	28	30	30	26	112	29	30	30	27	114
												13458	34	1	32.7	48.4	50	50	45	112	49.4	50	50	45	114

**Table 170: ZY04 to 12 high indoor blower - with powered convenience outlet (with VFD)**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
12 (10)	208-3-60	15.4	155	24	15.4	155	24	5.8	13.5	1.1	8.6	None	—	—	—	58.3	60	70	63	439	60.5	70	70	65	444
												11725	12	1	33.3	63.9	70	70	63	439	66.6	70	70	65	444
												12525	18.6	1	51.6	86.8	90	90	80	439	89.5	90	90	82	444
												13225	24	1	66.6	105.5	110	110	97	439	108.3	110	110	100	444
												14225	31.8	2	88.3	132.6	150	150	122	439	135.4	150	150	125	444
	230-3-60	15.4	155	24	15.4	155	24	5.2	13.4	1	8.6	None	—	—	—	57.6	60	70	62	435	59.6	60	70	64	440
												11725	16	1	38.5	70.3	80	80	65	435	72.8	80	80	67	440
												12525	24.8	1	59.7	96.8	100	100	89	435	99.3	100	100	91	440
												13225	32	1	77	118.4	125	125	109	435	120.9	125	125	111	440
												14225	42.4	2	102	149.6	150	150	138	435	152.1	175	175	140	440
	460-3-60	7.1	62	11	7.1	62	11	2.9	6.7	0.5	8.6	None	—	—	—	27.8	30	30	30	188	28.8	30	30	31	190
												11746	16.5	1	19.8	35.8	40	40	33	188	37.1	40	40	34	190
												12846	27.8	1	33.4	52.8	60	60	49	188	54.1	60	60	50	190
												13346	33	1	39.7	60.7	70	70	56	188	61.9	70	70	57	190
												14246	41.7	2	50.2	73.8	80	80	68	188	75.1	80	80	69	190
	575-3-60	6	47.8	9	6	47.8	9	2.2	5.4	0.4	8.6	None	—	—	—	22.8	25	25	24	149	23.6	25	25	25	150
												11758	17	1	16.4	29.4	30	30	27	149	30.4	35	35	28	150
												13458	34	1	32.7	49.8	50	50	46	149	50.8	60	60	47	150

- 1 Minimum Circuit Ampacity.
- 2 Dual Element, Time Delay Type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is correctly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL04 to 06 standard indoor blowers - without powered convenience outlet

**Table 171: ZL04 to 06 standard static indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
04 (3)	208-1-60	14.1	84.2	22				2.8	6.6	1.5		None	—	—	—	27	30	40	27	86	28.5	30	40	29	90
												10625	4.9	1	23.6	37.8	40	40	35	86	39.6	40	40	36	90
												11125	7.9	1	38	55.8	60	60	51	86	57.6	60	60	53	90
	230-1-60	14.1	84.2	22				2.8	6	1.3		None	—	—	—	26.4	30	40	26	86	27.7	30	40	28	89
												10625	6.5	1	27.1	41.4	45	45	38	86	43	45	45	40	89
												11125	10.5	1	43.8	62.3	70	70	57	86	63.9	70	70	59	89
	208-3-60	9.6	73.8	15				2.8	6.6	1.1		None	—	—	—	21.4	25	30	22	76	22.5	25	30	23	78
												10625	4.9	1	13.6	25.3	30	30	23	76	26.6	30	30	24	78
												11125	7.9	1	21.9	35.6	40	40	33	76	37	40	40	34	78
	230-3-60	9.6	73.8	15				2.8	6	1		11625	12	1	33.3	49.9	50	50	46	76	51.3	60	60	47	78
												None	—	—	—	20.8	25	30	21	76	21.8	25	30	22	78
												10625	6.5	1	15.6	27	30	30	25	76	28.3	30	30	26	78
	460-3-60	5.1	37	8				1.6	3.2	0.5		11125	10.5	1	25.3	39.1	40	40	36	76	40.4	45	45	37	78
												11625	16	1	38.5	55.6	60	60	51	76	56.9	60	60	52	78
												None	—	—	—	11.2	15	15	11	39	11.7	15	15	12	40
	575-3-60	3.2	26	5				2.8	6	0.4		10646	6	1	7.2	13	15	15	12	39	13.6	15	15	13	40
												11146	11.5	1	13.8	21.3	25	25	20	39	21.9	25	25	20	40
												11446	14	1	16.8	25	25	25	23	39	25.6	30	30	24	40
05 (4)	208-3-60	14	83.1	22				2.8	8.4	1.1		None	—	—	—	9.2	15	15	10	27	9.6	15	15	10	28
												11058	9.2	1	8.9	14.1	15	15	13	27	14.6	15	15	13	28
												11458	13.8	1	13.3	19.6	20	20	18	27	20.1	25	25	19	28
	230-3-60	14	83.1	22				2.8	7.6	1		None	—	—	—	28.7	30	40	29	85	29.8	30	40	30	88
												10625	4.9	1	13.6	28.7	30	40	29	85	29.8	30	40	30	88
												11125	7.9	1	21.9	37.9	40	40	35	85	39.3	40	40	36	88
	460-3-60	6.4	41	10				1.6	4	0.5		11625	12	1	33.3	52.1	60	60	48	85	53.5	60	60	49	88
												None	—	—	—	27.9	30	40	28	85	28.9	30	40	29	87
												10625	6.5	1	15.6	29	30	40	28	85	30.3	35	40	29	87
	575-3-60	4.6	33	7				2.8	7.6	0.4		11125	10.5	1	25.3	41.1	45	45	38	85	42.4	45	45	39	87
												11625	16	1	38.5	57.6	60	60	53	85	58.9	60	60	54	87
												None	—	—	—	13.6	15	20	14	43	14.1	15	20	14	44
												10646	6	1	7.2	14	15	20	13	43	14.6	15	20	13	44
												11146	11.5	1	13.8	22.3	25	25	20	43	22.9	25	25	21	44
												11446	14	1	16.8	26	30	30	24	43	26.6	30	30	24	44
												None	—	—	—	11.6	15	15	12	34	12	15	15	12	35
												11058	9.2	1	8.9	14.9	15	15	14	34	15.4	20	20	14	35
												11458	13.8	1	13.3	20.4	25	25	19	34	20.9	25	25	19	35



**Table 171: ZL04 to 06 standard static indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating / power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-3-60	16.2	110	25				2.8	8.4	1.1		None	—	—	—	31.5	35	45	32	112	32.6	35	45	33	115
												10625	4.9	1	13.6	31.5	35	45	32	112	32.6	35	45	33	115
												11125	7.9	1	21.9	37.9	40	45	35	112	39.3	40	45	36	115
												11625	12	1	33.3	52.1	60	60	48	112	53.5	60	60	49	115
	230-3-60	16.2	110	25				2.8	7.6	1		None	—	—	—	30.7	35	45	31	112	31.7	35	45	32	114
												10625	6.5	1	15.6	30.7	35	45	31	112	31.7	35	45	32	114
												11125	10.5	1	25.3	41.1	45	45	38	112	42.4	45	45	39	114
												11625	16	1	38.5	57.6	60	60	53	112	58.9	60	60	54	114
	460-3-60	7.6	52	12				1.6	4	0.5		None	—	—	—	15.1	20	20	15	54	15.6	20	20	16	55
												10646	6	1	7.2	15.1	20	20	13	54	15.6	20	20	13	55
												11146	11.5	1	13.8	22.3	25	25	20	54	22.9	25	25	21	55
												11446	14	1	16.8	26	30	30	24	54	26.6	30	30	24	55
	575-3-60	5.1	43.8	8				2.8	7.6	0.4		None	—	—	—	12.2	15	15	13	45	12.6	15	15	13	46
												11458	13.8	1	13.3	20.4	25	25	19	45	20.9	25	25	19	46
												12358	23	1	22.1	31.4	35	35	29	45	31.9	35	35	29	46

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL04 to 06 standard indoor blower

**Table 172: ZL04 to 06 standard indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
04 (3)	208-1-60	14.1	84.2	22				2.8	6.6	1.5	8.6	None	—	—	—	31.3	35	45	32	91	32.8	35	45	34	94
												10625	4.9	1	23.6	43.1	45	45	40	91	45	45	45	41	94
												11125	7.9	1	38	61.1	70	70	56	91	63	70	70	58	94
	230-1-60	14.1	84.2	22				2.8	6	1.3	8.6	None	—	—	—	30.7	35	40	31	91	32	35	45	33	93
												10625	6.5	1	27.1	46.8	50	50	43	91	48.4	50	50	45	93
												11125	10.5	1	43.8	67.6	70	70	62	91	69.3	70	70	64	93
	208-3-60	9.6	73.8	15				2.8	6.6	1.1	8.6	None	—	—	—	25.7	30	35	27	80	26.8	30	35	28	83
												10625	4.9	1	13.6	30.6	35	35	28	80	32	35	35	29	83
												11125	7.9	1	21.9	41	45	45	38	80	42.4	45	45	39	83
	230-3-60	9.6	73.8	15				2.8	6	1	8.6	11625	12	1	33.3	55.3	60	60	51	80	56.6	60	60	52	83
												None	—	—	—	25.1	30	30	26	80	26.1	30	35	27	82
												10625	6.5	1	15.6	32.4	35	35	30	80	33.6	35	35	31	82
	460-3-60	5.1	37	8				1.6	3.2	0.5	8.6	11125	10.5	1	25.3	44.5	45	45	41	80	45.8	50	50	42	82
												11625	16	1	38.5	61	70	70	56	80	62.3	70	70	57	82
												None	—	—	—	13.4	15	15	14	41	13.9	15	15	14	42
	575-3-60	3.2	26	5				2.8	6	0.4	8.6	10646	6	1	7.2	15.7	20	20	14	41	16.3	20	20	15	42
												11146	11.5	1	13.8	23.9	25	25	22	41	24.6	25	25	23	42
												11446	14	1	16.8	27.7	30	30	25	41	28.3	30	30	26	42
05 (4)	208-3-60	14	83.1	22				2.8	8.4	1.1	8.6	None	—	—	—	10.9	15	15	12	29	11.3	15	15	12	29
												11058	9.2	1	8.9	16.3	20	20	15	29	16.8	20	20	15	29
												11458	13.8	1	13.3	21.8	25	25	20	29	22.3	25	25	20	29
	230-3-60	14	83.1	22				2.8	7.6	1	8.6	None	—	—	—	33	35	45	34	89	34.1	35	45	35	92
												10625	4.9	1	13.6	33	35	45	34	89	34.3	35	45	35	92
												11125	7.9	1	21.9	43.3	45	45	40	89	44.6	45	45	41	92
	460-3-60	6.4	41	10				1.6	4	0.5	8.6	11625	12	1	33.3	57.5	60	60	53	89	58.9	60	60	54	92
												None	—	—	—	32.2	35	45	33	89	33.2	35	45	34	92
												10625	6.5	1	15.6	34.4	35	45	33	89	35.6	40	45	34	92
	575-3-60	4.6	33	7				2.8	7.6	0.4	8.6	11125	10.5	1	25.3	46.5	50	50	43	89	47.8	50	50	44	92
												11625	16	1	38.5	63	70	70	58	89	64.3	70	70	59	92
												None	—	—	—	15.8	20	20	16	45	16.3	20	20	17	46
												10646	6	1	7.2	16.7	20	20	15	45	17.3	20	20	16	46
												11146	11.5	1	13.8	24.9	25	25	23	45	25.6	30	30	24	46
												11446	14	1	16.8	28.7	30	30	26	45	29.3	30	30	27	46
												None	—	—	—	13.4	15	15	14	36	13.8	15	15	14	36
												11058	9.2	1	8.9	17.1	20	20	16	36	17.6	20	20	16	36
												11458	13.8	1	13.3	22.6	25	25	21	36	23.1	25	25	21	36

**Table 172: ZL04 to 06 standard indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-3-60	16.2	110	25				2.8	8.4	1.1	8.6	None	—	—	—	35.8	40	50	36	116	36.9	40	50	38	119
												10625	4.9	1	13.6	35.8	40	50	36	116	36.9	40	50	38	119
												11125	7.9	1	21.9	43.3	45	50	40	116	44.6	45	50	41	119
												11625	12	1	33.3	57.5	60	60	53	116	58.9	60	60	54	119
	230-3-60	16.2	110	25				2.8	7.6	1	8.6	None	—	—	—	35	35	50	36	116	36	40	50	37	119
												10625	6.5	1	15.6	35	35	50	36	116	36	40	50	37	119
												11125	10.5	1	25.3	46.5	50	50	43	116	47.8	50	50	44	119
												11625	16	1	38.5	63	70	70	58	116	64.3	70	70	59	119
	460-3-60	7.6	52	12				1.6	4	0.5	8.6	None	—	—	—	17.3	20	20	18	56	17.8	20	20	18	57
												10646	6	1	7.2	17.3	20	20	15	56	17.8	20	20	16	57
												11146	11.5	1	13.8	24.9	25	25	23	56	25.6	30	30	24	57
												11446	14	1	16.8	28.7	30	30	26	56	29.3	30	30	27	57
	575-3-60	5.1	43.8	8				2.8	7.6	0.4	8.6	None	—	—	—	14	15	15	15	46	14.4	15	15	15	47
												11458	13.8	1	13.3	22.6	25	25	21	46	23.1	25	25	21	47
												12358	23	1	22.1	33.6	35	35	31	46	34.1	35	35	31	47

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 173: ZL04 to 06 standard static indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				<sup>1</sup> MCA' (amps)	<sup>2,3</sup> Min fuse' / breaker <sup>3</sup> size (amps)	<sup>4</sup> Min disconnect' rating		MCA' w/power exh (amps)		Min fuse' / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse' / breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect' rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps			FLA	LRA	Min fuse' / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse' / breaker <sup>3</sup> size w/ power exh (amps)	FLA	LRA		
04 (3)	208-1-60	14.1	84.2	22				2.8	6.6	1.5		None	—	—	—	27	30	40	27	86	28.5	30	40	29	90
												10625	4.9	1	23.6	37.8	40	40	35	86	39.6	40	40	36	90
												11125	7.9	1	38	55.8	60	60	51	86	57.6	60	60	53	90
	230-1-60	14.1	84.2	22				2.8	6	1.3		None	—	—	—	26.4	30	40	26	86	27.7	30	40	28	89
												10625	6.5	1	27.1	41.4	45	45	38	86	43	45	45	40	89
												11125	10.5	1	43.8	62.3	70	70	57	86	63.9	70	70	59	89
	208-3-60	9.6	73.8	15				2.8	6.6	1.1		None	—	—	—	21.4	25	30	22	76	22.5	25	30	23	78
												10625	4.9	1	13.6	25.3	30	30	23	76	26.6	30	30	24	78
												11125	7.9	1	21.9	35.6	40	40	33	76	37	40	40	34	78
	230-3-60	9.6	73.8	15				2.8	6	1		11625	12	1	33.3	49.9	50	50	46	76	51.3	60	60	47	78
												None	—	—	—	20.8	25	30	21	76	21.8	25	30	22	78
												10625	6.5	1	15.6	27	30	30	25	76	28.3	30	30	26	78
	460-3-60	5.1	37	8				1.6	3.2	0.5		11125	10.5	1	25.3	39.1	40	40	36	76	40.4	45	45	37	78
												11625	16	1	38.5	55.6	60	60	51	76	56.9	60	60	52	78
												None	—	—	—	11.2	15	15	11	39	11.7	15	15	12	40
	575-3-60	3.2	26	5				2.8	6	0.4		10646	6	1	7.2	13	15	15	12	39	13.6	15	15	13	40
												11146	11.5	1	13.8	21.3	25	25	20	39	21.9	25	25	20	40
												11446	14	1	16.8	25	25	25	23	39	25.6	30	30	24	40
05 (4)	208-3-60	14	83.1	22				2.8	8.4	1.1		None	—	—	—	9.2	15	15	10	27	9.6	15	15	10	28
												11058	9.2	1	8.9	14.1	15	15	13	27	14.6	15	15	13	28
												11458	13.8	1	13.3	19.6	20	20	18	27	20.1	25	25	19	28
	230-3-60	14	83.1	22				2.8	7.6	1		None	—	—	—	28.7	30	40	29	85	29.8	30	40	30	88
												10625	4.9	1	13.6	28.7	30	40	29	85	29.8	30	40	30	88
												11125	7.9	1	21.9	37.9	40	40	35	85	39.3	40	40	36	88
	460-3-60	6.4	41	10				1.6	4	0.5		11625	12	1	33.3	52.1	60	60	48	85	53.5	60	60	49	88
												None	—	—	—	27.9	30	40	28	85	28.9	30	40	29	87
												10625	6.5	1	15.6	29	30	40	28	85	30.3	35	40	29	87
	575-3-60	4.6	33	7				2.8	7.6	0.4		11125	10.5	1	25.3	41.1	45	45	38	85	42.4	45	45	39	87
												11625	16	1	38.5	57.6	60	60	53	85	58.9	60	60	54	87
												None	—	—	—	13.6	15	20	14	43	14.1	15	20	14	44
												10646	6	1	7.2	14	15	20	13	43	14.6	15	20	13	44
												11146	11.5	1	13.8	22.3	25	25	20	43	22.9	25	25	21	44
												11446	14	1	16.8	26	30	30	24	43	26.6	30	30	24	44
												None	—	—	—	11.6	15	15	12	34	12	15	15	12	35
												11058	9.2	1	8.9	14.9	15	15	14	34	15.4	20	20	14	35
												11458	13.8	1	13.3	20.4	25	25	19	34	20.9	25	25	19	35

**Table 173: ZL04 to 06 standard static indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				<sup>1</sup> MCA' (amps)	<sup>2,3</sup> Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	<sup>4</sup> Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)		Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	FLA	LRA				
06 (5)	208-3-60	16.2	110	25				2.8	8.4	1.1		None	—	—	—	31.5	35	45	32	112	32.6	35	45	33	115			
												10625	4.9	1	13.6	31.5	35	45	32	112	32.6	35	45	33	115			
												11125	7.9	1	21.9	37.9	40	45	35	112	39.3	40	45	36	115			
												11625	12	1	33.3	52.1	60	60	48	112	53.5	60	60	49	115			
	230-3-60	16.2	110	25				2.8	7.6	1		None	—	—	—	30.7	35	45	31	112	31.7	35	45	32	114			
												10625	6.5	1	15.6	30.7	35	45	31	112	31.7	35	45	32	114			
												11125	10.5	1	25.3	41.1	45	45	38	112	42.4	45	45	39	114			
												11625	16	1	38.5	57.6	60	60	53	112	58.9	60	60	54	114			
	460-3-60	7.6	52	12				1.6	4	0.5		None	—	—	—	15.1	20	20	15	54	15.6	20	20	16	55			
												10646	6	1	7.2	15.1	20	20	13	54	15.6	20	20	13	55			
												11146	11.5	1	13.8	22.3	25	25	20	54	22.9	25	25	21	55			
												11446	14	1	16.8	26	30	30	24	54	26.6	30	30	24	55			
	575-3-60	5.1	43.8	8				2.8	7.6	0.4		None	—	—	—	12.2	15	15	13	45	12.6	15	15	13	46			
												11458	13.8	1	13.3	20.4	25	25	19	45	20.9	25	25	19	46			
												12358	23	1	22.1	31.4	35	35	29	45	31.9	35	35	29	46			

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL04 to 06 medium indoor blower - without powered convenience outlet

**Table 174: ZL04 to 06 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power Exh (Amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)		Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	FLA	LRA		
04 (3)	208-1-60	14.1	84.2	22				2.8	7	1.5		None	—	—	—	27.4	30	40	27	144	28.9	30	40	29	148	
												10625	4.9	1	23.6	38.3	40	40	35	144	40.1	45	45	37	148	
												11125	7.9	1	38	56.3	60	60	52	144	58.1	60	60	53	148	
	230-1-60	14.1	84.2	22				2.8	7.2	1.3		None	—	—	—	27.6	30	40	28	146	28.9	30	40	29	149	
												10625	6.5	1	27.1	42.9	45	45	39	146	44.5	45	45	41	149	
												11125	10.5	1	43.8	63.8	70	70	59	146	65.4	70	70	60	149	
	208-3-60	9.6	73.8	15				2.8	7	1.1		None	—	—	—	21.8	25	30	22	134	22.9	25	30	24	136	
												10625	4.9	1	13.6	25.8	30	30	24	134	27.1	30	30	25	136	
												11125	7.9	1	21.9	36.1	40	40	33	134	37.5	40	40	35	136	
	230-3-60	9.6	73.8	15				2.8	7.2	1		11625	12	1	33.3	50.4	60	60	46	134	51.8	60	60	48	136	
												None	—	—	—	22	25	30	23	136	23	25	30	24	138	
												10625	6.5	1	15.6	28.5	30	30	26	136	29.8	30	30	27	138	
	460-3-60	5.1	37	8				1.6	3.6	0.5		11125	10.5	1	25.3	40.6	45	45	37	136	41.9	45	45	39	138	
												11625	16	1	38.5	57.1	60	60	53	136	58.4	60	60	54	138	
												None	—	—	—	11.6	15	15	12	68	12.1	15	15	12	69	
	575-3-60	3.2	26	5				2.8	2.5	0.4		10646	6	1	7.2	13.5	15	15	12	68	14.1	15	15	13	69	
												11146	11.5	1	13.8	21.8	25	25	20	68	22.4	25	25	21	69	
												11446	14	1	16.8	25.5	30	30	23	68	26.1	30	30	24	69	
05 (4)	208-3-60	14	83.1	22				2.8	7	1.1		None	—	—	—	9.3	15	15	10	44	9.7	15	15	10	45	
												11058	9.2	1	8.9	14.3	15	15	13	44	14.8	15	15	14	45	
												11458	13.8	1	13.3	19.8	20	20	18	44	20.3	25	25	19	45	
	230-3-60	14	83.1	22				2.8	7.2	1		None	—	—	—	27.3	30	40	27	143	28.4	30	40	29	146	
												10625	4.9	1	13.6	27.3	30	40	27	143	28.4	30	40	29	146	
												11125	7.9	1	21.9	36.1	40	40	33	143	37.5	40	40	35	146	
	460-3-60	6.4	41	10				1.6	3.6	0.5		11625	12	1	33.3	50.4	60	60	46	143	51.8	60	60	48	146	
												None	—	—	—	27.5	30	40	28	145	28.5	30	40	29	147	
												10625	6.5	1	15.6	28.5	30	40	28	145	29.8	30	40	29	147	
	575-3-60	4.6	33	7				2.8	2.5	0.4		11125	10.5	1	25.3	40.6	45	45	37	145	41.9	45	45	39	147	
												11625	16	1	38.5	57.1	60	60	53	145	58.4	60	60	54	147	
												None	—	—	—	13.2	15	15	13	72	13.7	15	15	14	73	
												10646	6	1	7.2	13.5	15	15	12	72	14.1	15	15	13	73	
												11146	11.5	1	13.8	21.8	25	25	20	72	22.4	25	25	21	73	
												11446	14	1	16.8	25.5	30	30	23	72	26.1	30	30	24	73	
												None	—	—	—	11.1	15	15	11	51	11.5	15	15	12	52	
												11058	9.2	1	8.9	14.3	15	15	13	51	14.8	15	15	14	52	
												11458	13.8	1	13.3	19.8	20	20	18	51	20.3	25	25	19	52	

**Table 174: ZL04 to 06 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker size (amps)	Max fuse/ breaker size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power Exh (Amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-3-60	16.2	110	25				2.8	7	1.1		None	—	—	—	30.1	35	45	30	170	31.2	35	45	31	173
												10625	4.9	1	13.6	30.1	35	45	30	170	31.2	35	45	31	173
												11125	7.9	1	21.9	36.1	40	45	33	170	37.5	40	45	35	173
												11625	12	1	33.3	50.4	60	60	46	170	51.8	60	60	48	173
	230-3-60	16.2	110	25				2.8	7.2	1		None	—	—	—	30.3	35	45	30	172	31.3	35	45	31	174
												10625	6.5	1	15.6	30.3	35	45	30	172	31.3	35	45	31	174
												11125	10.5	1	25.3	40.6	45	45	37	172	41.9	45	45	39	174
												11625	16	1	38.5	57.1	60	60	53	172	58.4	60	60	54	174
	460-3-60	7.6	52	12				1.6	3.6	0.5		None	—	—	—	14.7	15	20	15	83	15.2	20	20	15	84
												10646	6	1	7.2	14.7	15	20	12	83	15.2	20	20	13	84
												11146	11.5	1	13.8	21.8	25	25	20	83	22.4	25	25	21	84
												11446	14	1	16.8	25.5	30	30	23	83	26.1	30	30	24	84
	575-3-60	5.1	43.8	8				2.8	2.5	0.4		None	—	—	—	11.7	15	15	12	62	12.1	15	15	12	62
												11458	13.8	1	13.3	19.8	20	20	18	62	20.3	25	25	19	62
												12358	23	1	22.1	30.8	35	35	28	62	31.3	35	35	29	62

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL04 to 06 medium indoor blower

**Table 175: ZL04 to 06 medium indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)		Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	FLA	LRA
04 (3)	208-1-60	14.1	84.2	22				2.8	7	1.5	8.6	None	—	—	—	31.7	35	45	32	149	33.2	35	45	34	152
												10625	4.9	1	23.6	43.6	45	45	40	149	45.5	50	50	42	152
												11125	7.9	1	38	61.6	70	70	57	149	63.5	70	70	58	152
	230-1-60	14.1	84.2	22				2.8	7.2	1.3	8.6	None	—	—	—	31.9	35	45	33	150	33.2	35	45	34	153
												10625	6.5	1	27.1	48.3	50	50	44	150	49.9	50	50	46	153
												11125	10.5	1	43.8	69.1	70	70	64	150	70.8	80	80	65	153
	208-3-60	9.6	73.8	15				2.8	7	1.1	8.6	None	—	—	—	26.1	30	35	27	138	27.2	30	35	29	141
												10625	4.9	1	13.6	31.1	35	35	29	138	32.5	35	35	30	141
												11125	7.9	1	21.9	41.5	45	45	38	138	42.9	45	45	39	141
	230-3-60	9.6	73.8	15				2.8	7.2	1	8.6	11625	12	1	33.3	55.8	60	60	51	138	57.1	60	60	53	141
												None	—	—	—	26.3	30	35	27	140	27.3	30	35	29	142
												10625	6.5	1	15.6	33.9	35	35	31	140	35.1	40	40	32	142
	460-3-60	5.1	37	8				1.6	3.6	0.5	8.6	11125	10.5	1	25.3	46	50	50	42	140	47.3	50	50	43	142
												11625	16	1	38.5	62.5	70	70	58	140	63.8	70	70	59	142
												None	—	—	—	13.8	15	15	14	70	14.3	15	15	15	71
	575-3-60	3.2	26	5				2.8	2.5	0.4	8.6	10646	6	1	7.2	16.2	20	20	15	70	16.8	20	20	15	71
												11146	11.5	1	13.8	24.4	25	25	22	70	25.1	30	30	23	71
												11446	14	1	16.8	28.2	30	30	26	70	28.8	30	30	27	71
05 (4)	208-3-60	14	83.1	22				2.8	7	1.1	8.6	None	—	—	—	11	15	15	12	45	11.4	15	15	12	46
												11058	9.2	1	8.9	16.4	20	20	15	45	16.9	20	20	16	46
												11458	13.8	1	13.3	21.9	25	25	20	45	22.4	25	25	21	46
	230-3-60	14	83.1	22				2.8	7.2	1	8.6	None	—	—	—	31.6	35	45	32	148	32.7	35	45	34	150
												10625	4.9	1	13.6	31.6	35	45	32	148	32.7	35	45	34	150
												11125	7.9	1	21.9	41.5	45	45	38	148	42.9	45	45	39	150
	460-3-60	6.4	41	10				1.6	3.6	0.5	8.6	11625	12	1	33.3	55.8	60	60	51	148	57.1	60	60	53	150
												None	—	—	—	31.8	35	45	33	149	32.8	35	45	34	152
												10625	6.5	1	15.6	33.9	35	45	33	149	35.1	40	45	34	152
	575-3-60	4.6	33	7				2.8	2.5	0.4	8.6	11125	10.5	1	25.3	46	50	50	42	149	47.3	50	50	43	152
												11625	16	1	38.5	62.5	70	70	58	149	63.8	70	70	59	152
												None	—	—	—	15.4	20	20	16	74	15.9	20	20	16	75
												10646	6	1	7.2	16.2	20	20	15	74	16.8	20	20	15	75
												11146	11.5	1	13.8	24.4	25	25	22	74	25.1	30	30	23	75
												11446	14	1	16.8	28.2	30	30	26	74	28.8	30	30	27	75
												None	—	—	—	12.8	15	15	13	52	13.2	15	15	14	53
												11058	9.2	1	8.9	16.4	20	20	15	52	16.9	20	20	16	53
												11458	13.8	1	13.3	21.9	25	25	20	52	22.4	25	25	21	53



**Table 175: ZL04 to 06 medium indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
06 (5)	208-3-60	16.2	110	25				2.8	7	1.1	8.6	None	—	—	—	34.4	35	50	35	174	35.5	40	50	36	177
												10625	4.9	1	13.6	34.4	35	50	35	174	35.5	40	50	36	177
												11125	7.9	1	21.9	41.5	45	50	38	174	42.9	45	50	39	177
												11625	12	1	33.3	55.8	60	60	51	174	57.1	60	60	53	177
	230-3-60	16.2	110	25				2.8	7.2	1	8.6	None	—	—	—	34.6	35	50	35	176	35.6	40	50	36	178
												10625	6.5	1	15.6	34.6	35	50	35	176	35.6	40	50	36	178
												11125	10.5	1	25.3	46	50	50	42	176	47.3	50	50	43	178
												11625	16	1	38.5	62.5	70	70	58	176	63.8	70	70	59	178
	460-3-60	7.6	52	12				1.6	3.6	0.5	8.6	None	—	—	—	16.9	20	20	17	85	17.4	20	20	18	86
												10646	6	1	7.2	16.9	20	20	15	85	17.4	20	20	15	86
												11146	11.5	1	13.8	24.4	25	25	22	85	25.1	30	30	23	86
												11446	14	1	16.8	28.2	30	30	26	85	28.8	30	30	27	86
	575-3-60	5.1	43.8	8				2.8	2.5	0.4	8.6	None	—	—	—	13.4	15	15	14	63	13.8	15	15	14	64
												11458	13.8	1	13.3	21.9	25	25	20	63	22.4	25	25	21	64
												12358	23	1	22.1	32.9	35	35	30	63	33.4	35	35	31	64

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 176: ZL04 to 06 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				1'MCA' (amps)	2,3Min fuse / breaker size (amps)	Max fuse/ breaker size (amps)	4 Min disconnect rating		MCA1 w/power Exh (Amps)		Min fuse2 / breaker3 size w/ power exh (amps)	Max fuse2 / breaker3 size w/ power exh (amps)	Min disconnect4 rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	Min fuse2 / breaker3 size w/ power exh (amps)	Max fuse2 / breaker3 size w/ power exh (amps)			FLA	LRA
04 (3)	208-1-60	14.1	84.2	22				2.8	7	1.5		None	—	—	—	27.4	30	40	27	144	28.9	30	40	29	148	
												10625	4.9	1	23.6	38.3	40	40	35	144	40.1	45	45	37	148	
												11125	7.9	1	38	56.3	60	60	52	144	58.1	60	60	53	148	
	230-1-60	14.1	84.2	22				2.8	7.2	1.3		None	—	—	—	27.6	30	40	28	146	28.9	30	40	29	149	
												10625	6.5	1	27.1	42.9	45	45	39	146	44.5	45	45	41	149	
												11125	10.5	1	43.8	63.8	70	70	59	146	65.4	70	70	60	149	
	208-3-60	9.6	73.8	15				2.8	7	1.1		None	—	—	—	21.8	25	30	22	134	22.9	25	30	24	136	
												10625	4.9	1	13.6	25.8	30	30	24	134	27.1	30	30	25	136	
												11125	7.9	1	21.9	36.1	40	40	33	134	37.5	40	40	35	136	
	230-3-60	9.6	73.8	15				2.8	7.2	1		11625	12	1	33.3	50.4	60	60	46	134	51.8	60	60	48	136	
												None	—	—	—	22	25	30	23	136	23	25	30	24	138	
												10625	6.5	1	15.6	28.5	30	30	26	136	29.8	30	30	27	138	
	460-3-60	5.1	37	8				1.6	3.6	0.5		11125	10.5	1	25.3	40.6	45	45	37	136	41.9	45	45	39	138	
												11625	16	1	38.5	57.1	60	60	53	136	58.4	60	60	54	138	
												None	—	—	—	11.6	15	15	12	68	12.1	15	15	12	69	
	575-3-60	3.2	26	5				2.8	2.5	0.4		10646	6	1	7.2	13.5	15	15	12	68	14.1	15	15	13	69	
												11146	11.5	1	13.8	21.8	25	25	20	68	22.4	25	25	21	69	
												11446	14	1	16.8	25.5	30	30	23	68	26.1	30	30	24	69	
05 (4)	208-3-60	14	83.1	22				2.8	7	1.1		None	—	—	—	9.3	15	15	10	44	9.7	15	15	10	45	
												11058	9.2	1	8.9	14.3	15	15	13	44	14.8	15	15	14	45	
												11458	13.8	1	13.3	19.8	20	20	18	44	20.3	25	25	19	45	
	230-3-60	14	83.1	22				2.8	7.2	1		None	—	—	—	27.3	30	40	27	143	28.4	30	40	29	146	
												10625	4.9	1	13.6	27.3	30	40	27	143	28.4	30	40	29	146	
												11125	7.9	1	21.9	36.1	40	40	33	143	37.5	40	40	35	146	
	460-3-60	6.4	41	10				1.6	3.6	0.5		11625	12	1	33.3	50.4	60	60	46	143	51.8	60	60	48	146	
												None	—	—	—	27.5	30	40	28	145	28.5	30	40	29	147	
												10625	6.5	1	15.6	28.5	30	40	28	145	29.8	30	40	29	147	
	575-3-60	4.6	33	7				2.8	2.5	0.4		11125	10.5	1	25.3	40.6	45	45	37	145	41.9	45	45	39	147	
												11625	16	1	38.5	57.1	60	60	53	145	58.4	60	60	54	147	
												None	—	—	—	13.2	15	15	13	72	13.7	15	15	14	73	
												10646	6	1	7.2	13.5	15	15	12	72	14.1	15	15	13	73	
												11146	11.5	1	13.8	21.8	25	25	20	72	22.4	25	25	21	73	
												11446	14	1	16.8	25.5	30	30	23	72	26.1	30	30	24	73	
												None	—	—	—	11.1	15	15	11	51	11.5	15	15	12	52	
												11058	9.2	1	8.9	14.3	15	15	13	51	14.8	15	15	14	52	
												11458	13.8	1	13.3	19.8	20	20	18	51	20.3	25	25	19	52	

**Table 176: ZL04 to 06 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				1'MCA' (amps)	2,3Min fuse 2/ breaker'size (amps)		Max fuse/ breaker size (amps)	4 Min disconnect' rating		MCA' w/power Exh (Amps)		Min fuse2/ breaker' size w/ power exh (amps)		Max fuse2/ breaker' size w/ power exh (amps)		Min disconnect' rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA		Min fuse2/ breaker' size w/ power exh (amps)	Max fuse2/ breaker' size w/ power exh (amps)	FLA	LRA						
06 (5)	208-3-60	16.2	110	25				2.8	7	1.1		None	—	—	—	30.1	35	45	30	170	31.2	35	45	31	173				
												10625	4.9	1	13.6	30.1	35	45	30	170	31.2	35	45	31	173				
												11125	7.9	1	21.9	36.1	40	45	33	170	37.5	40	45	35	173				
												11625	12	1	33.3	50.4	60	60	46	170	51.8	60	60	48	173				
	230-3-60	16.2	110	25				2.8	7.2	1		None	—	—	—	30.3	35	45	30	172	31.3	35	45	31	174				
												10625	6.5	1	15.6	30.3	35	45	30	172	31.3	35	45	31	174				
												11125	10.5	1	25.3	40.6	45	45	37	172	41.9	45	45	39	174				
												11625	16	1	38.5	57.1	60	60	53	172	58.4	60	60	54	174				
	460-3-60	7.6	52	12				1.6	3.6	0.5		None	—	—	—	14.7	15	20	15	83	15.2	20	20	15	84				
												10646	6	1	7.2	14.7	15	20	12	83	15.2	20	20	13	84				
												11146	11.5	1	13.8	21.8	25	25	20	83	22.4	25	25	21	84				
												11446	14	1	16.8	25.5	30	30	23	83	26.1	30	30	24	84				
	575-3-60	5.1	43.8	8				2.8	2.5	0.4		None	—	—	—	11.7	15	15	12	62	12.1	15	15	12	62				
												11458	13.8	1	13.3	19.8	20	20	18	62	20.3	25	25	19	62				
												12358	23	1	22.1	30.8	35	35	28	62	31.3	35	35	29	62				

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL04 to 06 high indoor blower - without powered convenience outlet

**Table 177: ZL04 to 06 high indoor blower - without powered convenience outlet**

Size (tons)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)				Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ power exh		
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA					
04 (3)	208-3-60	9.6	73.8	15				2.8	7	1.1		None	—	—	—	21.8	25	30	22	134	22.9	25	30	24	136	30	30	25	136
												10625	4.9	1	13.6	25.8	30	30	24	134	27.1	30	30	25	136	40	40	35	136
												11125	7.9	1	21.9	36.1	40	40	33	134	37.5	40	40	35	136	40	40	35	136
												11625	12	1	33.3	50.4	60	60	46	134	51.8	60	60	48	136	60	60	48	136
	230-3-60	9.6	73.8	15				2.8	7.2	1		None	—	—	—	22	25	30	23	136	23	25	30	24	138	30	30	27	138
												10625	6.5	1	15.6	28.5	30	30	26	136	29.8	30	30	27	138	40	40	39	138
												11125	10.5	1	25.3	40.6	45	45	37	136	41.9	45	45	39	138	45	45	39	138
												11625	16	1	38.5	57.1	60	60	53	136	58.4	60	60	54	138	60	60	54	138
	460-3-60	5.1	37	8				1.6	3.6	0.5		None	—	—	—	11.6	15	15	12	68	12.1	15	15	12	69	15	15	12	69
												10646	6	1	7.2	13.5	15	15	12	68	14.1	15	15	13	69	15	15	13	69
												11146	11.5	1	13.8	21.8	25	25	20	68	22.4	25	25	21	69	25	25	21	69
												11446	14	1	16.8	25.5	30	30	23	68	26.1	30	30	24	69	30	30	24	69
	575-3-60	3.2	26	5				2.8	2.5	0.4		None	—	—	—	9.3	15	15	10	44	9.7	15	15	10	45	15	15	10	45
												11058	9.2	1	8.9	14.3	15	15	13	44	14.8	15	15	14	45	15	15	14	45
												11458	13.8	1	13.3	19.8	20	20	18	44	20.3	25	25	19	45	25	25	19	45
												12358	23	1	22.1	31.6	35	35	29	70	32.1	35	35	30	71	35	35	30	71
05 (4)	208-3-60	14	83.1	22				2.8	8.9	1.1		None	—	—	—	29.2	30	40	30	145	30.3	35	40	31	147	40	40	31	147
												10625	4.9	1	13.6	29.2	30	40	30	145	30.3	35	40	31	147	40	40	31	147
												11125	7.9	1	21.9	38.5	40	40	35	145	39.9	40	40	37	147	40	40	37	147
												11625	12	1	33.3	52.8	60	60	49	145	54.1	60	60	50	147	60	60	50	147
	230-3-60	14	83.1	22				2.8	8.2	1		None	—	—	—	28.5	30	40	29	152	29.5	30	40	30	154	40	40	30	154
												10625	6.5	1	15.6	29.8	30	40	29	152	31	35	40	30	154	40	40	30	154
												11125	10.5	1	25.3	41.9	45	45	39	152	43.1	45	45	40	154	45	45	40	154
												11625	16	1	38.5	58.4	60	60	54	152	59.6	60	60	55	154	60	60	55	154
	460-3-60	6.4	41	10				1.6	4.1	0.5		None	—	—	—	13.7	15	20	14	76	14.2	15	20	14	77	15	20	14	77
												10646	6	1	7.2	14.1	15	20	13	76	14.8	15	20	14	77	15	20	14	77
												11146	11.5	1	13.8	22.4	25	25	21	76	23	25	25	21	77	25	25	21	77
												11446	14	1	16.8	26.1	30	30	24	76	26.8	30	30	25	77	30	30	25	77
	575-3-60	4.6	33	7				2.8	3.2	0.4		None	—	—	—	11.8	15	15	12	59	12.2	15	15	13	60	15	15	13	60
												11058	9.2	1	8.9	15.1	20	20	14	59	15.6	20	20	14	60	20	20	14	60
												11458	13.8	1	13.3	20.6	25	25	19	59	21.1	25	25	19	60	25	25	19	60
												12358	23	1	22.1	31.6	35	35	29	70	32.1	35	35	30	71	35	35	30	71
06 (5)	208-3-60	16.2	110	25				2.8	8.9	1.1		None	—	—	—	32	35	45	32	172	33.1	35	45	33	174	45	45	33	174
												10625	4.9	1	13.6	32	35	45	32	172	33.1	35	45	33	174	45	45	33	174
												11125	7.9	1	21.9	38.5	40	45	35	172	39.9	40	45	37	174	40	45	37	174
												11625	12	1	33.3	52.8	60	60	49	172	54.1	60	60	50	174	60	60	50	174
	230-3-60	16.2	110	25				2.8	8.2	1		None	—	—	—	31.3	35	45	31	179	32.3	35	45	32	181	45	45	32	181
												10625	6.5	1	15.6	31.3	35	45	31	179	32.3	35	45	32	181	45	45	32	181
												11125	10.5	1	25.3	41.9	45	45	39	179	43.1	45	45	40	181	45	45	40	181
												11625	16	1	38.5	58.4	60	60	54	179	59.6	60	60	55	181	60	60	55	181
	460-3-60	7.6	52	12				1.6	4.1	0.5		None	—	—	—	15.2	20	20	15	87	15.7	20	20	16	88	20	20	16	88
												10646	6	1	7.2	15.2	20	20	13	87	15.7	20	20	14	88	20	20	14	88
												11146	11.5	1	13.8	22.4	25	25	21	87	23	25	25	21	88	25	25	21	88
												11446	14	1	16.8	26.1	30	30	24	87	26.8	30	30	25	88	30	30	25	88
	575-3-60	5.1	43.8	8				2.8	3.2	0.4		None	—	—	—	12.4	15	15	13	70	12.8	15	15	13	71	15	15	13	71
												11458	13.8	1	13.3	20.6	25	25	19	70	21.1	25	25	19	71	25	25	19	71
												12358	23	1	22.1	31.6	35	35	29	70	32.1	35	35	30	71	35	35	30	71
												12358	23	1	22.1	31.6	35	35	29	70	32.1	35	35	30	71	35	35	30	71

- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL04 to 06 high indoor blower

**Table 178: ZL 04 to 06 high indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/power exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ power exh (amps)	Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
04 (3)	208-3-60	9.6	73.8	15				2.8	7	1.1	8.6	None	—	—	—	26.1	30	35	27	138	27.2	30	35	29	141
												10625	4.9	1	13.6	31.1	35	35	29	138	32.5	35	35	30	141
												11125	7.9	1	21.9	41.5	45	45	38	138	42.9	45	45	39	141
												11625	12	1	33.3	55.8	60	60	51	138	57.1	60	60	53	141
	230-3-60	9.6	73.8	15				2.8	7.2	1	8.6	None	—	—	—	26.3	30	35	27	140	27.3	30	35	29	142
												10625	6.5	1	15.6	33.9	35	35	31	140	35.1	40	40	32	142
												11125	10.5	1	25.3	46	50	50	42	140	47.3	50	50	43	142
												11625	16	1	38.5	62.5	70	70	58	140	63.8	70	70	59	142
	460-3-60	5.1	37	8				1.6	3.6	0.5	8.6	None	—	—	—	13.8	15	15	14	70	14.3	15	15	15	71
												10646	6	1	7.2	16.2	20	20	15	70	16.8	20	20	15	71
												11146	11.5	1	13.8	24.4	25	25	22	70	25.1	30	30	23	71
												11446	14	1	16.8	28.2	30	30	26	70	28.8	30	30	27	71
	575-3-60	3.2	26	5				2.8	2.5	0.4	8.6	None	—	—	—	11	15	15	12	45	11.4	15	15	12	46
												11058	9.2	1	8.9	16.4	20	20	15	45	16.9	20	20	16	46
												11458	13.8	1	13.3	21.9	25	25	20	45	22.4	25	25	21	46
05 (4)	208-3-60	14	83.1	22				2.8	8.9	1.1	8.6	None	—	—	—	33.5	35	45	35	149	34.6	35	45	36	152
												10625	4.9	1	13.6	33.5	35	45	35	149	34.9	35	45	36	152
												11125	7.9	1	21.9	43.9	45	45	40	149	45.3	50	50	42	152
												11625	12	1	33.3	58.1	60	60	53	149	59.5	60	60	55	152
	230-3-60	14	83.1	22				2.8	8.2	1	8.6	None	—	—	—	32.8	35	45	34	156	33.8	35	45	35	159
												10625	6.5	1	15.6	35.1	40	45	34	156	36.4	40	45	35	159
												11125	10.5	1	25.3	47.3	50	50	43	156	48.5	50	50	45	159
												11625	16	1	38.5	63.8	70	70	59	156	65	70	70	60	159
	460-3-60	6.4	41	10				1.6	4.1	0.5	8.6	None	—	—	—	15.9	20	20	16	78	16.4	20	20	17	79
												10646	6	1	7.2	16.8	20	20	15	78	17.4	20	20	16	79
												11146	11.5	1	13.8	25.1	30	30	23	78	25.7	30	30	24	79
												11446	14	1	16.8	28.8	30	30	27	78	29.4	30	30	27	79
	575-3-60	4.6	33	7				2.8	3.2	0.4	8.6	None	—	—	—	13.5	15	15	14	61	13.9	15	15	15	62
												11058	9.2	1	8.9	17.3	20	20	16	61	17.8	20	20	16	62
												11458	13.8	1	13.3	22.8	25	25	21	61	23.3	25	25	21	62
06 (5)	208-3-60	16.2	110	25				2.8	8.9	1.1	8.6	None	—	—	—	36.3	40	50	37	176	37.4	40	50	38	179
												10625	4.9	1	13.6	36.3	40	50	37	176	37.4	40	50	38	179
												11125	7.9	1	21.9	43.9	45	50	40	176	45.3	50	50	42	179
												11625	12	1	33.3	58.1	60	60	53	176	59.5	60	60	55	179
	230-3-60	16.2	110	25				2.8	8.2	1	8.6	None	—	—	—	35.6	40	50	36	183	36.6	40	50	37	186
												10625	6.5	1	15.6	35.6	40	50	36	183	36.6	40	50	37	186
												11125	10.5	1	25.3	47.3	50	50	43	183	48.5	50	50	45	186
												11625	16	1	38.5	63.8	70	70	59	183	65	70	70	60	186
	460-3-60	7.6	52	12				1.6	4.1	0.5	8.6	None	—	—	—	17.4	20	25	18	89	17.9	20	25	18	90
												10646	6	1	7.2	17.4	20	25	15	89	17.9	20	25	16	90
												11146	11.5	1	13.8	25.1	30	30	23	89	25.7	30	30	24	90
												11446	14	1	16.8	28.8	30	30	27	89	29.4	30	30	27	90
	575-3-60	5.1	43.8	8				2.8	3.2	0.4	8.6	None	—	—	—	14.1	15	15	15	72	14.5	15	15	15	73
												11458	13.8	1	13.3	22.8	25	25	21	72	23.3	25	25	21	73
												12358	23	1	22.1	33.8	35	35	31	72	34.3	35	35	32	73

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.

- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

**Table 179: ZL04 to 06 high indoor blower - without powered convenience outlet**

Size (tons)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Power exh motor	Power conv outlet	Electric heat field installed kit 2EK045*				<sup>1</sup> MCA <sup>1</sup> (amps)	<sup>2,3</sup> Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	<sup>4</sup> Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ power exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA				
04 (3)	208-3-60	9.6	73.8	15				2.8	7	1.1		None	—	—	—	21.8	25	30	22	134	22.9	25	30	24	136			
												10625	4.9	1	13.6	25.8	30	30	24	134	27.1	30	30	25	136			
												11125	7.9	1	21.9	36.1	40	40	33	134	37.5	40	40	35	136			
												11625	12	1	33.3	50.4	60	60	46	134	51.8	60	60	48	136			
	230-3-60	9.6	73.8	15				2.8	7.2	1		None	—	—	—	22	25	30	23	136	23	25	30	24	138			
												10625	6.5	1	15.6	28.5	30	30	26	136	29.8	30	30	27	138			
												11125	10.5	1	25.3	40.6	45	45	37	136	41.9	45	45	39	138			
												11625	16	1	38.5	57.1	60	60	53	136	58.4	60	60	54	138			
	460-3-60	5.1	37	8				1.6	3.6	0.5		None	—	—	—	11.6	15	15	12	68	12.1	15	15	12	69			
												10646	6	1	7.2	13.5	15	15	12	68	14.1	15	15	13	69			
												11146	11.5	1	13.8	21.8	25	25	20	68	22.4	25	25	21	69			
												11446	14	1	16.8	25.5	30	30	23	68	26.1	30	30	24	69			
	575-3-60	3.2	26	5				2.8	2.5	0.4		None	—	—	—	9.3	15	15	10	44	9.7	15	15	10	45			
												11058	9.2	1	8.9	14.3	15	15	13	44	14.8	15	15	14	45			
												11458	13.8	1	13.3	19.8	20	20	18	44	20.3	25	25	19	45			
05 (4)	208-3-60	14	83.1	22				2.8	8.9	1.1		None	—	—	—	29.2	30	40	30	145	30.3	35	40	31	147			
												10625	4.9	1	13.6	29.2	30	40	30	145	30.3	35	40	31	147			
												11125	7.9	1	21.9	38.5	40	40	35	145	39.9	40	40	37	147			
												11625	12	1	33.3	52.8	60	60	49	145	54.1	60	60	50	147			
	230-3-60	14	83.1	22				2.8	8.2	1		None	—	—	—	28.5	30	40	29	152	29.5	30	40	30	154			
												10625	6.5	1	15.6	29.8	30	40	29	152	31	35	40	30	154			
												11125	10.5	1	25.3	41.9	45	45	39	152	43.1	45	45	40	154			
												11625	16	1	38.5	58.4	60	60	54	152	59.6	60	60	55	154			
	460-3-60	6.4	41	10				1.6	4.1	0.5		None	—	—	—	13.7	15	20	14	76	14.2	15	20	14	77			
												10646	6	1	7.2	14.1	15	20	13	76	14.8	15	20	14	77			
												11146	11.5	1	13.8	22.4	25	25	21	76	23	25	25	21	77			
												11446	14	1	16.8	26.1	30	30	24	76	26.8	30	30	25	77			
	575-3-60	4.6	33	7				2.8	3.2	0.4		None	—	—	—	11.8	15	15	12	59	12.2	15	15	13	60			
												11058	9.2	1	8.9	15.1	20	20	14	59	15.6	20	20	14	60			
												11458	13.8	1	13.3	20.6	25	25	19	59	21.1	25	25	19	60			
06 (5)	208-3-60	16.2	110	25				2.8	8.9	1.1		None	—	—	—	32	35	45	32	172	33.1	35	45	33	174			
												10625	4.9	1	13.6	32	35	45	32	172	33.1	35	45	33	174			
												11125	7.9	1	21.9	38.5	40	45	35	172	39.9	40	45	37	174			
												11625	12	1	33.3	52.8	60	60	49	172	54.1	60	60	50	174			
	230-3-60	16.2	110	25				2.8	8.2	1		None	—	—	—	31.3	35	45	31	179	32.3	35	45	32	181			
												10625	6.5	1	15.6	31.3	35	45	31	179	32.3	35	45	32	181			
												11125	10.5	1	25.3	41.9	45	45	39	179	43.1	45	45	40	181			
												11625	16	1	38.5	58.4	60	60	54	179	59.6	60	60	55	181			
	460-3-60	7.6	52	12				1.6	4.1	0.5		None	—	—	—	15.2	20	20	15	87	15.7	20	20	16	88			
												10646	6	1	7.2	15.2	20	20	13	87	15.7	20	20	14	88			
												11146	11.5	1	13.8	22.4	25	25	21	87	23	25	25	21	88			
												11446	14	1	16.8	26.1	30	30	24	87	26.8	30	30	25	88			
	575-3-60	5.1	43.8	8				2.8	3.2	0.4		None	—	—	—	12.4	15	15	13	70	12.8	15	15	13	71			
												11458	13.8	1	13.3	20.6	25	25	19	70	21.1	25	25	19	71			
												12358	23	1	22.1	31.6	35	35	29	70	32.1	35	35	30	71			

- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.



# ZL08 to 14 static indoor blowers - without powered convenience outlet

**Table 180: ZL08 to 14 standard static indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA' (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA' w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA		
08 (7.5)	208-3-60	14	83.1	22	13.5	88	21	2	7	1.1	—	None	—	—	—	42	45	50	44	240	44.2	45	50	47	245		
												11725	12	1	33.3	50.4	60	60	46	240	53.1	60	60	49	245		
												12525	18.6	1	51.6	73.3	80	80	67	240	76	80	80	70	245		
												13225	24	1	66.6	92	100	100	85	240	94.8	100	100	87	245		
												14225	31.8	2	88.3	119.1	125	125	110	240	121.9	125	125	112	245		
	230-3-60	14	83.1	22	13.5	88	21	2.3	7.2	1	—	None	—	—	—	42.8	45	50	45	243	44.8	45	50	47	247		
												11725	16	1	38.5	57.1	60	60	53	243	59.6	60	60	55	247		
												12525	24.8	1	59.7	83.6	90	90	77	243	86.1	90	90	79	247		
												13225	32	1	77	105.3	110	110	97	243	107.8	110	110	99	247		
												14225	42.4	2	102	136.5	150	150	126	243	139	150	150	128	247		
	460-3-60	6.4	41	10	6	44	9	1.3	3.6	0.5	—	None	—	—	—	20.2	25	25	21	122	21.2	25	25	23	124		
												11746	16.5	1	19.8	29.3	30	30	27	122	30.5	35	35	28	124		
												12846	27.8	1	33.4	46.3	50	50	43	122	47.5	50	50	44	124		
												13346	33	1	39.7	54.1	60	60	50	122	55.4	60	60	51	124		
												14246	41.7	2	50.2	67.3	70	70	62	122	68.5	70	70	63	124		
	575-3-60	4.6	33	7	4.9	34	8	1	2.5	0.4	—	None	—	—	—	15.2	20	20	16	89	16	20	20	17	91		
												11758	17	1	16.4	23.6	25	25	22	89	24.6	25	25	23	91		
												13458	34	1	32.7	44	45	45	40	89	45	45	45	41	91		
												None	—	—	—	42.2	45	50	45	235	44.4	45	50	47	240		
												11725	12	1	33.3	50.4	60	60	46	235	53.1	60	60	49	240		
09 (8.5)	208-3-60	14	83.1	22	13.7	83.1	21	2	7	1.1	—	None	—	—	—	43	45	50	45	238	45	45	50	48	242		
												11725	12	1	33.3	50.4	60	60	46	235	53.1	60	60	49	240		
												12525	18.6	1	51.6	73.3	80	80	67	235	76	80	80	70	240		
												13225	24	1	66.6	92	100	100	85	235	94.8	100	100	87	240		
												14225	31.8	2	88.3	119.1	125	125	110	235	121.9	125	125	112	240		
	230-3-60	14	83.1	22	13.7	83.1	21	2.3	7.2	1	—	None	—	—	—	43	45	50	45	238	45	45	50	48	242		
												11725	16	1	38.5	57.1	60	60	53	238	59.6	60	60	55	242		
												12525	24.8	1	59.7	83.6	90	90	77	238	86.1	90	90	79	242		
												13225	32	1	77	105.3	110	110	97	238	107.8	110	110	99	242		
												14225	42.4	2	102	136.5	150	150	126	238	139	150	150	128	242		
	460-3-60	6.4	41	10	6.2	41	10	1.3	3.6	0.5	—	None	—	—	—	20.4	25	25	22	119	21.4	25	25	23	121		
												11746	16.5	1	19.8	29.3	30	30	27	119	30.5	35	35	28	121		
												12846	27.8	1	33.4	46.3	50	50	43	119	47.5	50	50	44	121		
												13346	33	1	39.7	54.1	60	60	50	119	55.4	60	60	51	121		
												14246	41.7	2	50.2	67.3	70	70	62	119	68.5	70	70	63	121		
	575-3-60	4.6	33	7	4.8	33	8	1	2.5	0.4	—	None	—	—	—	15.1	20	20	16	88	15.9	20	20	17	90		
												11758	17	1	16.4	23.6	25	25	22	88	24.6	25	25	23	90		
												13458	34	1	32.7	44	45	45	40	88	45	45	45	41	90		
												None	—	—	—	42.2	45	50	45	235	44.4	45	50	47	240		
												11725	12	1	33.3	50.4	60	60	46	235	53.1	60	60	49	240		

**Table 180: ZL08 to 14 standard static indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA		
12 (10)	208-3-60	16.5	110	26	16	110	25	5.8	7	1.1	—	None	—	—	—	49.4	50	60	52	302	51.6	60	60	55	307		
												11725	12	1	33.3	50.4	60	60	52	302	53.1	60	60	55	307		
												12525	18.6	1	51.6	73.3	80	80	67	302	76	80	80	70	307		
												13225	24	1	66.6	92	100	100	85	302	94.8	100	100	87	307		
												14225	31.8	2	88.3	119.1	125	125	110	302	121.9	125	125	112	307		
	230-3-60	16.5	110	26	16	110	25	5.2	7.2	1	—	None	—	—	—	49	50	60	52	301	51	60	60	54	305		
												11725	16	1	38.5	57.1	60	60	53	301	59.6	60	60	55	305		
												12525	24.8	1	59.7	83.6	90	90	77	301	86.1	90	90	79	305		
												13225	32	1	77	105.3	110	110	97	301	107.8	110	110	99	305		
												14225	42.4	2	102	136.5	150	150	126	301	139	150	150	128	305		
	460-3-60	7.2	52	11	7.8	52	12	2.9	3.6	0.5	—	None	—	—	—	23.5	25	30	25	146	24.5	25	30	26	148		
												11746	16.5	1	19.8	29.3	30	30	27	146	30.5	35	35	28	148		
												12846	27.8	1	33.4	46.3	50	50	43	146	47.5	50	50	44	148		
												13346	33	1	39.7	54.1	60	60	50	146	55.4	60	60	51	148		
												14246	41.7	2	50.2	67.3	70	70	62	146	68.5	70	70	63	148		
	575-3-60	5.7	43.8	9	5.7	38.9	9	2.2	2.5	0.4	—	None	—	—	—	17.5	20	20	19	112	18.3	20	20	19	114		
												11758	17	1	16.4	23.6	25	25	22	112	24.6	25	25	23	114		
												13458	34	1	32.7	44	45	45	40	112	45	45	45	41	114		
												None	—	—	—	57.8	60	70	61	384	57.8	60	70	61	384		
												11725	12	1	33.3	57.8	60	70	61	384	57.8	60	70	61	384		
14 (12.5)	208-3-60	18.6	149	29	19.6	136	31	5.8	8.9	0	—	None	—	—	—	57.8	60	70	61	384	57.8	60	70	61	384		
												11725	12	1	33.3	57.8	60	70	61	384	57.8	60	70	61	384		
												12525	18.6	1	51.6	75.6	80	80	70	384	75.6	80	80	70	384		
												13225	24	1	66.6	94.4	100	100	87	384	94.4	100	100	87	384		
												14225	31.8	2	88.3	121.5	125	125	112	384	121.5	125	125	112	384		
	230-3-60	18.6	149	29	19.6	136	31	5.2	8.2	0	—	None	—	—	—	56.5	60	70	59	383	56.5	60	70	59	383		
												11725	16	1	38.5	58.4	60	70	59	383	58.4	60	70	59	383		
												12525	24.8	1	59.7	84.9	90	90	78	383	84.9	90	90	78	383		
												13225	32	1	77	106.5	110	110	98	383	106.5	110	110	98	383		
												14225	42.4	2	102	137.8	150	150	127	383	137.8	150	150	127	383		
	460-3-60	9	60.9	14	8.2	66.1	13	2.9	4.1	0	—	None	—	—	—	26.5	30	35	28	173	26.5	30	35	28	173		
												11746	16.5	1	19.8	29.9	30	35	27	173	29.9	30	35	27	173		
												12846	27.8	1	33.4	46.9	50	50	43	173	46.9	50	50	43	173		
												13346	33	1	39.7	54.8	60	60	50	173	54.8	60	60	50	173		
												14246	41.7	2	50.2	67.9	70	70	62	173	67.9	70	70	62	173		
	575-3-60	7.1	56	11	6.6	55.3	10	2.2	3.2	0	—	None	—	—	—	20.9	25	25	22	149	20.9	25	25	22	149		
												11758	17	1	16.4	24.5	25	25	23	149	24.5	25	25	23	149		
												13458	34	1	32.7	44.9	45	45	41	149	44.9	45	45	41	149		
												None	—	—	—	57.8	60	70	61	384	57.8	60	70	61	384		
												11725	12	1	33.3	57.8	60	70	61	384	57.8	60	70	61	384		

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL08 to 14 standard indoor blower - with powered convenience outlet

**Table 181: ZL08 to 14 standard indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA` (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)		Min disconnect <sup>4</sup> rating		MCA` w/pwr exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh															
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps		FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA																						
08 (7.5)	208-3-60	14	83.1	22	13.5	88	21	2	7	1.1	8.6	None	—	—	—	46.3	50	60	49	244	48.5	50	60	52	249	50	60	54	249	50	60	54	249											
												11725	12	1	33.3	55.8	60	60	51	244	58.5	60	60	54	249	60	60	54	249	60	60	54	249											
												12525	18.6	1	51.6	78.6	80	80	72	244	81.4	90	90	75	249	90	90	75	249	90	90	75	249											
												13225	24	1	66.6	97.4	100	100	90	244	100.1	110	110	92	249	110	110	92	249	110	110	92	249											
												14225	31.8	2	88.3	124.5	125	125	115	244	127.3	150	150	117	249	150	150	117	249	150	150	117	249											
	230-3-60	14	83.1	22	13.5	88	21	2.3	7.2	1	8.6	None	—	—	—	47.1	50	60	50	247	49.1	50	60	52	252	50	60	52	252	50	60	52	252											
												11725	16	1	38.5	62.5	70	70	58	247	65	70	70	60	252	70	70	60	252	70	70	60	252											
												12525	24.8	1	59.7	89	90	90	82	247	91.5	100	100	84	252	100	100	84	252	100	100	84	252											
												13225	32	1	77	110.6	125	125	102	247	113.1	125	125	104	252	125	125	104	252	125	125	104	252											
												14225	42.4	2	102	141.9	150	150	131	247	144.4	150	150	133	252	150	150	133	252	150	150	133	252											
	460-3-60	6.4	41	10	6	44	9	1.3	3.6	0.5	8.6	None	—	—	—	22.4	25	25	24	124	23.4	25	25	25	126	25	25	25	126	25	25	25	126											
												11746	16.5	1	19.8	31.9	35	35	29	124	33.2	35	35	31	126	35	35	31	126	35	35	31	126											
												12846	27.8	1	33.4	48.9	50	50	45	124	50.2	60	60	46	126	60	60	46	126	60	60	46	126											
												13346	33	1	39.7	56.8	60	60	52	124	58.1	60	60	53	126	60	60	53	126	60	60	53	126											
												14246	41.7	2	50.2	69.9	70	70	64	124	71.2	80	80	65	126	80	80	65	126	80	80	65	126											
	575-3-60	4.6	33	7	4.9	34	8	1	2.5	0.4	8.6	None	—	—	—	16.9	20	20	18	91	17.7	20	20	19	93	20	20	19	93	20	20	19	93											
11758												17	1	16.4	25.8	30	30	24	91	26.8	30	30	25	93	30	30	25	93	30	30	25	93												
13458												34	1	32.7	46.2	50	50	42	91	47.2	50	50	43	93	50	50	43	93	50	50	43	93												
09 (8.5)												208-3-60	14	83.1	22	13.7	83.1	21	2	7	1.1	8.6	None	—	—	—	46.5	50	60	49	239	48.7	50	60	52	244	50	60	52	244	50	60	52	244
																							11725	12	1	33.3	55.8	60	60	51	239	58.5	60	60	54	244	60	60	54	244	60	60	54	244
	12525	18.6	1	51.6	78.6	80	80	72	239	81.4	90												90	75	244	90	90	75	244	90	90	75	244											
	13225	24	1	66.6	97.4	100	100	90	239	100.1	110												110	92	244	110	110	92	244	110	110	92	244											
	14225	31.8	2	88.3	124.5	125	125	115	239	127.3	150												150	117	244	150	150	117	244	150	150	117	244											
	230-3-60	14	83.1	22	13.7	83.1	21	2.3	7.2	1	8.6	None	—	—	—	47.3	50	60	50	242	49.3	50	60	53	247	50	60	53	247	50	60	53	247											
												11725	16	1	38.5	62.5	70	70	58	242	65	70	70	60	247	70	70	60	247	70	70	60	247											
												12525	24.8	1	59.7	89	90	90	82	242	91.5	100	100	84	247	100	100	84	247	100	100	84	247											
												13225	32	1	77	110.6	125	125	102	242	113.1	125	125	104	247	125	125	104	247	125	125	104	247											
												14225	42.4	2	102	141.9	150	150	131	242	144.4	150	150	133	247	150	150	133	247	150	150	133	247											
	460-3-60	6.4	41	10	6.2	41	10	1.3	3.6	0.5	8.6	None	—	—	—	22.6	25	25	24	121	23.6	25	25	25	123	25	25	25	123	25	25	25	123											
												11746	16.5	1	19.8	31.9	35	35	29	121	33.2	35	35	31	123	35	35	31	123	35	35	31	123											
												12846	27.8	1	33.4	48.9	50	50	45	121	50.2	60	60	46	123	60	60	46	123	60	60	46	123											
												13346	33	1	39.7	56.8	60	60	52	121	58.1	60	60	53	123	60	60	53	123	60	60	53	123											
												14246	41.7	2	50.2	69.9	70	70	64	121	71.2	80	80	65	123	80	80	65	123	80	80	65	123											
	575-3-60	4.6	33	7	4.8	33	8	1	2.5	0.4	8.6	None	—	—	—	16.8	20	20	18	90	17.6	20	20	19	92	20	20	19	92	20	20	19	92											
11758												17	1	16.4	25.8	30	30	24	90	26.8	30	30	25	92	30	30	25	92	30	30	25	92												
13458												34	1	32.7	46.2	50	50	42	90	47.2	50	50	43	92	50	50	43	92	50	50	43	92												

**Table 181: ZL08 to 14 standard indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA		
12 (10)	208-3-60	16.5	110	26	16	110	25	5.8	7	1.1	8.6	None	—	—	—	53.7	60	70	57	306	55.9	60	70	60	311		
												11725	12	1	33.3	55.8	60	70	57	306	58.5	60	70	60	311		
												12525	18.6	1	51.6	78.6	80	80	72	306	81.4	90	90	75	311		
												13225	24	1	66.6	97.4	100	100	90	306	100.1	110	110	92	311		
												14225	31.8	2	88.3	124.5	125	125	115	306	127.3	150	150	117	311		
												None	—	—	—	53.3	60	60	57	305	55.3	60	70	59	310		
	230-3-60	16.5	110	26	16	110	25	5.2	7.2	1	8.6	11725	16	1	38.5	62.5	70	70	58	305	65	70	70	60	310		
												12525	24.8	1	59.7	89	90	90	82	305	91.5	100	100	84	310		
												13225	32	1	77	110.6	125	125	102	305	113.1	125	125	104	310		
												14225	42.4	2	102	141.9	150	150	131	305	144.4	150	150	133	310		
												None	—	—	—	25.7	30	30	27	148	26.7	30	30	28	150		
												11746	16.5	1	19.8	31.9	35	35	29	148	33.2	35	35	31	150		
	460-3-60	7.2	52	11	7.8	52	12	2.9	3.6	0.5	8.6	12846	27.8	1	33.4	48.9	50	50	45	148	50.2	60	60	46	150		
												13346	33	1	39.7	56.8	60	60	52	148	58.1	60	60	53	150		
												14246	41.7	2	50.2	69.9	70	70	64	148	71.2	80	80	65	150		
												None	—	—	—	19.2	20	20	20	113	20	20	20	21	115		
												11758	17	1	16.4	25.8	30	30	24	113	26.8	30	30	25	115		
												13458	34	1	32.7	46.2	50	50	42	113	47.2	50	50	43	115		
14 (12.5)	208-3-60	18.6	149	29	19.6	136	31	5.8	8.9	0	8.6	None	—	—	—	62.1	70	80	66	388	62.1	70	80	66	388		
												11725	12	1	33.3	62.1	70	80	66	388	62.1	70	80	66	388		
												12525	18.6	1	51.6	81	90	90	75	388	81	90	90	75	388		
												13225	24	1	66.6	99.8	100	100	92	388	99.8	100	100	92	388		
												14225	31.8	2	88.3	126.9	150	150	117	388	126.9	150	150	117	388		
												None	—	—	—	60.8	70	80	64	387	60.8	70	80	64	387		
	230-3-60	18.6	149	29	19.6	136	31	5.2	8.2	0	8.6	11725	16	1	38.5	63.8	70	80	64	387	63.8	70	80	64	387		
												12525	24.8	1	59.7	90.3	100	100	83	387	90.3	100	100	83	387		
												13225	32	1	77	111.9	125	125	103	387	111.9	125	125	103	387		
												14225	42.4	2	102	143.1	150	150	132	387	143.1	150	150	132	387		
												None	—	—	—	28.7	30	35	30	175	28.7	30	35	30	175		
												11746	16.5	1	19.8	32.6	35	35	30	175	32.6	35	35	30	175		
	460-3-60	9	60.9	14	8.2	66.1	13	2.9	4.1	0	8.6	12846	27.8	1	33.4	49.6	50	50	46	175	49.6	50	50	46	175		
												13346	33	1	39.7	57.4	60	60	53	175	57.4	60	60	53	175		
												14246	41.7	2	50.2	70.6	80	80	65	175	70.6	80	80	65	175		
												None	—	—	—	22.6	25	25	24	150	22.6	25	25	24	150		
												11758	17	1	16.4	26.7	30	30	25	150	26.7	30	30	25	150		
												13458	34	1	32.7	47	50	50	43	150	47	50	50	43	150		

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL08 to 14 medium indoor blower - without powered convenience outlet

**Table 182: ZL08 to 14 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA` (amps)	Min fuse`/breaker³ size (amps)	Max Fuse²`/ Breaker³ Size (Amps)	Min disconnect` rating		MCA` w/pwr exh (amps)	Min fuse²`/ breaker³ size w/ pwr exh (amps)	Max fuse²`/ breaker³ size w/ pwr exh (amps)	Min disconnect` rating/ pwr exh													
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA												
08 (7.5)	208-3-60	14	83.1	22	13.5	88	21	2	7	1.1	—	None	—	—	—	42	45	50	44	240	44.2	45	50	47	245												
												11725	12	1	33.3	50.4	60	60	46	240	53.1	60	60	49	245												
												12525	18.6	1	51.6	73.3	80	80	67	240	76	80	80	70	245												
												13225	24	1	66.6	92	100	100	85	240	94.8	100	100	87	245												
												14225	31.8	2	88.3	119.1	125	125	110	240	121.9	125	125	112	245												
	230-3-60	14	83.1	22	13.5	88	21	2.3	7.2	1	—	None	—	—	—	42.8	45	50	45	243	44.8	45	50	47	247												
												11725	16	1	38.5	57.1	60	60	53	243	59.6	60	60	55	247												
												12525	24.8	1	59.7	83.6	90	90	77	243	86.1	90	90	79	247												
												13225	32	1	77	105.3	110	110	97	243	107.8	110	110	99	247												
												14225	42.4	2	102	136.5	150	150	126	243	139	150	150	128	247												
	460-3-60	6.4	41	10	6	44	9	1.3	3.6	0.5	—	None	—	—	—	20.2	25	25	21	122	21.2	25	25	23	124												
												11746	16.5	1	19.8	29.3	30	30	27	122	30.5	35	35	28	124												
												12846	27.8	1	33.4	46.3	50	50	43	122	47.5	50	50	44	124												
												13346	33	1	39.7	54.1	60	60	50	122	55.4	60	60	51	124												
												14246	41.7	2	50.2	67.3	70	70	62	122	68.5	70	70	63	124												
	575-3-60	4.6	33	7	4.9	34	8	1	2.5	0.4	—	None	—	—	—	15.2	20	20	16	89	16	20	20	17	91												
												11758	17	1	16.4	23.6	25	25	22	89	24.6	25	25	23	91												
												13458	34	1	32.7	44	45	45	40	89	45	45	41	91													
												09 (8.5)	208-3-60	14	83.1	22	13.7	83.1	21	2	7	1.1	—	None	—	—	—	42.2	45	50	45	235	44.4	45	50	47	240
																								11725	12	1	33.3	50.4	60	60	46	235	53.1	60	60	49	240
12525	18.6	1	51.6	73.3	80	80	67	235	76	80	80													70	240												
13225	24	1	66.6	92	100	100	85	235	94.8	100	100													87	240												
14225	31.8	2	88.3	119.1	125	125	110	235	121.9	125	125													112	240												
230-3-60	14	83.1	22	13.7	83.1	21	2.3	7.2	1	—	None		—	—	—	43	45	50	45	238	45	45	50	48	242												
											11725		16	1	38.5	57.1	60	60	53	238	59.6	60	60	55	242												
											12525		24.8	1	59.7	83.6	90	90	77	238	86.1	90	90	79	242												
											13225		32	1	77	105.3	110	110	97	238	107.8	110	110	99	242												
											14225		42.4	2	102	136.5	150	150	126	238	139	150	150	128	242												
460-3-60	6.4	41	10	6.2	41	10	1.3	3.6	0.5	—	None		—	—	—	20.4	25	25	22	119	21.4	25	25	23	121												
											11746		16.5	1	19.8	29.3	30	30	27	119	30.5	35	35	28	121												
											12846		27.8	1	33.4	46.3	50	50	43	119	47.5	50	50	44	121												
											13346		33	1	39.7	54.1	60	60	50	119	55.4	60	60	51	121												
											14246		41.7	2	50.2	67.3	70	70	62	119	68.5	70	70	63	121												
575-3-60	4.6	33	7	4.8	33	8	1	2.5	0.4	—	None		—	—	—	15.1	20	20	16	88	15.9	20	20	17	90												
											11758		17	1	16.4	23.6	25	25	22	88	24.6	25	25	23	90												
											13458		34	1	32.7	44	45	45	40	88	45	45	41	90													

**Table 182: ZL08 to 14 medium indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max Fuse <sup>2</sup> / Breaker <sup>3</sup> Size (Amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA				
12 (10)	208-3-60	16.5	110	26	16	110	25	5.8	9.9	1.1	—	None	—	—	—	52.3	60	60	55	315	54.5	60	60	58	320			
												11725	12	1	33.3	54	60	60	55	315	56.8	60	60	58	320			
												12525	18.6	1	51.6	76.9	80	80	71	315	79.6	80	80	73	320			
												13225	24	1	66.6	95.6	100	100	88	315	98.4	100	100	91	320			
												14225	31.8	2	88.3	122.8	125	125	113	315	125.5	150	150	115	320			
	230-3-60	16.5	110	26	16	110	25	5.2	9.4	1	—	None	—	—	—	51.2	60	60	54	320	53.2	60	60	56	324			
												11725	16	1	38.5	59.9	60	60	55	320	62.4	70	70	57	324			
												12525	24.8	1	59.7	86.4	90	90	79	320	88.9	90	90	82	324			
												13225	32	1	77	108	110	110	99	320	110.5	125	125	102	324			
												14225	42.4	2	102	139.3	150	150	128	320	141.8	150	150	130	324			
	460-3-60	7.2	52	11	7.8	52	12	2.9	4.7	0.5	—	None	—	—	—	24.6	25	30	26	155	25.6	30	30	27	158			
												11746	16.5	1	19.8	30.6	35	35	28	155	31.9	35	35	29	158			
												12846	27.8	1	33.4	47.6	50	50	44	155	48.9	50	50	45	158			
												13346	33	1	39.7	55.5	60	60	51	155	56.8	60	60	52	158			
												14246	41.7	2	50.2	68.6	70	70	63	155	69.9	70	70	64	158			
	575-3-60	5.7	43.8	9	5.7	38.9	9	2.2	4.3	0.4	—	None	—	—	—	19.3	20	25	21	134	20.1	25	25	22	136			
												11758	17	1	16.4	25.9	30	30	24	134	26.9	30	30	25	136			
												13458	34	1	32.7	46.3	50	50	43	134	47.3	50	50	43	136			
	14 (12.5)	208-3-60	18.6	149	29	19.6	136	31	5.8	9.9	0	—	None	—	—	—	58.8	60	70	62	380	58.8	60	70	62	380		
													11725	12	1	33.3	58.8	60	70	62	380	58.8	60	70	62	380		
12525													18.6	1	51.6	76.9	80	80	71	380	76.9	80	80	71	380			
13225													24	1	66.6	95.6	100	100	88	380	95.6	100	100	88	380			
14225													31.8	2	88.3	122.8	125	125	113	380	122.8	125	125	113	380			
230-3-60		18.6	149	29	19.6	136	31	5.2	9.4	0	—	None	—	—	—	57.7	60	70	61	385	57.7	60	70	61	385			
												11725	16	1	38.5	59.9	60	70	61	385	59.9	60	70	61	385			
												12525	24.8	1	59.7	86.4	90	90	79	385	86.4	90	90	79	385			
												13225	32	1	77	108	110	110	99	385	108	110	110	99	385			
												14225	42.4	2	102	139.3	150	150	128	385	139.3	150	150	128	385			
460-3-60		9	60.9	14	8.2	66.1	13	2.9	4.7	0	—	None	—	—	—	27.1	30	35	29	178	27.1	30	35	29	178			
												11746	16.5	1	19.8	30.6	35	35	28	178	30.6	35	35	28	178			
												12846	27.8	1	33.4	47.6	50	50	44	178	47.6	50	50	44	178			
												13346	33	1	39.7	55.5	60	60	51	178	55.5	60	60	51	178			
												14246	41.7	2	50.2	68.6	70	70	63	178	68.6	70	70	63	178			
575-3-60		7.1	56	11	6.6	55.3	10	2.2	4.3	0	—	None	—	—	—	22	25	25	23	163	22	25	25	23	163			
												11758	17	1	16.4	25.9	30	30	24	163	25.9	30	30	24	163			
												13458	34	1	32.7	46.3	50	50	43	163	46.3	50	50	43	163			

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL08 to 14 medium indoor blower - with powered convenience outlet

**Table 183: ZL08 to 14 medium indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA' (amps)	Min Fuse' / breaker' size (amps)	Max fuse' / breaker' size (amps)	Min disconnect' rating		MCA' w/pwr exh (amps)	Min fuse' / breaker' size w/ pwr exh (amps)	Max fuse' / breaker' size w/ pwr exh (amps)	Min Disconnect' rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
08 (7.5)	208-3-60	14	83.1	22	13.5	88	21	2	7	1.1	8.6	None	—	—	—	46.3	50	60	49	244	48.5	50	60	52	249
												11725	12	1	33.3	55.8	60	60	51	244	58.5	60	60	54	249
												12525	18.6	1	51.6	78.6	80	80	72	244	81.4	90	90	75	249
												13225	24	1	66.6	97.4	100	100	90	244	100.1	110	110	92	249
												14225	31.8	2	88.3	124.5	125	125	115	244	127.3	150	150	117	249
	230-3-60	14	83.1	22	13.5	88	21	2.3	7.2	1	8.6	None	—	—	—	47.1	50	60	50	247	49.1	50	60	52	252
												11725	16	1	38.5	62.5	70	70	58	247	65	70	70	60	252
												12525	24.8	1	59.7	89	90	90	82	247	91.5	100	100	84	252
												13225	32	1	77	110.6	125	125	102	247	113.1	125	125	104	252
												14225	42.4	2	102	141.9	150	150	131	247	144.4	150	150	133	252
	460-3-60	6.4	41	10	6	44	9	1.3	3.6	0.5	8.6	None	—	—	—	22.4	25	25	24	124	23.4	25	25	25	126
												11746	16.5	1	19.8	31.9	35	35	29	124	33.2	35	35	31	126
												12846	27.8	1	33.4	48.9	50	50	45	124	50.2	60	60	46	126
												13346	33	1	39.7	56.8	60	60	52	124	58.1	60	60	53	126
												14246	41.7	2	50.2	69.9	70	70	64	124	71.2	80	80	65	126
	575-3-60	4.6	33	7	4.9	34	8	1	2.5	0.4	8.6	None	—	—	—	16.9	20	20	18	91	17.7	20	20	19	93
												11758	17	1	16.4	25.8	30	30	24	91	26.8	30	30	25	93
												13458	34	1	32.7	46.2	50	50	42	91	47.2	50	50	43	93
												None	—	—	—	46.5	50	60	49	239	48.7	50	60	52	244
												11725	12	1	33.3	55.8	60	60	51	239	58.5	60	60	54	244
09 (8.5)	208-3-60	14	83.1	22	13.7	83.1	21	2	7	1.1	8.6	12525	18.6	1	51.6	78.6	80	80	72	239	81.4	90	90	75	244
												13225	24	1	66.6	97.4	100	100	90	239	100.1	110	110	92	244
												14225	31.8	2	88.3	124.5	125	125	115	239	127.3	150	150	117	244
												None	—	—	—	47.3	50	60	50	242	49.3	50	60	53	247
												11725	16	1	38.5	62.5	70	70	58	242	65	70	70	60	247
	230-3-60	14	83.1	22	13.7	83.1	21	2.3	7.2	1	8.6	12525	24.8	1	59.7	89	90	90	82	242	91.5	100	100	84	247
												13225	32	1	77	110.6	125	125	102	242	113.1	125	125	104	247
												14225	42.4	2	102	141.9	150	150	131	242	144.4	150	150	133	247
												None	—	—	—	22.6	25	25	24	121	23.6	25	25	25	123
												11746	16.5	1	19.8	31.9	35	35	29	121	33.2	35	35	31	123
	460-3-60	6.4	41	10	6.2	41	10	1.3	3.6	0.5	8.6	12846	27.8	1	33.4	48.9	50	50	45	121	50.2	60	60	46	123
												13346	33	1	39.7	56.8	60	60	52	121	58.1	60	60	53	123
												14246	41.7	2	50.2	69.9	70	70	64	121	71.2	80	80	65	123
												None	—	—	—	16.8	20	20	18	90	17.6	20	20	19	92
												11758	17	1	16.4	25.8	30	30	24	90	26.8	30	30	25	92
	575-3-60	4.6	33	7	4.8	33	8	1	2.5	0.4	8.6	13458	34	1	32.7	46.2	50	50	42	90	47.2	50	50	43	92

**Table 183: ZL08 to 14 medium indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA¹ (amps)	Min Fuse² / breaker³ size (amps)	Max fuse² / breaker³ size (amps)	Min disconnect⁴ rating		MCA¹ w/pwr exh (amps)	Min fuse² / breaker³ size w/ pwr exh (amps)	Max fuse² / breaker³ size w/ pwr exh (amps)	Min Disconnect⁴ rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA
12 (10)	208-3-60	16.5	110	26	16	110	25	5.8	9.9	1.1	8.6	None	—	—	—	56.6	60	70	60	319	58.8	60	70	63	324
												11725	12	1	33.3	59.4	60	70	60	319	62.1	70	70	63	324
												12525	18.6	1	51.6	82.3	90	90	76	319	85	90	90	78	324
												13225	24	1	66.6	101	110	110	93	319	103.8	110	110	95	324
												14225	31.8	2	88.3	128.1	150	150	118	319	130.9	150	150	120	324
												None	—	—	—	55.5	60	70	59	324	57.5	60	70	61	329
	230-3-60	16.5	110	26	16	110	25	5.2	9.4	1	8.6	11725	16	1	38.5	65.3	70	70	60	324	67.8	70	70	62	329
												12525	24.8	1	59.7	91.8	100	100	84	324	94.3	100	100	87	329
												13225	32	1	77	113.4	125	125	104	324	115.9	125	125	107	329
												14225	42.4	2	102	144.6	150	150	133	324	147.1	150	150	135	329
												None	—	—	—	26.8	30	30	29	157	27.8	30	30	30	160
												11746	16.5	1	19.8	33.3	35	35	31	157	34.6	35	35	32	160
	460-3-60	7.2	52	11	7.8	52	12	2.9	4.7	0.5	8.6	12846	27.8	1	33.4	50.3	60	60	46	157	51.6	60	60	47	160
												13346	33	1	39.7	58.2	60	60	54	157	59.4	60	60	55	160
												14246	41.7	2	50.2	71.3	80	80	66	157	72.6	80	80	67	160
												None	—	—	—	21	25	25	23	136	21.8	25	25	23	138
												11758	17	1	16.4	28	30	30	26	136	29	30	30	27	138
												13458	34	1	32.7	48.4	50	50	45	136	49.4	50	50	45	138
14 (12.5)	208-3-60	18.6	149	29	19.6	136	31	5.8	9.9	0	8.6	None	—	—	—	63.1	70	80	67	384	63.1	70	80	67	384
												11725	12	1	33.3	63.1	70	80	67	384	63.1	70	80	67	384
												12525	18.6	1	51.6	82.3	90	90	76	384	82.3	90	90	76	384
												13225	24	1	66.6	101	110	110	93	384	101	110	110	93	384
												14225	31.8	2	88.3	128.1	150	150	118	384	128.1	150	150	118	384
												None	—	—	—	62	70	80	66	389	62	70	80	66	389
	230-3-60	18.6	149	29	19.6	136	31	5.2	9.4	0	8.6	11725	16	1	38.5	65.3	70	80	66	389	65.3	70	80	66	389
												12525	24.8	1	59.7	91.8	100	100	84	389	91.8	100	100	84	389
												13225	32	1	77	113.4	125	125	104	389	113.4	125	125	104	389
												14225	42.4	2	102	144.6	150	150	133	389	144.6	150	150	133	389
												None	—	—	—	29.3	30	35	31	180	29.3	30	35	31	180
												11746	16.5	1	19.8	33.3	35	35	31	180	33.3	35	35	31	180
	460-3-60	9	60.9	14	8.2	66.1	13	2.9	4.7	0	8.6	12846	27.8	1	33.4	50.3	60	60	46	180	50.3	60	60	46	180
												13346	33	1	39.7	58.2	60	60	54	180	58.2	60	60	54	180
												14246	41.7	2	50.2	71.3	80	80	66	180	71.3	80	80	66	180
												None	—	—	—	23.7	25	30	25	164	23.7	25	30	25	164
												11758	17	1	16.4	28	30	30	26	164	28	30	30	26	164
												13458	34	1	32.7	48.4	50	50	45	164	48.4	50	50	45	164

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.



# ZL08 to 14 high indoor blower - without powered convenience outlet

**Table 184: ZL08 to 14 high indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA' (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA' w/pwr exh (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> /Breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA		Min fuse <sup>2</sup> /breaker <sup>3</sup> size w/ pwr exh (amps)	Max fuse <sup>2</sup> /Breaker <sup>3</sup> size w/ pwr exh (amps)	FLA	LRA		
08 (7.5)	208-3-60	14	83.1	22	13.5	88	21	2	9.9	1.1	—	None	—	—	—	44.9	45	50	48	252	47.1	50	60	50	257		
												11725	12	1	33.3	54	60	60	50	252	56.8	60	60	52	257		
												12525	18.6	1	51.6	76.9	80	80	71	252	79.6	80	80	73	257		
												13225	24	1	66.6	95.6	100	100	88	252	98.4	100	100	91	257		
												14225	31.8	2	88.3	122.8	125	125	113	252	125.5	150	150	115	257		
	230-3-60	14	83.1	22	13.5	88	21	2.3	9.4	1	—	None	—	—	—	45	45	50	48	262	47	50	60	50	266		
												11725	16	1	38.5	59.9	60	60	55	262	62.4	70	70	57	266		
												12525	24.8	1	59.7	86.4	90	90	79	262	88.9	90	90	82	266		
												13225	32	1	77	108	110	110	99	262	110.5	125	125	102	266		
												14225	42.4	2	102	139.3	150	150	128	262	141.8	150	150	130	266		
	460-3-60	6.4	41	10	6	44	9	1.3	4.7	0.5	—	None	—	—	—	21.3	25	25	23	131	22.3	25	25	24	133		
												11746	16.5	1	19.8	30.6	35	35	28	131	31.9	35	35	29	133		
												12846	27.8	1	33.4	47.6	50	50	44	131	48.9	50	50	45	133		
												13346	33	1	39.7	55.5	60	60	51	131	56.8	60	60	52	133		
												14246	41.7	2	50.2	68.6	70	70	63	131	69.9	70	70	64	133		
	575-3-60	4.6	33	7	4.9	34	8	1	4.3	0.4	—	None	—	—	—	17	20	20	18	112	17.8	20	20	19	113		
												11758	17	1	16.4	25.9	30	30	24	112	26.9	30	30	25	113		
												13458	34	1	32.7	46.3	50	50	43	112	47.3	50	50	43	113		
												None	—	—	—	45.1	50	50	48	248	47.3	50	60	50	253		
												11725	12	1	33.3	54	60	60	50	248	56.8	60	60	52	253		
09 (8.5)	208-3-60	14	83.1	22	13.7	83.1	21	2	9.9	1.1	—	None	—	—	—	45.2	50	50	48	257	47.2	50	60	50	261		
												11725	16	1	38.5	59.9	60	60	55	257	62.4	70	70	57	261		
												12525	24.8	1	59.7	86.4	90	90	79	257	88.9	90	90	82	261		
												13225	32	1	77	108	110	110	99	257	110.5	125	125	102	261		
												14225	42.4	2	102	139.3	150	150	128	257	141.8	150	150	130	261		
	230-3-60	14	83.1	22	13.7	83.1	21	2.3	9.4	1	—	None	—	—	—	21.5	25	25	23	128	22.5	25	25	24	130		
												11746	16.5	1	19.8	30.6	35	35	28	128	31.9	35	35	29	130		
												12846	27.8	1	33.4	47.6	50	50	44	128	48.9	50	50	45	130		
												13346	33	1	39.7	55.5	60	60	51	128	56.8	60	60	52	130		
												14246	41.7	2	50.2	68.6	70	70	63	128	69.9	70	70	64	130		
	460-3-60	6.4	41	10	6.2	41	10	1.3	4.7	0.5	—	None	—	—	—	16.9	20	20	18	111	17.7	20	20	19	112		
												11758	17	1	16.4	25.9	30	30	24	111	26.9	30	30	25	112		
												13458	34	1	32.7	46.3	50	50	43	111	47.3	50	50	43	112		
												None	—	—	—	16.9	20	20	18	111	17.7	20	20	19	112		
												11758	17	1	16.4	25.9	30	30	24	111	26.9	30	30	25	112		

**Table 184: ZL08 to 14 high indoor blower - without powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> /breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max fuse <sup>2</sup> / Breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA		
12 (10)	208-3-60	16.5	110	26	16	110	25	5.8	13.5	1.1	—	None	—	—	—	55.9	60	70	60	345	58.1	60	70	62	350		
												11725	12	1	33.3	58.5	60	70	60	345	61.3	70	70	62	350		
												12525	18.6	1	51.6	81.4	90	90	75	345	84.1	90	90	77	350		
												13225	24	1	66.6	100.1	110	110	92	345	102.9	110	110	95	350		
												14225	31.8	2	88.3	127.3	150	150	117	345	130	150	150	120	350		
	230-3-60	16.5	110	26	16	110	25	5.2	13.4	1	—	None	—	—	—	55.2	60	70	59	341	57.2	60	70	61	346		
												11725	16	1	38.5	64.9	70	70	60	341	67.4	70	70	62	346		
												12525	24.8	1	59.7	91.4	100	100	84	341	93.9	100	100	86	346		
												13225	32	1	77	113	125	125	104	341	115.5	125	125	106	346		
												14225	42.4	2	102	144.3	150	150	133	341	146.8	150	150	135	346		
	460-3-60	7.2	52	11	7.8	52	12	2.9	6.7	0.5	—	None	—	—	—	26.6	30	30	28	166	27.6	30	30	29	168		
												11746	16.5	1	19.8	33.1	35	35	30	166	34.4	35	35	32	168		
												12846	27.8	1	33.4	50.1	60	60	46	166	51.4	60	60	47	168		
												13346	33	1	39.7	58	60	60	53	166	59.3	60	60	55	168		
												14246	41.7	2	50.2	71.1	80	80	65	166	72.4	80	80	67	168		
	575-3-60	5.7	43.8	9	5.7	38.9	9	2.2	5.4	0.4	—	None	—	—	—	20.4	25	25	22	134	21.2	25	25	23	136		
												11758	17	1	16.4	27.3	30	30	25	134	28.3	30	30	26	136		
												13458	34	1	32.7	47.6	50	50	44	134	48.6	50	50	45	136		
												None	—	—	—	62.4	70	80	66	410	62.4	70	80	66	410		
												11725	12	1	33.3	62.4	70	80	66	410	62.4	70	80	66	410		
14 (12.5)	208-3-60	18.6	149	29	19.6	136	31	5.8	13.5	0	—	None	—	—	—	62.4	70	80	66	410	62.4	70	80	66	410		
												11725	12	1	33.3	62.4	70	80	66	410	62.4	70	80	66	410		
												12525	18.6	1	51.6	81.4	90	90	75	410	81.4	90	90	75	410		
												13225	24	1	66.6	100.1	110	110	92	410	100.1	110	110	92	410		
												14225	31.8	2	88.3	127.3	150	150	117	410	127.3	150	150	117	410		
	230-3-60	18.6	149	29	19.6	136	31	5.2	13.4	0	—	None	—	—	—	61.7	70	80	65	406	61.7	70	80	65	406		
												11725	16	1	38.5	64.9	70	80	65	406	64.9	70	80	65	406		
												12525	24.8	1	59.7	91.4	100	100	84	406	91.4	100	100	84	406		
												13225	32	1	77	113	125	125	104	406	113	125	125	104	406		
												14225	42.4	2	102	144.3	150	150	133	406	144.3	150	150	133	406		
	460-3-60	9	60.9	14	8.2	66.1	13	2.9	6.7	0	—	None	—	—	—	29.1	30	35	31	189	29.1	30	35	31	189		
												11746	16.5	1	19.8	33.1	35	35	30	189	33.1	35	35	30	189		
												12846	27.8	1	33.4	50.1	60	60	46	189	50.1	60	60	46	189		
												13346	33	1	39.7	58	60	60	53	189	58	60	60	53	189		
												14246	41.7	2	50.2	71.1	80	80	65	189	71.1	80	80	65	189		
	575-3-60	7.1	56	11	6.6	55.3	10	2.2	5.4	0	—	None	—	—	—	23.1	25	30	24	163	23.1	25	30	24	163		
												11758	17	1	16.4	27.3	30	30	25	163	27.3	30	30	25	163		
												13458	34	1	32.7	47.6	50	50	44	163	47.6	50	50	44	163		
												None	—	—	—	62.4	70	80	66	410	62.4	70	80	66	410		
												11725	12	1	33.3	62.4	70	80	66	410	62.4	70	80	66	410		

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

# ZL08 to 14 high indoor blower - with powered convenience outlet

**Table 185: ZL08 to 14 high indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA' (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA' w/pwr exh (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)		Max Fuse <sup>2</sup> / Breaker <sup>3</sup> size w/ pwr exh (amps)		Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA				FLA	LRA		
08 (7.5)	208-3-60	14	83.1	22	13.5	88	21	2	9.9	1.1	8.6	None	—	—	—	49.2	50	60	53	257	51.4	60	60	55	262		
												11725	12	1	33.3	59.4	60	60	55	257	62.1	70	70	57	262		
												12525	18.6	1	51.6	82.3	90	90	76	257	85	90	90	78	262		
												13225	24	1	66.6	101	110	110	93	257	103.8	110	110	95	262		
												14225	31.8	2	88.3	128.1	150	150	118	257	130.9	150	150	120	262		
	230-3-60	14	83.1	22	13.5	88	21	2.3	9.4	1	8.6	None	—	—	—	49.3	50	60	53	266	51.3	60	60	55	270		
												11725	16	1	38.5	65.3	70	70	60	266	67.8	70	70	62	270		
												12525	24.8	1	59.7	91.8	100	100	84	266	94.3	100	100	87	270		
												13225	32	1	77	113.4	125	125	104	266	115.9	125	125	107	270		
												14225	42.4	2	102	144.6	150	150	133	266	147.1	150	150	135	270		
	460-3-60	6.4	41	10	6	44	9	1.3	4.7	0.5	8.6	None	—	—	—	23.5	25	25	25	133	24.5	25	25	26	135		
												11746	16.5	1	19.8	33.3	35	35	31	133	34.6	35	35	32	135		
												12846	27.8	1	33.4	50.3	60	60	46	133	51.6	60	60	47	135		
												13346	33	1	39.7	58.2	60	60	54	133	59.4	60	60	55	135		
												14246	41.7	2	50.2	71.3	80	80	66	133	72.6	80	80	67	135		
	575-3-60	4.6	33	7	4.9	34	8	1	4.3	0.4	8.6	None	—	—	—	18.7	20	20	20	113	19.5	20	20	21	115		
												11758	17	1	16.4	28	30	30	26	113	29	30	30	27	115		
												13458	34	1	32.7	48.4	50	50	45	113	49.4	50	50	45	115		
												None	—	—	—	49.4	50	60	53	252	51.6	60	60	55	257		
												11725	12	1	33.3	59.4	60	60	55	252	62.1	70	70	57	257		
09 (8.5)	208-3-60	14	83.1	22	13.7	83.1	21	2	9.9	1.1	8.6	None	—	—	—	49.4	50	60	53	252	51.6	60	60	55	257		
												11725	12	1	33.3	59.4	60	60	55	252	62.1	70	70	57	257		
												12525	18.6	1	51.6	82.3	90	90	76	252	85	90	90	78	257		
												13225	24	1	66.6	101	110	110	93	252	103.8	110	110	95	257		
												14225	31.8	2	88.3	128.1	150	150	118	252	130.9	150	150	120	257		
	230-3-60	14	83.1	22	13.7	83.1	21	2.3	9.4	1	8.6	None	—	—	—	49.5	50	60	53	261	51.5	60	60	55	266		
												11725	16	1	38.5	65.3	70	70	60	261	67.8	70	70	62	266		
												12525	24.8	1	59.7	91.8	100	100	84	261	94.3	100	100	87	266		
												13225	32	1	77	113.4	125	125	104	261	115.9	125	125	107	266		
												14225	42.4	2	102	144.6	150	150	133	261	147.1	150	150	135	266		
	460-3-60	6.4	41	10	6.2	41	10	1.3	4.7	0.5	8.6	None	—	—	—	23.7	25	30	25	130	24.7	25	30	27	132		
												11746	16.5	1	19.8	33.3	35	35	31	130	34.6	35	35	32	132		
												12846	27.8	1	33.4	50.3	60	60	46	130	51.6	60	60	47	132		
												13346	33	1	39.7	58.2	60	60	54	130	59.4	60	60	55	132		
												14246	41.7	2	50.2	71.3	80	80	66	130	72.6	80	80	67	132		
	575-3-60	4.6	33	7	4.8	33	8	1	4.3	0.4	8.6	None	—	—	—	18.6	20	20	20	112	19.4	20	20	21	114		
												11758	17	1	16.4	28	30	30	26	112	29	30	30	27	114		
												13458	34	1	32.7	48.4	50	50	45	112	49.4	50	50	45	114		

**Table 185: ZL08 to 14 high indoor blower - with powered convenience outlet**

Size (ton)	Nominal unit voltage	Compressor 1			Compressor 2			OD fan motors (each)	Supply blower motor	Pwr exh motor	Pwr conv outlet	Electric heat field installed kit 2EK045*				MCA <sup>1</sup> (amps)	Min fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Max fuse <sup>2</sup> / breaker <sup>3</sup> size (amps)	Min disconnect <sup>4</sup> rating		MCA <sup>1</sup> w/pwr exh (amps)		Min fuse <sup>2</sup> / breaker <sup>3</sup> size w/ pwr exh (amps)	Max Fuse <sup>2</sup> / Breaker <sup>3</sup> size w/ pwr exh (amps)	Min disconnect <sup>4</sup> rating/ pwr exh	
		RLA	LRA	MCC	RLA	LRA	MCC					Model	kW	Stages	Amps				FLA	LRA	FLA	LRA				
12 (10)	208-3-60	16.5	110	26	16	110	25	5.8	13.5	1.1	8.6	None	—	—	—	60.2	70	70	65	349	62.4	70	70	67	354	
												11725	12	1	33.3	63.9	70	70	65	349	66.6	70	70	67	354	
												12525	18.6	1	51.6	86.8	90	90	80	349	89.5	90	90	82	354	
												13225	24	1	66.6	105.5	110	110	97	349	108.3	110	110	100	354	
												14225	31.8	2	88.3	132.6	150	150	122	349	135.4	150	150	125	354	
	230-3-60	16.5	110	26	16	110	25	5.2	13.4	1	8.6	None	—	—	—	59.5	60	70	64	345	61.5	70	70	66	350	
												11725	16	1	38.5	70.3	80	80	65	345	72.8	80	80	67	350	
												12525	24.8	1	59.7	96.8	100	100	89	345	99.3	100	100	91	350	
												13225	32	1	77	118.4	125	125	109	345	120.9	125	125	111	350	
												14225	42.4	2	102	149.6	150	150	138	345	152.1	175	175	140	350	
	460-3-60	7.2	52	11	7.8	52	12	2.9	6.7	0.5	8.6	None	—	—	—	28.8	30	35	31	168	29.8	30	35	32	170	
												11746	16.5	1	19.8	35.8	40	40	33	168	37.1	40	40	34	170	
												12846	27.8	1	33.4	52.8	60	60	49	168	54.1	60	60	50	170	
												13346	33	1	39.7	60.7	70	70	56	168	61.9	70	70	57	170	
												14246	41.7	2	50.2	73.8	80	80	68	168	75.1	80	80	69	170	
	575-3-60	5.7	43.8	9	5.7	38.9	9	2.2	5.4	0.4	8.6	None	—	—	—	22.1	25	25	24	136	22.9	25	25	25	138	
												11758	17	1	16.4	29.4	30	30	27	136	30.4	35	35	28	138	
												13458	34	1	32.7	49.8	50	50	46	136	50.8	60	60	47	138	
	14 (12.5)	208-3-60	18.6	149	29	19.6	136	31	5.8	13.5	0	8.6	None	—	—	—	66.7	70	80	71	414	66.7	70	80	71	414
													11725	12	1	33.3	66.7	70	80	71	414	66.7	70	80	71	414
12525													18.6	1	51.6	86.8	90	90	80	414	86.8	90	90	80	414	
13225													24	1	66.6	105.5	110	110	97	414	105.5	110	110	97	414	
14225													31.8	2	88.3	132.6	150	150	122	414	132.6	150	150	122	414	
230-3-60		18.6	149	29	19.6	136	31	5.2	13.4	0	8.6	None	—	—	—	66	70	80	70	410	66	70	80	70	410	
												11725	16	1	38.5	70.3	80	80	70	410	70.3	80	80	70	410	
												12525	24.8	1	59.7	96.8	100	100	89	410	96.8	100	100	89	410	
												13225	32	1	77	118.4	125	125	109	410	118.4	125	125	109	410	
												14225	42.4	2	102	149.6	150	150	138	410	149.6	150	150	138	410	
460-3-60		9	60.9	14	8.2	66.1	13	2.9	6.7	0	8.6	None	—	—	—	31.3	35	40	33	191	31.3	35	40	33	191	
												11746	16.5	1	19.8	35.8	40	40	33	191	35.8	40	40	33	191	
												12846	27.8	1	33.4	52.8	60	60	49	191	52.8	60	60	49	191	
												13346	33	1	39.7	60.7	70	70	56	191	60.7	70	70	56	191	
												14246	41.7	2	50.2	73.8	80	80	68	191	73.8	80	80	68	191	
575-3-60		7.1	56	11	6.6	55.3	10	2.2	5.4	0	8.6	None	—	—	—	24.8	25	30	26	164	24.8	25	30	26	164	
												11758	17	1	16.4	29.4	30	30	27	164	29.4	30	30	27	164	
												13458	34	1	32.7	49.8	50	50	46	164	49.8	50	50	46	164	

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.


3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.


## Weights and dimensions

ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 unit weights


**Figure 7: Unit 4 point load weight**

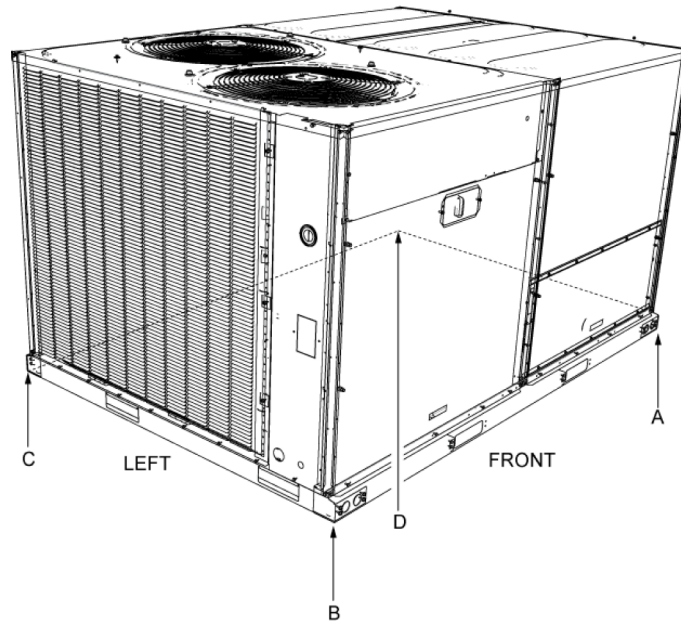

**Figure 8: Unit 6 point load weight**

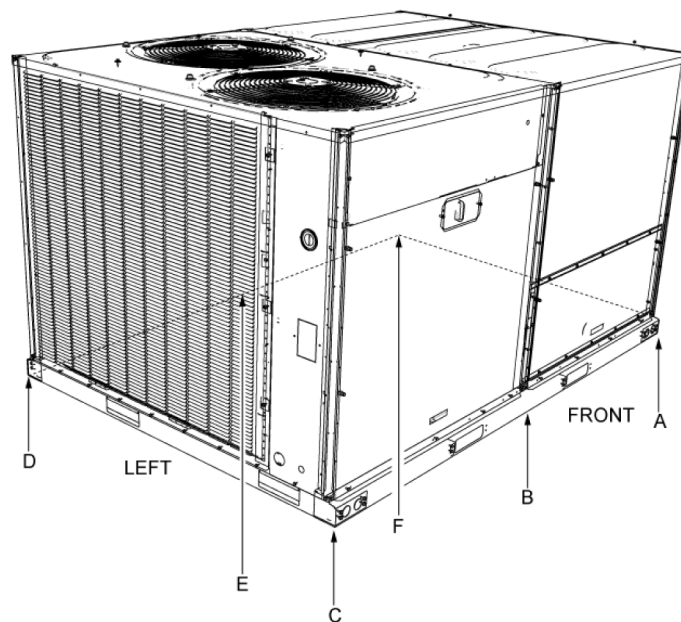

**Figure 9: Unit center of gravity**

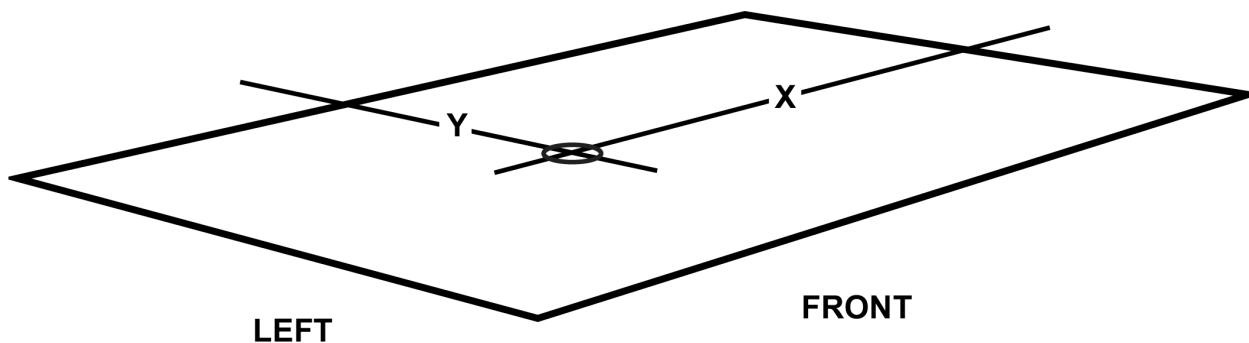

**Table 186: ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 corner weights**

Model	Size (ton)	Weight (lb)		Center of gravity		4 point load location (lb)				6 point load location (lb)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
ZQE	04 (3)	479	450	36	26	121	117	104	108	81	79	78	69	71	72
ZQE	05 (4)	516	487	36	26	131	124	113	119	88	85	82	75	77	80
ZQE	06 (5)	590	561	36	24	140	134	140	147	94	91	89	93	96	99
ZXE	A7 (6)	634	614	34	25	168	146	139	160	115	104	95	91	99	109
ZXE	08 (7.5)	787	782	47	36	211	245	175	151	138	151	167	119	108	98
ZXE	09 (8.5)	847	842	46	36	227	259	189	166	148	161	176	129	118	109
ZXE	12 (10)	874	869	46	36	239	268	191	170	156	169	182	130	120	111
ZXE	14 (12.5)	936	931	45	36	262	281	200	187	173	181	190	135	129	123
ZYE	04 (3)	486	481	36	25	127	118	113	122	86	82	78	75	78	82
ZYE	05 (4)	569	564	36	25	145	140	137	142	97	95	93	91	93	95
ZYE	06 (5)	587	582	36	25	151	145	140	146	101	99	96	93	95	98
ZYE	07 (6)	730	725	44	36	206	211	156	153	137	139	141	104	103	101
ZYE	A7 (6)	849	829	45	35	229	244	183	172	151	158	165	124	118	113
ZYE	08 (7.5)	873	868	46	36	236	268	193	171	154	167	182	132	121	111
ZYE	09 (8.5)	878	878	46	36	241	265	195	177	158	168	180	132	124	116
ZYE	12 (10)	907	902	47	36	239	278	207	178	155	171	190	142	128	116
ZLE	04 (3)	486	481	42	27	112	147	126	96	71	85	103	88	73	61
ZLE	05 (4)	569	564	36	26	153	145	130	137	103	99	96	86	89	92
ZLE	06 (5)	587	582	37	24	141	142	150	149	94	94	95	100	100	99
ZLE	08 (7.5)	925	920	45	37	262	282	195	181	173	181	191	131	125	119
ZLE	09 (8.5)	930	925	46	36	258	284	201	182	169	180	192	136	128	120
ZLE	12 (10)	960	955	46	35	258	287	216	194	169	181	195	146	136	127
ZLE	14 (12.5)	985	980	44	35	277	283	213	208	184	186	189	142	140	138

**Table 187: ZY04-12 and ZL04-14 corner weights with MagnaDRY option**

Model	Size (ton)	Weight (lb)		Center of gravity		4 point load location (lb)				6 point load location (lb)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
ZYE	04 (3)	494	489	36	25	130	120	115	124	87	83	79	76	80	84
ZYE	05 (4)	579	574	36	25	148	142	140	145	99	97	94	92	95	97
ZYE	06 (5)	597	592	36	25	154	148	142	148	103	100	98	94	97	100
ZYE	A7 (6)	848	843	45	35	230	246	190	177	151	158	166	128	122	117
ZYE	08 (7.5)	888	883	46	36	240	272	197	174	157	170	185	134	123	113
ZYE	09 (8.5)	898	893	46	36	245	270	199	180	161	171	183	135	126	118
ZYE	12 (10)	925	920	47	36	242	285	212	181	157	175	195	146	130	117
ZLE	04 (3)	494	489	42	27	114	150	127	97	73	87	104	89	74	62
ZLE	05 (4)	579	574	36	26	156	150	132	137	104	102	99	87	90	92
ZLE	06 (5)	599	594	37	24	144	145	153	152	96	96	97	102	102	101
ZLE	08 (7.5)	940	935	45	37	269	289	195	182	178	186	195	132	126	120
ZLE	09 (8.5)	945	940	46	36	256	290	209	185	167	181	197	143	131	121
ZLE	12 (10)	978	973	46	35	261	288	222	202	171	183	195	150	141	132
ZLE	14 (12.5)	1003	998	44	35	278	285	220	215	185	188	191	147	145	143

**Table 188: ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 corner weights**

Model	Size (ton)	Weight (lb)		Center of gravity		4 point load location (lb)				6 point load location (lb)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
ZQG	04 (3)	530	515	35	27	145	132	113	125	98	92	87	74	79	84
ZQG	05 (4)	557	552	36	27	154	144	123	131	104	99	95	81	85	89
ZQG	06 (5)	639	610	36	26	165	157	141	147	111	107	104	93	96	99
ZXG	A7 (6)	688	668	34	25	183	159	152	174	125	114	104	99	108	119
ZXG	07 (6)	651	646	34	26	183	155	141	167	125	112	101	92	102	114
ZXG	08 (7.5)	889	884	46	37	249	282	188	166	162	176	192	128	117	108
ZXG	09 (8.5)	949	944	45	36	266	288	203	187	175	184	194	137	130	123
ZXG	12 (10)	980	975	45	37	281	298	204	192	185	193	201	137	132	127
ZXG	14 (12.5)	1042	1037	44	37	301	309	216	210	200	203	207	145	142	140
ZYG	04 (3)	532	527	36	27	147	136	117	126	99	94	90	77	81	85
ZYG	05 (4)	623	618	36	26	167	156	142	152	113	108	103	94	98	103
ZYG	06 (5)	641	636	35	26	174	159	144	159	118	111	104	95	101	108
ZYG	07 (6)	800	795	43	37	237	233	161	164	159	157	155	107	108	109
ZYG	A7 (6)	919	899	45.0	35	249	265	199	187	164	171	179	134	128	123
ZYG	08 (7.5)	975	970	44	37	287	294	197	193	191	193	196	132	130	128
ZYG	09 (8.5)	980	970	45	36	276	289	207	198	183	188	194	139	135	131
ZYG	12 (10)	1013	1008	45	36	285	300	217	206	189	195	202	146	141	136
ZLG	04 (3)	560	555	42	27	129	170	146	111	82	98	118	102	84	71
ZLG	05 (4)	607	602	36	26	163	155	139	146	109	106	102	92	95	98
ZLG	06 (5)	636	631	37	25	160	160	156	155	106	107	107	104	104	103
ZLG	08 (7.5)	1045	1040	44	37	304	312	215	210	202	205	209	144	141	139
ZLG	09 (8.5)	1035	1030	45	36	294	309	219	208	194	201	208	147	142	138
ZLG	12 (10)	1055	1050	45	36	299	313	224	214	198	204	210	151	146	142
ZLG	14 (12.5)	1075	1070	44	36	309	316	225	220	205	208	211	151	148	146

**Table 189: ZY04-12 and ZL04-14 corner weights with MagnaDRY option**

Model	Size (ton)	Weight (lb)		Center of gravity		4 point load location (lb)				6 point load location (lb)					
		Shipping	Operating	X	Y	A	B	C	D	A	B	C	D	E	F
ZYG	04 (3)	540	535	36	27	149	139	119	128	101	96	91	79	82	87
ZYG	05 (4)	633	628	36	26	170	161	145	152	114	110	107	96	99	102
ZYG	06 (5)	651	646	35	26	179	161	145	161	122	113	106	95	102	109
ZYG	A7 (6)	918	913	45	35	249	267	206	192	164	172	180	139	132	127
ZYG	08 (7.5)	990	985	44	37	291	298	200	196	193	196	199	134	132	130
ZYG	09 (8.5)	1000	995	45	36	279	299	216	201	184	192	202	146	139	133
ZYG	12 (10)	1031	1026	45	36	290	305	221	210	192	198	205	148	143	139
ZLG	04 (3)	568	563	42	27	131	172	148	112	83	99	120	103	85	72
ZLG	05 (4)	617	612	36	26	166	157	141	148	111	108	104	93	96	100
ZLG	06 (5)	648	643	37	25	163	163	159	158	108	109	109	106	106	105
ZLG	08 (7.5)	1060	1055	44	37	313	319	213	209	208	211	213	143	141	139
ZLG	09 (8.5)	1050	1045	45	36	295	315	225	211	195	203	212	151	145	139
ZLG	12 (10)	1073	1068	45	36	302	322	230	215	199	208	217	155	148	142
ZLG	14 (12.5)	1093	1088	44	36	312	320	231	226	207	211	214	154	152	150

**Table 190: ZQ, ZX, ZY and ZL04-14 unit accessory weights**

Unit accessory	Weights (lb)
Powered convenience outlet factory installed	35
Non-powered convenience outlet factory installed	10
Vertical flow dry bulb economizer small footprint	63
Vertical flow dry bulb economizer large footprint	96
Horizontal flow dry bulb economizer small footprint short	75
Horizontal flow dry bulb economizer small footprint tall	81
Horizontal flow dry bulb economizer large footprint short	105
Horizontal flow dry bulb economizer large footprint tall	102
Power exhaust vertical flow small footprint	39
Power exhaust vertical flow large footprint	39
Power exhaust horizontal flow small footprint	39
Power exhaust horizontal flow large footprint	39
Hail guard kit small short factory installed	19
Hail guard kit small tall factory installed	24
Hail guard kit large short factory installed	50
Hail guard kit large tall factory installed	50

**Table 190: ZQ, ZX, ZY and ZL04-14 unit accessory weights**

Unit accessory	Weights (lb)
Flue extension kit (1FE0414)	15
Flue extension kit (1FE0415)	17
Flue extension kit (1FE0416)	19
Curb rigid 14 in. small footprint	145
Curb rigid 14 in. large footprint	135
Curb rigid 24 in. small footprint	135
Curb rigid 24 in. large footprint	135



# ZQ04-06, ZXA7, ZY04-12, ZL04-06 and ZL08-14 unit dimensions

Figure 10: ZQ04-05, ZL04 and ZY04

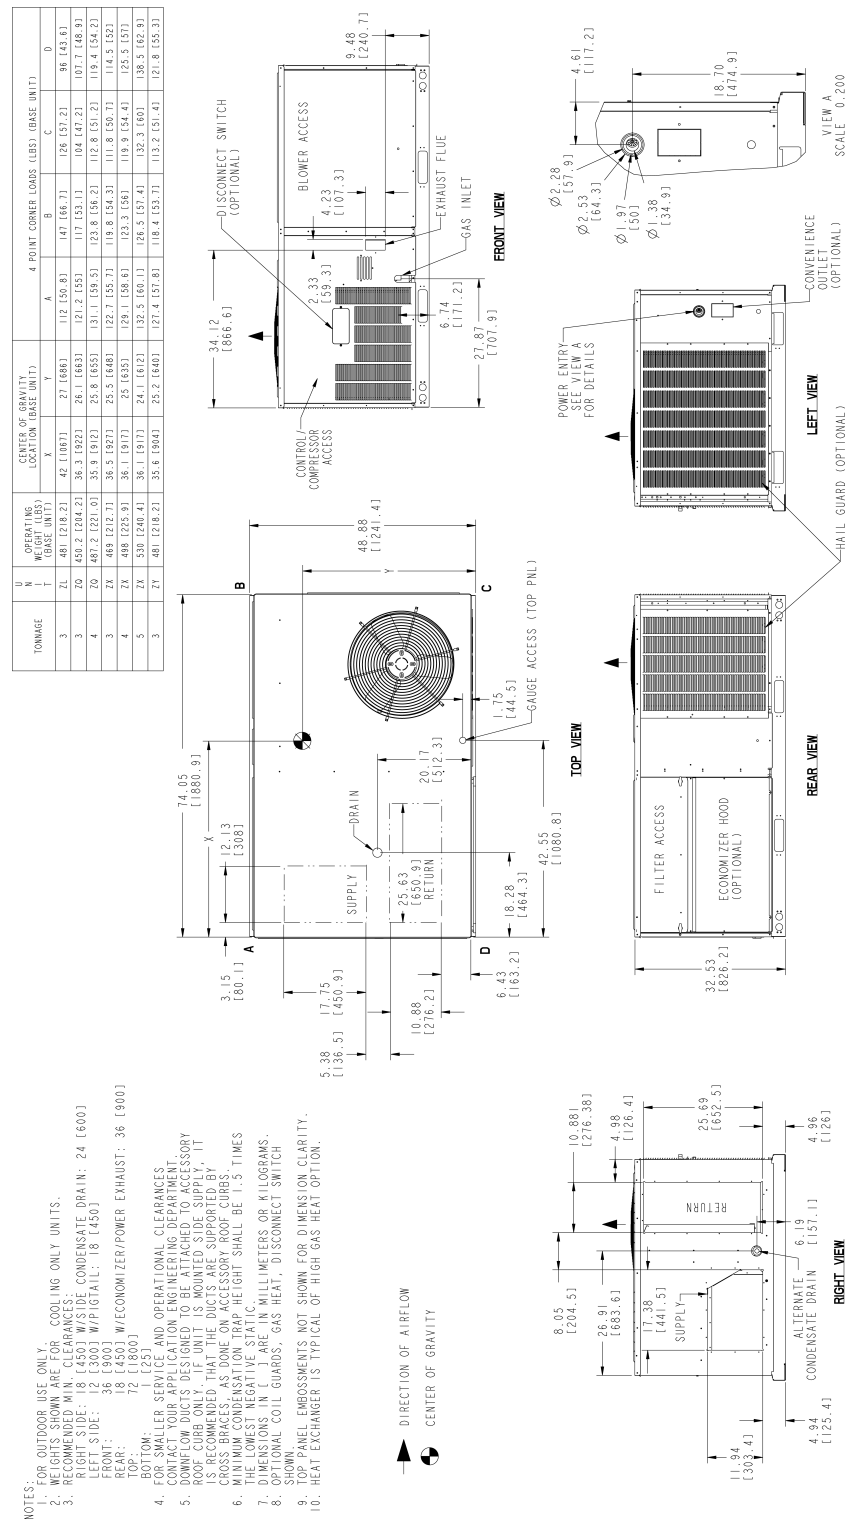


Figure 11: ZQ06, ZXA7, ZL05-06 and ZY05-06

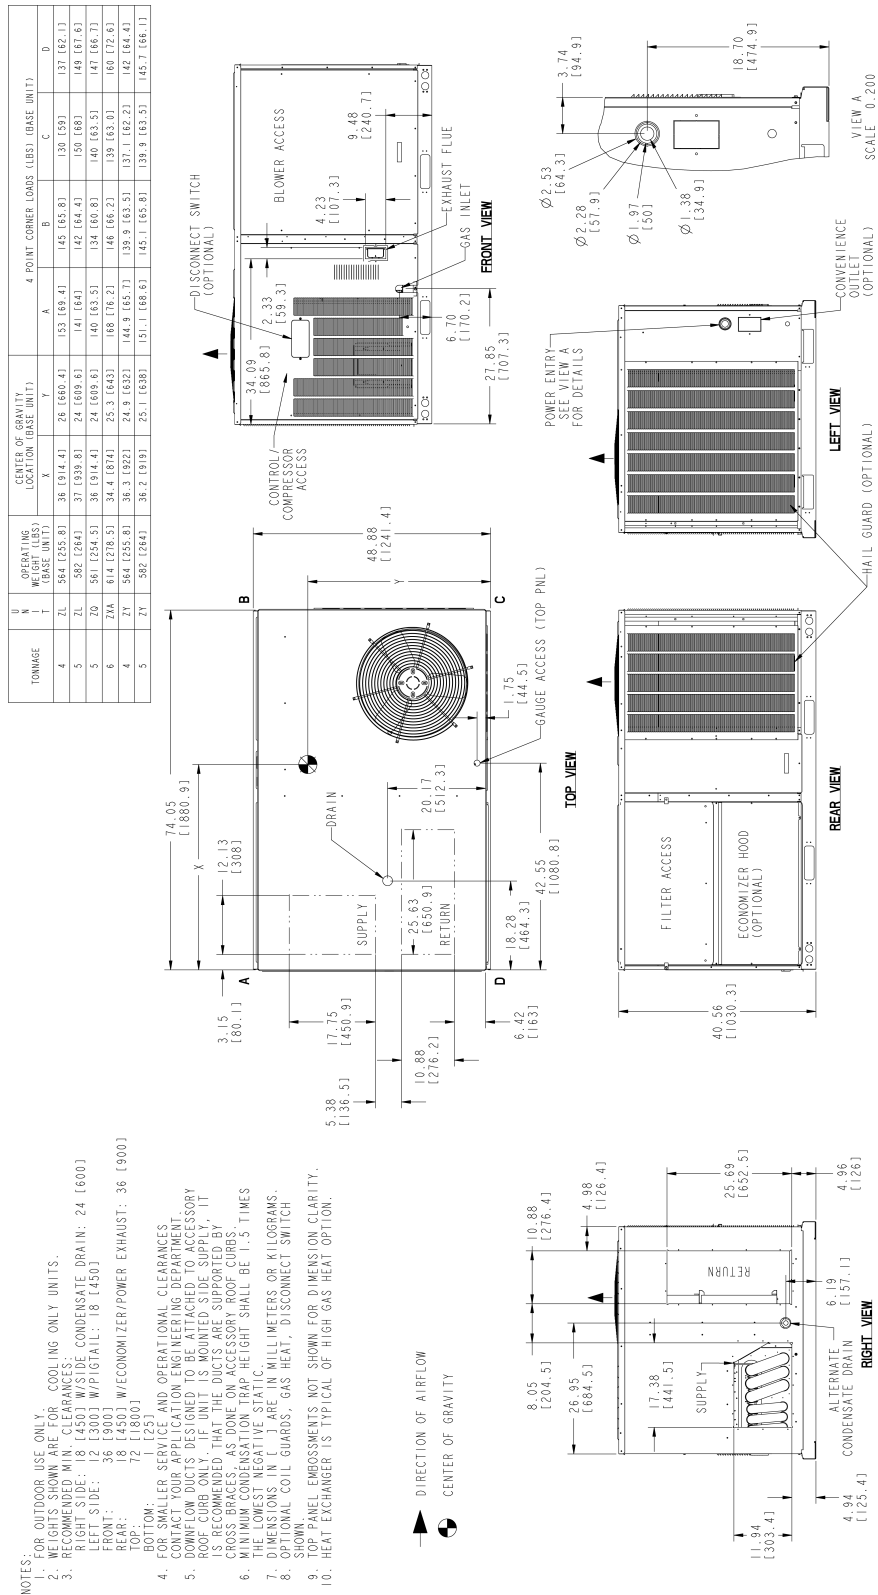


Figure 12: ZYA7

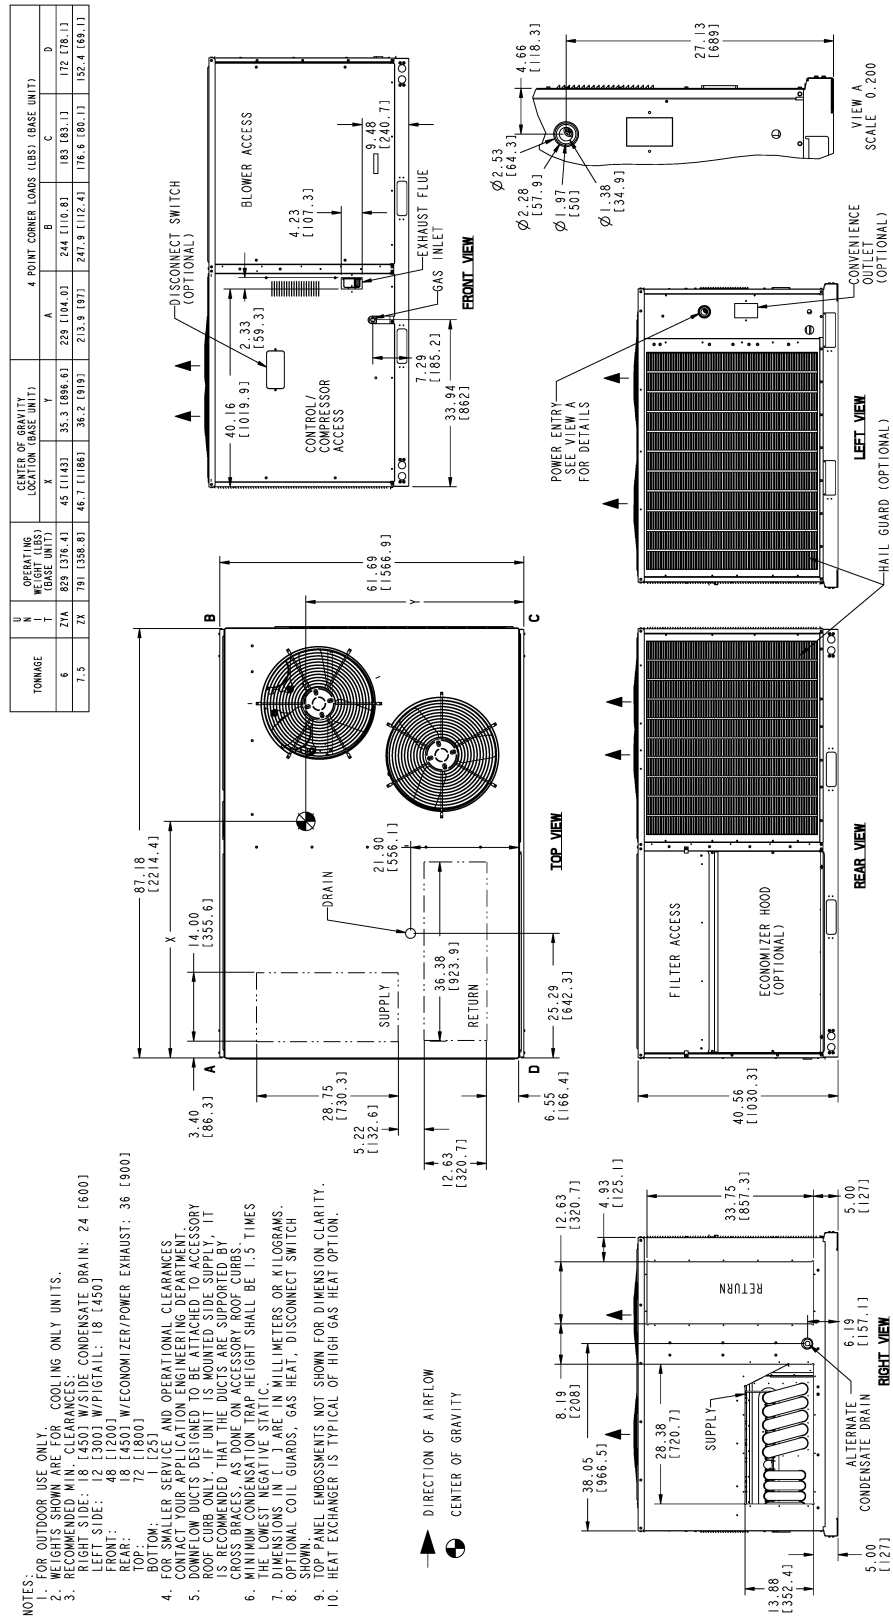


Figure 13: ZY08-09 and ZL08-09


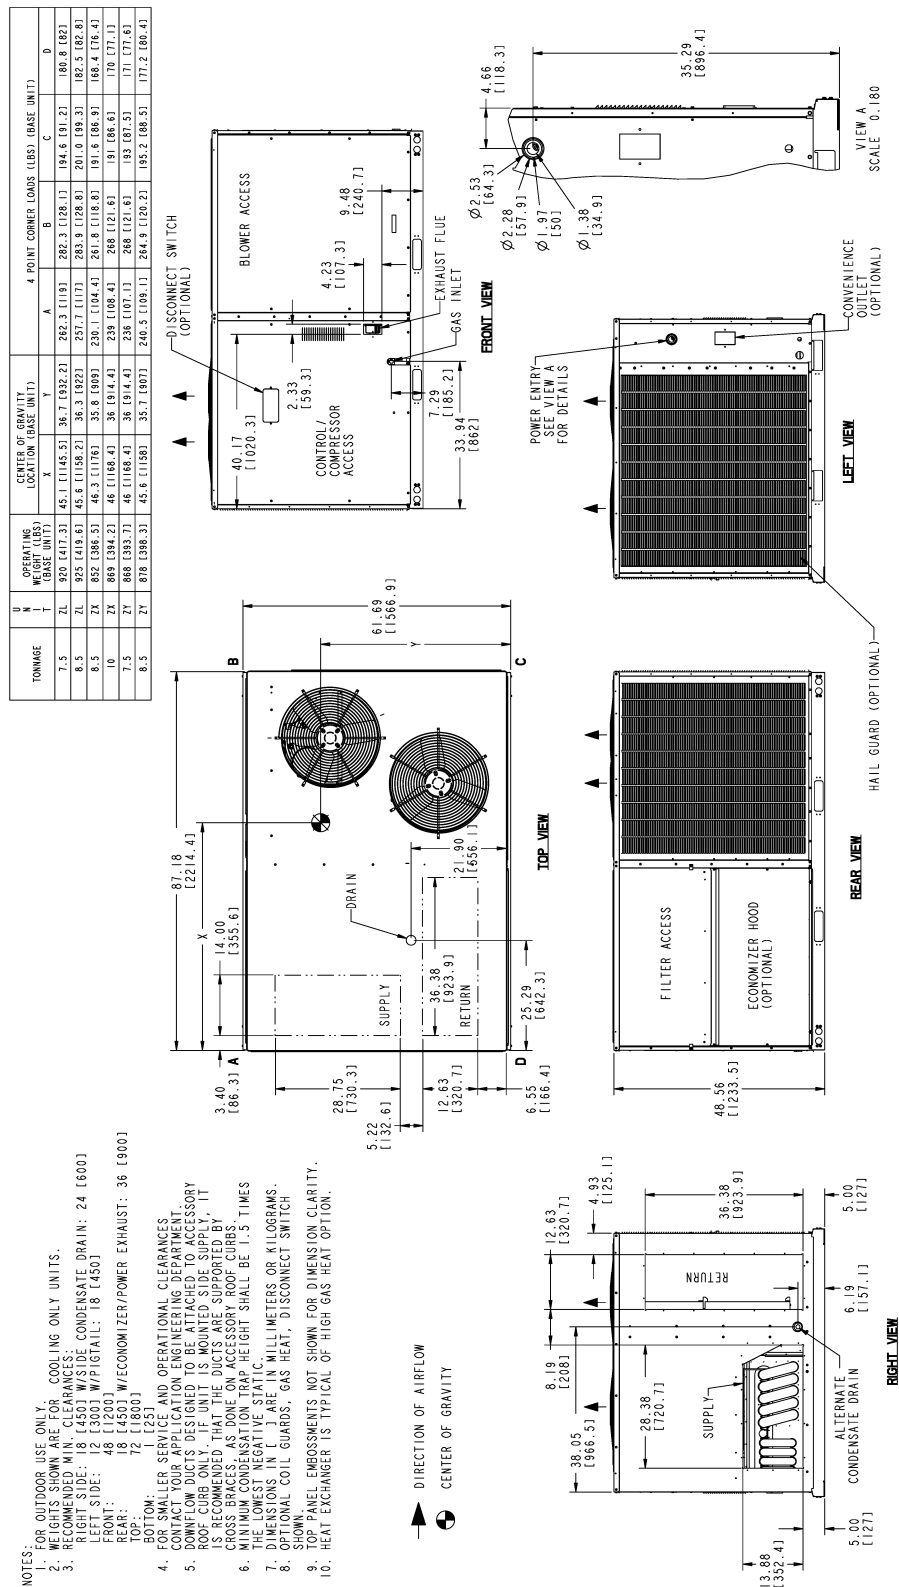


Figure 14: ZY12 and ZL 12-14

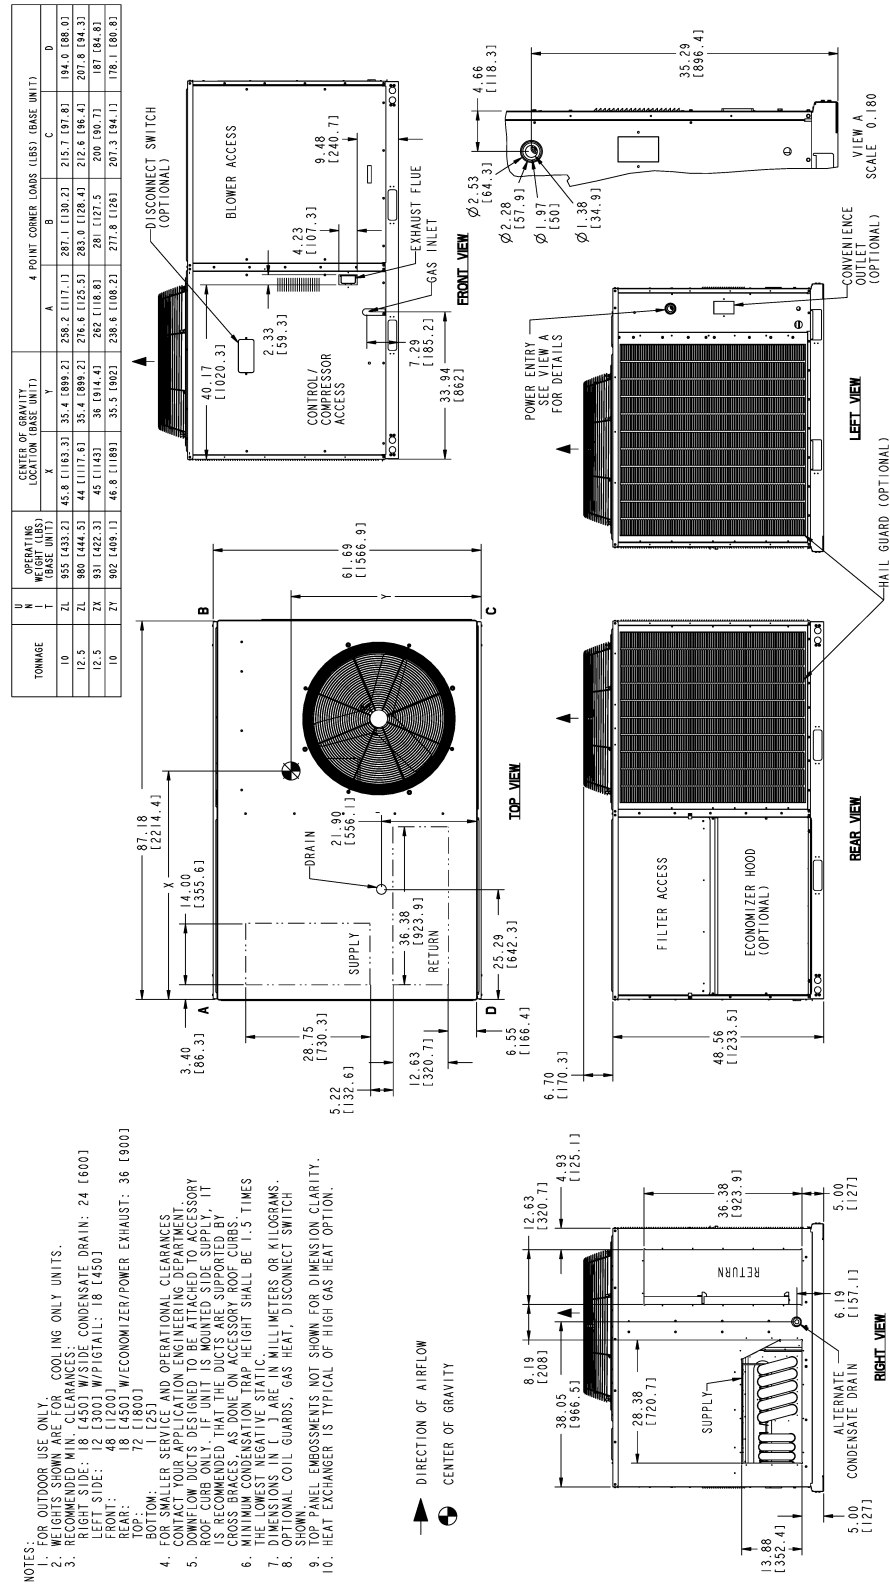

**Table 191: ZQ04-06, ZXA7, ZL04-06 and ZY04-06 unit clearances**

Direction	Distance (in.)	Direction	Distance (in.)
Top <sup>1</sup>	72	Right	18
Front	36	Left	12
Rear	18 <sup>2</sup> /36 <sup>3</sup>	Bottom <sup>4</sup>	1

- 1 Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
- 2 Units without economizer or power exhaust.
- 3 Units equipped with an economizer or power exhaust. Flue products must not be discharged within 10 ft of the rear of the unit.
- 4 Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.


**Table 192: ZYA7 and ZL08-14 unit clearances**

Direction	Distance (in.)	Direction	Distance (in.)
Top <sup>1</sup>	72	Right	18
Front	48	Left	12
Rear	18 <sup>2</sup> /36 <sup>3</sup>	Bottom <sup>4</sup>	1

- 1 Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
- 2 Units without economizer or power exhaust.
- 3 Units equipped with an economizer or power exhaust. Flue products must not be discharged within 10 ft of the rear of the unit.
- 4 Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.

## ZQ04-06, ZXA7, ZY04-12, ZL04-06 and ZL08-14 unit roof curb dimensions

**Figure 15: 1RC0456, 1RC0458 roof curb dimensions**

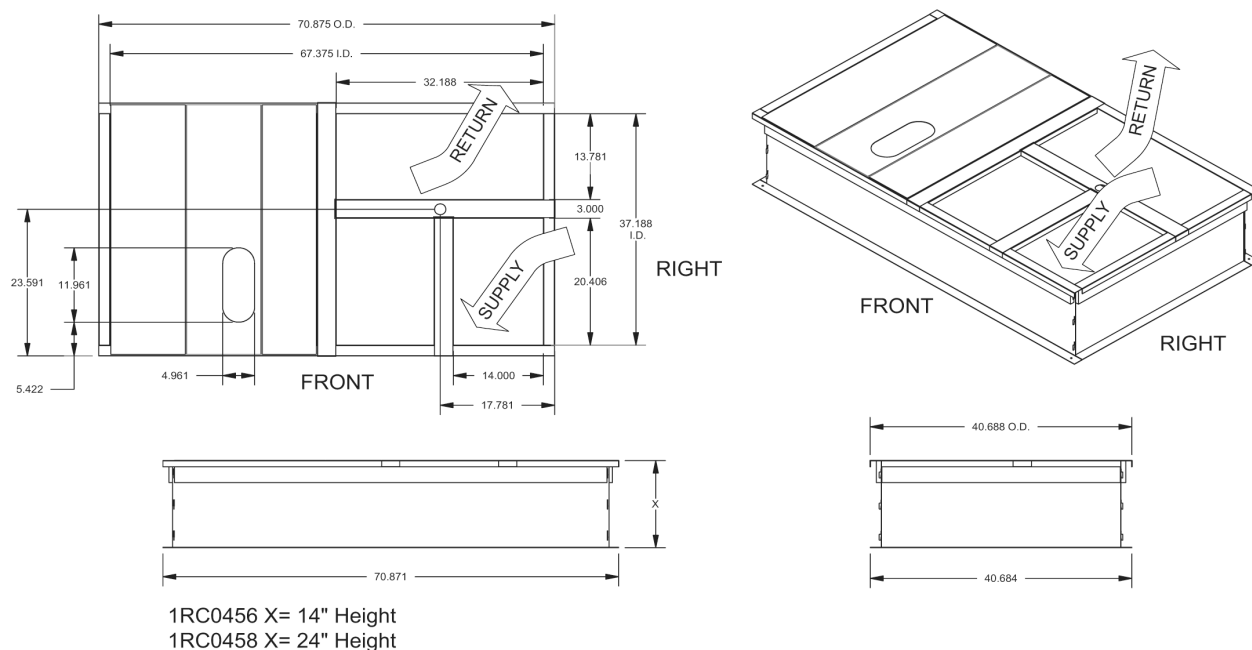

**Notes:**


1. Sides, ends and cross support are 18-G90. Deck pans, R/A & S/A supports are 20-G90.
2. Full perimeter wood nailer.
3. Insulated deck pans.

**Table 193: Unit models used with 1RC0456, 1RC0458 roof curb**

• ZQ04	• ZXA7	• ZY04	• ZL04
• ZQ05		• ZY05	• ZL05
• ZQ06		• ZY06	• ZL06

- ① **Note:** If utilities are required through the base of the unit or through the roof curb the following field installed accessories can be purchased through your dealer or contractor.
- ① **Note:** 1TB0401 - Thru the base electrical and through the curb gas  
1TB0403 - Thru the base electrical and gas

**Figure 16: 1RC0457, 1RC0459 roof curb dimensions**

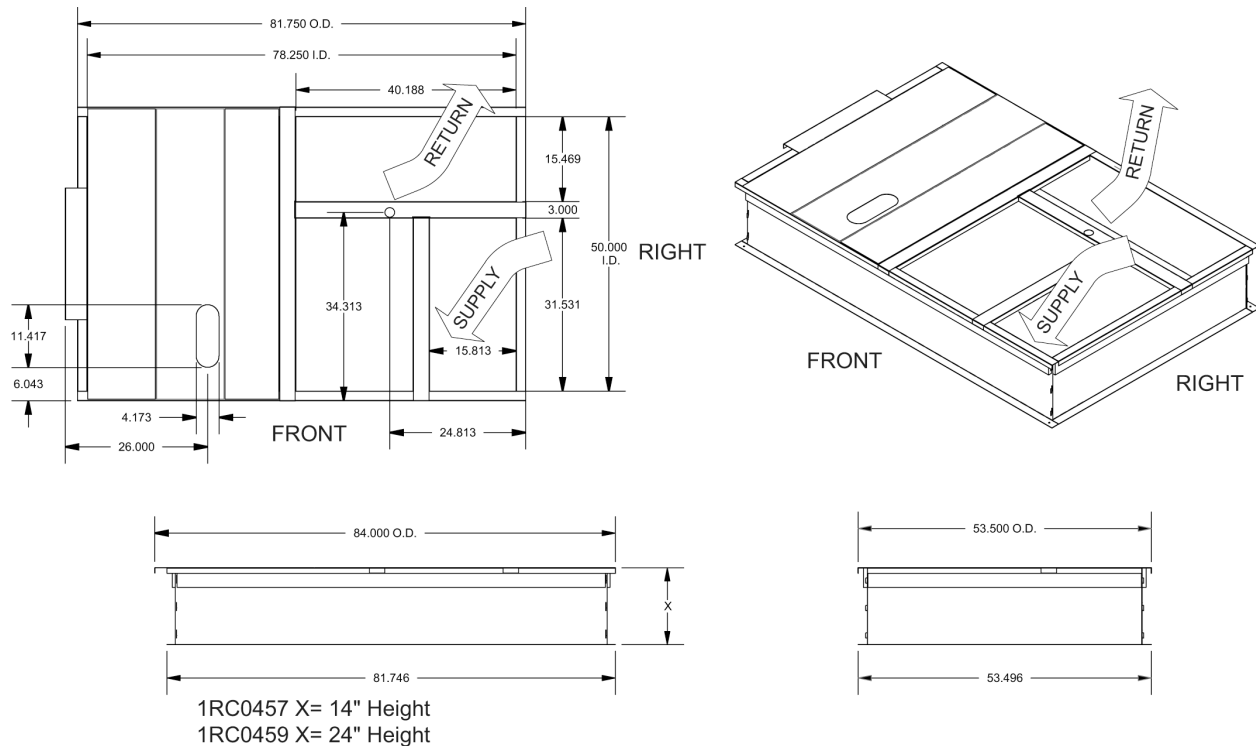

**Notes:**

1. Sides, ends, unit locator and cross support are 18-G90. Deck pans, R/A & S/A supports are 20-G90.
2. Full perimeter wood nailer.
3. Insulated deck pans.

**Table 194: Unit models used with 1RC0457, 1RC0459 roof curb**

- |        |        |
|--------|--------|
| • ZYA7 | • ZL08 |
| • ZY08 | • ZL09 |
| • ZY09 | • ZL12 |
| • ZY12 | • ZL14 |

ⓘ **Note:** If utilities are required through the base of the unit or through the roof curb the following field installed accessories can be purchased through your dealer or contractor:

ⓘ **Note:** 1TB0402 - Through the base electrical and through the curb gas,  
1TB0404 - Through the base electrical and gas




# Economizer options


**Table 195: Economizer usage**

Application	Description	Accessory kit number
Economizer vertical flow Everyday Thermostat Control	Econ, DB, vertical flow, small footprint w/barometric relief	2EE04706725
	Econ, DB, vertical flow, large footprint w/barometric relief	2EE04706825
Economizer vertical flow Smart Equipment Control	Econ, DB, vertical flow, small footprint	2EE04706724
	Econ, DB, vertical flow, large footprint	2EE04706824
Economizer horizontal flow Everyday Thermostat Control	Econ, DB, horizontal flow, small footprint, short cabinet w/barometric relief	2EE04707025
	Econ, DB, horizontal flow, small footprint, Tall cabinet w/barometric relief	2EE04707125
	Econ, DB, horizontal flow, large footprint, short cabinet w/barometric relief	2EE04707225
	Econ, DB, horizontal flow, large footprint, tall cabinet w/barometric relief	2EE04707325
Economizer horizontal flow Smart Equipment Control	Econ, DB, horizontal flow, small footprint, short cabinet	2EE04707024
	Econ, DB, horizontal flow, small footprint, tall cabinet	2EE04707124
	Econ, DB, horizontal flow, large footprint, short cabinet	2EE04707224
	Econ, DB, horizontal flow, large footprint, tall cabinet	2EE04707324
Power exhaust vertical flow	Power exhaust vert flow small footprint 208 V-230 V 1-ph	2PE04704206
	Power exhaust vert flow small footprint 208 V-230 V 3-ph	2PE04704225
	Power exhaust vert flow small footprint 460 V 3-ph	2PE04704246
	Power exhaust vert flow small footprint 575 V 3-ph	2PE04704258
	Power exhaust vert flow large footprint 208 V-230 V 1-ph	2PE04704306
	Power exhaust vert flow large footprint 208 V-230 V 3-ph	2PE04704325
	Power exhaust vert flow large footprint 460 V 3-ph	2PE04704346
	Power exhaust vert flow large footprint 575 V 3-ph	2PE04704358
Power Exhaust Horizontal Flow	Power exhaust horiz flow small footprint 208 V-230 V 1-ph	2PE04704406
	Power exhaust horiz flow small footprint 208 V-230 V 3-ph	2PE04704425
	Power exhaust horiz flow small footprint 460 V 3-ph	2PE04704446
	Power exhaust horiz flow small footprint 575 V 3-ph	2PE04704458
	Power exhaust horiz flow large footprint 208 V-230 V 1-ph	2PE04704506
	Power exhaust horiz flow large footprint 208 V-230 V 3-ph	2PE04704525
	Power exhaust horiz flow large footprint 460 V 3-ph	2PE04704546
	Power exhaust horiz flow large footprint 575 V 3-ph	2PE04704558


**Figure 17: Field Installed vertical flow economizer**

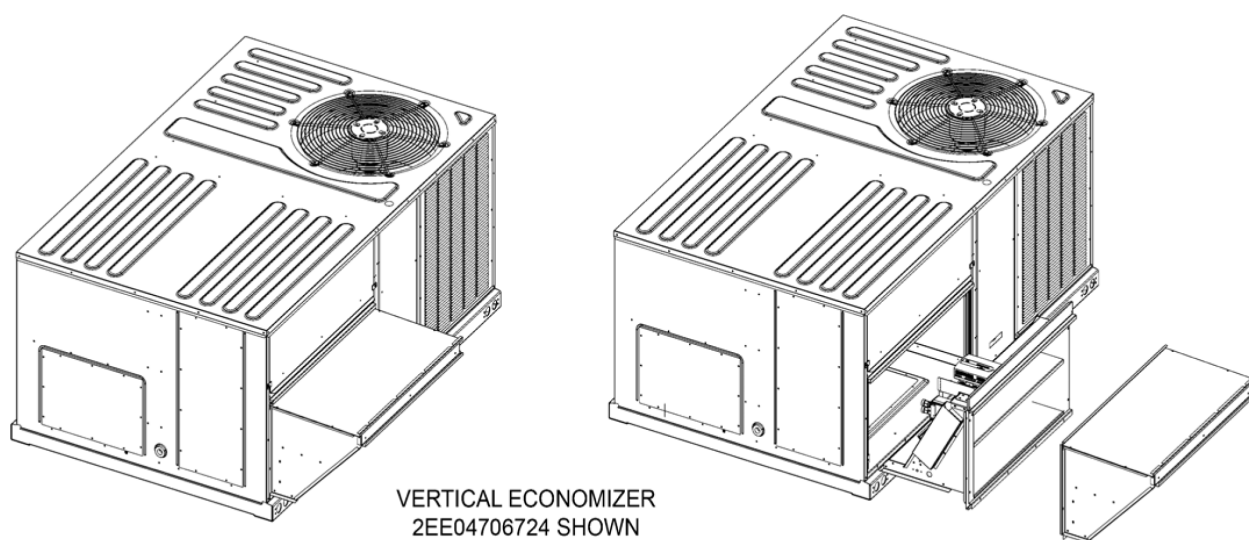


**Figure 18: Field installed vertical flow economizer w/power exhaust**

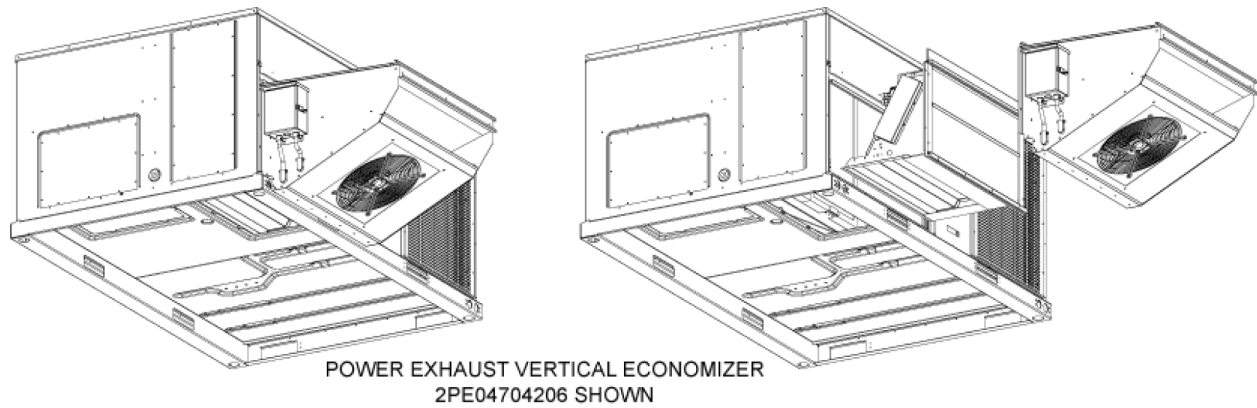

**Figure 19: Field installed horizontal flow economizer**

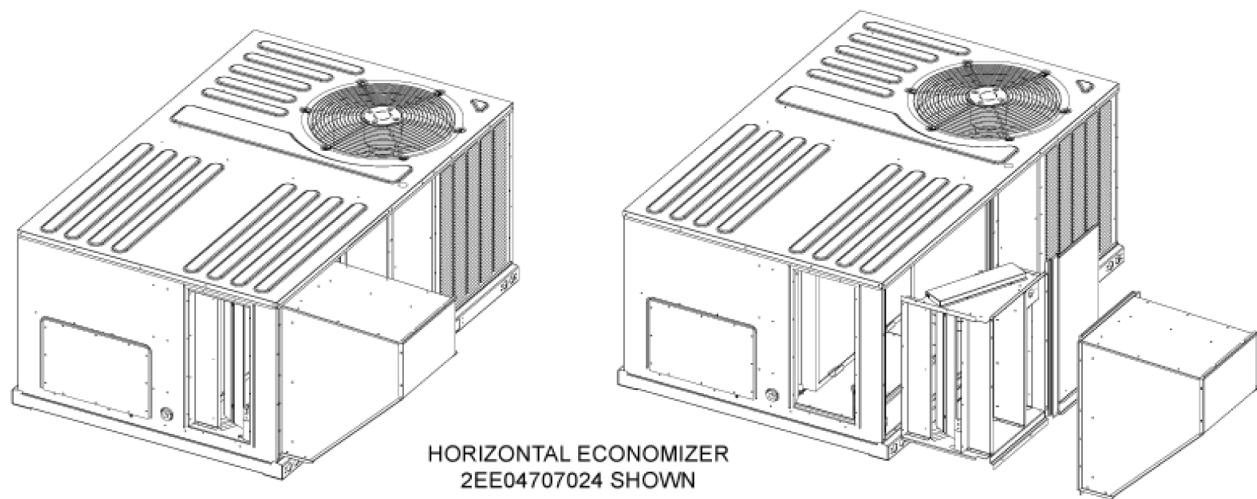

**Figure 20: Field installed horizontal flow economizer w/power exhaust**

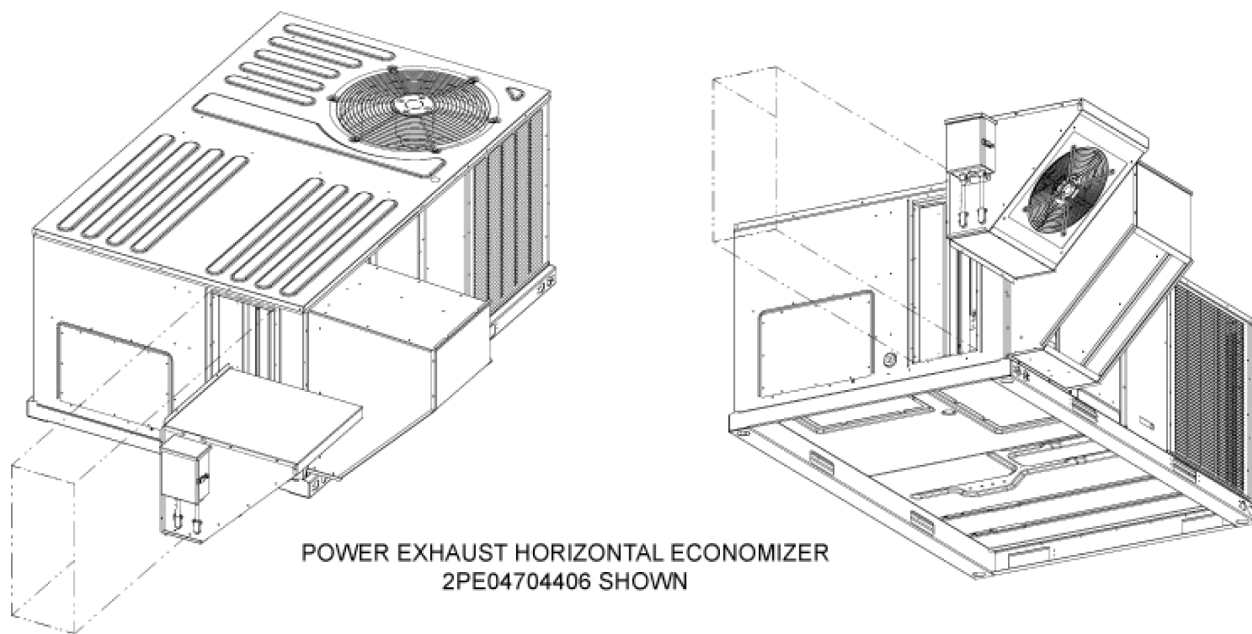

# Guide specifications

## DUCTED SYSTEMS GUIDE MECHANICAL SPECIFICATIONS SINGLE PACKAGE AIR CONDITIONERS

3 THRU 12-1/2 NOMINAL TONS

### Ducted Systems Core SERIES

Size Range: 3 to 12-1/2 Tons Nominal Cooling

45,000 to 200,000 BTUH Nominal Gas Heating Output

Model Series: ZQ, ZX, ZY & ZL

## DIVISION 23 – HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

Number   Title

### 23 00 00 HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

#### 23 06 80 Schedules for Decentralized HVAC Equipment

23 06 80.13 Decentralized Unitary HVAC Equipment Schedule

23 06 80.13.A. Rooftop unit schedule

1. Schedule is per the project specification requirements.

#### 23 07 16 HVAC Equipment Insulation

23 07 16.13.C. Economizer and Control compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, foil faced fiber glass insulation with thermal conductivity of 0.24 or better, adhered with acrylate polymer based adhesive
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

#### 23 09 13 Instrumentation and Control Devices for HVAC

23 09 13.23 Sensors and Transmitters

23 09 13.23.A. Thermostats

1. Thermostat must
  - a. Energize "Y" when calling for cooling and "W" when calling for heating.
  - b. Shall have capability to energize 2 stages of cooling and 2 stages of heating.

#### 23 09 23 Direct-digital Control system for HVAC

23 09 23.13 Decentralized, Rooftop Units:

23 09 23.13.B. ETC Control)

1. Unit shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-volt transformer side.
2. Unit shall incorporate a lockout circuit which provides reset capability at the space thermostat or base unit, should any of the following standard safety devices trip and shut off compressor.
3. Loss-of-charge/Low-pressure switch.
4. High-pressure switch.
5. Freeze-protection thermostat, evaporator coil.

7. Unit shall operate with conventional thermostat designs and have a low voltage terminal strip for easy hook-up.
8. Unit control board shall have on-board diagnostics and fault code display.
9. Standard controls shall include anti-short cycle and low voltage protection, and permit cooling operation down to 0°F.
10. Control board shall monitor each refrigerant safety switch independently.
11. Control board shall retain last 5 fault codes in nonvolatile memory which will not be lost in the event of a power loss.

### **23 09 33 Electric and Electronic Control System for HVAC**

23 09 33.13 Decentralized, Rooftop Units: 23 09 33.13.A. General:

1. Shall be complete with self contained low voltage control circuit protected by a resettable circuit breaker on the 24 v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, economizer, thermostat, and low and high pressure switches.
4. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor. See heat exchanger section of this specification.

23 09 33.23.B. Safeties:

1. Compressor over temperature, over current. High internal pressure differential.
2. Low pressure switch and high pressure switch
  - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. Automatic reset, motor thermal overload protector.
4. Heating section shall be provided with the following minimum protections:
  - a. High temperature limit switches.
  - b. Induced draft pressure sensor.
  - c. Flame rollout switch (except Ultra-Low NOx (ULN) models).
  - d. Flame proving controls.

### **23 40 13 Panel Air Filters**

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory installed, low velocity, disposable 1 in. thick fiberglass filters of commercially available sizes.
2. Units can accept 1" or 2" filters and have a field convertible tool less transition.
3. Filters shall be accessible through an access panel; hinged panel with "no tool" removal option is available as described in the unit cabinet section of this specification (23 81 19.13.H).

### **238119 Self Contained Air Conditioners**

23 81 19.13 Small Capacity Self Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic, suction gas cooled, direct drive compressor(s) for cooling duty and gas combustion or nickel chromium elements for heating duty.
2. Factory assembled, single piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start up.
3. Unit shall use environmentally sound, R-410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

#### 23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
2. Unit shall be rated in accordance with AHRI Standards 210/240 or 340/360.
3. Unit shall be designed to conform to ASHRAE 15, 2001.
4. Unit shall be UL tested and certified in accordance with ANSI Z21.47 -2012/CSA 2.3-2012, CSA C22.2 No. 236-11 (UL 1995) 4th edition and CSA C22.2 No. 3 - M 1988.
5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
6. Unit casing shall be capable of withstanding 1000 hour salt spray exposure per ASTM B117 (scribed specimen).
7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
8. Roof curb shall be designed to conform to NRCA Standards.
9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
10. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box.
12. Unit shall be tested to assurance Truck 2, ASTM D4169 to ensure shipping reliability.

#### 23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Overhead crane can be used to place the units on a roof using rigging holes built into the unit base rails without any additions to the unit.
3. Unit shall only be stored or positioned in the upright position.

#### 23 81 19.13.E. Project Conditions

As specified in the contract.

#### 23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at  $\pm 10\%$  voltage.
2. Compressor with standard controls shall be capable of operation down to 30°F (-1°C), ambient outdoor temperatures.
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal airflow on all models.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

#### 23 81 19.13.I. Gas Heat

1. General
  - a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
  - b. Shall incorporate a direct spark ignition system and redundant main gas valve.
  - c. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.
2. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor.
  - a. IGC board shall notify users of fault using an LED (light emitting diode).
  - b. The LED shall be visible without removing the control box access panel.
  - c. IGC board shall contain algorithms that modify evaporator fan operation to prevent future cycling on high temperature limit switch.
  - d. Unit shall be equipped with anti cycle protection with one short cycle on unit flame rollout switch.



or 4 continuous short cycles on the high temperature limit switch. Fault indication shall be made using an LED.

3. Standard Heat Exchanger construction

- a. Heat exchanger shall be of the tubular section type constructed of a minimum of 20 gauge steel coated with a nominal 1.2mil aluminum silicone alloy for corrosion resistance.
- b. Burners shall be of the in shot type constructed of aluminum coated steel. **Note:** Burners for Ultra-Low NOx models are pre-mix type.
- c. Burners shall incorporate orifices for rated heat output up to 2000 ft. (610m) elevation. Additional accessory kits may be required for applications above 2000 ft. (610m) elevation, depending on local gas supply conditions.
- d. Each heat exchanger tube shall contain multiple dimples for increased heating effectiveness.

4. Optional Stainless Steel Heat Exchanger construction

- a. Use energy saving, direct spark ignition system.
- b. Use a redundant main gas valve.
- c. Burners shall be of the in shot type constructed of aluminum coated steel. **Note:** Burners for Ultra-Low NOx models are pre-mix type.
- d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
- e. The optional stainless steel heat exchanger shall be of the tubular section type, constructed of a minimum of 20 gauge type 409 or 439 stainless steel.
- f. Type 409 or 439 stainless steel shall be used in heat exchanger tubes and vestibule plate.

5. Optional Low NOx Heat Exchanger construction

- a. Low NOx reduction shall be provided to reduce nitrous oxide emissions to meet California's Air Quality Management District (SCAQMD) low NOx emissions requirement of 40 nanograms per joule or less.
- b. Ultra-Low NOx (ULN) models shall meet current SCAQMD NOx emissions requirement of 14 nanograms per joule or less.

6. Induced draft combustion motor and blower

- a. Shall be a direct drive, single inlet, forward curved centrifugal type.
- b. Shall be made from steel with a corrosion resistant finish.
- c. Shall have permanently lubricated sealed bearings.
- d. Shall have inherent thermal overload protection.
- e. Shall have an automatic reset feature.

23 81 19.13.L. Refrigerant Circuits

1. All units shall have one or two refrigerant circuits.
2. Refrigerant circuit shall include the following control, safety, and maintenance features:
  1. Refrigerant filter drier Solid core design.
  2. Service gauge connections on suction and discharge lines.
3. Compressors
  1. Unit shall use fully hermetic, scroll compressors for each independent refrigeration circuit.
  2. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
  3. Compressors shall be internally protected from high discharge temperature conditions.
  4. Compressors shall be protected from an over temperature and over amperage conditions by an internal, motor overload device.
  5. Compressor shall be factory mounted on rubber grommets.
  6. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
  7. All non-Scroll compressors include Crankcase heaters.

23 81 19.13.M.Filter Section

1. Filters access is specified in the unit cabinet section of this specification.

23 81 19.13.N. Evaporator Fan and Motor

1. Evaporator fan motor:
  - a. Shall have permanently lubricated ball-bearings.
  - b. Shall have inherent automatic reset thermal overload protection.
  - c. The job site selected brake horsepower shall be required to not exceed the motor's nameplate horsepower rating plus the service factor.
2. Evaporator Fan:
  - a. Fan shall be a factory installed direct-drive (optional) or standard belt drive assembly with an adjustable pitch motor pulley.
  - b. Shall use sealed, permanently lubricated ball
  - c. Blower fan shall be double inlet type with forward curved blades.
  - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.O. Multi-speed Fan Control

1. IntelliSpeed staged air volume system:
  - a. Fan speed shall be matched with staging of compressor operation.
2. Variable Frequency Drive (VFD):
  - a. Shall contain a variable frequency drive tied to the evaporator fan motor.
  - b. Shall be installed inside the unit cabinet, mounted, wired and tested.
  - c. Shall contain Electromagnetic Interference (EMI) frequency protection.
  - d. Insulated Gate Bi Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform.
  - e. Built in LED display and controls. Does not require additional kit or options.
  - f. RS485 capability standard.
  - g. Electronic thermal overload protection.
  - h. 5% swinging chokes for harmonic reduction and improved power factor.
  - i. All printed circuit boards shall be conformal coated.

23 81 19.13.P. Condenser Fans and Motors

1. Condenser fan motors:
  - a. Shall be a totally enclosed motor.
  - b. Shall use permanently lubricated ball-bearings.
  - c. Shall have inherent thermal overload protection with an automatic reset feature.
  - d. Shall use a shaft down design.
2. Condenser Fans:
  - a. Shall be a direct driven propeller type fan.
  - b. Shall have aluminum blades riveted to corrosion resistant steel spider brackets and be dynamically balanced.

23 81 19.13.Q. Special Features Options and Accessories

1. Standard Integrated Economizer:
  - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
  - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Damper blades shall be class 1A dampers.
  - e. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
  - f. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for



- positive air stream control.
- g. Economizer shall comply with, and be certified to, the AMCA 511 standard.
- h. Standard leak rate shall be equipped with dampers not to exceed 3 cfm/ft<sup>2</sup> leakage at 1 in. wg pressure differential.
- i. Johnson Controls RRS Economizer shall be the field installed option for units equipped with the ETC controller
  - 1. On board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, meets the requirements for California Title 24, IECC 2015, and ASHRAE 90.1
  - 2. Display alarms if the following occur
    - i. Economizer is economizing when conditions do not support
    - ii. Economizer is not economizing when conditions do support
    - iii. Damper Stuck
    - iv. Excess Outdoor Air
    - v. Failed Sensor
  - 3. Automatic sensor detection
  - 4. Capabilities for use with multiple speed indoor fan systems
  - 5. Utilize digital sensors: Dry bulb and Enthalpy
  - 6. UL, CSA, and ICES-003 recognized and FCC compliant to CFR47
- j. Shall be capable of introducing up to 100% outdoor air.
- k. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements. Barometric relief can be replaced by optional power exhaust.
- l. Shall be designed to close damper(s) during loss of power situations with spring return built into motor.
- m. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor set point shall be adjustable and shall range from 40° to 80°F / 4° to 27°C. Additional sensor options shall be available as accessories.
- n. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
- o. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
- p. Dampers shall be completely closed when the unit is in the unoccupied mode.
- q. Economizer controller shall accept a 2 10 Vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
- r. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
- s. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
- 2. Barometric Relief Kit
  - a. Shall contain all materials necessary to field install a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
- 3. Manual Fresh Air Damper
  - a. Shall contain all materials necessary to field install a manual fresh air damper.
  - b. Shall include a slide-in damper assembly with an outdoor hood and filters.
  - c. Shall be available with either a range of 0%-100% outdoor air entry or 0%-35% outdoor air entry.
- 4. Motorized Damper
  - a. Damper shall be a Two Position Damper. Damper travel shall be from the full closed position to the field adjustable % open setpoint.

- b. Damper shall include adjustable damper travel from 0% to 100% (full open).
  - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
  - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
  - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
  - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
  - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
  - h. Outside air hood shall include aluminum water entrainment filter.
5. Manual damper
- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25 or 50% outdoor air for year round ventilation.
6. Propeller Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Horizontal power exhaust shall be mounted in return ductwork.
  - c. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0 100% adjustable set point on the economizer control.
7. Single Enthalpy Sensor Kit
- a. The single enthalpy sensor kit shall provide a relative humidity sensor to be mounted in the outdoor air stream to provide single enthalpy economizer control
  - b. The sensor allows the unit to determine if outside air is suitable for free cooling.
8. Dual Enthalpy Sensor Kit:
- a. The dual enthalpy sensor kit shall provide 2 relative humidity sensors to be mounted in the return and outdoor air streams to provide dual enthalpy economizer control.
  - b. This kit contains all components required for dual enthalpy control and does not need to be used in conjunction with the Single Enthalpy Sensor Kit.
9. CO2 Sensor:
- a. Shall be able to provide demand ventilation control for indoor air quality (IAQ) or outdoor air quality (OAQ).
  - b. The CO2 sensor shall be available in duct mount or wall mount with LED display.
  - c. The set-points for IAQ and OAQ shall have adjustment capability between 0 and 5000 ppm in the RRS Economizer controls.
10. Smoke detectors:
- a. Shall be a Four Wire Controller and Detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift free sensitivity.
  - c. Shall use magnet activated test/reset sensor switches.
  - d. Shall have a recessed momentary switch for testing and resetting the detector.
  - e. Controller shall include:
    - 1. One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
    - 2. Two Form C auxiliary alarm relays for interface with rooftop unit or other equipment.
    - 3. One Form C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
    - 4. Capable of direct connection to two individual detector modules.
    - 5. Can be wired to up to 49 other duct smoke detectors for multiple fan shutdown applications