

### EFFICIENT 13 SEER AIR CONDITIONER ENVIRONMENTALLY SOUND R-410A REFRIGERANT 2.5 THRU 5 TONS SPLIT SYSTEM

**208/230, 460 & 575 Volt, 3-phase, 60 Hz  
REFRIGERATION CIRCUIT**

- Scroll compressors on all models
- Filter-Drier supplied with every unit for field installation
- Copper tube / aluminum fin coil

#### EASY TO INSTALL AND SERVICE

- Easy Access service valves on all models
- External high and low refrigerant service ports
- Only two screws to access control panel
- Factory charged with R-410A refrigerant

#### BUILT TO LAST

- Baked-on powder coat finish over galvanized steel
- Post-painted (black) coil fins
- Coated, weather-resistant cabinet screws
- Coated inlet grille with 2" (51mm) spacing standard, alternate models available with 3/8" (10mm) grille spacing for extra protection (hail guard)

#### WARRANTY\*

- 5 year compressor limited warranty
- 5 year parts limited warranty (including compressor and coil)
  - With timely registration, an additional 5 year parts limited warranty (including compressor and coil)

\* For owner occupied, residential applications only. See warranty certificate for complete details and restrictions, including warranty coverage for other applications.




Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to [www.ahridirectory.org](http://www.ahridirectory.org).



Model Number	Size (tons)	Nominal BTU/hr	Min. Circuit Ampacity	Max. Fuse or Breaker	Operating Dimensions height x width x depth in. (mm)	Ship / Operating Weight lbs. (kg)
N4A330GHC	2-1/2	30,000	11.2	20	28-11/16 x 23-1/8 x 23-1/8 (729 x 587 x 587)	136 / 111(62 / 50)
N4A336GHB	3	36,000	14.5	20	31-13/16 x 25-3/4 x 25-3/4 (808 x 654 x 654)	170 / 141(77 / 64)
N4A336GLB			7.7	15		170 / 141(77 / 64)
N4A336GSB			5.3	15		
N4A342GHA	3-1/2	42,000	18.0	30	32-5/16 x 31-3/16 x 31-3/16 (821 x 792 x 792)	218 / 190(99 / 86)
N4A342GLA			8.1	15		
N4A348GHB	4	48,000	17.8	30	35-3/4 x 31-3/16 x 31-3/16 (908 x 792 x 792)	224 / 186(102 / 84)
N4A348GLB			8.3	15		
N4A348GSB			6.0	15		
N4A360GHC	5	60,000	21.4	30	28-15/16 x 31-3/16 x 31-3/16 (735 x 792 x 792)	230 / 198(104 / 90)
N4A360GLC			10.5	15		
N4A360GSC			7.6	15		

OUTDOOR UNIT MODEL NUMBER IDENTIFICATION GUIDE											
Digit Position:	1	2	3	4	5, 6	7	8	9	10	11	12
Example Part Number:	<b>N</b>	<b>4</b>	<b>A</b>	<b>3</b>	<b>18</b>	<b>A</b>	<b>H</b>	<b>B</b>	<b>1</b>	<b>0</b>	<b>0</b>
H = Arcoaire Mainline											
N = Arcoaire Entry <b>BRANDING</b>											
4 = R-410A <b>REFRIGERANT</b>											
A = Air Conditioner											
H = Heat Pump <b>TYPE</b>											
3 = 13 SEER											
4 = 14 SEER <b>NOMINAL EFFICIENCY</b>											
30 = 30,000 BTUH = 2-1/2 tons											
36 = 36,000 BTUH = 3 tons											
42 = 42,000 BTUH = 3-1/2 tons											
48 = 48,000 BTUH = 4 tons											
60 = 60,000 BTUH = 5 tons <b>NOMINAL CAPACITY</b>											
A = Standard Grille											
G = Coil Guard Grille											
C = Coastal <b>FEATURES</b>											
H = 208/230-3-60											
L = 460-3-60											
S = 575-3-60 <b>VOLTAGE</b>											
Sales Code											
Engineering Revision											
Extra Digit											
Extra Digit											

ACCESSORIES PART NUMBER IDENTIFICATION GUIDE										
Digit Position:	1	2	3	4	5	6, 7	8, 9	10, 11		
Example Part Number:	N	A	S	A	0	0 1	01	CH		
N = Non-Branded		BRANDING								
A = Accessory		PRODUCT GROUP								
S = Split System (AC & HP)		KIT USAGE								
A = Original										
B = 2nd Generation		MAJOR SERIES								
0 = Generic or Not Applicable										
2 = R-22										
4 = R-410A		REFRIGERANT								
Product Identifier Number										
Package Quantity										
Type of Kit (Example: CH = Crankcase Heater)										

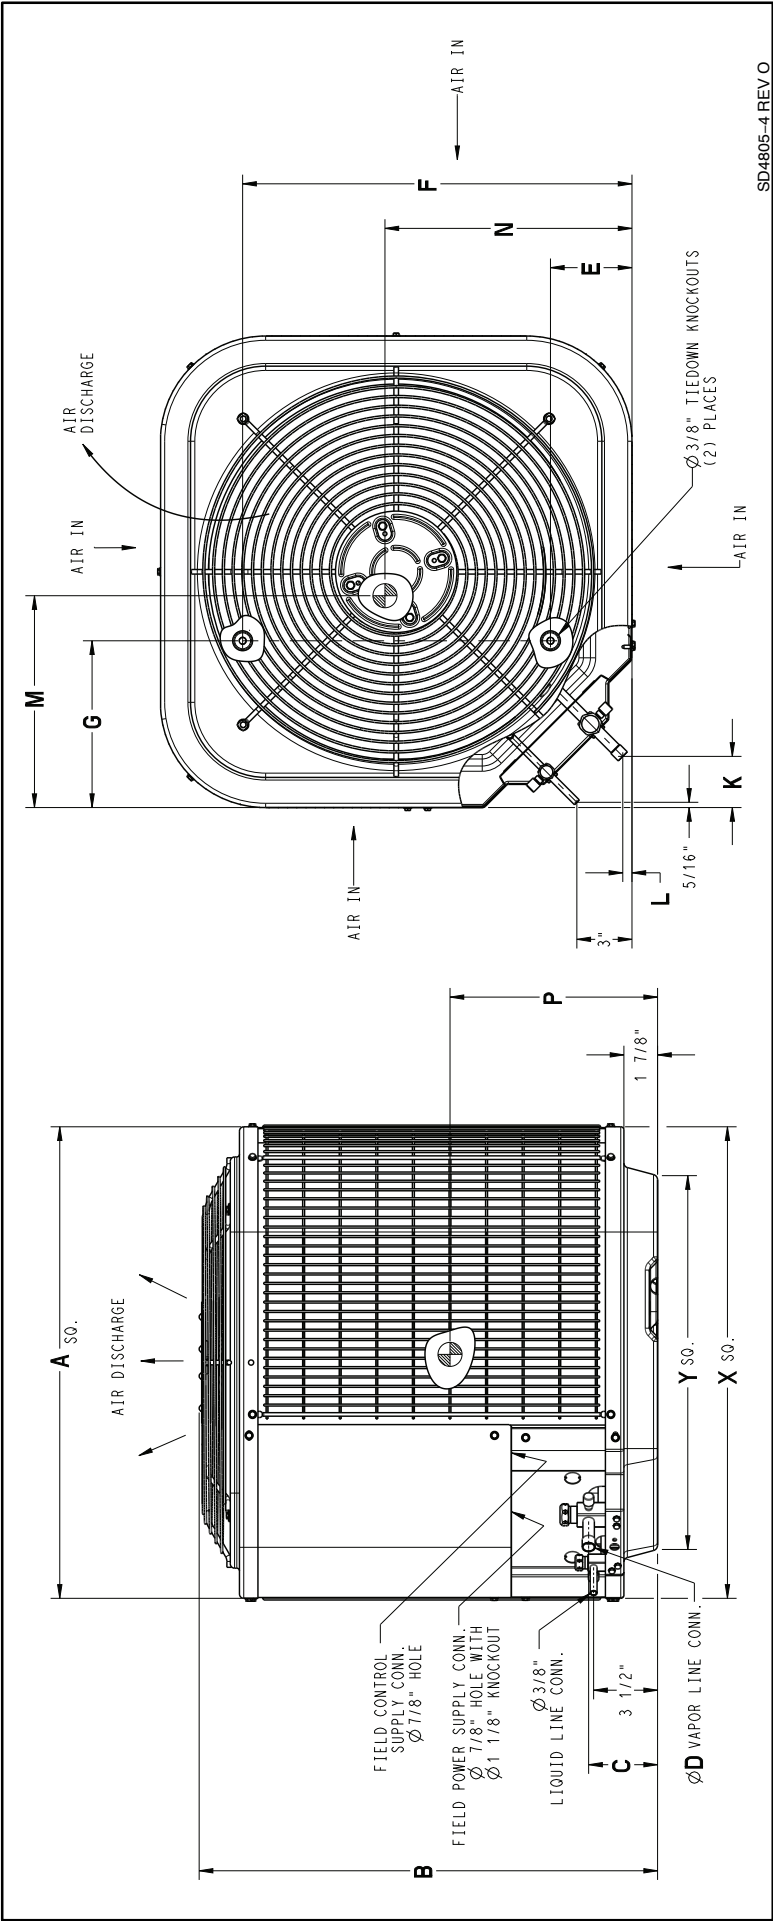


SD4805-4 REV.0

1. Allow 24" clearance to service side of unit, 48" above unit, 6" on one side, 12" on remaining sides.
2. Maintain a distance of 24" between units or 18" if no overhang within 12'.
3. Minimum outdoor operating ambient in cooling mode is 55°F, max 125°F.
4. Center of Gravity

Dimensions Inches (English)															
Model	A	B	C	D	E	F	G	K	L	M	N	P	Minimum Ground Mounting Pad Size X	Minimum Rooftop Mounting Pad Size Y	Shipping Dimensions L x W x H
N4A330G†C	23-1/8	28-11/16	3-3/4	3/4	4-7/16	18-1/16	7-13/16	2-13/16	1/2	16-1/2	15	14	23-1/8 x 23-1/8	17-3/4 x 17-3/4	25-1/4 x 25-1/4 x 33-1/4
N4A336G†B	25-3/4	31-13/16	3-7/8	7/8	6-9/16	21-1/4	9-1/8	2-15/16	5/8	14-1/4	10-1/2	16	25-3/4 x 25-3/4	20-7/16 x 20-7/16	27-7/8 x 27-7/8 x 36-5/8
N4A342G†A	31-3/16	32-5/16	3-7/8	7/8	6-9/16	24-11/16	9-1/8	2-15/16	5/8	15-3/4	16-1/4	13-3/4	31-3/16 x 31-3/16	31-1/2 x 31-1/2	33-3/8 x 33-3/8 x 36-5/8
N4A348G†B	31-3/16	35-3/4	3-7/8	7/8	6-9/16	24-11/16	9-1/8	2-15/16	5/8	14-1/8	15-3/8	11-3/4	31-3/16 x 31-3/16	31-1/2 x 31-1/2	33-3/8 x 33-3/8 x 40
N4A360G†C	31-3/16	28-15/16	3-7/8	7/8	6-9/16	24-11/16	9-1/8	2-15/16	5/8	16	15-1/2	12-3/4	31-3/16 x 31-3/16	31-1/2 x 31-1/2	33-3/8 x 33-3/8 x 33-1/4

† H = 208/230, 3-phase, L = 460 Volt, 3-phase, S = 575 Volt, 3-phase



1. Allow 610 mm clearance to service side of unit, 1219 mm above unit, 152 mm on one side, 305 mm on remaining sides
2. Maintain a distance of 610mm between units or 457mm if no overhang within 3.7m.
3. Minimum outdoor operating ambient in cooling mode is 13°C, max 52°C.

#### 4. Center of Gravity

Model	Dimensions mm (SI Metric)												Minimum Roof-top Mounting Pad Size Y	Minimum Ground Mounting Pad Size X	Shipping Dimensions L x W x H
	A	B	C	D	E	F	G	K	L	M	N	P			
N4A330G†C	587	729	95	19	113	459	198	71	13	419	381	356	451 x 451	642 x 642 x 844	
N4A336G†B	654	808	98	22	167	540	232	75	16	362	267	406	518 x 518	708 x 708 x 931	
N4A342G†A	792	821	98	22	167	627	232	75	16	400	413	349	583 x 583	847 x 847 x 931	
N4A348G†B	792	908	98	22	167	627	232	75	16	375	391	381	451 x 451	847 x 847 x 1017	
N4A360G†C	792	735	98	22	167	627	232	75	16	406	394	324	451 x 451	847 x 847 x 844	

 $\pm \mathbf{H} = 208/230, 3\text{-phase}, \mathbf{L} = 460 \text{ Volt}, 3\text{-phase}, \mathbf{S} = 575 \text{ Volt}, 3\text{-phase}$

PHYSICAL DATA (3-phase)					
Model Size	30	36	42	48	60
Nominal Cooling Capacity (BTU/hr)	30,000	36,000	42,000	48,000	60,000
Nominal SEER	13.0	13.0	13.0	13.0	13.0
Sound Rating (dBA) **	74	75	78	80	79
PSC Fan Motor HP	1/10	1/4	1/5	1/4	1/4
Fan RPM (single speed)	1100	1100	1100	1100	1100
Fan CFM	2218	2954	3167	3365	3365
Coil Face Area ft <sup>2</sup> (m <sup>2</sup> )	9.80 (0.91)	13.13 (1.22)	17.25 (1.60)	19.40 (1.80)	15.09 (1.40)
Coil Rows – fins per inch	1 – 25	1 – 25	1 – 25	1 – 25	2 – 20
Liquid Line Connection Size in. (mm)	3/8 (10)	3/8 (10)	3/8 (10)	3/8 (10)	3/8 (10)
Vapor Line Connection Size in. (mm)	3/4 (19)	7/8 (22)	7/8 (22)	7/8 (22)	7/8 (22)
Rated Line Set Liquid Tube Diameter in. (mm)	3/8 (10) *	3/8 (10) *	3/8 (10) *	3/8 (10) *	3/8 (10) *
Rated Line Set Vapor Tube Diameter in. (mm)	3/4 (19) *	7/8 (22) *	7/8 (22) *	7/8 (22) *	1-1/8 (29)*
Factory Charge, R-410A lbs. (kg)	4.10 (1.86)	5.34 (2.42)	5.84 (2.65)	7.00(3.18)	8.00 (3.63)
Required Subcooling ° F (° C)	10 (6)	14 (8)	10 (6)	15 (8)	10 (6)

\* Units are rated with 25 ft (7.6 m) of lineset length. See Vapor Line Sizing and Cooling Capacity Loss table when using other sizes and lengths of lineset. **Note:** See unit Installation Instruction for proper installation.

ELECTRICAL DATA (208/230, 460, 575–3–60)												
Model Size	30GH	36GH	36GL	36GS	42GH	42GL	48GH	48GL	48GS	60GH	60GL	60GS
Supply Voltage, 3-phase 60 Hz.	208/230	208/230	460	575	208/230	460	208/230	460	575	208/230	460	575
Acceptable Voltage Range, min-max	197–253	197–253	414–506	518–632	197–253	414–506	197–253	414–506	518–632	197–253	414–506	518–632
Minimum Circuit Ampacity <b>MCA</b> (amps)	11.2	14.5	7.7	5.3	18.0	8.1	17.8	8.3	6.0	21.4	10.5	7.6
Maximum OverCurrent Protective device <b>MOCP</b> (amps)	20	20	15	15	30	15	30	15	15	30	15	15
Compressor <b>RLA</b> (Rated Load Amps) <b>LRA</b> (Locked Rotor Amps)	8.3 58.0	10.5 71.0	5.6 38.0	3.8 36.5	13.5 88.0	6.0 44.0	13.1 83.1	6.1 41.0	4.4 33.0	16.0 110.0	7.8 52.0	5.7 38.9
Fan Motor <b>FLA</b> (Full Load Amps)	.77	1.4	0.7	0.5	1.1	0.6	1.4	0.7	0.5	1.4	0.7	0.5

\*\*Sound Rating tested in accordance with AHRI Standard 270–2008 (not listed with AHRI).

A-Weighted Sound Power Level - Without Sound Shield								
Model	Standard Rating (dBA)	TYPICAL OCTAVE BAND SPECTRUM (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
330GHC	74	55.0	63.5	68.5	68.5	65.5	61.0	54.0
336GHB/GLB/GSB	75	59.5	63.0	68.5	70.0	65.5	61.5	53.5
342GHA/GLA	78	57.5	65.0	71.0	73.0	70.5	67.5	62.5
348GHB/GLB/GSB	80	58.5	67.5	73.5	75.0	70.5	67.5	64.5
360GHC/GLC/GSC	79	59.5	69.5	72.5	73.5	71.0	68.0	63.5

Note: Tested in accordance with AHRI Standard 270-2008 (not listed in AHRI).

A-Weighted Sound Power Level - With Sound Shield								
Model	Standard Rating (dBA)	TYPICAL OCTAVE BAND SPECTRUM (without tone adjustment)						
		125	250	500	1000	2000	4000	8000
330GHC	73	55.5	64.0	68.0	67.0	64.0	60.0	52.5
336GHB/GLB/GSB	74	59.5	63.0	68.0	69.5	65.0	60.5	50.5
342GHA/GLA	77	57.5	65.0	70.5	72.0	70.0	67.0	62.0
348GHB/GLB/GSB	79	60.5	67.5	73.5	74.5	71.0	68.0	63.5
360GHC/GLC/GSC	78	60.5	69.5	72.5	73.0	71.0	67.5	61.5

Note: Tested in accordance with AHRI Standard 270-2008 (not listed in AHRI).

### REFRIGERANT CHARGE ADJUSTMENTS

Liquid Line Size	R-410A Charge oz/ft
3/8	0.60 (Factory charge for lineset = 9 oz)
5/16	0.40
1/4	0.27

Units are factory charged for 15 ft (4.6 m) of 3/8" liquid line. The factory charge for 3/8" lineset 9 oz. When using other length or diameter liquid lines, charge adjustments are required per the chart above.

#### Charging Formula:

$[(\text{Lineset oz/ft} \times \text{total length}) - (\text{factory charge for lineset})] = \text{charge adjustment}$

**Example 1:** System has 15 ft of line set using existing 1/4" liquid line. What charge adjustment is required?

Formula:  $(.27 \text{ oz/ft} \times 15\text{ft}) - (9 \text{ oz}) = (-4.95) \text{ oz.}$

Net result is to remove 4.95 oz of refrigerant from the system

**Example 2:** System has 45 ft of existing 5/16" liquid line. What is the charge adjustment?

Formula:  $(.40 \text{ oz/ft.} \times 45\text{ft}) - (9 \text{ oz.}) = 9 \text{ oz.}$

Net result is to add 9 oz of refrigerant to the system

### LONG LINE APPLICATIONS

An application is considered Long Line, when the refrigerant level in the system requires the use of accessories to maintain acceptable refrigerant management for systems reliability. See Accessory Usage Guideline table for required accessories. Defining a system as long line depends on the liquid line diameter, actual length of the tubing, and vertical separation between the indoor and outdoor units.

For Air Conditioner systems, the charts below shows when an application requires a TXV and long line accessories due to lineset length.

#### AC with R-410A Refrigerant Long Line Description ft (m) Beyond these lengths, a TXV is required

Total Length	Outdoor Unit Above or Below Indoor Unit
TXV required beyond 50 ft. (15.2 m)	TXV required beyond 20 ft. (6.1 m)

#### AC with R-410A Refrigerant Long Line Description ft (m) (Beyond these lengths, long line accessories are required)

Liquid Line Size	Units On Same Level	Outdoor Below Indoor	Outdoor Above Indoor
1/4 + TXV	No accessories needed within allowed lengths	No accessories needed within allowed lengths	175 (53.3)
5/16 + TXV	120 (36.6)	50 (15.2) vertical or 120 (36.6) total	120 (36.6)
3/8 + TXV	80 (24.4)	35 (10.7) vertical or 80 (24.4) total	80 (24.4)

**Note:** See Long Line Guideline for details

R-410A COOLING CAPACITY LOSS FOR VARIOUS LINE LENGTHS & TUBE DIAMETERS													
Model Size	Liquid Line in.(mm)	Acceptable Vapor Line Sizes in. (mm)	Cooling Capacity Loss (%) at Total Equivalent Line Length, feet (m) Refer to Long Line Application Guideline to calculate equivalent length										
			Standard Application			Long Line Application (Requires Accessories)							
			25' (7.6)	50' (15.2)	80' (24.4)	81' (24.7)	100' (30.5)	125' (38.1)	150' (45.7)	175' (53.3)	200' (61)	225' (68.6)	250' (76.2)
30	3/8 (10)	5/8 (16)	1	2	3	3	3	4	5	6	7	8	9
		3/4 (19)	0	0	1	1	1	1	2	2	2	3	3
		7/8 (22)	0	0	0	0	0	1	1	1	1	1	1
36		5/8 (16)	1	2	4	4	5	6	7	9	10	11	13
		3/4 (19)	0	0	1	1	1	2	2	3	3	4	4
		7/8 (22)	0	0	0	0	0	1	1	1	1	2	2
42		3/4 (19)	0	1	2	2	2	3	4	4	5	6	6
		7/8 (22)	0	0	1	1	1	1	2	2	2	3	3
		1-1/8 (29)	0	0	0	0	0	0	0	0	0	0	1
48		3/4 (19)	0	1	2	2	3	4	5	5	6	7	8
		7/8 (22)	0	0	1	1	1	2	2	2	3	3	4
		1-1/8 (29)	0	0	0	0	0	0	0	0	1	1	1
60		3/4 (19)	1	2	4	4	5	6	7	9	10	11	12
		7/8 (22)	0	1	2	2	2	3	4	4	5	5	6
		1-1/8(29)	0	0	0	0	1	1	1	1	1	1	2

Consult the Long Line Application Guideline document before purchasing/installing line sets.

Applications in shaded area may have height restrictions that limit allowable total equivalent length when outdoor unit is below indoor unit.

COOLING PERFORMANCE FOR COMBINATION RATINGS Indoor Models								
For complete ratings information, use the AHRI website directory search: <a href="http://www.AHRI.org">www.AHRI.org</a> . New ratings may be listed online before Specification Sheets are updated.								
Unit Size	Indoor Model	Furnace Model	AHRI Standard Ratings					
			Cooling 95° F (35°C)					
			Capacity	Factory Installed	SEER			EER
					Standard	W/ Field TDR	Piston	
N4A330GHC	*ED*4X30B**		27200	TXV		13.00		10.80
N4A336G(H,L,S)B	*EA*4X36*17A*		34000	TXV		13.00		11.00
N4A342G(H,L)A	*ED*4X42J**		41000	TXV		13.00		11.00
N4A348G(H,L,S)B	*EA*4X48*21A*		46000	TXV		13.00		11.00
N4A360G(H,L,S)C	*EA*4X60*24A*		58000	TXV		13.00		11.00

#### TESTED AHRI COMBINATION RATINGS\*

NOTE: Ratings contained in this document are subject to change at any time.

For AHRI ratings certificates, please refer to the AHRI directory. [www.ahridirectory.org](http://www.ahridirectory.org)

Additional ratings and system combinations can be accessed via the Arcoaire database:

<http://www.icpeqp.com/AHRIratings/ratings.aspx?Brand=Arcoaire>

Or scan this QR code:



**COOLING PERFORMANCE RATINGS For Outdoor / Indoor Models**

For complete ratings information, use the AHRI website directory search: [www.AHRIdirectory.org](http://www.AHRIdirectory.org).  
New ratings may be listed online before Specification Sheets are updated.

EVAPORAT- OR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtuh		Total Sys- tem KW	Capacity MBtuh		Total Sys- tem KW	Capacity MBtuh		Total Sys- tem KW	Capacity MBtuh		Total Sys- tem KW	Capacity MBtuh		Total Sys- tem KW	Capacity MBtuh		Total Sys- tem KW
CFM	EWB	Total	Sens		Total	Sens		Total	Sens		Total	Sens		Total	Sens		Total	Sens	
<b>N4A330GHC* Outdoor Section With ED*4X30B** Indoor Section</b>																			
875	72	32.02	16.33	2.03	30.68	15.86	2.24	29.25	15.36	2.47	27.76	14.85	2.72	26.11	14.28	3.00	24.24	13.65	3.29
	67	29.54	20.42	2.02	28.28	19.93	2.23	26.92	19.41	2.46	25.50	18.87	2.72	23.94	18.28	2.99	22.21	17.63	3.29
	63	27.75	19.85	2.02	26.53	19.34	2.23	25.22	18.80	2.46	23.85	18.24	2.71	22.35	17.62	2.99	20.71	16.96	3.29
	62	27.35	24.48	2.02	26.19	23.94	2.23	24.96	24.73	2.46	23.81	23.81	2.71	22.57	22.57	2.99	21.21	21.21	3.28
	57	26.98	26.98	2.02	25.99	25.99	2.23	24.93	24.93	2.46	23.81	23.81	2.71	22.58	22.58	2.99	21.21	21.21	3.28
1000	72	32.38	17.12	2.08	30.97	16.63	2.29	29.51	16.14	2.52	27.98	15.62	2.78	26.29	15.05	3.05	24.37	14.42	3.35
	67	29.89	21.72	2.08	28.59	21.23	2.29	27.20	20.70	2.52	25.75	20.16	2.77	24.16	19.56	3.05	22.39	18.89	3.34
	63	28.12	21.08	2.08	26.86	20.57	2.29	25.52	20.02	2.52	24.11	19.45	2.77	22.58	18.82	3.05	20.90	18.14	3.34
	62	27.91	27.74	2.08	26.85	26.85	2.29	25.73	25.73	2.52	24.55	24.55	2.77	23.26	23.26	3.04	21.81	21.81	3.34
	57	27.89	27.89	2.08	26.85	26.85	2.29	25.73	25.73	2.52	24.56	24.56	2.77	23.26	23.26	3.04	21.81	21.81	3.34
1125	72	32.60	17.86	2.14	31.16	17.37	2.35	29.67	16.87	2.58	28.11	16.35	2.83	26.38	15.78	3.11	24.43	15.14	3.40
	67	30.13	22.97	2.14	28.80	22.47	2.34	27.39	21.94	2.57	25.92	21.38	2.83	24.30	20.77	3.10	22.52	20.07	3.40
	63	28.36	22.24	2.13	27.09	21.72	2.34	25.72	21.17	2.57	24.30	20.59	2.83	22.74	19.94	3.10	21.06	19.21	3.40
	62	28.60	28.60	2.13	27.52	27.52	2.34	26.35	26.35	2.57	25.13	25.13	2.83	23.78	23.78	3.10	22.26	22.26	3.40
	57	28.60	28.60	2.13	27.52	27.52	2.34	26.35	26.35	2.57	25.13	25.13	2.83	23.78	23.78	3.10	22.26	22.26	3.40
<b>N4A336G(H,L,S)B Outdoor Section With EA*4X36*17A* Indoor Section</b>																			
1050	72	40.22	21.00	2.47	38.50	20.34	2.71	36.66	19.65	2.98	34.69	18.93	3.30	32.56	18.15	3.66	30.22	17.30	4.08
	67	36.61	25.73	2.44	35.00	25.05	2.69	33.29	24.35	2.96	31.46	23.60	3.27	29.49	22.81	3.64	27.34	21.95	4.07
	63	34.02	24.88	2.43	32.50	24.20	2.67	30.89	23.49	2.94	29.17	22.73	3.26	27.32	21.94	3.63	25.29	21.07	4.07
	62	33.42	30.44	2.42	31.97	29.75	2.67	30.45	29.01	2.94	28.86	28.20	3.26	27.29	27.29	3.63	25.64	25.64	4.07
	57	32.55	32.55	2.42	31.38	31.38	2.66	30.12	30.12	2.94	28.77	28.77	3.26	27.29	27.29	3.63	25.65	25.65	4.07
1200	72	40.90	21.97	2.53	39.11	21.31	2.77	37.20	20.61	3.04	35.17	19.88	3.36	32.96	19.09	3.72	30.54	18.23	4.14
	67	37.25	27.30	2.50	35.57	26.61	2.74	33.80	25.90	3.02	31.91	25.15	3.33	29.88	24.35	3.70	27.67	23.48	4.13
	63	34.63	26.36	2.49	33.04	25.66	2.73	31.38	24.94	3.00	29.60	24.18	3.32	27.69	23.37	3.69	25.61	22.48	4.12
	62	34.19	32.60	2.48	32.73	31.85	2.73	31.24	31.24	3.00	29.83	29.83	3.32	28.26	28.26	3.69	26.52	26.52	4.12
	57	33.87	33.87	2.48	32.61	32.61	2.72	31.27	31.27	3.00	29.83	29.83	3.32	28.26	28.26	3.69	26.52	26.52	4.12
1350	72	41.40	22.89	2.59	39.55	22.22	2.83	37.60	21.52	3.10	35.50	20.77	3.42	33.24	19.97	3.78	30.75	19.10	4.20
	67	37.72	28.79	2.56	36.00	28.11	2.80	34.19	27.39	3.08	32.26	26.63	3.39	30.19	25.81	3.76	27.93	24.92	4.18
	63	35.09	27.77	2.54	33.47	27.07	2.79	31.76	26.34	3.06	29.94	25.57	3.38	27.99	24.73	3.74	25.88	23.82	4.18
	62	34.90	34.90	2.54	33.63	33.63	2.79	32.22	32.22	3.06	30.70	30.70	3.38	29.05	29.05	3.75	27.22	27.22	4.18
	57	34.96	34.96	2.54	33.64	33.64	2.79	32.23	32.23	3.06	30.70	30.70	3.38	29.05	29.05	3.75	27.22	27.22	4.18
<b>N4A342G(H,L)A Outdoor Section With EB*4X42J Indoor Section</b>																			
1225	72	48.65	25.59	3.45	46.41	24.73	3.68	44.15	23.88	4.08	41.78	23.00	4.51	39.23	22.06	4.99	36.40	21.03	5.51
	67	44.62	31.50	3.40	42.55	30.62	3.66	40.47	29.75	4.06	38.27	28.85	4.50	35.92	27.90	4.98	33.34	26.87	5.50
	63	41.68	30.56	3.35	39.82	29.72	3.70	37.85	28.84	4.08	35.76	27.91	4.51	33.53	26.94	4.97	31.08	25.89	5.48
	62	40.98	37.36	3.35	39.11	36.47	3.65	37.25	35.56	4.04	35.32	34.59	4.48	33.39	33.39	4.97	31.42	31.42	5.50
	57	39.89	39.89	3.33	38.36	38.36	3.64	36.82	36.82	4.04	35.18	35.18	4.48	33.40	33.40	4.97	31.42	31.42	5.50
1400	72	49.36	26.72	3.54	47.04	25.86	3.76	44.69	24.99	4.15	42.24	24.10	4.59	39.60	23.15	5.06	36.68	22.11	5.58
	67	45.32	33.35	3.48	43.17	32.47	3.74	41.00	31.58	4.13	38.74	30.68	4.57	36.32	29.72	5.05	33.67	28.67	5.58
	63	42.37	32.31	3.44	40.44	31.45	3.79	38.40	30.56	4.17	36.25	29.64	4.59	33.95	28.65	5.06	31.43	27.57	5.56
	62	41.84	39.94	3.43	39.95	38.98	3.73	38.08	38.08	4.12	36.38	36.38	4.56	34.49	34.49	5.05	32.37	32.37	5.57
	57	41.42	41.42	3.43	39.79	39.79	3.72	38.14	38.14	4.12	36.39	36.39	4.56	34.49	34.49	5.05	32.38	32.38	5.57
1575	72	49.90	27.82	3.62	47.50	26.94	3.84	45.08	26.07	4.23	42.57	25.17	4.66	39.86	24.21	5.14	36.86	23.16	5.66
	67	45.85	35.16	3.57	43.63	34.27	3.82	41.41	33.39	4.21	39.10	32.47	4.65	36.63	31.49	5.13	33.92	30.40	5.65
	63	42.90	34.01	3.52	40.92	33.16	3.87	38.83	32.26	4.25	36.63	31.32	4.68	34.28	30.31	5.14	31.71	29.19	5.64
	62	42.68	42.28	3.52	40.93	40.93	3.80	39.20	39.20	4.20	37.35	37.35	4.64	35.35	35.35	5.12	33.12	33.12	5.65
	57	42.66	42.66	3.52	40.94	40.94	3.80	39.20	39.20	4.20	37.35	37.35	4.64	35.35	35.35	5.12	33.12	33.12	5.65



EVAPORATOR AIR		CONDENSER ENTERING AIR TEMPERATURES deg F																	
		75			85			95			105			115			125		
		Capacity MBtuh		Total Sys-tem KW	Capacity MBtuh		Total Sys-tem KW	Capacity MBtuh		Total Sys-tem KW	Capacity MBtuh		Total Sys-tem KW	Capacity MBtuh		Total Sys-tem KW	Capacity MBtuh		Total Sys-tem KW
CFM	EWB	Total	Sens		Total	Sens		Total	Sens		Total	Sens		Total	Sens		Total	Sens	
<b>N4A348G(H,L,S)B Outdoor Section With EA*4X48*21A Indoor Section</b>																			
1400	72	54.48	26.42	3.38	52.18	25.62	3.74	49.73	24.77	4.13	47.13	23.89	4.56	44.34	22.96	5.03	41.30	21.95	5.55
	67	49.80	32.57	3.36	47.63	31.74	3.71	45.34	30.88	4.10	42.93	29.97	4.53	40.34	29.02	5.01	37.58	28.02	5.53
	63	46.42	31.55	3.34	44.36	30.70	3.69	42.19	29.82	4.08	39.89	28.90	4.52	37.46	27.94	5.00	34.91	26.94	5.51
	62	45.58	38.68	3.34	43.61	37.81	3.69	41.55	36.89	4.08	39.45	39.21	4.52	37.47	37.47	5.00	35.38	35.38	5.51
	57	44.55	44.55	3.33	42.94	42.94	3.69	41.23	41.23	4.08	39.42	39.42	4.52	37.47	37.47	4.99	35.39	35.39	5.51
1600	72	55.34	27.67	3.47	52.95	26.86	3.82	50.42	26.01	4.21	47.73	25.12	4.64	44.84	24.17	5.11	41.69	23.15	5.63
	67	50.63	34.61	3.44	48.38	33.76	3.79	46.00	32.88	4.18	43.51	31.98	4.61	40.84	31.01	5.09	38.00	29.98	5.61
	63	47.22	33.46	3.42	45.08	32.60	3.77	42.83	31.71	4.17	40.47	30.78	4.60	37.96	29.80	5.08	35.33	28.77	5.59
	62	46.58	41.42	3.42	44.61	44.23	3.77	42.74	42.74	4.16	40.82	40.82	4.60	38.75	38.75	5.08	36.51	36.51	5.60
	57	46.27	46.27	3.42	44.56	44.56	3.77	42.75	42.75	4.16	40.82	40.82	4.60	38.75	38.75	5.08	36.52	36.52	5.60
1800	72	55.96	28.85	3.55	53.51	28.03	3.90	50.90	27.17	4.29	48.15	26.28	4.72	45.18	25.32	5.19	41.94	24.28	5.70
	67	51.22	36.53	3.52	48.91	35.69	3.87	46.48	34.81	4.26	43.93	33.88	4.69	41.20	32.89	5.17	38.30	31.83	5.68
	63	47.80	35.26	3.50	45.61	34.40	3.85	43.31	33.50	4.25	40.89	32.56	4.68	38.33	31.55	5.16	35.64	30.47	5.67
	62	47.66	47.66	3.50	45.87	45.87	3.86	43.97	43.97	4.25	41.94	41.94	4.68	39.77	39.77	5.16	37.41	37.41	5.68
	57	47.67	47.67	3.50	45.88	45.88	3.86	43.97	43.97	4.25	41.95	41.95	4.68	39.77	39.77	5.16	37.41	37.41	5.68
<b>N4A360G(H,L,S)C Outdoor Section With EA*4X60*24A* Indoor Section</b>																			
1750	72	68.71	34.82	4.37	65.76	33.74	4.81	62.59	32.60	5.30	59.21	31.39	5.84	55.54	30.09	6.42	51.41	28.66	7.05
	67	63.16	43.00	4.29	60.43	41.90	4.74	57.50	40.73	5.23	54.39	39.50	5.77	51.03	38.20	6.36	47.32	36.77	6.99
	63	59.15	41.80	4.24	56.59	40.69	4.68	53.84	39.50	5.18	50.92	38.26	5.72	47.79	36.96	6.31	44.36	35.54	6.95
	62	58.14	51.13	4.23	55.65	49.99	4.67	53.01	48.77	5.16	50.27	47.45	5.71	47.55	47.55	6.31	44.70	44.70	6.96
	57	56.63	56.63	4.21	54.60	54.60	4.66	52.42	52.42	5.16	50.09	50.09	5.71	47.55	47.55	6.31	44.71	44.71	6.96
2000	72	69.71	36.45	4.48	66.67	35.37	4.92	63.38	34.20	5.41	59.88	32.98	5.95	56.07	31.67	6.53	51.80	30.21	7.15
	67	64.15	45.67	4.40	61.31	44.55	4.85	58.27	43.36	5.34	55.05	42.13	5.87	51.58	40.80	6.46	47.74	39.34	7.10
	63	60.14	44.30	4.35	57.47	43.18	4.79	54.61	41.98	5.28	51.60	40.73	5.82	48.36	39.39	6.42	44.82	37.93	7.06
	62	59.33	54.75	4.34	56.80	53.54	4.78	54.23	54.23	5.28	51.77	51.77	5.83	49.05	49.05	6.42	45.99	45.99	7.07
	57	58.75	58.75	4.33	56.59	56.59	4.78	54.26	54.26	5.28	51.77	51.77	5.83	49.05	49.05	6.42	46.00	46.00	7.07
2250	72	70.44	37.99	4.59	67.31	36.90	5.03	63.93	35.73	5.52	60.33	34.49	6.05	56.41	33.16	6.63	52.03	31.69	7.25
	67	64.85	48.20	4.51	61.94	47.09	4.95	58.82	45.89	5.44	55.52	44.63	5.98	51.96	43.27	6.56	48.04	41.75	7.20
	63	60.84	46.68	4.45	58.11	45.56	4.90	55.17	44.34	5.39	52.08	43.07	5.93	48.77	41.69	6.52	45.14	40.17	7.16
	62	60.44	60.44	4.45	58.18	58.18	4.90	55.72	55.72	5.40	53.10	53.10	5.94	50.23	50.23	6.54	46.99	46.99	7.18
	57	60.47	60.47	4.45	58.19	58.19	4.90	55.73	55.73	5.40	53.10	53.10	5.94	50.23	50.23	6.54	47.00	47.00	7.18

Total sensible capacities are based on net capacities. Blower heat has been subtracted.

Sensible capacities shown are based on 80° F (27° C) entering air at the indoor coil. For sensible capacities at other than 80° F (27° C), deduct 835 Btuh (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80° F (27° C), or add 835 Btuh (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80° F (27° C).

Detailed cooling and heating capacities are based on indoor and outdoor unit at the same elevation per AHRI standard 210/240 -2008. If additional tubing length is required and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

System kw is total of indoor and outdoor unit kilowatts.

## ACCESSORY USAGE GUIDELINES

Accessory	REQUIRED FOR LOW-AMBIENT APPLICATIONS {Below 55°F (13°C)}	REQUIRED FOR LONG-LINE APPLICATIONS*
Crankcase Heater	Yes	Yes
Evaporator Freeze Thermostat	Yes	No
Winter Start Control	Yes**	No
TXV	Yes	Yes†
Low Ambient Kit (Pressure Switch)	Yes	No
Support Feet, 4" (102mm) tall	Recommended	No

\* Refer to the Long Line Application Guideline document.

\*\* Can only be installed in conjunction with the Low Pressure Switch

† TXV required beyond 20 ft (6.1m) vertical separation or 50 ft (15.2) total length.

## ACCESSORIES

Part Number	Description	Used On Model Size
NASA003CH	Crankcase Heater for Scroll Compressor (208/230 V)	30
NASA001CH	Crankcase Heater for Scroll Compressor (208/230 V)	36, 42, 48, 60
NASA004CH	Crankcase Heater for Scroll Compressor (460 V)	36
NASA00301CH	Crankcase Heater for Scroll Compressor (460 V)	42, 48, 60
NASA00701CH	Crankcase Heater for Scroll Compressor (575 V)	36
NASA00801CH	Crankcase Heater for Scroll Compressor (575 V)	48, 60
NASA001SC	Start Component – PTC Device	ALL
NASA00201FS	Evaporator Freeze Thermostat	ALL
NASA403PS	Low Pressure Switch, AC, R-410A	ALL
NASA401LS	Liquid Line Solenoid Valve, R-410A	ALL
NASA001TD	Time Delay Relay, Indoor Blower	ALL
NASA00201WS	Winter Start Control	ALL
NASA001AC	Anti-Cycle Timer (5 minute delay)	ALL
NASA404PS	High Pressure Switch, AC or HP, R-410A	ALL
NASA401LA	Low Ambient Kit (Pressure Switch), R-410A	ALL
NASA00201SF	Support Feet, 4" (102mm) tall (5 blocks)	30, 36
NASA001SF	Support Feet, 4" (102mm) tall (4 blocks)	42, 48, 60
NASA001SJ	Sound Jacket, Compressor	30, 36, 42, 48
NASA003SJ	Sound Jacket, Compressor	60
EBAC05TXVX	TXV Kit, R-410A – 2005–2009 R-22 TXV Fancoils (air handlers)	30
EBAC06TXVX	TXV Kit, R-410A – 2005–2009 R-22 TXV Fancoils (air handlers)	36, 42
EBAC07TXVX	TXV Kit, R-410A – 2005–2009 R-22 TXV Fancoils (air handlers)	48, 60
NAEA40501TX	TXV Kit, R-410A – 2010 and later Piston Coils	30
NAEA40601TX	TXV Kit, R-410A – 2010 and later Piston Coils	36, 42
NAEA40701TX	TXV Kit, R-410A – 2010 and later Piston Coils	48, 60