

AIR CONDITIONER

**Cassette type**

## DESIGN & TECHNICAL MANUAL

---

---

INDOOR



ACUH09LUAS1  
ACUH12LUAS1  
ACUH18LUAS1

---

OUTDOOR



AOUH09LUAS1



AOUH12LUAS1  
AOUH18LUAS1

---

**FUJITSU GENERAL LIMITED**

**Notices:**

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

# CONTENTS

---

<b>Part 1. INDOOR UNIT</b>	<b>1</b>
<b>1. Specifications</b>	<b>2</b>
<b>2. Dimensions</b>	<b>4</b>
2-1. Models: ACUH09LUAS1, ACUH12LUAS1, and ACUH18LUAS1	4
2-2. Installation space requirement	5
<b>3. Wiring diagram</b>	<b>6</b>
3-1. Models: ACUH09LUAS1, ACUH12LUAS1, and ACUH18LUAS1	6
<b>4. Capacity table</b>	<b>7</b>
4-1. Cooling capacity	7
4-2. Heating capacity	9
<b>5. Fan performance</b>	<b>11</b>
5-1. Air velocity distributions	11
5-2. Airflow	17
<b>6. Operation noise (sound pressure)</b>	<b>20</b>
6-1. Noise level curve	20
6-2. Sound level check point	22
<b>7. Safety devices</b>	<b>23</b>
<b>8. External input and output</b>	<b>24</b>
8-1. External input	25
8-2. External output	27
8-3. Setting of external input and output	28
8-4. Details of control input function	30
8-5. Details of control output function	34
<b>9. Function settings</b>	<b>55</b>
9-1. Function settings on indoor unit	55
9-2. Function settings by using remote controller	56
<b>10. Accessories</b>	<b>65</b>
10-1. Models: ACUH09LUAS1, ACUH12LUAS1, and ACUH18LUAS1	65
<b>11. Optional parts</b>	<b>66</b>
11-1. Controllers	66
11-2. Cassette grille	66
11-3. Others	67

## CONTENTS (continued)

---

### Part 2. OUTDOOR UNIT .....69

---

<b>1. Specifications</b> .....	<b>70</b>
<b>2. Dimensions</b> .....	<b>71</b>
2-1. Models: AOUH09LUAS1.....	71
2-2. Models: AOUH12LUAS1 and AOUH18LUAS1 .....	72
<b>3. Installation space</b> .....	<b>73</b>
3-1. Models: AOUH09LUAS1, AOUH12LUAS1, and AOUH18LUAS1 .....	73
<b>4. Refrigerant circuit</b> .....	<b>76</b>
4-1. Models: AOUH09LUAS1.....	76
4-2. Models: AOUH12LUAS1 and AOUH18LUAS1 .....	77
<b>5. Wiring diagrams</b> .....	<b>78</b>
5-1. Model: AOUH09LUAS1 .....	78
5-2. Models: AOUH12LUAS1 and AOUH18LUAS1 .....	79
<b>6. Capacity compensation rate for pipe length and height difference.....</b>	<b>80</b>
6-1. Model: AOUH09LUAS1 .....	80
6-2. Model: AOUH12LUAS1 .....	81
6-3. Model: AOUH18LUAS1 .....	82
<b>7. Additional charge calculation</b> .....	<b>83</b>
7-1. Model: AOUH09LUAS1 .....	83
7-2. Model: AOUH12LUAS1 .....	83
7-3. Model: AOUH18LUAS1 .....	83
<b>8. Airflow</b> .....	<b>84</b>
8-1. Model: AOUH09LUAS1 .....	84
8-2. Model: AOUH12LUAS1 .....	84
8-3. Model: AOUH18LUAS1 .....	85
<b>9. Operation noise (sound pressure).....</b>	<b>86</b>
9-1. Noise level curve.....	86
9-2. Sound level check point .....	87
<b>10. Electrical characteristics</b> .....	<b>88</b>
<b>11. Safety devices</b> .....	<b>89</b>
<b>12. Accessories</b> .....	<b>90</b>
12-1.Models: AOUH09LUAS1, AOUH12LUAS1, and AOUH18LUAS1 .....	90

# **Part 1. INDOOR UNIT**

---

**CASSETTE TYPE:**

**ACUH09LUAS1**

**ACUH12LUAS1**

**ACUH18LUAS1**

# 1. Specifications

Type				Cassette					
				Inverter, Heat pump					
Model name				ACUH09LUAS1	ACUH12LUAS1	ACUH18LUAS1			
Power supply				208/230 V ~ 60 Hz					
Available voltage range				187—253 V					
Capacity	Cooling	Cooling	Rated	kW	2.64	3.52	5.02		
				Btu/h	9,000	12,000	17,100		
			Min.—Max.	kW	0.91—3.20	0.91—3.99	0.91—5.89		
				Btu/h	3,100—11,000	3,100—13,600	3,100—20,100		
	Heating	47 °FDB (Outdoor temp.)	Rated	kW	3.52	4.69	6.33		
				Btu/h	12,000	16,000	21,600		
			Min.—Max.	kW	0.91—4.69	0.91—5.69	0.91—7.00		
				Btu/h	3,100—16,000	3,100—19,400	3,100—23,900		
		17 °FDB (Outdoor temp.)*1	Rated	kW	2.29	3.14	4.31		
				Btu/h	7,800	10,700	14,700		
			Max.	kW	3.08	4.98	5.75		
				Btu/h	10,500	17,000	19,600		
		5 °FDB (Outdoor temp.)*2	Rated	kW	2.96	4.54	5.01		
				Btu/h	10,100	15,500	17,100		
			Max.	kW	2.96	4.69	5.13		
				Btu/h	10,100	16,000	17,500		
Input power	Cooling	Cooling	Rated Max.	kW	0.66 1.05	0.94 1.79	1.37 2.35		
					47 °FDB (Outdoor temp.)	Rated Max.	0.93 1.72	1.44 1.79	1.81 2.50
	Heating	17 °FDB (Outdoor temp.)*1	Rated Max.	0.72 1.42		1.05 2.01	1.47 2.56		
			5 °FDB (Outdoor temp.)*2	Rated Max.	1.33 1.33	2.25 2.25	2.28 2.28		
		Current		Cooling Heating	Rated	A	3.3 4.6	4.2 6.4	6.1 8.1
							EER2	Cooling	
	COP2		Heating		kW/kW	3.78	3.26	3.50	
	SEER2		Cooling		Btu/hW	23.5	23.0	21.5	
	HSPF2		Heating		Btu/hW	11.8	11.3	11.2	
	Power factor		Cooling		%	87.0	97.3	97.6	
Heating			86.0			97.8	97.2		
Moisture removal				pints/h (L/h)	1.3 (0.6)	2.5 (1.2)	4.6 (2.2)		
Maximum operating current*3		Cooling		A	6.8	9.8	11.8		
		Heating			9.3	11.3	14.8		
Fan	Airflow rate	Cooling	HIGH	CFM (m³/h)	318 (540)	359 (610)	436 (740)		
			MED		288 (490)	312 (530)	341 (580)		
			LOW		259 (440)	277 (470)	288 (490)		
			QUIET		230 (390)	241 (410)			
		Heating	HIGH		318 (540)	359 (610)	471 (800)		
			MED		288 (490)	312 (530)	341 (580)		
			LOW		259 (440)	277 (470)	288 (490)		
			QUIET		230 (390)	241 (410)			
	Type × Qty		Turbo × 1						
	Motor output			W	54				
Sound pressure level*4	Cooling		HIGH	dB (A)	33	37	42		
			MED		32	33	36		
			LOW		29	31	32		
			QUIET		28				
	Heating		HIGH		34	37	44		
			MED		32	33	40		
			LOW		29	31	36		
			QUIET		27	28	30		
Heat exchanger type		Dimensions (H × W × D)		in (mm)	Main 1: 8-1/4 × 51-9/16 × 1/2 (210 × 1,310 × 13.3) Main 2: 8-1/4 × 49-3/16 × 1/2 (210 × 1,250 × 13.3)				
		Fin pitch		FPI	Main 1: 21 Main 2: 21				
		Rows × Stages			Main 1: 1 × 10 Main 2: 1 × 10				
		Pipe type			Copper tube				
		Fin type			Aluminum				
Dimensions (H × W × D)		Net Gross		in (mm)	9-5/8 × 22-7/16 × 22-7/16 (245 × 570 × 570)				
					10-7/16 × 28-3/4 × 24-5/8 (265 × 730 × 625)				
Weight		Net Gross		lb (kg)	33 (15)				
					40 (18)	42 (19)			
Connection pipe		Size	Liquid Gas	in (mm)	Ø1/4 (Ø6.35)				
					Ø3/8 (Ø9.52)		Ø1/2 (Ø12.70)		
Operation range		Cooling Heating		°F (°C) %RH °F (°C)	Flare 64 to 90 (18 to 32) 80 or less 60 to 86 (16 to 30)				
					HARD PVC				
Drain hose		Material		in (mm)	Ø1 (Ø25.0) [I.D.] Ø1-1/4 (Ø32.0) [O.D.]				
		Size			Ø13/16 (Ø20.7) [I.D.] Ø1-1/16 (Ø26.6) [O.D.]				
Remote controller (Option)					Wired, Wireless, Mobile app*5 [FGLair™]				

Type				Cassette		
				Inverter, Heat pump		
Model name				ACUH09LUAS1	ACUH12LUAS1	ACUH18LUAS1
Cassette grille (Grid type: Option)	Model name			UTG-CCGFGA		
	Material			PS		
	Color			White		
				Approximate color of Munsell 9PB 9.1/0.2		
	Dimensions (H × W × D)		Net	in (mm)	1-15/16 × 24-7/16 × 24-7/16 (49 × 620 × 620)	
			Gross		4-3/4 × 30-1/8 × 29-3/4 (120 × 765 × 755)	
	Weight		Net	lb (kg)	5.0 (2.3)	
		Gross	10 (4.5)			

**NOTES:**

- Specifications are based on the following conditions:
  - Cooling: Indoor temperature of 80°FDB (26.67°CDB)/67°FWB (19.44°CWB), and outdoor temperature of 95 °FDB (35°CDB)/75°FWB (23.9°CWB).
  - Heating: Indoor temperature of 70°FDB (21.11°CDB)/59°FWB (15°CWB), and outdoor temperature of 47°FDB (8.33°CDB)/43°FWB (6.11°CWB).
  - \*1: Heating (17°F): Indoor temperature of 70°FDB (21.11°CDB) /60°FWB (15.56°CWB), and outdoor temperature of 17°FDB (-8.33°CDB) /15°FWB (-9.44°CWB).
  - \*2: Heating (5°F): Indoor temperature of 70°FDB (21.11°CDB) /60°FWB (15.56°CWB), and outdoor temperature of 5°FDB (-15.0°CDB)/4°FWB (-15.56°CWB).
  - Test conditions are based on AHRI 210/240 2023.
  - Pipe length: 24 ft 6 in (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- \*3: Maximum operating current is the total current of the indoor unit and the outdoor unit.
- \*4: Sound pressure level:
  - Measured values in manufacturer’s anechoic chamber.
  - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- \*5: Available on Google Play™ store or on App Store®. Optional WLAN Adapter is also required. For details, refer to the setting manual.

M condition								
Model name				ACUH09LUAS1		ACUH12LUAS1	ACUH18LUAS1	
Power supply				208/230 V ~ 60 Hz				
Available voltage range				187—253 V				
Capacity	Cooling	Cooling	Rated	kW	2.64	3.52	5.02	
				Btu/h	9,000	12,000	17,100	
			Min.—Max.	kW	0.91—3.20	0.91—3.99	0.91—5.89	
				Btu/h	3,100—11,000	3,100—13,600	3,100—20,100	
	Heating	47 °FDB (Outdoor temp.)	Rated	kW	3.52	4.69	6.33	
				Btu/h	12,000	16,000	21,600	
			Min.—Max.	kW	0.91—4.69	0.91—5.69	0.91—7.00	
				Btu/h	3,100—16,000	3,100—19,400	3,100—23,900	
		17 °FDB (Outdoor temp.)*	Rated	kW	2.29	3.14	4.31	
				Btu/h	7,800	10,700	14,700	
			Max.	kW	3.08	4.98	5.75	
				Btu/h	10,500	17,000	19,600	
Input power	Cooling	Cooling	kW	Rated	0.66	0.94	1.37	
				Max.	1.05	2.06	2.35	
	Heating	47 °FDB (Outdoor temp.)		Rated	0.93	1.44	1.81	
				Max.	1.72	1.79	2.50	
		17 °FDB (Outdoor temp.)*		Rated	0.72	1.05	1.47	
				Max.	1.42	2.01	2.56	
	Current		Cooling	Rated	A	3.3	4.2	6.1
			Heating			4.6	6.4	8.1
EER		Cooling	kW/kW	4.00	3.74	3.66		
			Btu/hW	13.6	12.8	12.5		
COP		Heating	kW/kW	3.78	3.26	3.50		
			Btu/hW	12.9	11.1	11.9		
SEER		Cooling	Btu/hW	22.5	22.1	20.8		
HSPF		Heating	Btu/hW	12.5	12.2	11.6		
Power factor		Cooling	%	87.0	97.3	97.6		
		Heating		86.0	97.8	97.2		
NOTES:								
<div><div><div><div><div></div><div></div></div><div><div><div><span></span></div><div><span></span></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div><div><div><div><span></span></div><div><span></span></div></div><div><div><span></span></div><div><span></span></div></div></div></div> <div><div><div><div>Specifications are based on the following conditions:</div><div><div><div>– Cooling: Indoor temperature of 80°FDB (26.67°CDB)/67°FWB (19.44°CWB), and outdoor temperature of 95°FDB (35°CDB)/75°FWB (23.9°CWB).</div><div>– Heating: Indoor temperature of 70°FDB (21.11°CDB)/59°FWB (15°CWB), and outdoor temperature of 47°FDB (8.33°CDB)/43°FWB (6.11°CWB).</div><div>– Pipe length: 24 ft 6 in (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</div><div>– *: Heating (17°F): Indoor temperature of 70°FDB (21.11°CDB) /60°FWB (15.56°CWB), and outdoor temperature of 17°FDB (-8.33°CDB) /15°FWB (-9.44°CWB).</div></div><div>– Test conditions are based on AHRI 210/240 2017.</div></div></div><div><div>Protective function might work when using it outside the operation range.</div></div></div></div>								

## 2-1. Models: ACUH09LUAS1, ACUH12LUAS1, and ACUH18LUAS1


Grid type grille





## 2-2. Installation space requirement


Unit: in (mm)

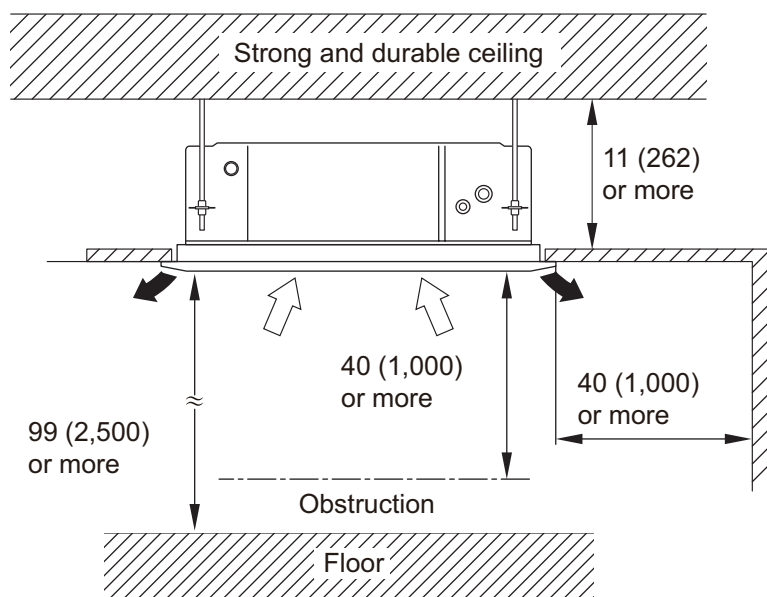

Maximum height from floor to ceiling [Unit: in (mm)]	
Standard	107 (2,700)
High ceiling	119 (3,000)

### 3-way direction setting:

Unit: in (mm)

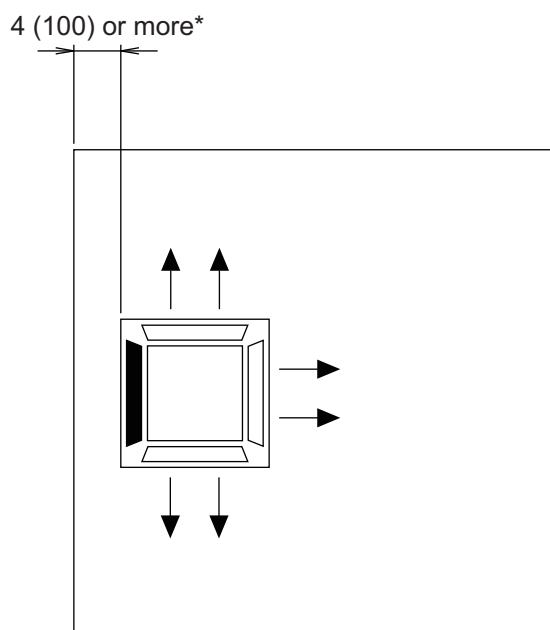


#### NOTES:

- To set "3-direction", optional Air Outlet Shutter Plate (UTR-YDZB) must be installed, and the "outlet-direction" need to be switched to "3-way" by remote controller.  
\*When installing the indoor unit, be careful about the maintenance space.
- In 3-way outlet mode, changing of ceiling height setting by function setting 20 is prohibited.  
(Ceiling height setting [function setting 20] is allowed to be changed only in 4-way outlet mode.)

## 3. Wiring diagram

### 3-1. Models: ACUH09LUAS1, ACUH12LUAS1, and ACUH18LUAS1

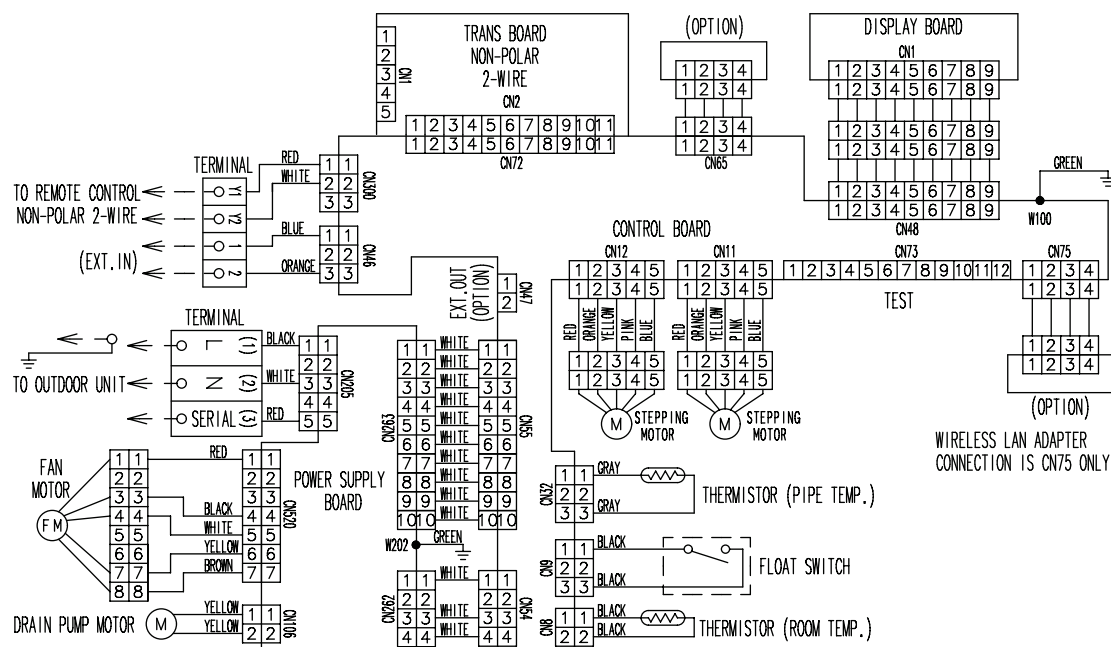

## 4. Capacity table

Capacity tables show each of following values calculated based on the outdoor temperature and the indoor temperature, under given Airflow Rate (AFR):

**For cooling capacity:** Total Capacity (TC), Sensible Heat Capacity (SHC), and Input Power (IP)

**For heating capacity:** Total Capacity (TC) and Input Power (IP)

### 4-1. Cooling capacity

#### ■ Model: ACUH09LUAS1

AFR	CFM	318
-----	-----	-----

		Indoor temperature																	
		64			70			75			80			85			90		
		54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW
	14	8.43	5.99	0.23	9.39	6.02	0.23	9.71	6.55	0.23	10.67	7.09	0.23	11.31	7.06	0.24	11.95	7.52	0.24
	23	7.99	5.67	0.26	8.90	5.71	0.26	9.21	6.21	0.26	10.12	6.72	0.27	10.72	6.70	0.27	11.33	7.13	0.27
	32	7.55	5.36	0.27	8.41	5.39	0.28	8.70	5.86	0.28	9.56	6.35	0.28	10.13	6.32	0.28	10.70	6.74	0.29
	41	7.47	5.05	0.27	8.32	5.08	0.28	8.60	5.52	0.28	9.45	5.98	0.28	10.02	5.96	0.28	10.58	6.34	0.29
	50	7.33	4.74	0.27	8.17	4.76	0.27	8.45	5.18	0.27	9.28	5.61	0.28	9.84	5.59	0.28	10.40	5.95	0.28
	59	7.16	4.58	0.28	7.98	4.60	0.28	8.25	5.01	0.28	9.06	5.42	0.29	9.61	5.40	0.29	10.15	5.75	0.29
	67	8.57	5.39	0.45	9.55	5.42	0.46	9.88	5.89	0.46	10.85	6.38	0.47	11.50	6.36	0.47	12.15	6.77	0.48
	77	8.11	5.16	0.51	9.03	5.19	0.52	9.34	5.64	0.52	10.26	6.11	0.53	10.88	6.09	0.53	11.49	6.48	0.54
	87	7.58	5.05	0.58	8.45	5.08	0.59	8.74	5.53	0.60	9.60	5.99	0.61	10.18	5.96	0.61	10.75	6.35	0.62
	95	7.11	4.83	0.64	7.92	4.86	0.65	8.19	5.28	0.65	9.00	5.72	0.66	9.54	5.70	0.67	10.08	6.07	0.67
104	6.04	4.58	0.60	6.73	4.60	0.61	6.96	5.01	0.62	7.65	5.42	0.63	8.11	5.40	0.63	8.57	5.75	0.64	
115	5.55	5.24	0.51	6.19	5.27	0.52	6.40	5.73	0.52	7.03	6.21	0.53	7.45	6.19	0.54	7.87	6.59	0.54	

AFR	m <sup>3</sup> /h	540
-----	-------------------	-----

Outdoor temperature		Indoor temperature																	
	°CDB	17.8			21.1			23.9			26.7			29.4			32.2		
	°CWB	12.2			15.6			17.2			19.4			21.7			22.8		
	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP
		kW				kW				kW				kW				kW	
	-10.0	2.47	1.75	0.23	2.75	1.77	0.23	2.85	1.92	0.23	3.13	2.08	0.23	3.32	2.07	0.24	3.50	2.21	0.24
	-5.0	2.34	1.66	0.26	2.61	1.67	0.26	2.70	1.82	0.26	2.97	1.97	0.27	3.14	1.96	0.27	3.32	2.09	0.27
	0.0	2.21	1.57	0.27	2.47	1.58	0.28	2.55	1.72	0.28	2.80	1.86	0.28	2.97	1.85	0.28	3.14	1.97	0.29
	5.0	2.19	1.48	0.27	2.44	1.49	0.28	2.52	1.62	0.28	2.77	1.75	0.28	2.94	1.75	0.28	3.10	1.86	0.29
	10.0	2.15	1.39	0.27	2.39	1.40	0.27	2.48	1.52	0.27	2.72	1.65	0.28	2.88	1.64	0.28	3.05	1.75	0.28
15.0	2.10	1.34	0.28	2.34	1.35	0.28	2.42	1.47	0.28	2.66	1.59	0.29	2.82	1.58	0.29	2.98	1.69	0.29	
19.4	2.51	1.58	0.45	2.80	1.59	0.46	2.90	1.73	0.46	3.18	1.87	0.47	3.37	1.86	0.47	3.56	1.99	0.48	
25.0	2.38	1.51	0.51	2.65	1.52	0.52	2.74	1.65	0.52	3.01	1.79	0.53	3.19	1.78	0.53	3.37	1.90	0.54	
30.6	2.22	1.48	0.58	2.48	1.49	0.59	2.56	1.62	0.60	2.81	1.76	0.61	2.98	1.75	0.61	3.15	1.86	0.62	
35.0	2.08	1.42	0.64	2.32	1.42	0.65	2.40	1.55	0.65	2.64	1.68	0.66	2.80	1.67	0.67	2.96	1.78	0.67	
40.0	1.77	1.34	0.60	1.97	1.35	0.61	2.04	1.47	0.62	2.24	1.59	0.63	2.38	1.58	0.63	2.51	1.69	0.64	
46.0	1.63	1.54	0.51	1.81	1.55	0.52	1.88	1.68	0.52	2.06	1.82	0.53	2.18	1.81	0.54	2.31	1.93	0.54	

# Model: ACUH12LUAS1

AFR		CFM								359											
		Indoor temperature																			
		64			70			75			80			85			90				
		54			60			63			67			71			73				
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP		
		kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW		
	14	10.36	8.83	0.33	11.54	8.88	0.33	11.93	9.66	0.33	13.11	10.46	0.34	13.90	10.42	0.34	14.68	11.10	0.34		
	23	10.28	8.74	0.38	11.45	8.80	0.38	11.84	9.56	0.39	13.01	10.36	0.39	13.79	10.32	0.40	14.57	10.99	0.40		
	32	10.20	8.67	0.41	11.36	8.72	0.41	11.75	9.48	0.42	12.91	10.27	0.42	13.68	10.23	0.43	14.46	10.89	0.43		
	41	10.12	8.61	0.44	11.27	8.66	0.44	11.66	9.42	0.45	12.81	10.20	0.45	13.58	10.16	0.46	14.35	10.83	0.46		
	50	10.04	8.53	0.45	11.18	8.58	0.45	11.57	9.33	0.46	12.71	10.11	0.46	13.47	10.07	0.47	14.24	10.73	0.47		
	59	9.96	8.48	0.46	11.10	8.53	0.47	11.48	9.27	0.47	12.61	10.05	0.47	13.37	10.01	0.48	14.12	10.66	0.48		
	67	11.23	9.57	0.64	12.51	9.63	0.65	12.94	10.47	0.66	14.22	11.34	0.67	15.07	11.30	0.67	15.93	12.03	0.68		
	77	10.69	9.09	0.73	11.91	9.14	0.75	12.31	9.94	0.75	13.53	10.77	0.76	14.34	10.73	0.77	15.15	11.43	0.78		
	87	10.10	8.58	0.82	11.25	8.63	0.83	11.63	9.38	0.83	12.78	10.17	0.84	13.55	10.13	0.85	14.31	10.79	0.86		
	95	9.48	8.06	0.91	10.56	8.11	0.92	10.92	8.82	0.93	12.00	9.56	0.94	12.72	9.52	0.95	13.44	10.14	0.96		
	104	8.00	7.19	0.77	8.91	7.23	0.78	9.22	7.86	0.79	10.13	8.52	0.80	10.74	8.48	0.81	11.35	9.04	0.82		
115	7.38	6.67	0.77	8.22	6.71	0.78	8.50	7.30	0.79	9.34	7.91	0.80	9.90	7.88	0.81	10.46	8.39	0.82			

AFR				m³/h							610											
Outdoor temperature		Indoor temperature																				
	°CDB	17.8			21.1			23.9			26.7			29.4			32.2					
	°CWB	12.2			15.6			17.2			19.4			21.7			22.8					
	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP			
		kW			kW			kW			kW			kW			kW					
	-10.0	3.04	2.59	0.33	3.38	2.60	0.33	3.50	2.83	0.33	3.84	3.07	0.34	4.07	3.06	0.34	4.30	3.25	0.34			
	-5.0	3.01	2.56	0.38	3.36	2.58	0.38	3.47	2.80	0.39	3.81	3.04	0.39	4.04	3.03	0.40	4.27	3.22	0.40			
	0.0	2.99	2.54	0.41	3.33	2.56	0.41	3.44	2.78	0.42	3.78	3.01	0.42	4.01	3.00	0.43	4.24	3.19	0.43			
	5.0	2.97	2.52	0.44	3.30	2.54	0.44	3.42	2.76	0.45	3.76	2.99	0.45	3.98	2.98	0.46	4.21	3.17	0.46			
	10.0	2.94	2.50	0.45	3.28	2.52	0.45	3.39	2.74	0.46	3.73	2.96	0.46	3.95	2.95	0.47	4.17	3.15	0.47			
	15.0	2.92	2.49	0.46	3.25	2.50	0.47	3.36	2.72	0.47	3.70	2.95	0.47	3.92	2.93	0.48	4.14	3.12	0.48			
	19.4	3.29	2.81	0.64	3.67	2.82	0.65	3.79	3.07	0.66	4.17	3.33	0.67	4.42	3.31	0.67	4.67	3.53	0.68			
	25.0	3.13	2.66	0.73	3.49	2.68	0.75	3.61	2.91	0.75	3.97	3.16	0.76	4.20	3.14	0.77	4.44	3.35	0.78			
30.6	2.96	2.52	0.82	3.30	2.53	0.83	3.41	2.75	0.83	3.75	2.98	0.84	3.97	2.97	0.85	4.20	3.16	0.86				
35.0	2.78	2.36	0.91	3.10	2.38	0.92	3.20	2.59	0.93	3.52	2.80	0.94	3.73	2.79	0.95	3.94	2.97	0.96				
40.0	2.35	2.11	0.77	2.61	2.12	0.78	2.70	2.31	0.79	2.97	2.50	0.80	3.15	2.49	0.81	3.33	2.65	0.82				
46.0	2.16	1.96	0.77	2.41	1.97	0.78	2.49	2.14	0.79	2.74	2.32	0.80	2.90	2.31	0.81	3.07	2.46	0.82				

# Model: ACUH18LUAS1

AFR			CFM						435											
			Indoor temperature																	
			64			70			75			80			85			90		
			54			60			63			67			71			73		
Outdoor temperature	°FDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	
		kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	kBtu		kW	
	14	15.00	11.36	0.47	16.71	11.43	0.48	17.28	12.43	0.48	18.99	13.46	0.49	20.13	13.41	0.49	21.27	14.28	0.50	
	23	14.77	11.16	0.51	16.45	11.23	0.52	17.01	12.20	0.52	18.69	13.22	0.53	19.81	13.17	0.53	20.94	14.03	0.54	
	32	14.53	11.00	0.53	16.19	11.07	0.54	16.74	12.03	0.54	18.40	13.04	0.55	19.50	12.99	0.56	20.60	13.83	0.56	
	41	14.30	10.83	0.53	15.93	10.89	0.54	16.47	11.84	0.54	18.10	12.83	0.55	19.19	12.78	0.56	20.27	13.61	0.56	
	50	14.07	10.65	0.55	15.67	10.71	0.56	16.20	11.64	0.56	17.81	12.61	0.57	18.88	12.56	0.57	19.94	13.38	0.58	
	59	13.84	10.45	0.58	15.41	10.52	0.59	15.94	11.43	0.60	17.51	12.39	0.61	18.56	12.34	0.61	19.61	13.14	0.62	
	67	15.89	12.04	0.95	17.70	12.11	0.97	18.31	13.17	0.97	20.12	14.27	0.99	21.33	14.21	1.00	22.53	15.14	1.01	
	77	15.16	11.45	1.07	16.88	11.52	1.08	17.46	12.53	1.09	19.19	13.57	1.11	20.34	13.52	1.12	21.49	14.40	1.13	
	87	14.37	10.88	1.21	16.00	10.94	1.23	16.55	11.89	1.23	18.18	12.89	1.25	19.28	12.83	1.26	20.37	13.67	1.28	
	95	13.51	10.23	1.32	15.05	10.30	1.34	15.56	11.19	1.35	17.10	12.13	1.37	18.13	12.08	1.38	19.15	12.87	1.40	
	104	11.86	8.97	1.30	13.21	9.02	1.32	13.66	9.81	1.32	15.01	10.63	1.34	15.91	10.59	1.36	16.81	11.28	1.37	
115	9.95	8.16	1.28	11.09	8.21	1.30	11.47	8.93	1.31	12.60	9.67	1.33	13.36	9.63	1.34	14.11	10.26	1.36		

AFR				m³/h								740											
Outdoor temperature		Indoor temperature																					
	°CDB	17.8			21.1			23.9			26.7			29.4			32.2						
	°CWB	12.2			15.6			17.2			19.4			21.7			22.8						
	°CDB	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP	TC	SHC	IP				
		kW			kW			kW			kW			kW			kW						
	-10.0	4.40	3.33	0.47	4.90	3.35	0.48	5.07	3.64	0.48	5.57	3.95	0.49	5.90	3.93	0.49	6.23	4.19	0.50				
	-5.0	4.33	3.27	0.51	4.82	3.29	0.52	4.99	3.58	0.52	5.48	3.88	0.53	5.81	3.86	0.53	6.14	4.11	0.54				
	0.0	4.26	3.23	0.53	4.75	3.25	0.54	4.91	3.53	0.54	5.39	3.82	0.55	5.72	3.81	0.56	6.04	4.06	0.56				
	5.0	4.19	3.18	0.53	4.67	3.19	0.54	4.83	3.47	0.54	5.31	3.76	0.55	5.63	3.75	0.56	5.94	3.99	0.56				
	10.0	4.12	3.12	0.55	4.59	3.14	0.56	4.75	3.41	0.56	5.22	3.70	0.57	5.53	3.68	0.57	5.85	3.92	0.58				
15.0	4.06	3.06	0.58	4.52	3.08	0.59	4.67	3.35	0.60	5.13	3.63	0.61	5.44	3.62	0.61	5.75	3.85	0.62					
19.4	4.66	3.53	0.95	5.19	3.55	0.97	5.37	3.86	0.97	5.90	4.18	0.99	6.25	4.17	1.00	6.61	4.44	1.01					
25.0	4.44	3.36	1.07	4.95	3.38	1.08	5.12	3.67	1.09	5.63	3.98	1.11	5.96	3.96	1.12	6.30	4.22	1.13					
30.6	4.21	3.19	1.21	4.69	3.21	1.23	4.85	3.49	1.23	5.33	3.78	1.25	5.65	3.76	1.26	5.97	4.01	1.28					
35.0	3.96	3.00	1.32	4.41	3.02	1.34	4.56	3.28	1.35	5.01	3.56	1.37	5.31	3.54	1.38	5.61	3.77	1.40					
40.0	3.48	2.63	1.30	3.87	2.65	1.32	4.01	2.88	1.32	4.40	3.12	1.34	4.67	3.10	1.36	4.93	3.31	1.37					
46.0	2.92	2.39	1.28	3.25	2.41	1.30	3.36	2.62	1.31	3.69	2.84	1.33	3.92	2.82	1.34	4.14	3.01	1.36					

## 4-2. Heating capacity

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

### ■ Model: ACUH09LUAS1

AFR	CFM	318
-----	-----	-----

		Indoor temperature								
		°FDB	60		65		70		75	
Outdoor temperature	°FDB	°FWB	TC kBtu/h	IP kW	TC kBtu/h	IP kW	TC kBtu/h	IP kW	TC kBtu/h	IP kW
	-5	-7	8.96	1.18	8.74	1.21	8.53	1.23	8.10	1.28
	5	3	10.63	1.28	10.37	1.30	10.12	1.33	9.61	1.38
	14	12	10.47	1.31	10.22	1.33	9.97	1.36	9.47	1.41
	23	19	12.32	1.38	12.02	1.41	11.73	1.44	11.14	1.50
	32	28	13.99	1.49	13.65	1.52	13.32	1.55	12.65	1.61
	41	37	15.49	1.58	15.12	1.62	14.75	1.65	14.01	1.72
	47	43	16.80	1.65	16.40	1.69	16.00	1.72	15.20	1.79
	50	47	16.89	1.67	16.49	1.71	16.09	1.74	15.29	1.80
	59	50	17.06	1.57	16.66	1.60	16.25	1.64	15.44	1.69
	68	59	16.10	1.19	15.79	1.22	15.33	1.24	14.56	1.29
	75	64	16.62	1.25	16.30	1.27	15.83	1.30	15.04	1.35

AFR	m³/h	540
-----	------	-----

		Indoor temperature									
		°CDB	15.6		18.3		21.1		23.9		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		
	-20.6	-21.7	2.63	1.18	2.56	1.21	2.50	1.23	2.38	1.28	
	-15.0	-16.1	3.11	1.28	3.04	1.30	2.97	1.33	2.82	1.38	
	-10.0	-11.1	3.07	1.31	3.00	1.33	2.92	1.36	2.78	1.41	
	-5.0	-7.2	3.61	1.38	3.52	1.41	3.44	1.44	3.27	1.50	
	0.0	-2.2	4.10	1.49	4.00	1.52	3.90	1.55	3.71	1.61	
	5.0	2.8	4.54	1.58	4.43	1.62	4.32	1.65	4.11	1.72	
	8.3	6.1	4.92	1.65	4.81	1.69	4.69	1.72	4.45	1.79	
	10.0	8.3	4.95	1.67	4.83	1.71	4.72	1.74	4.48	1.80	
	15.0	10.0	5.00	1.57	4.88	1.60	4.76	1.64	4.52	1.69	
	20.0	15.0	4.72	1.19	4.63	1.22	4.49	1.24	4.27	1.29	
24.0	18.0	4.87	1.25	4.78	1.27	4.64	1.30	4.41	1.35		

### ■ Model: ACUH12LUAS1

AFR	CFM	359
-----	-----	-----

		Indoor temperature									
		°FDB	60		65		70		75		
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	-5	-7	15.75	2.11	15.38	2.16	15.00	2.20	14.25	2.29	
	5	3	16.80	2.16	16.40	2.21	16.00	2.25	15.20	2.34	
	14	12	18.27	2.04	17.84	2.08	17.40	2.12	16.53	2.20	
	23	19	19.11	1.87	18.66	1.91	18.20	1.95	17.29	2.03	
	32	28	19.43	1.82	18.96	1.86	18.50	1.90	17.58	1.98	
	41	37	19.74	1.77	19.27	1.81	18.80	1.84	17.86	1.92	
	47	43	20.37	1.72	19.89	1.75	19.40	1.79	18.43	1.86	
	50	47	22.47	1.71	21.94	1.75	21.40	1.78	20.33	1.84	
	59	50	23.31	1.51	22.76	1.55	22.20	1.58	21.09	1.63	
	68	59	22.14	1.21	21.72	1.24	21.09	1.26	20.04	1.31	
	75	64	22.61	1.24	22.18	1.27	21.53	1.29	20.46	1.35	

AFR	m³/h	610
-----	------	-----

		Indoor temperature									
		°CDB	15.6		18.3		21.1		23.9		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		
	-20.6	-21.7	4.62	2.11	4.51	2.16	4.40	2.20	4.18	2.29	
	-15.0	-16.1	4.92	2.16	4.81	2.21	4.69	2.25	4.45	2.34	
	-10.0	-11.1	5.35	2.04	5.23	2.08	5.10	2.12	4.84	2.20	
	-5.0	-7.2	5.60	1.87	5.47	1.91	5.33	1.95	5.07	2.03	
	0.0	-2.2	5.69	1.82	5.56	1.86	5.42	1.90	5.15	1.98	
	5.0	2.8	5.79	1.77	5.65	1.81	5.51	1.84	5.23	1.92	
	8.3	6.1	5.97	1.72	5.83	1.75	5.69	1.79	5.40	1.86	
	10.0	8.3	6.59	1.71	6.43	1.75	6.27	1.78	5.96	1.84	
	15.0	10.0	6.83	1.51	6.67	1.55	6.51	1.58	6.18	1.63	
	20.0	15.0	6.49	1.21	6.37	1.24	6.18	1.26	5.87	1.31	
24.0	18.0	6.63	1.24	6.50	1.27	6.31	1.29	6.00	1.35		

# Model: ACUH18LUAS1

AFR	CFM	435
-----	-----	-----

		Indoor temperature									
		°FDB	60		65		70		75		
Outdoor temperature	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	kBtu/h	kW	
	-5	-7	15.75	2.02	15.38	2.06	15.00	2.10	14.25	2.18	
	5	3	18.38	2.11	17.94	2.16	17.50	2.20	16.63	2.29	
	14	12	19.95	2.36	19.48	2.41	19.00	2.46	18.05	2.56	
	23	19	21.68	2.60	21.16	2.66	20.10	2.71	19.61	2.82	
	32	28	22.84	2.92	22.30	2.98	21.76	3.04	20.67	3.16	
	41	37	23.44	2.51	22.88	2.56	22.33	2.61	21.21	2.71	
	47	43	25.10	2.40	24.50	2.45	23.90	2.50	22.71	2.60	
	50	47	26.15	2.25	25.52	2.29	24.90	2.34	23.66	2.42	
	59	50	27.20	1.99	26.55	2.04	25.90	2.08	24.61	2.15	
	68	59	25.84	1.60	25.34	1.63	24.61	1.66	23.37	1.73	
	75	64	26.38	1.64	25.88	1.67	25.12	1.70	23.87	1.77	

AFR	m³/h	740
-----	------	-----

		Indoor temperature									
		°CDB	15.6		18.3		21.1		23.9		
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		
	-20.6	-21.7	4.62	2.02	4.51	2.06	4.40	2.10	4.18	2.18	
	-15.0	-16.1	5.39	2.11	5.26	2.16	5.13	2.20	4.87	2.29	
	-10.0	-11.1	5.85	2.36	5.71	2.41	5.57	2.46	5.29	2.56	
	-5.0	-7.2	6.35	2.60	6.20	2.66	5.89	2.71	5.75	2.82	
	0.0	-2.2	6.69	2.92	6.54	2.98	6.38	3.04	6.06	3.16	
	5.0	2.8	6.87	2.51	6.71	2.56	6.54	2.61	6.22	2.71	
	8.3	6.1	7.35	2.40	7.18	2.45	7.00	2.50	6.65	2.60	
	10.0	8.3	7.66	2.25	7.48	2.29	7.30	2.34	6.93	2.42	
	15.0	10.0	7.97	1.99	7.78	2.04	7.59	2.08	7.21	2.15	
	20.0	15.0	7.57	1.60	7.43	1.63	7.21	1.66	6.85	1.73	
24.0	18.0	7.73	1.64	7.58	1.67	7.36	1.70	6.99	1.77		


## 5. Fan performance

### 5-1. Air velocity distributions


#### ■ Model: ACUH09LUAS1 (4-way air outlet)

Measuring conditions	Fan speed	Operation mode	Ceiling mode
	HIGH	FAN	STANDARD


Top view  
Horizontal louver: Upward

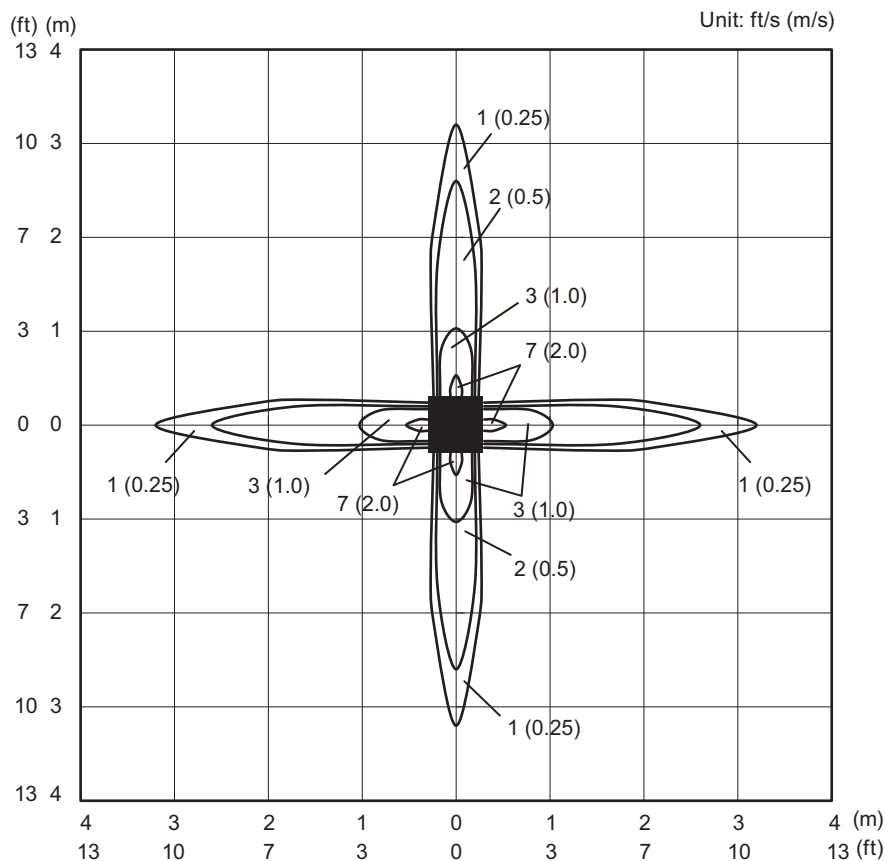

Side view  
Horizontal louver: Upward

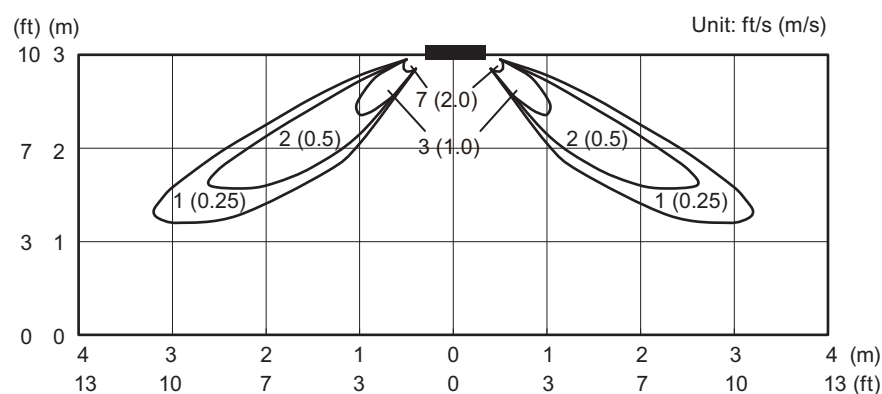


Side view  
Horizontal louver: Downward

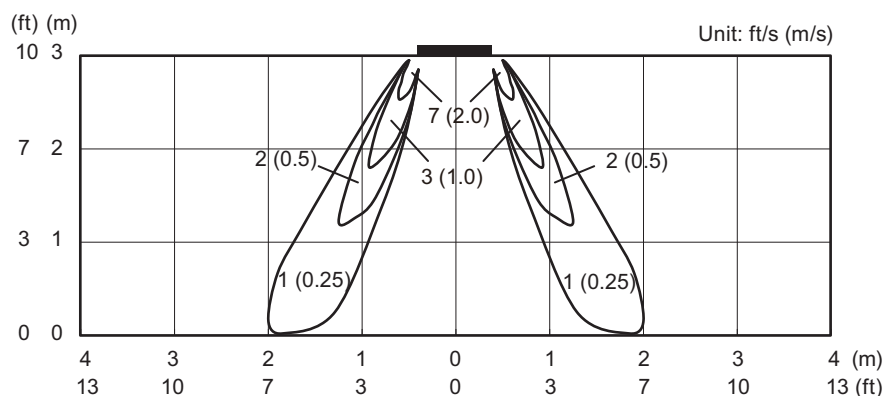


# Model: ACUH09LUAS1 (3-way air outlet)

Measuring conditions	Fan speed HIGH	Operation mode FAN	Ceiling mode STANDARD
----------------------	-------------------	-----------------------	--------------------------


Top view  
Horizontal louver: Upward

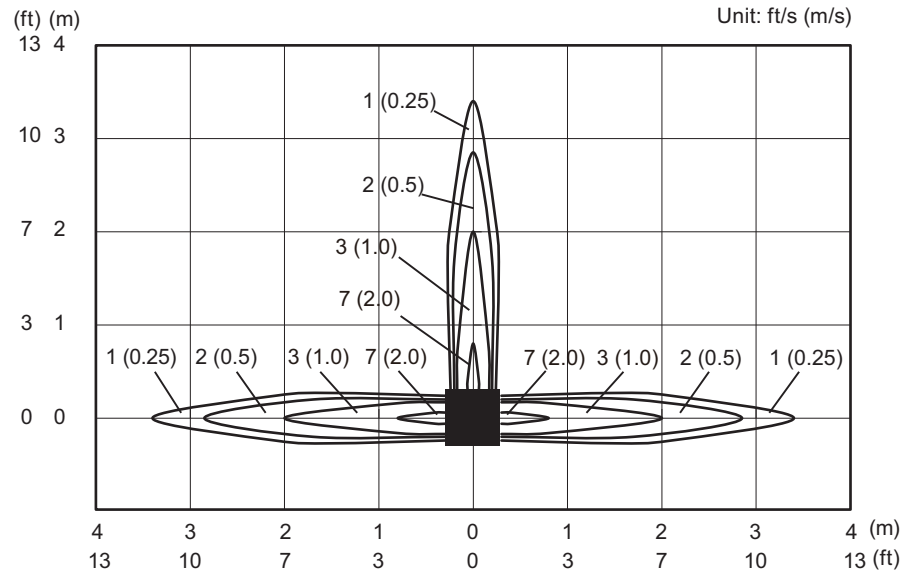

Side view  
Horizontal louver: Upward

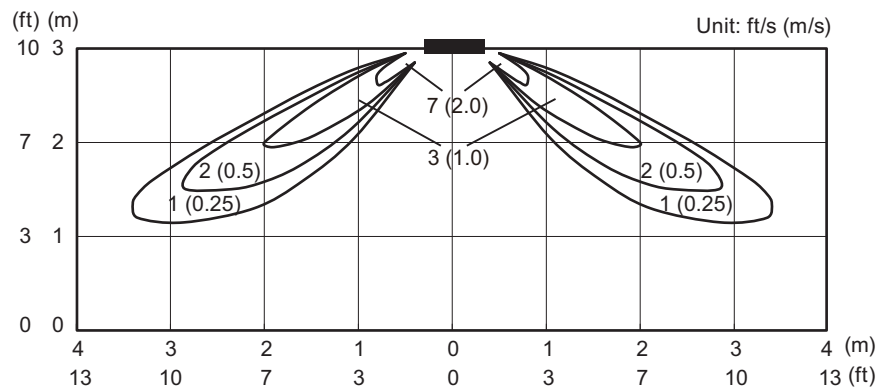

Side view  
Horizontal louver: Downward

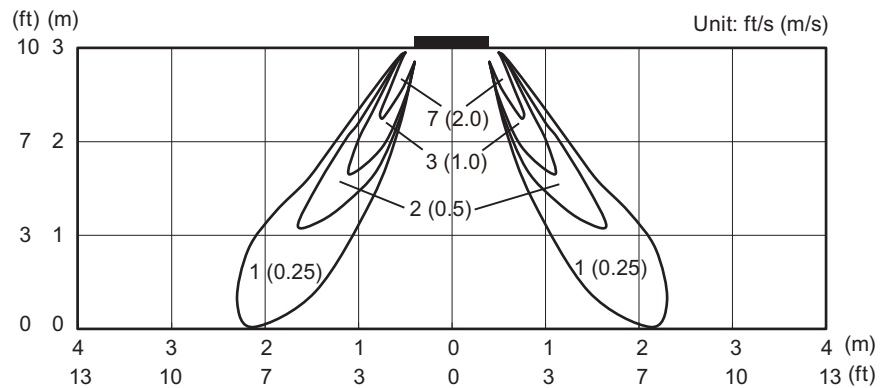





# Model: ACUH12LUAS1 (4-way air outlet)

Measuring conditions	Fan speed HIGH	Operation mode FAN	Ceiling mode STANDARD
----------------------	-------------------	-----------------------	--------------------------


Top view  
Horizontal louver: Upward

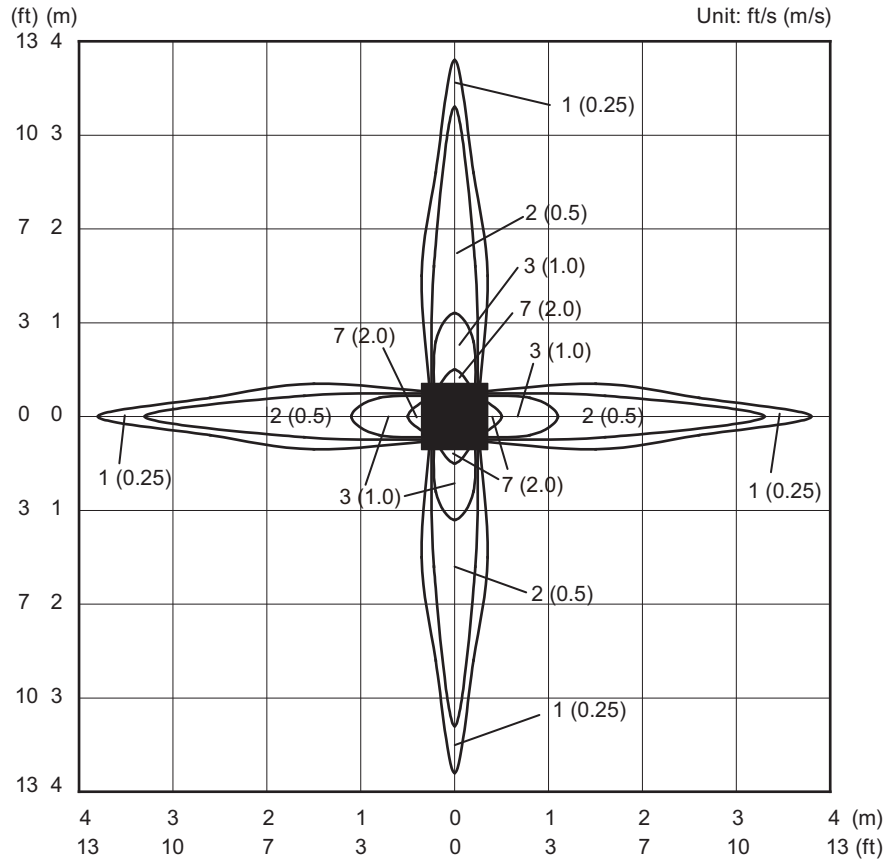

Side view  
Horizontal louver: Upward

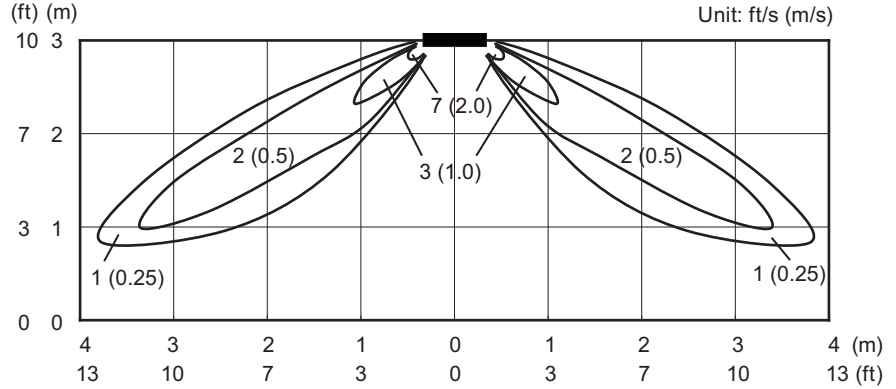


Side view  
Horizontal louver: Downward

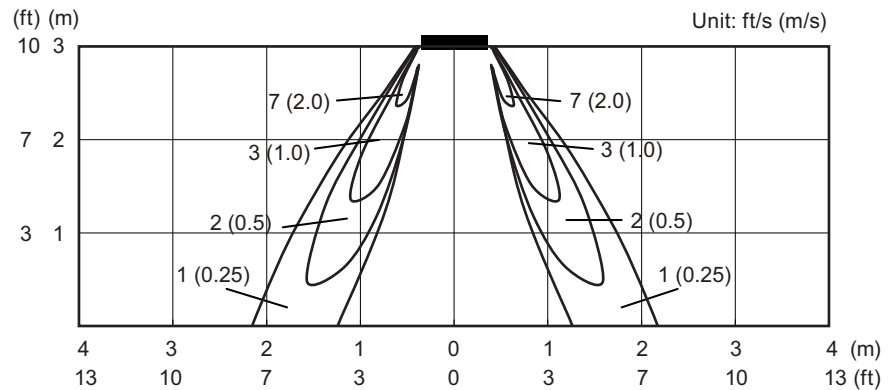


# Model: ACUH12LUAS1 (3-way air outlet)

Measuring conditions	Fan speed	Operation mode	Ceiling mode
	HIGH	FAN	STANDARD


Top view  
Horizontal louver: Upward

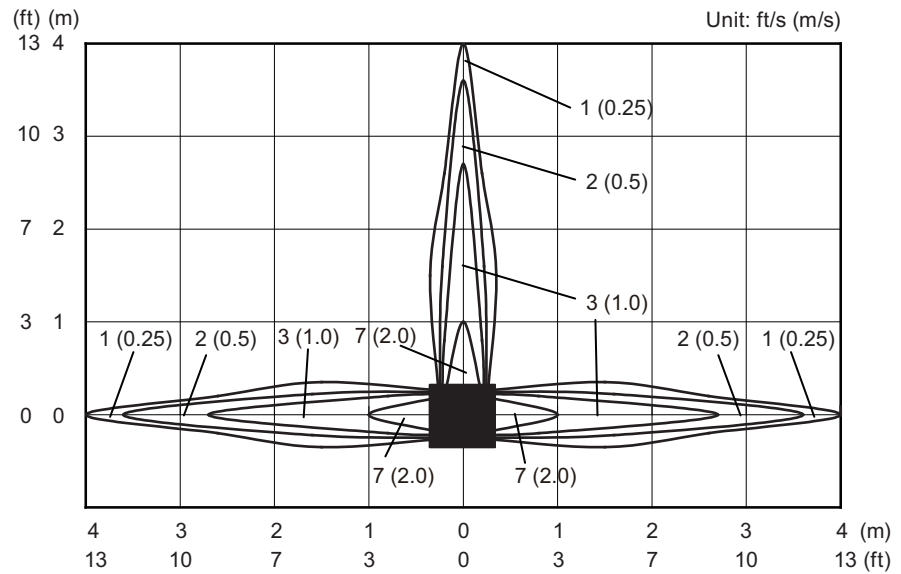

Side view  
Horizontal louver: Upward

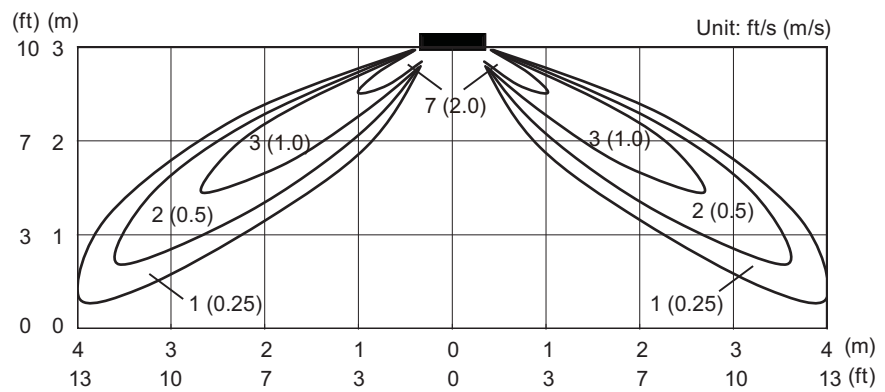


Side view  
Horizontal louver: Downward

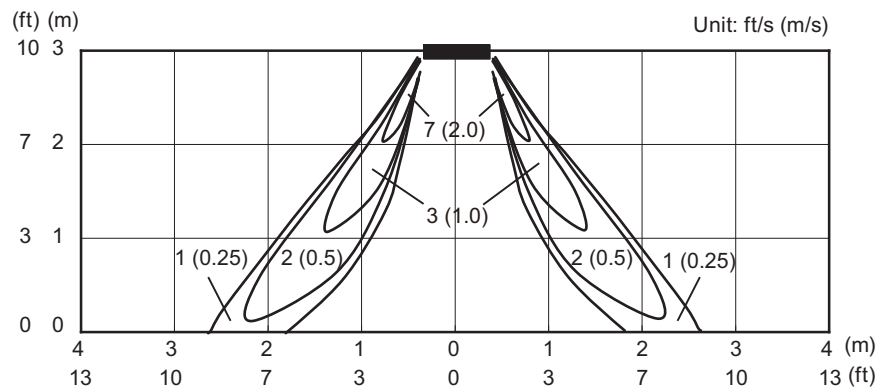


# Model: ACUH18LUAS1 (4-way air outlet)

Measuring conditions	Fan speed	Operation mode	Ceiling mode
	HIGH	FAN	STANDARD


Top view  
Horizontal louver: Upward

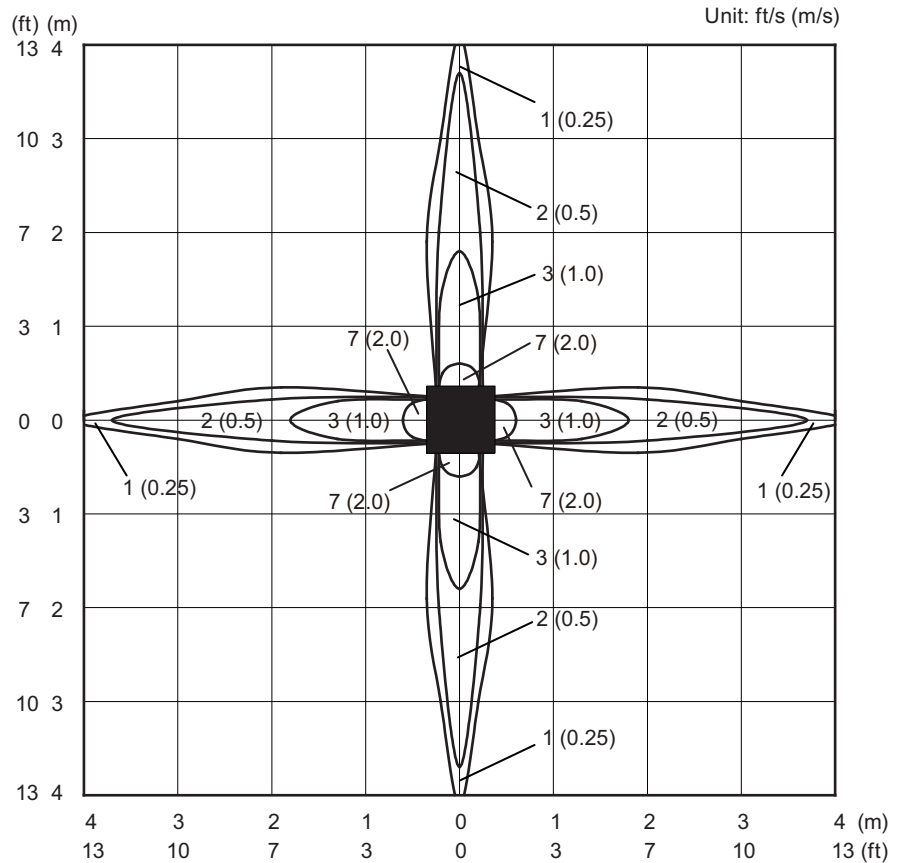

Side view  
Horizontal louver: Upward

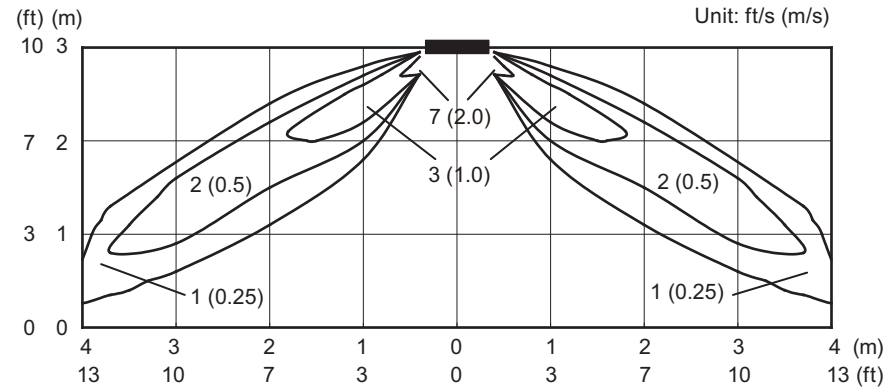


Side view  
Horizontal louver: Downward

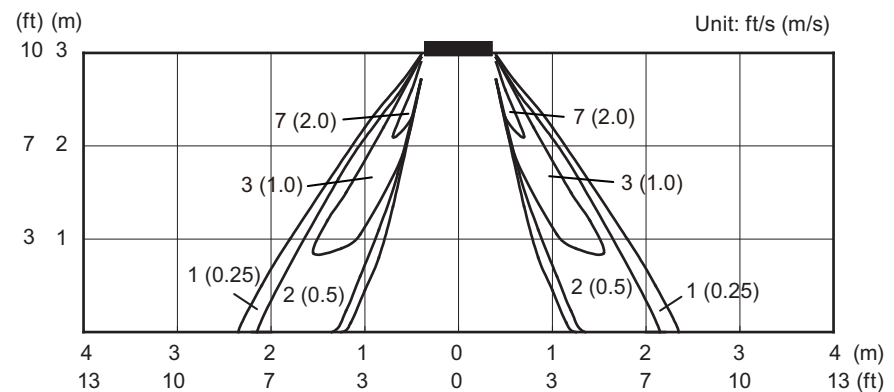


# Model: ACUH18LUAS1 (3-way air outlet)

Measuring conditions	Fan speed HIGH	Operation mode FAN	Ceiling mode STANDARD
----------------------	-------------------	-----------------------	--------------------------


Top view  
Horizontal louver: Upward

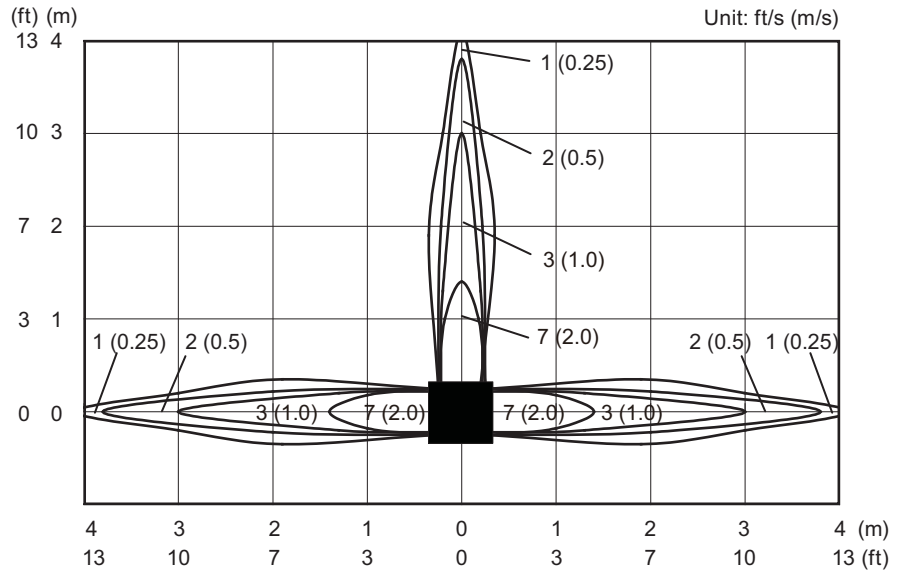

Side view  
Horizontal louver: Upward

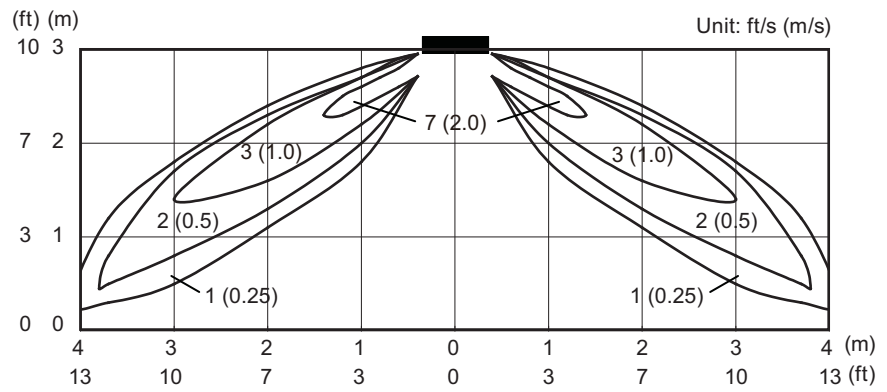

Side view  
Horizontal louver: Downward

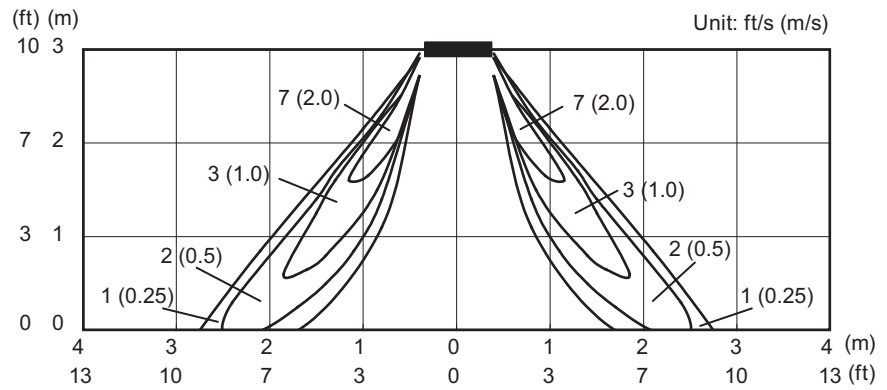

## 5-2. Airflow

Conversion factor:

- $1 \text{ m}^3/\text{h} = 0.2778 \text{ l/s} = 0.5886 \text{ CFM}$
- $3.6 \text{ m}^3/\text{h} = 1 \text{ l/s}$
- $1.699 \text{ m}^3/\text{h} = 1 \text{ CFM}$

### ■ Model: ACUH09LUAS1

#### ● Cooling

Fan speed	Airflow	
HIGH	$\text{m}^3/\text{h}$	540
	$\text{l/s}$	150
	CFM	318
MED	$\text{m}^3/\text{h}$	490
	$\text{l/s}$	136
	CFM	288
LOW	$\text{m}^3/\text{h}$	440
	$\text{l/s}$	122
	CFM	259
QUIET	$\text{m}^3/\text{h}$	390
	$\text{l/s}$	108
	CFM	229

#### ● Heating

Fan speed	Airflow	
HIGH	$\text{m}^3/\text{h}$	540
	$\text{l/s}$	150
	CFM	318
MED	$\text{m}^3/\text{h}$	490
	$\text{l/s}$	136
	CFM	288
LOW	$\text{m}^3/\text{h}$	440
	$\text{l/s}$	122
	CFM	259
QUIET	$\text{m}^3/\text{h}$	390
	$\text{l/s}$	108
	CFM	229

## ■ Model: ACUH12LUAS1

### ● Cooling

Fan speed	Airflow	
HIGH	m <sup>3</sup> /h	610
	l/s	169
	CFM	359
MED	m <sup>3</sup> /h	530
	l/s	147
	CFM	312
LOW	m <sup>3</sup> /h	470
	l/s	131
	CFM	276
QUIET	m <sup>3</sup> /h	410
	l/s	114
	CFM	241

### ● Heating

Fan speed	Airflow	
HIGH	m <sup>3</sup> /h	610
	l/s	169
	CFM	359
MED	m <sup>3</sup> /h	530
	l/s	147
	CFM	312
LOW	m <sup>3</sup> /h	470
	l/s	131
	CFM	276
QUIET	m <sup>3</sup> /h	410
	l/s	114
	CFM	241

## ■ Model: ACUH18LUAS1

### ● Cooling

Fan speed	Airflow	
HIGH	m <sup>3</sup> /h	740
	l/s	206
	CFM	436
MED	m <sup>3</sup> /h	580
	l/s	161
	CFM	341
LOW	m <sup>3</sup> /h	490
	l/s	136
	CFM	288
QUIET	m <sup>3</sup> /h	410
	l/s	114
	CFM	241

### ● Heating


Fan speed	Airflow	
HIGH	m <sup>3</sup> /h	740
	l/s	206
	CFM	436
MED	m <sup>3</sup> /h	580
	l/s	161
	CFM	341
LOW	m <sup>3</sup> /h	490
	l/s	136
	CFM	288
QUIET	m <sup>3</sup> /h	410
	l/s	114
	CFM	241

## 6. Operation noise (sound pressure)


### 6-1. Noise level curve

#### ■ Model: ACUH09LUAS1

##### ● Cooling

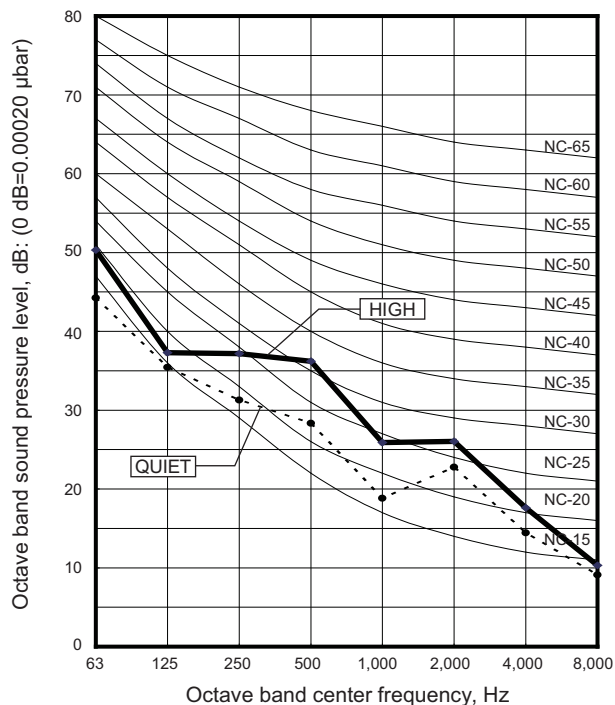


##### ● Heating

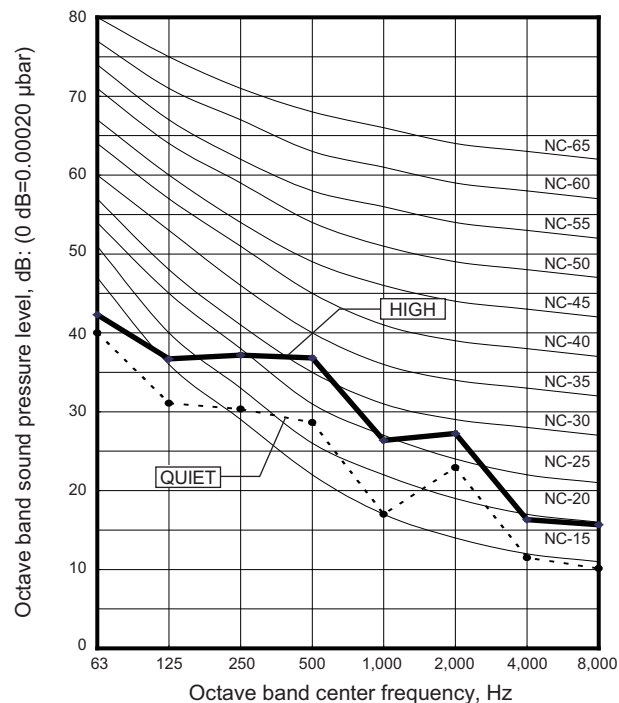


#### ■ Model: ACUH12LUAS1

##### ● Cooling

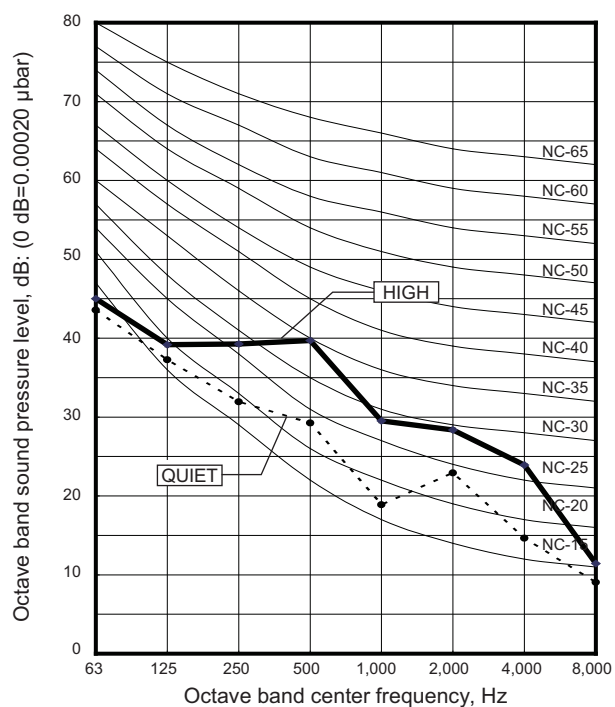


##### ● Heating

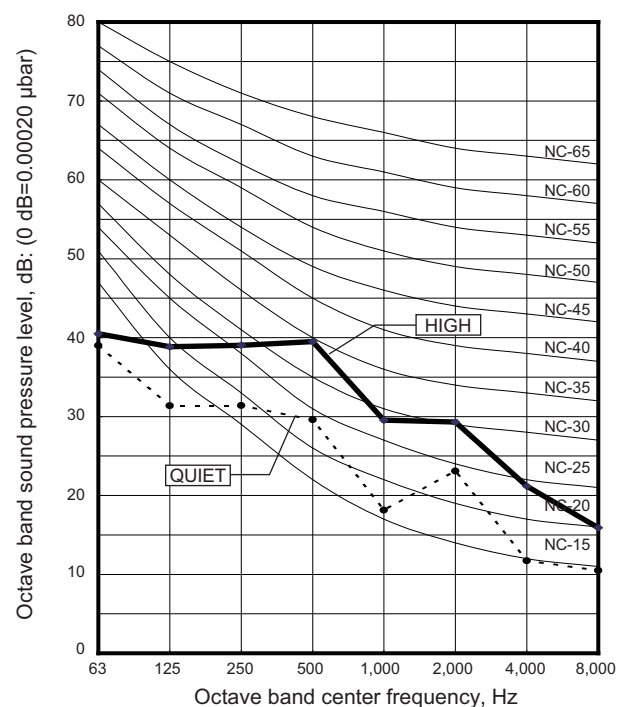




# Model: ACUH18LUAS1



## Cooling

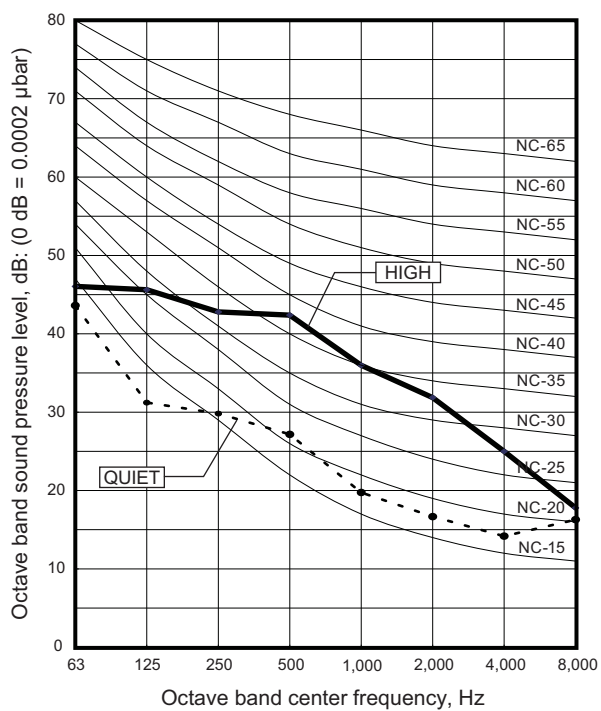

## Heating

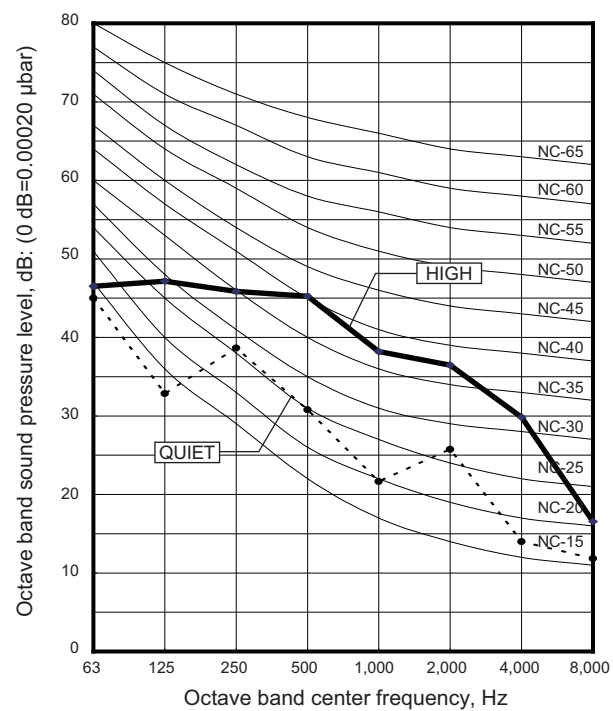

## 6-2. Sound level check point

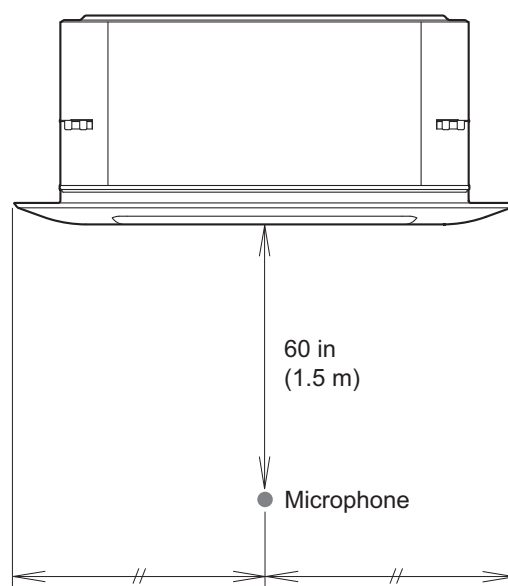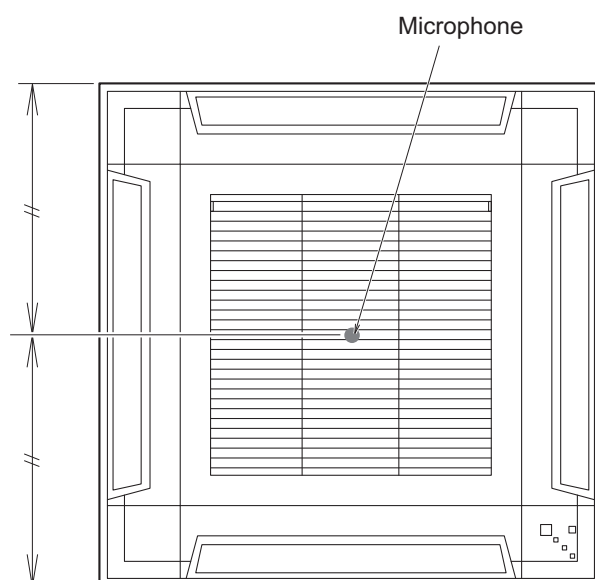


## 7. Safety devices

Type of protection	Protection form		Model
			ACUH09-18LUAS1
Circuit protection	Current fuse (PCB*)		250 V, 5 A
Fan motor protection	Thermal protection program	Activate	Activate: $212 \pm 27$ °F ( $100 \pm 15$ °C) Fan motor stop
		Reset	Reset: $203 \pm 18$ °F ( $95 \pm 10$ °C) Fan motor restart

\*PCB: Printed Circuit Board

## 8. External input and output

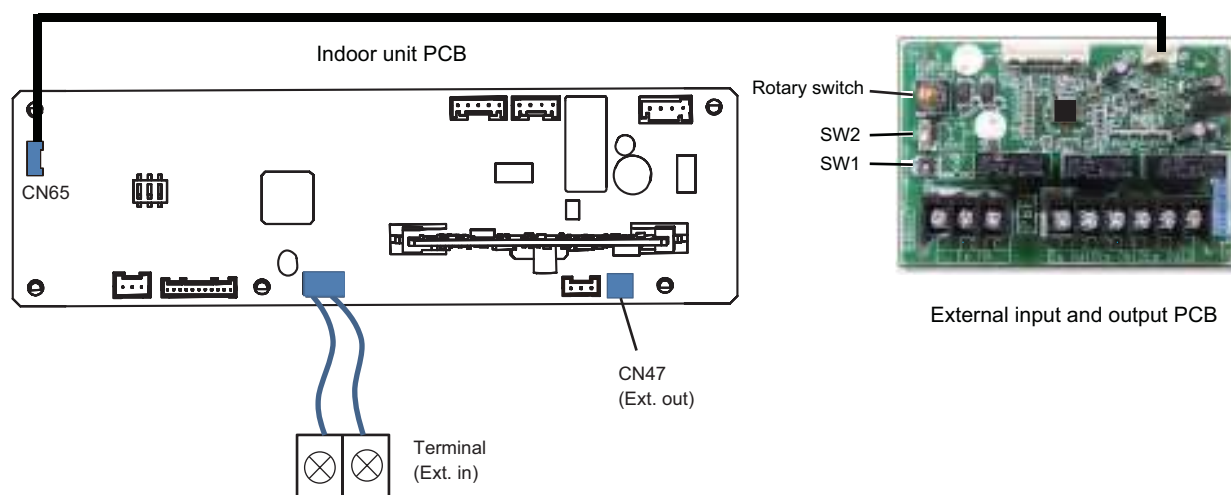

Connecting point		Input/Output	Function	Input select	Input signal
Indoor unit	Terminal	Input	Operation/Stop Forced stop	Dry contact	Edge
	CN47	Output	Operation/Stop	—	—
			Error status		
			Indoor unit fan operation status		
			Cooling thermostat On		
			Heating thermostat On		
			External heater output		
External Input and Output PCB (UTY-XCSX)	Ex IN 1/2	Input	Operation/Stop	Dry contact/Apply voltage	Edge/Pulse
	Ex IN 1		Forced thermostat off		Edge
	Ex OUT 1 Ex OUT 2 Ex OUT 3	Output	Operation/Stop	—	—
			Error status		
			Indoor unit fan operation status		
			External heater output		
			Cooling high/low output		
			Heating thermostat On		


**NOTE:** For details of the switching function, refer to ["Setting of external input and output"](#) on page 28.

## 8-1. External input

- “Operation/Stop” mode or “Forced stop” mode can be selected with function setting of indoor unit.
- A twisted pair cable (22 AWG) should be used. Maximum length of cable is 492 ft (150 m).
- Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.
- The wire connection should be separate from the power cable line.

### Indoor unit

Indoor unit functions such as Operation/Stop can be done by using indoor unit terminal.

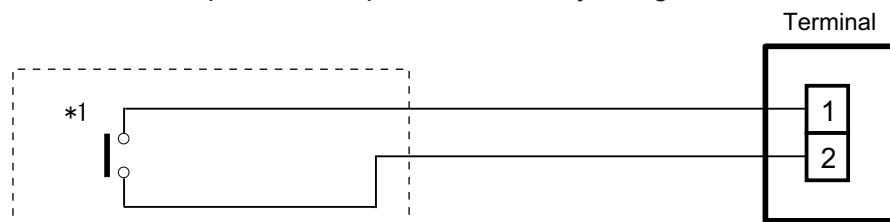

\*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

### External Input and Output PCB


The indoor unit Operation/Stop can be set by using the input terminal on the PCB.

#### Input select

Use either one of these types of terminal according to the application. (Both types of terminal cannot be used simultaneously.)

##### – Dry contact


In case of internal power supply, set the slide switch of SW1 to “NON VOL” side.

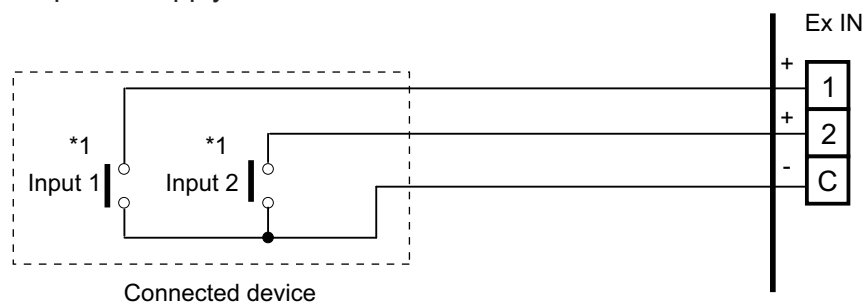

\*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

##### – Apply voltage

In case of external power supply, set the slide switch of SW1 to “VOL” side.

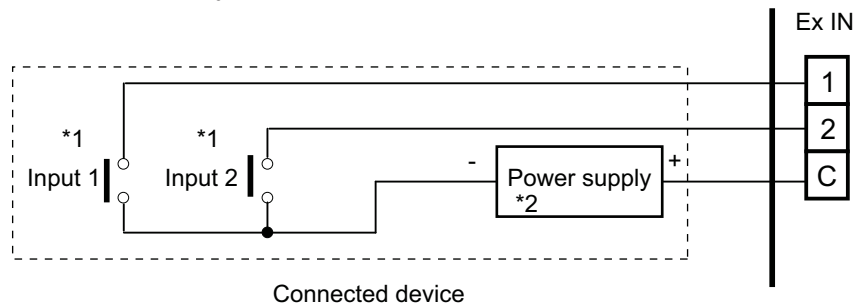


\*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

\*2: Make the power supply DC 12 V to 24 V, 10 mA or more.

## ■ Input signal type

- **Indoor unit**


Input signal type is only "Edge".



- **External Input and Output PCB**

The input signal type can be selected.

Signal type (edge or pulse) can be switched by the DIP switch 2 (SW2) on the External Input and Output PCB.

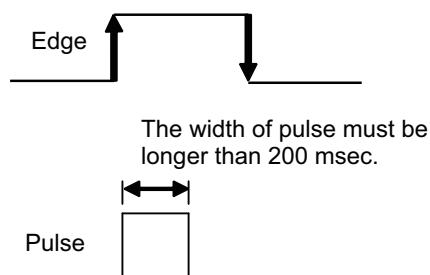

**NOTE:** The input signal supports the following switch type:

- Edge: Alternate type switch
- Pulse: Momentary type switch

## 8-2. External output


Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

### Indoor unit

- A twisted pair cable (22 AWG) should be used. Maximum length of cable is 82 ft (25 m).
- Output voltage: High DC 12 V  $\pm$  2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to ["Setting of external input and output"](#) on page 28.


#### When indicator, etc. are connected directly

**Example:** Function setting number 60 is set to "00"

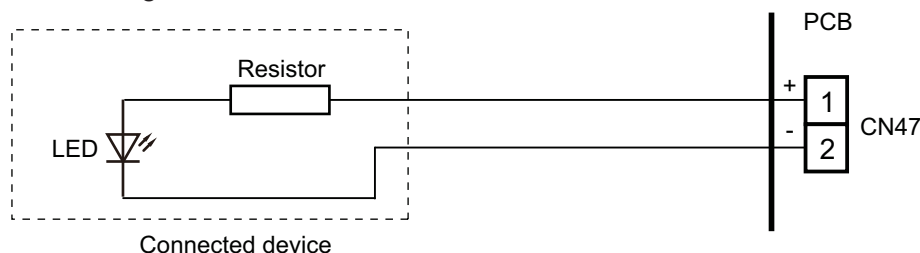


#### When connecting with a device equipped with a power supply

**Example:** Function setting number 60 is set to "00"

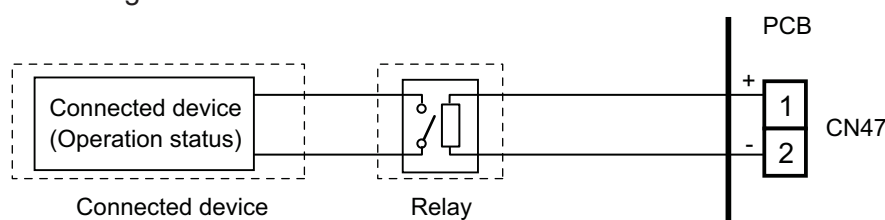

### External Input and Output PCB

- A twisted pair cable (22 AWG) should be used.
- Permissible voltage and current: DC 5 V to 30 V/3 A, AC 30 V to 250 V/3 A
- For details, refer to ["Setting of external input and output"](#) on page 28.

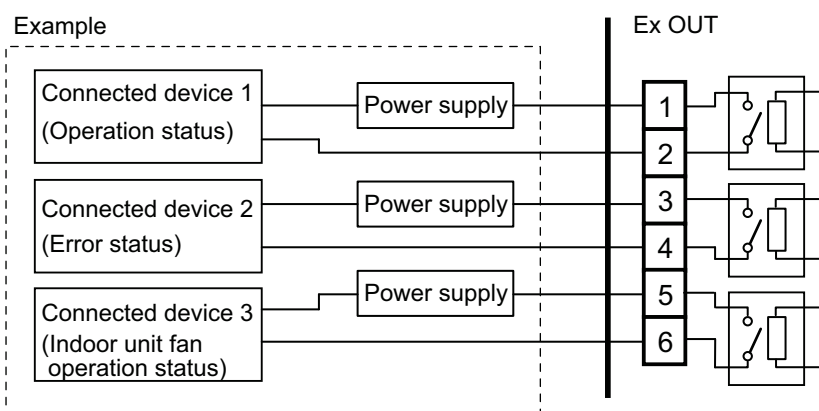

## 8-3. Setting of external input and output

- Indoor unit

Input		
Connection point	Function setting number 46	Function
Terminal	00	Operation/Stop mode 1
	01	(Setting prohibited)
	02	Forced stop mode
	03	Operation/Stop mode 2

Output		
Connection point	Function setting number 60	Function
CN47	00	Operation/Stop
	01—04	Cooling thermostat On
	05	Heating thermostat On
	06	Operation/Stop
	07—08	Cooling thermostat On
	09	Error status
	10	Indoor unit fan operation status
	11	External heater output



• External Input and Output PCB

Switch setting		Ex IN		Ex OUT		
Rotary switch	SW2	1	2	1	2	3
1	Edge	Operation/Stop	Not available	Operation/Stop	Error status	Indoor unit fan operation status
	Pulse	Operation	Stop			
2	Edge*1	Forced thermostat off	Not available	Error status	Indoor unit fan operation status	External heater output
3		Mechanical cooling off	Not available	Error status	Indoor unit fan operation status	External heater output
4		Forced thermostat off	Not available	Error status	Operation/Stop	External heater output
5		Mechanical cooling on*2	Not available	Cooling high/low output	Operation/Stop	External heater output
6		Mechanical cooling on*2	Not available	Error status	Operation/Stop	Cooling high/low output
7		Forced thermostat off	Not available	Error status	Indoor unit fan operation status	External heater output
8		Forced thermostat off	Not available	Error status	Indoor unit fan operation status	Heating thermostat on
9		Mechanical cooling off	Not available	Error status	Heating thermostat on	External heater output
A		Forced thermostat off	Not available	Heating thermostat on	Operation/Stop	External heater output
B		Forced thermostat off	Not available	Operation/Stop	Indoor unit fan operation status	External heater output
C		Forced thermostat off	Not available	Operation/Stop	Error status	External heater output
D		Forced thermostat off	Not available	Operation/Stop	Indoor unit fan operation status	Error status

**NOTES:**


- When the rotary switch is selected to "1", the operation of the terminal block input of the indoor unit and the External Input and Output PCB input are the same. The operation content depends on the setting of function setting number 46.
- \*1: The external input other than "Operation/Stop" is available only when the SW2 is set to "Edge".
- \*2: The external input of "Mechanical cooling on" is available only when the function setting number 60 is set to "03" or "04".

## 8-4. Details of control input function

### ■ Operation/Stop mode 1


- In the case of "Edge" input

Function setting	External Input and Output PCB		External input		Input signal	Command
	Rotary switch	SW2				
46-00	—		Input of indoor unit	Terminal	Off → On	Operation
	—		Input of indoor unit	Terminal	On → Off	Stop
	1	Edge	External Input and Output PCB	Ex IN 1	Off → On	Operation
					On → Off	Stop

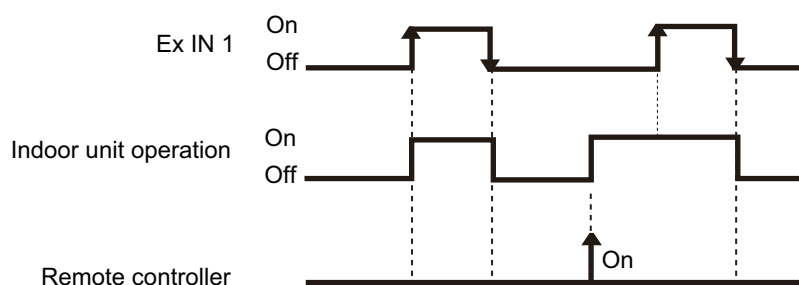

- In the case of "Pulse" input

Function setting	External Input and Output PCB		External input		Input signal	Command
	Rotary switch	SW2				
46-00	1	Pulse	External Input and Output PCB	Ex IN 1	Pulse	Operation
				Ex IN 2		Stop

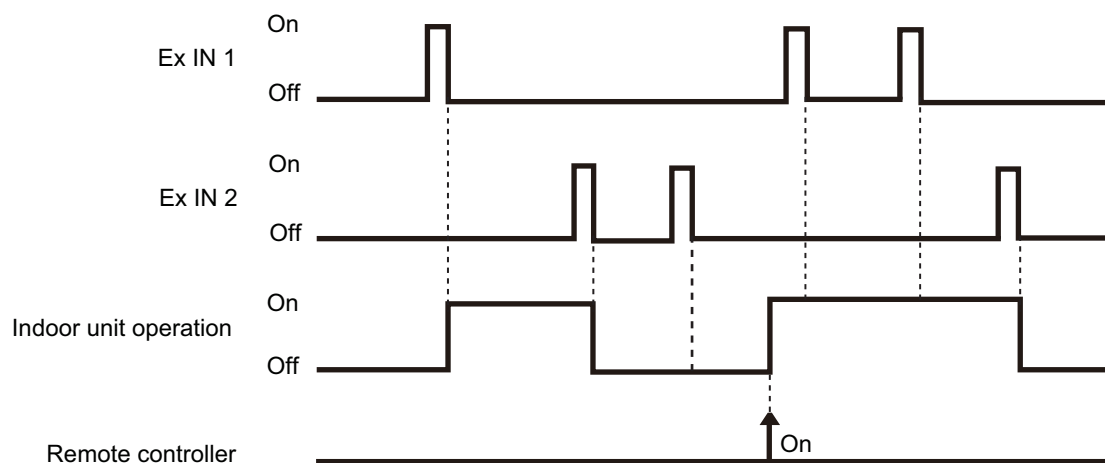


#### NOTES:

- The last command has priority.
- The indoor units within the same remote controller group operates in the same mode.

## ■ Forced stop


- In the case of "Edge" input

Function setting	External Input and Output PCB		External input		Input signal	Command
	Rotary switch	SW2				
46-02	—		Input of indoor unit	Terminal	Off → On	Forced stop (R.C. disabled)
					On → Off	Normal (R.C. enabled)
	1	Edge	External Input and Output PCB	Ex IN 1	Off → On	Forced stop (R.C. disabled)
					On → Off	Normal (R.C. enabled)

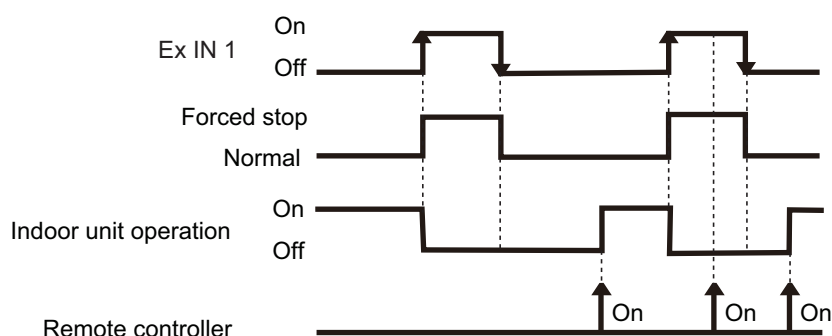

- In the case of "Pulse" input

Function setting	External Input and Output PCB		External input		Input signal	Command
	Rotary switch	SW2				
46-02	1	Pulse	External Input and Output PCB	Ex IN 1	Pulse	Forced stop (R.C. disabled)
				Ex IN 2		Normal (R.C. enabled)

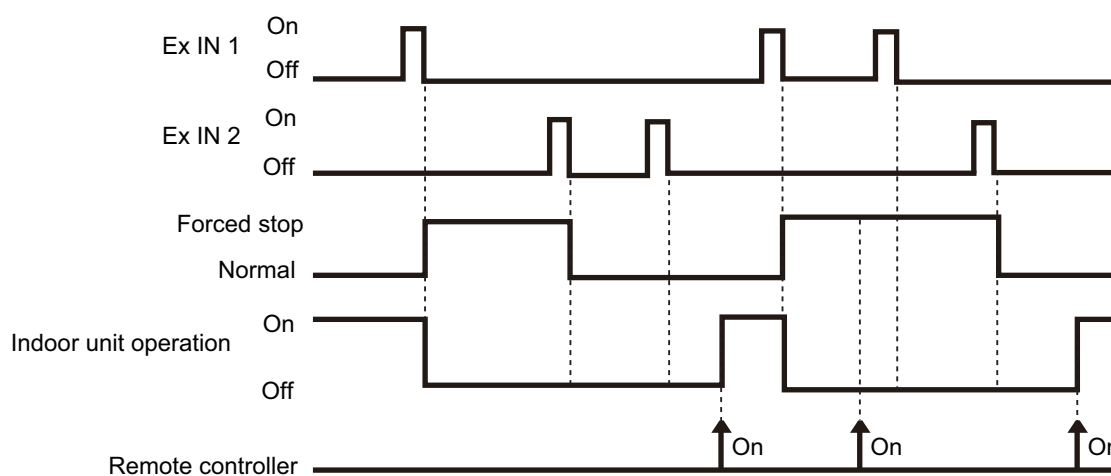


### NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

## ■ Operation/Stop mode 2


- In the case of "Edge" input

Function setting	External Input and Output PCB		External input		Input signal	Command
	Rotary switch	SW2				
46-03	—		Input of indoor unit	Terminal	Off → On	Operation (R.C. enabled)
					On → Off	Stop (R.C. disabled)
	1	Edge	External Input and Output PCB	Ex IN 1	Off → On	Operation (R.C. enabled)
					On → Off	Stop (R.C. disabled)

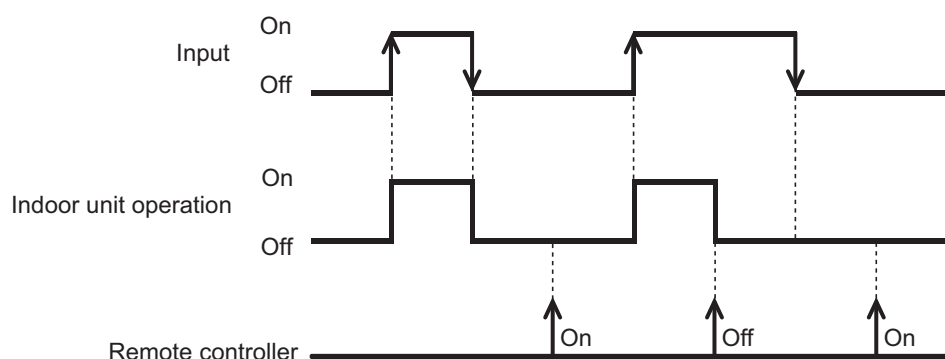

- In the case of "Pulse" input


Function setting	External Input and Output PCB		External input		Input signal	Command
	Rotary switch	SW2				
46-03	1	Pulse	External Input and Output PCB	Ex IN 1	Pulse	Operation (R.C. enabled)
				Ex IN 2		Stop (R.C. disabled)

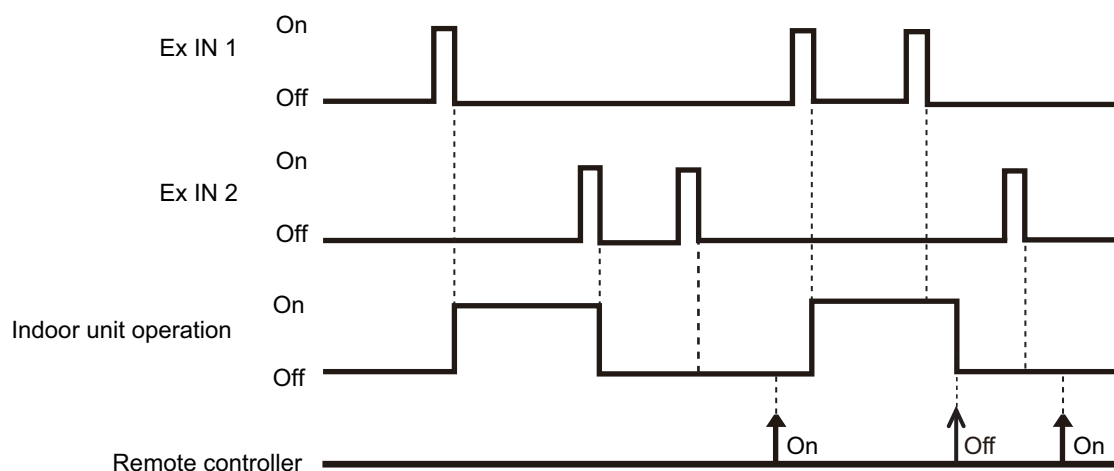

**NOTE:** When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

## ■ Forced thermostat off

External Input and Output PCB	External input		Input signal	Command
Rotary switch				
2, B, C, D	External Input and Output PCB	Ex IN 1	Off → On	Thermostat off
			On → Off	Normal operation
4, 7, 8, A	External Input and Output PCB	Ex IN 1	Off → On	Thermostat off
			On → Off	Normal operation

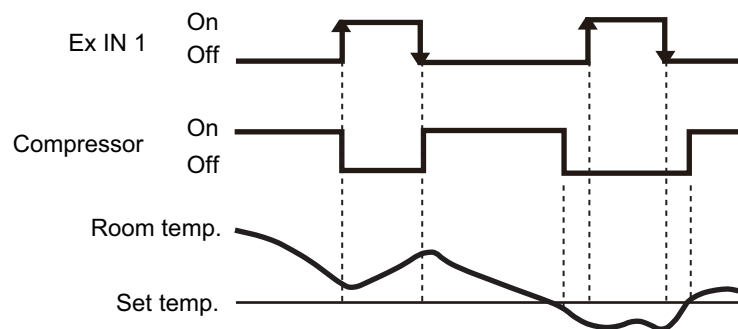


## 8-5. Details of control output function

### ■ Operation status

Function setting	External Input and Output PCB	External output		Output signal	Status
	Rotary switch				
60-00 60-06	—	Output of indoor unit	CN47	Off → On	Operation
				On → Off	Stop
—	1, B, C, D	External Input and Output PCB	Ex OUT 1	Off → On	Operation
				On → Off	Stop


The output is low when the unit is stopped.

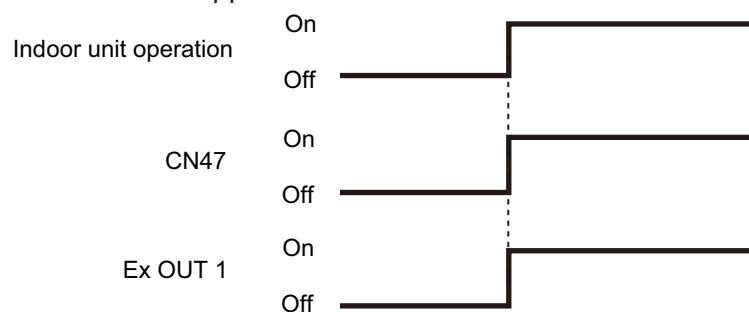

### ■ Error status

Function setting	External Input and Output PCB	External output		Output signal	Status
	Rotary switch				
60-09	—	Output of indoor unit	CN47	Off → On	Error
				On → Off	Normal
—	2, 3, 4, 6, 7, 8, 9	External Input and Output PCB	Ex OUT 1	Off → On	Error
				On → Off	Normal
—	1, C	External Input and Output PCB	Ex OUT 2	Off → On	Error
				On → Off	Normal
—	D	External Input and Output PCB	Ex OUT 3	Off → On	Error
				On → Off	Normal


The output is on when an error is generated for the indoor unit.

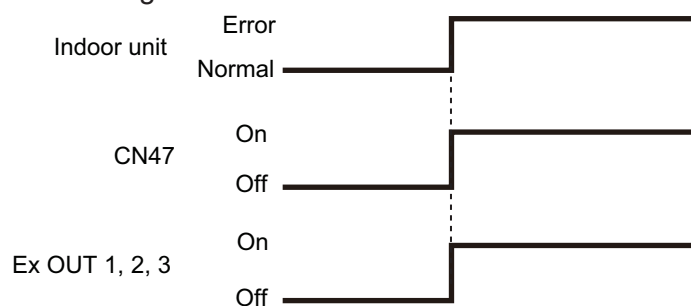

## Indoor unit fan operation status

Function setting	External Input and Output PCB	External output		Output signal	Status
	Rotary switch				
60-10	—	Output of indoor unit	CN47	Off → On	Fan run
				On → Off	Fan stop
—	2, 3, 7, 8, B, D	External Input and Output PCB	Ex OUT 2	Off → On	Fan run
				On → Off	Fan stop
—	1	External Input and Output PCB	Ex OUT 3	Off → On	Fan run
				On → Off	Fan stop

Output signal	Condition
On	The indoor unit fan is operating.
Off	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

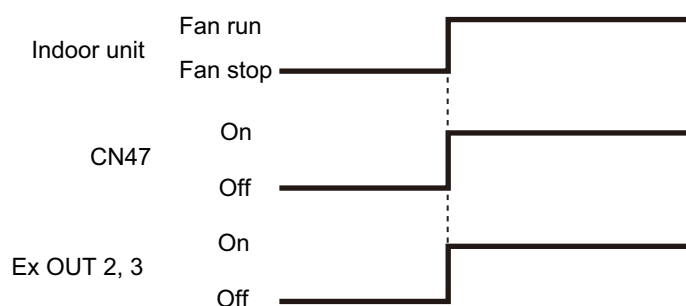

## ■ External heater output

Control	Primary heater	Auxiliary heater	Function setting
			Indoor unit
			Control switching external heaters No. 61
Auxiliary heater control 1	Heat pump	External device*	61-00
Auxiliary heater control 2	Heat pump	External device	61-01
Heat pump prohibition control	External device	None	61-02
Auxiliary heater control by outdoor temperature 1	Heat pump	External device	61-03
Auxiliary heater control by outdoor temperature 2	Heat Pump	External device	61-04


### NOTES:

- After turning off the heater, 3 minutes of standby time is required by next power-on of the heater.
- For items marked “—” in the table, any of validate or invalidate of the setting are acceptable.
- \*: External device means Hot water, Electrical heater, etc.




## ● Installation configuration of individual connection

External heating device is installed individually. (No use of indoor unit fan)

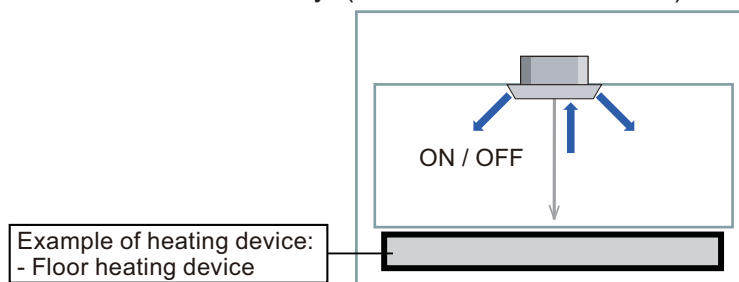


### ⚠ WARNING

Operation	Condition
Heater off	<ul style="list-style-type: none"> <li>• Heater is off as shown in following diagram of heating temperature.</li> <li>• Other than heating mode</li> <li>• Error occurred</li> <li>• Forced thermostat off</li> </ul>

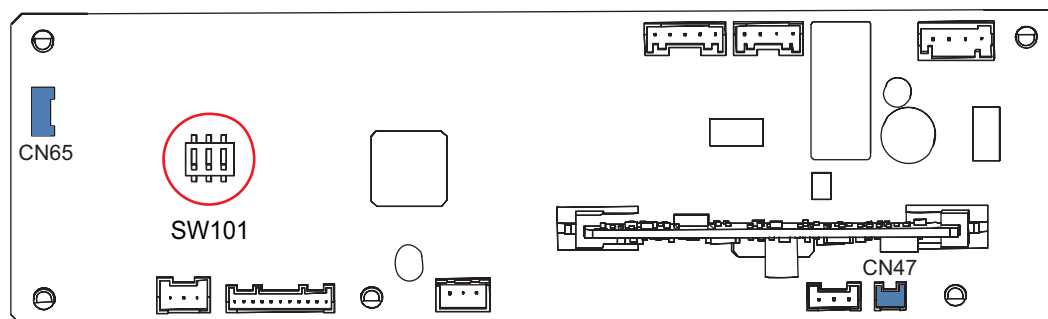


- Design and install external heater appropriately with considering its protection.

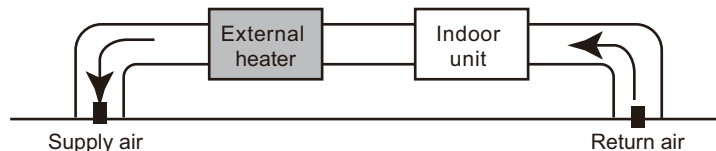

- Inappropriate designing and installation of external heater may cause a fire by emitted heat from the external heater.
- Fujitsu General Ltd. is not responsible for inappropriate designing or installation of external heating device.

## ● Auxiliary equipment control by room temperature

Auxiliary equipment control is switchable by room temperature. Auxiliary equipment switching is performed for each room temperature divided to following 3 zones.

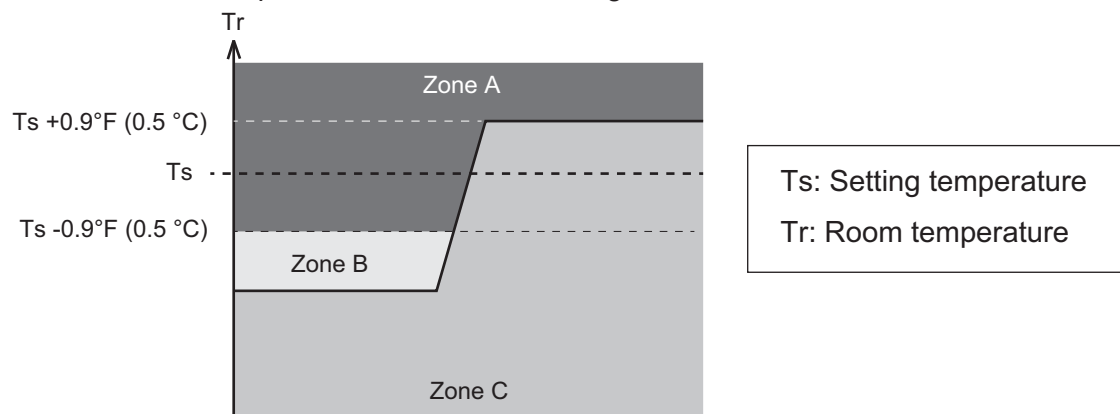

Zone	Application	When temperature dropping		When temperature rising	
		Primary	Auxiliary	Primary	Auxiliary
A	Both of primary and auxiliary equipment is unnecessary.	Off	Off	Off	Off
B	Primary heater only. When room temperature stays in zone B for a long time, auxiliary equipment also operates.	On	Off*1	—	—
C	Auxiliary equipment also operates.	On	On*2	On	On*2

\*1: For standby time for auxiliary equipment operation, refer to indoor unit function number 71 "[Contents of function setting](#)" on page 56.


\*2: When indoor unit function number 61 is set to "00", auxiliary equipment operates according to the following conditions.

- Ts - Tr > 21.6 °F (-12.0 °C): Auxiliary equipment turn off.
- Ts - Tr > 18.0 °F (-10.0 °C): Auxiliary equipment turn on.

## ● Auxiliary heater control 1

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> <li>Fan stop protection</li> </ul>

- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting "Thon".

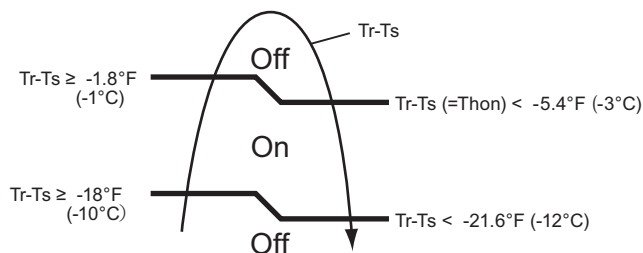

Tr: Room temperature  
Ts: Set temperature  
Thon: Heater on temperature


**Example:** When set temperature (Ts) is 72°F (22°C) (Factory setting),

- and room temperature (Tr) increases above 53.6°F (12°C), signal output is on.
- and room temperature (Tr) increases above 69.8°F (21°C), signal output is off.
- and room temperature (Tr) decreases below 66.2°F (19°C), signal output is on.
- and room temperature (Tr) decreases below 50°F (10°C), signal output is off.

## ● Auxiliary heater control 2

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> <li>Fan stop protection</li> </ul>

- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting "Thon".

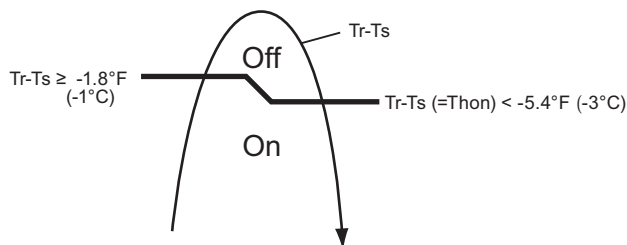


Tr: Room temperature  
Ts: Set temperature  
Thon: Heater on temperature

## ● Heat pump prohibition control


Perform heating by external heater only. Indoor unit is continuous thermostat off.

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>

- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting "Thon".

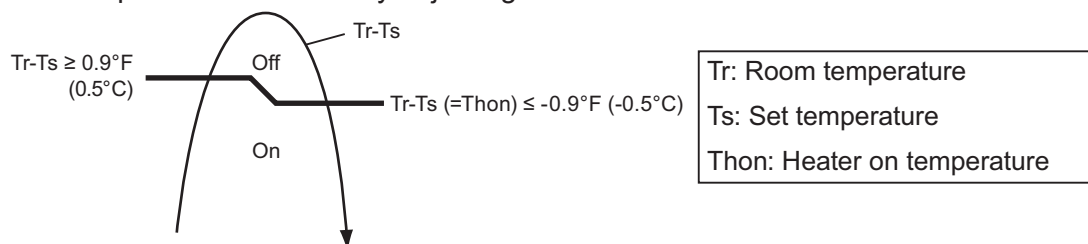

### • Operation status

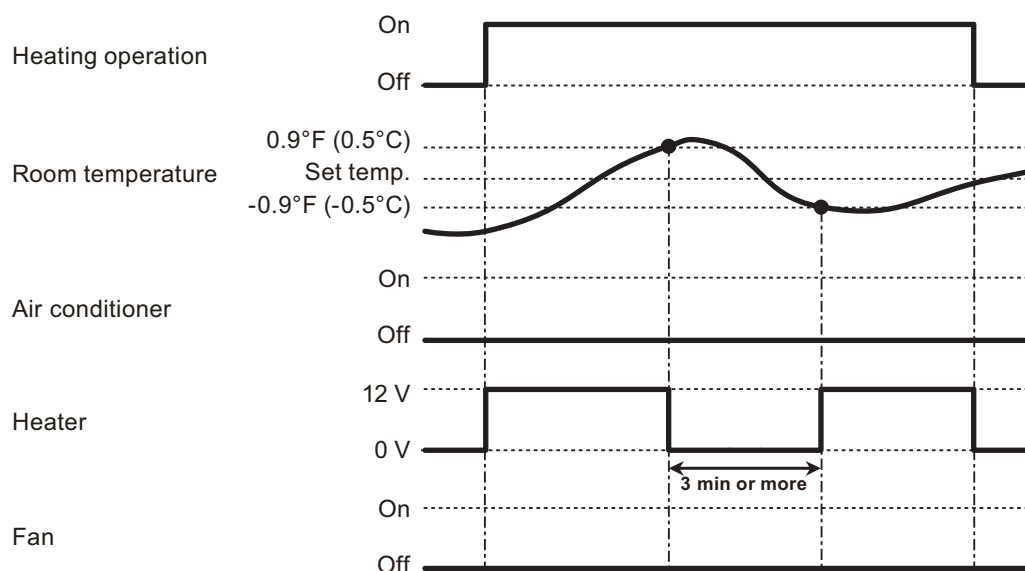

**NOTE:** In following operations, compressor will be on.

- Other than heating
- Test run


## ● Auxiliary heater control by outdoor temperature 1

This control selects heat pump or external heater according to the outdoor temperature. When outdoor temperature is high, the heating is performed by using heat pump only.

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> <li>Heat pump only zone</li> </ul>


- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting "Thon".
- Outdoor temperature zone boundary A and B: Adjustable individually by function setting number 66 and 67.

### • External heater output

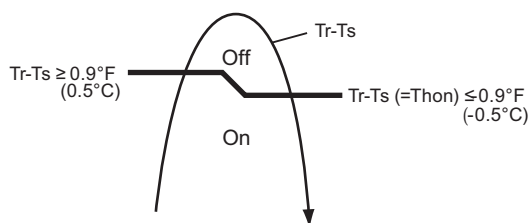


Tr: Room temperature  
Ts: Set temperature  
Thon: Heater on temperature

### • Outdoor temperature zone

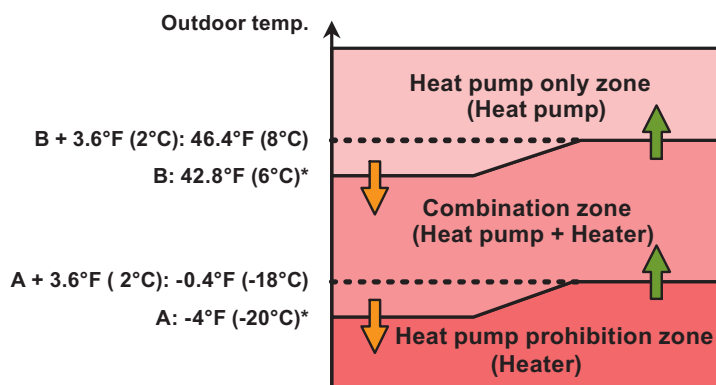

\*: Adjustable by function setting 66 and 67

- **Operation status**

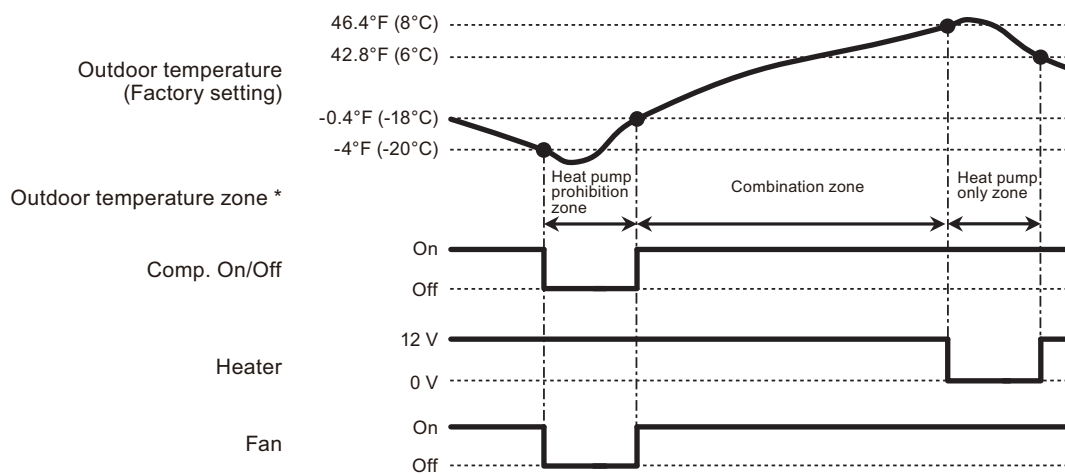

\* The outdoor temperature zone transition from one to another will stay in that zone for minimum of 30 min.

**NOTE:** In following operations, compressor will be on in heat pump prohibition zone.

- Other than heating
- Test run


## ● Auxiliary heater control by outdoor temperature 2

This control selects heat pump or external heater according to the outdoor temperature. Even when outdoor temperature is high, the heating is performed by using both of heat pump and external heater.

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>


- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting "Thon".
- Outdoor temperature zone boundary A: Adjustable by function setting number 66.

### • External heater output

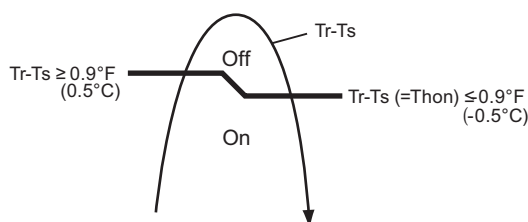


Tr: Room temperature  
Ts: Set temperature  
Thon: Heater on temperature

### • Outdoor temperature zone

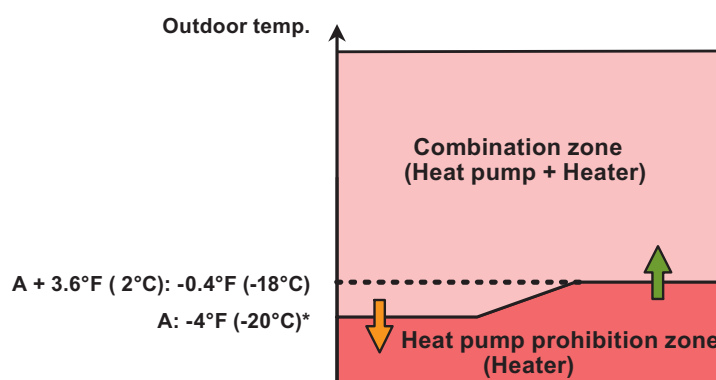

\*: Adjustable by function setting 66

- Operation status

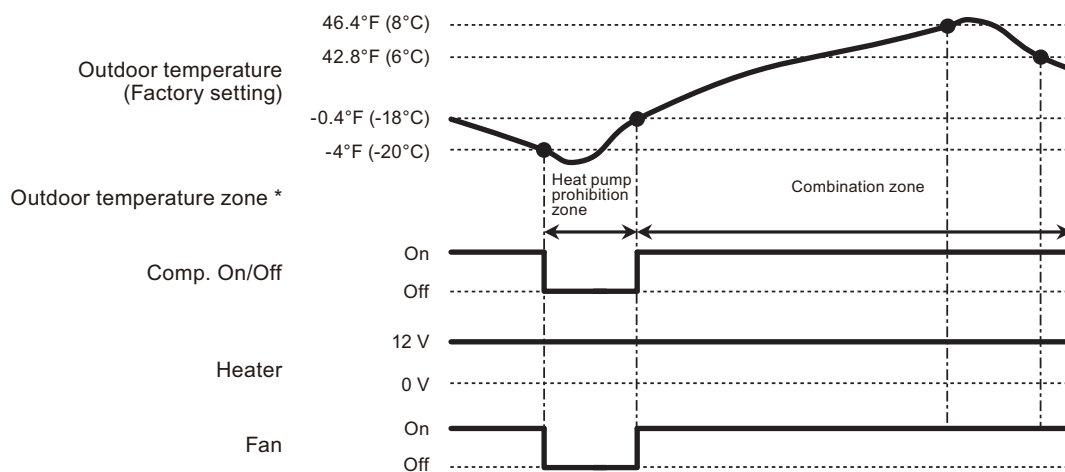

\* The outdoor temperature zone transition from one to another will stay in that zone for minimum of 30 min.

**NOTE:** In following operations, compressor will be on in heat pump prohibition zone.

- Other than heating
- Test run




## ● Auxiliary heater control by outdoor temperature 3

This control selects heat pump or external heater according to the outdoor temperature. Even when outdoor temperature is high, the heating is performed by using both of heat pump and external heater.

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>


- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of external heaters).
- All control temperatures will shift by adjusting "Thon".
- Outdoor temperature zone boundary B: Adjustable by function setting number 67.

### • External heater output

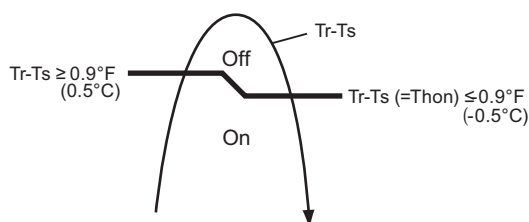


Tr: Room temperature  
Ts: Set temperature  
Thon: Heater on temperature

### • Outdoor temperature zone

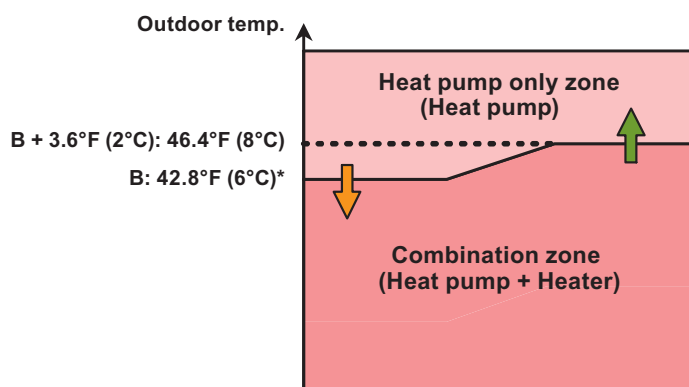

\*: Adjustable by function setting 67

- Operation status

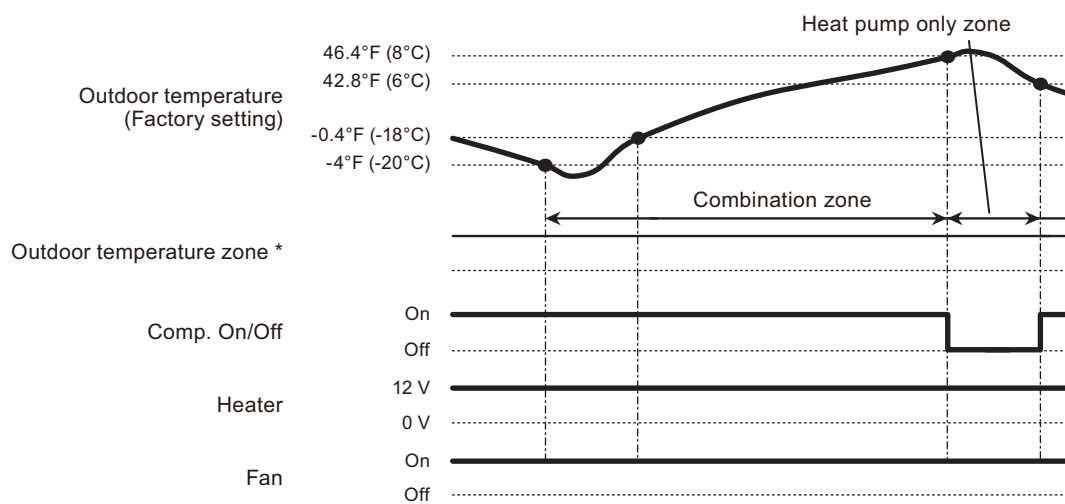

\* The outdoor temperature zone transition from one to another will stay in that zone for minimum of 30 min.

**NOTE:** In following operations, compressor will be on in heat pump prohibition zone.


- Other than heating
- Test run

## ● Auxiliary heat pump control

### • External heater output


Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>

- Temperature of heater on (Thon): Set temperature (Ts) - 0.9 °F (- 0.5 °C)
- Temperature of heater off: Set temperature (Ts) + 0.9 °F (+ 0.5 °C)

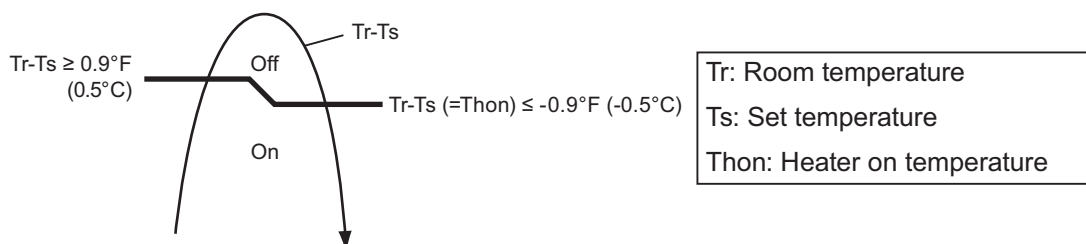

### • Auxiliary heat pump On/Off

- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of heat pump).
- All control temperatures will shift by adjusting "Thon".

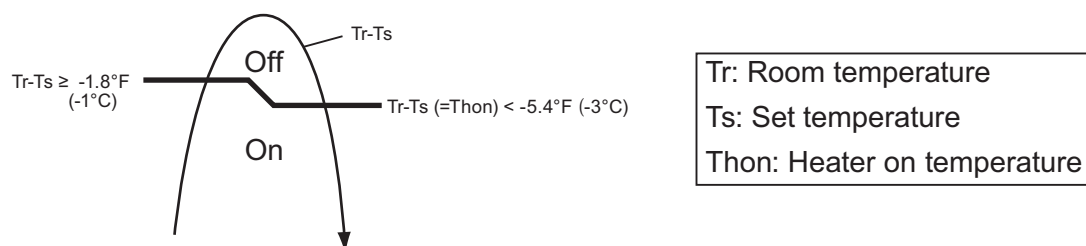


## ● Auxiliary heat pump control by outdoor temperature 1

### • External heater output

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>

– Temperature of heater on (Thon): Set temperature (Ts) - 0.9 °F (- 0.5 °C)


– Temperature of heater off: Set temperature (Ts) + 0.9 °F (+ 0.5 °C)

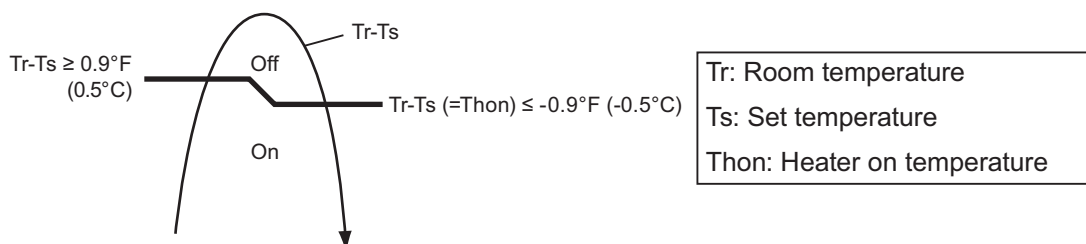


### • Auxiliary heat pump On/Off

– Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of heat pump).

– All control temperatures will shift by adjusting “Thon”.

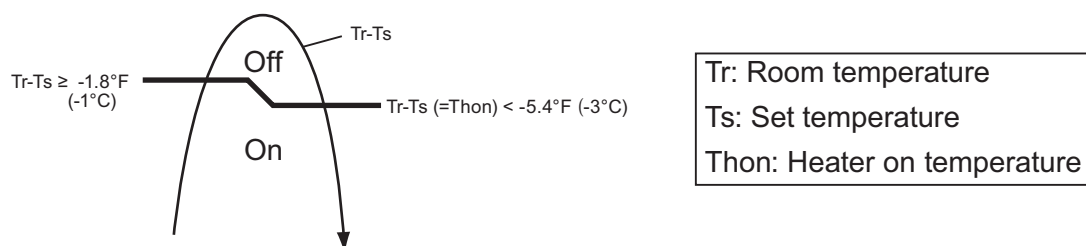


### • Outdoor temperature zone

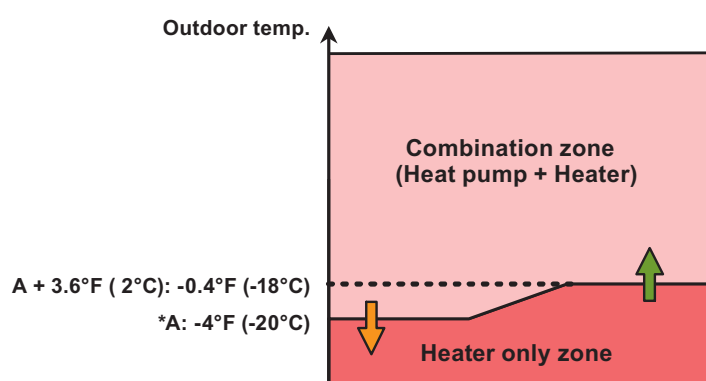

\*: Adjustable by function setting 67

- Operation status

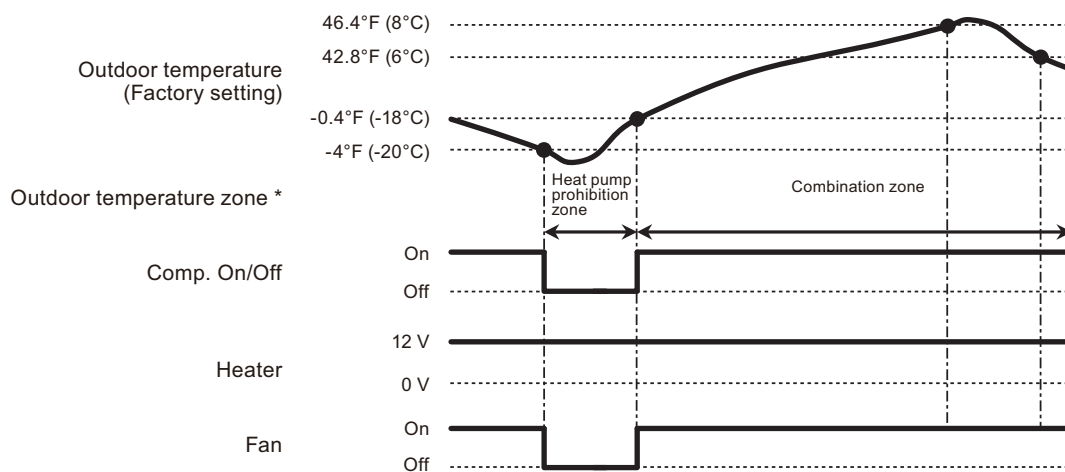

\* The outdoor temperature zone transition from one to another will stay in that zone for minimum of 30 min.

**NOTE:** In following operations, compressor will be on in heat pump prohibition zone.


- Other than heating
- Test run

## ● Auxiliary heat pump control by outdoor temperature 2

### • External heater output


Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>

- Temperature of heater on (Thon): Set temperature (Ts) - 0.9 °F (- 0.5 °C)
- Temperature of heater off: Set temperature (Ts) + 0.9 °F (+ 0.5 °C)

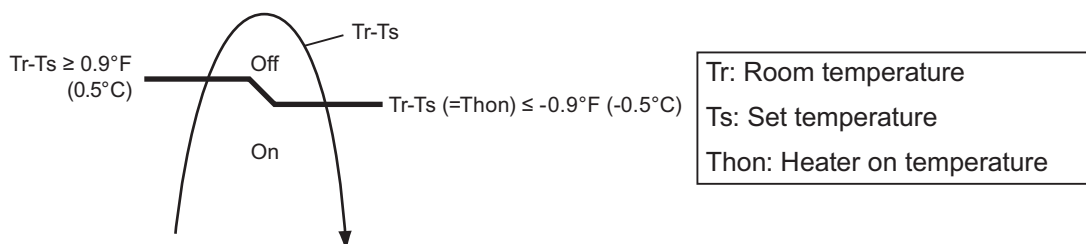


### • Auxiliary heat pump On/Off

- Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of heat pump).
- All control temperatures will shift by adjusting "Thon".

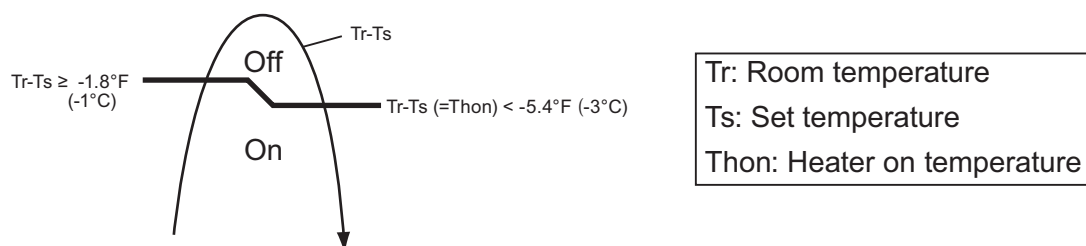


### • Outdoor temperature zone

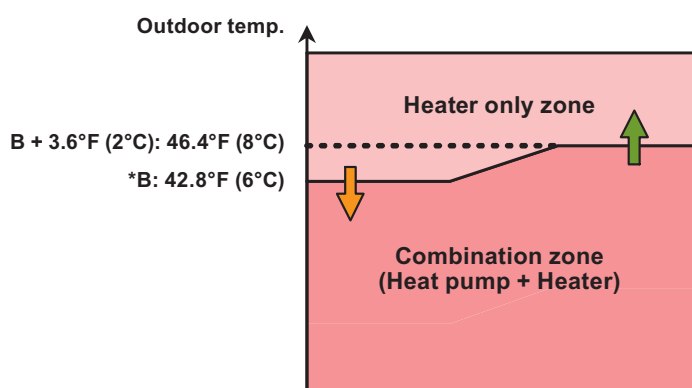

\*: Adjustable by function setting 67

- Operation status

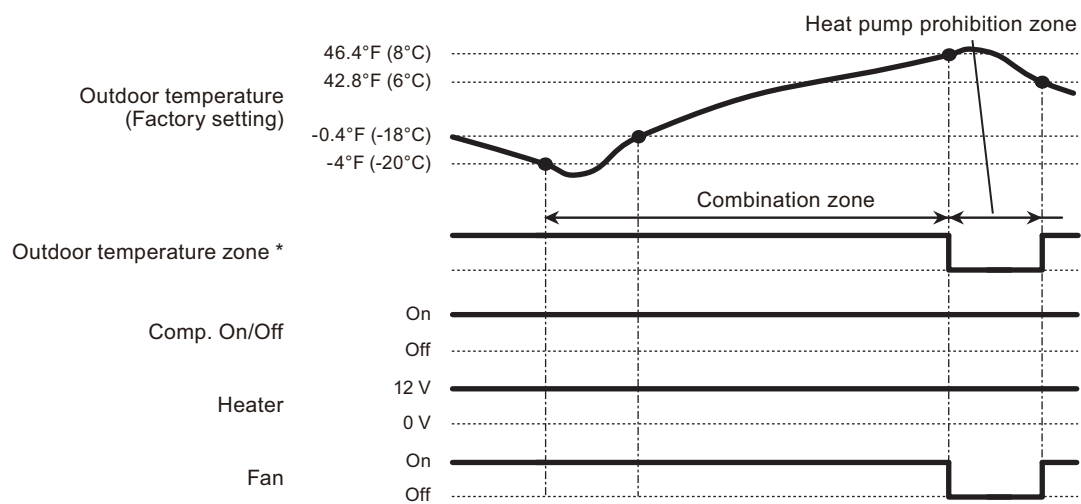

\* The outdoor temperature zone transition from one to another will stay in that zone for minimum of 30 min.

**NOTE:** In following operations, compressor will be on in heat pump prohibition zone.

- Other than heating
- Test run


## ● Auxiliary heat pump control by outdoor temperature 3

### • External heater output

Operation	Condition
Heater on	Heater is on as shown in following diagram of heating temperature.
Heater off	<ul style="list-style-type: none"> <li>Heater is off as shown in following diagram of heating temperature.</li> <li>Other than heating mode</li> <li>Error occurred</li> <li>Forced thermostat off</li> </ul>

– Temperature of heater on (Thon): Set temperature (Ts) - 0.9 °F (- 0.5 °C)


– Temperature of heater off: Set temperature (Ts) + 0.9 °F (+ 0.5 °C)

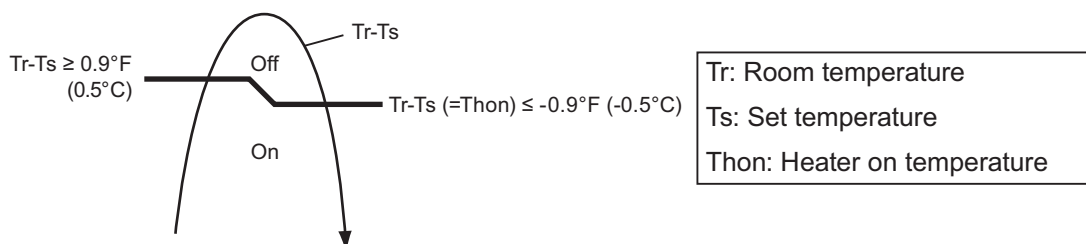

### • Auxiliary heat pump On/Off


– Temperature of heater on (Thon): Adjustable by function number 62 (Operating temperature switching of heat pump).

– All control temperatures will shift by adjusting “Thon”.

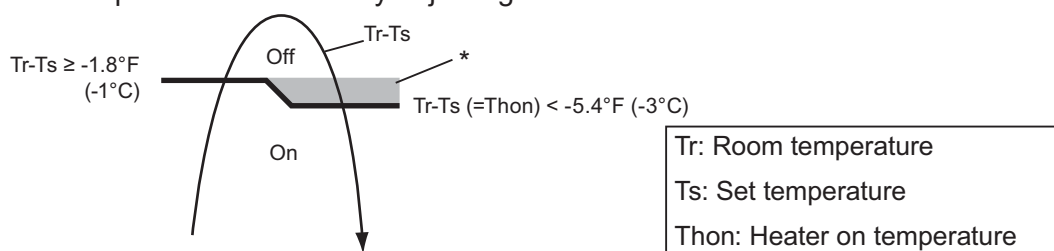

\*: When room temperature stays in this zone for a specific time, auxiliary heater is turned on. For details, refer to function number 71.


### • Outdoor temperature zone

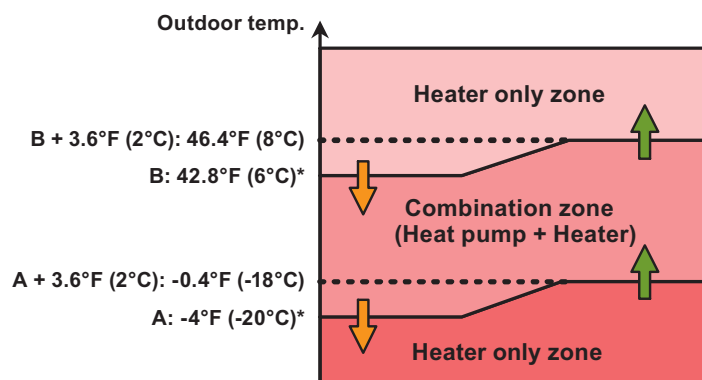

\*: Adjustable by function setting 66 and 67



- Operation status

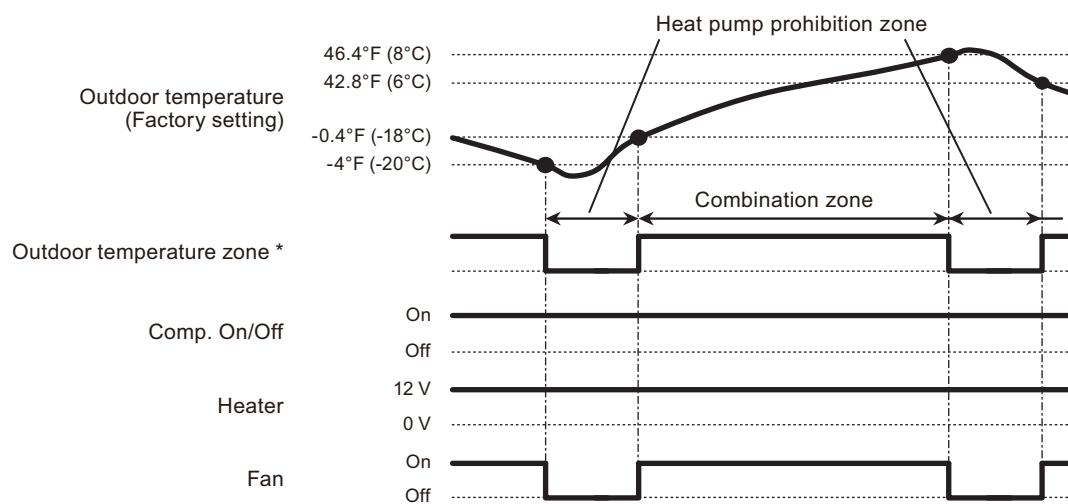

\* The outdoor temperature zone transition from one to another will stay in that zone for minimum of 30 min.


**NOTE:** In following operations, compressor will be on in heat pump prohibition zone.

- Other than heating
- Test run

## ■ Heating thermostat on for humidifier

Situation	Indoor unit				
	Mode	Function setting	Rotary SW	External output	
		Heating thermostat on no. 60		Heating thermostat on	Indoor unit fan operation status
Example of individual connection	5	60-05	7	CN47	Not used
	6	60-06	8	Output3	
	7	60-07	9	Output2	
	8	60-08	A	Output1	


### • Example of individual connection

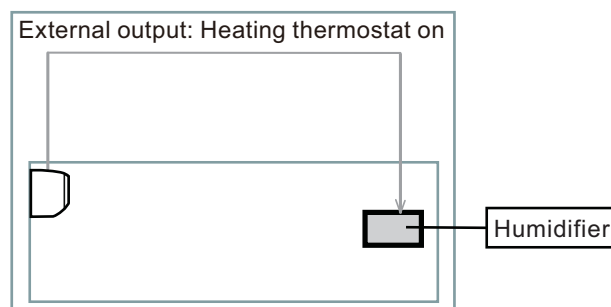

### • Operation status

The heating thermostat output for CN47, Output1, Output2, and Output3 will be on when comp on or external heater on.

The heating thermostat output will be off when comp off and external heater off.

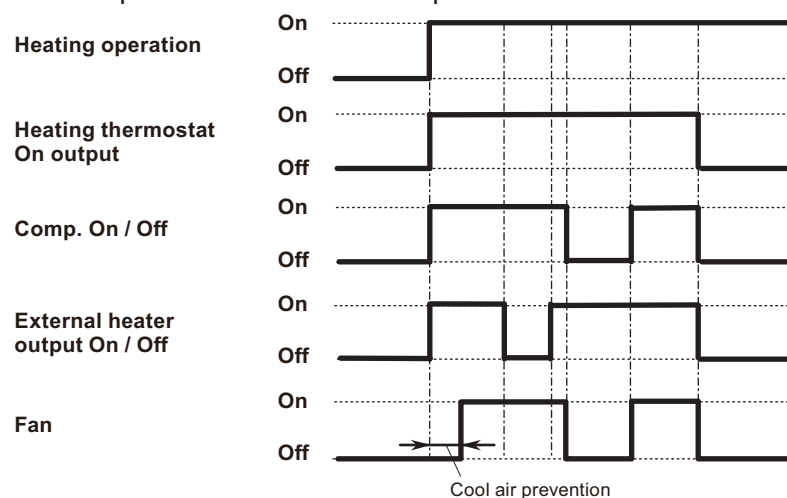

## 9. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.


**NOTE:** Incorrect settings can cause a product malfunction.

### 9-1. Function settings on indoor unit

By using some components on the PCB, you can change the function settings.

#### ■ Component location

Components on the indoor unit main PCB used for the function settings are located as shown in the following figure.

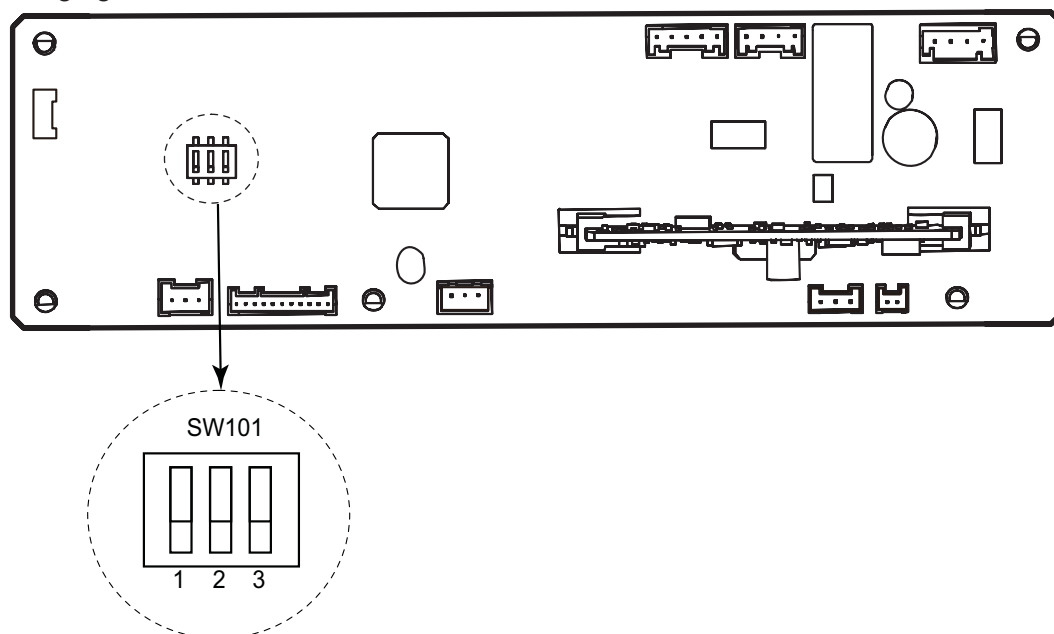

#### ■ DIP switch setting

- SW101: Setting change prohibited

## 9-2. Function settings by using remote controller

Some function settings can be changed on the remote controller. After confirming the setting procedure and the content of each function setting, select appropriate functions for your installation environment.

### ■ Setting procedure by using remote controller

Remote controller is not attached for this product. For details of the installing remote controller, refer to following information.

- Overview information: Operating manual of the remote controller
- Setting procedure: Installation manual of the remote controller

### ■ Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

**NOTE:** Setting will not be changed if invalid numbers or setting values are selected.

### ● Function setting list

	Function no.	Functions
1)	11	Filter sign
2)	20	Ceiling height
3)	22	Outlet directions
4)	30/31	Room temperature control for indoor unit sensor
5)	35/36	Room temperature control for wired remote controller sensor
6)	40	Auto restart
7)	42	Room temperature sensor switching
8)	44	Remote controller custom code
9)	46	External input control
10)	48	Room temperature sensor switching (Aux.)
11)	49	Indoor unit fan control for energy saving for cooling
12)	60	Switching functions for external output terminal
13)	61	Control switching of external heaters
14)	62	Operating temperature switching of external heaters
15)	66	Outdoor temperature zone boundary temperature A
16)	67	Outdoor temperature zone boundary temperature B
17)	71	Standby time for auxiliary equipment operation
18)	72	Heat pump backup setting
19)	73	Emergency heat for external output terminal
20)	75	External heater use in defrosting

#### 1) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
11	00	Standard (2,500 hours)	
	01	Long interval (4,400 hours)	
	02	Short interval (1,250 hours)	
	03	No indication	◆

**2) Ceiling height (For Compact cassette type only)**

Select the appropriate ceiling height according to the place of installation.

Function number	Setting value	Setting description	Factory setting
20	00	Standard	◆
	01	High ceiling	

For the specific height for each setting value, refer to “Installation space” in Chapter 2. ["Dimensions"](#) on page 4.

**In case of cassette type models:**

The ceiling height values are for the 4-way outlet. Do not change this setting in the 3-way outlet mode.

9,000 Btu/h model cannot be installed in high ceiling. Do not change this setting.

**3) Outlet directions (For Compact cassette type only)**

Select the appropriate number of outlet directions according to the installation conditions.

Function number	Setting value	Setting description	Factory setting
22	00	4-way	◆
	01	3-way	

#### 4) Room temperature control for indoor unit sensor

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

The temperature of the room temperature sensor is corrected as follows:

Corrected temp. = Temp. of the room temp. sensor - Correction temp. value

Example of correction:

When the temperature of the room temp. sensor is 78°F and the setting value is "03" (-2°F), the corrected temp. will be 80°F (78°F - [-2°F]).

The temperature correction values show the difference from the Standard setting "00" (manufacturer's recommended value).

Function number		Setting value	Setting description	Factory setting
30 (For cooling)	31 (For heating)	00	Standard setting	◆
		01	No correction 0.0 °F (0.0 °C)	
		02	-1 °F (-0.5 °C)	More cooling Less heating
		03	-2 °F (-1.0 °C)	
		04	-3 °F (-1.5 °C)	
		05	-4 °F (-2.0 °C)	
		06	-5 °F (-2.5 °C)	
		07	-6 °F (-3.0 °C)	
		08	-7 °F (-3.5 °C)	
		09	-8 °F (-4.0 °C)	
		10	+1 °F (+0.5 °C)	Less cooling More heating
		11	+2 °F (+1.0 °C)	
		12	+3 °F (+1.5 °C)	
		13	+4 °F (+2.0 °C)	
		14	+5 °F (+2.5 °C)	
		15	+6 °F (+3.0 °C)	
		16	+7 °F (+3.5 °C)	
		17	+8 °F (+4.0 °C)	

### 5) Room temperature control for wired remote controller sensor

Depending on the installed environment, correction of the wire remote temperature sensor may be required. Select the appropriate control setting according to the installed environment.

To change this setting, set Function 42 to "Both" (01).

Ensure that the Thermo Sensor icon is displayed on the remote controller screen.

Function number		Setting value	Setting description	Factory setting
35 (For cooling)	36 (For heating)	00	Standard setting	◆
		01	No correction 0.0 °F (0.0 °C)	
		02	-1 °F (-0.5 °C)	More cooling Less heating
		03	-2 °F (-1.0 °C)	
		04	-3 °F (-1.5 °C)	
		05	-4 °F (-2.0 °C)	
		06	-5 °F (-2.5 °C)	
		07	-6 °F (-3.0 °C)	
		08	-7 °F (-3.5 °C)	
		09	-8 °F (-4.0 °C)	
		10	+1 °F (+0.5 °C)	Less cooling More heating
		11	+2 °F (+1.0 °C)	
		12	+3 °F (+1.5 °C)	
		13	+4 °F (+2.0 °C)	
		14	+5 °F (+2.5 °C)	
		15	+6 °F (+3.0 °C)	
		16	+7 °F (+3.5 °C)	
		17	+8 °F (+4.0 °C)	

### 6) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	◆
	01	Disable	

**NOTE:** Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

### 7) Room temperature sensor switching

When using the wired remote controller temperature sensor, change the setting to "Both" (01).

Function number	Setting value	Setting description	Factory setting
42	00	Indoor unit	◆
	01	Both	

00: Sensor on the indoor unit is active.

01: Sensors on both indoor unit and wired remote controller are active.

**NOTE:** Remote controller sensor must be turned on by using the remote controller.

**8) Remote controller custom code**

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
44	00	A	◆
	01	B	
	02	C	
	03	D	

**9) External input control**

"Operation/Stop" mode or "Forced stop" mode can be selected.

Function number	Setting value	Setting description	Factory setting
46	00	Operation/Stop mode 1 (Remote controller enabled)	◆
	01	(Setting prohibited)	
	02	Forced stop mode	
	03	Operation/Stop mode 2 (Remote controller disabled)	

**10) Room temperature sensor switching (Aux.)**

To use the temperature sensor on the wired remote controller only, change the setting to "Wired remote controller" (01).

This function will only work if the function setting 42 is set at "Both" (01).

When the setting value is set to "Both" (00), more suitable control of the room temperature is possible by setting function setting 30 and 31 too.

Function number	Setting value	Setting description	Factory setting
48	00	Both	◆
	01	Wired remote controller	

**11) Indoor unit fan control for energy saving for cooling**

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
49	00	Disable	
	01	Enable	
	02	Remote controller	◆

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.

01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

02: Enable or disable this function by remote controller setting.

**NOTE:** Set to "00" or "01" when connecting a remote controller that cannot set the Fan control for energy saving function or connecting a network converter. To confirm if the remote controller has this setting, refer to the operating manual of each remote controller.



## 12) Switching functions for external output terminal

Functions of the external output terminal can be switched. For details, refer to “External input and output”.

Function number	Setting value	Setting description	Factory setting
60	00	Operation status	◆
	01—04	Cooling thermostat On	
	05	Heating operation	
	06	Operation/Stop	
	07—08	Cooling thermostat On	
	09	Error status	
	10	Indoor unit fan operation status	
	11	External heater	

## 13) Control switching of external heaters

Sets the control method for external heater to be used.

For details, refer to “External heater output” in ["Details of control output function"](#) on page 34.

Function number	Setting value	Setting description	Factory setting
61	00	Auxiliary heater control 1	◆
	01	Auxiliary heater control 2	
	02	Heat pump prohibition control	
	03	Auxiliary heater control by outdoor temperature 1	
	04	Auxiliary heater control by outdoor temperature 2	
	05	Auxiliary heater control by outdoor temperature 3	
	06	Auxiliary heat pump control	
	07	Auxiliary heat pump control by outdoor temperature 1	
	08	Auxiliary heat pump control by outdoor temperature 2	
	09	Auxiliary heat pump control by outdoor temperature 3	

#### 14) Operating temperature switching of external heaters

Sets the temperature conditions when the external heater is ON.

For details, refer to "External heater output" in ["Details of control output function"](#) on page 34.

Function number	Setting value	Setting description				Factory setting
		Setting value of function 61:				
		00		01 to 09		
		Heater: On	Heater: Off	Heater: On	Heater: Off	
62	00	-5.4 °F (-3 °C)	-1.8 °F (-1 °C)	-0.9 °F (-0.5 °C)	0.9 °F (0.5 °C)	◆
	01	-3.6 °F (-2 °C)	-1.8 °F (-1 °C)	-1.8 °F (-1 °C)	0.9 °F (0.5 °C)	
	02	-3.6 °F (-2 °C)	-1.8 °F (-1 °C)	-3.6 °F (-2 °C)	0.9 °F (0.5 °C)	
	03	-5.4 °F (-3 °C)	-1.8 °F (-1 °C)	-5.4 °F (-3 °C)	0.9 °F (0.5 °C)	
	04	-7.2 °F (-4 °C)	-1.8 °F (-1 °C)	-7.2 °F (-4 °C)	0.9 °F (0.5 °C)	
	05	-9.0 °F (-5 °C)	-1.8 °F (-1 °C)	-9.0 °F (-5 °C)	0.9 °F (0.5 °C)	
	06	-5.4 °F (-3 °C)	-0.9 °F (-0.5 °C)	-0.9 °F (-0.5 °C)	0 °F (0 °C)	
	07	-3.6 °F (-2 °C)	-0.9 °F (-0.5 °C)	-1.8 °F (-1 °C)	0 °F (0 °C)	
	08	-3.6 °F (-2 °C)	-0.9 °F (-0.5 °C)	-3.6 °F (-2 °C)	0 °F (0 °C)	
	09	-5.4 °F (-3 °C)	-0.9 °F (-0.5 °C)	-5.4 °F (-3 °C)	0 °F (0 °C)	
	10	-7.2 °F (-4 °C)	-0.9 °F (-0.5 °C)	-7.2 °F (-4 °C)	0 °F (0 °C)	
	11	-9.0 °F (-5 °C)	-0.9 °F (-0.5 °C)	-9.0 °F (-5 °C)	0 °F (0 °C)	
	12	-5.4 °F (-3 °C)	0 °F (0 °C)	-0.9 °F (-0.5 °C)	-0.9 °F (-0.5 °C)	
	13	-3.6 °F (-2 °C)	0 °F (0 °C)	-1.8 °F (-1 °C)	-0.9 °F (-0.5 °C)	
	14	-3.6 °F (-2 °C)	0 °F (0 °C)	-3.6 °F (-2 °C)	-0.9 °F (-0.5 °C)	
	15	-5.4 °F (-3 °C)	0 °F (0 °C)	-5.4 °F (-3 °C)	-0.9 °F (-0.5 °C)	
	16	-7.2 °F (-4 °C)	0 °F (0 °C)	-7.2 °F (-4 °C)	-0.9 °F (-0.5 °C)	
	17	-9.0 °F (-5 °C)	0 °F (0 °C)	-9.0 °F (-5 °C)	-0.9 °F (-0.5 °C)	

#### 15) Outdoor temperature zone boundary temperature A

Setting required if changing of the outdoor temperature setting for heat pump prohibition zone is required when auxiliary heater control by outdoor temperature 1 and 2 are performed on the indoor unit.

For details, refer to "External heater output" in ["Details of control output function"](#) on page 34.

Function number	Setting value	Setting description	Factory setting
66	00	-4.0 °F (-20 °C)	◆
	01	-0.4 °F (-18 °C)	
	02	3.2 °F (-16 °C)	
	03	6.8 °F (-14 °C)	
	04	10.4 °F (-12 °C)	
	05	14.0 °F (-10 °C)	
	06	17.6 °F (-8 °C)	
	07	21.2 °F (-6 °C)	
	08	24.8 °F (-4 °C)	

**16) Outdoor temperature zone boundary temperature B**

Setting required if changing of the outdoor temperature setting for heat pump only zone is required when auxiliary heater control by outdoor temperature 1 and 3 is performed on the indoor unit.

For details, refer to "External heater output" in ["Details of control output function"](#) on page 34.

Function number	Setting value	Setting description	Factory setting
67	00	42.8 °F (6 °C)	◆
	01	14.0 °F (-10 °C)	
	02	17.6 °F (-8 °C)	
	03	21.2 °F (-6 °C)	
	04	24.8 °F (-4 °C)	
	05	28.4 °F (-2 °C)	
	06	32.0 °F (0 °C)	
	07	35.6 °F (2 °C)	
	08	39.2 °F (4 °C)	
	09	42.8 °F (6 °C)	
	10	46.4 °F (8 °C)	
	11	50.0 °F (10 °C)	
	12	53.6 °F (12 °C)	
	13	57.2 °F (14 °C)	
	14	60.8 °F (16 °C)	
	15	64.4 °F (18 °C)	

**17) Standby time for auxiliary equipment operation**

Sets the standby time until the auxiliary equipment operation starts during primary equipment operation.

For details, refer to ["Details of control output function"](#) on page 34.

Function number	Setting value	Setting description	Factory setting
71	00	Disable	◆
	01	1 minute	
	02	2 minutes	
	•	•	
	•	•	
	•	•	
	98	98 minutes	
	99	99 minutes	

**18) Heat pump backup setting**

Enables or disables the heat pump backup instruction from the outdoor unit.

This function will be usable provided that the corresponding outdoor unit is connected.

Function number	Setting value	Setting description	Factory setting
72	00	Disable	◆
	01	Enable	

**19) Emergency heat for external output terminal**

Enables or disables emergency heat input.

Function number	Setting value	Setting description	Factory setting
73	00	Disable	◆
	01	Enable	

**NOTE:** When this function is used, IR Receiver Unit is necessary.

**20) External heater use in defrosting**












Enables or disables external heater use in defrosting.

**NOTE:** Inappropriate heater selection may cause cold air in defrosting.

Function number	Setting value	Setting description	Factory setting
75	00	Disable	◆
	01	Enable	





## 10. Accessories

### 10-1. Models: ACUH09LUAS1, ACUH12LUAS1, and ACUH18LUAS1

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Operating manual		1	Drain hose insulation		1
Installation manual		1	Hose band		1
Template (Carton top)		1	Coupler heat insulation (large)		1
Special nut A (large flange)		4	Coupler heat insulation (small)		1
Special nut B (small flange)		4	Cable tie (for electrical wiring)		2
Drain hose (Ø3/4 in [I.D.], Ø1-1/16 in [O.D.])		1			


## 11. Optional parts

### 11-1. Controllers










Exterior	Part name	Model name	Summary
	Wired Remote Controller	UTY-RNRUZ*	Easy finger touch operation with LCD panel. Backlit LCD enables easy operation in a dark room. Wire type: Non-polar 2-wire
	Simple Remote Controller	UTY-RSRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Non-polar 2-wire (For Slim duct type only)
	Simple Remote Controller	UTY-RHRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, and temperature setting. Wire type: Non-polar 2-wire
	Wireless Remote Controller	UTY-LNTU	Unit control is performed by Wireless Remote Controller.





**NOTE:** Available functions may differ by the remote controller. For details, refer to the operation manual.

### 11-2. Cassette grille

Exterior	Part name	Model name	Summary
	Cassette Grille	UTG-CCGFGA	This cassette grille can be installed appropriately on the grid type ceiling common in the office.

## 11-3. Others

Exterior	Part name	Model name	Summary
	External Connect Kit	UTY-XWZXZG	Use to connect with various peripheral devices and air conditioner PCB. For control output port. Connecting point: CN47 on Main PCB
	Air Outlet Shutter Plate	UTR-YDZB	Installed at the air outlet when 3-directions mode is performed.
	Fresh Air Intake Kit	UTZ-VXAA	By attaching Fresh Air Intake Kit to the indoor unit, it can be taken in fresh air of up to 10% of "high" air volume of the indoor unit. Do not branch the connecting duct into multiple rooms.
	Insulation Kit for High Humidity	UTZ-KXGC	Install when the under-roof condition is expected to be the humidity of over 80% and the temperature of over 86 °F(30 °C).
	External Input and Output PCB	UTY-XCSX	Use to connect with external devices and air conditioner PCB. Connecting point: CN65 or CN75 on Main PCB
	External Input and Output PCB Box	UTZ-GXEA	For installing the External input and output PCB.
	WLAN Adapter	UTY-TFSXZ2	Remotely manage an air conditioning system using mobile devices such as smartphones and tablets. For connection indoor unit with UART interface. Appropriate application for each region is required to use this option. For details, contact FGL sales company. Connecting point: CN75 on Main PCB
	Modbus Converter	UTY-VMSX	For connection between indoor unit with UART interface and a Modbus open network. Connecting point: CN65 or CN75 on Main PCB
	KNX Converter	UTY-VKSX	For connection between indoor unit with UART interface and a KNX open network. Connecting point: CN65 or CN75 on Main PCB

Exterior	Part name	Model name	Summary
	Thermostat Converter	UTY-TTRX	This converter can control Fujitsu General products using a third-party thermostat controller.
	Network Converter	UTY-VTGX	This converter is required when connecting single split system to VRF network system. Use the terminal for wired remote controller.
	Network Converter (AC power supply)	UTY-VTGXV	This converter is required when connecting single split system to VRF network system. Use the terminal for wired remote controller.
	External Switch Controller	UTY-TERX	Air conditioner switching can be controlled by connecting other external sensor switches. Use the terminal for wired remote controller.



# **Part 2. OUTDOOR UNIT**

---

**SINGLE TYPE:**

**AOUH09LUAS1**

**AOUH12LUAS1**

**AOUH18LUAS1**

# 1. Specifications

Type				Inverter, Heat pump			
Model name				AOUH09LUAS1	AOUH12LUAS1	AOUH18LUAS1	
Power supply				208/230 V ~ 60 Hz			
Power supply intake				Outdoor unit			
Available voltage range				187—253 V			
Starting current			A	4.6	6.4	8.1	
Fan	Airflow rate	Cooling	CFM (m³/h)	906 (1,540)	1,171 (1,990)	1,395 (2,370)	
		Heating			1,089 (1,850)	1,460 (2,480)	
		Type × Qty		Propeller fan × 1			
Motor output		W		23	49		
Sound pressure level*		Cooling	dB (A)	44	48	52	
		Heating		48	49	55	
Heat exchanger type		Dimensions (H × W × D)	in (mm)	Main1: 19-13/16 × 34-11/16 × 11/16 (504 × 881 × 18.19) Main2: 19-13/16 × 33-1/2 × 11/16 (504 × 851 × 18.19)	Main1: 23-1/8 × 34-11/16 × 11/16 (588 × 881 × 18.19) Main2: 23-1/8 × 33-1/2 × 11/16 (588 × 851 × 18.19)		
		Fin pitch	FPI	20			
		Rows × Stages		Main1: 1 × 24 Main2: 1 × 24	Main1: 1 × 28 Main2: 1 × 28		
		Pipe type		Copper			
		Fin type	Type (Material)	Aluminum			
	Surface treatment	PC fin					
Compressor	Type			DC rotary			
	Motor output		W	900	1,030		
Refrigerant		Type	R410A				
		Charge	lb oz	2lbs.3oz.	2lbs.10oz.	2lbs.12oz.	
			g	1,000	1,200	1,250	
Refrigerant oil		Type	RB68A		RB68	RB68A	
		Amount	in³ (cm³)	20.7 (340)	24.4 (400)		
Enclosure		Material		Steel sheet			
		Color		Beige Approximate color of Munsell 10YR 7.5/1.0			
Dimensions (H × W × D)	Net	in (mm)	21-5/16 × 31-7/16 × 11-7/16 (542 × 799 × 290)	24-7/8 × 31-7/16 × 11-7/16 (632 × 799 × 290)			
	Gross		23-11/16 × 37 × 14-3/4 (602 × 940 × 375)	27-1/4 × 37 × 14-3/4 (692 × 940 × 375)			
Weight	Net	lb (kg)	71 (32)	84 (38)	86 (39)		
	Gross		77 (35)	95 (43)			
Connection pipe	Size	Liquid	in (mm)	Ø 1/4 (Ø 6.35)			
		Gas		Ø 3/8 (Ø 9.52)			
	Method		Ø 3/8 (Ø 9.52)	Ø 1/2 (Ø 12.7)			
	Pre-charge length		ft (m)	49 (15)	66 (20)		
	Max. length			66 (20)	98 (30)		
	Max. height difference			49 (15)			
Operation range		Cooling		14 to 115 (-10 to 46)			
		Heating	-5 to 75 (-21 to 24)				
Drain hose		Material		LDPE			
		Tip diameter	in (mm)	Ø 1/2 (Ø 13.0) (I. D.), Ø 5/8 to 11/16 (Ø 16.0 to 16.7) (O. D.)			


## NOTES:

- Specifications are based on the following conditions:
  - Cooling: Indoor temperature of 80°FDB (26.67°CDB) / 67°FWB (19.44°CWB), and outdoor temperature of 95°FDB (35°CDB) / 75°FWB (23.9°CWB).
  - Heating: Indoor temperature of 70°FDB (21.11°CDB) / 59°FWB (15°CWB), and outdoor temperature of 47°FDB (8.33°CDB) / 43°FWB (6.11°CWB).
  - Pipe length: 24 ft 6 in (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- \*: Sound pressure level
  - Measured values in manufacturer's anechoic chamber.
  - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.


## 2. Dimensions

### 2-1. Models: AOUH09LUAS1


Unit: in (mm)

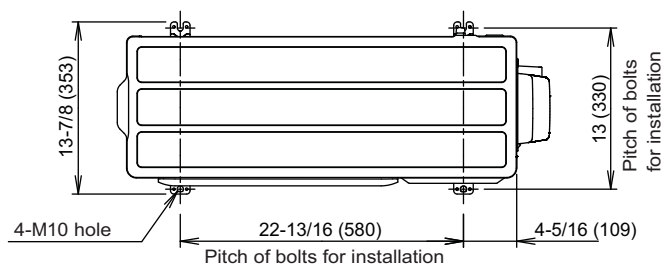


Top view

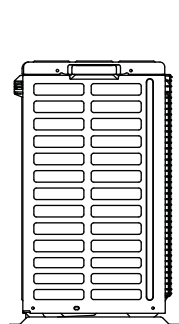


Side view

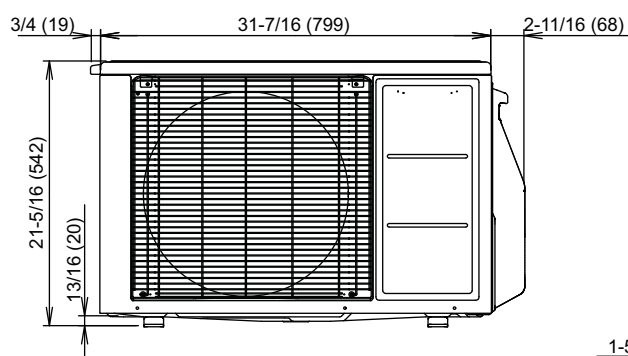


Front view

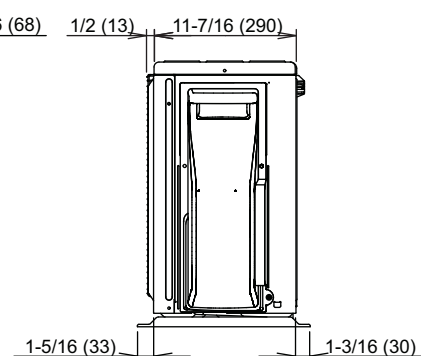

Side view

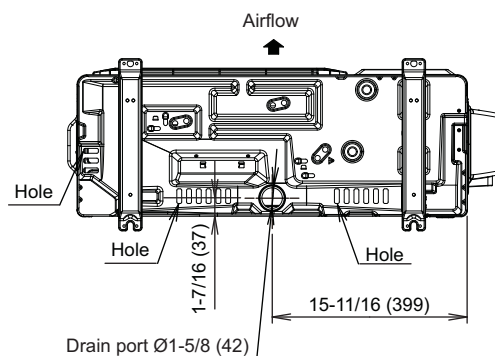

Bottom view

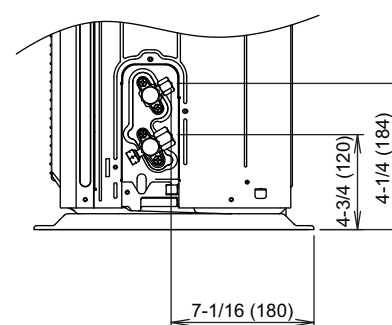

Side view (Valve part)



### 3. Installation space

#### 3-1. Models: AOUH09LUAS1, AOUH12LUAS1, and AOUH18LUAS1

##### ■ Space requirement

Provide sufficient installation space for product safety.

##### ⚠ CAUTION

Keep the space shown in the installation examples.


If the installation is not performed accordingly, it could cause a short circuit and result in a lack of operating performance.

##### ● Single outdoor unit installation


- When the upper space is open:

Unit: in (mm)


Obstacles at rear only

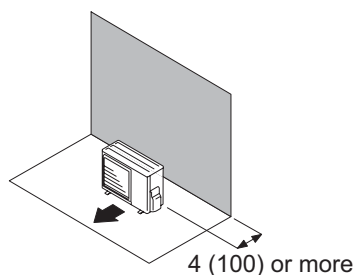


Obstacles at rear and sides

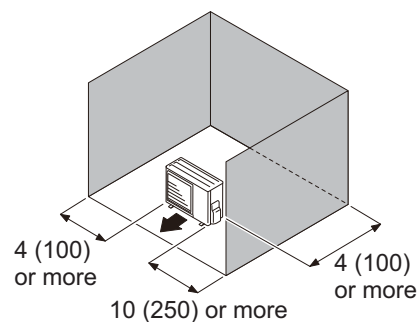

Obstacles at front

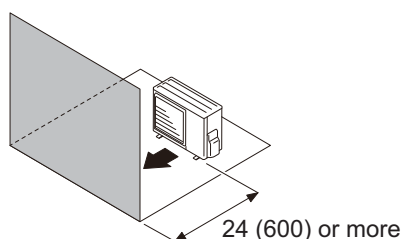


Obstacles at front and rear

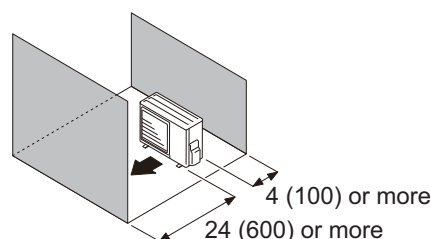


- When an obstruction in the upper space:

Unit: in (mm)

Obstacles at rear and above

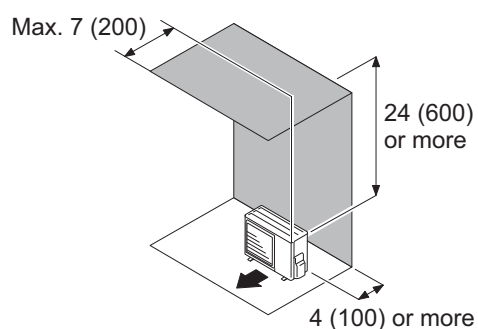

Obstacles at rear, sides, and above

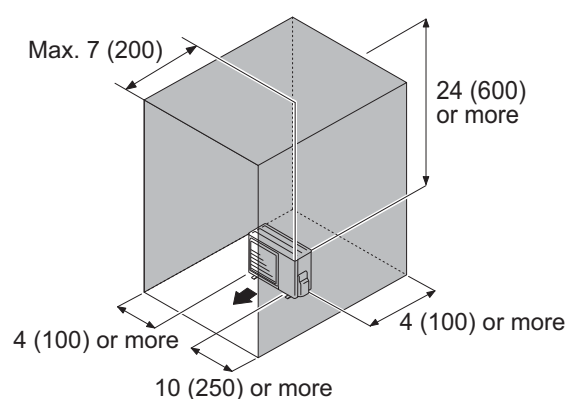


## ● Multiple outdoor unit installation


- Provide at least 10 in (250 mm) of space between the outdoor units if multiple units are installed.
- When routing the piping from the side of an outdoor unit, provide space for piping.
- No more than 3 units must be installed side by side.  
When 4 units or more are arranged in a line, provide the space as shown in the following example **“When an obstruction in the upper space:”**.
- **When the upper space is open:**

Unit: in (mm)


Obstacles at rear only

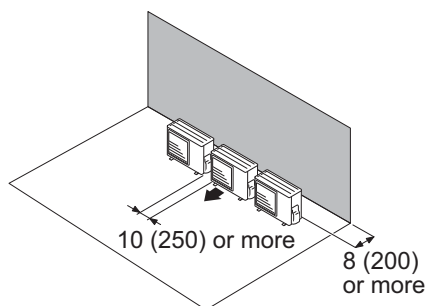

Obstacles at front only

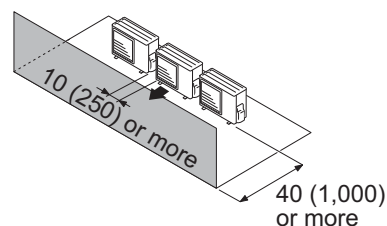


Obstacles at front and rear

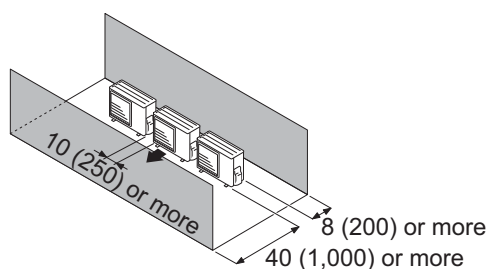

- **When an obstruction in the upper space:**

Unit: in (mm)


Obstacles at rear and above.

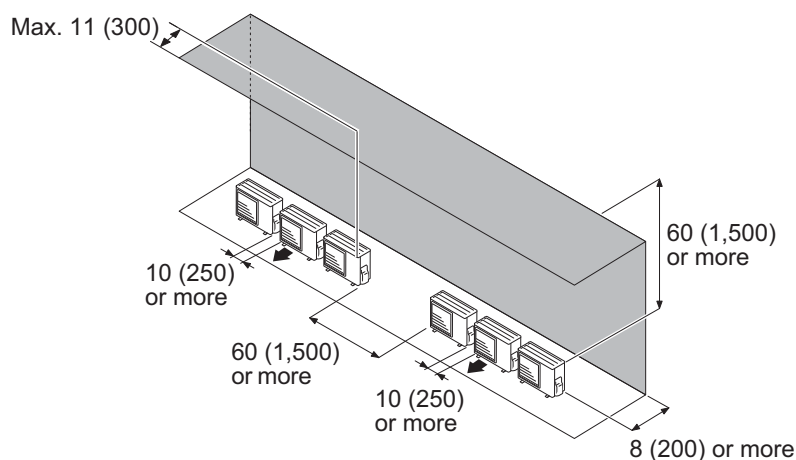



## ● Outdoor units installation in multi-row

Unit: in (mm)

Single parallel unit arrangement

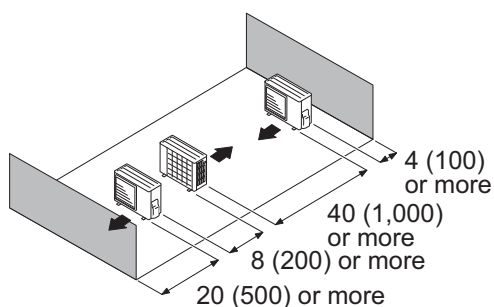

Multiple parallel unit arrangement

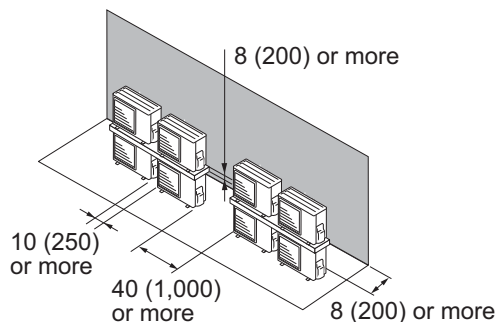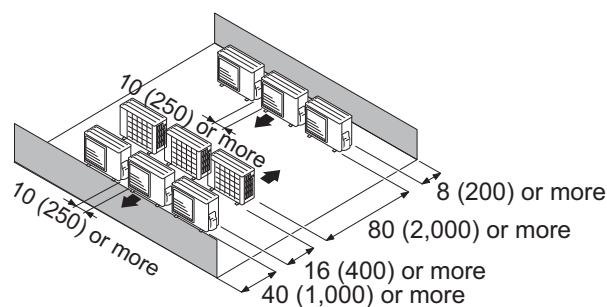


### NOTES:

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.


### ⚠ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 32 °F (0 °C) or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.



## 4. Refrigerant circuit

### 4-1. Models: AOUH09LUAS1

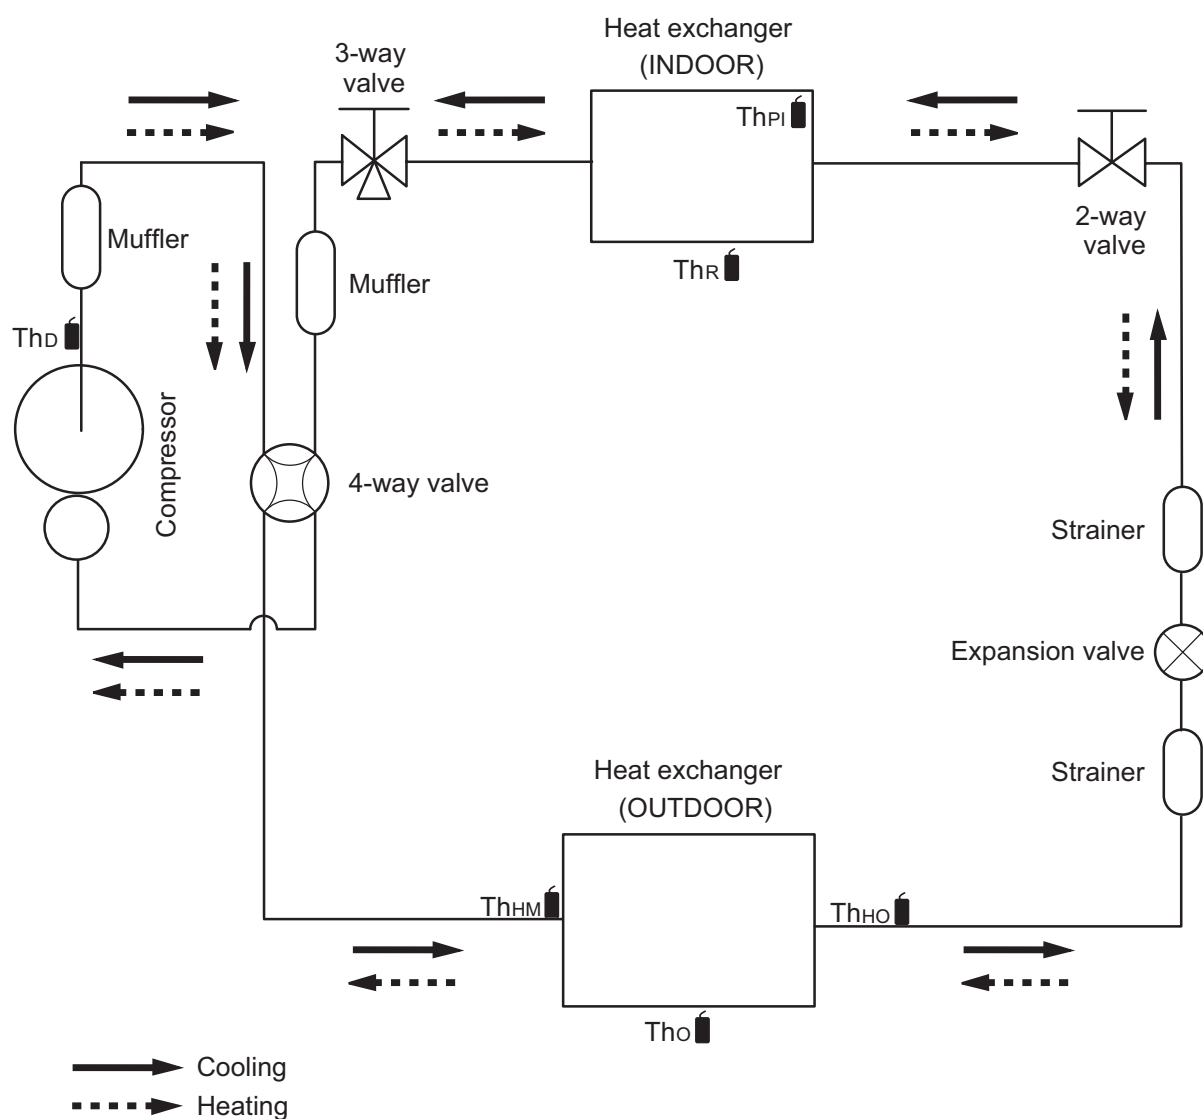

$Th_D$  : Thermistor (Discharge temperature)

$Th_{HM}$  : Thermistor (Heat exchanger middle temperature)

$Th_O$  : Thermistor (Outdoor temperature)


$Th_{HO}$  : Thermistor (Heat exchanger out temperature)

$Th_{PI}$  : Thermistor (Pipe temperature)

$Th_R$  : Thermistor (Room temperature)



## 4-2. Models: AOUH12LUAS1 and AOUH18LUAS1

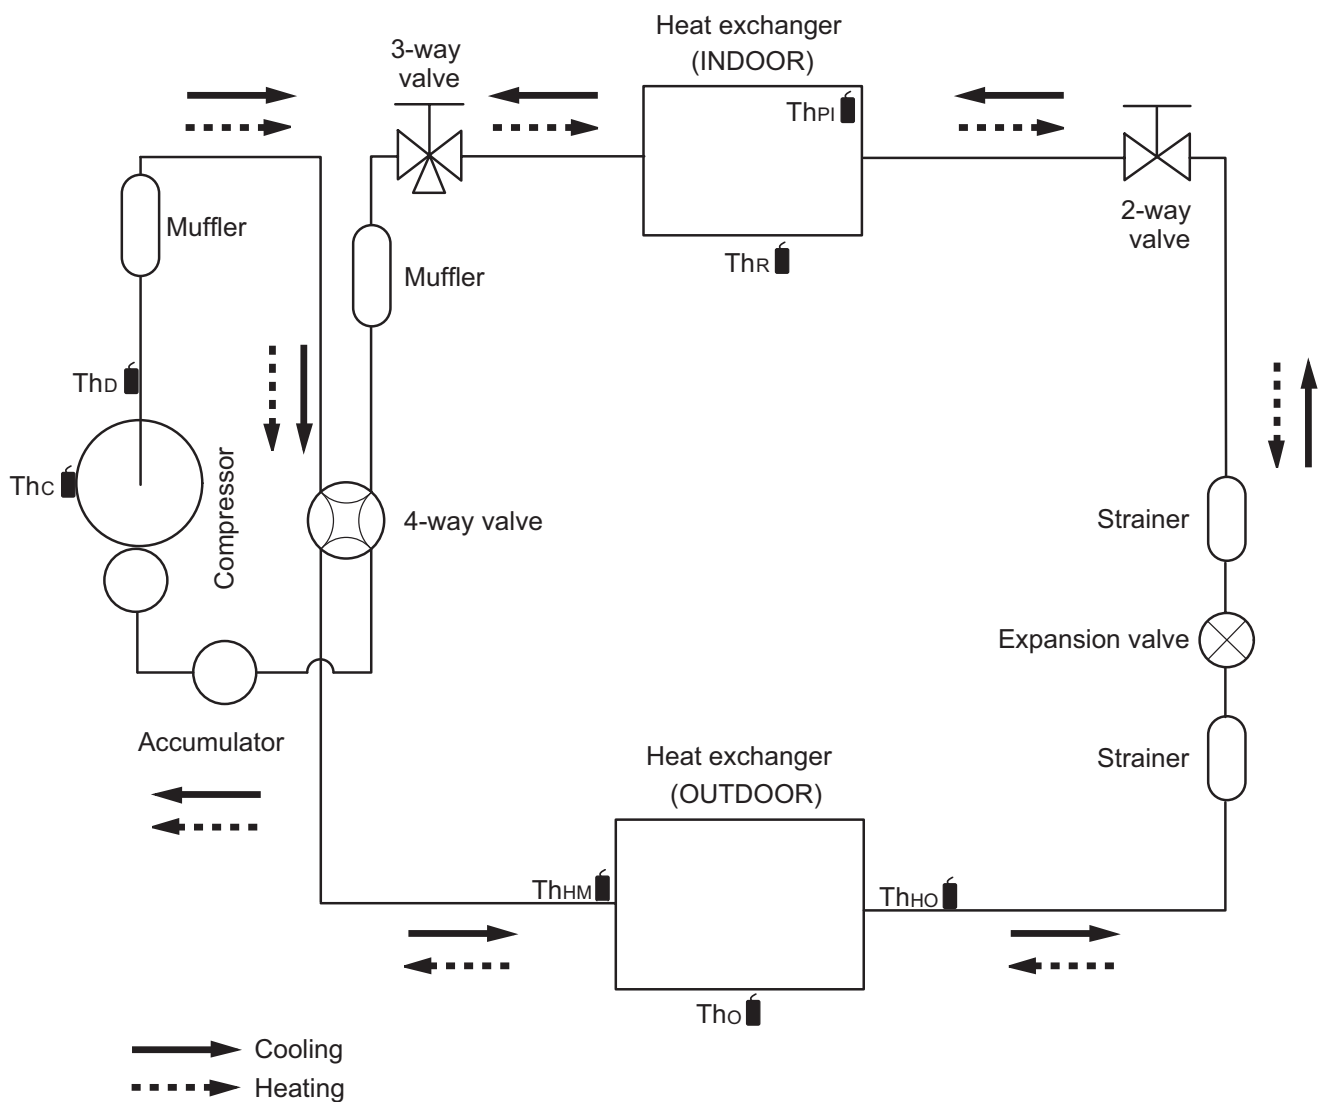

Thc : Thermistor (Compressor temperature)

ThD : Thermistor (Discharge temperature)

ThHM : Thermistor (Heat exchanger middle temperature)

ThO : Thermistor (Outdoor temperature)


ThHO : Thermistor (Heat exchanger out temperature)

ThPI : Thermistor (Pipe temperature)


ThR : Thermistor (Room temperature)

## 5. Wiring diagrams

### 5-1. Model: AOUH09LUAS1

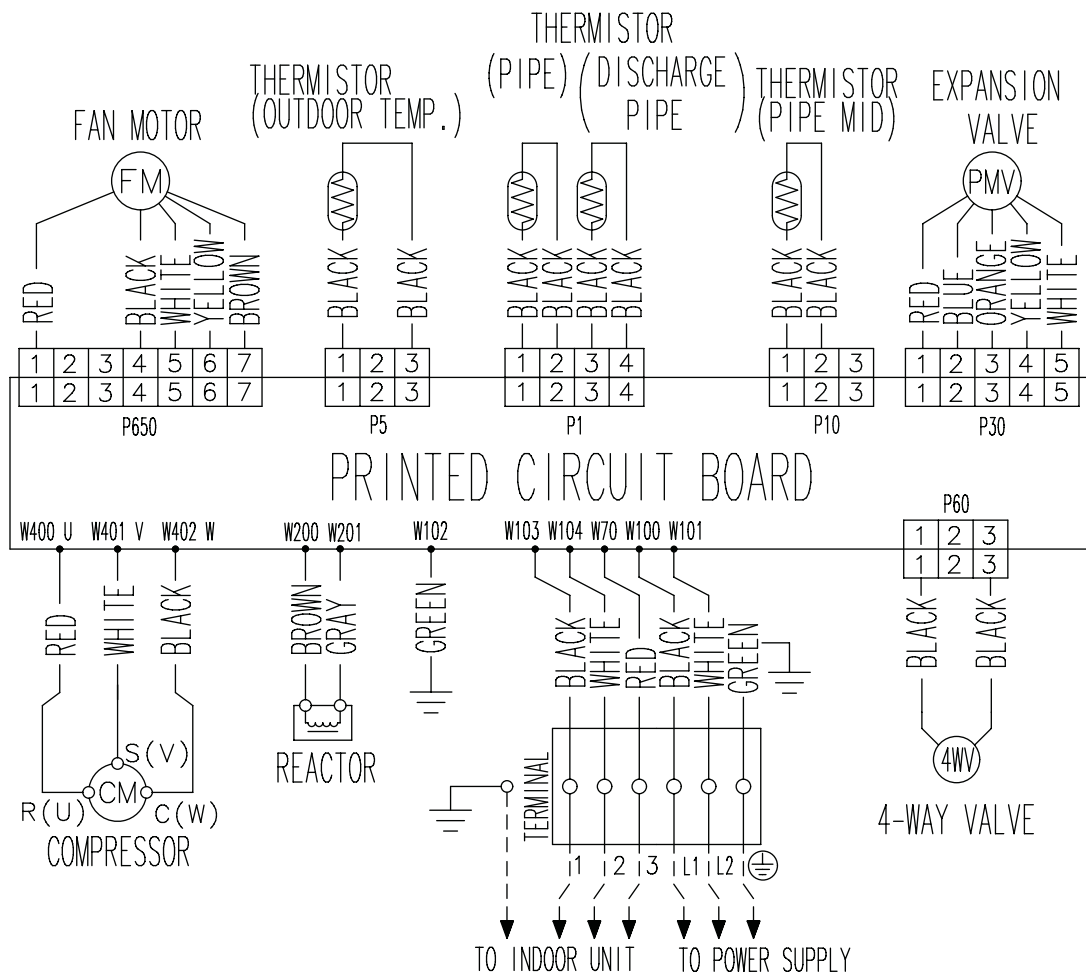


## 5-2. Models: AOUH12LUAS1 and AOUH18LUAS1

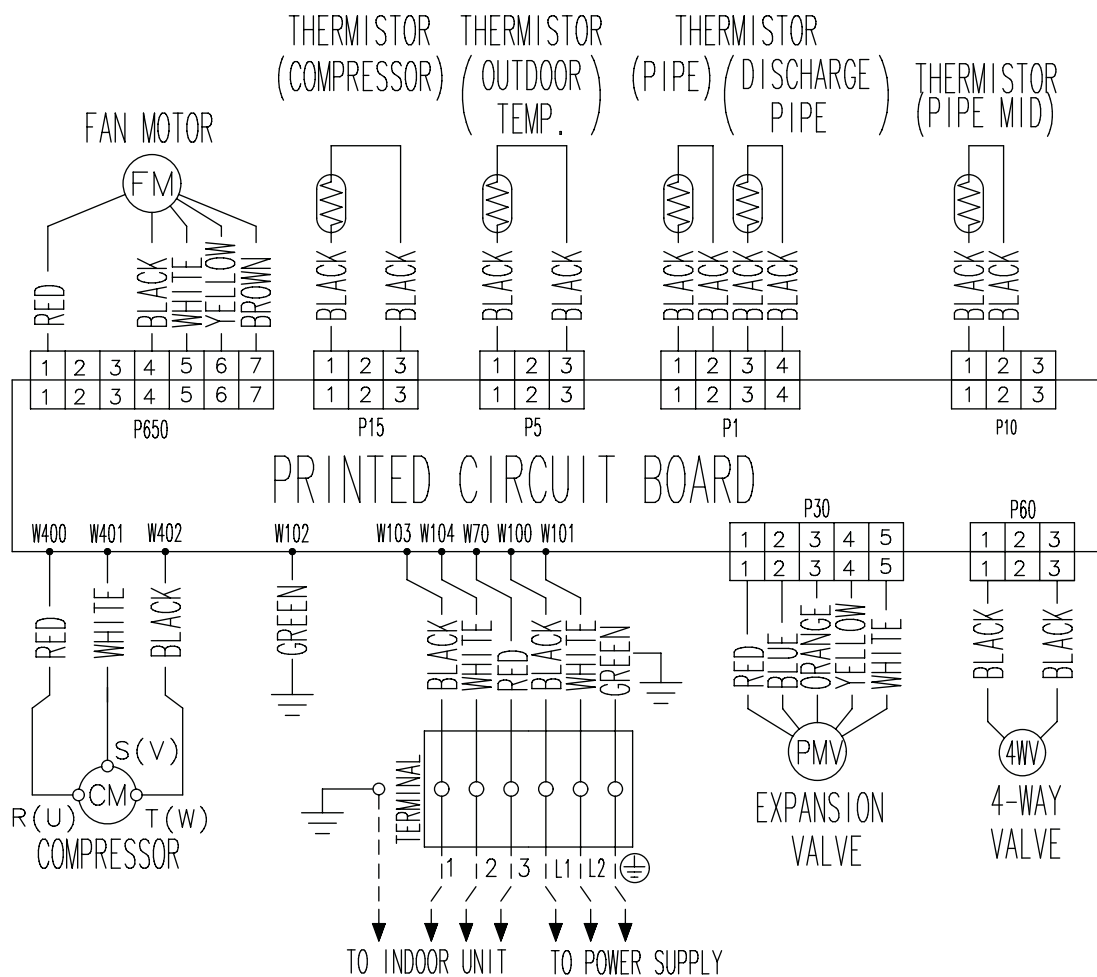

OUTDOOR UNIT  
AOUH09-18LUAS1

OUTDOOR UNIT  
AOUH09-18LUAS1

## 6. Capacity compensation rate for pipe length and height difference

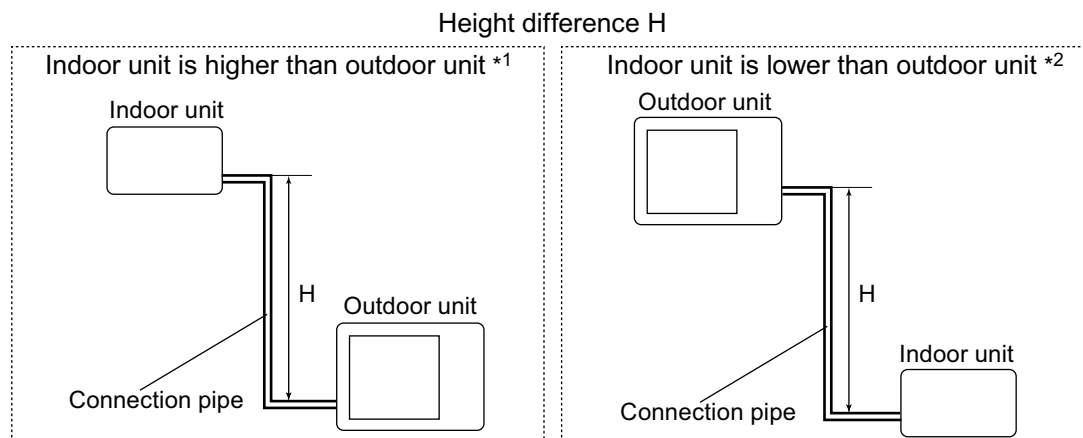

### 6-1. Model: AOUH09LUAS1

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length						
		m		5	7.5	10	15	20
			ft	16	25	33	49	66
Height difference H	Indoor unit is higher than outdoor unit *1	15	49	—	—	—	0.883	0.893
		10	33	—	—	0.956	0.897	0.907
		7.5	25	—	0.988	0.960	0.901	0.910
		5	16	1.021	0.992	0.964	0.904	0.915
	Indoor unit is lower than outdoor unit *2	0	0	1.029	1.000	0.971	0.913	0.922
		-5	-16	1.029	1.000	0.971	0.913	0.922
		-7.5	-25	—	1.000	0.971	0.913	0.922
		-10	-33	—	—	0.971	0.913	0.922
		-15	-49	—	—	—	0.913	0.922

HEATING		Pipe length						
		m		5	7.5	10	15	20
			ft	16	25	33	49	66
Height difference H	Indoor unit is higher than outdoor unit *1	15	49	—	—	—	0.901	0.884
		10	33	—	—	0.974	0.901	0.884
		7.5	25	—	1.000	0.974	0.901	0.884
		5	16	1.006	1.000	0.974	0.901	0.884
	Indoor unit is lower than outdoor unit *2	0	0	1.006	1.000	0.974	0.901	0.884
		-5	-16	1.001	0.995	0.969	0.896	0.880
		-7.5	-25	—	0.993	0.967	0.894	0.878
		-10	-33	—	—	0.965	0.892	0.876
		-15	-49	—	—	—	0.883	0.867

## 6-2. Model: AOUH12LUAS1

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length						
		m	ft	5	7.5	10	15	20
				16	25	33	49	66
Height difference H	Indoor unit is higher than outdoor unit *1	15	49	—	—	—	0.877	0.874
		10	33	—	—	0.956	0.891	0.888
		7.5	25	—	0.988	0.960	0.895	0.892
		5	16	1.017	0.992	0.964	0.899	0.895
	Indoor unit is lower than outdoor unit *2	0	0	1.025	1.000	0.971	0.906	0.902
		-5	-16	1.025	1.000	0.971	0.906	0.902
		-7.5	-25	—	1.000	0.971	0.906	0.902
		-10	-33	—	—	0.971	0.906	0.902
		-15	-49	—	—	—	0.906	0.902

HEATING		Pipe length						
		m	ft	5	7.5	10	15	20
				16	25	33	49	66
Height difference H	Indoor unit is higher than outdoor unit *1	15	49	—	—	—	0.933	0.925
		10	33	—	—	0.981	0.933	0.925
		7.5	25	—	1.000	0.981	0.933	0.925
		5	16	1.017	1.000	0.981	0.933	0.925
	Indoor unit is lower than outdoor unit *2	0	0	1.017	1.000	0.981	0.933	0.925
		-5	-16	1.012	0.995	0.976	0.928	0.920
		-7.5	-25	—	0.993	0.974	0.926	0.918
		-10	-33	—	—	0.971	0.923	0.916
		-15	-49	—	—	—	0.914	0.906

## 6-3. Model: AOUH18LUAS1

**NOTE:** Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length								
		m		5	7.5	10	15	20	25	30
			ft	16	25	33	49	66	82	98
Height difference H	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.951	0.950	0.947	0.941
		10	33	-	-	0.979	0.967	0.966	0.962	0.956
		7.5	25	-	0.988	0.983	0.971	0.970	0.966	0.960
		5	16	0.994	0.992	0.987	0.975	0.974	0.970	0.964
		0	0	1.002	1.000	0.995	0.983	0.982	0.978	0.972
	Indoor unit is lower than outdoor unit *2	-5	-16	1.002	1.000	0.995	0.983	0.982	0.978	0.972
		-7.5	-25	-	1.000	0.995	0.983	0.982	0.978	0.972
		-10	-33	-	-	0.995	0.983	0.982	0.978	0.972
		-15	-49	-	-	-	0.983	0.982	0.978	0.972

HEATING		Pipe length								
		m		5	7.5	10	15	20	25	30
			ft	16	25	33	49	66	82	98
Height difference H	Indoor unit is higher than outdoor unit *1	15	49	-	-	-	0.994	0.979	0.949	0.919
		10	33	-	-	1.012	0.994	0.979	0.949	0.919
		7.5	25	-	1.000	1.012	0.994	0.979	0.949	0.919
		5	16	0.969	1.000	1.012	0.994	0.979	0.949	0.919
		0	0	0.969	1.000	1.012	0.994	0.979	0.949	0.919
	Indoor unit is lower than outdoor unit *2	-5	-16	0.964	0.995	1.007	0.989	0.974	0.944	0.915
		-7.5	-25	-	0.993	1.004	0.986	0.972	0.942	0.911
		-10	-33	-	-	1.002	0.984	0.969	0.940	0.909
		-15	-49	-	-	-	0.974	0.959	0.930	0.899

## 7. Additional charge calculation

### 7-1. Model: AOUH09LUAS1

Refrigerant type		R410A
Refrigerant amount	lb oz	2lbs.3oz.
	g	1,000

#### ■ Refrigerant charge

Total pipe length	ft	49 or less	66 (Max.)	0.2 oz/ft (20 g/m)
	m	15 or less	20 (Max.)	
Additional charge	oz	0	4.0	
	g	0	100	

### 7-2. Model: AOUH12LUAS1

Refrigerant type		R410A
Refrigerant amount	lb oz	2lbs.10oz.
	g	1,200

#### ■ Refrigerant charge

Total pipe length	ft	49 or less	66 (Max.)	0.2 oz/ft (20 g/m)
	m	15 or less	20 (Max.)	
Additional charge	oz	0	4.0	
	g	0	100	

### 7-3. Model: AOUH18LUAS1

Refrigerant type		R410A
Refrigerant amount	lb oz	2lbs.12oz.
	g	1,250

#### ■ Refrigerant charge

Total pipe length	ft	66 or less	82 or less	98 (Max.)	0.2 oz/ft (20 g/m)
	m	20 or less	25 or less	30 (Max.)	
Additional charge	oz	0	4.0	7.0	
	g	0	100	200	

## 8. Airflow

### 8-1. Model: AOUH09LUAS1

#### ● Cooling

Airflow	
m <sup>3</sup> /h	1,540
l/s	428
CFM	906

#### ● Heating

Airflow	
m <sup>3</sup> /h	1,540
l/s	428
CFM	906

### 8-2. Model: AOUH12LUAS1

#### ● Cooling

Airflow	
m <sup>3</sup> /h	1,990
l/s	553
CFM	1,171

#### ● Heating

Airflow	
m <sup>3</sup> /h	1,850
l/s	514
CFM	1,089



## 8-3. Model: AOUE18LUAS1

### ● Cooling

Airflow	
m <sup>3</sup> /h	2,370
l/s	658
CFM	1,395

### ● Heating


Airflow	
m <sup>3</sup> /h	2,480
l/s	689
CFM	1,460

## 9. Operation noise (sound pressure)


### 9-1. Noise level curve

#### ■ Model: AOUH09LUAS1

##### ● Cooling

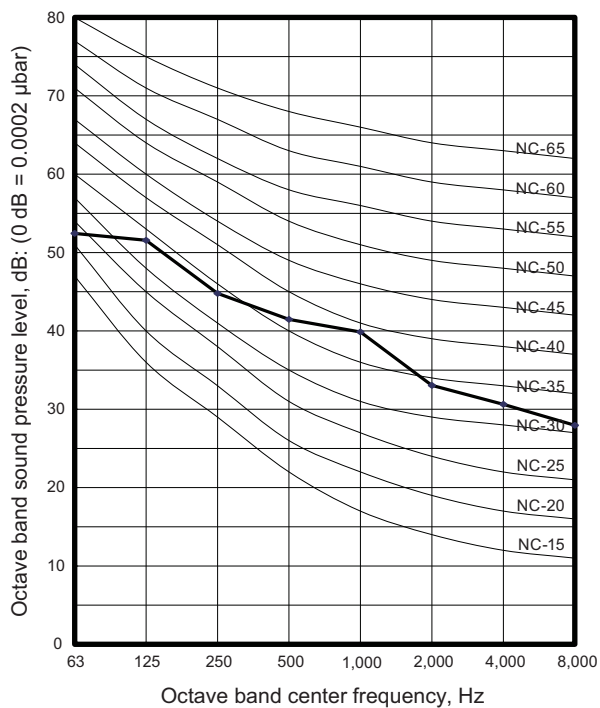


##### ● Heating

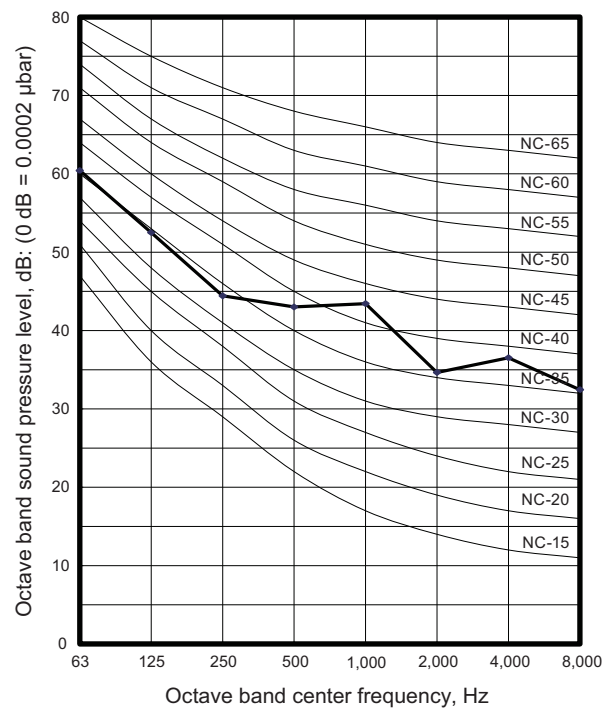


#### ■ Model: AOUH12LUAS1

##### ● Cooling

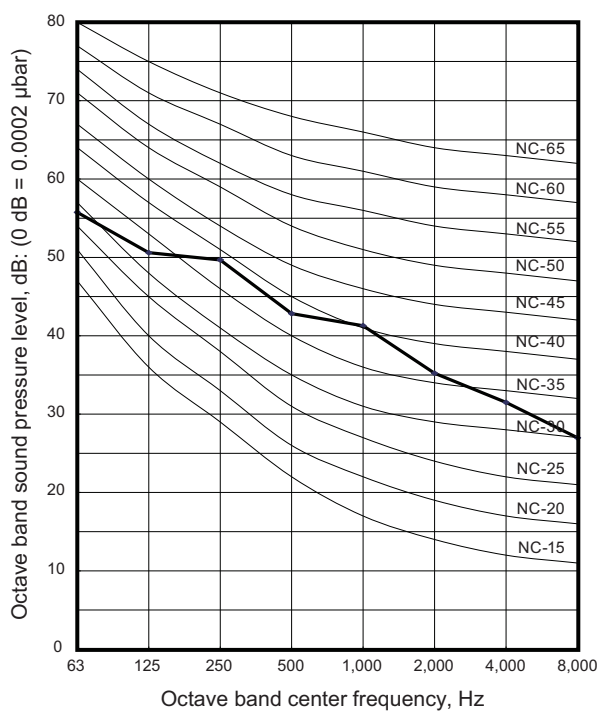


##### ● Heating

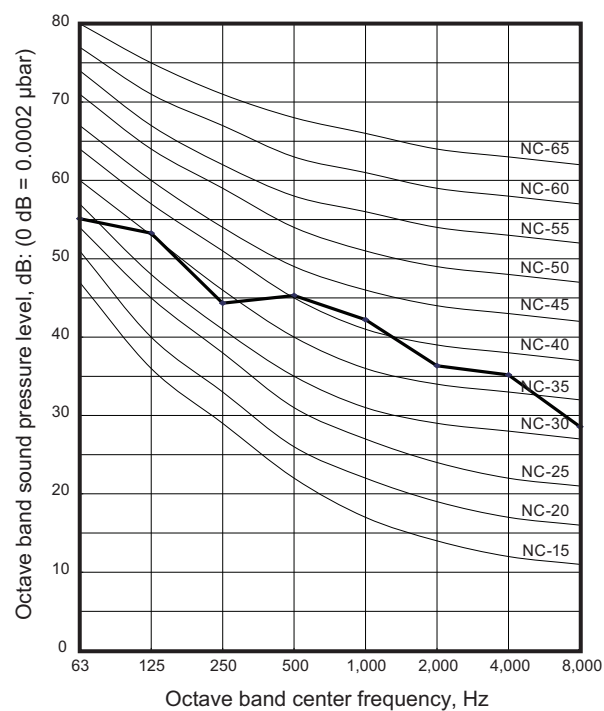


## Model: AOUH18LUAS1


### ● Cooling

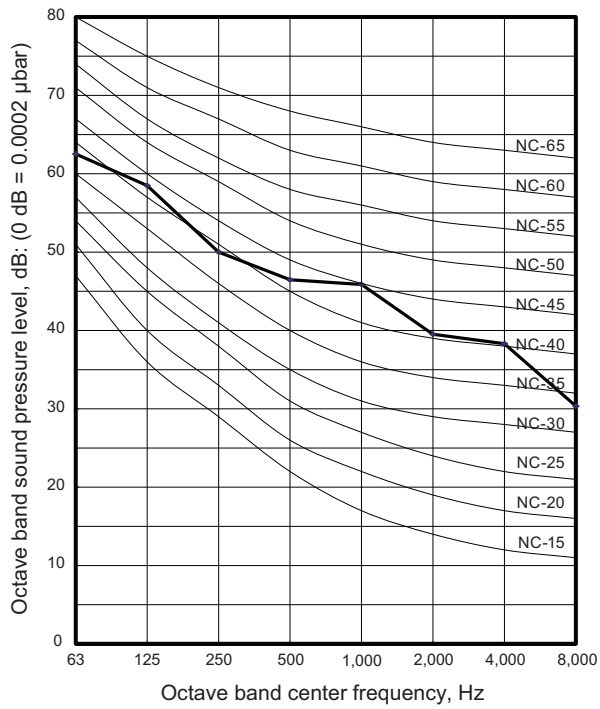

### ● Heating

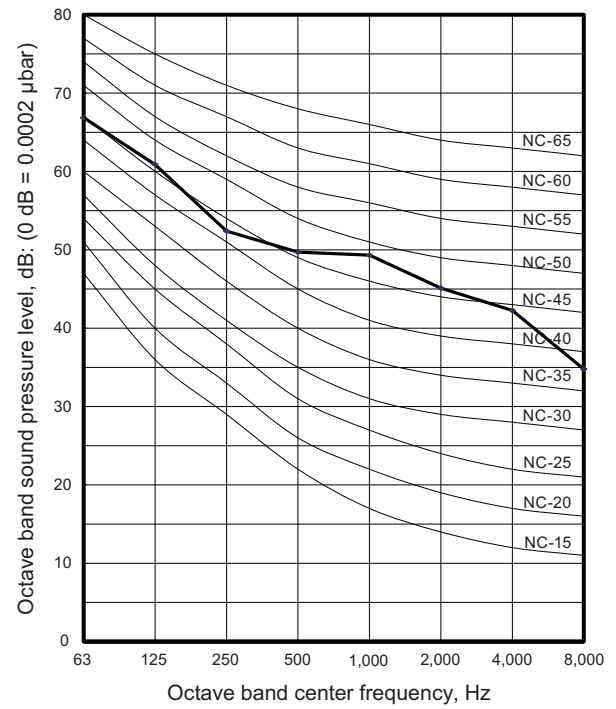

## 9-2. Sound level check point

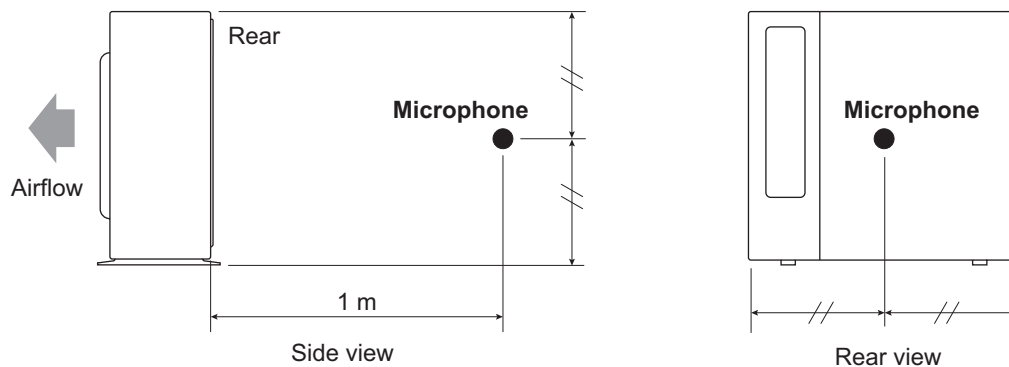

**NOTE:** Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

## 10. Electrical characteristics

Model name			AOUH09LUAS1	AOUH12LUAS1	AOUH18LUAS1
Power supply	Voltage	V	208/230~		
	Frequency	Hz	60		
MCA *1		A	9.3	11.3	14.8
Starting current		A	4.6	6.4	8.1
Wiring spec. *2	MAX. CKT. BKR *3		A	15	20
	Power cable		AWG	14	
	Connection cable *4	Size	AWG	14	
		Limited wiring length	ft (m)	69 (21)	

\*1: Minimum Circuit Ampacity (Calculation based on UL60335-2-40)

\*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005. As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.

\*3: Maximum Circuit Breaker

\*4: Limit voltage drop to less than 2%. If voltage drop is 2% or more, increase cable conductor size.





## 11. Safety devices

Type of protection	Protection form		Model
			AOUH09LUAS1
Circuit protection	Current fuse (Main PCB)		250 V, 15 A
			250 V, 5 A
			250 V, 3.15 A
Fan motor protection	Thermal protection program	Activate	217.4±32.4 °F (103±18°C) Fan motor stop
		Reset	203±32.4 °F or less (95±18 °C or less) Fan motor restart
Compressor protection	Thermal protection program (Discharge temp.)	Activate	230 °F (110 °C) Compressor stop
		Reset	After 7 minutes Compressor restart
	Thermal protection program (Outdoor temp.) (Only in COOL or DRY mode)	Activate	5 °F (-15°C) Compressor stop
		Reset	14 °F (-10°C) Compressor restart

Type of protection	Protection form		Model	
			AOUH12LUAS1	AOUH18LUAS1
Circuit protection	Current fuse (Main PCB)		250 V, 15 A	250 V, 20 A
			250 V, 5 A	
			250 V, 3.15 A	
Fan motor protection	Thermal protection program	Activate	257±18 °F (125±10 °C) Fan motor stop	
		Reset	248±18 °F (120±10 °C) Fan motor restart	
Compressor protection	Thermal protection program (Compressor temp.)	Activate	226 °F (108 °C) Compressor stop	
		Reset	After 3 minutes, and 176 °F (80 °C) or less Compressor restart	
	Thermal protection program (Discharge temp.)	Activate	230 °F (110 °C) Compressor stop	
		Reset	After 7 minutes Compressor restart	
	Thermal protection program (Outdoor temp.) (Only in COOL and DRY mode)	Activate	5 °F (-15 °C) Compressor stop	
		Reset	14 °F (-10 °C) Compressor restart	

## 12. Accessories

### 12-1. Models: AOUH09LUAS1, AOUH12LUAS1, and AOUH18LUAS1

Part name	Exterior	Qty	Part name	Exterior	Qty
Installation manual		1	Cable tie		2
Drain pipe		1	Drain cap		5