

# DESIGN & TECHNICAL MANUAL

## AIRSTAGE™ V-II

Variable Refrigerant Flow System



### Multi Air Conditioning System for Buildings

Large Capacity Multi VRF System  
DC Inverter Control Compressor  
Long Piping System Design  
High Efficiency Refrigerant R410A



60 Hz

FUJITSU GENERAL LIMITED

## **CONTENTS**

### **1. GENERAL INFORMATION**

### **2. MODEL SELECTION**

### **3. OUTDOOR UNITS**

### **4. INDOOR UNITS**

### **5. CONTROL SYSTEM**

### **6. SYSTEM DESIGN**

### **7. FUNCTION SETTINGS**

### **8. EXTERNAL INPUT AND OUTPUT**

### **9. NOTES**

### **10. OPTIONAL PARTS**





## 1. GENERAL INFORMATION

# CONTENTS

## 1. GENERAL INFORMATION

<b>1. Outdoor unit and indoor unit lineup .....</b>	<b>01-1</b>
1-1. Outdoor units .....	01-1
1-2. Indoor units .....	01-4
<b>2. Optional parts .....</b>	<b>01-8</b>
2-1. Controllers .....	01-8
2-2. Adapter/Converter/Maintenance tool .....	01-11
2-3. Branch kit .....	01-13
2-4. Cassette grille .....	01-14
2-5. Others .....	01-15

# 1. Outdoor unit and indoor unit lineup

**NOTE:** Information on models not mentioned here is available on our Pocket or Pocket Portal as the back number.

## 1-1. Outdoor units

Extensive lineup from 6 ton to 24 ton in 2 ton increments.

Space saving combination and Energy efficiency combination are available, which can be selected to suit any air conditioning needs.

### ■ Stand-alone



Ton	Cooling capacity (Btu/h)	Model name
6	72,000	AOUA72RLBV1
8	96,000	AOUA96RLBV1



Ton	Cooling capacity (Btu/h)	Model name
10	120,000	AOUA120RLBV1

## ■ Combination

Combinations other than followings are prohibited.






















Ton	Cooling capacity (Btu/h)	Set model name	Model name			Maximum number of connectable indoor units
			Unit 1	Unit 2	Unit 3	
12	144,000	AOUA144RLBVG1	AOUA72RLBV1	AOUA72RLBV1	—	32
14	168,000	AOUA168RLBVG1	AOUA96RLBV1	AOUA72RLBV1	—	37
16	192,000	AOUA192RLBVG1	AOUA120RLBV1	AOUA72RLBV1	—	42
18	216,000	AOUA216RLBVG1	AOUA120RLBV1	AOUA96RLBV1	—	47
20	240,000	AOUA240RLBVG1	AOUA120RLBV1	AOUA120RLBV1	—	52
22	264,000	AOUA264RLBVG1	AOUA96RLBV1	AOUA96RLBV1	AOUA72RLBV1	58
24	288,000	AOUA288RLBVG1	AOUA96RLBV1	AOUA96RLBV1	AOUA96RLBV1	63

## ■ Model designation

Column	1	2	3	4	5	6	7	8	9	10	11	12	13
Code	A	O	U	A	1	4	4	R	L	B	V	G	1

Column	Item	Description
1	Type	AO: Outdoor unit
2		
3	Brand	U: Fujitsu
4		
5	Capacity	72: 72,000 Btu/h
		96: 96,000 Btu/h
		108: 108,000 Btu/h
		120: 120,000 Btu/h
		144: 144,000 Btu/h
6	Capacity	168: 168,000 Btu/h
		192: 192,000 Btu/h
		216: 216,000 Btu/h
		240: 240,000 Btu/h
		264: 264,000 Btu/h
7	Capacity	288: 288,000 Btu/h
8	Function	R: Heat pump
9	Function	L: Inverter
10	Function	B: 230V
11	Series name	V: VRF
12	Set name	G1: Combination model
13		Blank: Single model

# 1-2. Indoor units

	Type	Capacity													
	Btu/h	4,000	7,500	9,500	12,000	14,000	18,000	24,000	30,000	34,000	36,000	48,000	60,000	72,000	96,000
	Model code	4	7	9	12	14	18	24	30	36	36	48	60	72	96
Compact cas- sette		•	•	•	•	•	•	•							
															
4-way flow cassette							•	•							
									•		•				
Circular flow cassette							•	•	•						
											•	•			
Mini duct		•													
Slim duct/Slim concealed floor			•	•	•	•									
							•								
Medium static pressure duct								•	•		•				
High static pressure duct											•	•	•		
														•	
															•
Compact floor		•	•	•	•	•									
Floor/Ceiling					•	•	•	•							
Ceiling									•		•				
Wall mounted		•	•	•	•	•									
							•	•							
									•	•					
			•	•	•	•									
							•	•							



Type	Rated capacity (Btu/h)		Model name	Dimensions	Remarks
	Cooling	Heating		H × W × D	
Compact cassette	4,000	4,400	AUUA4TLAV2	9-5/8 × 22-7/16 × 22-7/16 (245 × 570 × 570)	Cassette grille: UTG-CCGVG (Grid type)
	7,500	9,500	AUUA7TLAV2		
	9,500	10,900	AUUA9TLAV2		
	12,000	13,500	AUUA12TLAV2		
	14,000	15,600	AUUA14TLAV2		
	18,000	20,000	AUUA18TLAV2		
	24,000	27,000	AUUA24TLAV2		
4-way flow cassette	18,000	20,000	AUUB18TLAV	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)	Cassette grille: UTG-LCGV
	24,000	27,000	AUUB24TLAV	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)	
	30,000	34,000	AUUB30TLAV		
	36,000	40,000	AUUB36TLAV		
Circular flow cassette	18,000	20,000	AUUB18TLAV2	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)	Cassette grille: UTG-LCGVCW (White) UTG-LCGVCB (Black)
	24,000	27,000	AUUB24TLAV2		
	30,000	34,000	AUUB30TLAV2	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)	
	36,000	40,000	AUUB36TLAV2		
	48,000	54,000	AUUB48TLAV2		
Mini duct	4,000	4,400	ARUL4TLAV2	7-13/16 × 27-9/16 × 17-11/16 (198 × 700 × 450)	
Slim duct/Slim concealed floor	7,500	9,500	ARUL7TLAV2	7-13/16 × 27-9/16 × 24-7/16 (198 × 700 × 620)	
	9,500	10,900	ARUL9TLAV2		
	12,000	13,500	ARUL12TLAV2		
	14,000	15,600	ARUL14TLAV2		
	18,000	20,000	ARUL18TLAV2	7-13/16 × 35-7/16 × 24-7/16 (198 × 900 × 620)	
Medium static pressure duct	24,000	27,000	ARUM24TLAV2	10-5/16 × 44-11/16 × 27-9/16 (270 × 1,135 × 700)	
	30,000	34,000	ARUM30TLAV2		
	36,000	40,000	ARUM36TLAV2		
High static pressure duct	36,000	40,000	ARUH36TLAV	15-3/4 × 41-5/16 × 19-11/16 (400 × 1,050 × 500)	
	48,000	54,000	ARUH48TLAV		
	60,000	67,000	ARUH60TLAV		
	72,000	81,000	ARUH72TLAV2	17-11/16 × 62-1/2 × 27-9/16 (450 × 1,587 × 700)	
	96,000	108,000	ARUH96TLAV2	21-5/8 × 62-1/2 × 27-9/16 (550 × 1,587 × 700)	
Compact floor	4,000	4,400	AGUA4TLAV2	23-5/8 × 29-1/8 × 7-7/8 (600 × 740 × 200)	
	7,500	9,500	AGUA7TLAV2		
	9,500	10,900	AGUA9TLAV2		
	12,000	13,500	AGUA12TLAV2		
	14,000	15,600	AGUA14TLAV2		
Floor/Ceiling	12,000	13,500	ABUA12TLAV2	7-13/16 × 39 × 25-13/16 (199 × 990 × 655)	
	14,000	15,600	ABUA14TLAV2		
	18,000	20,000	ABUA18TLAV2		
	24,000	27,000	ABUA24TLAV2		
Ceiling	30,000	34,000	ABUA30TLAV2	9-7/16 × 65-3/8 × 27-9/16 (240 × 1,660 × 700)	
	36,000	40,000	ABUA36TLAV2		

Type	Rated capacity (Btu/h)		Model name	Dimensions	Remarks
	Cooling	Heating		H × W × D	
Wall mounted	4,000	4,400	ASUA4TLAV2	10-9/16 × 33-1/16 × 8 (268 × 840 × 203)	
	7,500	9,500	ASUA7TLAV2		
	9,500	10,900	ASUA9TLAV2		
	12,000	13,500	ASUA12TLAV2		
	14,000	15,600	ASUA14TLAV2		
	18,000	20,000	ASUB18TLAV1	12-5/8 × 39-5/16 × 9-3/8 (320 × 998 × 238)	
	24,000	27,000	ASUB24TLAV1		
	30,000	34,000	ASUA30TLAV2	13-3/8 × 45-1/4 × 11 (340 × 1,150 × 280)	
	34,000	38,000	ASUA36TLAV2		
	7,500	9,500	ASUA7TLAV	10-13/16 × 31-1/8 × 8-7/16 (275 × 790 × 215)	
	9,500	10,900	ASUA9TLAV		
	12,000	13,500	ASUA12TLAV		
	14,000	15,600	ASUA14TLAV		
	18,000	20,000	ASUB18TLAV	12-5/8 × 39-5/16 × 9 (320 × 998 × 228)	
	24,000	27,000	ASUB24TLAV		

## ■ Model designation

Column	1	2	3	4	5	6	7	8	9	10	11
Code	A	U	U	A	1	2	T	L	A	V	1





Column	Item	Description
1	Type	AU: Cassette type
2		AR: Duct type
		AB: Floor/Ceiling or Ceiling type
		AG: Floor type
		AS: Wall mounted type
3	Brand	U: Fujitsu
4	Model	A: Standard (AU, AS) B: Large (AU, AS) L: Slim (AR) M: Middle static pressure (AR) H: High static pressure (AR) V: Vertical air handler (AR)
5	Capacity	4: 4,000 Btu/h
6		7: 7,500 Btu/h
		9: 9,500 Btu/h
		12: 12,000 Btu/h
		14: 14,000 Btu/h
		18: 18,000 Btu/h
		24: 24,000 Btu/h
		30: 30,000 Btu/h
		36: 34,000 or 36,000 Btu/h
		48: 48,000 Btu/h
		60: 60,000 Btu/h
7	Function	T: Heat pump
8	Function	L: Inverter
9	Function	A: 1 Phase
10	Function	V: VRF
11	Version	1, 2

## 2. Optional parts







**NOTE:** Information on models not mentioned here is available on our Pocket or Pocket Portal as the back number.


### 2-1. Controllers

#### ■ Central control

Exterior	Part name	Model name	Summary
	System controller	UTY-APGXZ1	System controller realizes the advanced integrated monitoring & control of VRF network system from small scale buildings to large scale buildings. Optional: UTY-PEGXZ1, UTY-PPGXP2
	System controller lite	UTY-ALGXZ1	System controller lite has standard functions sufficient for air conditioner management in small and medium scale buildings. Optional: UTY-PLGXA2, UTY-PLGXR2, UTY-PLGXE2, UTY-PLGXP2, UTY-PLGXX2
	Touch panel controller	UTY-DTGYZ1	Controls and monitors our air conditioner via LAN or Internet. Allows user or tenant to manage the air conditioning by using assigned equipment only such as their PCs or smart devices from anywhere. Optional: UTY-PTGXA
	Central remote controller	UTY-DCGYZ*	Central control of small and medium sized buildings and tenants. Central remote controller realizes the trouble support function, remote monitoring, and remote operation.

## Individual control

Exterior	Part name	Model name	Summary
	Wired remote controller (Touch panel)	UTY-RNRUZ*	Easy finger touch operation with LCD panel. Backlight LCD enables easy operation in a dark room. Wire type: Non-polar 2-wire
	Wired remote controller	UTY-RNKU	Room temperature can be controlled by detecting the temperature accurately with built-in thermo sensor. Wire type: Polar 3-wire
	Simple remote controller	UTY-RSRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Non-polar 2-wire
	Simple remote controller (Without operation mode)	UTY-RHRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting. Wire type: Non-polar 2-wire
	Simple remote controller	UTY-RSKU	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Polar 3-wire
	Simple remote controller (Without operation mode)	UTY-RHKU	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting. Wire type: Polar 3-wire

Exterior	Part name	Model name	Summary
	Wireless remote controller	UTY-LNHU	Unit control is performed by wireless remote controller.










## ■ Model designation





Column	1	2	3	4	5	6	7	8	9	10
Code	U	T	Y	-	A	P	G	X	Z	1

Column	Item	Description
1	Series name	UTY: Control unit
2		
3		
4		
5	Type	APG: System controller ALG: System controller lite DTG: Touch panel controller DCG: Central remote controller RNR, RNK: Wired remote controller RSR, RHR, RSK, RHK: Simple remote controller LNH: Wireless remote controller
6		
7		
8	Brand	Y: Fujitsu X: Neutral brand
9	Version	Z1, Z2, Z3
10		





## 2-2. Adapter/Converter/Maintenance tool

Exterior	Part name	Model name	Summary
	Network converter	UTY-VTGX	Split type systems can be controlled from a central controller via the converter.
	Network converter (AC power supply)	UTY-VTGXV	Split type systems can be controlled from a central controller via the converter.
	Network converter	UTY-VGGXZ1	Split type systems can be controlled from a central controller via the converter. Group remote controller can be controlled up to two refrigerant systems via the converter.
	Network converter for LonWorks	UTY-VLGX	For connection between VRF network system and a LonWorks open network for management of small to medium-sized BMS.
	Modbus converter for VRF	UTY-VMGX	For connection between VRF network system and a Modbus open network.
	Modbus converter for indoor unit	UTY-VMSX	For connection between Single split indoor unit and a Modbus open network.
	BACnet gateway (Hardware)	UTY-VBGX	For connection between VRF network system to the BMS system using BACnet protocol. Supports max. 128 indoor units.
	BACnet gateway (Software)	UTY-ABGXZ1	The central control of maximum 1600 indoor units can be realized by connecting the VRF network system to the BACnet, a global standard for open network.
	Niagara driver for VRF	FUJ-VRF-8000 (Tridium part No.)	JACE8000. Niagara driver for VRF is a software driver for the Niagara framework. With the driver, direct connection of VRF system to Niagara system becomes possible using JACE, or Supervisor running on PC. Required: DR-FUJ-DEVICE-25 and/or DR-FUJ-DEVICE-50, NPB-8000-LON, SMA-8005-1YR-INIT Optional: WPM-8000 Later addition: DR-FUJ-DEV-UP-50







Exterior	Part name	Model name	Summary
	Signal amplifier	UTY-VSGXZ1	If the total length of transmission line exceeds 500m, or the number of units exceeds 64, a Signal amplifier will be necessary.
	External switch controller	UTY-TERX UTY-TEKX	Air conditioner switching can be controlled by connecting other external sensor switches.
	Service tool	UTY-ASGXZ1	Extensive monitoring and analysis functions for installation and maintenance. Operation status and error history can be grasped promptly and adequately.
	Web monitoring tool	UTY-AMGXZ1	Trouble free operation at all times by web monitoring system. The operation status of the VRF network system within the building can be monitored in real time over the Internet.

## 2-3. Branch kit









### Outdoor unit branch kit

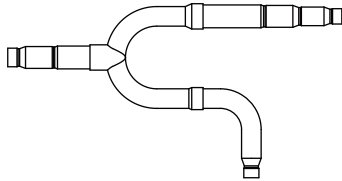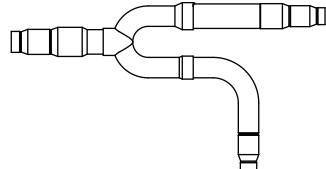Exterior	Model name
<p>Liquid pipe</p>  <p>Gas pipe</p> 	UTP-CX567A




### Separation tube

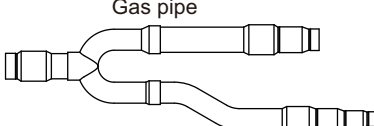For 2 pipes	
Exterior	Model name
<p>Liquid pipe</p>  <p>Gas pipe</p> 	UTP-AX090A
<p>Liquid pipe</p>  <p>Gas pipe</p> 	UTP-AX180A
<p>Liquid pipe</p>  <p>Gas pipe</p> 	UTP-AX567A

## ■ Header

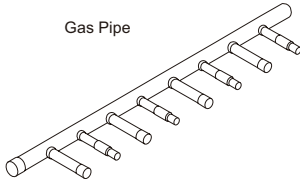Exterior	Model name
<p>Liquid Pipe</p>  <p>Gas Pipe</p> 	UTR-H0906L
<p>Liquid Pipe</p>  <p>Gas Pipe</p> 	UTR-H1806L
<p>Liquid Pipe</p>  <p>Gas Pipe</p> 	UTR-H0908L
<p>Liquid Pipe</p>  <p>Gas Pipe</p> 	UTR-H1808L










## 2-4. Cassette grille

Exterior	Model name	Remarks
 <p>For Compact cassette type</p>	UTG-CCGVG	Grid type grille
 <p>For Circular flow cassette type</p>	UTG-LCGVCW UTG-LCGVCB	
 <p>For 4-way flow cassette type</p>	UTG-LCGV	
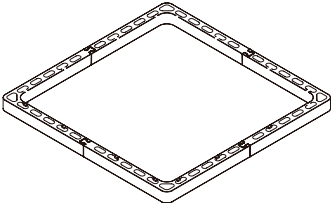
## 2-5. Others











**NOTE:** For applicable indoor unit type, refer to "[Applicable parts](#)" in Chapter 10. OPTIONAL PARTS on page 10-24.

Exterior	Part name	Model name
	Flange (Square)	UTD-SF045T
	Flange (Round)	UTD-RF204
 × 2 pcs	Air filter	UTD-LF25NA
 × 2 pcs	Air filter	UTD-LF60KA
	Drain pump unit	UTZ-PX1BBA UTZ-PU1NBA
	Drain pump unit	UTR-DPB24T
	Air outlet shutter plate	UTR-YDZB
	Air outlet shutter plate	UTR-YDZK UTR-YDZC
	Pressure sensor kit	UTY-SPWX

Exterior	Part name	Model name
	Panel spacer	UTG-BGYA-W UTG-BKXA-W
	Wide panel	UTG-AGYA-W UTG-AKXA-W
	Half concealed kit	UTR-STA
	IR receiver unit	UTY-TRHX
	IR receiver unit	UTB-YWC
	IR receiver unit	UTY-LRHYB1
	IR receiver unit	UTY-LBHxD
	Human sensor kit	UTY-SHZXC
	Remote sensor unit	UTY-XSZX



Exterior	Part name	Model name
<p>Install when the condition under the roof is over 80% in humidity and over 86 °F (30 °C) in temperature.</p>  <p>Insulation kit</p>	Insulation kit for high humidity	UTZ-KXRA UTZ-KXGA UTZ-KXGB UTZ-KXGC
	Fresh air intake kit	UTZ-VXAA
	Fresh air intake kit	UTZ-VXGA UTZ-VXRA
	Auto louver grille kit	UTD-GXTA-W
	Auto louver grille kit	UTD-GXSA-W UTD-GXSB-W
	External power supply unit	UTZ-GXXA

Exterior	Model name
 For Outdoor unit	UTY-XWZXZ6
 For Indoor unit and Central remote controller	UTY-XWZXZ7
 For Central remote controller	UTY-XWZXZ8
 For Outdoor unit	UTY-XWZXZ9
 For Touch panel controller and Central remote controller	UTY-XWZXZA
 For Indoor unit	UTY-XWZXZB
 For Indoor unit	UTY-XWZXZC
 For Indoor unit	UTY-XWZXZD
 For Indoor unit	UTY-XWZXZE
 For Outdoor unit	UTY-XWZXZF



## 2. MODEL SELECTION


# CONTENTS

## 2. MODEL SELECTION

<b>1. Model selection and capacity calculation .....</b>	<b>02-1</b>
1-1. Model selection procedure.....	02-1
1-2. Indoor unit and outdoor unit selection procedure.....	02-2
1-3. Capacity calculation method.....	02-4
1-4. Cooling capacity range of connectable indoor units .....	02-11
1-5. Capacity compensation coefficient .....	02-12
<b>2. Cooling capacity table (Indoor unit) .....</b>	<b>02-14</b>
2-1. Compact cassette type .....	02-14
2-2. 4-way flow cassette type .....	02-16
2-3. Circular flow cassette type.....	02-17
2-4. Mini duct type .....	02-19
2-5. Slim duct/Slim concealed floor type.....	02-20
2-6. Medium static pressure duct type .....	02-22
2-7. High static pressure duct type .....	02-23
2-8. Compact floor type .....	02-25
2-9. Floor/Ceiling type.....	02-27
2-10. Ceiling type.....	02-28
2-11. Wall mounted type.....	02-29
<b>3. Heating capacity table (Indoor unit) .....</b>	<b>02-33</b>
3-1. Compact cassette type .....	02-33
3-2. 4-way flow cassette type .....	02-35
3-3. Circular flow cassette type.....	02-37
3-4. Mini duct type .....	02-39
3-5. Slim duct/Slim concealed floor type.....	02-40
3-6. Medium static pressure duct type .....	02-42
3-7. High static pressure duct type .....	02-43
3-8. Compact floor type .....	02-45
3-9. Floor/Ceiling type.....	02-47
3-10. Ceiling type.....	02-49
3-11. Wall mounted type.....	02-50
<b>4. Cooling capacity table (Outdoor unit) .....</b>	<b>02-54</b>
4-1. Stand-alone .....	02-54
4-2. Combination .....	02-60
<b>5. Heating capacity table (Outdoor unit) .....</b>	<b>02-74</b>
5-1. Stand-alone .....	02-74
5-2. Combination .....	02-83
<b>6. Heating capacity curve (Outdoor unit) .....</b>	<b>02-104</b>
6-1. Stand-alone .....	02-104
6-2. Combination .....	02-106

# 1. Model selection and capacity calculation

## 1-1. Model selection procedure

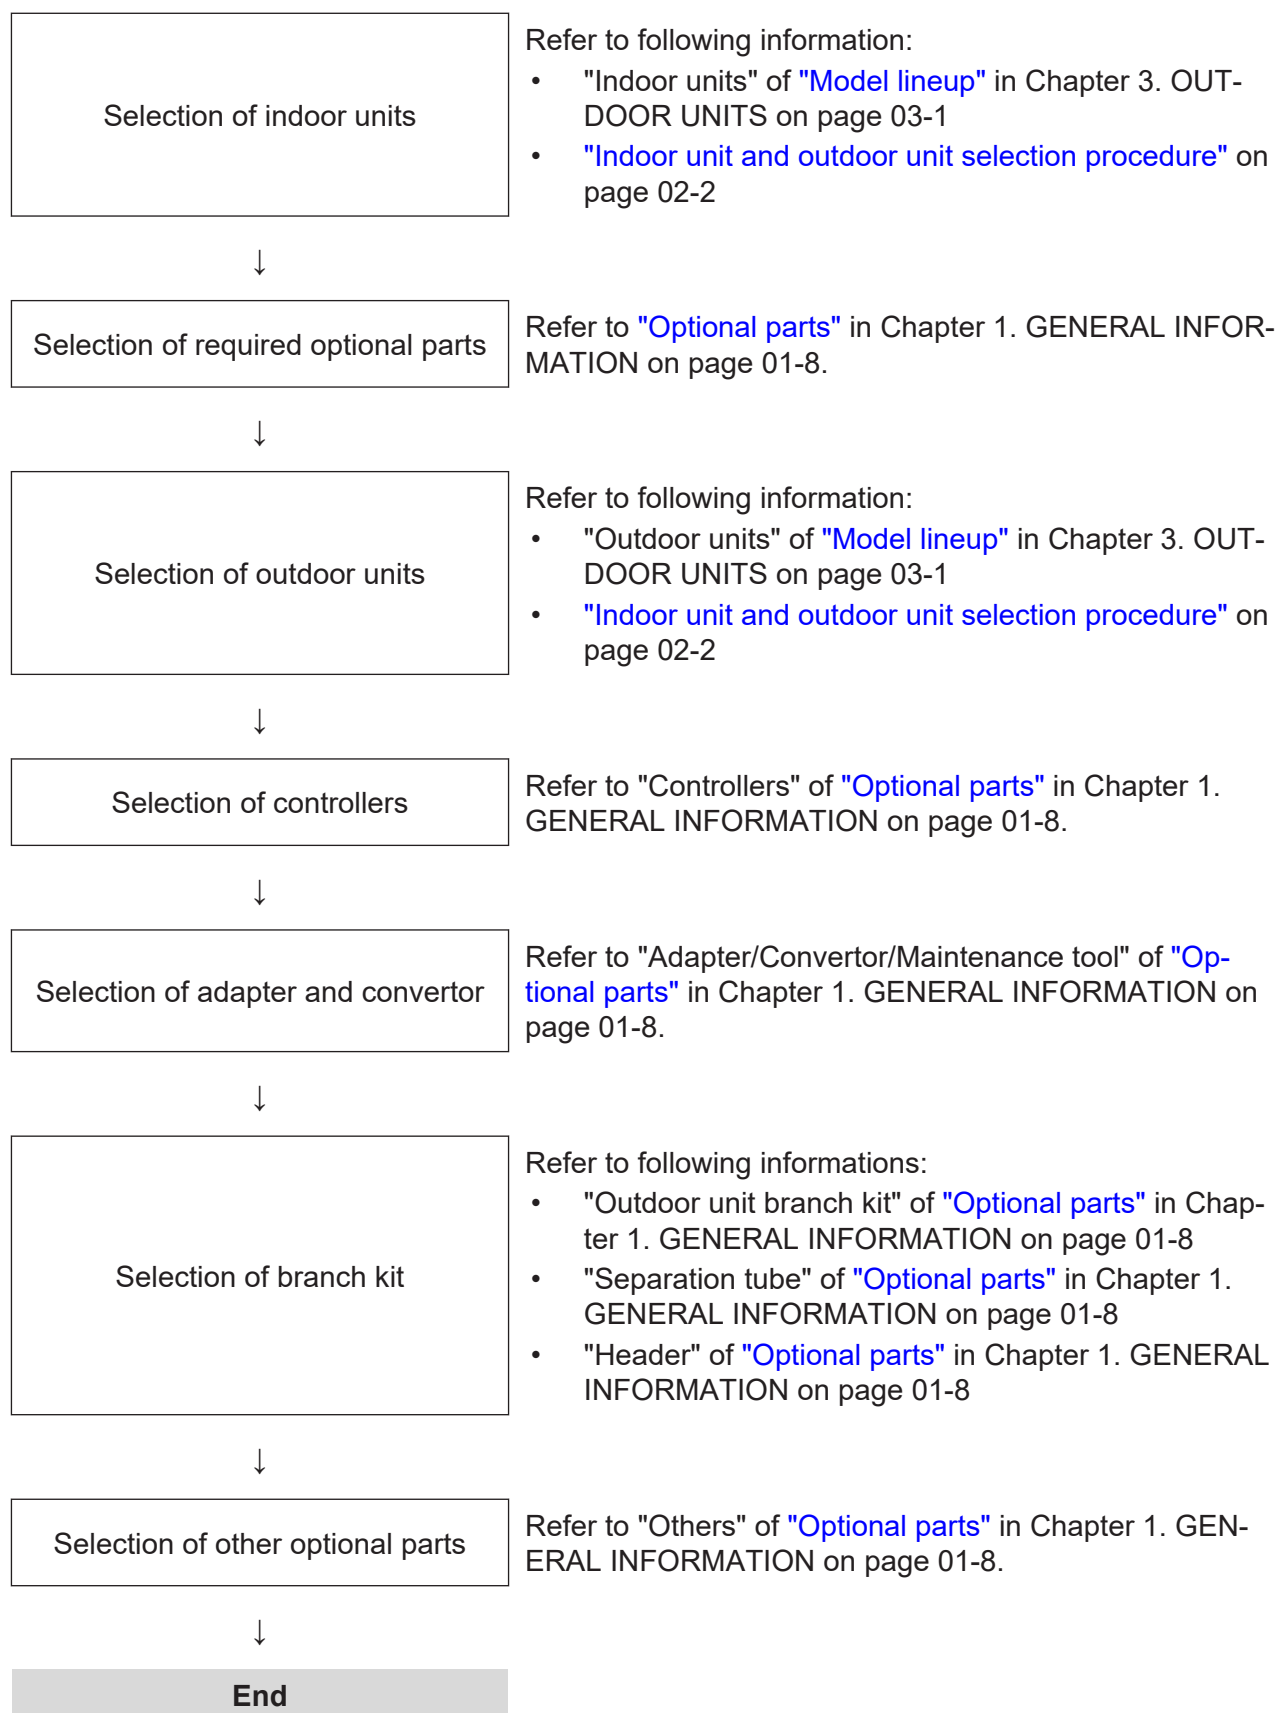

## 1-2. Indoor unit and outdoor unit selection procedure

Confirm the design of indoor and outdoor temperature condition.



Calculate heat load of each room.



Select indoor unit to match the heat load for each room.



[▲]  
Calculate the estimated capacity of each indoor unit.

Refer to "[Capacity calculation method](#)" on page 02-4.



Confirm whether satisfy the following calculation.  
Estimated capacity of indoor unit  $\geq$  heat load

If estimated capacity is lower than heat load, change to larger capacity of indoor unit and return to step marked [▲] and perform the calculation again.



Calculate the total capacity of indoor units at following conditions:

- Rated condition
- Design temperature condition

Calculated total capacity of indoor units: **A**



[▲▲]  
Select outdoor units to match the total capacity of indoor units in the list of stand-alone or combination.  
Confirm the following items:

- Cooling capacity range of connectable indoor units
- Maximum connectable indoor units number

Refer to "[Cooling capacity range of connectable indoor units](#)" on page 02-11.



Calculate the compensated capacity of outdoor units.

Refer to "[Capacity calculation method](#)" on page 02-4.  
Calculated compensated capacity of outdoor units: **B**





Confirm whether satisfy the following calculation.  
Total capacity of indoor units at design temperature  $\geq$  compensated capacity of outdoor units  
( $A \geq B$ )

If **A** is lower than **B**, go to step marked [▼▼▼].



System capacity = **B**



Calculate actual capacity of each indoor unit by dividing system capacity proportionally.

Refer to "[Capacity calculation method](#)" on page 02-4.



Confirm whether satisfy the following calculation.  
Actual capacity of indoor unit  $\geq$  heat load

If actual capacity of indoor unit is lower than heat load, change to larger capacity of outdoor units and return to step marked [▲▲].  
If actual capacity of indoor unit is larger than heat load, procedure is completing.



**End**

[▼▼▼]  
System capacity = **A**



Actual capacity of indoor unit = capacity of indoor unit at design temperature



**End**

## 1-3. Capacity calculation method

The capacity calculation method which takes the effects of air temperature, pipe length, and frosting/defrosting into consideration is shown below.

$(TCin)r$	: Capacity of indoor unit at rated condition
$(TCin)d$	: Capacity of indoor unit at design temperature
$(TCin)e$	: Estimated capacity of indoor unit
$\Sigma(TCin)r$	: Total capacity of indoor units at rated condition
$\Sigma(TCin)d$	: Total capacity of indoor units at design temperature
$(TCout)r$	: Capacity of outdoor unit at rated condition
$(TCout)d$	: Capacity of outdoor unit at design temperature
$(TCout)c$	: Compensated capacity of outdoor unit

### • Estimated capacity of each indoor unit

- Find  $(TCin)r$  and  $(TCin)d$ .  
Refer to "[Cooling capacity table \(Indoor unit\)](#)" on page 02-14 or "[Heating capacity table \(Indoor unit\)](#)" on page 02-33.
- Find the following compensation coefficient.  
Refer to "[Capacity compensation coefficient](#)" on page 02-12.
  - Compensation coefficient of pipe length
  - Compensation coefficient of frosting/defrosting (For heating calculation only)
- Calculate  $(TCin)e$ .
  - Cooling calculation  
 $(TCin)e = (TCin)d \times \text{compensation coefficient of pipe length}$
  - Heating calculation  
 $(TCin)e = (TCin)d \times \text{compensation coefficient of pipe length} \times \text{compensation coefficient of defrosting/frosting}$

- **Compensated capacity of outdoor units**

1. Find  $(TC_{out})r$ .  
Refer to the value marked blue in "Cooling capacity table (Outdoor unit)" on page 02-54 or the value marked orange in "Heating capacity table (Outdoor unit)" on page 02-74.
2. Find the following compensation coefficient.  
Refer to "Capacity compensation coefficient" on page 02-12.
  - Compensation coefficient of pipe length
  - Compensation coefficient of frosting/defrosting (For heating calculation only)
3. Calculate  $\sum(TC_{in})r$ .
4. Calculate the ratio of  $\sum(TC_{in})r$  to  $(TC_{out})r$ .  
Refer to "Cooling capacity range of connectable indoor units" on page 02-11 and confirm whether satisfy the condition.
5. Find  $(TC_{out})d$  using the value of previous step and "Cooling capacity table (Outdoor unit)" on page 02-54 or "Heating capacity table (Outdoor unit)" on page 02-74.
6. Calculate  $(TC_{out})c$ .
  - Cooling calculation  
 $(TC_{out})c = (TC_{out})d \times \text{compensation coefficient of pipe length}$
  - Heating calculation  
 $(TC_{out})c = (TC_{out})d \times \text{compensation coefficient of pipe length} \times \text{compensation coefficient of defrosting/frosting}$

- **System capacity**

1. Calculate  $\sum(TC_{in})d$ .
2. System capacity is the smaller value of  $(TC_{out})c$  and  $\sum(TC_{in})d$ .

- **Actual capacity of each indoor unit**


Calculate actual capacity of each indoor unit by dividing system capacity proportionally.

Actual capacity of indoor unit = (System capacity)  $\times (TC_{in})r / \sum(TC_{in})r$

## ■ Calculation example

### ● Example 1

Design conditions			
Indoor temperature	Outdoor temperature	Pipe length	Height difference
82°FDB/68°F WB (27.8°CDB/20°CWB)	95°FDB (35°CDB)	246 ft (75 m)	65 ft (20 m) Outdoor unit higher side

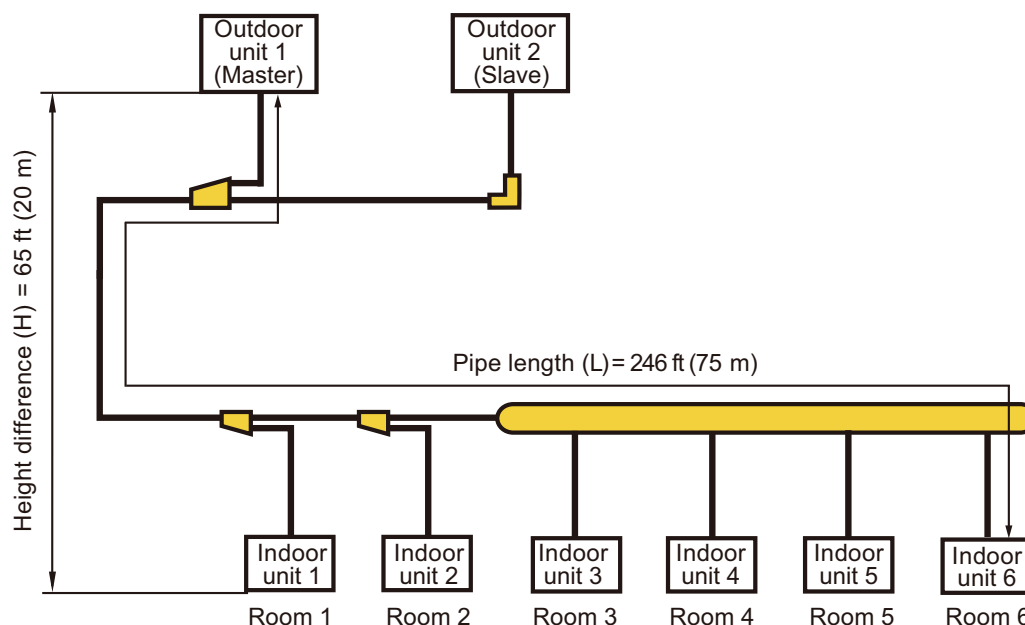

#### • Selection of indoor unit

No	Item		Room						Remark
			1	2	3	4	5	6	
A-1	Cooling heat load	kBtu/h	33.0	33.0	33.0	27.5	27.5	22.0	
A-2	Indoor unit models (Example: AU)		AUUB 36	AUUB 36	AUUB 36	AUUB 30	AUUB 30	AUUB 24	
A-3	$(TCin)r$	kBtu/h	36.0	36.0	36.0	30.0	30.0	24.0	Refer to "Indoor units" of "Outdoor unit and indoor unit lineup" in Chapter 1. GENERAL INFORMATION on page 01-1.
A-4	$(TCin)d$	kBtu/h	37.7	37.7	37.7	31.4	31.4	25.1	Refer to "Cooling capacity table (Indoor unit)" on page 02-14.
A-5	Compensation coefficient of pipe length		0.9						Refer to "Capacity compensation coefficient" on page 02-12.
A-6	$(TCin)e$	kBtu/h	33.9	33.9	33.9	28.3	28.3	22.6	(A-4) × (A-5)
A-7	$\sum(TCin)r$	kBtu/h	192.0						Sum of A-3
A-8	$\sum(TCin)d$	kBtu/h	201.0						Sum of A-4

• Preliminary selection of outdoor unit

No	Item		Value	Remark
B-1	Outdoor unit model		14 Ton: AOUA168RLBVG1	
B-2	$(TC_{out})_r$	kBtu/h	168.0	Refer to the value marked gray in "Cooling capacity table (Outdoor unit)" on page 02-54
B-3	$\sum (TC_{in})_r / (TC_{out})_r$	%	114.3	$(A-7)/(B-2)$
B-4	$(TC_{out})_d$	kBtu/h	177.1	Refer to "Calculation example of 14Ton outdoor units: AOUA168RLBVG1 (AOUA96RLBV1 + AOUA72RLBV1)" on page 02-9.
B-5	Compensation coefficient of pipe length		0.9	Refer to "Capacity compensation coefficient" on page 02-12.
B-6	$(TC_{out})_c$	kBtu/h	159.4	$(B-4) \times (B-5)$

• Decision of system capacity

No	Item		Value	Remark
C-1	System capacity		159.4	Smaller value of (A-8) and (B-6)

• Calculation of actual capacity of each indoor unit

Item		Room						Remark
		1	2	3	4	5	6	
Actual capacity of each indoor unit	kBtu/h	29.9	29.9	29.9	24.9	24.9	19.9	$(C-1) \times (A-3)/(A-7)$

In this calculation example, since the capacities of indoor units are smaller than the cooling heat loads, reselect outdoor units with larger capacity and perform the calculation again.

• Reselection of outdoor unit with larger capacity

No	Item		Value	Remark
B'-1	Outdoor unit model		16 Ton: AOUA192RLBVG1 (AOUA120RLBV1 + AOUA72RLBV1)	
B'-2	$(TC_{out})_r$	kBtu/h	192.0	Refer to the value marked gray in "Cooling capacity table (Outdoor unit)" on page 02-54
B'-3	$\sum(TC_{in})_r / (TC_{out})_r$	%	100.0	(A-7)/(B'-2)
B'-4	$(TC_{out})_d$	kBtu/h	196.4	Refer to "Calculation example of 16Ton outdoor units: AOUA192RLBVG1 (AOUA120RLBV1 + AOUA72RLBV1)" on page 02-10.
B'-5	Compensation coefficient of pipe length		0.90	Refer to "Capacity compensation coefficient" on page 02-12.
B'-6	$(TC_{out})_c$	kBtu/h	176.8	(B'-4) × (B'-5)

• Decision of system capacity


No	Item	Value	Remark
C'-1	System capacity	176.8	Smaller value of (A-8) and (B'-6)

• Calculation of actual capacity of each indoor unit

Item		Room						Remark
		1	2	3	4	5	6	
Actual capacity of each indoor unit	kBtu/h	33.2	33.2	33.2	27.6	27.6	22.1	(C'-1) × (A-3)/(A-7)

**Actual capacity of all indoor units is larger than cooling heat load of each room.**

# Calculation method of outdoor unit capacity from capacity tables

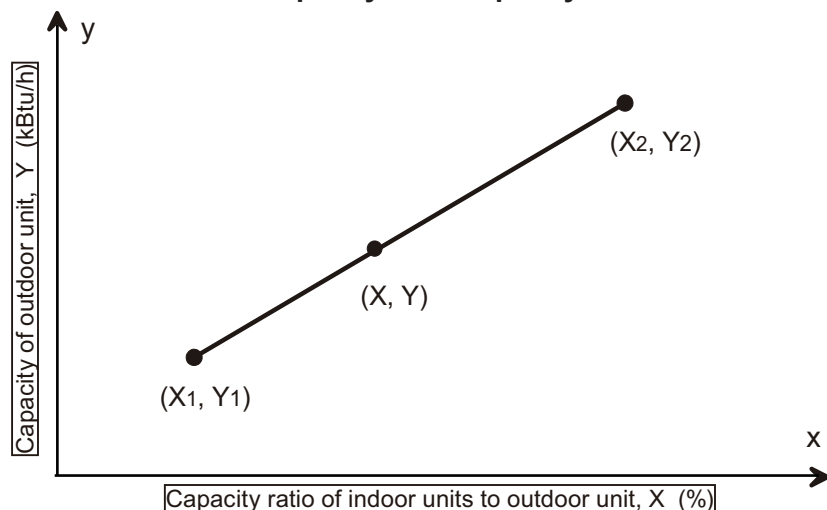

Equation for outdoor unit capacity calculation:  $Y = (Y_2 - Y_1) / (X_2 - X_1) \times (X - X_1) + Y_1$

**NOTE:** Refer to "Cooling capacity table (Outdoor unit)" on page 02-54 to find values of  $Y_1$  and  $Y_2$  using values of  $X_1$  and  $X_2$ .

- Calculation example of 14Ton outdoor units: AOUA168RLBVG1 (AOUA96RLBV1 + AOUA72RLBV1)

Total rated cooling capacity of indoor unit	Outdoor temperature (°FDB)	Indoor temperature									
		68°FDB / 59°F WB		80°FDB / 67°F WB		82°FDB / 68°F WB		86°FDB / 72°F WB		90°FDB / 73°F WB	
		TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
201.6 (120%) $X_2$	50	128.5	7.67	198.0	11.32	200.5	11.31	210.9	11.26	213.5	11.25
	95	128.5	10.17	177.1	14.63	179.1	14.68	187.3	14.88	189.4	14.92
	115	128.5	14.20	158.4	17.63	$Y_2$	17.70	167.8	17.98	169.7	18.05
184.8 (110%) $X_1$	50	117.8	7.10	184.8	10.69	193.3	11.15	205.6	11.29	208.1	11.28
	95	117.8	9.38	173.6	14.55	175.6	14.60	183.6	14.79	185.6	14.84
	115	117.8	12.65	156.5	17.52	$Y_1$	17.59	164.7	17.87	166.6	17.93

Capacity ratio of indoor units to outdoor unit (%)	$X_1 = 110$	$X = 114.3$	$X_2 = 120$
Capacity of outdoor units (kW)	$Y_1 = 175.6$	$Y$	$Y_2 = 179.1$

$$Y = (179.1 - 175.6) / (120 - 110) \times (114.3 - 110) + 175.6 = 177.1 \text{ kBTu/h}$$

- Calculation example of 16Ton outdoor units: AOUA192RLBVG1 (AOUA120RLBV1 + AOUA72RLBV1)

Total rated cooling capacity of indoor unit	Outdoor temperature (°DFB)	Indoor temperature									
		68°FDB / 59 °FWB		80°FDB / 67 °FWB		82°FDB / 68 °FWB		86°FDB / 72 °FWB		90°FDB / 73 °FWB	
		TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
211.2 (110%)	50	134.6	8.01	211.2	12.08	220.9	12.59	235.4	12.79	238.4	12.77
	.	.	.	.	.	.	.	.	.	.	.
	95	134.6	10.59	198.7	16.49	201.0	16.55	210.2	16.77	212.5	16.82
	115	134.6	14.30	178.0	19.87	180.2	19.95	188.6	20.26	190.7	20.34
192.0 (100%) X <sub>1</sub>	50	122.4	7.36	192.0	11.06	200.8	11.52	228.6	12.82	231.4	12.81
	.	.	.	.	.	.	.	.	.	.	.
	95	122.4	9.71	192.0	16.04	196.4	16.43	205.3	16.65	207.5	16.71
	115	122.4	12.66	174.2	19.73	Y <sub>1</sub>	19.81	184.5	20.11	186.6	20.19

Capacity ration of indoor units to outdoor unit (%)	X = 100
Capacity of outdoor units (kW)	Y = 196.4

$$Y = Y_1 = 196.4 \text{ kBTu/h}$$



# 1-4. Cooling capacity range of connectable indoor units

## RELATED LINKS

"Refrigerant system" in Chapter 6. SYSTEM DESIGN on page 06-1

### ■ Stand-alone

Ton	Capacity (Btu/h)		Set model name	Ton			Connectable indoor unit	
	Cooling	Heating		Unit 1	Unit 2	Unit 3	Maximum number	Cooling capacity range (Btu/h)*
6	72,000	81,000	AOUA72RLBV1	6	—	—	16	36,000 to 108,000
8	96,000	108,000	AOUA96RLBV1	8	—	—	21	48,000 to 144,000
10	120,000	135,000	AOUA120RLBV1	10	—	—	26	60,000 to 180,000

\*: For conditions for cooling capacity of connectable indoor unit, refer to "Refrigerant system" in Chapter 6. SYSTEM DESIGN on page 06-1.

### ■ Combination

Ton	Capacity (Btu/h)		Set model name	Ton			Connectable indoor unit	
	Cooling	Heating		Unit 1	Unit 2	Unit 3	Maximum number	Cooling capacity range (Btu/h)*
12	144,000	162,000	AOUA144RLBV G1	6	6	—	32	72,000 to 216,000
14	168,000	188,000	AOUA168RLBV G1	8	6	—	37	84,000 to 252,000
16	192,000	216,000	AOUA192RLBV G1	10	6	—	42	96,000 to 288,000
18	216,000	243,000	AOUA216RLBV G1	10	8	—	47	108,000 to 324,000
20	240,000	270,000	AOUA240RLBV G1	10	10	—	52	120,000 to 360,000
22	264,000	297,000	AOUA264RLBV G1	8	8	6	58	132,000 to 396,000
24	288,000	324,000	AOUA288RLBV G1	8	8	8	63	144,000 to 432,000


\*: For conditions for cooling capacity of connectable indoor unit, refer to "Refrigerant system" in Chapter 6. SYSTEM DESIGN on page 06-1.

# 1-5. Capacity compensation coefficient


## ■ Compensation coefficient of pipe length

The figures give the compensation coefficient of pipe length owing to installation position (pipe length and height difference). Pipe length and height difference are the length and the height difference between master outdoor unit and indoor unit.

### • Cooling

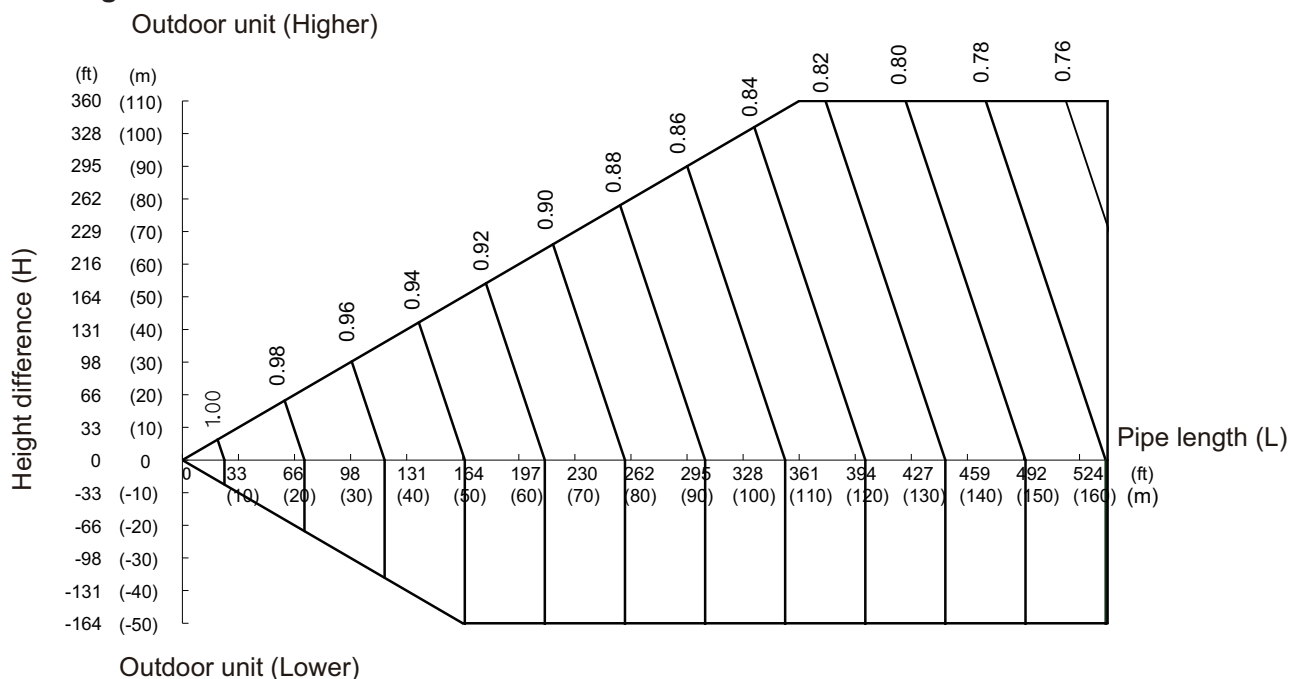

### • Heating

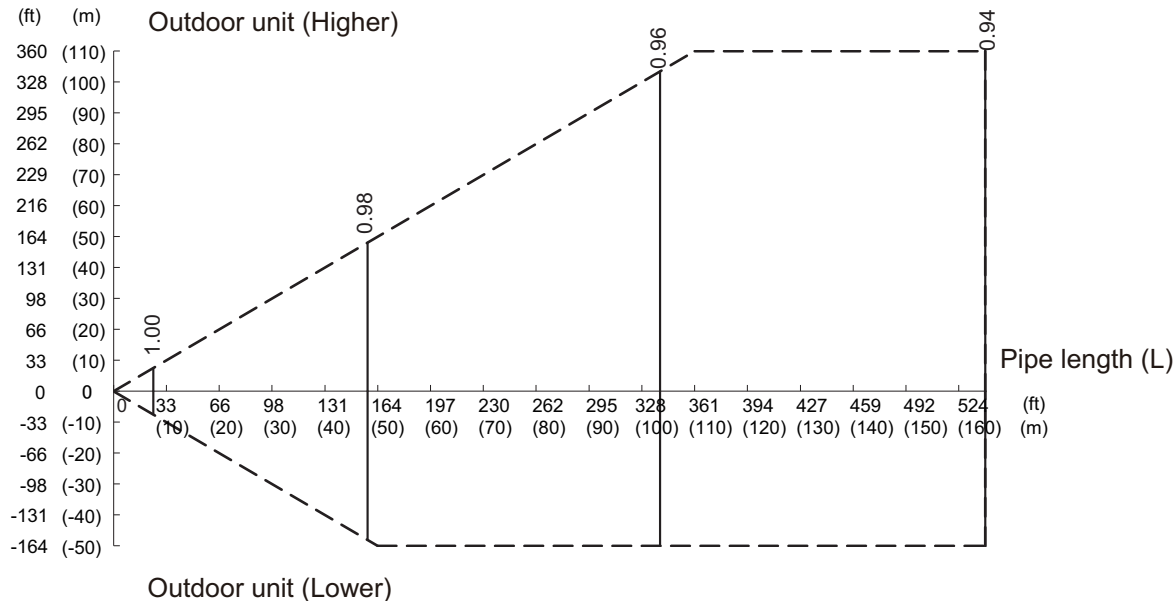

## ■ Compensation coefficient of frosting/defrosting (Heating operation)

To take the effects of accumulated frost and defrosting operation on heating capacity into consideration, the capacity of outdoor units should be corrected by compensation coefficient shown in the table below.

Outdoor temperature	°FDB/ °FWB	5/3	16/14	19/18	23/21	27/25	32/30	36/34	41/39	45/43
	°CDB/ °CWB	-15/-16	-9/-10	-7/-8	-5/-6	-3/-4	0/-1	2/1	5/4	7/6
Compensation coefficient		0.96	0.94	0.92	0.89	0.86	0.83	0.84	0.90	1.00

## 2. Cooling capacity table (Indoor unit)

- TC: Total capacity (kBtu/h)
- SHC: Sensible heat capacity (kBtu/h)
- Values mentioned in the table are the values when the indoor unit's total rated capacity is 100% of the outdoor unit capacity.

### 2-1. Compact cassette type

#### ■ Model: AUUA4TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.9	3.3	5.1	3.6
59	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.9	3.3	5.1	3.6
70	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.9	3.3	5.1	3.6
73	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.9	3.3	5.1	3.6
77	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.9	3.3	5.0	3.6
81	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.9	3.2	4.9	3.6
86	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.8	3.2	4.8	3.5
91	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.7	3.2	4.7	3.5
95	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.6	3.1	4.6	3.5
99	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.5	3.1	4.5	3.4
104	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.2	3.1	4.4	3.1	4.4	3.4
109	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	4.0	3.0	4.1	3.1	4.3	3.0	4.3	3.4
115	2.5	2.1	2.9	2.6	3.3	2.7	3.5	3.1	3.9	3.0	4.0	3.1	4.2	3.0	4.2	3.3

#### ■ Model: AUUA7TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.6	7.0
59	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.6	7.0
70	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.6	7.0
73	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.5	7.0
77	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.4	6.9
81	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.1	6.2	9.2	6.9
86	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.9	6.1	9.0	6.8
91	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.7	6.1	8.8	6.7
95	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.6	6.0	8.7	6.7
99	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.4	6.0	8.5	6.6
104	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.2	5.9	8.3	6.6
109	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.7	6.0	8.0	5.8	8.1	6.5
115	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.4	5.7	7.5	5.9	7.8	5.7	7.9	6.4

#### ■ Model: AUUA9TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
59	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
70	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
73	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
77	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.7	7.2	11.9	7.9
81	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.5	7.2	11.7	7.8
86	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.3	7.1	11.4	7.7
91	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	11.1	7.0	11.2	7.6
95	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	10.9	6.9	11.0	7.6
99	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	10.7	6.8	10.8	7.5
104	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.9	6.9	10.4	6.7	10.5	7.4
109	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.5	6.6	9.7	6.8	10.2	6.7	10.3	7.3
115	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.8	9.3	6.5	9.4	6.7	9.9	6.5	10.0	7.2

## Model: AUUA12TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.3	10.3
59	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.3	10.3
70	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.3	10.3
73	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.2	10.3
77	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.0	10.2
81	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.6	9.2	14.7	10.1
86	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.3	9.1	14.4	10.0
91	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.0	9.0	14.1	9.9
95	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	13.7	8.9	13.9	9.8
99	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	13.5	8.8	13.6	9.7
104	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	13.2	8.7	13.3	9.6
109	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.3	8.8	12.8	8.6	13.0	9.5
115	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	11.8	8.4	11.9	8.7	12.5	8.4	12.6	9.3

## Model: AUUA14TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	17.2	10.7	17.9	11.9
59	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	17.2	10.7	17.9	11.9
70	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	17.2	10.7	17.9	11.9
73	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	17.2	10.7	17.8	11.8
77	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	17.2	10.7	17.5	11.7
81	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	17.0	10.6	17.2	11.6
86	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	16.7	10.5	16.8	11.5
91	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	16.3	10.4	16.5	11.4
95	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	16.0	10.3	16.2	11.2
99	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	15.7	10.2	15.9	11.1
104	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.6	10.3	15.4	10.0	15.5	11.0
109	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	14.0	9.8	14.4	10.1	15.0	9.9	15.1	10.9
115	8.9	7.0	10.2	8.4	11.4	8.8	12.1	10.0	13.8	9.7	13.9	10.0	14.5	9.7	14.7	10.7

## Model: AUUA18TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	22.1	13.2	23.0	14.6
59	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	22.1	13.2	23.0	14.6
70	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	22.1	13.2	23.0	14.6
73	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	22.1	13.2	22.8	14.5
77	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	22.1	13.2	22.5	14.4
81	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	21.9	13.1	22.1	14.2
86	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	21.4	12.9	21.6	14.0
91	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	21.0	12.7	21.2	13.9
95	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	20.6	12.6	20.8	13.7
99	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	20.2	12.4	20.4	13.6
104	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.8	12.6	19.7	12.3	19.9	13.4
109	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	18.0	12.0	18.5	12.4	19.3	12.1	19.5	13.2
115	11.4	8.5	13.1	10.3	14.7	10.8	15.5	12.2	17.7	11.9	17.9	12.2	18.7	11.9	18.9	13.0

## Model: AUUA24TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	29.5	18.1	30.6	20.1
59	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	29.5	18.1	30.6	20.1
70	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	29.5	18.1	30.6	20.1
73	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	29.5	18.1	30.5	20.0
77	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	29.5	18.1	30.0	19.8
81	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	29.2	18.0	29.5	19.6
86	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	28.6	17.8	28.9	19.4
91	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	27.9	17.5	28.2	19.2
95	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	27.5	17.3	27.7	19.0
99	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	27.0	17.1	27.2	18.8
104	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	25.1	17.3	26.3	16.9	26.6	18.5
109	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	24.0	16.5	24.6	17.1	25.7	16.7	26.0	18.3
115	15.2	11.8	17.4	14.2	19.6	14.9	20.7	16.9	23.6	16.3	23.8	16.8	24.9	16.4	25.2	18.0

## 2-2. 4-way flow cassette type

### Model: AUUB18TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	22.1	15.5	23.0	17.4
59	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	22.1	15.5	23.0	17.4
70	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	22.1	15.5	23.0	17.4
73	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	22.1	15.5	22.8	17.4
77	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	22.1	15.5	22.5	17.3
81	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	21.9	15.5	22.1	17.1
86	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	21.4	15.3	21.6	17.0
91	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	21.0	15.1	21.2	16.8
95	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	20.6	15.0	20.8	16.7
99	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	20.2	14.9	20.4	16.6
104	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.8	15.0	19.7	14.7	19.9	16.4
109	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	18.0	14.3	18.5	14.9	19.3	14.6	19.5	16.3
115	11.4	10.2	13.1	12.5	14.7	13.0	15.5	15.0	17.7	14.2	17.9	14.7	18.7	14.4	18.9	16.1

### Model: AUUB24TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	29.5	19.5	30.6	21.8
59	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	29.5	19.5	30.6	21.8
70	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	29.5	19.5	30.6	21.8
73	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	29.5	19.5	30.5	21.7
77	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	29.5	19.5	30.0	21.6
81	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	29.2	19.4	29.5	21.4
86	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	28.6	19.2	28.9	21.2
91	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	27.9	19.0	28.2	21.0
95	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	27.5	18.8	27.7	20.8
99	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	27.0	18.6	27.2	20.6
104	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	25.1	18.8	26.3	18.4	26.6	20.4
109	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	24.0	17.9	24.6	18.6	25.7	18.2	26.0	20.2
115	15.2	12.8	17.4	15.6	19.6	16.2	20.7	18.6	23.6	17.7	23.8	18.3	24.9	17.9	25.2	19.9

### Model: AUUB30TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	36.9	24.4	38.3	27.3
59	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	36.9	24.4	38.3	27.3
70	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	36.9	24.4	38.3	27.3
73	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	36.9	24.4	38.1	27.2
77	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	36.9	24.4	37.5	27.0
81	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	36.5	24.3	36.8	26.8
86	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	35.7	24.0	36.1	26.5
91	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	34.9	23.7	35.3	26.2
95	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	34.3	23.5	34.7	26.0
99	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	33.7	23.3	34.0	25.8
104	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	31.4	23.5	32.9	23.0	33.2	25.5
109	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	30.0	22.4	30.8	23.3	32.1	22.7	32.4	25.2
115	19.0	16.0	21.8	19.5	24.5	20.2	25.9	23.3	29.5	22.2	29.8	22.9	31.1	22.4	31.5	24.9

### Model: AUUB36TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	44.2	28.5	45.9	31.7
59	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	44.2	28.5	45.9	31.7
70	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	44.2	28.5	45.9	31.7
73	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	44.2	28.5	45.7	31.6
77	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	44.2	28.5	44.9	31.4
81	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	43.8	28.3	44.2	31.1
86	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	42.8	28.0	43.3	30.8
91	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	41.9	27.7	42.4	30.4
95	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	41.2	27.4	41.6	30.1
99	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	40.4	27.1	40.9	29.9
104	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	37.7	27.4	39.5	26.8	39.9	29.5
109	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	36.0	26.1	36.9	27.1	38.5	26.4	38.9	29.2
115	22.8	18.6	26.1	22.6	29.4	23.5	31.1	27.0	35.4	25.8	35.8	26.7	37.4	26.0	37.8	28.8

## 2-3. Circular flow cassette type

### Model: AUUB18TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	22.1	14.8	23.0	16.6
59	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	22.1	14.8	23.0	16.6
70	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	22.1	14.8	23.0	16.6
73	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	22.1	14.8	22.8	16.5
77	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	22.1	14.8	22.5	16.4
81	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	21.9	14.8	22.1	16.3
86	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	21.4	14.6	21.6	16.1
91	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	21.0	14.4	21.2	16.0
95	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	20.6	14.3	20.8	15.8
99	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	20.2	14.2	20.4	15.7
104	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.8	14.3	19.7	14.0	19.9	15.5
109	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	18.0	13.6	18.5	14.2	19.3	13.8	19.5	15.4
115	11.4	9.7	13.1	11.9	14.7	12.3	15.5	14.2	17.7	13.5	17.9	14.0	18.7	13.6	18.9	15.2

### Model: AUUB24TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	29.5	18.1	30.6	20.0
59	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	29.5	18.1	30.6	20.0
70	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	29.5	18.1	30.6	20.0
73	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	29.5	18.1	30.5	19.9
77	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	29.5	18.1	30.0	19.7
81	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	29.2	17.9	29.5	19.5
86	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	28.6	17.7	28.9	19.3
91	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	27.9	17.5	28.2	19.1
95	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	27.5	17.3	27.7	18.9
99	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	27.0	17.1	27.2	18.7
104	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	25.1	17.3	26.3	16.8	26.6	18.4
109	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	24.0	16.4	24.6	17.0	25.7	16.6	26.0	18.2
115	15.2	11.7	17.4	14.2	19.6	14.8	20.7	16.8	23.6	16.3	23.8	16.7	24.9	16.3	25.2	17.9

### Model: AUUB30TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	36.9	23.4	38.3	26.0
59	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	36.9	23.4	38.3	26.0
70	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	36.9	23.4	38.3	26.0
73	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	36.9	23.4	38.1	26.0
77	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	36.9	23.4	37.5	25.7
81	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	36.5	23.3	36.8	25.5
86	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	35.7	23.0	36.1	25.2
91	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	34.9	22.7	35.3	25.0
95	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	34.3	22.5	34.7	24.7
99	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	33.7	22.3	34.0	24.5
104	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	31.4	22.5	32.9	22.0	33.2	24.2
109	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	30.0	21.4	30.8	22.3	32.1	21.7	32.4	23.9
115	19.0	15.3	21.8	18.6	24.5	19.3	25.9	22.1	29.5	21.2	29.8	21.9	31.1	21.3	31.5	23.6

### Model: AUUB36TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	44.2	27.1	45.9	29.9
59	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	44.2	27.1	45.9	29.9
70	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	44.2	27.1	45.9	29.9
73	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	44.2	27.1	45.7	29.8
77	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	44.2	27.1	44.9	29.6
81	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	43.8	26.9	44.2	29.3
86	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	42.8	26.5	43.3	28.9
91	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	41.9	26.2	42.4	28.6
95	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	41.2	25.9	41.6	28.3
99	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	40.4	25.6	40.9	28.0
104	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	37.7	25.9	39.5	25.2	39.9	27.7
109	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	36.0	24.7	36.9	25.6	38.5	24.9	38.9	27.3
115	22.8	17.5	26.1	21.2	29.4	22.2	31.1	25.3	35.4	24.4	35.8	25.1	37.4	24.5	37.8	26.9

# Model: AUUB48TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	59.0	36.2	61.2	40.1
59	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	59.0	36.2	61.2	40.1
70	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	59.0	36.2	61.2	40.1
73	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	59.0	36.2	60.9	40.0
77	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	59.0	36.2	59.9	39.6
81	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	58.4	36.0	58.9	39.2
86	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	57.1	35.5	57.7	38.7
91	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	55.9	35.0	56.5	38.3
95	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	54.9	34.7	55.5	37.9
99	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	53.9	34.3	54.5	37.5
104	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	50.2	34.7	52.6	33.8	53.2	37.1
109	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	48.0	33.0	49.2	34.2	51.4	33.3	51.9	36.6
115	30.4	23.5	34.8	28.5	39.2	29.7	41.4	33.9	47.2	32.7	47.7	33.6	49.8	32.8	50.4	36.0

MODEL  
SELECTIONMODEL  
SELECTION



## 2-4. Mini duct type

### ■ Model: ARUL4TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.9	3.1	5.1	3.5
59	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.9	3.1	5.1	3.5
70	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.9	3.1	5.1	3.5
73	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.9	3.1	5.1	3.5
77	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.9	3.1	5.0	3.5
81	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.9	3.1	4.9	3.4
86	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.8	3.1	4.8	3.4
91	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.7	3.0	4.7	3.3
95	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.6	3.0	4.6	3.3
99	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.5	3.0	4.5	3.3
104	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.2	3.0	4.4	2.9	4.4	3.2
109	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	4.0	2.9	4.1	3.0	4.3	2.9	4.3	3.2
115	2.5	2.0	2.9	2.5	3.3	2.6	3.5	3.0	3.9	2.8	4.0	2.9	4.2	2.9	4.2	3.2

## 2-5. Slim duct/Slim concealed floor type

### Model: ARUL7TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	9.2	6.3	9.6	7.1
59	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	9.2	6.3	9.6	7.1
70	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	9.2	6.3	9.6	7.1
73	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	9.2	6.3	9.5	7.0
77	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	9.2	6.3	9.4	7.0
81	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	9.1	6.3	9.2	6.9
86	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	8.9	6.2	9.0	6.9
91	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	8.7	6.1	8.8	6.8
95	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	8.6	6.1	8.7	6.7
99	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	8.4	6.0	8.5	6.7
104	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.8	6.1	8.2	6.0	8.3	6.6
109	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.5	5.8	7.7	6.0	8.0	5.9	8.1	6.6
115	4.8	4.1	5.4	5.1	6.1	5.2	6.5	6.0	7.4	5.7	7.5	5.9	7.8	5.8	7.9	6.5

### Model: ARUL9TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.7	7.5	12.1	8.3
59	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.7	7.5	12.1	8.3
70	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.7	7.5	12.1	8.3
73	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.7	7.5	12.1	8.3
77	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.7	7.5	11.9	8.2
81	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.5	7.4	11.7	8.1
86	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.3	7.3	11.4	8.1
91	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	11.1	7.2	11.2	8.0
95	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	10.9	7.2	11.0	7.9
99	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	10.7	7.1	10.8	7.8
104	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.9	7.2	10.4	7.0	10.5	7.7
109	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.5	6.8	9.7	7.1	10.2	6.9	10.3	7.6
115	6.0	4.9	6.9	5.9	7.8	6.2	8.2	7.1	9.3	6.8	9.4	7.0	9.9	6.8	10.0	7.5

### Model: ARUL12TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.3	10.3
59	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.3	10.3
70	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.3	10.3
73	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.2	10.3
77	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.7	9.3	15.0	10.2
81	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.6	9.2	14.7	10.1
86	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.3	9.1	14.4	10.0
91	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	14.0	9.0	14.1	9.9
95	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	13.7	8.9	13.9	9.8
99	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	13.5	8.8	13.6	9.7
104	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.6	8.9	13.2	8.7	13.3	9.6
109	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.5	12.3	8.8	12.8	8.6	13.0	9.5
115	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	11.8	8.4	11.9	8.7	12.5	8.4	12.6	9.3

### Model: ARUL14TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	17.2	11.5	17.9	12.8
59	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	17.2	11.5	17.9	12.8
70	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	17.2	11.5	17.9	12.8
73	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	17.2	11.5	17.8	12.8
77	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	17.2	11.5	17.5	12.7
81	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	17.0	11.4	17.2	12.6
86	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	16.7	11.3	16.8	12.4
91	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	16.3	11.1	16.5	12.3
95	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	16.0	11.0	16.2	12.2
99	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	15.7	10.9	15.9	12.1
104	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.6	11.1	15.4	10.8	15.5	12.0
109	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	14.0	10.5	14.4	10.9	15.0	10.7	15.1	11.8
115	8.9	7.5	10.2	9.2	11.4	9.5	12.1	10.9	13.8	10.4	13.9	10.8	14.5	10.5	14.7	11.7

# Model: ARUL18TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	22.1	14.2	23.0	15.8
59	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	22.1	14.2	23.0	15.8
70	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	22.1	14.2	23.0	15.8
73	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	22.1	14.2	22.8	15.7
77	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	22.1	14.2	22.5	15.6
81	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	21.9	14.1	22.1	15.4
86	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	21.4	13.9	21.6	15.3
91	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	21.0	13.7	21.2	15.1
95	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	20.6	13.6	20.8	15.0
99	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	20.2	13.5	20.4	14.8
104	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.8	13.6	19.7	13.3	19.9	14.7
109	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	13.0	18.5	13.5	19.3	13.1	19.5	14.5
115	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	17.7	12.8	17.9	13.2	18.7	12.9	18.9	14.3

MODEL  
SELECTIONMODEL  
SELECTION

## 2-6. Medium static pressure duct type

### Model: ARUM24TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	29.5	18.8	30.6	20.9
59	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	29.5	18.8	30.6	20.9
70	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	29.5	18.8	30.6	20.9
73	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	29.5	18.8	30.5	20.9
77	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	29.5	18.8	30.0	20.7
81	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	29.2	18.7	29.5	20.5
86	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	28.6	18.5	28.9	20.3
91	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	27.9	18.3	28.2	20.1
95	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	27.5	18.1	27.7	19.9
99	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	27.0	17.9	27.2	19.7
104	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	25.1	18.1	26.3	17.7	26.6	19.5
109	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	24.0	17.2	24.6	17.9	25.7	17.4	26.0	19.2
115	15.2	12.3	17.4	14.9	19.6	15.5	20.7	17.8	23.6	17.0	23.8	17.6	24.9	17.1	25.2	19.0

### Model: ARUM30TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	36.9	21.7	38.3	23.9
59	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	36.9	21.7	38.3	23.9
70	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	36.9	21.7	38.3	23.9
73	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	36.9	21.7	38.1	23.8
77	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	36.9	21.7	37.5	23.6
81	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	36.5	21.6	36.8	23.3
86	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	35.7	21.3	36.1	23.0
91	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	34.9	21.0	35.3	22.7
95	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	34.3	20.7	34.7	22.5
99	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	33.7	20.5	34.0	22.2
104	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	31.4	20.7	32.9	20.1	33.2	21.9
109	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	30.0	19.7	30.8	20.4	32.1	19.8	32.4	21.6
115	19.0	14.0	21.8	16.9	24.5	17.7	25.9	20.0	29.5	19.5	29.8	20.0	31.1	19.5	31.5	21.2

### Model: ARUM36TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	44.2	27.7	45.9	30.8
59	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	44.2	27.7	45.9	30.8
70	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	44.2	27.7	45.9	30.8
73	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	44.2	27.7	45.7	30.7
77	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	44.2	27.7	44.9	30.4
81	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	43.8	27.6	44.2	30.1
86	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	42.8	27.2	43.3	29.8
91	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	41.9	26.9	42.4	29.4
95	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	41.2	26.6	41.6	29.2
99	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	40.4	26.3	40.9	28.9
104	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	37.7	26.6	39.5	25.9	39.9	28.5
109	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	36.0	25.3	36.9	26.3	38.5	25.6	38.9	28.2
115	22.8	18.0	26.1	21.9	29.4	22.8	31.1	26.1	35.4	25.1	35.8	25.8	37.4	25.2	37.8	27.8

## 2-7. High static pressure duct type

### Model: ARUH36TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	44.2	27.9	45.9	30.9
59	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	44.2	27.9	45.9	30.9
70	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	44.2	27.9	45.9	30.9
73	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	44.2	27.9	45.7	30.9
77	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	44.2	27.9	44.9	30.6
81	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	43.8	27.7	44.2	30.3
86	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	42.8	27.4	43.3	30.0
91	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	41.9	27.0	42.4	29.6
95	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	41.2	26.7	41.6	29.3
99	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	40.4	26.5	40.9	29.1
104	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	37.7	26.7	39.5	26.1	39.9	28.7
109	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	36.0	25.5	36.9	26.4	38.5	25.8	38.9	28.4
115	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.2	35.4	25.2	35.8	26.0	37.4	25.3	37.8	28.0

### Model: ARUH48TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	59.0	37.2	61.2	41.3
59	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	59.0	37.2	61.2	41.3
70	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	59.0	37.2	61.2	41.3
73	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	59.0	37.2	60.9	41.1
77	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	59.0	37.2	59.9	40.8
81	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	58.4	36.9	58.9	40.4
86	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	57.1	36.5	57.7	39.9
91	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	55.9	36.0	56.5	39.5
95	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	54.9	35.6	55.5	39.1
99	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	53.9	35.3	54.5	38.8
104	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	50.2	35.7	52.6	34.8	53.2	38.3
109	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	48.0	33.9	49.2	35.2	51.4	34.3	51.9	37.8
115	30.4	24.2	34.8	29.4	39.2	30.6	41.4	35.0	47.2	33.6	47.7	34.6	49.8	33.8	50.4	37.3

### Model: ARUH60TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	73.7	48.4	76.5	53.9
59	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	73.7	48.4	76.5	53.9
70	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	73.7	48.4	76.5	53.9
73	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	73.7	48.4	76.1	53.8
77	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	73.7	48.4	74.9	53.3
81	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	72.9	48.1	73.7	52.9
86	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	71.4	47.5	72.1	52.3
91	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	69.9	47.0	70.6	51.8
95	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	68.6	46.5	69.3	51.3
99	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	67.4	46.1	68.1	50.9
104	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	62.8	46.6	65.8	45.5	66.5	50.4
109	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	60.0	44.3	61.5	46.1	64.2	44.9	64.9	49.8
115	38.1	31.6	43.5	38.6	49.0	40.0	51.8	46.0	59.0	43.9	59.6	45.3	62.3	44.2	62.9	49.1

### Model: ARUH72TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	88.5	54.0	91.8	59.7
59	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	88.5	54.0	91.8	59.7
70	45.7	34.9	52.2	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	88.5	54.0	91.8	59.7
73	45.7	34.9	52.2	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	88.5	54.0	91.4	59.5
77	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	88.5	54.0	89.9	58.9
81	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	87.5	53.6	88.4	58.4
86	45.7	34.9	52.2	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	85.7	52.9	86.6	57.7
91	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	83.8	52.2	84.7	57.0
95	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	82.4	51.6	83.2	56.4
99	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	80.9	51.0	81.7	55.8
104	45.7	34.9	52.2	42.3	58.8	44.2	62.2	50.3	72.0	49.2	75.3	51.6	79.0	50.3	79.8	55.1
109	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	72.0	49.2	73.8	51.0	77.0	49.6	77.9	54.4
115	45.7	34.9	52.3	42.3	58.8	44.2	62.2	50.3	70.7	48.6	71.5	50.0	74.7	48.7	75.5	53.5

# Model: ARUH96TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	118.0	70.7	122.4	77.9
59	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	118.0	70.7	122.4	77.9
70	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	118.0	70.7	122.4	77.9
73	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	118.0	70.7	121.8	77.7
77	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	118.0	70.7	119.9	76.9
81	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	116.7	70.2	117.9	76.1
86	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	114.2	69.2	115.4	75.2
91	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	111.8	68.2	112.9	74.2
95	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	109.8	67.4	110.9	73.4
99	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	107.8	66.7	108.9	72.6
104	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	100.4	67.4	105.3	65.7	106.4	71.7
109	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	96.0	64.2	98.4	66.5	102.7	64.7	103.8	70.7
115	60.9	45.6	69.7	55.0	78.4	57.6	82.9	65.4	94.3	63.5	95.4	65.3	99.6	63.5	100.7	69.6

MODEL  
SELECTIONMODEL  
SELECTION

## 2-8. Compact floor type

### Model: AGUA4TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.9	3.1	5.1	3.4
59	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.9	3.1	5.1	3.4
70	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.9	3.1	5.1	3.4
73	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.9	3.1	5.1	3.4
77	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.9	3.1	5.0	3.4
81	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.9	3.1	4.9	3.3
86	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.8	3.0	4.8	3.3
91	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.7	3.0	4.7	3.3
95	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.6	3.0	4.6	3.2
99	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.5	2.9	4.5	3.2
104	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	3.0	4.4	2.9	4.4	3.2
109	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.1	2.9	4.3	2.8	4.3	3.1
115	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	3.9	2.8	4.0	2.9	4.2	2.8	4.2	3.1

### Model: AGUA7TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	9.2	5.7	9.6	6.2
59	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	9.2	5.7	9.6	6.2
70	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	9.2	5.7	9.6	6.2
73	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	9.2	5.7	9.5	6.2
77	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	9.2	5.7	9.4	6.2
81	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	9.1	5.6	9.2	6.1
86	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	8.9	5.5	9.0	6.0
91	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	8.7	5.5	8.8	6.0
95	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	8.6	5.4	8.7	5.9
99	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	8.4	5.3	8.5	5.8
104	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.8	5.4	8.2	5.3	8.3	5.8
109	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.5	5.1	7.7	5.3	8.0	5.2	8.1	5.7
115	4.8	3.7	5.4	4.4	6.1	4.6	6.5	5.3	7.4	5.1	7.5	5.2	7.8	5.1	7.9	5.6

### Model: AGUA9TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
59	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
70	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
73	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.7	7.2	12.1	8.0
77	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.7	7.2	11.9	7.9
81	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.5	7.2	11.7	7.8
86	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.3	7.1	11.4	7.7
91	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	11.1	7.0	11.2	7.6
95	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	10.9	6.9	11.0	7.5
99	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	10.7	6.8	10.8	7.5
104	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.9	6.9	10.4	6.7	10.5	7.4
109	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.5	6.6	9.7	6.8	10.2	6.6	10.3	7.3
115	6.0	4.7	6.9	5.7	7.8	5.9	8.2	6.7	9.3	6.5	9.4	6.7	9.9	6.5	10.0	7.2

### Model: AGUA12TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.7	9.4	15.3	10.4
59	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.7	9.4	15.3	10.4
70	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.7	9.4	15.3	10.4
73	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.7	9.4	15.2	10.4
77	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.7	9.4	15.0	10.3
81	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.6	9.3	14.7	10.2
86	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.3	9.2	14.4	10.1
91	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	14.0	9.1	14.1	10.0
95	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	13.7	9.0	13.9	9.9
99	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	13.5	8.9	13.6	9.8
104	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.6	9.0	13.2	8.8	13.3	9.7
109	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	12.0	8.6	12.3	8.9	12.8	8.7	13.0	9.6
115	7.6	6.1	8.7	7.4	9.8	7.7	10.4	8.8	11.8	8.5	11.9	8.7	12.5	8.5	12.6	9.4

# Model: AGUA14TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	17.2	10.8	17.9	12.0
59	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	17.2	10.8	17.9	12.0
70	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	17.2	10.8	17.9	12.0
73	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	17.2	10.8	17.8	12.0
77	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	17.2	10.8	17.5	11.9
81	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	17.0	10.8	17.2	11.8
86	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	16.7	10.6	16.8	11.7
91	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	16.3	10.5	16.5	11.5
95	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	16.0	10.4	16.2	11.4
99	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	15.7	10.3	15.9	11.3
104	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.6	10.4	15.4	10.2	15.5	11.2
109	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	14.0	9.9	14.4	10.3	15.0	10.0	15.1	11.0
115	8.9	7.1	10.2	8.6	11.4	8.9	12.1	10.2	13.8	9.8	13.9	10.1	14.5	9.9	14.7	10.9

MODEL  
SELECTIONMODEL  
SELECTION



## 2-9. Floor/Ceiling type

### Model: ABUA12TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.7	9.9	15.3	11.1
59	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.7	9.9	15.3	11.1
70	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.7	9.9	15.3	11.1
73	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.7	9.9	15.2	11.0
77	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.7	9.9	15.0	11.0
81	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.6	9.9	14.7	10.9
86	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.3	9.7	14.4	10.8
91	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	14.0	9.6	14.1	10.7
95	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	13.7	9.5	13.9	10.6
99	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	13.5	9.5	13.6	10.5
104	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.6	9.6	13.2	9.3	13.3	10.4
109	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	12.0	9.1	12.3	9.5	12.8	9.2	13.0	10.3
115	7.6	6.5	8.7	7.9	9.8	8.2	10.4	9.5	11.8	9.0	11.9	9.3	12.5	9.1	12.6	10.1

### Model: ABUA14TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	17.2	11.6	17.9	13.0
59	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	17.2	11.6	17.9	13.0
70	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	17.2	11.6	17.9	13.0
73	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	17.2	11.6	17.8	13.0
77	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	17.2	11.6	17.5	12.9
81	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	17.0	11.6	17.2	12.8
86	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	16.7	11.4	16.8	12.6
91	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	16.3	11.3	16.5	12.5
95	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	16.0	11.2	16.2	12.4
99	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	15.7	11.1	15.9	12.3
104	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.6	11.2	15.4	11.0	15.5	12.2
109	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	14.0	10.7	14.4	11.1	15.0	10.8	15.1	12.1
115	8.9	7.6	10.2	9.3	11.4	9.7	12.1	11.1	13.8	10.6	13.9	10.9	14.5	10.7	14.7	11.9

### Model: ABUA18TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	22.1	14.9	23.0	16.7
59	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	22.1	14.9	23.0	16.7
70	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	22.1	14.9	23.0	16.7
73	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	22.1	14.9	22.8	16.7
77	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	22.1	14.9	22.5	16.5
81	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	21.9	14.8	22.1	16.4
86	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	21.4	14.7	21.6	16.2
91	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	21.0	14.5	21.2	16.1
95	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	20.6	14.4	20.8	15.9
99	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	20.2	14.3	20.4	15.8
104	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.8	14.4	19.7	14.1	19.9	15.6
109	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	18.0	13.7	18.5	14.3	19.3	13.9	19.5	15.5
115	11.4	9.8	13.1	12.0	14.7	12.4	15.5	14.3	17.7	13.6	17.9	14.0	18.7	13.7	18.9	15.3

### Model: ABUA24TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	29.5	17.7	30.6	19.6
59	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	29.5	17.7	30.6	19.6
70	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	29.5	17.7	30.6	19.6
73	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	29.5	17.7	30.5	19.5
77	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	29.5	17.7	30.0	19.3
81	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	29.2	17.6	29.5	19.1
86	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	28.6	17.4	28.9	18.9
91	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	27.9	17.1	28.2	18.6
95	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	27.5	16.9	27.7	18.5
99	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	27.0	16.7	27.2	18.3
104	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	25.1	16.9	26.3	16.5	26.6	18.0
109	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	24.0	16.1	24.6	16.7	25.7	16.3	26.0	17.8
115	15.2	11.5	17.4	13.8	19.6	14.5	20.7	16.5	23.6	16.0	23.8	16.4	24.9	16.0	25.2	17.5

## 2-10. Ceiling type

### Model: ABUA30TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	36.9	24.6	38.3	27.5
59	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	36.9	24.6	38.3	27.5
70	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	36.9	24.6	38.3	27.5
73	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	36.9	24.6	38.1	27.4
77	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	36.9	24.6	37.5	27.2
81	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	36.5	24.5	36.8	27.0
86	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	35.7	24.2	36.1	26.7
91	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	34.9	23.9	35.3	26.5
95	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	34.3	23.7	34.7	26.2
99	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	33.7	23.5	34.0	26.0
104	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	31.4	23.8	32.9	23.2	33.2	25.8
109	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	30.0	22.6	30.8	23.5	32.1	22.9	32.4	25.5
115	19.0	16.1	21.8	19.7	24.5	20.4	25.9	23.5	29.5	22.4	29.8	23.1	31.1	22.6	31.5	25.1

### Model: ABUA36TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	44.2	27.8	45.9	30.8
59	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	44.2	27.8	45.9	30.8
70	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	44.2	27.8	45.9	30.8
73	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	44.2	27.8	45.7	30.7
77	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	44.2	27.8	44.9	30.5
81	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	43.8	27.6	44.2	30.2
86	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	42.8	27.3	43.3	29.8
91	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	41.9	26.9	42.4	29.5
95	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	41.2	26.6	41.6	29.2
99	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	40.4	26.4	40.9	28.9
104	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	37.7	26.6	39.5	26.0	39.9	28.6
109	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	36.0	25.4	36.9	26.3	38.5	25.7	38.9	28.3
115	22.8	18.1	26.1	22.0	29.4	22.9	31.1	26.1	35.4	25.1	35.8	25.9	37.4	25.2	37.8	27.8

## 2-11. Wall mounted type

### Model: ASUA4TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.9	3.1	5.1	3.4
59	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.9	3.1	5.1	3.4
70	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.9	3.1	5.1	3.4
73	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.9	3.1	5.1	3.4
77	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.9	3.1	5.0	3.3
81	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.9	3.0	4.9	3.3
86	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.8	3.0	4.8	3.3
91	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.7	3.0	4.7	3.2
95	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.6	2.9	4.6	3.2
99	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.5	2.9	4.5	3.2
104	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.2	2.9	4.4	2.9	4.4	3.1
109	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	4.0	2.8	4.1	2.9	4.3	2.8	4.3	3.1
115	2.5	2.0	2.9	2.4	3.3	2.5	3.5	2.9	3.9	2.8	4.0	2.8	4.2	2.8	4.2	3.1

### Model: ASUA7TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.6	7.0
59	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.6	7.0
70	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.6	7.0
73	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.5	7.0
77	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.2	6.3	9.4	6.9
81	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	9.1	6.2	9.2	6.9
86	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.9	6.2	9.0	6.8
91	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.7	6.1	8.8	6.7
95	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.6	6.0	8.7	6.7
99	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.4	6.0	8.5	6.6
104	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.8	6.0	8.2	5.9	8.3	6.6
109	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.5	5.7	7.7	6.0	8.0	5.8	8.1	6.5
115	4.8	4.1	5.4	5.0	6.1	5.2	6.5	6.0	7.4	5.7	7.5	5.9	7.8	5.8	7.9	6.4

### Model: ASUA9TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.7	8.4	12.1	9.5
59	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.7	8.4	12.1	9.5
70	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.7	8.4	12.1	9.5
73	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.7	8.4	12.1	9.5
77	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.7	8.4	11.9	9.4
81	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.5	8.4	11.7	9.3
86	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.3	8.3	11.4	9.2
91	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	11.1	8.2	11.2	9.2
95	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	10.9	8.2	11.0	9.1
99	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	10.7	8.1	10.8	9.0
104	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.9	8.2	10.4	8.0	10.5	8.9
109	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.5	7.8	9.7	8.1	10.2	7.9	10.3	8.9
115	6.0	5.5	6.9	6.8	7.8	7.0	8.2	8.2	9.3	7.7	9.4	8.0	9.9	7.8	10.0	8.8

### Model: ASUA12TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.7	9.6	15.3	10.6
59	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.7	9.6	15.3	10.6
70	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.7	9.6	15.3	10.6
73	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.7	9.6	15.2	10.6
77	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.7	9.6	15.0	10.5
81	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.6	9.5	14.7	10.4
86	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.7	12.6	9.2	14.3	9.4	14.4	10.3
91	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	14.0	9.3	14.1	10.2
95	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	13.7	9.2	13.9	10.1
99	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	13.5	9.1	13.6	10.0
104	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.6	9.2	13.2	9.0	13.3	9.9
109	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	12.0	8.8	12.3	9.1	12.8	8.9	13.0	9.8
115	7.6	6.2	8.7	7.6	9.8	7.9	10.4	9.1	11.8	8.7	11.9	8.9	12.5	8.7	12.6	9.7

## Model: ASUA14TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	17.2	11.4	17.9	12.7
59	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	17.2	11.4	17.9	12.7
70	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	17.2	11.4	17.9	12.7
73	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	17.2	11.4	17.8	12.6
77	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	17.2	11.4	17.5	12.5
81	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	17.0	11.3	17.2	12.4
86	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	16.7	11.2	16.8	12.3
91	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	16.3	11.0	16.5	12.2
95	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	16.0	10.9	16.2	12.1
99	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	15.7	10.8	15.9	12.0
104	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.6	10.9	15.4	10.7	15.5	11.8
109	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	14.0	10.4	14.4	10.8	15.0	10.5	15.1	11.7
115	8.9	7.4	10.2	9.1	11.4	9.4	12.1	10.8	13.8	10.3	13.9	10.6	14.5	10.4	14.7	11.5

## Model: ASUB18TLAV1

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.1	23.0	15.7
59	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.1	23.0	15.7
70	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.1	23.0	15.7
73	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.1	22.8	15.7
77	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.1	22.5	15.5
81	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	21.9	14.0	22.1	15.4
86	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	21.4	13.9	21.6	15.2
91	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	21.0	13.7	21.2	15.1
95	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	20.6	13.6	20.8	14.9
99	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	20.2	13.4	20.4	14.8
104	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	19.7	13.3	19.9	14.6
109	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.5	13.4	19.3	13.1	19.5	14.5
115	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	17.7	12.8	17.9	13.2	18.7	12.9	18.9	14.2

## Model: ASUB24TLAV1

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	29.5	18.8	30.6	20.9
59	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	29.5	18.8	30.6	20.9
70	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	29.5	18.8	30.6	20.9
73	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	29.5	18.8	30.5	20.8
77	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	29.5	18.8	30.0	20.6
81	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	29.2	18.7	29.5	20.4
86	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	28.6	18.4	28.9	20.2
91	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	27.9	18.2	28.2	20.0
95	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	27.5	18.0	27.7	19.8
99	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	27.0	17.8	27.2	19.6
104	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	25.1	18.0	26.3	17.6	26.6	19.4
109	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	24.0	17.2	24.6	17.8	25.7	17.4	26.0	19.2
115	15.2	12.2	17.4	14.9	19.6	15.5	20.7	17.7	23.6	17.0	23.8	17.5	24.9	17.1	25.2	18.9

## Model: ASUA30TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	36.9	23.4	38.3	25.9
59	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	36.9	23.4	38.3	25.9
70	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	36.9	23.4	38.3	25.9
73	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	36.9	23.4	38.1	25.9
77	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	36.9	23.4	37.5	25.6
81	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	36.5	23.2	36.8	25.4
86	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	35.7	22.9	36.1	25.1
91	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	34.9	22.6	35.3	24.8
95	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	34.3	22.4	34.7	24.6
99	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	33.7	22.2	34.0	24.4
104	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	31.4	22.4	32.9	21.9	33.2	24.1
109	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	30.0	21.3	30.8	22.2	32.1	21.6	32.4	23.8
115	19.0	15.2	21.8	18.5	24.5	19.2	25.9	22.0	29.5	21.1	29.8	21.8	31.1	21.2	31.5	23.5

## Model: ASUA36TLAV2

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	41.8	26.6	43.4	29.5
59	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	41.8	26.6	43.4	29.5
70	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	41.8	26.6	43.4	29.5
73	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	41.8	26.6	43.1	29.5
77	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	41.8	26.6	42.5	29.2
81	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	41.3	26.4	41.8	28.9
86	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	40.5	26.1	40.9	28.6
91	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	39.6	25.8	40.0	28.3
95	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	38.9	25.5	39.3	28.0
99	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	38.2	25.3	38.6	27.8
104	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	35.6	25.5	37.3	24.9	37.7	27.5
109	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	34.0	24.3	34.9	25.2	36.4	24.6	36.8	27.2
115	21.6	17.3	24.7	21.1	27.8	21.9	29.4	25.1	33.4	24.1	33.8	24.8	35.3	24.2	35.7	26.8

## Model: ASUA7TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	9.2	6.4	9.6	7.1
59	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	9.2	6.4	9.6	7.1
70	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	9.2	6.4	9.6	7.1
73	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	9.2	6.4	9.5	7.1
77	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	9.2	6.4	9.4	7.0
81	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	9.1	6.3	9.2	7.0
86	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	8.9	6.3	9.0	6.9
91	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	8.7	6.2	8.8	6.9
95	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	8.6	6.1	8.7	6.8
99	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	8.4	6.1	8.5	6.8
104	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.8	6.1	8.2	6.0	8.3	6.7
109	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.5	5.8	7.7	6.1	8.0	5.9	8.1	6.6
115	4.8	4.2	5.4	5.1	6.1	5.3	6.5	6.1	7.4	5.8	7.5	6.0	7.8	5.9	7.9	6.5

## Model: ASUA9TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.7	7.7	12.1	8.6
59	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.7	7.7	12.1	8.6
70	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.7	7.7	12.1	8.6
73	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.7	7.7	12.1	8.6
77	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.7	7.7	11.9	8.5
81	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.5	7.6	11.7	8.4
86	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.3	7.6	11.4	8.3
91	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	11.1	7.5	11.2	8.2
95	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	10.9	7.4	11.0	8.2
99	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	10.7	7.3	10.8	8.1
104	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.9	7.4	10.4	7.2	10.5	8.0
109	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.5	7.0	9.7	7.3	10.2	7.1	10.3	7.9
115	6.0	5.0	6.9	6.1	7.8	6.4	8.2	7.3	9.3	7.0	9.4	7.2	9.9	7.0	10.0	7.8

## Model: ASUA12TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.7	9.2	15.3	10.2
59	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.7	9.2	15.3	10.2
70	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.7	9.2	15.3	10.2
73	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.7	9.2	15.2	10.2
77	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.7	9.2	15.0	10.1
81	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.6	9.2	14.7	10.0
86	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.3	9.1	14.4	9.9
91	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	14.0	8.9	14.1	9.8
95	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	13.7	8.9	13.9	9.7
99	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	13.5	8.8	13.6	9.6
104	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.6	8.9	13.2	8.6	13.3	9.5
109	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	12.0	8.4	12.3	8.8	12.8	8.5	13.0	9.4
115	7.6	6.0	8.7	7.3	9.8	7.6	10.4	8.7	11.8	8.3	11.9	8.6	12.5	8.4	12.6	9.3

## Model: ASUA14TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	17.2	10.9	17.9	12.1
59	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	17.2	10.9	17.9	12.1
70	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	17.2	10.9	17.9	12.1
73	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	17.2	10.9	17.8	12.1
77	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	17.2	10.9	17.5	11.9
81	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	17.0	10.8	17.2	11.8
86	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	16.7	10.7	16.8	11.7
91	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	16.3	10.6	16.5	11.6
95	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	16.0	10.4	16.2	11.5
99	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	15.7	10.3	15.9	11.4
104	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.6	10.4	15.4	10.2	15.5	11.2
109	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	14.0	9.9	14.4	10.3	15.0	10.1	15.1	11.1
115	8.9	7.1	10.2	8.6	11.4	9.0	12.1	10.3	13.8	9.8	13.9	10.2	14.5	9.9	14.7	10.9

## Model: ASUB18TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.2	23.0	15.7
59	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.2	23.0	15.7
70	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.2	23.0	15.7
73	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.2	22.8	15.7
77	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	22.1	14.2	22.5	15.6
81	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	21.9	14.1	22.1	15.4
86	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	21.4	13.9	21.6	15.3
91	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	21.0	13.7	21.2	15.1
95	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	20.6	13.6	20.8	15.0
99	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	20.2	13.5	20.4	14.8
104	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.8	13.6	19.7	13.3	19.9	14.7
109	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	18.0	12.9	18.5	13.5	19.3	13.1	19.5	14.5
115	11.4	9.2	13.1	11.2	14.7	11.7	15.5	13.4	17.7	12.8	17.9	13.2	18.7	12.9	18.9	14.3

## Model: ASUB24TLAV

Outdoor temperature	Indoor temperature															
	68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
°FDB	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
50	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	29.5	18.7	30.6	20.8
59	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	29.5	18.7	30.6	20.8
70	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	29.5	18.7	30.6	20.8
73	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	29.5	18.7	30.5	20.8
77	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	29.5	18.7	30.0	20.6
81	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	29.2	18.6	29.5	20.4
86	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	28.6	18.4	28.9	20.2
91	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	27.9	18.2	28.2	20.0
95	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	27.5	18.0	27.7	19.8
99	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	27.0	17.8	27.2	19.6
104	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	25.1	18.0	26.3	17.6	26.6	19.4
109	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	24.0	17.1	24.6	17.8	25.7	17.3	26.0	19.1
115	15.2	12.2	17.4	14.9	19.6	15.4	20.7	17.7	23.6	17.0	23.8	17.5	24.9	17.1	25.2	18.9

### 3. Heating capacity table (Indoor unit)

- TC: Total capacity (kBtu/h)
- Values mentioned in the table are the values when the indoor unit's total rated capacity is 100% of the outdoor unit capacity.

#### 3-1. Compact cassette type

##### ■ Model: AUUA4TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	2.3	2.3	2.3	2.3	2.3	2.3	2.3
5.0	3.2	2.7	2.6	2.6	2.6	2.6	2.6	2.6
10.4	8.6	3.0	2.9	2.9	2.9	2.9	2.9	2.9
15.8	14.0	3.2	3.2	3.2	3.2	3.2	3.2	3.2
17.0	15.0	3.3	3.3	3.3	3.2	3.2	3.2	3.2
23.0	21.2	3.7	3.6	3.6	3.6	3.6	3.6	3.6
26.6	24.8	3.8	3.8	3.8	3.8	3.8	3.8	3.6
30.2	28.4	4.0	4.0	4.0	4.0	4.0	3.9	3.6
32.0	30.2	4.2	4.1	4.1	4.1	4.1	3.9	3.6
35.6	33.8	4.3	4.3	4.3	4.3	4.2	3.9	3.6
41.0	39.2	4.7	4.7	4.6	4.4	4.2	4.0	3.6
47.0	43.0	4.9	4.9	4.6	4.4	4.2	4.0	3.6
48.2	46.0	5.1	4.9	4.6	4.4	4.2	4.0	3.6
53.6	51.1	5.1	4.9	4.6	4.4	4.2	4.0	3.6
59.0	56.3	5.1	4.9	4.6	4.4	4.2	4.0	3.6

##### ■ Model: AUUA7TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	4.9	4.9	4.9	4.9	4.9	4.9	4.9
5.0	3.2	5.7	5.7	5.7	5.7	5.7	5.7	5.6
10.4	8.6	6.4	6.4	6.3	6.3	6.3	6.3	6.3
15.8	14.0	7.0	7.0	6.9	6.9	6.9	6.9	6.8
17.0	15.0	7.1	7.1	7.0	7.0	7.0	7.0	7.0
23.0	21.2	7.9	7.9	7.8	7.8	7.8	7.7	7.7
26.6	24.8	8.3	8.3	8.2	8.2	8.2	8.2	7.8
30.2	28.4	8.7	8.7	8.6	8.6	8.6	8.5	7.8
32.0	30.2	9.0	8.9	8.8	8.8	8.8	8.5	7.8
35.6	33.8	9.4	9.3	9.3	9.2	9.0	8.5	7.8
41.0	39.2	10.1	10.1	9.9	9.5	9.1	8.6	7.9
47.0	43.0	10.6	10.5	9.9	9.5	9.1	8.6	7.9
48.2	46.0	10.9	10.6	9.9	9.5	9.1	8.6	7.9
53.6	51.1	11.1	10.6	9.9	9.5	9.1	8.6	7.9
59.0	56.3	11.1	10.6	9.9	9.5	9.1	8.6	7.9

##### ■ Model: AUUA9TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	5.7	5.7	5.7	5.6	5.6	5.6	5.6
5.0	3.2	6.6	6.5	6.5	6.5	6.5	6.5	6.5
10.4	8.6	7.3	7.3	7.3	7.3	7.2	7.2	7.2
15.8	14.0	8.0	8.0	7.9	7.9	7.9	7.9	7.8
17.0	15.0	8.1	8.1	8.1	8.0	8.0	8.0	8.0
23.0	21.2	9.0	9.0	9.0	8.9	8.9	8.9	8.8
26.6	24.8	9.5	9.5	9.4	9.4	9.4	9.4	8.9
30.2	28.4	10.0	10.0	9.9	9.9	9.9	9.7	8.9
32.0	30.2	10.3	10.2	10.1	10.1	10.1	9.7	8.9
35.6	33.8	10.8	10.7	10.6	10.6	10.3	9.7	8.9
41.0	39.2	11.6	11.6	11.3	10.9	10.5	9.8	9.0
47.0	43.0	12.1	12.1	11.3	10.9	10.5	9.8	9.0
48.2	46.0	12.6	12.1	11.3	10.9	10.5	9.8	9.0
53.6	51.1	12.8	12.1	11.3	10.9	10.5	9.8	9.0
59.0	56.3	12.8	12.1	11.3	10.9	10.5	9.8	9.0

## Model: AUUA12TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
5.0	3.2	8.1	8.1	8.1	8.0	8.0	8.0	8.0
10.4	8.6	9.1	9.0	9.0	9.0	8.9	8.9	8.9
15.8	14.0	9.9	9.9	9.8	9.8	9.8	9.8	9.7
17.0	15.0	10.1	10.1	10.0	10.0	10.0	9.9	9.9
23.0	21.2	11.2	11.2	11.1	11.1	11.0	11.0	10.9
26.6	24.8	11.8	11.8	11.7	11.7	11.6	11.6	11.0
30.2	28.4	12.4	12.4	12.3	12.2	12.2	12.1	11.0
32.0	30.2	12.7	12.6	12.6	12.5	12.5	12.1	11.0
35.6	33.8	13.3	13.2	13.2	13.1	12.8	12.1	11.0
41.0	39.2	14.4	14.3	14.0	13.5	12.9	12.2	11.2
47.0	43.0	15.0	14.9	14.0	13.5	12.9	12.2	11.2
48.2	46.0	15.5	15.0	14.0	13.5	12.9	12.2	11.2
53.6	51.1	15.8	15.0	14.0	13.5	12.9	12.2	11.2
59.0	56.3	15.8	15.0	14.0	13.5	12.9	12.2	11.2

## Model: AUUA14TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0
5.0	3.2	9.4	9.4	9.4	9.3	9.3	9.3	9.3
10.4	8.6	10.5	10.4	10.4	10.4	10.3	10.3	10.3
15.8	14.0	11.5	11.4	11.4	11.4	11.3	11.3	11.2
17.0	15.0	11.7	11.6	11.6	11.5	11.5	11.5	11.4
23.0	21.2	12.9	12.9	12.8	12.8	12.7	12.7	12.6
26.6	24.8	13.6	13.6	13.5	13.5	13.4	13.4	12.7
30.2	28.4	14.3	14.3	14.2	14.1	14.1	13.9	12.7
32.0	30.2	14.7	14.6	14.5	14.5	14.4	13.9	12.7
35.6	33.8	15.4	15.3	15.2	15.2	14.8	13.9	12.7
41.0	39.2	16.6	16.5	16.2	15.6	15.0	14.1	12.9
47.0	43.0	17.4	17.3	16.2	15.6	15.0	14.1	12.9
48.2	46.0	18.0	17.4	16.2	15.6	15.0	14.1	12.9
53.6	51.1	18.3	17.4	16.2	15.6	15.0	14.1	12.9
59.0	56.3	18.3	17.4	16.2	15.6	15.0	14.1	12.9

## Model: AUUA18TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

## Model: AUUA24TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3



## 3-2. 4-way flow cassette type

### ■ Model: AUUB18TLAV

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

### ■ Model: AUUB24TLAV

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3

### ■ Model: AUUB30TLAV

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	17.7	17.7	17.7	17.6	17.6	17.6	17.5
5.0	3.2	20.5	20.4	20.4	20.3	20.3	20.3	20.2
10.4	8.6	22.8	22.7	22.6	22.6	22.5	22.5	22.4
15.8	14.0	25.0	24.9	24.8	24.8	24.7	24.6	24.5
17.0	15.0	25.4	25.3	25.2	25.1	25.1	25.0	24.9
23.0	21.2	28.2	28.1	28.0	27.9	27.8	27.7	27.6
26.6	24.8	29.7	29.6	29.4	29.4	29.3	29.2	27.8
30.2	28.4	31.2	31.1	30.9	30.8	30.8	30.4	27.8
32.0	30.2	32.1	31.9	31.6	31.5	31.4	30.4	27.8
35.6	33.8	33.6	33.4	33.1	33.0	32.3	30.4	27.8
41.0	39.2	36.1	36.0	35.3	34.0	32.6	30.7	28.1
47.0	43.0	37.9	37.6	35.3	34.0	32.6	30.7	28.1
48.2	46.0	39.1	37.9	35.3	34.0	32.6	30.7	28.1
53.6	51.1	39.8	37.9	35.3	34.0	32.6	30.7	28.1
59.0	56.3	39.8	37.9	35.3	34.0	32.6	30.7	28.1

# Model: AUUB36TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	20.8	20.8	20.8	20.7	20.7	20.7	20.6
5.0	3.2	24.1	24.0	24.0	23.8	23.8	23.8	23.7
10.4	8.6	26.9	26.8	26.6	26.6	26.5	26.5	26.4
15.8	14.0	29.4	29.3	29.1	29.1	29.0	28.9	28.8
17.0	15.0	29.9	29.8	29.7	29.5	29.5	29.4	29.3
23.0	21.2	33.2	33.1	32.9	32.8	32.7	32.6	32.4
26.6	24.8	35.0	34.8	34.6	34.6	34.4	34.3	32.7
30.2	28.4	36.7	36.6	36.3	36.2	36.2	35.7	32.7
32.0	30.2	37.7	37.5	37.2	37.1	37.0	35.7	32.7
35.6	33.8	39.5	39.2	39.0	38.9	38.0	35.7	32.7
41.0	39.2	42.5	42.4	41.5	40.0	38.4	36.1	33.1
47.0	43.0	44.5	44.3	41.5	40.0	38.4	36.1	33.1
48.2	46.0	46.1	44.5	41.5	40.0	38.4	36.1	33.1
53.6	51.1	46.8	44.5	41.5	40.0	38.4	36.1	33.1
59.0	56.3	46.8	44.5	41.5	40.0	38.4	36.1	33.1

### 3-3. Circular flow cassette type

#### ■ Model: AUUB18TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

#### ■ Model: AUUB24TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3

#### ■ Model: AUUB30TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	17.7	17.7	17.7	17.6	17.6	17.6	17.5
5.0	3.2	20.5	20.4	20.4	20.3	20.3	20.3	20.2
10.4	8.6	22.8	22.7	22.6	22.6	22.5	22.5	22.4
15.8	14.0	25.0	24.9	24.8	24.8	24.7	24.6	24.5
17.0	15.0	25.4	25.3	25.2	25.1	25.1	25.0	24.9
23.0	21.2	28.2	28.1	28.0	27.9	27.8	27.7	27.6
26.6	24.8	29.7	29.6	29.4	29.4	29.3	29.2	27.8
30.2	28.4	31.2	31.1	30.9	30.8	30.8	30.4	27.8
32.0	30.2	32.1	31.9	31.6	31.5	31.4	30.4	27.8
35.6	33.8	33.6	33.4	33.1	33.0	32.3	30.4	27.8
41.0	39.2	36.1	36.0	35.3	34.0	32.6	30.7	28.1
47.0	43.0	37.9	37.6	35.3	34.0	32.6	30.7	28.1
48.2	46.0	39.1	37.9	35.3	34.0	32.6	30.7	28.1
53.6	51.1	39.8	37.9	35.3	34.0	32.6	30.7	28.1
59.0	56.3	39.8	37.9	35.3	34.0	32.6	30.7	28.1

## Model: AUUB36TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	20.8	20.8	20.8	20.7	20.7	20.7	20.6
5.0	3.2	24.1	24.0	24.0	23.8	23.8	23.8	23.7
10.4	8.6	26.9	26.8	26.6	26.6	26.5	26.5	26.4
15.8	14.0	29.4	29.3	29.1	29.1	29.0	28.9	28.8
17.0	15.0	29.9	29.8	29.7	29.5	29.5	29.4	29.3
23.0	21.2	33.2	33.1	32.9	32.8	32.7	32.6	32.4
26.6	24.8	35.0	34.8	34.6	34.6	34.4	34.3	32.7
30.2	28.4	36.7	36.6	36.3	36.2	36.2	35.7	32.7
32.0	30.2	37.7	37.5	37.2	37.1	37.0	35.7	32.7
35.6	33.8	39.5	39.2	39.0	38.9	38.0	35.7	32.7
41.0	39.2	42.5	42.4	41.5	40.0	38.4	36.1	33.1
47.0	43.0	44.5	44.3	41.5	40.0	38.4	36.1	33.1
48.2	46.0	46.1	44.5	41.5	40.0	38.4	36.1	33.1
53.6	51.1	46.8	44.5	41.5	40.0	38.4	36.1	33.1
59.0	56.3	46.8	44.5	41.5	40.0	38.4	36.1	33.1

## Model: AUUB48TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	28.1	28.1	28.1	27.9	27.9	27.9	27.8
5.0	3.2	32.5	32.4	32.4	32.2	32.2	32.2	32.0
10.4	8.6	36.3	36.1	35.9	35.9	35.8	35.8	35.6
15.8	14.0	39.7	39.5	39.4	39.4	39.2	39.0	38.8
17.0	15.0	40.4	40.2	40.0	39.9	39.9	39.7	39.5
23.0	21.2	44.8	44.6	44.5	44.3	44.1	43.9	43.8
26.6	24.8	47.2	47.0	46.7	46.7	46.5	46.3	44.1
30.2	28.4	49.6	49.4	49.1	48.9	48.9	48.2	44.1
32.0	30.2	50.9	50.6	50.3	50.1	49.9	48.2	44.1
35.6	33.8	53.3	53.0	52.6	52.5	51.3	48.2	44.1
41.0	39.2	57.4	57.2	56.0	54.0	51.8	48.7	44.6
47.0	43.0	60.1	59.8	56.0	54.0	51.8	48.7	44.6
48.2	46.0	62.2	60.1	56.0	54.0	51.8	48.7	44.6
53.6	51.1	63.2	60.1	56.0	54.0	51.8	48.7	44.6
59.0	56.3	63.2	60.1	56.0	54.0	51.8	48.7	44.6

## 3-4. Mini duct type

### ■ Model: ARUL4TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	2.3	2.3	2.3	2.3	2.3	2.3	2.3
5.0	3.2	2.7	2.6	2.6	2.6	2.6	2.6	2.6
10.4	8.6	3.0	2.9	2.9	2.9	2.9	2.9	2.9
15.8	14.0	3.2	3.2	3.2	3.2	3.2	3.2	3.2
17.0	15.0	3.3	3.3	3.3	3.2	3.2	3.2	3.2
23.0	21.2	3.7	3.6	3.6	3.6	3.6	3.6	3.6
26.6	24.8	3.8	3.8	3.8	3.8	3.8	3.8	3.6
30.2	28.4	4.0	4.0	4.0	4.0	4.0	3.9	3.6
32.0	30.2	4.2	4.1	4.1	4.1	4.1	3.9	3.6
35.6	33.8	4.3	4.3	4.3	4.3	4.2	3.9	3.6
41.0	39.2	4.7	4.7	4.6	4.4	4.2	4.0	3.6
47.0	43.0	4.9	4.9	4.6	4.4	4.2	4.0	3.6
48.2	46.0	5.1	4.9	4.6	4.4	4.2	4.0	3.6
53.6	51.1	5.1	4.9	4.6	4.4	4.2	4.0	3.6
59.0	56.3	5.1	4.9	4.6	4.4	4.2	4.0	3.6

## 3-5. Slim duct/Slim concealed floor type

### Model: ARUL7TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	4.9	4.9	4.9	4.9	4.9	4.9	4.9
5.0	3.2	5.7	5.7	5.7	5.7	5.7	5.7	5.6
10.4	8.6	6.4	6.4	6.3	6.3	6.3	6.3	6.3
15.8	14.0	7.0	7.0	6.9	6.9	6.9	6.9	6.8
17.0	15.0	7.1	7.1	7.0	7.0	7.0	7.0	7.0
23.0	21.2	7.9	7.9	7.8	7.8	7.8	7.7	7.7
26.6	24.8	8.3	8.3	8.2	8.2	8.2	8.2	7.8
30.2	28.4	8.7	8.7	8.6	8.6	8.6	8.5	7.8
32.0	30.2	9.0	8.9	8.8	8.8	8.8	8.5	7.8
35.6	33.8	9.4	9.3	9.3	9.2	9.0	8.5	7.8
41.0	39.2	10.1	10.1	9.9	9.5	9.1	8.6	7.9
47.0	43.0	10.6	10.5	9.9	9.5	9.1	8.6	7.9
48.2	46.0	10.9	10.6	9.9	9.5	9.1	8.6	7.9
53.6	51.1	11.1	10.6	9.9	9.5	9.1	8.6	7.9
59.0	56.3	11.1	10.6	9.9	9.5	9.1	8.6	7.9

### Model: ARUL9TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	5.7	5.7	5.7	5.6	5.6	5.6	5.6
5.0	3.2	6.6	6.5	6.5	6.5	6.5	6.5	6.5
10.4	8.6	7.3	7.3	7.3	7.3	7.2	7.2	7.2
15.8	14.0	8.0	8.0	7.9	7.9	7.9	7.9	7.8
17.0	15.0	8.1	8.1	8.1	8.0	8.0	8.0	8.0
23.0	21.2	9.0	9.0	9.0	8.9	8.9	8.9	8.8
26.6	24.8	9.5	9.5	9.4	9.4	9.4	9.4	8.9
30.2	28.4	10.0	10.0	9.9	9.9	9.9	9.7	8.9
32.0	30.2	10.3	10.2	10.1	10.1	10.1	9.7	8.9
35.6	33.8	10.8	10.7	10.6	10.6	10.3	9.7	8.9
41.0	39.2	11.6	11.6	11.3	10.9	10.5	9.8	9.0
47.0	43.0	12.1	12.1	11.3	10.9	10.5	9.8	9.0
48.2	46.0	12.6	12.1	11.3	10.9	10.5	9.8	9.0
53.6	51.1	12.8	12.1	11.3	10.9	10.5	9.8	9.0
59.0	56.3	12.8	12.1	11.3	10.9	10.5	9.8	9.0

### Model: ARUL12TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
5.0	3.2	8.1	8.1	8.1	8.0	8.0	8.0	8.0
10.4	8.6	9.1	9.0	9.0	9.0	8.9	8.9	8.9
15.8	14.0	9.9	9.9	9.8	9.8	9.8	9.8	9.7
17.0	15.0	10.1	10.1	10.0	10.0	10.0	9.9	9.9
23.0	21.2	11.2	11.2	11.1	11.1	11.0	11.0	10.9
26.6	24.8	11.8	11.8	11.7	11.7	11.6	11.6	11.0
30.2	28.4	12.4	12.4	12.3	12.2	12.2	12.1	11.0
32.0	30.2	12.7	12.6	12.6	12.5	12.5	12.1	11.0
35.6	33.8	13.3	13.2	13.2	13.1	12.8	12.1	11.0
41.0	39.2	14.4	14.3	14.0	13.5	12.9	12.2	11.2
47.0	43.0	15.0	14.9	14.0	13.5	12.9	12.2	11.2
48.2	46.0	15.5	15.0	14.0	13.5	12.9	12.2	11.2
53.6	51.1	15.8	15.0	14.0	13.5	12.9	12.2	11.2
59.0	56.3	15.8	15.0	14.0	13.5	12.9	12.2	11.2

## Model: ARUL14TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0
5.0	3.2	9.4	9.4	9.4	9.3	9.3	9.3	9.3
10.4	8.6	10.5	10.4	10.4	10.4	10.3	10.3	10.3
15.8	14.0	11.5	11.4	11.4	11.4	11.3	11.3	11.2
17.0	15.0	11.7	11.6	11.6	11.5	11.5	11.5	11.4
23.0	21.2	12.9	12.9	12.8	12.8	12.7	12.7	12.6
26.6	24.8	13.6	13.6	13.5	13.5	13.4	13.4	12.7
30.2	28.4	14.3	14.3	14.2	14.1	14.1	13.9	12.7
32.0	30.2	14.7	14.6	14.5	14.5	14.4	13.9	12.7
35.6	33.8	15.4	15.3	15.2	15.2	14.8	13.9	12.7
41.0	39.2	16.6	16.5	16.2	15.6	15.0	14.1	12.9
47.0	43.0	17.4	17.3	16.2	15.6	15.0	14.1	12.9
48.2	46.0	18.0	17.4	16.2	15.6	15.0	14.1	12.9
53.6	51.1	18.3	17.4	16.2	15.6	15.0	14.1	12.9
59.0	56.3	18.3	17.4	16.2	15.6	15.0	14.1	12.9

## Model: ARUL18TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

## 3-6. Medium static pressure duct type

### ■ Model: ARUM24TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3

### ■ Model: ARUM30TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	17.7	17.7	17.7	17.6	17.6	17.6	17.5
5.0	3.2	20.5	20.4	20.4	20.3	20.3	20.3	20.2
10.4	8.6	22.8	22.7	22.6	22.6	22.5	22.5	22.4
15.8	14.0	25.0	24.9	24.8	24.8	24.7	24.6	24.5
17.0	15.0	25.4	25.3	25.2	25.1	25.1	25.0	24.9
23.0	21.2	28.2	28.1	28.0	27.9	27.8	27.7	27.6
26.6	24.8	29.7	29.6	29.4	29.4	29.3	29.2	27.8
30.2	28.4	31.2	31.1	30.9	30.8	30.8	30.4	27.8
32.0	30.2	32.1	31.9	31.6	31.5	31.4	30.4	27.8
35.6	33.8	33.6	33.4	33.1	33.0	32.3	30.4	27.8
41.0	39.2	36.1	36.0	35.3	34.0	32.6	30.7	28.1
47.0	43.0	37.9	37.6	35.3	34.0	32.6	30.7	28.1
48.2	46.0	39.1	37.9	35.3	34.0	32.6	30.7	28.1
53.6	51.1	39.8	37.9	35.3	34.0	32.6	30.7	28.1
59.0	56.3	39.8	37.9	35.3	34.0	32.6	30.7	28.1

### ■ Model: ARUM36TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	20.8	20.8	20.8	20.7	20.7	20.7	20.6
5.0	3.2	24.1	24.0	24.0	23.8	23.8	23.8	23.7
10.4	8.6	26.9	26.8	26.6	26.6	26.5	26.5	26.4
15.8	14.0	29.4	29.3	29.1	29.1	29.0	28.9	28.8
17.0	15.0	29.9	29.8	29.7	29.5	29.5	29.4	29.3
23.0	21.2	33.2	33.1	32.9	32.8	32.7	32.6	32.4
26.6	24.8	35.0	34.8	34.6	34.6	34.4	34.3	32.7
30.2	28.4	36.7	36.6	36.3	36.2	36.2	35.7	32.7
32.0	30.2	37.7	37.5	37.2	37.1	37.0	35.7	32.7
35.6	33.8	39.5	39.2	39.0	38.9	38.0	35.7	32.7
41.0	39.2	42.5	42.4	41.5	40.0	38.4	36.1	33.1
47.0	43.0	44.5	44.3	41.5	40.0	38.4	36.1	33.1
48.2	46.0	46.1	44.5	41.5	40.0	38.4	36.1	33.1
53.6	51.1	46.8	44.5	41.5	40.0	38.4	36.1	33.1
59.0	56.3	46.8	44.5	41.5	40.0	38.4	36.1	33.1



## 3-7. High static pressure duct type

### Model: ARUH36TLAV

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
TC	TC	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	20.8	20.8	20.8	20.7	20.7	20.7	20.6
5.0	3.2	24.1	24.0	24.0	23.8	23.8	23.8	23.7
10.4	8.6	26.9	26.8	26.6	26.6	26.5	26.5	26.4
15.8	14.0	29.4	29.3	29.1	29.1	29.0	28.9	28.8
17.0	15.0	29.9	29.8	29.7	29.5	29.5	29.4	29.3
23.0	21.2	33.2	33.1	32.9	32.8	32.7	32.6	32.4
26.6	24.8	35.0	34.8	34.6	34.6	34.4	34.3	32.7
30.2	28.4	36.7	36.6	36.3	36.2	36.2	35.7	32.7
32.0	30.2	37.7	37.5	37.2	37.1	37.0	35.7	32.7
35.6	33.8	39.5	39.2	39.0	38.9	38.0	35.7	32.7
41.0	39.2	42.5	42.4	41.5	40.0	38.4	36.1	33.1
47.0	43.0	44.5	44.3	41.5	40.0	38.4	36.1	33.1
48.2	46.0	46.1	44.5	41.5	40.0	38.4	36.1	33.1
53.6	51.1	46.8	44.5	41.5	40.0	38.4	36.1	33.1
59.0	56.3	46.8	44.5	41.5	40.0	38.4	36.1	33.1

### Model: ARUH48TLAV

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
TC	TC	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	28.1	28.1	28.1	27.9	27.9	27.9	27.8
5.0	3.2	32.5	32.4	32.4	32.2	32.2	32.2	32.0
10.4	8.6	36.3	36.1	35.9	35.9	35.8	35.8	35.6
15.8	14.0	39.7	39.5	39.4	39.4	39.2	39.0	38.8
17.0	15.0	40.4	40.2	40.0	39.9	39.9	39.7	39.5
23.0	21.2	44.8	44.6	44.5	44.3	44.1	43.9	43.8
26.6	24.8	47.2	47.0	46.7	46.7	46.5	46.3	44.1
30.2	28.4	49.6	49.4	49.1	48.9	48.9	48.2	44.1
32.0	30.2	50.9	50.6	50.3	50.1	49.9	48.2	44.1
35.6	33.8	53.3	53.0	52.6	52.5	51.3	48.2	44.1
41.0	39.2	57.4	57.2	56.0	54.0	51.8	48.7	44.6
47.0	43.0	60.1	59.8	56.0	54.0	51.8	48.7	44.6
48.2	46.0	62.2	60.1	56.0	54.0	51.8	48.7	44.6
53.6	51.1	63.2	60.1	56.0	54.0	51.8	48.7	44.6
59.0	56.3	63.2	60.1	56.0	54.0	51.8	48.7	44.6

### Model: ARUH60TLAV

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
TC	TC	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	34.9	34.9	34.9	34.7	34.7	34.7	34.5
5.0	3.2	40.4	40.2	40.2	39.9	39.9	39.9	39.7
10.4	8.6	45.0	44.8	44.6	44.6	44.4	44.4	44.2
15.8	14.0	49.2	49.0	48.8	48.8	48.6	48.4	48.2
17.0	15.0	50.1	49.9	49.7	49.5	49.5	49.2	49.0
23.0	21.2	55.6	55.4	55.2	55.0	54.7	54.5	54.3
26.6	24.8	58.5	58.3	57.9	57.9	57.7	57.5	54.7
30.2	28.4	61.5	61.3	60.9	60.7	60.7	59.8	54.7
32.0	30.2	63.2	62.8	62.4	62.1	61.9	59.8	54.7
35.6	33.8	66.2	65.7	65.3	65.1	63.6	59.8	54.7
41.0	39.2	71.2	71.0	69.5	67.0	64.3	60.4	55.4
47.0	43.0	74.6	74.2	69.5	67.0	64.3	60.4	55.4
48.2	46.0	77.1	74.6	69.5	67.0	64.3	60.4	55.4
53.6	51.1	78.4	74.6	69.5	67.0	64.3	60.4	55.4
59.0	56.3	78.4	74.6	69.5	67.0	64.3	60.4	55.4

## Model: ARUH72TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	42.2	42.2	42.2	41.9	41.9	41.9	41.6
5.0	3.2	48.8	48.5	48.5	48.3	48.3	48.3	48.0
10.4	8.6	54.4	54.2	53.9	53.9	53.7	53.7	53.4
15.8	14.0	59.5	59.3	59.0	59.0	58.8	58.5	58.3
17.0	15.0	60.6	60.3	60.0	59.8	59.8	59.5	59.3
23.0	21.2	67.2	66.9	66.7	66.4	66.2	65.9	65.7
26.6	24.8	70.8	70.5	70.0	70.0	69.8	69.5	66.2
30.2	28.4	74.4	74.1	73.6	73.3	73.3	72.3	66.2
32.0	30.2	76.4	75.9	75.4	75.1	74.9	72.3	66.2
35.6	33.8	80.0	79.5	79.0	78.7	76.9	72.3	66.2
41.0	39.2	86.1	85.9	84.1	81.0	77.7	73.1	66.9
47.0	43.0	90.2	89.7	84.1	81.0	77.7	73.1	66.9
48.2	46.0	93.3	90.2	84.1	81.0	77.7	73.1	66.9
53.6	51.1	94.8	90.2	84.1	81.0	77.7	73.1	66.9
59.0	56.3	94.8	90.2	84.1	81.0	77.7	73.1	66.9

## Model: ARUH96TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	56.2	56.2	56.2	55.9	55.9	55.9	55.5
5.0	3.2	65.1	64.7	64.7	64.4	64.4	64.4	64.1
10.4	8.6	72.6	72.2	71.9	71.9	71.5	71.5	71.2
15.8	14.0	79.4	79.0	78.7	78.7	78.4	78.0	77.7
17.0	15.0	80.7	80.4	80.1	79.7	79.7	79.4	79.0
23.0	21.2	89.6	89.3	88.9	88.6	88.2	87.9	87.6
26.6	24.8	94.4	94.0	93.4	93.4	93.0	92.7	88.2
30.2	28.4	99.1	98.8	98.1	97.8	97.8	96.4	88.2
32.0	30.2	101.9	101.2	100.5	100.2	99.8	96.4	88.2
35.6	33.8	106.6	106.0	105.3	104.9	102.5	96.4	88.2
41.0	39.2	114.8	114.5	112.1	108.0	103.6	97.4	89.3
47.0	43.0	120.3	119.6	112.1	108.0	103.6	97.4	89.3
48.2	46.0	124.4	120.3	112.1	108.0	103.6	97.4	89.3
53.6	51.1	126.4	120.3	112.1	108.0	103.6	97.4	89.3
59.0	56.3	126.4	120.3	112.1	108.0	103.6	97.4	89.3

## 3-8. Compact floor type

### Model: AGUA4TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	2.3	2.3	2.3	2.3	2.3	2.3	2.3
5.0	3.2	2.7	2.6	2.6	2.6	2.6	2.6	2.6
10.4	8.6	3.0	2.9	2.9	2.9	2.9	2.9	2.9
15.8	14.0	3.2	3.2	3.2	3.2	3.2	3.2	3.2
17.0	15.0	3.3	3.3	3.3	3.2	3.2	3.2	3.2
23.0	21.2	3.7	3.6	3.6	3.6	3.6	3.6	3.6
26.6	24.8	3.8	3.8	3.8	3.8	3.8	3.8	3.6
30.2	28.4	4.0	4.0	4.0	4.0	4.0	3.9	3.6
32.0	30.2	4.2	4.1	4.1	4.1	4.1	3.9	3.6
35.6	33.8	4.3	4.3	4.3	4.3	4.2	3.9	3.6
41.0	39.2	4.7	4.7	4.6	4.4	4.2	4.0	3.6
47.0	43.0	4.9	4.9	4.6	4.4	4.2	4.0	3.6
48.2	46.0	5.1	4.9	4.6	4.4	4.2	4.0	3.6
53.6	51.1	5.1	4.9	4.6	4.4	4.2	4.0	3.6
59.0	56.3	5.1	4.9	4.6	4.4	4.2	4.0	3.6

### Model: AGUA7TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	4.9	4.9	4.9	4.9	4.9	4.9	4.9
5.0	3.2	5.7	5.7	5.7	5.7	5.7	5.7	5.6
10.4	8.6	6.4	6.4	6.3	6.3	6.3	6.3	6.3
15.8	14.0	7.0	7.0	6.9	6.9	6.9	6.9	6.8
17.0	15.0	7.1	7.1	7.0	7.0	7.0	7.0	7.0
23.0	21.2	7.9	7.9	7.8	7.8	7.8	7.7	7.7
26.6	24.8	8.3	8.3	8.2	8.2	8.2	8.2	7.8
30.2	28.4	8.7	8.7	8.6	8.6	8.6	8.5	7.8
32.0	30.2	9.0	8.9	8.8	8.8	8.8	8.5	7.8
35.6	33.8	9.4	9.3	9.3	9.2	9.0	8.5	7.8
41.0	39.2	10.1	10.1	9.9	9.5	9.1	8.6	7.9
47.0	43.0	10.6	10.5	9.9	9.5	9.1	8.6	7.9
48.2	46.0	10.9	10.6	9.9	9.5	9.1	8.6	7.9
53.6	51.1	11.1	10.6	9.9	9.5	9.1	8.6	7.9
59.0	56.3	11.1	10.6	9.9	9.5	9.1	8.6	7.9

### Model: AGUA9TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	5.7	5.7	5.7	5.6	5.6	5.6	5.6
5.0	3.2	6.6	6.5	6.5	6.5	6.5	6.5	6.5
10.4	8.6	7.3	7.3	7.3	7.3	7.2	7.2	7.2
15.8	14.0	8.0	8.0	7.9	7.9	7.9	7.9	7.8
17.0	15.0	8.1	8.1	8.1	8.0	8.0	8.0	8.0
23.0	21.2	9.0	9.0	9.0	8.9	8.9	8.9	8.8
26.6	24.8	9.5	9.5	9.4	9.4	9.4	9.4	8.9
30.2	28.4	10.0	10.0	9.9	9.9	9.9	9.7	8.9
32.0	30.2	10.3	10.2	10.1	10.1	10.1	9.7	8.9
35.6	33.8	10.8	10.7	10.6	10.6	10.3	9.7	8.9
41.0	39.2	11.6	11.6	11.3	10.9	10.5	9.8	9.0
47.0	43.0	12.1	12.1	11.3	10.9	10.5	9.8	9.0
48.2	46.0	12.6	12.1	11.3	10.9	10.5	9.8	9.0
53.6	51.1	12.8	12.1	11.3	10.9	10.5	9.8	9.0
59.0	56.3	12.8	12.1	11.3	10.9	10.5	9.8	9.0

## Model: AGUA12TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
5.0	3.2	8.1	8.1	8.1	8.0	8.0	8.0	8.0
10.4	8.6	9.1	9.0	9.0	9.0	8.9	8.9	8.9
15.8	14.0	9.9	9.9	9.8	9.8	9.8	9.8	9.7
17.0	15.0	10.1	10.1	10.0	10.0	10.0	9.9	9.9
23.0	21.2	11.2	11.2	11.1	11.1	11.0	11.0	10.9
26.6	24.8	11.8	11.8	11.7	11.7	11.6	11.6	11.0
30.2	28.4	12.4	12.4	12.3	12.2	12.2	12.1	11.0
32.0	30.2	12.7	12.6	12.6	12.5	12.5	12.1	11.0
35.6	33.8	13.3	13.2	13.2	13.1	12.8	12.1	11.0
41.0	39.2	14.4	14.3	14.0	13.5	12.9	12.2	11.2
47.0	43.0	15.0	14.9	14.0	13.5	12.9	12.2	11.2
48.2	46.0	15.5	15.0	14.0	13.5	12.9	12.2	11.2
53.6	51.1	15.8	15.0	14.0	13.5	12.9	12.2	11.2
59.0	56.3	15.8	15.0	14.0	13.5	12.9	12.2	11.2

## Model: AGUA14TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0
5.0	3.2	9.4	9.4	9.4	9.3	9.3	9.3	9.3
10.4	8.6	10.5	10.4	10.4	10.4	10.3	10.3	10.3
15.8	14.0	11.5	11.4	11.4	11.4	11.3	11.3	11.2
17.0	15.0	11.7	11.6	11.6	11.5	11.5	11.5	11.4
23.0	21.2	12.9	12.9	12.8	12.8	12.7	12.7	12.6
26.6	24.8	13.6	13.6	13.5	13.5	13.4	13.4	12.7
30.2	28.4	14.3	14.3	14.2	14.1	14.1	13.9	12.7
32.0	30.2	14.7	14.6	14.5	14.5	14.4	13.9	12.7
35.6	33.8	15.4	15.3	15.2	15.2	14.8	13.9	12.7
41.0	39.2	16.6	16.5	16.2	15.6	15.0	14.1	12.9
47.0	43.0	17.4	17.3	16.2	15.6	15.0	14.1	12.9
48.2	46.0	18.0	17.4	16.2	15.6	15.0	14.1	12.9
53.6	51.1	18.3	17.4	16.2	15.6	15.0	14.1	12.9
59.0	56.3	18.3	17.4	16.2	15.6	15.0	14.1	12.9

## 3-9. Floor/Ceiling type

### ■ Model: ABUA12TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
5.0	3.2	8.1	8.1	8.1	8.0	8.0	8.0	8.0
10.4	8.6	9.1	9.0	9.0	9.0	8.9	8.9	8.9
15.8	14.0	9.9	9.9	9.8	9.8	9.8	9.8	9.7
17.0	15.0	10.1	10.1	10.0	10.0	10.0	9.9	9.9
23.0	21.2	11.2	11.2	11.1	11.1	11.0	11.0	10.9
26.6	24.8	11.8	11.8	11.7	11.7	11.6	11.6	11.0
30.2	28.4	12.4	12.4	12.3	12.2	12.2	12.1	11.0
32.0	30.2	12.7	12.6	12.6	12.5	12.5	12.1	11.0
35.6	33.8	13.3	13.2	13.2	13.1	12.8	12.1	11.0
41.0	39.2	14.4	14.3	14.0	13.5	12.9	12.2	11.2
47.0	43.0	15.0	14.9	14.0	13.5	12.9	12.2	11.2
48.2	46.0	15.5	15.0	14.0	13.5	12.9	12.2	11.2
53.6	51.1	15.8	15.0	14.0	13.5	12.9	12.2	11.2
59.0	56.3	15.8	15.0	14.0	13.5	12.9	12.2	11.2

### ■ Model: ABUA14TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0
5.0	3.2	9.4	9.4	9.4	9.3	9.3	9.3	9.3
10.4	8.6	10.5	10.4	10.4	10.4	10.3	10.3	10.3
15.8	14.0	11.5	11.4	11.4	11.4	11.3	11.3	11.2
17.0	15.0	11.7	11.6	11.6	11.5	11.5	11.5	11.4
23.0	21.2	12.9	12.9	12.8	12.8	12.7	12.7	12.6
26.6	24.8	13.6	13.6	13.5	13.5	13.4	13.4	12.7
30.2	28.4	14.3	14.3	14.2	14.1	14.1	13.9	12.7
32.0	30.2	14.7	14.6	14.5	14.5	14.4	13.9	12.7
35.6	33.8	15.4	15.3	15.2	15.2	14.8	13.9	12.7
41.0	39.2	16.6	16.5	16.2	15.6	15.0	14.1	12.9
47.0	43.0	17.4	17.3	16.2	15.6	15.0	14.1	12.9
48.2	46.0	18.0	17.4	16.2	15.6	15.0	14.1	12.9
53.6	51.1	18.3	17.4	16.2	15.6	15.0	14.1	12.9
59.0	56.3	18.3	17.4	16.2	15.6	15.0	14.1	12.9

### ■ Model: ABUA18TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

# Model: ABUA24TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3

MODEL  
SELECTIONMODEL  
SELECTION

## 3-10. Ceiling type

### ■ Model: ABUA30TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	17.7	17.7	17.7	17.6	17.6	17.6	17.5
5.0	3.2	20.5	20.4	20.4	20.3	20.3	20.3	20.2
10.4	8.6	22.8	22.7	22.6	22.6	22.5	22.5	22.4
15.8	14.0	25.0	24.9	24.8	24.8	24.7	24.6	24.5
17.0	15.0	25.4	25.3	25.2	25.1	25.1	25.0	24.9
23.0	21.2	28.2	28.1	28.0	27.9	27.8	27.7	27.6
26.6	24.8	29.7	29.6	29.4	29.4	29.3	29.2	27.8
30.2	28.4	31.2	31.1	30.9	30.8	30.8	30.4	27.8
32.0	30.2	32.1	31.9	31.6	31.5	31.4	30.4	27.8
35.6	33.8	33.6	33.4	33.1	33.0	32.3	30.4	27.8
41.0	39.2	36.1	36.0	35.3	34.0	32.6	30.7	28.1
47.0	43.0	37.9	37.6	35.3	34.0	32.6	30.7	28.1
48.2	46.0	39.1	37.9	35.3	34.0	32.6	30.7	28.1
53.6	51.1	39.8	37.9	35.3	34.0	32.6	30.7	28.1
59.0	56.3	39.8	37.9	35.3	34.0	32.6	30.7	28.1

### ■ Model: ABUA36TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
		TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	20.8	20.8	20.8	20.7	20.7	20.7	20.6
5.0	3.2	24.1	24.0	24.0	23.8	23.8	23.8	23.7
10.4	8.6	26.9	26.8	26.6	26.6	26.5	26.5	26.4
15.8	14.0	29.4	29.3	29.1	29.1	29.0	28.9	28.8
17.0	15.0	29.9	29.8	29.7	29.5	29.5	29.4	29.3
23.0	21.2	33.2	33.1	32.9	32.8	32.7	32.6	32.4
26.6	24.8	35.0	34.8	34.6	34.6	34.4	34.3	32.7
30.2	28.4	36.7	36.6	36.3	36.2	36.2	35.7	32.7
32.0	30.2	37.7	37.5	37.2	37.1	37.0	35.7	32.7
35.6	33.8	39.5	39.2	39.0	38.9	38.0	35.7	32.7
41.0	39.2	42.5	42.4	41.5	40.0	38.4	36.1	33.1
47.0	43.0	44.5	44.3	41.5	40.0	38.4	36.1	33.1
48.2	46.0	46.1	44.5	41.5	40.0	38.4	36.1	33.1
53.6	51.1	46.8	44.5	41.5	40.0	38.4	36.1	33.1
59.0	56.3	46.8	44.5	41.5	40.0	38.4	36.1	33.1

## 3-11. Wall mounted type

### ■ Model: ASUA4TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	2.3	2.3	2.3	2.3	2.3	2.3	2.3
5.0	3.2	2.7	2.6	2.6	2.6	2.6	2.6	2.6
10.4	8.6	3.0	2.9	2.9	2.9	2.9	2.9	2.9
15.8	14.0	3.2	3.2	3.2	3.2	3.2	3.2	3.2
17.0	15.0	3.3	3.3	3.3	3.2	3.2	3.2	3.2
23.0	21.2	3.7	3.6	3.6	3.6	3.6	3.6	3.6
26.6	24.8	3.8	3.8	3.8	3.8	3.8	3.8	3.6
30.2	28.4	4.0	4.0	4.0	4.0	4.0	3.9	3.6
32.0	30.2	4.2	4.1	4.1	4.1	4.1	3.9	3.6
35.6	33.8	4.3	4.3	4.3	4.3	4.2	3.9	3.6
41.0	39.2	4.7	4.7	4.6	4.4	4.2	4.0	3.6
47.0	43.0	4.9	4.9	4.6	4.4	4.2	4.0	3.6
48.2	46.0	5.1	4.9	4.6	4.4	4.2	4.0	3.6
53.6	51.1	5.1	4.9	4.6	4.4	4.2	4.0	3.6
59.0	56.3	5.1	4.9	4.6	4.4	4.2	4.0	3.6

### ■ Model: ASUA7TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	4.9	4.9	4.9	4.9	4.9	4.9	4.9
5.0	3.2	5.7	5.7	5.7	5.7	5.7	5.7	5.6
10.4	8.6	6.4	6.4	6.3	6.3	6.3	6.3	6.3
15.8	14.0	7.0	7.0	6.9	6.9	6.9	6.9	6.8
17.0	15.0	7.1	7.1	7.0	7.0	7.0	7.0	7.0
23.0	21.2	7.9	7.9	7.8	7.8	7.8	7.7	7.7
26.6	24.8	8.3	8.3	8.2	8.2	8.2	8.2	7.8
30.2	28.4	8.7	8.7	8.6	8.6	8.6	8.5	7.8
32.0	30.2	9.0	8.9	8.8	8.8	8.8	8.5	7.8
35.6	33.8	9.4	9.3	9.3	9.2	9.0	8.5	7.8
41.0	39.2	10.1	10.1	9.9	9.5	9.1	8.6	7.9
47.0	43.0	10.6	10.5	9.9	9.5	9.1	8.6	7.9
48.2	46.0	10.9	10.6	9.9	9.5	9.1	8.6	7.9
53.6	51.1	11.1	10.6	9.9	9.5	9.1	8.6	7.9
59.0	56.3	11.1	10.6	9.9	9.5	9.1	8.6	7.9

### ■ Model: ASUA9TLAV2

Outdoor temperature		Indoor temperature						
°FDB	°FWB	61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	5.7	5.7	5.7	5.6	5.6	5.6	5.6
5.0	3.2	6.6	6.5	6.5	6.5	6.5	6.5	6.5
10.4	8.6	7.3	7.3	7.3	7.3	7.2	7.2	7.2
15.8	14.0	8.0	8.0	7.9	7.9	7.9	7.9	7.8
17.0	15.0	8.1	8.1	8.1	8.0	8.0	8.0	8.0
23.0	21.2	9.0	9.0	9.0	8.9	8.9	8.9	8.8
26.6	24.8	9.5	9.5	9.4	9.4	9.4	9.4	8.9
30.2	28.4	10.0	10.0	9.9	9.9	9.9	9.7	8.9
32.0	30.2	10.3	10.2	10.1	10.1	10.1	9.7	8.9
35.6	33.8	10.8	10.7	10.6	10.6	10.3	9.7	8.9
41.0	39.2	11.6	11.6	11.3	10.9	10.5	9.8	9.0
47.0	43.0	12.1	12.1	11.3	10.9	10.5	9.8	9.0
48.2	46.0	12.6	12.1	11.3	10.9	10.5	9.8	9.0
53.6	51.1	12.8	12.1	11.3	10.9	10.5	9.8	9.0
59.0	56.3	12.8	12.1	11.3	10.9	10.5	9.8	9.0



## Model: ASUA12TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
5.0	3.2	8.1	8.1	8.1	8.0	8.0	8.0	8.0
10.4	8.6	9.1	9.0	9.0	9.0	8.9	8.9	8.9
15.8	14.0	9.9	9.9	9.8	9.8	9.8	9.8	9.7
17.0	15.0	10.1	10.1	10.0	10.0	10.0	9.9	9.9
23.0	21.2	11.2	11.2	11.1	11.1	11.0	11.0	10.9
26.6	24.8	11.8	11.8	11.7	11.7	11.6	11.6	11.0
30.2	28.4	12.4	12.4	12.3	12.2	12.2	12.1	11.0
32.0	30.2	12.7	12.6	12.6	12.5	12.5	12.1	11.0
35.6	33.8	13.3	13.2	13.2	13.1	12.8	12.1	11.0
41.0	39.2	14.4	14.3	14.0	13.5	12.9	12.2	11.2
47.0	43.0	15.0	14.9	14.0	13.5	12.9	12.2	11.2
48.2	46.0	15.5	15.0	14.0	13.5	12.9	12.2	11.2
53.6	51.1	15.8	15.0	14.0	13.5	12.9	12.2	11.2
59.0	56.3	15.8	15.0	14.0	13.5	12.9	12.2	11.2

## Model: ASUA14TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0
5.0	3.2	9.4	9.4	9.4	9.3	9.3	9.3	9.3
10.4	8.6	10.5	10.4	10.4	10.4	10.3	10.3	10.3
15.8	14.0	11.5	11.4	11.4	11.4	11.3	11.3	11.2
17.0	15.0	11.7	11.6	11.6	11.5	11.5	11.5	11.4
23.0	21.2	12.9	12.9	12.8	12.8	12.7	12.7	12.6
26.6	24.8	13.6	13.6	13.5	13.5	13.4	13.4	12.7
30.2	28.4	14.3	14.3	14.2	14.1	14.1	13.9	12.7
32.0	30.2	14.7	14.6	14.5	14.5	14.4	13.9	12.7
35.6	33.8	15.4	15.3	15.2	15.2	14.8	13.9	12.7
41.0	39.2	16.6	16.5	16.2	15.6	15.0	14.1	12.9
47.0	43.0	17.4	17.3	16.2	15.6	15.0	14.1	12.9
48.2	46.0	18.0	17.4	16.2	15.6	15.0	14.1	12.9
53.6	51.1	18.3	17.4	16.2	15.6	15.0	14.1	12.9
59.0	56.3	18.3	17.4	16.2	15.6	15.0	14.1	12.9

## Model: ASUB18TLAV1

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

## Model: ASUB24TLAV1

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3

## Model: ASUA30TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	17.7	17.7	17.7	17.6	17.6	17.6	17.5
5.0	3.2	20.5	20.4	20.4	20.3	20.3	20.3	20.2
10.4	8.6	22.8	22.7	22.6	22.6	22.5	22.5	22.4
15.8	14.0	25.0	24.9	24.8	24.8	24.7	24.6	24.5
17.0	15.0	25.4	25.3	25.2	25.1	25.1	25.0	24.9
23.0	21.2	28.2	28.1	28.0	27.9	27.8	27.7	27.6
26.6	24.8	29.7	29.6	29.4	29.4	29.3	29.2	27.8
30.2	28.4	31.2	31.1	30.9	30.8	30.8	30.4	27.8
32.0	30.2	32.1	31.9	31.6	31.5	31.4	30.4	27.8
35.6	33.8	33.6	33.4	33.1	33.0	32.3	30.4	27.8
41.0	39.2	36.1	36.0	35.3	34.0	32.6	30.7	28.1
47.0	43.0	37.9	37.6	35.3	34.0	32.6	30.7	28.1
48.2	46.0	39.1	37.9	35.3	34.0	32.6	30.7	28.1
53.6	51.1	39.8	37.9	35.3	34.0	32.6	30.7	28.1
59.0	56.3	39.8	37.9	35.3	34.0	32.6	30.7	28.1

## Model: ASUA36TLAV2

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	19.8	19.8	19.8	19.7	19.7	19.7	19.5
5.0	3.2	22.9	22.8	22.8	22.7	22.7	22.7	22.5
10.4	8.6	25.5	25.4	25.3	25.3	25.2	25.2	25.1
15.8	14.0	27.9	27.8	27.7	27.7	27.6	27.5	27.3
17.0	15.0	28.4	28.3	28.2	28.1	28.1	27.9	27.8
23.0	21.2	31.5	31.4	31.3	31.2	31.0	30.9	30.8
26.6	24.8	33.2	33.1	32.8	32.8	32.7	32.6	31.0
30.2	28.4	34.9	34.8	34.5	34.4	34.4	33.9	31.0
32.0	30.2	35.8	35.6	35.4	35.2	35.1	33.9	31.0
35.6	33.8	37.5	37.3	37.0	36.9	36.1	33.9	31.0
41.0	39.2	40.4	40.3	39.4	38.0	36.4	34.3	31.4
47.0	43.0	42.3	42.1	39.4	38.0	36.4	34.3	31.4
48.2	46.0	43.8	42.3	39.4	38.0	36.4	34.3	31.4
53.6	51.1	44.5	42.3	39.4	38.0	36.4	34.3	31.4
59.0	56.3	44.5	42.3	39.4	38.0	36.4	34.3	31.4

## Model: ASUA7TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	4.9	4.9	4.9	4.9	4.9	4.9	4.9
5.0	3.2	5.7	5.7	5.7	5.7	5.7	5.7	5.6
10.4	8.6	6.4	6.4	6.3	6.3	6.3	6.3	6.3
15.8	14.0	7.0	7.0	6.9	6.9	6.9	6.9	6.8
17.0	15.0	7.1	7.1	7.0	7.0	7.0	7.0	7.0
23.0	21.2	7.9	7.9	7.8	7.8	7.8	7.7	7.7
26.6	24.8	8.3	8.3	8.2	8.2	8.2	8.2	7.8
30.2	28.4	8.7	8.7	8.6	8.6	8.6	8.5	7.8
32.0	30.2	9.0	8.9	8.8	8.8	8.8	8.5	7.8
35.6	33.8	9.4	9.3	9.3	9.2	9.0	8.5	7.8
41.0	39.2	10.1	10.1	9.9	9.5	9.1	8.6	7.9
47.0	43.0	10.6	10.5	9.9	9.5	9.1	8.6	7.9
48.2	46.0	10.9	10.6	9.9	9.5	9.1	8.6	7.9
53.6	51.1	11.1	10.6	9.9	9.5	9.1	8.6	7.9
59.0	56.3	11.1	10.6	9.9	9.5	9.1	8.6	7.9

## Model: ASUA9TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	5.7	5.7	5.7	5.6	5.6	5.6	5.6
5.0	3.2	6.6	6.5	6.5	6.5	6.5	6.5	6.5
10.4	8.6	7.3	7.3	7.3	7.3	7.2	7.2	7.2
15.8	14.0	8.0	8.0	7.9	7.9	7.9	7.9	7.8
17.0	15.0	8.1	8.1	8.1	8.0	8.0	8.0	8.0
23.0	21.2	9.0	9.0	9.0	8.9	8.9	8.9	8.8
26.6	24.8	9.5	9.5	9.4	9.4	9.4	9.4	8.9
30.2	28.4	10.0	10.0	9.9	9.9	9.9	9.7	8.9
32.0	30.2	10.3	10.2	10.1	10.1	10.1	9.7	8.9
35.6	33.8	10.8	10.7	10.6	10.6	10.3	9.7	8.9
41.0	39.2	11.6	11.6	11.3	10.9	10.5	9.8	9.0
47.0	43.0	12.1	12.1	11.3	10.9	10.5	9.8	9.0
48.2	46.0	12.6	12.1	11.3	10.9	10.5	9.8	9.0
53.6	51.1	12.8	12.1	11.3	10.9	10.5	9.8	9.0
59.0	56.3	12.8	12.1	11.3	10.9	10.5	9.8	9.0

## Model: ASUA12TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
5.0	3.2	8.1	8.1	8.1	8.0	8.0	8.0	8.0
10.4	8.6	9.1	9.0	9.0	9.0	8.9	8.9	8.9
15.8	14.0	9.9	9.9	9.8	9.8	9.8	9.8	9.7
17.0	15.0	10.1	10.1	10.0	10.0	10.0	9.9	9.9
23.0	21.2	11.2	11.2	11.1	11.1	11.0	11.0	10.9
26.6	24.8	11.8	11.8	11.7	11.7	11.6	11.6	11.0
30.2	28.4	12.4	12.4	12.3	12.2	12.2	12.1	11.0
32.0	30.2	12.7	12.6	12.6	12.5	12.5	12.1	11.0
35.6	33.8	13.3	13.2	13.2	13.1	12.8	12.1	11.0
41.0	39.2	14.4	14.3	14.0	13.5	12.9	12.2	11.2
47.0	43.0	15.0	14.9	14.0	13.5	12.9	12.2	11.2
48.2	46.0	15.5	15.0	14.0	13.5	12.9	12.2	11.2
53.6	51.1	15.8	15.0	14.0	13.5	12.9	12.2	11.2
59.0	56.3	15.8	15.0	14.0	13.5	12.9	12.2	11.2

## Model: ASUA14TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0
5.0	3.2	9.4	9.4	9.4	9.3	9.3	9.3	9.3
10.4	8.6	10.5	10.4	10.4	10.4	10.3	10.3	10.3
15.8	14.0	11.5	11.4	11.4	11.4	11.3	11.3	11.2
17.0	15.0	11.7	11.6	11.6	11.5	11.5	11.5	11.4
23.0	21.2	12.9	12.9	12.8	12.8	12.7	12.7	12.6
26.6	24.8	13.6	13.6	13.5	13.5	13.4	13.4	12.7
30.2	28.4	14.3	14.3	14.2	14.1	14.1	13.9	12.7
32.0	30.2	14.7	14.6	14.5	14.5	14.4	13.9	12.7
35.6	33.8	15.4	15.3	15.2	15.2	14.8	13.9	12.7
41.0	39.2	16.6	16.5	16.2	15.6	15.0	14.1	12.9
47.0	43.0	17.4	17.3	16.2	15.6	15.0	14.1	12.9
48.2	46.0	18.0	17.4	16.2	15.6	15.0	14.1	12.9
53.6	51.1	18.3	17.4	16.2	15.6	15.0	14.1	12.9
59.0	56.3	18.3	17.4	16.2	15.6	15.0	14.1	12.9

## Model: ASUB18TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	10.4	10.4	10.4	10.3	10.3	10.3	10.3
5.0	3.2	12.1	12.0	12.0	11.9	11.9	11.9	11.9
10.4	8.6	13.4	13.4	13.3	13.3	13.2	13.2	13.2
15.8	14.0	14.7	14.6	14.6	14.6	14.5	14.4	14.4
17.0	15.0	15.0	14.9	14.8	14.8	14.8	14.7	14.6
23.0	21.2	16.6	16.5	16.5	16.4	16.3	16.3	16.2
26.6	24.8	17.5	17.4	17.3	17.3	17.2	17.2	16.3
30.2	28.4	18.4	18.3	18.2	18.1	18.1	17.9	16.3
32.0	30.2	18.9	18.7	18.6	18.5	18.5	17.9	16.3
35.6	33.8	19.7	19.6	19.5	19.4	19.0	17.9	16.3
41.0	39.2	21.3	21.2	20.8	20.0	19.2	18.0	16.5
47.0	43.0	22.3	22.1	20.8	20.0	19.2	18.0	16.5
48.2	46.0	23.0	22.3	20.8	20.0	19.2	18.0	16.5
53.6	51.1	23.4	22.3	20.8	20.0	19.2	18.0	16.5
59.0	56.3	23.4	22.3	20.8	20.0	19.2	18.0	16.5

## Model: ASUB24TLAV

Outdoor temperature		Indoor temperature						
		61°FDB	64°FDB	68°FDB	70°FDB	72°FDB	75°FDB	79°FDB
°FDB	°FWB	TC	TC	TC	TC	TC	TC	TC
-2.7	-4.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9
5.0	3.2	16.3	16.2	16.2	16.1	16.1	16.1	16.0
10.4	8.6	18.1	18.1	18.0	18.0	17.9	17.9	17.8
15.8	14.0	19.8	19.8	19.7	19.7	19.6	19.5	19.4
17.0	15.0	20.2	20.1	20.0	19.9	19.9	19.8	19.8
23.0	21.2	22.4	22.3	22.2	22.1	22.1	22.0	21.9
26.6	24.8	23.6	23.5	23.3	23.3	23.3	23.2	22.1
30.2	28.4	24.8	24.7	24.5	24.4	24.4	24.1	22.1
32.0	30.2	25.5	25.3	25.1	25.0	25.0	24.1	22.1
35.6	33.8	26.7	26.5	26.3	26.2	25.6	24.1	22.1
41.0	39.2	28.7	28.6	28.0	27.0	25.9	24.4	22.3
47.0	43.0	30.1	29.9	28.0	27.0	25.9	24.4	22.3
48.2	46.0	31.1	30.1	28.0	27.0	25.9	24.4	22.3
53.6	51.1	31.6	30.1	28.0	27.0	25.9	24.4	22.3
59.0	56.3	31.6	30.1	28.0	27.0	25.9	24.4	22.3

## 4. Cooling capacity table (Outdoor unit)

- TC: Total capacity (kBtu/h)
- IP: Input power of compressor and outdoor fan motor (kW)
- The data is based on the following conditions:
  - Pipe length: 25 ft (7.5 m)
  - Height difference: 0 ft (0 m)

### 4-1. Stand-alone

#### Model: AOUA72RLBV1

Cooling capacity at rated condition: 72 kBtu/h (6 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
		°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC
108.0 (150%)	50	68.8	3.56	78.6	4.02	85.2	4.28	86.4	4.28	89.9	4.26	91.1	4.26	95.9	4.23	97.1	4.22
	59	68.8	3.66	78.6	4.14	84.6	4.37	85.7	4.37	89.2	4.35	90.4	4.35	95.1	4.32	96.3	4.31
	70	68.8	3.87	78.6	4.38	83.3	4.54	84.4	4.54	87.9	4.53	89.0	4.52	93.7	4.50	94.9	4.49
	73	68.8	3.94	78.6	4.46	82.9	4.60	84.0	4.59	87.4	4.58	88.6	4.58	93.1	4.57	94.2	4.58
	77	68.8	4.05	78.6	4.59	82.2	4.68	83.4	4.68	86.5	4.71	87.5	4.72	91.5	4.77	92.5	4.78
	81	68.8	4.18	78.6	4.77	81.0	4.85	82.0	4.86	84.9	4.90	85.9	4.92	89.9	4.97	90.9	4.98
	86	68.8	4.35	77.2	5.05	79.2	5.09	80.1	5.10	83.0	5.15	84.0	5.16	87.8	5.21	88.8	5.23
	91	68.8	4.71	75.4	5.29	77.3	5.33	78.3	5.35	81.1	5.39	82.0	5.41	85.8	5.47	86.7	5.48
	95	68.8	5.04	73.9	5.49	75.8	5.53	76.7	5.55	79.4	5.61	80.3	5.63	84.0	5.70	84.9	5.72
	99	68.8	5.43	72.3	5.71	74.1	5.75	75.0	5.77	77.7	5.84	78.6	5.86	82.2	5.93	83.2	5.95
	104	68.6	5.93	70.3	5.98	72.1	6.03	73.0	6.05	75.6	6.12	76.5	6.14	80.0	6.23	80.9	6.25
	109	66.6	6.21	68.3	6.26	70.0	6.31	70.8	6.34	73.4	6.41	74.3	6.43	77.8	6.53	78.6	6.55
	115	64.1	6.53	65.8	6.59	67.5	6.65	68.3	6.68	70.8	6.76	71.7	6.79	75.0	6.89	75.9	6.92
100.8 (140%)	50	64.2	3.34	73.4	3.77	82.5	4.20	84.9	4.28	88.4	4.27	89.6	4.26	94.2	4.24	95.4	4.23
	59	64.2	3.44	73.4	3.88	82.5	4.33	84.3	4.37	87.7	4.36	88.9	4.35	93.5	4.33	94.7	4.32
	70	64.2	3.63	73.4	4.11	81.9	4.54	83.1	4.54	86.4	4.53	87.6	4.53	92.1	4.51	93.3	4.50
	73	64.2	3.70	73.4	4.19	81.5	4.60	82.6	4.60	86.0	4.59	87.1	4.59	91.7	4.57	92.8	4.57
	77	64.2	3.80	73.4	4.30	80.9	4.68	82.0	4.68	85.2	4.69	86.2	4.70	90.2	4.75	91.2	4.76
	81	64.2	3.92	73.4	4.43	79.8	4.83	80.8	4.84	83.7	4.89	84.7	4.90	88.6	4.95	89.6	4.96
	86	64.2	4.08	73.4	4.72	78.1	5.07	79.0	5.08	81.9	5.13	82.8	5.14	86.6	5.20	87.6	5.21
	91	64.2	4.29	73.4	5.15	76.3	5.31	77.2	5.33	80.0	5.38	80.9	5.39	84.6	5.45	85.5	5.46
	95	64.2	4.59	73.0	5.47	74.8	5.51	75.7	5.53	78.4	5.59	79.3	5.61	82.9	5.68	83.8	5.70
	99	64.2	4.92	71.4	5.69	73.2	5.73	74.1	5.75	76.7	5.81	77.6	5.83	81.2	5.91	82.1	5.93
	104	64.2	5.41	69.4	5.96	71.2	6.01	72.0	6.03	74.6	6.10	75.5	6.12	79.0	6.21	79.9	6.23
	109	64.2	5.94	67.4	6.23	69.1	6.28	70.0	6.31	72.5	6.38	73.4	6.41	76.8	6.50	77.7	6.53
	115	63.4	6.51	65.0	6.56	66.7	6.62	67.5	6.65	70.0	6.73	70.8	6.76	74.1	6.86	75.0	6.89
93.6 (130%)	50	59.6	3.12	68.1	3.52	76.6	3.92	80.9	4.13	86.7	4.28	87.8	4.27	92.4	4.25	93.6	4.24
	59	59.6	3.21	68.1	3.63	76.6	4.04	80.9	4.25	86.1	4.37	87.2	4.36	91.7	4.34	92.9	4.33
	70	59.6	3.39	68.1	3.84	76.6	4.28	80.9	4.50	84.8	4.54	85.9	4.53	90.4	4.51	91.5	4.51
	73	59.6	3.46	68.1	3.91	76.6	4.36	80.9	4.58	84.4	4.59	85.5	4.59	89.9	4.57	91.1	4.57
	77	59.6	3.55	68.1	4.02	76.6	4.48	80.5	4.68	83.8	4.68	84.8	4.69	88.7	4.74	89.7	4.75
	81	59.6	3.66	68.1	4.14	76.6	4.62	79.5	4.82	82.4	4.87	83.3	4.88	87.2	4.93	88.2	4.95
	86	59.6	3.81	68.1	4.31	76.6	5.02	77.8	5.06	80.6	5.11	81.5	5.12	85.3	5.18	86.2	5.19
	91	59.6	3.99	68.1	4.65	75.1	5.29	76.0	5.30	78.7	5.35	79.7	5.37	83.3	5.43	84.2	5.44
	95	59.6	4.17	68.1	4.97	73.7	5.48	74.5	5.50	77.2	5.56	78.1	5.58	81.7	5.65	82.6	5.67
	99	59.6	4.45	68.1	5.35	72.1	5.70	73.0	5.72	75.6	5.79	76.5	5.81	80.0	5.89	80.9	5.91
	104	59.6	4.88	68.1	5.88	70.1	5.98	71.0	6.00	73.5	6.07	74.4	6.09	77.8	6.18	78.7	6.20
	109	59.6	5.36	66.5	6.20	68.1	6.25	69.0	6.28	71.5	6.35	72.3	6.38	75.7	6.47	76.5	6.50
	115	59.6	5.99	64.1	6.53	65.7	6.59	66.6	6.62	69.0	6.70	69.8	6.73	73.1	6.83	73.9	6.86
86.4 (120%)	50	55.0	2.90	62.9	3.27	70.7	3.65	74.7	3.83	84.8	4.28	85.9	4.28	90.4	4.26	91.5	4.25
	59	55.0	2.99	62.9	3.37	70.7	3.75	74.7	3.95	84.2	4.37	85.3	4.37	89.7	4.35	90.8	4.35
	70	55.0	3.16	62.9	3.56	70.7	3.97	74.7	4.17	83.0	4.54	84.1	4.54	88.4	4.52	89.6	4.52
	73	55.0	3.22	62.9	3.63	70.7	4.05	74.7	4.25	82.6	4.60	83.7	4.60	88.0	4.58	89.1	4.58
	77	55.0	3.30	62.9	3.73	70.7	4.16	74.7	4.37	82.0	4.68	83.1	4.68	87.0	4.72	88.0	4.73
	81	55.0	3.40	62.9	3.84	70.7	4.28	74.7	4.51	80.9	4.84	81.8	4.86	85.6	4.91	86.5	4.92
	86	55.0	3.54	62.9	4.00	70.7	4.49	74.7	4.84	79.1	5.09	80.0	5.10	83.7	5.16	84.6	5.17
	91	55.0	3.70	62.9	4.19	70.7	4.89	74.7	5.28	77.4	5.33	78.3	5.35	81.8	5.41	82.7	5.42
	95	55.0	3.85	62.9	4.47	70.7	5.24	73.3	5.48	75.9	5.53	76.8	5.55	80.3	5.63	81.1	5.64
	99	55.0	4.02	62.9	4.78	70.7	5.65	71.8	5.69	74.3	5.76	75.2	5.78	78.6	5.86	79.5	5.88
	104	55.0	4.38	62.9	5.25	69.0	5.95	69.8	5.97	72.3	6.04	73.2	6.06	76.6	6.15	77.4	6.17
	109	55.0	4.81	62.9	5.77	67.1	6.22	67.9	6.25	70.3	6.32	71.2	6.34	74.5	6.44	75.3	6.46
	115	55.0	5.37	62.9	6.46	64.7	6.55	65.5	6.58	67.9	6.66	68.7	6.69	71.9	6.79	72.7	6.82
79.2 (110%)	50	50.5	2.69	57.7	3.03	64.8	3.37	68.5	3.54	79.2	4.05	82.8	4.22	88.1	4.27	89.2	4.27
	59	50.5	2.77	57.7	3.12	64.8	3.47	68.5	3.64	79.2	4.17	82.8	4.35	87.5	4.36	88.6	4.36
	70	50.5	2.92	57.7	3.29	64.8	3.66	68.5	3.85	79.2	4.41	82.1	4.54	86.3	4.53	87.3	4.53
	73	50.5	2.97	57.7	3.35	64.8	3.73	68.5	3.93	79.2	4.49	81.7	4.60	85.9	4.59	86.9	4.59
	77	50.5	3.05	57.7	3.44	64.8	3.84	68.5	4.03	79.2	4.62	81.1	4.68	85.1	4.69	86.1	4.70
	81	50.5	3.14	57.7	3.55	64.8	3.95	68.5	4.16	79.1	4.82	80.1	4.83	83.7	4.89	84.7	4.90
	86	50.5	3.27	57.7	3.69	64.8	4.12	68.5	4.33	77.5	5.06	78.4	5.07	82.0	5.13	82.9	5.15
	91	50.5	3.42	57.7	3.86	64.8	4.35	68.5	4.68	75.8	5.30	76.7	5.32	80.2	5.38	81.1	5.39
	95	50.5	3.55	57.7	4.01	64.8	4.65	68.5	5.01	74.4	5.50	75.2	5.52	78.7	5.59	79.5	5.61
	99	50.5	3.70	57.7	4.26	64.8	4.99	68.5	5.39	72.9	5.72	73.7	5.74	77.1	5.82	77.9	5.84
	104	50.5	3.92	57.7	4.66	64.8	5.48	68.5	5.93	71.0	6.00	71.8	6.02	75.1	6.11	75.9	6.13
	109	50.5	4.29	57.7	5.11	64.8	6.02	66.6	6.21	69.0	6.28	69.8	6.31	73.1	6.40	73.9	6.42
	115	50.5	4.78	57.7	5.71	63.5	6.51	64.3	6.54	66.7	6.62	67.5	6.65	70.6	6.75	71.4	6.78

Cooling capacity at rated condition: 72 kBTu/h (6 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
72.0 (100%)	50	45.9	2.47	52.4	2.78	58.9	3.09	62.2	3.24	72.0	3.71	75.3	3.86	85.5	4.28	86.6	4.28
	59	45.9	2.54	52.4	2.86	58.9	3.18	62.2	3.34	72.0	3.82	75.3	3.98	84.9	4.37	86.0	4.37
	70	45.9	2.68	52.4	3.02	58.9	3.36	62.2	3.53	72.0	4.04	75.3	4.21	83.8	4.54	84.8	4.54
	73	45.9	2.73	52.4	3.08	58.9	3.42	62.2	3.60	72.0	4.11	75.3	4.29	83.4	4.60	84.4	4.59
	77	45.9	2.80	52.4	3.16	58.9	3.51	62.2	3.69	72.0	4.23	75.3	4.41	82.8	4.68	83.9	4.68
	81	45.9	2.88	52.4	3.25	58.9	3.62	62.2	3.81	72.0	4.36	75.3	4.54	81.7	4.86	82.6	4.87
	86	45.9	3.00	52.4	3.39	58.9	3.77	62.2	3.96	72.0	4.60	75.3	4.90	80.0	5.10	80.9	5.11
	91	45.9	3.14	52.4	3.54	58.9	3.94	62.2	4.15	72.0	5.02	74.8	5.28	78.3	5.35	79.1	5.36
	95	45.9	3.26	52.4	3.68	58.9	4.10	62.2	4.40	72.0	5.37	73.5	5.48	76.8	5.55	77.7	5.57
	99	45.9	3.39	52.4	3.83	58.9	4.38	62.2	4.71	71.2	5.68	72.0	5.70	75.3	5.78	76.1	5.80
	104	45.9	3.58	52.4	4.11	58.9	4.80	62.2	5.18	69.4	5.96	70.2	5.98	73.4	6.07	74.2	6.09
	109	45.9	3.81	52.4	4.51	58.9	5.27	62.2	5.68	67.5	6.23	68.3	6.26	71.5	6.35	72.3	6.38
	115	45.9	4.24	52.4	5.03	58.9	5.89	62.2	6.36	65.2	6.57	66.0	6.60	69.1	6.70	69.9	6.73
64.8 (90%)	50	41.3	2.25	47.2	2.53	53.0	2.81	56.0	2.95	64.8	3.37	67.8	3.51	79.5	4.06	82.5	4.20
	59	41.3	2.32	47.2	2.60	53.0	2.89	56.0	3.04	64.8	3.47	67.8	3.61	79.5	4.18	82.5	4.33
	70	41.3	2.44	47.2	2.75	53.0	3.05	56.0	3.21	64.8	3.66	67.8	3.82	79.5	4.43	82.0	4.54
	73	41.3	2.49	47.2	2.80	53.0	3.11	56.0	3.27	64.8	3.73	67.8	3.89	79.5	4.51	81.6	4.60
	77	41.3	2.55	47.2	2.87	53.0	3.19	56.0	3.35	64.8	3.83	67.8	4.00	79.5	4.64	81.1	4.68
	81	41.3	2.63	47.2	2.96	53.0	3.29	56.0	3.46	64.8	3.95	67.8	4.12	79.2	4.82	80.1	4.83
	86	41.3	2.73	47.2	3.08	53.0	3.42	56.0	3.60	64.8	4.12	67.8	4.29	77.7	5.06	78.5	5.08
	91	41.3	2.85	47.2	3.21	53.0	3.58	56.0	3.76	64.8	4.34	67.8	4.61	76.0	5.31	76.9	5.32
	95	41.3	2.96	47.2	3.34	53.0	3.72	56.0	3.91	64.8	4.65	67.8	4.94	74.7	5.51	75.5	5.53
	99	41.3	3.08	47.2	3.48	53.0	3.87	56.0	4.11	64.8	4.98	67.8	5.31	73.3	5.73	74.1	5.75
	104	41.3	3.25	47.2	3.67	53.0	4.18	56.0	4.49	64.8	5.48	67.8	5.84	71.4	6.01	72.2	6.03
	109	41.3	3.46	47.2	3.94	53.0	4.58	56.0	4.92	64.8	6.02	66.5	6.20	69.6	6.30	70.4	6.32
	115	41.3	3.76	47.2	4.39	53.0	5.11	56.0	5.49	63.6	6.51	64.3	6.54	67.3	6.64	68.1	6.67
57.6 (80%)	50	36.7	2.04	41.9	2.28	47.1	2.53	49.8	2.66	57.6	3.02	60.2	3.15	70.7	3.64	73.3	3.77
	59	36.7	2.09	41.9	2.35	47.1	2.60	49.8	2.73	57.6	3.11	60.2	3.24	70.7	3.75	73.3	3.88
	70	36.7	2.20	41.9	2.48	47.1	2.75	49.8	2.88	57.6	3.29	60.2	3.43	70.7	3.97	73.3	4.10
	73	36.7	2.24	41.9	2.52	47.1	2.80	49.8	2.94	57.6	3.35	60.2	3.49	70.7	4.04	73.3	4.18
	77	36.7	2.30	41.9	2.59	47.1	2.87	49.8	3.02	57.6	3.44	60.2	3.59	70.7	4.16	73.3	4.30
	81	36.7	2.37	41.9	2.66	47.1	2.96	49.8	3.10	57.6	3.54	60.2	3.69	70.7	4.28	73.3	4.43
	86	36.7	2.46	41.9	2.77	47.1	3.08	49.8	3.23	57.6	3.69	60.2	3.85	70.7	4.48	73.3	4.72
	91	36.7	2.57	41.9	2.89	47.1	3.21	49.8	3.38	57.6	3.86	60.2	4.02	70.7	4.89	73.3	5.14
	95	36.7	2.66	41.9	3.00	47.1	3.34	49.8	3.51	57.6	4.01	60.2	4.22	70.7	5.23	73.0	5.47
	99	36.7	2.77	41.9	3.12	47.1	3.47	49.8	3.65	57.6	4.26	60.2	4.51	70.7	5.64	71.6	5.69
	104	36.7	2.92	41.9	3.30	47.1	3.67	49.8	3.86	57.6	4.66	60.2	4.95	69.1	5.95	69.9	5.97
	109	36.7	3.11	41.9	3.51	47.1	3.94	49.8	4.22	57.6	5.11	60.2	5.43	67.4	6.23	68.1	6.25
	115	36.7	3.37	41.9	3.81	47.1	4.39	49.8	4.70	57.6	5.71	60.2	6.07	65.3	6.57	66.0	6.60
50.4 (70%)	50	32.1	1.82	36.7	2.04	41.3	2.25	43.6	2.36	50.4	2.68	52.7	2.79	61.8	3.23	64.1	3.33
	59	32.1	1.87	36.7	2.09	41.3	2.32	43.6	2.43	50.4	2.76	52.7	2.87	61.8	3.32	64.1	3.43
	70	32.1	1.97	36.7	2.20	41.3	2.44	43.6	2.56	50.4	2.92	52.7	3.03	61.8	3.51	64.1	3.63
	73	32.1	2.00	36.7	2.24	41.3	2.48	43.6	2.61	50.4	2.97	52.7	3.09	61.8	3.57	64.1	3.70
	77	32.1	2.05	36.7	2.30	41.3	2.55	43.6	2.68	50.4	3.05	52.7	3.17	61.8	3.67	64.1	3.80
	81	32.1	2.11	36.7	2.37	41.3	2.62	43.6	2.75	50.4	3.14	52.7	3.27	61.8	3.78	64.1	3.91
	86	32.1	2.19	36.7	2.46	41.3	2.73	43.6	2.87	50.4	3.27	52.7	3.40	61.8	3.94	64.1	4.08
	91	32.1	2.28	36.7	2.57	41.3	2.85	43.6	2.99	50.4	3.41	52.7	3.56	61.8	4.12	64.1	4.28
	95	32.1	2.37	36.7	2.66	41.3	2.96	43.6	3.11	50.4	3.55	52.7	3.69	61.8	4.37	64.1	4.58
	99	32.1	2.46	36.7	2.77	41.3	3.08	43.6	3.23	50.4	3.69	52.7	3.85	61.8	4.67	64.1	4.91
	104	32.1	2.60	36.7	2.92	41.3	3.25	43.6	3.41	50.4	3.91	52.7	4.14	61.8	5.13	64.1	5.40
	109	32.1	2.76	36.7	3.11	41.3	3.46	43.6	3.64	50.4	4.28	52.7	4.54	61.8	5.63	64.1	5.93
	115	32.1	2.99	36.7	3.37	41.3	3.75	43.6	3.97	50.4	4.77	52.7	5.06	61.8	6.30	63.5	6.51
43.2 (60%)	50	27.5	1.60	31.4	1.79	35.4	1.97	37.3	2.07	43.2	2.34	45.2	2.44	53.0	2.81	55.0	2.90
	59	27.5	1.64	31.4	1.84	35.4	2.03	37.3	2.12	43.2	2.41	45.2	2.51	53.0	2.89	55.0	2.99
	70	27.5	1.73	31.4	1.93	35.4	2.13	37.3	2.24	43.2	2.54	45.2	2.64	53.0	3.05	55.0	3.15
	73	27.5	1.76	31.4	1.97	35.4	2.17	37.3	2.28	43.2	2.59	45.2	2.69	53.0	3.11	55.0	3.21
	77	27.5	1.80	31.4	2.02	35.4	2.23	37.3	2.34	43.2	2.66	45.2	2.76	53.0	3.19	55.0	3.30
	81	27.5	1.85	31.4	2.07	35.4	2.29	37.3	2.40	43.2	2.73	45.2	2.84	53.0	3.29	55.0	3.40
	86	27.5	1.92	31.4	2.15	35.4	2.38	37.3	2.50	43.2	2.84	45.2	2.96	53.0	3.42	55.0	3.54
	91	27.5	2.00	31.4	2.24	35.4	2.49	37.3	2.61	43.2	2.97	45.2	3.09	53.0	3.58	55.0	3.70
	95	27.5	2.07	31.4	2.33	35.4	2.58	37.3	2.71	43.2	3.08	45.2	3.21	53.0	3.71	55.0	3.84
	99	27.5	2.15	31.4	2.42	35.4	2.68	37.3	2.81	43.2	3.21	45.2	3.34	53.0	3.87	55.0	4.01
	104	27.5	2.27	31.4	2.55	35.4	2.83	37.3	2.97	43.2	3.39	45.2	3.53	53.0	4.17	55.0	4.38
	109	27.5	2.41	31.4	2.71	35.4	3.01	37.3	3.16	43.2	3.61	45.2	3.76	53.0	4.57	55.0	4.80
	115	27.5	2.60	31.4	2.93	35.4	3.26	37.3	3.43	43.2	3.93	45.2	4.16	53.0	5.10	55.0	5.36
36.0 (50%)	50	22.9	1.39	26.2	1.54	29.5	1.69	31.1	1.77	36.0	2.00	37.6	2				

# Model: AOUA96RLBV1

MODEL  
SELECTIONMODEL  
SELECTION

Cooling capacity at rated condition: 96 kBTU/h (8 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
144.0 (150%)	50	91.8	5.07	104.8	5.73	113.6	6.11	115.2	6.11	119.9	6.08	121.5	6.08	127.8	6.04	129.5	6.02
	59	91.8	5.22	104.8	5.91	112.8	6.24	114.3	6.23	119.0	6.21	120.6	6.21	126.9	6.17	128.5	6.16
	70	91.8	5.52	104.8	6.25	111.1	6.48	112.6	6.48	117.2	6.46	118.8	6.45	125.0	6.42	126.6	6.41
	73	91.8	5.63	104.8	6.37	110.5	6.56	112.0	6.56	116.6	6.55	118.1	6.54	124.3	6.52	125.6	6.53
	77	91.8	5.79	104.8	6.55	109.7	6.69	111.2	6.68	115.4	6.72	116.7	6.73	122.1	6.80	123.5	6.82
	81	91.8	5.96	104.8	6.80	108.0	6.91	109.4	6.94	113.3	7.00	114.7	7.01	119.9	7.08	121.3	7.10
	86	91.8	6.21	103.0	7.21	105.6	7.26	106.9	7.28	110.7	7.35	112.0	7.37	117.2	7.44	118.5	7.46
	91	91.8	6.73	100.6	7.56	103.1	7.61	104.4	7.63	108.1	7.70	109.4	7.72	114.4	7.80	115.7	7.83
	95	91.8	7.20	98.6	7.84	101.0	7.90	102.3	7.93	105.9	8.01	107.2	8.04	112.1	8.14	113.3	8.16
	99	91.8	7.76	96.5	8.16	98.9	8.22	100.1	8.25	103.7	8.34	104.9	8.37	109.7	8.48	110.9	8.50
	104	91.4	8.48	93.8	8.55	96.1	8.62	97.3	8.65	100.8	8.75	102.0	8.78	106.7	8.90	107.9	8.93
	109	88.7	8.87	91.0	8.95	93.3	9.02	94.5	9.06	97.9	9.16	99.1	9.20	103.7	9.33	104.8	9.37
134.4 (140%)	115	85.5	9.35	87.7	9.43	89.9	9.51	91.0	9.55	94.4	9.66	95.5	9.70	100.0	9.85	101.2	9.89
	50	85.7	4.76	97.9	5.38	110.0	6.00	113.3	6.11	117.9	6.09	119.4	6.09	125.7	6.05	127.2	6.04
	59	85.7	4.90	97.9	5.54	110.0	6.18	112.4	6.24	117.0	6.22	118.5	6.22	124.7	6.18	126.3	6.17
	70	85.7	5.18	97.9	5.86	109.3	6.48	110.8	6.48	115.3	6.47	116.8	6.46	122.9	6.43	124.4	6.42
	73	85.7	5.28	97.9	5.97	108.7	6.57	110.2	6.56	114.7	6.55	116.2	6.55	122.2	6.52	123.8	6.51
	77	85.7	5.43	97.9	6.14	107.9	6.69	109.4	6.69	113.7	6.69	115.0	6.71	120.3	6.78	121.7	6.80
	81	85.7	5.59	97.9	6.33	106.5	6.89	107.8	6.91	111.7	6.97	113.0	6.99	118.2	7.06	119.5	7.08
	86	85.7	5.83	97.9	6.74	104.1	7.23	105.4	7.26	109.2	7.32	110.5	7.34	115.6	7.42	116.9	7.44
	91	85.7	6.12	97.9	7.35	101.7	7.58	103.0	7.61	106.7	7.68	107.9	7.70	112.9	7.78	114.1	7.80
	95	85.7	6.55	97.3	7.81	99.7	7.87	100.9	7.90	104.5	7.98	105.7	8.01	110.6	8.11	111.8	8.13
	99	85.7	7.03	95.2	8.12	97.6	8.19	98.8	8.22	102.3	8.30	103.5	8.33	108.3	8.45	109.5	8.47
	104	85.7	7.73	92.6	8.52	94.9	8.58	96.0	8.62	99.5	8.71	100.7	8.75	105.3	8.87	106.5	8.90
124.8 (130%)	109	85.7	8.50	89.9	8.91	92.1	8.98	93.3	9.02	96.7	9.13	97.8	9.16	102.4	9.30	103.5	9.33
	115	84.5	9.31	86.6	9.39	88.8	9.47	89.9	9.51	93.2	9.63	94.4	9.66	98.8	9.81	99.9	9.85
	50	79.5	4.45	90.9	5.03	102.2	5.60	107.9	5.89	115.6	6.10	117.1	6.10	123.2	6.07	124.8	6.06
	59	79.5	4.58	90.9	5.18	102.2	5.77	107.9	6.07	114.8	6.23	116.3	6.23	122.3	6.20	123.8	6.19
	70	79.5	4.84	90.9	5.47	102.2	6.10	107.9	6.42	113.1	6.48	114.6	6.47	120.6	6.45	122.1	6.44
	73	79.5	4.93	90.9	5.58	102.2	6.22	107.9	6.54	112.5	6.56	114.0	6.55	119.9	6.53	121.4	6.52
	77	79.5	5.07	90.9	5.73	102.2	6.39	107.4	6.69	111.7	6.68	113.1	6.68	118.4	6.75	119.7	6.77
	81	79.5	5.22	90.9	5.91	102.2	6.59	106.1	6.88	109.9	6.94	111.2	6.96	116.3	7.04	117.6	7.06
	86	79.5	5.44	90.9	6.15	102.2	7.17	103.7	7.23	107.5	7.29	108.7	7.32	113.7	7.39	115.0	7.41
	91	79.5	5.69	90.9	6.63	100.1	7.55	101.4	7.58	105.0	7.65	106.3	7.67	111.1	7.75	112.4	7.77
	95	79.5	5.94	90.9	7.10	98.2	7.83	99.4	7.86	103.0	7.95	104.2	7.97	108.9	8.08	110.1	8.10
	99	79.5	6.36	90.9	7.65	96.1	8.15	97.3	8.18	100.8	8.27	102.0	8.30	106.7	8.41	107.8	8.44
115.2 (120%)	104	79.5	6.97	90.9	8.41	93.5	8.54	94.7	8.58	98.1	8.67	99.2	8.71	103.8	8.83	105.0	8.86
	109	79.5	7.66	88.6	8.87	90.9	8.94	92.0	8.98	95.3	9.08	96.4	9.12	100.9	9.25	102.1	9.29
	115	79.5	8.57	85.5	9.34	87.6	9.42	88.7	9.46	92.0	9.58	93.1	9.62	97.4	9.77	98.5	9.81
	50	73.4	4.14	83.9	4.67	94.3	5.20	99.6	5.47	113.1	6.11	114.6	6.11	120.5	6.08	122.0	6.07
	59	73.4	4.26	83.9	4.81	94.3	5.36	99.6	5.63	112.3	6.24	113.8	6.23	119.6	6.21	121.1	6.20
	70	73.4	4.50	83.9	5.08	94.3	5.67	99.6	5.96	110.7	6.48	112.2	6.48	118.0	6.46	119.4	6.45
	73	73.4	4.58	83.9	5.18	94.3	5.77	99.6	6.07	110.2	6.56	111.6	6.56	117.4	6.54	118.8	6.54
	77	73.4	4.71	83.9	5.32	94.3	5.93	99.6	6.24	109.4	6.69	110.8	6.68	116.1	6.73	117.4	6.74
	81	73.4	4.85	83.9	5.48	94.3	6.12	99.6	6.43	107.9	6.91	109.1	6.93	114.2	7.01	115.4	7.03
	86	73.4	5.05	83.9	5.71	94.3	6.40	99.6	6.91	105.5	7.26	106.8	7.28	111.7	7.36	112.9	7.38
	91	73.4	5.28	83.9	5.98	94.3	6.98	99.6	7.54	103.2	7.61	104.4	7.63	109.2	7.72	110.4	7.74
	95	73.4	5.49	83.9	6.37	94.3	7.48	97.7	7.82	101.2	7.90	102.4	7.93	107.0	8.04	108.2	8.06
105.6 (110%)	99	73.4	5.73	83.9	6.83	94.3	8.07	95.7	8.14	99.1	8.22	100.3	8.25	104.8	8.37	106.0	8.39
	104	73.4	6.26	83.9	7.51	92.0	8.50	93.1	8.53	96.5	8.63	97.6	8.66	102.1	8.78	103.2	8.81
	109	73.4	6.87	83.9	8.25	89.4	8.89	90.5	8.93	93.8	9.04	94.9	9.07	99.3	9.21	100.4	9.24
	115	73.4	7.68	83.9	9.24	86.2	9.37	87.3	9.41	90.5	9.53	91.6	9.57	95.9	9.72	97.0	9.75
	50	67.3	3.83	76.9	4.32	86.5	4.80	91.3	5.05	105.6	5.77	110.4	6.02	117.5	6.10	118.9	6.09
	59	67.3	3.94	76.9	4.44	86.5	4.95	91.3	5.20	105.6	5.95	110.4	6.20	116.7	6.22	118.1	6.22
	70	67.3	4.16	76.9	4.69	86.5	5.23	91.3	5.50	105.6	6.29	109.4	6.48	115.1	6.47	116.5	6.46
	73	67.3	4.24	76.9	4.78	86.5	5.33	91.3	5.60	105.6	6.42	108.9	6.57	114.5	6.55	115.9	6.55
	77	67.3	4.35	76.9	4.91	86.5	5.47	91.3	5.76	105.6	6.60	108.1	6.69	113.6	6.69	114.9	6.71
	81	67.3	4.48	76.9	5.06	86.5	5.64	91.3	5.93	105.6	6.87	106.8	6.89	111.7	6.97	113.0	6.99
	86	67.3	4.67	76.9	5.27	86.5	5.88	91.3	6.18	103.3	7.22	104.5	7.24	109.4	7.33	110.6	7.34
	91	67.3	4.88	76.9	5.51	86.5	6.20	91.3	6.67	101.1	7.57	102.2	7.59	106.9	7.68	108.1	7.70
96.0 (100%)	95	67.3	5.07	76.9	5.73	86.5	6.64	91.3	7.15	99.2	7.86	100.3	7.88	104.9	7.99	106.1	8.01
	99	67.3	5.27	76.9	6.08	86.5	7.12	91.3	7.70	97.2	8.17	98.3	8.20	102.8	8.32	103.9	8.34
	104	67.3	5.59	76.9	6.66	86.5	7.83	91.3	8.47	94.6	8.58	95.7	8.61	100.1	8.73	101.2	8.76
	109	67.3	6.13	76.9	7.31	86.5	8.62	88.8	8.87	92.0	8.98	93.1	9.01	97.4	9.15	98.5	9.18
	115	67.3	6.84	76.9	8.18	84.7	9.32	85.7	9.35	88.9	9						



Cooling capacity at rated condition: 96 kBTu/h (8 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
86.4 (90%)	50	55.1	3.21	62.9	3.61	70.7	4.00	74.7	4.20	86.4	4.80	90.4	5.00	106.0	5.80	110.0	6.00
	59	55.1	3.30	62.9	3.71	70.7	4.12	74.7	4.33	86.4	4.94	90.4	5.15	106.0	5.97	110.0	6.18
	70	55.1	3.48	62.9	3.91	70.7	4.35	74.7	4.57	86.4	5.22	90.4	5.44	106.0	6.32	109.3	6.48
	73	55.1	3.54	62.9	3.99	70.7	4.43	74.7	4.66	86.4	5.32	90.4	5.55	106.0	6.44	108.9	6.57
	77	55.1	3.63	62.9	4.09	70.7	4.55	74.7	4.78	86.4	5.47	90.4	5.70	106.0	6.62	108.1	6.69
	81	55.1	3.74	62.9	4.21	70.7	4.69	74.7	4.93	86.4	5.64	90.4	5.88	105.7	6.87	106.9	6.89
	86	55.1	3.89	62.9	4.39	70.7	4.88	74.7	5.13	86.4	5.87	90.4	6.12	103.6	7.22	104.7	7.25
	91	55.1	4.06	62.9	4.58	70.7	5.10	74.7	5.37	86.4	6.20	90.4	6.58	101.4	7.58	102.5	7.60
	95	55.1	4.22	62.9	4.76	70.7	5.30	74.7	5.58	86.4	6.63	90.4	7.05	99.6	7.87	100.7	7.89
	99	55.1	4.39	62.9	4.96	70.7	5.52	74.7	5.86	86.4	7.12	90.4	7.59	97.7	8.19	98.8	8.22
	104	55.1	4.64	62.9	5.24	70.7	5.96	74.7	6.41	86.4	7.83	90.4	8.35	95.3	8.59	96.3	8.62
	109	55.1	4.94	62.9	5.62	70.7	6.54	74.7	7.03	86.4	8.61	88.7	8.87	92.8	9.00	93.8	9.04
76.8 (80%)	115	55.1	5.36	62.9	6.27	70.7	7.30	74.7	7.86	84.8	9.32	85.8	9.36	89.7	9.50	90.8	9.54
	50	48.9	2.90	55.9	3.25	62.9	3.60	66.4	3.78	76.8	4.31	80.3	4.49	94.3	5.20	97.8	5.38
	59	48.9	2.98	55.9	3.34	62.9	3.71	66.4	3.89	76.8	4.44	80.3	4.62	94.3	5.35	97.8	5.54
	70	48.9	3.14	55.9	3.53	62.9	3.91	66.4	4.11	76.8	4.69	80.3	4.89	94.3	5.66	97.8	5.86
	73	48.9	3.19	55.9	3.59	62.9	3.99	66.4	4.19	76.8	4.78	80.3	4.98	94.3	5.77	97.8	5.97
	77	48.9	3.28	55.9	3.68	62.9	4.09	66.4	4.30	76.8	4.91	80.3	5.11	94.3	5.93	97.8	6.14
	81	48.9	3.37	55.9	3.79	62.9	4.21	66.4	4.43	76.8	5.06	80.3	5.27	94.3	6.11	97.8	6.32
	86	48.9	3.51	55.9	3.95	62.9	4.39	66.4	4.61	76.8	5.27	80.3	5.49	94.3	6.40	97.8	6.73
	91	48.9	3.66	55.9	4.12	62.9	4.58	66.4	4.82	76.8	5.51	80.3	5.74	94.3	6.98	97.8	7.34
	95	48.9	3.80	55.9	4.28	62.9	4.76	66.4	5.00	76.8	5.72	80.3	6.02	94.3	7.47	97.4	7.81
	99	48.9	3.95	55.9	4.45	62.9	4.95	66.4	5.21	76.8	6.07	80.3	6.44	94.3	8.06	95.5	8.13
	104	48.9	4.17	55.9	4.70	62.9	5.24	66.4	5.51	76.8	6.65	80.3	7.07	92.2	8.50	93.2	8.53
	109	48.9	4.44	55.9	5.01	62.9	5.62	66.4	6.02	76.8	7.30	80.3	7.76	89.8	8.91	90.8	8.94
67.2 (70%)	115	48.9	4.81	55.9	5.44	62.9	6.26	66.4	6.72	76.8	8.17	80.3	8.69	87.0	9.40	88.0	9.44
	50	42.8	2.59	48.9	2.89	55.0	3.20	58.1	3.36	67.2	3.82	70.3	3.98	82.5	4.60	85.5	4.76
	59	42.8	2.66	48.9	2.98	55.0	3.30	58.1	3.46	67.2	3.94	70.3	4.10	82.5	4.74	85.5	4.90
	70	42.8	2.80	48.9	3.14	55.0	3.48	58.1	3.65	67.2	4.15	70.3	4.33	82.5	5.00	85.5	5.18
	73	42.8	2.85	48.9	3.19	55.0	3.54	58.1	3.71	67.2	4.23	70.3	4.41	82.5	5.10	85.5	5.27
	77	42.8	2.92	48.9	3.28	55.0	3.63	58.1	3.81	67.2	4.35	70.3	4.53	82.5	5.24	85.5	5.42
	81	42.8	3.00	48.9	3.37	55.0	3.74	58.1	3.92	67.2	4.48	70.3	4.66	82.5	5.40	85.5	5.59
	86	42.8	3.12	48.9	3.50	55.0	3.89	58.1	4.08	67.2	4.66	70.3	4.85	82.5	5.62	85.5	5.82
	91	42.8	3.25	48.9	3.66	55.0	4.06	58.1	4.26	67.2	4.87	70.3	5.07	82.5	5.88	85.5	6.11
	95	42.8	3.37	48.9	3.79	55.0	4.22	58.1	4.43	67.2	5.06	70.3	5.27	82.5	6.23	85.5	6.54
	99	42.8	3.51	48.9	3.95	55.0	4.39	58.1	4.61	67.2	5.27	70.3	5.49	82.5	6.67	85.5	7.02
	104	42.8	3.70	48.9	4.17	55.0	4.63	58.1	4.87	67.2	5.58	70.3	5.91	82.5	7.33	85.5	7.72
	109	42.8	3.93	48.9	4.43	55.0	4.94	58.1	5.19	67.2	6.12	70.3	6.48	82.5	8.06	85.5	8.48
57.6 (60%)	115	42.8	4.26	48.9	4.81	55.0	5.35	58.1	5.67	67.2	6.83	70.3	7.24	82.5	9.02	84.6	9.31
	50	36.7	2.28	41.9	2.54	47.2	2.81	49.8	2.94	57.6	3.34	60.2	3.47	70.7	4.00	73.3	4.13
	59	36.7	2.34	41.9	2.61	47.2	2.88	49.8	3.02	57.6	3.43	60.2	3.57	70.7	4.12	73.3	4.26
	70	36.7	2.46	41.9	2.75	47.2	3.04	49.8	3.18	57.6	3.62	60.2	3.77	70.7	4.35	73.3	4.50
	73	36.7	2.50	41.9	2.79	47.2	3.09	49.8	3.24	57.6	3.69	60.2	3.84	70.7	4.43	73.3	4.58
	77	36.7	2.56	41.9	2.87	47.2	3.17	49.8	3.33	57.6	3.78	60.2	3.94	70.7	4.55	73.3	4.70
	81	36.7	2.63	41.9	2.95	47.2	3.26	49.8	3.42	57.6	3.89	60.2	4.05	70.7	4.69	73.3	4.85
	86	36.7	2.73	41.9	3.06	47.2	3.39	49.8	3.56	57.6	4.05	60.2	4.22	70.7	4.88	73.3	5.05
	91	36.7	2.85	41.9	3.19	47.2	3.54	49.8	3.71	57.6	4.23	60.2	4.41	70.7	5.10	73.3	5.28
	95	36.7	2.95	41.9	3.31	47.2	3.67	49.8	3.85	57.6	4.39	60.2	4.58	70.7	5.30	73.3	5.48
	99	36.7	3.06	41.9	3.44	47.2	3.82	49.8	4.01	57.6	4.57	60.2	4.76	70.7	5.52	73.3	5.72
	104	36.7	3.23	41.9	3.63	47.2	4.03	49.8	4.23	57.6	4.83	60.2	5.03	70.7	5.96	73.3	6.25
	109	36.7	3.43	41.9	3.86	47.2	4.29	49.8	4.51	57.6	5.15	60.2	5.37	70.7	6.53	73.3	6.86
48.0 (50%)	115	36.7	3.71	41.9	4.18	47.2	4.65	49.8	4.89	57.6	5.62	60.2	5.94	70.7	7.30	73.3	7.66
	50	30.6	1.96	34.9	2.19	39.3	2.41	41.5	2.52	48.0	2.85	50.2	2.96	58.9	3.40	61.1	3.51
	59	30.6	2.01	34.9	2.24	39.3	2.47	41.5	2.59	48.0	2.93	50.2	3.04	58.9	3.50	61.1	3.62
	70	30.6	2.11	34.9	2.36	39.3	2.60	41.5	2.72	48.0	3.09	50.2	3.21	58.9	3.69	61.1	3.81
	73	30.6	2.15	34.9	2.40	39.3	2.64	41.5	2.77	48.0	3.14	50.2	3.26	58.9	3.76	61.1	3.88
	77	30.6	2.20	34.9	2.46	39.3	2.71	41.5	2.84	48.0	3.22	50.2	3.35	58.9	3.86	61.1	3.99
	81	30.6	2.26	34.9	2.52	39.3	2.79	41.5	2.92	48.0	3.31	50.2	3.45	58.9	3.97	61.1	4.11
	86	30.6	2.34	34.9	2.62	39.3	2.89	41.5	3.03	48.0	3.45	50.2	3.58	58.9	4.13	61.1	4.27
	91	30.6	2.44	34.9	2.73	39.3	3.02	41.5	3.16	48.0	3.60	50.2	3.74	58.9	4.32	61.1	4.46
	95	30.6	2.53	34.9	2.83	39.3	3.13	41.5	3.28	48.0	3.73	50.2	3.88	58.9	4.48	61.1	4.64
	99	30.6	2.62	34.9	2.94	39.3	3.25	41.5	3.41	48.0	3.88	50.2	4.04	58.9	4.67	61.1	4.83
	104	30.6	2.76	34.9	3.09	39.3	3.43	41.5	3.59	48.0	4.09	50.2	4.26	58.9	4.93	61.1	5.10
	109	30.6	2.93	34.9	3.28	39.3	3.64	41.5	3.82	48.0	4.36	50.2	4.54	58.9	5.26	61.1	5.44
48.0 (50%)	115	30.6	3.16	34.9	3.55	39.3	3.94	41.5	4.14	48.0	4.72	50.2	4.92	58.9	5.77	61.1	6.04

# Model: AOUA120RLBV1

MODEL  
SELECTIONMODEL  
SELECTION

Cooling capacity at rated condition: 120 kBTU/h (10 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
180.0 (150%)	50	114.7	6.52	131.0	7.37	142.6	7.89	144.5	7.88	150.4	7.86	152.4	7.85	160.4	7.80	162.4	7.78
	59	114.7	6.71	131.0	7.60	141.5	8.06	143.4	8.05	149.3	8.02	151.2	8.01	159.1	7.97	161.2	7.95
	70	114.7	7.10	131.0	8.04	139.4	8.37	141.3	8.36	147.0	8.34	149.0	8.33	156.8	8.29	158.8	8.28
	73	114.7	7.23	131.0	8.19	138.6	8.48	140.5	8.47	146.3	8.45	148.2	8.44	155.8	8.42	157.6	8.44
	77	114.7	7.44	131.0	8.42	137.6	8.63	139.5	8.63	144.7	8.68	146.4	8.70	153.1	8.79	154.8	8.81
	81	114.7	7.66	131.0	8.74	135.5	8.94	137.2	8.96	142.1	9.04	143.8	9.07	150.4	9.16	152.1	9.18
	86	114.7	7.99	129.2	9.33	132.4	9.39	134.0	9.42	138.9	9.50	140.5	9.52	147.0	9.62	148.6	9.64
	91	114.7	8.64	126.2	9.77	129.3	9.84	130.9	9.87	135.6	9.96	137.2	9.98	143.5	10.09	145.0	10.12
	95	114.7	9.26	123.7	10.14	126.7	10.22	128.2	10.25	132.8	10.36	134.4	10.39	140.5	10.53	142.1	10.56
	99	114.7	9.97	121.0	10.55	123.9	10.63	125.5	10.67	130.0	10.78	131.5	10.82	137.5	10.96	139.1	11.00
	104	114.6	10.97	117.5	11.06	120.5	11.14	122.0	11.19	126.4	11.31	127.8	11.36	133.8	11.52	135.3	11.55
	109	111.2	11.47	114.1	11.57	117.0	11.67	118.4	11.71	122.7	11.85	124.2	11.90	130.0	12.07	131.4	12.12
168.0 (140%)	115	107.1	12.09	109.9	12.19	112.7	12.30	114.1	12.35	118.3	12.50	119.7	12.55	125.4	12.75	126.8	12.79
	50	107.1	6.12	122.3	6.91	137.5	7.71	142.1	7.89	147.9	7.87	149.8	7.86	157.6	7.81	159.6	7.80
	59	107.1	6.30	122.3	7.12	137.5	7.95	141.0	8.06	146.7	8.04	148.7	8.03	156.4	7.98	158.4	7.97
	70	107.1	6.66	122.3	7.53	137.1	8.37	139.0	8.37	144.6	8.35	146.5	8.35	154.1	8.31	156.1	8.30
	73	107.1	6.79	122.3	7.68	136.4	8.48	138.2	8.48	143.8	8.46	145.8	8.45	153.4	8.42	155.2	8.42
	77	107.1	6.97	122.3	7.89	135.3	8.64	137.2	8.63	142.6	8.65	144.2	8.67	150.9	8.76	152.6	8.78
	81	107.1	7.19	122.3	8.13	133.6	8.90	135.2	8.93	140.1	9.01	141.7	9.04	148.3	9.13	149.9	9.15
	86	107.1	7.49	122.3	8.66	130.6	9.35	132.2	9.38	136.9	9.47	138.5	9.49	144.9	9.59	146.5	9.62
	91	107.1	7.87	122.3	9.45	127.5	9.80	129.1	9.83	133.7	9.92	135.3	9.95	141.5	10.06	143.1	10.08
	95	107.1	8.43	122.0	10.10	125.0	10.18	126.6	10.21	131.1	10.32	132.6	10.35	138.6	10.49	140.2	10.52
	99	107.1	9.04	119.4	10.50	122.3	10.58	123.8	10.62	128.3	10.74	129.8	10.78	135.7	10.92	137.2	10.96
	104	107.1	9.94	116.1	11.01	118.9	11.10	120.4	11.14	124.7	11.27	126.2	11.31	132.1	11.47	133.5	11.51
156.0 (130%)	109	107.1	10.93	112.7	11.52	115.5	11.62	116.9	11.67	121.2	11.80	122.6	11.85	128.3	12.02	129.8	12.07
	115	105.9	12.04	108.6	12.14	111.4	12.25	112.7	12.30	116.9	12.45	118.3	12.50	123.8	12.69	125.3	12.74
	50	99.4	5.72	113.6	6.46	127.7	7.20	134.8	7.57	145.0	7.88	146.9	7.87	154.6	7.83	156.5	7.82
	59	99.4	5.89	113.6	6.65	127.7	7.41	134.8	7.80	144.0	8.05	145.9	8.04	153.4	8.00	155.3	7.99
	70	99.4	6.22	113.6	7.03	127.7	7.84	134.8	8.25	141.9	8.36	143.8	8.36	151.2	8.32	153.1	8.31
	73	99.4	6.34	113.6	7.17	127.7	8.00	134.8	8.41	141.2	8.47	143.0	8.46	150.5	8.43	152.3	8.42
	77	99.4	6.51	113.6	7.37	127.7	8.22	134.7	8.64	140.1	8.63	141.9	8.64	148.4	8.73	150.1	8.75
	81	99.4	6.71	113.6	7.59	127.7	8.47	133.0	8.89	137.8	8.97	139.4	9.00	145.9	9.10	147.5	9.12
	86	99.4	6.99	113.6	7.91	127.7	9.21	130.1	9.34	134.8	9.43	136.4	9.46	142.6	9.56	144.2	9.58
	91	99.4	7.31	113.6	8.52	125.6	9.76	127.1	9.79	131.7	9.88	133.2	9.91	139.3	10.02	140.9	10.05
	95	99.4	7.64	113.6	9.13	123.2	10.13	124.7	10.17	129.1	10.27	130.6	10.31	136.6	10.44	138.1	10.47
	99	99.4	8.17	113.6	9.83	120.5	10.53	122.0	10.57	126.4	10.69	127.9	10.73	133.7	10.87	135.2	10.91
144.0 (120%)	104	99.4	8.96	113.6	10.82	117.2	11.05	118.7	11.09	122.9	11.22	124.4	11.26	130.1	11.42	131.6	11.46
	109	99.4	9.85	111.1	11.47	113.9	11.56	115.3	11.61	119.5	11.75	120.9	11.79	126.5	11.97	127.9	12.01
	115	99.4	11.03	107.1	12.08	109.8	12.19	111.2	12.24	115.3	12.39	116.6	12.44	122.1	12.63	123.5	12.68
	50	91.8	5.32	104.8	6.00	117.9	6.68	124.5	7.03	141.9	7.89	143.7	7.89	151.2	7.85	153.0	7.84
	59	91.8	5.48	104.8	6.18	117.9	6.88	124.5	7.24	140.9	8.06	142.7	8.05	150.1	8.02	151.9	8.01
	70	91.8	5.78	104.8	6.53	117.9	7.28	124.5	7.66	138.9	8.37	140.7	8.37	148.0	8.34	149.8	8.33
	73	91.8	5.89	104.8	6.66	117.9	7.42	124.5	7.80	138.2	8.48	140.0	8.47	147.2	8.45	149.1	8.44
	77	91.8	6.05	104.8	6.84	117.9	7.63	124.5	8.02	137.2	8.63	139.0	8.63	145.6	8.69	147.2	8.71
	81	91.8	6.23	104.8	7.05	117.9	7.86	124.5	8.27	135.3	8.93	136.8	8.96	143.1	9.06	144.7	9.08
	86	91.8	6.49	104.8	7.34	117.9	8.23	124.5	8.88	132.3	9.38	133.9	9.41	140.0	9.52	141.6	9.54
	91	91.8	6.79	104.8	7.68	117.9	8.97	124.5	9.69	129.4	9.84	130.9	9.87	136.9	9.98	138.4	10.00
	95	91.8	7.05	104.8	8.19	117.9	9.62	122.5	10.11	126.9	10.22	128.3	10.26	134.2	10.39	135.7	10.42
132.0 (110%)	99	91.8	7.37	104.8	8.78	117.9	10.38	120.0	10.52	124.2	10.63	125.7	10.67	131.4	10.82	132.9	10.85
	104	91.8	8.05	104.8	9.65	115.3	10.99	116.7	11.03	120.9	11.16	122.3	11.20	128.0	11.36	129.4	11.40
	109	91.8	8.83	104.8	10.61	112.1	11.50	113.4	11.55	117.5	11.69	118.9	11.73	124.4	11.91	125.8	11.95
	115	91.8	9.87	104.8	11.90	108.1	12.12	109.4	12.17	113.4	12.32	114.8	12.37	120.2	12.57	121.5	12.61
	50	84.1	4.92	96.1	5.54	108.1	6.17	114.1	6.49	132.0	7.42	138.0	7.74	147.3	7.87	149.2	7.86
	59	84.1	5.06	96.1	5.71	108.1	6.35	114.1	6.68	132.0	7.65	138.0	7.97	146.3	8.04	148.1	8.03
	70	84.1	5.34	96.1	6.03	108.1	6.72	114.1	7.06	132.0	8.09	137.3	8.37	144.3	8.35	146.1	8.35
	73	84.1	5.44	96.1	6.14	108.1	6.84	114.1	7.20	132.0	8.25	136.6	8.48	143.6	8.46	145.4	8.46
	77	84.1	5.59	96.1	6.31	108.1	7.03	114.1	7.40	132.0	8.48	135.6	8.64	142.4	8.65	144.0	8.67
	81	84.1	5.76	96.1	6.50	108.1	7.25	114.1	7.62	132.0	8.84	133.9	8.91	140.1	9.01	141.6	9.03
	86	84.1	5.99	96.1	6.77	108.1	7.55	114.1	7.95	129.6	9.33	131.1	9.36	137.1	9.47	138.6	9.49
	91	84.1	6.27	96.1	7.08	108.1	7.97	114.1	8.58	126.7	9.78	128.2	9.81	134.1	9.93	135.6	9.96
120.0 (100%)	95	84.1	6.51	96.1	7.36	108.1	8.53	114.1	9.19	124.4	10.16	125.8	10.19	131.5	10.33	133.0	10.36
	99	84.1	6.78	96.1	7.82	108.1	9.16	114.1	9.90	121.8	10.57	123.2	10.61	128.9	10.75	130.3	10.79
	104	84.1	7.19	96.1	8.56	108.1											



Cooling capacity at rated condition: 120 kBTu/h (10 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
108.0 (90%)	50	68.8	4.12	78.6	4.63	88.4	5.14	93.4	5.40	108.0	6.17	112.9	6.43	132.5	7.45	137.5	7.71
	59	68.8	4.24	78.6	4.76	88.4	5.29	93.4	5.56	108.0	6.35	112.9	6.62	132.5	7.68	137.5	7.94
	70	68.8	4.47	78.6	5.03	88.4	5.59	93.4	5.87	108.0	6.71	112.9	7.00	132.5	8.12	137.1	8.37
	73	68.8	4.55	78.6	5.12	88.4	5.69	93.4	5.98	108.0	6.84	112.9	7.13	132.5	8.28	136.5	8.48
	77	68.8	4.67	78.6	5.26	88.4	5.85	93.4	6.15	108.0	7.03	112.9	7.33	132.5	8.51	135.6	8.64
	81	68.8	4.81	78.6	5.41	88.4	6.02	93.4	6.33	108.0	7.24	112.9	7.55	132.5	8.89	134.0	8.91
	86	68.8	5.00	78.6	5.64	88.4	6.27	93.4	6.60	108.0	7.55	112.9	7.87	129.8	9.34	131.3	9.36
	91	68.8	5.22	78.6	5.89	88.4	6.56	93.4	6.90	108.0	7.96	112.9	8.46	127.1	9.79	128.5	9.82
	95	68.8	5.42	78.6	6.12	88.4	6.82	93.4	7.17	108.0	8.52	112.9	9.06	124.9	10.17	126.3	10.21
	99	68.8	5.64	78.6	6.37	88.4	7.10	93.4	7.53	108.0	9.15	112.9	9.75	122.5	10.59	123.8	10.62
	104	68.8	5.96	78.6	6.73	88.4	7.67	93.4	8.23	108.0	10.06	112.9	10.73	119.4	11.11	120.7	11.15
	109	68.8	6.35	78.6	7.23	88.4	8.41	93.4	9.04	108.0	11.07	111.1	11.47	116.3	11.64	117.6	11.69
96.0 (80%)	115	68.8	6.89	78.6	8.06	88.4	9.39	93.4	10.11	106.2	12.05	107.5	12.10	112.5	12.29	113.7	12.33
	50	61.2	3.72	69.9	4.17	78.6	4.63	83.0	4.86	96.0	5.54	100.4	5.77	117.8	6.68	122.2	6.91
	59	61.2	3.82	69.9	4.29	78.6	4.76	83.0	5.00	96.0	5.70	100.4	5.94	117.8	6.88	122.2	7.12
	70	61.2	4.03	69.9	4.53	78.6	5.03	83.0	5.28	96.0	6.03	100.4	6.28	117.8	7.28	122.2	7.53
	73	61.2	4.10	69.9	4.61	78.6	5.12	83.0	5.38	96.0	6.14	100.4	6.40	117.8	7.42	122.2	7.67
	77	61.2	4.21	69.9	4.73	78.6	5.26	83.0	5.52	96.0	6.31	100.4	6.57	117.8	7.62	122.2	7.89
	81	61.2	4.33	69.9	4.87	78.6	5.41	83.0	5.69	96.0	6.50	100.4	6.77	117.8	7.85	122.2	8.13
	86	61.2	4.50	69.9	5.07	78.6	5.63	83.0	5.92	96.0	6.77	100.4	7.05	117.8	8.22	122.2	8.65
	91	61.2	4.70	69.9	5.29	78.6	5.89	83.0	6.19	96.0	7.08	100.4	7.38	117.8	8.97	122.2	9.44
	95	61.2	4.88	69.9	5.50	78.6	6.12	83.0	6.43	96.0	7.35	100.4	7.74	117.8	9.61	122.0	10.10
	99	61.2	5.07	69.9	5.72	78.6	6.37	83.0	6.69	96.0	7.81	100.4	8.28	117.8	10.37	119.7	10.51
	104	61.2	5.35	69.9	6.04	78.6	6.73	83.0	7.08	96.0	8.55	100.4	9.09	115.5	10.99	116.8	11.03
	109	61.2	5.70	69.9	6.44	78.6	7.23	83.0	7.74	96.0	9.39	100.4	9.98	112.6	11.52	113.8	11.56
84.0 (70%)	115	61.2	6.18	69.9	6.98	78.6	8.05	83.0	8.64	96.0	10.50	100.4	11.18	109.0	12.16	110.2	12.20
	50	53.5	3.32	61.1	3.72	68.8	4.12	72.6	4.32	84.0	4.91	87.8	5.11	103.1	5.91	106.9	6.11
	59	53.5	3.41	61.1	3.82	68.8	4.23	72.6	4.44	84.0	5.06	87.8	5.26	103.1	6.09	106.9	6.29
	70	53.5	3.59	61.1	4.03	68.8	4.46	72.6	4.68	84.0	5.34	87.8	5.56	103.1	6.43	106.9	6.65
	73	53.5	3.65	61.1	4.10	68.8	4.54	72.6	4.77	84.0	5.44	87.8	5.66	103.1	6.55	106.9	6.78
	77	53.5	3.75	61.1	4.21	68.8	4.67	72.6	4.90	84.0	5.58	87.8	5.82	103.1	6.73	106.9	6.97
	81	53.5	3.85	61.1	4.33	68.8	4.80	72.6	5.04	84.0	5.75	87.8	5.99	103.1	6.94	106.9	7.18
	86	53.5	4.00	61.1	4.50	68.8	5.00	72.6	5.25	84.0	5.99	87.8	6.24	103.1	7.23	106.9	7.48
	91	53.5	4.18	61.1	4.70	68.8	5.22	72.6	5.48	84.0	6.26	87.8	6.52	103.1	7.56	106.9	7.86
	95	53.5	4.33	61.1	4.87	68.8	5.42	72.6	5.69	84.0	6.50	87.8	6.77	103.1	8.01	106.9	8.41
	99	53.5	4.50	61.1	5.07	68.8	5.64	72.6	5.92	84.0	6.77	87.8	7.06	103.1	8.57	106.9	9.02
	104	53.5	4.75	61.1	5.35	68.8	5.95	72.6	6.26	84.0	7.18	87.8	7.60	103.1	9.42	106.9	9.92
	109	53.5	5.05	61.1	5.70	68.8	6.34	72.6	6.67	84.0	7.86	87.8	8.33	103.1	10.36	106.9	10.91
72.0 (60%)	115	53.5	5.47	61.1	6.18	68.8	6.88	72.6	7.29	84.0	8.78	87.8	9.31	103.1	11.61	106.0	12.04
	50	45.9	2.92	52.4	3.26	58.9	3.60	62.2	3.77	72.0	4.28	75.3	4.46	88.4	5.14	91.6	5.31
	59	45.9	3.00	52.4	3.35	58.9	3.70	62.2	3.88	72.0	4.41	75.3	4.59	88.4	5.29	91.6	5.47
	70	45.9	3.15	52.4	3.53	58.9	3.90	62.2	4.09	72.0	4.65	75.3	4.84	88.4	5.59	91.6	5.78
	73	45.9	3.21	52.4	3.59	58.9	3.97	62.2	4.16	72.0	4.73	75.3	4.93	88.4	5.69	91.6	5.88
	77	45.9	3.29	52.4	3.68	58.9	4.07	62.2	4.27	72.0	4.86	75.3	5.06	88.4	5.85	91.6	6.04
	81	45.9	3.38	52.4	3.78	58.9	4.19	62.2	4.39	72.0	5.00	75.3	5.21	88.4	6.02	91.6	6.23
	86	45.9	3.51	52.4	3.93	58.9	4.36	62.2	4.57	72.0	5.21	75.3	5.42	88.4	6.27	91.6	6.48
	91	45.9	3.65	52.4	4.10	58.9	4.55	62.2	4.77	72.0	5.44	75.3	5.66	88.4	6.55	91.6	6.78
	95	45.9	3.79	52.4	4.25	58.9	4.72	62.2	4.95	72.0	5.65	75.3	5.88	88.4	6.81	91.6	7.04
	99	45.9	3.93	52.4	4.42	58.9	4.91	62.2	5.15	72.0	5.88	75.3	6.12	88.4	7.09	91.6	7.36
	104	45.9	4.15	52.4	4.66	58.9	5.18	62.2	5.44	72.0	6.21	75.3	6.47	88.4	7.66	91.6	8.04
	109	45.9	4.41	52.4	4.96	58.9	5.51	62.2	5.79	72.0	6.62	75.3	6.90	88.4	8.40	91.6	8.82
60.0 (50%)	115	45.9	4.76	52.4	5.37	58.9	5.97	62.2	6.28	72.0	7.22	75.3	7.63	88.4	9.38	91.6	9.86
	50	38.2	2.52	43.7	2.80	49.1	3.09	51.9	3.23	60.0	3.66	62.7	3.80	73.6	4.37	76.4	4.51
	59	38.2	2.58	43.7	2.88	49.1	3.17	51.9	3.32	60.0	3.76	62.7	3.91	73.6	4.50	76.4	4.64
	70	38.2	2.71	43.7	3.03	49.1	3.34	51.9	3.49	60.0	3.96	62.7	4.12	73.6	4.74	76.4	4.90
	73	38.2	2.76	43.7	3.08	49.1	3.40	51.9	3.56	60.0	4.03	62.7	4.19	73.6	4.83	76.4	4.99
	77	38.2	2.82	43.7	3.15	49.1	3.48	51.9	3.65	60.0	4.14	62.7	4.30	73.6	4.96	76.4	5.12
	81	38.2	2.90	43.7	3.24	49.1	3.58	51.9	3.75	60.0	4.26	62.7	4.43	73.6	5.10	76.4	5.28
	86	38.2	3.01	43.7	3.36	49.1	3.72	51.9	3.90	60.0	4.42	62.7	4.60	73.6	5.31	76.4	5.49
	91	38.2	3.13	43.7	3.50	49.1	3.88	51.9	4.06	60.0	4.62	62.7	4.81	73.6	5.55	76.4	5.74
	95	38.2	3.24	43.7	3.63	49.1	4.02	51.9	4.21	60.0	4.79	62.7	4.99	73.6	5.76	76.4	5.96
	99	38.2	3.36	43.7	3.77	49.1	4.17	51.9	4.38	60.0	4.98	62.7	5.19	73.6	6.00	76.4	6.20
	104	38.2	3.54	43.7	3.97	49.1	4.40	51.9	4.62	60.0	5.26	62.7	5.48	73.6	6.34	76.4	6.55
	109	38.2	3.76	43.7	4.22	49.1	4.68	51.9	4.91	60.0	5.60	62.7	5.83	73.6	6.75	76.4	6.99
60.0 (50%)	115	38.2	4.06	43.7	4.56	49.1	5.06	51.9	5.32	60.0	6.07	62.7	6.32	73.6	7.42	76.4	7.77

## 4-2. Combination

### Model: AOUA144RLBVG1

Cooling capacity at rated condition: 144 kBtu/h (12 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
216.0 (150%)	50	137.6	7.81	157.2	8.83	170.4	9.41	172.8	9.40	179.8	9.37	182.2	9.35	191.7	9.29	194.2	9.28
	59	137.6	8.05	157.2	9.10	169.1	9.60	171.4	9.59	178.4	9.57	180.8	9.55	190.3	9.50	192.7	9.48
	70	137.6	8.51	157.2	9.62	166.6	9.97	168.9	9.97	175.8	9.94	178.1	9.93	187.4	9.88	189.8	9.87
	73	137.6	8.67	157.2	9.81	165.7	10.10	168.0	10.10	174.8	10.07	177.2	10.06	186.2	10.04	188.3	10.07
	77	137.6	8.91	157.2	10.08	164.4	10.29	166.7	10.28	172.9	10.35	175.0	10.37	183.0	10.48	185.1	10.50
	81	137.6	9.18	157.2	10.48	162.0	10.65	164.0	10.68	169.9	10.77	171.9	10.80	179.8	10.91	181.8	10.94
	86	137.6	9.56	154.5	11.11	158.3	11.18	160.3	11.21	166.0	11.31	168.0	11.34	175.7	11.46	177.6	11.49
	91	137.6	10.35	150.8	11.63	154.6	11.71	156.5	11.75	162.1	11.85	164.0	11.88	171.5	12.01	173.4	12.05
	95	137.6	11.08	147.9	12.07	151.5	12.16	153.4	12.20	158.8	12.33	160.7	12.37	168.0	12.53	169.9	12.56
	99	137.6	11.93	144.7	12.54	148.3	12.64	150.1	12.69	155.4	12.82	157.3	12.87	164.5	13.04	166.3	13.08
	104	137.1	13.04	140.6	13.15	144.1	13.25	145.9	13.30	151.2	13.45	152.9	13.50	160.0	13.69	161.8	13.74
	109	133.1	13.64	136.5	13.75	140.0	13.87	141.7	13.92	146.8	14.09	148.6	14.14	155.5	14.35	157.3	14.40
201.6 (140%)	115	128.3	14.36	131.6	14.48	134.9	14.61	136.6	14.67	141.6	14.85	143.3	14.91	150.1	15.14	151.8	15.20
	50	128.5	7.34	146.7	8.29	165.0	9.24	169.9	9.41	176.8	9.38	179.1	9.37	188.4	9.32	190.8	9.30
	59	128.5	7.55	146.7	8.54	165.0	9.52	168.6	9.60	175.4	9.58	177.7	9.57	187.0	9.52	189.4	9.50
	70	128.5	7.98	146.7	9.03	163.9	9.98	166.1	9.98	172.9	9.96	175.1	9.95	184.3	9.90	186.6	9.89
	73	128.5	8.13	146.7	9.20	163.0	10.11	165.3	10.10	172.0	10.08	174.2	10.08	183.3	10.03	185.5	10.04
	77	128.5	8.36	146.7	9.45	161.8	10.29	164.0	10.29	170.4	10.31	172.4	10.34	180.4	10.45	182.4	10.47
	81	128.5	8.61	146.7	9.74	159.7	10.61	161.6	10.64	167.5	10.74	169.4	10.77	177.2	10.88	179.2	10.91
	86	128.5	8.97	146.7	10.38	156.1	11.14	158.0	11.17	163.7	11.27	165.6	11.31	173.3	11.42	175.2	11.45
	91	128.5	9.43	146.7	11.32	152.5	11.67	154.4	11.71	159.9	11.81	161.8	11.85	169.2	11.97	171.1	12.00
	95	128.5	10.09	145.9	12.02	149.5	12.11	151.4	12.15	156.7	12.28	158.6	12.32	165.8	12.48	167.6	12.52
	99	128.5	10.82	142.8	12.49	146.3	12.59	148.1	12.64	153.4	12.77	155.2	12.82	162.3	12.99	164.1	13.03
	104	128.5	11.88	138.9	13.09	142.3	13.20	144.1	13.25	149.3	13.40	151.0	13.45	158.0	13.64	159.7	13.68
187.2 (130%)	109	128.5	13.06	134.9	13.70	138.2	13.81	139.9	13.86	145.0	14.03	146.7	14.08	153.6	14.29	155.3	14.34
	115	126.7	14.30	130.0	14.42	133.3	14.55	135.0	14.61	139.9	14.79	141.6	14.85	148.2	15.08	149.9	15.14
	50	119.3	6.86	136.3	7.74	153.2	8.62	161.8	9.07	173.4	9.40	175.7	9.39	184.8	9.34	187.1	9.32
	59	119.3	7.06	136.3	7.97	153.2	8.88	161.8	9.34	172.1	9.59	174.4	9.58	183.4	9.54	185.7	9.53
	70	119.3	7.46	136.3	8.43	153.2	9.39	161.8	9.88	169.6	9.97	171.9	9.96	180.8	9.92	183.1	9.91
	73	119.3	7.60	136.3	8.59	153.2	9.58	161.8	10.07	168.8	10.09	171.0	10.09	179.9	10.05	182.1	10.04
	77	119.3	7.81	136.3	8.82	153.2	9.84	161.0	10.29	167.5	10.28	169.6	10.30	177.4	10.41	179.4	10.43
	81	119.3	8.04	136.3	9.09	153.2	10.14	159.0	10.60	164.8	10.69	166.7	10.72	174.4	10.84	176.3	10.87
	86	119.3	8.38	136.3	9.47	153.2	11.03	155.6	11.13	161.1	11.23	163.0	11.26	170.5	11.38	172.4	11.41
	91	119.3	8.76	136.3	10.21	150.2	11.62	152.0	11.66	157.5	11.77	159.3	11.80	166.6	11.93	168.5	11.96
	95	119.3	9.15	136.3	10.93	147.3	12.05	149.1	12.10	154.4	12.22	156.2	12.27	163.3	12.43	165.1	12.46
	99	119.3	9.78	136.3	11.76	144.2	12.53	146.0	12.58	151.2	12.72	152.9	12.76	159.9	12.93	161.7	12.98
172.8 (120%)	104	119.3	10.73	136.3	12.93	140.3	13.13	142.0	13.19	147.1	13.34	148.8	13.39	155.7	13.58	157.4	13.62
	109	119.3	11.77	133.0	13.63	136.3	13.74	138.0	13.80	143.0	13.96	144.7	14.02	151.4	14.22	153.1	14.28
	115	119.3	13.16	128.2	14.36	131.5	14.48	133.1	14.54	138.0	14.72	139.6	14.78	146.2	15.01	147.8	15.07
	50	110.1	6.38	125.8	7.20	141.4	8.01	149.3	8.42	169.7	9.41	171.9	9.40	180.7	9.36	183.0	9.35
	59	110.1	6.57	125.8	7.41	141.4	8.25	149.3	8.68	168.4	9.60	170.6	9.60	179.4	9.56	181.7	9.55
	70	110.1	6.94	125.8	7.83	141.4	8.72	149.3	9.17	166.0	9.98	168.2	9.97	176.9	9.94	179.1	9.93
	73	110.1	7.07	125.8	7.98	141.4	8.89	149.3	9.35	165.2	10.10	167.4	10.10	176.0	10.07	178.2	10.06
	77	110.1	7.26	125.8	8.20	141.4	9.14	149.3	9.61	164.0	10.29	166.2	10.29	174.1	10.36	176.0	10.39
	81	110.1	7.47	125.8	8.44	141.4	9.41	149.3	9.90	161.7	10.64	163.6	10.67	171.1	10.79	173.0	10.82
	86	110.1	7.78	125.8	8.80	141.4	9.86	149.3	10.64	158.2	11.18	160.1	11.21	167.4	11.33	169.3	11.36
	91	110.1	8.14	125.8	9.20	141.4	10.75	149.3	11.60	154.7	11.71	156.5	11.75	163.7	11.88	165.5	11.91
	95	110.1	8.45	125.8	9.81	141.4	11.51	146.6	12.03	151.8	12.16	153.5	12.20	160.5	12.36	162.3	12.40
158.4 (110%)	99	110.1	8.83	125.8	10.50	141.4	12.41	143.5	12.51	148.6	12.65	150.4	12.69	157.2	12.87	159.0	12.91
	104	110.1	9.63	125.8	11.54	138.0	13.06	139.7	13.12	144.7	13.27	146.4	13.32	153.1	13.51	154.8	13.55
	109	110.1	10.57	125.8	12.67	134.1	13.67	135.8	13.73	140.7	13.89	142.3	13.94	148.9	14.15	150.6	14.20
	115	110.1	11.79	125.8	14.19	129.4	14.40	131.0	14.46	135.8	14.64	137.4	14.70	143.9	14.93	145.5	14.99
	50	100.9	5.91	115.3	6.65	129.7	7.40	136.9	7.78	158.4	8.89	165.6	9.27	176.2	9.38	178.4	9.37
	59	100.9	6.08	115.3	6.85	129.7	7.62	136.9	8.01	158.4	9.16	165.6	9.55	174.9	9.58	177.1	9.57
	70	100.9	6.41	115.3	7.23	129.7	8.05	136.9	8.46	158.4	9.69	164.1	9.98	172.5	9.96	174.7	9.95
	73	100.9	6.53	115.3	7.37	129.7	8.20	136.9	8.63	158.4	9.87	163.3	10.11	171.7	10.09	173.8	10.08
	77	100.9	6.71	115.3	7.57	129.7	8.43	136.9	8.86	158.4	10.15	162.2	10.29	170.3	10.31	172.2	10.34
	81	100.9	6.91	115.3	7.80	129.7	8.68	136.9	9.13	158.3	10.58	160.1	10.62	167.5	10.74	169.3	10.77
	86	100.9	7.19	115.3	8.12	129.7	9.05	136.9	9.52	154.9	11.11	156.8	11.15	163.9	11.28	165.8	11.31
	91	100.9	7.51	115.3	8.49	129.7	9.55	136.9	10.28	151.5	11.65	153.3	11.68	160.3	11.82	162.1	11.85
144.0 (100%)	95	100.9	7.80	115.3	8.82	129.7	10.22	136.9	11.00	148.8	12.09	150.5	12.13	157.3	12.29	159.0	12.33

Cooling capacity at rated condition: 144 kBTu/h (12 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
129.6 (90%)	50	82.6	4.95	94.3	5.56	106.1	6.17	112.0	6.48	129.6	7.40	135.5	7.70	159.0	8.92	164.9	9.23
	59	82.6	5.09	94.3	5.72	106.1	6.35	112.0	6.67	129.6	7.61	135.5	7.93	159.0	9.19	164.9	9.51
	70	82.6	5.37	94.3	6.04	106.1	6.71	112.0	7.05	129.6	8.05	135.5	8.39	159.0	9.73	164.0	9.98
	73	82.6	5.46	94.3	6.15	106.1	6.83	112.0	7.18	129.6	8.20	135.5	8.54	159.0	9.91	163.2	10.11
	77	82.6	5.61	94.3	6.31	106.1	7.02	112.0	7.37	129.6	8.43	135.5	8.78	159.0	10.19	162.1	10.29
	81	82.6	5.77	94.3	6.50	106.1	7.23	112.0	7.59	129.6	8.68	135.5	9.05	158.5	10.59	160.2	10.62
	86	82.6	6.00	94.3	6.76	106.1	7.52	112.0	7.91	129.6	9.04	135.5	9.43	155.3	11.12	157.0	11.15
	91	82.6	6.27	94.3	7.06	106.1	7.86	112.0	8.26	129.6	9.54	135.5	10.13	152.1	11.66	153.8	11.69
	95	82.6	6.50	94.3	7.34	106.1	8.17	112.0	8.59	129.6	10.21	135.5	10.85	149.4	12.10	151.0	12.14
	99	82.6	6.77	94.3	7.64	106.1	8.50	112.0	9.02	129.6	10.95	135.5	11.67	146.5	12.59	148.1	12.64
	104	82.6	7.15	94.3	8.07	106.1	9.18	112.0	9.86	129.6	12.03	135.5	12.83	142.9	13.21	144.5	13.26
	109	82.6	7.61	94.3	8.66	106.1	10.06	112.0	10.81	129.6	13.22	133.0	13.63	139.2	13.84	140.7	13.89
	115	82.6	8.25	94.3	9.64	106.1	11.22	112.0	12.07	127.2	14.32	128.7	14.37	134.7	14.60	136.2	14.65
115.2 (80%)	50	73.4	4.47	83.9	5.02	94.3	5.56	99.6	5.83	115.2	6.65	120.5	6.92	141.3	8.01	146.6	8.28
	59	73.4	4.60	83.9	5.16	94.3	5.72	99.6	6.00	115.2	6.84	120.5	7.13	141.3	8.25	146.6	8.53
	70	73.4	4.84	83.9	5.44	94.3	6.04	99.6	6.34	115.2	7.23	120.5	7.53	141.3	8.72	146.6	9.02
	73	73.4	4.93	83.9	5.54	94.3	6.15	99.6	6.45	115.2	7.36	120.5	7.67	141.3	8.88	146.6	9.19
	77	73.4	5.06	83.9	5.68	94.3	6.31	99.6	6.63	115.2	7.56	120.5	7.88	141.3	9.13	146.6	9.45
	81	73.4	5.20	83.9	5.85	94.3	6.50	99.6	6.82	115.2	7.79	120.5	8.12	141.3	9.41	146.6	9.74
	86	73.4	5.41	83.9	6.08	94.3	6.76	99.6	7.10	115.2	8.11	120.5	8.45	141.3	9.85	146.6	10.37
	91	73.4	5.64	83.9	6.35	94.3	7.06	99.6	7.42	115.2	8.48	120.5	8.84	141.3	10.74	146.6	11.30
	95	73.4	5.85	83.9	6.59	94.3	7.33	99.6	7.71	115.2	8.81	120.5	9.27	141.3	11.50	146.0	12.02
	99	73.4	6.09	83.9	6.86	94.3	7.63	99.6	8.02	115.2	9.35	120.5	9.91	141.3	12.40	143.3	12.51
	104	73.4	6.42	83.9	7.24	94.3	8.07	99.6	8.48	115.2	10.23	120.5	10.87	138.3	13.07	139.8	13.12
	109	73.4	6.84	83.9	7.72	94.3	8.65	99.6	9.27	115.2	11.22	120.5	11.93	134.8	13.69	136.3	13.74
	115	73.4	7.41	83.9	8.37	94.3	9.64	99.6	10.33	115.2	12.54	120.5	13.35	130.5	14.44	132.0	14.50
100.8 (70%)	50	64.2	4.00	73.4	4.47	82.5	4.95	87.1	5.19	100.8	5.90	105.4	6.14	123.7	7.09	128.3	7.33
	59	64.2	4.11	73.4	4.60	82.5	5.09	87.1	5.34	100.8	6.07	105.4	6.32	123.7	7.30	128.3	7.55
	70	64.2	4.32	73.4	4.84	82.5	5.36	87.1	5.63	100.8	6.41	105.4	6.67	123.7	7.71	128.3	7.97
	73	64.2	4.40	73.4	4.93	82.5	5.46	87.1	5.73	100.8	6.52	105.4	6.79	123.7	7.86	128.3	8.12
	77	64.2	4.51	73.4	5.06	82.5	5.60	87.1	5.88	100.8	6.70	105.4	6.98	123.7	8.07	128.3	8.35
	81	64.2	4.63	73.4	5.20	82.5	5.77	87.1	6.05	100.8	6.90	105.4	7.18	123.7	8.32	128.3	8.60
	86	64.2	4.81	73.4	5.41	82.5	6.00	87.1	6.30	100.8	7.18	105.4	7.48	123.7	8.66	128.3	8.96
	91	64.2	5.02	73.4	5.64	82.5	6.26	87.1	6.57	100.8	7.50	105.4	7.82	123.7	9.06	128.3	9.42
	95	64.2	5.21	73.4	5.85	82.5	6.50	87.1	6.83	100.8	7.79	105.4	8.12	123.7	9.60	128.3	10.07
	99	64.2	5.41	73.4	6.09	82.5	6.76	87.1	7.10	100.8	8.11	105.4	8.45	123.7	10.27	128.3	10.80
	104	64.2	5.70	73.4	6.42	82.5	7.14	87.1	7.50	100.8	8.60	105.4	9.10	123.7	11.27	128.3	11.86
	109	64.2	6.07	73.4	6.83	82.5	7.60	87.1	7.99	100.8	9.41	105.4	9.97	123.7	12.38	128.3	13.03
	115	64.2	6.57	73.4	7.41	82.5	8.25	87.1	8.73	100.8	10.49	105.4	11.13	123.7	13.85	126.9	14.31
86.4 (60%)	50	55.1	3.52	62.9	3.93	70.7	4.33	74.7	4.54	86.4	5.15	90.3	5.36	106.0	6.17	110.0	6.38
	59	55.1	3.61	62.9	4.03	70.7	4.46	74.7	4.67	86.4	5.30	90.3	5.51	106.0	6.35	110.0	6.56
	70	55.1	3.80	62.9	4.24	70.7	4.69	74.7	4.92	86.4	5.58	90.3	5.81	106.0	6.70	110.0	6.93
	73	55.1	3.86	62.9	4.32	70.7	4.77	74.7	5.00	86.4	5.69	90.3	5.92	106.0	6.83	110.0	7.06
	77	55.1	3.96	62.9	4.43	70.7	4.90	74.7	5.13	86.4	5.84	90.3	6.07	106.0	7.01	110.0	7.25
	81	55.1	4.07	62.9	4.55	70.7	5.04	74.7	5.28	86.4	6.01	90.3	6.25	106.0	7.22	110.0	7.47
	86	55.1	4.22	62.9	4.73	70.7	5.24	74.7	5.49	86.4	6.25	90.3	6.50	106.0	7.52	110.0	7.77
	91	55.1	4.40	62.9	4.93	70.7	5.46	74.7	5.73	86.4	6.53	90.3	6.79	106.0	7.86	110.0	8.13
	95	55.1	4.56	62.9	5.11	70.7	5.67	74.7	5.94	86.4	6.77	90.3	7.05	106.0	8.16	110.0	8.44
	99	55.1	4.73	62.9	5.31	70.7	5.89	74.7	6.18	86.4	7.05	90.3	7.34	106.0	8.50	110.0	8.82
	104	55.1	4.98	62.9	5.60	70.7	6.21	74.7	6.52	86.4	7.44	90.3	7.75	106.0	9.17	110.0	9.62
	109	55.1	5.29	62.9	5.95	70.7	6.61	74.7	6.95	86.4	7.93	90.3	8.26	106.0	10.05	110.0	10.55
	115	55.1	5.72	62.9	6.44	70.7	7.16	74.7	7.53	86.4	8.64	90.3	9.13	106.0	11.21	110.0	11.77
72.0 (50%)	50	45.9	3.04	52.4	3.38	58.9	3.72	62.2	3.89	72.0	4.40	75.3	4.57	88.3	5.25	91.6	5.42
	59	45.9	3.12	52.4	3.47	58.9	3.82	62.2	4.00	72.0	4.52	75.3	4.70	88.3	5.40	91.6	5.58
	70	45.9	3.27	52.4	3.65	58.9	4.02	62.2	4.21	72.0	4.76	75.3	4.95	88.3	5.70	91.6	5.88
	73	45.9	3.33	52.4	3.71	58.9	4.09	62.2	4.28	72.0	4.85	75.3	5.04	88.3	5.80	91.6	5.99
	77	45.9	3.41	52.4	3.80	58.9	4.19	62.2	4.39	72.0	4.97	75.3	5.17	88.3	5.95	91.6	6.15
	81	45.9	3.50	52.4	3.90	58.9	4.31	62.2	4.51	72.0	5.11	75.3	5.32	88.3	6.13	91.6	6.33
	86	45.9	3.63	52.4	4.05	58.9	4.47	62.2	4.69	72.0	5.32	75.3	5.53	88.3	6.37	91.6	6.59
	91	45.9	3.77	52.4	4.22	58.9	4.66	62.2	4.88	72.0	5.55	75.3	5.77	88.3	6.66	91.6	6.88
	95	45.9	3.91	52.4	4.37	58.9	4.83	62.2	5.06	72.0	5.75	75.3	5.99	88.3	6.91	91.6	7.15
	99	45.9	4.05	52.4	4.54	58.9	5.02	62.2	5.26	72.0	5.98	75.3	6.23	88.3	7.19	91.6	7.44
	104	45.9	4.26	52.4	4.77	58.9	5.29	62.2	5.55	72.0	6.31	75.3	6.57	88.3	7.60	91.6	7.86
	109	45.9	4.52	52.4	5.07	58.9	5.62	62.2	5.90	72.0	6.72	75.3	7.00	88.3	8.10	91.6	8.37
	115	45.9	4.88	52.4	5.48	58.9	6.08	62.2	6.38	72.0	7.28	75.3	7.58	88.3	8.88	91.6	9.29

# Model: AOUA168RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Cooling capacity at rated condition: 168 kBTu/h (14 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
252.0 (150%)	50	160.6	9.39	183.4	10.62	198.9	11.32	201.6	11.31	209.8	11.27	212.6	11.25	223.7	11.18	226.5	11.16
	59	160.6	9.68	183.4	10.94	197.3	11.55	200.0	11.54	208.2	11.51	210.9	11.49	222.0	11.42	224.8	11.40
	70	160.6	10.23	183.4	11.58	194.4	12.00	197.1	11.99	205.1	11.96	207.8	11.95	218.7	11.89	221.5	11.87
	73	160.6	10.43	183.4	11.80	193.4	12.15	196.0	12.15	204.0	12.12	206.7	12.11	217.4	12.07	219.8	12.10
	77	160.6	10.71	183.4	12.13	191.9	12.38	194.5	12.37	201.8	12.44	204.2	12.47	213.6	12.60	216.0	12.63
	81	160.6	11.04	183.4	12.60	189.0	12.81	191.4	12.85	198.3	12.96	200.6	12.99	209.8	13.12	212.2	13.15
	86	160.6	11.51	180.3	13.36	184.7	13.45	187.0	13.49	193.8	13.61	196.0	13.64	205.0	13.78	207.3	13.82
	91	160.6	12.45	176.0	14.00	180.4	14.09	182.6	14.13	189.2	14.26	191.4	14.30	200.2	14.45	202.4	14.49
	95	160.6	13.34	172.6	14.52	176.8	14.63	179.0	14.68	185.3	14.83	187.5	14.88	196.1	15.07	198.2	15.12
	99	160.6	14.36	168.8	15.10	173.0	15.21	175.1	15.27	181.4	15.43	183.5	15.49	191.9	15.69	194.1	15.74
	104	160.0	15.70	164.1	15.83	168.2	15.95	170.2	16.01	176.4	16.19	178.4	16.25	186.7	16.48	188.8	16.54
	109	155.3	16.42	159.3	16.56	163.3	16.69	165.3	16.76	171.3	16.96	173.3	17.02	181.4	17.27	183.5	17.34
235.2 (140%)	115	149.6	17.29	153.5	17.44	157.4	17.59	159.3	17.67	165.2	17.88	167.2	17.96	175.1	18.23	177.1	18.30
	50	149.9	8.82	171.2	9.97	192.6	11.11	198.2	11.32	206.3	11.29	209.0	11.27	219.9	11.21	222.6	11.19
	59	149.9	9.08	171.2	10.27	192.5	11.45	196.7	11.55	204.7	11.52	207.4	11.51	218.2	11.45	221.0	11.43
	70	149.9	9.60	171.2	10.86	191.2	12.01	193.8	12.00	201.7	11.98	204.4	11.97	215.0	11.91	217.7	11.90
	73	149.9	9.78	171.2	11.06	190.2	12.16	192.8	12.15	200.7	12.13	203.3	12.12	213.9	12.07	216.5	12.06
	77	149.9	10.05	171.2	11.37	188.8	12.38	191.4	12.38	198.9	12.40	201.2	12.43	210.5	12.56	212.9	12.59
	81	149.9	10.36	171.2	11.72	186.3	12.76	188.6	12.80	195.4	12.91	197.7	12.95	206.8	13.08	209.1	13.11
	86	149.9	10.79	171.2	12.48	182.2	13.40	184.4	13.44	191.1	13.56	193.3	13.60	202.2	13.74	204.4	13.77
	91	149.9	11.34	171.2	13.62	178.0	14.04	180.2	14.08	186.6	14.21	188.8	14.25	197.5	14.40	199.7	14.44
	95	149.9	12.14	170.3	14.46	174.5	14.57	176.6	14.62	182.9	14.78	185.0	14.83	193.5	15.02	195.6	15.06
	99	149.9	13.02	166.6	15.04	170.8	15.15	172.8	15.21	179.0	15.37	181.1	15.43	189.4	15.63	191.5	15.69
	104	149.9	14.31	162.0	15.76	166.0	15.89	168.1	15.95	174.1	16.13	176.2	16.19	184.3	16.42	186.4	16.47
218.4 (130%)	109	149.9	15.73	157.3	16.49	161.3	16.63	163.3	16.69	169.2	16.89	171.2	16.96	179.2	17.21	181.2	17.27
	115	147.8	17.22	151.6	17.37	155.5	17.52	157.4	17.60	163.2	17.81	165.1	17.88	172.9	18.16	174.9	18.23
	50	139.2	8.25	159.0	9.31	178.8	10.37	188.8	10.91	202.3	11.30	205.0	11.29	215.6	11.23	218.3	11.22
	59	139.2	8.49	159.0	9.59	178.8	10.69	188.8	11.24	200.8	11.54	203.5	11.53	214.0	11.47	216.7	11.46
	70	139.2	8.97	159.0	10.14	178.8	11.30	188.8	11.89	197.9	11.99	200.5	11.98	210.9	11.94	213.6	11.92
	73	139.2	9.14	159.0	10.33	178.8	11.52	188.8	12.12	196.9	12.14	199.5	12.14	209.9	12.09	212.5	12.08
	77	139.2	9.39	159.0	10.61	178.8	11.84	187.9	12.38	195.5	12.37	197.9	12.38	207.1	12.51	209.4	12.54
	81	139.2	9.67	159.0	10.94	178.8	12.20	185.6	12.75	192.3	12.86	194.5	12.90	203.5	13.04	205.8	13.07
	86	139.2	10.08	159.0	11.40	178.8	13.27	181.5	13.38	188.1	13.51	190.3	13.55	199.0	13.69	201.2	13.73
	91	139.2	10.53	159.0	12.28	175.2	13.98	177.4	14.03	183.8	14.16	185.9	14.20	194.4	14.35	196.6	14.39
	95	139.2	11.01	159.0	13.15	171.9	14.50	174.0	14.56	180.2	14.71	182.3	14.76	190.6	14.95	192.7	15.00
	99	139.2	11.77	159.0	14.15	168.3	15.08	170.3	15.14	176.4	15.30	178.4	15.36	186.6	15.57	188.7	15.62
201.6 (120%)	104	139.2	12.91	159.0	15.57	163.7	15.81	165.7	15.87	171.6	16.06	173.6	16.11	181.7	16.34	183.7	16.40
	109	139.2	14.17	155.1	16.41	159.0	16.55	161.0	16.62	166.8	16.81	168.8	16.88	176.6	17.13	178.6	17.19
	115	139.2	15.86	149.6	17.29	153.4	17.44	155.3	17.51	161.0	17.73	162.9	17.80	170.5	18.08	172.5	18.14
	50	128.5	7.67	146.8	8.65	165.0	9.63	174.3	10.13	198.0	11.32	200.5	11.31	210.9	11.26	213.5	11.25
	59	128.5	7.90	146.8	8.91	165.0	9.92	174.3	10.44	196.5	11.55	199.1	11.55	209.4	11.50	212.0	11.49
	70	128.5	8.34	146.8	9.42	165.0	10.49	174.3	11.04	193.7	12.00	196.3	11.99	206.4	11.96	209.0	11.95
	73	128.5	8.49	146.8	9.59	165.0	10.69	174.3	11.25	192.8	12.15	195.3	12.15	205.4	12.11	208.0	12.10
	77	128.5	8.73	146.8	9.86	165.0	10.99	174.3	11.56	191.4	12.38	193.9	12.37	203.1	12.46	205.4	12.49
	81	128.5	8.99	146.8	10.16	165.0	11.32	174.3	11.92	188.7	12.80	190.9	12.84	199.7	12.98	202.0	13.01
	86	128.5	9.36	146.8	10.58	165.0	11.86	174.3	12.80	184.7	13.44	186.8	13.48	195.4	13.63	197.6	13.67
	91	128.5	9.78	146.8	11.07	165.0	12.93	174.3	13.96	180.5	14.09	182.6	14.13	191.0	14.29	193.1	14.33
	95	128.5	10.17	146.8	11.80	165.0	13.85	171.0	14.48	177.1	14.63	179.1	14.68	187.3	14.88	189.4	14.92
184.8 (110%)	99	128.5	10.62	146.8	12.64	165.0	14.94	167.4	15.06	173.4	15.22	175.4	15.28	183.5	15.49	185.5	15.54
	104	128.5	11.59	146.8	13.89	161.0	15.73	162.9	15.79	168.8	15.97	170.8	16.03	178.6	16.26	180.6	16.31
	109	128.5	12.71	146.8	15.26	156.4	16.46	158.4	16.53	164.1	16.72	166.0	16.79	173.7	17.04	175.7	17.10
	115	128.5	14.20	146.8	17.10	151.0	17.35	152.8	17.42	158.4	17.63	160.3	17.70	167.8	17.98	169.7	18.05
	50	117.8	7.10	134.5	8.00	151.3	8.90	159.7	9.35	184.8	10.69	193.3	11.15	205.6	11.29	208.1	11.28
	59	117.8	7.30	134.5	8.23	151.3	9.16	159.8	9.63	184.8	11.02	193.3	11.49	204.1	11.53	206.7	11.51
	70	117.8	7.71	134.5	8.69	151.3	9.68	159.7	10.18	184.8	11.66	191.5	12.01	201.3	11.98	203.8	11.97
	73	117.8	7.85	134.5	8.86	151.3	9.86	159.7	10.37	184.8	11.88	190.6	12.16	200.4	12.13	202.8	12.13
	77	117.8	8.06	134.5	9.10	151.3	10.14	159.7	10.66	184.8	12.21	189.2	12.38	198.7	12.39	200.9	12.43
	81	117.8	8.30	134.5	9.37	151.3	10.44	159.7	10.99	184.7	12.73	186.9	12.77	195.5	12.91	197.6	12.95
	86	117.8	8.64	134.5	9.76	151.3	10.88	159.7	11.45	180.8	13.37	182.9	13.41	191.3	13.57	193.4	13.60
	91	117.8	9.03	134.5	10.21	151.3	11.48	159.7	12.36	176.8	14.01	178.9	14.06	187.1	14.22	189.2	14.26
168.0 (100%)	95	117.8	9.38	134.5	10.61												

Cooling capacity at rated condition: 168 kBTu/h (14 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
151.2 (90%)	50	96.3	5.95	110.1	6.68	123.8	7.42	130.7	7.79	151.2	8.89	158.1	9.26	185.5	10.73	192.5	11.11
	59	96.3	6.12	110.1	6.88	123.8	7.64	130.7	8.02	151.2	9.16	158.1	9.54	185.5	11.06	192.5	11.44
	70	96.3	6.45	110.1	7.25	123.8	8.06	130.7	8.47	151.2	9.68	158.1	10.08	185.5	11.70	191.3	12.01
	73	96.3	6.56	110.1	7.39	123.8	8.21	130.7	8.63	151.2	9.86	158.1	10.28	185.5	11.92	190.5	12.16
	77	96.3	6.74	110.1	7.59	123.8	8.44	130.7	8.86	151.2	10.13	158.1	10.56	185.5	12.26	189.2	12.38
	81	96.3	6.93	110.1	7.81	123.8	8.69	130.7	9.13	151.2	10.44	158.1	10.88	184.9	12.73	187.0	12.77
	86	96.3	7.21	110.1	8.13	123.8	9.05	130.7	9.51	151.2	10.88	158.1	11.34	181.2	13.38	183.2	13.42
	91	96.3	7.53	110.1	8.49	123.8	9.46	130.7	9.94	151.2	11.48	158.1	12.19	177.5	14.03	179.4	14.07
	95	96.3	7.82	110.1	8.82	123.8	9.82	130.7	10.33	151.2	12.28	158.1	13.05	174.3	14.57	176.2	14.61
	99	96.3	8.13	110.1	9.18	123.8	10.23	130.7	10.85	151.2	13.18	158.1	14.04	171.0	15.16	172.8	15.21
	104	96.3	8.59	110.1	9.70	123.8	11.04	130.7	11.86	151.2	14.49	158.1	15.45	166.7	15.91	168.5	15.96
	109	96.3	9.15	110.1	10.42	123.8	12.10	130.7	13.01	151.2	15.93	155.2	16.42	162.4	16.66	164.2	16.72
	115	96.3	9.93	110.1	11.60	123.8	13.51	130.7	14.54	148.3	17.24	150.1	17.31	157.1	17.58	158.8	17.65
	50	85.7	5.37	97.8	6.03	110.0	6.68	116.2	7.01	134.4	7.99	140.6	8.32	164.9	9.63	171.1	9.96
	59	85.7	5.52	97.8	6.20	110.0	6.87	116.2	7.21	134.4	8.22	140.6	8.57	164.9	9.92	171.1	10.26
	70	85.7	5.82	97.8	6.54	110.0	7.25	116.2	7.61	134.4	8.69	140.6	9.05	164.9	10.49	171.1	10.85
134.4 (80%)	73	85.7	5.92	97.8	6.65	110.0	7.39	116.2	7.76	134.4	8.85	140.6	9.22	164.9	10.69	171.1	11.06
	77	85.7	6.07	97.8	6.83	110.0	7.58	116.2	7.96	134.4	9.09	140.6	9.47	164.9	10.98	171.1	11.36
	81	85.7	6.25	97.8	7.03	110.0	7.81	116.2	8.20	134.4	9.37	140.6	9.76	164.9	11.32	171.1	11.71
	86	85.7	6.50	97.8	7.31	110.0	8.13	116.2	8.54	134.4	9.75	140.6	10.17	164.9	11.85	171.1	12.47
	91	85.7	6.78	97.8	7.63	110.0	8.49	116.2	8.92	134.4	10.20	140.6	10.63	164.9	12.92	171.1	13.60
	95	85.7	7.03	97.8	7.93	110.0	8.82	116.2	9.27	134.4	10.60	140.6	11.15	164.9	13.84	170.4	14.46
	99	85.7	7.32	97.8	8.25	110.0	9.18	116.2	9.65	134.4	11.25	140.6	11.92	164.9	14.93	167.2	15.05
	104	85.7	7.72	97.8	8.71	110.0	9.70	116.2	10.20	134.4	12.31	140.6	13.08	161.3	15.74	163.1	15.80
	109	85.7	8.22	97.8	9.28	110.0	10.41	116.2	11.15	134.4	13.51	140.6	14.37	157.2	16.49	159.0	16.55
	115	85.7	8.91	97.8	10.07	110.0	11.60	116.2	12.43	134.4	15.11	140.6	16.08	152.2	17.39	153.9	17.46
	50	74.9	4.80	85.6	5.37	96.3	5.94	101.7	6.23	117.6	7.09	123.0	7.38	144.3	8.52	149.7	8.81
	59	74.9	4.93	85.6	5.52	96.3	6.11	101.7	6.41	117.6	7.29	123.0	7.59	144.3	8.77	149.7	9.07
	70	74.9	5.19	85.6	5.81	96.3	6.44	101.7	6.76	117.6	7.70	123.0	8.02	144.3	9.27	149.7	9.59
	73	74.9	5.28	85.6	5.92	96.3	6.56	101.7	6.88	117.6	7.84	123.0	8.16	144.3	9.45	149.7	9.77
	77	74.9	5.41	85.6	6.07	96.3	6.73	101.7	7.07	117.6	8.05	123.0	8.39	144.3	9.71	149.7	10.04
	81	74.9	5.56	85.6	6.25	96.3	6.93	101.7	7.27	117.6	8.29	123.0	8.64	144.3	10.00	149.7	10.34
117.6 (70%)	86	74.9	5.78	85.6	6.49	96.3	7.21	101.7	7.57	117.6	8.63	123.0	8.99	144.3	10.42	149.7	10.78
	91	74.9	6.03	85.6	6.78	96.3	7.53	101.7	7.90	117.6	9.02	123.0	9.40	144.3	10.90	149.7	11.32
	95	74.9	6.25	85.6	7.03	96.3	7.81	101.7	8.20	117.6	9.37	123.0	9.76	144.3	11.54	149.7	12.12
	99	74.9	6.50	85.6	7.31	96.3	8.13	101.7	8.54	117.6	9.76	123.0	10.17	144.3	12.35	149.7	12.99
	104	74.9	6.85	85.6	7.72	96.3	8.58	101.7	9.02	117.6	10.34	123.0	10.95	144.3	13.57	149.7	14.28
	109	74.9	7.29	85.6	8.22	96.3	9.14	101.7	9.61	117.6	11.33	123.0	12.00	144.3	14.91	149.7	15.70
	115	74.9	7.89	85.6	8.91	96.3	9.92	101.7	10.51	117.6	12.63	123.0	13.40	144.3	16.69	148.1	17.23
	50	64.2	4.22	73.4	4.71	82.5	5.20	87.1	5.45	100.8	6.19	105.4	6.43	123.7	7.41	128.3	7.66
	59	64.2	4.33	73.4	4.84	82.5	5.35	87.1	5.60	100.8	6.36	105.4	6.62	123.7	7.63	128.3	7.89
	70	64.2	4.56	73.4	5.09	82.5	5.63	87.1	5.90	100.8	6.71	105.4	6.98	123.7	8.06	128.3	8.33
	73	64.2	4.63	73.4	5.18	82.5	5.73	87.1	6.01	100.8	6.83	105.4	7.11	123.7	8.21	128.3	8.48
	77	64.2	4.75	73.4	5.32	82.5	5.88	87.1	6.17	100.8	7.01	105.4	7.30	123.7	8.43	128.3	8.72
	81	64.2	4.88	73.4	5.46	82.5	6.05	87.1	6.34	100.8	7.22	105.4	7.51	123.7	8.68	128.3	8.98
	86	64.2	5.07	73.4	5.68	82.5	6.29	87.1	6.60	100.8	7.51	105.4	7.82	123.7	9.04	128.3	9.35
	91	64.2	5.28	73.4	5.92	82.5	6.56	87.1	6.88	100.8	7.84	105.4	8.17	123.7	9.45	128.3	9.77
	95	64.2	5.47	73.4	6.14	82.5	6.81	87.1	7.14	100.8	8.14	105.4	8.48	123.7	9.82	128.3	10.15
100.8 (60%)	99	64.2	5.68	73.4	6.38	82.5	7.08	87.1	7.43	100.8	8.47	105.4	8.83	123.7	10.22	128.3	10.60
	104	64.2	5.98	73.4	6.73	82.5	7.47	87.1	7.84	100.8	8.95	105.4	9.32	123.7	11.03	128.3	11.57
	109	64.2	6.36	73.4	7.15	82.5	7.95	87.1	8.35	100.8	9.54	105.4	9.94	123.7	12.09	128.3	12.69
	115	64.2	6.88	73.4	7.74	82.5	8.61	87.1	9.05	100.8	10.40	105.4	10.99	123.7	13.50	128.3	14.18
	50	53.5	3.65	61.1	4.06	68.8	4.46	72.6	4.67	84.0	5.28	87.8	5.49	103.1	6.31	106.9	6.51
	59	53.5	3.74	61.1	4.16	68.8	4.59	72.6	4.80	84.0	5.43	87.8	5.64	103.1	6.49	106.9	6.70
	70	53.5	3.93	61.1	4.37	68.8	4.82	72.6	5.05	84.0	5.72	87.8	5.95	103.1	6.84	106.9	7.07
	73	53.5	3.99	61.1	4.45	68.8	4.91	72.6	5.14	84.0	5.82	87.8	6.05	103.1	6.97	106.9	7.20
	77	53.5	4.09	61.1	4.56	68.8	5.03	72.6	5.27	84.0	5.97	87.8	6.21	103.1	7.15	106.9	7.39
	81	53.5	4.20	61.1	4.68	68.8	5.17	72.6	5.42	84.0	6.14	87.8	6.39	103.1	7.36	106.9	7.61
	86	53.5	4.35	61.1	4.86	68.8	5.37	72.6	5.63	84.0	6.39	87.8	6.64	103.1	7.66	106.9	7.92
	91	53.5	4.53	61.1	5.06	68.8	5.60	72.6	5.87	84.0	6.66	87.8	6.93	103.1	8.00	106.9	8.27
	95	53.5	4.69	61.1	5.24	68.8	5.80	72.6	6.08	84.0	6.91	87.8	7.20	103.1	8.31	106.9	8.59
	99	53.5	4.86	61.1	5.44	68.8	6.03	72.6	6.32	84.0	7.19	87.8	7.48	103.1	8.65	106.9	8.94
	104	53.5	5.12	61.1	5.73	68.8	6.35	72.6	6.66	84.0	7.59	87.8	7.90	103.1	9.14	106.9	9.45
	109	53.5	5.43	61.1	6.09	68.8	6.75	72.6	7.09	84.0	8.08	87.8	8.41	103.1	9.74	106.9	10.07
	115	53.5	5.86	61.1	6.58	68.8	7.30	72.6	7.67	84.0	8.75	87.8	9.12	103.1	10.69	106.9	11.19



# Model: AOUA192RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Cooling capacity at rated condition: 192 kBtu/h (16 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
288.0 (150%)	50	183.5	10.61	209.6	12.00	227.8	12.82	230.9	12.81	240.3	12.76	243.5	12.75	256.2	12.66	259.5	12.64
	59	183.5	10.93	209.6	12.36	226.0	13.09	229.1	13.08	238.5	13.04	241.6	13.02	254.3	12.94	257.5	12.92
	70	183.5	11.55	209.6	13.07	222.6	13.59	225.7	13.59	234.9	13.55	238.0	13.54	250.5	13.47	253.7	13.45
	73	183.5	11.77	209.6	13.33	221.5	13.77	224.5	13.76	233.7	13.73	236.8	13.72	248.9	13.68	251.7	13.72
	77	183.5	12.10	209.6	13.70	219.8	14.02	222.8	14.02	231.1	14.10	233.9	14.14	244.7	14.28	247.4	14.31
	81	183.5	12.47	209.6	14.23	216.5	14.52	219.1	14.56	227.1	14.69	229.7	14.73	240.3	14.88	243.0	14.91
	86	183.5	12.99	206.4	15.14	211.6	15.24	214.2	15.29	221.9	15.42	224.5	15.47	234.8	15.63	237.4	15.66
	91	183.5	14.06	201.6	15.87	206.6	15.97	209.1	16.02	216.7	16.17	219.2	16.21	229.2	16.39	231.8	16.43
	95	183.5	15.06	197.6	16.46	202.5	16.59	204.9	16.65	212.2	16.82	214.7	16.87	224.5	17.09	227.0	17.14
	99	183.5	16.22	193.3	17.12	198.1	17.25	200.5	17.31	207.7	17.50	210.1	17.56	219.8	17.80	222.2	17.85
	104	183.2	17.80	187.9	17.95	192.5	18.09	194.9	18.16	201.9	18.36	204.3	18.43	213.8	18.69	216.2	18.75
	109	177.8	18.62	182.4	18.78	186.9	18.93	189.3	19.01	196.1	19.23	198.5	19.31	207.7	19.59	210.1	19.66
268.8 (140%)	115	171.3	19.61	175.7	19.78	180.2	19.95	182.4	20.04	189.1	20.28	191.4	20.36	200.4	20.68	202.7	20.76
	50	171.3	9.96	195.7	11.25	220.0	12.55	227.1	12.82	236.2	12.79	239.4	12.77	251.8	12.70	255.0	12.67
	59	171.3	10.26	195.7	11.59	220.0	12.93	225.3	13.09	234.5	13.05	237.6	13.04	249.9	12.97	253.1	12.95
	70	171.3	10.84	195.7	12.26	219.0	13.60	222.0	13.60	231.0	13.57	234.1	13.56	246.3	13.50	249.4	13.48
	73	171.3	11.05	195.7	12.49	217.9	13.77	220.9	13.77	229.8	13.75	232.9	13.73	245.0	13.68	248.0	13.67
	77	171.3	11.35	195.7	12.84	216.2	14.03	219.2	14.02	227.8	14.05	230.5	14.09	241.1	14.23	243.8	14.27
	81	171.3	11.70	195.7	13.24	213.4	14.46	216.0	14.51	223.8	14.64	226.4	14.68	236.9	14.83	239.5	14.87
	86	171.3	12.18	195.7	14.09	208.6	15.19	211.2	15.24	218.8	15.37	221.4	15.42	231.5	15.58	234.1	15.62
	91	171.3	12.81	195.7	15.38	203.8	15.91	206.3	15.97	213.7	16.11	216.2	16.16	226.1	16.33	228.6	16.37
	95	171.3	13.71	195.0	16.40	199.8	16.52	202.2	16.58	209.4	16.75	211.9	16.81	221.5	17.03	224.0	17.08
	99	171.3	14.70	190.8	17.05	195.5	17.18	197.9	17.25	205.0	17.43	207.4	17.49	216.9	17.73	219.3	17.79
	104	171.3	16.17	185.5	17.87	190.1	18.01	192.4	18.09	199.4	18.29	201.7	18.36	211.0	18.62	213.4	18.68
249.6 (130%)	109	171.3	17.78	180.1	18.70	184.6	18.85	186.9	18.93	193.7	19.15	196.0	19.23	205.1	19.51	207.4	19.58
	115	169.2	19.53	173.6	19.70	178.0	19.87	180.2	19.95	186.8	20.20	189.1	20.28	198.0	20.60	200.2	20.67
	50	159.1	9.31	181.7	10.51	204.3	11.71	215.7	12.32	231.7	12.80	234.8	12.79	247.0	12.73	250.1	12.71
	59	159.1	9.59	181.7	10.83	204.3	12.07	215.7	12.69	230.0	13.07	233.0	13.06	245.1	13.00	248.2	12.98
	70	159.1	10.13	181.7	11.45	204.3	12.76	215.7	13.43	226.7	13.58	229.7	13.57	241.6	13.52	244.6	13.51
	73	159.1	10.32	181.7	11.66	204.3	13.01	215.7	13.69	225.6	13.76	228.5	13.75	240.4	13.70	243.4	13.69
	77	159.1	10.60	181.7	11.99	204.3	13.37	215.2	14.03	223.9	14.02	226.7	14.03	237.1	14.18	239.7	14.22
	81	159.1	10.92	181.7	12.35	204.3	13.78	212.5	14.45	220.2	14.58	222.8	14.62	233.0	14.78	235.6	14.81
	86	159.1	11.38	181.7	12.87	204.3	14.99	207.9	15.17	215.3	15.31	217.9	15.36	227.9	15.52	230.4	15.56
	91	159.1	11.90	181.7	13.87	200.7	15.85	203.1	15.90	210.4	16.05	212.9	16.10	222.7	16.27	225.1	16.31
	95	159.1	12.43	181.7	14.85	196.8	16.44	199.2	16.50	206.3	16.68	208.7	16.74	218.2	16.95	220.6	17.01
	99	159.1	13.29	181.7	15.99	192.6	17.10	195.0	17.17	202.0	17.35	204.3	17.42	213.7	17.65	216.1	17.71
	104	159.1	14.58	181.7	17.59	187.4	17.93	189.7	18.00	196.5	18.21	198.8	18.27	208.0	18.53	210.3	18.60
230.4 (120%)	109	159.1	16.01	177.6	18.61	182.0	18.77	184.3	18.84	191.0	19.07	193.2	19.14	202.2	19.42	204.5	19.49
	115	159.1	17.92	171.2	19.61	175.6	19.78	177.8	19.86	184.3	20.11	186.5	20.19	195.2	20.50	197.4	20.58
	50	146.8	8.66	167.7	9.77	188.6	10.88	199.1	11.44	226.7	12.82	229.7	12.81	241.5	12.76	244.5	12.74
	59	146.8	8.92	167.7	10.06	188.6	11.21	199.1	11.78	225.1	13.09	228.0	13.08	239.8	13.03	242.8	13.01
	70	146.8	9.42	167.7	10.63	188.6	11.85	199.1	12.46	221.9	13.60	224.8	13.59	236.4	13.55	239.3	13.53
	73	146.8	9.59	167.7	10.83	188.6	12.08	199.1	12.70	220.8	13.77	223.7	13.76	235.2	13.72	238.2	13.71
	77	146.8	9.85	167.7	11.13	188.6	12.41	199.1	13.06	219.2	14.02	222.1	14.02	232.6	14.12	235.2	14.16
	81	146.8	10.15	167.7	11.47	188.6	12.79	199.1	13.46	216.1	14.51	218.7	14.55	228.7	14.71	231.3	14.75
	86	146.8	10.57	167.7	11.95	188.6	13.39	199.1	14.45	211.4	15.24	213.9	15.29	223.8	15.46	226.2	15.50
	91	146.8	11.05	167.7	12.50	188.6	14.60	199.1	15.77	206.7	15.97	209.1	16.02	218.7	16.20	221.1	16.24
	95	146.8	11.48	167.7	13.33	188.6	15.64	195.8	16.42	202.8	16.59	205.1	16.65	214.4	16.87	216.8	16.92
	99	146.8	11.99	167.7	14.28	188.6	16.88	191.7	17.07	198.6	17.26	200.9	17.32	210.1	17.56	212.4	17.62
	104	146.8	13.10	167.7	15.69	184.3	17.83	186.5	17.90	193.2	18.11	195.5	18.18	204.5	18.44	206.8	18.50
211.2 (110%)	109	146.8	14.37	167.7	17.25	179.1	18.66	181.3	18.74	187.9	18.96	190.1	19.04	198.9	19.32	201.1	19.39
	115	146.8	16.05	167.7	19.33	172.8	19.67	175.0	19.75	181.4	20.00	183.5	20.08	192.1	20.39	194.3	20.47
	50	134.6	8.01	153.7	9.03	172.9	10.04	182.6	10.56	211.2	12.08	220.9	12.59	235.4	12.79	238.4	12.77
	59	134.6	8.24	153.7	9.29	172.9	10.34	182.6	10.87	211.2	12.44	220.8	12.97	233.8	13.06	236.7	13.04
	70	134.6	8.70	153.7	9.82	172.9	10.93	182.6	11.50	211.2	13.17	219.3	13.60	230.6	13.57	233.4	13.56
	73	134.6	8.86	153.7	10.00	172.9	11.14	182.6	11.72	211.2	13.42	218.3	13.77	229.5	13.75	232.3	13.74
	77	134.6	9.10	153.7	10.28	172.9	11.45	182.6	12.04	211.2	13.79	216.7	14.03	227.6	14.05	230.1	14.08
	81	134.6	9.37	153.7	10.59	172.9	11.80	182.6	12.41	211.1	14.38	214.0	14.47	223.8	14.64	226.3	14.68
	86	134.6	9.76	153.7	11.02	172.9	12.29	182.6	12.93	207.0	15.16	209.5	15.20	219.1	15.38	221.5	15.42
	91	134.6	10.20	153.7	11.53	172.9	12.97	182.6	13.96	202.5	15.89	204.9	15.94	214.2	16.12	216.6	16.16
	95	134.6	10.59	153.7	11.98	172.9	13.88	182.6	14.95	198.7	16.49	201.0	16.55	210.2	16.77	212.5	16.82
	99	134.6	11.03	153.7	12.72	172.9	14.89	182.6	16.10	194.7	17.16	196.9	17.22	205.9	17.46	208.2	17.51
	104	134.6	11.70	153.7	13.92	172.9	16.38	182.6	17.72	189.5	18.00	191.8	18.06	200.6	18.32	202.8	18.39
192.0 (100%)																	

Cooling capacity at rated condition: 192 kBTu/h (16 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
172.8 (90%)	50	110.1	6.71	125.8	7.54	141.5	8.38	149.4	8.80	172.8	10.04	180.7	10.46	212.0	12.12	219.9	12.54
	59	110.1	6.90	125.8	7.76	141.5	8.62	149.4	9.05	172.8	10.34	180.7	10.77	212.0	12.49	219.9	12.92
	70	110.1	7.28	125.8	8.19	141.5	9.10	149.4	9.56	172.8	10.93	180.7	11.39	212.0	13.21	219.1	13.60
	73	110.1	7.41	125.8	8.34	141.5	9.27	149.4	9.74	172.8	11.13	180.7	11.60	212.0	13.47	218.1	13.77
	77	110.1	7.61	125.8	8.57	141.5	9.52	149.4	10.01	172.8	11.44	180.7	11.93	212.0	13.85	216.7	14.03
	81	110.1	7.83	125.8	8.82	141.5	9.81	149.4	10.31	172.8	11.79	180.7	12.29	211.7	14.43	214.1	14.47
	86	110.1	8.14	125.8	9.18	141.5	10.21	149.4	10.74	172.8	12.28	180.7	12.81	207.5	15.16	209.8	15.21
	91	110.1	8.50	125.8	9.59	141.5	10.68	149.4	11.22	172.8	12.96	180.7	13.77	203.2	15.90	205.4	15.95
	95	110.1	8.83	125.8	9.96	141.5	11.09	149.4	11.66	172.8	13.87	180.7	14.74	199.6	16.51	201.8	16.57
	99	110.1	9.18	125.8	10.37	141.5	11.55	149.4	12.26	172.8	14.88	180.7	15.86	195.7	17.19	197.9	17.24
	104	110.1	9.70	125.8	10.95	141.5	12.47	149.4	13.40	172.8	16.37	180.7	17.45	190.8	18.04	192.9	18.10
	109	110.1	10.33	125.8	11.76	141.5	13.67	149.4	14.70	172.8	18.00	177.7	18.61	185.8	18.90	187.9	18.97
153.6 (80%)	50	97.9	6.06	111.8	6.80	125.7	7.54	132.8	7.91	153.6	9.02	160.6	9.39	188.5	10.87	195.5	11.25
	59	97.9	6.23	111.8	6.99	125.7	7.76	132.8	8.14	153.6	9.29	160.6	9.67	188.5	11.20	195.5	11.58
	70	97.9	6.56	111.8	7.38	125.7	8.19	132.8	8.60	153.6	9.81	160.6	10.22	188.5	11.84	195.5	12.25
	73	97.9	6.68	111.8	7.51	125.7	8.34	132.8	8.76	153.6	9.99	160.6	10.41	188.5	12.07	195.5	12.49
	77	97.9	6.86	111.8	7.71	125.7	8.56	132.8	8.99	153.6	10.27	160.6	10.70	188.5	12.40	195.5	12.83
	81	97.9	7.05	111.8	7.93	125.7	8.81	132.8	9.26	153.6	10.58	160.6	11.02	188.5	12.78	195.5	13.23
	86	97.9	7.33	111.8	8.25	125.7	9.17	132.8	9.64	153.6	11.02	160.6	11.48	188.5	13.38	195.5	14.08
	91	97.9	7.65	111.8	8.62	125.7	9.59	132.8	10.07	153.6	11.52	160.6	12.01	188.5	14.59	195.5	15.36
	95	97.9	7.94	111.8	8.95	125.7	9.95	132.8	10.46	153.6	11.97	160.6	12.59	188.5	15.63	195.0	16.40
	99	97.9	8.26	111.8	9.31	125.7	10.36	132.8	10.90	153.6	12.70	160.6	13.47	188.5	16.86	191.4	17.07
	104	97.9	8.72	111.8	9.83	125.7	10.95	132.8	11.52	153.6	13.91	160.6	14.78	184.7	17.85	186.7	17.91
	109	97.9	9.28	111.8	10.48	125.7	11.76	132.8	12.60	153.6	15.27	160.6	16.23	180.0	18.69	182.0	18.76
	115	97.9	10.06	111.8	11.37	125.7	13.10	132.8	14.05	153.6	17.07	160.6	18.17	174.2	19.73	176.2	19.80
134.4 (70%)	50	85.6	5.41	97.8	6.06	110.0	6.71	116.2	7.03	134.4	8.00	140.5	8.33	164.9	9.62	171.1	9.95
	59	85.6	5.56	97.8	6.23	110.0	6.90	116.2	7.23	134.4	8.23	140.5	8.57	164.9	9.91	171.1	10.24
	70	85.6	5.85	97.8	6.56	110.0	7.27	116.2	7.63	134.4	8.69	140.5	9.05	164.9	10.47	171.1	10.83
	73	85.6	5.95	97.8	6.68	110.0	7.40	116.2	7.77	134.4	8.85	140.5	9.22	164.9	10.67	171.1	11.03
	77	85.6	6.11	97.8	6.85	110.0	7.60	116.2	7.98	134.4	9.09	140.5	9.47	164.9	10.96	171.1	11.34
	81	85.6	6.28	97.8	7.05	110.0	7.82	116.2	8.21	134.4	9.36	140.5	9.75	164.9	11.29	171.1	11.68
	86	85.6	6.52	97.8	7.33	110.0	8.14	116.2	8.54	134.4	9.75	140.5	10.15	164.9	11.76	171.1	12.17
	91	85.6	6.80	97.8	7.65	110.0	8.50	116.2	8.92	134.4	10.19	140.5	10.61	164.9	12.30	171.1	12.79
	95	85.6	7.06	97.8	7.94	110.0	8.82	116.2	9.26	134.4	10.58	140.5	11.03	164.9	13.04	171.1	13.69
	99	85.6	7.34	97.8	8.26	110.0	9.18	116.2	9.64	134.4	11.02	140.5	11.48	164.9	13.95	171.1	14.68
	104	85.6	7.74	97.8	8.71	110.0	9.69	116.2	10.18	134.4	11.68	140.5	12.37	164.9	15.33	171.1	16.14
	109	85.6	8.23	97.8	9.28	110.0	10.32	116.2	10.85	134.4	12.79	140.5	13.56	164.9	16.84	171.1	17.74
	115	85.6	8.91	97.8	10.06	110.0	11.20	116.2	11.87	134.4	14.27	140.5	15.14	164.9	18.87	169.5	19.54
115.2 (60%)	50	73.4	4.76	83.9	5.32	94.3	5.87	99.6	6.15	115.2	6.98	120.5	7.26	141.4	8.37	146.6	8.65
	59	73.4	4.89	83.9	5.46	94.3	6.04	99.6	6.32	115.2	7.18	120.5	7.47	141.4	8.62	146.6	8.90
	70	73.4	5.14	83.9	5.75	94.3	6.36	99.6	6.66	115.2	7.57	120.5	7.88	141.4	9.10	146.6	9.40
	73	73.4	5.23	83.9	5.85	94.3	6.47	99.6	6.78	115.2	7.71	120.5	8.02	141.4	9.27	146.6	9.58
	77	73.4	5.36	83.9	6.00	94.3	6.64	99.6	6.96	115.2	7.92	120.5	8.24	141.4	9.52	146.6	9.84
	81	73.4	5.51	83.9	6.17	94.3	6.83	99.6	7.16	115.2	8.15	120.5	8.48	141.4	9.80	146.6	10.14
	86	73.4	5.72	83.9	6.41	94.3	7.10	99.6	7.45	115.2	8.48	120.5	8.83	141.4	10.21	146.6	10.55
	91	73.4	5.96	83.9	6.68	94.3	7.41	99.6	7.77	115.2	8.85	120.5	9.22	141.4	10.67	146.6	11.04
	95	73.4	6.17	83.9	6.93	94.3	7.68	99.6	8.06	115.2	9.19	120.5	9.57	141.4	11.09	146.6	11.47
	99	73.4	6.41	83.9	7.20	94.3	7.99	99.6	8.39	115.2	9.57	120.5	9.97	141.4	11.54	146.6	11.97
	104	73.4	6.75	83.9	7.59	94.3	8.43	99.6	8.85	115.2	10.11	120.5	10.53	141.4	12.46	146.6	13.07
	109	73.4	7.18	83.9	8.07	94.3	8.97	99.6	9.43	115.2	10.77	120.5	11.22	141.4	13.66	146.6	14.34
	115	73.4	7.76	83.9	8.74	94.3	9.72	99.6	10.22	115.2	11.75	120.5	12.41	141.4	15.26	146.6	16.02
96.0 (50%)	50	61.2	4.11	69.9	4.57	78.6	5.04	83.0	5.27	96.0	5.96	100.4	6.19	117.8	7.12	122.2	7.35
	59	61.2	4.22	69.9	4.70	78.6	5.17	83.0	5.41	96.0	6.13	100.4	6.37	117.8	7.32	122.2	7.56
	70	61.2	4.43	69.9	4.93	78.6	5.44	83.0	5.70	96.0	6.46	100.4	6.71	117.8	7.72	122.2	7.98
	73	61.2	4.50	69.9	5.02	78.6	5.54	83.0	5.80	96.0	6.57	100.4	6.83	117.8	7.87	122.2	8.13
	77	61.2	4.61	69.9	5.14	78.6	5.68	83.0	5.94	96.0	6.74	100.4	7.01	117.8	8.08	122.2	8.35
	81	61.2	4.73	69.9	5.28	78.6	5.83	83.0	6.11	96.0	6.93	100.4	7.21	117.8	8.31	122.2	8.59
	86	61.2	4.91	69.9	5.48	78.6	6.06	83.0	6.35	96.0	7.21	100.4	7.50	117.8	8.65	122.2	8.94
	91	61.2	5.11	69.9	5.71	78.6	6.32	83.0	6.62	96.0	7.52	100.4	7.83	117.8	9.04	122.2	9.34
	95	61.2	5.29	69.9	5.92	78.6	6.55	83.0	6.86	96.0	7.80	100.4	8.12	117.8	9.38	122.2	9.70
	99	61.2	5.49	69.9	6.14	78.6	6.80	83.0	7.13	96.0	8.12	100.4	8.45	117.8	9.76	122.2	10.10
	104	61.2	5.77	69.9	6.47	78.6	7.17	83.0	7.52	96.0	8.57	100.4	8.92	117.8	10.32	122.2	10.67
	109	61.2	6.13	69.9	6.87	78.6	7.62	83.0	8.00	96.0	9.12	100.4	9.50	117.8	10.99	122.2	11.37
	115	61.2	6.61	69.9	7.43	78.6	8.25	83.0	8.66	96.0	9.88	100.4	10.29	117.8	12.07	122.2	12.64

# Model: AOUA216RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Cooling capacity at rated condition: 216 kBTU/h (18 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
		°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC
324.0 (150%)	50	206.5	12.21	235.9	13.81	256.2	14.75	259.8	14.74	270.3	14.69	273.9	14.67	288.2	14.57	291.9	14.55
	59	206.5	12.58	235.9	14.23	254.2	15.06	257.7	15.05	268.2	15.00	271.8	14.98	286.0	14.89	289.6	14.87
	70	206.5	13.30	235.9	15.05	250.4	15.65	253.9	15.64	264.2	15.60	267.7	15.58	281.8	15.50	285.3	15.48
	73	206.5	13.55	235.9	15.34	249.1	15.85	252.6	15.84	262.9	15.80	266.3	15.79	280.1	15.74	283.2	15.78
	77	206.5	13.93	235.9	15.77	247.2	16.14	250.6	16.13	260.0	16.22	263.1	16.26	275.2	16.43	278.3	16.46
	81	206.5	14.35	235.9	16.38	243.5	16.70	246.5	16.75	255.4	16.90	258.4	16.94	270.4	17.11	273.4	17.15
	86	206.5	14.96	232.2	17.43	238.0	17.54	240.9	17.59	249.6	17.75	252.5	17.80	264.2	17.98	267.1	18.02
	91	206.5	16.19	226.8	18.26	232.4	18.38	235.3	18.44	243.7	18.60	246.6	18.66	257.9	18.85	260.7	18.91
	95	206.5	17.34	222.3	18.95	227.7	19.09	230.5	19.16	238.7	19.36	241.5	19.42	252.6	19.67	255.4	19.73
	99	206.5	18.68	217.4	19.71	222.8	19.86	225.5	19.93	233.6	20.14	236.4	20.21	247.2	20.48	250.0	20.55
	104	206.0	20.49	211.3	20.66	216.6	20.82	219.2	20.90	227.1	21.14	229.8	21.22	240.5	21.52	243.2	21.59
302.4 (140%)	109	200.0	21.44	205.1	21.62	210.3	21.80	212.9	21.89	220.6	22.14	223.2	22.23	233.7	22.55	236.3	22.64
	115	192.6	22.58	197.6	22.78	202.6	22.97	205.2	23.07	212.7	23.35	215.2	23.45	225.4	23.81	228.0	23.90
	50	192.7	11.46	220.1	12.95	247.6	14.45	255.4	14.76	265.7	14.71	269.2	14.70	283.3	14.61	286.8	14.58
	59	192.7	11.81	220.1	13.35	247.6	14.88	253.5	15.06	263.7	15.02	267.2	15.01	281.1	14.93	284.7	14.90
	70	192.7	12.48	220.1	14.11	246.3	15.65	249.7	15.65	259.9	15.62	263.3	15.60	277.0	15.53	280.5	15.51
	73	192.7	12.72	220.1	14.38	245.1	15.85	248.5	15.85	258.5	15.82	261.9	15.81	275.6	15.74	279.0	15.73
	77	192.7	13.07	220.1	14.79	243.2	16.15	246.6	16.14	256.3	16.16	259.3	16.21	271.2	16.38	274.3	16.41
	81	192.7	13.46	220.1	15.24	240.1	16.64	243.0	16.69	251.8	16.84	254.8	16.89	266.5	17.06	269.5	17.10
	86	192.7	14.03	220.1	16.22	234.7	17.48	237.6	17.53	246.1	17.69	249.0	17.74	260.5	17.92	263.4	17.97
	91	192.7	14.74	220.1	17.71	229.3	18.32	232.1	18.37	240.4	18.54	243.2	18.59	254.4	18.79	257.2	18.84
	95	192.7	15.78	219.3	18.87	224.7	19.01	227.5	19.08	235.6	19.28	238.3	19.35	249.2	19.59	252.0	19.65
	99	192.7	16.93	214.6	19.62	219.9	19.78	222.6	19.85	230.6	20.07	233.3	20.14	244.0	20.41	246.7	20.47
280.8 (130%)	104	192.7	18.62	208.6	20.57	213.8	20.74	216.4	20.82	224.3	21.05	226.9	21.13	237.4	21.43	240.1	21.50
	109	192.7	20.48	202.6	21.53	207.7	21.71	210.2	21.80	217.9	22.05	220.4	22.14	230.7	22.46	233.3	22.54
	115	190.3	22.49	195.2	22.69	200.2	22.88	202.7	22.98	210.1	23.26	212.6	23.35	222.6	23.71	225.2	23.80
	50	179.0	10.71	204.4	12.10	229.9	13.48	242.7	14.18	260.7	14.74	264.1	14.72	277.8	14.65	281.3	14.62
	59	179.0	11.03	204.4	12.46	229.9	13.89	242.7	14.61	258.7	15.04	262.1	15.03	275.7	14.96	279.2	14.94
	70	179.0	11.66	204.4	13.18	229.9	14.69	242.7	15.46	255.0	15.63	258.4	15.62	271.8	15.56	275.2	15.54
	73	179.0	11.88	204.4	13.43	229.9	14.98	242.7	15.76	253.7	15.83	257.1	15.82	270.4	15.77	273.8	15.75
	77	179.0	12.20	204.4	13.80	229.9	15.40	242.1	16.15	251.8	16.13	255.0	16.14	266.8	16.32	269.7	16.36
	81	179.0	12.57	204.4	14.22	229.9	15.87	239.1	16.62	247.7	16.77	250.6	16.82	262.2	17.00	265.1	17.04
	86	179.0	13.10	204.4	14.82	229.9	17.25	233.8	17.46	242.3	17.62	245.1	17.67	256.4	17.86	259.2	17.90
	91	179.0	13.69	204.4	15.97	225.7	18.24	228.5	18.30	236.7	18.47	239.5	18.52	250.5	18.72	253.3	18.77
	95	179.0	14.31	204.4	17.10	221.4	18.93	224.1	19.00	232.1	19.20	234.8	19.26	245.5	19.51	248.2	19.57
	99	179.0	15.30	204.4	18.41	216.7	19.68	219.3	19.76	227.2	19.97	229.8	20.05	240.4	20.32	243.0	20.38
259.2 (120%)	104	179.0	16.79	204.4	20.27	210.7	20.64	213.3	20.72	221.0	20.96	223.6	21.04	233.9	21.33	236.6	21.41
	109	179.0	18.45	199.7	21.43	204.7	21.61	207.3	21.69	214.8	21.95	217.3	22.03	227.4	22.36	230.0	22.44
	115	179.0	20.65	192.6	22.58	197.4	22.77	199.9	22.87	207.2	23.15	209.7	23.24	219.6	23.60	222.1	23.69
	50	165.2	9.96	188.7	11.24	212.2	12.52	224.1	13.17	255.0	14.76	258.4	14.75	271.7	14.68	275.1	14.66
	59	165.2	10.26	188.7	11.58	212.2	12.90	224.1	13.57	253.2	15.06	256.5	15.05	269.7	14.99	273.1	14.98
	70	165.2	10.84	188.7	12.24	212.2	13.64	224.1	14.35	249.6	15.65	252.9	15.64	265.9	15.59	269.2	15.57
	73	165.2	11.04	188.7	12.47	212.2	13.90	224.1	14.62	248.4	15.85	251.6	15.84	264.6	15.80	267.9	15.78
	77	165.2	11.34	188.7	12.81	212.2	14.29	224.1	15.03	246.6	16.14	249.8	16.14	261.7	16.24	264.6	16.29
	81	165.2	11.68	188.7	13.20	212.2	14.72	224.1	15.49	243.1	16.69	246.0	16.74	257.3	16.93	260.2	16.97
	86	165.2	12.16	188.7	13.75	212.2	15.41	224.1	16.63	237.9	17.54	240.7	17.59	251.7	17.78	254.5	17.83
	91	165.2	12.72	188.7	14.39	212.2	16.81	224.1	18.16	232.5	18.38	235.3	18.44	246.0	18.65	248.8	18.69
	95	165.2	13.21	188.7	15.34	212.2	18.01	220.2	18.90	228.1	19.10	230.7	19.16	241.2	19.41	243.9	19.47
	99	165.2	13.80	188.7	16.44	212.2	19.44	215.6	19.65	223.3	19.87	225.9	19.94	236.3	20.21	238.9	20.28
237.6 (110%)	104	165.2	15.08	188.7	18.08	207.3	20.53	209.8	20.61	217.4	20.85	219.9	20.92	230.0	21.22	232.6	21.30
	109	165.2	16.54	188.7	19.87	201.4	21.49	203.9	21.58	211.3	21.83	213.8	21.92	223.7	22.24	226.2	22.32
	115	165.2	18.49	188.7	22.28	194.4	22.65	196.8	22.75	204.0	23.03	206.4	23.12	216.1	23.48	218.5	23.57
	50	151.4	9.22	173.0	10.39	194.5	11.56	205.4	12.15	237.6	13.90	248.5	14.50	264.8	14.72	268.1	14.70
	59	151.4	9.48	173.0	10.70	194.5	11.91	205.4	12.52	237.6	14.33	248.5	14.94	263.0	15.03	266.2	15.01
	70	151.4	10.01	173.0	11.30	194.5	12.59	205.4	13.23	237.6	15.16	246.7	15.65	259.3	15.62	262.6	15.61
	73	151.4	10.20	173.0	11.51	194.5	12.82	205.4	13.49	237.6	15.45	245.5	15.85	258.1	15.82	261.3	15.81
	77	151.4	10.48	173.0	11.83	194.5	13.18	205.4	13.86	237.6	15.88	243.8	16.15	256.0	16.16	258.9	16.20
	81	151.4	10.79	173.0	12.18	194.5	13.58	205.4	14.28	237.6	16.55	240.7	16.65	251.8	16.84	254.6	16.88
	86	151.4	11.23	173.0	12.69	194.5	14.15	205.4	14.89	232.9	17.44	235.6	17.49	246.4	17.69	249.2	17.74
	91	151.4	11.74	173.0	13.27	194.5	14.93	205.4	16.07	227.8	18.28	230.4	18.34	241.0	18.55	243.7	18.60
	95	151.4	12.19	173.0	13.79	194.5	15.98	205.4	17.21	223.5	18.98	226.1	19.05	236.4	19.30	239.0	19.36
	99	151.4	12.70	173.0	14.64	194.5	17.15	205.4	18.54	219.0	19.75	221.5	19.82	231.7	20.09	234.2	20.16
216.0 (100%)	104	151.4	13.47	173.0	16.04	194.5	18.87	205.4	20.41	213.2							



Cooling capacity at rated condition: 216 kBTu/h (18 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
194.4 (90%)	50	123.9	7.72	141.5	8.68	159.2	9.64	168.1	10.12	194.4	11.55	203.3	12.04	238.6	13.96	247.5	14.44
	59	123.9	7.94	141.5	8.93	159.2	9.92	168.1	10.42	194.4	11.90	203.3	12.40	238.6	14.38	247.5	14.88
	70	123.9	8.37	141.5	9.42	159.2	10.47	168.1	11.01	194.4	12.58	203.3	13.11	238.6	15.21	246.5	15.65
	73	123.9	8.52	141.5	9.60	159.2	10.67	168.1	11.21	194.4	12.82	203.3	13.36	238.6	15.51	245.3	15.85
	77	123.9	8.75	141.5	9.86	159.2	10.96	168.1	11.52	194.4	13.17	203.3	13.73	238.6	15.94	243.7	16.15
	81	123.9	9.00	141.5	10.15	159.2	11.29	168.1	11.86	194.4	13.57	203.3	14.15	238.2	16.61	240.8	16.65
	86	123.9	9.37	141.5	10.56	159.2	11.75	168.1	12.36	194.4	14.14	203.3	14.74	233.4	17.45	236.0	17.50
	91	123.9	9.78	141.5	11.04	159.2	12.29	168.1	12.92	194.4	14.92	203.3	15.85	228.6	18.30	231.1	18.35
	95	123.9	10.16	141.5	11.46	159.2	12.77	168.1	13.43	194.4	15.97	203.3	16.97	224.5	19.01	227.0	19.07
	99	123.9	10.57	141.5	11.93	159.2	13.30	168.1	14.11	194.4	17.14	203.3	18.27	220.2	19.78	222.6	19.85
	104	123.9	11.16	141.5	12.61	159.2	14.36	168.1	15.43	194.4	18.85	203.3	20.10	214.6	20.76	217.0	20.84
	109	123.9	11.89	141.5	13.54	159.2	15.75	168.1	16.93	194.4	20.74	199.8	21.43	209.0	21.76	211.4	21.83
172.8 (80%)	115	123.9	12.90	141.5	15.09	159.2	17.59	168.1	18.93	191.0	22.51	193.2	22.60	202.2	22.96	204.5	23.05
	50	110.1	6.97	125.8	7.82	141.5	8.67	149.4	9.10	172.8	10.38	180.7	10.81	212.1	12.51	220.0	12.94
	59	110.1	7.17	125.8	8.05	141.5	8.93	149.4	9.37	172.8	10.69	180.7	11.13	212.1	12.89	220.0	13.34
	70	110.1	7.55	125.8	8.49	141.5	9.42	149.4	9.89	172.8	11.29	180.7	11.76	212.1	13.63	220.0	14.10
	73	110.1	7.68	125.8	8.64	141.5	9.59	149.4	10.08	172.8	11.50	180.7	11.98	212.1	13.89	220.0	14.37
	77	110.1	7.89	125.8	8.87	141.5	9.85	149.4	10.35	172.8	11.82	180.7	12.31	212.1	14.28	220.0	14.78
	81	110.1	8.11	125.8	9.13	141.5	10.14	149.4	10.65	172.8	12.17	180.7	12.69	212.1	14.72	220.0	15.23
	86	110.1	8.44	125.8	9.50	141.5	10.56	149.4	11.09	172.8	12.68	180.7	13.22	212.1	15.40	220.0	16.20
	91	110.1	8.81	125.8	9.92	141.5	11.03	149.4	11.59	172.8	13.26	180.7	13.82	212.1	16.80	220.0	17.69
	95	110.1	9.14	125.8	10.30	141.5	11.46	149.4	12.04	172.8	13.78	180.7	14.50	212.1	18.00	219.4	18.87
	99	110.1	9.50	125.8	10.72	141.5	11.93	149.4	12.54	172.8	14.62	180.7	15.50	212.1	19.42	215.3	19.64
	104	110.1	10.03	125.8	11.32	141.5	12.61	149.4	13.26	172.8	16.01	180.7	17.02	207.7	20.54	210.0	20.62
	109	110.1	10.68	125.8	12.06	141.5	13.54	149.4	14.50	172.8	17.58	180.7	18.70	202.4	21.52	204.7	21.60
151.2 (70%)	115	110.1	11.58	125.8	13.09	141.5	15.09	149.4	16.18	172.8	19.67	180.7	20.94	196.0	22.71	198.2	22.80
	50	96.4	6.22	110.1	6.97	123.8	7.71	130.7	8.09	151.2	9.20	158.1	9.58	185.6	11.07	192.5	11.45
	59	96.4	6.39	110.1	7.16	123.8	7.93	130.7	8.32	151.2	9.47	158.1	9.86	185.6	11.40	192.5	11.79
	70	96.4	6.73	110.1	7.55	123.8	8.37	130.7	8.78	151.2	10.00	158.1	10.41	185.6	12.05	192.5	12.46
	73	96.4	6.85	110.1	7.68	123.8	8.52	130.7	8.94	151.2	10.19	158.1	10.61	185.6	12.28	192.5	12.70
	77	96.4	7.02	110.1	7.88	123.8	8.74	130.7	9.18	151.2	10.46	158.1	10.90	185.6	12.62	192.5	13.05
	81	96.4	7.22	110.1	8.11	123.8	9.00	130.7	9.45	151.2	10.77	158.1	11.22	185.6	13.00	192.5	13.45
	86	96.4	7.50	110.1	8.43	123.8	9.36	130.7	9.83	151.2	11.22	158.1	11.69	185.6	13.54	192.5	14.01
	91	96.4	7.83	110.1	8.80	123.8	9.78	130.7	10.27	151.2	11.72	158.1	12.22	185.6	14.16	192.5	14.72
	95	96.4	8.12	110.1	9.13	123.8	10.15	130.7	10.66	151.2	12.18	158.1	12.69	185.6	15.01	192.5	15.76
	99	96.4	8.44	110.1	9.50	123.8	10.56	130.7	11.10	151.2	12.68	158.1	13.22	185.6	16.06	192.5	16.90
	104	96.4	8.90	110.1	10.03	123.8	11.15	130.7	11.72	151.2	13.44	158.1	14.24	185.6	17.65	192.5	18.58
	109	96.4	9.47	110.1	10.67	123.8	11.88	130.7	12.49	151.2	14.73	158.1	15.61	185.6	19.40	192.5	20.44
129.6 (60%)	115	96.4	10.25	110.1	11.57	123.8	12.89	130.7	13.66	151.2	16.44	158.1	17.44	185.6	21.74	190.6	22.50
	50	82.6	5.47	94.3	6.11	106.1	6.75	112.0	7.07	129.6	8.03	135.5	8.35	159.0	9.63	165.0	9.95
	59	82.6	5.62	94.3	6.28	106.1	6.94	112.0	7.27	129.6	8.26	135.5	8.59	159.0	9.91	165.0	10.25
	70	82.6	5.91	94.3	6.61	106.1	7.31	112.0	7.66	129.6	8.71	135.5	9.07	159.0	10.47	165.0	10.82
	73	82.6	6.01	94.3	6.72	106.1	7.44	112.0	7.80	129.6	8.87	135.5	9.23	159.0	10.66	165.0	11.02
	77	82.6	6.16	94.3	6.90	106.1	7.63	112.0	8.01	129.6	9.11	135.5	9.48	159.0	10.95	165.0	11.33
	81	82.6	6.33	94.3	7.09	106.1	7.85	112.0	8.24	129.6	9.38	135.5	9.76	159.0	11.28	165.0	11.67
	86	82.6	6.57	94.3	7.37	106.1	8.16	112.0	8.56	129.6	9.75	135.5	10.16	159.0	11.75	165.0	12.15
	91	82.6	6.85	94.3	7.68	106.1	8.52	112.0	8.94	129.6	10.19	135.5	10.61	159.0	12.28	165.0	12.70
	95	82.6	7.10	94.3	7.97	106.1	8.84	112.0	9.28	129.6	10.58	135.5	11.02	159.0	12.76	165.0	13.20
	99	82.6	7.37	94.3	8.28	106.1	9.19	112.0	9.65	129.6	11.01	135.5	11.47	159.0	13.29	165.0	13.78
	104	82.6	7.77	94.3	8.73	106.1	9.70	112.0	10.19	129.6	11.63	135.5	12.12	159.0	14.35	165.0	15.05
	109	82.6	8.26	94.3	9.29	106.1	10.33	112.0	10.85	129.6	12.40	135.5	12.92	159.0	15.73	165.0	16.52
108.0 (50%)	115	82.6	8.93	94.3	10.06	106.1	11.19	112.0	11.76	129.6	13.52	135.5	14.29	159.0	17.57	165.0	18.46
	50	68.8	4.72	78.6	5.26	88.4	5.79	93.4	6.06	108.0	6.85	112.9	7.12	132.5	8.19	137.5	8.46
	59	68.8	4.85	78.6	5.40	88.4	5.95	93.4	6.22	108.0	7.05	112.9	7.32	132.5	8.42	137.5	8.70
	70	68.8	5.09	78.6	5.67	88.4	6.26	93.4	6.55	108.0	7.42	112.9	7.72	132.5	8.89	137.5	9.18
	73	68.8	5.17	78.6	5.77	88.4	6.36	93.4	6.66	108.0	7.56	112.9	7.86	132.5	9.05	137.5	9.35
	77	68.8	5.30	78.6	5.91	88.4	6.52	93.4	6.84	108.0	7.75	112.9	8.06	132.5	9.29	137.5	9.60
	81	68.8	5.44	78.6	6.07	88.4	6.71	93.4	7.03	108.0	7.98	112.9	8.30	132.5	9.56	137.5	9.89
	86	68.8	5.64	78.6	6.30	88.4	6.97	93.4	7.30	108.0	8.29	112.9	8.63	132.5	9.95	137.5	10.29
	91	68.8	5.87	78.6	6.57	88.4	7.26	93.4	7.61	108.0	8.65	112.9	9.01	132.5	10.40	137.5	10.75
	95	68.8	6.08	78.6	6.80	88.4	7.53	93.4	7.89	108.0	8.98	112.9	9.35	132.5	10.80	137.5	11.16
	99	68.8	6.31	78.6	7.06	88.4	7.82	93.4	8.21	108.0	9.34	112.9	9.72	132.5	11.24	137.5	11.62
	104	68.8	6.64	78.6	7.44	88.4	8.25	93.4	8.65	108.0	9.86	112.9	10.26	132.5	11.87	137.5	12.28
	109	68.8	7.04	78.6	7.90	88.4	8.77	93.4	9.20	108.0	10.49	112.9	10.93	132.5	12.66	137.5	13.09
	115	68.8	7.60	78.6	8.55	88.4	9.49	93.4	9.96	108.0	11.37	112.9	11.85	132.5	13.90	137.5	14.55

# Model: AOUA240RLBVG1

MODEL  
SELECTION

Cooling capacity at rated condition: 240 kBTu/h (20 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
360.0 (150%)	50	229.4	13.52	262.1	15.29	285.1	16.37	289.1	16.35	300.8	16.30	304.8	16.27	320.8	16.17	324.8	16.14
	59	229.4	13.92	262.1	15.75	282.9	16.71	286.8	16.69	298.5	16.64	302.5	16.62	318.3	16.52	322.3	16.49
	70	229.4	14.72	262.1	16.67	278.7	17.36	282.6	17.35	294.1	17.30	298.0	17.29	313.6	17.20	317.5	17.17
	73	229.4	15.00	262.1	16.99	277.3	17.58	281.1	17.57	292.5	17.53	296.4	17.52	311.7	17.47	315.1	17.51
	77	229.4	15.42	262.1	17.46	275.1	17.91	278.9	17.90	289.3	18.00	292.8	18.05	306.3	18.23	309.7	18.27
	81	229.4	15.89	262.1	18.14	271.0	18.53	274.3	18.59	284.2	18.75	287.6	18.81	300.8	18.99	304.2	19.04
	86	229.4	16.56	258.4	19.34	264.8	19.47	268.1	19.53	277.7	19.70	281.0	19.75	293.9	19.96	297.2	20.00
	91	229.4	17.92	252.3	20.27	258.6	20.40	261.8	20.47	271.2	20.65	274.4	20.71	286.9	20.93	290.1	20.99
	95	229.4	19.20	247.3	21.03	253.4	21.19	256.5	21.27	265.6	21.49	268.7	21.56	281.0	21.83	284.1	21.90
	99	229.4	20.68	241.9	21.87	247.9	22.04	250.9	22.12	259.9	22.36	263.0	22.44	275.1	22.74	278.1	22.81
	104	229.2	22.74	235.1	22.93	240.9	23.11	243.9	23.21	252.7	23.47	255.7	23.55	267.5	23.88	270.5	23.97
336.0 (140%)	109	222.5	23.80	228.2	24.00	233.9	24.20	236.8	24.30	245.4	24.58	248.4	24.68	260.0	25.04	262.9	25.13
	115	214.3	25.07	219.9	25.29	225.4	25.50	228.2	25.61	236.6	25.93	239.5	26.03	250.8	26.44	253.6	26.54
	50	214.1	12.69	244.6	14.34	275.1	15.99	284.2	16.37	295.7	16.32	299.6	16.30	315.2	16.21	319.2	16.18
	59	214.1	13.07	244.6	14.77	275.0	16.48	282.1	16.71	293.5	16.67	297.4	16.65	312.9	16.56	316.8	16.53
	70	214.1	13.81	244.6	15.63	274.2	17.37	277.9	17.36	289.2	17.32	293.0	17.31	308.3	17.23	312.2	17.21
	73	214.1	14.08	244.6	15.92	272.7	17.59	276.5	17.58	287.7	17.55	291.5	17.54	306.7	17.46	310.5	17.45
	77	214.1	14.47	244.6	16.37	270.7	17.91	274.4	17.91	285.1	17.94	288.5	17.99	301.8	18.17	305.2	18.22
	81	214.1	14.91	244.6	16.87	267.1	18.47	270.4	18.52	280.2	18.69	283.5	18.74	296.5	18.94	299.8	18.98
	86	214.1	15.53	244.6	17.96	261.1	19.40	264.4	19.46	273.9	19.63	277.1	19.69	289.8	19.89	293.1	19.94
	91	214.1	16.32	244.6	19.60	255.1	20.33	258.2	20.39	267.5	20.58	270.6	20.64	283.1	20.86	286.2	20.91
	95	214.1	17.48	244.0	20.95	250.1	21.10	253.1	21.18	262.1	21.40	265.2	21.47	277.3	21.75	280.4	21.82
312.0 (130%)	99	214.1	18.75	238.8	21.78	244.7	21.95	247.7	22.03	256.5	22.27	259.5	22.35	271.5	22.65	274.5	22.73
	104	214.1	20.62	232.1	22.84	237.9	23.02	240.8	23.11	249.5	23.37	252.4	23.46	264.1	23.79	267.1	23.87
	109	214.1	22.68	225.4	23.90	231.0	24.10	233.9	24.20	242.4	24.48	245.3	24.57	256.7	24.94	259.6	25.03
	115	211.7	24.96	217.2	25.18	222.7	25.40	225.5	25.51	233.8	25.82	236.6	25.92	247.7	26.33	250.5	26.43
	50	198.8	11.86	227.1	13.39	255.4	14.93	269.7	15.70	290.1	16.35	293.9	16.33	309.1	16.25	313.0	16.22
	59	198.8	12.21	227.1	13.80	255.4	15.38	269.7	16.18	287.9	16.69	291.7	16.67	306.8	16.60	310.7	16.57
	70	198.8	12.91	227.1	14.59	255.4	16.27	269.7	17.12	283.8	17.34	287.5	17.33	302.4	17.26	306.2	17.24
	73	198.8	13.15	227.1	14.86	255.4	16.58	269.7	17.45	282.3	17.57	286.1	17.56	300.9	17.49	304.7	17.47
	77	198.8	13.51	227.1	15.28	255.4	17.05	269.4	17.91	280.2	17.90	283.7	17.92	296.8	18.11	300.1	18.15
	81	198.8	13.92	227.1	15.74	255.4	17.57	266.0	18.45	275.6	18.61	278.9	18.67	291.7	18.87	295.0	18.91
	86	198.8	14.50	227.1	16.41	255.4	19.10	260.2	19.38	269.5	19.55	272.7	19.61	285.2	19.82	288.4	19.87
288.0 (120%)	91	198.8	15.16	227.1	17.68	251.2	20.24	254.2	20.31	263.4	20.50	266.5	20.56	278.7	20.78	281.8	20.83
	95	198.8	15.84	227.1	18.93	246.3	21.01	249.3	21.09	258.2	21.31	261.2	21.38	273.1	21.66	276.1	21.72
	99	198.8	16.95	227.1	20.38	241.1	21.85	244.0	21.93	252.8	22.17	255.7	22.25	267.4	22.55	270.4	22.63
	104	198.8	18.59	227.1	22.44	234.5	22.91	237.3	23.00	245.9	23.26	248.8	23.35	260.3	23.68	263.2	23.76
	109	198.8	20.43	222.2	23.79	227.8	23.98	230.6	24.08	238.9	24.37	241.8	24.46	253.0	24.82	255.9	24.91
	115	198.8	22.88	214.2	25.06	219.7	25.28	222.4	25.39	230.5	25.70	233.3	25.80	244.3	26.20	247.0	26.30
	50	183.5	11.03	209.6	12.45	235.8	13.86	248.9	14.58	283.8	16.37	287.5	16.36	302.3	16.29	306.1	16.27
	59	183.5	11.36	209.6	12.82	235.8	14.28	248.9	15.02	281.7	16.71	285.4	16.70	300.1	16.63	303.9	16.61
	70	183.5	12.00	209.6	13.55	235.8	15.10	248.9	15.89	277.7	17.36	281.4	17.35	295.9	17.30	299.6	17.28
	73	183.5	12.22	209.6	13.80	235.8	15.39	248.9	16.19	276.4	17.58	280.0	17.57	294.4	17.52	298.1	17.51
	77	183.5	12.55	209.6	14.19	235.8	15.82	248.9	16.64	274.4	17.91	278.0	17.90	291.2	18.03	294.4	18.07
264.0 (110%)	81	183.5	12.93	209.6	14.61	235.8	16.30	248.9	17.15	270.5	18.53	273.7	18.58	286.3	18.79	289.5	18.83
	86	183.5	13.47	209.6	15.23	235.8	17.06	248.9	18.41	264.7	19.46	267.8	19.52	280.1	19.74	283.2	19.79
	91	183.5	14.08	209.6	15.93	235.8	18.61	248.9	20.10	258.7	20.40	261.7	20.47	273.8	20.70	276.8	20.75
	95	183.5	14.63	209.6	16.98	235.8	19.95	245.0	20.97	253.7	21.20	256.7	21.27	268.4	21.55	271.3	21.62
	99	183.5	15.28	209.6	18.20	235.8	21.53	239.9	21.82	248.5	22.06	251.4	22.14	262.9	22.44	265.8	22.51
	104	183.5	16.70	209.6	20.01	230.6	22.79	233.4	22.88	241.8	23.14	244.7	23.23	255.9	23.56	258.8	23.64
	109	183.5	18.32	209.6	22.01	224.1	23.85	226.9	23.95	235.1	24.24	237.9	24.33	248.9	24.69	251.7	24.78
	115	183.5	20.47	209.6	24.68	216.2	25.14	218.9	25.25	226.9	25.56	229.6	25.66	240.4	26.06	243.1	26.16
	50	168.2	10.20	192.2	11.50	216.1	12.80	228.2	13.45	264.0	15.39	276.1	16.05	294.7	16.33	298.3	16.31
	59	168.2	10.50	192.2	11.84	216.1	13.18	228.2	13.86	264.0	15.86	276.1	16.54	292.6	16.67	296.2	16.65
	70	168.2	11.08	192.2	12.51	216.1	13.93	228.2	14.65	264.0	16.78	274.5	17.37	288.6	17.33	292.2	17.31
240.0 (100%)	73	168.2	11.29	192.2	12.74	216.1	14.20	228.2	14.93	264.0	17.10	273.2	17.59	287.2	17.55	290.8	17.54
	77	168.2	11.60	192.2	13.09	216.1	14.59	228.2	15.35	264.0	17.58	271.2	17.91	284.8	17.93	288.0	17.98
	81	168.2	11.94	192.2	13.49	216.1	15.03	228.2	15.81	264.0	18.33	267.8	18.48	280.2	18.69	283.3	18.74
	86	168.2	12.43	192.2	14.05	216.1	15.66	228.2	16.48	259.1	19.36	262.2	19.42	274.2	19.64	277.2	19.69
	91	168.2	13.00	192.2	14.69	216.1	16.53	228.2	17.79	253.4	20.29	256.4	20.36	26			

Cooling capacity at rated condition: 240 kBTu/h (20 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
216.0 (90%)	50	137.7	8.54	157.2	9.60	176.8	10.67	186.7	11.20	216.0	12.79	225.9	13.33	265.1	15.45	274.9	15.99
	59	137.7	8.79	157.2	9.88	176.8	10.98	186.7	11.53	216.0	13.17	225.9	13.73	265.1	15.92	274.9	16.47
	70	137.7	9.26	157.2	10.43	176.8	11.59	186.7	12.18	216.0	13.93	225.9	14.51	265.1	16.84	274.2	17.37
	73	137.7	9.43	157.2	10.62	176.8	11.81	186.7	12.41	216.0	14.19	225.9	14.79	265.1	17.17	273.0	17.59
	77	137.7	9.68	157.2	10.91	176.8	12.13	186.7	12.75	216.0	14.58	225.9	15.20	265.1	17.65	271.2	17.91
	81	137.7	9.97	157.2	11.23	176.8	12.49	186.7	13.13	216.0	15.03	225.9	15.66	265.0	18.43	267.9	18.48
	86	137.7	10.37	157.2	11.69	176.8	13.01	186.7	13.68	216.0	15.66	225.9	16.32	259.7	19.37	262.6	19.42
	91	137.7	10.83	157.2	12.22	176.8	13.60	186.7	14.30	216.0	16.51	225.9	17.54	254.3	20.31	257.1	20.37
	95	137.7	11.24	157.2	12.69	176.8	14.14	186.7	14.86	216.0	17.68	225.9	18.79	249.8	21.10	252.5	21.17
	99	137.7	11.70	157.2	13.21	176.8	14.72	186.7	15.62	216.0	18.98	225.9	20.23	244.9	21.96	247.6	22.03
	104	137.7	12.35	157.2	13.96	176.8	15.90	186.7	17.08	216.0	20.87	225.9	22.26	238.8	23.05	241.4	23.13
	109	137.7	13.17	157.2	14.99	176.8	17.44	186.7	18.75	216.0	22.96	222.3	23.79	232.5	24.15	235.1	24.24
115	137.7	14.28	157.2	16.72	176.8	19.48	186.7	20.96	212.4	24.99	214.9	25.09	224.9	25.49	227.5	25.58	
192.0 (80%)	50	122.3	7.71	139.8	8.66	157.2	9.60	166.0	10.08	192.0	11.49	200.8	11.96	235.6	13.85	244.4	14.33
	59	122.3	7.93	139.8	8.90	157.2	9.88	166.0	10.37	192.0	11.83	200.8	12.32	235.6	14.27	244.4	14.76
	70	122.3	8.36	139.8	9.39	157.2	10.43	166.0	10.95	192.0	12.50	200.8	13.02	235.6	15.09	244.4	15.61
	73	122.3	8.50	139.8	9.56	157.2	10.62	166.0	11.15	192.0	12.73	200.8	13.27	235.6	15.38	244.4	15.91
	77	122.3	8.73	139.8	9.82	157.2	10.91	166.0	11.45	192.0	13.08	200.8	13.63	235.6	15.81	244.4	16.36
	81	122.3	8.98	139.8	10.10	157.2	11.23	166.0	11.79	192.0	13.48	200.8	14.04	235.6	16.29	244.4	16.86
	86	122.3	9.34	139.8	10.51	157.2	11.69	166.0	12.28	192.0	14.04	200.8	14.63	235.6	17.04	244.4	17.94
	91	122.3	9.75	139.8	10.98	157.2	12.21	166.0	12.83	192.0	14.68	200.8	15.30	235.6	18.60	244.4	19.58
	95	122.3	10.11	139.8	11.40	157.2	12.68	166.0	13.33	192.0	15.25	200.8	16.05	235.6	19.92	244.1	20.95
	99	122.3	10.52	139.8	11.86	157.2	13.20	166.0	13.88	192.0	16.19	200.8	17.16	235.6	21.50	239.5	21.80
	104	122.3	11.10	139.8	12.53	157.2	13.95	166.0	14.67	192.0	17.73	200.8	18.84	231.1	22.80	233.6	22.89
	109	122.3	11.82	139.8	13.35	157.2	14.99	166.0	16.06	192.0	19.47	200.8	20.71	225.2	23.89	227.7	23.98
115	122.3	12.82	139.8	14.49	157.2	16.70	166.0	17.92	192.0	21.79	200.8	23.19	218.0	25.21	220.4	25.31	
168.0 (70%)	50	107.1	6.88	122.3	7.71	137.5	8.54	145.2	8.95	168.0	10.19	175.7	10.60	206.2	12.26	213.8	12.67
	59	107.1	7.07	122.3	7.93	137.5	8.78	145.2	9.21	168.0	10.49	175.7	10.92	206.2	12.62	213.8	13.05
	70	107.1	7.45	122.3	8.35	137.5	9.26	145.2	9.72	168.0	11.07	175.7	11.53	206.2	13.34	213.8	13.80
	73	107.1	7.58	122.3	8.50	137.5	9.43	145.2	9.89	168.0	11.28	175.7	11.74	206.2	13.59	213.8	14.06
	77	107.1	7.77	122.3	8.72	137.5	9.68	145.2	10.16	168.0	11.58	175.7	12.06	206.2	13.97	213.8	14.45
	81	107.1	7.99	122.3	8.97	137.5	9.96	145.2	10.46	168.0	11.93	175.7	12.42	206.2	14.39	213.8	14.89
	86	107.1	8.30	122.3	9.33	137.5	10.36	145.2	10.88	168.0	12.42	175.7	12.94	206.2	14.99	213.8	15.51
	91	107.1	8.66	122.3	9.74	137.5	10.82	145.2	11.36	168.0	12.98	175.7	13.52	206.2	15.68	213.8	16.29
	95	107.1	8.98	122.3	10.11	137.5	11.23	145.2	11.80	168.0	13.48	175.7	14.05	206.2	16.61	213.8	17.44
	99	107.1	9.34	122.3	10.51	137.5	11.69	145.2	12.28	168.0	14.04	175.7	14.63	206.2	17.78	213.8	18.71
	104	107.1	9.85	122.3	11.10	137.5	12.34	145.2	12.98	168.0	14.88	175.7	15.76	206.2	19.55	213.8	20.58
	109	107.1	10.48	122.3	11.82	137.5	13.15	145.2	13.83	168.0	16.31	175.7	17.29	206.2	21.49	213.8	22.64
115	107.1	11.35	122.3	12.81	137.5	14.27	145.2	15.13	168.0	18.20	175.7	19.31	206.2	24.08	212.0	24.97	
144.0 (60%)	50	91.8	6.05	104.8	6.76	117.9	7.47	124.5	7.83	144.0	8.89	150.6	9.24	176.7	10.66	183.3	11.02
	59	91.8	6.22	104.8	6.95	117.9	7.68	124.5	8.05	144.0	9.14	150.6	9.51	176.7	10.97	183.3	11.34
	70	91.8	6.54	104.8	7.31	117.9	8.09	124.5	8.48	144.0	9.64	150.6	10.03	176.7	11.59	183.3	11.98
	73	91.8	6.65	104.8	7.44	117.9	8.23	124.5	8.63	144.0	9.82	150.6	10.22	176.7	11.81	183.3	12.20
	77	91.8	6.82	104.8	7.63	117.9	8.45	124.5	8.86	144.0	10.08	150.6	10.49	176.7	12.13	183.3	12.54
	81	91.8	7.00	104.8	7.85	117.9	8.69	124.5	9.12	144.0	10.38	150.6	10.80	176.7	12.49	183.3	12.91
	86	91.8	7.27	104.8	8.15	117.9	9.04	124.5	9.48	144.0	10.80	150.6	11.24	176.7	13.00	183.3	13.45
	91	91.8	7.58	104.8	8.50	117.9	9.43	124.5	9.90	144.0	11.28	150.6	11.75	176.7	13.60	183.3	14.06
	95	91.8	7.85	104.8	8.82	117.9	9.78	124.5	10.27	144.0	11.71	150.6	12.20	176.7	14.13	183.3	14.61
	99	91.8	8.16	104.8	9.16	117.9	10.17	124.5	10.68	144.0	12.19	150.6	12.70	176.7	14.71	183.3	15.26
	104	91.8	8.60	104.8	9.67	117.9	10.74	124.5	11.28	144.0	12.88	150.6	13.42	176.7	15.88	183.3	16.67
	109	91.8	9.14	104.8	10.28	117.9	11.43	124.5	12.01	144.0	13.72	150.6	14.30	176.7	17.42	183.3	18.29
115	91.8	9.88	104.8	11.13	117.9	12.39	124.5	13.02	144.0	14.97	150.6	15.83	176.7	19.46	183.3	20.44	
120.0 (50%)	50	76.5	5.22	87.4	5.81	98.2	6.40	103.7	6.70	120.0	7.59	125.5	7.88	147.3	9.06	152.8	9.36
	59	76.5	5.36	87.4	5.97	98.2	6.58	103.7	6.89	120.0	7.80	125.5	8.11	147.3	9.32	152.8	9.63
	70	76.5	5.63	87.4	6.27	98.2	6.92	103.7	7.25	120.0	8.22	125.5	8.54	147.3	9.84	152.8	10.16
	73	76.5	5.72	87.4	6.38	98.2	7.04	103.7	7.37	120.0	8.36	125.5	8.70	147.3	10.02	152.8	10.35
	77	76.5	5.86	87.4	6.54	98.2	7.22	103.7	7.56	120.0	8.58	125.5	8.92	147.3	10.28	152.8	10.63
	81	76.5	6.02	87.4	6.72	98.2	7.42	103.7	7.78	120.0	8.83	125.5	9.18	147.3	10.59	152.8	10.94
	86	76.5	6.24	87.4	6.97	98.2	7.71	103.7	8.08	120.0	9.18	125.5	9.55	147.3	11.02	152.8	11.39
	91	76.5	6.50	87.4	7.27	98.2	8.04	103.7	8.43	120.0	9.58	125.5	9.97	147.3	11.51	152.8	11.90
	95	76.5	6.72	87.4	7.53	98.2	8.33	103.7	8.74	120.0	9.94	125.5	10.34	147.3	11.95	152.8	12.36
	99	76.5	6.98	87.4	7.82	98.2	8.66	103.7	9.08	120.0	10.34	125.5	10.76	147.3	12.44	152.8	12.86
	104	76.5	7.34	87.4	8.24	98.2	9.13	103.7	9.58	120.0	10.91	125.5	11.36	147.3	13.14	152.8	13.

# Model: AOUA264RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Cooling capacity at rated condition: 264 kBTU/h (22 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
396.0 (150%)	50	252.4	14.93	288.3	16.89	312.5	17.99	316.8	17.98	329.7	17.92	334.1	17.89	351.6	17.77	356.0	17.74
	59	252.4	15.39	288.3	17.40	310.1	18.37	314.4	18.35	327.2	18.30	331.5	18.27	348.9	18.16	353.3	18.13
	70	252.4	16.27	288.3	18.41	305.5	19.08	309.7	19.07	322.3	19.02	326.6	19.00	343.7	18.90	348.0	18.87
	73	252.4	16.58	288.3	18.76	303.9	19.32	308.1	19.31	320.6	19.27	324.9	19.25	341.6	19.19	345.4	19.24
	77	252.4	17.04	288.3	19.29	301.5	19.68	305.7	19.67	317.2	19.78	320.9	19.83	335.7	20.03	339.5	20.07
	81	252.4	17.55	288.3	20.04	297.1	20.36	300.7	20.42	311.6	20.60	315.2	20.66	329.8	20.86	333.5	20.91
	86	252.4	18.29	283.3	21.24	290.3	21.38	293.9	21.45	304.5	21.63	308.1	21.69	322.2	21.92	325.8	21.97
	91	252.4	19.80	276.6	22.26	283.5	22.40	287.0	22.47	297.3	22.67	300.8	22.74	314.6	22.98	318.1	23.04
	95	252.4	21.20	271.2	23.09	277.9	23.26	281.2	23.34	291.3	23.59	294.7	23.66	308.1	23.96	311.5	24.04
	99	252.4	22.83	265.3	24.01	271.8	24.19	275.2	24.28	285.0	24.54	288.4	24.63	301.6	24.96	305.0	25.04
	104	251.4	24.96	257.8	25.17	264.2	25.37	267.5	25.47	277.2	25.75	280.4	25.85	293.4	26.21	296.7	26.30
	109	244.0	26.11	250.3	26.33	256.6	26.55	259.8	26.66	269.2	26.97	272.4	27.07	285.1	27.47	288.3	27.57
115	235.1	27.50	241.2	27.74	247.3	27.98	250.4	28.10	259.6	28.44	262.7	28.56	275.1	29.00	278.2	29.11	
369.6 (140%)	50	235.5	14.02	269.1	15.84	302.6	17.67	311.5	18.00	324.1	17.94	328.4	17.92	345.5	17.82	349.9	17.79
	59	235.5	14.44	269.1	16.32	302.6	18.20	309.2	18.37	321.7	18.32	325.9	18.30	342.9	18.20	347.2	18.17
	70	235.5	15.26	269.1	17.26	300.5	19.09	304.6	19.08	316.9	19.04	321.1	19.03	337.9	18.94	342.1	18.91
	73	235.5	15.55	269.1	17.59	298.9	19.33	303.0	19.33	315.3	19.29	319.5	19.28	336.2	19.19	340.3	19.18
	77	235.5	15.98	269.1	18.08	296.7	19.69	300.7	19.68	312.6	19.71	316.3	19.76	330.9	19.97	334.5	20.01
	81	235.5	16.46	269.1	18.64	292.9	20.28	296.5	20.35	307.1	20.53	310.8	20.59	325.1	20.80	328.7	20.85
	86	235.5	17.15	269.1	19.84	286.3	21.30	289.8	21.37	300.3	21.56	303.8	21.62	317.8	21.85	321.3	21.90
	91	235.5	18.03	269.1	21.65	279.7	22.32	283.1	22.39	293.3	22.60	296.7	22.66	310.4	22.90	313.8	22.96
	95	235.5	19.30	267.6	23.00	274.2	23.17	277.5	23.25	287.4	23.49	290.8	23.57	304.1	23.88	307.4	23.95
	99	235.5	20.70	261.9	23.91	268.3	24.10	271.6	24.19	281.3	24.45	284.6	24.53	297.7	24.86	301.0	24.94
	104	235.5	22.75	254.6	25.06	260.9	25.26	264.1	25.36	273.6	25.65	276.9	25.74	289.7	26.11	292.9	26.20
	109	235.5	25.02	247.2	26.23	253.4	26.44	256.5	26.55	265.9	26.86	269.0	26.96	281.5	27.36	284.7	27.46
115	232.3	27.39	238.3	27.63	244.3	27.87	247.4	27.98	256.4	28.33	259.5	28.44	271.7	28.88	274.8	28.99	
343.2 (130%)	50	218.7	13.11	249.9	14.80	281.0	16.49	296.7	17.35	318.0	17.97	322.1	17.95	338.8	17.86	343.1	17.83
	59	218.7	13.50	249.9	15.24	281.0	16.99	296.7	17.87	315.6	18.35	319.7	18.33	336.3	18.25	340.5	18.22
	70	218.7	14.26	249.9	16.12	281.0	17.97	296.7	18.91	311.0	19.06	315.1	19.05	331.5	18.98	335.6	18.95
	73	218.7	14.53	249.9	16.42	281.0	18.32	296.7	19.27	309.5	19.31	313.6	19.30	329.8	19.23	334.0	19.21
	77	218.7	14.93	249.9	16.87	281.0	18.83	295.3	19.69	307.2	19.67	311.1	19.69	325.4	19.89	329.0	19.94
	81	218.7	15.37	249.9	17.39	281.0	19.41	291.7	20.26	302.2	20.45	305.7	20.51	319.8	20.72	323.4	20.78
	86	218.7	16.02	249.9	18.12	281.0	21.10	285.3	21.28	295.5	21.48	299.0	21.54	312.7	21.77	316.2	21.82
	91	218.7	16.75	249.9	19.53	275.4	22.23	278.8	22.30	288.8	22.51	292.2	22.58	305.6	22.82	309.0	22.88
	95	218.7	17.50	249.9	20.91	270.1	23.06	273.4	23.15	283.1	23.39	286.4	23.47	299.5	23.77	302.8	23.85
	99	218.7	18.71	249.9	22.51	264.4	23.98	267.6	24.08	277.2	24.34	280.4	24.42	293.3	24.75	296.5	24.83
	104	218.7	20.53	249.9	24.76	257.2	25.15	260.3	25.25	269.7	25.53	272.9	25.63	285.5	25.99	288.6	26.08
	109	218.7	22.54	243.7	26.10	249.9	26.32	252.9	26.43	262.1	26.74	265.2	26.84	277.5	27.24	280.7	27.34
115	218.7	25.23	235.0	27.50	241.0	27.74	244.0	27.85	252.9	28.20	255.9	28.31	268.0	28.75	271.0	28.86	
316.8 (120%)	50	201.9	12.19	230.6	13.75	259.4	15.32	273.9	16.10	311.1	18.00	315.2	17.98	331.4	17.91	335.5	17.88
	59	201.9	12.55	230.6	14.17	259.4	15.78	273.9	16.59	308.8	18.37	312.9	18.36	329.0	18.29	333.1	18.26
	70	201.9	13.26	230.6	14.97	259.4	16.68	273.9	17.55	304.5	19.08	308.4	19.07	324.4	19.01	328.4	18.99
	73	201.9	13.50	230.6	15.25	259.4	17.00	273.9	17.88	303.0	19.33	306.9	19.32	322.8	19.26	326.8	19.24
	77	201.9	13.87	230.6	15.67	259.4	17.47	273.9	18.38	300.7	19.68	304.7	19.68	319.3	19.81	322.8	19.86
	81	201.9	14.29	230.6	16.15	259.4	18.01	273.9	18.95	296.6	20.35	300.1	20.41	313.9	20.64	317.4	20.69
	86	201.9	14.88	230.6	16.82	259.4	18.85	273.9	20.34	290.2	21.38	293.6	21.44	307.1	21.68	310.5	21.73
	91	201.9	15.55	230.6	17.60	259.4	20.56	273.9	22.20	283.7	22.41	287.0	22.47	300.2	22.73	303.5	22.78
	95	201.9	16.16	230.6	18.77	259.4	22.02	268.7	23.03	278.3	23.27	281.5	23.35	294.3	23.66	297.6	23.73
	99	201.9	16.88	230.6	20.10	259.4	23.76	263.1	23.95	272.5	24.21	275.7	24.30	288.3	24.63	291.5	24.71
	104	201.9	18.43	230.6	22.09	252.9	25.01	256.0	25.11	265.2	25.40	268.3	25.49	280.7	25.86	283.8	25.94
	109	201.9	20.22	230.6	24.28	245.8	26.18	248.9	26.28	257.9	26.60	260.9	26.70	273.0	27.09	276.1	27.19
115	201.9	22.59	230.6	27.20	237.2	27.59	240.2	27.70	248.9	28.04	251.9	28.16	263.7	28.59	266.7	28.70	
290.4 (110%)	50	185.1	11.28	211.4	12.71	237.7	14.14	251.0	14.86	290.4	17.00	303.7	17.73	323.1	17.95	327.1	17.93
	59	185.1	11.61	211.4	13.09	237.7	14.56	251.0	15.31	290.4	17.52	303.7	18.27	320.8	18.33	324.8	18.31
	70	185.1	12.25	211.4	13.82	237.7	15.39	251.0	16.18	290.4	18.53	300.9	19.09	316.4	19.05	320.3	19.03
	73	185.1	12.48	211.4	14.08	237.7	15.68	251.0	16.49	290.4	18.89	299.5	19.33	314.9	19.29	318.8	19.28
	77	185.1	12.82	211.4	14.47	237.7	16.12	251.0	16.95	290.4	19.42	297.4	19.69	312.3	19.70	315.8	19.76
	81	185.1	13.20	211.4	14.90	237.7	16.61	251.0	17.47	290.3	20.24	293.7	20.30	307.2	20.53	310.6	20.58
	86	185.1	13.74	211.4	15.52	237.7	17.30	251.0	18.20	284.1	21.26	287.5	21.32	300.7	21.57	304.0	21.63
	91	185.1	14.36	211.4	16.23	237.7	18.26	251.0	19.66	277.9	22.28	281.2	22.35	294.1	22.61	297.3	22.67
	95	18															

Cooling capacity at rated condition: 264 kBTu/h (22 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
237.6 (90%)	50	151.4	9.45	173.0	10.62	194.5	11.79	205.4	12.38	237.6	14.14	248.5	14.72	291.6	17.07	302.4	17.66
	59	151.4	9.72	173.0	10.93	194.5	12.14	205.4	12.75	237.6	14.56	248.5	15.17	291.6	17.59	302.4	18.20
	70	151.4	10.25	173.0	11.53	194.5	12.82	205.4	13.47	237.6	15.39	248.5	16.03	291.6	18.60	300.7	19.09
	73	151.4	10.43	173.0	11.74	194.5	13.06	205.4	13.72	237.6	15.68	248.5	16.34	291.6	18.96	299.3	19.33
	77	151.4	10.71	173.0	12.06	194.5	13.41	205.4	14.09	237.6	16.11	248.5	16.79	291.6	19.49	297.3	19.69
	81	151.4	11.02	173.0	12.42	194.5	13.81	205.4	14.51	237.6	16.60	248.5	17.30	290.6	20.24	293.8	20.30
	86	151.4	11.46	173.0	12.92	194.5	14.38	205.4	15.11	237.6	17.29	248.5	18.03	284.8	21.27	288.0	21.33
	91	151.4	11.97	173.0	13.50	194.5	15.03	205.4	15.80	237.6	18.25	248.5	19.38	278.9	22.31	282.0	22.37
	95	151.4	12.43	173.0	14.02	194.5	15.62	205.4	16.42	237.6	19.53	248.5	20.75	274.0	23.16	277.0	23.24
	99	151.4	12.93	173.0	14.60	194.5	16.26	205.4	17.25	237.6	20.95	248.5	22.33	268.7	24.10	271.6	24.19
	104	151.4	13.66	173.0	15.42	194.5	17.56	205.4	18.86	237.6	23.04	248.5	24.57	261.9	25.30	264.8	25.39
	109	151.4	14.55	173.0	16.56	194.5	19.25	205.4	20.69	237.6	25.33	243.9	26.11	255.1	26.50	258.0	26.60
	115	151.4	15.78	173.0	18.45	194.5	21.49	205.4	23.12	233.1	27.42	235.9	27.53	246.8	27.96	249.6	28.07
211.2 (80%)	50	134.6	8.54	153.8	9.58	172.9	10.62	182.6	11.14	211.2	12.70	220.9	13.22	259.2	15.31	268.8	15.83
	59	134.6	8.78	153.8	9.85	172.9	10.92	182.6	11.47	211.2	13.07	220.9	13.62	259.2	15.77	268.8	16.31
	70	134.6	9.24	153.8	10.39	172.9	11.53	182.6	12.10	211.2	13.81	220.9	14.39	259.2	16.67	268.8	17.25
	73	134.6	9.41	153.8	10.58	172.9	11.74	182.6	12.33	211.2	14.07	220.9	14.66	259.2	16.99	268.8	17.58
	77	134.6	9.65	153.8	10.86	172.9	12.06	182.6	12.66	211.2	14.45	220.9	15.06	259.2	17.46	268.8	18.07
	81	134.6	9.93	153.8	11.17	172.9	12.41	182.6	13.04	211.2	14.89	220.9	15.52	259.2	17.99	268.8	18.62
	86	134.6	10.33	153.8	11.62	172.9	12.92	182.6	13.57	211.2	15.51	220.9	16.16	259.2	18.84	268.8	19.82
	91	134.6	10.78	153.8	12.14	172.9	13.50	182.6	14.18	211.2	16.22	220.9	16.90	259.2	20.54	268.8	21.62
	95	134.6	11.18	153.8	12.60	172.9	14.02	182.6	14.73	211.2	16.85	220.9	17.73	259.2	22.00	267.7	23.00
	99	134.6	11.63	153.8	13.11	172.9	14.59	182.6	15.34	211.2	17.88	220.9	18.96	259.2	23.74	262.7	23.94
	104	134.6	12.27	153.8	13.85	172.9	15.42	182.6	16.21	211.2	19.58	220.9	20.80	253.5	25.03	256.3	25.12
	109	134.6	13.07	153.8	14.75	172.9	16.55	182.6	17.73	211.2	21.48	220.9	22.85	247.1	26.22	249.8	26.32
	115	134.6	14.16	153.8	16.01	172.9	18.44	182.6	19.77	211.2	24.03	220.9	25.58	239.2	27.67	241.9	27.77
184.8 (70%)	50	117.8	7.62	134.5	8.53	151.3	9.44	159.8	9.90	184.8	11.26	193.3	11.73	226.8	13.55	235.2	14.01
	59	117.8	7.83	134.5	8.77	151.3	9.71	159.8	10.19	184.8	11.59	193.3	12.07	226.8	13.95	235.2	14.42
	70	117.8	8.24	134.5	9.24	151.3	10.24	159.8	10.74	184.8	12.24	193.3	12.74	226.8	14.74	235.2	15.24
	73	117.8	8.39	134.5	9.41	151.3	10.42	159.8	10.94	184.8	12.47	193.3	12.98	226.8	15.02	235.2	15.53
	77	117.8	8.60	134.5	9.65	151.3	10.70	159.8	11.23	184.8	12.80	193.3	13.33	226.8	15.43	235.2	15.96
	81	117.8	8.84	134.5	9.93	151.3	11.01	159.8	11.56	184.8	13.18	193.3	13.73	226.8	15.90	235.2	16.45
	86	117.8	9.19	134.5	10.32	151.3	11.46	159.8	12.03	184.8	13.72	193.3	14.29	226.8	16.56	235.2	17.14
	91	117.8	9.58	134.5	10.77	151.3	11.96	159.8	12.56	184.8	14.34	193.3	14.94	226.8	17.32	235.2	18.00
	95	117.8	9.94	134.5	11.18	151.3	12.42	159.8	13.04	184.8	14.90	193.3	15.52	226.8	18.35	235.2	19.27
	99	117.8	10.33	134.5	11.62	151.3	12.92	159.8	13.57	184.8	15.51	193.3	16.17	226.8	19.64	235.2	20.66
	104	117.8	10.89	134.5	12.27	151.3	13.65	159.8	14.34	184.8	16.44	193.3	17.41	226.8	21.58	235.2	22.71
	109	117.8	11.59	134.5	13.06	151.3	14.54	159.8	15.28	184.8	18.01	193.3	19.08	226.8	23.71	235.2	24.97
	115	117.8	12.54	134.5	14.16	151.3	15.77	159.8	16.71	184.8	20.09	193.3	21.31	226.8	26.55	232.7	27.40
158.4 (60%)	50	101.0	6.71	115.3	7.49	129.7	8.27	136.9	8.66	158.4	9.83	165.7	10.22	194.4	11.79	201.6	12.18
	59	101.0	6.89	115.3	7.69	129.7	8.50	136.9	8.91	158.4	10.11	165.7	10.52	194.4	12.13	201.6	12.54
	70	101.0	7.24	115.3	8.10	129.7	8.95	136.9	9.38	158.4	10.66	165.7	11.10	194.4	12.81	201.6	13.24
	73	101.0	7.36	115.3	8.24	129.7	9.11	136.9	9.55	158.4	10.86	165.7	11.30	194.4	13.05	201.6	13.49
	77	101.0	7.55	115.3	8.45	129.7	9.35	136.9	9.80	158.4	11.15	165.7	11.60	194.4	13.40	201.6	13.86
	81	101.0	7.75	115.3	8.68	129.7	9.61	136.9	10.08	158.4	11.47	165.7	11.94	194.4	13.80	201.6	14.27
	86	101.0	8.05	115.3	9.02	129.7	9.99	136.9	10.48	158.4	11.94	165.7	12.43	194.4	14.37	201.6	14.86
	91	101.0	8.39	115.3	9.41	129.7	10.43	136.9	10.94	158.4	12.47	165.7	12.98	194.4	15.02	201.6	15.54
	95	101.0	8.69	115.3	9.75	129.7	10.82	136.9	11.35	158.4	12.94	165.7	13.48	194.4	15.61	201.6	16.14
	99	101.0	9.03	115.3	10.14	129.7	11.25	136.9	11.81	158.4	13.47	165.7	14.03	194.4	16.25	201.6	16.86
	104	101.0	9.51	115.3	10.69	129.7	11.87	136.9	12.46	158.4	14.23	165.7	14.83	194.4	17.54	201.6	18.40
	109	101.0	10.11	115.3	11.37	129.7	12.63	136.9	13.27	158.4	15.16	165.7	15.80	194.4	19.23	201.6	20.19
	115	101.0	10.93	115.3	12.31	129.7	13.69	136.9	14.39	158.4	16.54	165.7	17.47	194.4	21.47	201.6	22.55
132.0 (50%)	50	84.1	5.79	96.1	6.44	108.1	7.09	114.1	7.42	132.0	8.40	138.0	8.72	162.0	10.03	168.0	10.35
	59	84.1	5.94	96.1	6.61	108.1	7.29	114.1	7.62	132.0	8.63	138.0	8.97	162.0	10.31	168.0	10.65
	70	84.1	6.24	96.1	6.95	108.1	7.66	114.1	8.02	132.0	9.09	138.0	9.45	162.0	10.88	168.0	11.24
	73	84.1	6.34	96.1	7.07	108.1	7.80	114.1	8.16	132.0	9.25	138.0	9.62	162.0	11.08	168.0	11.44
	77	84.1	6.49	96.1	7.24	108.1	7.99	114.1	8.37	132.0	9.49	138.0	9.87	162.0	11.37	168.0	11.75
	81	84.1	6.66	96.1	7.44	108.1	8.22	114.1	8.61	132.0	9.76	138.0	10.16	162.0	11.70	168.0	12.10
	86	84.1	6.91	96.1	7.72	108.1	8.53	114.1	8.94	132.0	10.15	138.0	10.56	162.0	12.18	168.0	12.59
	91	84.1	7.19	96.1	8.04	108.1	8.89	114.1	9.32	132.0	10.59	138.0	11.02	162.0	12.72	168.0	13.15
	95	84.1	7.45	96.1	8.33	108.1	9.22	114.1	9.66	132.0	10.99	138.0	11.44	162.0	13.21	168.0	13.66
	99	84.1	7.73	96.1	8.65	108.1	9.58	114.1	10.05	132.0	11.43	138.0	11.90	162.0	13.75	168.0	14.21
	104	84.1	8.13	96.1	9.11	108.1	10.10	11									



# Model: AOUA288RLBVG1

MODEL  
SELECTION

Cooling capacity at rated condition: 288 kBtu/h (24 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
		°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC
432.0 (150%)	50	275.3	16.71	314.5	18.89	340.9	20.13	345.6	20.12	359.7	20.05	364.5	20.02	383.5	19.89	388.4	19.85
	59	275.3	17.21	314.5	19.47	338.3	20.55	343.0	20.54	356.9	20.47	361.7	20.45	380.6	20.32	385.4	20.29
	70	275.3	18.20	314.5	20.59	333.2	21.35	337.9	21.34	351.6	21.29	356.3	21.26	374.9	21.15	379.7	21.12
	73	275.3	18.55	314.5	20.99	331.5	21.62	336.1	21.61	349.8	21.57	354.4	21.54	372.8	21.47	376.9	21.52
	77	275.3	19.06	314.5	21.58	329.0	22.03	333.5	22.02	346.1	22.12	350.2	22.18	366.3	22.40	370.4	22.46
	81	275.3	19.64	314.5	22.42	324.1	22.78	328.1	22.85	340.0	23.05	344.0	23.11	359.8	23.34	363.8	23.40
	86	275.3	20.47	309.1	23.77	316.8	23.92	320.7	24.00	332.2	24.21	336.1	24.27	351.6	24.52	355.5	24.58
	91	275.3	22.16	301.8	24.91	309.3	25.07	313.1	25.15	324.4	25.37	328.2	25.44	343.2	25.71	347.0	25.79
	95	275.3	23.73	295.8	25.84	303.1	26.03	306.8	26.13	317.8	26.39	321.5	26.48	336.2	26.82	339.9	26.90
	99	275.3	25.56	289.4	26.87	296.6	27.08	300.2	27.18	311.0	27.47	314.6	27.57	329.1	27.93	332.7	28.02
	104	274.3	27.94	281.3	28.17	288.3	28.39	291.8	28.50	302.4	28.83	305.9	28.93	320.1	29.34	323.7	29.44
	109	266.2	29.23	273.0	29.48	279.9	29.72	283.4	29.84	293.7	30.19	297.2	30.31	311.0	30.75	314.5	30.86
403.2 (140%)	115	256.4	30.79	263.1	31.06	269.7	31.33	273.1	31.46	283.1	31.84	286.5	31.97	300.1	32.46	303.5	32.59
	50	257.0	15.69	293.6	17.73	330.1	19.77	339.9	20.14	353.6	20.08	358.3	20.05	377.0	19.94	381.7	19.90
	59	257.0	16.15	293.6	18.26	330.1	20.37	337.3	20.56	350.9	20.50	355.6	20.48	374.1	20.37	378.8	20.34
	70	257.0	17.07	293.6	19.31	327.8	21.36	332.3	21.35	345.8	21.31	350.4	21.29	368.6	21.20	373.3	21.17
	73	257.0	17.40	293.6	19.68	326.1	21.63	330.6	21.63	344.0	21.59	348.6	21.57	366.7	21.48	371.3	21.45
	77	257.0	17.88	293.6	20.23	323.7	22.03	328.1	22.03	341.1	22.05	345.1	22.11	361.0	22.34	365.0	22.39
	81	257.0	18.42	293.6	20.85	319.5	22.70	323.5	22.77	335.1	22.97	339.1	23.03	354.7	23.27	358.6	23.33
	86	257.0	19.19	293.6	22.20	312.4	23.84	316.2	23.91	327.6	24.13	331.5	24.19	346.7	24.45	350.6	24.51
	91	257.0	20.17	293.6	24.23	305.1	24.98	308.9	25.06	320.0	25.29	323.7	25.36	338.6	25.63	342.3	25.69
	95	257.0	21.60	292.0	25.74	299.2	25.93	302.8	26.02	313.6	26.29	317.2	26.38	331.7	26.72	335.4	26.80
	99	257.0	23.17	285.7	26.76	292.7	26.97	296.3	27.07	306.9	27.36	310.5	27.46	324.8	27.83	328.4	27.91
	104	257.0	25.47	277.7	28.05	284.6	28.28	288.1	28.39	298.5	28.71	302.0	28.82	316.0	29.22	319.5	29.32
	109	257.0	28.01	269.7	29.36	276.4	29.60	279.9	29.72	290.0	30.07	293.5	30.18	307.1	30.63	310.6	30.74
374.4 (130%)	115	253.4	30.66	259.9	30.93	266.5	31.20	269.8	31.33	279.7	31.71	283.1	31.84	296.4	32.33	299.8	32.45
	50	238.6	14.66	272.6	16.56	306.5	18.45	323.7	19.41	346.9	20.11	351.4	20.09	369.7	19.99	374.3	19.96
	59	238.6	15.10	272.6	17.05	306.5	19.01	323.7	20.00	344.3	20.53	348.8	20.51	366.9	20.42	371.5	20.39
	70	238.6	15.95	272.6	18.03	306.5	20.11	323.7	21.16	339.3	21.33	343.8	21.32	361.7	21.24	366.2	21.21
	73	238.6	16.25	272.6	18.37	306.5	20.49	323.7	21.56	337.6	21.61	342.1	21.59	359.8	21.52	364.3	21.49
	77	238.6	16.70	272.6	18.88	306.5	21.07	322.1	22.04	335.1	22.01	339.4	22.02	355.1	22.25	359.0	22.31
	81	238.6	17.20	272.6	19.46	306.5	21.72	318.2	22.67	329.7	22.88	333.6	22.94	349.0	23.19	352.8	23.24
	86	238.6	17.92	272.6	20.28	306.5	23.61	311.2	23.81	322.4	24.03	326.2	24.10	341.2	24.36	345.0	24.42
	91	238.6	18.74	272.6	21.85	300.4	24.88	304.1	24.96	315.1	25.19	318.8	25.26	333.4	25.54	337.1	25.60
	95	238.6	19.58	272.6	23.40	294.7	25.81	298.3	25.91	308.9	26.18	312.5	26.27	326.7	26.61	330.3	26.69
	99	238.6	20.94	272.6	25.19	288.4	26.84	292.0	26.95	302.4	27.24	305.9	27.34	320.0	27.70	323.5	27.79
	104	238.6	22.97	272.6	27.72	280.5	28.15	284.0	28.26	294.2	28.58	297.7	28.68	311.4	29.09	314.9	29.19
	109	238.6	25.23	265.9	29.22	272.6	29.46	275.9	29.58	285.9	29.93	289.3	30.05	302.8	30.49	306.2	30.60
345.6 (120%)	115	238.6	28.25	256.4	30.79	262.9	31.05	266.1	31.18	275.9	31.57	279.2	31.69	292.3	32.18	295.6	32.30
	50	220.3	13.64	251.6	15.39	283.0	17.14	298.8	18.02	339.4	20.14	343.8	20.12	361.6	20.04	366.1	20.01
	59	220.3	14.04	251.6	15.85	283.0	17.65	298.8	18.56	336.9	20.56	341.3	20.54	358.9	20.46	363.4	20.44
	70	220.3	14.83	251.6	16.75	283.0	18.66	298.8	19.63	332.2	21.35	336.5	21.34	353.9	21.28	358.3	21.25
	73	220.3	15.10	251.6	17.06	283.0	19.02	298.8	20.01	330.5	21.63	334.8	21.62	352.1	21.55	356.5	21.53
	77	220.3	15.52	251.6	17.54	283.0	19.55	298.8	20.57	328.1	22.03	332.4	22.02	348.4	22.16	352.2	22.21
	81	220.3	15.98	251.6	18.06	283.0	20.15	298.8	21.20	323.6	22.77	327.4	22.84	342.5	23.09	346.3	23.15
	86	220.3	16.65	251.6	18.82	283.0	21.09	298.8	22.76	316.6	23.92	320.3	23.99	335.1	24.26	338.8	24.32
	91	220.3	17.40	251.6	19.69	283.0	23.00	298.8	24.84	309.5	25.07	313.1	25.15	327.5	25.43	331.1	25.50
	95	220.3	18.08	251.6	21.00	283.0	24.64	293.2	25.77	303.6	26.04	307.1	26.13	321.1	26.47	324.7	26.56
	99	220.3	18.89	251.6	22.49	282.9	26.59	287.1	26.80	297.3	27.10	300.8	27.19	314.5	27.56	318.0	27.65
	104	220.3	20.63	251.6	24.73	275.9	28.00	279.3	28.11	289.4	28.43	292.7	28.53	306.2	28.94	309.7	29.04
	109	220.3	22.63	251.6	27.18	268.2	29.30	271.5	29.42	281.3	29.77	284.6	29.89	297.8	30.33	301.2	30.44
316.8 (110%)	115	220.3	25.29	251.6	30.46	258.7	30.88	262.0	31.01	271.5	31.40	274.8	31.52	287.7	32.01	290.9	32.13
	50	201.9	12.61	230.7	14.22	259.4	15.82	273.9	16.63	316.8	19.03	331.3	19.83	352.5	20.08	356.8	20.06
	59	201.9	12.98	230.7	14.64	259.4	16.29	273.9	17.13	316.8	19.60	331.3	20.44	350.0	20.51	354.3	20.49
	70	201.9	13.71	230.7	15.46	259.4	17.22	273.9	18.11	316.8	20.74	328.3	21.36	345.2	21.31	349.4	21.30
	73	201.9	13.96	230.7	15.75	259.4	17.55	273.9	18.45	316.8	21.14	326.7	21.63	343.5	21.59	347.8	21.57
	77	201.9	14.34	230.7	16.19	259.4	18.04	273.9	18.97	316.8	21.73	324.4	22.03	340.8	22.04	344.6	22.10
	81	201.9	14.77	230.7	16.67	259.4	18.58	273.9	19.55	316.7	22.64	320.4	22.71	335.2	22.97	338.9	23.03
	86	201.9	15.37	230.7	17.37	259.4	19.36	273.9	20.37	310.0	23.79	313.6	23.86	328.1	24.13	331.7	24.20
	91	201.9	16.06	230.7	18.16	259.4	20.43	273.9	21.99	303.2	24.94	306.7	25.02	320.8	25.30	324.4	25.37
	95	201.9	16.69	230.7	18.87	259.4	21.87	273.9	23.55	297.6	25.89	301.0	25.98	314.7	26.32	318.2	26.40
	99	201.9	17.38	230.7	20.04	259.4	23.46	273.9	25.36	291.5	26.93	294.9	27.03	308.4	27.40	311.8	27.49
	104	201.9	18.43	230.7	21.94	259.4	25.81	273.9	27.91	283.8	28.25	287.1	28.36	300.4	28.77		

Cooling capacity at rated condition: 288 kBTu/h (24 ton)																	
Total rated capacity of indoor unit	Outdoor temperature	Indoor temperature															
		68°FDB/59°FWB		73°FDB/61°FWB		75°FDB/63°FWB		79°FDB/64°FWB		80°FDB/67°FWB		82°FDB/68°FWB		86°FDB/72°FWB		90°FDB/73°FWB	
	°FDB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
259.2 (90%)	50	165.2	10.56	188.7	11.88	212.2	13.19	224.1	13.85	259.2	15.81	271.1	16.47	318.1	19.10	330.0	19.76
	59	165.2	10.87	188.7	12.22	212.2	13.58	224.1	14.26	259.2	16.28	271.1	16.97	318.1	19.68	330.0	20.36
	70	165.2	11.46	188.7	12.90	212.2	14.34	224.1	15.06	259.2	17.21	271.1	17.94	318.1	20.82	328.0	21.36
	73	165.2	11.67	188.7	13.13	212.2	14.60	224.1	15.35	259.2	17.54	271.1	18.28	318.1	21.22	326.6	21.63
	77	165.2	11.98	188.7	13.49	212.2	15.00	224.1	15.76	259.2	18.03	271.1	18.79	318.1	21.81	324.4	22.03
	81	165.2	12.32	188.7	13.89	212.2	15.45	224.1	16.24	259.2	18.57	271.1	19.36	317.1	22.65	320.6	22.72
	86	165.2	12.82	188.7	14.45	212.2	16.09	224.1	16.91	259.2	19.35	271.1	20.18	310.7	23.80	314.2	23.87
	91	165.2	13.39	188.7	15.10	212.2	16.82	224.1	17.68	259.2	20.41	271.1	21.69	304.3	24.96	307.6	25.03
	95	165.2	13.90	188.7	15.68	212.2	17.47	224.1	18.37	259.2	21.85	271.1	23.22	298.9	25.92	302.2	26.01
	99	165.2	14.46	188.7	16.33	212.2	18.20	224.1	19.31	259.2	23.45	271.1	24.99	293.1	26.98	296.3	27.07
	104	165.2	15.28	188.7	17.25	212.2	19.65	224.1	21.11	259.2	25.79	271.1	27.50	285.8	28.31	288.9	28.41
	109	165.2	16.28	188.7	18.53	212.2	21.54	224.1	23.16	259.2	28.36	266.0	29.23	278.3	29.67	281.4	29.77
230.4 (80%)	115	165.2	17.66	188.7	20.65	212.2	24.06	224.1	25.89	254.3	30.70	257.3	30.82	269.2	31.31	272.3	31.42
	50	146.8	9.54	167.7	10.71	188.6	11.87	199.2	12.46	230.4	14.20	241.0	14.79	282.8	17.12	293.3	17.71
	59	146.8	9.81	167.7	11.01	188.6	12.22	199.2	12.83	230.4	14.63	241.0	15.23	282.8	17.64	293.3	18.25
	70	146.8	10.34	167.7	11.62	188.6	12.89	199.2	13.54	230.4	15.45	241.0	16.10	282.8	18.65	293.3	19.30
	73	146.8	10.52	167.7	11.83	188.6	13.13	199.2	13.79	230.4	15.74	241.0	16.40	282.8	19.01	293.3	19.67
	77	146.8	10.80	167.7	12.14	188.6	13.49	199.2	14.16	230.4	16.17	241.0	16.85	282.8	19.54	293.3	20.22
	81	146.8	11.11	167.7	12.49	188.6	13.88	199.2	14.58	230.4	16.66	241.0	17.36	282.8	20.14	293.3	20.84
	86	146.8	11.55	167.7	13.00	188.6	14.45	199.2	15.18	230.4	17.35	241.0	18.08	282.8	21.07	293.3	22.18
	91	146.8	12.05	167.7	13.57	188.6	15.10	199.2	15.87	230.4	18.14	241.0	18.91	282.8	22.98	293.3	24.20
	95	146.8	12.50	167.7	14.09	188.6	15.68	199.2	16.48	230.4	18.86	241.0	19.83	282.8	24.62	292.1	25.74
	99	146.8	13.01	167.7	14.67	188.6	16.32	199.2	17.16	230.4	20.01	241.0	21.21	282.8	26.57	286.6	26.79
	104	146.8	13.73	167.7	15.49	188.6	17.25	199.2	18.14	230.4	21.91	241.0	23.28	276.6	28.02	279.6	28.12
201.6 (70%)	109	146.8	14.62	167.7	16.51	188.6	18.52	199.2	19.84	230.4	24.05	241.0	25.58	269.5	29.35	272.5	29.46
	115	146.8	15.84	167.7	17.91	188.6	20.64	199.2	22.13	230.4	26.90	241.0	28.64	260.9	30.97	263.9	31.09
	50	128.5	8.52	146.8	9.54	165.1	10.56	174.3	11.07	201.6	12.60	210.9	13.11	247.4	15.15	256.6	15.67
	59	128.5	8.75	146.8	9.81	165.1	10.86	174.3	11.39	201.6	12.97	210.9	13.50	247.4	15.61	256.6	16.14
	70	128.5	9.21	146.8	10.33	165.1	11.45	174.3	12.01	201.6	13.69	210.9	14.25	247.4	16.49	256.6	17.05
	73	128.5	9.37	146.8	10.52	165.1	11.66	174.3	12.23	201.6	13.94	210.9	14.52	247.4	16.80	256.6	17.38
	77	128.5	9.62	146.8	10.79	165.1	11.97	174.3	12.56	201.6	14.32	210.9	14.91	247.4	17.27	256.6	17.86
	81	128.5	9.89	146.8	11.10	165.1	12.32	174.3	12.93	201.6	14.74	210.9	15.36	247.4	17.79	256.6	18.40
	86	128.5	10.27	146.8	11.54	165.1	12.81	174.3	13.45	201.6	15.35	210.9	15.99	247.4	18.53	256.6	19.17
	91	128.5	10.71	146.8	12.05	165.1	13.38	174.3	14.05	201.6	16.05	210.9	16.72	247.4	19.38	256.6	20.14
	95	128.5	11.11	146.8	12.50	165.1	13.89	174.3	14.59	201.6	16.67	210.9	17.37	247.4	20.53	256.6	21.56
	99	128.5	11.55	146.8	13.00	165.1	14.45	174.3	15.19	201.6	17.36	210.9	18.09	247.4	21.97	256.6	23.12
	104	128.5	12.18	146.8	13.72	165.1	15.26	174.3	16.04	201.6	18.39	210.9	19.48	247.4	24.15	256.6	25.42
172.8 (60%)	109	128.5	12.96	146.8	14.61	165.1	16.26	174.3	17.10	201.6	20.16	210.9	21.36	247.4	26.54	256.6	27.95
	115	128.5	14.03	146.8	15.84	165.1	17.64	174.3	18.70	201.6	22.49	210.9	23.85	247.4	29.73	253.8	30.68
	50	110.1	7.50	125.8	8.37	141.5	9.24	149.4	9.68	172.8	10.99	180.7	11.43	212.1	13.18	220.0	13.62
	59	110.1	7.69	125.8	8.60	141.5	9.50	149.4	9.96	172.8	11.31	180.7	11.76	212.1	13.57	220.0	14.02
	70	110.1	8.09	125.8	9.05	141.5	10.01	149.4	10.49	172.8	11.93	180.7	12.41	212.1	14.33	220.0	14.81
	73	110.1	8.23	125.8	9.21	141.5	10.19	149.4	10.68	172.8	12.14	180.7	12.64	212.1	14.59	220.0	15.09
	77	110.1	8.44	125.8	9.44	141.5	10.45	149.4	10.96	172.8	12.47	180.7	12.98	212.1	14.99	220.0	15.50
	81	110.1	8.67	125.8	9.71	141.5	10.75	149.4	11.27	172.8	12.83	180.7	13.36	212.1	15.44	220.0	15.97
	86	110.1	9.00	125.8	10.09	141.5	11.18	149.4	11.72	172.8	13.35	180.7	13.90	212.1	16.08	220.0	16.62
	91	110.1	9.38	125.8	10.52	141.5	11.66	149.4	12.24	172.8	13.95	180.7	14.52	212.1	16.81	220.0	17.38
	95	110.1	9.72	125.8	10.91	141.5	12.10	149.4	12.70	172.8	14.48	180.7	15.08	212.1	17.46	220.0	18.06
	99	110.1	10.09	125.8	11.34	141.5	12.58	149.4	13.21	172.8	15.07	180.7	15.70	212.1	18.18	220.0	18.86
	104	110.1	10.63	125.8	11.95	141.5	13.28	149.4	13.94	172.8	15.92	180.7	16.59	212.1	19.63	220.0	20.59
144.0 (50%)	109	110.1	11.30	125.8	12.72	141.5	14.13	149.4	14.85	172.8	16.96	180.7	17.68	212.1	21.53	220.0	22.59
	115	110.1	12.22	125.8	13.77	141.5	15.32	149.4	16.09	172.8	18.50	180.7	19.55	212.1	24.04	220.0	25.25
	50	91.8	6.47	104.8	7.20	117.9	7.93	124.5	8.30	144.0	9.39	150.6	9.75	176.7	11.21	183.3	11.58
	59	91.8	6.64	104.8	7.39	117.9	8.14	124.5	8.52	144.0	9.65	150.6	10.03	176.7	11.53	183.3	11.91
	70	91.8	6.97	104.8	7.77	117.9	8.57	124.5	8.97	144.0	10.16	150.6	10.57	176.7	12.16	183.3	12.57
	73	91.8	7.08	104.8	7.90	117.9	8.71	124.5	9.12	144.0	10.34	150.6	10.76	176.7	12.39	183.3	12.80
	77	91.8	7.25	104.8	8.09	117.9	8.93	124.5	9.36	144.0	10.61	150.6	11.04	176.7	12.72	183.3	13.14
	81	91.8	7.45	104.8	8.32	117.9	9.18	124.5	9.62	144.0	10.92	150.6	11.36	176.7	13.09	183.3	13.53
	86	91.8	7.72	104.8	8.63	117.9	9.54	124.5	10.00	144.0	11.35	150.6	11.81	176.7	13.62	183.3	14.08
	91	91.8	8.04	104.8	8.99	117.9	9.94	124.5	10.42	144.0	11.85	150.6	12.33	176.7	14.23	183.3	14.71
	95	91.8	8.32	104.8	9.31	117.9	10.31	124.5	10.81	144.0	12.29	150.6	12.79	176.7	14.78	183.3	15.28
	99	91.8	8.64	104.8	9.67	117.9	10.71	124.5	11.23	144.0	12.78	150.6	13.31	176.7	15.38	183.3	15.90
	104	91.8	9.09	104.8	10.19	117.9	11.29	124.5	11.84	144.0	13.49	150.6	14.05	176.7	16.25	183.3	16.80
	109	91.8	9.64	104.8	10.82	117.9	12.00	124.5	12.60	144.0	14.36	150.6	14.96	176			

## 5. Heating capacity table (Outdoor unit)

- TC: Total capacity (kBtu/h)
- IP: Input power of compressor and outdoor fan motor (kW)
- The data is based on the following conditions:
  - Pipe length: 25 ft (7.5 m)
  - Height difference: 0 ft (0 m)

### 5-1. Stand-alone

#### ■ Model: AOUA72RLBV1

Heating capacity at rated condition: 81 kBtu/h (6 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
	°FDB	°FWB	61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
			TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
121.5 (150%)	-4.0	-5.3	53.3	5.04	53.1	5.08	52.8	5.14	52.6	5.16	52.5	5.19	52.3	5.23	52.0	5.29
	5.0	3.2	60.9	5.23	60.7	5.28	60.3	5.34	60.2	5.37	60.0	5.41	59.8	5.46	59.4	5.52
	10.4	8.6	65.9	5.34	65.7	5.39	65.3	5.47	65.1	5.50	65.0	5.54	64.7	5.59	64.3	5.66
	15.8	14.0	71.0	5.45	70.8	5.51	70.4	5.59	70.2	5.63	70.0	5.67	69.7	5.73	69.3	5.80
	17.0	15.0	72.0	5.47	71.7	5.53	71.3	5.61	71.1	5.65	70.9	5.69	70.6	5.75	70.2	5.83
	23.0	21.2	78.0	5.59	77.7	5.66	77.2	5.74	77.0	5.79	76.8	5.83	76.4	5.90	76.0	5.98
	26.6	24.8	81.5	5.66	81.2	5.73	80.7	5.82	80.5	5.87	80.2	5.91	79.9	5.98	79.4	6.07
	30.2	28.4	85.1	5.73	84.7	5.80	84.2	5.89	83.9	5.94	83.7	5.99	83.3	6.06	82.8	6.15
	32.0	30.2	86.9	5.76	86.5	5.84	85.9	5.93	85.7	5.98	85.4	6.03	85.0	6.10	84.5	6.20
	35.6	33.8	90.4	5.83	90.0	5.90	89.5	6.00	89.2	6.05	88.9	6.10	88.5	6.18	87.9	6.28
	41.0	39.2	95.9	5.92	95.4	6.00	94.8	6.11	94.4	6.16	94.1	6.21	93.6	6.29	93.0	6.39
	47.0	43.0	99.7	5.99	99.2	6.07	98.5	6.18	98.2	6.23	97.8	6.28	97.3	6.36	96.6	6.47
	48.2	46.0	102.7	6.04	102.2	6.12	101.5	6.23	101.1	6.28	100.7	6.34	100.2	6.42	99.8	6.48
	53.6	51.1	107.9	6.12	107.3	6.20	106.5	6.31	106.1	6.37	105.7	6.43	105.1	6.51	98.9	6.16
	59.0	56.3	113.1	6.20	112.5	6.28	111.6	6.40	111.2	6.46	110.7	6.51	108.9	6.50	98.9	5.85
113.4 (140%)	-4.0	-5.3	53.2	5.06	53.0	5.10	52.7	5.16	52.5	5.18	52.4	5.21	52.1	5.25	51.8	5.31
	5.0	3.2	60.8	5.25	60.5	5.30	60.2	5.37	60.0	5.40	59.9	5.43	59.6	5.48	59.3	5.55
	10.4	8.6	65.8	5.37	65.5	5.43	65.1	5.50	65.0	5.53	64.8	5.57	64.5	5.63	64.2	5.70
	15.8	14.0	70.8	5.49	70.6	5.55	70.2	5.63	70.0	5.67	69.8	5.71	69.5	5.76	69.1	5.84
	17.0	15.0	71.8	5.51	71.5	5.57	71.1	5.65	70.9	5.69	70.7	5.73	70.4	5.79	70.0	5.87
	23.0	21.2	77.8	5.64	77.4	5.71	77.0	5.79	76.8	5.83	76.5	5.88	76.2	5.94	75.7	6.03
	26.6	24.8	81.2	5.71	80.9	5.78	80.4	5.87	80.2	5.92	79.9	5.96	79.6	6.03	79.1	6.12
	30.2	28.4	84.8	5.79	84.4	5.86	83.9	5.95	83.6	6.00	83.4	6.04	83.0	6.12	82.5	6.21
	32.0	30.2	86.5	5.82	86.1	5.89	85.6	5.99	85.4	6.04	85.1	6.08	84.7	6.16	84.1	6.25
	35.6	33.8	90.1	5.89	89.7	5.97	89.1	6.07	88.8	6.11	88.5	6.16	88.1	6.24	87.5	6.34
	41.0	39.2	95.4	5.99	95.0	6.07	94.3	6.18	94.0	6.23	93.7	6.28	93.2	6.36	92.3	6.44
	47.0	43.0	99.2	6.06	98.7	6.14	98.0	6.25	97.7	6.30	97.3	6.36	96.8	6.44	92.3	6.20
	48.2	46.0	102.2	6.12	101.7	6.20	100.9	6.31	100.6	6.36	100.2	6.42	99.7	6.50	92.3	6.01
	53.6	51.1	107.3	6.20	106.7	6.29	105.9	6.40	105.5	6.46	105.1	6.51	101.7	6.35	92.3	5.72
	59.0	56.3	112.4	6.29	111.8	6.37	110.9	6.49	110.5	6.55	108.7	6.49	101.7	6.03	92.3	5.43
105.3 (130%)	-4.0	-5.3	53.1	5.09	52.8	5.13	52.5	5.18	52.4	5.21	52.2	5.24	52.0	5.28	51.7	5.33
	5.0	3.2	60.6	5.29	60.4	5.34	60.0	5.40	59.9	5.43	59.7	5.47	59.5	5.52	59.1	5.58
	10.4	8.6	65.6	5.41	65.3	5.47	65.0	5.54	64.8	5.57	64.6	5.61	64.3	5.66	64.0	5.74
	15.8	14.0	70.6	5.53	70.3	5.59	69.9	5.67	69.8	5.71	69.6	5.75	69.3	5.81	68.9	5.89
	17.0	15.0	71.6	5.56	71.3	5.62	70.9	5.70	70.7	5.74	70.5	5.78	70.2	5.84	69.8	5.92
	23.0	21.2	77.5	5.70	77.1	5.76	76.7	5.85	76.5	5.89	76.3	5.93	75.9	6.00	75.5	6.09
	26.6	24.8	80.9	5.77	80.6	5.84	80.1	5.93	79.9	5.98	79.6	6.02	79.3	6.09	78.8	6.18
	30.2	28.4	84.4	5.85	84.0	5.92	83.5	6.01	83.3	6.06	83.0	6.11	82.6	6.18	82.1	6.27
	32.0	30.2	86.2	5.89	85.8	5.96	85.2	6.06	85.0	6.10	84.7	6.15	84.3	6.22	83.8	6.32
	35.6	33.8	89.7	5.97	89.2	6.04	88.7	6.14	88.4	6.19	88.1	6.24	87.7	6.31	85.7	6.28
	41.0	39.2	94.9	6.07	94.5	6.15	93.8	6.25	93.5	6.31	93.2	6.36	92.7	6.44	85.7	5.94
	47.0	43.0	98.7	6.15	98.2	6.23	97.5	6.33	97.1	6.39	96.8	6.44	94.4	6.35	85.7	5.72
	48.2	46.0	101.6	6.21	101.1	6.29	100.4	6.40	100.0	6.45	99.6	6.50	94.4	6.16	85.7	5.55
	53.6	51.1	106.6	6.30	106.0	6.39	105.2	6.50	104.8	6.55	101.0	6.30	94.4	5.86	85.7	5.28
	59.0	56.3	111.6	6.39	111.0	6.48	109.6	6.55	105.3	6.26	101.0	5.98	94.4	5.56	85.7	5.02
97.2 (120%)	-4.0	-5.3	52.9	5.11	52.7	5.15	52.4	5.21	52.2	5.24	52.1	5.26	51.9	5.30	51.6	5.36
	5.0	3.2	60.4	5.32	60.2	5.37	59.9	5.44	59.7	5.47	59.5	5.50	59.3	5.55	58.9	5.62
	10.4	8.6	65.4	5.46	65.1	5.51	64.7	5.58	64.6	5.62	64.4	5.65	64.1	5.71	63.8	5.78
	15.8	14.0	70.4	5.59	70.1	5.65	69.7	5.72	69.5	5.76	69.3	5.80	69.0	5.86	68.6	5.94
	17.0	15.0	71.3	5.61	71.0	5.67	70.6	5.75	70.4	5.79	70.2	5.83	69.9	5.89	69.5	5.97
	23.0	21.2	77.1	5.76	76.8	5.82	76.4	5.91	76.2	5.95	75.9	6.00	75.6	6.06	75.1	6.15
	26.6	24.8	80.6	5.84	80.2	5.91	79.7	6.00	79.5	6.05	79.3	6.09	78.9	6.16	78.4	6.25
	30.2	28.4	84.0	5.93	83.6	6.00	83.1	6.09	82.9	6.14	82.6	6.18	82.2	6.25	79.1	6.09
	32.0	30.2	85.7	5.97	85.3	6.04	84.8	6.13	84.5	6.18	84.3	6.23	83.9	6.30	79.1	5.98
	35.6	33.8	89.2	6.05	88.8	6.12	88.2	6.22	87.9	6.27	87.6	6.32	87.1	6.39	79.1	5.77
	41.0	39.2	94.4	6.17	93.9	6.24	93.3	6.35	93.0	6.40	92.6	6.45	87.2	6.05	79.1	5.46
	47.0	43.0	98.0	6.25	97.5	6.33	96.8	6.43	96.5	6.49	93.2	6.26	87.2	5.83	79.1	5.26
	48.2	46.0	100.9	6.31	100.4	6.39	99.7	6.50	97.2	6.36	93.2	6.07	87.2	5.65	79.1	5.10
	53.6	51.1	105.8	6.41	105.2	6.50	101.2	6.32	97.2	6.04	93.2	5.77	87.2	5.37	79.1	4.85
	59.0	56.3	110.7	6.51	109.2	6.52	101.2	6.00	97.2	5.74	93.2	5.48	87.2	5.10	79.1	4.61



Heating capacity at rated condition: 81 kBTu/h (6 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
89.1 (110%)	-4.0	-5.3	52.7	5.15	52.5	5.19	52.2	5.24	52.1	5.27	51.9	5.29	51.7	5.33	51.4	5.39
	5.0	3.2	60.2	5.37	60.0	5.42	59.6	5.48	59.5	5.51	59.3	5.55	59.1	5.60	58.7	5.66
	10.4	8.6	65.1	5.51	64.8	5.56	64.5	5.63	64.3	5.67	64.1	5.71	63.9	5.76	63.5	5.83
	15.8	14.0	70.1	5.65	69.8	5.71	69.4	5.79	69.2	5.82	69.0	5.86	68.7	5.92	68.3	6.00
	17.0	15.0	71.0	5.68	70.7	5.73	70.3	5.81	70.1	5.85	69.9	5.89	69.6	5.95	69.2	6.03
	23.0	21.2	76.8	5.83	76.4	5.90	76.0	5.98	75.8	6.03	75.5	6.07	75.2	6.14	72.5	5.99
	26.6	24.8	80.1	5.92	79.8	5.99	79.3	6.08	79.1	6.13	78.8	6.17	78.5	6.24	72.5	5.77
	30.2	28.4	83.5	6.01	83.2	6.08	82.6	6.18	82.4	6.22	82.1	6.27	79.9	6.15	72.5	5.56
	32.0	30.2	85.2	6.06	84.8	6.13	84.3	6.22	84.0	6.27	83.8	6.32	79.9	6.04	72.5	5.46
	35.6	33.8	88.6	6.15	88.2	6.22	87.6	6.32	87.4	6.37	85.4	6.25	79.9	5.82	72.5	5.26
	41.0	39.2	93.7	6.28	93.2	6.35	92.6	6.45	89.1	6.20	85.4	5.92	79.9	5.52	72.5	4.99
	47.0	43.0	97.3	6.36	96.8	6.44	92.8	6.23	89.1	5.96	85.4	5.70	79.9	5.31	72.5	4.80
	48.2	46.0	100.1	6.43	99.6	6.51	92.8	6.05	89.1	5.79	85.4	5.53	79.9	5.16	72.5	4.66
	53.6	51.1	104.9	6.55	100.1	6.24	92.8	5.75	89.1	5.50	85.4	5.26	79.9	4.90	72.5	4.44
	59.0	56.3	105.7	6.29	100.1	5.93	92.8	5.46	89.1	5.23	85.4	5.00	79.9	4.66	72.5	4.21
81.0 (100%)	-4.0	-5.3	52.5	5.18	52.3	5.22	52.0	5.28	51.9	5.31	51.7	5.33	51.5	5.37	51.2	5.43
	5.0	3.2	59.9	5.42	59.7	5.47	59.4	5.53	59.2	5.57	59.0	5.60	58.8	5.65	58.5	5.71
	10.4	8.6	64.8	5.57	64.5	5.63	64.2	5.70	64.0	5.73	63.8	5.77	63.5	5.82	63.2	5.90
	15.8	14.0	69.7	5.72	69.4	5.78	69.0	5.86	68.8	5.90	68.6	5.94	68.3	6.00	65.9	5.85
	17.0	15.0	70.6	5.75	70.3	5.81	69.9	5.89	69.7	5.93	69.5	5.97	69.2	6.03	65.9	5.79
	23.0	21.2	76.3	5.92	76.0	5.99	75.5	6.07	75.3	6.12	75.1	6.16	72.6	6.00	65.9	5.42
	26.6	24.8	79.6	6.02	79.3	6.09	78.8	6.18	78.6	6.22	77.7	6.20	72.6	5.78	65.9	5.23
	30.2	28.4	83.0	6.12	82.6	6.19	82.1	6.28	81.0	6.24	77.7	5.97	72.6	5.57	65.9	5.04
	32.0	30.2	84.6	6.17	84.2	6.24	83.7	6.33	81.0	6.13	77.7	5.86	72.6	5.47	65.9	4.95
	35.6	33.8	88.0	6.26	87.5	6.34	84.3	6.17	81.0	5.91	77.7	5.65	72.6	5.27	65.9	4.77
	41.0	39.2	92.9	6.40	91.0	6.34	84.3	5.84	81.0	5.60	77.7	5.36	72.6	4.99	65.9	4.52
	47.0	43.0	96.1	6.47	91.0	6.10	84.3	5.63	81.0	5.39	77.7	5.16	72.6	4.81	65.9	4.36
	48.2	46.0	96.1	6.28	91.0	5.92	84.3	5.46	81.0	5.23	77.7	5.01	72.6	4.67	65.9	4.23
	53.6	51.1	96.1	5.97	91.0	5.63	84.3	5.19	81.0	4.97	77.7	4.76	72.6	4.44	65.9	4.02
	59.0	56.3	96.1	5.67	91.0	5.35	84.3	4.93	81.0	4.73	77.7	4.52	72.6	4.22	65.9	3.82
72.9 (90%)	-4.0	-5.3	52.3	5.23	52.0	5.27	51.7	5.32	51.6	5.35	51.4	5.38	51.2	5.42	50.9	5.47
	5.0	3.2	59.6	5.49	59.4	5.53	59.0	5.60	58.9	5.63	58.7	5.66	58.5	5.71	58.1	5.78
	10.4	8.6	64.4	5.65	64.1	5.70	63.8	5.77	63.6	5.81	63.4	5.85	63.2	5.90	59.3	5.57
	15.8	14.0	69.2	5.81	69.0	5.87	68.6	5.95	68.4	5.99	68.2	6.03	65.4	5.80	59.3	5.25
	17.0	15.0	70.2	5.84	69.9	5.90	69.5	5.98	69.3	6.02	69.1	6.06	65.4	5.74	59.3	5.20
	23.0	21.2	75.8	6.03	75.4	6.09	75.0	6.18	72.9	6.02	69.9	5.76	65.4	5.38	59.3	4.87
	26.6	24.8	79.0	6.14	78.7	6.20	75.9	6.05	72.9	5.80	69.9	5.55	65.4	5.18	59.3	4.69
	30.2	28.4	82.3	6.25	81.9	6.31	75.9	5.83	72.9	5.59	69.9	5.35	65.4	4.99	59.3	4.53
	32.0	30.2	83.9	6.30	81.9	6.20	75.9	5.72	72.9	5.49	69.9	5.25	65.4	4.90	59.3	4.45
	35.6	33.8	86.5	6.33	81.9	5.98	75.9	5.52	72.9	5.29	69.9	5.07	65.4	4.73	59.3	4.29
	41.0	39.2	86.5	6.00	81.9	5.67	75.9	5.23	72.9	5.01	69.9	4.80	65.4	4.48	59.3	4.07
	47.0	43.0	86.5	5.78	81.9	5.45	75.9	5.04	72.9	4.83	69.9	4.62	65.4	4.32	59.3	3.92
	48.2	46.0	86.5	5.61	81.9	5.29	75.9	4.89	72.9	4.69	69.9	4.49	65.4	4.19	59.3	3.81
	53.6	51.1	86.5	5.33	81.9	5.03	75.9	4.65	72.9	4.46	69.9	4.27	65.4	3.99	59.3	3.62
	59.0	56.3	86.5	5.06	81.9	4.78	75.9	4.42	72.9	4.24	69.9	4.06	65.4	3.79	59.3	3.44
64.8 (80%)	-4.0	-5.3	51.9	5.29	51.7	5.33	51.4	5.38	51.3	5.41	51.1	5.44	50.9	5.48	50.6	5.53
	5.0	3.2	59.2	5.56	59.0	5.61	58.6	5.68	58.5	5.71	58.3	5.74	58.1	5.79	52.8	5.25
	10.4	8.6	63.9	5.74	63.7	5.80	63.3	5.87	63.1	5.90	62.1	5.84	58.1	5.45	52.8	4.94
	15.8	14.0	68.7	5.92	68.4	5.98	67.5	6.00	64.8	5.75	62.1	5.51	58.1	5.14	52.8	4.66
	17.0	15.0	69.6	5.96	69.3	6.02	67.5	5.93	64.8	5.69	62.1	5.45	58.1	5.09	52.8	4.61
	23.0	21.2	75.1	6.16	72.8	6.01	67.5	5.55	64.8	5.33	62.1	5.10	58.1	4.77	52.8	4.33
	26.6	24.8	76.9	6.13	72.8	5.79	67.5	5.35	64.8	5.13	62.1	4.92	58.1	4.60	52.8	4.17
	30.2	28.4	76.9	5.91	72.8	5.58	67.5	5.16	64.8	4.95	62.1	4.74	58.1	4.43	52.8	4.02
	32.0	30.2	76.9	5.80	72.8	5.48	67.5	5.07	64.8	4.86	62.1	4.66	58.1	4.35	52.8	3.95
	35.6	33.8	76.9	5.59	72.8	5.29	67.5	4.89	64.8	4.69	62.1	4.49	58.1	4.20	52.8	3.81
	41.0	39.2	76.9	5.30	72.8	5.01	67.5	4.63	64.8	4.44	62.1	4.26	58.1	3.98	52.8	3.62
	47.0	43.0	76.9	5.10	72.8	4.82	67.5	4.46	64.8	4.28	62.1	4.10	58.1	3.84	52.8	3.49
	48.2	46.0	76.9	4.95	72.8	4.68	67.5	4.33	64.8	4.16	62.1	3.98	58.1	3.73	52.8	3.39
	53.6	51.1	76.9	4.71	72.8	4.45	67.5	4.12	64.8	3.95	62.1	3.79	58.1	3.55	52.8	3.23
	59.0	56.3	76.9	4.47	72.8	4.23	67.5	3.91	64.8	3.76	62.1	3.60	58.1	3.37	52.8	3.07
56.7 (70%)	-4.0	-5.3	51.5	5.36	51.3	5.40	51.0	5.46	50.9	5.48	50.7	5.51	50.5	5.55	46.2	5.08
	5.0	3.2	58.7	5.67	58.5	5.71	58.1	5.78	56.7	5.65	54.4	5.41	50.8	5.06	46.2	4.60
	10.4	8.6	63.3	5.86	63.1	5.92	59.0	5.54	56.7	5.32	54.4	5.10	50.8	4.76	46.2	4.33
	15.8	14.0	67.2	5.97	63.7	5.65	59.0	5.23	56.7	5.02	54.4	4.81	50.8	4.50	46.2	4.09
	17.0	15.0	67.2	5.91	63.7	5.59	59.0	5.17	56.7	4.96	54.4	4.76	50.8	4.45	46.2	4.04
	23.0	21.2	67.2	5.54	63.7	5.24	59.0	4.85	56.7	4.65	54.4	4.46	50.8	4.17	46.2	3.79
	26.6	24.8	67.2	5.33	63.7	5.05	59.0	4.67	56.7	4.48	54.4	4.30	50.8	4.02	46.2	3.66
	30.2	28.4	67.2	5.14	63.7	4.86	59.0	4.50	56.7	4.32	54.4	4.15	50.8	3.88	46.2	3.53
	32.0	30.2	67.2	5.05	63.7	4.78	59.0	4.42	56.7	4.25	54.4	4.07	50.8	3.81	46.2	3.47
	35.6	33.8	67.2	4.87	63.7	4.61	59.0	4.27	56.7	4.10	54.4	3.93	50.8	3.68	46.2	3.35
	41.0	39.2	67.2	4.61	63.7	4.37	59.0	4.05	56.7	3.89	54.4	3.73	50.8	3.49	46.2	3.18
	47.0	43.0	67.2	4.44	63.7	4.21	59.0	3.90	56.7	3.74	54.4	3.59	50.8	3.36	46.2	3.07
	48.2	46.0	67.2	4.31	63.7	4.09	59.0	3.79	56.7	3.64	54.4	3.49	50.8	3.27	46.2	2.98
	53.6	51.1	67.2	4.10												

Heating capacity at rated condition: 81 kBtu/h (6 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
48.6 (60%)	-4.0	-5.3	51.0	5.46	50.8	5.50	50.5	5.55	48.6	5.35	46.6	5.12	43.6	4.79	39.6	4.36
	5.0	3.2	57.6	5.75	54.6	5.44	50.6	5.04	48.6	4.84	46.6	4.64	43.6	4.34	39.6	3.95
	10.4	8.6	57.6	5.41	54.6	5.12	50.6	4.74	48.6	4.56	46.6	4.37	43.6	4.09	39.6	3.72
	15.8	14.0	57.6	5.10	54.6	4.83	50.6	4.48	48.6	4.30	46.6	4.12	43.6	3.86	39.6	3.52
	17.0	15.0	57.6	5.05	54.6	4.78	50.6	4.43	48.6	4.25	46.6	4.08	43.6	3.82	39.6	3.48
	23.0	21.2	57.6	4.73	54.6	4.48	50.6	4.15	48.6	3.99	46.6	3.83	43.6	3.59	39.6	3.27
	26.6	24.8	57.6	4.56	54.6	4.32	50.6	4.00	48.6	3.85	46.6	3.69	43.6	3.46	39.6	3.16
	30.2	28.4	57.6	4.40	54.6	4.17	50.6	3.86	48.6	3.71	46.6	3.56	43.6	3.34	39.6	3.05
	32.0	30.2	57.6	4.32	54.6	4.09	50.6	3.79	48.6	3.65	46.6	3.50	43.6	3.28	39.6	3.00
	35.6	33.8	57.6	4.16	54.6	3.95	50.6	3.66	48.6	3.52	46.6	3.38	43.6	3.17	39.6	2.89
	41.0	39.2	57.6	3.95	54.6	3.74	50.6	3.47	48.6	3.34	46.6	3.21	43.6	3.01	39.6	2.75
	47.0	43.0	57.6	3.81	54.6	3.61	50.6	3.35	48.6	3.22	46.6	3.09	43.6	2.90	39.6	2.65
	48.2	46.0	57.6	3.70	54.6	3.51	50.6	3.25	48.6	3.13	46.6	3.01	43.6	2.82	39.6	2.58
	53.6	51.1	57.6	3.52	54.6	3.34	50.6	3.10	48.6	2.98	46.6	2.86	43.6	2.69	39.6	2.46
	59.0	56.3	57.6	3.35	54.6	3.17	50.6	2.95	48.6	2.84	46.6	2.73	43.6	2.56	39.6	2.34
40.5 (50%)	-4.0	-5.3	48.0	5.28	45.5	5.01	42.2	4.64	40.5	4.46	38.8	4.28	36.3	4.01	33.0	3.65
	5.0	3.2	48.0	4.78	45.5	4.53	42.2	4.20	40.5	4.04	38.8	3.88	36.3	3.64	33.0	3.32
	10.4	8.6	48.0	4.50	45.5	4.27	42.2	3.96	40.5	3.81	38.8	3.66	36.3	3.43	33.0	3.13
	15.8	14.0	48.0	4.25	45.5	4.03	42.2	3.74	40.5	3.60	38.8	3.46	36.3	3.24	33.0	2.96
	17.0	15.0	48.0	4.20	45.5	3.99	42.2	3.70	40.5	3.56	38.8	3.42	36.3	3.21	33.0	2.93
	23.0	21.2	48.0	3.94	45.5	3.74	42.2	3.48	40.5	3.34	38.8	3.21	36.3	3.02	33.0	2.76
	26.6	24.8	48.0	3.80	45.5	3.61	42.2	3.35	40.5	3.23	38.8	3.10	36.3	2.91	33.0	2.66
	30.2	28.4	48.0	3.67	45.5	3.48	42.2	3.24	40.5	3.12	38.8	2.99	36.3	2.81	33.0	2.57
	32.0	30.2	48.0	3.61	45.5	3.42	42.2	3.18	40.5	3.06	38.8	2.94	36.3	2.76	33.0	2.53
	35.6	33.8	48.0	3.48	45.5	3.30	42.2	3.07	40.5	2.96	38.8	2.84	36.3	2.67	33.0	2.45
	41.0	39.2	48.0	3.30	45.5	3.14	42.2	2.92	40.5	2.81	38.8	2.70	36.3	2.54	33.0	2.33
	47.0	43.0	48.0	3.18	45.5	3.03	42.2	2.81	40.5	2.71	38.8	2.61	36.3	2.45	33.0	2.25
	48.2	46.0	48.0	3.09	45.5	2.94	42.2	2.74	40.5	2.64	38.8	2.53	36.3	2.38	33.0	2.19
	53.6	51.1	48.0	2.95	45.5	2.80	42.2	2.61	40.5	2.51	38.8	2.42	36.3	2.27	33.0	2.09
	59.0	56.3	48.0	2.81	45.5	2.67	42.2	2.48	40.5	2.39	38.8	2.30	36.3	2.17	33.0	1.99

MODEL  
SELECTIONMODEL  
SELECTION

# Model: AOUA96RLBV1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 108 kBtu/h (8 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
162.0 (150%)	-4.0	-5.3	66.1	7.21	65.8	7.28	65.4	7.36	65.2	7.40	65.0	7.45	64.7	7.51	64.3	7.60
	5.0	3.2	76.9	7.49	76.6	7.56	76.2	7.67	75.9	7.72	75.7	7.77	75.4	7.85	75.0	7.95
	10.4	8.6	84.0	7.66	83.7	7.74	83.2	7.86	83.0	7.91	82.8	7.97	82.4	8.06	81.9	8.17
	15.8	14.0	91.3	7.83	90.9	7.92	90.4	8.04	90.1	8.10	89.9	8.17	89.5	8.26	89.0	8.38
	17.0	15.0	92.7	7.86	92.3	7.95	91.8	8.08	91.5	8.14	91.2	8.20	90.8	8.30	90.3	8.42
	23.0	21.2	101.1	8.05	100.7	8.15	100.1	8.28	99.8	8.35	99.5	8.42	99.1	8.52	98.5	8.66
	26.6	24.8	106.1	8.16	105.7	8.26	105.0	8.40	104.7	8.47	104.4	8.54	103.9	8.65	103.3	8.79
	30.2	28.4	111.2	8.26	110.7	8.37	110.0	8.52	109.6	8.59	109.3	8.66	108.8	8.77	108.1	8.92
	32.0	30.2	113.7	8.31	113.2	8.42	112.5	8.57	112.1	8.65	111.8	8.72	111.2	8.83	110.5	8.98
	35.6	33.8	118.7	8.42	118.2	8.53	117.4	8.68	117.1	8.76	116.7	8.84	116.1	8.95	115.3	9.11
	41.0	39.2	126.4	8.57	125.7	8.69	124.9	8.85	124.5	8.93	124.1	9.01	123.4	9.13	122.6	9.29
	47.0	43.0	131.7	8.67	131.1	8.79	130.2	8.96	129.7	9.04	129.3	9.12	128.6	9.25	127.7	9.41
	48.2	46.0	136.0	8.75	135.3	8.87	134.4	9.04	133.9	9.12	133.4	9.21	132.7	9.34	131.7	9.51
	53.6	51.1	143.2	8.87	142.5	9.00	141.4	9.18	140.9	9.26	140.4	9.35	139.6	9.48	139.1	9.01
	59.0	56.3	150.6	9.00	149.8	9.13	148.6	9.31	148.0	9.40	147.4	9.49	145.3	9.50	131.9	8.52
151.2 (140%)	-4.0	-5.3	66.0	7.24	65.7	7.31	65.3	7.39	65.1	7.43	64.9	7.48	64.6	7.54	64.1	7.63
	5.0	3.2	76.7	7.53	76.4	7.61	76.0	7.71	75.8	7.76	75.6	7.81	75.2	7.89	74.8	7.99
	10.4	8.6	83.8	7.71	83.5	7.79	83.0	7.91	82.8	7.96	82.5	8.02	82.2	8.11	81.7	8.22
	15.8	14.0	91.0	7.89	90.7	7.98	90.2	8.10	89.9	8.16	89.6	8.22	89.2	8.32	88.7	8.44
	17.0	15.0	92.4	7.92	92.0	8.01	91.5	8.14	91.2	8.20	91.0	8.26	90.6	8.36	90.0	8.48
	23.0	21.2	100.8	8.12	100.4	8.22	99.8	8.36	99.5	8.42	99.2	8.49	98.8	8.59	98.2	8.73
	26.6	24.8	105.8	8.23	105.3	8.34	104.7	8.48	104.4	8.55	104.1	8.62	103.6	8.73	102.9	8.87
	30.2	28.4	110.8	8.35	110.3	8.46	109.6	8.60	109.2	8.67	108.9	8.75	108.4	8.86	107.7	9.01
	32.0	30.2	113.3	8.40	112.7	8.51	112.0	8.66	111.7	8.74	111.3	8.81	110.8	8.92	110.1	9.07
	35.6	33.8	118.3	8.51	117.7	8.63	117.0	8.78	116.6	8.86	116.2	8.93	115.6	9.05	114.9	9.20
	41.0	39.2	125.8	8.67	125.2	8.79	124.4	8.95	123.9	9.03	123.5	9.11	122.9	9.23	122.0	9.40
	47.0	43.0	131.1	8.78	130.5	8.91	129.6	9.07	129.1	9.15	128.7	9.24	128.0	9.36	123.1	9.12
	48.2	46.0	135.3	8.87	134.6	8.99	133.7	9.16	133.2	9.24	132.7	9.33	132.0	9.46	123.1	8.82
	53.6	51.1	142.5	9.01	141.7	9.14	140.6	9.31	140.1	9.40	139.6	9.48	135.6	9.30	123.1	8.35
	59.0	56.3	149.7	9.14	148.8	9.27	147.7	9.45	147.1	9.54	145.0	9.48	135.6	8.79	123.1	7.89
140.4 (130%)	-4.0	-5.3	65.8	7.28	65.5	7.34	65.1	7.43	64.9	7.47	64.7	7.51	64.4	7.58	64.0	7.66
	5.0	3.2	76.5	7.58	76.2	7.65	75.8	7.76	75.6	7.81	75.3	7.86	75.0	7.94	74.6	8.04
	10.4	8.6	83.6	7.77	83.2	7.85	82.8	7.96	82.5	8.02	82.3	8.08	81.9	8.16	81.5	8.28
	15.8	14.0	90.8	7.96	90.4	8.05	89.9	8.17	89.6	8.23	89.4	8.29	89.0	8.39	88.4	8.51
	17.0	15.0	92.1	7.99	91.7	8.08	91.2	8.21	90.9	8.27	90.7	8.33	90.3	8.43	89.8	8.55
	23.0	21.2	100.5	8.20	100.0	8.30	99.5	8.44	99.2	8.51	98.9	8.57	98.4	8.68	97.8	8.81
	26.6	24.8	105.4	8.32	104.9	8.43	104.3	8.57	104.0	8.64	103.6	8.71	103.2	8.82	102.5	8.96
	30.2	28.4	110.3	8.45	109.8	8.55	109.1	8.70	108.8	8.77	108.4	8.85	107.9	8.96	107.2	9.10
	32.0	30.2	112.8	8.51	112.3	8.62	111.6	8.76	111.2	8.84	110.9	8.91	110.3	9.02	109.6	9.17
	35.6	33.8	117.7	8.62	117.2	8.74	116.4	8.89	116.0	8.97	115.7	9.04	115.1	9.16	114.3	9.31
	41.0	39.2	125.2	8.80	124.5	8.92	123.7	9.08	123.3	9.16	122.9	9.24	122.2	9.36	114.3	8.76
	47.0	43.0	130.4	8.91	129.7	9.04	128.8	9.20	128.4	9.28	127.9	9.37	125.9	9.35	114.3	8.40
	48.2	46.0	134.6	9.01	133.8	9.13	132.9	9.30	132.4	9.38	131.9	9.47	125.9	9.05	114.3	8.13
	53.6	51.1	141.5	9.16	140.8	9.29	139.7	9.46	139.2	9.54	138.6	9.22	125.9	8.56	114.3	7.69
	59.0	56.3	148.7	9.30	147.8	9.44	146.2	9.57	140.4	9.14	134.6	8.72	125.9	8.09	114.3	7.27
129.6 (120%)	-4.0	-5.3	65.6	7.32	65.3	7.38	64.9	7.47	64.7	7.51	64.5	7.55	64.2	7.62	63.8	7.70
	5.0	3.2	76.3	7.63	76.0	7.71	75.5	7.81	75.3	7.86	75.1	7.91	74.8	7.99	74.3	8.10
	10.4	8.6	83.3	7.83	83.0	7.92	82.5	8.03	82.3	8.09	82.0	8.14	81.7	8.23	81.2	8.34
	15.8	14.0	90.4	8.03	90.0	8.13	89.5	8.25	89.3	8.31	89.0	8.37	88.6	8.46	88.1	8.59
	17.0	15.0	91.8	8.07	91.4	8.16	90.9	8.29	90.6	8.35	90.3	8.41	89.9	8.51	89.4	8.63
	23.0	21.2	100.1	8.30	99.6	8.40	99.0	8.53	98.7	8.60	98.4	8.67	98.0	8.77	97.4	8.91
	26.6	24.8	104.9	8.43	104.4	8.53	103.8	8.67	103.5	8.74	103.2	8.82	102.7	8.92	102.1	9.06
	30.2	28.4	109.8	8.56	109.3	8.67	108.6	8.81	108.3	8.89	107.9	8.96	107.4	9.07	105.5	9.08
	32.0	30.2	112.2	8.62	111.7	8.73	111.0	8.88	110.6	8.96	110.3	9.03	109.8	9.14	105.5	8.89
	35.6	33.8	117.1	8.75	116.5	8.87	115.8	9.02	115.4	9.09	115.0	9.17	114.5	9.29	105.5	8.53
	41.0	39.2	124.4	8.94	123.8	9.06	123.0	9.22	122.5	9.30	122.1	9.38	116.2	8.93	105.5	8.03
	47.0	43.0	129.6	9.07	128.9	9.19	128.0	9.35	127.6	9.43	124.3	9.22	116.2	8.56	105.5	7.70
	48.2	46.0	133.6	9.17	132.9	9.29	132.0	9.46	129.6	9.34	124.3	8.92	116.2	8.28	105.5	7.45
	53.6	51.1	140.5	9.33	139.7	9.46	135.0	9.25	129.6	8.84	124.3	8.43	116.2	7.83	105.5	7.05
	59.0	56.3	147.4	9.49	145.7	9.53	135.0	8.74	129.6	8.35	124.3	7.97	116.2	7.40	105.5	6.67
118.8 (110%)	-4.0	-5.3	65.4	7.36	65.1	7.43	64.7	7.51	64.5	7.56	64.3	7.60	64.0	7.66	63.6	7.75
	5.0	3.2	76.0	7.70	75.7	7.78	75.3	7.88	75.1	7.93	74.8	7.98	74.5	8.06	74.1	8.16
	10.4	8.6	83.0	7.91	82.6	8.00	82.2	8.11	81.9	8.17	81.7	8.22	81.3	8.31	80.9	8.42
	15.8	14.0	90.0	8.13	89.7	8.22	89.1	8.34	88.9	8.40	88.6	8.46	88.2	8.56	87.7	8.68
	17.0	15.0	91.4	8.17	91.0	8.26	90.5	8.38	90.2	8.45	89.9	8.51	89.5	8.60	89.0	8.73
	23.0	21.2	99.6	8.41	99.1	8.51	98.5	8.65	98.2	8.71	98.0	8.78	97.5	8.88	96.7	9.00
	26.6	24.8	104.4	8.55	103.9	8.66	103.3	8.80	102.9	8.87	102.6	8.94	102.1	9.04	96.7	8.62
	30.2	28.4	109.2	8.69	108.7	8.80	108.0	8.95	107.6	9.02	107.3	9.09	106.5	9.17	96.7	8.26
	32.0	30.2	111.6	8.76	111.0	8.87	110.3	9.02	110.0	9.10	109.6	9.17	106.5	8.99	96.7	8.10
	35.6	33.8	116.4	8.90	115.8	9.02	115.0	9.17	114.7	9.24	113.9	9.28	106.5	8.62	96.7	7.77
	41.0	39.2	123.6	9.10	122.9	9.22	122.1	9.38	118.8	9.15	113.9					

Heating capacity at rated condition: 108 kBtu/h (8 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
108.0 (100%)	-4.0	-5.3	65.1	7.42	64.8	7.48	64.4	7.57	64.2	7.61	64.0	7.65	63.7	7.72	63.3	7.81
	5.0	3.2	75.7	7.78	75.4	7.85	74.9	7.96	74.7	8.01	74.5	8.06	74.2	8.14	73.7	8.24
	10.4	8.6	82.6	8.01	82.2	8.09	81.8	8.20	81.5	8.26	81.3	8.32	81.0	8.40	80.5	8.52
	15.8	14.0	89.6	8.24	89.2	8.33	88.7	8.45	88.4	8.51	88.2	8.58	87.8	8.67	87.3	8.79
	17.0	15.0	90.9	8.28	90.5	8.37	90.0	8.50	89.7	8.56	89.5	8.62	89.1	8.72	87.9	8.77
	23.0	21.2	99.0	8.55	98.5	8.65	98.0	8.78	97.7	8.85	97.4	8.92	96.9	9.01	87.9	8.12
	26.6	24.8	103.7	8.70	103.2	8.81	102.6	8.94	102.3	9.01	102.0	9.08	96.9	8.63	87.9	7.79
	30.2	28.4	108.4	8.85	107.9	8.96	107.2	9.11	106.9	9.18	103.6	8.90	96.9	8.28	87.9	7.47
	32.0	30.2	110.8	8.93	110.2	9.04	109.5	9.19	108.0	9.12	103.6	8.71	96.9	8.11	87.9	7.31
	35.6	33.8	115.5	9.08	114.9	9.19	112.5	9.15	108.0	8.75	103.6	8.36	96.9	7.78	87.9	7.02
	41.0	39.2	122.5	9.30	121.4	9.37	112.5	8.61	108.0	8.24	103.6	7.87	96.9	7.32	87.9	6.61
	47.0	43.0	127.4	9.46	121.4	8.98	112.5	8.26	108.0	7.90	103.6	7.55	96.9	7.02	87.9	6.34
	48.2	46.0	128.1	9.22	121.4	8.69	112.5	7.99	108.0	7.64	103.6	7.30	96.9	6.80	87.9	6.14
	53.6	51.1	128.1	8.72	121.4	8.22	112.5	7.56	108.0	7.23	103.6	6.91	96.9	6.43	87.9	5.81
	59.0	56.3	128.1	8.24	121.4	7.77	112.5	7.14	108.0	6.84	103.6	6.53	96.9	6.08	87.9	5.49
97.2 (90%)	-4.0	-5.3	64.8	7.49	64.5	7.55	64.1	7.64	63.9	7.68	63.7	7.72	63.4	7.79	63.0	7.87
	5.0	3.2	75.3	7.87	75.0	7.95	74.5	8.05	74.3	8.10	74.1	8.15	73.8	8.23	73.3	8.34
	10.4	8.6	82.1	8.12	81.8	8.21	81.3	8.32	81.1	8.38	80.8	8.43	80.5	8.52	79.1	8.51
	15.8	14.0	89.0	8.37	88.6	8.47	88.1	8.59	87.9	8.65	87.6	8.71	87.2	8.80	79.1	7.94
	17.0	15.0	90.3	8.42	89.9	8.51	89.4	8.64	89.1	8.70	88.9	8.76	87.2	8.69	79.1	7.84
	23.0	21.2	98.3	8.71	97.8	8.81	97.2	8.94	96.9	9.01	93.2	8.65	87.2	8.05	79.1	7.27
	26.6	24.8	102.9	8.88	102.4	8.98	101.2	9.05	97.2	8.67	93.2	8.28	87.2	7.71	79.1	6.97
	30.2	28.4	107.5	9.05	107.0	9.15	101.2	8.68	97.2	8.31	93.2	7.94	87.2	7.40	79.1	6.68
	32.0	30.2	109.8	9.13	109.3	9.24	101.2	8.50	97.2	8.14	93.2	7.78	87.2	7.25	79.1	6.55
	35.6	33.8	114.4	9.30	109.3	8.86	101.2	8.16	97.2	7.81	93.2	7.47	87.2	6.96	79.1	6.29
	41.0	39.2	115.3	8.85	109.3	8.34	101.2	7.68	97.2	7.35	93.2	7.03	87.2	6.55	79.1	5.92
	47.0	43.0	115.3	8.48	109.3	8.00	101.2	7.36	97.2	7.05	93.2	6.74	87.2	6.28	79.1	5.68
	48.2	46.0	115.3	8.21	109.3	7.74	101.2	7.13	97.2	6.82	93.2	6.53	87.2	6.08	79.1	5.50
	53.6	51.1	115.3	7.76	109.3	7.32	101.2	6.74	97.2	6.46	93.2	6.18	87.2	5.75	79.1	5.21
	59.0	56.3	115.3	7.34	109.3	6.92	101.2	6.37	97.2	6.11	93.2	5.84	87.2	5.44	79.1	4.92
86.4 (80%)	-4.0	-5.3	64.4	7.57	64.1	7.64	63.7	7.72	63.5	7.76	63.3	7.81	63.0	7.87	62.6	7.96
	5.0	3.2	74.8	7.99	74.5	8.07	74.0	8.17	73.8	8.22	73.6	8.27	73.3	8.35	70.4	8.09
	10.4	8.6	81.5	8.26	81.2	8.35	80.7	8.46	80.5	8.52	80.2	8.57	77.5	8.33	70.4	7.52
	15.8	14.0	88.3	8.54	87.9	8.63	87.4	8.75	86.4	8.72	82.9	8.33	77.5	7.77	70.4	7.02
	17.0	15.0	89.6	8.59	89.2	8.69	88.7	8.81	86.4	8.61	82.9	8.23	77.5	7.67	70.4	6.93
	23.0	21.2	97.4	8.91	96.9	9.01	90.0	8.33	86.4	7.98	82.9	7.63	77.5	7.11	70.4	6.43
	26.6	24.8	101.9	9.10	97.1	8.66	90.0	7.98	86.4	7.64	82.9	7.31	77.5	6.82	70.4	6.17
	30.2	28.4	102.5	8.80	97.1	8.30	90.0	7.65	86.4	7.33	82.9	7.01	77.5	6.54	70.4	5.92
	32.0	30.2	102.5	8.62	97.1	8.13	90.0	7.49	86.4	7.18	82.9	6.87	77.5	6.40	70.4	5.80
	35.6	33.8	102.5	8.27	97.1	7.80	90.0	7.19	86.4	6.89	82.9	6.59	77.5	6.15	70.4	5.57
	41.0	39.2	102.5	7.78	97.1	7.35	90.0	6.77	86.4	6.49	82.9	6.21	77.5	5.79	70.4	5.25
	47.0	43.0	102.5	7.46	97.1	7.05	90.0	6.50	86.4	6.23	82.9	5.96	77.5	5.56	70.4	5.03
	48.2	46.0	102.5	7.22	97.1	6.82	90.0	6.29	86.4	6.03	82.9	5.77	77.5	5.38	70.4	4.87
	53.6	51.1	102.5	6.83	97.1	6.45	90.0	5.95	86.4	5.70	82.9	5.46	77.5	5.09	70.4	4.62
	59.0	56.3	102.5	6.46	97.1	6.10	90.0	5.63	86.4	5.39	82.9	5.16	77.5	4.82	70.4	4.37
75.6 (70%)	-4.0	-5.3	63.9	7.68	63.6	7.75	63.2	7.83	63.0	7.87	62.8	7.92	62.5	7.98	61.6	7.98
	5.0	3.2	74.2	8.14	73.8	8.22	73.4	8.32	73.2	8.37	72.5	8.35	67.8	7.79	61.6	7.05
	10.4	8.6	80.8	8.45	80.4	8.53	78.7	8.47	75.6	8.11	72.5	7.76	67.8	7.24	61.6	6.56
	15.8	14.0	87.4	8.75	85.0	8.56	78.7	7.90	75.6	7.57	72.5	7.24	67.8	6.76	61.6	6.12
	17.0	15.0	88.7	8.81	85.0	8.45	78.7	7.80	75.6	7.47	72.5	7.15	67.8	6.67	61.6	6.05
	23.0	21.2	89.7	8.30	85.0	7.84	78.7	7.23	75.6	6.93	72.5	6.64	67.8	6.19	61.6	5.61
	26.6	24.8	89.7	7.95	85.0	7.51	78.7	6.93	75.6	6.64	72.5	6.36	67.8	5.94	61.6	5.38
	30.2	28.4	89.7	7.62	85.0	7.20	78.7	6.65	75.6	6.37	72.5	6.10	67.8	5.70	61.6	5.17
	32.0	30.2	89.7	7.47	85.0	7.05	78.7	6.51	75.6	6.24	72.5	5.98	67.8	5.58	61.6	5.06
	35.6	33.8	89.7	7.17	85.0	6.77	78.7	6.25	75.6	6.00	72.5	5.74	67.8	5.36	61.6	4.86
	41.0	39.2	89.7	6.75	85.0	6.38	78.7	5.89	75.6	5.65	72.5	5.41	67.8	5.05	61.6	4.59
	47.0	43.0	89.7	6.47	85.0	6.12	78.7	5.65	75.6	5.42	72.5	5.19	67.8	4.85	61.6	4.40
	48.2	46.0	89.7	6.26	85.0	5.92	78.7	5.47	75.6	5.25	72.5	5.03	67.8	4.70	61.6	4.26
	53.6	51.1	89.7	5.93	85.0	5.60	78.7	5.18	75.6	4.97	72.5	4.76	67.8	4.45	61.6	4.04
	59.0	56.3	89.7	5.61	85.0	5.30	78.7	4.90	75.6	4.70	72.5	4.50	67.8	4.21	61.6	3.82
64.8 (60%)	-4.0	-5.3	63.2	7.82	62.9	7.89	62.6	7.97	62.4	8.02	62.1	8.05	58.1	7.52	52.8	6.81
	5.0	3.2	73.3	8.34	72.8	8.40	67.5	7.75	64.8	7.43	62.1	7.12	58.1	6.64	52.8	6.02
	10.4	8.6	76.9	8.26	72.8	7.80	67.5	7.21	64.8	6.91	62.1	6.62	58.1	6.18	52.8	5.61
	15.8	14.0	76.9	7.70	72.8	7.28	67.5	6.73	64.8	6.45	62.1	6.18	58.1	5.77	52.8	5.24
	17.0	15.0	76.9	7.60	72.8	7.19	67.5	6.64	64.8	6.37	62.1	6.10	58.1	5.70	52.8	5.18
	23.0	21.2	76.9	7.05	72.8	6.67	67.5	6.16	64.8	5.91	62.1	5.67	58.1	5.30	52.8	4.81
	26.6	24.8	76.9	6.76	72.8	6.39	67.5	5.91	64.8	5.67	62.1	5.43	58.1	5.08	52.8	4.61
	30.2	28.4	76.9	6.48	72.8	6.13	67.5	5.67	64.8	5.44	62.1	5.22	58.1	4.88	52.8	4.43
	32.0	30.2	76.9	6.35	72.8	6.01	67.5	5.56	64.8	5.33	62.1	5.11	58.1	4.78	52.8	4.34
	35.6	33.8	76.9	6.10	72.8	5.77	67.5	5.34	64.8	5.12	62.1	4.91	58.1	4.59	52.8	4.17
	41.0	39.2	76.9	5.75	72.8	5.44	67.5	5.03	64.8	4.83	62.1	4.63	58.1	4.33	52.8	3.94
	47.0	43.0	76.9	5.51	72.8	5.22	67.5	4.83	64.8	4.64	62.1	4.44	58.1	4.16	52.8	3.78
	48.2	46.0	76.9	5.34	72.8	5.05	67.5	4.67	64.8	4.49	62.1	4.30	58.1			

Heating capacity at rated condition: 108 kBtu/h (8 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
54.0 (50%)	-4.0	-5.3	62.3	8.02	60.7	7.86	56.2	7.27	54.0	6.97	51.8	6.68	48.4	6.24	44.0	5.67
	5.0	3.2	64.1	7.34	60.7	6.95	56.2	6.43	54.0	6.17	51.8	5.91	48.4	5.53	44.0	5.02
	10.4	8.6	64.1	6.83	60.7	6.46	56.2	5.98	54.0	5.74	51.8	5.50	48.4	5.15	44.0	4.68
	15.8	14.0	64.1	6.38	60.7	6.03	56.2	5.59	54.0	5.36	51.8	5.14	48.4	4.81	44.0	4.38
	17.0	15.0	64.1	6.30	60.7	5.96	56.2	5.52	54.0	5.30	51.8	5.08	48.4	4.75	44.0	4.33
	23.0	21.2	64.1	5.84	60.7	5.53	56.2	5.12	54.0	4.92	51.8	4.72	48.4	4.42	44.0	4.02
	26.6	24.8	64.1	5.60	60.7	5.31	56.2	4.92	54.0	4.72	51.8	4.53	48.4	4.24	44.0	3.86
	30.2	28.4	64.1	5.38	60.7	5.09	56.2	4.72	54.0	4.53	51.8	4.35	48.4	4.07	44.0	3.71
	32.0	30.2	64.1	5.27	60.7	4.99	56.2	4.63	54.0	4.44	51.8	4.26	48.4	3.99	44.0	3.64
	35.6	33.8	64.1	5.06	60.7	4.80	56.2	4.45	54.0	4.27	51.8	4.10	48.4	3.84	44.0	3.50
	41.0	39.2	64.1	4.77	60.7	4.52	56.2	4.19	54.0	4.03	51.8	3.87	48.4	3.62	44.0	3.31
	47.0	43.0	64.1	4.58	60.7	4.34	56.2	4.03	54.0	3.87	51.8	3.71	48.4	3.48	44.0	3.18
	48.2	46.0	64.1	4.44	60.7	4.20	56.2	3.90	54.0	3.75	51.8	3.60	48.4	3.37	44.0	3.08
	53.6	51.1	64.1	4.20	60.7	3.98	56.2	3.70	54.0	3.55	51.8	3.41	48.4	3.20	44.0	2.92
	59.0	56.3	64.1	3.98	60.7	3.77	56.2	3.50	54.0	3.37	51.8	3.23	48.4	3.03	44.0	2.77

MODEL  
SELECTIONMODEL  
SELECTION

# Model: AOUA120RLBV1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 135 kBTu/h (10 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
202.5 (150%)	-4.0	-5.3	94.8	10.25	93.8	10.30	92.6	10.37	92.0	10.40	91.3	10.44	90.4	10.49	89.2	10.56
	5.0	3.2	104.6	10.50	103.8	10.57	102.8	10.66	102.3	10.70	101.8	10.74	101.0	10.81	100.0	10.90
	10.4	8.6	111.6	10.66	110.9	10.74	110.0	10.83	109.5	10.88	109.0	10.93	108.4	11.01	107.5	11.11
	15.8	14.0	119.1	10.82	118.4	10.90	117.6	11.01	117.2	11.06	116.7	11.12	116.1	11.20	115.3	11.31
	17.0	15.0	120.5	10.85	119.9	10.93	119.1	11.04	118.6	11.10	118.2	11.15	117.6	11.24	116.8	11.35
	23.0	21.2	129.8	11.02	129.2	11.11	128.4	11.24	128.0	11.30	127.6	11.36	127.0	11.45	126.2	11.58
	26.6	24.8	135.4	11.12	134.8	11.22	134.0	11.35	133.6	11.41	133.2	11.48	132.6	11.58	131.8	11.71
	30.2	28.4	141.1	11.22	140.5	11.33	139.7	11.46	139.3	11.53	138.9	11.60	138.3	11.70	137.5	11.84
	32.0	30.2	144.1	11.27	143.4	11.38	142.6	11.52	142.2	11.59	141.8	11.66	141.2	11.76	140.4	11.90
	35.6	33.8	150.0	11.37	149.4	11.48	148.5	11.63	148.1	11.70	147.7	11.77	147.0	11.88	146.2	12.03
	41.0	39.2	159.1	11.52	158.4	11.64	157.5	11.79	157.1	11.86	156.6	11.94	155.9	12.06	154.9	12.21
	47.0	43.0	165.6	11.63	164.9	11.74	163.9	11.90	163.4	11.98	162.9	12.06	162.2	12.18	161.2	12.34
	48.2	46.0	170.9	11.71	170.1	11.83	169.0	11.99	168.5	12.07	168.0	12.15	167.2	12.27	164.9	12.31
	53.6	51.1	179.8	11.84	178.9	11.97	177.7	12.13	177.2	12.22	176.6	12.30	175.7	12.43	164.9	11.66
	59.0	56.3	188.9	11.98	188.0	12.11	187.7	12.28	186.0	12.37	185.3	12.45	181.6	12.32	164.9	11.04
189.0 (140%)	-4.0	-5.3	94.3	10.27	93.3	10.33	92.1	10.39	91.5	10.43	90.9	10.46	89.9	10.52	88.7	10.59
	5.0	3.2	104.1	10.54	103.3	10.61	102.3	10.69	101.8	10.74	101.3	10.78	100.6	10.85	99.6	10.94
	10.4	8.6	111.1	10.71	110.4	10.78	109.5	10.88	109.1	10.93	108.6	10.98	108.0	11.06	107.1	11.16
	15.8	14.0	118.6	10.87	118.0	10.95	117.2	11.06	116.8	11.12	116.3	11.17	115.7	11.26	114.9	11.37
	17.0	15.0	120.1	10.90	119.5	10.99	118.6	11.10	118.2	11.15	117.8	11.21	117.2	11.29	116.4	11.41
	23.0	21.2	129.3	11.09	128.7	11.18	127.9	11.30	127.5	11.37	127.1	11.43	126.5	11.52	125.7	11.65
	26.6	24.8	134.9	11.20	134.3	11.29	133.5	11.42	133.1	11.49	132.7	11.55	132.1	11.65	131.3	11.78
	30.2	28.4	140.6	11.31	140.0	11.41	139.2	11.54	138.8	11.61	138.4	11.68	137.8	11.78	137.0	11.92
	32.0	30.2	143.6	11.36	142.9	11.46	142.1	11.60	141.7	11.67	141.3	11.74	140.7	11.84	139.9	11.98
	35.6	33.8	149.5	11.47	148.8	11.57	148.0	11.72	147.6	11.79	147.1	11.86	146.5	11.97	145.6	12.12
	41.0	39.2	158.5	11.62	157.8	11.74	156.9	11.89	156.4	11.97	156.0	12.04	155.3	12.16	153.9	12.27
	47.0	43.0	165.0	11.74	164.2	11.85	163.2	12.01	162.7	12.09	162.2	12.17	161.5	12.29	153.9	11.77
	48.2	46.0	170.1	11.82	169.3	11.94	168.3	12.10	167.7	12.19	167.2	12.27	166.4	12.39	153.9	11.39
	53.6	51.1	178.9	11.97	178.0	12.09	176.9	12.26	176.3	12.34	175.7	12.43	169.5	12.03	153.9	10.79
	59.0	56.3	187.9	12.11	186.9	12.24	185.6	12.42	184.9	12.50	181.2	12.29	169.5	11.39	153.9	10.22
175.5 (130%)	-4.0	-5.3	93.7	10.31	92.8	10.36	91.5	10.43	90.9	10.46	90.3	10.50	89.4	10.55	88.2	10.62
	5.0	3.2	103.6	10.59	102.8	10.65	101.8	10.74	101.3	10.78	100.8	10.83	100.1	10.89	99.1	10.98
	10.4	8.6	110.6	10.76	109.9	10.84	109.0	10.93	108.6	10.98	108.2	11.03	107.5	11.11	106.6	11.21
	15.8	14.0	118.1	10.94	117.5	11.02	116.7	11.13	116.3	11.18	115.9	11.24	115.2	11.32	114.4	11.43
	17.0	15.0	119.6	10.97	119.0	11.05	118.2	11.16	117.7	11.22	117.3	11.27	116.7	11.36	115.9	11.47
	23.0	21.2	128.8	11.17	128.2	11.26	127.4	11.38	127.0	11.44	126.6	11.51	126.0	11.60	125.3	11.72
	26.6	24.8	134.4	11.28	133.8	11.38	133.0	11.51	132.6	11.57	132.2	11.64	131.6	11.74	130.8	11.87
	30.2	28.4	140.1	11.40	139.5	11.50	138.7	11.63	138.3	11.70	137.9	11.77	137.3	11.87	136.4	12.01
	32.0	30.2	143.0	11.46	142.4	11.56	141.6	11.70	141.1	11.77	140.7	11.84	140.1	11.94	139.3	12.08
	35.6	33.8	148.8	11.57	148.2	11.68	147.4	11.82	146.9	11.89	146.5	11.97	145.9	12.08	142.9	11.99
	41.0	39.2	157.8	11.74	157.1	11.86	156.2	12.01	155.7	12.08	155.2	12.16	154.5	12.28	142.9	11.30
	47.0	43.0	164.2	11.86	163.4	11.98	162.4	12.14	161.9	12.22	161.4	12.29	157.4	12.07	142.9	10.84
	48.2	46.0	169.2	11.96	168.5	12.08	167.4	12.24	166.9	12.32	166.3	12.40	157.4	11.68	142.9	10.50
	53.6	51.1	177.9	12.11	177.0	12.24	175.8	12.41	175.2	12.49	168.3	11.93	157.4	11.07	142.9	9.94
	59.0	56.3	186.7	12.27	185.7	12.40	182.8	12.41	175.5	11.85	168.3	11.29	157.4	10.47	142.9	9.42
162.0 (120%)	-4.0	-5.3	93.0	10.34	92.1	10.39	90.9	10.46	90.3	10.50	89.7	10.53	88.8	10.59	87.6	10.66
	5.0	3.2	103.0	10.64	102.2	10.70	101.3	10.79	100.8	10.83	100.3	10.88	99.5	10.95	98.6	11.03
	10.4	8.6	110.1	10.82	109.4	10.90	108.5	11.00	108.0	11.05	107.6	11.09	106.9	11.17	106.1	11.27
	15.8	14.0	117.6	11.01	117.0	11.09	116.1	11.20	115.7	11.26	115.3	11.31	114.7	11.39	113.9	11.50
	17.0	15.0	119.0	11.04	118.4	11.13	117.6	11.24	117.2	11.29	116.8	11.35	116.2	11.43	115.4	11.55
	23.0	21.2	128.2	11.26	127.6	11.35	126.9	11.47	126.5	11.53	126.1	11.60	125.5	11.69	124.7	11.81
	26.6	24.8	133.8	11.38	133.2	11.48	132.4	11.61	132.0	11.67	131.6	11.74	131.0	11.84	130.2	11.97
	30.2	28.4	139.4	11.51	138.8	11.61	138.0	11.74	137.6	11.81	137.2	11.88	136.6	11.98	131.9	11.67
	32.0	30.2	142.3	11.57	141.7	11.67	140.9	11.81	140.5	11.88	140.1	11.95	139.4	12.05	131.9	11.44
	35.6	33.8	148.1	11.69	147.5	11.80	146.6	11.94	146.2	12.02	145.8	12.09	145.1	12.20	131.9	10.98
	41.0	39.2	157.0	11.88	156.3	11.99	155.3	12.14	154.9	12.22	154.4	12.30	145.3	11.51	131.9	10.35
	47.0	43.0	163.2	12.01	162.5	12.13	161.5	12.28	161.0	12.36	155.3	11.89	145.3	11.04	131.9	9.93
	48.2	46.0	168.2	12.11	167.4	12.23	166.4	12.39	162.0	12.07	155.3	11.51	145.3	10.69	131.9	9.62
	53.6	51.1	176.7	12.28	175.8	12.41	168.7	11.97	162.0	11.43	155.3	10.91	145.3	10.13	131.9	9.12
	59.0	56.3	185.3	12.46	182.1	12.36	168.7	11.33	162.0	10.82	155.3	10.32	145.3	9.59	131.9	8.63
148.5 (110%)	-4.0	-5.3	92.3	10.38	91.4	10.44	90.1	10.51	89.6	10.54	89.0	10.58	88.1	10.63	86.9	10.70
	5.0	3.2	102.3	10.70	101.6	10.76	100.6	10.85	100.1	10.89	99.6	10.94	98.9	11.01	97.9	11.09
	10.4	8.6	109.4	10.90	108.7	10.97	107.8	11.07	107.4	11.12	107.0	11.17	106.3	11.24	105.4	11.34
	15.8	14.0	116.9	11.10	116.3	11.18	115.5	11.29	115.1	11.34	114.7	11.40	114.1	11.48	113.3	11.59
	17.0	15.0	118.4	11.13	117.8	11.22	117.0	11.33	116.6	11.38	116.1	11.44	115.5	11.52	114.7	11.64
	23.0	21.2	127.6	11.36	127.0	11.46	126.2	11.58	125.8	11.64	125.4	11.70	124.8	11.79	120.9	11.54
	26.6	24.8	133.1	11.50	132.5	11.59	131.7	11.72	131.3	11.79	130.9	11.85	130.3	11.95	120.	



Heating capacity at rated condition: 135 kBTu/h (10 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
135.0 (100%)	-4.0	-5.3	91.4	10.44	90.5	10.49	89.3	10.56	88.7	10.59	88.1	10.63	87.2	10.68	86.1	10.75
	5.0	3.2	101.5	10.77	100.8	10.83	99.8	10.92	99.3	10.97	98.8	11.01	98.1	11.08	97.2	11.17
	10.4	8.6	108.6	10.98	107.9	11.06	107.1	11.15	106.6	11.20	106.2	11.25	105.6	11.33	104.7	11.43
	15.8	14.0	116.1	11.20	115.5	11.28	114.7	11.39	114.3	11.44	113.9	11.50	113.3	11.58	109.9	11.36
	17.0	15.0	117.6	11.24	117.0	11.32	116.2	11.43	115.8	11.49	115.4	11.54	114.8	11.63	109.9	11.22
	23.0	21.2	126.7	11.49	126.2	11.58	125.4	11.70	125.0	11.77	124.6	11.83	121.1	11.56	109.9	10.42
	26.6	24.8	132.2	11.64	131.6	11.73	130.8	11.86	130.5	11.93	129.4	11.92	121.1	11.08	109.9	10.00
	30.2	28.4	137.8	11.78	137.2	11.89	136.4	12.02	135.0	11.97	129.4	11.43	121.1	10.64	109.9	9.60
	32.0	30.2	140.6	11.86	140.0	11.96	139.2	12.10	135.0	11.73	129.4	11.20	121.1	10.42	109.9	9.41
	35.6	33.8	146.3	12.01	145.6	12.11	140.6	11.78	135.0	11.27	129.4	10.76	121.1	10.01	109.9	9.04
	41.0	39.2	154.8	12.23	151.7	12.08	140.6	11.10	135.0	10.62	129.4	10.14	121.1	9.44	109.9	8.52
	47.0	43.0	160.1	12.31	151.7	11.59	140.6	10.65	135.0	10.19	129.4	9.74	121.1	9.06	109.9	8.18
	48.2	46.0	160.1	11.91	151.7	11.22	140.6	10.31	135.0	9.87	129.4	9.43	121.1	8.78	109.9	7.93
	53.6	51.1	160.1	11.28	151.7	10.63	140.6	9.77	135.0	9.35	129.4	8.93	121.1	8.32	109.9	7.52
	59.0	56.3	160.1	10.68	151.7	10.06	140.6	9.25	135.0	8.85	129.4	8.46	121.1	7.88	109.9	7.12
121.5 (90%)	-4.0	-5.3	90.3	10.50	89.4	10.55	88.3	10.62	87.7	10.65	87.1	10.69	86.3	10.74	85.1	10.82
	5.0	3.2	100.5	10.86	99.8	10.92	98.8	11.01	98.4	11.05	97.9	11.10	97.2	11.16	96.3	11.25
	10.4	8.6	107.7	11.09	107.0	11.16	106.2	11.26	105.7	11.31	105.3	11.36	104.7	11.43	98.9	10.86
	15.8	14.0	115.2	11.32	114.6	11.40	113.8	11.51	113.4	11.57	113.0	11.62	108.9	11.25	98.9	10.16
	17.0	15.0	116.7	11.37	116.1	11.45	115.3	11.56	114.9	11.62	114.5	11.67	108.9	11.11	98.9	10.04
	23.0	21.2	125.8	11.64	125.2	11.73	124.4	11.86	121.5	11.60	116.5	11.09	108.9	10.33	98.9	9.33
	26.6	24.8	131.2	11.80	130.6	11.90	126.5	11.62	121.5	11.13	116.5	10.64	108.9	9.90	98.9	8.95
	30.2	28.4	136.7	11.97	136.1	12.07	126.5	11.16	121.5	10.68	116.5	10.21	108.9	9.51	98.9	8.60
	32.0	30.2	139.5	12.05	136.6	11.88	126.5	10.93	121.5	10.47	116.5	10.00	108.9	9.32	98.9	8.43
	35.6	33.8	144.1	12.11	136.6	11.41	126.5	10.50	121.5	10.05	116.5	9.61	108.9	8.96	98.9	8.10
	41.0	39.2	144.1	11.40	136.6	10.75	126.5	9.90	121.5	9.48	116.5	9.06	108.9	8.45	98.9	7.64
	47.0	43.0	144.1	10.94	136.6	10.32	126.5	9.50	121.5	9.10	116.5	8.70	108.9	8.11	98.9	7.34
	48.2	46.0	144.1	10.60	136.6	9.99	126.5	9.20	121.5	8.81	116.5	8.43	108.9	7.86	98.9	7.11
	53.6	51.1	144.1	10.04	136.6	9.47	126.5	8.72	121.5	8.35	116.5	7.99	108.9	7.45	98.9	6.75
	59.0	56.3	144.1	9.50	136.6	8.96	126.5	8.26	121.5	7.91	116.5	7.57	108.9	7.06	98.9	6.40
108.0 (80%)	-4.0	-5.3	89.0	10.57	88.1	10.63	87.0	10.70	86.5	10.73	85.9	10.77	85.1	10.82	84.0	10.89
	5.0	3.2	99.3	10.96	98.6	11.03	97.7	11.12	97.2	11.16	96.8	11.20	96.1	11.27	87.9	10.29
	10.4	8.6	106.5	11.22	105.9	11.29	105.0	11.39	104.6	11.44	103.5	11.40	96.8	10.62	87.9	9.61
	15.8	14.0	114.1	11.48	113.5	11.56	112.5	11.64	108.0	11.15	103.5	10.66	96.8	9.94	87.9	8.99
	17.0	15.0	115.5	11.53	114.9	11.61	112.5	11.50	108.0	11.01	103.5	10.53	96.8	9.82	87.9	8.88
	23.0	21.2	124.6	11.83	121.4	11.59	112.5	10.68	108.0	10.23	103.5	9.79	96.8	9.13	87.9	8.26
	26.6	24.8	128.1	11.78	121.4	11.12	112.5	10.24	108.0	9.81	103.5	9.39	96.8	8.76	87.9	7.93
	30.2	28.4	128.1	11.31	121.4	10.67	112.5	9.83	108.0	9.42	103.5	9.02	96.8	8.41	87.9	7.62
	32.0	30.2	128.1	11.08	121.4	10.45	112.5	9.64	108.0	9.23	103.5	8.84	96.8	8.24	87.9	7.47
	35.6	33.8	128.1	10.64	121.4	10.04	112.5	9.26	108.0	8.87	103.5	8.49	96.8	7.92	87.9	7.18
	41.0	39.2	128.1	10.03	121.4	9.47	112.5	8.73	108.0	8.37	103.5	8.01	96.8	7.48	87.9	6.78
	47.0	43.0	128.1	9.63	121.4	9.09	112.5	8.38	108.0	8.04	103.5	7.69	96.8	7.18	87.9	6.52
	48.2	46.0	128.1	9.32	121.4	8.80	112.5	8.12	108.0	7.79	103.5	7.45	96.8	6.96	87.9	6.32
	53.6	51.1	128.1	8.83	121.4	8.34	112.5	7.70	108.0	7.38	103.5	7.07	96.8	6.60	87.9	5.99
	59.0	56.3	128.1	8.37	121.4	7.90	112.5	7.30	108.0	7.00	103.5	6.70	96.8	6.26	87.9	5.69
94.5 (70%)	-4.0	-5.3	87.4	10.67	86.6	10.72	85.5	10.79	84.9	10.83	84.4	10.86	83.6	10.92	76.9	10.05
	5.0	3.2	97.9	11.10	97.2	11.17	96.3	11.25	94.5	11.10	90.6	10.62	84.7	9.91	76.9	8.97
	10.4	8.6	105.1	11.38	104.5	11.46	98.4	10.80	94.5	10.35	90.6	9.91	84.7	9.25	76.9	8.38
	15.8	14.0	112.1	11.60	106.2	10.95	98.4	10.10	94.5	9.69	90.6	9.27	84.7	8.66	76.9	7.85
	17.0	15.0	112.1	11.45	106.2	10.82	98.4	9.98	94.5	9.57	90.6	9.16	84.7	8.55	76.9	7.76
	23.0	21.2	112.1	10.64	106.2	10.05	98.4	9.28	94.5	8.90	90.6	8.52	84.7	7.96	76.9	7.22
	26.6	24.8	112.1	10.21	106.2	9.64	98.4	8.90	94.5	8.54	90.6	8.18	84.7	7.64	76.9	6.94
	30.2	28.4	112.1	9.80	106.2	9.26	98.4	8.55	94.5	8.20	90.6	7.86	84.7	7.34	76.9	6.67
	32.0	30.2	112.1	9.60	106.2	9.07	98.4	8.38	94.5	8.04	90.6	7.70	84.7	7.20	76.9	6.54
	35.6	33.8	112.1	9.23	106.2	8.72	98.4	8.06	94.5	7.73	90.6	7.40	84.7	6.92	76.9	6.29
	41.0	39.2	112.1	8.70	106.2	8.22	98.4	7.60	94.5	7.29	90.6	6.99	84.7	6.54	76.9	5.94
	47.0	43.0	112.1	8.35	106.2	7.90	98.4	7.30	94.5	7.01	90.6	6.71	84.7	6.28	76.9	5.71
	48.2	46.0	112.1	8.09	106.2	7.65	98.4	7.08	94.5	6.79	90.6	6.51	84.7	6.09	76.9	5.54
	53.6	51.1	112.1	7.67	106.2	7.26	98.4	6.71	94.5	6.44	90.6	6.18	84.7	5.78	76.9	5.26
	59.0	56.3	112.1	7.27	106.2	6.88	98.4	6.36	94.5	6.11	90.6	5.86	84.7	5.48	76.9	5.00
81.0 (60%)	-4.0	-5.3	85.4	10.80	84.6	10.85	83.6	10.92	81.0	10.60	77.7	10.15	72.6	9.48	65.9	8.60
	5.0	3.2	96.0	11.28	91.0	10.67	84.4	9.86	81.0	9.46	77.7	9.06	72.6	8.47	65.9	7.69
	10.4	8.6	96.1	10.53	91.0	9.96	84.4	9.21	81.0	8.83	77.7	8.46	72.6	7.91	65.9	7.19
	15.8	14.0	96.1	9.85	91.0	9.32	84.4	8.62	81.0	8.27	77.7	7.93	72.6	7.41	65.9	6.74
	17.0	15.0	96.1	9.74	91.0	9.21	84.4	8.52	81.0	8.17	77.7	7.83	72.6	7.33	65.9	6.66
	23.0	21.2	96.1	9.05	91.0	8.56	84.4	7.92	81.0	7.60	77.7	7.29	72.6	6.82	65.9	6.21
	26.6	24.8	96.1	8.69	91.0	8.22	84.4	7.60	81.0	7.30	77.7	7.00	72.6	6.55	65.9	5.96
	30.2	28.4	96.1	8.34	91.0	7.89	84.4	7.31	81.0	7.02	77.7	6.73	72.6	6.30	65.9	5.74
	32.0	30.2	96.1	8.18	91.0	7.74	84.4	7.16	81.0	6.88	77.7	6.60	72.6	6.18	65.9	5.63
	35.6	33.8	96.1	7.86	91.0	7.44	84.4	6.89	81.0	6.62	77.7	6.35	72.6	5.94	65.9	5.42
	41.0	39.2														

Heating capacity at rated condition: 135 kBtu/h (10 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
67.5 (50%)	-4.0	-5.3	80.1	10.47	75.9	9.91	70.3	9.17	67.5	8.81	64.7	8.44	60.5	7.90	55.0	7.19
	5.0	3.2	80.1	9.35	75.9	8.85	70.3	8.19	67.5	7.87	64.7	7.55	60.5	7.07	55.0	6.44
	10.4	8.6	80.1	8.73	75.9	8.26	70.3	7.66	67.5	7.36	64.7	7.06	60.5	6.61	55.0	6.02
	15.8	14.0	80.1	8.17	75.9	7.74	70.3	7.18	67.5	6.90	64.7	6.62	60.5	6.20	55.0	5.65
	17.0	15.0	80.1	8.08	75.9	7.65	70.3	7.09	67.5	6.81	64.7	6.54	60.5	6.13	55.0	5.59
	23.0	21.2	80.1	7.52	75.9	7.12	70.3	6.61	67.5	6.35	64.7	6.09	60.5	5.72	55.0	5.22
	26.6	24.8	80.1	7.22	75.9	6.84	70.3	6.35	67.5	6.10	64.7	5.86	60.5	5.49	55.0	5.02
	30.2	28.4	80.1	6.93	75.9	6.57	70.3	6.10	67.5	5.87	64.7	5.63	60.5	5.29	55.0	4.83
	32.0	30.2	80.1	6.80	75.9	6.45	70.3	5.98	67.5	5.75	64.7	5.53	60.5	5.19	55.0	4.74
	35.6	33.8	80.1	6.54	75.9	6.20	70.3	5.76	67.5	5.54	64.7	5.32	60.5	4.99	55.0	4.57
	41.0	39.2	80.1	6.18	75.9	5.86	70.3	5.44	67.5	5.24	64.7	5.03	60.5	4.73	55.0	4.32
	47.0	43.0	80.1	5.94	75.9	5.63	70.3	5.24	67.5	5.04	64.7	4.84	60.5	4.55	55.0	4.16
	48.2	46.0	80.1	5.76	75.9	5.46	70.3	5.08	67.5	4.89	64.7	4.70	60.5	4.42	55.0	4.04
	53.6	51.1	80.1	5.47	75.9	5.19	70.3	4.83	67.5	4.65	64.7	4.47	60.5	4.20	55.0	3.85
	59.0	56.3	80.1	5.19	75.9	4.93	70.3	4.59	67.5	4.42	64.7	4.25	60.5	3.99	55.0	3.66

MODEL  
SELECTIONMODEL  
SELECTION



## 5-2. Combination

### Model: AOUA144RLBVG1

Heating capacity at rated condition: 162 kBTu/h (12 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
243.0 (150%)	-4.0	-5.3	106.6	11.98	106.2	12.07	105.6	12.22	105.2	12.26	105.0	12.33	104.6	12.43	104.0	12.57
	5.0	3.2	121.8	12.43	121.4	12.55	120.6	12.69	120.4	12.76	120.0	12.86	119.6	12.98	118.8	13.12
	10.4	8.6	131.8	12.69	131.4	12.81	130.6	13.00	130.2	13.07	130.0	13.17	129.4	13.29	128.6	13.45
	15.8	14.0	142.0	12.95	141.6	13.10	140.8	13.29	140.4	13.38	140.0	13.48	139.4	13.62	138.6	13.78
	17.0	15.0	144.0	13.00	143.4	13.14	142.6	13.33	142.2	13.43	141.8	13.52	141.2	13.67	140.4	13.86
	23.0	21.2	156.0	13.29	155.4	13.45	154.4	13.64	154.0	13.76	153.6	13.86	152.8	14.02	152.0	14.21
	26.6	24.8	163.0	13.45	162.4	13.62	161.4	13.83	161.0	13.95	160.4	14.05	159.8	14.21	158.8	14.43
	30.2	28.4	170.2	13.62	169.4	13.78	168.4	14.00	167.8	14.12	167.4	14.24	166.6	14.40	165.6	14.62
	32.0	30.2	173.8	13.69	173.0	13.88	171.8	14.09	171.4	14.21	170.8	14.33	170.0	14.50	169.0	14.74
	35.6	33.8	180.8	13.86	180.0	14.02	179.0	14.26	178.4	14.38	177.8	14.50	177.0	14.69	175.8	14.93
	41.0	39.2	191.8	14.07	190.8	14.26	189.6	14.52	188.8	14.64	188.2	14.76	187.2	14.95	186.0	15.19
	47.0	43.0	199.4	14.24	198.4	14.43	197.0	14.69	196.4	14.81	195.6	14.93	194.6	15.12	193.2	15.38
	48.2	46.0	205.4	14.35	204.4	14.54	203.0	14.81	202.2	14.93	201.4	15.07	200.4	15.26	197.8	15.40
	53.6	51.1	215.8	14.54	214.6	14.74	213.0	15.00	212.2	15.14	211.4	15.28	210.2	15.47	197.8	14.64
	59.0	56.3	226.2	14.74	225.0	14.93	223.2	15.21	222.4	15.35	221.4	15.47	217.8	15.45	197.8	13.90
226.8 (140%)	-4.0	-5.3	106.4	12.03	106.0	12.12	105.4	12.26	105.0	12.31	104.8	12.38	104.2	12.48	103.6	12.62
	5.0	3.2	121.6	12.48	121.0	12.60	120.4	12.76	120.0	12.83	119.8	12.91	119.2	13.02	118.6	13.19
	10.4	8.6	131.6	12.76	131.0	12.91	130.2	13.07	130.0	13.14	129.6	13.24	129.0	13.38	128.4	13.55
	15.8	14.0	141.6	13.05	141.2	13.19	140.4	13.38	140.0	13.48	139.6	13.57	139.0	13.69	138.2	13.88
	17.0	15.0	143.6	13.10	143.0	13.24	142.2	13.43	141.8	13.52	141.4	13.62	140.8	13.76	140.0	13.95
	23.0	21.2	155.6	13.40	154.8	13.57	154.0	13.76	153.6	13.86	153.0	13.97	152.4	14.12	151.4	14.33
	26.6	24.8	162.4	13.57	161.8	13.74	160.8	13.95	160.4	14.07	159.8	14.16	159.2	14.33	158.2	14.54
	30.2	28.4	169.6	13.76	168.8	13.93	167.8	14.14	167.2	14.26	166.8	14.35	166.0	14.54	165.0	14.76
	32.0	30.2	173.0	13.83	172.2	14.00	171.2	14.24	170.8	14.35	170.2	14.45	169.4	14.64	168.2	14.85
	35.6	33.8	180.2	14.00	179.4	14.19	178.2	14.43	177.6	14.52	177.0	14.64	176.2	14.83	175.0	15.07
	41.0	39.2	190.8	14.24	190.0	14.43	188.6	14.69	188.0	14.81	187.4	14.93	186.4	15.12	184.6	15.31
	47.0	43.0	198.4	14.40	197.4	14.59	196.0	14.85	195.4	14.97	194.6	15.12	193.6	15.31	184.6	14.74
	48.2	46.0	204.4	14.54	203.4	14.74	201.8	15.00	201.2	15.12	200.4	15.26	199.4	15.45	184.6	14.28
	53.6	51.1	214.6	14.74	213.4	14.95	211.8	15.21	211.0	15.35	210.2	15.47	203.4	15.09	184.6	13.59
	59.0	56.3	224.8	14.95	223.6	15.14	221.8	15.42	221.0	15.57	217.4	15.42	203.4	14.33	184.6	12.91
210.6 (130%)	-4.0	-5.3	106.2	12.10	105.6	12.19	105.0	12.31	104.8	12.38	104.4	12.45	104.0	12.55	103.4	12.67
	5.0	3.2	121.2	12.57	120.8	12.69	120.0	12.83	119.8	12.91	119.4	13.00	119.0	13.12	118.2	13.26
	10.4	8.6	131.2	12.86	130.6	13.00	130.0	13.17	129.6	13.24	129.2	13.33	128.6	13.45	128.0	13.64
	15.8	14.0	141.2	13.14	140.6	13.29	139.8	13.48	139.6	13.57	139.2	13.67	138.6	13.81	137.8	14.00
	17.0	15.0	143.2	13.21	142.6	13.36	141.8	13.55	141.4	13.64	141.0	13.74	140.4	13.88	139.6	14.07
	23.0	21.2	155.0	13.55	154.2	13.69	153.4	13.90	153.0	14.00	152.6	14.09	151.8	14.26	151.0	14.47
	26.6	24.8	161.8	13.71	161.2	13.88	160.2	14.09	159.8	14.21	159.2	14.31	158.6	14.47	157.6	14.69
	30.2	28.4	168.8	13.90	168.0	14.07	167.0	14.28	166.6	14.40	166.0	14.52	165.2	14.69	164.2	14.90
	32.0	30.2	172.4	14.00	171.6	14.16	170.4	14.40	170.0	14.50	169.4	14.62	168.6	14.78	167.6	15.02
	35.6	33.8	179.4	14.19	178.4	14.35	177.4	14.59	176.8	14.71	176.2	14.83	175.4	15.00	171.4	14.93
	41.0	39.2	189.8	14.43	189.0	14.62	187.6	14.85	187.0	15.00	186.4	15.12	185.4	15.31	171.4	14.12
	47.0	43.0	197.4	14.62	196.4	14.81	195.0	15.04	194.2	15.19	193.6	15.31	188.8	15.09	171.4	13.59
	48.2	46.0	203.2	14.76	202.2	14.95	200.8	15.21	200.0	15.33	199.2	15.45	188.8	14.64	171.4	13.19
	53.6	51.1	213.2	14.97	212.0	15.19	210.4	15.45	209.6	15.57	202.0	14.97	188.8	13.93	171.4	12.55
	59.0	56.3	223.2	15.19	222.0	15.40	219.2	15.57	210.6	14.88	202.0	14.21	188.8	13.21	171.4	11.93
194.4 (120%)	-4.0	-5.3	105.8	12.14	105.4	12.24	104.8	12.38	104.4	12.45	104.2	12.50	103.8	12.60	103.2	12.74
	5.0	3.2	120.8	12.64	120.4	12.76	119.8	12.93	119.4	13.00	119.0	13.07	118.6	13.19	117.8	13.36
	10.4	8.6	130.8	12.98	130.2	13.10	129.4	13.26	129.2	13.36	128.8	13.43	128.2	13.57	127.6	13.74
	15.8	14.0	140.8	13.29	140.2	13.43	139.4	13.59	139.0	13.69	138.6	13.78	138.0	13.93	137.2	14.12
	17.0	15.0	142.6	13.33	142.0	13.48	141.2	13.67	140.8	13.76	140.4	13.86	139.8	14.00	139.0	14.19
	23.0	21.2	154.2	13.69	153.6	13.83	152.8	14.05	152.4	14.14	151.8	14.26	151.2	14.40	150.2	14.62
	26.6	24.8	161.2	13.88	160.4	14.05	159.4	14.26	159.0	14.38	158.6	14.47	157.8	14.64	156.8	14.85
	30.2	28.4	168.0	14.09	167.2	14.26	166.2	14.47	165.8	14.59	165.2	14.69	164.4	14.85	158.2	14.47
	32.0	30.2	171.4	14.19	170.6	14.35	169.6	14.57	169.0	14.69	168.6	14.81	167.8	14.97	158.2	14.21
	35.6	33.8	178.4	14.38	177.6	14.54	176.4	14.78	175.8	14.90	175.2	15.02	174.2	15.19	158.2	13.71
	41.0	39.2	188.8	14.66	187.8	14.83	186.6	15.09	186.0	15.21	185.2	15.33	174.4	14.38	158.2	12.98
	47.0	43.0	196.0	14.85	195.0	15.04	193.6	15.28	193.0	15.42	186.4	14.88	174.4	13.86	158.2	12.50
	48.2	46.0	201.8	15.00	200.8	15.19	199.4	15.45	194.4	15.12	186.4	14.43	174.4	13.43	158.2	12.12
	53.6	51.1	211.6	15.23	210.4	15.45	202.4	15.02	194.4	14.35	186.4	13.71	174.4	12.76	158.2	11.53
	59.0	56.3	221.4	15.47	218.4	15.50	202.4	14.26	194.4	13.64	186.4	13.02	174.4	12.12	158.2	10.96
178.2 (110%)	-4.0	-5.3	105.4	12.24	105.0	12.33	104.4	12.45	104.2	12.52	103.8	12.57	103.4	12.67	102.8	12.81
	5.0	3.2	120.4	12.76	120.0	12.88	119.2	13.02	119.0	13.10	118.6	13.19	118.2	13.31	117.4	13.45
	10.4	8.6	130.2	13.10	129.6	13.21	129.0	13.38	128.6	13.48	128.2	13.57	127.8	13.69	127.0	13.86
	15.8	14.0	140.2	13.43	139.6	13.57	138.8	13.76	138.4	13.83	138.0	13.93	137.4	14.07	136.6	14.26
	17.0	15.0	142.0	13.50	141.4	13.62	140.60									

Heating capacity at rated condition: 162 kBTu/h (12 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
162.0 (100%)	-4.0	-5.3	105.0	12.31	104.6	12.41	104.0	12.55	103.8	12.62	103.4	12.67	103.0	12.76	102.4	12.91
	5.0	3.2	119.8	12.88	119.4	13.00	118.8	13.14	118.4	13.24	118.0	13.31	117.6	13.43	117.0	13.57
	10.4	8.6	129.6	13.24	129.0	13.38	128.4	13.55	128.0	13.62	127.6	13.71	127.0	13.83	126.4	14.02
	15.8	14.0	139.4	13.59	138.8	13.74	138.0	13.93	137.6	14.02	137.2	14.12	136.6	14.26	131.8	13.90
	17.0	15.0	141.2	13.67	140.6	13.81	139.8	14.00	139.4	14.09	139.0	14.19	138.4	14.33	131.8	13.76
	23.0	21.2	152.6	14.07	152.0	14.24	151.0	14.43	150.6	14.54	150.2	14.64	145.2	14.26	131.8	12.88
	26.6	24.8	159.2	14.31	158.6	14.47	157.6	14.69	157.2	14.78	155.4	14.74	145.2	13.74	131.8	12.43
	30.2	28.4	166.0	14.54	165.2	14.71	164.2	14.93	162.0	14.83	155.4	14.19	145.2	13.24	131.8	11.98
	32.0	30.2	169.2	14.66	168.4	14.83	167.4	15.04	162.0	14.57	155.4	13.93	145.2	13.00	131.8	11.76
	35.6	33.8	176.0	14.88	175.0	15.07	168.6	14.66	162.0	14.05	155.4	13.43	145.2	12.52	131.8	11.34
	41.0	39.2	185.8	15.21	182.0	15.07	168.6	13.88	162.0	13.31	155.4	12.74	145.2	11.86	131.8	10.74
	47.0	43.0	192.2	15.38	182.0	14.50	168.6	13.38	162.0	12.81	155.4	12.26	145.2	11.43	131.8	10.36
	48.2	46.0	192.2	14.93	182.0	14.07	168.6	12.98	162.0	12.43	155.4	11.91	145.2	11.10	131.8	10.05
	53.6	51.1	192.2	14.19	182.0	13.38	168.6	12.33	162.0	11.81	155.4	11.31	145.2	10.55	131.8	9.55
	59.0	56.3	192.2	13.48	182.0	12.71	168.6	11.72	162.0	11.24	155.4	10.74	145.2	10.03	131.8	9.08
145.8 (90%)	-4.0	-5.3	104.6	12.43	104.0	12.52	103.4	12.64	103.2	12.71	102.8	12.79	102.4	12.88	101.8	13.00
	5.0	3.2	119.2	13.05	118.8	13.14	118.0	13.31	117.8	13.38	117.4	13.45	117.0	13.57	116.2	13.74
	10.4	8.6	128.8	13.43	128.2	13.55	127.6	13.71	127.2	13.81	126.8	13.90	126.4	14.02	118.6	13.24
	15.8	14.0	138.4	13.81	138.0	13.95	137.2	14.14	136.8	14.24	136.4	14.33	130.8	13.78	118.6	12.48
	17.0	15.0	140.4	13.88	139.8	14.02	139.0	14.21	138.6	14.31	138.2	14.40	130.8	13.64	118.6	12.36
	23.0	21.2	151.6	14.33	150.8	14.47	150.0	14.69	145.8	14.31	139.8	13.69	130.8	12.79	118.6	11.57
	26.6	24.8	158.0	14.59	157.4	14.74	151.8	14.38	145.8	13.78	139.8	13.19	130.8	12.31	118.6	11.15
	30.2	28.4	164.6	14.85	163.8	15.00	151.8	13.86	145.8	13.29	139.8	12.71	130.8	11.86	118.6	10.77
	32.0	30.2	167.8	14.97	163.8	14.74	151.8	13.59	145.8	13.05	139.8	12.48	130.8	11.65	118.6	10.58
	35.6	33.8	173.0	15.04	163.8	14.21	151.8	13.12	145.8	12.57	139.8	12.05	130.8	11.24	118.6	10.20
	41.0	39.2	173.0	14.26	163.8	13.48	151.8	12.43	145.8	11.91	139.8	11.41	130.8	10.65	118.6	9.67
	47.0	43.0	173.0	13.74	163.8	12.95	151.8	11.98	145.8	11.48	139.8	10.98	130.8	10.27	118.6	9.32
	48.2	46.0	173.0	13.33	163.8	12.57	151.8	11.62	145.8	11.15	139.8	10.67	130.8	9.96	118.6	9.05
	53.6	51.1	173.0	12.67	163.8	11.95	151.8	11.05	145.8	10.60	139.8	10.15	130.8	9.48	118.6	8.60
	59.0	56.3	173.0	12.03	163.8	11.36	151.8	10.50	145.8	10.08	139.8	9.65	130.8	9.01	118.6	8.18
129.6 (80%)	-4.0	-5.3	103.8	12.57	103.4	12.67	102.8	12.79	102.6	12.86	102.2	12.93	101.8	13.02	101.2	13.14
	5.0	3.2	118.4	13.21	118.0	13.33	117.2	13.50	117.0	13.57	116.6	13.64	116.2	13.76	105.6	12.48
	10.4	8.6	127.8	13.64	127.4	13.78	126.6	13.95	126.2	14.02	124.2	13.88	116.2	12.95	105.6	11.74
	15.8	14.0	137.4	14.07	136.8	14.21	135.0	14.26	129.6	13.67	124.2	13.10	116.2	12.22	105.6	11.08
	17.0	15.0	139.2	14.16	138.6	14.31	135.0	14.09	129.6	13.52	124.2	12.95	116.2	12.10	105.6	10.96
	23.0	21.2	150.2	14.64	145.6	14.28	135.0	13.19	129.6	12.67	124.2	12.12	116.2	11.34	105.6	10.29
	26.6	24.8	153.8	14.57	145.6	13.76	135.0	12.71	129.6	12.19	124.2	11.69	116.2	10.93	105.6	9.91
	30.2	28.4	153.8	14.05	145.6	13.26	135.0	12.26	129.6	11.76	124.2	11.27	116.2	10.53	105.6	9.55
	32.0	30.2	153.8	13.78	145.6	13.02	135.0	12.05	129.6	11.55	124.2	11.08	116.2	10.34	105.6	9.39
	35.6	33.8	153.8	13.29	145.6	12.57	135.0	11.62	129.6	11.15	124.2	10.67	116.2	9.98	105.6	9.05
	41.0	39.2	153.8	12.60	145.6	11.91	135.0	11.00	129.6	10.55	124.2	10.12	116.2	9.46	105.6	8.60
	47.0	43.0	153.8	12.12	145.6	11.46	135.0	10.60	129.6	10.17	124.2	9.74	116.2	9.13	105.6	8.29
	48.2	46.0	153.8	11.76	145.6	11.12	135.0	10.29	129.6	9.89	124.2	9.46	116.2	8.86	105.6	8.06
	53.6	51.1	153.8	11.19	145.6	10.58	135.0	9.79	129.6	9.39	124.2	9.01	116.2	8.44	105.6	7.68
	59.0	56.3	153.8	10.62	145.6	10.05	135.0	9.29	129.6	8.94	124.2	8.56	116.2	8.01	105.6	7.30
113.4 (70%)	-4.0	-5.3	103.0	12.74	102.6	12.83	102.0	12.98	101.8	13.02	101.4	13.10	101.0	13.19	92.4	12.07
	5.0	3.2	117.4	13.48	117.0	13.57	116.2	13.74	113.4	13.43	108.8	12.86	101.6	12.03	92.4	10.93
	10.4	8.6	126.6	13.93	126.2	14.07	118.0	13.17	113.4	12.64	108.8	12.12	101.6	11.31	92.4	10.29
	15.8	14.0	134.4	14.19	127.4	13.43	118.0	12.43	113.4	11.93	108.8	11.43	101.6	10.69	92.4	9.72
	17.0	15.0	134.4	14.05	127.4	13.29	118.0	12.29	113.4	11.79	108.8	11.31	101.6	10.58	92.4	9.60
	23.0	21.2	134.4	13.17	127.4	12.45	118.0	11.53	113.4	11.05	108.8	10.60	101.6	9.91	92.4	9.01
	26.6	24.8	134.4	12.67	127.4	12.00	118.0	11.10	113.4	10.65	108.8	10.22	101.6	9.55	92.4	8.70
	30.2	28.4	134.4	12.22	127.4	11.55	118.0	10.69	113.4	10.27	108.8	9.86	101.6	9.22	92.4	8.39
	32.0	30.2	134.4	12.00	127.4	11.36	118.0	10.50	113.4	10.10	108.8	9.67	101.6	9.05	92.4	8.25
	35.6	33.8	134.4	11.57	127.4	10.96	118.0	10.15	113.4	9.74	108.8	9.34	101.6	8.75	92.4	7.96
	41.0	39.2	134.4	10.96	127.4	10.39	118.0	9.63	113.4	9.25	108.8	8.86	101.6	8.29	92.4	7.56
	47.0	43.0	134.4	10.55	127.4	10.01	118.0	9.27	113.4	8.89	108.8	8.53	101.6	7.99	92.4	7.30
	48.2	46.0	134.4	10.24	127.4	9.72	118.0	9.01	113.4	8.65	108.8	8.29	101.6	7.77	92.4	7.08
	53.6	51.1	134.4	9.74	127.4	9.25	118.0	8.56	113.4	8.22	108.8	7.89	101.6	7.39	92.4	6.75
	59.0	56.3	134.4	9.27	127.4	8.79	118.0	8.15	113.4	7.82	108.8	7.51	101.6	7.03	92.4	6.42
97.2 (60%)	-4.0	-5.3	102.0	12.98	101.6	13.07	101.0	13.19	97.2	12.71	93.2	12.17	87.2	11.38	79.2	10.36
	5.0	3.2	115.2	13.67	109.2	12.93	101.2	11.98	97.2	11.50	93.2	11.03	87.2	10.31	79.2	9.39
	10.4	8.6	115.2	12.86	109.2	12.17	101.2	11.27	97.2	10.84	93.2	10.39	87.2	9.72	79.2	8.84
	15.8	14.0	115.2	12.12	109.2	11.48	101.2	10.65	97.2	10.22	93.2	9.79	87.2	9.17	79.2	8.37
	17.0	15.0	115.2	12.00	109.2	11.36	101.2	10.53	97.2	10.10	93.2	9.70</				

Heating capacity at rated condition: 162 kBtu/h (12 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
81.0 (50%)	-4.0	-5.3	96.0	12.55	91.0	11.91	84.4	11.03	81.0	10.60	77.6	10.17	72.6	9.53	66.0	8.67
	5.0	3.2	96.0	11.36	91.0	10.77	84.4	9.98	81.0	9.60	77.6	9.22	72.6	8.65	66.0	7.89
	10.4	8.6	96.0	10.69	91.0	10.15	84.4	9.41	81.0	9.05	77.6	8.70	72.6	8.15	66.0	7.44
	15.8	14.0	96.0	10.10	91.0	9.58	84.4	8.89	81.0	8.56	77.6	8.22	72.6	7.70	66.0	7.03
	17.0	15.0	96.0	9.98	91.0	9.48	84.4	8.79	81.0	8.46	77.6	8.13	72.6	7.63	66.0	6.96
	23.0	21.2	96.0	9.36	91.0	8.89	84.4	8.27	81.0	7.94	77.6	7.63	72.6	7.18	66.0	6.56
	26.6	24.8	96.0	9.03	91.0	8.58	84.4	7.96	81.0	7.68	77.6	7.37	72.6	6.92	66.0	6.32
	30.2	28.4	96.0	8.72	91.0	8.27	84.4	7.70	81.0	7.42	77.6	7.11	72.6	6.68	66.0	6.11
	32.0	30.2	96.0	8.58	91.0	8.13	84.4	7.56	81.0	7.27	77.6	6.99	72.6	6.56	66.0	6.01
	35.6	33.8	96.0	8.27	91.0	7.84	84.4	7.30	81.0	7.03	77.6	6.75	72.6	6.35	66.0	5.82
	41.0	39.2	96.0	7.84	91.0	7.46	84.4	6.94	81.0	6.68	77.6	6.42	72.6	6.04	66.0	5.54
	47.0	43.0	96.0	7.56	91.0	7.20	84.4	6.68	81.0	6.44	77.6	6.20	72.6	5.82	66.0	5.35
	48.2	46.0	96.0	7.34	91.0	6.99	84.4	6.51	81.0	6.27	77.6	6.01	72.6	5.66	66.0	5.20
	53.6	51.1	96.0	7.01	91.0	6.65	84.4	6.20	81.0	5.97	77.6	5.75	72.6	5.39	66.0	4.97
	59.0	56.3	96.0	6.68	91.0	6.35	84.4	5.89	81.0	5.68	77.6	5.47	72.6	5.16	66.0	4.73

# Model: AOUA168RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 188 kBtu/h (14 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
282.0 (150%)	-4.0	-5.3	118.8	13.54	118.3	13.66	117.6	13.82	117.2	13.88	116.9	13.97	116.4	14.08	115.7	14.25
	5.0	3.2	137.1	14.06	136.6	14.19	135.8	14.38	135.4	14.47	135.0	14.57	134.5	14.71	133.7	14.89
	10.4	8.6	149.1	14.37	148.6	14.51	147.7	14.73	147.3	14.82	147.0	14.93	146.3	15.09	145.4	15.29
	15.8	14.0	161.4	14.68	160.8	14.84	159.9	15.07	159.5	15.18	159.1	15.30	158.4	15.46	157.5	15.67
	17.0	15.0	163.8	14.73	163.1	14.90	162.2	15.13	161.7	15.24	161.2	15.35	160.5	15.53	159.7	15.75
	23.0	21.2	178.2	15.08	177.5	15.26	176.4	15.50	175.9	15.63	175.4	15.75	174.6	15.94	173.6	16.18
	26.6	24.8	186.6	15.28	185.9	15.46	184.7	15.72	184.2	15.85	183.6	15.97	182.8	16.17	181.7	16.43
	30.2	28.4	195.3	15.46	194.4	15.66	193.2	15.93	192.5	16.06	192.0	16.19	191.1	16.39	189.9	16.66
	32.0	30.2	199.5	15.55	198.6	15.76	197.4	16.03	196.8	16.17	196.2	16.30	195.2	16.50	194.0	16.78
	35.6	33.8	208.0	15.75	207.1	15.95	205.8	16.23	205.2	16.37	204.5	16.51	203.5	16.72	202.1	17.01
	41.0	39.2	221.1	16.02	219.9	16.24	218.5	16.54	217.7	16.68	217.0	16.82	215.9	17.04	214.5	17.33
	47.0	43.0	230.2	16.20	229.1	16.43	227.5	16.73	226.7	16.88	225.9	17.02	224.7	17.25	223.1	17.55
	48.2	46.0	237.4	16.35	236.2	16.57	234.7	16.88	233.8	17.02	232.9	17.19	231.7	17.42	229.4	17.67
	53.6	51.1	249.8	16.57	248.5	16.80	246.6	17.12	245.7	17.28	244.8	17.44	243.4	17.67	229.6	16.77
	59.0	56.3	262.3	16.80	260.9	17.03	258.8	17.36	257.8	17.53	256.7	17.69	255.9	17.69	229.6	15.88
263.2 (140%)	-4.0	-5.3	118.6	13.60	118.1	13.72	117.4	13.87	117.0	13.94	116.7	14.03	116.1	14.14	115.3	14.30
	5.0	3.2	136.8	14.13	136.2	14.27	135.5	14.46	135.1	14.55	134.8	14.63	134.1	14.78	133.4	14.97
	10.4	8.6	148.8	14.46	148.2	14.61	147.3	14.82	147.0	14.91	146.5	15.02	145.9	15.19	145.1	15.39
	15.8	14.0	160.9	14.79	160.4	14.96	159.6	15.18	159.1	15.29	158.6	15.40	157.9	15.56	157.0	15.78
	17.0	15.0	163.3	14.84	162.6	15.01	161.7	15.24	161.2	15.35	160.8	15.46	160.1	15.64	159.2	15.86
	23.0	21.2	177.7	15.21	176.9	15.40	175.9	15.64	175.4	15.75	174.8	15.88	174.1	16.06	173.0	16.31
	26.6	24.8	186.0	15.41	185.2	15.61	184.1	15.86	183.6	15.99	183.0	16.12	182.2	16.31	181.0	16.57
	30.2	28.4	194.6	15.63	193.7	15.83	192.5	16.08	191.8	16.22	191.3	16.35	190.4	16.56	189.2	16.82
	32.0	30.2	198.7	15.72	197.7	15.92	196.6	16.19	196.1	16.34	195.4	16.46	194.5	16.67	193.2	16.93
	35.6	33.8	207.3	15.92	206.3	16.14	205.0	16.41	204.3	16.55	203.6	16.68	202.6	16.90	201.3	17.18
	41.0	39.2	220.0	16.20	219.0	16.43	217.5	16.72	216.7	16.87	216.1	17.01	215.0	17.23	213.2	17.51
	47.0	43.0	229.1	16.40	228.0	16.64	226.4	16.93	225.6	17.08	224.8	17.24	223.6	17.46	214.3	16.93
	48.2	46.0	236.2	16.57	235.0	16.79	233.4	17.10	232.6	17.24	231.7	17.41	230.5	17.64	214.3	16.39
	53.6	51.1	248.5	16.81	247.1	17.06	245.2	17.36	244.3	17.53	243.4	17.67	236.0	17.30	214.3	15.55
	59.0	56.3	260.7	17.06	259.2	17.29	257.2	17.62	256.2	17.78	255.2	17.85	236.0	16.38	214.3	14.72
244.4 (130%)	-4.0	-5.3	118.3	13.67	117.7	13.78	117.0	13.94	116.7	14.02	116.3	14.09	115.8	14.21	115.1	14.36
	5.0	3.2	136.4	14.23	135.9	14.36	135.1	14.55	134.8	14.63	134.3	14.73	133.8	14.88	133.0	15.05
	10.4	8.6	148.4	14.57	147.7	14.72	147.0	14.92	146.5	15.02	146.1	15.13	145.4	15.28	144.7	15.50
	15.8	14.0	160.5	14.91	159.8	15.08	159.0	15.30	158.6	15.41	158.2	15.52	157.5	15.70	156.5	15.92
	17.0	15.0	162.8	14.98	162.1	15.14	161.2	15.38	160.7	15.49	160.3	15.60	159.7	15.77	158.8	15.99
	23.0	21.2	177.1	15.36	176.2	15.54	175.3	15.80	174.8	15.92	174.3	16.03	173.4	16.23	172.4	16.47
	26.6	24.8	185.3	15.57	184.5	15.77	183.4	16.03	182.9	16.16	182.2	16.28	181.5	16.48	180.3	16.73
	30.2	28.4	193.7	15.81	192.8	15.99	191.6	16.26	191.1	16.39	190.4	16.54	189.5	16.73	188.3	16.99
	32.0	30.2	197.9	15.92	197.1	16.12	195.8	16.38	195.2	16.51	194.6	16.65	193.6	16.85	192.4	17.12
	35.6	33.8	206.3	16.13	205.3	16.34	204.0	16.61	203.3	16.76	202.7	16.89	201.7	17.10	198.9	17.23
	41.0	39.2	218.9	16.44	217.8	16.66	216.3	16.94	215.7	17.10	215.0	17.24	213.8	17.46	198.9	16.25
	47.0	43.0	227.9	16.65	226.7	16.88	225.1	17.17	224.3	17.32	223.5	17.48	219.1	17.35	198.9	15.61
	48.2	46.0	235.0	16.82	233.7	17.04	232.1	17.35	231.2	17.50	230.3	17.65	219.1	16.81	198.9	15.12
	53.6	51.1	246.8	17.09	245.5	17.33	243.6	17.64	242.7	17.78	234.4	17.15	219.1	15.94	198.9	14.34
	59.0	56.3	258.9	17.34	257.4	17.60	254.4	17.82	244.4	17.02	234.4	16.25	219.1	15.09	198.9	13.58
225.6 (120%)	-4.0	-5.3	117.9	13.74	117.4	13.85	116.7	14.02	116.3	14.09	116.0	14.16	115.5	14.28	114.8	14.44
	5.0	3.2	136.0	14.31	135.5	14.46	134.7	14.65	134.3	14.73	133.9	14.82	133.4	14.97	132.5	15.17
	10.4	8.6	147.9	14.69	147.3	14.84	146.4	15.04	146.1	15.15	145.6	15.24	145.0	15.41	144.2	15.61
	15.8	14.0	159.9	15.05	159.3	15.23	158.4	15.44	158.0	15.55	157.5	15.66	156.8	15.83	155.9	16.06
	17.0	15.0	162.2	15.12	161.5	15.29	160.6	15.52	160.1	15.63	159.7	15.74	159.0	15.92	158.1	16.14
	23.0	21.2	176.3	15.54	175.5	15.72	174.5	15.96	174.0	16.08	173.4	16.22	172.7	16.39	171.6	16.65
	26.6	24.8	184.5	15.77	183.6	15.96	182.5	16.22	182.0	16.35	181.5	16.48	180.6	16.67	179.5	16.92
	30.2	28.4	192.8	16.02	191.9	16.22	190.7	16.47	190.2	16.61	189.5	16.73	188.6	16.93	183.6	16.77
	32.0	30.2	196.9	16.13	196.0	16.33	194.8	16.59	194.1	16.73	193.6	16.87	192.7	17.07	183.6	16.44
	35.6	33.8	205.2	16.36	204.2	16.57	202.9	16.85	202.2	16.98	201.5	17.12	200.5	17.33	183.6	15.81
	41.0	39.2	217.6	16.70	216.5	16.91	215.2	17.21	214.4	17.35	213.6	17.50	202.3	16.56	183.6	14.91
	47.0	43.0	226.4	16.93	225.2	17.15	223.6	17.44	222.9	17.60	216.3	17.11	202.3	15.91	183.6	14.33
	48.2	46.0	233.3	17.11	232.1	17.33	230.5	17.64	225.6	17.35	216.3	16.57	202.3	15.40	183.6	13.87
	53.6	51.1	245.0	17.40	243.6	17.64	235.0	17.21	225.6	16.45	216.3	15.70	202.3	14.59	183.6	13.15
	59.0	56.3	256.7	17.69	253.6	17.74	235.0	16.29	225.6	15.57	216.3	14.87	202.3	13.82	183.6	12.47
206.8 (110%)	-4.0	-5.3	117.5	13.83	117.0	13.95	116.3	14.09	116.0	14.18	115.6	14.25	115.1	14.36	114.4	14.52
	5.0	3.2	135.5	14.45	135.0	14.59	134.2	14.77	133.9	14.86	133.4	14.96	132.9	15.10	132.1	15.28
	10.4	8.6	147.3	14.83	146.6	14.99	145.9	15.19	145.4	15.30	145.0	15.40	144.4	15.55	143.6	15.75
	15.8	14.0	159.3	15.23	158.7	15.40	157.7	15.62	157.3	15.72	156.8	15.83	156.1	16.01	155.2	16.23
	17.0	15.0	161.5	15.31	160.8	15.46	159.9	15.68	159.5	<						

Heating capacity at rated condition: 188 kBTU/h (14 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
188.0 (100%)	-4.0	-5.3	117.0	13.93	116.5	14.04	115.8	14.20	115.5	14.28	115.1	14.35	114.6	14.47	113.9	14.63
	5.0	3.2	134.9	14.59	134.4	14.72	133.6	14.91	133.2	15.01	132.8	15.10	132.3	15.24	131.5	15.42
	10.4	8.6	146.6	15.01	145.9	15.17	145.2	15.36	144.7	15.46	144.3	15.57	143.7	15.72	142.9	15.94
	15.8	14.0	158.5	15.43	157.8	15.60	156.9	15.82	156.4	15.93	156.0	16.05	155.3	16.22	152.4	16.18
	17.0	15.0	160.6	15.51	159.9	15.67	159.1	15.91	158.6	16.02	158.2	16.13	157.5	16.30	153.0	16.09
	23.0	21.2	174.4	15.99	173.6	16.18	172.6	16.41	172.1	16.55	171.6	16.67	168.6	16.59	153.0	14.97
	26.6	24.8	182.3	16.27	181.5	16.47	180.4	16.71	179.9	16.83	178.7	16.89	168.6	15.93	153.0	14.39
	30.2	28.4	190.4	16.55	189.5	16.75	188.3	17.01	186.9	17.04	180.3	16.44	168.6	15.31	153.0	13.83
	32.0	30.2	194.4	16.69	193.4	16.89	192.2	17.15	188.0	16.86	180.3	16.10	168.6	15.01	153.0	13.55
	35.6	33.8	202.4	16.96	201.3	17.17	195.8	16.93	188.0	16.20	180.3	15.49	168.6	14.42	153.0	13.03
	41.0	39.2	214.3	17.35	211.3	17.36	195.8	15.97	188.0	15.30	180.3	14.62	168.6	13.61	153.0	12.30
	47.0	43.0	222.3	17.61	211.3	16.67	195.8	15.35	188.0	14.69	180.3	14.05	168.6	13.08	153.0	11.83
	48.2	46.0	223.0	17.13	211.3	16.15	195.8	14.87	188.0	14.23	180.3	13.61	168.6	12.68	153.0	11.46
	53.6	51.1	223.0	16.24	211.3	15.31	195.8	14.09	188.0	13.49	180.3	12.90	168.6	12.02	153.0	10.87
	59.0	56.3	223.0	15.38	211.3	14.50	195.8	13.34	188.0	12.79	180.3	12.21	168.6	11.39	153.0	10.29
169.2 (90%)	-4.0	-5.3	116.5	14.06	115.9	14.17	115.2	14.33	114.9	14.40	114.5	14.48	114.0	14.60	113.3	14.75
	5.0	3.2	134.2	14.77	133.7	14.90	132.8	15.09	132.5	15.18	132.1	15.26	131.6	15.41	130.7	15.61
	10.4	8.6	145.7	15.22	145.1	15.38	144.3	15.57	143.9	15.68	143.4	15.78	142.9	15.94	137.7	15.56
	15.8	14.0	157.4	15.67	156.8	15.85	155.9	16.07	155.5	16.18	155.0	16.29	151.8	16.14	137.7	14.58
	17.0	15.0	159.7	15.76	159.0	15.93	158.1	16.16	157.6	16.27	157.2	16.38	151.8	15.95	137.7	14.41
	23.0	21.2	173.2	16.29	172.3	16.47	171.3	16.71	168.9	16.61	162.2	15.93	151.8	14.84	137.7	13.42
	26.6	24.8	180.9	16.60	180.1	16.78	176.2	16.69	169.2	15.99	162.2	15.29	151.8	14.25	137.7	12.89
	30.2	28.4	188.8	16.91	187.9	17.09	176.2	16.04	169.2	15.36	162.2	14.69	151.8	13.70	137.7	12.39
	32.0	30.2	192.7	17.06	190.2	17.07	176.2	15.72	169.2	15.07	162.2	14.40	151.8	13.43	137.7	12.16
	35.6	33.8	199.8	17.28	190.2	16.40	176.2	15.12	169.2	14.48	162.2	13.86	151.8	12.92	137.7	11.69
	41.0	39.2	200.7	16.41	190.2	15.49	176.2	14.27	169.2	13.66	162.2	13.08	151.8	12.19	137.7	11.04
	47.0	43.0	200.7	15.76	190.2	14.87	176.2	13.71	169.2	13.13	162.2	12.56	151.8	11.72	137.7	10.61
	48.2	46.0	200.7	15.28	190.2	14.40	176.2	13.29	169.2	12.72	162.2	12.18	151.8	11.35	137.7	10.29
	53.6	51.1	200.7	14.47	190.2	13.65	176.2	12.59	169.2	12.07	162.2	11.55	151.8	10.77	137.7	9.76
	59.0	56.3	200.7	13.71	190.2	12.93	176.2	11.93	169.2	11.44	162.2	10.94	151.8	10.20	137.7	9.24
150.4 (80%)	-4.0	-5.3	115.7	14.21	115.2	14.34	114.5	14.48	114.2	14.56	113.8	14.65	113.3	14.76	112.6	14.91
	5.0	3.2	133.3	14.98	132.8	15.12	131.9	15.31	131.6	15.40	131.2	15.49	130.7	15.63	122.5	14.75
	10.4	8.6	144.6	15.47	144.1	15.64	143.2	15.84	142.8	15.94	141.5	15.93	134.9	15.23	122.5	13.77
	15.8	14.0	156.2	15.98	155.5	16.15	154.1	16.30	150.4	15.99	144.2	15.30	134.9	14.27	122.5	12.91
	17.0	15.0	158.4	16.08	157.7	16.26	155.4	16.29	150.4	15.81	144.2	15.12	134.9	14.10	122.5	12.76
	23.0	21.2	171.6	16.66	168.8	16.60	156.7	15.34	150.4	14.71	144.2	14.07	134.9	13.13	122.5	11.89
	26.6	24.8	177.9	16.83	169.0	15.97	156.7	14.73	150.4	14.12	144.2	13.52	134.9	12.62	122.5	11.43
	30.2	28.4	178.5	16.26	169.0	15.34	156.7	14.16	150.4	13.57	144.2	12.99	134.9	12.13	122.5	10.99
	32.0	30.2	178.5	15.94	169.0	15.04	156.7	13.88	150.4	13.31	144.2	12.74	134.9	11.88	122.5	10.78
	35.6	33.8	178.5	15.32	169.0	14.47	156.7	13.35	150.4	12.80	144.2	12.25	134.9	11.44	122.5	10.37
	41.0	39.2	178.5	14.46	169.0	13.66	156.7	12.60	150.4	12.08	144.2	11.57	134.9	10.80	122.5	9.80
	47.0	43.0	178.5	13.88	169.0	13.12	156.7	12.11	150.4	11.62	144.2	11.12	134.9	10.39	122.5	9.42
	48.2	46.0	178.5	13.45	169.0	12.71	156.7	11.74	150.4	11.26	144.2	10.78	134.9	10.07	122.5	9.13
	53.6	51.1	178.5	12.76	169.0	12.05	156.7	11.13	150.4	10.67	144.2	10.22	134.9	9.55	122.5	8.68
	59.0	56.3	178.5	12.08	169.0	11.42	156.7	10.54	150.4	10.11	144.2	9.68	134.9	9.05	122.5	8.22
131.6 (70%)	-4.0	-5.3	114.8	14.41	114.3	14.54	113.6	14.69	113.3	14.76	112.9	14.84	112.4	14.96	107.2	14.44
	5.0	3.2	132.2	15.26	131.6	15.40	130.8	15.59	129.2	15.50	126.2	15.21	118.0	14.20	107.2	12.88
	10.4	8.6	143.3	15.82	142.7	15.97	137.0	15.49	131.6	14.84	126.2	14.21	118.0	13.26	107.2	12.04
	15.8	14.0	153.8	16.27	147.9	15.71	137.0	14.51	131.6	13.92	126.2	13.32	118.0	12.45	107.2	11.29
	17.0	15.0	155.1	16.27	147.9	15.52	137.0	14.34	131.6	13.74	126.2	13.16	118.0	12.29	107.2	11.15
	23.0	21.2	156.1	15.30	147.9	14.46	137.0	13.35	131.6	12.80	126.2	12.27	118.0	11.45	107.2	10.39
	26.6	24.8	156.1	14.68	147.9	13.88	137.0	12.82	131.6	12.29	126.2	11.78	118.0	11.01	107.2	9.99
	30.2	28.4	156.1	14.10	147.9	13.33	137.0	12.32	131.6	11.82	126.2	11.33	118.0	10.59	107.2	9.62
	32.0	30.2	156.1	13.84	147.9	13.08	137.0	12.08	131.6	11.60	126.2	11.11	118.0	10.38	107.2	9.43
	35.6	33.8	156.1	13.31	147.9	12.58	137.0	11.63	131.6	11.16	126.2	10.69	118.0	9.99	107.2	9.07
	41.0	39.2	156.1	12.56	147.9	11.88	137.0	10.99	131.6	10.54	126.2	10.10	118.0	9.44	107.2	8.59
	47.0	43.0	156.1	12.06	147.9	11.42	137.0	10.56	131.6	10.12	126.2	9.70	118.0	9.07	107.2	8.26
	48.2	46.0	156.1	11.68	147.9	11.06	137.0	10.24	131.6	9.83	126.2	9.42	118.0	8.81	107.2	8.00
	53.6	51.1	156.1	11.09	147.9	10.49	137.0	9.70	131.6	9.32	126.2	8.93	118.0	8.36	107.2	7.60
	59.0	56.3	156.1	10.51	147.9	9.95	137.0	9.21	131.6	8.83	126.2	8.47	118.0	7.93	107.2	7.21
112.8 (60%)	-4.0	-5.3	113.6	14.68	113.1	14.80	112.5	14.94	110.4	14.78	108.1	14.56	101.2	13.61	91.9	12.35
	5.0	3.2	130.2	15.57	126.7	15.30	117.5	14.14	112.8	13.56	108.1	13.00	101.2	12.14	91.9	11.02
	10.4	8.6	133.8	15.11	126.7	14.28	117.5	13.21	112.8	12.68	108.1	12.15	101.2	11.35	91.9	10.31
	15.8	14.0	133.8	14.15	126.7	13.39	117.5	12.39	112.8	11.88	108.1	11.39	101.2	10.64	91.9	9.68
	17.0	15.0	133.8</													

Heating capacity at rated condition: 188 kBtu/h (14 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
94.0 (50%)	-4.0	-5.3	109.7	14.70	105.6	14.23	97.9	13.16	94.0	12.63	90.1	12.11	84.3	11.33	76.6	10.30
	5.0	3.2	111.5	13.40	105.6	12.69	97.9	11.75	94.0	11.29	90.1	10.82	84.3	10.14	76.6	9.22
	10.4	8.6	111.5	12.52	105.6	11.86	97.9	10.99	94.0	10.56	90.1	10.12	84.3	9.48	76.6	8.63
	15.8	14.0	111.5	11.75	105.6	11.12	97.9	10.31	94.0	9.90	90.1	9.51	84.3	8.90	76.6	8.11
	17.0	15.0	111.5	11.61	105.6	11.00	97.9	10.19	94.0	9.79	90.1	9.40	84.3	8.80	76.6	8.02
	23.0	21.2	111.5	10.81	105.6	10.25	97.9	9.51	94.0	9.13	90.1	8.77	84.3	8.22	76.6	7.49
	26.6	24.8	111.5	10.39	105.6	9.86	97.9	9.14	94.0	8.79	90.1	8.43	84.3	7.90	76.6	7.21
	30.2	28.4	111.5	10.00	105.6	9.47	97.9	8.80	94.0	8.46	90.1	8.11	84.3	7.60	76.6	6.94
	32.0	30.2	111.5	9.82	105.6	9.30	97.9	8.63	94.0	8.29	90.1	7.96	84.3	7.46	76.6	6.82
	35.6	33.8	111.5	9.44	105.6	8.95	97.9	8.31	94.0	7.99	90.1	7.67	84.3	7.20	76.6	6.58
	41.0	39.2	111.5	8.92	105.6	8.47	97.9	7.86	94.0	7.56	90.1	7.26	84.3	6.81	76.6	6.23
	47.0	43.0	111.5	8.58	105.6	8.15	97.9	7.56	94.0	7.27	90.1	6.99	84.3	6.55	76.6	6.00
	48.2	46.0	111.5	8.32	105.6	7.89	97.9	7.34	94.0	7.06	90.1	6.78	84.3	6.36	76.6	5.83
	53.6	51.1	111.5	7.90	105.6	7.49	97.9	6.97	94.0	6.70	90.1	6.44	84.3	6.05	76.6	5.54
	59.0	56.3	111.5	7.51	105.6	7.12	97.9	6.61	94.0	6.37	90.1	6.11	84.3	5.75	76.6	5.26



# Model: AOUA192RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 216 kBtu/h (16 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
324.0 (150%)	-4.0	-5.3	148.1	15.36	146.9	15.45	145.4	15.58	144.6	15.63	143.8	15.70	142.7	15.79	141.2	15.92
	5.0	3.2	165.5	15.80	164.5	15.92	163.1	16.07	162.5	16.14	161.8	16.22	160.8	16.34	159.4	16.49
	10.4	8.6	177.5	16.07	176.6	16.20	175.3	16.37	174.6	16.45	174.0	16.54	173.1	16.67	171.8	16.85
	15.8	14.0	190.1	16.34	189.2	16.48	188.0	16.67	187.4	16.76	186.7	16.87	185.8	17.01	184.6	17.19
	17.0	15.0	192.5	16.39	191.6	16.53	190.4	16.72	189.7	16.83	189.1	16.92	188.2	17.07	187.0	17.26
	23.0	21.2	207.8	16.68	206.9	16.85	205.6	17.06	205.0	17.17	204.4	17.27	203.4	17.43	202.2	17.64
	26.6	24.8	216.9	16.86	216.0	17.03	214.7	17.25	214.1	17.36	213.4	17.47	212.5	17.64	211.2	17.86
	30.2	28.4	226.2	17.03	225.2	17.21	223.9	17.43	223.2	17.55	222.6	17.67	221.6	17.84	220.3	18.07
	32.0	30.2	231.0	17.11	229.9	17.30	228.5	17.53	227.9	17.65	227.2	17.77	226.2	17.94	224.9	18.18
	35.6	33.8	240.4	17.28	239.4	17.46	238.0	17.71	237.3	17.83	236.6	17.95	235.5	18.14	234.1	18.39
	41.0	39.2	255.0	17.52	253.8	17.72	252.3	17.98	251.5	18.10	250.7	18.23	249.5	18.43	247.9	18.68
	47.0	43.0	265.3	17.70	264.1	17.89	262.4	18.16	261.6	18.29	260.7	18.42	259.5	18.62	257.8	18.89
	48.2	46.0	273.6	17.83	272.3	18.03	270.5	18.30	269.6	18.43	268.7	18.57	267.4	18.77	263.8	18.87
	53.6	51.1	287.7	18.04	286.2	18.25	284.2	18.52	283.3	18.67	282.3	18.81	280.8	19.03	263.8	17.90
	59.0	56.3	302.0	18.26	300.5	18.47	298.3	18.76	297.2	18.91	296.0	19.05	290.5	18.90	263.8	16.97
302.4 (140%)	-4.0	-5.3	147.5	15.40	146.3	15.50	144.8	15.62	144.0	15.68	143.3	15.74	142.0	15.84	140.5	15.97
	5.0	3.2	164.9	15.86	163.8	15.98	162.5	16.13	161.8	16.21	161.2	16.28	160.2	16.40	158.9	16.56
	10.4	8.6	176.9	16.15	175.9	16.28	174.6	16.45	174.1	16.53	173.4	16.62	172.5	16.76	171.3	16.94
	15.8	14.0	189.4	16.43	188.6	16.57	187.4	16.76	186.8	16.87	186.1	16.96	185.2	17.10	184.0	17.29
	17.0	15.0	191.9	16.48	191.0	16.63	189.7	16.83	189.1	16.92	188.5	17.02	187.6	17.16	186.4	17.36
	23.0	21.2	207.1	16.81	206.1	16.97	204.9	17.17	204.3	17.28	203.6	17.39	202.7	17.54	201.4	17.76
	26.6	24.8	216.1	16.99	215.2	17.15	213.9	17.37	213.3	17.49	212.6	17.59	211.7	17.76	210.4	17.98
	30.2	28.4	225.4	17.18	224.4	17.35	223.1	17.57	222.4	17.69	221.8	17.80	220.8	17.98	219.5	18.21
	32.0	30.2	230.1	17.26	229.0	17.43	227.7	17.67	227.1	17.79	226.4	17.90	225.4	18.08	224.0	18.31
	35.6	33.8	239.6	17.44	238.5	17.62	237.1	17.87	236.4	17.98	235.6	18.10	234.6	18.29	233.1	18.54
	41.0	39.2	253.9	17.69	252.8	17.89	251.2	18.15	250.4	18.28	249.7	18.40	248.5	18.60	246.2	18.79
	47.0	43.0	264.2	17.88	262.9	18.07	261.2	18.34	260.4	18.47	259.5	18.61	258.3	18.81	246.2	18.05
	48.2	46.0	272.3	18.02	271.0	18.22	269.2	18.49	268.3	18.63	267.4	18.77	266.1	18.97	246.2	17.48
	53.6	51.1	286.2	18.25	284.7	18.46	282.8	18.74	281.8	18.88	280.8	19.03	271.2	18.46	246.2	16.58
	59.0	56.3	300.3	18.48	298.7	18.69	296.5	18.99	295.4	19.14	289.9	18.86	271.2	17.50	246.2	15.72
280.8 (130%)	-4.0	-5.3	146.8	15.47	145.6	15.56	144.0	15.68	143.3	15.74	142.5	15.81	141.4	15.90	139.9	16.02
	5.0	3.2	164.2	15.95	163.2	16.06	161.8	16.21	161.2	16.28	160.5	16.37	159.6	16.48	158.2	16.63
	10.4	8.6	176.2	16.24	175.2	16.38	174.0	16.54	173.4	16.62	172.8	16.71	171.8	16.85	170.6	17.03
	15.8	14.0	188.7	16.54	187.8	16.68	186.6	16.88	186.1	16.97	185.5	17.07	184.5	17.21	183.3	17.40
	17.0	15.0	191.2	16.60	190.3	16.74	189.1	16.94	188.4	17.04	187.8	17.13	186.9	17.28	185.7	17.47
	23.0	21.2	206.3	16.95	205.3	17.10	204.1	17.31	203.5	17.41	202.9	17.52	201.9	17.68	200.8	17.89
	26.6	24.8	215.3	17.13	214.4	17.30	213.1	17.52	212.5	17.63	211.8	17.74	210.9	17.91	209.6	18.13
	30.2	28.4	224.5	17.33	223.5	17.50	222.2	17.72	221.6	17.84	220.9	17.96	219.9	18.13	218.5	18.36
	32.0	30.2	229.2	17.43	228.2	17.60	226.8	17.84	226.1	17.95	225.4	18.07	224.4	18.24	223.1	18.48
	35.6	33.8	238.5	17.62	237.4	17.80	236.1	18.04	235.3	18.16	234.6	18.29	233.6	18.47	228.6	18.35
	41.0	39.2	252.7	17.89	251.6	18.09	250.0	18.34	249.2	18.47	248.4	18.60	247.2	18.80	228.6	17.32
	47.0	43.0	262.9	18.09	261.6	18.29	259.9	18.55	259.0	18.69	258.2	18.81	251.8	18.50	228.6	16.63
	48.2	46.0	270.8	18.25	269.6	18.45	267.8	18.72	266.9	18.85	265.9	18.98	251.8	17.92	228.6	16.12
	53.6	51.1	284.5	18.49	283.0	18.71	281.0	18.99	280.0	19.13	269.3	18.31	251.8	17.01	228.6	15.29
	59.0	56.3	298.3	18.74	296.7	18.96	292.4	19.05	280.8	18.19	269.3	17.35	251.8	16.10	228.6	14.50
259.2 (120%)	-4.0	-5.3	145.9	15.52	144.8	15.61	143.3	15.74	142.5	15.81	141.8	15.86	140.7	15.96	139.2	16.09
	5.0	3.2	163.4	16.03	162.4	16.14	161.2	16.30	160.5	16.37	159.8	16.45	158.8	16.57	157.5	16.72
	10.4	8.6	175.5	16.35	174.5	16.48	173.2	16.65	172.6	16.74	172.0	16.82	171.0	16.96	169.9	17.13
	15.8	14.0	188.0	16.67	187.1	16.82	185.8	17.00	185.2	17.10	184.6	17.19	183.7	17.33	182.5	17.52
	17.0	15.0	190.3	16.72	189.4	16.88	188.2	17.07	187.6	17.16	187.0	17.26	186.1	17.40	184.9	17.60
	23.0	21.2	205.3	17.10	204.4	17.25	203.3	17.46	202.7	17.56	202.0	17.68	201.1	17.83	199.8	18.04
	26.6	24.8	214.4	17.30	213.4	17.47	212.1	17.69	211.5	17.80	210.9	17.91	209.9	18.08	208.6	18.30
	30.2	28.4	223.4	17.52	222.4	17.69	221.1	17.91	220.5	18.03	219.8	18.14	218.8	18.31	211.0	17.84
	32.0	30.2	228.0	17.62	227.0	17.79	225.7	18.02	225.0	18.14	224.4	18.26	223.3	18.43	211.0	17.50
	35.6	33.8	237.3	17.82	236.3	18.00	234.8	18.24	234.1	18.37	233.4	18.49	232.2	18.67	211.0	16.83
	41.0	39.2	251.4	18.13	250.2	18.31	248.6	18.57	247.9	18.70	247.0	18.83	232.5	17.64	211.0	15.88
	47.0	43.0	261.2	18.34	260.0	18.54	258.3	18.79	257.5	18.93	248.5	18.23	232.5	16.95	211.0	15.26
	48.2	46.0	269.1	18.50	267.8	18.70	266.1	18.97	259.2	18.51	248.5	17.66	232.5	16.41	211.0	14.79
	53.6	51.1	282.5	18.77	281.0	18.99	269.9	18.37	259.2	17.55	248.5	16.75	232.5	15.57	211.0	14.03
	59.0	56.3	296.0	19.06	291.3	18.96	269.9	17.41	259.2	16.63	248.5	15.87	232.5	14.76	211.0	13.30
237.6 (110%)	-4.0	-5.3	145.0	15.60	143.9	15.70	142.3	15.82	141.7	15.88	140.9	15.94	139.8	16.03	138.3	16.16
	5.0	3.2	162.5	16.14	161.6	16.25	160.2	16.40	159.6	16.47	158.9	16.56	158.0	16.68	156.6	16.83
	10.4	8.6	174.5	16.48	173.5	16.60	172.3	16.78	171.7	16.87	171.1	16.96	170.2	17.08	168.9	17.25
	15.8	14.0	187.0	16.83	186.1	16.97	184.9	17.16	184.3	17.24	183.7	17.34	182.8	17.48	181.6	17.67
	17.0	15.0	189.4	16.89	188.5	17.03	187.3	17.22	186.7							

Heating capacity at rated condition: 216 kBTu/h (16 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
216.0 (100%)	-4.0	-5.3	143.9	15.69	142.8	15.78	141.3	15.91	140.6	15.97	139.8	16.03	138.7	16.12	137.3	16.25
	5.0	3.2	161.4	16.26	160.5	16.37	159.2	16.52	158.5	16.61	157.8	16.68	156.9	16.81	155.7	16.96
	10.4	8.6	173.4	16.62	172.4	16.76	171.3	16.93	170.6	17.01	170.0	17.10	169.1	17.23	167.9	17.41
	15.8	14.0	185.8	17.00	184.9	17.14	183.7	17.33	183.1	17.42	182.5	17.52	181.6	17.66	175.8	17.29
	17.0	15.0	188.2	17.07	187.3	17.21	186.1	17.40	185.5	17.50	184.9	17.59	184.0	17.74	175.8	17.09
	23.0	21.2	203.0	17.49	202.2	17.65	200.9	17.85	200.3	17.97	199.7	18.07	193.7	17.64	175.8	15.91
	26.6	24.8	211.8	17.74	210.9	17.90	209.6	18.12	209.1	18.23	207.1	18.20	193.7	16.94	175.8	15.30
	30.2	28.4	220.8	17.98	219.8	18.16	218.5	18.38	216.0	18.29	207.1	17.48	193.7	16.28	175.8	14.71
	32.0	30.2	225.2	18.11	224.2	18.28	222.9	18.51	216.0	17.94	207.1	17.14	193.7	15.96	175.8	14.42
	35.6	33.8	234.3	18.35	233.1	18.53	224.9	18.03	216.0	17.26	207.1	16.48	193.7	15.35	175.8	13.87
	41.0	39.2	247.7	18.71	242.7	18.50	224.9	17.02	216.0	16.29	207.1	15.57	193.7	14.49	175.8	13.10
	47.0	43.0	256.2	18.86	242.7	17.77	224.9	16.35	216.0	15.65	207.1	14.97	193.7	13.93	175.8	12.60
	48.2	46.0	256.2	18.27	242.7	17.22	224.9	15.84	216.0	15.17	207.1	14.50	193.7	13.51	175.8	12.21
	53.6	51.1	256.2	17.33	242.7	16.33	224.9	15.03	216.0	14.38	207.1	13.75	193.7	12.82	175.8	11.59
	59.0	56.3	256.2	16.42	242.7	15.48	224.9	14.24	216.0	13.64	207.1	13.04	193.7	12.15	175.8	10.99
194.4 (90%)	-4.0	-5.3	142.6	15.80	141.4	15.89	140.0	16.01	139.3	16.07	138.5	16.14	137.5	16.23	136.0	16.36
	5.0	3.2	160.1	16.42	159.2	16.52	157.8	16.68	157.3	16.75	156.6	16.84	155.7	16.95	154.4	17.11
	10.4	8.6	172.1	16.82	171.1	16.94	170.0	17.11	169.3	17.20	168.7	17.29	167.9	17.41	158.2	16.50
	15.8	14.0	184.4	17.21	183.6	17.35	182.4	17.54	181.8	17.64	181.2	17.73	174.3	17.13	158.2	15.48
	17.0	15.0	186.9	17.29	186.0	17.43	184.8	17.62	184.2	17.72	183.6	17.81	174.3	16.93	158.2	15.31
	23.0	21.2	201.6	17.75	200.6	17.90	199.4	18.12	194.4	17.70	186.4	16.93	174.3	15.78	158.2	14.26
	26.6	24.8	210.2	18.02	209.3	18.18	202.4	17.75	194.4	17.01	186.4	16.26	174.3	15.15	158.2	13.70
	30.2	28.4	219.0	18.30	218.0	18.46	202.4	17.07	194.4	16.34	186.4	15.63	174.3	14.57	158.2	13.19
	32.0	30.2	223.4	18.43	218.5	18.16	202.4	16.72	194.4	16.03	186.4	15.32	174.3	14.28	158.2	12.94
	35.6	33.8	230.6	18.52	218.5	17.47	202.4	16.09	194.4	15.41	186.4	14.75	174.3	13.75	158.2	12.45
	41.0	39.2	230.6	17.48	218.5	16.49	202.4	15.20	194.4	14.56	186.4	13.92	174.3	12.99	158.2	11.76
	47.0	43.0	230.6	16.80	218.5	15.84	202.4	14.61	194.4	13.99	186.4	13.38	174.3	12.49	158.2	11.31
	48.2	46.0	230.6	16.28	218.5	15.35	202.4	14.15	194.4	13.56	186.4	12.98	174.3	12.10	158.2	10.97
	53.6	51.1	230.6	15.44	218.5	14.57	202.4	13.43	194.4	12.87	186.4	12.32	174.3	11.49	158.2	10.42
	59.0	56.3	230.6	14.63	218.5	13.80	202.4	12.74	194.4	12.20	186.4	11.68	174.3	10.90	158.2	9.88
172.8 (80%)	-4.0	-5.3	140.9	15.93	139.8	16.03	138.4	16.15	137.8	16.21	137.0	16.28	136.0	16.37	134.6	16.49
	5.0	3.2	158.5	16.59	157.6	16.71	156.3	16.88	155.7	16.95	155.1	17.02	154.2	17.14	140.7	15.61
	10.4	8.6	170.4	17.04	169.6	17.17	168.3	17.34	167.7	17.42	165.6	17.32	154.9	16.14	140.7	14.62
	15.8	14.0	182.8	17.48	181.9	17.62	180.0	17.72	172.8	16.98	165.6	16.24	154.9	15.15	140.7	13.71
	17.0	15.0	185.1	17.57	184.2	17.71	180.0	17.51	172.8	16.78	165.6	16.05	154.9	14.98	140.7	13.55
	23.0	21.2	199.7	18.07	194.2	17.68	180.0	16.30	172.8	15.63	165.6	14.96	154.9	13.96	140.7	12.65
	26.6	24.8	205.0	17.99	194.2	16.99	180.0	15.66	172.8	15.01	165.6	14.37	154.9	13.42	140.7	12.15
	30.2	28.4	205.0	17.30	194.2	16.32	180.0	15.06	172.8	14.43	165.6	13.82	154.9	12.90	140.7	11.69
	32.0	30.2	205.0	16.96	194.2	16.00	180.0	14.78	172.8	14.15	165.6	13.56	154.9	12.65	140.7	11.47
	35.6	33.8	205.0	16.30	194.2	15.40	180.0	14.21	172.8	13.62	165.6	13.04	154.9	12.17	140.7	11.04
	41.0	39.2	205.0	15.40	194.2	14.55	180.0	13.42	172.8	12.87	165.6	12.33	154.9	11.51	140.7	10.45
	47.0	43.0	205.0	14.80	194.2	13.97	180.0	12.90	172.8	12.38	165.6	11.84	154.9	11.07	140.7	10.05
	48.2	46.0	205.0	14.33	194.2	13.54	180.0	12.51	172.8	12.00	165.6	11.48	154.9	10.74	140.7	9.75
	53.6	51.1	205.0	13.60	194.2	12.85	180.0	11.87	172.8	11.38	165.6	10.91	154.9	10.20	140.7	9.26
	59.0	56.3	205.0	12.90	194.2	12.18	180.0	11.26	172.8	10.81	165.6	10.35	154.9	9.67	140.7	8.80
151.2 (70%)	-4.0	-5.3	138.9	16.10	137.9	16.19	136.5	16.32	135.8	16.38	135.1	16.44	134.1	16.54	123.1	15.20
	5.0	3.2	156.6	16.85	155.7	16.96	154.4	17.11	151.2	16.83	145.0	16.10	135.5	15.04	123.1	13.63
	10.4	8.6	168.4	17.32	167.6	17.46	157.4	16.41	151.2	15.74	145.0	15.08	135.5	14.07	123.1	12.77
	15.8	14.0	179.3	17.65	169.9	16.67	157.4	15.40	151.2	14.78	145.0	14.14	135.5	13.22	123.1	11.99
	17.0	15.0	179.3	17.44	169.9	16.48	157.4	15.22	151.2	14.60	145.0	13.98	135.5	13.06	123.1	11.85
	23.0	21.2	179.3	16.25	169.9	15.36	157.4	14.19	151.2	13.61	145.0	13.04	135.5	12.18	123.1	11.06
	26.6	24.8	179.3	15.61	169.9	14.76	157.4	13.63	151.2	13.08	145.0	12.54	135.5	11.71	123.1	10.65
	30.2	28.4	179.3	15.01	169.9	14.18	157.4	13.11	151.2	12.58	145.0	12.06	135.5	11.27	123.1	10.25
	32.0	30.2	179.3	14.72	169.9	13.91	157.4	12.86	151.2	12.35	145.0	11.82	135.5	11.06	123.1	10.05
	35.6	33.8	179.3	14.16	169.9	13.39	157.4	12.39	151.2	11.88	145.0	11.38	135.5	10.65	123.1	9.68
	41.0	39.2	179.3	13.37	169.9	12.65	157.4	11.70	151.2	11.23	145.0	10.77	135.5	10.08	123.1	9.16
	47.0	43.0	179.3	12.85	169.9	12.16	157.4	11.25	151.2	10.80	145.0	10.35	135.5	9.68	123.1	8.82
	48.2	46.0	179.3	12.46	169.9	11.79	157.4	10.92	151.2	10.48	145.0	10.04	135.5	9.40	123.1	8.56
	53.6	51.1	179.3	11.82	169.9	11.20	157.4	10.36	151.2	9.94	145.0	9.54	135.5	8.93	123.1	8.14
	59.0	56.3	179.3	11.22	169.9	10.63	157.4	9.83	151.2	9.44	145.0	9.06	135.5	8.48	123.1	7.73
129.6 (60%)	-4.0	-5.3	136.4	16.33	135.4	16.42	134.1	16.54	129.6	16.02	124.3	15.34	116.2	14.33	105.5	13.02
	5.0	3.2	153.6	17.11	145.6	16.18	135.0	14.97	129.6	14.36	124.3	13.76	116.2	12.87	105.5	11.69
	10.4	8.6	153.7	16.01	145.6	15.15	135.0	14.01	129.6	13.45	124.3	12.89	116.2	12.05	105.5	10.96
	15.8	14.0	153.7	15.02	145.6	14.21	135.0	13.16	129.6	12.63	124.3	12.10	116.2	11.32	105.5	10.31
	17.0															



Heating capacity at rated condition: 216 kBtu/h (16 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
108.0 (50%)	-4.0	-5.3	128.1	15.82	121.4	14.99	112.5	13.87	108.0	13.33	103.5	12.78	96.8	11.96	88.0	10.89
	5.0	3.2	128.1	14.19	121.4	13.44	112.5	12.45	108.0	11.96	103.5	11.48	96.8	10.76	88.0	9.80
	10.4	8.6	128.1	13.29	121.4	12.59	112.5	11.67	108.0	11.22	103.5	10.77	96.8	10.09	88.0	9.19
	15.8	14.0	128.1	12.48	121.4	11.82	112.5	10.97	108.0	10.55	103.5	10.13	96.8	9.48	88.0	8.65
	17.0	15.0	128.1	12.34	121.4	11.69	112.5	10.84	108.0	10.42	103.5	10.00	96.8	9.38	88.0	8.56
	23.0	21.2	128.1	11.51	121.4	10.91	112.5	10.14	108.0	9.73	103.5	9.34	96.8	8.78	88.0	8.02
	26.6	24.8	128.1	11.07	121.4	10.50	112.5	9.74	108.0	9.37	103.5	9.00	96.8	8.44	88.0	7.71
	30.2	28.4	128.1	10.65	121.4	10.10	112.5	9.38	108.0	9.03	103.5	8.66	96.8	8.14	88.0	7.43
	32.0	30.2	128.1	10.46	121.4	9.91	112.5	9.20	108.0	8.85	103.5	8.51	96.8	7.99	88.0	7.30
	35.6	33.8	128.1	10.07	121.4	9.54	112.5	8.87	108.0	8.54	103.5	8.20	96.8	7.69	88.0	7.05
	41.0	39.2	128.1	9.52	121.4	9.04	112.5	8.40	108.0	8.09	103.5	7.76	96.8	7.30	88.0	6.68
	47.0	43.0	128.1	9.16	121.4	8.70	112.5	8.09	108.0	7.78	103.5	7.48	96.8	7.03	88.0	6.44
	48.2	46.0	128.1	8.89	121.4	8.44	112.5	7.86	108.0	7.56	103.5	7.26	96.8	6.83	88.0	6.26
	53.6	51.1	128.1	8.46	121.4	8.03	112.5	7.47	108.0	7.19	103.5	6.92	96.8	6.50	88.0	5.97
	59.0	56.3	128.1	8.04	121.4	7.63	112.5	7.10	108.0	6.84	103.5	6.58	96.8	6.19	88.0	5.68

# Model: AOUA216RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 243 kBtu/h (18 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
364.5 (150%)	-4.0	-5.3	160.9	18.41	159.6	18.53	158.0	18.69	157.2	18.76	156.3	18.86	155.1	18.98	153.5	19.14
	5.0	3.2	181.5	18.96	180.4	19.11	179.0	19.32	178.2	19.42	177.5	19.51	176.4	19.67	175.0	19.87
	10.4	8.6	195.6	19.31	194.6	19.48	193.2	19.70	192.5	19.81	191.8	19.92	190.8	20.10	189.4	20.32
	15.8	14.0	210.4	19.66	209.3	19.84	208.0	20.08	207.3	20.20	206.6	20.34	205.6	20.51	204.3	20.76
	17.0	15.0	213.2	19.72	212.2	19.90	210.9	20.16	210.1	20.28	209.4	20.40	208.4	20.60	207.1	20.84
	23.0	21.2	230.9	20.10	229.9	20.30	228.5	20.58	227.8	20.71	227.1	20.85	226.1	21.05	224.7	21.34
	26.6	24.8	241.5	20.32	240.5	20.54	239.0	20.82	238.3	20.96	237.6	21.10	236.5	21.33	235.1	21.61
	30.2	28.4	252.3	20.54	251.2	20.77	249.7	21.06	248.9	21.21	248.2	21.36	247.1	21.58	245.6	21.88
	32.0	30.2	257.8	20.64	256.6	20.87	255.1	21.18	254.3	21.34	253.6	21.48	252.4	21.71	250.9	22.01
	35.6	33.8	268.7	20.86	267.6	21.09	265.9	21.41	265.2	21.57	264.4	21.73	263.1	21.96	261.5	22.29
	41.0	39.2	285.5	21.18	284.1	21.43	282.4	21.76	281.6	21.92	280.7	22.08	279.3	22.34	277.5	22.66
	47.0	43.0	297.3	21.40	296.0	21.64	294.1	21.99	293.1	22.16	292.2	22.33	290.8	22.59	288.9	22.93
	48.2	46.0	306.9	21.57	305.4	21.82	303.4	22.17	302.4	22.34	301.4	22.52	299.9	22.78	296.6	23.00
	53.6	51.1	323.0	21.83	321.4	22.11	319.1	22.46	318.1	22.64	317.0	22.82	315.3	23.10	296.8	21.79
	59.0	56.3	339.5	22.12	337.8	22.39	335.3	22.76	334.0	22.95	332.7	23.13	326.9	23.00	296.8	20.62
340.2 (140%)	-4.0	-5.3	160.3	18.46	159.0	18.60	157.4	18.74	156.6	18.83	155.8	18.91	154.5	19.04	152.8	19.21
	5.0	3.2	180.8	19.05	179.7	19.21	178.3	19.40	177.6	19.50	176.9	19.60	175.8	19.76	174.4	19.96
	10.4	8.6	194.9	19.42	193.9	19.58	192.5	19.81	191.9	19.91	191.1	20.03	190.2	20.21	188.8	20.43
	15.8	14.0	209.6	19.78	208.7	19.96	207.4	20.20	206.7	20.32	205.9	20.44	204.9	20.64	203.6	20.88
	17.0	15.0	212.5	19.84	211.5	20.03	210.1	20.28	209.4	20.40	208.8	20.52	207.8	20.71	206.4	20.97
	23.0	21.2	230.1	20.25	229.1	20.45	227.7	20.73	227.0	20.86	226.3	21.00	225.3	21.20	223.9	21.48
	26.6	24.8	240.7	20.48	239.6	20.69	238.2	20.98	237.5	21.13	236.8	21.26	235.7	21.48	234.2	21.77
	30.2	28.4	251.4	20.73	250.3	20.95	248.8	21.23	248.0	21.38	247.3	21.54	246.2	21.76	244.7	22.06
	32.0	30.2	256.9	20.83	255.6	21.05	254.1	21.36	253.4	21.52	252.6	21.66	251.5	21.88	250.0	22.19
	35.6	33.8	267.8	21.06	266.5	21.29	265.0	21.61	264.2	21.77	263.3	21.92	262.1	22.16	260.5	22.47
	41.0	39.2	284.3	21.39	283.0	21.64	281.3	21.97	280.3	22.14	279.5	22.30	278.2	22.55	275.9	22.84
	47.0	43.0	296.1	21.63	294.7	21.88	292.8	22.22	291.8	22.39	290.9	22.57	289.5	22.82	277.0	22.02
	48.2	46.0	305.4	21.81	303.9	22.06	302.0	22.41	300.9	22.59	299.9	22.77	298.4	23.03	277.0	21.30
	53.6	51.1	321.4	22.12	319.7	22.38	317.5	22.74	316.4	22.92	315.3	23.10	305.1	22.49	277.0	20.18
	59.0	56.3	337.6	22.40	335.7	22.68	333.3	23.05	332.0	23.23	326.2	22.95	305.1	21.27	277.0	19.09
315.9 (130%)	-4.0	-5.3	159.5	18.54	158.3	18.66	156.6	18.83	155.8	18.90	155.0	18.99	153.8	19.11	152.2	19.27
	5.0	3.2	180.1	19.15	179.0	19.29	177.6	19.50	176.9	19.60	176.1	19.70	175.1	19.85	173.7	20.05
	10.4	8.6	194.2	19.53	193.1	19.70	191.8	19.91	191.1	20.03	190.5	20.15	189.4	20.31	188.1	20.55
	15.8	14.0	208.9	19.92	207.9	20.10	206.6	20.35	205.9	20.46	205.3	20.59	204.2	20.78	202.8	21.02
	17.0	15.0	211.7	19.99	210.7	20.17	209.4	20.42	208.6	20.55	208.0	20.66	207.0	20.86	205.7	21.10
	23.0	21.2	229.3	20.42	228.2	20.62	226.9	20.89	226.2	21.03	225.5	21.17	224.4	21.38	223.1	21.64
	26.6	24.8	239.8	20.66	238.7	20.88	237.3	21.17	236.6	21.30	235.8	21.45	234.8	21.67	233.3	21.96
	30.2	28.4	250.4	20.93	249.3	21.14	247.8	21.43	247.1	21.58	246.3	21.74	245.2	21.96	243.6	22.25
	32.0	30.2	255.8	21.05	254.7	21.27	253.2	21.57	252.3	21.73	251.6	21.87	250.4	22.10	248.9	22.40
	35.6	33.8	266.5	21.28	265.4	21.53	263.8	21.83	262.9	21.99	262.2	22.15	261.0	22.39	257.2	22.45
	41.0	39.2	283.0	21.65	281.6	21.91	279.9	22.23	279.0	22.39	278.1	22.56	276.7	22.81	257.2	21.15
	47.0	43.0	294.6	21.90	293.1	22.16	291.2	22.50	290.3	22.66	289.3	22.83	288.3	22.58	257.2	20.28
	48.2	46.0	303.8	22.11	302.3	22.36	300.3	22.71	299.3	22.88	298.2	23.05	283.3	21.85	257.2	19.64
	53.6	51.1	319.4	22.42	317.8	22.70	315.5	23.05	314.4	23.22	302.9	22.30	283.3	20.69	257.2	18.59
	59.0	56.3	335.4	22.74	333.5	23.02	329.0	23.17	315.9	22.13	302.9	21.09	283.3	19.57	257.2	17.59
291.6 (120%)	-4.0	-5.3	158.6	18.62	157.4	18.73	155.8	18.90	155.0	18.99	154.2	19.06	153.0	19.20	151.4	19.35
	5.0	3.2	179.3	19.26	178.2	19.41	176.8	19.61	176.1	19.70	175.4	19.81	174.3	19.97	172.9	20.17
	10.4	8.6	193.4	19.66	192.4	19.84	191.0	20.06	190.3	20.18	189.6	20.27	188.6	20.45	187.3	20.67
	15.8	14.0	208.0	20.07	207.0	20.26	205.6	20.50	205.0	20.63	204.3	20.75	203.3	20.93	202.0	21.18
	17.0	15.0	210.8	20.15	209.8	20.34	208.5	20.59	207.8	20.70	207.1	20.83	206.1	21.02	204.8	21.27
	23.0	21.2	228.3	20.62	227.2	20.82	225.9	21.08	225.2	21.22	224.5	21.37	223.5	21.57	222.1	21.84
	26.6	24.8	238.7	20.88	237.6	21.09	236.2	21.38	235.5	21.52	234.8	21.67	233.7	21.88	232.3	22.17
	30.2	28.4	249.2	21.16	248.1	21.38	246.6	21.66	245.9	21.82	245.1	21.97	244.0	22.19	237.4	21.87
	32.0	30.2	254.5	21.28	253.4	21.51	251.9	21.81	251.1	21.97	250.4	22.12	249.2	22.34	237.4	21.43
	35.6	33.8	265.2	21.55	264.0	21.79	262.4	22.10	261.6	22.25	260.8	22.41	259.6	22.65	237.4	20.57
	41.0	39.2	281.4	21.95	280.1	22.19	278.3	22.52	277.4	22.69	276.5	22.85	261.5	21.55	237.4	19.38
	47.0	43.0	292.8	22.22	291.4	22.47	289.5	22.80	288.6	22.97	279.6	22.25	261.5	20.66	237.4	18.59
	48.2	46.0	301.8	22.43	300.3	22.69	298.4	23.03	291.6	22.57	279.6	21.54	261.5	20.00	237.4	17.99
	53.6	51.1	317.2	22.78	315.5	23.05	303.7	22.37	291.6	21.37	279.6	20.39	261.5	18.93	237.4	17.05
	59.0	56.3	332.7	23.14	327.8	23.08	303.7	21.16	291.6	20.21	279.6	19.28	261.5	17.91	237.4	16.13
267.3 (110%)	-4.0	-5.3	157.7	18.70	156.5	18.84	154.8	19.00	154.1	19.08	153.3	19.16	152.1	19.28	150.5	19.45
	5.0	3.2	178.3	19.40	177.3	19.54	175.9	19.74	175.2	19.84	174.4	19.94	173.4	20.10	172.0	20.29
	10.4	8.6	192.4	19.83	191.3	20.00	190.0	20.22	189.3	20.34	188.7	20.44	187.6	20.61	186.3	20.83
	15.8	14.0	206.9	20.27	206.0	20.45	204.6	20.69	204.0	20.81	203.3	20.94	202.3	21.13	201.0	21.37
	17.0	15.0	209.8	20.35	208.8	20.54	207.5	20.78	206.8	<						

Heating capacity at rated condition: 243 kBTu/h (18 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
243.0 (100%)	-4.0	-5.3	156.5	18.83	155.3	18.94	153.7	19.11	152.9	19.19	152.1	19.27	150.9	19.40	149.4	19.57
	5.0	3.2	177.2	19.55	176.2	19.69	174.7	19.90	174.0	20.01	173.3	20.10	172.3	20.26	170.9	20.46
	10.4	8.6	191.2	20.02	190.1	20.19	188.9	20.40	188.1	20.51	187.5	20.63	186.6	20.80	185.2	21.03
	15.8	14.0	205.7	20.49	204.7	20.67	203.4	20.91	202.7	21.03	202.1	21.17	201.1	21.35	197.2	21.24
	17.0	15.0	208.5	20.58	207.5	20.76	206.2	21.01	205.5	21.14	204.9	21.25	203.9	21.45	197.8	21.07
	23.0	21.2	225.7	21.13	224.7	21.33	223.4	21.59	222.7	21.74	222.0	21.87	218.0	21.68	197.8	19.54
	26.6	24.8	235.9	21.44	234.8	21.65	233.4	21.93	232.8	22.07	231.4	22.14	218.0	20.78	197.8	18.75
	30.2	28.4	246.2	21.75	245.1	21.98	243.6	22.27	241.9	22.30	233.0	21.43	218.0	19.94	197.8	17.99
	32.0	30.2	251.4	21.92	250.2	22.14	248.7	22.44	243.0	21.98	233.0	20.99	218.0	19.53	197.8	17.63
	35.6	33.8	261.8	22.23	260.5	22.45	253.1	22.06	243.0	21.10	233.0	20.16	218.0	18.75	197.8	16.93
	41.0	39.2	277.3	22.70	273.1	22.61	253.1	20.78	243.0	19.88	233.0	18.99	218.0	17.67	197.8	15.95
	47.0	43.0	287.5	22.95	273.1	21.68	253.1	19.93	243.0	19.07	233.0	18.23	218.0	16.95	197.8	15.31
	48.2	46.0	288.2	22.27	273.1	20.99	253.1	19.29	243.0	18.46	233.0	17.64	218.0	16.42	197.8	14.83
	53.6	51.1	288.2	21.08	273.1	19.87	253.1	18.27	243.0	17.48	233.0	16.70	218.0	15.55	197.8	14.05
	59.0	56.3	288.2	19.94	273.1	18.80	253.1	17.28	243.0	16.54	233.0	15.80	218.0	14.72	197.8	13.29
218.7 (90%)	-4.0	-5.3	155.1	18.96	153.9	19.08	152.4	19.25	151.6	19.32	150.8	19.41	149.7	19.53	148.1	19.70
	5.0	3.2	175.8	19.74	174.8	19.89	173.3	20.09	172.7	20.19	172.0	20.29	171.0	20.44	169.6	20.65
	10.4	8.6	189.8	20.25	188.8	20.42	187.5	20.64	186.8	20.76	186.1	20.86	185.2	21.03	178.0	20.42
	15.8	14.0	204.2	20.76	203.2	20.95	201.9	21.19	201.3	21.32	200.6	21.43	196.1	21.14	178.0	19.08
	17.0	15.0	207.0	20.86	206.0	21.04	204.7	21.29	204.0	21.42	203.4	21.54	196.1	20.87	178.0	18.85
	23.0	21.2	224.1	21.45	223.0	21.65	221.6	21.93	218.4	21.73	209.7	20.81	196.1	19.38	178.0	17.50
	26.6	24.8	234.1	21.80	233.0	22.01	227.7	21.79	218.7	20.87	209.7	19.94	196.1	18.56	178.0	16.78
	30.2	28.4	244.2	22.16	243.1	22.37	227.7	20.91	218.7	20.02	209.7	19.13	196.1	17.83	178.0	16.11
	32.0	30.2	249.3	22.33	245.9	22.26	227.7	20.48	218.7	19.62	209.7	18.74	196.1	17.47	178.0	15.79
	35.6	33.8	258.5	22.57	245.9	21.37	227.7	19.67	218.7	18.83	209.7	18.01	196.1	16.78	178.0	15.17
	41.0	39.2	259.4	21.35	245.9	20.12	227.7	18.53	218.7	17.74	209.7	16.96	196.1	15.81	178.0	14.29
	47.0	43.0	259.4	20.47	245.9	19.31	227.7	17.77	218.7	17.02	209.7	16.28	196.1	15.17	178.0	13.73
	48.2	46.0	259.4	19.83	245.9	18.69	227.7	17.21	218.7	16.48	209.7	15.77	196.1	14.70	178.0	13.29
	53.6	51.1	259.4	18.76	245.9	17.70	227.7	16.30	218.7	15.61	209.7	14.94	196.1	13.92	178.0	12.61
	59.0	56.3	259.4	17.75	245.9	16.74	227.7	15.42	218.7	14.78	209.7	14.14	196.1	13.18	178.0	11.93
194.4 (80%)	-4.0	-5.3	153.4	19.12	152.2	19.26	150.7	19.42	150.0	19.49	149.2	19.59	148.1	19.70	146.6	19.87
	5.0	3.2	174.1	19.98	173.1	20.13	171.7	20.34	171.0	20.43	170.4	20.52	169.4	20.68	158.3	19.38
	10.4	8.6	188.0	20.54	187.1	20.70	185.7	20.93	185.1	21.04	183.7	21.05	174.3	19.98	158.3	18.06
	15.8	14.0	202.4	21.10	201.4	21.28	199.9	21.49	194.4	20.95	186.4	20.02	174.3	18.67	158.3	16.88
	17.0	15.0	205.1	21.21	204.1	21.40	201.2	21.41	194.4	20.68	186.4	19.78	174.3	18.44	158.3	16.67
	23.0	21.2	222.0	21.86	218.3	21.72	202.5	20.04	194.4	19.20	186.4	18.36	174.3	17.12	158.3	15.49
	26.6	24.8	230.0	22.01	218.5	20.85	202.5	19.21	194.4	18.40	186.4	17.60	174.3	16.42	158.3	14.86
	30.2	28.4	230.6	21.20	218.5	20.00	202.5	18.43	194.4	17.66	186.4	16.90	174.3	15.76	158.3	14.27
	32.0	30.2	230.6	20.77	218.5	19.59	202.5	18.06	194.4	17.30	186.4	16.56	174.3	15.43	158.3	13.99
	35.6	33.8	230.6	19.93	218.5	18.81	202.5	17.34	194.4	16.61	186.4	15.90	174.3	14.83	158.3	13.44
	41.0	39.2	230.6	18.77	218.5	17.73	202.5	16.34	194.4	15.67	186.4	14.99	174.3	13.99	158.3	12.68
	47.0	43.0	230.6	18.02	218.5	17.01	202.5	15.69	194.4	15.04	186.4	14.39	174.3	13.43	158.3	12.18
	48.2	46.0	230.6	17.44	218.5	16.47	202.5	15.19	194.4	14.57	186.4	13.94	174.3	13.01	158.3	11.80
	53.6	51.1	230.6	16.51	218.5	15.59	202.5	14.39	194.4	13.79	186.4	13.21	174.3	12.32	158.3	11.18
	59.0	56.3	230.6	15.63	218.5	14.76	202.5	13.63	194.4	13.06	186.4	12.50	174.3	11.68	158.3	10.60
170.1 (70%)	-4.0	-5.3	151.3	19.34	150.2	19.47	148.7	19.63	147.9	19.71	147.2	19.80	146.1	19.92	138.5	19.01
	5.0	3.2	172.1	20.28	171.0	20.44	169.7	20.63	167.7	20.52	163.1	20.00	152.5	18.66	138.5	16.89
	10.4	8.6	185.9	20.90	184.9	21.07	177.1	20.31	170.1	19.46	163.1	18.63	152.5	17.38	138.5	15.75
	15.8	14.0	199.5	21.45	191.2	20.57	177.1	18.98	170.1	18.20	163.1	17.40	152.5	16.26	138.5	14.73
	17.0	15.0	200.8	21.36	191.2	20.31	177.1	18.74	170.1	17.96	163.1	17.19	152.5	16.04	138.5	14.56
	23.0	21.2	201.8	19.97	191.2	18.86	177.1	17.40	170.1	16.69	163.1	15.98	152.5	14.92	138.5	13.53
	26.6	24.8	201.8	19.14	191.2	18.08	177.1	16.69	170.1	16.00	163.1	15.33	152.5	14.32	138.5	12.99
	30.2	28.4	201.8	18.36	191.2	17.35	177.1	16.02	170.1	15.36	163.1	14.72	152.5	13.75	138.5	12.48
	32.0	30.2	201.8	17.99	191.2	16.99	177.1	15.70	170.1	15.05	163.1	14.42	152.5	13.47	138.5	12.23
	35.6	33.8	201.8	17.29	191.2	16.33	177.1	15.09	170.1	14.47	163.1	13.85	152.5	12.95	138.5	11.75
	41.0	39.2	201.8	16.29	191.2	15.39	177.1	14.22	170.1	13.64	163.1	13.07	152.5	12.22	138.5	11.10
	47.0	43.0	201.8	15.62	191.2	14.78	177.1	13.65	170.1	13.10	163.1	12.54	152.5	11.73	138.5	10.66
	48.2	46.0	201.8	15.13	191.2	14.31	177.1	13.23	170.1	12.69	163.1	12.17	152.5	11.37	138.5	10.33
	53.6	51.1	201.8	14.34	191.2	13.56	177.1	12.53	170.1	12.03	163.1	11.53	152.5	10.78	138.5	9.80
	59.0	56.3	201.8	13.58	191.2	12.84	177.1	11.87	170.1	11.40	163.1	10.92	152.5	10.21	138.5	9.30
145.8 (60%)	-4.0	-5.3	148.6	19.63	147.5	19.76	146.2	19.91	143.4	19.63	139.8	19.19	130.7	17.92	118.7	16.24
	5.0	3.2	169.3	20.68	163.8	20.10	151.9	18.56	145.8	17.80	139.8	17.06	130.7	15.93	118.7	14.45
	10.4	8.6	173.0	19.81	163.8	18.72	151.9	17.31	145.8	16.59	139.8	15.90	130.7	14.85	118.7	13.49
	15.8	14.0	173.0	18.50	163.8	17.50	151.9	16.18	145.8	15.52	139.8	14.87	130.7	13.89	118.7	<

Heating capacity at rated condition: 243 kBtu/h (18 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
121.5 (50%)	-4.0	-5.3	142.4	19.49	136.6	18.73	126.5	17.33	121.5	16.63	116.5	15.94	108.9	14.91	99.0	13.56
	5.0	3.2	144.2	17.59	136.6	16.66	126.5	15.41	121.5	14.80	116.5	14.19	108.9	13.28	99.0	12.08
	10.4	8.6	144.2	16.40	136.6	15.52	126.5	14.38	121.5	13.81	116.5	13.24	108.9	12.40	99.0	11.28
	15.8	14.0	144.2	15.34	136.6	14.52	126.5	13.46	121.5	12.92	116.5	12.40	108.9	11.61	99.0	10.57
	17.0	15.0	144.2	15.16	136.6	14.35	126.5	13.29	121.5	12.77	116.5	12.25	108.9	11.47	99.0	10.46
	23.0	21.2	144.2	14.08	136.6	13.34	126.5	12.37	121.5	11.88	116.5	11.40	108.9	10.69	99.0	9.74
	26.6	24.8	144.2	13.51	136.6	12.81	126.5	11.88	121.5	11.41	116.5	10.95	108.9	10.26	99.0	9.36
	30.2	28.4	144.2	12.98	136.6	12.29	126.5	11.41	121.5	10.96	116.5	10.52	108.9	9.87	99.0	9.00
	32.0	30.2	144.2	12.72	136.6	12.06	126.5	11.18	121.5	10.74	116.5	10.32	108.9	9.68	99.0	8.83
	35.6	33.8	144.2	12.23	136.6	11.60	126.5	10.76	121.5	10.34	116.5	9.93	108.9	9.31	99.0	8.51
	41.0	39.2	144.2	11.54	136.6	10.94	126.5	10.15	121.5	9.77	116.5	9.38	108.9	8.80	99.0	8.04
	47.0	43.0	144.2	11.09	136.6	10.51	126.5	9.77	121.5	9.39	116.5	9.01	108.9	8.47	99.0	7.74
	48.2	46.0	144.2	10.75	136.6	10.18	126.5	9.47	121.5	9.11	116.5	8.75	108.9	8.21	99.0	7.51
	53.6	51.1	144.2	10.19	136.6	9.67	126.5	8.99	121.5	8.64	116.5	8.31	108.9	7.80	99.0	7.14
	59.0	56.3	144.2	9.67	136.6	9.17	126.5	8.53	121.5	8.21	116.5	7.89	108.9	7.40	99.0	6.78

MODEL  
SELECTIONMODEL  
SELECTION

# Model: AOUA240RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 270 kBtu/h (20 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
405.0 (150%)	-4.0	-5.3	189.6	22.03	187.6	22.14	185.2	22.29	184.0	22.35	182.6	22.44	180.8	22.54	178.4	22.70
	5.0	3.2	209.2	22.57	207.6	22.72	205.6	22.91	204.6	23.00	203.6	23.08	202.0	23.23	200.0	23.43
	10.4	8.6	223.2	22.91	221.8	23.08	220.0	23.28	219.0	23.38	218.0	23.49	216.8	23.66	215.0	23.88
	15.8	14.0	238.2	23.25	236.8	23.43	235.2	23.66	234.4	23.77	233.4	23.90	232.2	24.07	230.6	24.31
	17.0	15.0	241.0	23.32	239.8	23.49	238.2	23.73	237.2	23.86	236.4	23.96	235.2	24.16	233.6	24.39
	23.0	21.2	259.6	23.68	258.4	23.88	256.8	24.16	256.0	24.29	255.2	24.41	254.0	24.61	252.4	24.89
	26.6	24.8	270.8	23.90	269.6	24.11	268.0	24.39	267.2	24.52	266.4	24.67	265.2	24.89	263.6	25.17
	30.2	28.4	282.2	24.11	281.0	24.35	279.4	24.63	278.6	24.78	277.8	24.93	276.6	25.15	275.0	25.45
	32.0	30.2	288.2	24.22	286.8	24.46	285.2	24.76	284.4	24.91	283.6	25.06	282.4	25.27	280.8	25.58
	35.6	33.8	300.0	24.44	298.8	24.67	297.0	24.99	296.2	25.15	295.4	25.30	294.0	25.53	292.4	25.85
	41.0	39.2	318.2	24.76	316.8	25.02	315.0	25.34	314.2	25.49	313.2	25.66	311.8	25.92	309.8	26.24
	47.0	43.0	331.2	24.99	329.8	25.23	327.8	25.58	326.8	25.75	325.8	25.92	324.4	26.18	322.4	26.52
	48.2	46.0	341.8	25.17	340.2	25.42	338.0	25.77	337.0	25.94	336.0	26.11	334.4	26.37	329.8	26.46
	53.6	51.1	359.6	25.45	357.8	25.73	355.4	26.07	354.4	26.26	353.2	26.43	351.4	26.71	329.8	25.06
	59.0	56.3	377.8	25.75	376.0	26.03	373.4	26.39	372.0	26.59	370.6	26.76	363.2	26.48	329.8	23.73
378.0 (140%)	-4.0	-5.3	188.6	22.07	186.6	22.20	184.2	22.33	183.0	22.42	181.8	22.48	179.8	22.61	177.4	22.76
	5.0	3.2	208.2	22.65	206.6	22.80	204.6	22.97	203.6	23.08	202.6	23.17	201.2	23.32	199.2	23.51
	10.4	8.6	222.2	23.02	220.8	23.17	219.0	23.38	218.2	23.49	217.2	23.60	216.0	23.77	214.2	23.98
	15.8	14.0	237.2	23.36	236.0	23.53	234.4	23.77	233.6	23.90	232.6	24.01	231.4	24.20	229.8	24.44
	17.0	15.0	240.2	23.43	239.0	23.62	237.2	23.86	236.4	23.96	235.6	24.09	234.4	24.26	232.8	24.52
	23.0	21.2	258.6	23.83	257.4	24.03	255.8	24.29	255.0	24.44	254.2	24.56	253.0	24.76	251.4	25.04
	26.6	24.8	269.8	24.07	268.6	24.26	267.0	24.54	266.2	24.69	265.4	24.82	264.2	25.04	262.6	25.32
	30.2	28.4	281.2	24.31	280.0	24.52	278.4	24.80	277.6	24.95	276.8	25.10	275.6	25.32	274.0	25.62
	32.0	30.2	287.2	24.41	285.8	24.63	284.2	24.93	283.4	25.08	282.6	25.23	281.4	25.45	279.8	25.75
	35.6	33.8	299.0	24.65	297.6	24.87	296.0	25.19	295.2	25.34	294.2	25.49	293.0	25.73	291.2	26.05
	41.0	39.2	317.0	24.97	315.6	25.23	313.8	25.55	312.8	25.73	312.0	25.88	310.6	26.13	307.8	26.37
	47.0	43.0	330.0	25.23	328.4	25.47	326.4	25.81	325.4	25.98	324.4	26.16	323.0	26.41	307.8	25.30
	48.2	46.0	340.2	25.40	338.6	25.66	336.6	26.00	335.4	26.20	334.4	26.37	332.8	26.63	307.8	24.48
	53.6	51.1	357.8	25.73	356.0	25.98	353.8	26.35	352.6	26.52	351.4	26.71	339.0	25.85	307.8	23.19
	59.0	56.3	375.8	26.03	373.8	26.31	371.2	26.69	369.8	26.86	362.4	26.41	339.0	24.48	307.8	21.96
351.0 (130%)	-4.0	-5.3	187.4	22.16	185.6	22.27	183.0	22.42	181.8	22.48	180.6	22.57	178.8	22.67	176.4	22.82
	5.0	3.2	207.2	22.76	205.6	22.89	203.6	23.08	202.6	23.17	201.6	23.28	200.2	23.40	198.2	23.60
	10.4	8.6	221.2	23.13	219.8	23.30	218.0	23.49	217.2	23.60	216.4	23.71	215.0	23.88	213.2	24.09
	15.8	14.0	236.2	23.51	235.0	23.68	233.4	23.92	232.6	24.03	231.8	24.16	230.4	24.33	228.8	24.56
	17.0	15.0	239.2	23.58	238.0	23.75	236.4	23.98	235.6	24.11	234.6	24.22	233.4	24.41	231.8	24.65
	23.0	21.2	257.6	24.01	256.4	24.20	254.8	24.46	254.0	24.59	253.2	24.74	252.0	24.93	250.6	25.19
	26.6	24.8	268.8	24.24	267.6	24.46	266.0	24.74	265.2	24.87	264.4	25.02	263.2	25.23	261.6	25.51
	30.2	28.4	280.2	24.50	279.0	24.72	277.4	24.99	276.6	25.15	275.8	25.30	274.6	25.51	272.8	25.81
	32.0	30.2	286.0	24.63	284.8	24.84	283.2	25.15	282.2	25.30	281.4	25.45	280.2	25.66	278.6	25.96
	35.6	33.8	297.6	24.87	296.4	25.10	294.8	25.40	293.8	25.55	293.0	25.73	291.8	25.96	285.8	25.77
	41.0	39.2	315.6	25.23	314.2	25.49	312.4	25.81	311.4	25.96	310.4	26.13	309.0	26.39	285.8	24.29
	47.0	43.0	328.4	25.49	326.8	25.75	324.8	26.09	323.8	26.26	322.8	26.41	314.8	25.94	285.8	23.30
	48.2	46.0	338.4	25.70	337.0	25.96	334.8	26.31	333.8	26.48	332.6	26.65	314.8	25.10	285.8	22.57
	53.6	51.1	355.8	26.03	354.0	26.31	351.6	26.67	350.4	26.84	336.6	25.64	314.8	23.79	285.8	21.36
	59.0	56.3	373.4	26.37	371.4	26.65	365.6	26.67	351.0	25.47	336.6	24.26	314.8	22.50	285.8	20.25
324.0 (120%)	-4.0	-5.3	186.0	22.22	184.2	22.33	181.8	22.48	180.6	22.57	179.4	22.63	177.6	22.76	175.2	22.91
	5.0	3.2	206.0	22.87	204.4	23.00	202.6	23.19	201.6	23.28	200.6	23.38	199.0	23.53	197.2	23.71
	10.4	8.6	220.2	23.25	218.8	23.43	217.0	23.64	216.0	23.75	215.2	23.83	213.8	24.01	212.2	24.22
	15.8	14.0	235.2	23.66	234.0	23.83	232.2	24.07	231.4	24.20	230.6	24.31	229.4	24.48	227.8	24.72
	17.0	15.0	238.0	23.73	236.8	23.92	235.2	24.16	234.4	24.26	233.6	24.39	232.4	24.56	230.8	24.82
	23.0	21.2	256.4	24.20	255.2	24.39	253.8	24.65	253.0	24.78	252.2	24.93	251.0	25.12	249.4	25.38
	26.6	24.8	267.6	24.46	266.4	24.67	264.8	24.95	264.0	25.08	263.2	25.23	262.0	25.45	260.4	25.73
	30.2	28.4	278.8	24.74	277.6	24.95	276.0	25.23	275.2	25.38	274.4	25.53	273.2	25.75	263.8	25.08
	32.0	30.2	284.6	24.87	283.4	25.08	281.8	25.38	281.0	25.53	280.2	25.68	278.8	25.90	263.8	24.59
	35.6	33.8	296.2	25.12	295.0	25.36	293.2	25.66	292.4	25.83	291.6	25.98	290.2	26.22	263.8	23.60
	41.0	39.2	314.0	25.53	312.6	25.77	310.6	26.09	309.8	26.26	308.8	26.43	290.6	24.74	263.8	22.24
	47.0	43.0	326.4	25.81	325.0	26.07	323.0	26.39	322.0	26.56	310.6	25.55	290.6	23.73	263.8	21.34
	48.2	46.0	336.4	26.03	334.8	26.28	332.8	26.63	324.0	25.94	310.6	24.74	290.6	22.97	263.8	20.67
	53.6	51.1	353.4	26.39	351.6	26.67	337.4	25.73	324.0	24.56	310.6	23.45	290.6	21.77	263.8	19.60
	59.0	56.3	370.6	26.78	364.2	26.56	337.4	24.35	324.0	23.25	310.6	22.18	290.6	20.61	263.8	18.55
297.0 (110%)	-4.0	-5.3	184.6	22.31	182.8	22.44	180.2	22.59	179.2	22.65	178.0	22.74	176.2	22.85	173.8	23.00
	5.0	3.2	204.6	23.00	203.2	23.13	201.2	23.32	200.2	23.40	199.2	23.51	197.8	23.66	195.8	23.83
	10.4	8.6	218.8	23.43	217.4	23.58	215.6	23.79	214.8	23.90	214.0	24.01	212.6	24.16	210.8	24.37
	15.8	14.0	233.8	23.86	232.6	24.03	231.0	24.26	230.2	24.37	229.4	24.50	228.2	24.67	226.6	24.91
	17.0	15.0	236.8	23.92	235.6	24.11	234.0	24.35	233.2							

Heating capacity at rated condition: 270 kBTu/h (20 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
270.0 (100%)	-4.0	-5.3	182.8	22.44	181.0	22.54	178.6	22.70	177.4	22.76	176.2	22.85	174.4	22.95	172.2	23.10
	5.0	3.2	203.0	23.15	201.6	23.28	199.6	23.47	198.6	23.58	197.6	23.66	196.2	23.81	194.4	24.01
	10.4	8.6	217.2	23.60	215.8	23.77	214.2	23.96	213.2	24.07	212.4	24.18	211.2	24.35	209.4	24.56
	15.8	14.0	232.2	24.07	231.0	24.24	229.4	24.48	228.6	24.59	227.8	24.72	226.6	24.89	219.8	24.41
	17.0	15.0	235.2	24.16	234.0	24.33	232.4	24.56	231.6	24.69	230.8	24.80	229.6	24.99	219.8	24.11
	23.0	21.2	253.4	24.69	252.4	24.89	250.8	25.15	250.0	25.30	249.2	25.42	242.2	24.84	219.8	22.39
	26.6	24.8	264.4	25.02	263.2	25.21	261.6	25.49	261.0	25.64	258.8	25.62	242.2	23.81	219.8	21.49
	30.2	28.4	275.6	25.32	274.4	25.55	272.8	25.83	270.0	25.73	258.8	24.56	242.2	22.87	219.8	20.63
	32.0	30.2	281.2	25.49	280.0	25.70	278.4	26.00	270.0	25.21	258.8	24.07	242.2	22.39	219.8	20.22
	35.6	33.8	292.6	25.81	291.2	26.03	281.2	25.32	270.0	24.22	258.8	23.13	242.2	21.51	219.8	19.43
	41.0	39.2	309.6	26.28	303.4	25.96	281.2	23.86	270.0	22.82	258.8	21.79	242.2	20.29	219.8	18.31
	47.0	43.0	320.2	26.46	303.4	24.91	281.2	22.89	270.0	21.90	258.8	20.93	242.2	19.47	219.8	17.58
	48.2	46.0	320.2	25.60	303.4	24.11	281.2	22.16	270.0	21.21	258.8	20.27	242.2	18.87	219.8	17.04
	53.6	51.1	320.2	24.24	303.4	22.85	281.2	21.00	270.0	20.09	258.8	19.19	242.2	17.88	219.8	16.16
	59.0	56.3	320.2	22.95	303.4	21.62	281.2	19.88	270.0	19.02	258.8	18.18	242.2	16.94	219.8	15.30
243.0 (90%)	-4.0	-5.3	180.6	22.57	178.8	22.67	176.6	22.82	175.4	22.89	174.2	22.97	172.6	23.08	170.2	23.25
	5.0	3.2	201.0	23.34	199.6	23.47	197.6	23.66	196.8	23.75	195.8	23.86	194.4	23.98	192.6	24.18
	10.4	8.6	215.4	23.83	214.0	23.98	212.4	24.20	211.4	24.31	210.6	24.41	209.4	24.56	197.8	23.34
	15.8	14.0	230.4	24.33	229.2	24.50	227.6	24.74	226.8	24.87	226.0	24.97	217.8	24.18	197.8	21.84
	17.0	15.0	233.4	24.44	232.2	24.61	230.6	24.84	229.8	24.97	229.0	25.08	217.8	23.88	197.8	21.58
	23.0	21.2	251.6	25.02	250.4	25.21	248.8	25.49	243.0	24.93	233.0	23.83	217.8	22.20	197.8	20.05
	26.6	24.8	262.4	25.36	261.2	25.58	253.0	24.97	243.0	23.92	233.0	22.87	217.8	21.28	197.8	19.24
	30.2	28.4	273.4	25.73	272.2	25.94	253.0	23.98	243.0	22.95	233.0	21.94	217.8	20.44	197.8	18.48
	32.0	30.2	279.0	25.90	273.2	25.53	253.0	23.49	243.0	22.50	233.0	21.49	217.8	20.03	197.8	18.12
	35.6	33.8	288.2	26.03	273.2	24.52	253.0	22.57	243.0	21.60	233.0	20.65	217.8	19.26	197.8	17.41
	41.0	39.2	288.2	24.50	273.2	23.10	253.0	21.28	243.0	20.37	233.0	19.47	217.8	18.16	197.8	16.42
	47.0	43.0	288.2	23.51	273.2	22.18	253.0	20.42	243.0	19.56	233.0	18.70	217.8	17.43	197.8	15.77
	48.2	46.0	288.2	22.78	273.2	21.47	253.0	19.77	243.0	18.93	233.0	18.12	217.8	16.89	197.8	15.28
	53.6	51.1	288.2	21.58	273.2	20.35	253.0	18.74	243.0	17.95	233.0	17.17	217.8	16.01	197.8	14.51
	59.0	56.3	288.2	20.42	273.2	19.26	253.0	17.75	243.0	17.00	233.0	16.27	217.8	15.17	197.8	13.75
216.0 (80%)	-4.0	-5.3	178.0	22.72	176.2	22.85	174.0	23.00	173.0	23.06	171.8	23.15	170.2	23.25	168.0	23.40
	5.0	3.2	198.6	23.55	197.2	23.71	195.4	23.90	194.4	23.98	193.6	24.07	192.2	24.22	175.8	22.11
	10.4	8.6	213.0	24.11	211.8	24.26	210.0	24.48	209.2	24.59	207.0	24.50	193.6	22.82	175.8	20.65
	15.8	14.0	228.2	24.67	227.0	24.84	225.0	25.02	216.0	23.96	207.0	22.91	193.6	21.36	175.8	19.32
	17.0	15.0	231.0	24.78	229.8	24.95	225.0	24.72	216.0	23.66	207.0	22.63	193.6	21.10	175.8	19.08
	23.0	21.2	249.2	25.42	242.8	24.91	225.0	22.95	216.0	21.99	207.0	21.04	193.6	19.62	175.8	17.75
	26.6	24.8	256.2	25.32	242.8	23.90	225.0	22.01	216.0	21.08	207.0	20.18	193.6	18.83	175.8	17.04
	30.2	28.4	256.2	24.31	242.8	22.93	225.0	21.13	216.0	20.25	207.0	19.39	193.6	18.07	175.8	16.38
	32.0	30.2	256.2	23.81	242.8	22.46	225.0	20.72	216.0	19.84	207.0	19.00	193.6	17.71	175.8	16.05
	35.6	33.8	256.2	22.87	242.8	21.58	225.0	19.90	216.0	19.06	207.0	18.25	193.6	17.02	175.8	15.43
	41.0	39.2	256.2	21.56	242.8	20.35	225.0	18.76	216.0	17.99	207.0	17.21	193.6	16.08	175.8	14.57
	47.0	43.0	256.2	20.70	242.8	19.54	225.0	18.01	216.0	17.28	207.0	16.53	193.6	15.43	175.8	14.01
	48.2	46.0	256.2	20.03	242.8	18.91	225.0	17.45	216.0	16.74	207.0	16.01	193.6	14.96	175.8	13.58
	53.6	51.1	256.2	18.98	242.8	17.92	225.0	16.55	216.0	15.86	207.0	15.19	193.6	14.18	175.8	12.87
	59.0	56.3	256.2	17.99	242.8	16.98	225.0	15.69	216.0	15.04	207.0	14.40	193.6	13.45	175.8	12.23
189.0 (70%)	-4.0	-5.3	174.8	22.93	173.2	23.04	171.0	23.19	169.8	23.28	168.8	23.34	167.2	23.47	153.8	21.60
	5.0	3.2	195.8	23.86	194.4	24.01	192.6	24.18	189.0	23.86	181.2	22.82	169.4	21.30	153.8	19.28
	10.4	8.6	210.2	24.46	209.0	24.63	196.8	23.21	189.0	22.24	181.2	21.30	169.4	19.88	153.8	18.01
	15.8	14.0	224.2	24.93	212.4	23.53	196.8	21.71	189.0	20.83	181.2	19.92	169.4	18.61	153.8	16.87
	17.0	15.0	224.2	24.61	212.4	23.25	196.8	21.45	189.0	20.57	181.2	19.69	169.4	18.38	153.8	16.68
	23.0	21.2	224.2	22.87	212.4	21.60	196.8	19.94	189.0	19.13	181.2	18.31	169.4	17.11	153.8	15.52
	26.6	24.8	224.2	21.94	212.4	20.72	196.8	19.13	189.0	18.35	181.2	17.58	169.4	16.42	153.8	14.92
	30.2	28.4	224.2	21.06	212.4	19.90	196.8	18.38	189.0	17.62	181.2	16.89	169.4	15.77	153.8	14.33
	32.0	30.2	224.2	20.63	212.4	19.49	196.8	18.01	189.0	17.28	181.2	16.55	169.4	15.47	153.8	14.06
	35.6	33.8	224.2	19.84	212.4	18.74	196.8	17.32	189.0	16.61	181.2	15.90	169.4	14.87	153.8	13.52
	41.0	39.2	224.2	18.70	212.4	17.67	196.8	16.33	189.0	15.67	181.2	15.02	169.4	14.06	153.8	12.77
	47.0	43.0	224.2	17.95	212.4	16.98	196.8	15.69	189.0	15.07	181.2	14.42	169.4	13.50	153.8	12.27
	48.2	46.0	224.2	17.39	212.4	16.44	196.8	15.22	189.0	14.59	181.2	13.99	169.4	13.09	153.8	11.91
	53.6	51.1	224.2	16.48	212.4	15.60	196.8	14.42	189.0	13.84	181.2	13.28	169.4	12.42	153.8	11.30
	59.0	56.3	224.2	15.62	212.4	14.79	196.8	13.67	189.0	13.13	181.2	12.59	169.4	11.78	153.8	10.75
162.0 (60%)	-4.0	-5.3	170.8	23.21	169.2	23.32	167.2	23.47	162.0	22.78	155.4	21.81	145.2	20.37	131.8	18.48
	5.0	3.2	192.0	24.24	182.0	22.93	168.8	21.19	162.0	20.33	155.4	19.47	145.2	18.20	131.8	16.53
	10.4	8.6	192.2	22.63	182.0	21.41	168.8	19.79	162.0	18.98	155.4	18.18	145.2	17.00	131.8	15.45
	15.8	14.0	192.2	21.17	182.0	20.03	168.8	18.53	162.0	17.77	155.4	17.04	145.2	15.93	131.8	

Heating capacity at rated condition: 270 kBtu/h (20 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
135.0 (50%)	-4.0	-5.3	160.2	22.50	151.8	21.30	140.6	19.71	135.0	18.93	129.4	18.14	121.0	16.98	110.0	15.45
	5.0	3.2	160.2	20.09	151.8	19.02	140.6	17.60	135.0	16.91	129.4	16.23	121.0	15.19	110.0	13.84
	10.4	8.6	160.2	18.76	151.8	17.75	140.6	16.46	135.0	15.82	129.4	15.17	121.0	14.21	110.0	12.94
	15.8	14.0	160.2	17.56	151.8	16.63	140.6	15.43	135.0	14.83	129.4	14.23	121.0	13.32	110.0	12.14
	17.0	15.0	160.2	17.37	151.8	16.44	140.6	15.24	135.0	14.64	129.4	14.06	121.0	13.17	110.0	12.01
	23.0	21.2	160.2	16.16	151.8	15.30	140.6	14.21	135.0	13.65	129.4	13.09	121.0	12.29	110.0	11.22
	26.6	24.8	160.2	15.52	151.8	14.70	140.6	13.65	135.0	13.11	129.4	12.59	121.0	11.80	110.0	10.79
	30.2	28.4	160.2	14.89	151.8	14.12	140.6	13.11	135.0	12.62	129.4	12.10	121.0	11.37	110.0	10.38
	32.0	30.2	160.2	14.61	151.8	13.86	140.6	12.85	135.0	12.36	129.4	11.88	121.0	11.15	110.0	10.19
	35.6	33.8	160.2	14.06	151.8	13.32	140.6	12.38	135.0	11.91	129.4	11.43	121.0	10.72	110.0	9.82
	41.0	39.2	160.2	13.28	151.8	12.59	140.6	11.69	135.0	11.26	129.4	10.81	121.0	10.17	110.0	9.28
	47.0	43.0	160.2	12.77	151.8	12.10	140.6	11.26	135.0	10.83	129.4	10.40	121.0	9.78	110.0	8.94
	48.2	46.0	160.2	12.38	151.8	11.73	140.6	10.92	135.0	10.51	129.4	10.10	121.0	9.50	110.0	8.68
	53.6	51.1	160.2	11.76	151.8	11.15	140.6	10.38	135.0	9.99	129.4	9.61	121.0	9.03	110.0	8.27
	59.0	56.3	160.2	11.15	151.8	10.60	140.6	9.86	135.0	9.50	129.4	9.13	121.0	8.58	110.0	7.87

MODEL  
SELECTIONMODEL  
SELECTION



# Model: AOUA264RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 297 kBtu/h (22 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
445.5 (150%)	-4.0	-5.3	185.5	21.50	184.7	21.70	183.6	21.94	183.0	22.05	182.5	22.19	181.7	22.37	180.6	22.64
	5.0	3.2	214.7	22.33	213.9	22.54	212.7	22.85	212.0	22.99	211.4	23.14	210.6	23.38	209.4	23.66
	10.4	8.6	233.9	22.82	233.1	23.06	231.7	23.41	231.1	23.55	230.6	23.73	229.5	23.98	228.1	24.30
	15.8	14.0	253.6	23.32	252.6	23.59	251.2	23.94	250.4	24.12	249.8	24.32	248.7	24.58	247.3	24.92
	17.0	15.0	257.4	23.41	256.3	23.68	254.9	24.05	254.1	24.23	253.3	24.40	252.2	24.69	250.8	25.05
	23.0	21.2	280.2	23.96	279.1	24.26	277.4	24.64	276.6	24.85	275.8	25.05	274.6	25.34	273.0	25.74
	26.6	24.8	293.7	24.28	292.6	24.58	290.7	24.99	289.9	25.20	289.0	25.40	287.7	25.72	286.0	26.13
	30.2	28.4	307.5	24.58	306.1	24.90	304.2	25.33	303.1	25.54	302.3	25.75	300.9	26.07	299.0	26.50
	32.0	30.2	314.3	24.72	312.9	25.06	310.9	25.49	309.9	25.72	309.0	25.93	307.4	26.25	305.5	26.69
	35.6	33.8	327.8	25.05	326.4	25.37	324.3	25.81	323.4	26.04	322.3	26.27	320.7	26.60	318.5	27.07
	41.0	39.2	348.7	25.48	346.8	25.83	344.6	26.30	343.4	26.54	342.3	26.77	340.4	27.12	338.2	27.59
	47.0	43.0	363.1	25.77	361.4	26.13	358.9	26.62	357.6	26.86	356.4	27.09	354.5	27.46	352.0	27.94
	48.2	46.0	374.7	26.01	372.8	26.36	370.3	26.86	368.9	27.09	367.5	27.35	365.6	27.73	362.3	28.17
	53.6	51.1	394.3	26.36	392.3	26.74	389.3	27.25	387.9	27.50	386.5	27.76	384.3	28.14	382.7	28.71
	59.0	56.3	414.3	26.74	412.1	27.11	408.8	27.64	407.2	27.91	405.5	28.16	399.5	28.17	382.7	25.29
415.8 (140%)	-4.0	-5.3	185.2	21.59	184.4	21.79	183.3	22.03	182.7	22.14	182.2	22.28	181.3	22.46	180.0	22.73
	5.0	3.2	214.2	22.44	213.3	22.67	212.2	22.97	211.6	23.11	211.1	23.26	210.0	23.49	208.9	23.79
	10.4	8.6	233.4	22.97	232.5	23.21	231.1	23.55	230.6	23.70	229.8	23.87	228.9	24.14	227.6	24.46
	15.8	14.0	252.8	23.50	252.0	23.76	250.6	24.12	249.8	24.29	249.0	24.47	247.9	24.75	246.5	25.10
	17.0	15.0	256.6	23.59	255.5	23.85	254.1	24.23	253.3	24.40	252.7	24.58	251.6	24.87	250.0	25.22
	23.0	21.2	279.4	24.17	278.2	24.47	276.6	24.87	275.8	25.05	274.9	25.25	273.8	25.54	272.1	25.95
	26.6	24.8	292.8	24.49	291.5	24.81	289.8	25.22	289.0	25.43	288.1	25.63	286.8	25.95	284.9	26.36
	30.2	28.4	306.4	24.85	305.0	25.17	303.1	25.58	302.0	25.79	301.2	26.01	299.8	26.34	297.9	26.77
	32.0	30.2	313.1	24.99	311.5	25.31	309.6	25.75	308.8	25.98	307.7	26.18	306.3	26.51	304.3	26.95
	35.6	33.8	326.7	25.31	325.1	25.66	323.1	26.11	322.0	26.33	320.9	26.54	319.3	26.89	317.3	27.33
	41.0	39.2	347.0	25.77	345.4	26.13	343.1	26.60	341.8	26.83	340.7	27.07	339.0	27.42	336.3	27.88
	47.0	43.0	361.4	26.09	359.7	26.47	357.2	26.95	355.9	27.18	354.7	27.44	352.8	27.80	348.5	27.00
	48.2	46.0	372.8	26.36	370.9	26.71	368.3	27.21	367.0	27.44	365.6	27.71	363.7	28.08	358.5	26.13
	53.6	51.1	392.3	26.76	390.1	27.14	387.1	27.64	385.7	27.91	384.3	28.14	372.9	27.56	338.5	24.77
	59.0	56.3	411.8	27.14	409.4	27.52	406.3	28.05	404.7	28.32	398.7	28.12	372.9	26.08	338.5	23.43
386.1 (130%)	-4.0	-5.3	184.7	21.71	183.8	21.89	182.7	22.14	182.2	22.26	181.6	22.38	180.8	22.58	179.7	22.81
	5.0	3.2	213.6	22.59	212.8	22.80	211.6	23.11	211.1	23.26	210.3	23.41	209.5	23.64	208.3	23.93
	10.4	8.6	232.8	23.14	231.7	23.39	230.6	23.71	229.8	23.87	229.2	24.05	228.1	24.28	227.0	24.64
	15.8	14.0	252.2	23.70	251.1	23.96	249.7	24.32	249.0	24.49	248.4	24.67	247.3	24.96	245.7	25.31
	17.0	15.0	255.8	23.80	254.7	24.06	253.3	24.44	252.5	24.61	251.9	24.79	250.8	25.08	249.4	25.43
	23.0	21.2	278.5	24.42	277.1	24.70	275.7	25.11	274.9	25.31	274.1	25.49	272.7	25.81	271.1	26.19
	26.6	24.8	291.7	24.76	290.4	25.08	288.7	25.49	287.9	25.70	286.8	25.90	285.7	26.22	283.8	26.62
	30.2	28.4	305.0	25.13	303.6	25.43	301.7	25.86	300.9	26.07	299.8	26.30	298.4	26.62	296.5	27.03
	32.0	30.2	311.8	25.31	310.4	25.63	308.4	26.05	307.4	26.27	306.5	26.48	304.9	26.80	303.0	27.24
	35.6	33.8	325.1	25.64	323.6	25.98	321.5	26.43	320.4	26.66	319.5	26.87	317.9	27.21	314.3	27.51
	41.0	39.2	345.3	26.15	343.5	26.50	341.2	26.97	340.1	27.21	339.0	27.44	337.1	27.80	314.3	25.92
	47.0	43.0	359.5	26.48	357.6	26.86	355.1	27.32	353.9	27.56	352.6	27.82	346.2	27.67	314.3	24.88
	48.2	46.0	370.8	26.77	368.7	27.12	366.2	27.62	364.8	27.85	363.4	28.11	346.2	26.80	314.3	24.09
	53.6	51.1	389.6	27.20	387.6	27.59	384.6	28.08	383.2	28.32	370.2	27.33	346.2	25.39	314.3	22.82
	59.0	56.3	409.0	27.61	406.6	28.02	402.0	28.38	386.1	27.11	370.2	25.87	346.2	24.02	314.3	21.61
356.4 (120%)	-4.0	-5.3	184.1	21.82	183.3	22.00	182.2	22.26	181.6	22.38	181.1	22.49	180.3	22.69	179.2	22.93
	5.0	3.2	213.0	22.74	212.2	22.97	210.9	23.27	210.3	23.41	209.7	23.55	208.9	23.79	207.5	24.11
	10.4	8.6	232.0	23.33	231.1	23.59	229.7	23.91	229.2	24.08	228.4	24.23	227.5	24.49	226.2	24.81
	15.8	14.0	251.2	23.92	250.1	24.21	248.7	24.55	248.1	24.72	247.3	24.90	246.2	25.17	244.8	25.54
	17.0	15.0	254.9	24.03	253.8	24.29	252.4	24.67	251.6	24.85	250.8	25.02	249.7	25.31	248.3	25.66
	23.0	21.2	277.3	24.70	276.0	24.99	274.4	25.38	273.6	25.58	272.7	25.79	271.6	26.07	269.9	26.48
	26.6	24.8	290.4	25.08	289.0	25.38	287.3	25.79	286.5	26.00	285.7	26.22	284.3	26.51	282.6	26.92
	30.2	28.4	303.6	25.46	302.2	25.79	300.3	26.19	299.5	26.43	298.4	26.62	297.0	26.95	290.1	26.79
	32.0	30.2	310.1	25.64	308.7	25.96	306.8	26.39	305.7	26.62	304.9	26.83	303.5	27.16	290.1	26.25
	35.6	33.8	323.4	26.02	321.8	26.36	319.8	26.80	318.7	27.01	317.6	27.24	316.1	27.59	290.1	25.22
	41.0	39.2	343.2	26.57	341.5	26.91	339.3	27.39	338.0	27.62	336.8	27.85	319.6	26.41	290.1	23.77
	47.0	43.0	357.2	26.95	355.3	27.30	352.8	27.76	351.7	28.01	341.8	27.29	319.6	25.35	290.1	22.82
	48.2	46.0	368.1	27.23	366.2	27.59	363.7	28.08	356.4	27.66	341.8	26.41	319.6	24.54	290.1	22.10
	53.6	51.1	386.8	27.70	384.6	28.08	371.2	27.42	356.4	26.21	341.8	25.00	319.6	23.23	290.1	20.94
	59.0	56.3	405.5	28.16	400.6	28.26	371.2	25.94	356.4	24.79	341.8	23.66	319.6	21.98	290.1	19.83
326.7 (110%)	-4.0	-5.3	183.5	21.95	182.7	22.15	181.6	22.38	181.1	22.53	180.5	22.64	179.7	22.81	178.6	23.08
	5.0	3.2	212.2	22.95	211.4	23.18	210.2	23.47	209.7	23.61	208.9	23.76	208.1	24.00	206.9	24.28
	10.4	8.6	231.1	23.56	230.0	23.82	228.9	24.14	228.1	24.32	227.5	24.47	226.5	24.72	225.3	25.05
	15.8	14.0	250.1	24.21	249.2	24.47	247.6	24.82	247.0	24.99	246.2	25.17	245.1	25.45	243.7	25.81
	17.0	15.0	253.8	24.33	252.7	24.58	251.3	24.93	250.5							



Heating capacity at rated condition: 297 kBTu/h (22 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
297.0 (100%)	-4.0	-5.3	182.7	22.12	181.9	22.29	180.8	22.56	180.3	22.68	179.7	22.79	178.9	22.99	177.8	23.26
	5.0	3.2	211.3	23.18	210.5	23.39	209.2	23.70	208.6	23.85	208.0	24.00	207.2	24.23	205.9	24.51
	10.4	8.6	230.0	23.85	228.9	24.09	227.8	24.42	227.0	24.58	226.4	24.76	225.5	24.99	224.2	25.34
	15.8	14.0	248.9	24.53	247.8	24.79	246.4	25.14	245.6	25.32	245.0	25.52	243.9	25.79	240.5	25.88
	17.0	15.0	252.4	24.65	251.3	24.91	249.9	25.29	249.1	25.46	248.5	25.64	247.4	25.93	241.7	25.77
	23.0	21.2	274.3	25.43	273.0	25.73	271.5	26.11	270.7	26.32	269.9	26.51	266.4	26.54	241.7	23.93
	26.6	24.8	287.0	25.87	285.7	26.19	284.0	26.58	283.2	26.78	281.7	26.91	266.4	25.45	241.7	22.99
	30.2	28.4	299.8	26.32	298.4	26.64	296.5	27.07	294.8	27.18	284.9	26.26	266.4	24.45	241.7	22.07
	32.0	30.2	306.2	26.55	304.6	26.87	302.7	27.30	297.0	26.92	284.9	25.72	266.4	23.96	241.7	21.62
	35.6	33.8	319.0	26.98	317.3	27.31	309.3	27.03	297.0	25.86	284.9	24.71	266.4	23.01	241.7	20.78
	41.0	39.2	337.9	27.62	333.8	27.71	309.3	25.48	297.0	24.39	284.9	23.31	266.4	21.69	241.7	19.60
	47.0	43.0	350.9	28.05	333.8	26.58	309.3	24.47	297.0	23.41	284.9	22.38	266.4	20.82	241.7	18.83
	48.2	46.0	352.3	27.31	333.8	25.74	309.3	23.69	297.0	22.66	284.9	21.66	266.4	20.18	241.7	18.24
	53.6	51.1	352.3	25.86	333.8	24.38	309.3	22.44	297.0	21.47	284.9	20.53	266.4	19.11	241.7	17.28
	59.0	56.3	352.3	24.47	333.8	23.08	309.3	21.22	297.0	20.34	284.9	19.42	266.4	18.10	241.7	16.35
267.3 (90%)	-4.0	-5.3	181.9	22.33	181.0	22.50	179.9	22.76	179.4	22.88	178.8	23.00	178.0	23.20	176.9	23.43
	5.0	3.2	210.2	23.45	209.4	23.68	208.0	23.97	207.5	24.12	206.9	24.26	206.1	24.49	204.7	24.81
	10.4	8.6	228.6	24.18	227.7	24.44	226.4	24.76	225.8	24.93	225.0	25.09	224.2	25.34	217.5	24.96
	15.8	14.0	247.2	24.91	246.2	25.20	244.8	25.55	244.2	25.73	243.4	25.91	239.8	25.85	217.5	23.34
	17.0	15.0	250.8	25.06	249.7	25.32	248.3	25.70	247.5	25.87	246.9	26.05	239.8	25.54	217.5	23.07
	23.0	21.2	272.4	25.91	271.0	26.19	269.4	26.58	266.7	26.56	256.3	25.48	239.8	23.73	217.5	21.44
	26.6	24.8	284.8	26.40	283.5	26.69	278.3	26.68	267.3	25.56	256.3	24.43	239.8	22.76	217.5	20.58
	30.2	28.4	297.3	26.90	295.9	27.19	278.3	25.62	267.3	24.54	256.3	23.45	239.8	21.86	217.5	19.76
	32.0	30.2	303.5	27.13	300.5	27.27	278.3	25.10	267.3	24.05	256.3	22.99	239.8	21.43	217.5	19.39
	35.6	33.8	315.3	27.54	300.5	26.18	278.3	24.13	267.3	23.10	256.3	22.11	239.8	20.60	217.5	18.64
	41.0	39.2	317.1	26.18	300.5	24.69	278.3	22.75	267.3	21.77	256.3	20.84	239.8	19.42	217.5	17.58
	47.0	43.0	317.1	25.12	300.5	23.70	278.3	21.83	267.3	20.91	256.3	20.00	239.8	18.65	217.5	16.88
	48.2	46.0	317.1	24.34	300.5	22.95	278.3	21.16	267.3	20.25	256.3	19.39	239.8	18.06	217.5	16.36
	53.6	51.1	317.1	23.03	300.5	21.73	278.3	20.03	267.3	19.20	256.3	18.37	239.8	17.11	217.5	15.51
	59.0	56.3	317.1	21.81	300.5	20.57	278.3	18.96	267.3	18.18	256.3	17.39	239.8	16.21	217.5	14.67
237.6 (80%)	-4.0	-5.3	180.7	22.57	179.9	22.77	178.8	23.00	178.3	23.12	177.7	23.27	176.9	23.44	175.8	23.70
	5.0	3.2	208.8	23.80	208.0	24.03	206.6	24.33	206.1	24.47	205.5	24.61	204.7	24.85	193.6	23.68
	10.4	8.6	226.9	24.59	226.1	24.86	224.7	25.18	224.1	25.34	222.5	25.39	213.1	24.43	193.6	22.07
	15.8	14.0	245.3	25.41	244.2	25.67	242.3	25.96	237.6	25.62	227.9	24.49	213.1	22.85	193.6	20.66
	17.0	15.0	248.8	25.56	247.7	25.85	244.9	26.02	237.6	25.31	227.9	24.21	213.1	22.57	193.6	20.41
	23.0	21.2	269.9	26.49	266.6	26.55	247.5	24.54	237.6	23.52	227.9	22.49	213.1	20.98	193.6	18.99
	26.6	24.8	280.7	26.88	267.0	25.53	247.5	23.54	237.6	22.55	227.9	21.59	213.1	20.15	193.6	18.24
	30.2	28.4	281.9	25.97	267.0	24.50	247.5	22.60	237.6	21.66	227.9	20.73	213.1	19.34	193.6	17.52
	32.0	30.2	281.9	25.45	267.0	24.02	247.5	22.15	237.6	21.23	227.9	20.33	213.1	18.95	193.6	17.18
	35.6	33.8	281.9	24.45	267.0	23.08	247.5	21.29	237.6	20.41	227.9	19.52	213.1	18.23	193.6	16.52
	41.0	39.2	281.9	23.05	267.0	21.77	247.5	20.07	237.6	19.25	227.9	18.43	213.1	17.19	193.6	15.60
	47.0	43.0	281.9	22.12	267.0	20.90	247.5	19.29	237.6	18.49	227.9	17.70	213.1	16.53	193.6	14.97
	48.2	46.0	281.9	21.42	267.0	20.24	247.5	18.68	237.6	17.92	227.9	17.15	213.1	16.01	193.6	14.51
	53.6	51.1	281.9	20.29	267.0	19.17	247.5	17.70	237.6	16.96	227.9	16.25	213.1	15.17	193.6	13.78
	59.0	56.3	281.9	19.21	267.0	18.15	247.5	16.76	237.6	16.06	227.9	15.38	213.1	14.37	193.6	13.05
207.9 (70%)	-4.0	-5.3	179.3	22.89	178.5	23.09	177.4	23.33	176.9	23.44	176.3	23.59	175.5	23.76	169.4	23.24
	5.0	3.2	207.1	24.25	206.1	24.47	204.9	24.77	203.1	24.74	199.4	24.43	186.4	22.80	169.4	20.66
	10.4	8.6	224.9	25.14	223.9	25.39	216.4	24.84	207.9	23.80	199.4	22.78	186.4	21.26	169.4	19.28
	15.8	14.0	242.0	25.93	233.7	25.16	216.4	23.23	207.9	22.27	199.4	21.31	186.4	19.91	169.4	18.04
	17.0	15.0	244.6	26.00	233.7	24.85	216.4	22.95	207.9	21.98	199.4	21.06	186.4	19.65	169.4	17.83
	23.0	21.2	246.6	24.46	233.7	23.11	216.4	21.33	207.9	20.45	199.4	19.60	186.4	18.28	169.4	16.58
	26.6	24.8	246.6	23.45	233.7	22.17	216.4	20.47	207.9	19.62	199.4	18.80	186.4	17.57	169.4	15.93
	30.2	28.4	246.6	22.52	233.7	21.28	216.4	19.66	207.9	18.85	199.4	18.06	186.4	16.88	169.4	15.32
	32.0	30.2	246.6	22.08	233.7	20.86	216.4	19.27	207.9	18.48	199.4	17.71	186.4	16.54	169.4	15.01
	35.6	33.8	246.6	21.22	233.7	20.05	216.4	18.53	207.9	17.79	199.4	17.02	186.4	15.91	169.4	14.44
	41.0	39.2	246.6	20.01	233.7	18.92	216.4	17.49	207.9	16.78	199.4	16.07	186.4	15.01	169.4	13.65
	47.0	43.0	246.6	19.20	233.7	18.17	216.4	16.79	207.9	16.11	199.4	15.43	186.4	14.43	169.4	13.11
	48.2	46.0	246.6	18.59	233.7	17.60	216.4	16.27	207.9	15.62	199.4	14.97	186.4	14.00	169.4	12.70
	53.6	51.1	246.6	17.63	233.7	16.67	216.4	15.42	207.9	14.80	199.4	14.19	186.4	13.27	169.4	12.06
	59.0	56.3	246.6	16.70	233.7	15.80	216.4	14.62	207.9	14.02	199.4	13.43	186.4	12.57	169.4	11.42
178.2 (60%)	-4.0	-5.3	177.4	23.31	176.6	23.51	175.7	23.74	173.4	23.63	170.8	23.44	159.8	21.91	145.2	19.86
	5.0	3.2	204.2	24.78	200.2	24.57	185.6	22.69	178.2	21.76	170.8	20.86	159.8	19.47	145.2	17.67
	10.4	8.6	211.4	24.23	200.2	22.89	185.6	21.17	178.2	20.31	170.8	19.45	159.8	18.17	145.2	16.51
	15.8	14.0	211.4	22.65	200.2	21.42	185.6	19.82	178.2	19.00	170.8	18.21	159.8	17.01	145.2	

Heating capacity at rated condition: 297 kBtu/h (22 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
148.5 (50%)	-4.0	-5.3	172.6	23.55	166.9	22.90	154.6	21.19	148.5	20.33	142.4	19.49	133.1	18.22	121.0	16.56
	5.0	3.2	176.2	21.50	166.9	20.36	154.6	18.85	148.5	18.10	142.4	17.34	133.1	16.24	121.0	14.76
	10.4	8.6	176.2	20.06	166.9	18.99	154.6	17.59	148.5	16.89	142.4	16.20	133.1	15.17	121.0	13.80
	15.8	14.0	176.2	18.79	166.9	17.78	154.6	16.48	148.5	15.82	142.4	15.18	133.1	14.21	121.0	12.95
	17.0	15.0	176.2	18.56	166.9	17.58	154.6	16.28	148.5	15.64	142.4	15.00	133.1	14.04	121.0	12.80
	23.0	21.2	176.2	17.26	166.9	16.35	154.6	15.16	148.5	14.56	142.4	13.98	133.1	13.10	121.0	11.93
	26.6	24.8	176.2	16.57	166.9	15.72	154.6	14.57	148.5	14.00	142.4	13.43	133.1	12.58	121.0	11.47
	30.2	28.4	176.2	15.94	166.9	15.09	154.6	14.01	148.5	13.46	142.4	12.91	133.1	12.10	121.0	11.04
	32.0	30.2	176.2	15.63	166.9	14.80	154.6	13.74	148.5	13.19	142.4	12.66	133.1	11.87	121.0	10.84
	35.6	33.8	176.2	15.02	166.9	14.25	154.6	13.22	148.5	12.70	142.4	12.20	133.1	11.43	121.0	10.44
	41.0	39.2	176.2	14.19	166.9	13.46	154.6	12.48	148.5	12.01	142.4	11.53	133.1	10.80	121.0	9.89
	47.0	43.0	176.2	13.63	166.9	12.94	154.6	12.01	148.5	11.54	142.4	11.08	133.1	10.40	121.0	9.51
	48.2	46.0	176.2	13.22	166.9	12.53	154.6	11.64	148.5	11.20	142.4	10.75	133.1	10.08	121.0	9.22
	53.6	51.1	176.2	12.54	166.9	11.89	154.6	11.06	148.5	10.62	142.4	10.21	133.1	9.58	121.0	8.76
	59.0	56.3	176.2	11.90	166.9	11.28	154.6	10.47	148.5	10.09	142.4	9.68	133.1	9.09	121.0	8.32

MODEL  
SELECTIONMODEL  
SELECTION

# Model: AOUA288RLBVG1

MODEL  
SELECTIONMODEL  
SELECTION

Heating capacity at rated condition: 324 kBtu/h (24 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
486.0 (150%)	-4.0	-5.3	198.3	23.98	197.4	24.22	196.2	24.48	195.6	24.62	195.0	24.78	194.1	24.98	192.9	25.28
	5.0	3.2	230.7	24.92	229.8	25.15	228.6	25.51	227.7	25.68	227.1	25.85	226.2	26.11	225.0	26.45
	10.4	8.6	252.0	25.48	251.1	25.75	249.6	26.15	249.0	26.31	248.4	26.51	247.2	26.81	245.7	27.18
	15.8	14.0	273.9	26.05	272.7	26.35	271.2	26.75	270.3	26.95	269.7	27.18	268.5	27.48	267.0	27.88
	17.0	15.0	278.1	26.15	276.9	26.45	275.4	26.88	274.5	27.08	273.6	27.28	272.4	27.61	270.9	28.01
	23.0	21.2	303.3	26.78	302.1	27.11	300.3	27.54	299.4	27.78	298.5	28.01	297.3	28.34	295.5	28.81
	26.6	24.8	318.3	27.14	317.1	27.48	315.0	27.94	314.1	28.18	313.2	28.41	311.7	28.77	309.9	29.24
	30.2	28.4	333.6	27.48	332.1	27.84	330.0	28.34	328.8	28.58	327.9	28.81	326.4	29.17	324.3	29.67
	32.0	30.2	341.1	27.64	339.6	28.01	337.5	28.51	336.3	28.77	335.4	29.01	333.6	29.37	331.5	29.87
	35.6	33.8	356.1	28.01	354.6	28.38	352.2	28.87	351.3	29.14	350.1	29.41	348.3	29.77	345.9	30.31
	41.0	39.2	379.2	28.51	377.1	28.91	374.7	29.44	373.5	29.71	372.3	29.97	370.2	30.37	367.8	30.90
	47.0	43.0	395.1	28.84	393.3	29.24	390.6	29.81	389.1	30.07	387.9	30.34	385.8	30.77	383.1	31.30
	48.2	46.0	408.0	29.11	405.9	29.51	403.2	30.07	401.7	30.34	400.2	30.64	398.1	31.07	395.1	31.64
	53.6	51.1	429.6	29.51	427.5	29.94	424.2	30.54	422.7	30.80	421.2	31.10	418.8	31.54	415.4	32.07
	59.0	56.3	451.8	29.94	449.4	30.37	445.8	30.97	444.0	31.27	442.2	31.57	439.5	31.60	435.7	32.34
453.6 (140%)	-4.0	-5.3	198.0	24.08	197.1	24.32	195.9	24.58	195.3	24.72	194.7	24.88	193.8	25.08	192.3	25.38
	5.0	3.2	230.1	25.05	229.2	25.32	228.0	25.65	227.4	25.81	226.8	25.98	225.6	26.25	224.4	26.58
	10.4	8.6	251.4	25.65	250.5	25.91	249.0	26.31	248.4	26.48	247.5	26.68	246.6	26.98	245.1	27.34
	15.8	14.0	273.0	26.25	272.1	26.55	270.6	26.95	269.7	27.14	268.8	27.34	267.6	27.68	265.1	28.08
	17.0	15.0	277.2	26.35	276.0	26.65	274.5	27.08	273.6	27.28	273.0	27.48	271.8	27.81	270.0	28.21
	23.0	21.2	302.4	27.01	301.2	27.34	299.4	27.81	298.5	28.01	297.6	28.24	296.4	28.58	294.6	29.04
	26.6	24.8	317.4	27.38	315.9	27.74	314.1	28.21	313.2	28.44	312.3	28.68	310.8	29.04	308.7	29.51
	30.2	28.4	332.4	27.78	330.9	28.14	328.8	28.61	327.6	28.84	326.7	29.11	325.2	29.47	323.1	29.97
	32.0	30.2	339.9	27.94	338.1	28.31	336.0	28.81	335.1	29.07	333.9	29.31	332.4	29.67	330.3	30.17
	35.6	33.8	354.9	28.31	353.1	28.71	351.0	29.21	349.8	29.47	348.6	29.71	346.8	30.11	344.7	30.60
	41.0	39.2	377.4	28.84	375.6	29.24	373.2	29.77	371.7	30.04	370.5	30.31	368.7	30.70	366.0	31.27
	47.0	43.0	393.3	29.21	391.5	29.64	388.8	30.17	387.3	30.44	386.1	30.74	384.0	31.14	369.3	30.34
	48.2	46.0	405.9	29.51	403.8	29.91	401.1	30.47	399.6	30.74	398.1	31.04	396.0	31.47	369.3	29.34
	53.6	51.1	427.5	29.97	425.1	30.40	421.8	30.97	420.3	31.27	418.8	31.54	416.8	31.94	413.4	32.41
	59.0	56.3	449.1	30.40	446.4	30.84	443.1	31.44	441.3	31.74	439.5	32.04	437.5	32.34	434.1	32.81
421.2 (130%)	-4.0	-5.3	197.4	24.22	196.5	24.42	195.3	24.72	194.7	24.85	194.1	24.98	193.2	25.22	192.0	25.48
	5.0	3.2	229.5	25.22	228.6	25.45	227.4	25.81	226.8	25.98	225.9	26.15	225.0	26.41	223.8	26.75
	10.4	8.6	250.8	25.85	249.6	26.11	248.4	26.48	247.5	26.68	246.9	26.88	245.7	27.14	244.5	27.54
	15.8	14.0	272.4	26.48	271.2	26.78	269.7	27.18	268.8	27.38	268.2	27.58	267.0	27.91	265.2	28.31
	17.0	15.0	276.3	26.58	275.1	26.88	273.6	27.31	272.7	27.51	272.1	27.71	270.9	28.04	269.4	28.44
	23.0	21.2	301.5	27.28	300.0	27.61	298.5	28.08	297.6	28.31	296.7	28.51	295.2	28.87	293.4	29.31
	26.6	24.8	316.2	27.68	314.7	28.04	312.9	28.51	312.0	28.74	310.8	28.97	309.6	29.34	307.5	29.81
	30.2	28.4	330.9	28.11	329.4	28.44	327.3	28.94	326.4	29.17	325.2	29.44	323.7	29.81	321.6	30.27
	32.0	30.2	338.4	28.31	336.9	28.68	334.8	29.14	333.6	29.41	332.7	29.64	330.9	30.01	328.8	30.50
	35.6	33.8	353.1	28.68	351.6	29.07	349.2	29.57	348.0	29.84	347.1	30.07	345.3	30.47	342.9	30.97
	41.0	39.2	375.6	29.27	373.5	29.67	371.1	30.21	369.9	30.47	368.7	30.74	366.6	31.14	364.2	31.54
	47.0	43.0	391.2	29.64	389.1	30.07	386.4	30.60	385.2	30.87	383.7	31.17	377.7	31.10	374.9	31.54
	48.2	46.0	403.8	29.97	401.4	30.37	398.7	30.94	397.2	31.20	395.7	31.50	393.7	31.81	391.7	32.11
	53.6	51.1	424.5	30.47	422.4	30.90	419.1	31.47	417.6	31.74	416.0	32.04	414.0	32.34	411.6	32.74
	59.0	56.3	446.1	30.94	443.4	31.40	439.6	31.84	437.1	32.14	434.6	32.44	432.1	32.74	429.6	33.04
388.8 (120%)	-4.0	-5.3	196.8	24.35	195.9	24.55	194.7	24.85	194.1	24.98	193.5	25.12	192.6	25.35	191.4	25.61
	5.0	3.2	228.9	25.38	228.0	25.65	226.5	25.98	225.9	26.15	225.3	26.31	224.4	26.58	222.9	26.95
	10.4	8.6	249.9	26.05	249.0	26.35	247.5	26.71	246.9	26.91	246.0	27.08	245.1	27.38	243.6	27.74
	15.8	14.0	271.2	26.71	270.0	27.05	268.5	27.44	267.9	27.64	267.0	27.84	265.8	28.14	264.3	28.58
	17.0	15.0	275.4	26.85	274.2	27.14	272.7	27.58	271.8	27.78	270.9	27.98	269.7	28.31	268.2	28.71
	23.0	21.2	300.3	27.61	298.8	27.94	297.0	28.38	296.1	28.61	295.2	28.84	294.0	29.17	292.2	29.64
	26.6	24.8	314.7	28.04	313.2	28.38	311.4	28.84	310.5	29.07	309.6	29.34	308.1	29.67	306.3	30.14
	30.2	28.4	329.4	28.48	327.9	28.84	325.8	29.31	324.9	29.57	323.7	29.81	322.2	30.17	319.5	30.57
	32.0	30.2	336.6	28.68	335.1	29.04	333.0	29.54	331.8	29.81	330.9	30.04	329.4	30.40	326.5	30.81
	35.6	33.8	351.3	29.11	349.5	29.51	347.4	30.01	346.2	30.24	345.0	30.50	343.5	30.90	340.5	31.31
	41.0	39.2	373.2	29.74	371.4	30.14	369.0	30.67	367.5	30.94	366.3	31.20	364.6	31.54	361.7	31.95
	47.0	43.0	388.8	30.17	386.7	30.57	384.0	31.10	382.8	31.37	381.7	31.64	379.6	32.04	376.7	32.45
	48.2	46.0	400.8	30.50	398.7	30.90	396.0	31.47	394.8	31.74	393.7	32.01	391.6	32.34	388.7	32.75
	53.6	51.1	421.5	31.04	419.1	31.47	416.0	31.94	414.8	32.21	413.7	32.48	411.6	32.81	408.7	33.22
	59.0	56.3	442.2	31.57	439.1	32.04	435.0	32.51	433.8	32.78	432.7	33.05	430.6	33.38	427.7	33.79
356.4 (110%)	-4.0	-5.3	196.2	24.48	195.3	24.72	194.1	24.98	193.5	25.15	192.9	25.28	192.0	25.48	190.8	25.78
	5.0	3.2	228.0	25.61	227.1	25.88	225.9	26.21	225.3	26.38	224.4	26.55	223.5	26.81	222.3	27.14
	10.4	8.6	249.0	26.31	247.8	26.61	246.6	26.98	245.7	27.18	245.1	27.34	243.9	27.64	242.7	28.01
	15.8	14.0	270.0	27.05	269.1	27.34	267.3	27.74	266.7	27.94	265.8	28.14	264.6	28.48	263.1	28.87
	17.0	15.0	274.2	27.18	273.0	27.48	271.5	27.88	270.6							

Heating capacity at rated condition: 324 kBTu/h (24 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
324.0 (100%)	-4.0	-5.3	195.3	24.68	194.4	24.88	193.2	25.18	192.6	25.32	192.0	25.45	191.1	25.68	189.9	25.98
	5.0	3.2	227.1	25.88	226.2	26.11	224.7	26.48	224.1	26.65	223.5	26.81	222.6	27.08	221.1	27.41
	10.4	8.6	247.8	26.65	246.6	26.91	245.4	27.28	244.5	27.48	243.9	27.68	243.0	27.94	241.5	28.34
	15.8	14.0	268.8	27.41	267.6	27.71	266.1	28.11	265.2	28.31	264.6	28.54	263.4	28.84	261.9	29.24
	17.0	15.0	272.7	27.54	271.5	27.84	270.0	28.28	269.1	28.48	268.5	28.68	267.3	29.01	263.7	29.17
	23.0	21.2	297.0	28.44	295.5	28.77	294.0	29.21	293.1	29.44	292.2	29.67	290.7	29.97	263.7	27.01
	26.6	24.8	311.1	28.94	309.6	29.31	307.8	29.74	306.9	29.97	306.0	30.21	290.7	28.71	263.7	25.91
	30.2	28.4	325.2	29.44	323.7	29.81	321.6	30.31	320.7	30.54	310.8	29.61	290.7	27.54	263.7	24.85
	32.0	30.2	332.4	29.71	330.6	30.07	328.5	30.57	324.0	30.34	310.8	28.97	290.7	26.98	263.7	24.32
	35.6	33.8	346.5	30.21	344.7	30.57	337.5	30.44	324.0	29.11	310.8	27.81	290.7	25.88	263.7	23.35
	41.0	39.2	367.5	30.94	364.2	31.17	337.5	28.64	324.0	27.41	310.8	26.18	290.7	24.35	263.7	21.99
	47.0	43.0	382.2	31.47	364.2	29.87	337.5	27.48	324.0	26.28	310.8	25.12	290.7	23.35	263.7	21.09
	48.2	46.0	384.3	30.67	364.2	28.91	337.5	26.58	324.0	25.42	310.8	24.28	290.7	22.62	263.7	20.43
	53.6	51.1	384.3	29.01	364.2	27.34	337.5	25.15	324.0	24.05	310.8	22.99	290.7	21.39	263.7	19.33
	59.0	56.3	384.3	27.41	364.2	25.85	337.5	23.75	324.0	22.75	310.8	21.72	290.7	20.23	263.7	18.26
291.6 (90%)	-4.0	-5.3	194.4	24.92	193.5	25.12	192.3	25.42	191.7	25.55	191.1	25.68	190.2	25.91	189.0	26.18
	5.0	3.2	225.9	26.18	225.0	26.45	223.5	26.78	222.9	26.95	222.3	27.11	221.4	27.38	219.9	27.74
	10.4	8.6	246.3	27.01	245.4	27.31	243.9	27.68	243.3	27.88	242.4	28.04	241.5	28.34	237.3	28.31
	15.8	14.0	267.0	27.84	265.8	28.18	264.3	28.58	263.7	28.77	262.8	28.97	261.6	29.27	237.3	26.41
	17.0	15.0	270.9	28.01	269.7	28.31	268.2	28.74	267.3	28.94	266.7	29.14	261.6	28.91	237.3	26.08
	23.0	21.2	294.9	28.97	293.4	29.31	291.6	29.74	290.7	29.97	279.6	28.77	261.6	26.78	237.3	24.18
	26.6	24.8	308.7	29.54	307.2	29.87	303.6	30.11	291.6	28.84	279.6	27.54	261.6	25.65	237.3	23.19
	30.2	28.4	322.5	30.11	321.0	30.44	303.6	28.87	291.6	27.64	279.6	26.41	261.6	24.62	237.3	22.22
	32.0	30.2	329.4	30.37	327.9	30.74	303.6	28.28	291.6	27.08	279.6	25.88	261.6	24.12	237.3	21.79
	35.6	33.8	343.2	30.94	327.9	29.47	303.6	27.14	291.6	25.98	279.6	24.85	261.6	23.15	237.3	20.92
	41.0	39.2	345.9	29.44	327.9	27.74	303.6	25.55	291.6	24.45	279.6	23.39	261.6	21.79	237.3	19.69
	47.0	43.0	345.9	28.21	327.9	26.61	303.6	24.48	291.6	23.45	279.6	22.42	261.6	20.89	237.3	18.89
	48.2	46.0	345.9	27.31	327.9	25.75	303.6	23.72	291.6	22.69	279.6	21.72	261.6	20.23	237.3	18.30
	53.6	51.1	345.9	25.81	327.9	24.35	303.6	22.42	291.6	21.49	279.6	20.56	261.6	19.13	237.3	17.33
	59.0	56.3	345.9	24.42	327.9	23.02	303.6	21.19	291.6	20.33	279.6	19.43	261.6	18.10	237.3	16.37
259.2 (80%)	-4.0	-5.3	193.2	25.18	192.3	25.42	191.1	25.68	190.5	25.81	189.9	25.98	189.0	26.18	187.8	26.48
	5.0	3.2	224.4	26.58	223.5	26.85	222.0	27.18	221.4	27.34	220.8	27.51	219.9	27.78	211.2	26.91
	10.4	8.6	244.5	27.48	243.6	27.78	242.1	28.14	241.5	28.34	240.6	28.51	232.5	27.71	211.2	25.02
	15.8	14.0	264.9	28.41	263.7	28.71	262.2	29.11	259.2	29.01	248.7	27.71	232.5	25.85	211.2	23.35
	17.0	15.0	268.8	28.58	267.6	28.91	266.1	29.31	259.2	28.64	248.7	27.38	232.5	25.51	211.2	23.05
	23.0	21.2	292.2	29.64	290.7	29.97	270.0	27.71	259.2	26.55	248.7	25.38	232.5	23.65	211.2	21.39
	26.6	24.8	305.7	30.27	291.3	28.81	270.0	26.55	259.2	25.42	248.7	24.32	232.5	22.69	211.2	20.53
	30.2	28.4	307.5	29.27	291.3	27.61	270.0	25.45	259.2	24.38	248.7	23.32	232.5	21.76	211.2	19.69
	32.0	30.2	307.5	28.68	291.3	27.05	270.0	24.92	259.2	23.88	248.7	22.85	232.5	21.29	211.2	19.29
	35.6	33.8	307.5	27.51	291.3	25.95	270.0	23.92	259.2	22.92	248.7	21.92	232.5	20.46	211.2	18.53
	41.0	39.2	307.5	25.88	291.3	24.45	270.0	22.52	259.2	21.59	248.7	20.66	232.5	19.26	211.2	17.46
	47.0	43.0	307.5	24.82	291.3	23.45	270.0	21.62	259.2	20.72	248.7	19.83	232.5	18.50	211.2	16.73
	48.2	46.0	307.5	24.02	291.3	22.69	270.0	20.92	259.2	20.06	248.7	19.19	232.5	17.90	211.2	16.20
	53.6	51.1	307.5	22.72	291.3	21.46	270.0	19.79	259.2	18.96	248.7	18.16	232.5	16.93	211.2	15.37
	59.0	56.3	307.5	21.49	291.3	20.29	270.0	18.73	259.2	17.93	248.7	17.17	232.5	16.03	211.2	14.54
226.8 (70%)	-4.0	-5.3	191.7	25.55	190.8	25.78	189.6	26.05	189.0	26.18	188.4	26.35	187.5	26.55	184.8	26.55
	5.0	3.2	222.6	27.08	221.4	27.34	220.2	27.68	219.6	27.84	217.5	27.78	203.4	25.91	184.8	23.45
	10.4	8.6	242.4	28.11	241.2	28.38	236.1	28.18	226.8	26.98	217.5	25.81	203.4	24.08	184.8	21.82
	15.8	14.0	262.2	29.11	255.0	28.48	236.1	26.28	226.8	25.18	217.5	24.08	203.4	22.49	184.8	20.36
	17.0	15.0	266.1	29.31	255.0	28.11	236.1	25.95	226.8	24.85	217.5	23.79	203.4	22.19	184.8	20.13
	23.0	21.2	269.1	27.61	255.0	26.08	236.1	24.05	226.8	23.05	217.5	22.09	203.4	20.59	184.8	18.66
	26.6	24.8	269.1	26.45	255.0	24.98	236.1	23.05	226.8	22.09	217.5	21.16	203.4	19.76	184.8	17.90
	30.2	28.4	269.1	25.35	255.0	23.95	236.1	22.12	226.8	21.19	217.5	20.29	203.4	18.96	184.8	17.20
	32.0	30.2	269.1	24.85	255.0	23.45	236.1	21.66	226.8	20.76	217.5	19.89	203.4	18.56	184.8	16.83
	35.6	33.8	269.1	23.85	255.0	22.52	236.1	20.79	226.8	19.96	217.5	19.09	203.4	17.83	184.8	16.17
	41.0	39.2	269.1	22.45	255.0	21.22	236.1	19.59	226.8	18.80	217.5	18.00	203.4	16.80	184.8	15.27
	47.0	43.0	269.1	21.52	255.0	20.36	236.1	18.80	226.8	18.03	217.5	17.26	203.4	16.13	184.8	14.64
	48.2	46.0	269.1	20.82	255.0	19.69	236.1	18.20	226.8	17.46	217.5	16.73	203.4	15.63	184.8	14.17
	53.6	51.1	269.1	19.73	255.0	18.63	236.1	17.23	226.8	16.53	217.5	15.83	203.4	14.80	184.8	13.44
	59.0	56.3	269.1	18.66	255.0	17.63	236.1	16.30	226.8	15.63	217.5	14.97	203.4	14.00	184.8	12.71
194.4 (60%)	-4.0	-5.3	189.6	26.01	188.7	26.25	187.8	26.51	187.2	26.68	186.3	26.78	174.3	25.02	158.4	22.65
	5.0	3.2	219.9	27.74	218.4	27.94	202.5	25.78	194.4	24.72	186.3	23.69	174.3	22.09	158.4	20.03
	10.4	8.6	230.7	27.48	218.4	25.95	202.5	23.98	194.4	22.99	186.3	22.02	174.3	20.56	158.4	18.66
	15.8	14.0	230.7	25.61	218.4	24.22	202.5	22.39	194.4	21.46	186.3	20.56	174.3	19.19	158.4	

Heating capacity at rated condition: 324 kBtu/h (24 ton)																
Total rated capacity of indoor unit	Outdoor temperature		Indoor temperature													
			61°FDB		64°FDB		68°FDB		70°FDB		72°FDB		75°FDB		79°FDB	
	°FDB	°FWB	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP	TC	IP
162.0 (50%)	-4.0	-5.3	186.9	26.68	182.1	26.15	168.6	24.18	162.0	23.19	155.4	22.22	145.2	20.76	132.0	18.86
	5.0	3.2	192.3	24.42	182.1	23.12	168.6	21.39	162.0	20.53	155.4	19.66	145.2	18.40	132.0	16.70
	10.4	8.6	192.3	22.72	182.1	21.49	168.6	19.89	162.0	19.09	155.4	18.30	145.2	17.13	132.0	15.57
	15.8	14.0	192.3	21.22	182.1	20.06	168.6	18.60	162.0	17.83	155.4	17.10	145.2	16.00	132.0	14.57
	17.0	15.0	192.3	20.96	182.1	19.83	168.6	18.36	162.0	17.63	155.4	16.90	145.2	15.80	132.0	14.40
	23.0	21.2	192.3	19.43	182.1	18.40	168.6	17.03	162.0	16.37	155.4	15.70	145.2	14.70	132.0	13.37
	26.6	24.8	192.3	18.63	182.1	17.66	168.6	16.37	162.0	15.70	155.4	15.07	145.2	14.10	132.0	12.84
	30.2	28.4	192.3	17.90	182.1	16.93	168.6	15.70	162.0	15.07	155.4	14.47	145.2	13.54	132.0	12.34
	32.0	30.2	192.3	17.53	182.1	16.60	168.6	15.40	162.0	14.77	155.4	14.17	145.2	13.27	132.0	12.11
	35.6	33.8	192.3	16.83	182.1	15.97	168.6	14.80	162.0	14.20	155.4	13.64	145.2	12.77	132.0	11.64
	41.0	39.2	192.3	15.87	182.1	15.04	168.6	13.94	162.0	13.41	155.4	12.87	145.2	12.04	132.0	11.01
	47.0	43.0	192.3	15.24	182.1	14.44	168.6	13.41	162.0	12.87	155.4	12.34	145.2	11.58	132.0	10.58
	48.2	46.0	192.3	14.77	182.1	13.97	168.6	12.97	162.0	12.47	155.4	11.98	145.2	11.21	132.0	10.25
	53.6	51.1	192.3	13.97	182.1	13.24	168.6	12.31	162.0	11.81	155.4	11.34	145.2	10.65	132.0	9.71
	59.0	56.3	192.3	13.24	182.1	12.54	168.6	11.64	162.0	11.21	155.4	10.74	145.2	10.08	132.0	9.21

MODEL  
SELECTIONMODEL  
SELECTION


## 6. Heating capacity curve (Outdoor unit)

Heating capacity curve is a diagram showing the rate of decrease in rated capacity as the outside air temperature decreases.


**NOTE:** Capacity below -4 °FDB (-20 °CDB) is not guaranteed.

### 6-1. Stand-alone


#### ■ Model: AOUA72RLBV1

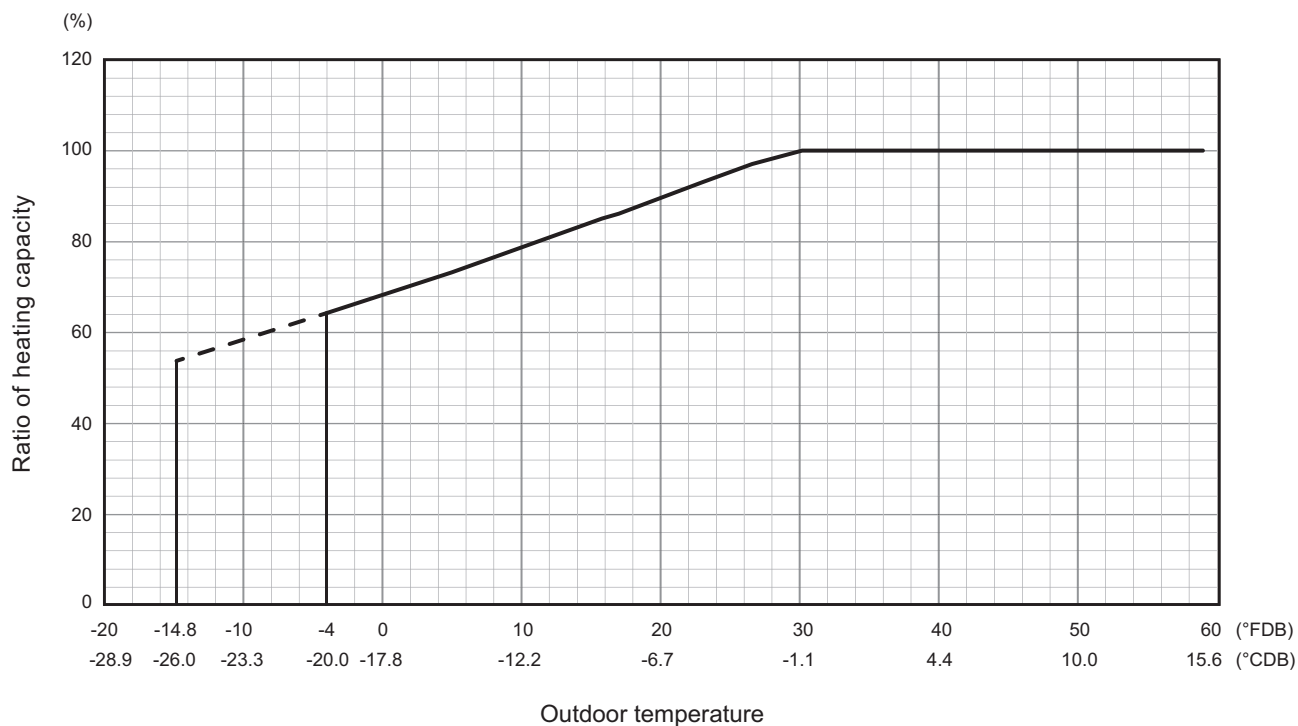

#### ■ Model: AOUA96RLBV1

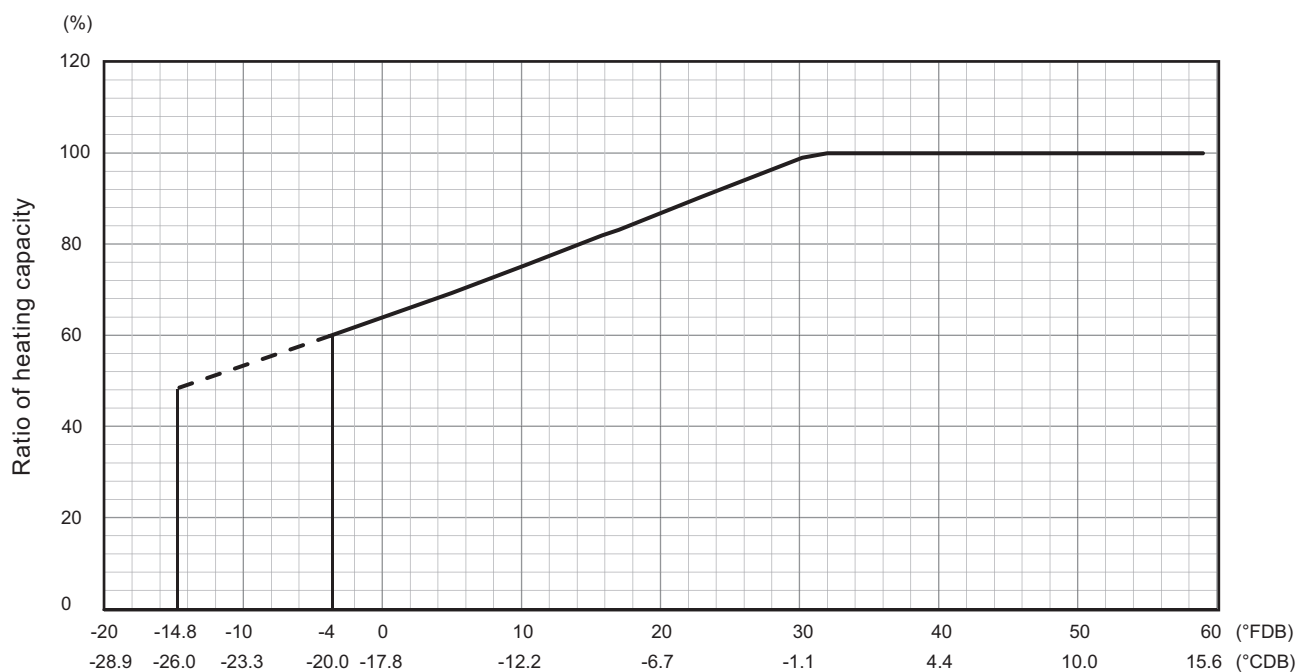


Model: AOUA120RLBV1

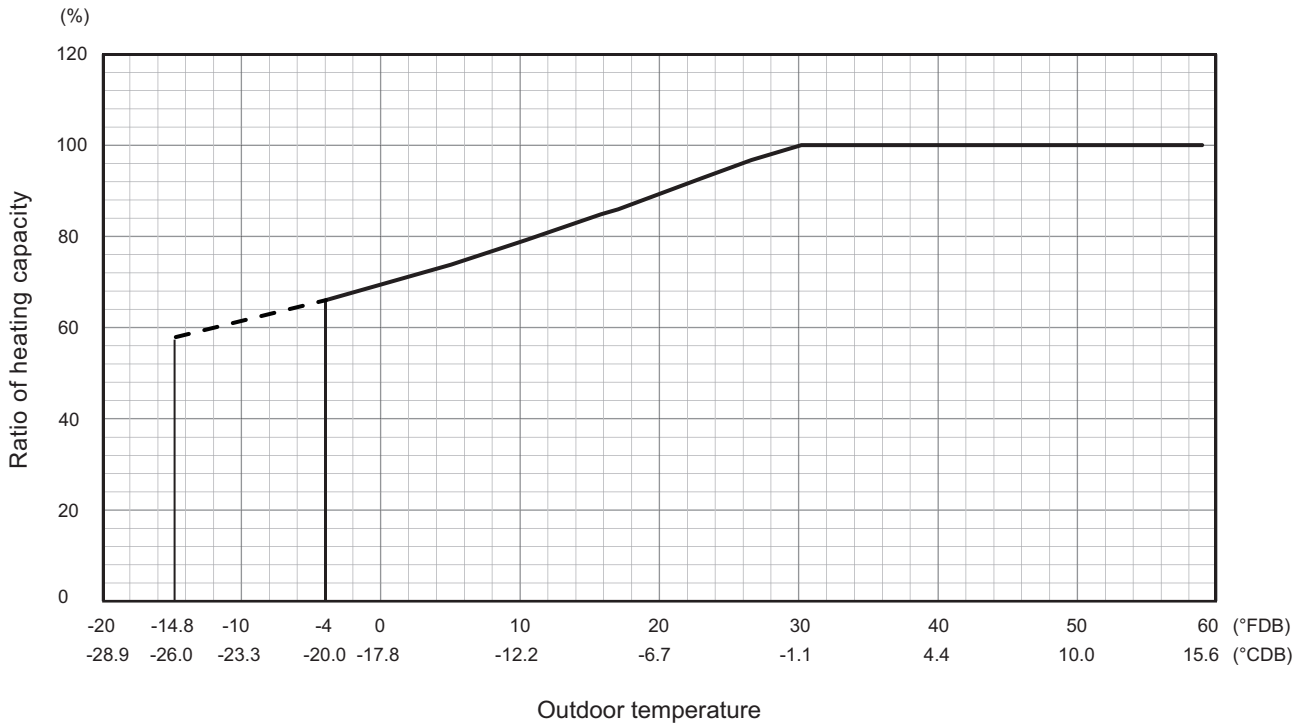


## 6-2. Combination

### ■ Model: AOUA144RLBVG1

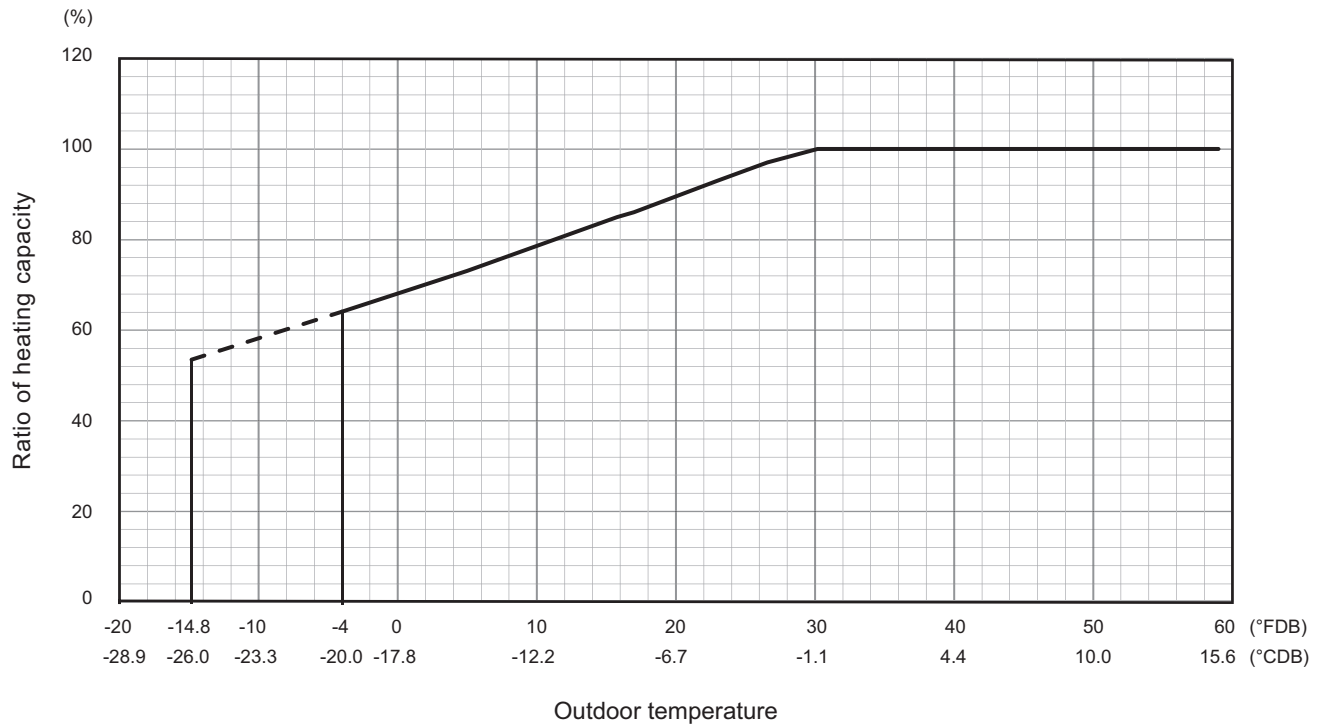


### ■ Model: AOUA168RLBVG1

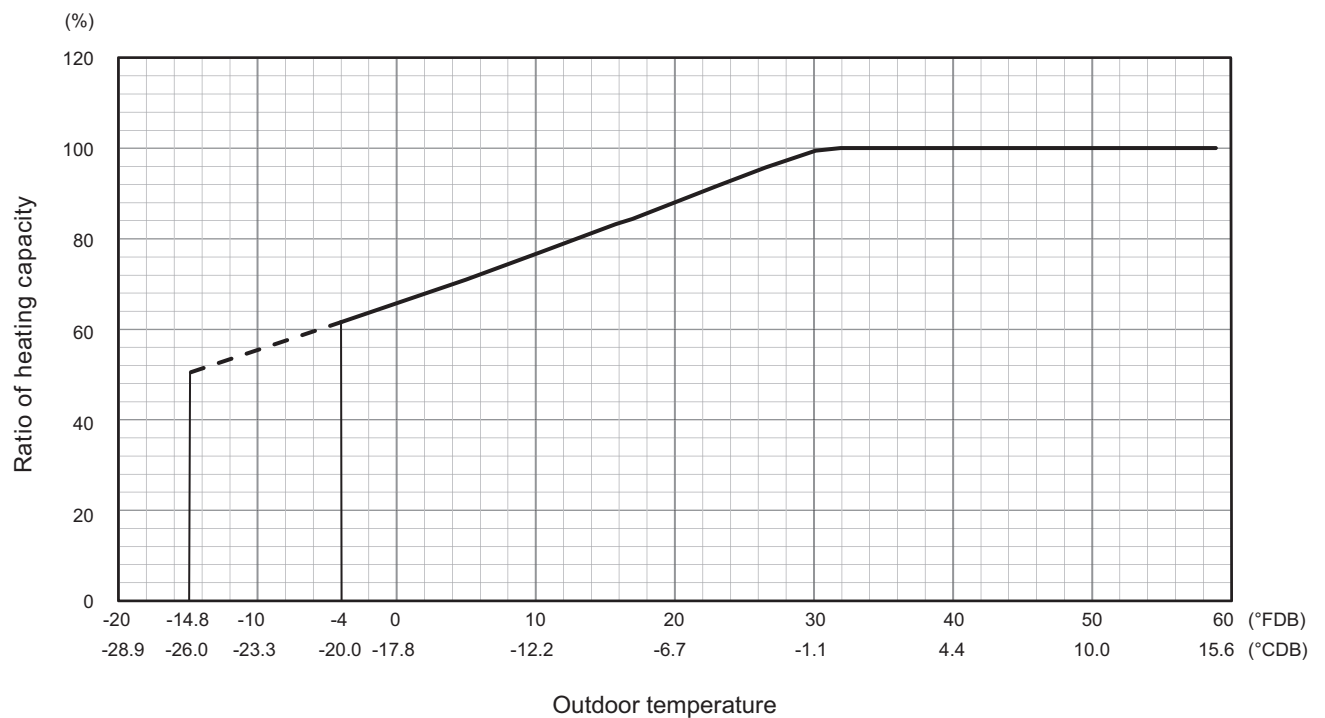





Model: AOUA192RLBVG1

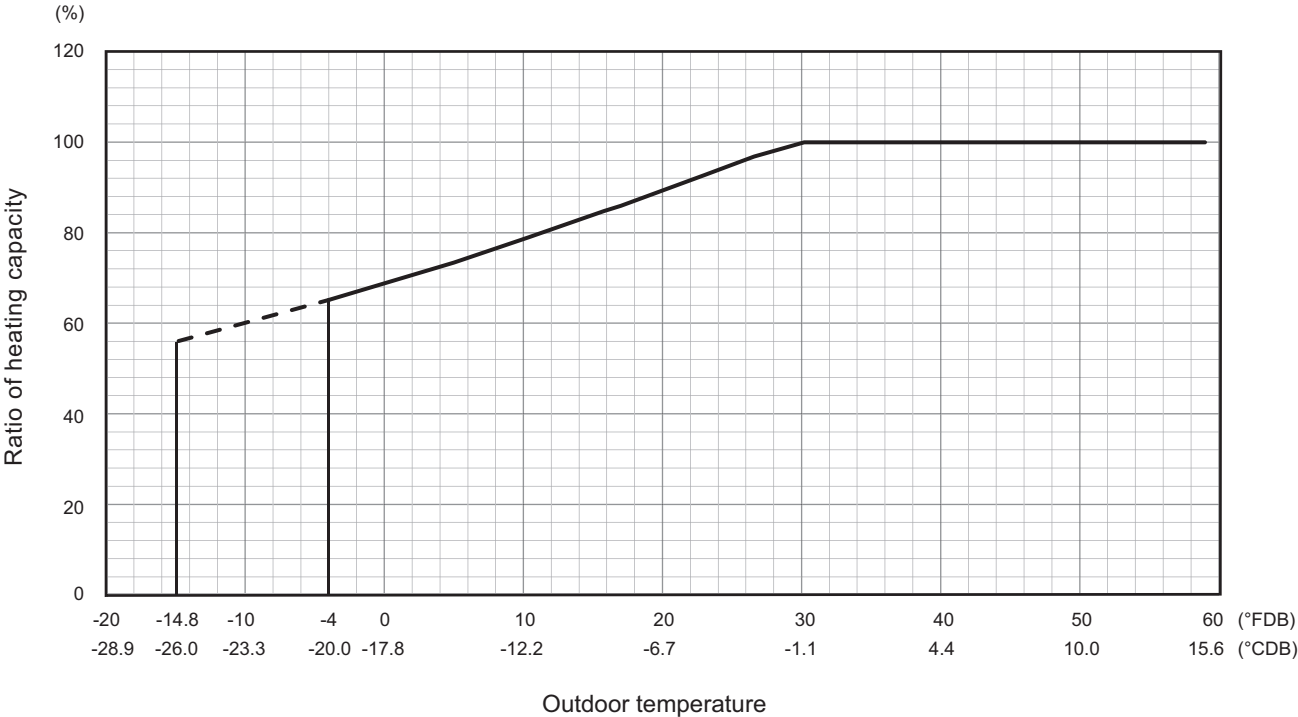


Model: AOUA216RLBVG1

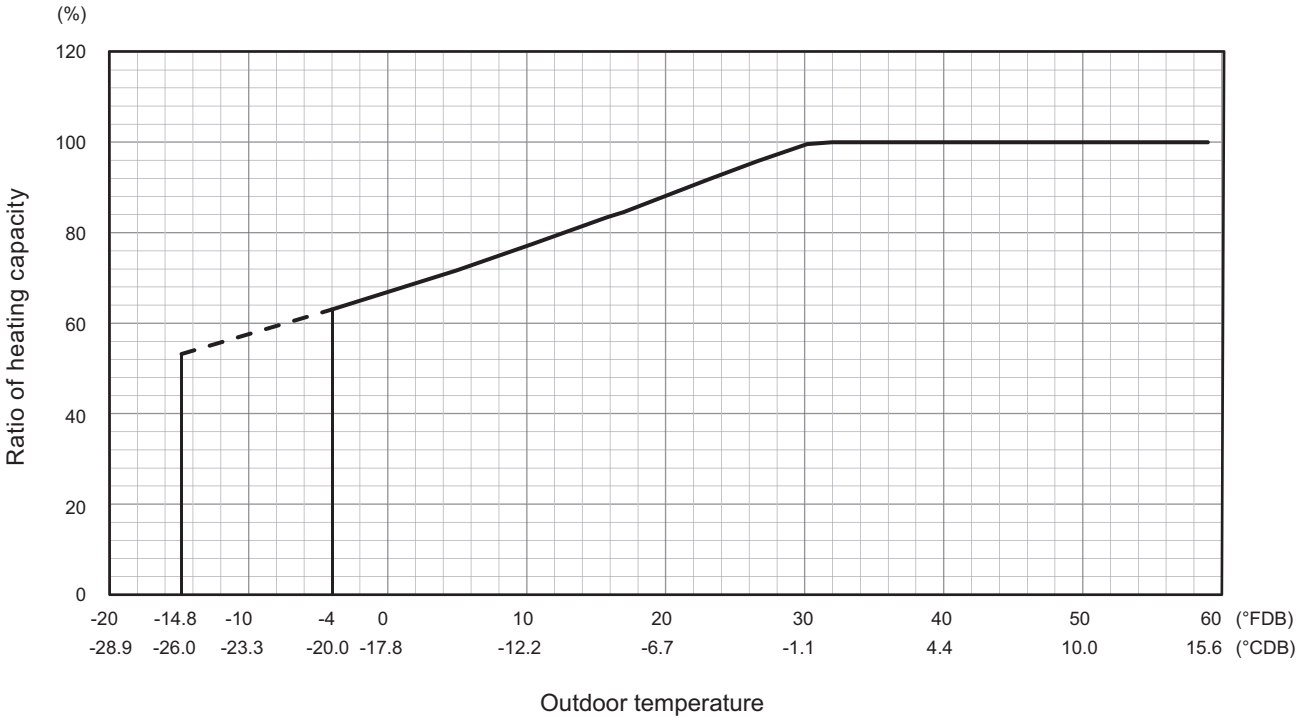


Model: AOUA240RLBVG1

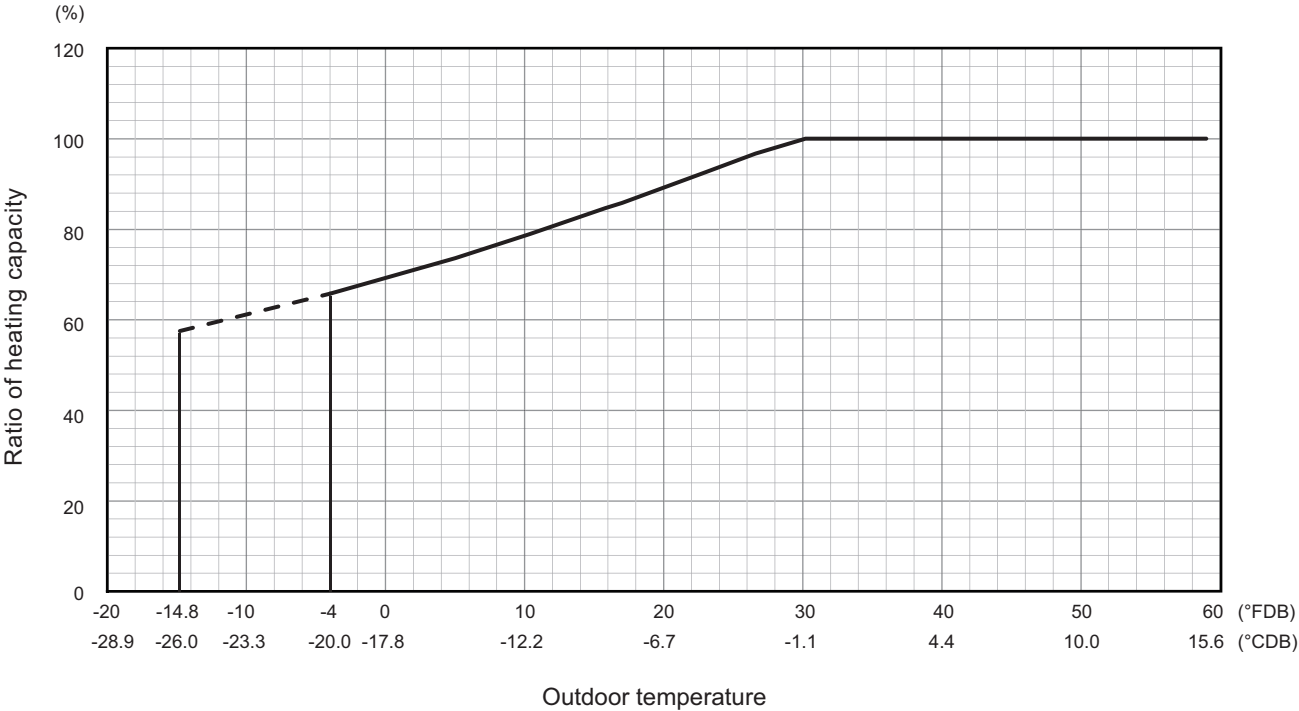

Model: AOUA264RLBVG1

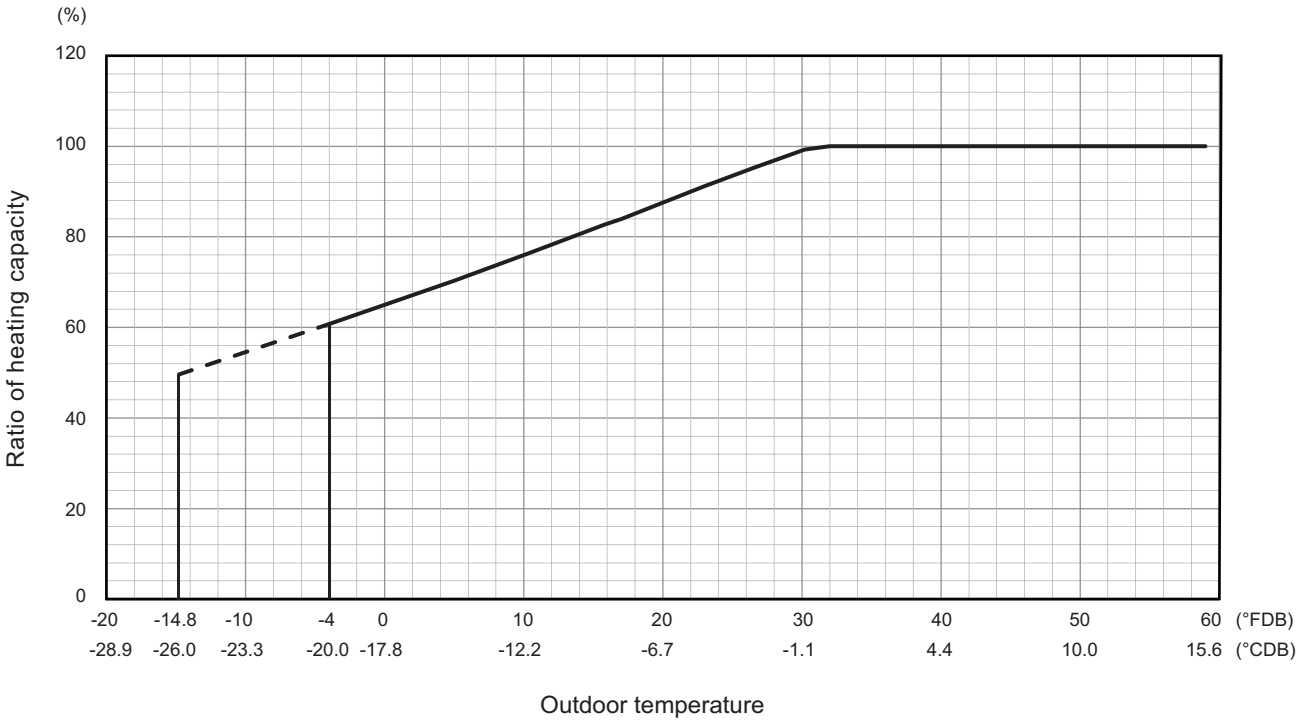

Model: AOUA288RLBVG1

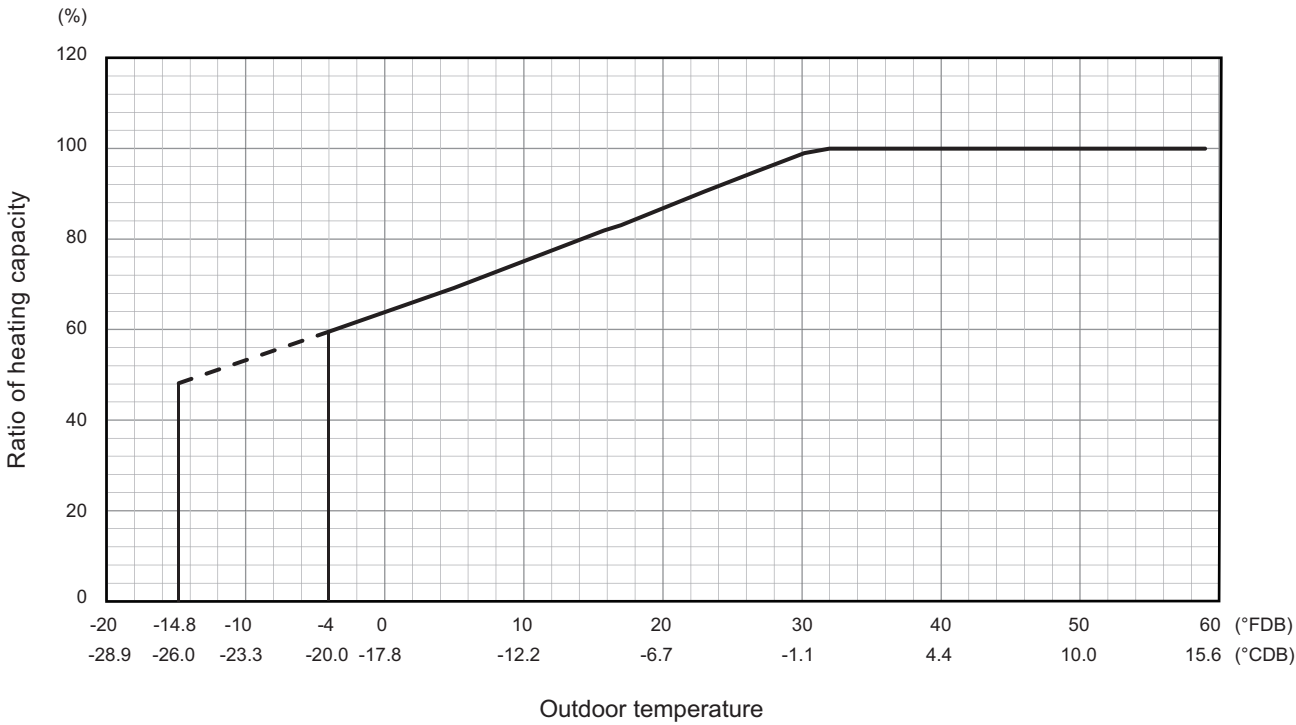

MODEL  
SELECTION

MODEL  
SELECTION





### 3. OUTDOOR UNITS

# CONTENTS

## 3. OUTDOOR UNITS

<b>1. Model lineup .....</b>	<b>03-1</b>
1-1. Stand-alone .....	03-1
1-2. Combination .....	03-2
<b>2. Specifications .....</b>	<b>03-3</b>
2-1. Stand-alone .....	03-3
2-2. Combination .....	03-5
<b>3. Dimensions .....</b>	<b>03-9</b>
3-1. Stand-alone .....	03-9
3-2. Combination .....	03-17
<b>4. Installation space .....</b>	<b>03-22</b>
4-1. When installing in front of height-restricted wall .....	03-22
4-2. When installing in front of wall with no specific height-restriction .....	03-24
4-3. When there is an obstruction above the product .....	03-26
4-4. Concentrated installation example .....	03-27
4-5. Installation on each floor .....	03-30
<b>5. Refrigerant circuit .....</b>	<b>03-31</b>
5-1. Models: AOUA72RLBV1, AOUA96RLBV1, andAOUA120RLBV1 .....	03-31
5-2. Symbol description .....	03-32
<b>6. Wiring diagrams .....</b>	<b>03-33</b>
6-1. Models: AOUA72RLBV1, AOUA96RLBV1, andAOUA120RLBV1 .....	03-33
<b>7. Operation range .....</b>	<b>03-34</b>
7-1. Outdoor unit .....	03-34
7-2. Indoor unit .....	03-34
<b>8. Operation noise (sound pressure) .....</b>	<b>03-35</b>
8-1. Noise level curve .....	03-35
8-2. Sound level check point .....	03-36
<b>9. Electrical characteristics .....</b>	<b>03-37</b>
9-1. Stand-alone .....	03-37
9-2. Combination .....	03-38
<b>10. Safety devices .....</b>	<b>03-39</b>
<b>11. Locally purchased parts .....</b>	<b>03-40</b>
11-1. Air discharge duct .....	03-40
11-2. Snow hood .....	03-43
11-3. Pressure gauge .....	03-46
11-4. Central drain pan .....	03-49
<b>12. Accessories .....</b>	<b>03-51</b>
12-1. Stand-alone .....	03-51

# 1. Model lineup

## 1-1. Stand-alone



Ton	Cooling capacity (Btu/h)	Model name
6	72,000	AQUA72RLBV1
8	96,000	AQUA96RLBV1



Ton	Cooling capacity (Btu/h)	Model name
10	120,000	AQUA120RLBV1

## 1-2. Combination

Combinations other than followings are prohibited.

Ton	Cooling capacity (Btu/h)	Set model name	Model name			Maximum number of connectable indoor units
			Unit 1	Unit 2	Unit 3	
12	144,000	AOUA144RLBVG1	AOUA72RLBV1	AOUA72RLBV1	—	32
14	168,000	AOUA168RLBVG1	AOUA96RLBV1	AOUA72RLBV1	—	37
16	192,000	AOUA192RLBVG1	AOUA120RLBV1	AOUA72RLBV1	—	42
18	216,000	AOUA216RLBVG1	AOUA120RLBV1	AOUA96RLBV1	—	47
20	240,000	AOUA240RLBVG1	AOUA120RLBV1	AOUA120RLBV1	—	52
22	264,000	AOUA264RLBVG1	AOUA96RLBV1	AOUA96RLBV1	AOUA72RLBV1	58
24	288,000	AOUA288RLBVG1	AOUA96RLBV1	AOUA96RLBV1	AOUA96RLBV1	63

OUTDOOR  
UNITS

OUTDOOR  
UNITS



## 2. Specifications

### 2-1. Stand-alone

Nominal system capacity				Ton		6		8		10			
Model name						AOUA72RLBV1		AOUA96RLBV1		AOUA120RLBV1			
Power supply						3N 208/230 V ~ 60 Hz							
Available voltage range						187—253 V							
Combination of indoor units						Non-Duct		Duct		Non-Duct		Duct	
Capacity	Cooling	Nominal	Btu/h	72,000		96,000		120,000					
			kW	21.1		28.1		35.2					
		Rated	Btu/h	69,000		92,000		114,000					
			kW	20.2		27.0		33.4					
	Heating	Nominal	Btu/h	81,000		108,000		135,000					
			kW	23.7		31.7		39.6					
		Rated	Btu/h	77,000		103,000		129,000					
			kW	22.5		30.1		37.6					
Input power*1	Cooling		kW	5.37	5.28	7.67	7.75	9.86	9.57				
	Heating			5.39	5.75	7.90	8.00	10.19	10.33				
Current*3	Cooling	Rated	A	14.23	14.00	20.33	20.54	26.14	25.37				
	Heating			14.29	15.24	20.94	21.21	27.07	27.44				
EER	Cooling		Btu/hW	12.5	12.3	11.7	11.3	11.3					
COP	Heating		W/W	4.06	3.64	3.72	3.60	3.61	3.49				
	Low ambient heating			2.53	2.38	2.46	2.42	2.43	2.41				
Fan	Airflow rate	HIGH	CFM	6,533				7,652					
			m³/h	11,100				13,000					
			inWG	0.32									
	External static pressure (Max. )		Pa	80									
	Type × Q'ty			Propeller fan × 1									
	Motor	Type × Q'ty	DC motor × 1										
Sound pressure level*3	Cooling		dB (A)	57		59		61					
	Heating			58		59		62					
Heat exchanger type	Length		in	69-5/16				81-1/8					
			mm	1,760				2,070					
	Fin pitch		FPI	18									
			mm	1.45									
	Rows × Stages			3 × 60									
	Face area		ft²	24									
			m²	2.2									
	Pipe type (Material)			Grooved H-pin (Copper)									
Fin	Type	Corrugate (Aluminum)											
	Surface treatment	Corrosion resistance (Blue fin)											
Compressor	Type × Q'ty		Rotary (inv) × 1										
	Motor output		kW	7.5				11.0					
	Crankcase heater	Type 1	W	35									
		Type 2	W	35									
Refrigerant	Type		R410A										
	Charge		lb	25.79				26.01					
kg			11.7				11.8						
Refrigerant oil	Type		POE										
Enclosure	Material		Painted galvanized steel										
	Color		Beige Approximate color of Munsell 10YR 7.5/1.0NN										
Dimensions (H × W × D)	Net		in	66-9/16 × 36-5/8 × 30-1/8				66-9/16 × 48-13/16 × 30-1/8					
			mm	1,690 × 930 × 765				1,690 × 1,240 × 765					
	Gross		in	71-5/16 × 39-7/16 × 33-3/8				71-5/16 × 51-5/8 × 33-3/8					
			mm	1,811 × 1,002 × 847				1,811 × 1,312 × 847					
Weight	Net		lb	564				611					
			kg	256				277					
	Gross		lb	611				664					
			kg	277				301					
Connection pipe	Pipe diameter	Liquid	in	Ø 1/2									
			mm	Ø 12.7									
		Gas	in	Ø 7/8				Ø 1-1/8					
			mm	Ø 22.22				Ø 28.58					
	Method	Liquid	Brazing										
		Gas	Brazing										
	Max. length		ft	541									
			m	165									
Max. height difference		ft	164/131 (Outdoor unit: Higher/Lower)										
		m	50/40 (Outdoor unit: Higher/Lower)										
Electrical characteristics	MCA		A	41				50					
	MAX. CKT. BKR			50				60					
Operation temperature range	Cooling		°FDB	5 to 115*2									
			°CDB	-15 to 46*2									
	Heating		°FDB	-4 to 70									
			°CDB	-20 to 21									
	Cooling/Heating simultaneous		°FDB	14 to 70									
°CDB			-10 to 21										
Defrost method				Reversed cycle									
Compressor capacity control (Steps/Range)				951 steps / 20 to 115 rps									
Connectable indoor units number				16		21		26					

Nominal system capacity	Ton	6	8	10
Model name		AQUA72RLBV1	AQUA96RLBV1	AQUA120RLBV1
<b>NOTES:</b> <ul style="list-style-type: none"> <li>Specifications are based on the following conditions: <ul style="list-style-type: none"> <li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35.0 °CDB/23.9 °CWB).</li> <li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li> <li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li> </ul> </li> <li>Protective function might work when using it outside the operation range.</li> <li>*1: Electrical data is only for outdoor unit.</li> <li>*2: If multiple outdoor units are used, operating range: 23 to 115°F (-5 to 46°C)</li> <li>*3: Refer to "<a href="#">Power supply cable</a>" in Chapter 6. SYSTEM DESIGN on page 06-70 when selecting the circuit breaker.</li> </ul>				

## 2-2. Combination

Nominal system capacity				Ton		12		14			
Set model name						AOUA144RLBVG1		AOUA168RLBVG1			
Model name						AOUA72RLBV1 AOUA72RLBV1		AOUA96RLBV1 AOUA72RLBV1			
Power supply						3N 208/230 V ~ 60 Hz					
Available voltage range						187—253 V					
Combination of indoor units				Non-Duct		Duct		Non-Duct		Duct	
Capacity	Cooling	Nominal	Btu/h	144,000				168,000			
			kW	42.2				49.2			
		Rated	Btu/h	138,000				160,000			
			kW	40.4				47.2			
	Heating	Nominal	Btu/h	162,000				188,000			
			kW	47.5				55.1			
		Rated	Btu/h	154,000				180,000			
			kW	45.0				52.7			
Input power*1	Cooling			kW	11.80		14.20				
	Heating			kW	12.81		14.69				
EER	Cooling			Btu/hW	11.4		11.0				
COP	Heating			W/W	3.44		3.48				
	Low ambient heating			W/W	2.28		2.32				
Fan	Airflow rate	HIGH	CFM	6,533 × 2							
			m³/h	11,100 × 2							
	External static pressure (Max.)		inWG	0.32							
			Pa	80							
	Type × Q'ty		Propeller fan × 2								
	Motor	Type × Q'ty		DC motor × 2							
		Motor output		W	740 × 2						
Sound pressure level	Cooling			dB (A)	60		61				
	Heating				61		62				
Heat exchanger type	Length			in	69-5/16 × 2						
				mm	1,760 × 2						
	Fin pitch			FPI	18						
				mm	1.45						
	Rows × Stages			(3 × 60) × 2							
	Face area				ft²	24 × 2					
					m²	2.2 × 2					
	Pipe type (Material)			Grooved H-pin (Copper)							
	Fin	Type		Corrugate (Aluminum)							
		Surface treatment		Corrosion resistance (Blue fin)							
Compressor	Type × Q'ty		Rotary (inv) × 2								
	Motor output		kW	7.5× 2							
	Crankcase heater		W	(35 × 2) × 2							
Refrigerant	Type		R410A								
	Charge			lb	25.79 × 2						
				kg	11.7 × 2						
Refrigerant oil	Type		POE								
Enclosure	Material		Painted galvanized steel								
	Color		Beige								
Dimensions (H × W × D)	Net			in	66-9/16 × 36-5/8 × 30-1/8						
				mm	66-9/16 × 36-5/8 × 30-1/8						
	Gross			in	71-5/16 × 39-7/16 × 33-3/8						
				mm	71-5/16 × 39-7/16 × 33-3/8						
				in	1,811 × 1,002 × 847						
				mm	1,811 × 1,002 × 847						
Weight	Net			lb	564 × 2						
				kg	256 × 2						
	Gross			lb	611 × 2						
				kg	277 × 2						
Connection pipe	Pipe diameter	Liquid	in	Ø 1/2		Ø 5/8					
			mm	Ø 12.7		Ø 15.88					
		Gas	in	Ø 1-1/8							
			mm	Ø 28.58							
	Method	Liquid		Brazing							
		Gas		Brazing							
	Max. length		ft	541							
			m	165							
	Max. height difference		ft	164/131 (Outdoor unit: Higher/Lower)							
			m	50/40 (Outdoor unit: Higher/Lower)							
Operation temperature range	Cooling	°FDB		23 to 115							
		°CDB		-5 to 46							
	Heating	°FDB		-4 to 70							
		°CDB		-20 to 21							
Defrost method				Reversed cycle							
Connectable indoor units number				32				37			
NOTES:											
• Specifications are based on the following conditions:											
– Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35.0 °CDB/23.9 °CWB).											
– Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).											
– Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)											
• Protective function might work when using it outside the operation range.											
• *1: Electrical data is only for outdoor unit.											

Nominal system capacity				Ton		16		18		20	
Set model name						AOUA192RLBVG1		AOUA216RLBVG1		AOUA240RLBVG1	
Model name						AOUA120RLBV1 AOUA72RLBV1		AOUA120RLBV1 AOUA96RLBV1		AOUA120RLBV1 AOUA120RLBV1	
Power supply				3N 208/230 V ~ 60 Hz							
Available voltage range				187—253 V							
Combination of indoor units				Non-Duct		Duct		Non-Duct		Duct	
Capacity	Cooling	Nominal	Btu/h	192,000		216,000		240,000			
			kW	56.2		63.3		70.3			
		Rated	Btu/h	184,000		206,000		228,000			
			kW	53.6		60.4		66.8			
	Heating	Nominal	Btu/h	216,000		243,000		270,000			
			kW	63.3		71.2		79.1			
		Rated	Btu/h	206,000		232,000		258,000			
			kW	60.3		68.0		75.6			
Input power*1		Cooling		kW	16.04		18.47		20.45		
		Heating			15.65		19.07		21.90		
EER		Cooling		Btu/hW	11.2	11.1	10.9				
COP		Heating		W/W	3.75	3.57	3.47		3.36		
		Low ambient heating			2.49	2.36	2.35		2.36		
Fan	Airflow rate	HIGH	CFM	7,652 + 6,533				7,652 × 2			
			m³/h	13,000 + 11,100				13,000 × 2			
	External static pressure (Max.)		inWG	0.32							
			Pa	80							
	Type × Q'ty		Propeller fan × 2								
	Motor		DC motor × 2								
			740 × 2								
	Sound pressure level*3		Cooling		dB (A)	62	63	64			
		Heating		63		64	65				
Heat exchanger type	Length		in	81-8/16 + 69-5/16				81-8/16 × 2			
			mm	2,070 + 1,760				2,070 × 2			
	Fin pitch		FPI	18							
			mm	1.45							
	Rows × Stages		(3 × 60) × 2								
	Face area		ft²	28 + 24				28 × 2			
			m²	2.6 + 2.2				2.6 × 2			
	Pipe type (Material)		Grooved H-pin (Copper)								
	Fin		Type	Corrugate (Aluminum)							
			Surface treatment	Corrosion resistance (Blue fin)							
Compressor		Type × Q'ty		Rotary (inv) × 2							
		Motor output		kW	11.0 + 7.5				11.0 × 2		
		Crankcase heater		W	(35 × 2) × 2						
Refrigerant		Type		R410A							
		Charge		lb	25.79 + 26.01				26.01 × 2		
				kg	11.7 + 11.8				11.8 × 2		
Refrigerant oil		Type		POE							
Enclosure		Material		Painted galvanized steel							
		Color		Beige							
				Approximate color of Munsell 10YR 7.5/1.0NN							
Dimensions (H × W × D)	Net		in	66-9/16 × 48-13/16 × 30-1/8 66-9/16 × 36-10/16 × 30-1/8				66-9/16 × 48-13/16 × 30-1/8 66-9/16 × 48-13/16 × 30-1/8			
			mm	1,690 × 1,240 × 765 1,690 × 930 × 765				1,690 × 1,240 × 765 1,690 × 1,240 × 765			
	Gross		in	71-5/16 × 51-5/8 × 33-3/8 71-5/16 × 39-7/16 × 33-3/8				71-5/16 × 51-5/8 × 33-3/8 71-5/16 × 51-5/8 × 33-3/8			
			mm	1,811 × 1,312 × 847 1,811 × 1,002 × 847				1,811 × 1,312 × 847 1,811 × 1,312 × 847			
Weight	Net		lb	611 + 564				611 × 2			
			kg	277 + 256				277 × 2			
	Gross		lb	664 + 611				664 × 2			
			kg	301 + 277				301 × 2			
Connection pipe	Pipe diameter	Liquid	in	Ø 5/8							
			mm	Ø 15.88							
		Gas	in	Ø 1-1/8		Ø 1-3/8					
			mm	Ø 28.58		Ø 34.92					
	Method	Liquid	Brazing								
			Brazing								
	Max. length		ft	541							
			m	165							
	Max. height difference		ft	164/131 (Outdoor unit: Higher/Lower)							
			m	50/40 (Outdoor unit: Higher/Lower)							
Operation temperature range	Cooling		°FDB	23 to 115							
			°CDB	-5 to 46							
	Heating		°FDB	-4 to 70							
			°CDB	-20 to 21							
Defrost method				Reversed cycle							
Connectable indoor units number				42		47		52			
NOTES:											
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35.0 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*1: Electrical data is only for outdoor unit.</li></ul>											

Nominal system capacity				Ton		22		24			
Set model name						AOUA264RLBVG1		AOUA288RLBVG1			
Model name						AOUA96RLBV1 AOUA96RLBV1 AOUA72RLBV1		AOUA96RLBV1 AOUA96RLBV1 AOUA96RLBV1			
Power supply				3N 208/230 V ~ 60 Hz							
Available voltage range				187—253 V							
Combination of indoor units				Non-Duct		Duct		Non-Duct		Duct	
Capacity	Cooling	Nominal	Btu/h	264,000		288,000					
			kW	77.4		84.4					
		Rated	Btu/h	252,000		274,000					
			kW	74.2		81.0					
	Heating	Nominal	Btu/h	297,000		324,000					
			kW	87.0		95.0					
		Rated	Btu/h	282,000		308,000					
			kW	82.9		90.6					
Input power*1		Cooling	kW	22.58		25.27					
		Heating		23.41		26.28					
EER		Cooling	Btu/hW	10.9		10.6					
COP	Heating		W/W	3.45	3.40	3.36	3.31				
	Low ambient heating			2.29	2.27	2.29	2.27				
Fan	Airflow rate	HIGH	CFM	6,533 × 3							
			m³/h	11,100 × 3							
	External static pressure (Max.)		inWG	0.32							
			Pa	80							
	Type × Q'ty		Propeller fan × 3								
	Motor	Type × Q'ty	DC motor × 3								
		Motor output	W	740 × 3							
Sound pressure level*3	Cooling	dB (A)	63	64							
	Heating		63	64							
Heat exchanger type	Length	in	69-5/16 × 3								
		mm	1,760 × 3								
	Fin pitch	FPI	18								
		mm	1.45								
	Rows × Stages		(3 × 60) × 3								
	Face area		ft²	24 × 3							
			m²	2.2 × 3							
	Pipe type (Material)		Grooved H-pin (Copper)								
	Fin	Type	Corrugate (Aluminum)								
		Surface treatment	Corrosion resistance (Blue fin)								
Compressor	Type × Q'ty		Rotary (inv) × 3								
	Motor output	kW	7.5× 3								
	Crankcase heater	W	(35 × 2) × 3								
Refrigerant	Type		R410A								
	Charge	lb	25.79 × 3								
		kg	11.7 × 3								
Refrigerant oil	Type		POE								
Enclosure	Material		Painted galvanized steel								
	Color		Beige Approximate color of Munsell 10YR 7.5/1.0NN								
Dimensions (H × W × D)	Net	in	66-9/16 × 36-5/8 × 30-1/8								
			66-9/16 × 36-5/8 × 30-1/8								
		mm	66-9/16 × 36-5/8 × 30-1/8								
			1,690 × 930 × 765								
	Gross	in	1,690 × 930 × 765								
			1,690 × 930 × 765								
		mm	71-5/16 × 39-7/16 × 33-3/8								
			71-5/16 × 39-7/16 × 33-3/8								
Weight	Net	lb	564 × 3								
		kg	256 × 3								
	Gross	lb	611 × 3								
		kg	277 × 3								
	Connection pipe	Pipe diameter	Liquid	in	Ø 5/8		Ø 3/4				
				mm	Ø 15.88		Ø 19.05				
Gas			in	Ø 1-3/8							
			mm	Ø 34.92							
Method		Liquid	Brazing								
		Gas	Brazing								
Max. length		ft	541								
		m	165								
Max. height difference		ft	164/131 (Outdoor unit: Higher/Lower)								
		m	50/40 (Outdoor unit: Higher/Lower)								
Operation temperature range	Cooling	°FDB	23 to 115								
		°CDB	-5 to 46								
	Heating	°FDB	-4 to 70								
		°CDB	-20 to 21								
Defrost method				Reversed cycle							
Connectable indoor units number				58		63					
NOTES:											
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35.0 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*1: Electrical data is only for outdoor unit.</li></ul>											

OUTDOOR  
UNITS


OUTDOOR  
UNITS

### 3. Dimensions



#### 3-1. Stand-alone

##### ■ Models: AOUA72RLBV1 and AOUA96RLBV1

Unit: in (mm)

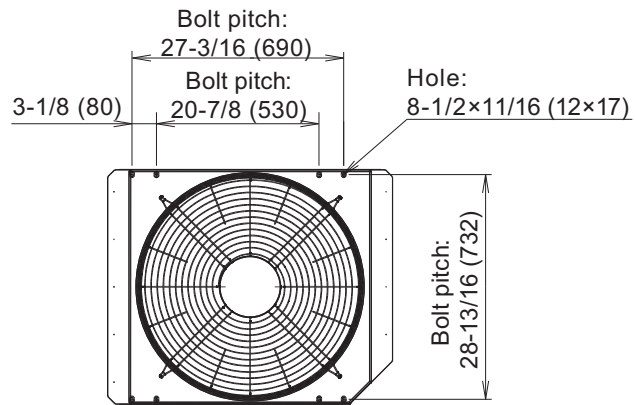


Top view

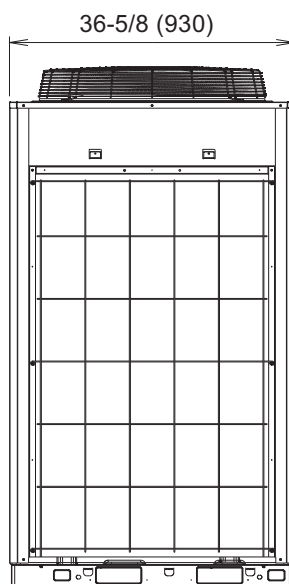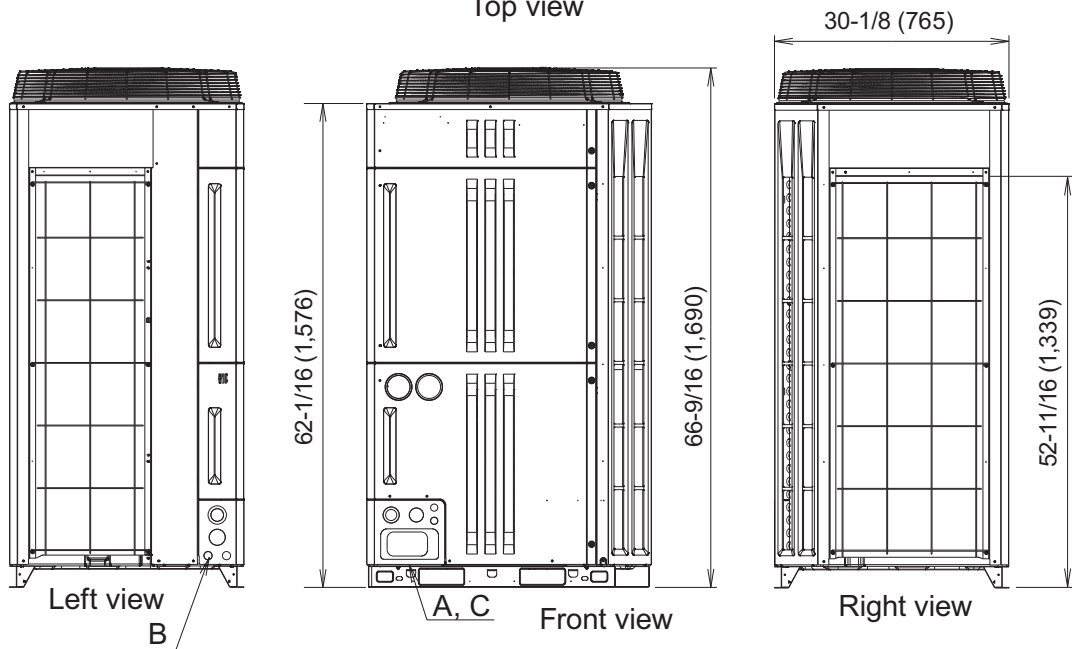


Rear view

# **Model: AOUA120RLBV1**

Unit: in (mm)

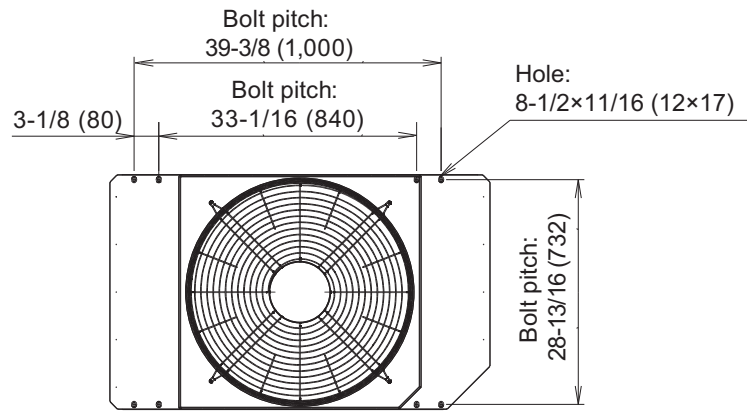


Top view

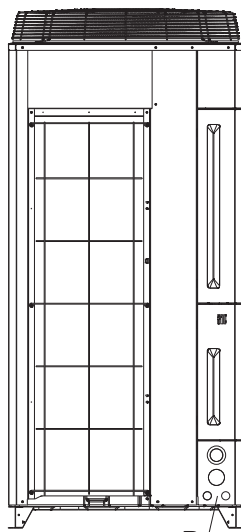


Left view

B

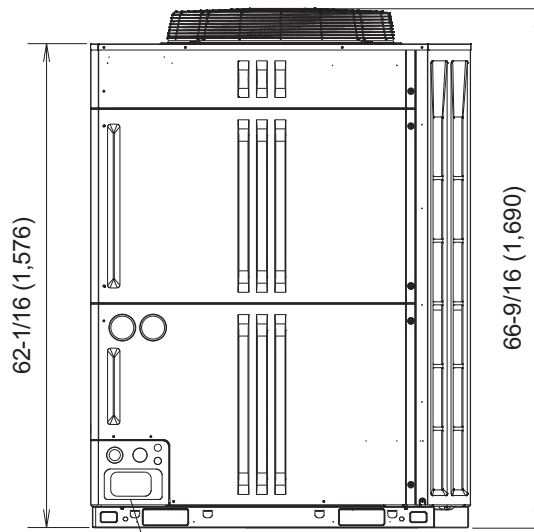


A, C

Front view

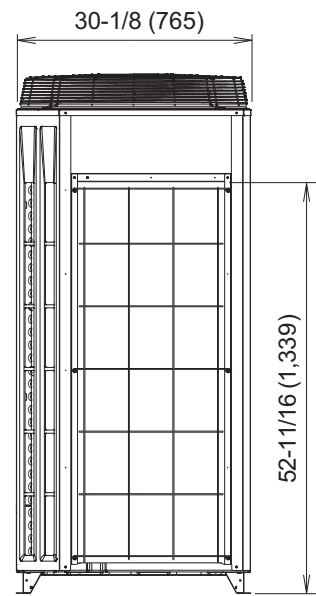

Right view

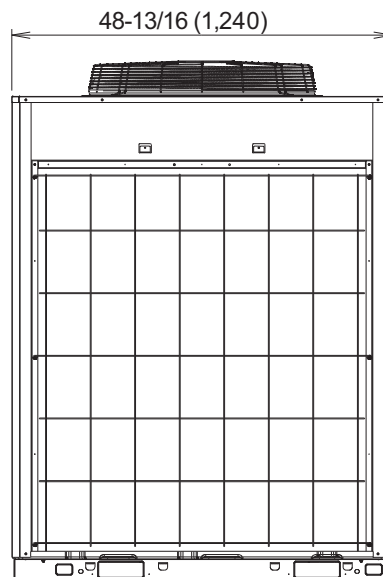


Rear view




# ■ Knock out hole position


Unit: in (mm)

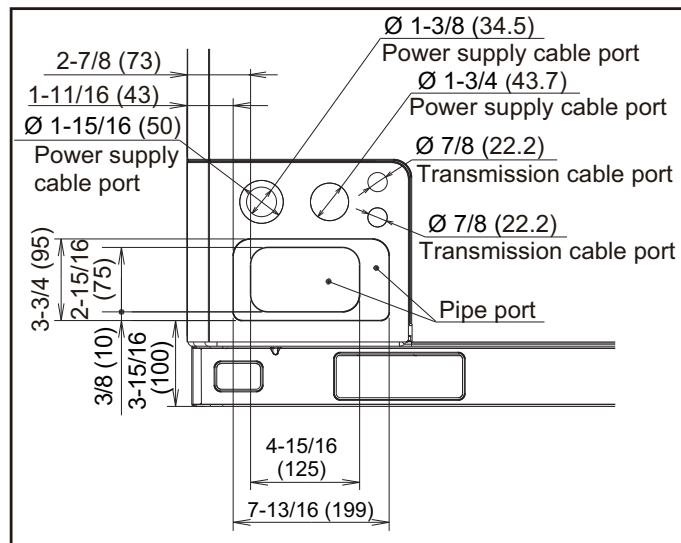OUTDOOR  
UNITSOUTDOOR  
UNITS

Detail A: Front view

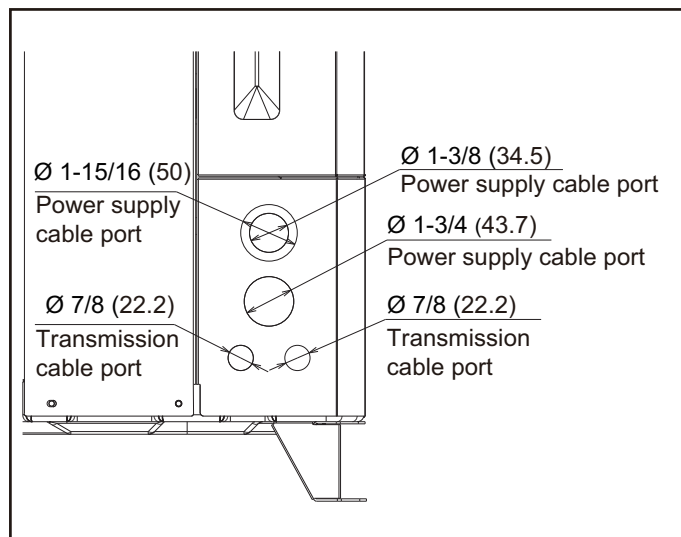


Detail B: Left view

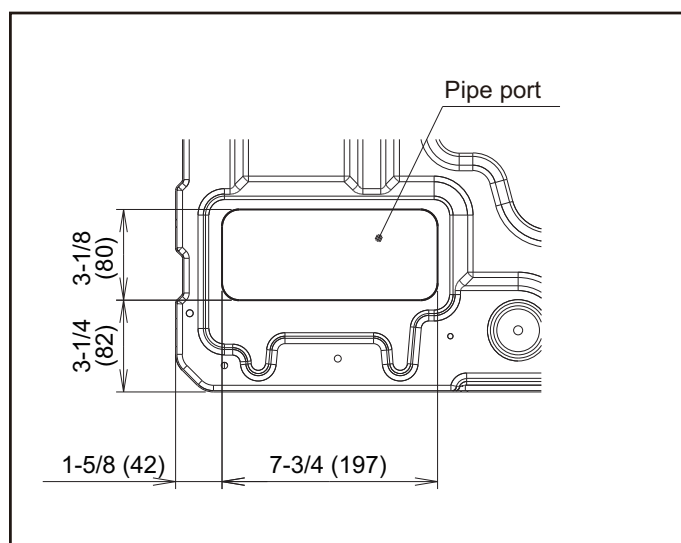

Detail C: Top view

## Valve position


Unit: in (mm)

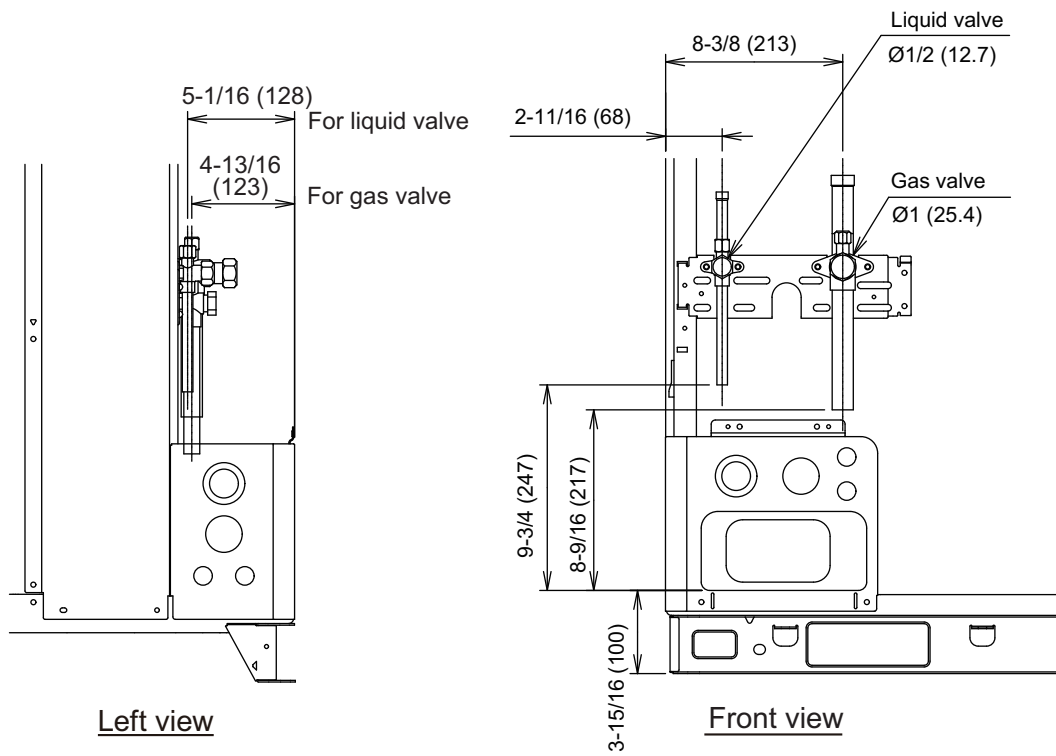OUTDOOR  
UNITSOUTDOOR  
UNITS


## ■ Accessory pipe

Unit: in (mm)

### • Front piping

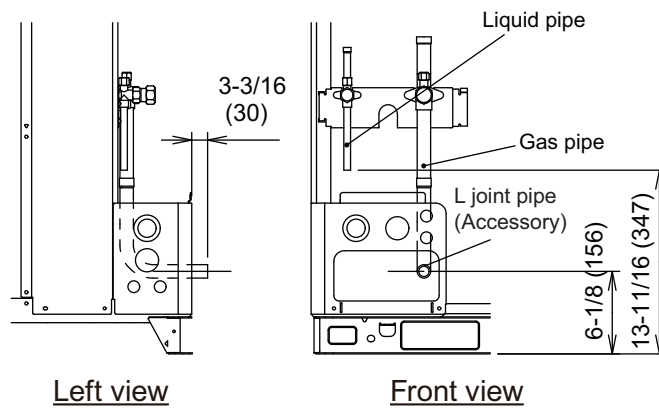


### • Bottom piping

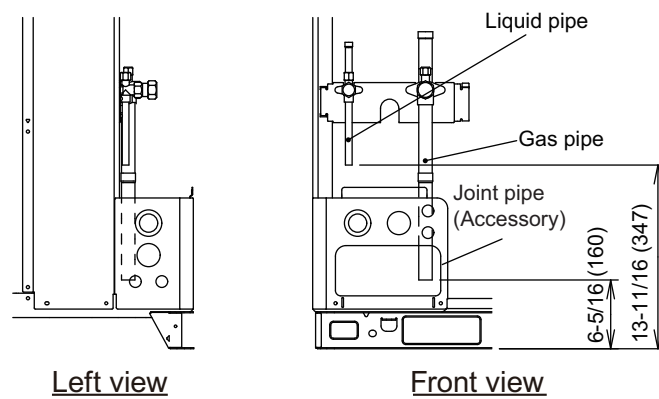

## ■ Installation (Foundation)


Unit: in (mm)

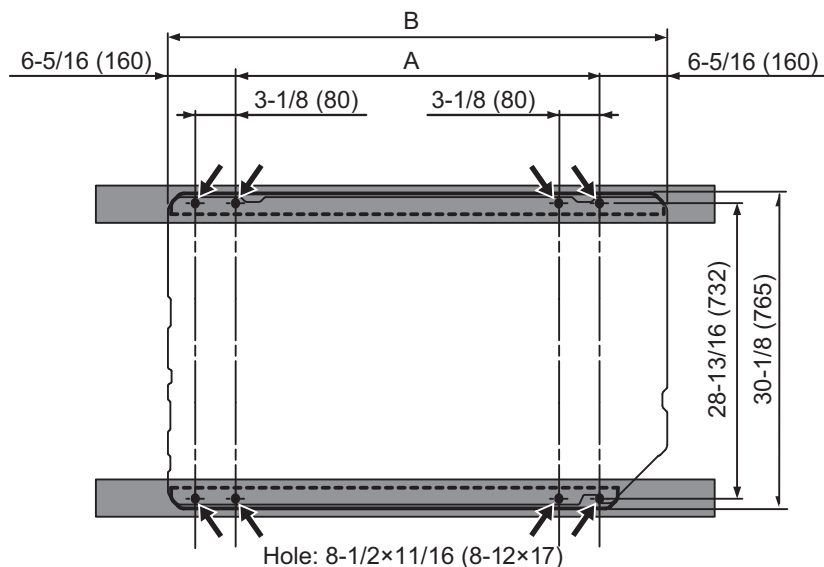


Bottom view

Model name	A	B
AQUA72RLBV1	24 (610)	36-5/8 (930)
AQUA96RLBV1		
AQUA120RLBV1	36-1/4 (920)	48-13/16 (1,240)

### • Installation example

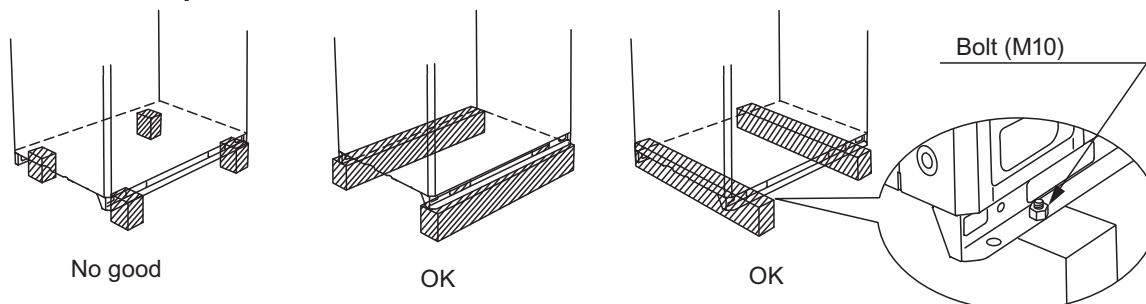

**NOTE:** Do not use a four-corner support foundation.

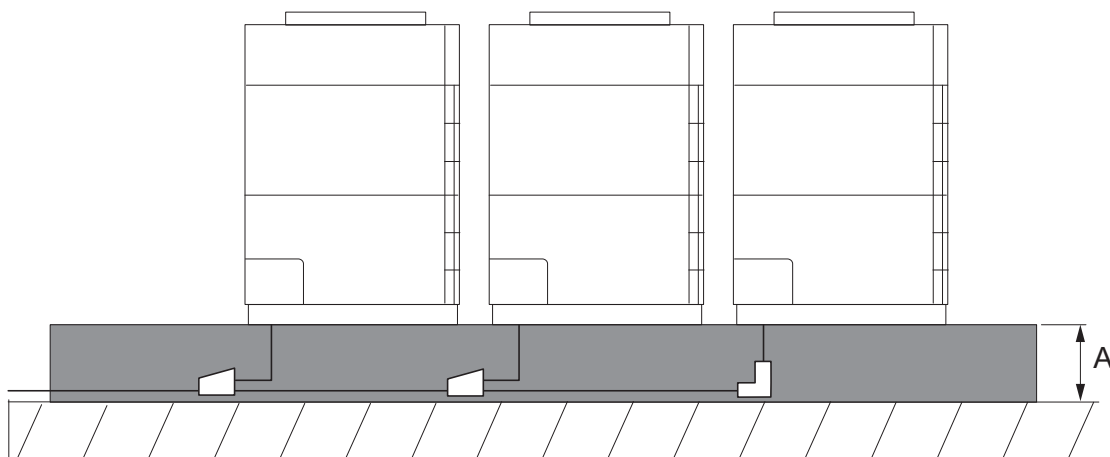



A: More than 7-7/8 (200).

When installing pipe from the bottom of the outdoor units, the required space under the outdoor unit  $\geq$  7-7/8 (200).

## Center of gravity position



Unit: in (mm)

- Models: AOUA72RLBV1 and AOUA96RLBV1

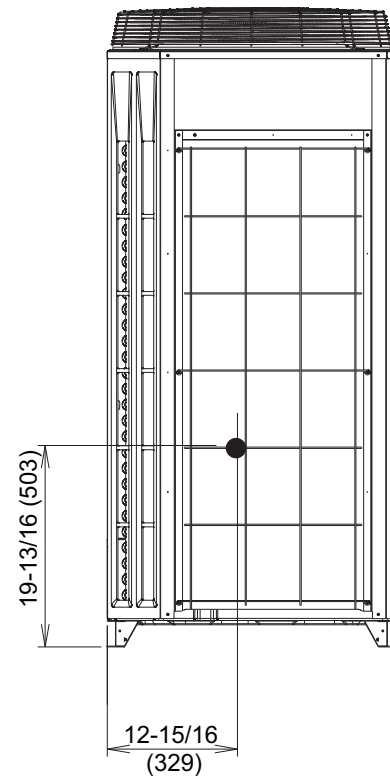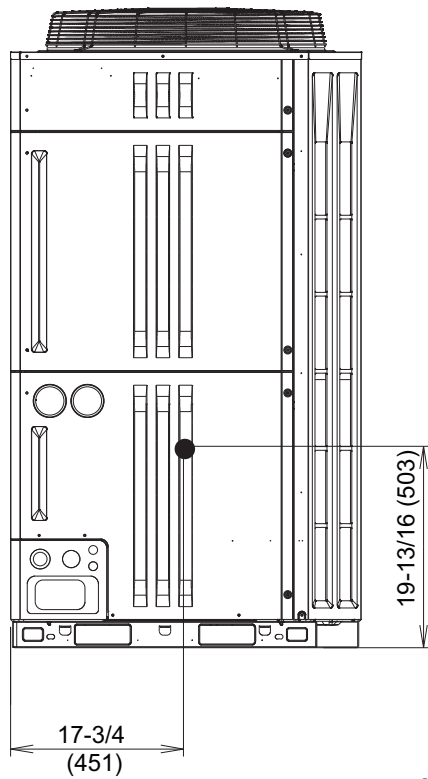

●: Center of gravity

- Model: AOUA120RLBV1

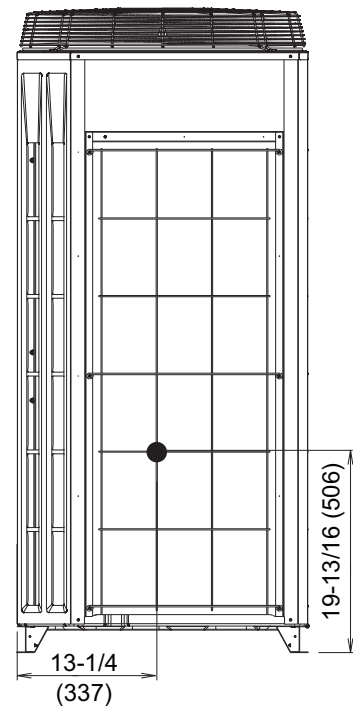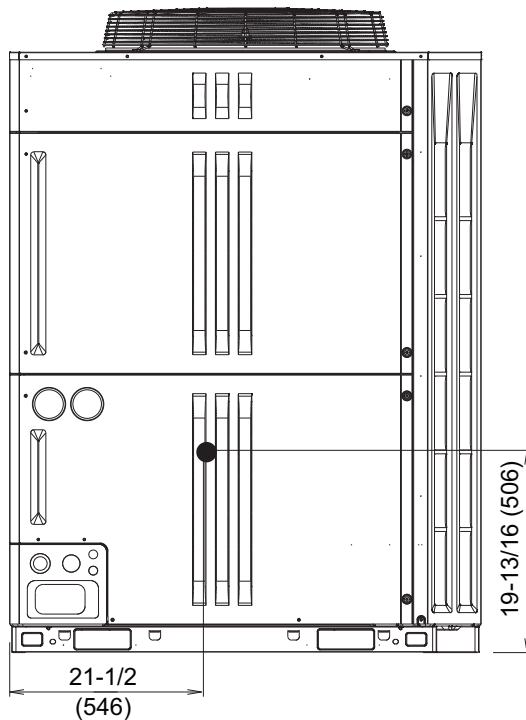


●: Center of gravity

■ Corner weights


Unit: lb (kg)

- Models: AOUA72RLBV1 and AOUA96RLBV1

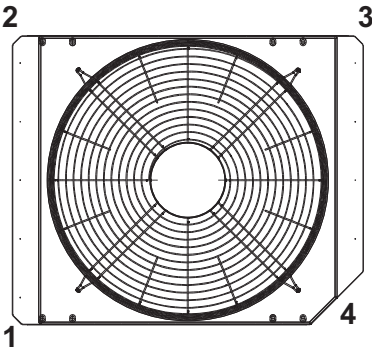

1	2	3	4	Total
161 (73)	130 (59)	112 (51)	161 (73)	564 (256)

- Model: AOUA120RLBV1

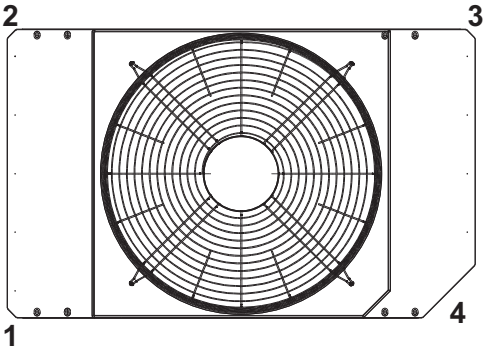


1	2	3	4	Total
187 (85)	154 (70)	115 (52)	154 (70)	611 (277)


## 3-2. Combination

Unit: in (mm)

Set model name	Outdoor unit 1	Outdoor unit 2
AQUA144RLBVG1 (12Ton)	6Ton	6Ton
AQUA168RLBVG1 (14Ton)	8Ton	6Ton

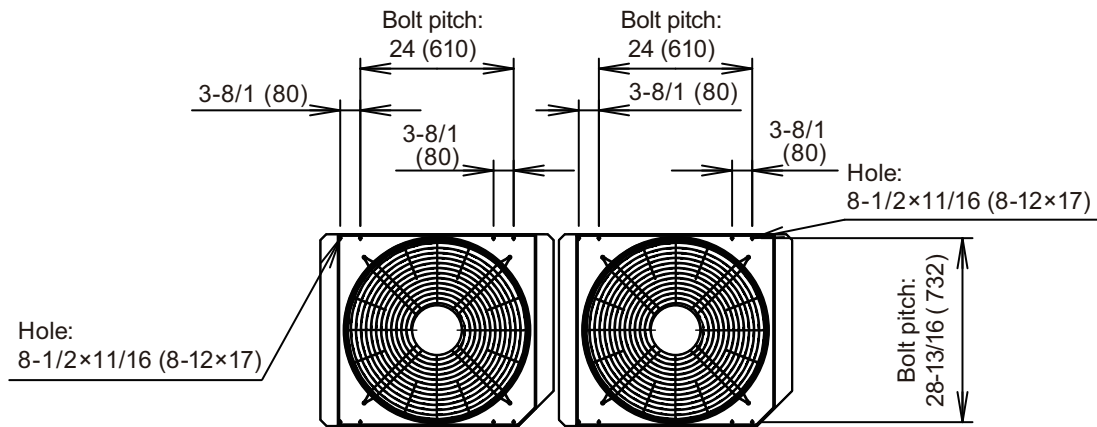


Top view

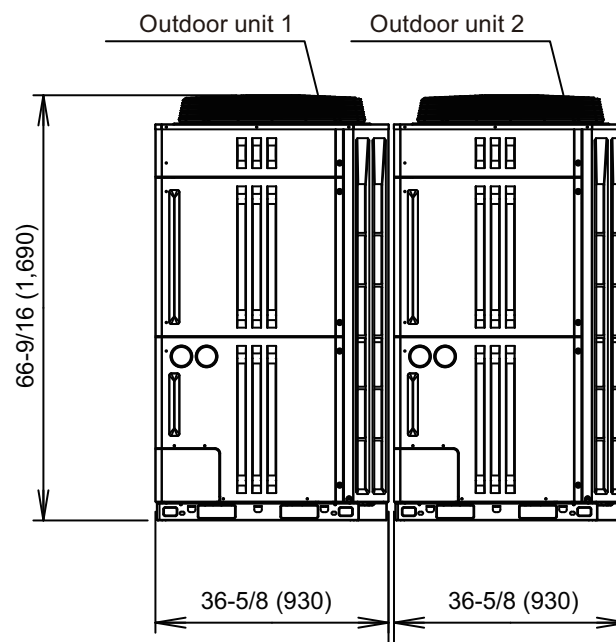


Front view

Unit: in (mm)

Set model name	Outdoor unit 1	Outdoor unit 2
AQUA192RLBVG1 (16Ton)	10Ton	6Ton
AQUA216RLBVG1 (18Ton)	10Ton	8Ton

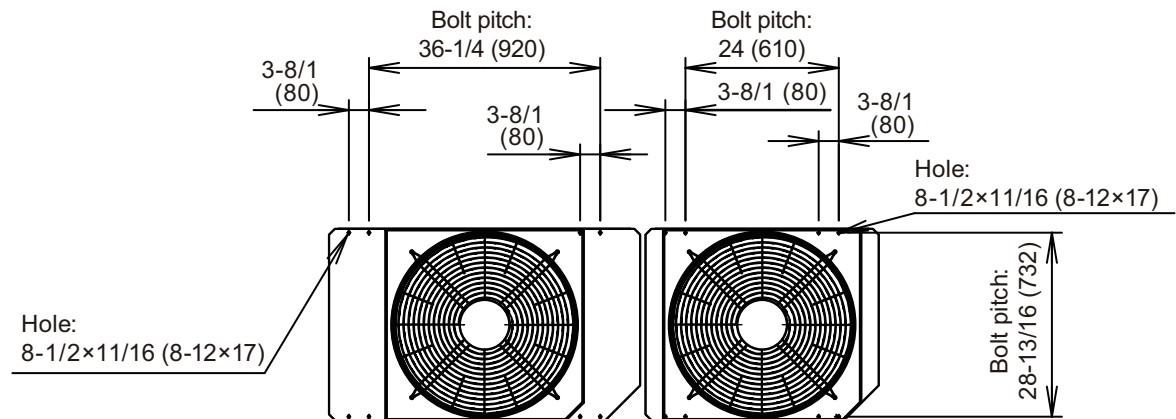

Top view

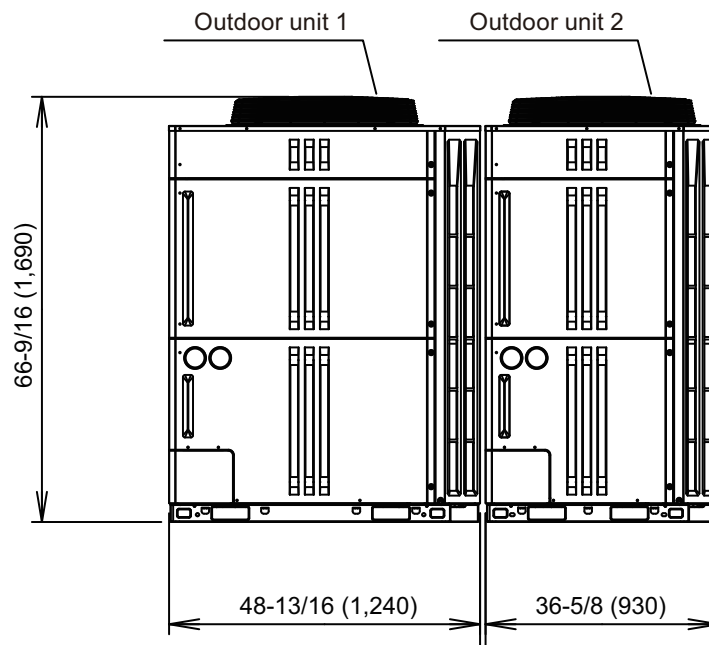


Front view




Unit: in (mm)

Set model name	Outdoor unit 1	Outdoor unit 2
AQUA240RLBVG1 (20Ton)	10Ton	10Ton

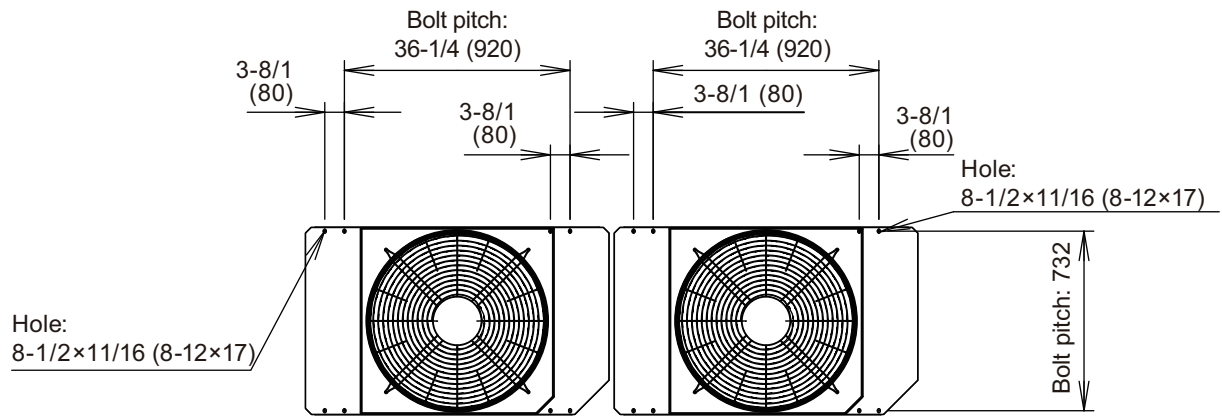



Top view

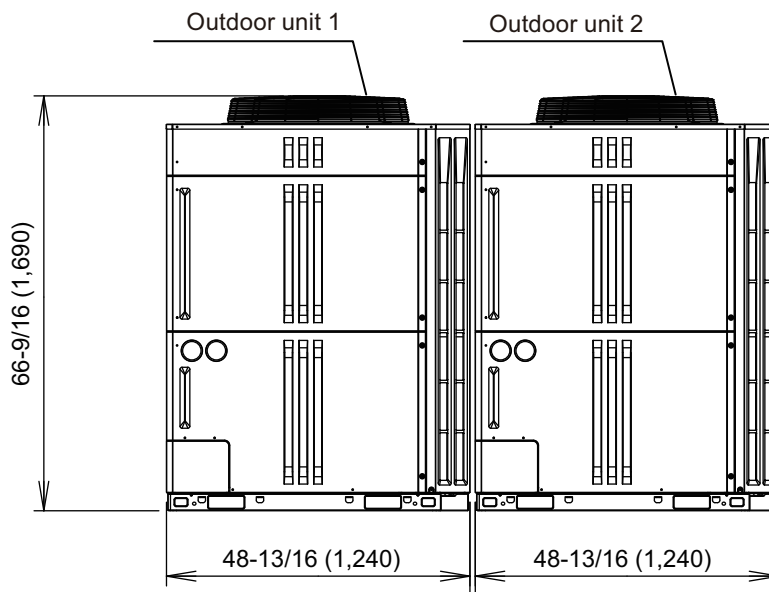

Front view

Unit: in (mm)

Set model name	Outdoor unit 1	Outdoor unit 2	Outdoor unit 3
AQUA264RLBVG1 (22Ton)	8Ton	8Ton	6Ton
AQUA288RLBVG1 (24Ton)	8Ton	8Ton	8Ton

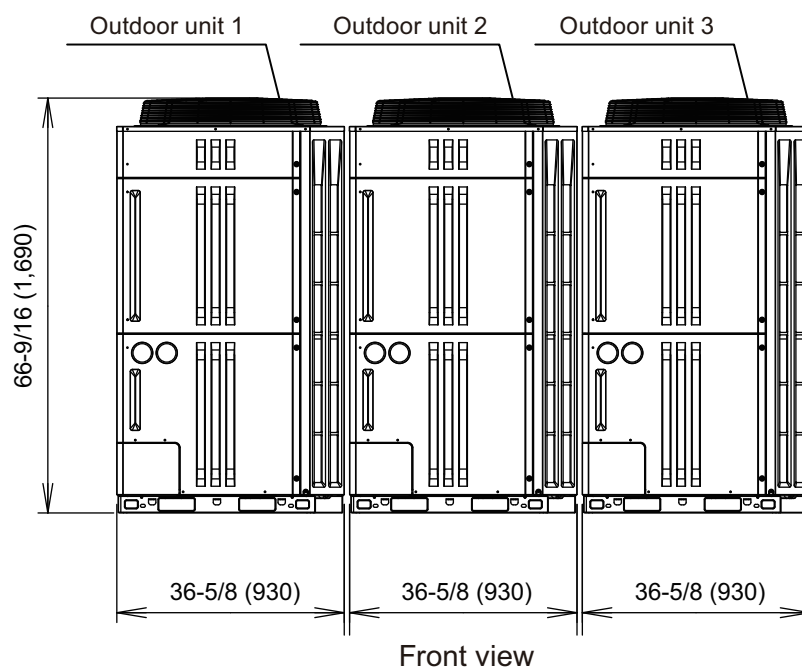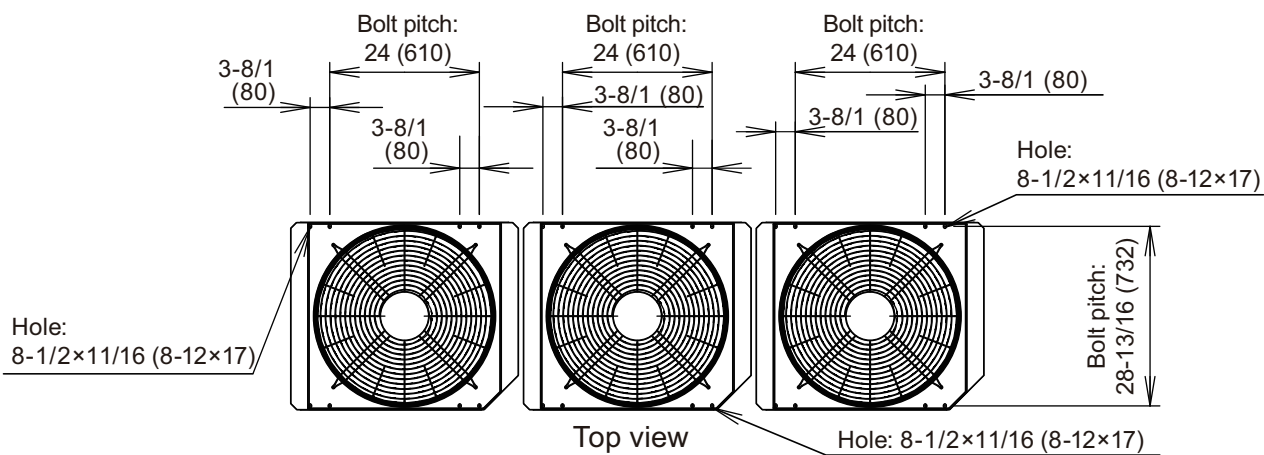



## 4. Installation space

### ⚠ CAUTION

When installing the outdoor unit, pay attention to the following items.


- To prevent shut down due to discharge air short circuiting, reduction in capacity, and high pressure protection, refer to the installation space requirements shown in the following diagrams to provide sufficient space.
- Provide sufficient space to allow for rigging and setting of unit, installation, maintenance, and access.
- Do not obstruct discharge airflow. Provide discharge duct if required for proper air discharge.
- If there is a wall in front of the unit, provide 20 in (500 mm) or more clearance for maintenance.
- If there is a wall on the left side of the unit, provide 2 in (30 mm) or more clearance for maintenance.
- An outdoor temperature of 95°FDB (35°CDB) in air-conditioned operation is assumed for the installation space in this item. If the outdoor temperature exceeds 95°FDB (35°CDB) and the outdoor unit is operating at a load exceeding its rated ability, provide a larger inlet space.

### 4-1. When installing in front of height-restricted wall

#### ■ Single and multiple installations

- There are no restrictions on the height of the side wall.
- Provide installation spaces L1 and L2 in accordance with the table below according to the wall height (front side and rear side) conditions.
- Provide installation spaces other than L1 and L2 in accordance with the conditions shown in the figure below.
- Airflow resistance can be ignored when the distance from a wall or other equipment is more than 79 in (2 m).

Wall height condition : in (mm)	Installation requirement : in (mm)
When H1 is 59 (1,500) or less	$L1 \geq 20 (500)$
When H1 is 59 (1,500) or more	$L1 \geq 20 (500) + h1 / 2$
When H2 is 19 (500) or less	$L2 \geq 4 (100)$
When H2 is 19 (500) or more	$L2 \geq 4 (100) + h2 / 2$




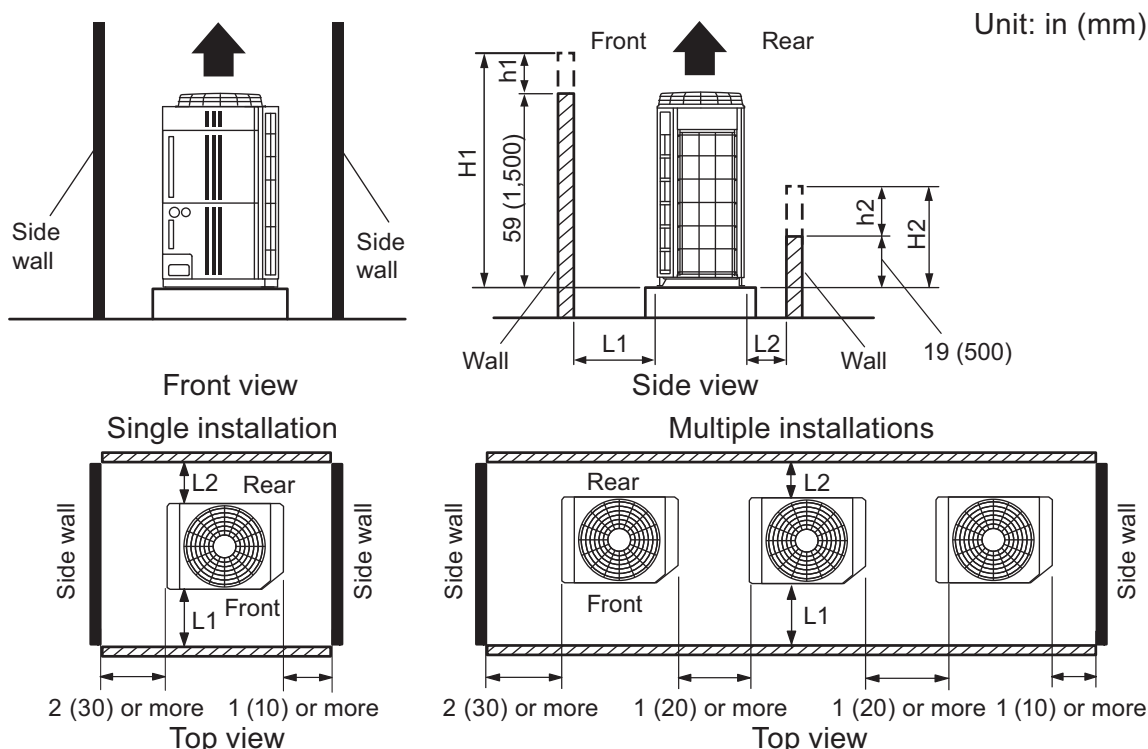


## Concentrated installation

- Provide installation spaces L3, L4, and L5 in accordance with the table below according to the wall height (front side and rear side) conditions.
- Provide installation spaces other than L3, L4, and L5 in accordance with the conditions shown in the figure below.
- Airflow resistance can be ignored when the distance from a wall or other equipment is more than 79 in (2 m).

Wall height condition : in (mm)	Installation requirement : in (mm)
When H3 is 59 (1,500) or less	$L3 \geq 20$ (500)
When H3 is 59 (1,500) or more	$L3 \geq 20$ (500) + $h3 / 2$
When H4 is 19 (500) or less	$L4 \geq 8$ (200)
When H4 is 19 (500) or more	$L4 \geq 8$ (200) + $h4 / 2$
When H5 is 19 (500) or less	$L5 \geq 8$ (200)
When H5 is 19 (500) or more	$L5 \geq 8$ (200) + $h5 / 2$

Unit: in (mm)

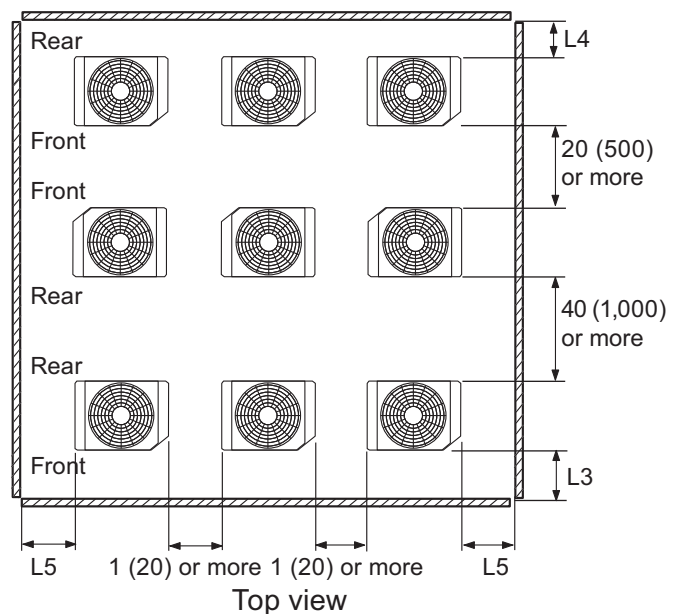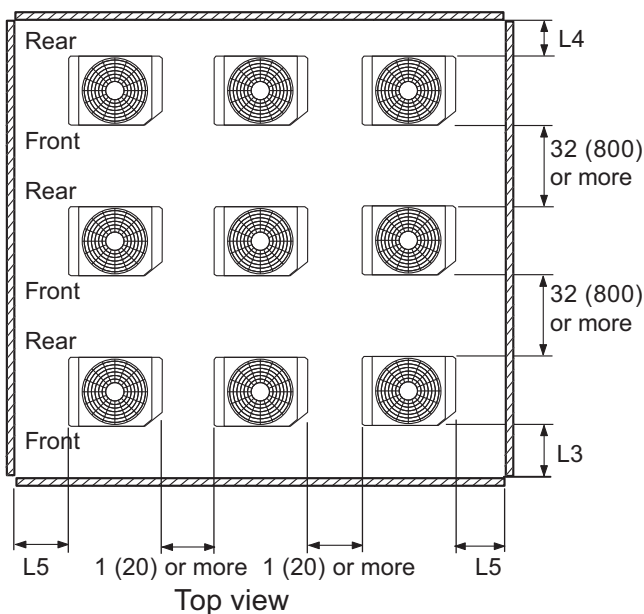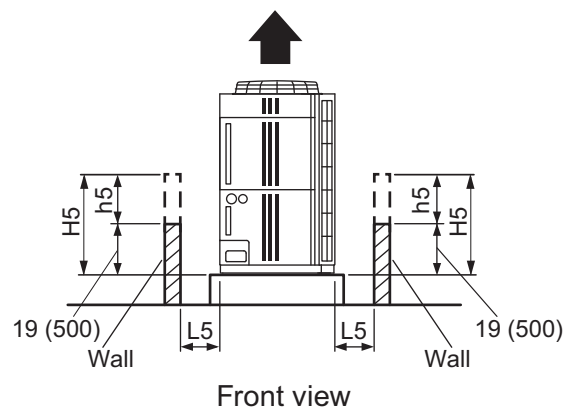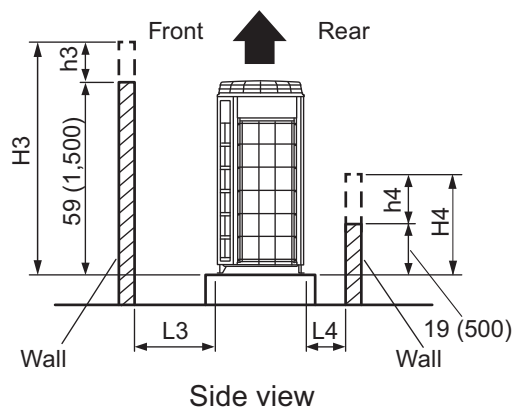



## 4-2. When installing in front of wall with no specific height-restriction

### ■ Single and multiple installations

- There are no restrictions on the height of the side wall.
- The wall (without height restrictions) must not exist on both left and right sides of the outdoor unit. Also, the wall must not exist on both front and rear of the outdoor unit.
- Provide installation spaces other than L6 in accordance with the conditions shown in the figure bellow.
- Airflow resistance can be ignored when the distance from a wall or other equipment is more than 79 in (2 m).
- **When installing with the rear of the outdoor unit facing the wall side:**

Wall height condition : in (mm)	Installation requirement : in (mm)
When $B \geq 16$ (400)	$L6 \geq 8$ (200)
When $1$ (20) $\leq B \leq 16$ (400)	$L6 \geq 8 + (16 - B) \times 3$ ( $200 + [400 - B] \times 3$ )


Unit: in (mm)

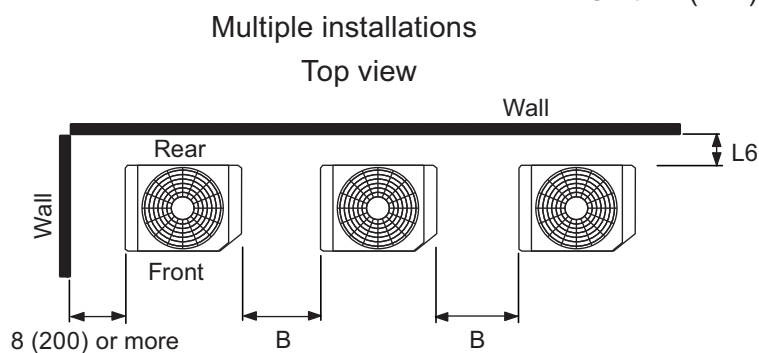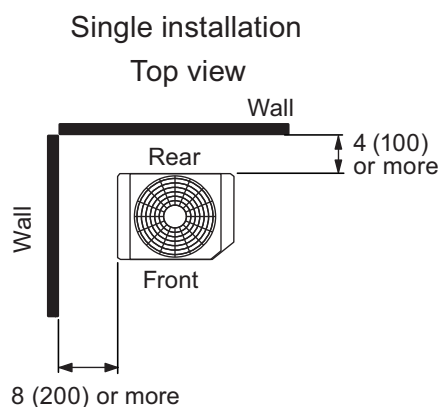



Example: When B is made 200

$$L6 \geq 8 + (16 - 8) \times 3 = 32$$

$$(200 + [400 - 200] \times 3 = 800)$$

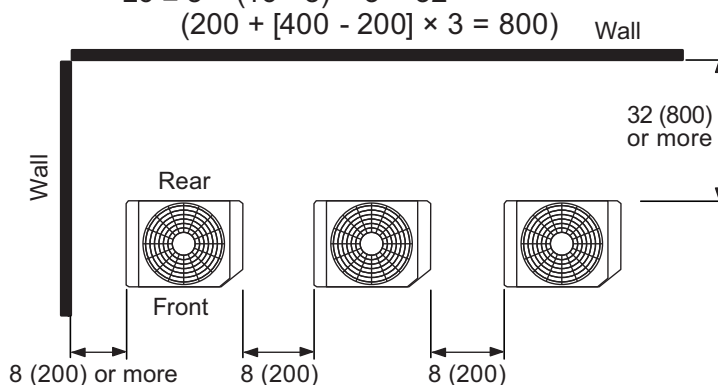



- **When installing with the front of the outdoor unit facing the wall side:**

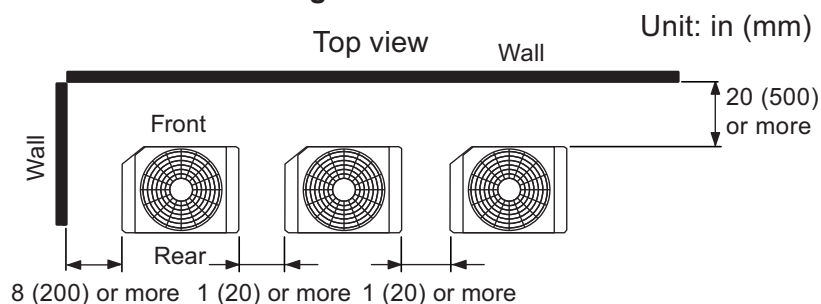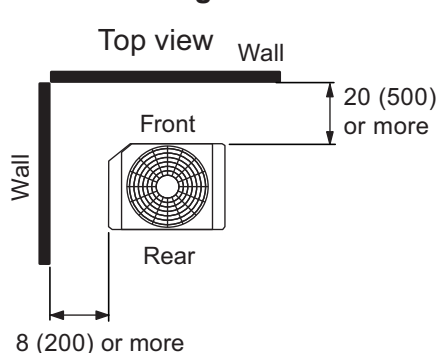

## Concentrated installation

- The wall (without height restrictions) must not exist on both left and right sides of the outdoor unit. Also, the wall must not exist on both front and rear of the outdoor unit.
- Airflow resistance can be ignored when the distance from a wall or other equipment is more than 79 in (2 m).


Unit: in (mm)

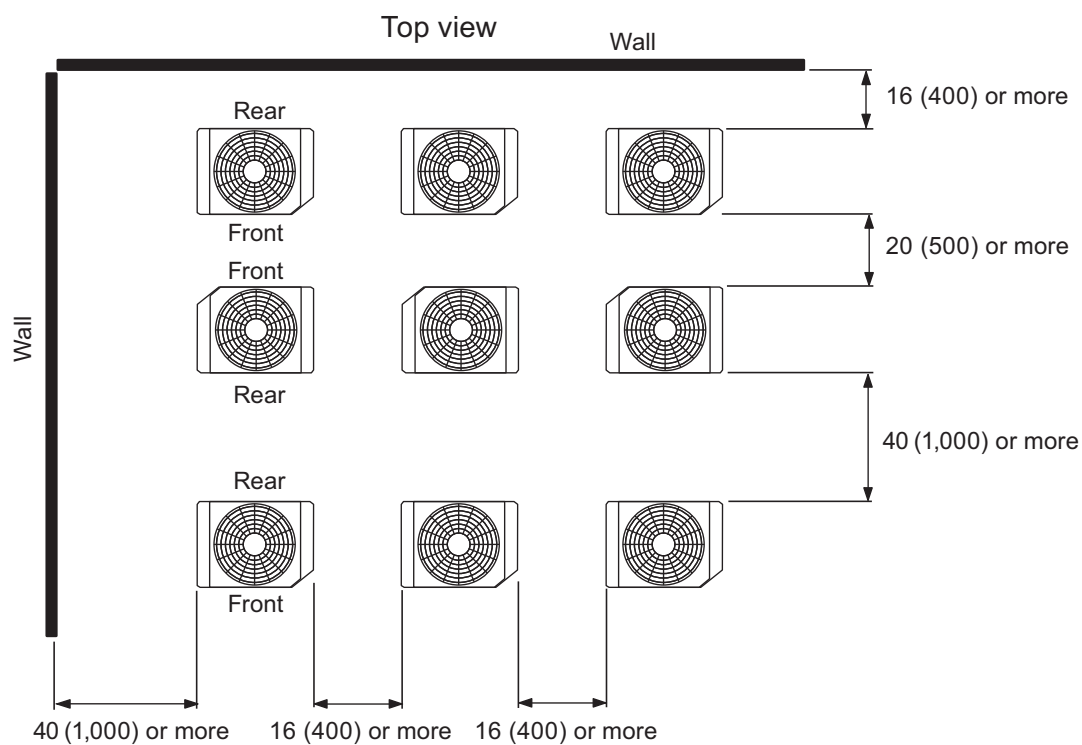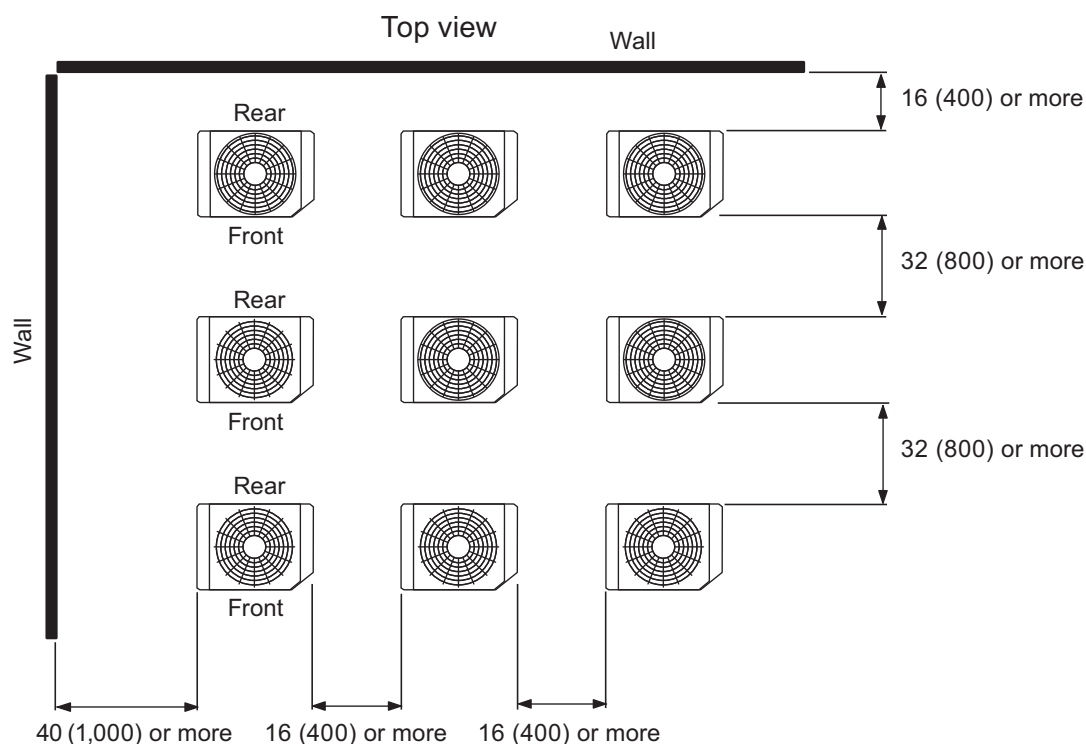

## 4-3. When there is an obstruction above the product

- When there is an obstruction above the product, observe the minimum installation height and install an outlet duct as shown below.
- When an outlet duct, etc. is installed, the high static pressure mode must be set by push button. (Also, applies when a snow hood is installed.)

Unit: in (mm)

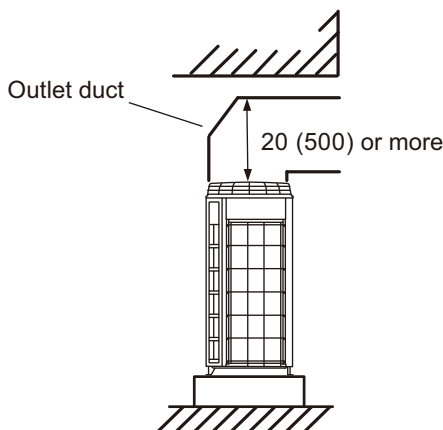

### • High static pressure mode setting

Select the high static pressure mode in accordance with the table below.

Condition	High static pressure mode* <sup>1</sup>
$0 \text{ Pa} \leq \text{Static pressure}^{*2} \leq 30 \text{ Pa}$	Set to mode 1
$30 \text{ Pa} < \text{Static pressure}^{*2} \leq 80 \text{ Pa}$	Set to mode 2


\*1: For function settings, refer to "[Setting list](#)" in Chapter 7. FUNCTION SETTINGS on page 07-65.

\*2: Static pressure is airflow resistance that includes the discharge duct resistance and additional resistance like discharge grille and so on.

### • When an outlet duct is not installed, install the product as shown below.

- Provide 40 in (1 m) or more clearance to ceiling.
- Do not locate wall at rear of the unit.
- Up to 3 units can be installed in this configuration.

Unit: in (mm)

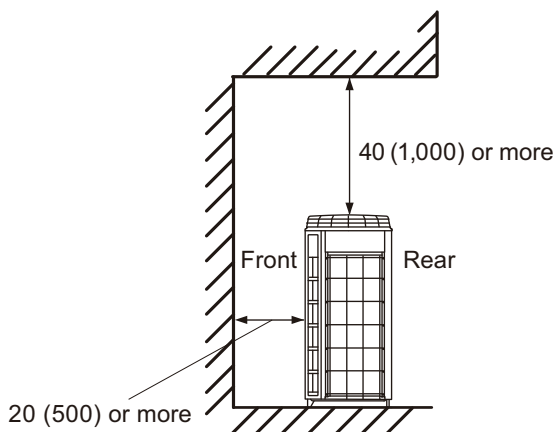



## 4-4. Concentrated installation example


- When installing units in a group, in order to avoid short circuiting that could reduce capacity or cause a shutdown, install units with clearances equal to or greater than shown below.
- To prevent short circuiting, consider elevating the units and provide openings at the bottom of the wall for airflow. When installing more than the number of units shown below, contact your distributor or representative for installation recommendations.

### ■ Example 1


Wall height: All 20 (500)

Unit: in (mm)

#### • 12 units installation example

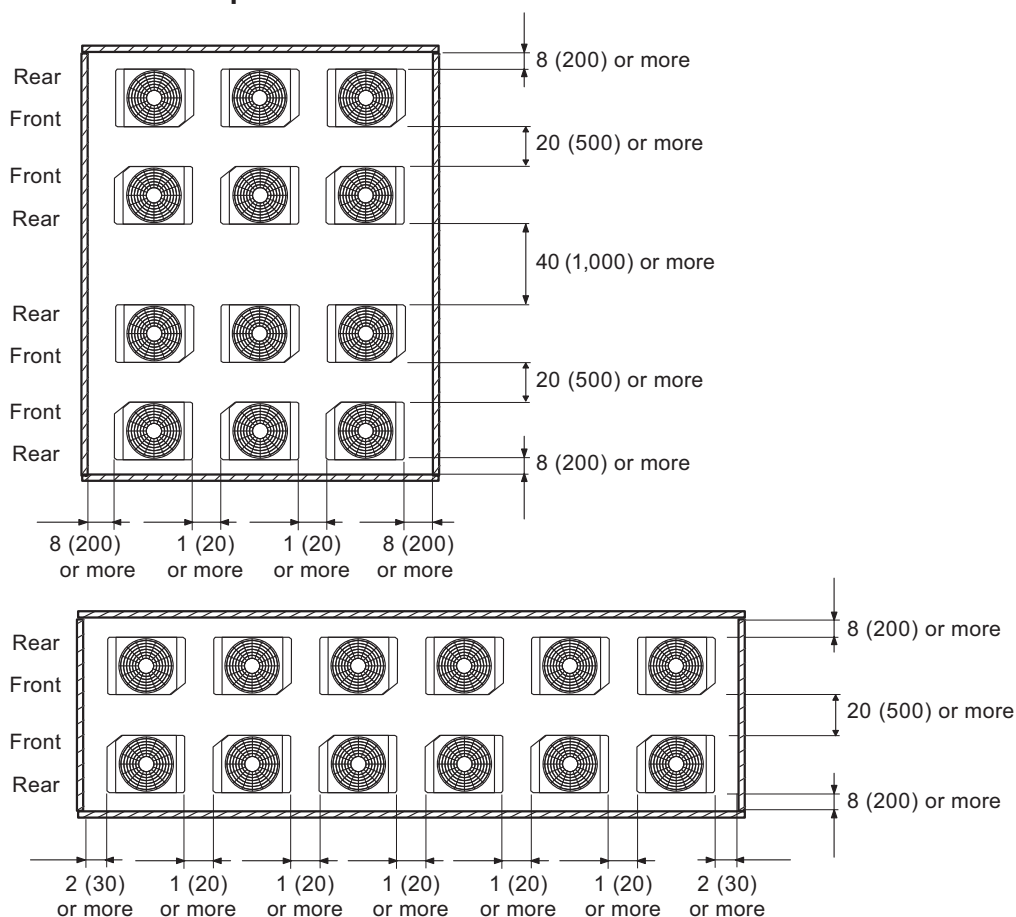

#### • 24 units installation example

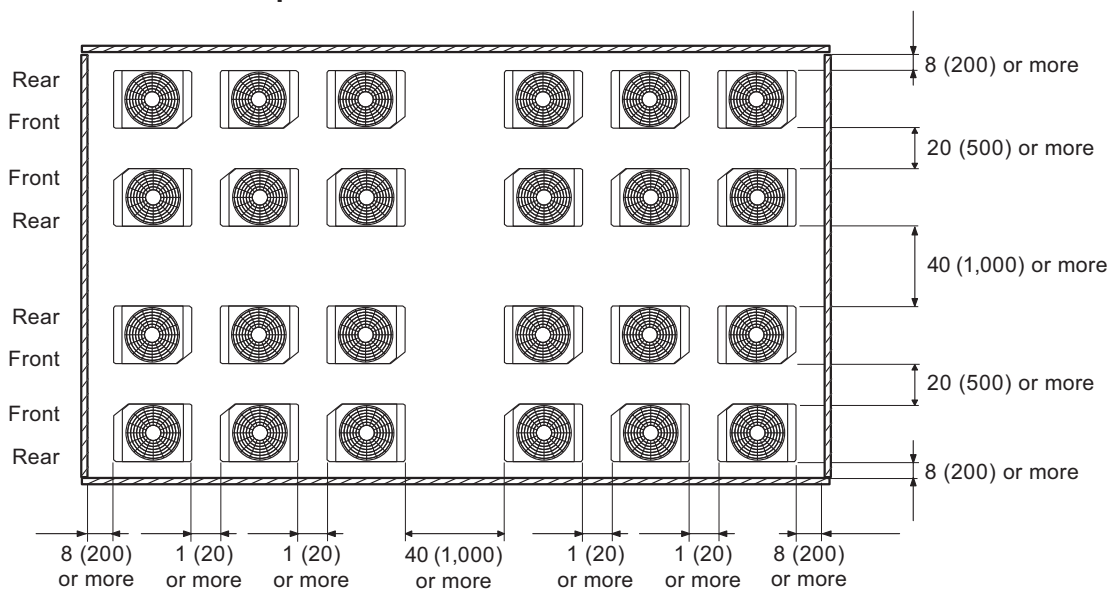


## Example 2

Wall height: All 67 (1,700)


Unit: in (mm)

However, the height of the            wall is unrestricted.

### • 12 units installation example

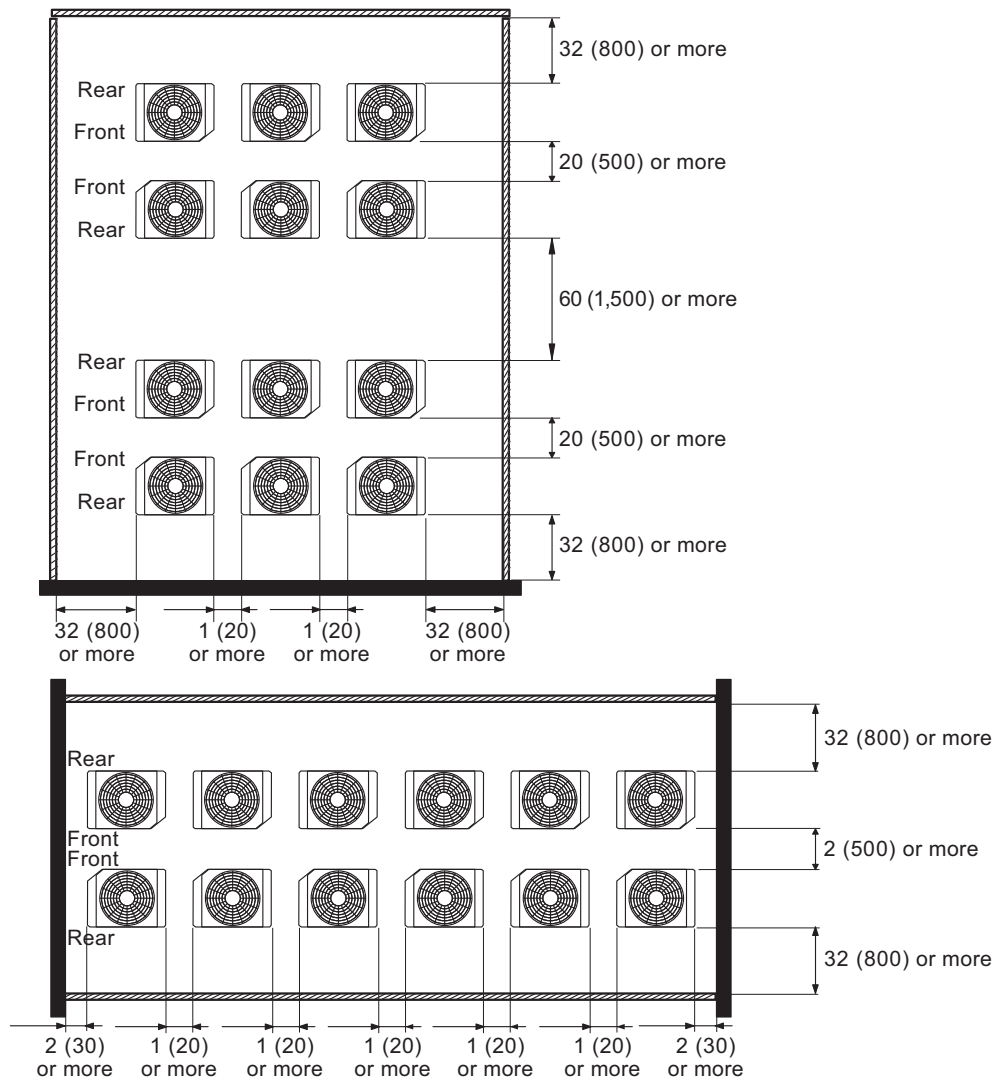

### • 24 units installation example

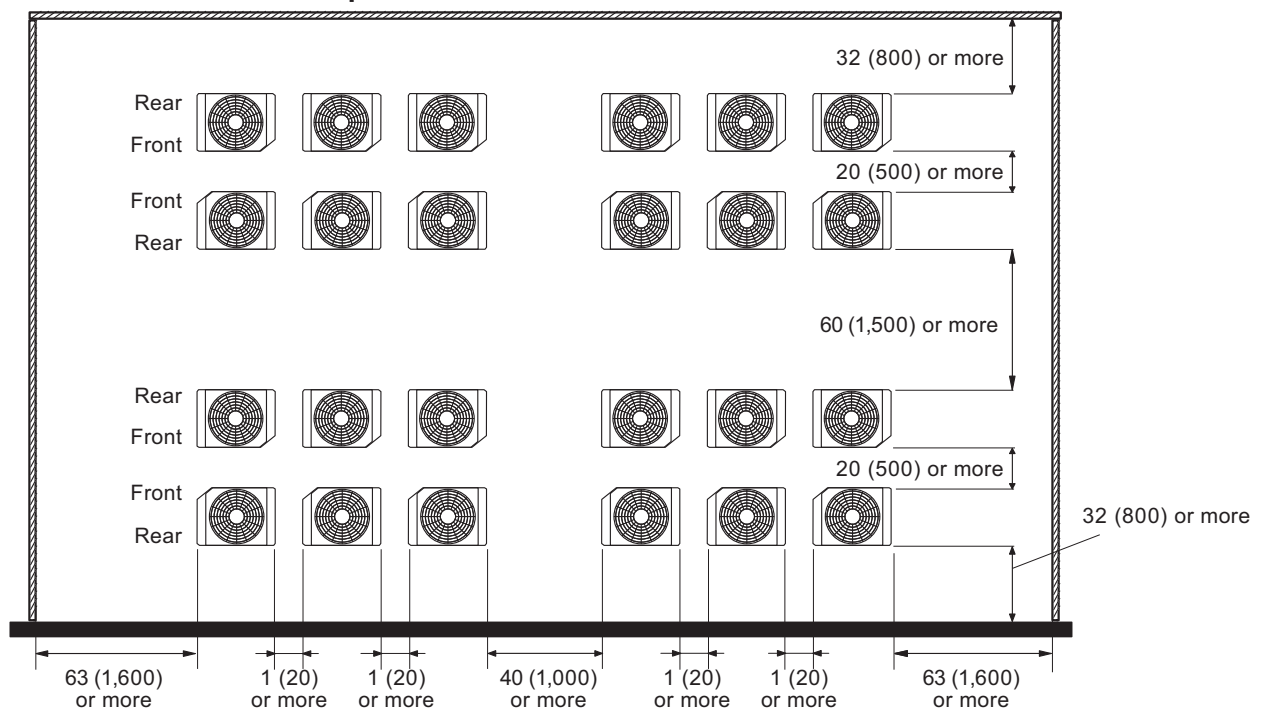


## Example 3

Wall height is unrestricted

Unit: in (mm)

Of the 4 directions, leave at least 2 directions open. Leave either the front or back direction.

### • 12 units installation example

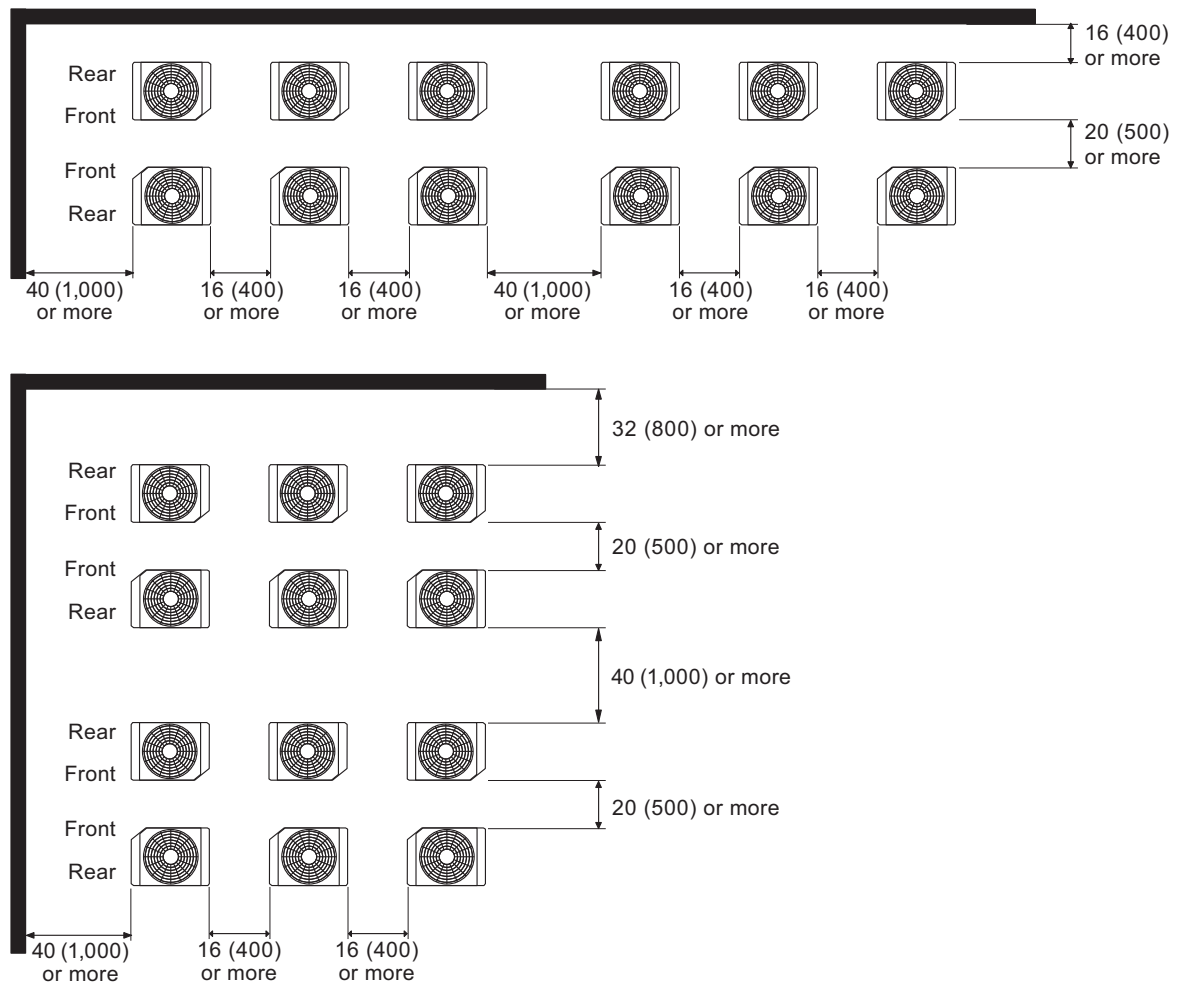

## 4-5. Installation on each floor

### • Precaution when installing on each floor

- When installing the product on each floor, be careful because updraft may cause a short circuit. If a short circuit occurred, the cooling and heating capacity and EER, COP (efficiency) may drop and in the worst case, high pressure protection may cause operation to stop.
- Regarding the installation dimensions, refer to the figure below and provide an ample intake space.
- Secure clearance for the refrigerant piping and electrical wiring.
- Install an outlet duct at each outdoor unit.



### • Installation example when installed on each floor

**NOTE:** If the installation differs from following example, be careful of short circuit.

Example	Height/Floor	Capacity/Floor	Installable floor number
	158 in (4,000 mm)	24 Ton	20 floors

Unit: in (mm)

Example of each floor

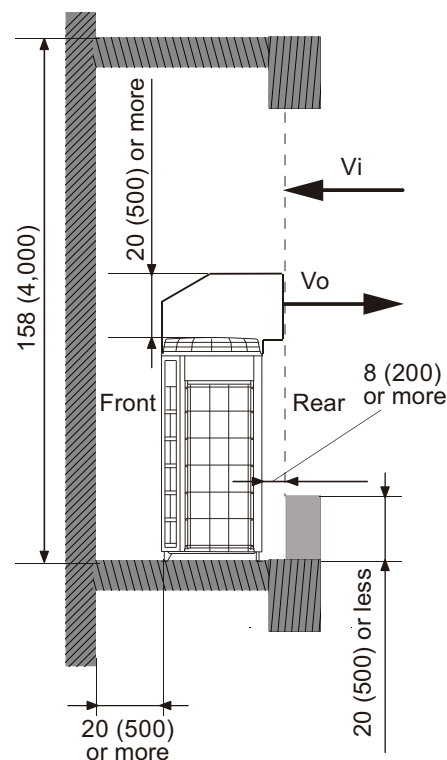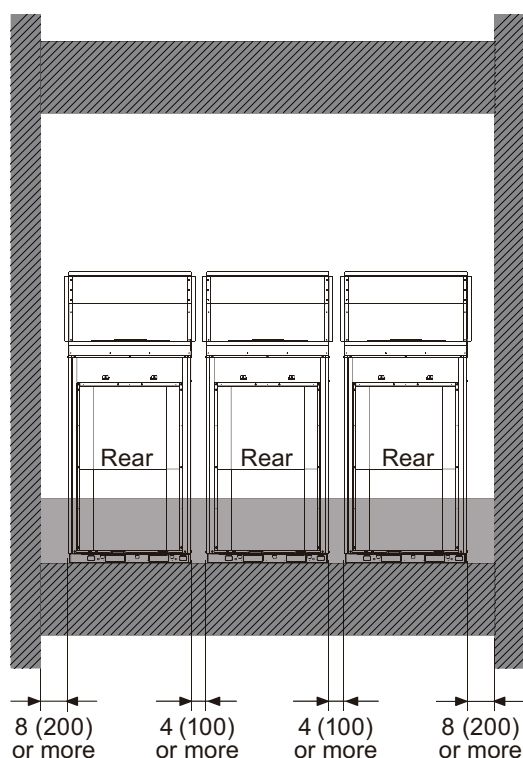

- The outlet air velocity ( $V_o$ ) = 18 to 25 ft/s (5.5 to 7.5 m/s)
- The intake air velocity ( $V_i$ ) = 4 ft/s (1.2 m/s) or less


### • When installing a louver

When installing a louver, pay attention to the following:

- Fit the outlet duct tightly to the louver so that short circuit will not occur.
- Make the louver angle  $0^\circ$  to  $20^\circ$  down. If installed facing up, short circuit is easily generated by updraft.
- Make the opening ratio of the outlet louver 75% or greater.

## 5. Refrigerant circuit

### 5-1. Models: AOUA72RLBV1, AOUA96RLBV1, and AOUA120RLBV1

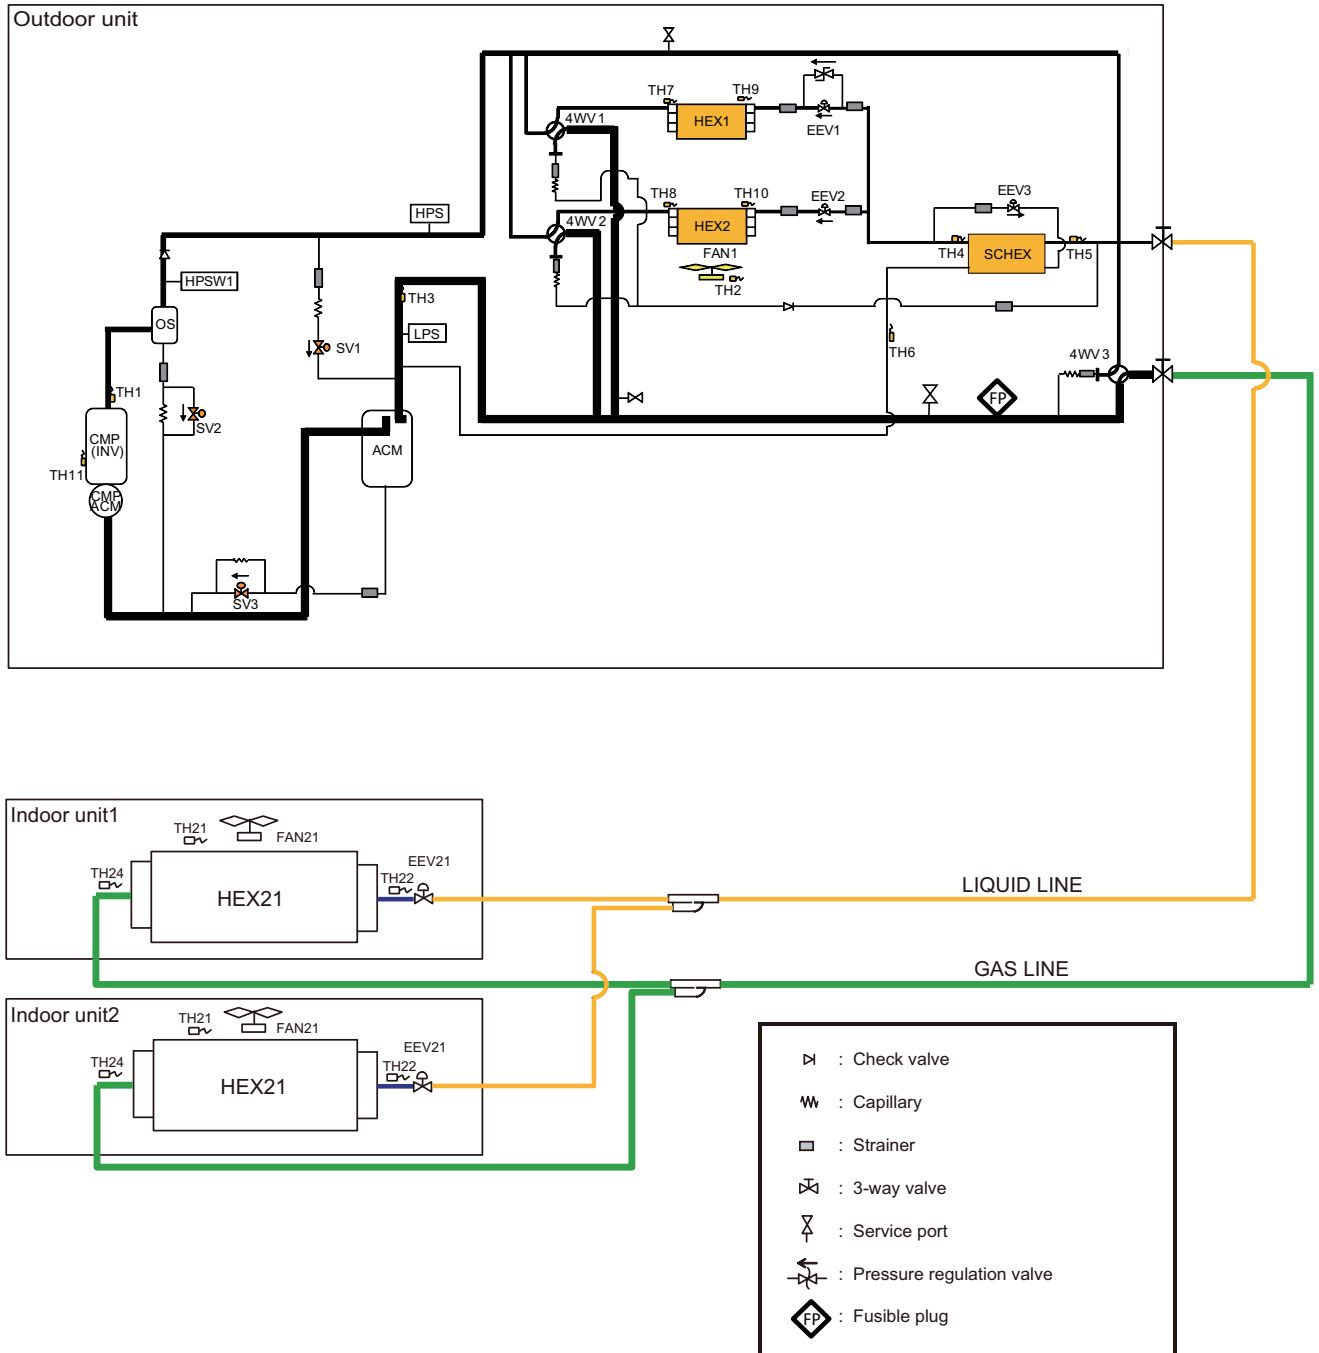

## 5-2. Symbol description

### • Outdoor unit


Symbol	Description	Marking color
CMP	Compressor 1 (Inverter type)	—
HEX1	Heat exchanger 1	—
HEX2	Heat exchanger 2	—
FAN1	Fan 1	—
ACM	Accumulator	—
OS	Oil separator	—
SCHEX	Sub-cool heat exchanger	—
HPS	High pressure sensor	—
LPS	Low pressure sensor	—
HPSW1	High pressure sensor switch 1	—
4WV1	4-way valve 1	—
4WV2	4-way valve 2	—
4WV3	4-way valve 3	—
EEV1	Electric expansion valve 1	—
EEV2	Electric expansion valve 2	—
EEV3	Electric expansion valve 3	—
SV1	Solenoid valve 1	—
SV2	Solenoid valve 2	—
SV3	Solenoid valve 3	—
TH1	Discharge temperature thermistor 1	Blue
TH2	Outdoor temperature thermistor	—
TH3	Suction temperature thermistor	Red
TH4	Liquid temperature thermistor 1	White
TH5	Liquid temperature thermistor 2	Brown
TH6	Sub-cool heat exchanger (outlet) thermistor	Green
TH7	Heat exchanger 1 gas thermistor	Black
TH8	Heat exchanger 2 gas thermistor	Yellow
TH9	Heat exchanger 1 liquid thermistor	Pink
TH10	Heat exchanger 2 liquid thermistor	Gray
TH11	Compressor 1 temperature thermistor	Orange

### • Indoor unit

Symbol	Description
HEX21	Heat exchanger
FAN21	Fan
EEV21	Electric expansion valve
TH21	Room temperature thermistor
TH22	Heat exchanger (inlet) thermistor
TH24	Heat exchanger (outlet) thermistor

## 6. Wiring diagrams

### 6-1. Models: AOUA72RLBV1, AOUA96RLBV1, and AOUA120RLBV1

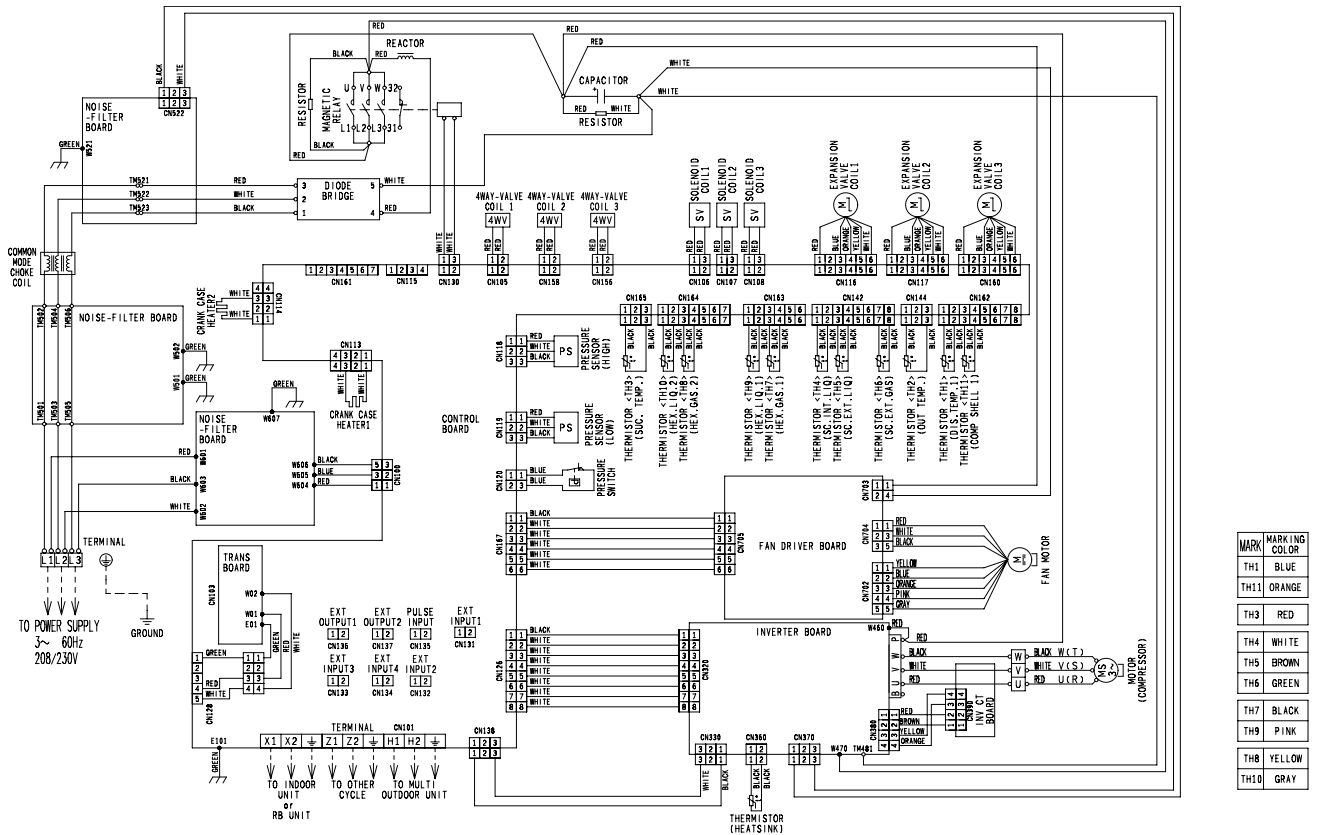

- NOTE:**
- X1 and X2: To be connected to indoor unit or RB unit
  - Z1 and Z2: To be connected to other master outdoor unit
  - H1 and H2: To be connected to outdoor unit within same refrigerant system

## 7. Operation range

### 7-1. Outdoor unit

#### ● Single outdoor unit

Operation mode	Operation range
Cooling/Dry	5 to 115 °FDB (-15 to 46 °CDB)
Heating	-4 to 70 °FDB (-20 to 21 °CDB)

#### ● Multiple outdoor unit

Operation mode	Operation range
Cooling/Dry	23 to 115 °FDB (-5 to 46 °CDB)
Heating	-4 to 70 °FDB (-20 to 21 °CDB)

### 7-2. Indoor unit

Operation mode	Operation range
Cooling/Dry	64 to 90 °FDB (18 to 32 °CDB) R.H. 80% or less
Heating	50 to 86 °FDB (10 to 30 °CDB)

R.H.: Relative humidity




## 8. Operation noise (sound pressure)


### 8-1. Noise level curve

#### ■ Model: AOUA72RLBV1

##### ● Cooling

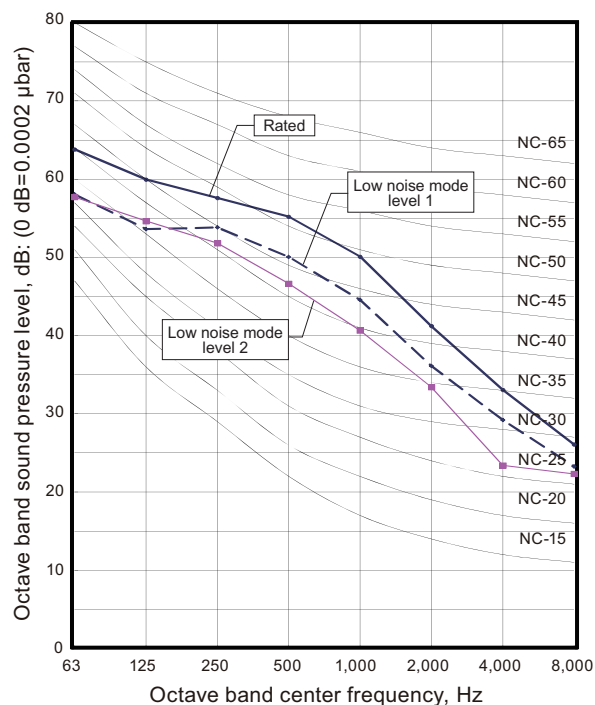


##### ● Heating

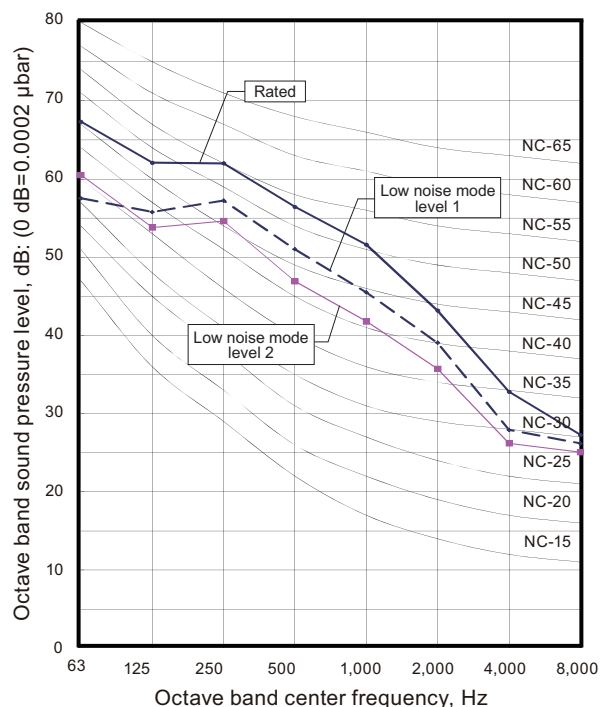


#### ■ Model: AOUA96RLBV1

##### ● Cooling

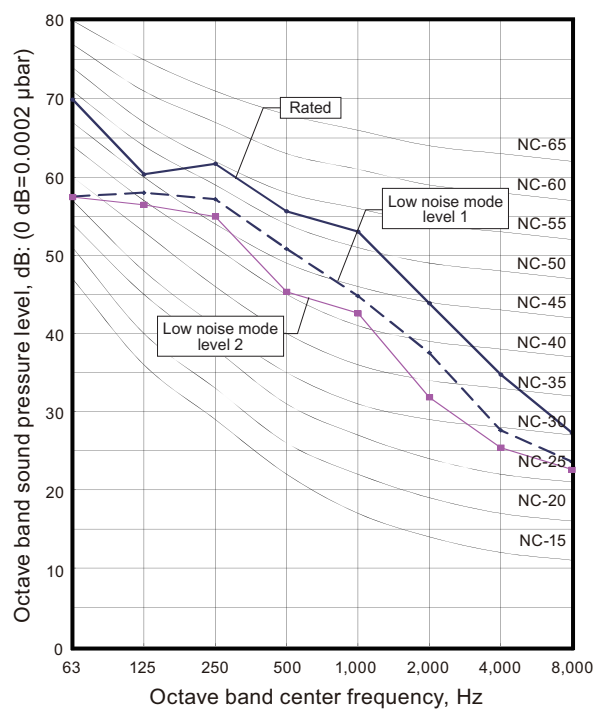


##### ● Heating

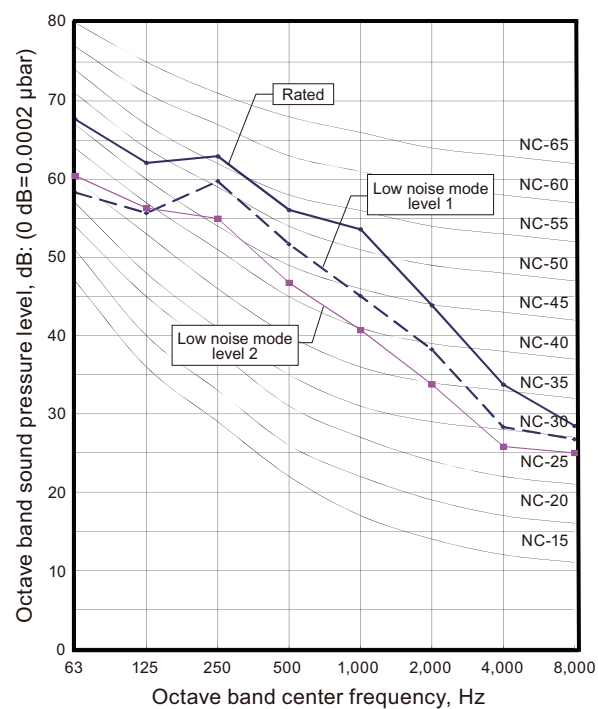


# Model: AOUA120RLBV1


## Cooling

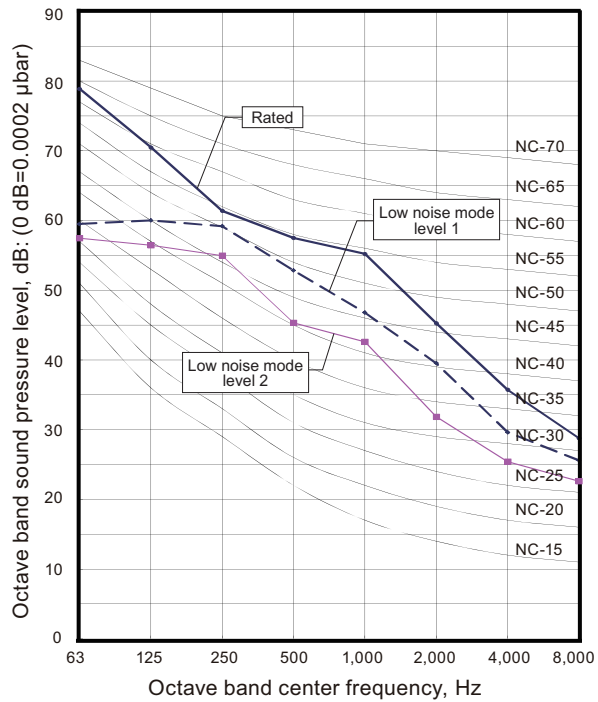

## Heating

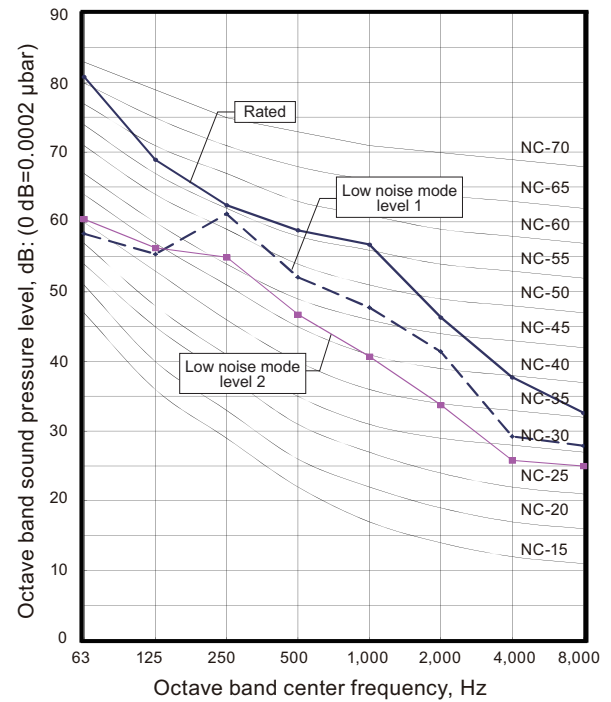

## 8-2. Sound level check point

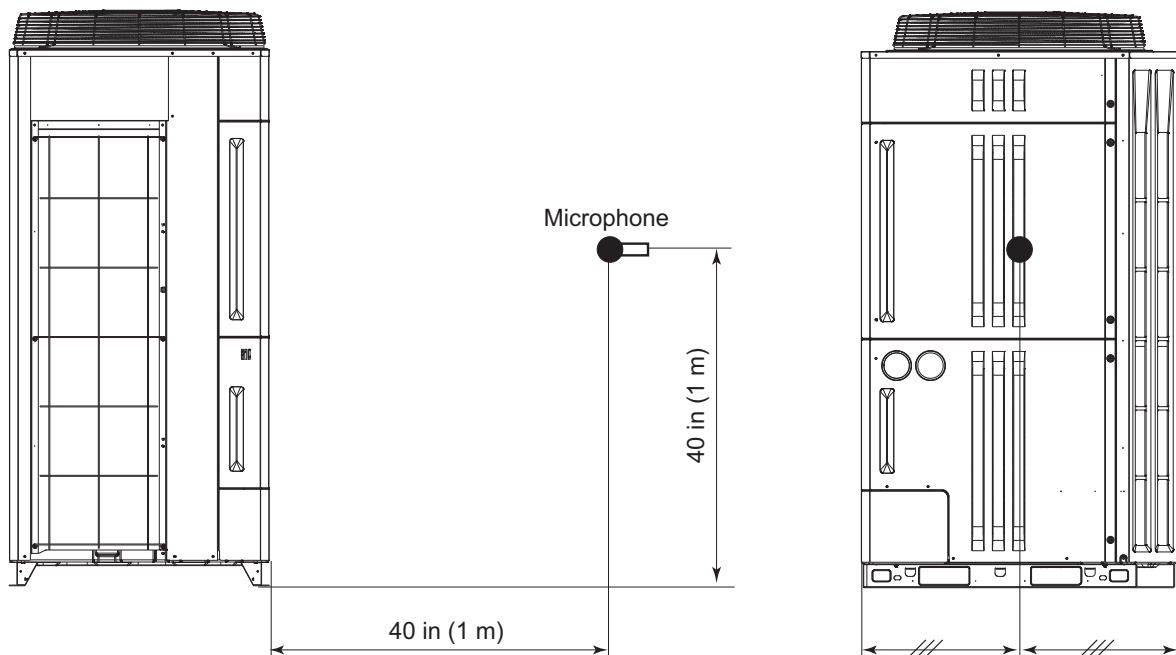

## 9. Electrical characteristics

Select the breaker based on MCA and MAX.CKT.BKR of the following tables.

Select the wire diameter based on the larger value of MCA or TOCA of the following tables.

Select a wire diameter which withstands the breaker capacity.

Select the correct cable type and size according to the country or region's regulations.

Limited wiring length is in case voltage drop less than 2%. When wiring length extend longer, select the wiring size of larger diameter.

- RLA: Rated Load Amp of compressor under the standard condition
- MCA: Minimum Circuit Ampacity = Maximum operating current (Full load)
- MSC: Maximum Starting Current
- TOCA: Total Over-Current Ampacity
- MAX.CKT.BKR: Maximum Circuit Breaker
- GFEB: Ground Fault Equipment Breaker

### 9-1. Stand-alone

Ton	Model name	Power supply: 208/230 V ~ 60 Hz		
		Full load characteristics		
		MCA (A)	TOCA (A)	MSC (A)
6	AOUA72RLBV1	41.0	45.0	33.2
8	AOUA96RLBV1	41.0	45.0	33.2
10	AOUA120RLBV1	50.0	55.0	40.0

HP	Model name	Wiring specifications	Compressor	Outdoor Fan Motor	
		MAX.CKT.BKR (A)	RLA (A)	Output (kW)	FLA (A)
6	AOUA72RLBV1	50.0	17.0	0.74	3.0
8	AOUA96RLBV1	50.0	25.0	0.74	3.0
10	AOUA120RLBV1	60.0	32.0	0.74	3.4

- Select the circuit breaker based on MCA and MAX.CKT.BKR of the table above.
- Select the wire diameter based on the larger value of MCA or TOCA of the table above and select a wire diameter which withstands the breaker capacity.
- Select the correct cable type and size according to the country or region's regulations.
- Limited Wiring Length is in case voltage drop less than 2%. When wiring length extend longer,

RLA: Rated Load Amp of compressor under the standard condition.

MCA: Min Circuit Amp = Max Operating Current (Full Load)

MSC: Max Starting Current

TOCA: Total Value of Each Over Current Set

MAX.CKT.BKR: Maximum Circuit Breaker

## 9-2. Combination

Ton	Set model name	Model name	Power supply: 60 Hz, 208/230 V		
			Full load characteristics		
			MCA (A)	TOCA (A)	MSC (A)
12	AOUA144RLBVG1	AOUA72RLBV1 AOUA72RLBV1	82.0	90.0	66.4
14	AOUA168RLBVG1	AOUA96RLBV1 AOUA72RLBV1	82.0	90.0	66.4
16	AOUA192RLBVG1	AOUA120RLBV1 AOUA72RLBV1	91.0	100.0	73.2
18	AOUA216RLBVG1	AOUA120RLBV1 AOUA96RLBV1	91.0	100.0	73.2
20	AOUA240RLBVG1	AOUA120RLBV1 AOUA120RLBV1	100.0	110.0	80.0
22	AOUA264RLBVG1	AOUA96RLBV1 AOUA96RLBV1 AOUA72RLBV1	123.0	135.0	99.6
24	AOUA288RLBVG1	AOUA96RLBV1 AOUA96RLBV1 AOUA96RLBV1	123.0	135.0	99.6

OUTDOOR  
UNITSOUTDOOR  
UNITS

## 10. Safety devices

Type of protection	Protection form		Model		
			AOUA72RLBV1	AOUA96RLBV1	AOUA120RLBV1
Circuit protection	Fuse (Main)		AC 250 V, 5 A		
	Protector (Inv)		AC 450 V, 60 A		
	Fuse (Varistor)		AC 250 V, 3.15 A		
	Protector (Fan driver)		DC 500 V, 10 A		
Compressor protector	Over current protection		—		
	Temperature protection	Activate	239 °F (115 °C) Compressor stop		
		Reset	176 °F (80 °C) Compressor restart		
High pressure protection			580 psi (4.0 MPa)		
			464 psi (3.2 MPa)		
Low pressure protection	Activate		7.25 psi (0.05 MPa)		

# 11. Locally purchased parts

## 11-1. Air discharge duct


### ■ Precaution

- All components such as the duct, support framework, misc. screws, and hardware to be locally purchased.
- Do not install the duct where prevailing wind will blow directly into it.
- Configure installation so that static pressure loss of duct or louvers etc. will not exceed 0.32 inWG (80 Pa).
- Allow sufficient space for combined height of duct and unit.
- Installation condition may requires that the duct is attached before the unit is installed.
- Unit noise levels may increase with duct installed.

### ■ Duct layout example

Unit: in (mm)

Model name	Dimension C	
	Minimum	Maximum
AOUA72RLBV1	33-15/16 (862)	36-9/16 (928)
AOUA96RLBV1		
AOUA120RLBV1	46-1/8 (1,172)	48-3/4 (1,238)

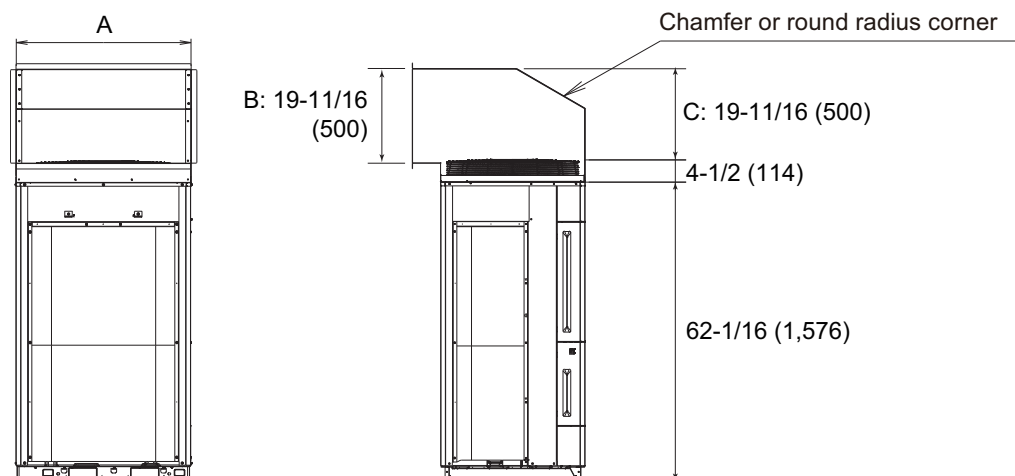


### ⚠ CAUTION

- The height B of the duct opening should be 19-11/16 in (500 mm) or greater.
- The height C of the duct opening should be 19-11/16 in (500 mm) or greater excluding the duct flange.
- Provide chamfer or round radius corner.
- Duct and components must weigh less than 220 lb (100 kg).
- Duct must be designed to allow access to fan motor through top of unit.
- Provide adequate support for ductwork.

## ■ Installation procedure


1. Remove the top panel/fan guard assembly from the cabinet.

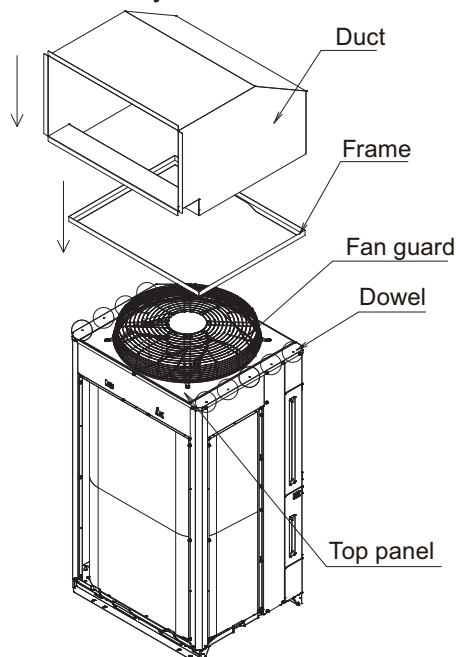

Example of Installation

2. Using the 9 dowel markings on the top panel drill 1/4 in (6 mm) holes in the top panel/fan guard assembly.

Unit: in (mm)

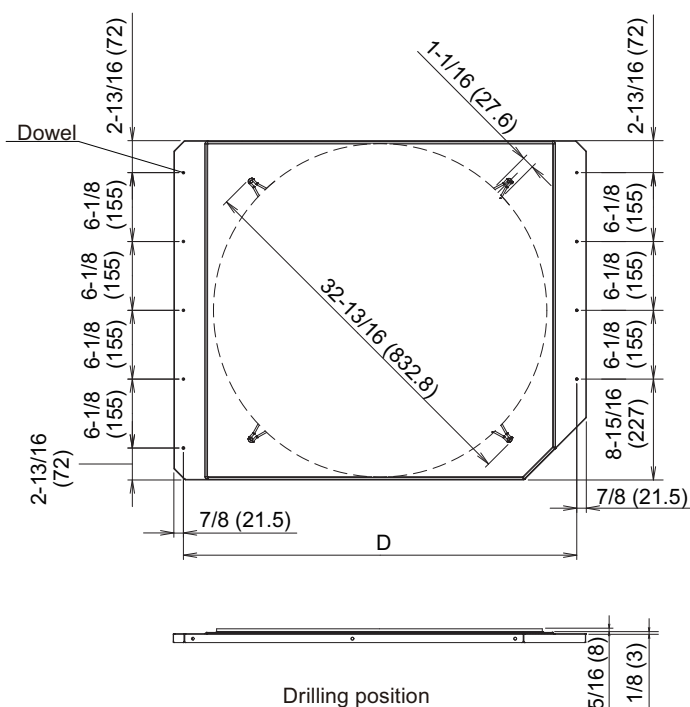


Model name	Dimension D
AOUA72RLBV1	34-7/8 (886)
AOUA96RLBV1	
AOUA120RLBV1	47-1/16 (1,196)

3. Reinstall the top panel/fan guard assembly.
4. Install flange/frame on top of the top panel/fan guard assembly using the predrilled holes and secure with 3/16 in (5 mm) screws.

5. Install duct onto the flange/frame using 3/16 in (5 mm) self tapping screws.

**⚠ CAUTION**

- Use 3/16 in (5 mm) self tapping screws with a length of 3/8 in (10 mm) to 13/16 in (20 mm).
- Do not drill in any locations other than the dowels, otherwise damage to the unit could occur and affect unit operation.
- To prevent air leakage and loss of performance, provide triangular steel cover plate at corner.

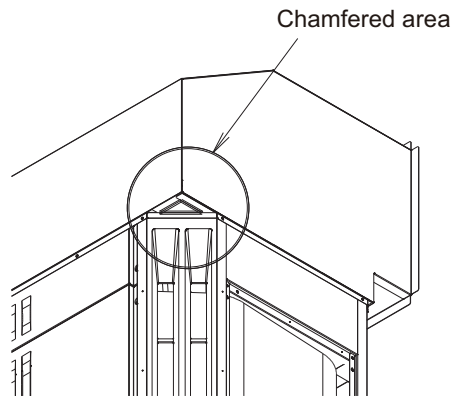




## 11-2. Snow hood

In cold or snowy area, install inlet and outlet hood to maintain stable operation and avoid snow damage.

### ■ Precaution

- All components or parts such as the snow hood, frame, and screws are to be locally purchased.
- Prior to installation of snow hoods, install unit on equipment foundation.
- Provide equipment foundation high enough to keep the unit base above the snow level. Foundation width should not exceed unit width.
- Install the snow hood so that direct blows are diverted from the opening.
- Note that installation of the snow hood increases the height of the cabinet.
- In multi unit installations, it may be necessary to install snow hoods before units are set in place.
- Static pressure loss of the airflow path including snow hoods must be 0.32 inWG (80 Pa) or less.
- Unit noise levels may increase with snow hood installed.

### ■ Installation example

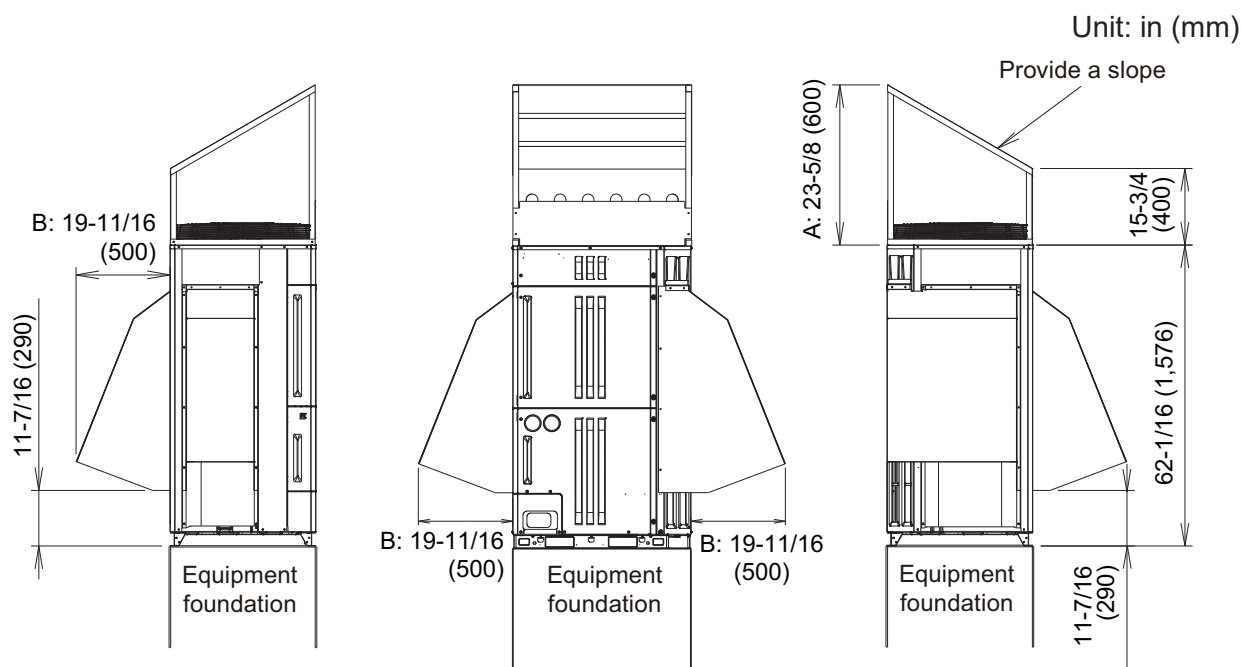

### ⚠ CAUTION

- Opening height A of the snow hood should be  $23\frac{5}{8}$  in (600 mm) or greater.
- The depth B of the snow hood should be  $19\frac{11}{16}$  in (500 mm) or greater.
- Provide ample slope so that snow will not accumulate on top of the snow hood. In addition, configure the snow hood so that snow will not fall off and accumulate at the hood inlet.


## ■ Installation procedure

### • Installing the upper part of snow hood

The upper part of snow hood can be installed in the same manner as the air discharge duct previously described. For details, refer to "Installation procedure" on page 03-41.

### • Installing the side of snow hood

1. Before starting snow hood installation, remove the screws from the external net to remove the net.
2. Install the snow hood, using the screw holes shown below.

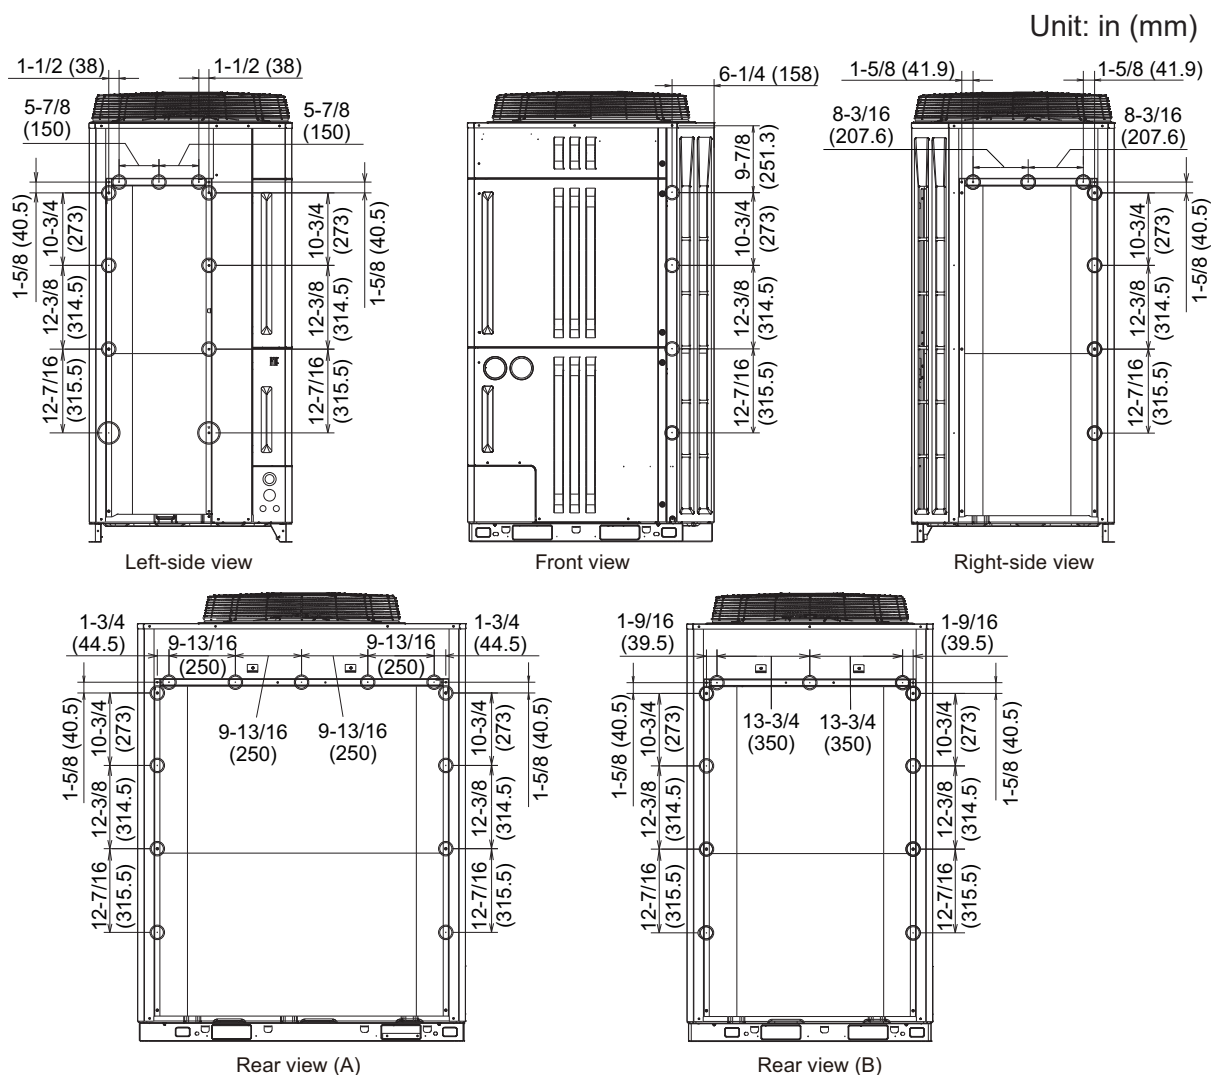


3. Remove the screws from where circles are marked in the figure, and make a  $\varnothing 3/16$  in (4.6 mm) hole in each dowel.

### ⚠ CAUTION

- Use 3/16 in (5 mm) self tapping screws having a thread length of 3/8 in (10 mm) to 13/16 in (20 mm).
- Remove only the screws that are highlighted with a circle shown in the figure.
- Drill hole in dowels only where highlighted with a circle shown in the figure, otherwise damage to the unit could occur.

- Notes on installation

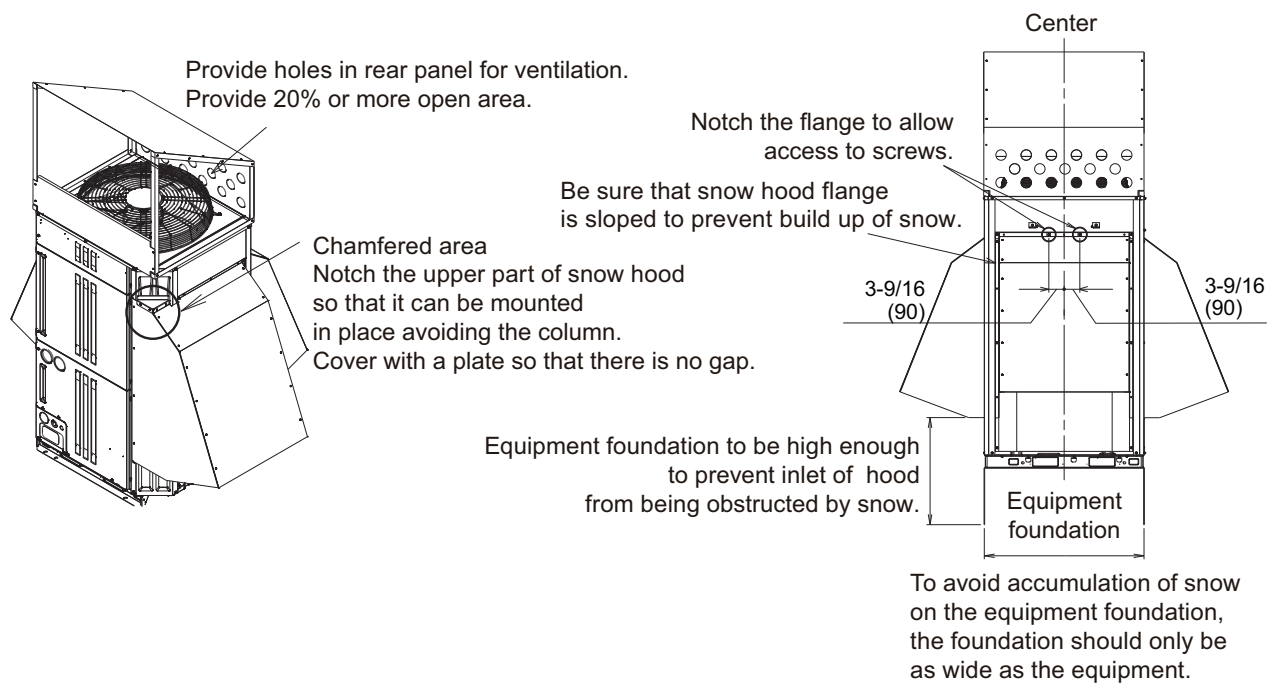


## 11-3. Pressure gauge

### ■ How to install

**NOTE:** All the components or parts such as the two pressure gauges, mounting plate, acrylic plates, double-stick tape, and capillary tubes are to be locally purchased.

Remove the panel as shown in the figure below, and install the pressure gauges.


Unit: in (mm)

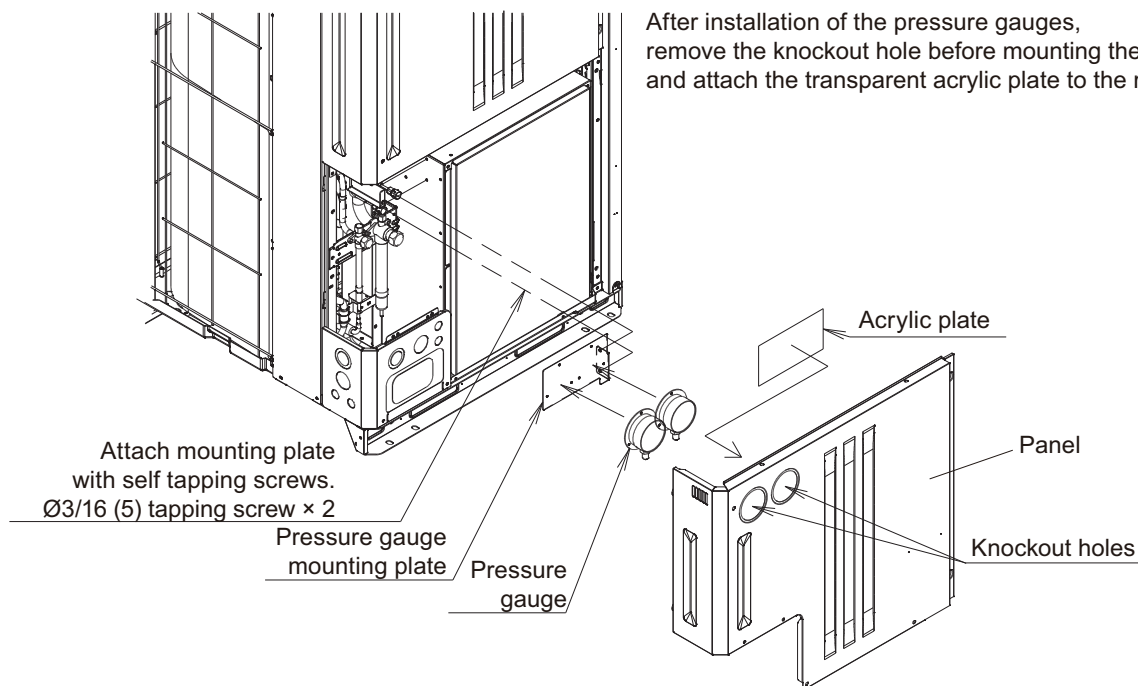

#### • Attachment of transparent acrylic plate

Prepare a transparent acrylic plate, and attach the acrylic plate with thick double-stick tape to completely close the knockout holes.

Unit: in (mm)

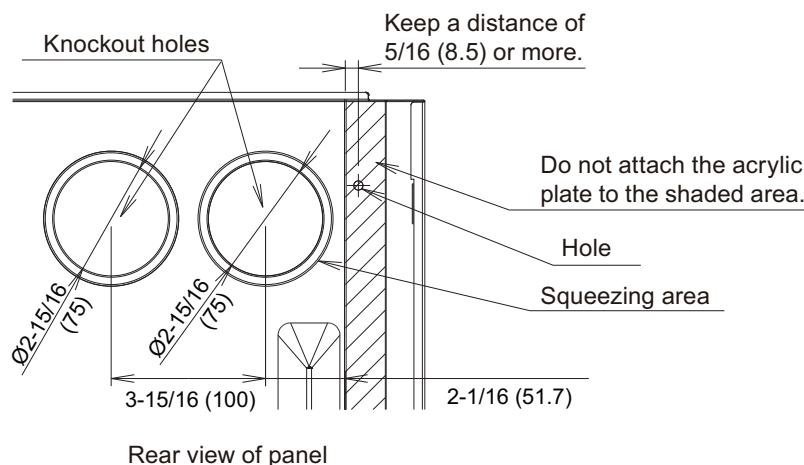


#### ⚠ CAUTION

- Firmly attach acrylic plate to panel to prevent water from leaking into unit cabinet.
- The acrylic plate must be attached to the left of the shaded area in the figure above.

- Pressure gauges (recommended)

Unit: in (mm)

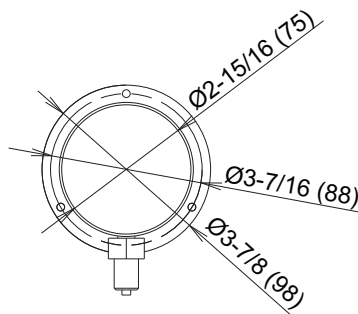


### ⚠ CAUTION

- Use a pressure gauges having an outside diameter (including the mounting part) of  $\text{Ø}3\text{-}7/8$  (98) or less and a gauge diameter of  $\text{Ø}2\text{-}15/16$  (75) or less.
- Measuring ranges of the pressure gauges:  
High pressure side: 0 to 725 psi (0 to 5 MPa)  
Low pressure side: 0 to 507 psi (0 to 3.5 MPa)  
However, it is recommended that both pressure gauges should be designed for a measuring range 0 to 725 psi (0 to 5 MPa).

- Pressure gauge mounting plate

Unit: in (mm)

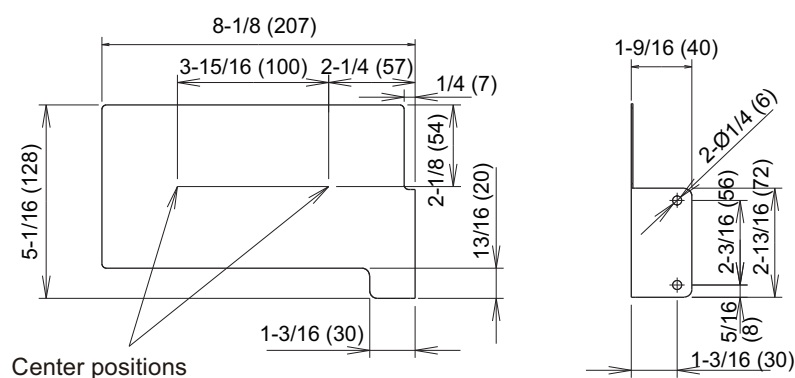


### ⚠ CAUTION

- Use a pressure gauges mounting plate of the above outside dimensions.
- The mounting plate must be thick enough to endure the weights of the pressure gauges.
- Make mounting screw holes in accordance with each pressure gauge.
- Each pressure gauge must be installed at the center position shown in the figure above.

- **Pressure gauge pipe connection positions**

Connect each pressure gauge with the pipe at the connection position shown in the figure below.

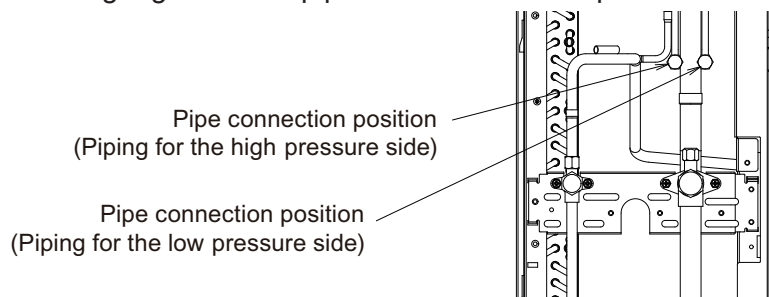

### **⚠ CAUTION**

- Gauge connections are 1/2-20 UNF (5/16") male flare (with valve core).
- Provide R410A hose or refrigerant tubing with 1/2-20 UNF (5/16") female flare that is rated for and can withstand 725 psi (5 MPa). Be sure method of connection and support does not place stress on gauge or location of piping connection.
- Purge air and leak test after installation.


## 11-4. Central drain pan

### ■ How to install

#### NOTES:


- All the components and parts including drain pan and piping materials are to be locally purchased.
- If drain pan is installed, refrigerant piping cannot be routed out the bottom.
- Do not locate the unit over an area that cannot get wet.
- It is possible under certain circumstances that some water may not be captured by the drain pan.
- Do not use a drain pan where freezing conditions in the pan or piping may occur.
- If drain pan piping connections are routed out the bottom of the pan, provide a foundation to raise the unit a minimum of 7-7/8 in (200 mm).

Unit: in (mm)

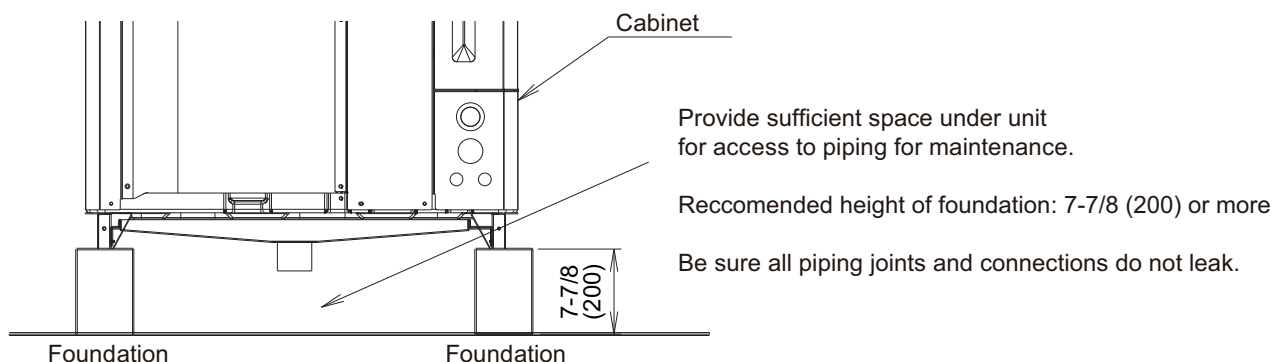

### ■ Installation procedure

Unit: in (mm)

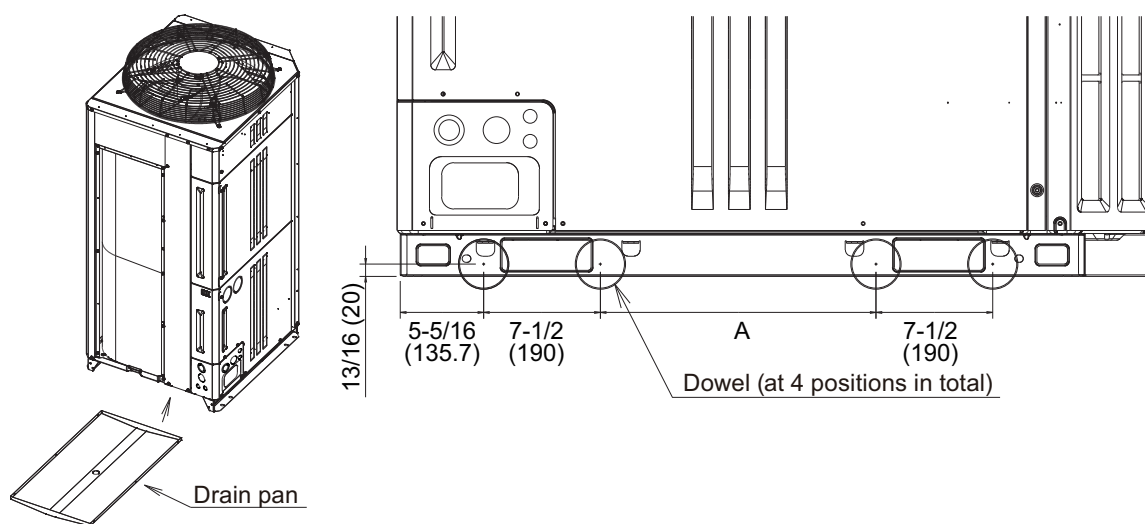


Model name	Dimension F
AQUA72RLBV1	5-1/2 (139)
AQUA96RLBV1	
AQUA120RLBV1	17-11/16 (449)

Drill holes in dowels located in base foot as shown in the figure above (total 8).


Attach drain pan using self tapping screws at dowel locations.

### • Notes on installation

- Make sure to design and install drain pan to cover the all drain hole on base completely.
- The gap between drain pan and base should be less than 1/16 in (2 mm).
- Be careful of the foot place during the working or design process.
- If the foundation or foot place makes working difficult, the metal fittings should be used as shown below.
- A drain pan not having the recommended outside dimensions can cause a water leakage or cannot be installed.
- Gaps other than the drain holes cause a water leakage. Completely close all the gaps in the bottom and sides by welding.

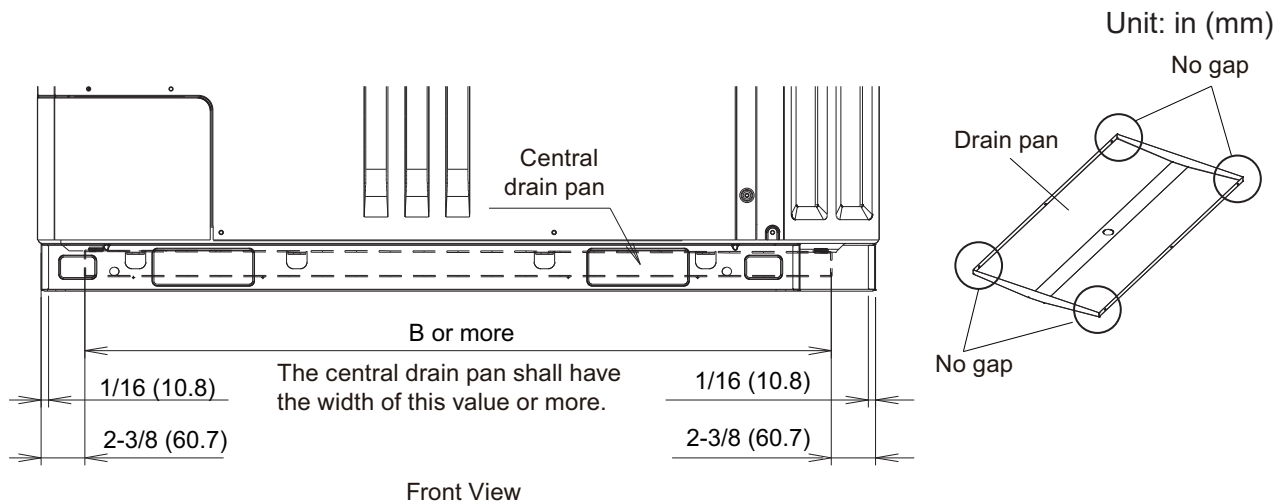

Model name	Dimension H
AQUA72RLBV1	31-5/16 (795)
AQUA96RLBV1	
AQUA120RLBV1	43-1/2 (1,105)

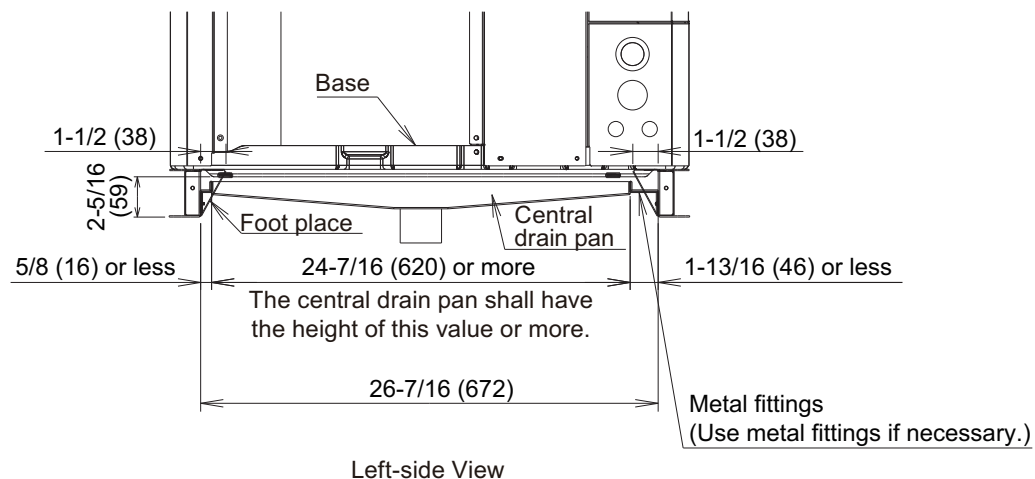








## 12. Accessories

The following installation parts are supplied. Use them as required. Do not discard any accessories until the installation work has been completed.

### 12-1. Stand-alone

Name and shape	Q'ty	Application
 Specifications manual	1	
 Installation manual	1	
 Cable tie	3	For securing the power and transmission cables. Do not run power cable and transmission cable together, electrical interference will cause communication errors.

Joint pipe for suction gas pipe	AQUA72RLBV1	AQUA96RLBV1	AQUA120RLBV1
 For connecting the gas pipe (L type) Joint pipe A (L type)	1	1	1
 For connecting the gas pipe (Straight type) Joint pipe B (Straight type)	1	1	1





## 4. INDOOR UNITS

# CONTENTS

## 4. INDOOR UNITS

<b>1. Model lineup .....</b>	<b>04-1</b>
1-1. Indoor units.....	04-1
<b>2. Specifications .....</b>	<b>04-4</b>
2-1. Compact cassette type .....	04-4
2-2. 4-way flow cassette type .....	04-6
2-3. Circular flow cassette type.....	04-8
2-4. Mini duct type .....	04-10
2-5. Slim duct/Slim concealed floor type .....	04-11
2-6. Medium static pressure duct type .....	04-13
2-7. High static pressure duct type .....	04-14
2-8. Compact floor type .....	04-16
2-9. Floor/Ceiling type.....	04-18
2-10. Ceiling type.....	04-19
2-11. Wall mounted type.....	04-20
<b>3. Electrical characteristics .....</b>	<b>04-26</b>
<b>4. Dimensions .....</b>	<b>04-28</b>
4-1. Compact cassette type .....	04-28
4-2. 4-way flow cassette type .....	04-30
4-3. Circular flow cassette type.....	04-33
4-4. Mini duct type .....	04-36
4-5. Slim duct/Slim concealed floor type .....	04-38
4-6. Medium static pressure duct type .....	04-42
4-7. High static pressure duct type .....	04-44
4-8. Compact floor type .....	04-48
4-9. Floor/Ceiling type.....	04-50
4-10. Ceiling type.....	04-52
4-11. Wall mounted type.....	04-54
<b>5. Wiring diagrams .....</b>	<b>04-64</b>
5-1. Compact cassette type .....	04-64
5-2. 4-way flow cassette type .....	04-65
5-3. Circular flow cassette type.....	04-66
5-4. Mini duct type .....	04-67
5-5. Slim duct/Slim concealed floor type .....	04-68
5-6. Medium static pressure duct type .....	04-69
5-7. High static pressure duct type .....	04-70
5-8. Compact floor type .....	04-72
5-9. Floor/Ceiling type.....	04-73
5-10. Ceiling type.....	04-74
5-11. Wall mounted type.....	04-75
<b>6. Air velocity and temperature distributions .....</b>	<b>04-79</b>
6-1. Compact cassette type .....	04-79

## CONTENTS (continued)



















6-2. 4-way flow cassette type .....	04-93
6-3. Circular flow cassette type.....	04-97
6-4. Mini duct type .....	04-102
6-5. Slim duct/Slim concealed floor type .....	04-104
6-6. Compact floor type .....	04-114
6-7. Floor/Ceiling type.....	04-118
6-8. Ceiling type.....	04-124
6-9. Wall mounted type.....	04-126
<b>7. Fan performance curve.....</b>	<b>04-138</b>
7-1. Mini duct type .....	04-138
7-2. Slim duct/Slim concealed floor type.....	04-141
7-3. Medium static pressure duct type .....	04-151
7-4. High static pressure duct type .....	04-157
7-5. Fresh air characteristics.....	04-164
<b>8. Airflow .....</b>	<b>04-166</b>
8-1. Compact cassette type .....	04-166
8-2. 4-way flow cassette type .....	04-167
8-3. Circular flow cassette type.....	04-168
8-4. Mini duct type .....	04-169
8-5. Slim duct/Slim concealed floor type.....	04-169
8-6. Medium static pressure duct type .....	04-170
8-7. High static pressure duct type .....	04-170
8-8. Compact floor type .....	04-171
8-9. Floor/Ceiling type.....	04-172
8-10. Ceiling type.....	04-173
8-11. Wall mounted type.....	04-173
<b>9. Noise level curve.....</b>	<b>04-175</b>
9-1. Compact cassette type .....	04-175
9-2. 4-way flow cassette type .....	04-177
9-3. Circular flow cassette type.....	04-178
9-4. Mini duct type .....	04-180
9-5. Slim duct/Slim concealed floor type.....	04-181
9-6. Medium static pressure duct type .....	04-183
9-7. High static pressure duct type .....	04-184
9-8. Compact floor type .....	04-186
9-9. Floor/Ceiling type.....	04-188
9-10. Ceiling type.....	04-189
9-11. Wall mounted type.....	04-190
9-12. Sound level check point.....	04-194
<b>10. Safety devices .....</b>	<b>04-195</b>
10-1. Compact cassette type .....	04-195
10-2. 4-way flow cassette type .....	04-195
10-3. Circular flow cassette type.....	04-195
10-4. Mini duct type .....	04-195

## CONTENTS (continued)

10-5.Slim duct/Slim concealed floor type .....	04-196
10-6.Medium static pressure duct type .....	04-196
10-7.High static pressure duct type .....	04-196
10-8.Compact floor type .....	04-196
10-9.Floor/Ceiling type.....	04-197
10-10.Ceiling type.....	04-197
10-11.Wall mounted type.....	04-197
<b>11. Accessories .....</b>	<b>04-198</b>
11-1.Compact cassette type .....	04-198
11-2.4-way flow cassette type .....	04-199
11-3.Circular flow cassette type.....	04-200
11-4.Mini duct type .....	04-201
11-5.Slim duct/Slim concealed floor type.....	04-202
11-6.Medium static pressure duct type .....	04-203
11-7.High static pressure duct type .....	04-204
11-8.Compact floor type .....	04-205
11-9.Floor/Ceiling type.....	04-206
11-10.Ceiling type.....	04-207
11-11.Wall mounted type.....	04-208

# 1. Model lineup

## 1-1. Indoor units

	Type	Capacity														
	Btu/h	4,000	7,500	9,500	12,000	14,000	18,000	24,000	30,000	34,000	36,000	48,000	60,000	72,000	96,000	
	Model code	4	7	9	12	14	18	24	30	36	36	48	60	72	96	
Compact cas- sette		•	•	•	•	•	•	•								
																
4-way flow cassette							•	•								
									•		•					
Circular flow cassette							•	•	•							
											•	•				
Mini duct		•														
Slim duct/Slim concealed floor			•	•	•	•										
							•									
Medium static pressure duct								•	•		•					
High static pressure duct											•	•	•			
														•		
															•	
Compact floor		•	•	•	•	•										
Floor/Ceiling					•	•	•	•								
Ceiling									•		•					
Wall mounted		•	•	•	•	•										
							•	•								
									•	•						
			•	•	•	•										
							•	•								

INDOOR  
UNITSINDOOR  
UNITS

Type	Rated capacity (Btu/h)		Model name	Dimensions	Remarks
	Cooling	Heating		H × W × D	
Compact cassette	4,000	4,400	AUUA4TLAV2	9-5/8 × 22-7/16 × 22-7/16 (245 × 570 × 570)	Cassette grille: UTG-CCGVG (Grid type)
	7,500	9,500	AUUA7TLAV2		
	9,500	10,900	AUUA9TLAV2		
	12,000	13,500	AUUA12TLAV2		
	14,000	15,600	AUUA14TLAV2		
	18,000	20,000	AUUA18TLAV2		
	24,000	27,000	AUUA24TLAV2		
4-way flow cassette	18,000	20,000	AUUB18TLAV	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)	Cassette grille: UTG-LCGV
	24,000	27,000	AUUB24TLAV	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)	
	30,000	34,000	AUUB30TLAV		
	36,000	40,000	AUUB36TLAV		
Circular flow cassette	18,000	20,000	AUUB18TLAV2	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)	Cassette grille: UTG-LCGVCW (White) UTG-LCGVCB (Black)
	24,000	27,000	AUUB24TLAV2		
	30,000	34,000	AUUB30TLAV2	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)	
	36,000	40,000	AUUB36TLAV2		
	48,000	54,000	AUUB48TLAV2		
Mini duct	4,000	4,400	ARUL4TLAV2	7-13/16 × 27-9/16 × 17-11/16 (198 × 700 × 450)	
Slim duct/Slim concealed floor	7,500	9,500	ARUL7TLAV2	7-13/16 × 27-9/16 × 24-7/16 (198 × 700 × 620)	
	9,500	10,900	ARUL9TLAV2		
	12,000	13,500	ARUL12TLAV2		
	14,000	15,600	ARUL14TLAV2		
	18,000	20,000	ARUL18TLAV2	7-13/16 × 35-7/16 × 24-7/16 (198 × 900 × 620)	
Medium static pressure duct	24,000	27,000	ARUM24TLAV2	10-5/16 × 44-11/16 × 27-9/16 (270 × 1,135 × 700)	
	30,000	34,000	ARUM30TLAV2		
	36,000	40,000	ARUM36TLAV2		
High static pressure duct	36,000	40,000	ARUH36TLAV	15-3/4 × 41-5/16 × 19-11/16 (400 × 1,050 × 500)	
	48,000	54,000	ARUH48TLAV		
	60,000	67,000	ARUH60TLAV		
	72,000	81,000	ARUH72TLAV2	17-11/16 × 62-1/2 × 27-9/16 (450 × 1,587 × 700)	
	96,000	108,000	ARUH96TLAV2	21-5/8 × 62-1/2 × 27-9/16 (550 × 1,587 × 700)	
Compact floor	4,000	4,400	AGUA4TLAV2	23-5/8 × 29-1/8 × 7-7/8 (600 × 740 × 200)	
	7,500	9,500	AGUA7TLAV2		
	9,500	10,900	AGUA9TLAV2		
	12,000	13,500	AGUA12TLAV2		
	14,000	15,600	AGUA14TLAV2		
Floor/Ceiling	12,000	13,500	ABUA12TLAV2	7-13/16 × 39 × 25-13/16 (199 × 990 × 655)	
	14,000	15,600	ABUA14TLAV2		
	18,000	20,000	ABUA18TLAV2		
	24,000	27,000	ABUA24TLAV2		
Ceiling	30,000	34,000	ABUA30TLAV2	9-7/16 × 65-3/8 × 27-9/16 (240 × 1,660 × 700)	
	36,000	40,000	ABUA36TLAV2		



Type	Rated capacity (Btu/h)		Model name	Dimensions	Remarks
	Cooling	Heating		H × W × D	
Wall mounted	4,000	4,400	ASUA4TLAV2	10-9/16 × 33-1/16 × 8 (268 × 840 × 203)	
	7,500	9,500	ASUA7TLAV2		
	9,500	10,900	ASUA9TLAV2		
	12,000	13,500	ASUA12TLAV2		
	14,000	15,600	ASUA14TLAV2		
	18,000	20,000	ASUB18TLAV1	12-5/8 × 39-5/16 × 9-3/8 (320 × 998 × 238)	
	24,000	27,000	ASUB24TLAV1		
	30,000	34,000	ASUA30TLAV2	13-3/8 × 45-1/4 × 11 (340 × 1,150 × 280)	
	34,000	38,000	ASUA36TLAV2		
	7,500	9,500	ASUA7TLAV	10-13/16 × 31-1/8 × 8-7/16 (275 × 790 × 215)	
	9,500	10,900	ASUA9TLAV		
	12,000	13,500	ASUA12TLAV		
	14,000	15,600	ASUA14TLAV		
	18,000	20,000	ASUB18TLAV	12-5/8 × 39-5/16 × 9 (320 × 998 × 228)	
	24,000	27,000	ASUB24TLAV		

## 2. Specifications

### 2-1. Compact cassette type

Model name				AUUA4TLAV2		AUUA7TLAV2		AUUA9TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz					
Available voltage range				187—253 V					
Capacity			Cooling	Btu/h	4,000	7,500	9,500		
				kW	1.2	2.2	2.8		
			Heating	Btu/h	4,400	9,500	10,900		
				kW	1.3	2.8	3.2		
Input power				W	23	25			
Fan	Airflow rate	HIGH	CFM (m³/h)	312 (530)	318 (540)	324 (550)			
		MED—HIGH		288/283*¹ (490/480*¹)	295 (500)	306 (520)			
		MED		265/253*¹ (450/430*¹)	271 (460)	283 (480)			
		MED—LOW		247/224*¹ (420/380*¹)	247 (420)	259 (440)			
		LOW		230/200*¹ (390/340*¹)	230 (390)	236 (400)			
		QUIET		206/177*¹ (350/300*¹)	206 (350)	206 (350)			
	Type × Q'ty		Turbo × 1						
	Motor output			W	54				
Sound pressure level*²		HIGH	dB (A)	34	34	35			
		MED—HIGH		32/31*¹	32	33			
		MED		30/29*¹	30	31			
		MED—LOW		28/26*¹	28	29			
		LOW		27/24*¹	27	27			
		QUIET		25/21*¹	25	25			
Heat exchanger type	Length		in (mm)	50-3/8 (1,280)					
	Fin pitch		FPI	21					
	Rows × Stages			2 × 10					
	Face area		ft² (m²)	2.9 (0.27)					
	Pipe type (Material)			Grooved H-pin (Copper)					
	Fin	Type (Material)		Slit (Aluminum)					
Surface treatment		Hydrophilic coating							
Air filter	Type		Anti-mold						
	Net material		PP honeycomb						
Enclosure	Material		Galvanized sheet iron						
	Color		—						
Dimensions (H × W × D)	Net		in (mm)	9-5/8 × 22-7/16 × 22-7/16 (245 × 570 × 570)					
	Gross			10-7/16 × 28-3/4 × 24-5/8 (265 × 730 × 625)					
Weight	Net		lb (kg)	32 (14.5)	33 (15)				
	Gross			40 (18)					
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 1/4 (6.35)					
	Gas (Flare)			Ø 3/8 (9.52)					
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)					
Cassette grille (Grid type: Option)	Model name			UTG-CCGVG					
	Color			White					
	Dimensions (H × W × D)	Net	in (mm)	Approximate color of Munsell 9PB 9.1/0.2					
		Gross		1-15/16 × 24-7/16 × 24-7/16 (50 × 620 × 620)					
	Weight	Net	lb (kg)	4-3/4 × 30-1/8 × 29-3/4 (120 × 765 × 755)					
		Gross		5 (2.3)					
				10 (4.5)					
NOTES:									
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*1: This value is "Cooling operation/Heating operation".</li><li>*2: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>									

Model name				AUUA12TLAV2	AUUA14TLAV2	AUUA18TLAV2	AUUA24TLAV2
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	12,000	14,000	18,000	24,000
			kW	3.5	4.1	5.3	7.0
		Heating	Btu/h	13,500	15,600	20,000	27,000
			kW	4.0	4.6	5.9	7.9
Input power			W	29	35	36	84
Fan	Airflow rate	HIGH	CFM (m³/h)	353 (600)	401 (680)	418 (710)	607 (1,030)
		MED—HIGH		330 (560)	365 (620)	389 (660)	536 (910)
		MED		306 (520)	330 (560)	348 (590)	465 (790)
		MED—LOW		283 (480)	295 (500)	306 (520)	401 (680)
		LOW		253 (430)	259 (440)	271 (460)	330 (560)
		QUIET		230 (390)	230 (390)	236 (400)	265 (450)
	Type × Q'ty			Turbo × 1			
	Motor output		W	54			
Sound pressure level*		HIGH	dB (A)	37	38	41	50
		MED—HIGH		34	37	39	46
		MED		33	34	36	43
		MED—LOW		31	32	33	39
		LOW		29	30	30	35
		QUIET		27	27	27	30
Heat exchanger type	Length	in (mm)	50-3/8 (1,280)		51-9/16 (1,310)		
	Fin pitch	FPI	21		19		
	Rows × Stages		2 × 10		3 × 10		
	Face area	ft² (m²)	2.9 (0.27)		3.0 (0.28)		
	Pipe type (Material)		Grooved H-pin (Copper)				
	Fin	Type (Material)	Slit (Aluminum)				
		Surface treatment	Hydrophilic coating				
Air filter	Type	Anti-mold					
	Net material	PP honeycomb					
Enclosure	Material	Galvanized sheet iron					
	Color	—					
Dimensions (H × W × D)	Net	in (mm)	9-5/8 × 22-7/16 × 22-7/16 (245 × 570 × 570)				
	Gross		10-7/16 × 28-3/4 × 24-5/8 (265 × 730 × 625)				
Weight	Net	lb (kg)	33 (15)		37 (17)		
	Gross		42 (19)		44 (20)		
Connection pipe diameter	Liquid (Flare)	in (mm)	Ø 1/4 (6.35)				Ø 3/8 (9.52)
	Gas (Flare)		Ø 1/2 (12.70)				Ø 5/8 (15.88)
	Drain hose		VP25 I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)				
Cassette grille (Grid type: Option)	Model name		UTG-CCGVG				
	Color		White Approximate color of Munsell 9PB 9.1/0.2				
	Dimensions (H × W × D)	Net	in (mm)	1-15/16 × 24-7/16 × 24-7/16 (50 × 620 × 620)			
		Gross		4-3/4 × 30-1/8 × 29-3/4 (120 × 765 × 755)			
	Weight	Net	lb (kg)	5 (2.3)			
		Gross		10 (4.5)			

**NOTES:**

- Specifications are based on the following conditions:
  - Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).
  - Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).
  - Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- \*: Sound pressure level:
  - Measured values in manufacturer's anechoic chamber.
  - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

## 2-2. 4-way flow cassette type

Model name				AUUB18TLAV		AUUB24TLAV	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	18,000	24,000		
			kW	5.3	7.0		
		Heating	Btu/h	20,000	27,000		
			kW	5.9	7.9		
Input power			W	39	46		
Fan	Airflow rate	HIGH	CFM (m³/h)	677 (1,150)	753 (1,280)		
		MED		553 (940)	612 (1,040)		
		LOW		512 (870)	512 (870)		
	Type × Q'ty		Turbo × 1				
Motor output			W	80			
Sound pressure level*		HIGH	dB (A)	36	38		
		MED		30	33		
		LOW		29	29		
Heat exchanger type	Length		in (mm)	81-15/16 (2,082)			
	Fin pitch		FPI	21			
	Rows × Stages			2 × 10			
	Face area		ft² (m²)	4.5 (0.42)			
	Pipe type (Material)			Grooved H-pin (Copper)			
	Fin	Type (Material)		Slit (Aluminum)			
		Surface treatment		Hydrophilic coating			
Air filter	Type		Anti-mold				
	Net material		PP honeycomb				
Enclosure	Material		Galvanized sheet iron				
	Color		—				
Dimensions (H × W × D)	Net		in (mm)	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)			
	Gross			12-1/2 × 37-13/16 × 38-9/16 (318 × 960 × 980)			
Weight	Net		lb (kg)	49 (22)			
	Gross			60 (27)			
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 3/8 (9.52)			
	Gas (Flare)			Ø 5/8 (15.88)			
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)			
Cassette grille (Option)	Model name			UTG-LCGV			
	Color			WhiteApproximate color of Munsell N9.25/			
	Dimensions (H × W × D)	Net	in (mm)	1-15/16 × 37-3/8 × 37-3/8 (50 × 950 × 950)			
		Gross		4-1/2 × 40-3/16 × 39-3/8 (115 × 1,020 × 1,000)			
	Weight	Net	lb (kg)	13 (5.5)			
Gross		19 (8.5)					

**NOTES:**

- Specifications are based on the following conditions:
  - Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).
  - Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).
  - Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- \*: Sound pressure level:
  - Measured values in manufacturer's anechoic chamber.
  - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

Model name				AUUB30TLAV		AUUB36TLAV	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling		Btu/h	30,000	36,000	
				kW	8.8	10.6	
		Heating		Btu/h	34,000	40,000	
				kW	10.0	11.7	
Input power				W	59	80	
Fan	Airflow rate	HIGH	CFM (m³/h)	942 (1,600)	1,059 (1,800)		
		MED		765 (1,300)	765 (1,300)		
		LOW		647 (1,100)	647 (1,100)		
	Type × Q'ty				Turbo × 1		
Motor output		W		80			
Sound pressure level*		HIGH	dB (A)	40	44		
		MED		38	38		
		LOW		33	33		
Heat exchanger type		Length	in (mm)	81-15/16 (2,082)			
		Fin pitch	FPI	19			
		Rows × Stages		3 × 12			
		Face area	ft² (m²)	5.6 (0.52)			
		Pipe type (Material)		Grooved H-pin (Copper)			
		Fin	Type (Material)	Slit (Aluminum)			
			Surface treatment	Hydrophilic coating			
Air filter		Type	Anti-mold				
		Net material	PP honeycomb				
Enclosure		Material	Galvanized sheet iron				
		Color	—				
Dimensions (H × W × D)		Net	Main body	in (mm)	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)		
		Gross			14-3/16 × 37-13/16 × 38-9/16 (360 × 960 × 980)		
Weight		Net		lb (kg)	60 (27)		
		Gross			73 (33)		
Connection pipe diameter		Liquid (Flare)		in (mm)	Ø 3/8 (9.52)		
		Gas (Flare)			Ø 5/8 (15.88) Ø 3/4 (19.05)		
		Drain hose			VP25		
		I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)					
Cassette grille (Option)		Model name		UTG-LCGV			
		Color		WhiteApproximate color of Munsell N9.25/			
		Dimensions (H × W × D)	Net	in (mm)	1-15/16 × 37-3/8 × 37-3/8 (50 × 950 × 950)		
			Gross		4-1/2 × 40-3/16 × 39-3/8 (115 × 1,020 × 1,000)		
		Weight	Net	lb (kg)	13 (5.5)		
			Gross		19 (8.5)		
<b>NOTES:</b> <ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

## 2-3. Circular flow cassette type

Model name				AUUB18TLAV2		AUUB24TLAV2		AUUB30TLAV2			
Power supply				1 phase ~ 208/230 V 60 Hz							
Available voltage range				187—253 V							
Capacity		Cooling	Btu/h		18,000		24,000		30,000		
			kW		5.3		7.0		8.8		
		Heating	Btu/h		20,000		27,000		34,000		
			kW		5.9		7.9		10.0		
Input power				W		20		25		49	
Fan	Airflow rate	HIGH		CFM (m³/h)	618 (1,050)		660 (1,120)		866 (1,470)		
		MED—HIGH			548 (930)		618 (1,050)		683 (1,160)		
		MED			530 (900)		548 (930)		630 (1,070)		
		MED—LOW			512 (870)		530 (900)		548 (930)		
		LOW			477 (810)		512 (870)		530 (900)		
		QUIET			459 (780)		459 (780)		459 (780)		
	Type × Q'ty		Turbo × 1								
	Motor output		W		81						
Sound pressure level*		HIGH		dB (A)	33		35		40		
		MED—HIGH			32		33		36		
		MED			31		32		34		
		MED—LOW			30		31		32		
		LOW			29		30		31		
		QUIET			28		28		28		
Heat exchanger type		Length		in (mm)		87-7/16 (2,094)					
		Fin pitch		FPI		21					
		Rows × Stages		2 × 10							
		Face area		ft² (m²)		4.7 (0.44)					
		Pipe type (Material)		Grooved H-pin (Copper)							
		Fin		Type (Material)		Slit (Aluminum)					
Air filter		Type		Hydrophilic coating							
		Net material		Anti-mold							
Enclosure		Material		PP honeycomb							
		Color		Galvanized sheet iron							
Dimensions (H × W × D)		Net		in (mm)		9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)					
		Gross		11-3/4 × 37-13/16 × 37-3/8 (298 × 960 × 950)							
Weight		Net		lb (kg)		53 (24)		54 (24.5)			
		Gross		lb (kg)		64 (29)		65 (29.5)			
Connection pipe diameter		Liquid (Flare)		in (mm)		Ø 1/4 (6.35)		Ø 3/8 (9.52)			
		Gas (Flare)				Ø 1/2 (12.70)		Ø 5/8 (15.88)			
		Drain hose				I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)					
Cassette grille (Option)		Color		in (mm)		UTG-LCGVCW					
						White					
						Approximate color of Munsell N9.25/					
		Dimensions (H × W × D)		in (mm)		UTG-LCGVCB:					
						Black					
						Approximate color of Munsell N2/					
Weight		lb (kg)		2-1/16 × 37-3/8 × 37-3/8 (53 × 950 × 950)		4-5/16 × 39-3/8 × 39-3/4 (110 × 1,000 × 1,010)					
				13 (6.0)		22 (10)					
NOTES:											
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>											

Model name				AUUB36TLAV2		AUUB48TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	36,000	48,000		
			kW	10.6	14.1		
		Heating	Btu/h	40,000	54,000		
			kW	11.7	15.8		
Input power			W	61	116		
Fan	Airflow rate	HIGH	CFM (m³/h)	954 (1,620)	1,202 (2,040)		
		MED—HIGH		884 (1,500)	1,060 (1,800)		
		MED		825 (1,400)	937 (1,590)		
		MED—LOW		789 (1,340)	848 (1,440)		
		LOW		754 (1,280)	766 (1,300)		
		QUIET		677 (1,150)	677 (1,150)		
	Type × Q'ty		Turbo × 1				
	Motor output		W	81			
Sound pressure level*		HIGH	dB (A)	41	47		
		MED—HIGH		40	45		
		MED		38	42		
		MED—LOW		37	39		
		LOW		35	36		
		QUIET		33	33		
Heat exchanger type		Length	in (mm)	81-1/4 (2,064)			
		Fin pitch	FPI	19			
		Rows × Stages	3 × 12				
		Face area	ft² (m²)	5.6 (0.52)			
		Pipe type (Material)		Grooved H-pin (Copper)			
		Fin	Type (Material)	Slit (Aluminum)			
		Surface treatment	Hydrophilic coating				
Air filter		Type	Anti-mold				
		Net material	PP honeycomb				
Enclosure		Material	Galvanized sheet iron				
		Color	—				
Dimensions (H × W × D)		Net	in (mm)	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)			
		Gross		13-3/8 × 37-13/16 × 37-3/8 (340 × 960 × 950)			
Weight		Net	lb (kg)	65 (29.5)			
		Gross		75 (34)			
Connection pipe diameter		Liquid (Flare)	in (mm)	Ø 3/8 (9.52)			
		Gas (Flare)		Ø 5/8 (15.88)			
		Drain hose		VP25 I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)			
Cassette grille (Option)		Color		UTG-LCGVCW White Approximate color of Munsell N9.25/			
				UTG-LCGVCB: Black Approximate color of Munsell N2/			
		Dimensions (H × W × D)		Net	in (mm)	2-1/16 × 37-3/8 × 37-3/8 (53 × 950 × 950)	
						4-5/16 × 39-3/8 × 39-3/4 (110 × 1,000 × 1,010)	
		Weight		Net	lb (kg)	13 (6.0)	
22 (10)							
<b>NOTES:</b> <ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

## 2-4. Mini duct type

Model name				ARUL4TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz	
Available voltage range				187—253 V	
Capacity	Cooling	Btu/h		4,000	
		kW		1.2	
	Heating	Btu/h		4,400	
		kW		1.3	
Input power			W	26	
Static pressure range			inWG (Pa)	0 to 0.12 (0 to 30)	
Standard static pressure			inWG (Pa)	0.04 (10)	
Fan	Airflow rate	HIGH	CFM (m³/h)	271 (460)	
		MED—HIGH		259 (440)	
		MED		247 (420)	
		MED—LOW		235 (400)	
		LOW		218 (370)	
		QUIET		200 (340)	
	Type × Q'ty		Sirocco × 2		
	Motor output		W	80	
Sound pressure level*	HIGH	dB (A)	25		
	MED—HIGH		24		
	MED		23		
	MED—LOW		22		
	LOW		21		
	QUIET		20		
Heat exchanger type	Length		in (mm)	19-5/16 (490)	
	Fin pitch		FPI	19	
	Rows × Stages		1 × 16		
	Face area		ft² (m²)	1.7 (0.16)	
	Pipe type (Material)			Grooved H-pin (Copper)	
	Fin	Type (Material)	Slit (Aluminum)		
		Surface treatment		Hydrophilic coating	
Air filter	Type		Fungicide type		
	Net material		PP honeycomb		
Enclosure	Material		Galvanized sheet iron		
	Color		—		
Dimensions (H × W × D)	Net		in (mm)	7-13/16 × 27-9/16 × 17-11/16 (198 × 700 × 450)	
	Gross			9-13/16 × 36-5/8 × 22-13/16 (250 × 930 × 580)	
Weight	Net		lb (kg)	32 (14.5)	
	Gross			40 (18)	
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 1/4 (6.35)	
	Gas (Flare)			Ø 3/8 (9.52)	
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)	
<b>NOTES:</b> <ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>					



## 2-5. Slim duct/Slim concealed floor type

Model name				ARUL7TLAV2	ARUL9TLAV2	ARUL12TLAV2	ARUL14TLAV2
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity	Cooling	Btu/h	7,500	9,500	12,000	14,000	
		kW	2.2	2.8	3.5	4.1	
	Heating	Btu/h	9,500	10,900	13,500	15,600	
		kW	2.8	3.2	4.0	4.6	
Input power		W	44	50	54	92	
Static pressure range		inWG (Pa)	0 to 0.36 (0 to 90)				
Standard static pressure		inWG (Pa)	0.10 (25)				
Fan	Airflow rate	HIGH	CFM (m³/h)	324 (550)	353 (600)	353 (600)	471 (800)
		MED—HIGH		283 (480)	300 (510)	312 (530)	401 (680)
		MED		259 (440)	271 (460)	289 (490)	353 (600)
		MED—LOW		241 (410)	247 (420)	265 (450)	306 (520)
		LOW		218 (370)	218 (370)	241 (410)	259 (440)
		QUIET		188 (320)	188 (320)	200 (340)	200 (340)
	Type × Q'ty		Sirocco × 2				
	Motor output		W	80		81	
Sound pressure level*	HIGH	dB (A)	28	29	30	34	
	MED—HIGH		26	27	28	32	
	MED		25	25	27	30	
	MED—LOW		24	24	26	28	
	LOW		22	22	24	25	
	QUIET		21	21	22	22	
Heat exchanger type	Length		in (mm)		19-11/16 (500)		
	Fin pitch		FPI		19		
	Rows × Stages				2 × 14		3 × 14
	Face area		ft² (m²)		1.6 (0.14)		
	Pipe type (Material)			Grooved H-pin (Copper)			
	Fin	Type (Material)	Slit (Aluminum)				
Air filter	Type		Hydrophilic coating				
	Net material		Fungicide type				
			PP honeycomb				
Enclosure	Material		Galvanized sheet iron				
	Color		—				
Dimensions (H × W × D)	Net		in (mm)	7-13/16 × 27-9/16 × 24-7/16 (198 × 700 × 620)			
	Gross			10-7/8 × 38-1/8 × 30-3/8 (276 × 968 × 772)			
Weight	Net		lb (kg)	37 (17)		40 (18)	
	Gross			46 (21)		51 (23)	
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 1/4 (6.35)			
	Gas (Flare)			Ø 3/8 (9.52)		Ø 1/2 (12.70)	
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)			
<b>NOTES:</b> <ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

Model name				ARUL18TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz	
Available voltage range				187—253 V	
Capacity	Cooling	Btu/h		18,000	
		kW		5.3	
	Heating	Btu/h		20,000	
		kW		5.9	
Input power				W	
Static pressure range				inWG (Pa)	
Standard static pressure				inWG (Pa)	
Fan	Airflow rate	HIGH		554 (940)	
		MED—HIGH		483 (820)	
		MED		430 (730)	
		MED—LOW		371 (630)	
		LOW		318 (540)	
		QUIET		277 (470)	
	Type × Q'ty		Sirocco × 3		
	Motor output		W		
Sound pressure level*		HIGH		34	
		MED—HIGH		31	
		MED		29	
		MED—LOW		27	
		LOW		25	
		QUIET		23	
Heat exchanger type	Length		in (mm)		
	Fin pitch		FPI		
	Rows × Stages		3 × 14		
	Face area		ft² (m²)		
	Pipe type (Material)		Grooved H-pin (Copper)		
	Fin		Type (Material)		
Air filter	Type		Fungicide type		
	Net material		PP honeycomb		
Enclosure	Material		Galvanized sheet iron		
	Color		—		
Dimensions (H × W × D)	Net		in (mm)		
	Gross		10-7/8 × 46 × 30-3/8 (276 × 1,168 × 772)		
Weight	Net		lb (kg)		
	Gross		60 (27)		
Connection pipe diameter	Liquid (Flare)		Ø 1/4 (6.35)		
	Gas (Flare)		Ø 1/2 (12.70)		
	Drain hose		VP25 I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)		
NOTES:					
<div><div>• Specifications are based on the following conditions:</div><div><div>— Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</div><div>— Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</div><div>— Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</div></div><div>• Protective function might work when using it outside the operation range.</div><div>• *: Sound pressure level:<div><div>— Measured values in manufacturer's anechoic chamber.</div><div>— Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</div></div></div></div>					

## 2-6. Medium static pressure duct type

Model name				ARUM24TLAV2	ARUM30TLAV2	ARUM36TLAV2
Power supply				1 phase ~ 208/230 V 60 Hz		
Available voltage range				187—253 V		
Capacity	Cooling	Btu/h	24,000	30,000	36,000	
		kW	7.0	8.8	10.6	
	Heating	Btu/h	27,000	34,000	40,000	
		kW	7.9	10.0	11.7	
Input power		W	125	190	222	
Static pressure range		inWG (Pa)	0 to 0.60 (0 to 150)			
Standard static pressure		inWG (Pa)	0.16 (40)			
Fan	Airflow rate	HIGH	CFM (m³/h)	860 (1,460)	1,043 (1,770)	1,113 (1,890)
		MED—HIGH		807 (1,370)	948 (1,610)	1,031 (1,750)
		MED		760 (1,290)	860 (1,460)	954 (1,620)
		MED—LOW		701 (1,190)	772 (1,310)	854 (1,450)
		LOW		648 (1,100)	683 (1,160)	766 (1,300)
		QUIET		589 (1,000)	589 (1,000)	677 (1,150)
	Type × Q'ty		Sirocco × 2			
Motor output		W	197			
Sound pressure level*		HIGH	dB (A)	36	40	41
		MED—HIGH		34	37	39
		MED		32	34	37
		MED—LOW		30	32	34
		LOW		29	30	31
		QUIET		28	28	29
Heat exchanger type	Length		in (mm)	39-3/8 (1,000)		
	Fin pitch		FPI	18		
	Rows × Stages			4 × 14		
	Face area		ft² (m²)	3.1 (0.29)		
	Pipe type (Material)			Grooved H-pin (Copper)		
	Fin	Type (Material)	Surface treatment	Slit (Aluminum) Hydrophilic coating		
Air filter (Option)	Model name		UTD-LF25NA			
	Type		Fungicide type			
	Net material		PP honeycomb			
Enclosure	Material			Galvanized sheet iron		
	Color			—		
Dimensions (H × W × D)	Net		in (mm)	10-5/16 × 44-11/16 × 27-9/16 (270 × 1,135 × 700)		
	Gross			11-13/16 × 51-15/16 × 31-1/8 (300 × 1,320 × 790)		
Weight	Net		lb (kg)	86 (39)		
	Gross			104 (47)		
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 3/8 (9.52)		
	Gas (Flare)			Ø 5/8 (15.88)		
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)		
<b>NOTES:</b>						
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>						

## 2-7. High static pressure duct type

Model name				ARUH36TLAV	ARUH48TLAV	ARUH60TLAV
Power supply				1 phase ~ 208/230 V 60 Hz		
Available voltage range				187—253 V		
Capacity	Cooling		Btu/h	36,000	48,000	60,000
			kW	10.6	14.1	17.6
	Heating		Btu/h	40,000	54,000	67,000
			kW	11.7	15.8	19.6
Input power			W	496	752	806
Static pressure range			inWG (Pa)	0.40 to 0.80 (100 to 200)		
Standard static pressure			inWG (Pa)	0.40 (100)		
Fan	Airflow rate	HIGH	CFM (m³/h)	1,324 (2,250)	1,766 (3,000)	1,972 (3,350)
		MED		1,030 (1,750)	1,589 (2,700)	1,678 (2,850)
		LOW		824 (1,400)	1,354 (2,300)	1,501 (2,550)
	Type × Q'ty			Sirocco × 2		
Motor output			W	247	424	482
Sound pressure level*		HIGH	dB (A)	43	47	48
		MED		37	43	44
		LOW		32	40	41
Heat exchanger type	Length		in (mm)	35-1/16 (890)		
	Fin pitch		FPI	19	17	
	Rows × Stages			4 × 16		
	Face area		ft² (m²)	3.2 (0.30)		
	Pipe type (Material)			Grooved H-pin (Copper)		
	Fin	Type (Material)	Surface treatment	Slit (Aluminum)		
Air filter (Option)				Hydrophilic coating		
	Model name			UTD-LF25NA		
	Type			Fungicide type		
Enclosure	Net material			PP honeycomb		
	Material			Galvanized sheet iron		
	Color			—		
	Dimensions (H × W × D)	Net	in (mm)	15-3/4 × 41-5/16 × 19-11/16 (400 × 1,050 × 500)		
Gross		18-1/8 × 48-7/16 × 25-3/16 (460 × 1,230 × 640)				
Weight	Net	lb (kg)	97 (44)	101 (46)		
	Gross		108 (49)	112 (51)		
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 3/8 (9.52)		
	Gas (Flare)			Ø 3/4 (19.05)		
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)		
<b>NOTES:</b>						
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*1: This value is "Cooling operation/Heating operation".</li><li>*2: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>						

Model name				ARUH72TLAV2		ARUH96TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling		Btu/h	72,000	96,000	
				kW	21.1	28.1	
		Heating		Btu/h	81,000	108,000	
				kW	23.7	31.7	
Input power				W	618	838	
Static pressure range				inWG (Pa)	0 to 1.2 (0 to 300)		
Standard static pressure				inWG (Pa)	0.60 (150)		
Fan	Airflow rate		HIGH	CFM (m³/h)	2,297 (3,900)	2,857 (4,850)	
			MED		1,944 (3,300)	2,503 (4,250)	
			LOW		1,767 (3,000)	2,120 (3,600)	
	Type × Q'ty				Sirocco × 2		
Motor output			W	700 × 2			
Sound pressure level*			HIGH	dB (A)	47	48	
			MED		43	45	
			LOW		40	42	
Heat exchanger type		Length		in (mm)	49-3/16 (1,250)		
		Fin pitch		FPI	17	16	
		Rows × Stages			4 × 18	4 × 20	
		Face area		ft² (m²)	5.0 (0.47)	6.9 (0.64)	
		Pipe type (Material)			Grooved H-pin (Copper)		
		Fin	Type (Material)	Slit (Aluminum)		Louver (Aluminum)	
			Surface treatment	Hydrophilic coating			
Air filter (Option)		Model name		—			
		Type		—			
		Net material		—			
Enclosure		Material		Galvanized sheet iron			
		Color		—			
Dimensions (H × W × D)		Net		in (mm)	17-11/16 × 62-1/2 × 27-9/16 (450 × 1,587 × 700)	21-5/8 × 62-1/2 × 27-9/16 (550 × 1,587 × 700)	
		Gross			20-1/2 × 68-7/8 × 32-1/2 (520 × 1,750 × 825)	24-7/16 × 68-7/8 × 32-1/2 (620 × 1,750 × 825)	
Weight		Net		lb (kg)	203 (92)	231 (105)	
		Gross			238 (108)	276 (125)	
Connection pipe		Size	Liquid	in (mm)	Ø 3/8 (9.52)		
			Gas		Ø 3/4 (19.05)	Ø 7/8 (22.22)	
		Connection method			Flare	Brazing	
Drain hose		Size		in (mm)	I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)		
NOTES:							
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*1: This value is "Cooling operation/Heating operation".</li><li>*2: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

## 2-8. Compact floor type

Model name				AGUA4TLAV2	AGUA7TLAV2	AGUA9TLAV2
Power supply				1 phase ~ 208/230 V 60 Hz		
Available voltage range				187—253 V		
Capacity		Cooling	Btu/h	4,000	7,500	9,500
			kW	1.2	2.2	2.8
		Heating	Btu/h	4,400	9,500	10,900
			kW	1.3	2.8	3.2
Input power			W	12/14*1	16	17
Fan	Airflow rate	HIGH	CFM (m³/h)	224/253*1 (380/430*1)	277 (470)	294 (500)
		MED—HIGH		206 (350)	247 (420)	265 (450)
		MED		188 (320)	230 (390)	235 (400)
		MED—LOW		182 (310)	212 (360)	212 (360)
		LOW		165 (280)	194 (330)	194 (330)
		QUIET		124 (210)	159 (270)	159 (270)
	Type × Q'ty	Crossflow × 2				
	Motor output		W	16 × 2		
Sound pressure level*2		HIGH	dB (A)	35/36*1	37	38
		MED—HIGH		33	35	36
		MED		31	33	34
		MED—LOW		30	31	31
		LOW		28	29	29
		QUIET		22	22	22
Heat exchanger type	Length		in (mm)	21-5/8 (550)		
	Fin pitch		FPI	21		
	Rows × Stages			2 × 18		
	Face area		ft² (m²)	2.3 (0.21)		
	Pipe type (Material)			Grooved H-pin (Copper)		
	Fin	Type (Material)		Slit (Aluminum)		
		Surface treatment		Hydrophilic coating		
Air filter	Type			Anti-mold		
	Net material			PP plain weave		
Enclosure	Material			Plastic		
	Color			White		
				Approximate color of Munsell 5Y 9/0.5NN		
Dimensions (H × W × D)	Net	in (mm)		23-5/8 × 29-1/8 × 7-7/8 (600 × 740 × 200)		
	Gross			27-9/16 × 32-5/16 × 12-3/16 (700 × 820 × 310)		
Weight	Net	lb (kg)		33 (15)		
	Gross			41 (18.5)	42 (19)	
Connection pipe diameter	Liquid (Flare)	in (mm)		Ø 1/4 (6.35)		
	Gas (Flare)			Ø 3/8 (9.52)		
	Drain hose			I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)		

**NOTES:**

- Specifications are based on the following conditions:
  - Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).
  - Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).
  - Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- \*1: This value is "Cooling operation/Heating operation".
- \*2: Sound pressure level:
  - Measured values in manufacturer's anechoic chamber.
  - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.

Model name				AGUA12TLAV2		AGUA14TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	12,000	14,000		
			kW	3.5	4.1		
		Heating	Btu/h	13,500	15,600		
			kW	4.0	4.6		
Input power			W	22	29		
Fan	Airflow rate	HIGH	CFM (m³/h)	347 (590)	394 (670)		
		MED—HIGH		306 (520)	347 (590)		
		MED		277 (470)	306 (520)		
		MED—LOW		247 (420)	265 (450)		
		LOW		230 (390)	230 (390)		
		QUIET		200 (340)	200 (340)		
	Type × Q'ty		Crossflow × 2				
	Motor output		W	16 × 2			
Sound pressure level*		HIGH	dB (A)	42	46		
		MED—HIGH		39	42		
		MED		37	39		
		MED—LOW		35	36		
		LOW		33	33		
		QUIET		30	30		
Heat exchanger type	Length		in (mm)	21-5/8 (550)			
	Fin pitch		FPI	21			
	Rows × Stages			2 × 18			
	Face area		ft² (m²)	2.3 (0.21)			
	Pipe type (Material)			Grooved H-pin (Copper)			
	Fin	Type (Material)		Slit (Aluminum)			
		Surface treatment		Hydrophilic coating			
Air filter	Type		Anti-mold				
	Net material		PP plain weave				
Enclosure	Material		Plastic				
	Color		White				
	Approximate color of Munsell 5Y 9/0.5NN						
Dimensions (H × W × D)	Net		in (mm)	23-5/8 × 29-1/8 × 7-7/8 (600 × 740 × 200)			
	Gross			27-9/16 × 32-5/16 × 12-3/16 (700 × 820 × 310)			
Weight	Net		lb (kg)	33 (15)			
	Gross			42 (19)			
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 1/4 (6.35)			
	Gas (Flare)			Ø 1/2 (12.70)			
	Drain hose			I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)			
<b>NOTES:</b>							
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

## 2-9. Floor/Ceiling type

Model name				ABUA12TLAV2	ABUA14TLAV2	ABUA18TLAV2	ABUA24TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz				
Available voltage range				187—253 V				
Capacity		Cooling	Btu/h	12,000	14,000	18,000	24,000	
			kW	3.5	4.1	5.3	7.0	
		Heating	Btu/h	13,500	15,600	20,000	27,000	
			kW	4.0	4.6	5.9	7.9	
Input power			W	30	42	74	99	
Fan	Airflow rate	HIGH	CFM (m³/h)	389 (660)	459 (780)	589 (1,000)	589 (1,000)	
		MED—HIGH		365 (620)	436 (740)	536 (910)	548 (930)	
		MED		342 (580)	406 (690)	489 (830)	512 (870)	
		MED—LOW		324 (550)	377 (640)	442 (750)	471 (800)	
		LOW		306 (520)	353 (600)	389 (660)	436 (740)	
		QUIET		289 (490)	324 (550)	342 (580)	401 (680)	
	Type × Q'ty		Sirocco × 2					
	Motor output		W	80				
Sound pressure level*		HIGH	dB (A)	36	40	46	47	
		MED—HIGH		34	39	44	45	
		MED		33	38	42	43	
		MED—LOW		31	36	40	41	
		LOW		29	35	37	39	
		QUIET		28	34	35	37	
Heat exchanger type		Length	in (mm)	31-1/2 (800)				
		Fin pitch	FPI	21	19			
		Rows × Stages		2 × 12	3 × 12		4 × 12	
		Face area	ft² (m²)	2.3 (0.20)				
		Pipe type (Material)		Grooved H-pin (Copper)				
		Fin	Type (Material)	Slit (Aluminum)				
			Surface treatment	Hydrophilic coating				
Air filter		Type	Anti-mold					
		Net material	PP monofilament net					
Enclosure		Material	Plastic					
		Color	White					
		Approximate color of Munsell N9.25/						
Dimensions (H × W × D)		Net	in (mm)	7-13/16 × 39 × 25-13/16 (199 × 990 × 655)				
		Gross		12-5/8 × 45-1/4 × 31-1/8 (320 × 1,150 × 790)				
Weight		Net	lb (kg)	55 (25)	57 (26)		60 (27)	
		Gross		77 (35)	79 (36)		84 (38)	
Connection pipe diameter		Liquid (Flare)	in (mm)	Ø 1/4 (6.35)			Ø 3/8 (9.52)	
		Gas (Flare)		Ø 1/2 (12.70)			Ø 5/8 (15.88)	
		Drain hose		I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)				
NOTES:								
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>								



## 2-10. Ceiling type

Model name				ABUA30TLAV2		ABUA36TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	30,000	36,000		
			kW	8.8	10.6		
		Heating	Btu/h	34,000	40,000		
			kW	10.0	11.7		
Input power			W	66	85		
Fan	Airflow rate	HIGH	CFM (m <sup>3</sup> /h)	960 (1,630)	995 (1,690)		
		MED—HIGH		895 (1,520)	919 (1,560)		
		MED		836 (1,420)	854 (1,450)		
		MED—LOW		777 (1,320)	801 (1,360)		
		LOW		719 (1,220)	748 (1,270)		
		QUIET		671 (1,140)	689 (1,170)		
		Type × Q'ty		Sirocco × 4			
	Motor output		W	106			
Sound pressure level*		HIGH	dB (A)	42	45		
		MED—HIGH		40	41		
		MED		39	39		
		MED—LOW		37	38		
		LOW		35	36		
		QUIET		33	34		
Heat exchanger type	Length		in (mm)	53-1/8 (1,350)			
	Fin pitch		FPI	17			
	Rows × Stages			3 × 12	3 × 12 1 × 8		
	Face area		ft <sup>2</sup> (m <sup>2</sup> )	3.7 (0.34)			
	Pipe type (Material)			Grooved H-pin (Copper)			
	Fin	Type (Material)		Slit (Aluminum)			
		Surface treatment		Hydrophilic coating			
Air filter	Type			Anti-mold			
	Net material			PP monofilament net			
Enclosure	Material			Plastic			
	Color			WhiteApproximate color of Munsell N9.25/			
Dimensions (H × W × D)	Net		in (mm)	9-7/16 × 65-3/8 × 27-9/16 (240 × 1,660 × 700)			
	Gross			12-1/2 × 70-7/8 × 31-1/8 (318 × 1,800 × 790)			
Weight	Net		lb (kg)	101 (46)	106 (48)		
	Gross			130 (59)	134 (61)		
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 3/8 (9.52)			
	Gas (Flare)			Ø 5/8 (15.88)			
	Drain hose			I.D.: Ø 3/4 (19.05); O.D.: Ø 1-1/16 (26.6)			
NOTES:							
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

## 2-11. Wall mounted type

Model name				ASUA4TLAV2		ASUA7TLAV2		ASUA9TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz					
Available voltage range				187—253 V					
Capacity			Cooling	Btu/h	4,000	7,500	9,500		
				kW	1.2	2.2	2.8		
			Heating	Btu/h	4,400	9,500	10,900		
				kW	1.3	2.8	3.2		
Input power				W	13	19	34		
Fan	Airflow rate	HIGH	CFM (m³/h)	265 (450)	324 (550)	359 (610)			
		MED—HIGH		253 (430)	300 (510)	330 (560)			
		MED		235 (400)	277 (470)	300 (510)			
		MED—LOW		224 (380)	241 (410)	259 (440)			
		LOW		212 (360)					
		QUIET		182 (310)					
	Type × Q'ty	Crossflow × 1							
	Motor output			W	30				
Sound pressure level*			HIGH	dB (A)	31	34	37		
			MED—HIGH		30	32	35		
			MED		28	30	32		
			MED—LOW		27	28	29		
			LOW		26	26	26		
			QUIET		22	22	22		
Heat exchanger type		Length	in (mm)	24-13/16 (630)					
		Fin pitch	FPI	23					
		Rows × Stages		2 × 20	Main: 2 × 20 Sub: 1 × 4				
		Face area	ft² (m²)	2.2 (0.20)					
		Pipe type (Material)			Grooved H-pin (Copper)				
		Fin	Type (Material) Surface treatment	Slit (Aluminum) Hydrophilic coating					
Air filter		Type	Anti-mold						
		Net material	PP honeycomb						
Enclosure		Material	Plastic						
		Color	White Approximate color of Munsell N9.25/						
Dimensions (H × W × D)		Net	in (mm)	10-9/16 × 33-1/16 × 8 (268 × 840 × 203)					
		Gross		10-10/16 × 34-13/16 × 13-4/16 (270 × 884 × 336)					
Weight		Net	lb (kg)	19 (8.5)	20 (9.0)				
		Gross		23 (10.5)	24 (11)				
Connection pipe diameter		Liquid (Flare)	in (mm)	Ø 1/4 (6.35)					
		Gas (Flare)		Ø 3/8 (9.52)					
		Drain hose		I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)					
<b>NOTES:</b> <ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>									

Model name				ASUA12TLAV2		ASUA14TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	12,000	14,000		
			kW	3.5	4.2		
		Heating	Btu/h	13,500	15,600		
			kW	4.0	4.6		
Input power			W	25	36		
Fan	Airflow rate	HIGH	CFM (m³/h)	406 (690)	471 (800)		
		MED—HIGH		359 (610)	436 (740)		
		MED		330 (560)	400 (680)		
		MED—LOW		312 (530)	359 (610)		
		LOW		277 (470)	324 (550)		
		QUIET		194 (330)	194 (330)		
	Type × Q'ty		Crossflow × 1				
	Motor output		W	30			
Sound pressure level*		HIGH	dB (A)	40	44		
		MED—HIGH		37	42		
		MED		35	40		
		MED—LOW		33	37		
		LOW		30	34		
		QUIET		24	24		
Heat exchanger type		Length	in (mm)	Main: 24-13/16 (630) Sub: 24-13/16 (630)			
		Fin pitch	FPI	Main: 23 Sub: 18			
		Rows × Stages		Main: 2 × 20 Sub: 1 × 4			
		Face area	ft² (m²)	2.2 (0.20)			
		Pipe type (Material)		Grooved H-pin (Copper)			
		Fin	Type (Material) Surface treatment	Slit (Aluminum) Hydrophilic coating			
Air filter		Type	Anti-mold				
		Net material	PP honeycomb				
Enclosure		Material	Plastic				
		Color	White Approximate color of Munsell N9.25/				
Dimensions (H × W × D)		Net	in (mm)	10-9/16 × 33-1/16 × 8 (268 × 840 × 203)			
		Gross		10-3/8 × 34-13/16 × 13-1/4 (270 × 884 × 336)			
Weight		Net	lb (kg)	20 (9)			
		Gross		24 (11)			
Connection pipe diameter		Liquid (Flare)	in (mm)	Ø 1/4 (6.35)			
		Gas (Flare)		Ø 1/2 (12.70)			
		Drain hose		I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)			
NOTES:							
<div><div>• Specifications are based on the following conditions:</div><div><div>– Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</div><div>– Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</div><div>– Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</div></div><div>• Protective function might work when using it outside the operation range.</div><div>• *: Sound pressure level:<div><div>– Measured values in manufacturer's anechoic chamber.</div><div>– Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</div></div></div></div>							

Model name				ASUB18TLAV1		ASUB24TLAV1		
Power supply				1 phase ~ 208/230 V 60 Hz				
Available voltage range				187—253 V				
Capacity		Cooling		Btu/h	18,000	24,000		
				kW	5.3	7.0		
		Heating		Btu/h	20,000	27,000		
				kW	5.9	7.9		
Input power				W	32	60		
Fan	Airflow rate		HIGH	CFM (m³/h)	494 (840)	647 (1,100)		
			MED		453 (770)	536 (910)		
			LOW		406 (690)	430 (730)		
			Type × Q'ty		Crossflow × 1			
		Motor output		W	42			
Sound pressure level*2			HIGH	dB (A)	41	48		
			MED		39	43		
			LOW		35	35		
Heat exchanger type		Length		in (mm)	Main: 32-3/16 (817) Sub1: 32-3/16 (817) Sub2: 32-3/16 (817)			
		Fin pitch		FPI	Main: 21 Sub1: 18 Sub2: 18			
		Rows × Stages			Main: 2 × 18 Sub1: 1 × 4 Sub2: 1 × 4			
		Face area		ft² (m²)	3.3 (0.31)			
		Pipe type (Material)			Grooved H-pin (Copper)			
		Fin	Type (Material)		Slit (Aluminum)			
			Surface treatment		Hydrophilic coating			
Air filter		Type		Deodorization/Anti-mold				
		Net material		PP monofilament net				
Enclosure		Material		Plastic				
		Color		White Approximate color of Munsell N9.25/				
Dimensions (H × W × D)		Net	in (mm)	12-5/8 × 39-5/16 × 9-3/8 (320 × 998 × 238)				
		Gross		12-5/16 × 42-15/16 × 16-7/8 (329 × 1,090 × 429)				
Weight		Net	lb (kg)	33 (15)				
		Gross		42 (19)				
Connection pipe diameter		Liquid (Flare)		Ø 1/4 (6.35)	Ø 3/8 (9.52)			
		Gas (Flare)		Ø 1/2 (12.70)	Ø 5/8 (15.88)			
		Drain hose		I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)				
NOTES:								
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>								

Model name				ASUA30TLAV2		ASUA36TLAV2	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling		Btu/h	30,000	34,000	
				kW	8.8	10.0	
		Heating		Btu/h	34,000	38,000	
				kW	10.0	11.2	
Input power				W	74	103	
Fan	Airflow rate		HIGH	CFM (m³/h)	848 (1,440)	954/895* <sup>1</sup> (1,620/1520* <sup>1</sup> )	
			MED—HIGH		707 (1,200)	766 (1,300)	
			MED		618 (1,050)	660 (1,120)	
			MED—LOW		554 (940)	577 (980)	
			LOW		524 (890)	524 (890)	
			QUIET		412 (700)	412 (700)	
	Type × Q'ty			Crossflow × 1			
	Motor output			W	61		
Sound pressure level <sup>2</sup>			HIGH	dB (A)	53	55/54* <sup>1</sup>	
			MED—HIGH		49	51	
			MED		45	47	
			MED—LOW		42	43	
			LOW		39	39	
			QUIET		33	33	
Heat exchanger type		Length		in (mm)	Main: 35-7/16 (900) Sub1: 35-7/16 (900) Sub2: 35-7/16 (900)		
		Fin pitch		FPI	Main: 21 Sub1: 18 Sub2: 18		
		Rows × Stages			Main: 2 × 22 Sub1: 1 × 6 Sub2: 1 × 4		
		Face area		ft² (m²)	4.5 (0.42)		
		Pipe type (Material)			Grooved H-pin (Copper)		
		Fin	Type (Material)		Slit (Aluminum)		
			Surface treatment		Hydrophilic coating		
Air filter		Type			Anti-mold		
		Net material			PP plain weave		
Enclosure		Material			Plastic		
		Color			White Approximate color of Munsell N9.25/		
Dimensions (H × W × D)		Net		in (mm)	13-3/8 × 45-1/4 × 11 (340 × 1,150 × 280)		
		Gross			15-5/16 × 50 × 17-11/16 (405 × 1,270 × 450)		
Weight		Net		lb (kg)	40 (18)		
		Gross			53 (24)		
Connection pipe diameter		Liquid (Flare)		in (mm)	Ø 3/8 (9.52)		
		Gas (Flare)			Ø 5/8 (15.88)		
		Drain hose			I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)		
NOTES:							
<div><div>• Specifications are based on the following conditions:</div><div><div>– Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</div><div>– Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</div><div>– Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</div></div><div>• Protective function might work when using it outside the operation range.</div><div>• *1: This value is "Cooling operation/Heating operation".</div><div>• *2: Sound pressure level:<div><div>– Measured values in manufacturer's anechoic chamber.</div><div>– Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</div></div></div></div>							

Model name				ASUA7TLAV	ASUA9TLAV	ASUA12TLAV	ASUA14TLAV
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity	Cooling	Btu/h	7,500	9,500	12,000	14,000	
		kW	2.2	2.8	3.5	4.1	
	Heating	Btu/h	9,500	10,900	13,500	15,600	
		kW	2.8	3.2	4.0	4.6	
Input power			W	17	18	22	34
Fan	Airflow rate	HIGH	CFM (m³/h)	288 (490)	294 (500)	330 (560)	394 (670)
		MED		265 (450)	265 (450)	283 (480)	288 (490)
		LOW		247/218* <sup>1</sup> (420/370* <sup>1</sup> )	247/218* <sup>1</sup> (420/370* <sup>1</sup> )	247 (420)	247 (420)
	Type × Q'ty			Crossflow × 1			
	Motor output		W	42			
Sound pressure level* <sup>2</sup>		HIGH	dB (A)	35	36	39	44
		MED		33	33	35	37
		LOW		31/27* <sup>1</sup>	31/27* <sup>1</sup>	31	32
Heat exchanger type	Length		in (mm)	23-5/8 (600)			
	Fin pitch		FPI	21			
	Rows × Stages			2 × 16			
	Face area		ft <sup>2</sup> (m <sup>2</sup> )	2.3 (0.20)			
	Pipe type (Material)			Grooved H-pin (Copper)			
	Fin	Type (Material)		Slit (Aluminum)			
		Surface treatment		Hydrophilic coating			
Air filter	Type			Antibacterial and mold proofing, ion deodorization			
	Net material			PP honeycomb			
Enclosure	Material			Plastic			
	Color			White Approximate color of Munsell N9.25/			
Dimensions (H × W × D)	Net		in (mm)	10-13/16 × 31-1/8 × 8-7/16 (275 × 790 × 215)			
	Gross			11-7/16 × 32-7/8 × 13-9/16 (290 × 835 × 345)			
Weight	Net		lb (kg)	20 (9)			
	Gross			26 (12)			
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 1/4 (6.35)			
	Gas (Flare)			Ø 1/2 (12.70)			
	Drain hose			I.D.: Ø 9/16 (13.8); O.D.: Ø 5/8 to 11/16 (15.8 to 16.7)			
<b>NOTES:</b> <ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*1: This value is "Cooling operation/Heating operation".</li><li>*2: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

Model name				ASUB18TLAV		ASUB24TLAV	
Power supply				1 phase ~ 208/230 V 60 Hz			
Available voltage range				187—253 V			
Capacity		Cooling	Btu/h	18,000	24,000		
			kW	5.3	7.0		
		Heating	Btu/h	20,000	27,000		
			kW	5.9	7.9		
Input power			W	32	60		
Fan	Airflow rate	HIGH	CFM (m³/h)	494 (840)	647 (1,100)		
		MED		453 (770)	536 (910)		
		LOW		406 (690)	430 (730)		
		Type × Q'ty			Crossflow × 1		
	Motor output		W	42			
Sound pressure level*		HIGH	dB (A)	41	48		
		MED		39	43		
		LOW		35	35		
Heat exchanger type	Length		in (mm)	Main: 32-3/16 (817) Sub1: 32-3/16 (817) Sub2: 32-3/16 (817)			
	Fin pitch		FPI	Main: 21 Sub1: 18 Sub2: 18			
	Rows × Stages			Main: 2 × 18 Sub1: 1 × 4 Sub2: 1 × 4			
	Face area		ft² (m²)	3.3 (0.31)			
	Pipe type (Material)			Grooved H-pin (Copper)			
	Fin	Type (Material)		Slit (Aluminum)			
		Surface treatment		Hydrophilic coating			
Air filter	Type			Deodorization/Anti-mold			
	Net material			PP monofilament net			
Enclosure	Material			Plastic			
	Color			White Approximate color of Munsell N9.25/			
Dimensions (H × W × D)	Net		in (mm)	12-5/8 × 39-5/16 × 9 (320 × 998 × 228)			
	Gross			12-9/16 × 42-15/16 × 16-7/8 (319 × 1,090 × 429)			
Weight	Net		lb (kg)	33 (15)			
	Gross			42 (19)			
Connection pipe diameter	Liquid (Flare)		in (mm)	Ø 3/8 (9.52)			
	Gas (Flare)			Ø 5/8 (15.88)			
	Drain hose			I.D.: Ø 1/2 (12); O.D.: Ø 5/8 (16)			
NOTES:							
<ul style="list-style-type: none"><li>Specifications are based on the following conditions:<ul style="list-style-type: none"><li>Cooling: Indoor temperature of 80 °FDB/67 °FWB (26.7 °CDB/19.4 °CWB), and outdoor temperature of 95 °FDB/75 °FWB (35 °CDB/23.9 °CWB).</li><li>Heating: Indoor temperature of 70 °FDB/60 °FWB (21.1 °CDB/15.6 °CWB), and outdoor temperature of 47 °FDB/43 °FWB (8.3 °CDB/6.1 °CWB).</li><li>Pipe length: 25 ft (7.5 m), Height difference: 0 ft (0 m). (Between outdoor unit and indoor unit.)</li></ul></li><li>Protective function might work when using it outside the operation range.</li><li>*: Sound pressure level:<ul style="list-style-type: none"><li>Measured values in manufacturer's anechoic chamber.</li><li>Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.</li></ul></li></ul>							

### 3. Electrical characteristics

Indoor unit		Power supply: 60 Hz, 230 V		Indoor rated		
Type	Model name	MCA	MAX. CKT. BKR	Input power	Current	FLA
		A	A	W	A	A
Compact cassette	AUUA4TLAV2	0.29	15	23	0.17	0.23
	AUUA7TLAV2	0.51		25	0.17	0.41
	AUUA9TLAV2	0.51		25	0.17	0.41
	AUUA12TLAV2	0.51		29	0.20	0.41
	AUUA14TLAV2	0.51		35	0.24	0.41
	AUUA18TLAV2	0.51		36	0.25	0.41
	AUUA24TLAV2	0.78		84	0.62	0.62
4-way flow cassette (Slim type)	AUUB18TLAV	0.43	15	39	0.27	0.34
	AUUB24TLAV	0.43		46	0.32	0.34
4-way flow cassette	AUUB30TLAV	0.68	15	59	0.42	0.54
	AUUB36TLAV	0.68		80	0.53	0.54
Circular flow cassette	AUUB18TLAV2	0.33	15	20	0.20	0.26
	AUUB24TLAV2	0.40		25	0.24	0.32
	AUUB30TLAV2	0.68		49	0.41	0.54
	AUUB36TLAV2	0.78		61	0.47	0.62
	AUUB48TLAV2	1.40		116	0.86	1.12
Mini duct	ARUL4TLAV2	0.35	15	26	0.21	0.28
Slim duct/Slim concealed floor	ARUL7TLAV2	0.71	15	44	0.31	0.57
	ARUL9TLAV2	0.71		50	0.35	0.57
	ARUL12TLAV2	0.71		50	0.38	0.57
	ARUL14TLAV2	0.76		92	0.61	0.61
	ARUL18TLAV2	0.76		83	0.55	0.61
Medium static pressure duct	ARUM24TLAV2	1.10	15	125	0.75	0.88
	ARUM30TLAV2	1.40		190	1.12	1.12
	ARUM36TLAV2	1.74		222	1.29	1.39
High static pressure duct	ARUH36TLAV	2.70	15	496	2.16	2.16
	ARUH48TLAV	4.83		752	3.27	3.86
	ARUH60TLAV	4.83		806	3.57	3.86
	ARUH72TLAV2	8.13		618	3.61	6.50
	ARUH96TLAV2	9.40		838	4.89	7.52
Compact floor	AGUA4TLAV2	0.22	15	12/14*	0.13	0.17
	AGUA7TLAV2	0.24		16	0.14	0.19
	AGUA9TLAV2	0.25		17	0.15	0.20
	AGUA12TLAV2	0.30		22	0.18	0.24
	AGUA14TLAV2	0.38		29	0.23	0.30
Floor/Ceiling	ABUA12TLAV2	0.40	15	30	0.25	0.32
	ABUA14TLAV2	0.43		42	0.34	0.34
	ABUA18TLAV2	0.71		74	0.57	0.57
	ABUA24TLAV2	0.93		99	0.70	0.74
Ceiling	ABUA30TLAV2	0.61	15	66	0.43	0.49
	ABUA36TLAV2	0.69		85	0.55	0.55

INDOOR  
UNITSINDOOR  
UNITS



Indoor unit		Power supply: 60 Hz, 230 V		Indoor rated		
Type	Model name	MCA	MAX. CKT. BKR	Input power	Current	FLA
		A	A	W	A	A
Wall mounted	ASUA4TLAV2	0.22	15	13	0.13	0.17
	ASUA7TLAV2	0.32		19	0.19	0.25
	ASUA9TLAV2	0.52		34	0.31	0.41
	ASUA12TLAV2	0.42		25	0.25	0.33
	ASUA14TLAV2	0.49		36	0.30	0.39
	ASUB18TLAV1	0.53		32	0.33	0.42
	ASUB24TLAV1	0.65		60	0.52	0.52
	ASUA30TLAV2	0.90		74	0.55	0.72
	ASUA36TLAV2	1.18		103	0.72	0.94
	ASUA7TLAV	0.51		17	0.17	0.41
	ASUA9TLAV	0.51		18	0.20	0.41
	ASUA12TLAV	0.51		22	0.20	0.41
	ASUA14TLAV	0.51		34	0.20	0.41
	ASUB18TLAV	0.53		32	0.33	0.42
	ASUB24TLAV	0.65		60	0.52	0.52

MCA: Minimum Circuit Ampacity = Maximum operating current (Full load)

MAX. CKT. BKR: Maximum Circuit Breaker

FLA: Full Load Amperes (Fan motor)

\*: This value is "Cooling operation/Heating operation".


## 4. Dimensions

### 4-1. Compact cassette type


■ Models: AUUA4TLAV2, AUUA7TLAV2, AUUA9TLAV2, AUUA12TLAV2, AUUA14TLAV2, AUUA18TLAV2, and AUUA24TLAV2

Unit: in (mm)




Grid type grille

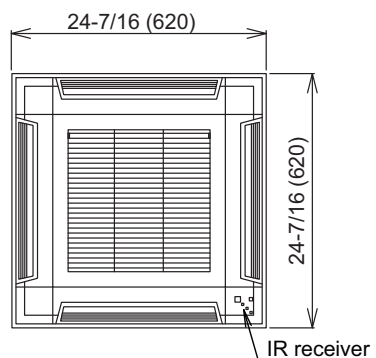


Standard type grille

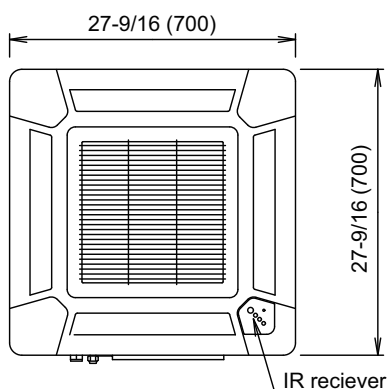

View A

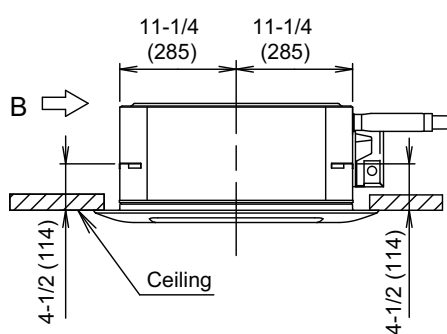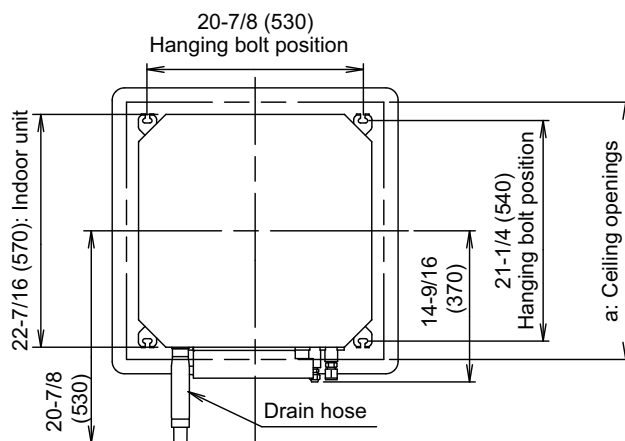

View B

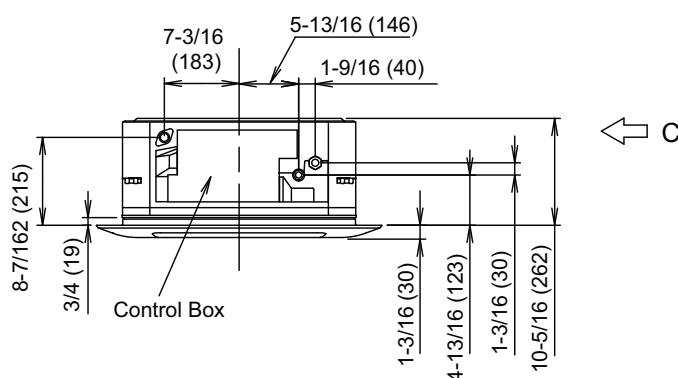


View C

**a: Ceiling openings**

Cassette grille	Standard type	in (mm)	22-13/16 to 26 (580 to 660)
	Grid type		22-13/16 to 24 (580 to 610)

## ■ Installation space

Unit: in (mm)

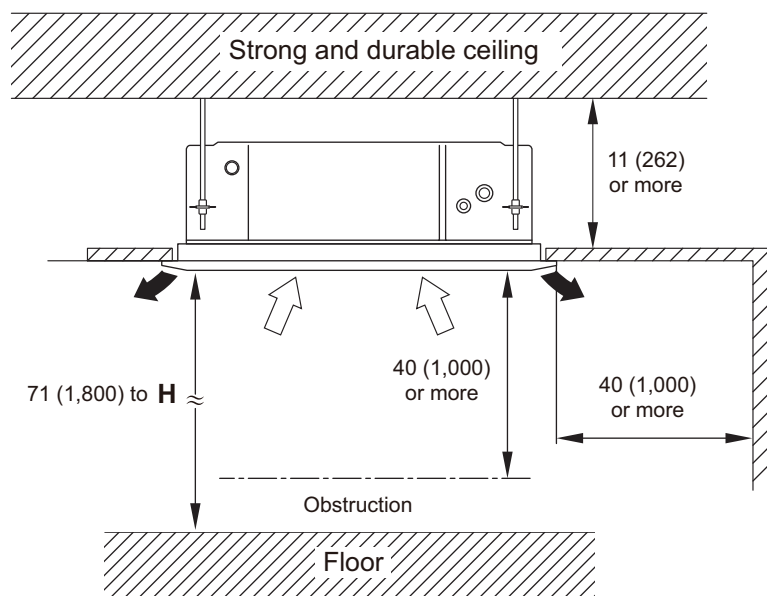


Be sure to make function setting with the remote controller according to the installed ceiling height.

H: The maximum height from floor to ceiling							
Ceiling height	Model name						
	AUUA4	AUUA7	AUUA9	AUUA12	AUUA14	AUUA18	AUUA24
Standard	106 (2,700)						
High ceiling	—			118 (3,000)			

## ● Installation notices

- When installing the indoor unit, be careful about the maintenance space.
- To set “3-direction”, Air outlet shutter plate (option) must be installed, and the “outlet-direction” need to be switched to “3-way” by the remote controller.






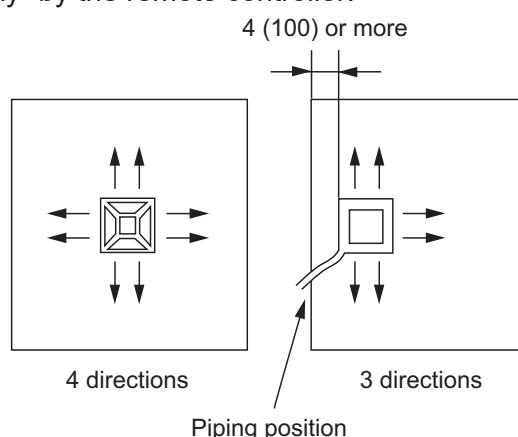


- In 3-way outlet mode, changing of ceiling height setting by function setting 20 is prohibited. (Ceiling height setting [function setting 20] is allowed to be changed only in 4-way outlet mode.)
- Use the Insulation kit for high humidity (option), when the condition under the roof is over 80% in humidity and over 86°F (30°C) in temperature. Otherwise, there is a risk of condensation on the ceiling.

## 4-2. 4-way flow cassette type







### ■ Models: AUUB18TLAV and AUUB24TLAV

Unit: in (mm)

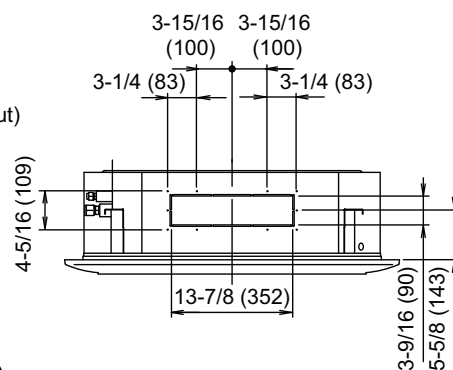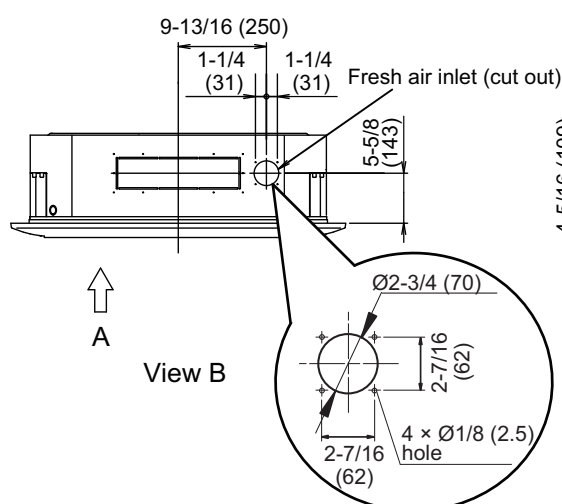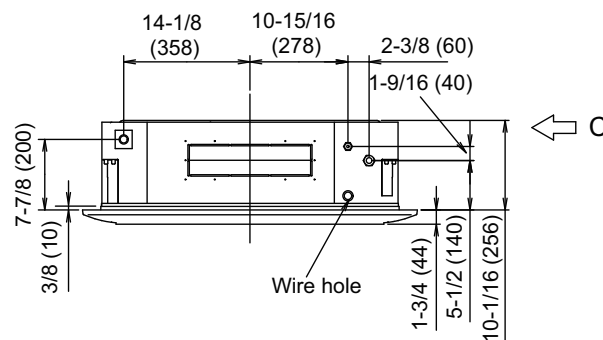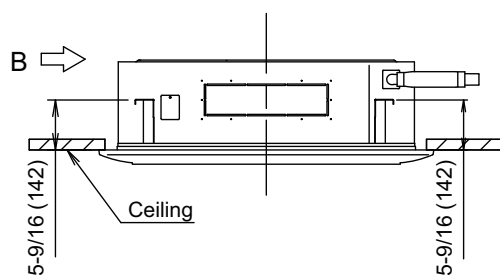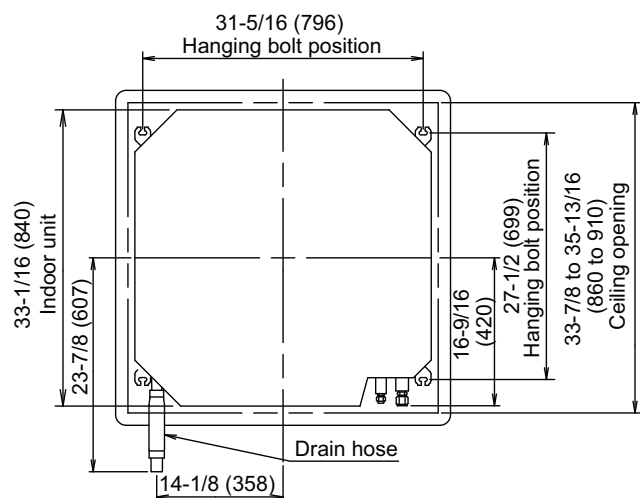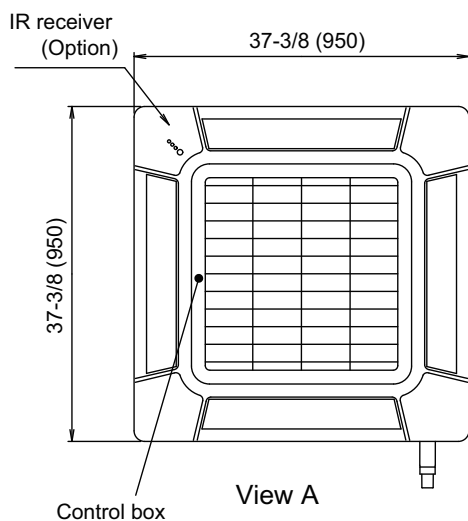


# Models: AUUB30TLAV and AUUB36TLAV

Unit: in (mm)

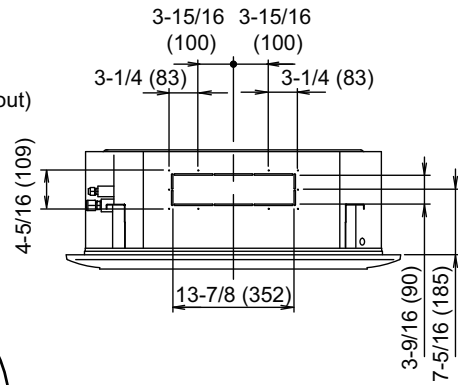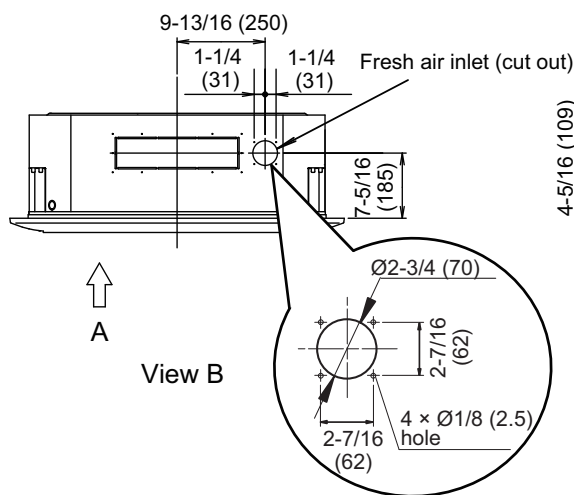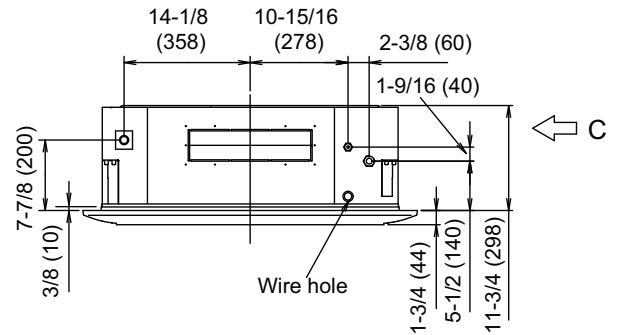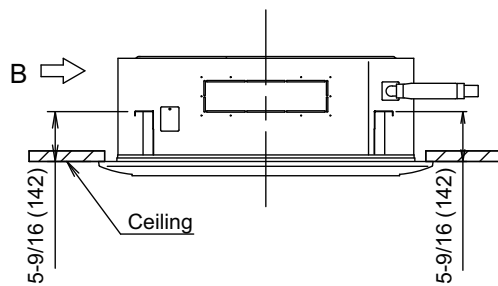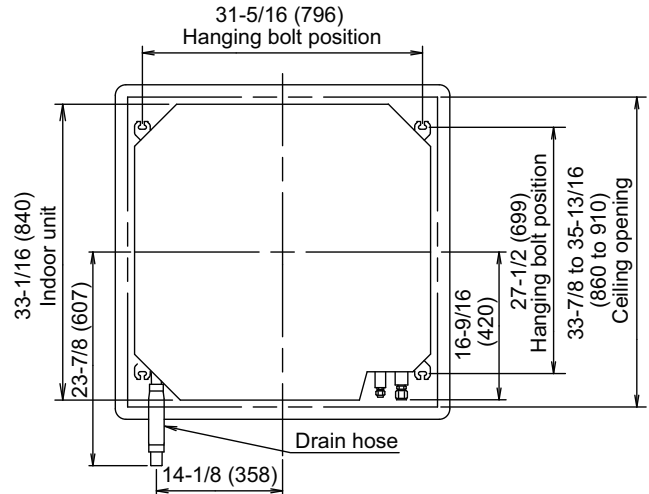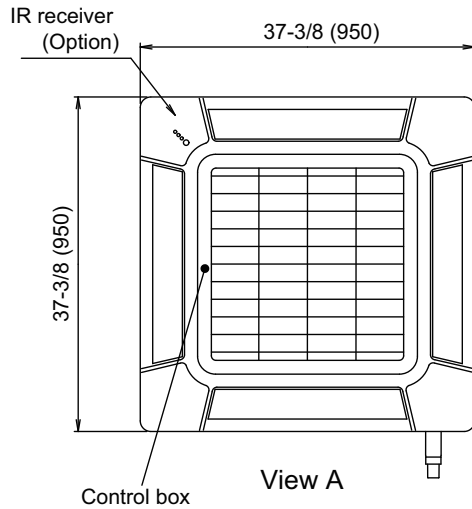

## ■ Installation space requirement

Unit: in (mm)

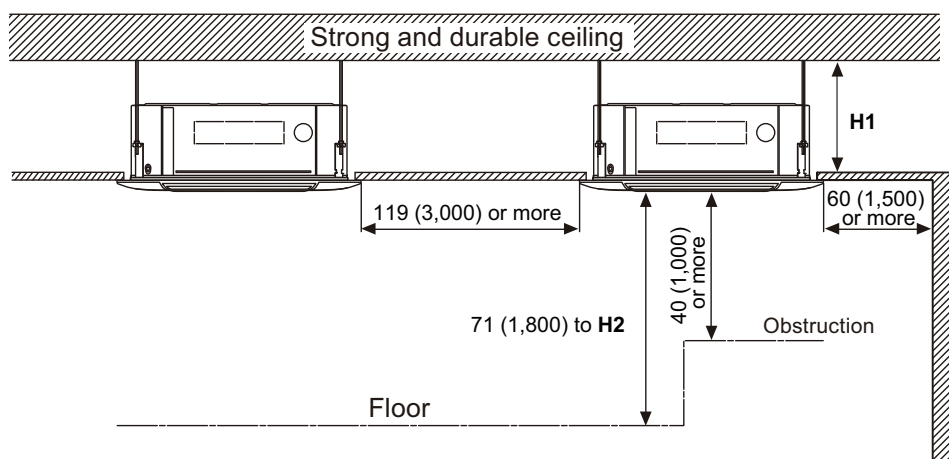


Model name	H1: Attic height
AUUB18-24TLAV	11 (256) or more
AUUB30-36TLAV	12 (298) or more

Be sure to make function setting with the remote controller according to the installed ceiling height.

H2: The maximum height from floor to ceiling			
Ceiling height	Model name		
	AUUB18-24TLAV	AUUB30TLAV	AUUB36TLAV
Standard	118 (3,000)	125 (3,200)	
High ceiling	137 (3,500)	141 (3,600)	165 (4,200)

## ● Installation notices

- When installing the indoor unit, be careful about the maintenance space.
- To set “3-direction”, Air outlet shutter plate (option) must be installed, and the “outlet-direction” need to be switched to “3-way” by the remote controller.

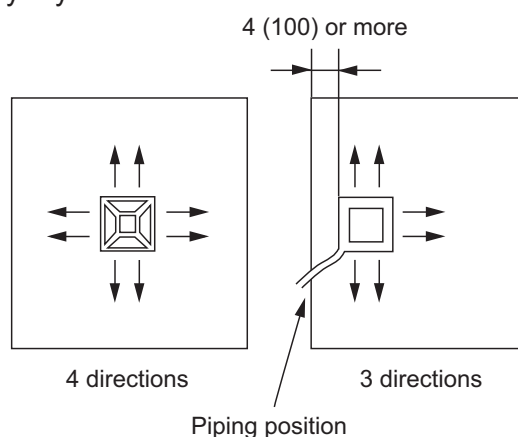


- In 3-way outlet mode, changing of ceiling height setting by function setting 20 is prohibited. (Ceiling height setting [function setting 20] is allowed to be changed only in 4-way outlet mode.)
- Use the Insulation kit for high humidity (option), when the condition under the roof is over 80% in humidity and over 86°F (30°C) in temperature. Otherwise, there is a risk of condensation on the ceiling.



## 4-3. Circular flow cassette type

### ■ Models: AUUB18TLAV2, AUUB24TLAV2, and AUUB30TLAV2


Unit: in (mm)

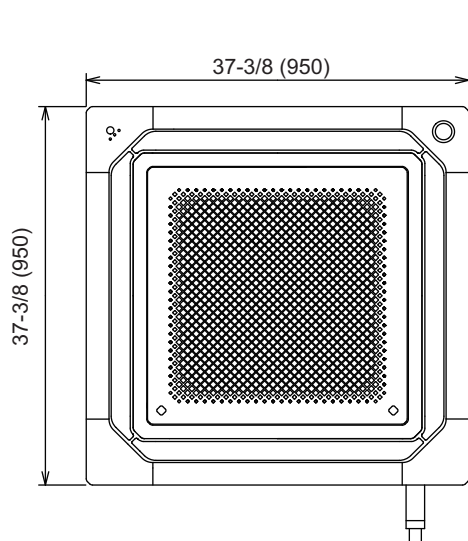


View A

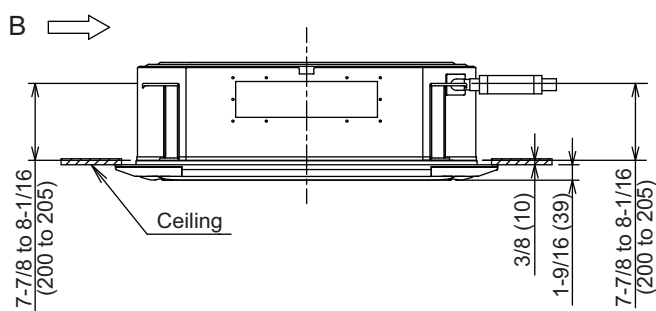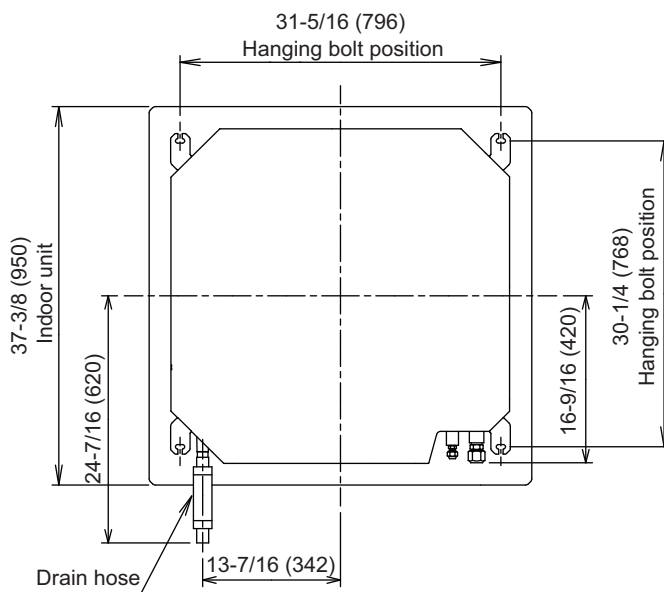

View B

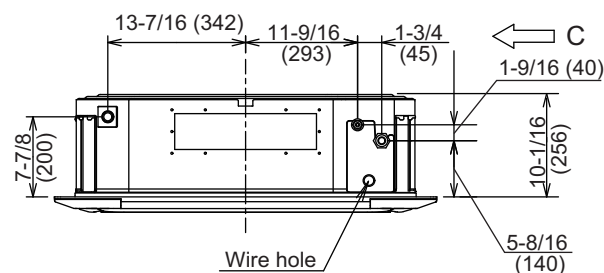

View C

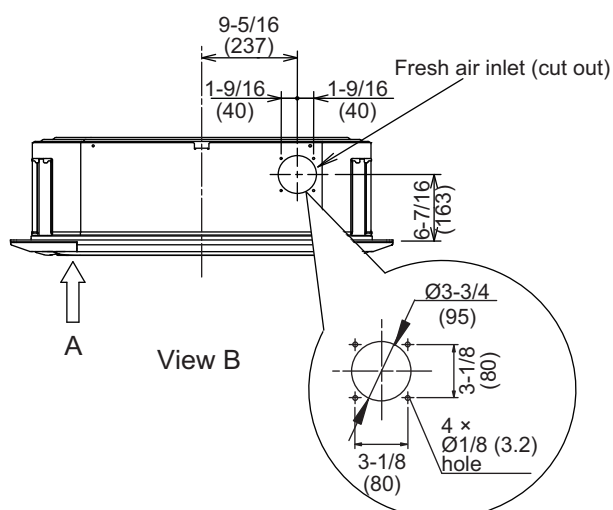

## INDOOR UNITS

## INDOOR UNITS




## INDOOR UNITS





## ■ Installation space requirement

Unit: in (mm)

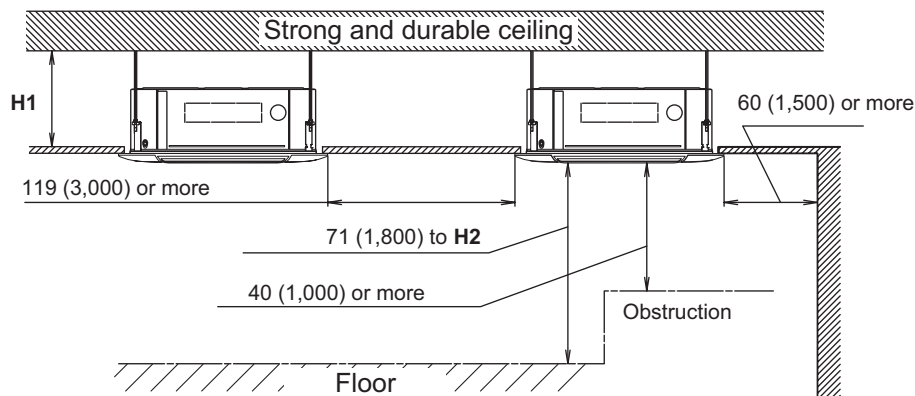


Model name	H1: Attic height
AUUB18-30TLAV2	11 (256) or more
AUUB36-48TLAV2	12 (298) or more

Be sure to make function setting with the remote controller according to the installed ceiling height.

H2: The maximum height from floor to ceiling		
Ceiling height	Model name	
	AUUB18-30TLAV2	AUUB36-48TLAV2
Standard	118 (3,000)	126 (3,200)
High ceiling	138 (3,500)	166 (4,200)

## ● Installation notices

- When installing the indoor unit, be careful about the maintenance space.
- To set "3-direction", Air outlet shutter plate (option) must be installed, and the "outlet-direction" need to be switched to "3-way" by the remote controller.


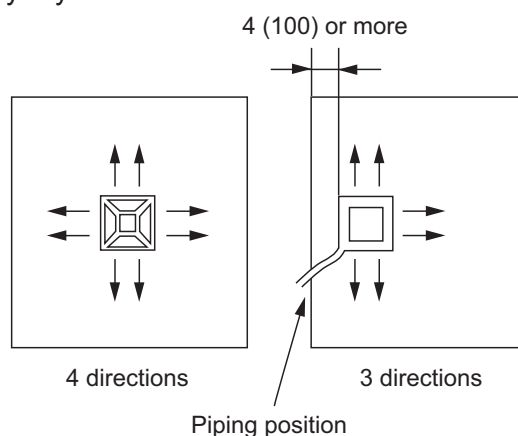


- In 3-way outlet mode, changing of ceiling height setting by function setting 20 is prohibited. (Ceiling height setting [function setting 20] is allowed to be changed only in 4-way outlet mode.)
- Use the Insulation kit for high humidity (option), when the condition under the roof is over 80% in humidity and over 86°F (30°C) in temperature. Otherwise, there is a risk of condensation on the ceiling.


## 4-4. Mini duct type

### ■ Model: ARUL4TLAV2


Unit: in (mm)

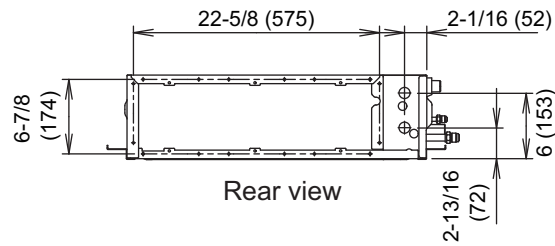


View A

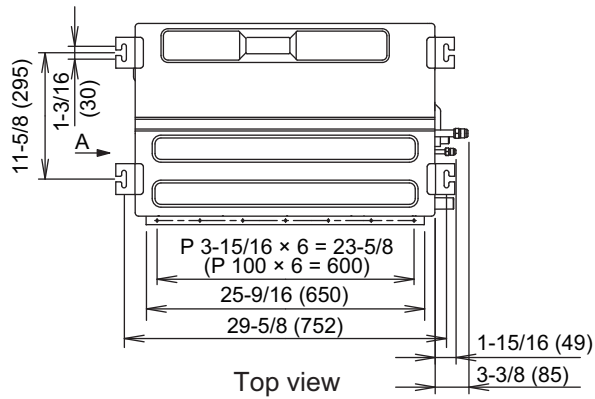


Top view

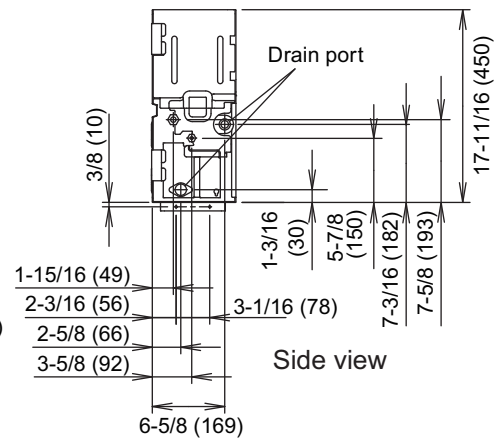

Side view

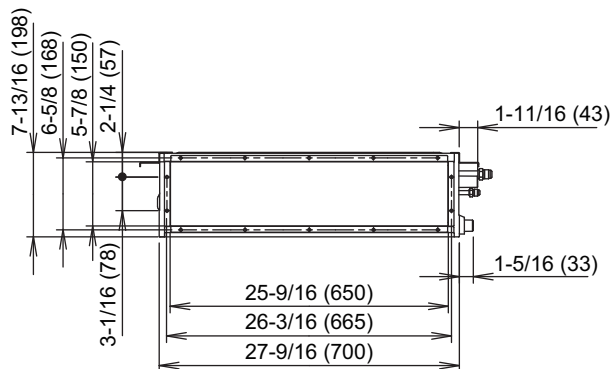

Front view

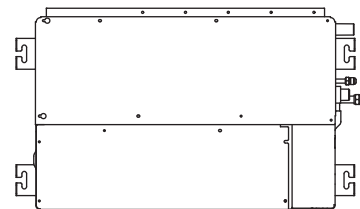


Bottom view

## ■ Installation space requirement


Provide sufficient installation space for product safety.

Unit: in (mm)

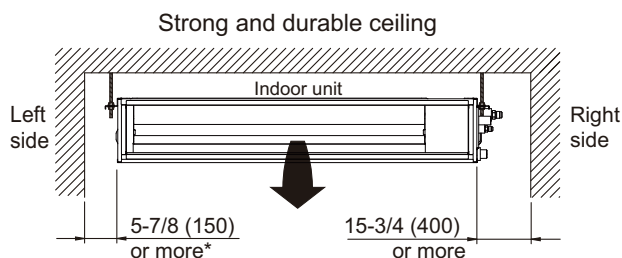


\*: 15-3/4 (400) or more when drain from drain pipe

- When intaking air from back:

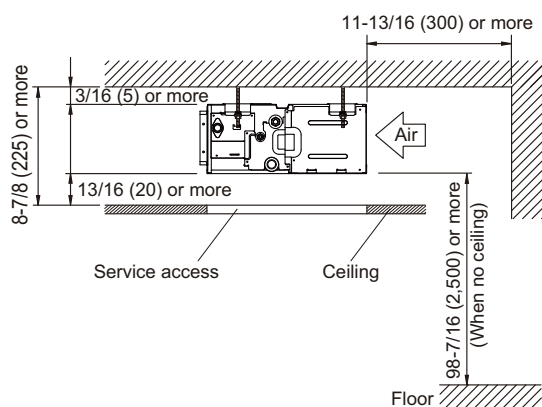

- When intaking air from bottom:

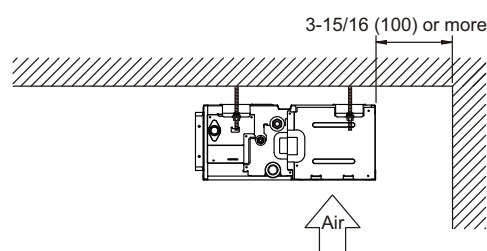


## ■ Maintenance space requirement

For future maintenance and service access, provide sufficient maintenance space.

**NOTE:** Do not place any wiring or illumination in the maintenance space, as they will impede service.

Unit: in (mm)

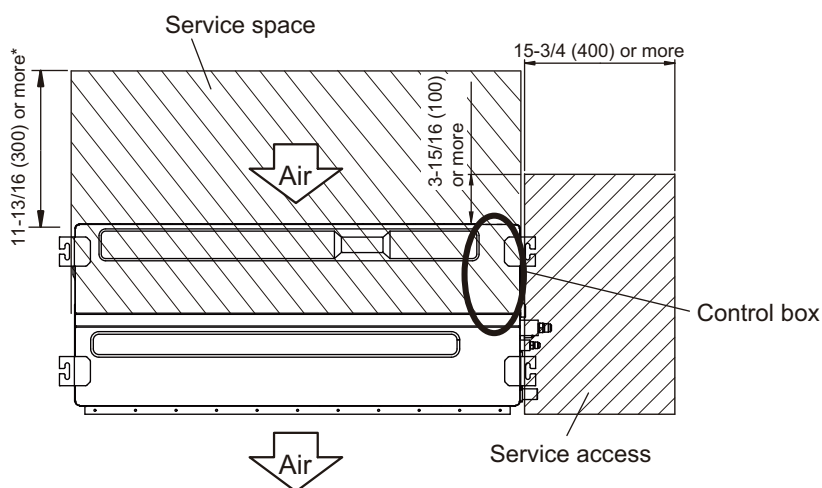


\*: More than 3-15/16 (100) when intaking air from bottom

Top view

## 4-5. Slim duct/Slim concealed floor type







### ■ Models: ARUL7TLAV2, ARUL9TLAV2, ARUL12TLAV2, and ARUL14TLAV2

Unit: in (mm)

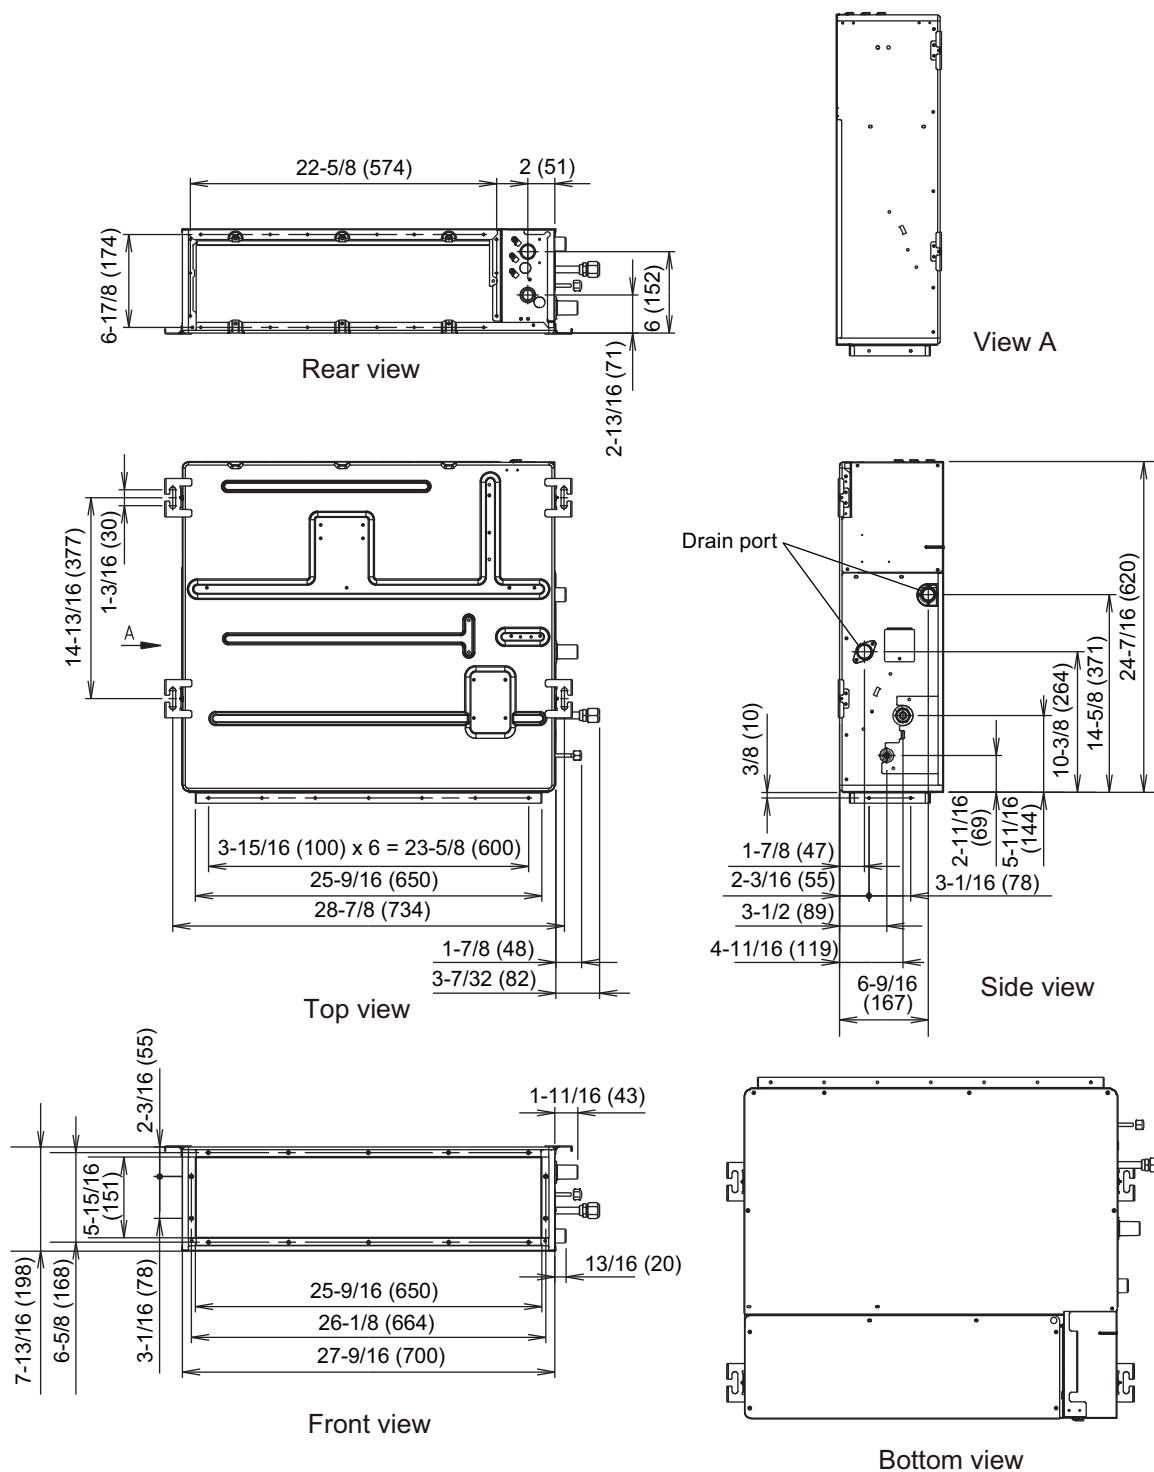INDOOR  
UNITSINDOOR  
UNITS

# Model: ARUL18TLAV2

Unit: in (mm)

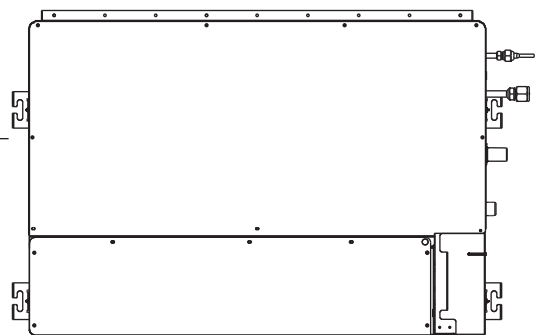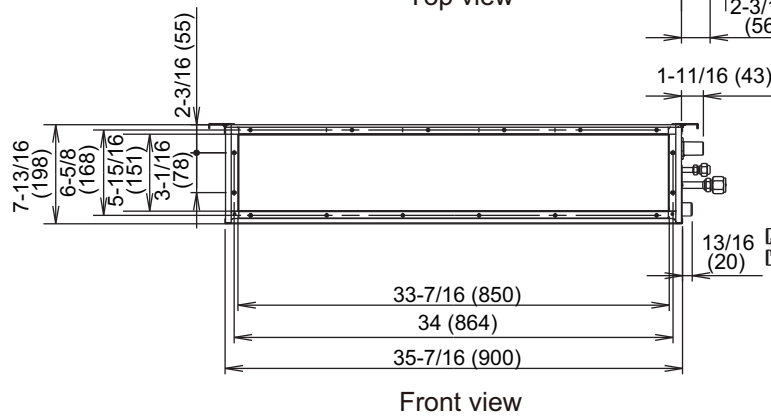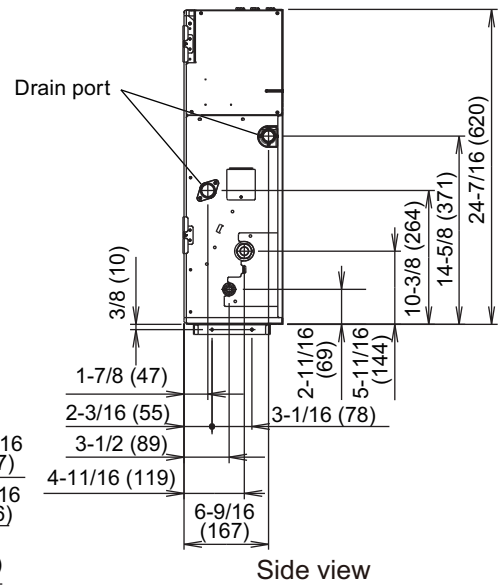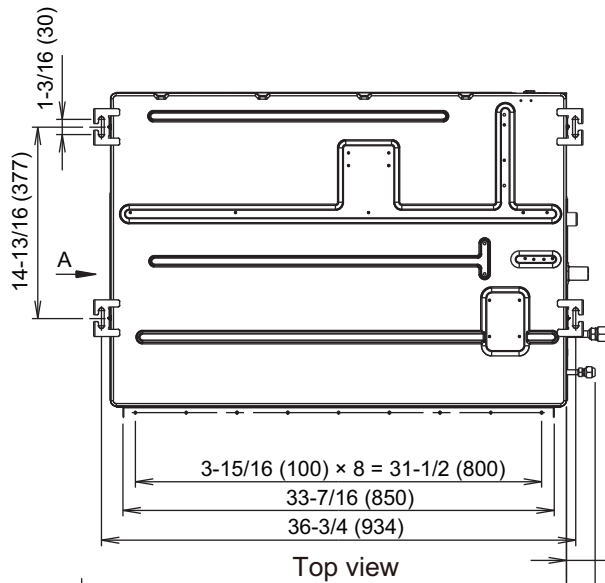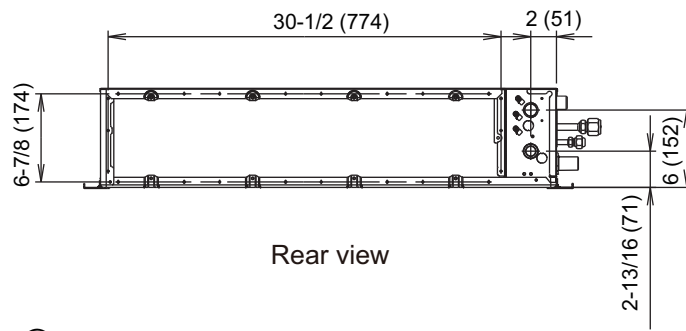


INDOOR  
UNITS

INDOOR  
UNITS


# ■ Installation space requirement

Unit: in (mm)

## In ceiling-concealed installations:

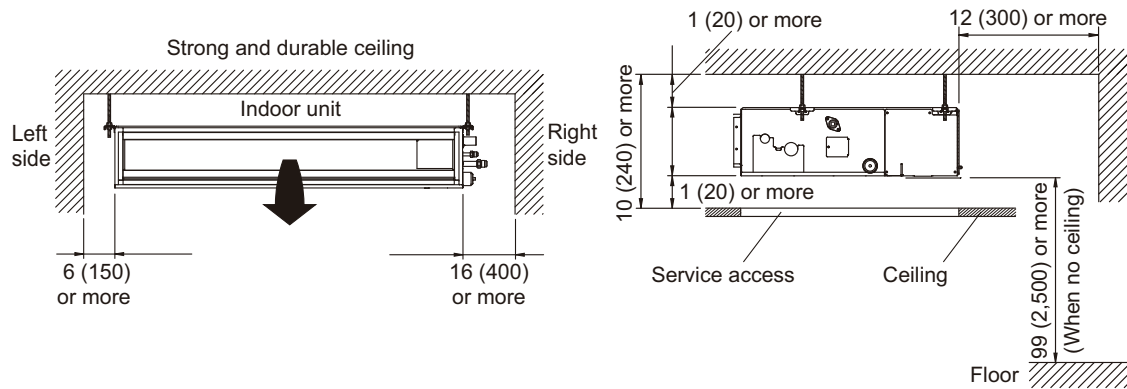

## In wall-concealed installations:

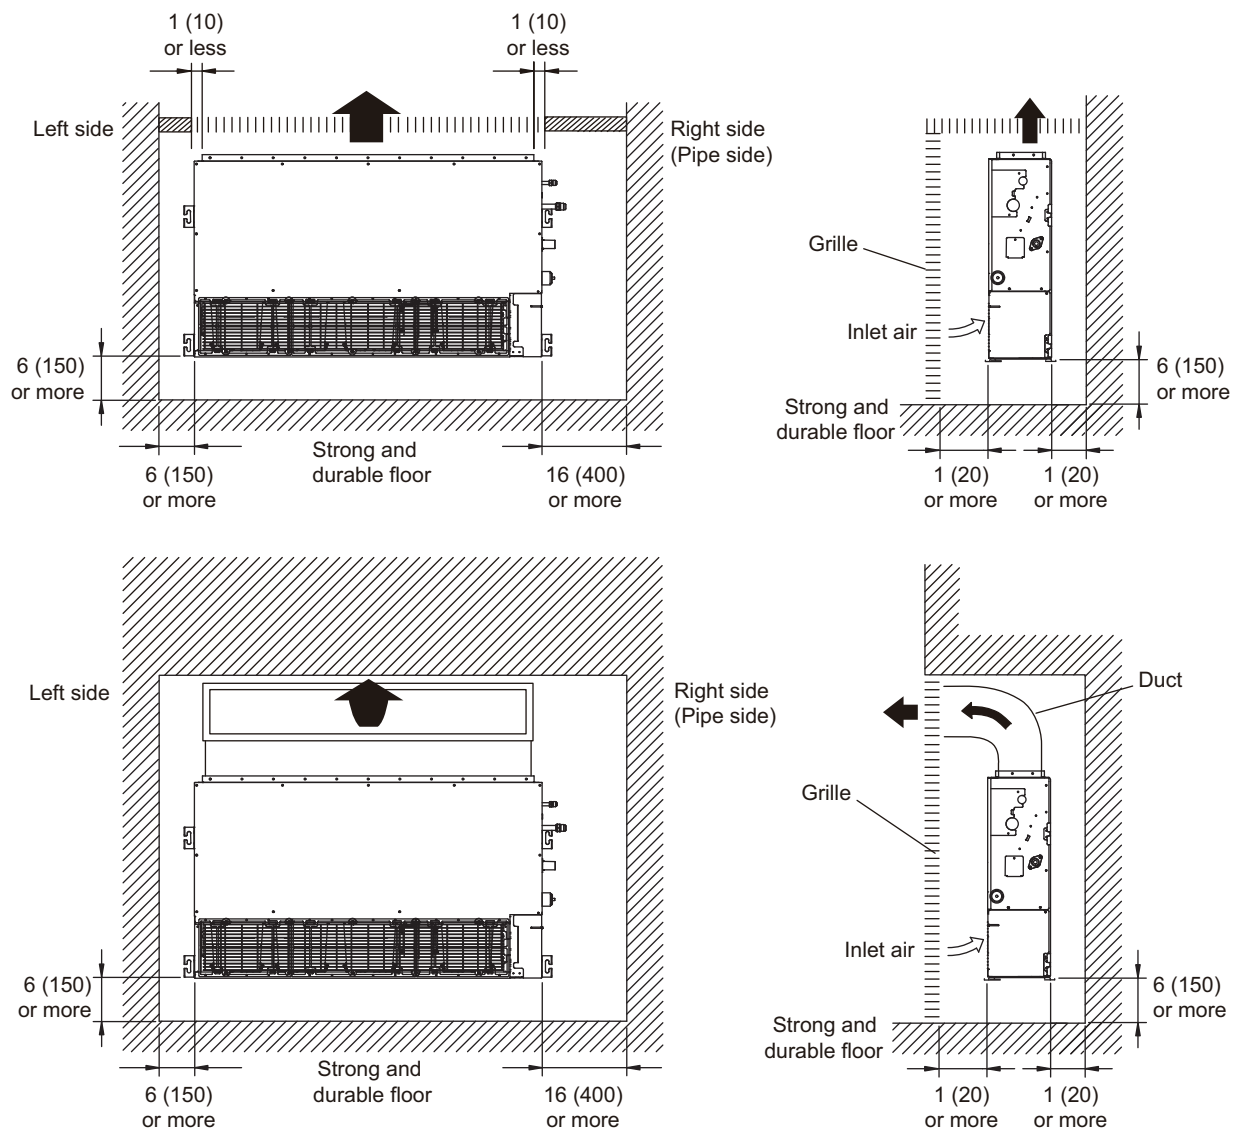


## ■ Maintenance space requirement

For future maintenance and service access, provide sufficient maintenance space.

**NOTE:** Do not place any wiring or illumination in the maintenance space, as they will impede service.


Unit: in (mm)

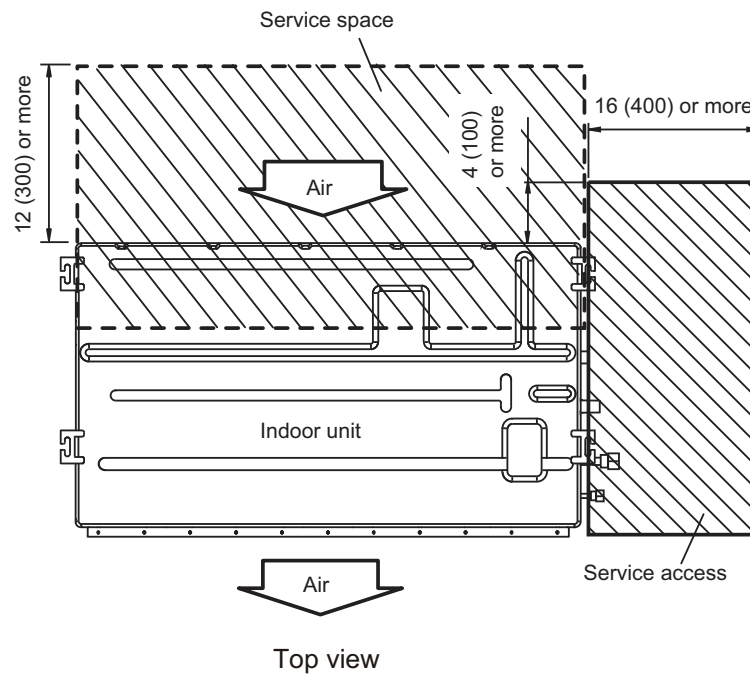


## 4-6. Medium static pressure duct type

### ■ Models: ARUM24TLAV2, ARUM30TLAV2, and ARUM36TLAV2

Unit: in (mm)

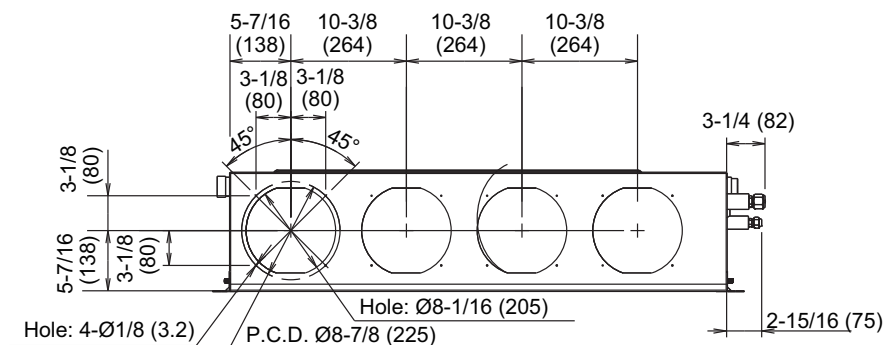


Front view

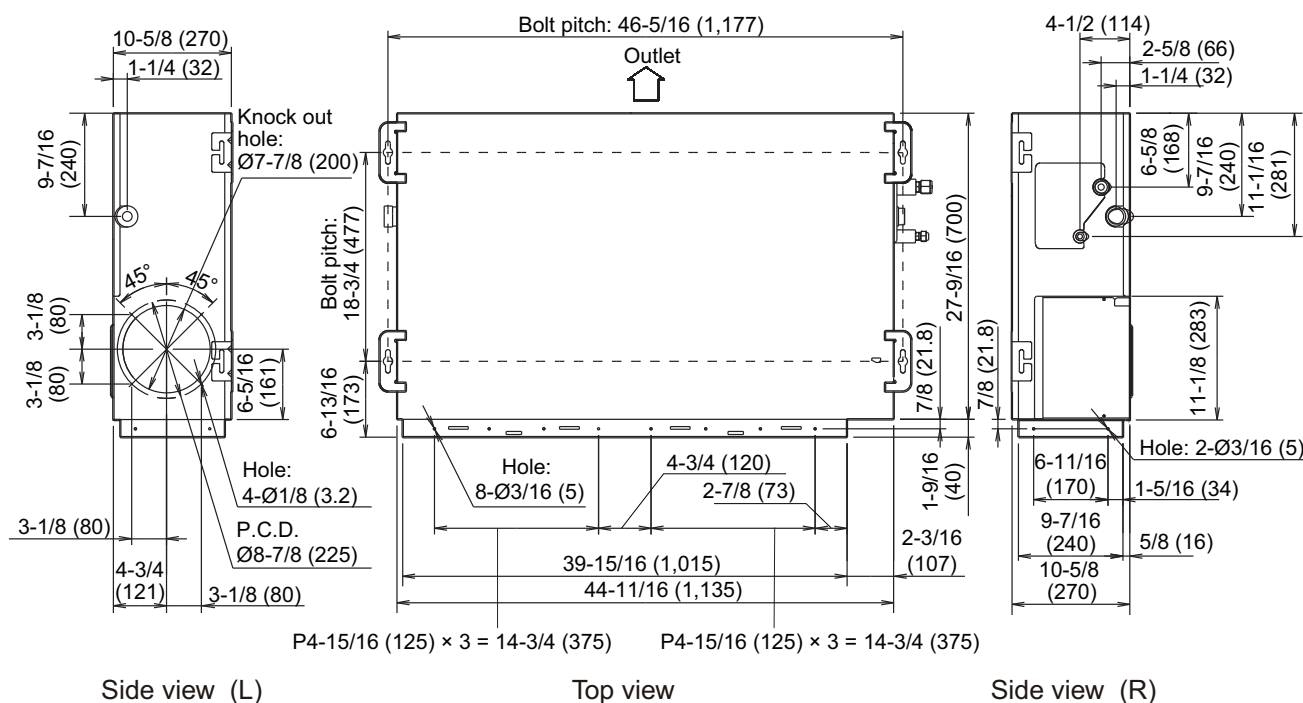

Side view (L)

Top view

Side view (R)

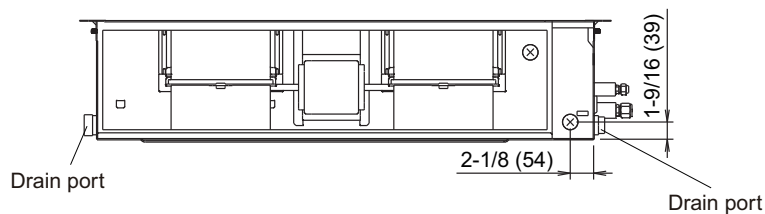


Rear view



## ■ Installation space requirement

Unit: in (mm)

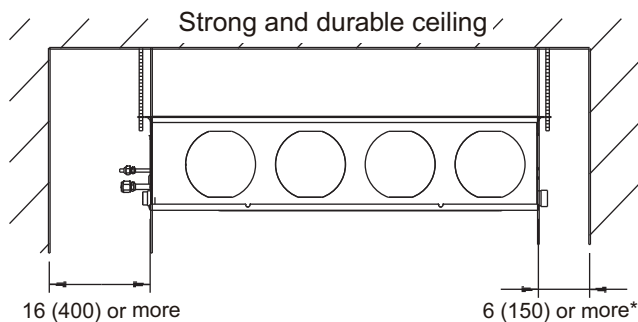

### NOTES:

- When Drain pump unit is used, leave the space requirement for service and maintenance. For details of Drain pump unit, refer to "[Drain pump unit for duct type](#)" in Chapter 10. OPTIONAL PARTS on page 10-27.
- \*: When drain hose is connected, the required dimension is 16 (in) 400 mm or more.


## ■ Maintenance space requirement

For future maintenance and service access, provide sufficient maintenance space.


**NOTE:** Do not place any wiring or illumination in the maintenance space, as they will impede service.

Unit: in (mm)


It shall be possible to install and remove the control box.

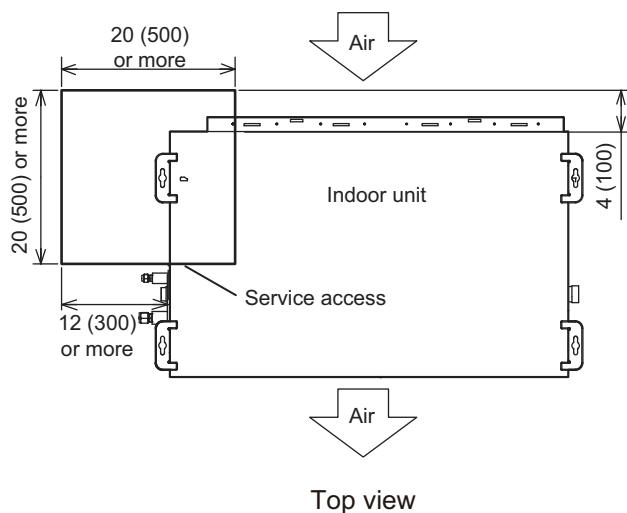

It shall be possible to install and remove the control box, fan units, and filter.

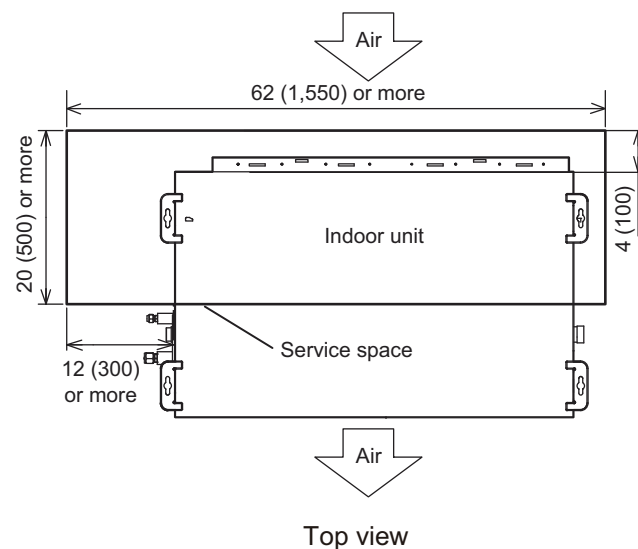


### When using a square duct

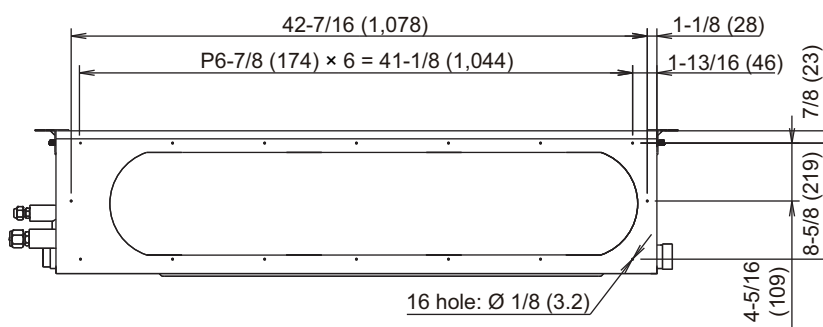


## 4-7. High static pressure duct type

### ■ Models: ARUH36TLAV, ARUH48TLAV, and ARUH60TLAV

Unit: in (mm)

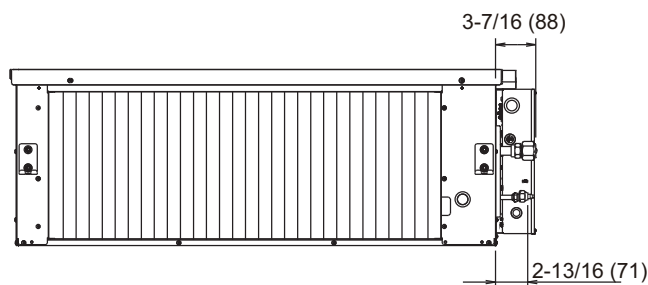


Rear view

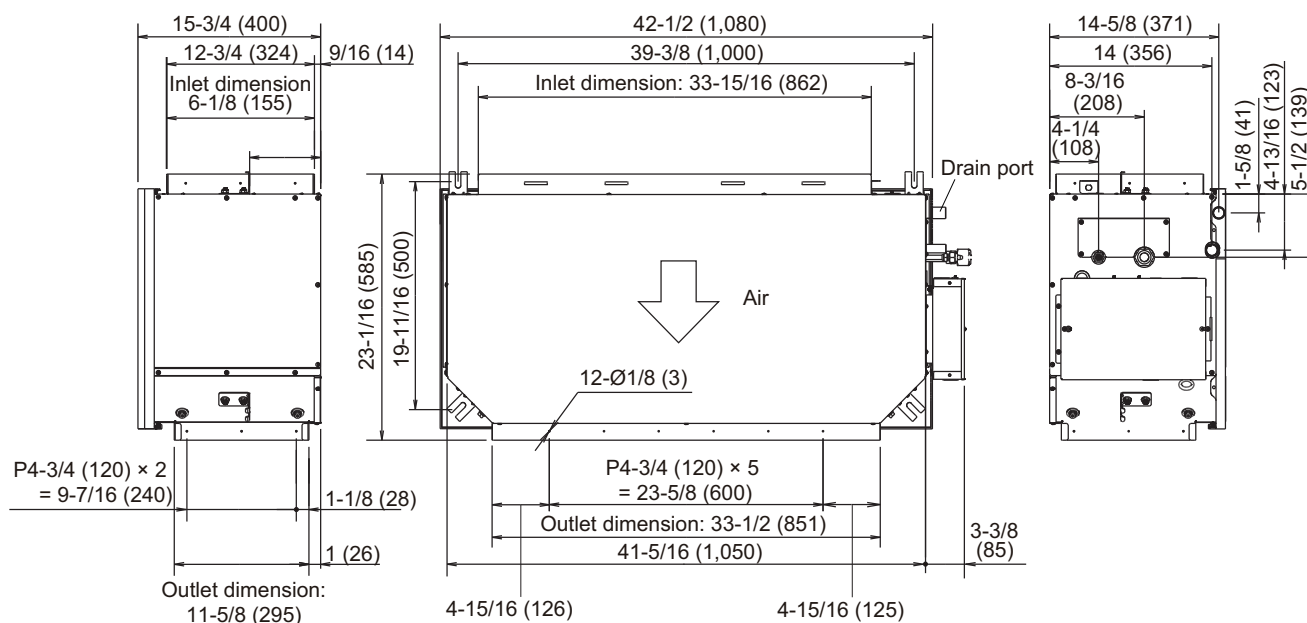

Side view (L)

Top view


Side view (R)

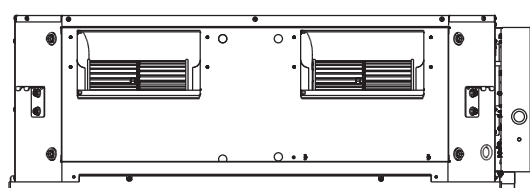

Front view

## ■ Installation space requirement

Unit: in (mm)

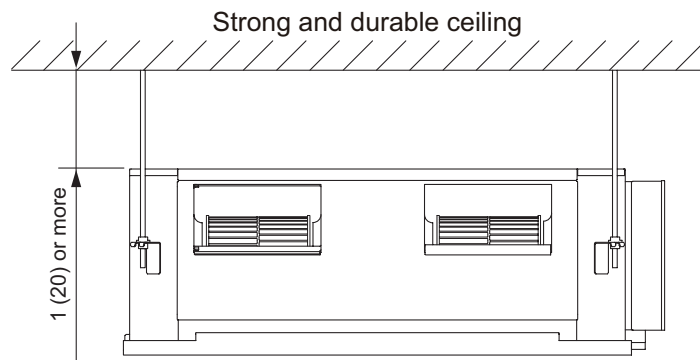


## ■ Maintenance space requirement

For future maintenance and service access, provide sufficient maintenance space.

**NOTE:** Do not place any wiring or illumination in the maintenance space, as they will impede service.




Unit: in (mm)

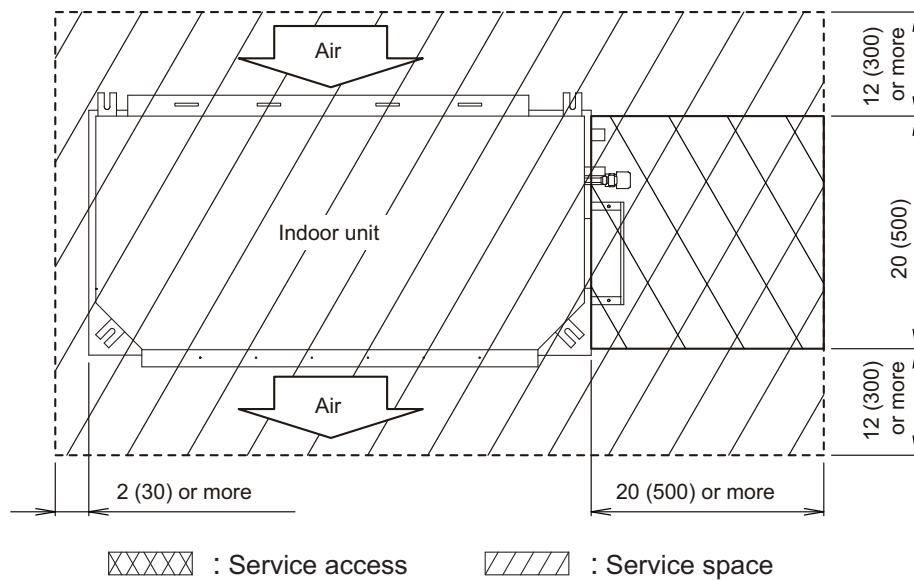

Top view

# Model: ARUH72TLAV2



Unit: in (mm)

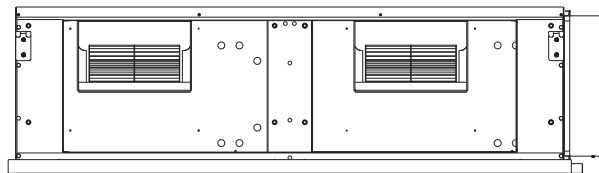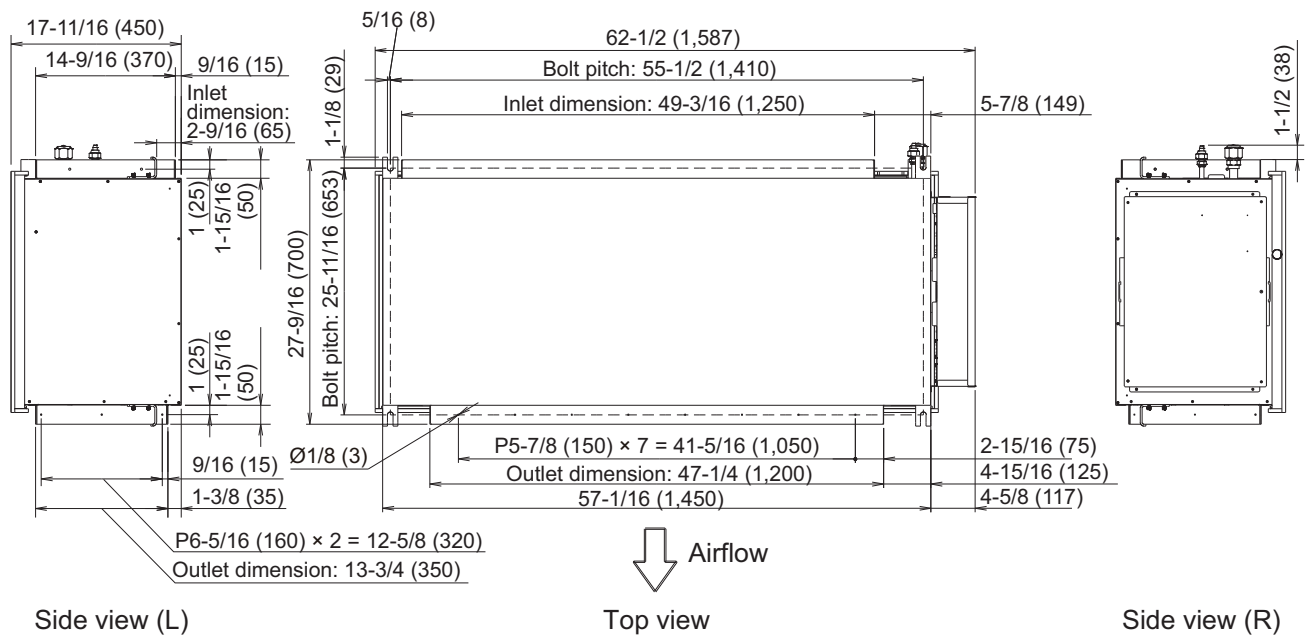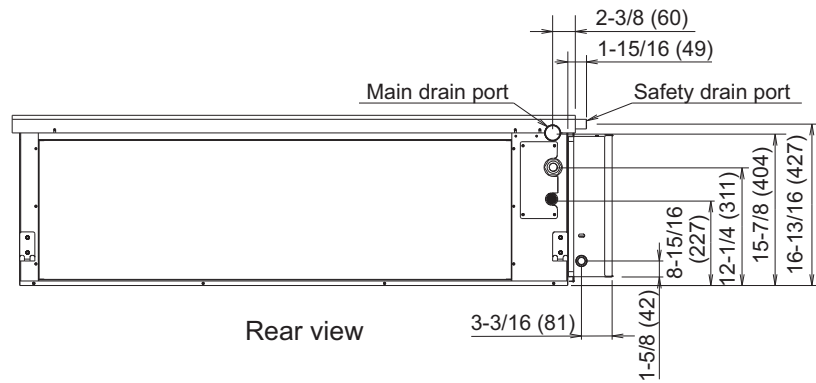

Front view

# Model: ARUH96TLAV2


Unit: in (mm)

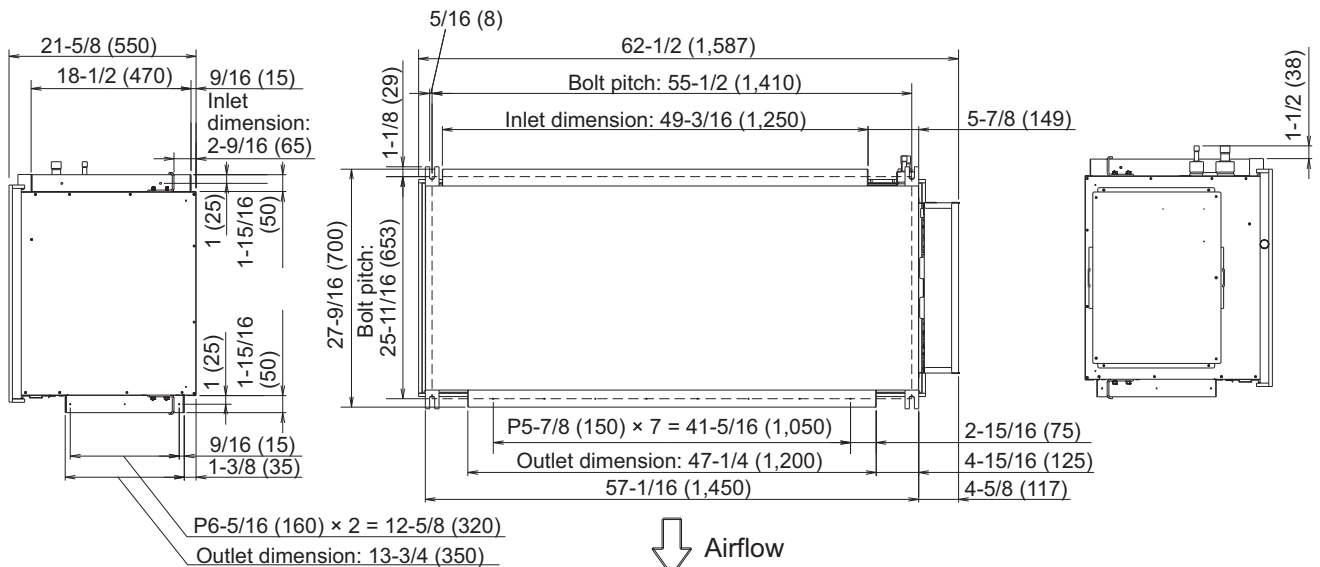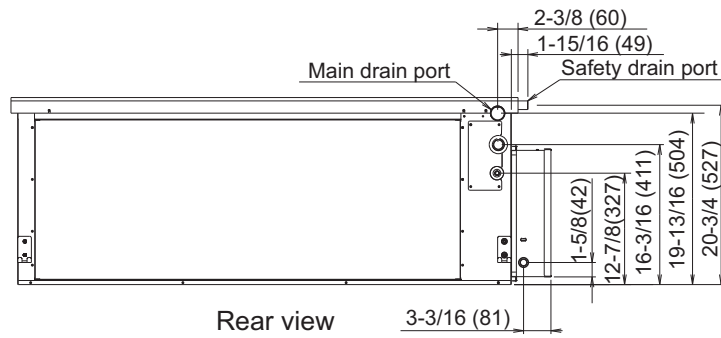

Side view (L)

Top view

Side view (R)

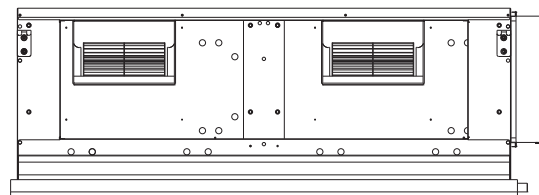


Front view

## 4-8. Compact floor type




■ Models: AGUA4TLAV2, AGUA7TLAV2, AGUA9TLAV2, AGUA12TLAV2, and AGUA14TLAV2

Unit: in (mm)

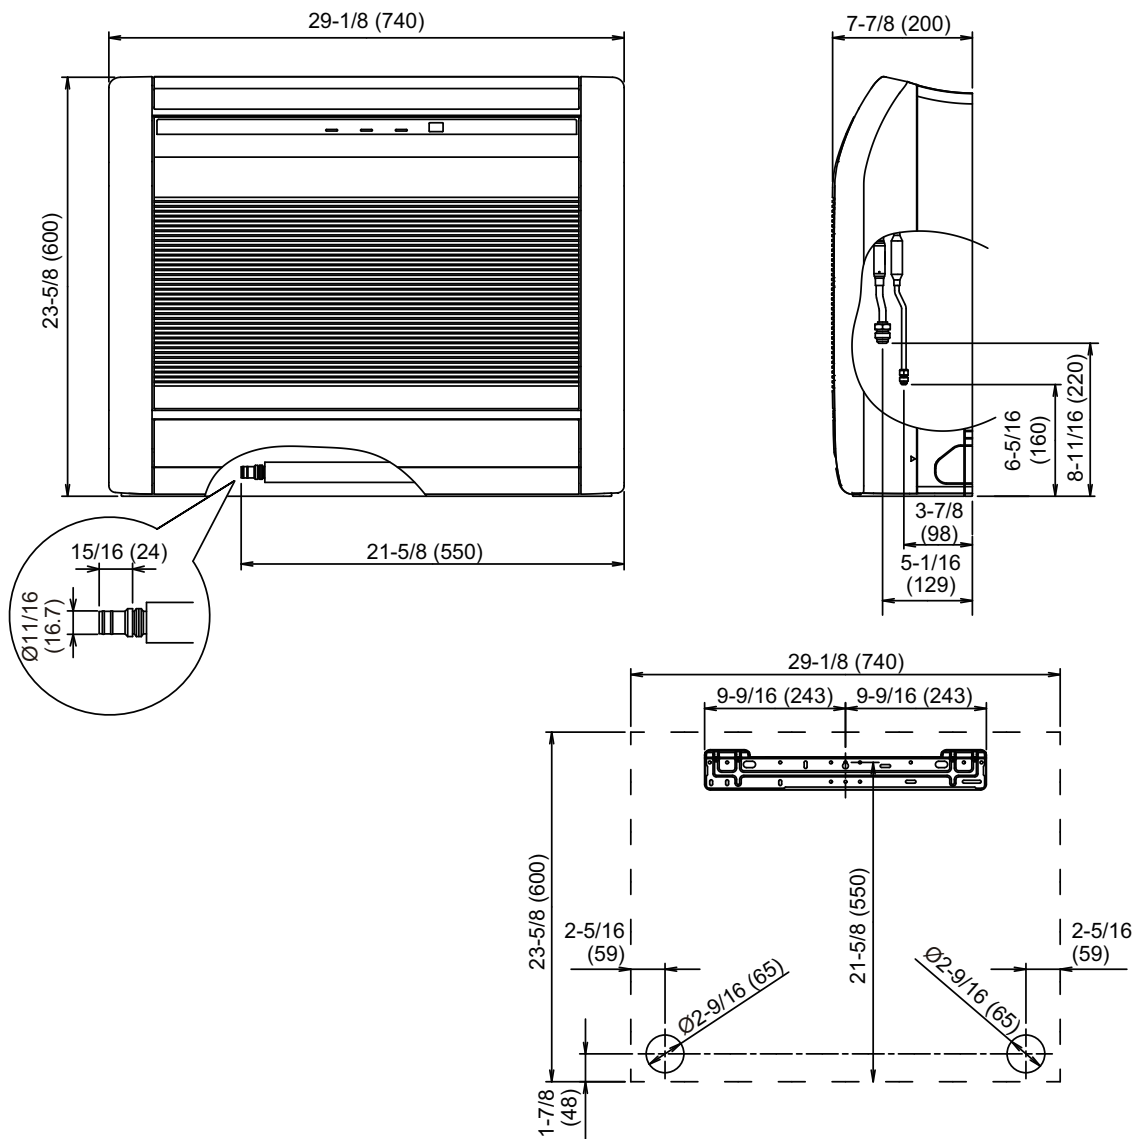

## ■ Installation space requirement



Unit: in (mm)

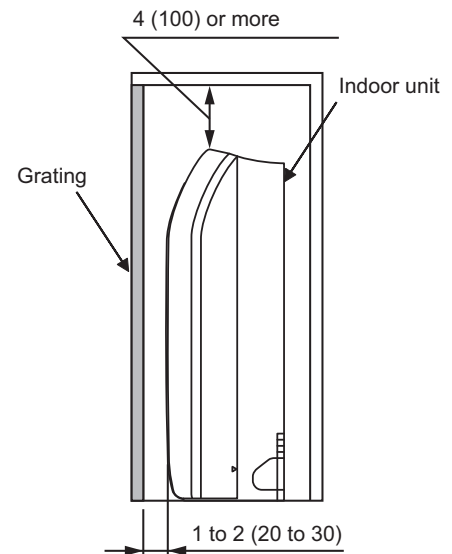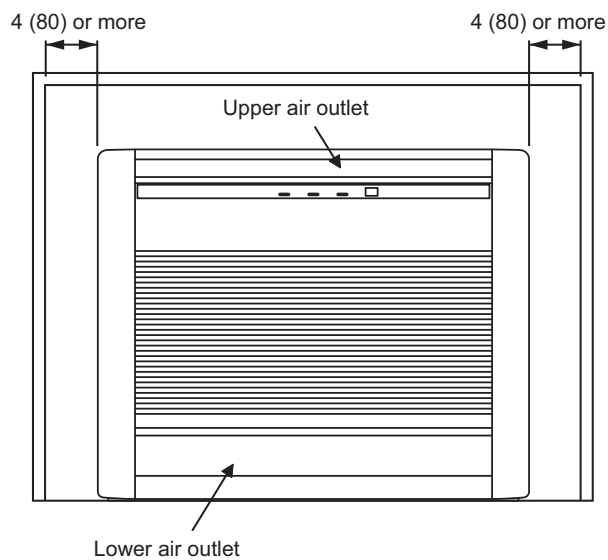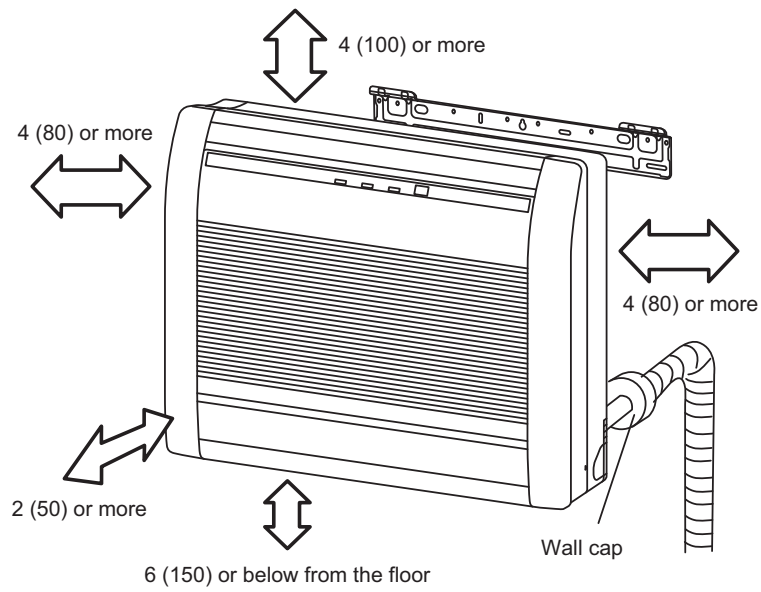

## 4-9. Floor/Ceiling type

### ■ Models: ABUA12TLAV2, ABUA14TLAV2, ABUA18TLAV2, and ABUA24TLAV2





Unit: in (mm)

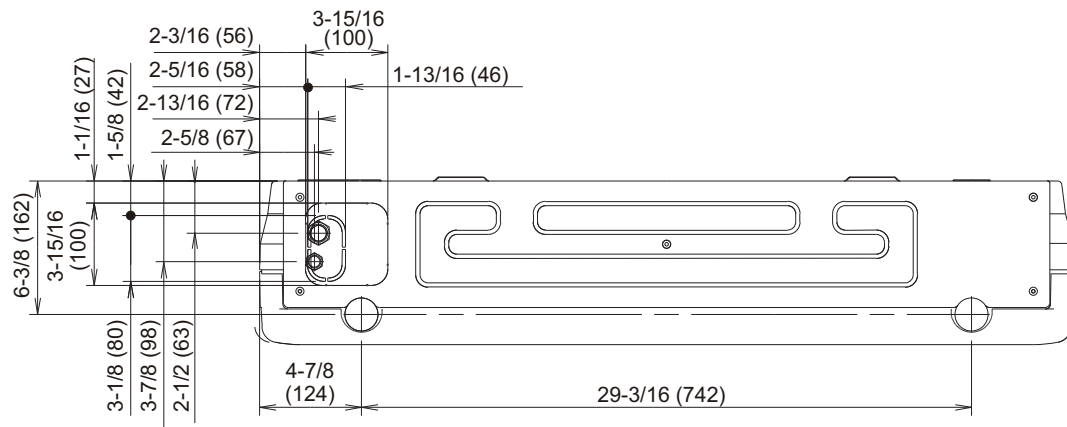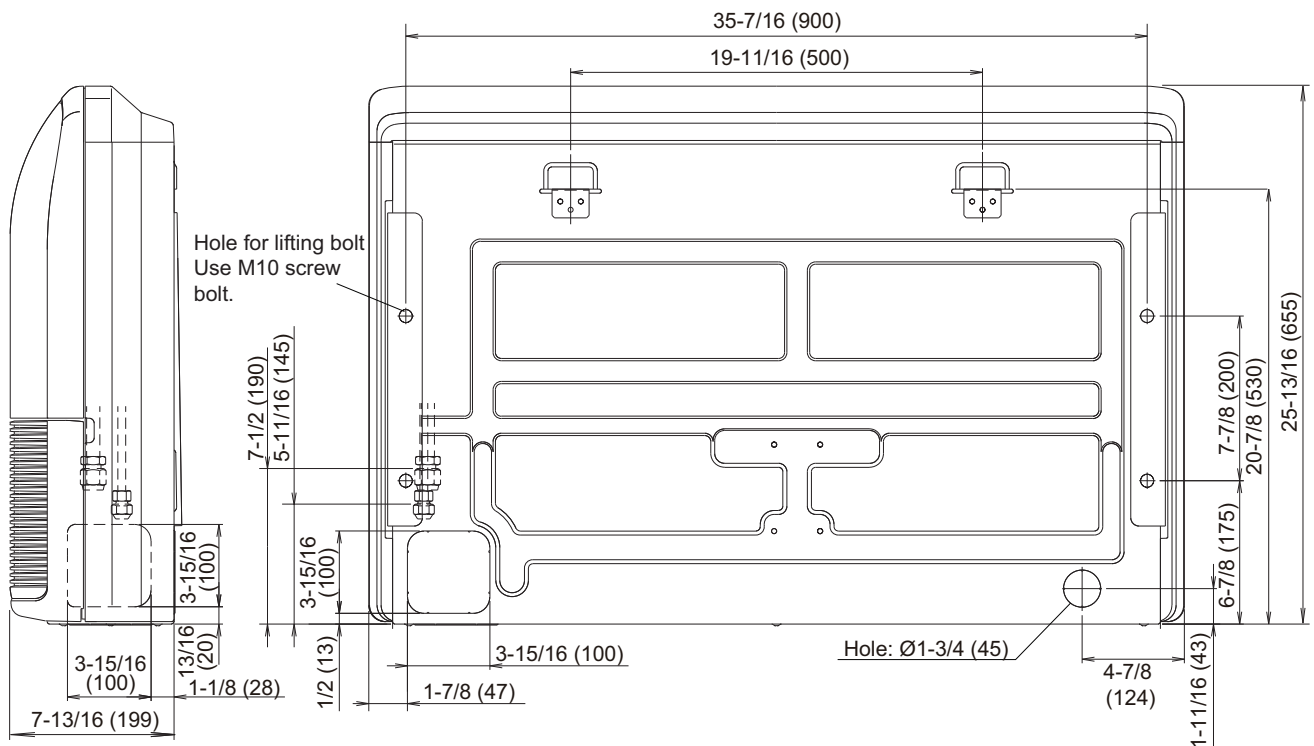



## ■ Installation space requirement


Unit: in (mm)

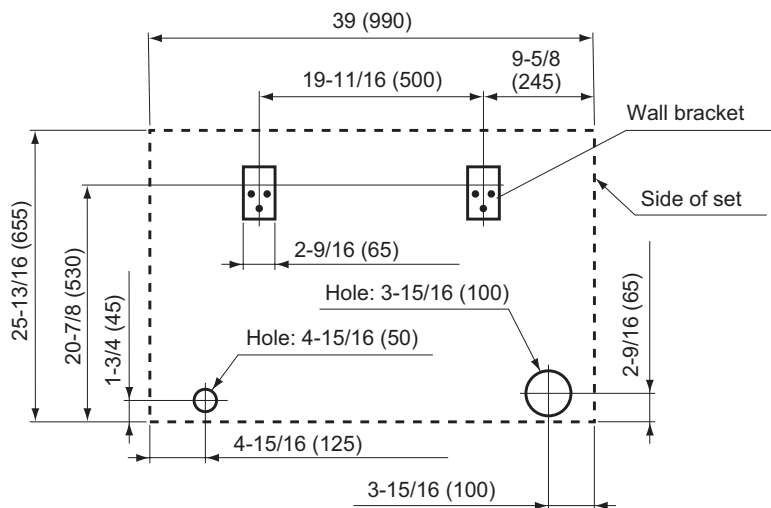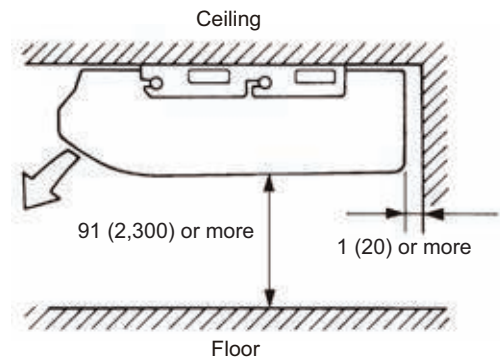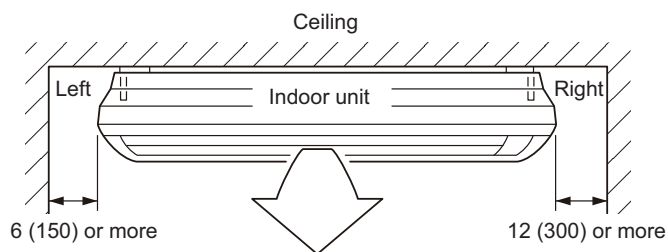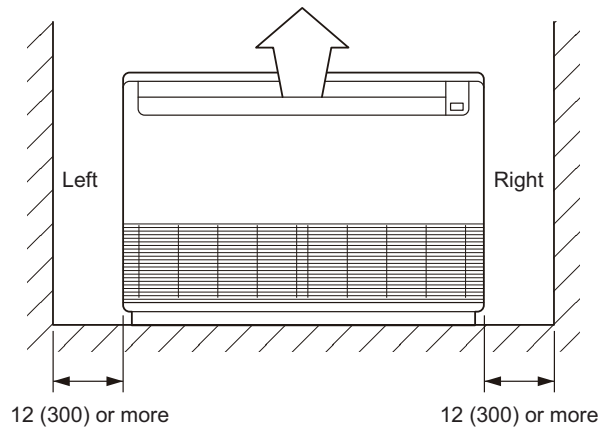




## ■ Installation space requirement

Unit: in (mm)


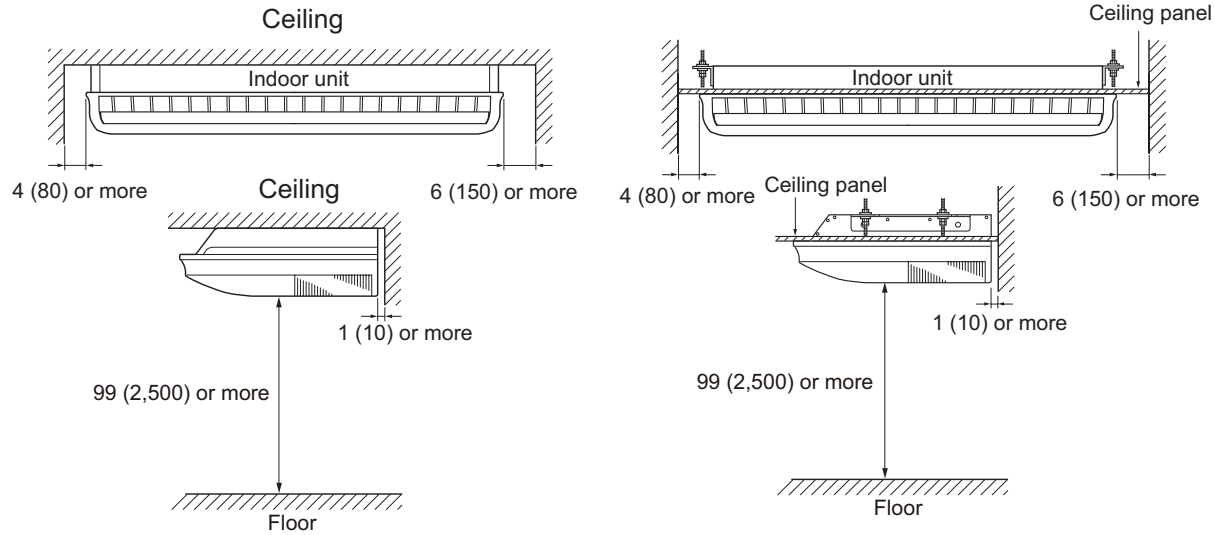


### Dimensions (Space required for Installation)

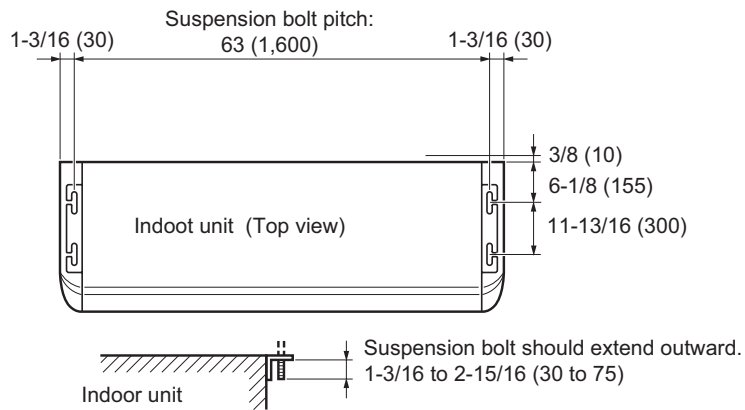





## ■ Installation space requirement

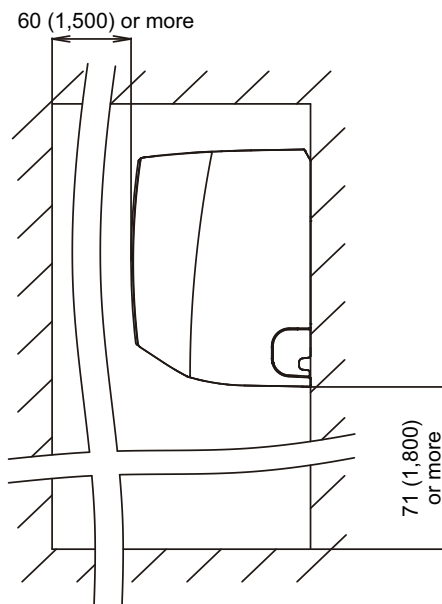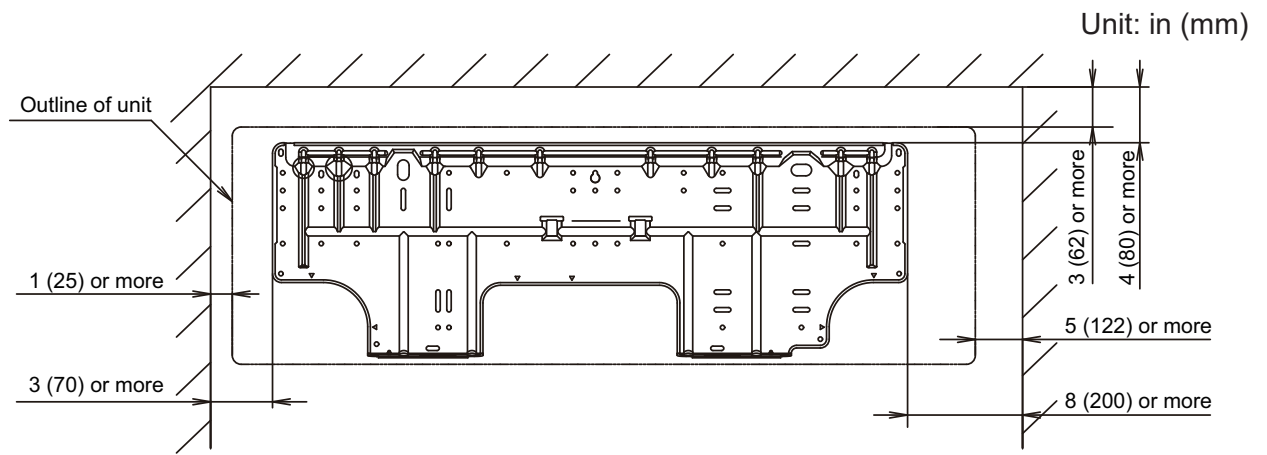



# **Models: ASUB18TLAV1 and ASUB24TLAV1**

Unit: in (mm)

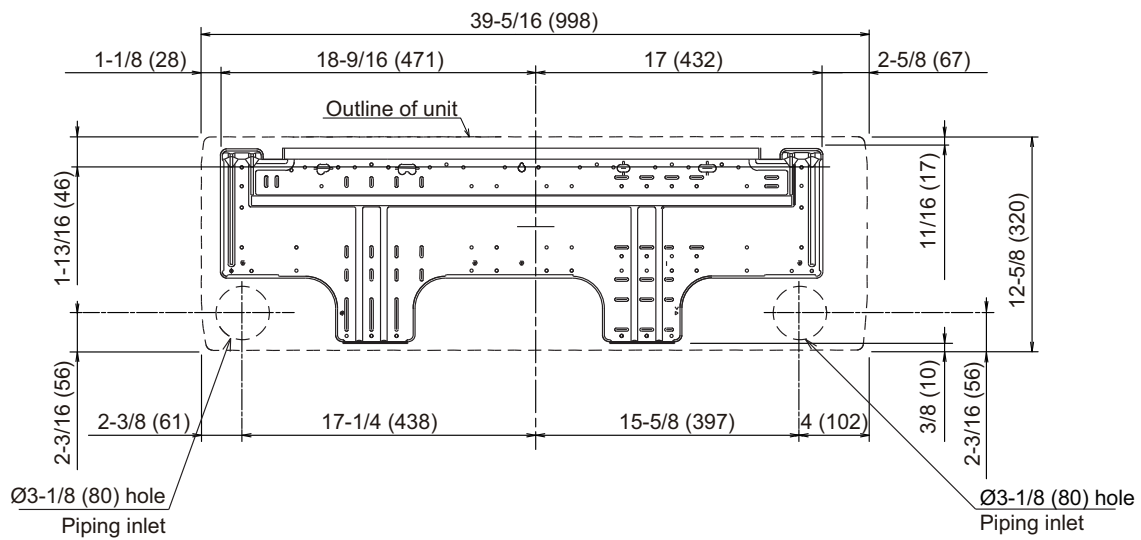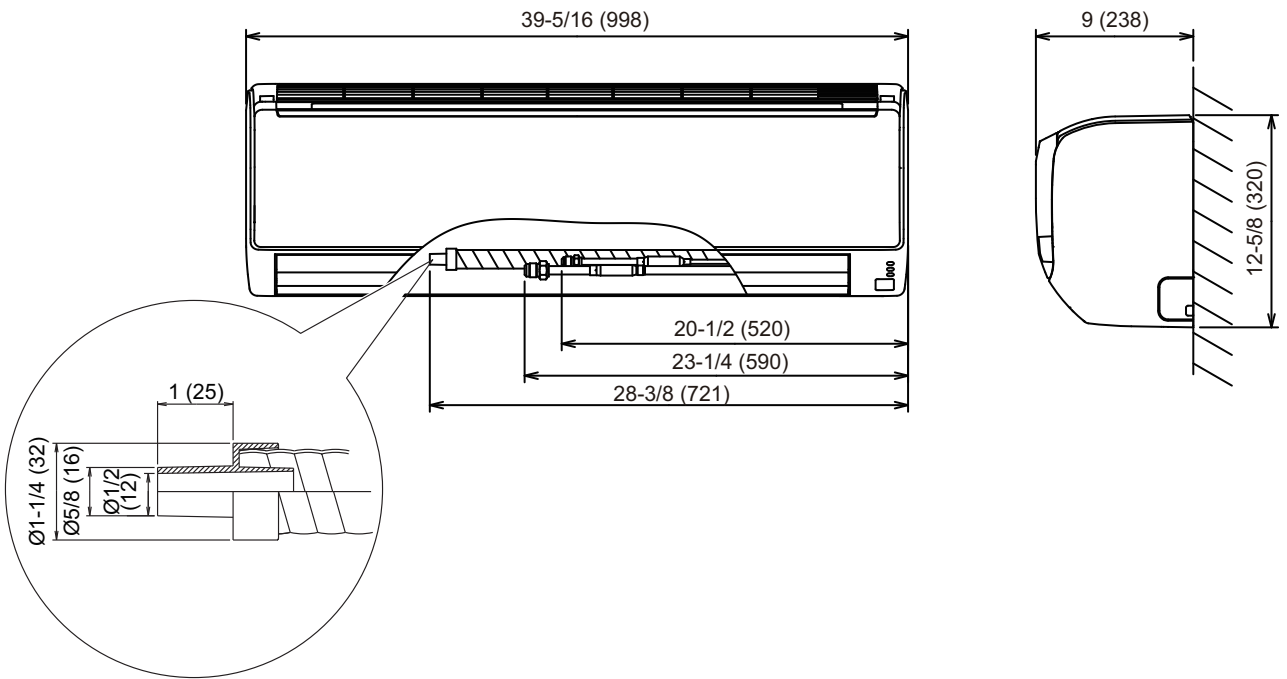

## ■ Installation space requirement

Unit: in (mm)

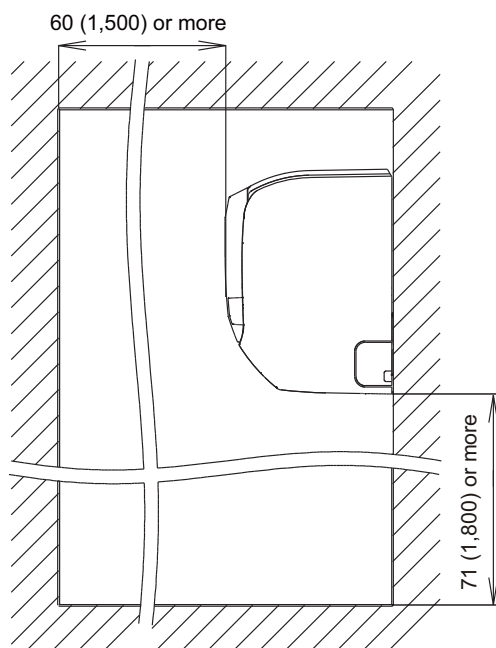
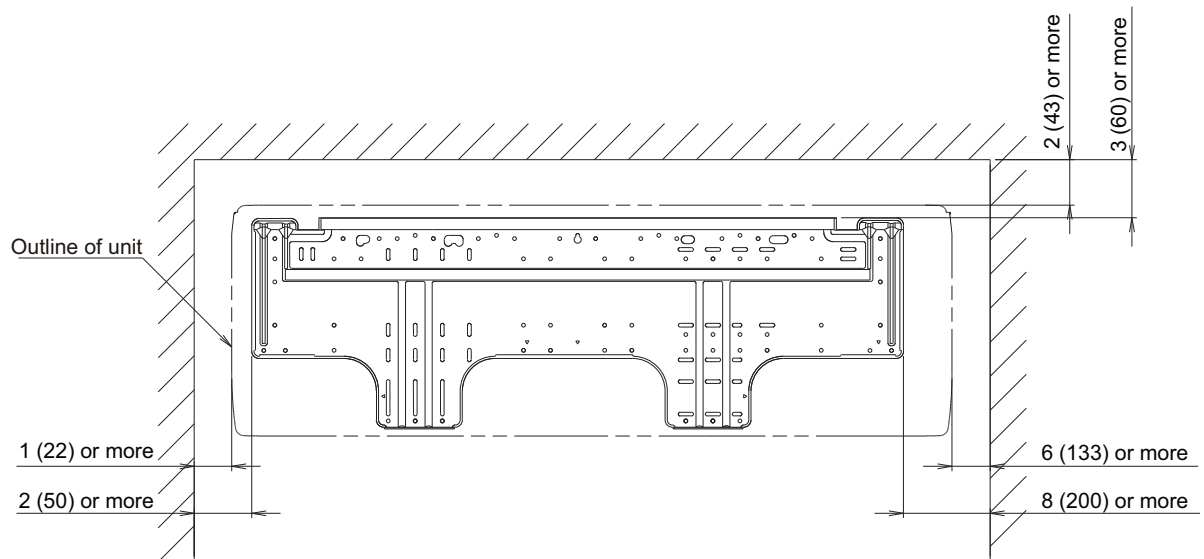


Unit: in (mm)




# **Installation space requirement**

Unit: in (mm)

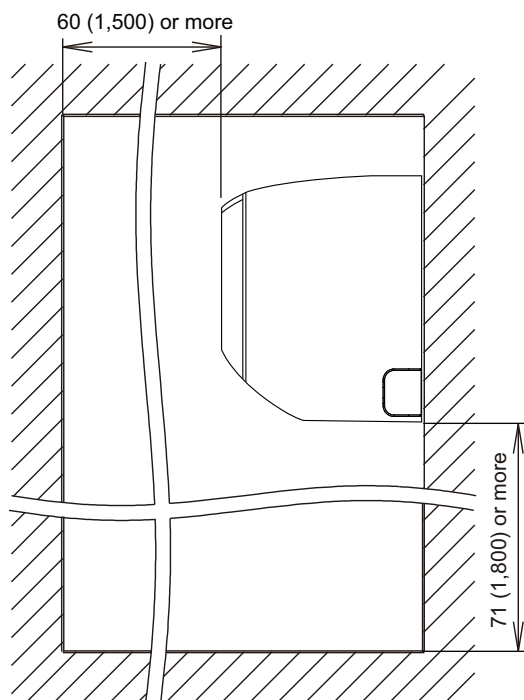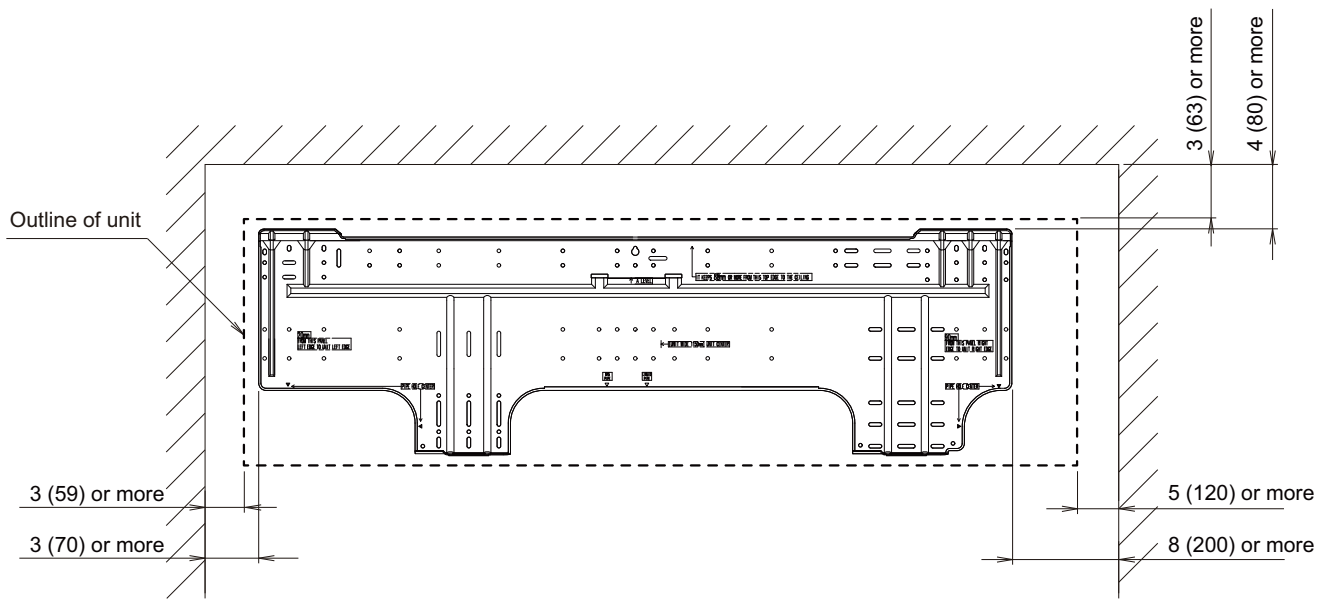INDOOR  
UNITSINDOOR  
UNITS



# ■ Models: ASUA7TLAV, ASUA9TLAV, ASUA12TLAV , and ASUA14TLAV

Unit: in (mm)

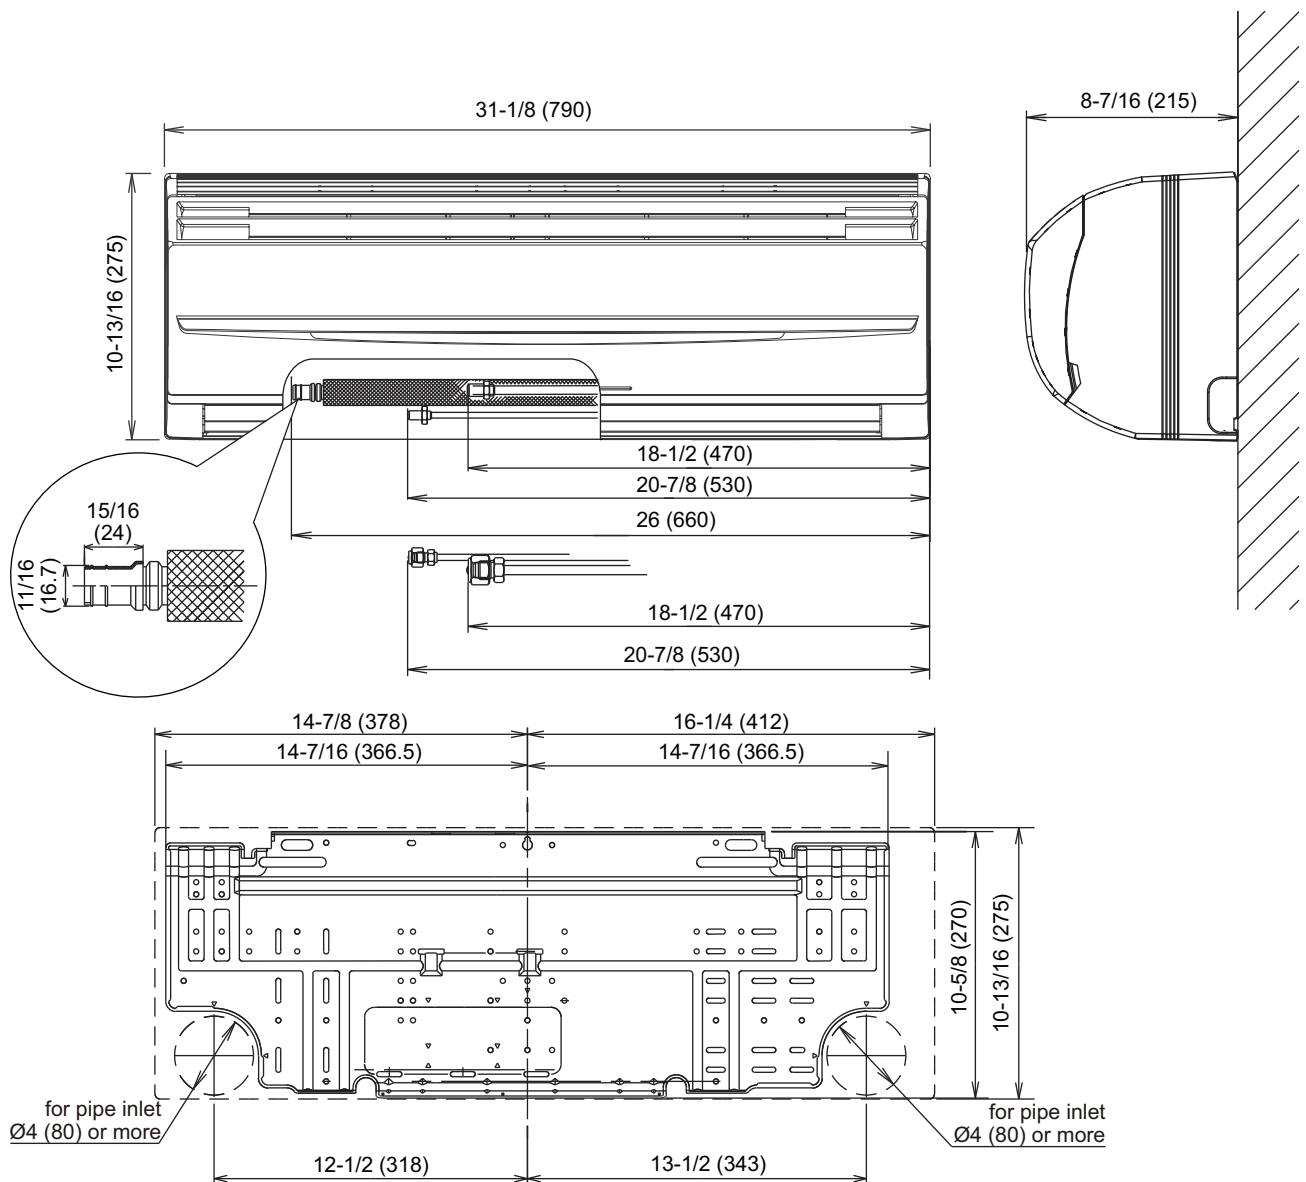


# **Installation space requirement**

Unit: in (mm)

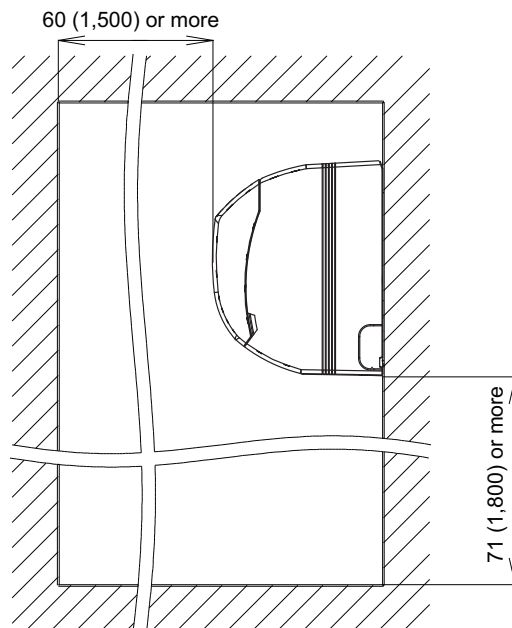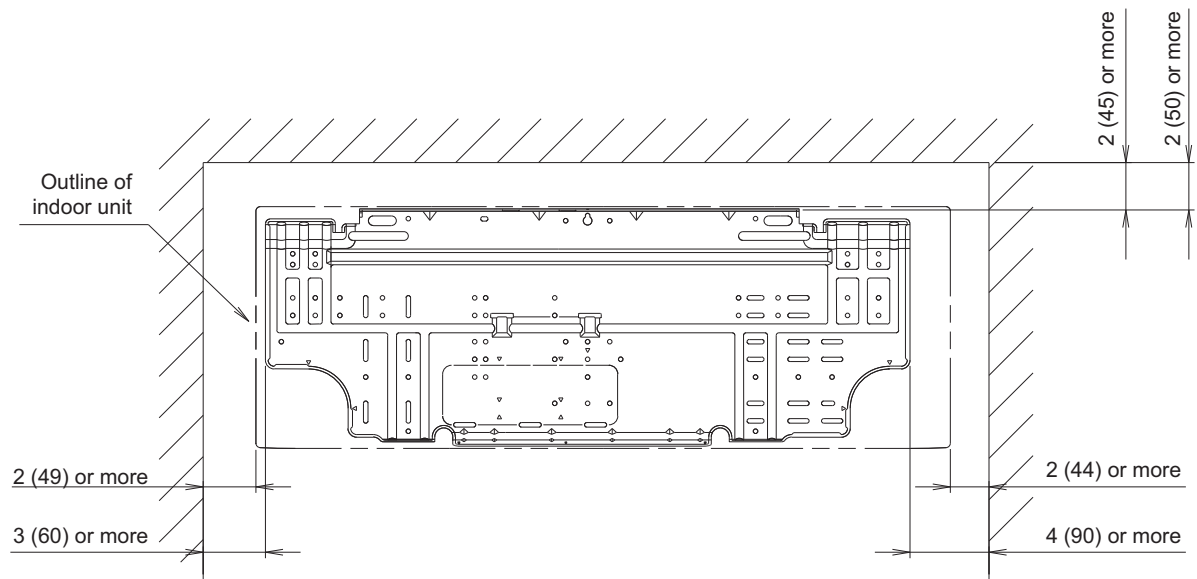

# Models: ASUB18TLAV and ASUB24TLAV

Unit: in (mm)


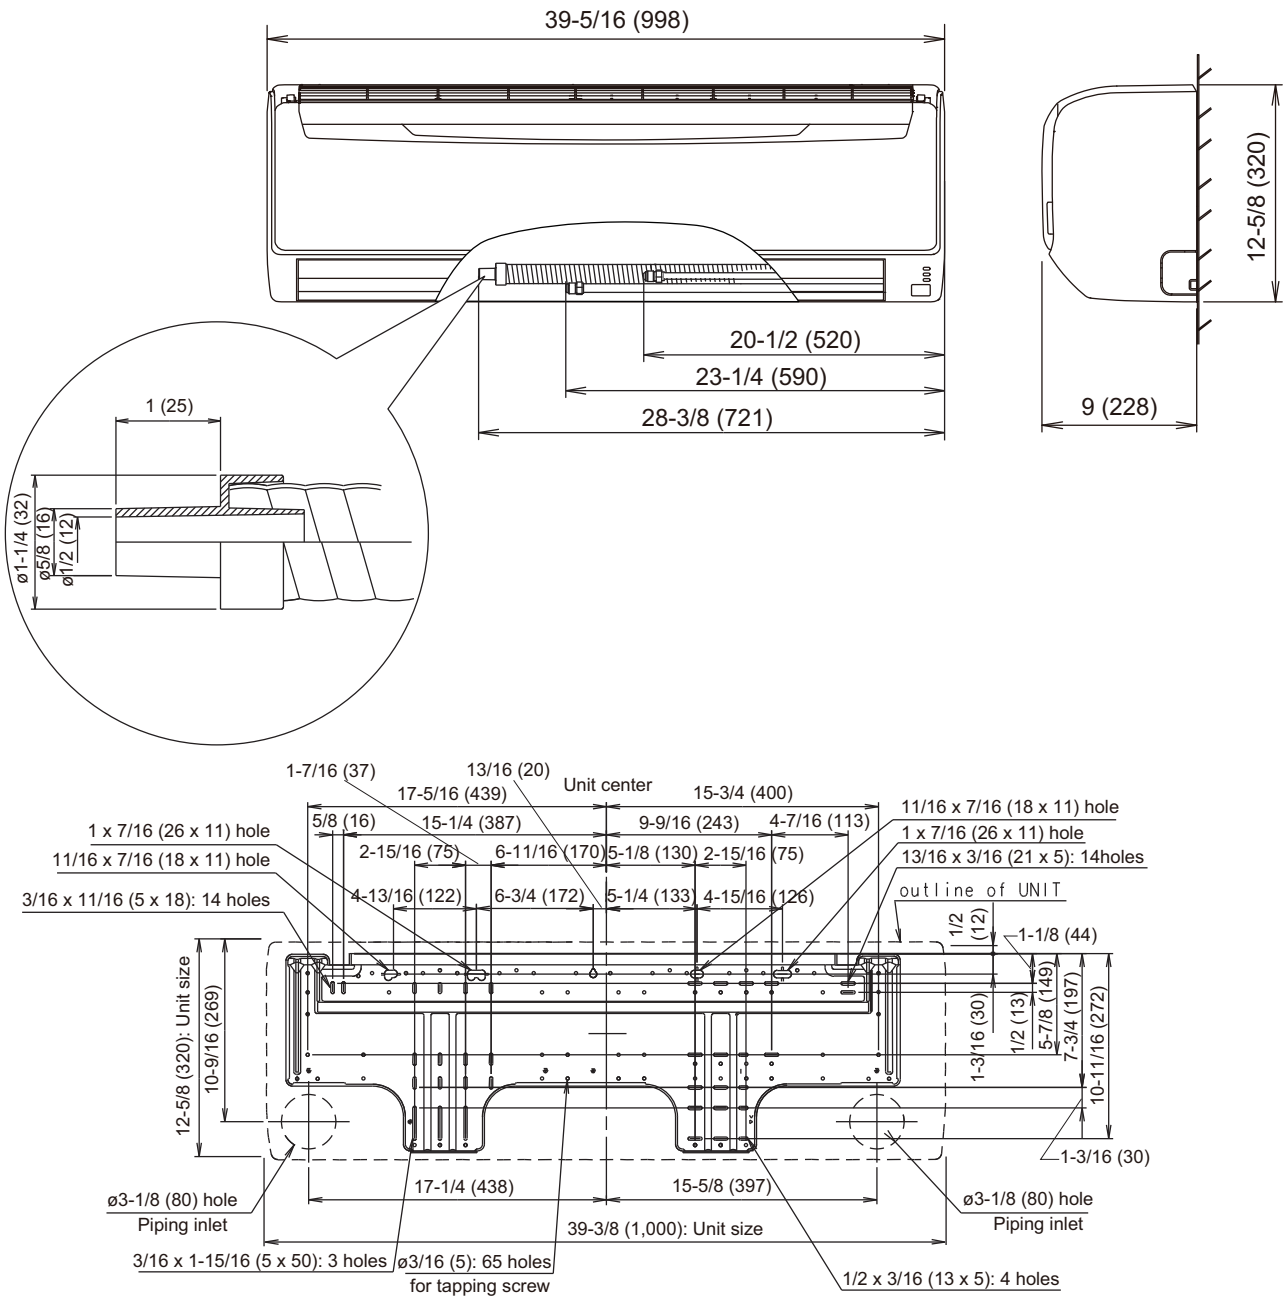


## ■ Installation space requirement

Provide sufficient installation space for product safety.

### ⚠ CAUTION


Do not place any other electrical products or household belongings under the product. Condensation dripping from the product might get them wet, and may cause damage or malfunction to the property.

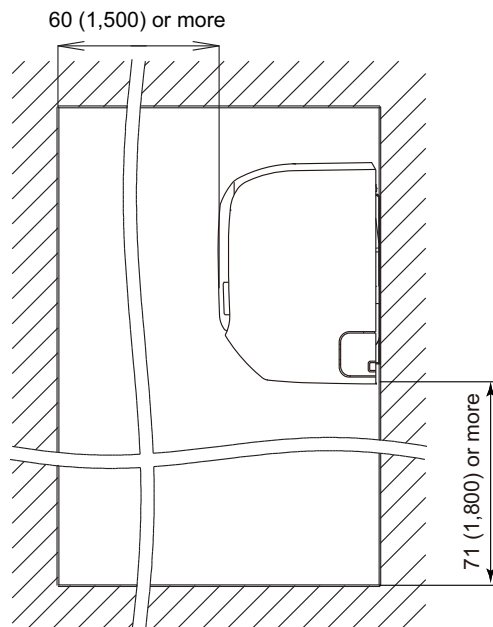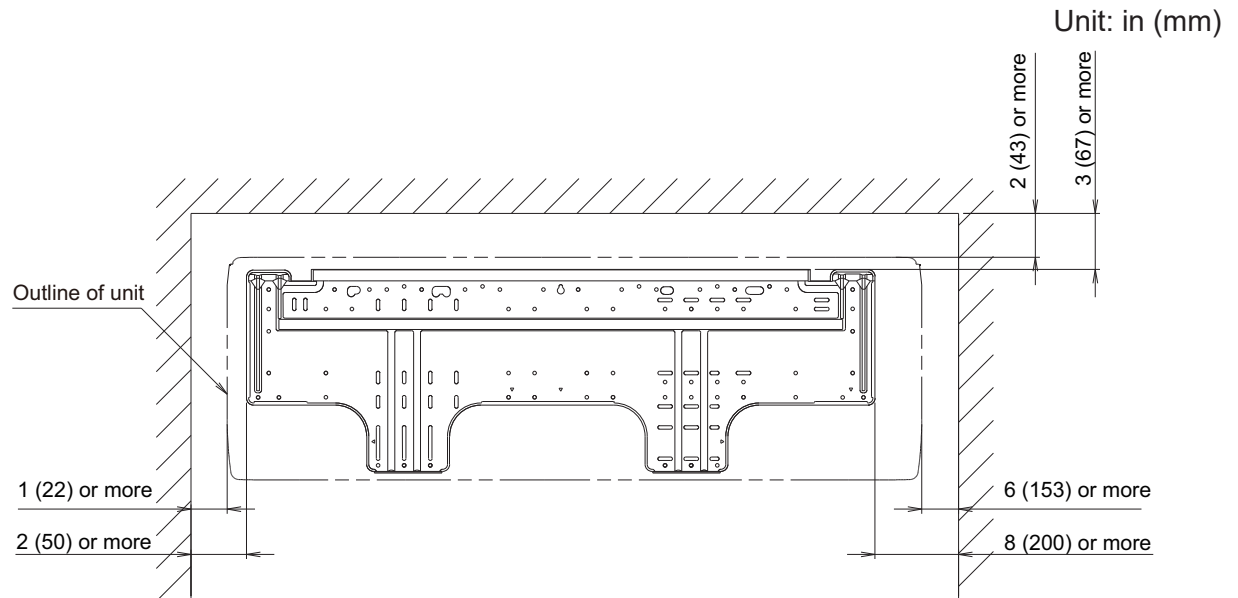

## 5. Wiring diagrams


### 5-1. Compact cassette type

- Models: AUUA4TLAV2, AUUA7TLAV2, AUUA9TLAV2, AUUA12TLAV2, AUUA14TLAV2, AUUA18TLAV2, and AUUA24TLAV2

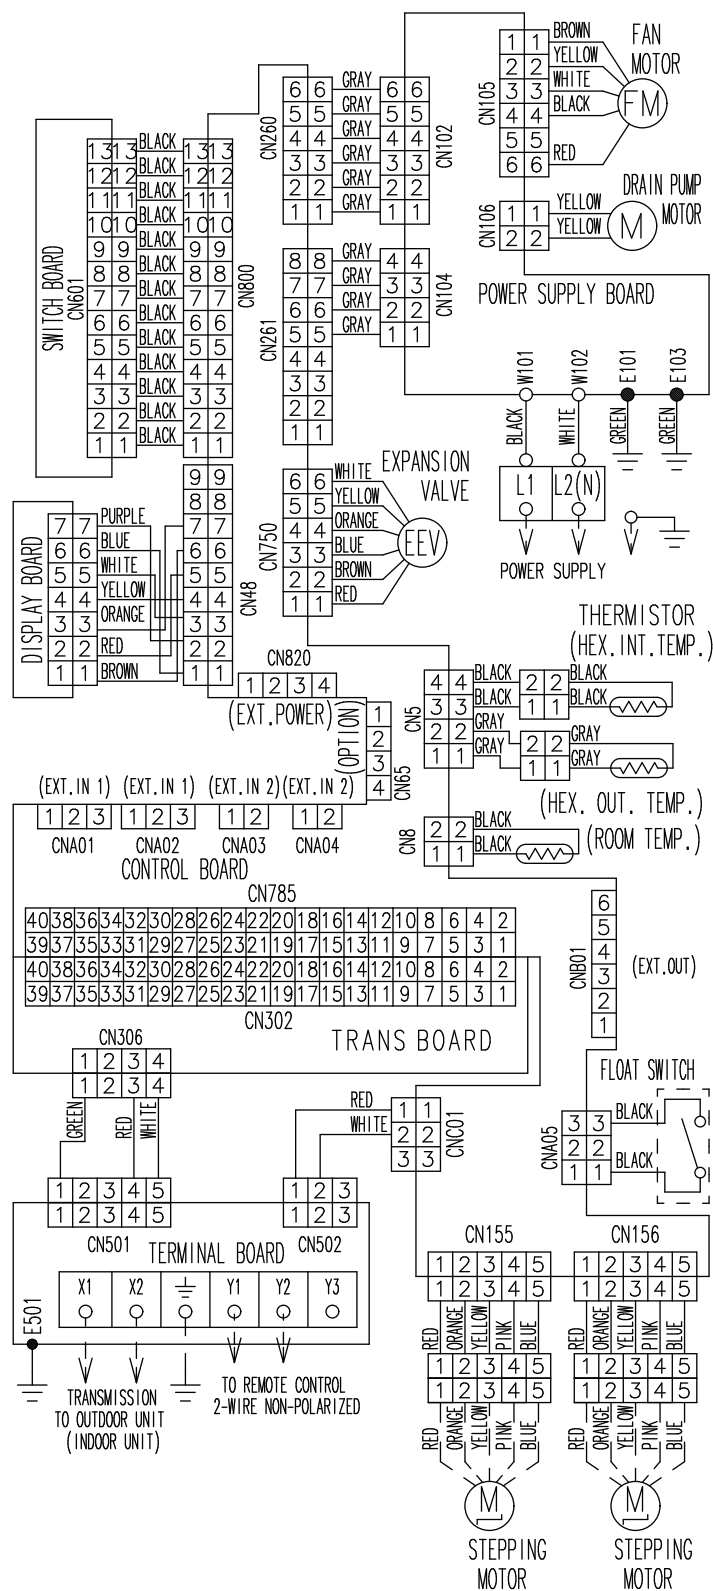


## 5-2. 4-way flow cassette type

### ■ Models: AUUB18TLAV, AUUB24TLAV, AUUB30TLAV and AUUB36TLAV

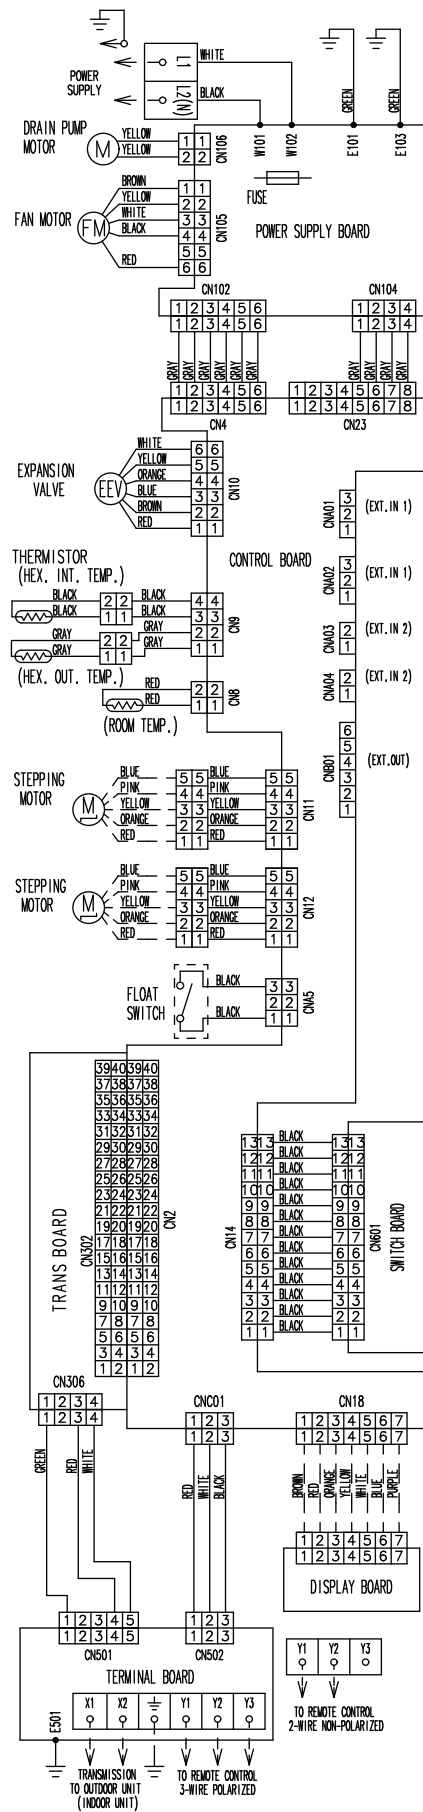

## 5-3. Circular flow cassette type


### ■ Models: AUUB18TLAV2, AUUB24TLAV2, AUUB30TLAV2, AUUB36TLAV2, and AUUB48TLAV2

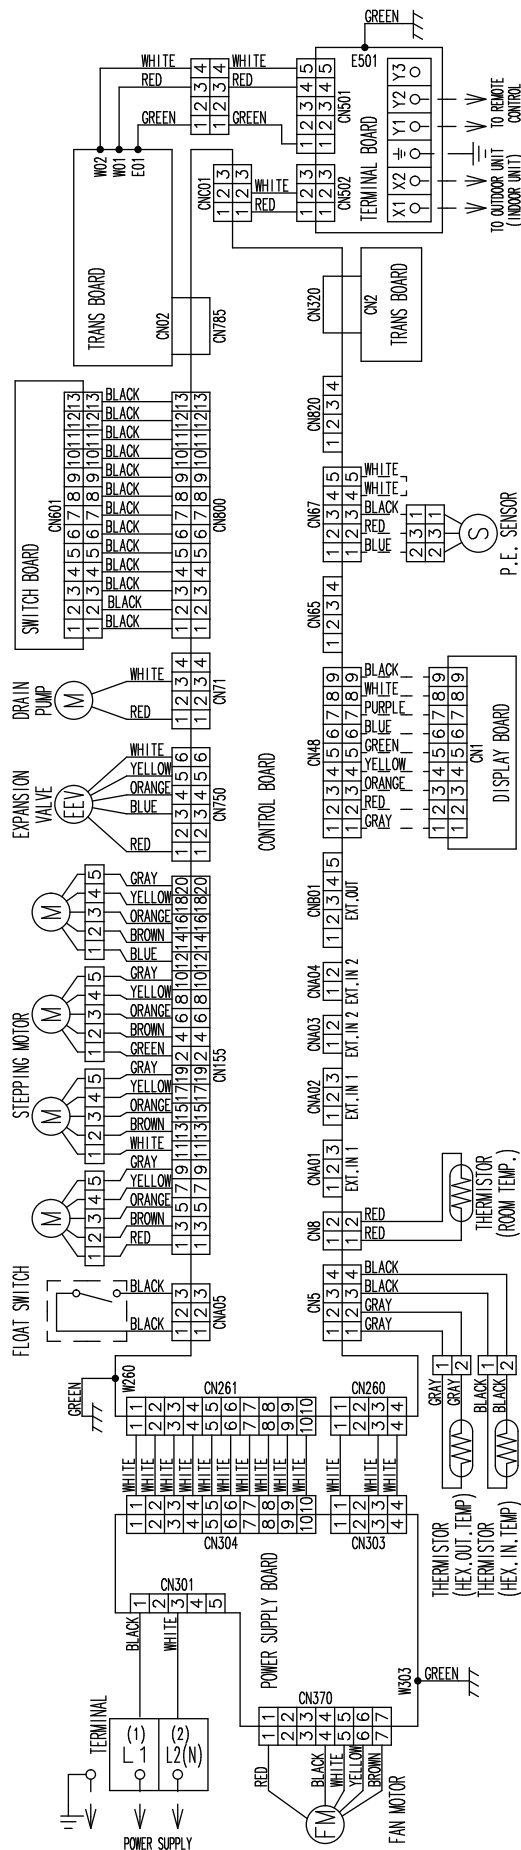




## 5-4. Mini duct type

### ■ Model: ARUL4TLAV2

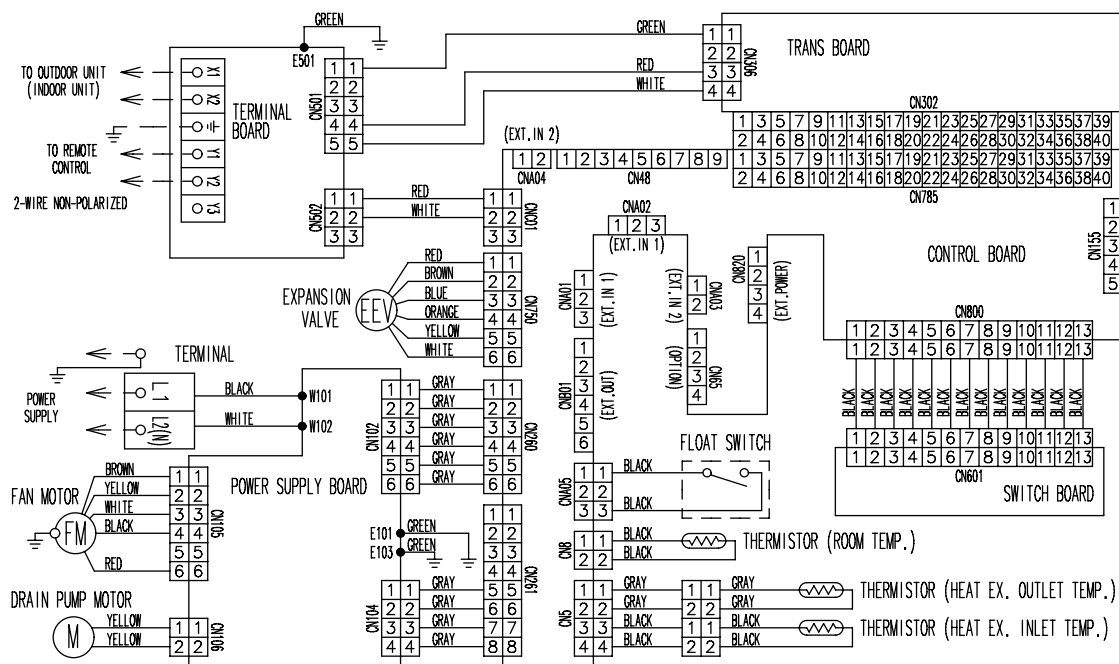


## 5-5. Slim duct/Slim concealed floor type

### Models: ARUL7TLAV2, ARUL9TLAV2, ARUL12TLAV2, ARUL14TLAV2, and ARUL18TLAV2

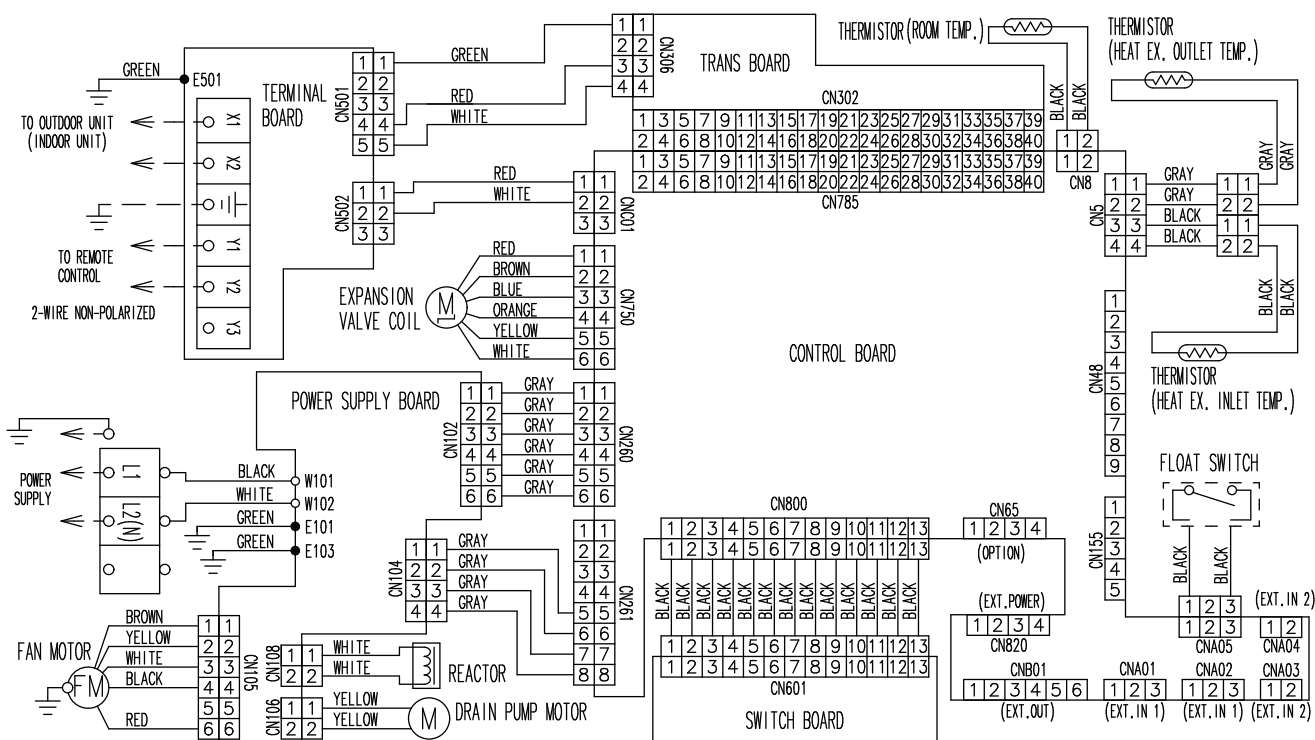


## 5-6. Medium static pressure duct type

### Models: ARUM24TLAV2, ARUM30TLAV2, and ARUM36TLAV2

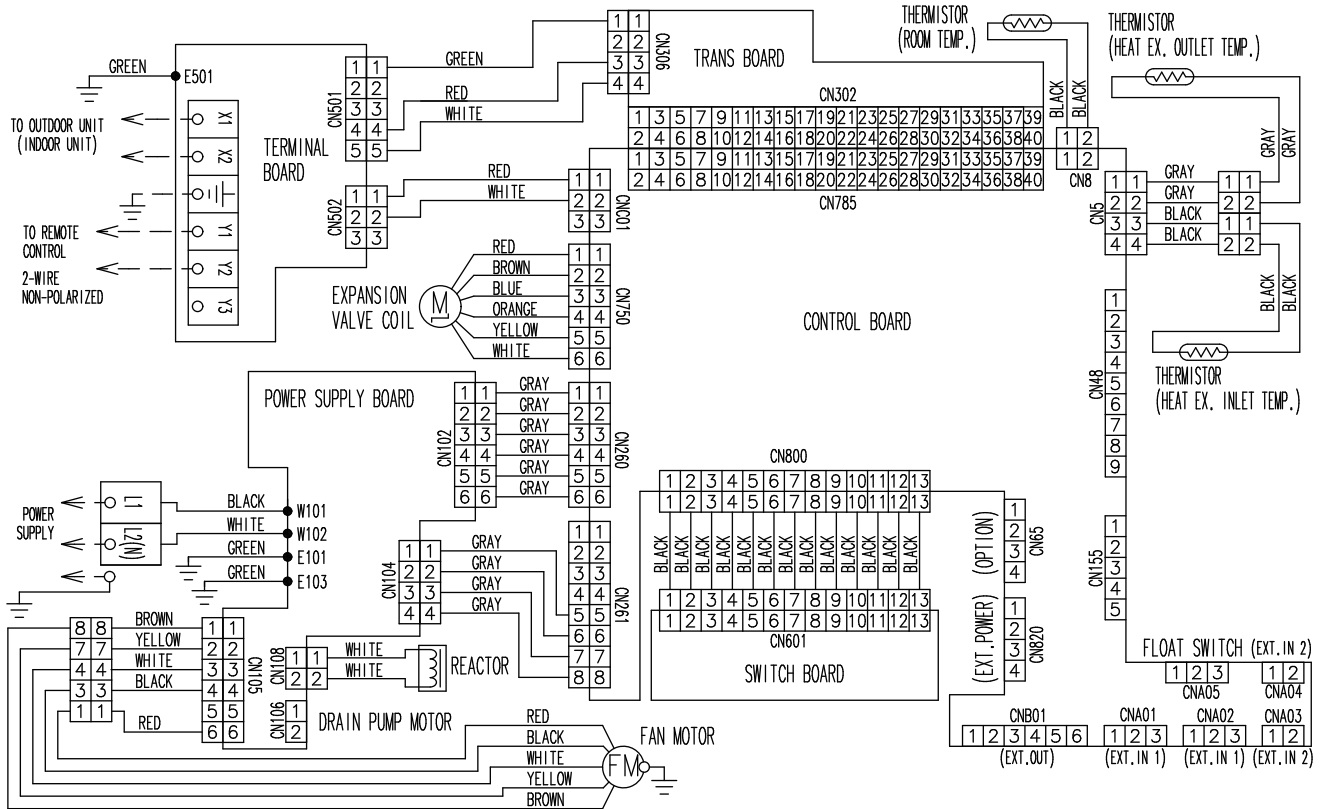


## 5-7. High static pressure duct type

### ■ Models: ARUH36TLAV, ARUH48TLAV, and ARUH60TLAV

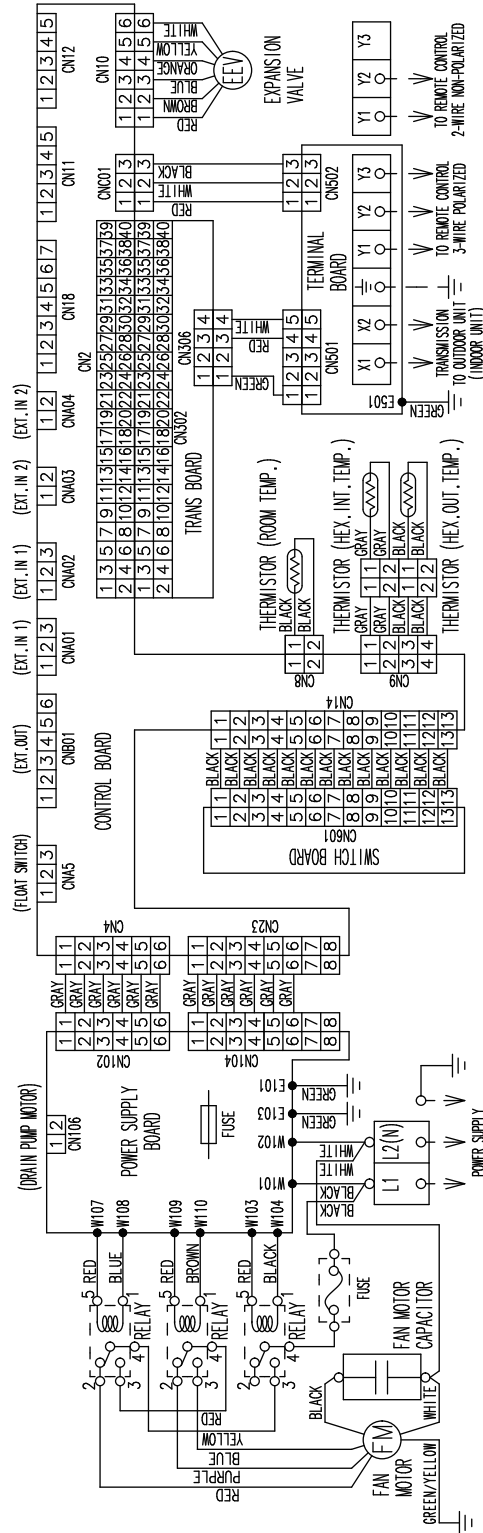


# Models: ARUH72TLAV2 and ARUH96TLAV2

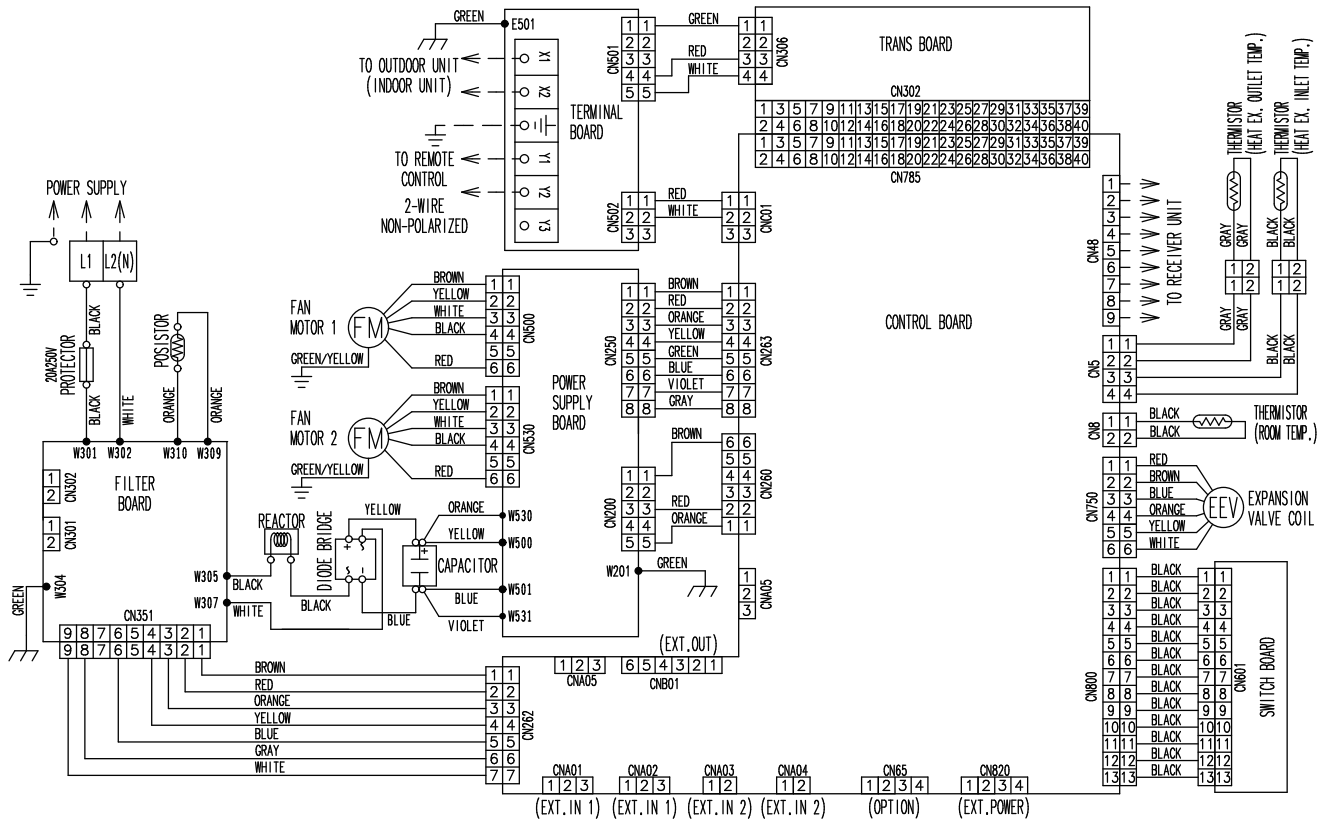


## INDOOR UNITS

■ Models: AGUA4TLAV2, AGUA7TLAV2, AGUA9TLAV2, AGUA12TLAV2, and AGUA14TLAV2

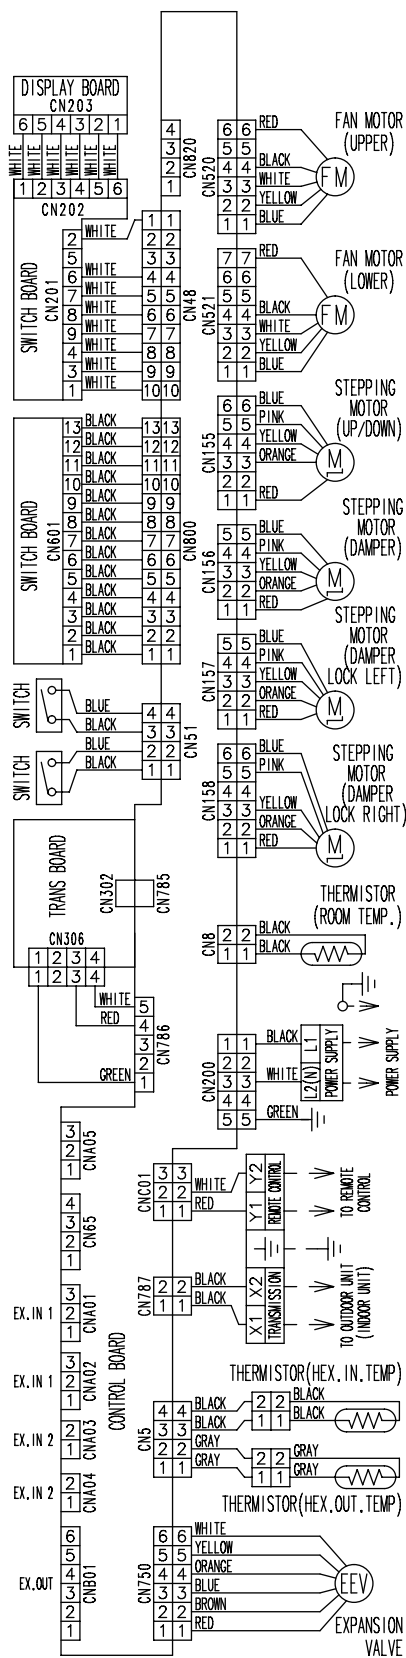


## 5-9. Floor/Ceiling type

### ■ Models: ABUA12TLAV2, ABUA14TLAV2, ABUA18TLAV2, and ABUA24TLAV2

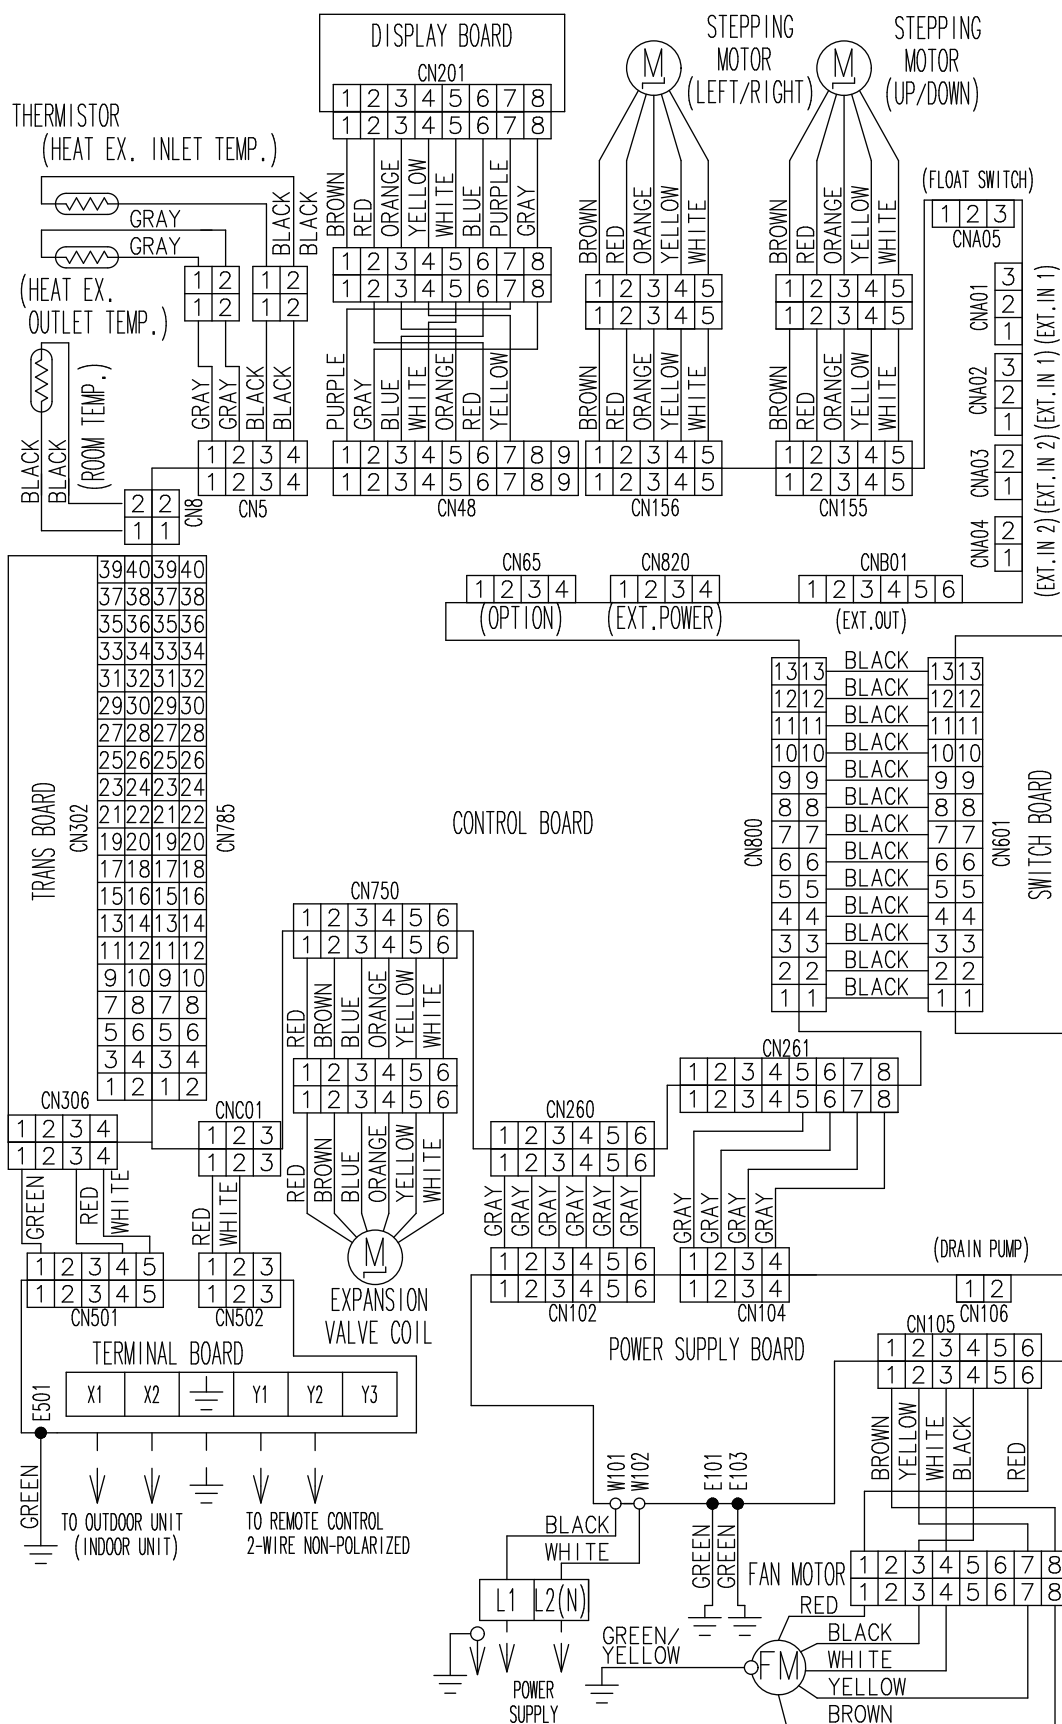

## 5-10. Ceiling type


### Models: ABUA30TLAV2 and ABUA36TLAV2

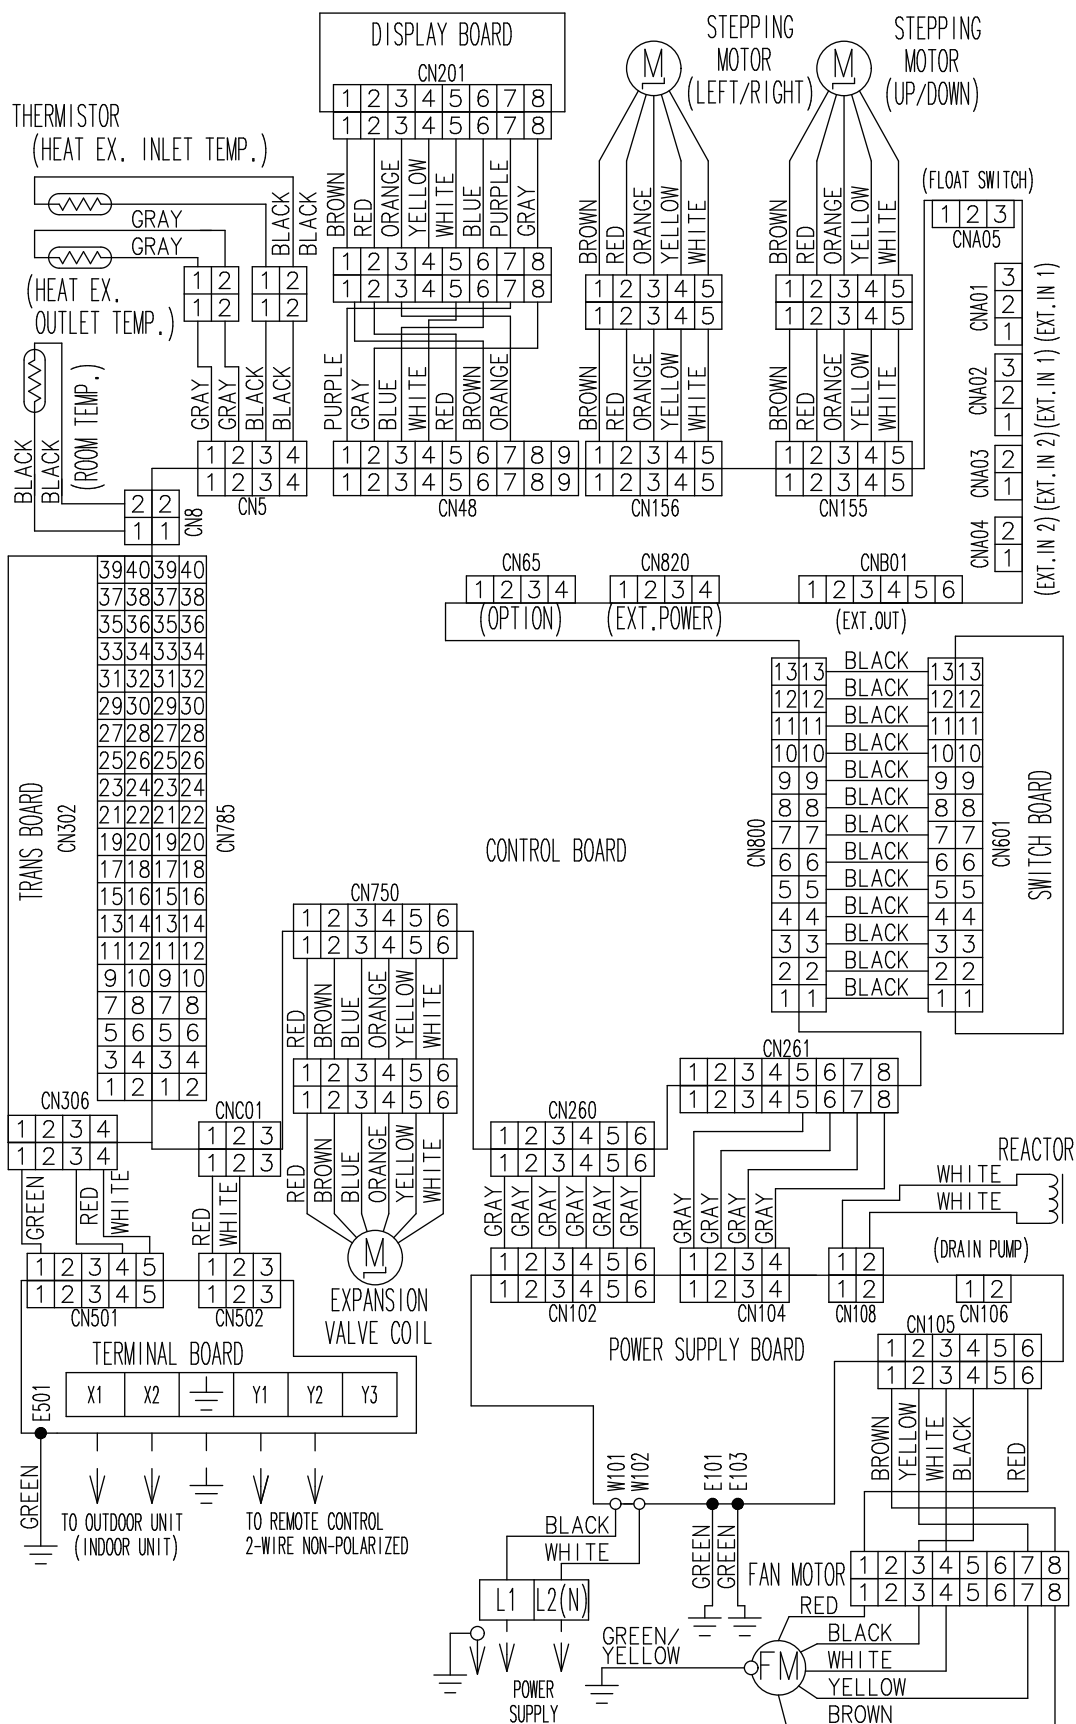INDOOR  
UNITSINDOOR  
UNITS



## INDOOR UNITS


■ **Models: ASUA4TLAV2, ASUA7TLAV2, ASUA9TLAV2, ASUA12TLAV2, and ASUA14TLAV2**

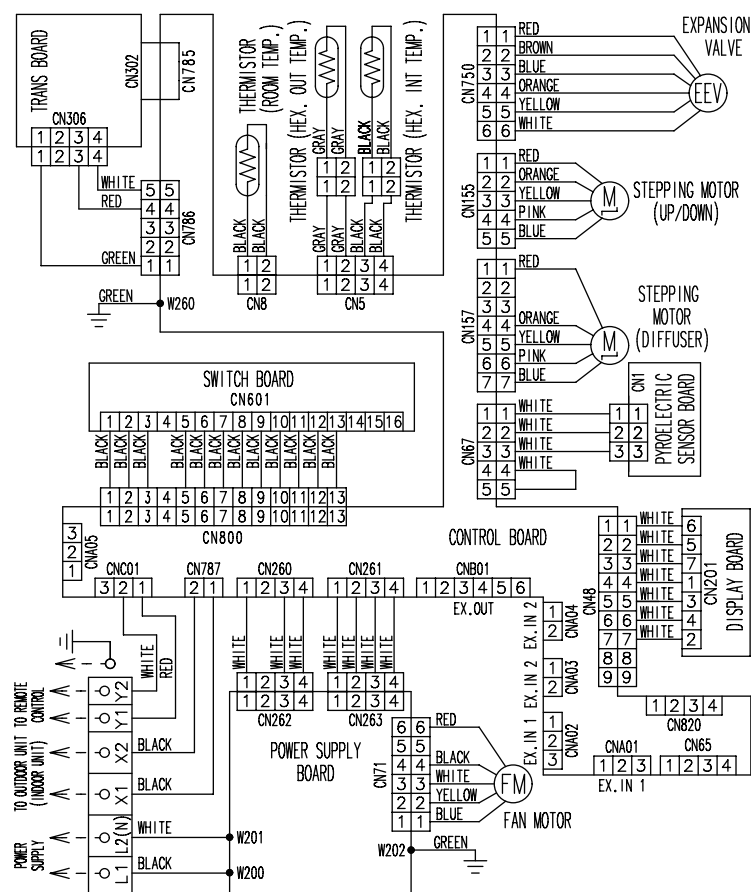

## INDOOR UNITS




# Models: ASUA30TLAV2 and ASUA36TLAV2

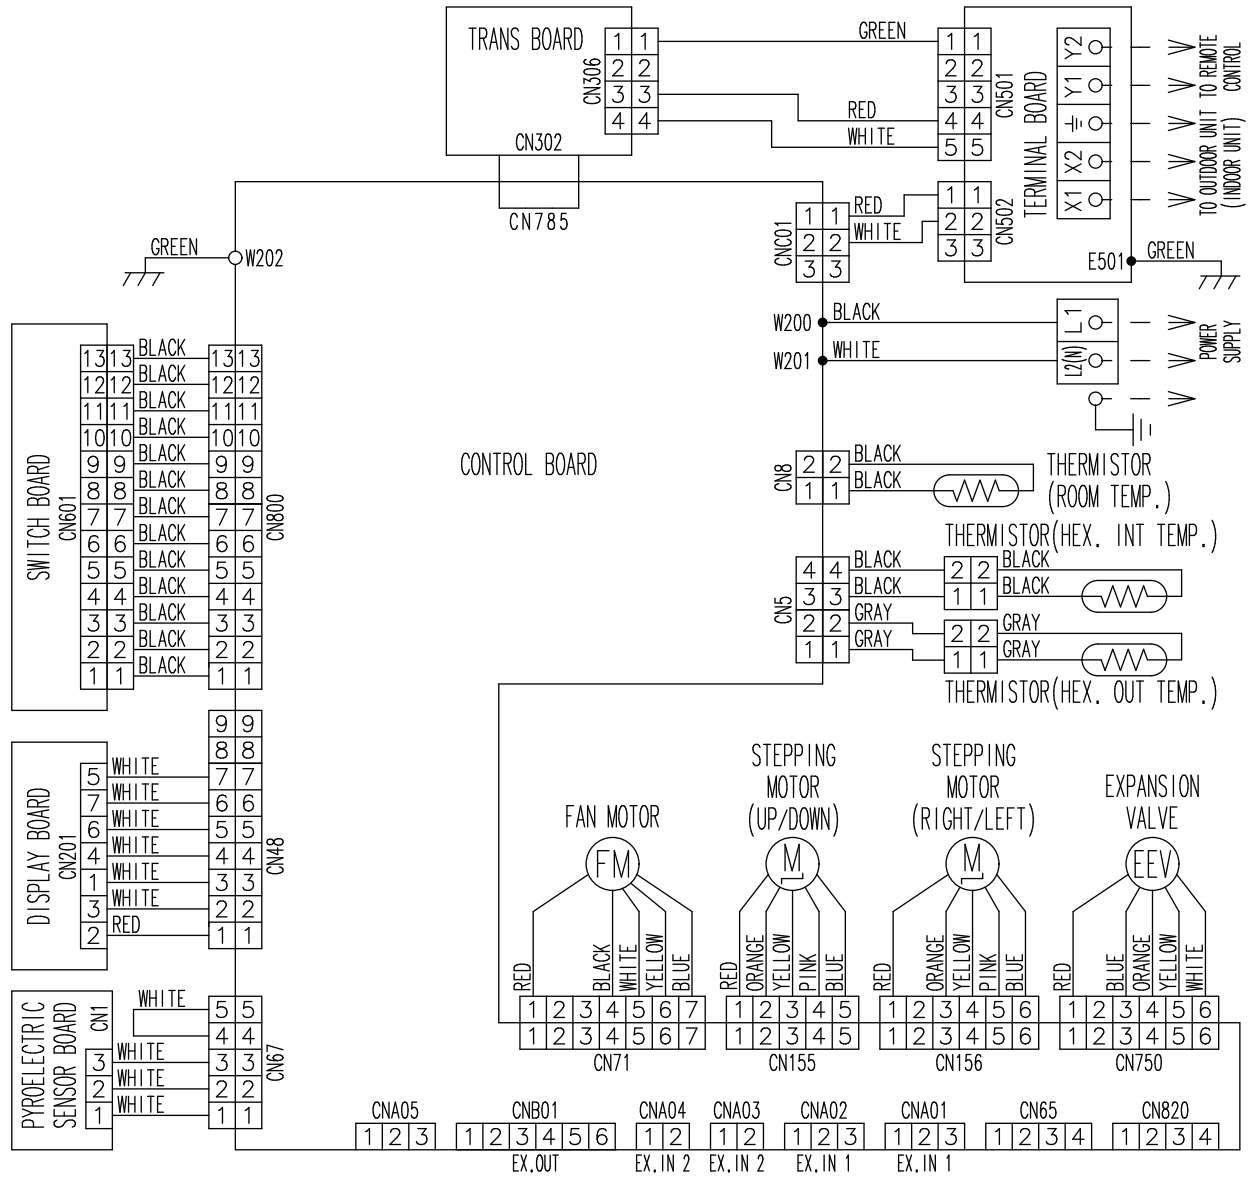

INDOOR UNITS

# ■ Models: ASUA7TLAV, ASUA9TLAV, ASUA12TLAV , and ASUA14TLAV

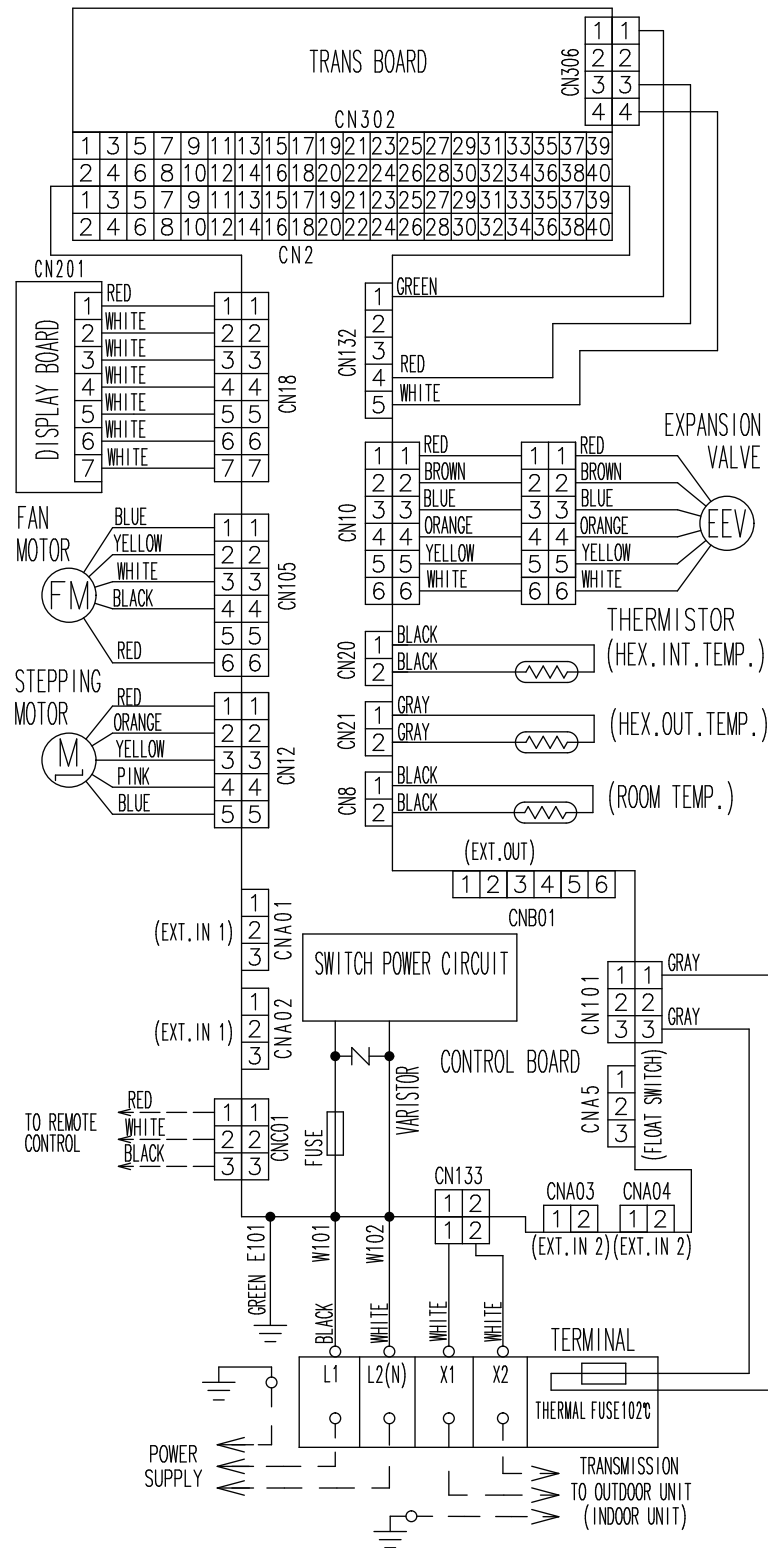INDOOR  
UNITSINDOOR  
UNITS


## 6. Air velocity and temperature distributions

### 6-1. Compact cassette type

#### ■ Model: AUUA4TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

#### • Air velocity distribution

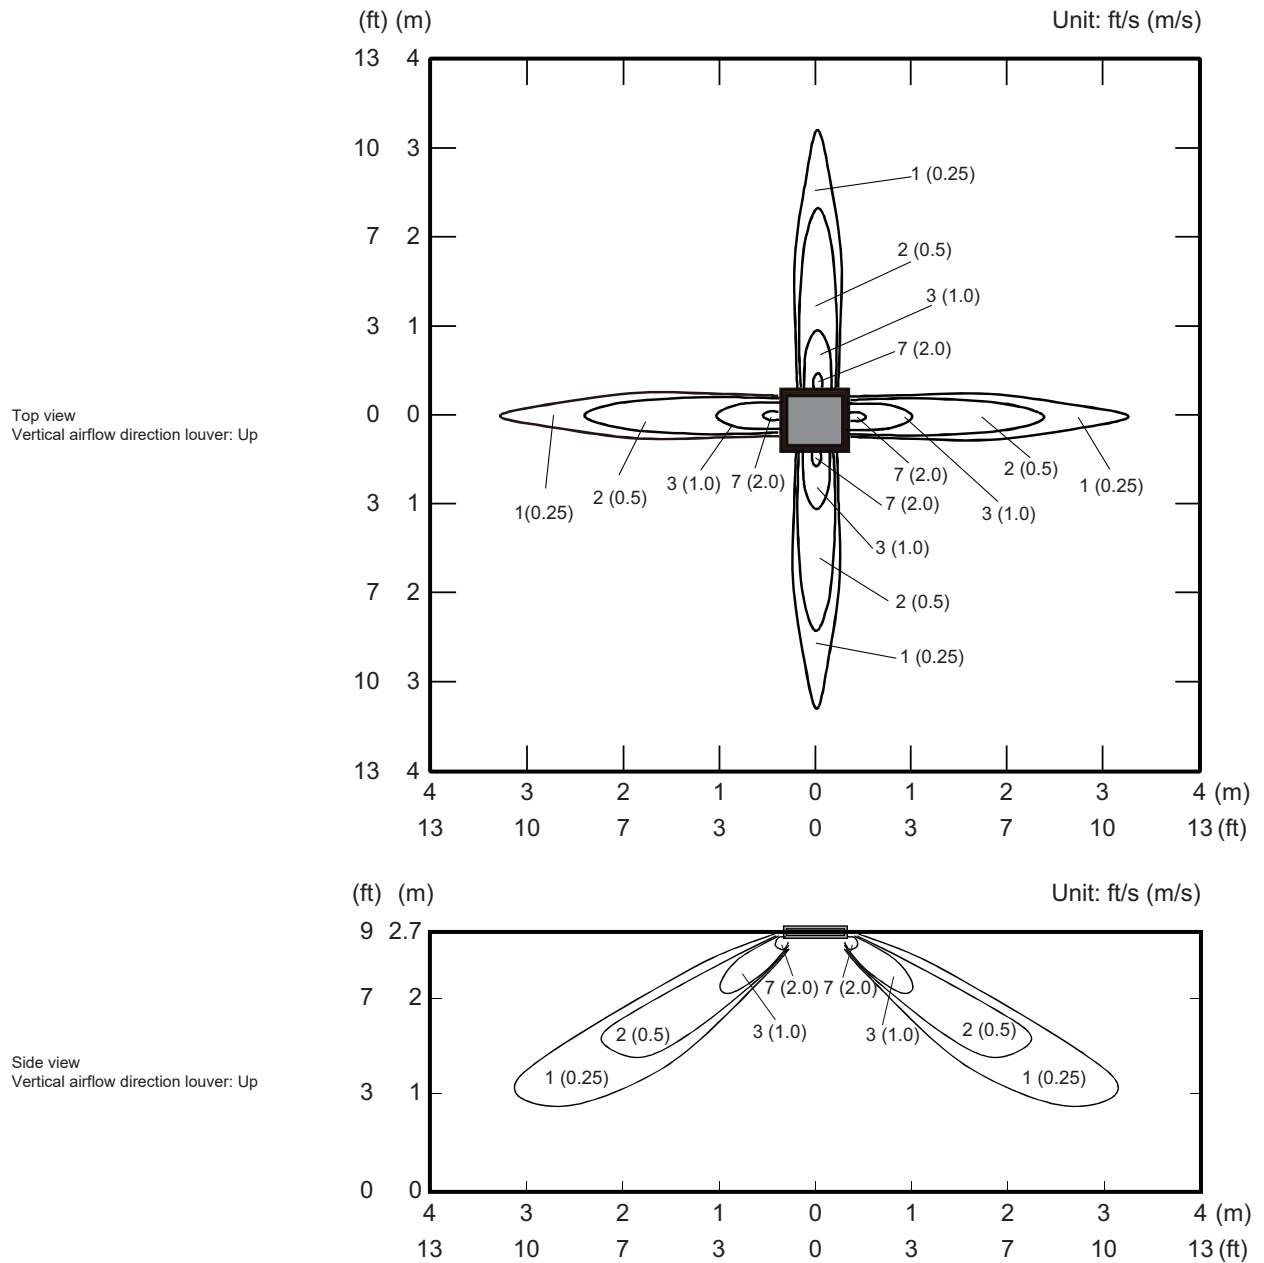


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

• Air velocity distribution

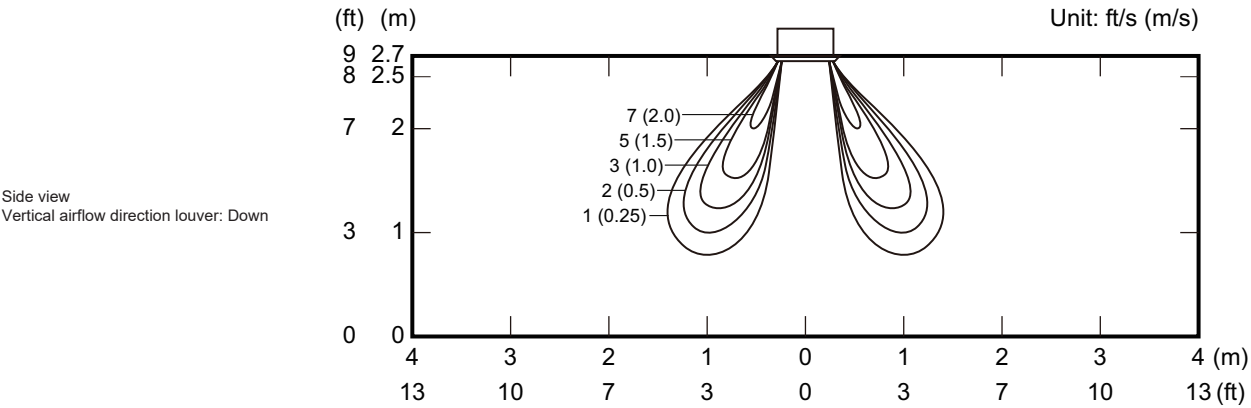

• Air temperature distribution

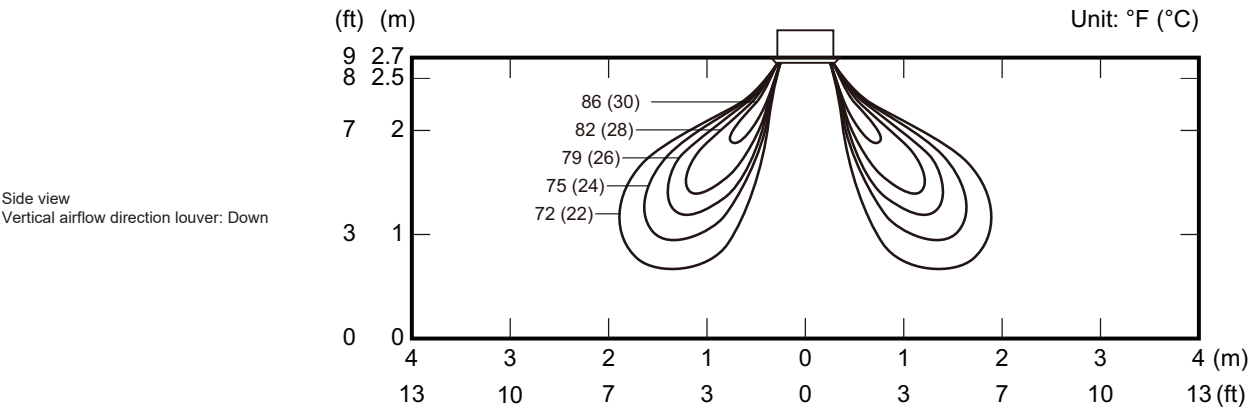


# Model: AUUA7TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## • Air velocity distribution

Top view  
Vertical airflow direction louver: Up

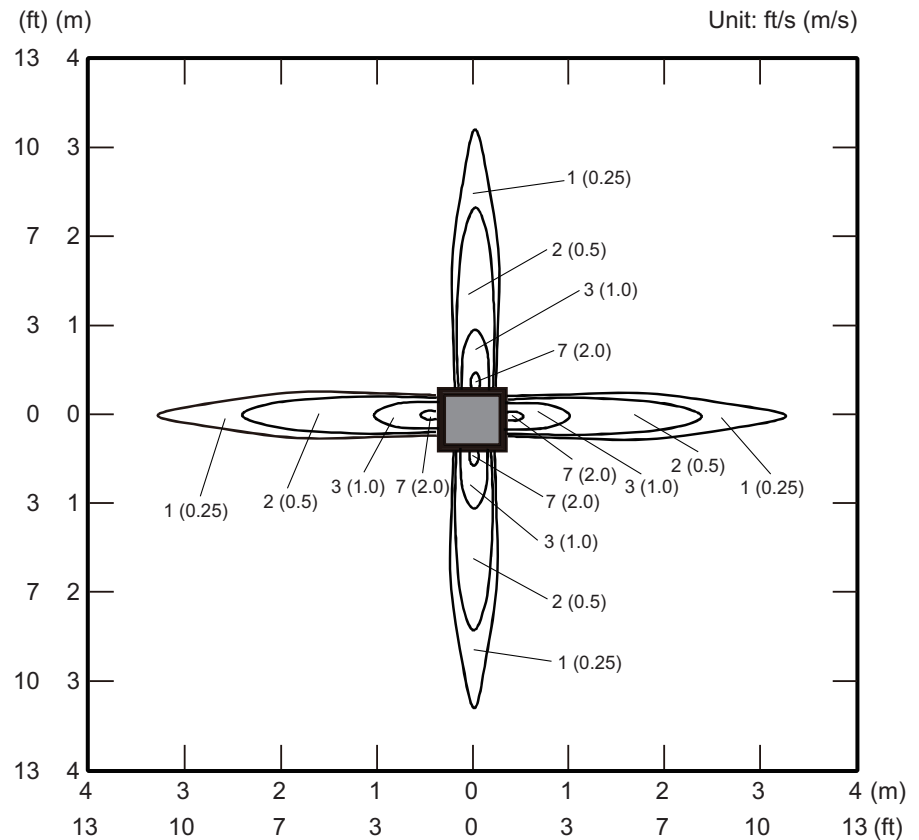


Side view  
Vertical airflow direction louver: Up

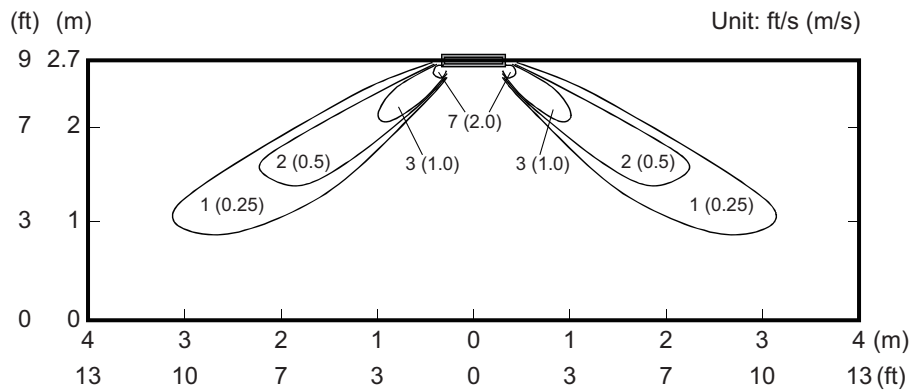


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

• Air velocity distribution

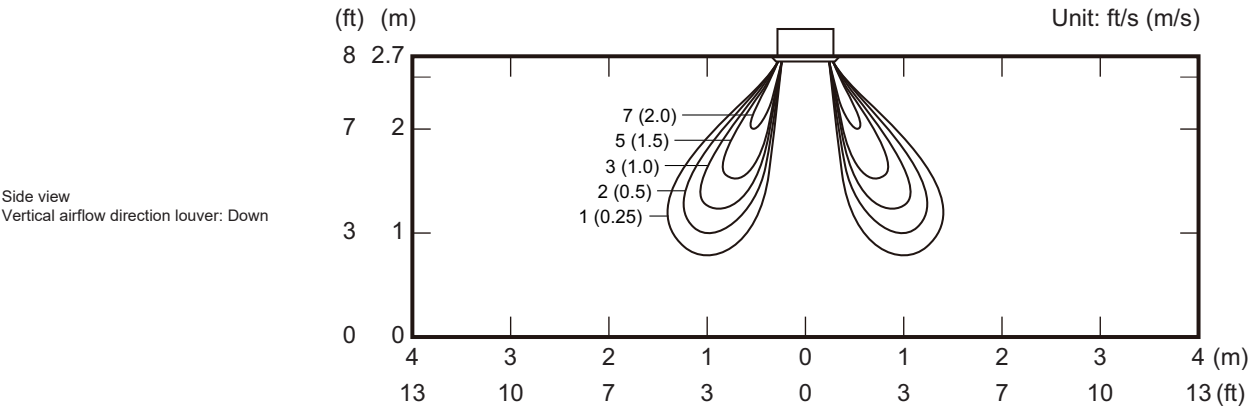

• Air temperature distribution

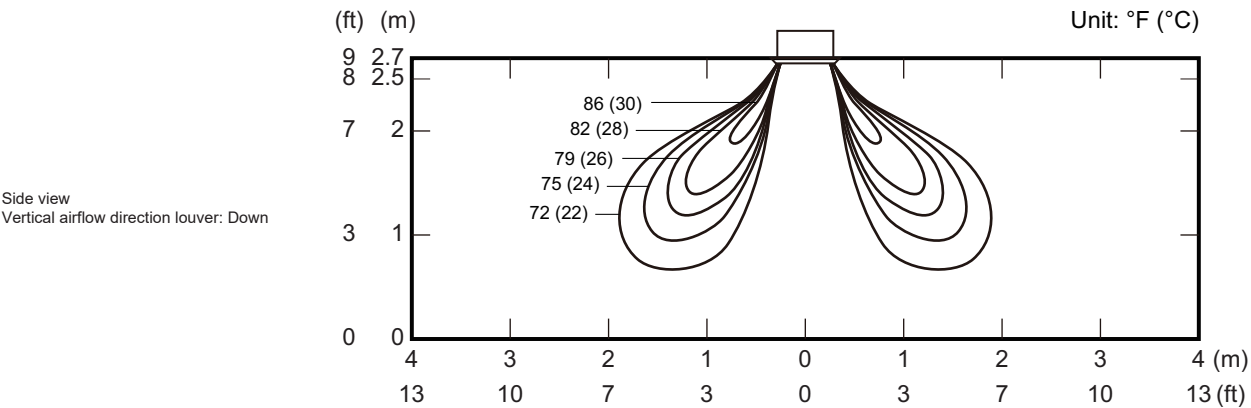




Model: AUUA9TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

Air velocity distribution

Top view  
Vertical airflow direction louver: Up

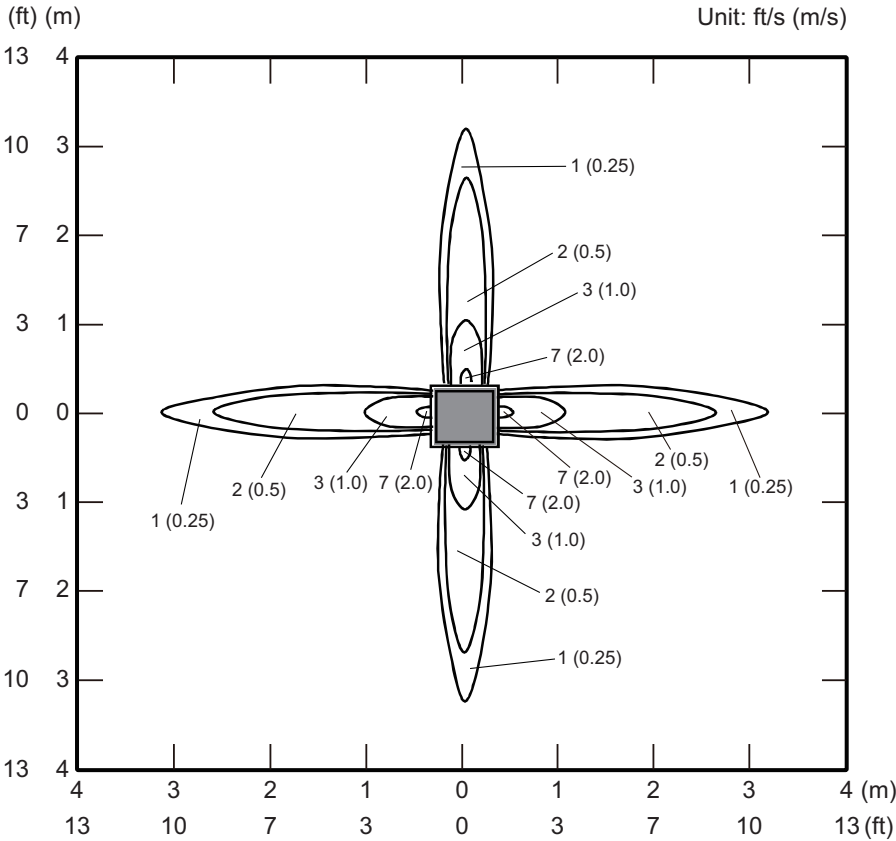


Side view  
Vertical airflow direction louver: Up

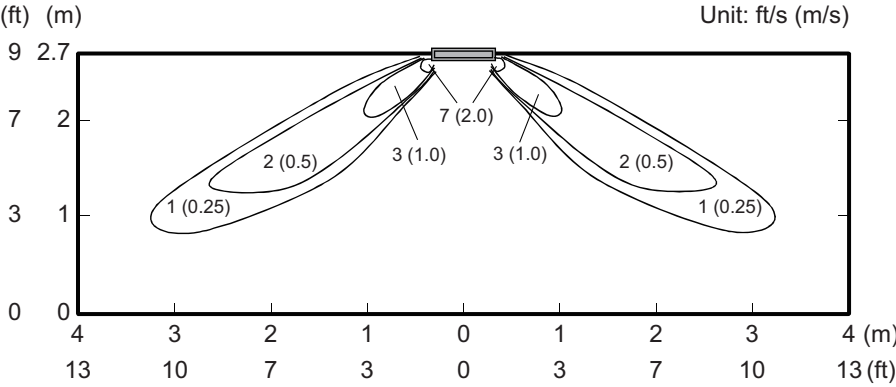


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

• Air velocity distribution

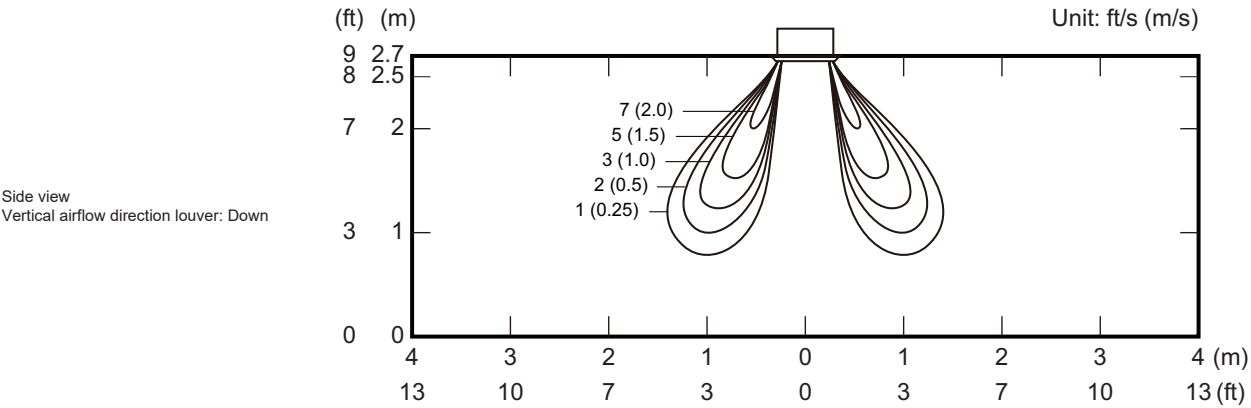


• Air temperature distribution

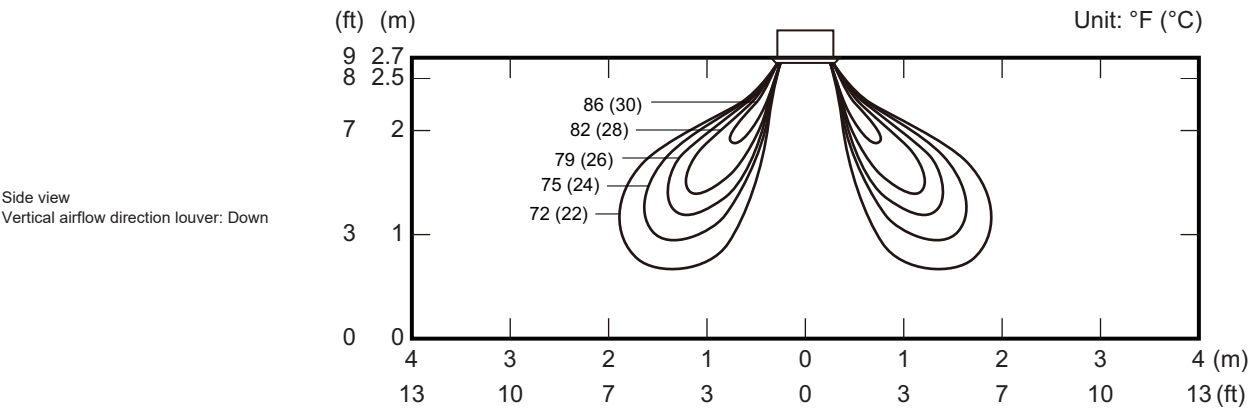

# Model: AUUA12TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## • Air velocity distribution

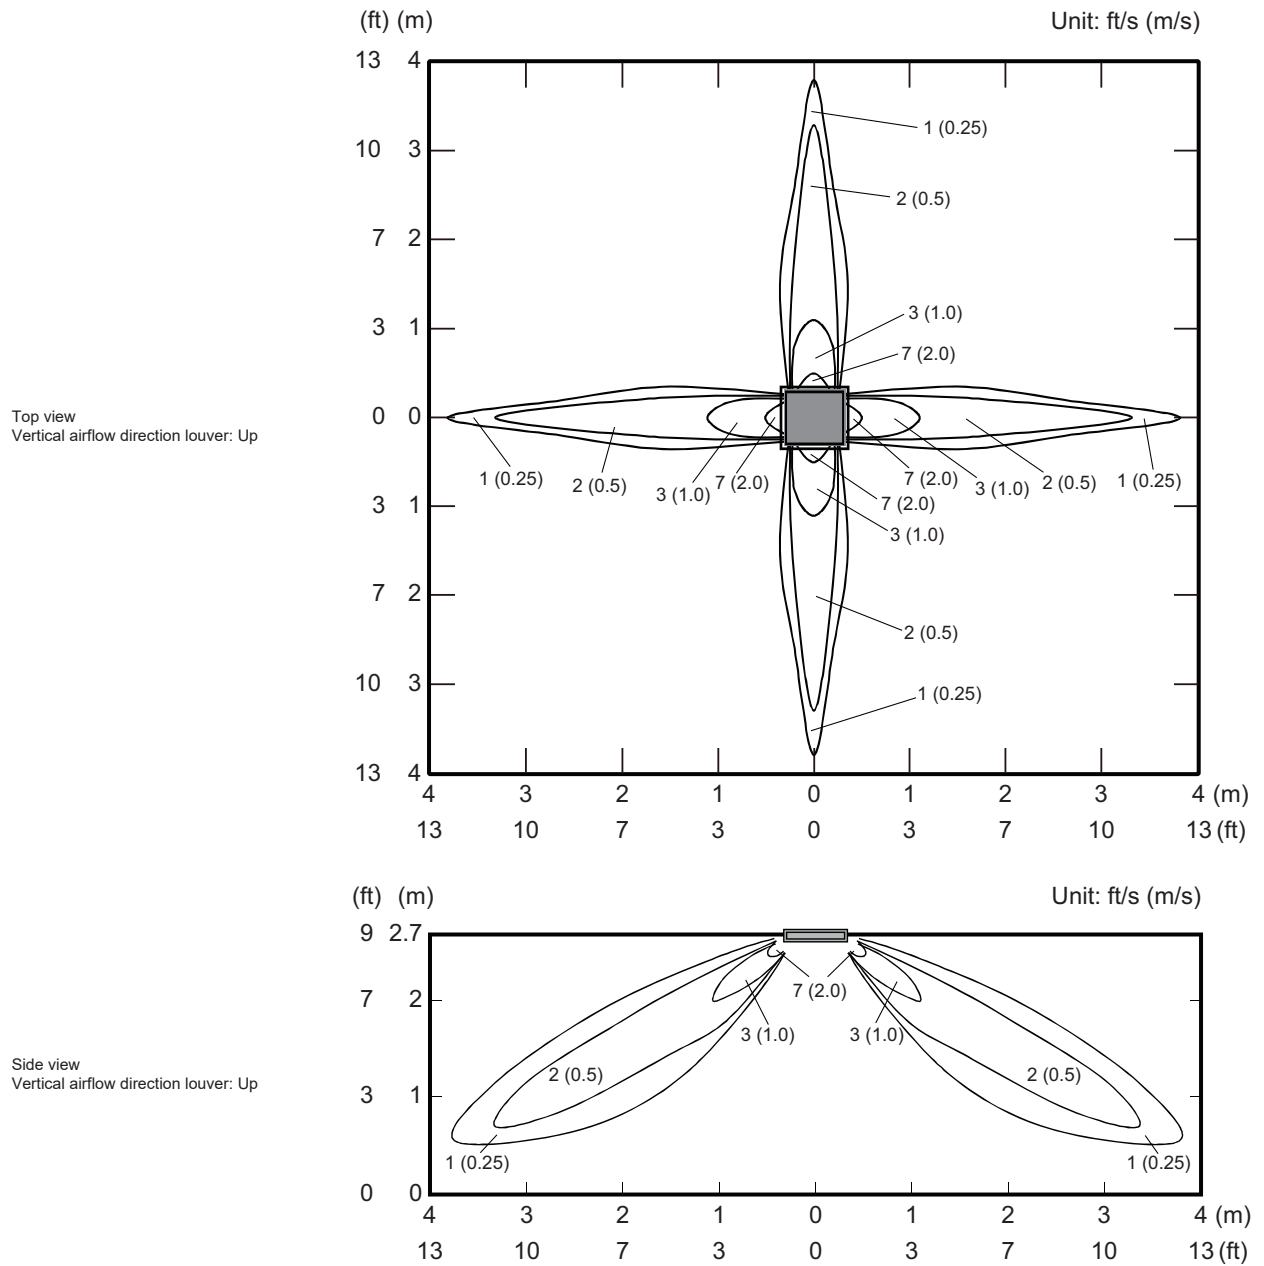


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

• Air velocity distribution

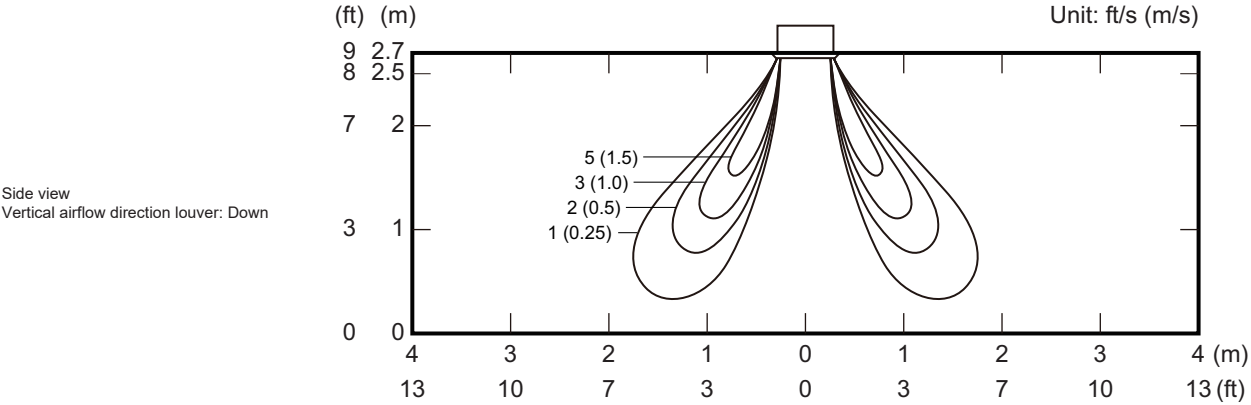


• Air temperature distribution

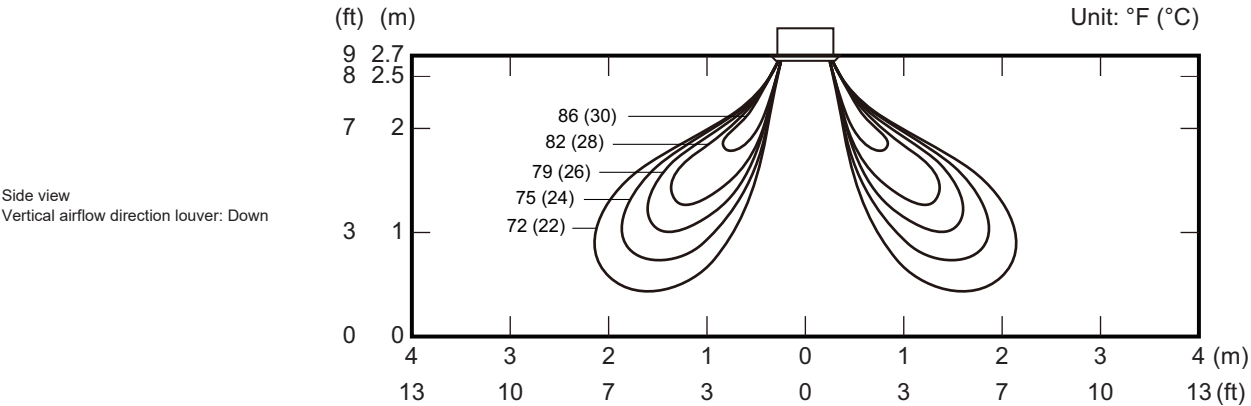

# Model: AUUA14TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## • Air velocity distribution

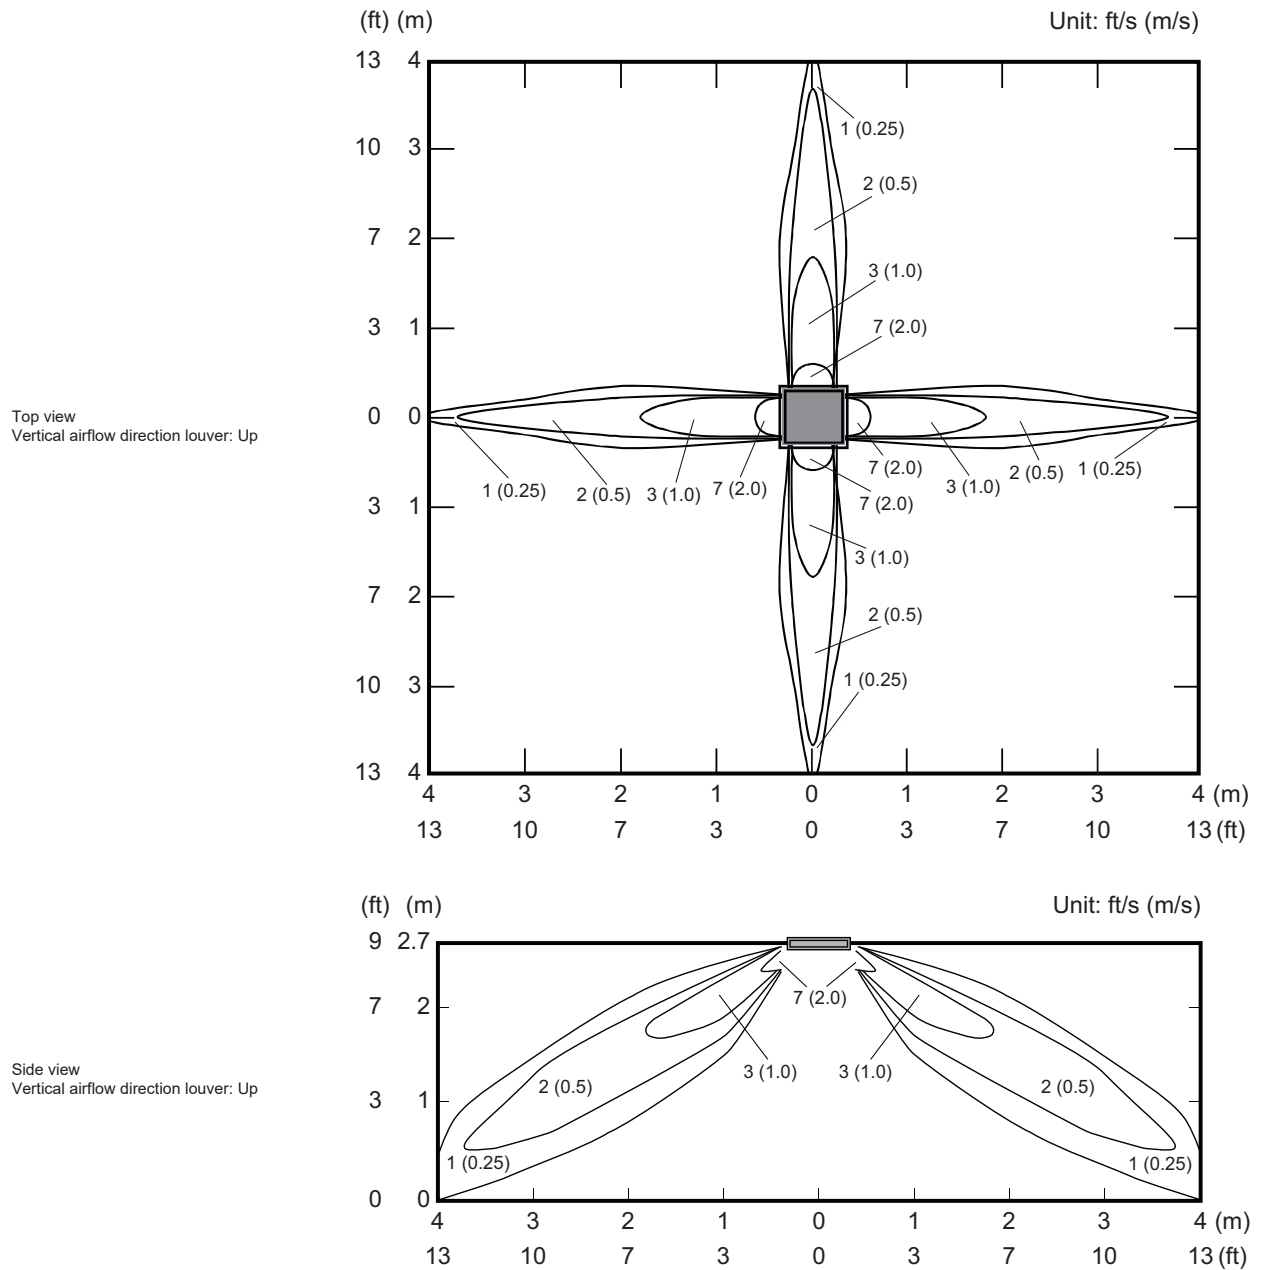


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

# • Air velocity distribution

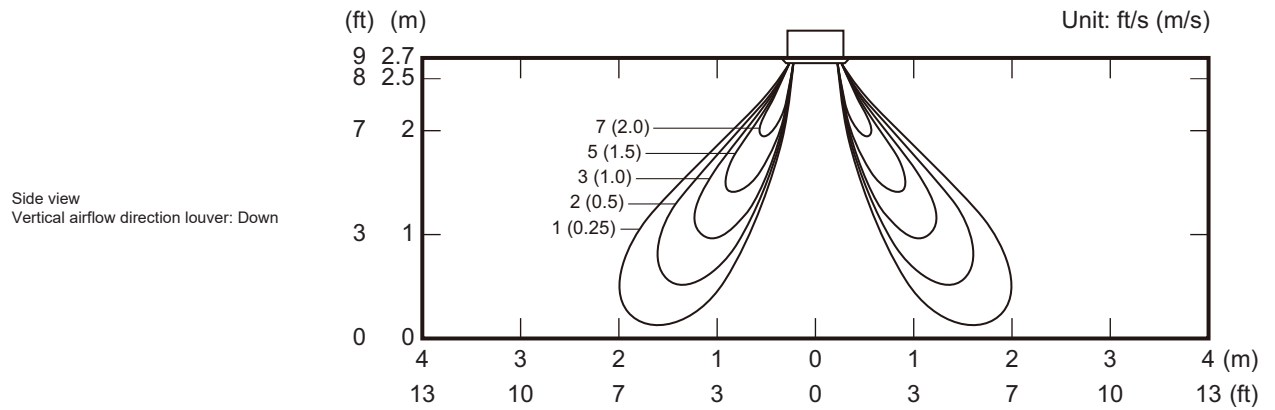


# • Air temperature distribution

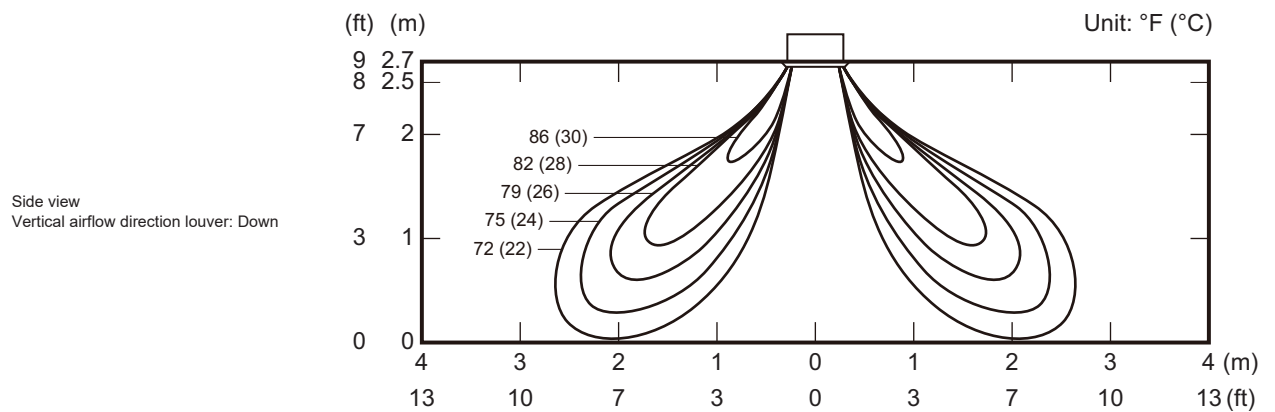

# Model: AUUA18TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution

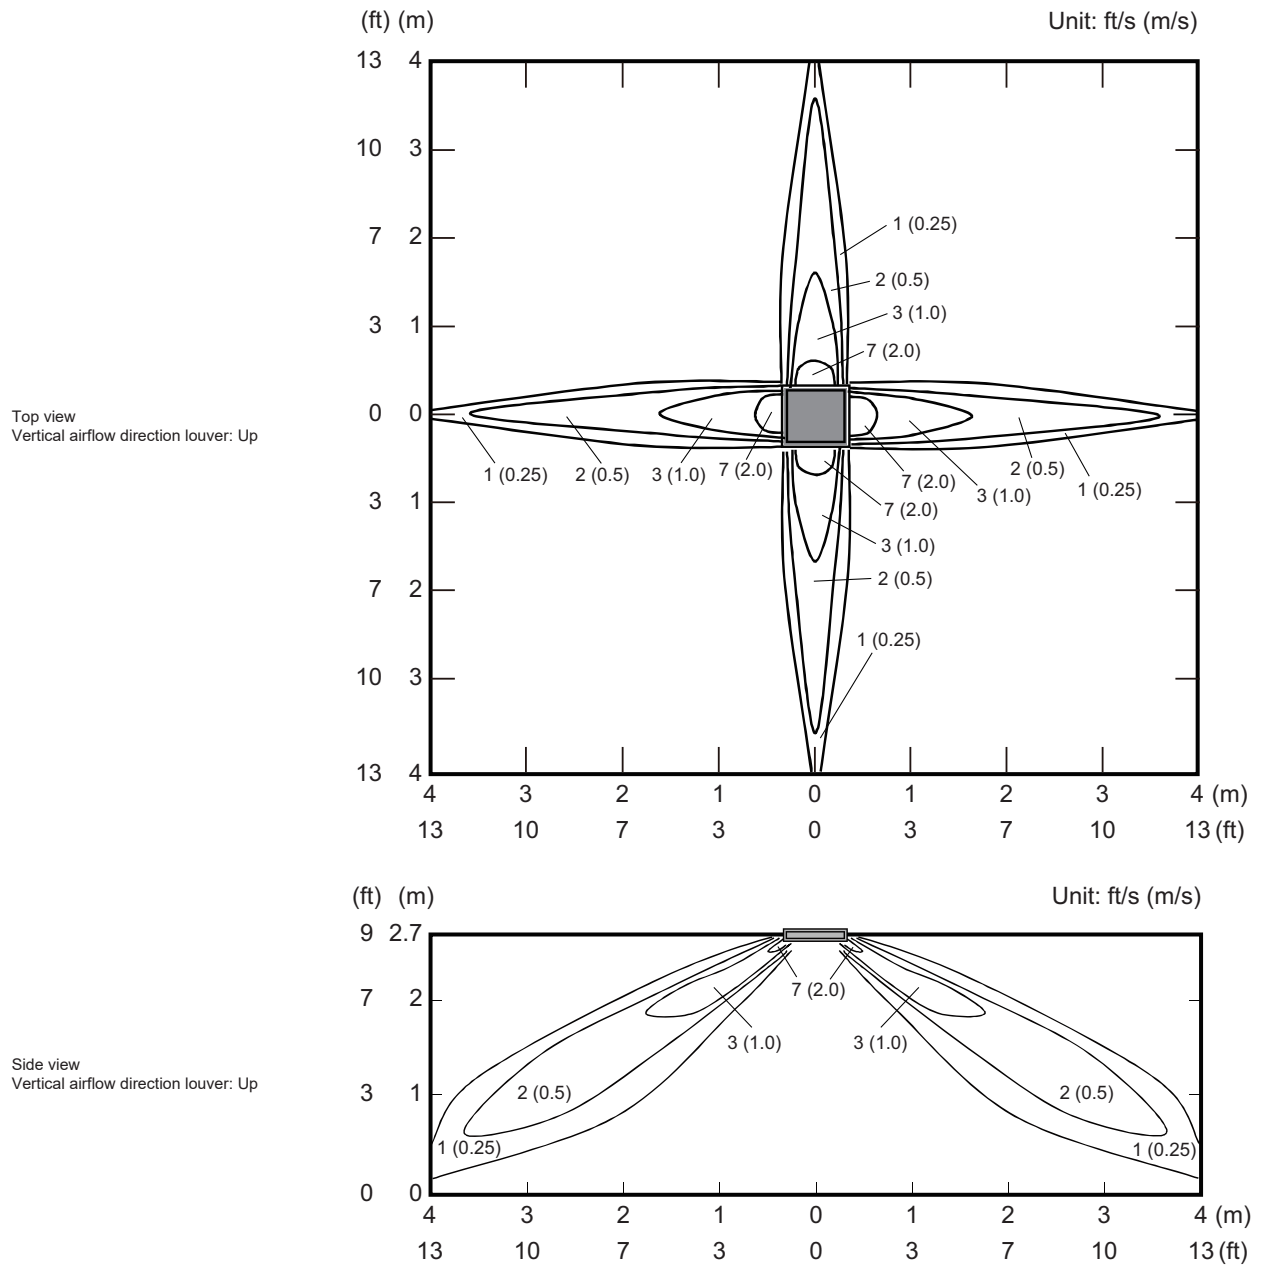


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

# • Air velocity distribution

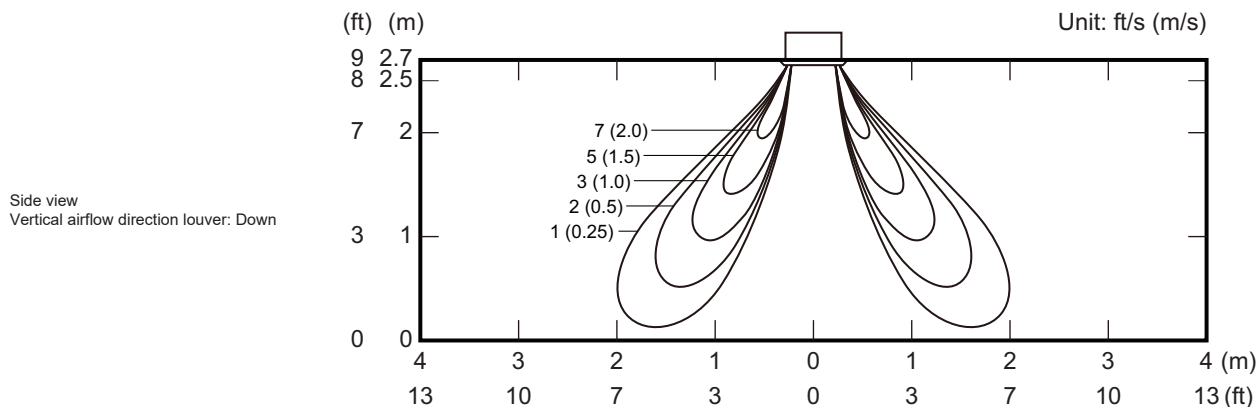

# • Air temperature distribution

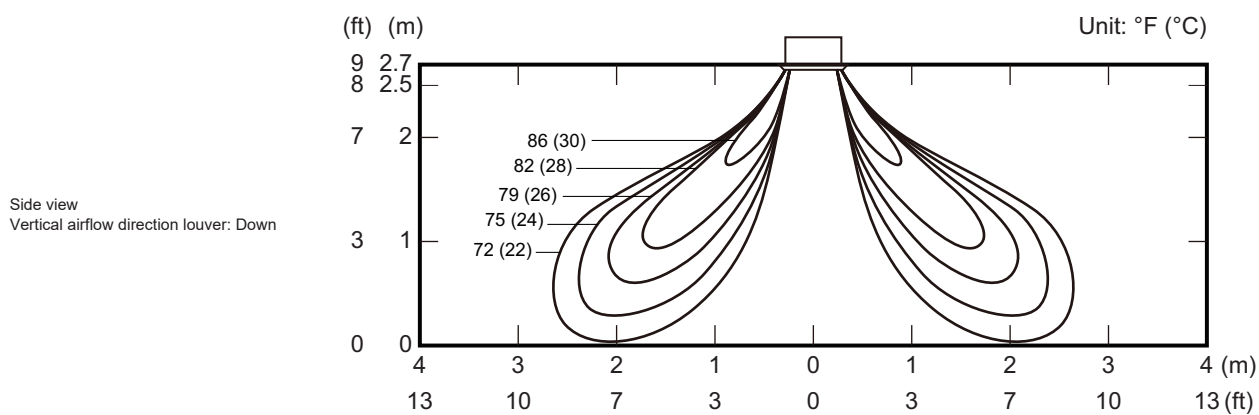




# Model: AUUA24TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## • Air velocity distribution

Top view  
Vertical airflow direction louver: Up

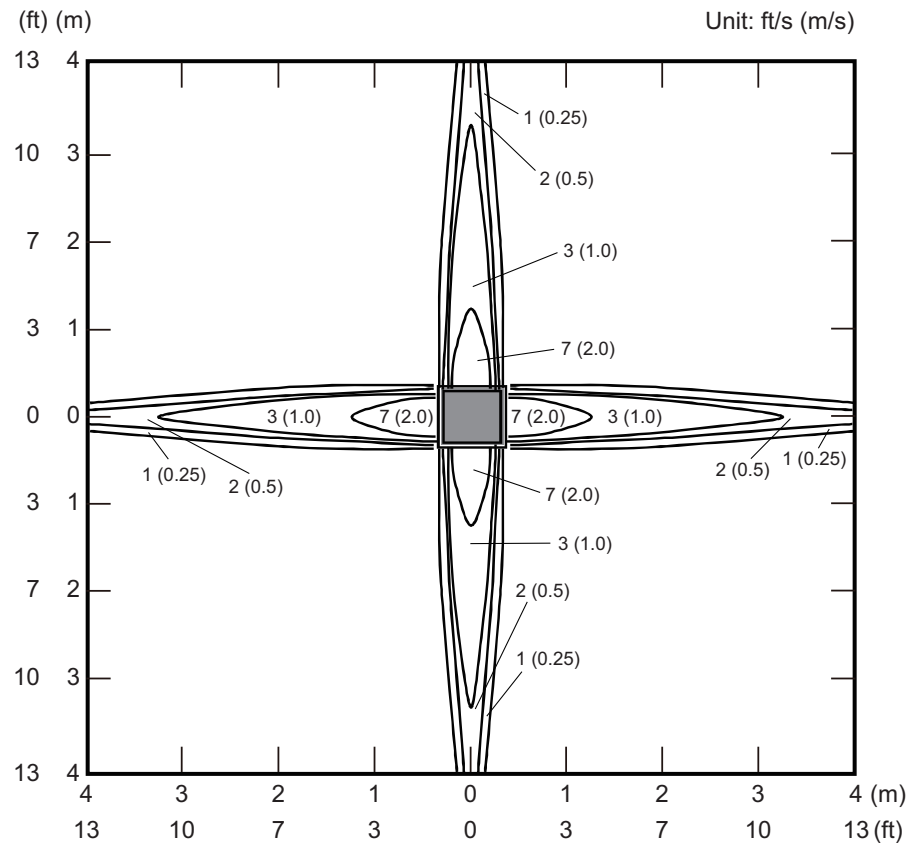


Side view  
Vertical airflow direction louver: Up

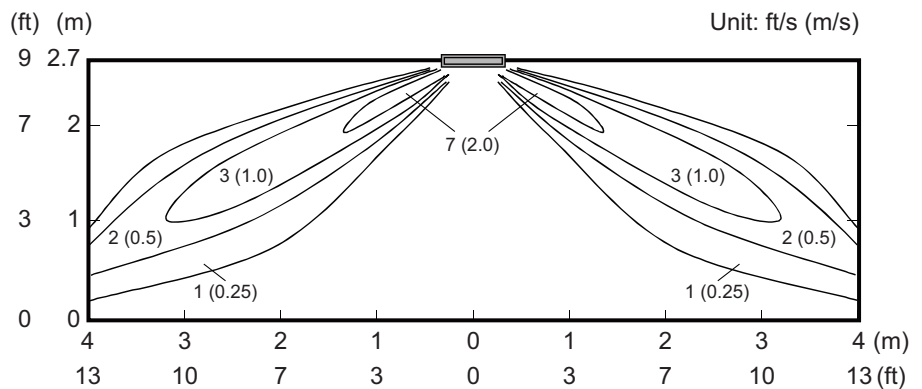


Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT

• Air velocity distribution

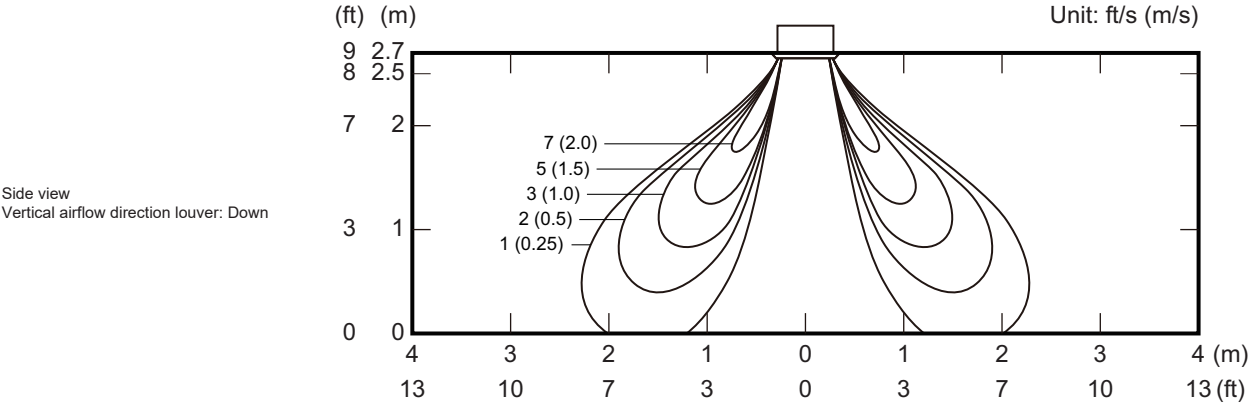

• Air temperature distribution

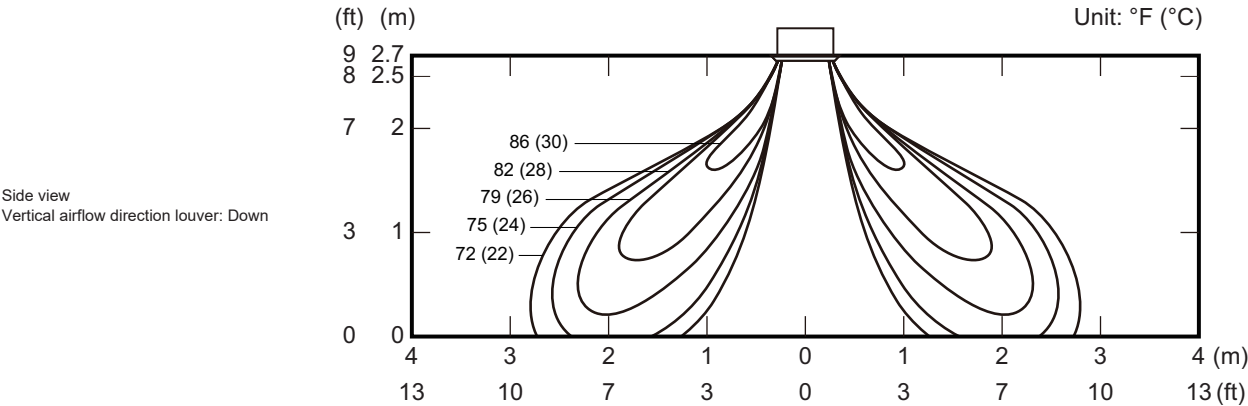


## 6-2. 4-way flow cassette type

### ■ Model: AUUB18TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution

Top view  
Vertical airflow direction louver: Up

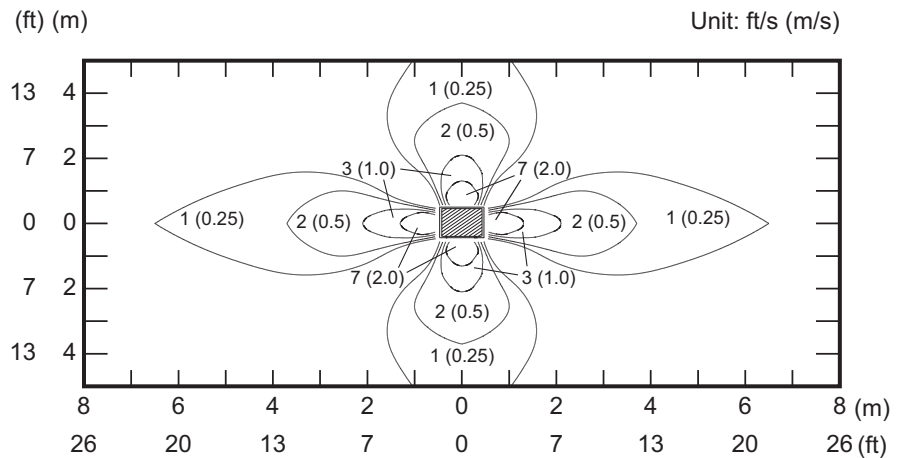


Side view  
Vertical airflow direction louver: Up

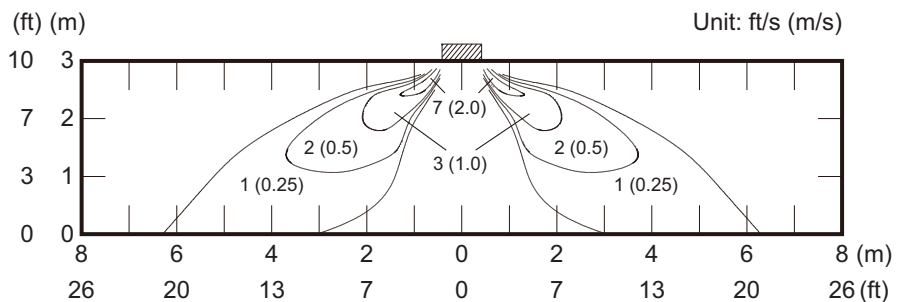

Measuring conditions NOTE: Reference data	Fan speed	Operation mode
	HIGH	HEAT


#### • Air velocity distribution

Side view  
Vertical airflow direction louver: Down

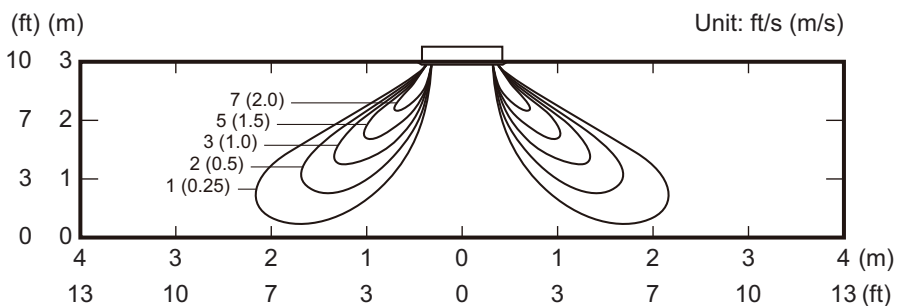

#### • Air temperature distribution

Side view  
Vertical airflow direction louver: Down

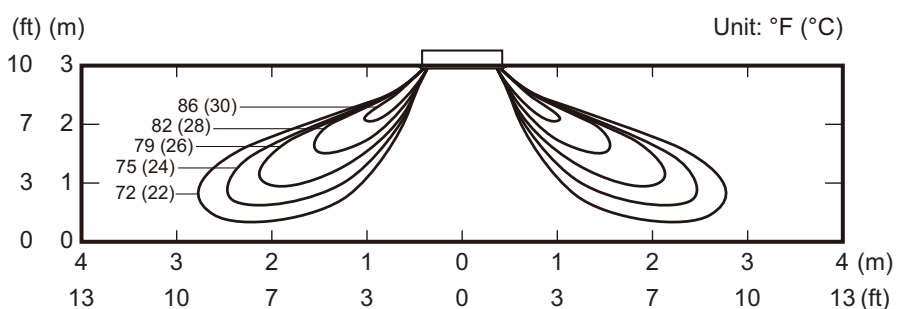


# Model: AUUB24TLAV


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution

Top view  
Vertical airflow direction louver: Up

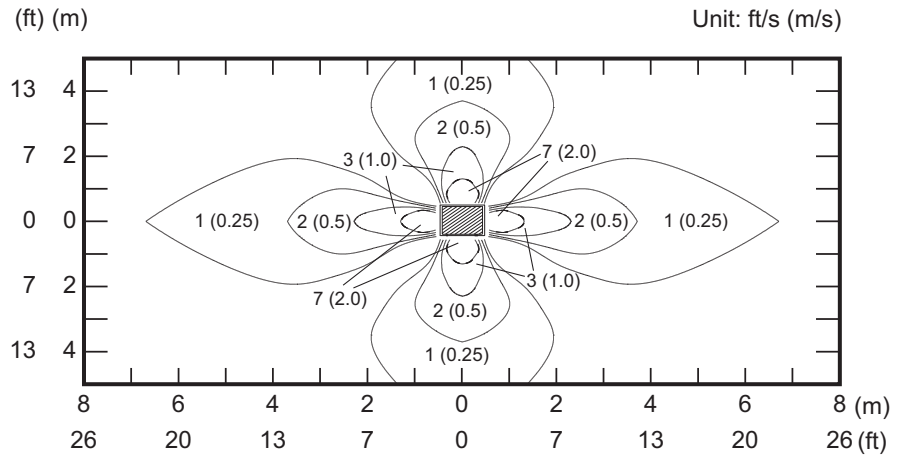


Side view  
Vertical airflow direction louver: Up

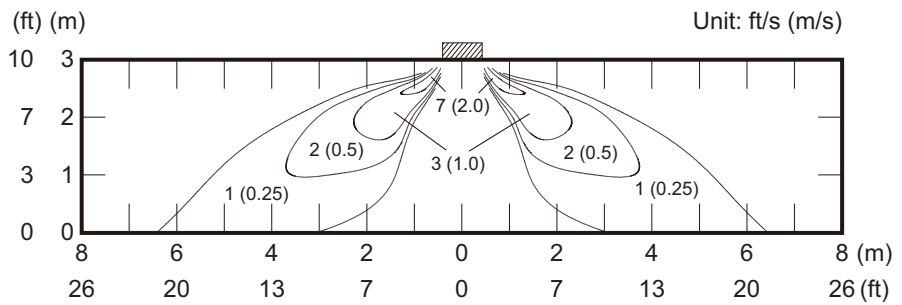

Measuring conditions	Fan speed HIGH	Operation mode HEAT
NOTE: Reference data		


## Air velocity distribution

Side view  
Vertical airflow direction louver: Down

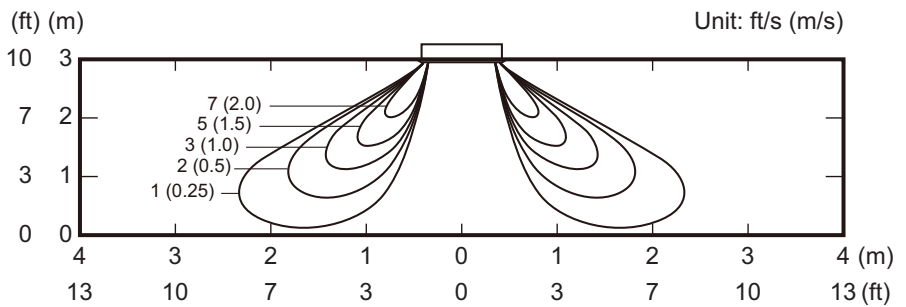

## Air temperature distribution

Side view  
Vertical airflow direction louver: Down

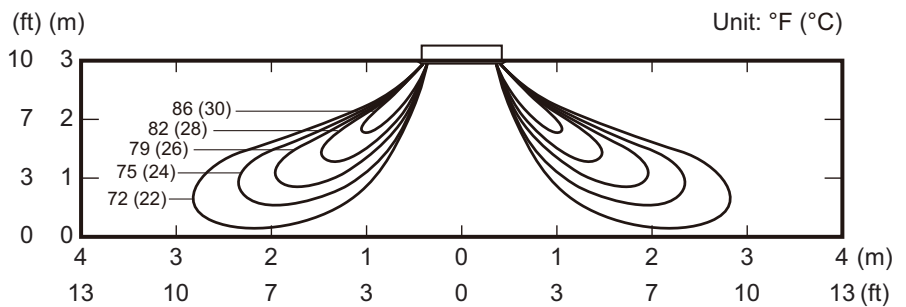


# Model: AUUB30TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution

Top view  
Vertical airflow direction louver: Up

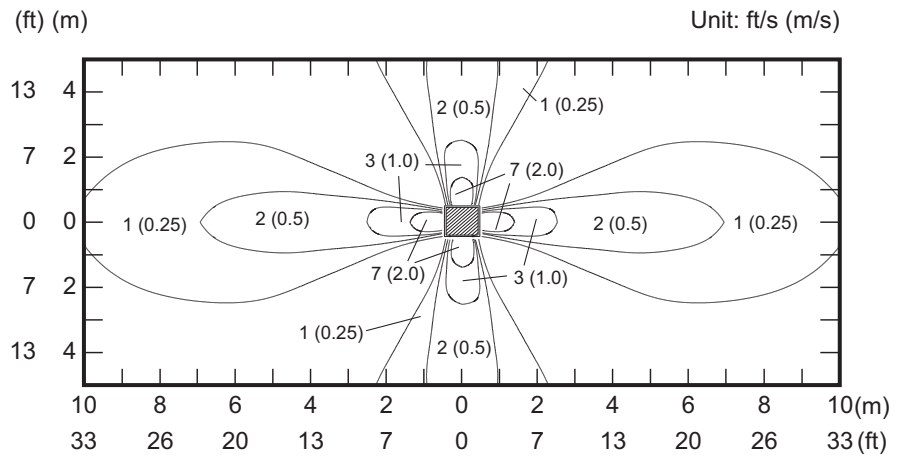


Side view  
Vertical airflow direction louver: Up

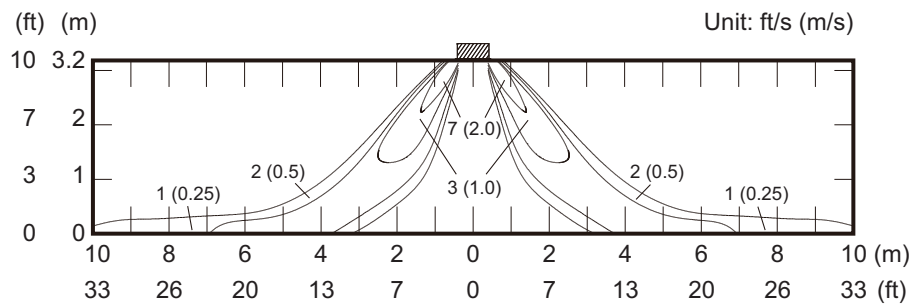

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


## Air velocity distribution

Side view  
Vertical airflow direction louver: Down

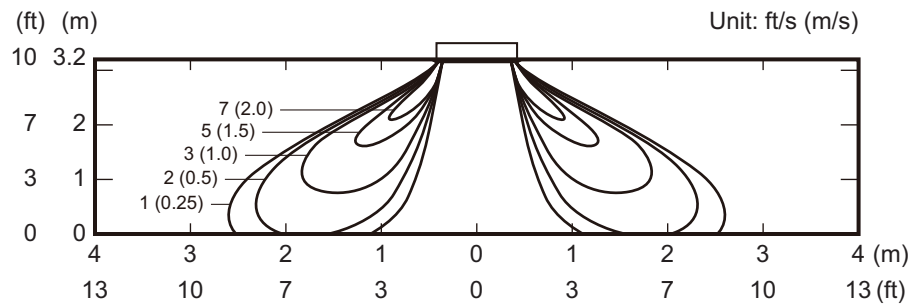

## Air temperature distribution

Side view  
Vertical airflow direction louver: Down

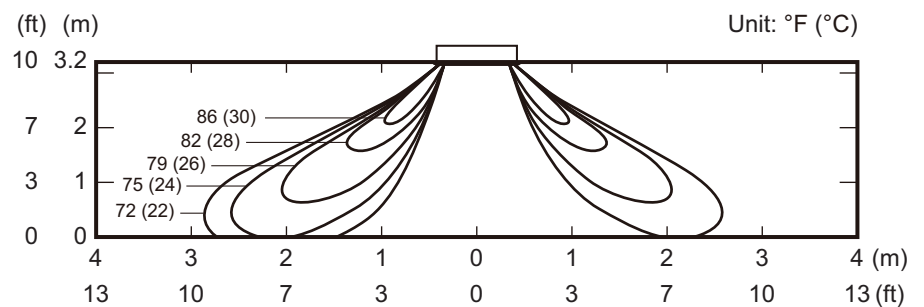


# Model: AUUB36TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution

Top view  
Vertical airflow direction louver: Up

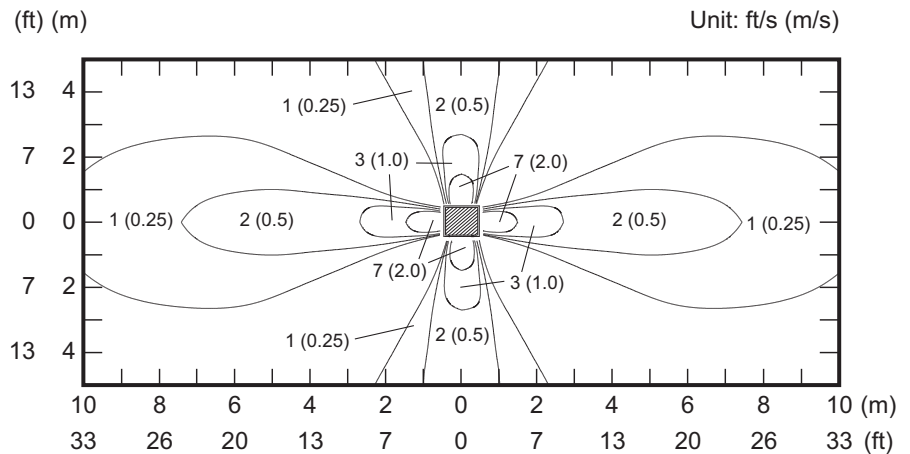


Side view  
Vertical airflow direction louver: Up

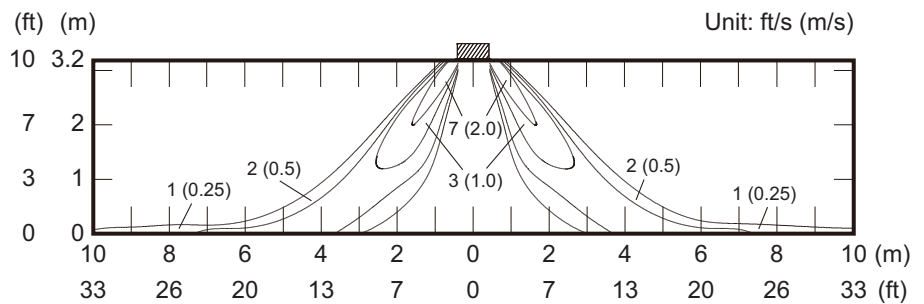

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


## Air velocity distribution

Side view  
Vertical airflow direction louver: Down

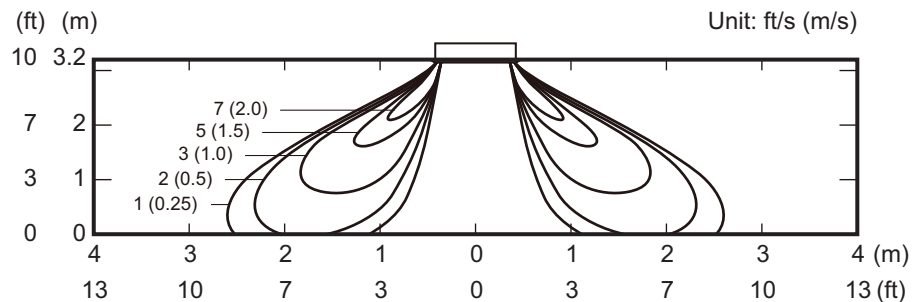

## Air temperature distribution

Side view  
Vertical airflow direction louver: Down

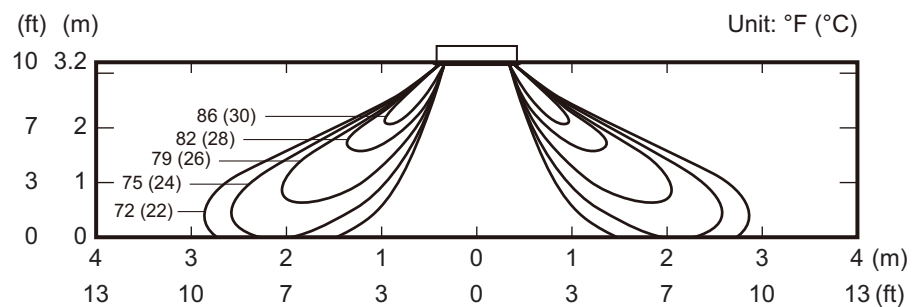


## 6-3. Circular flow cassette type

### ■ Model: AUUB18TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution

Top view  
Vertical airflow direction louver: Position 1

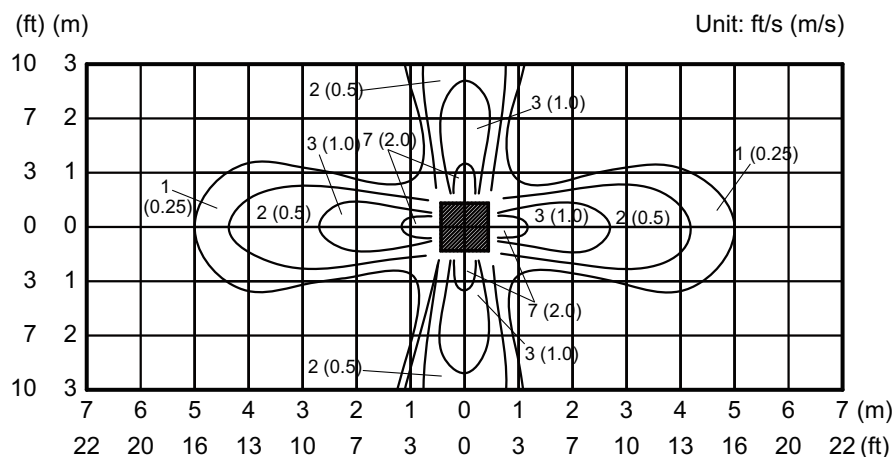


Side view  
Vertical airflow direction louver: Position 1

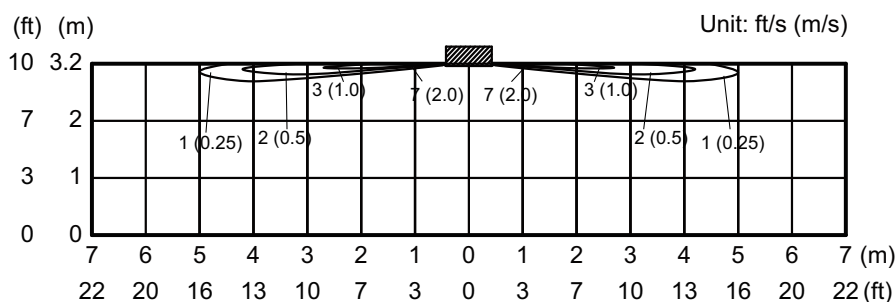


Measuring conditions NOTE: Reference data	Fan speed	Operation mode
	HIGH	HEAT

#### • Air velocity distribution

Side view  
Vertical airflow direction louver: Position 2

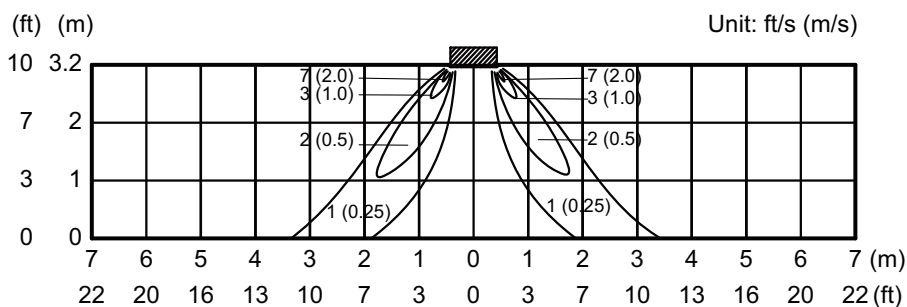

Side view  
Vertical airflow direction louver: Position 4

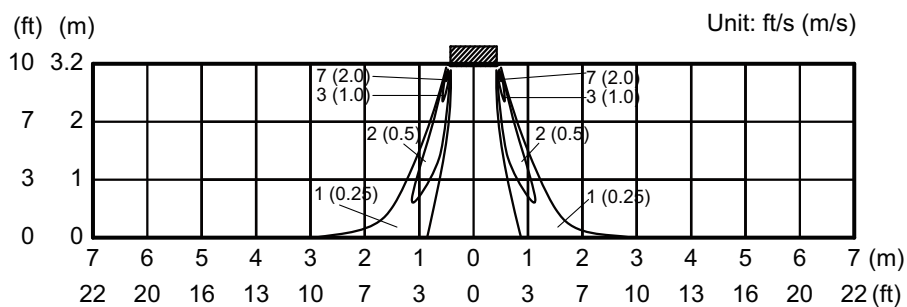


# Model: AUUB24TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution

Top view  
Vertical airflow direction louver: Position 1

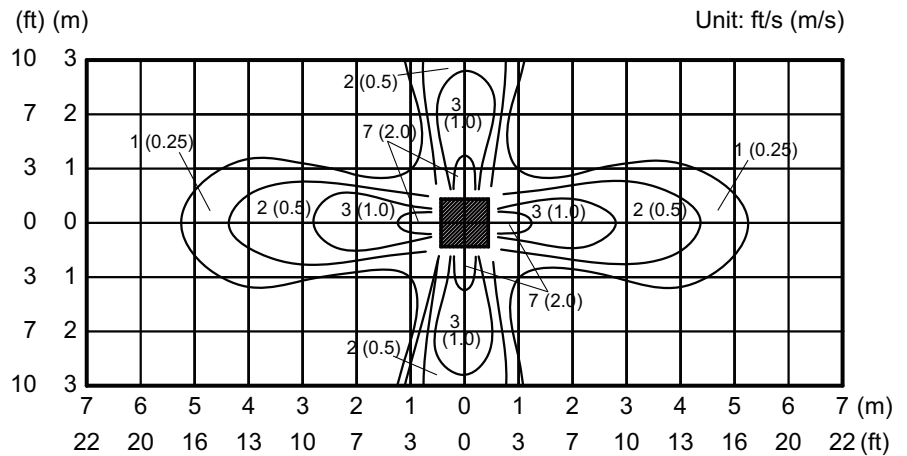


Side view  
Vertical airflow direction louver: Position 1

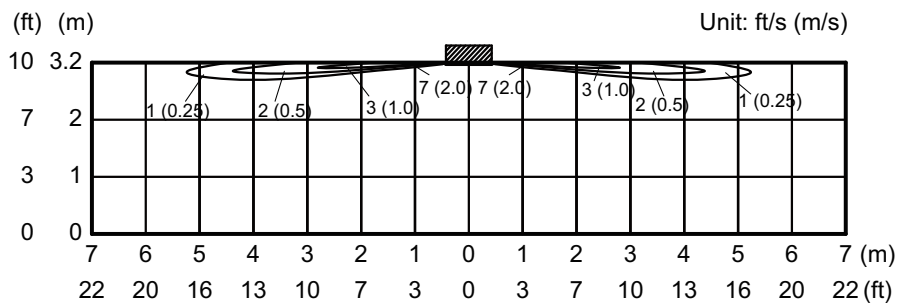


Measuring conditions	Fan speed HIGH	Operation mode HEAT
NOTE: Reference data		

## Air velocity distribution

Side view  
Vertical airflow direction louver: Position 2

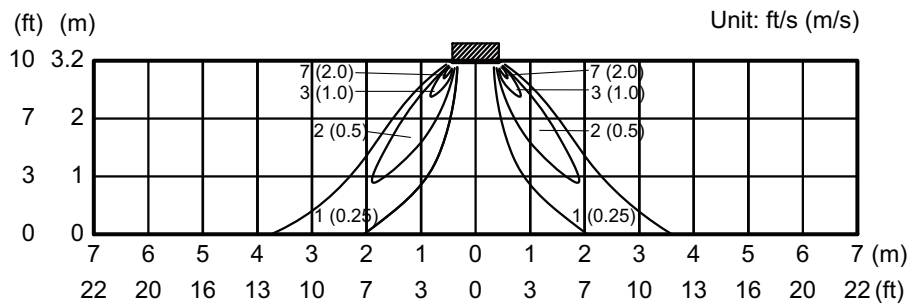

Side view  
Vertical airflow direction louver: Position 4

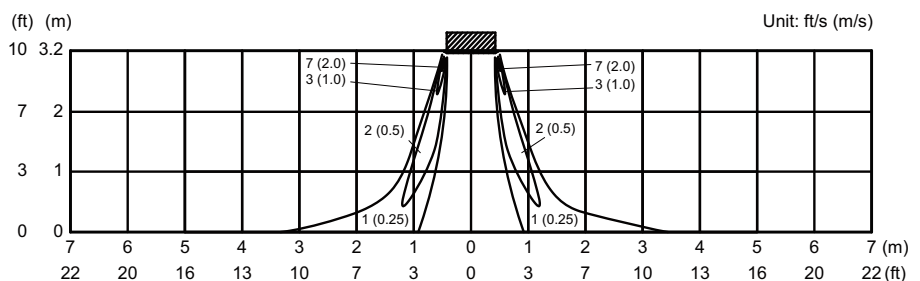




# Model: AUUB30TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution

Top view  
Vertical airflow direction louver: Position 1

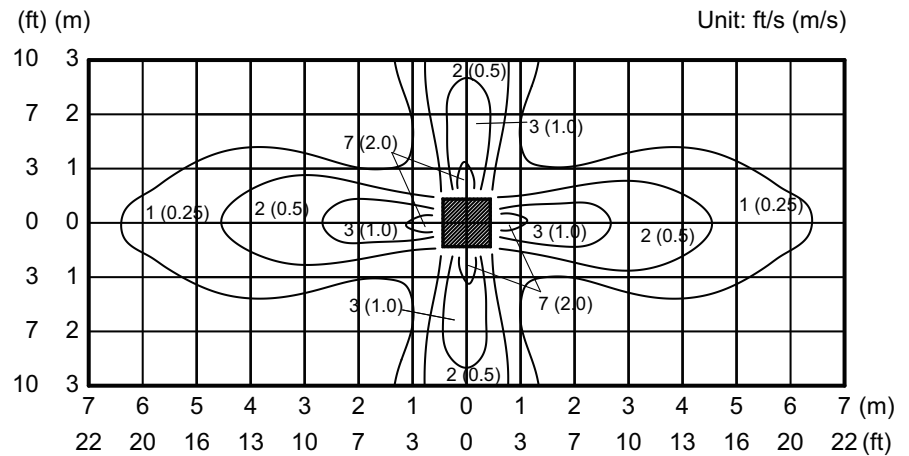


Side view  
Vertical airflow direction louver: Position 1

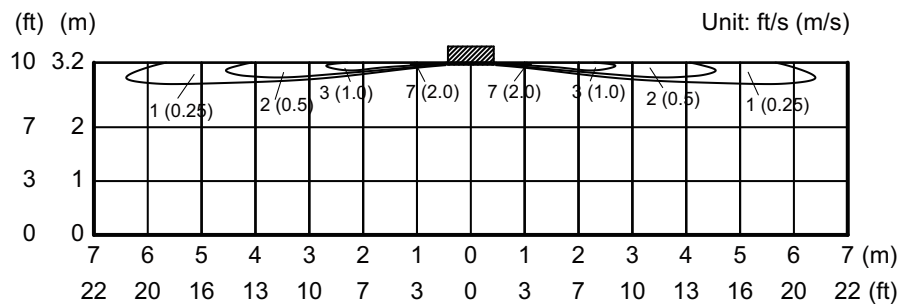


Measuring conditions <b>NOTE:</b> Reference data	Fan speed HIGH	Operation mode HEAT
---	-------------------	------------------------

## Air velocity distribution

Side view  
Vertical airflow direction louver: Position 2

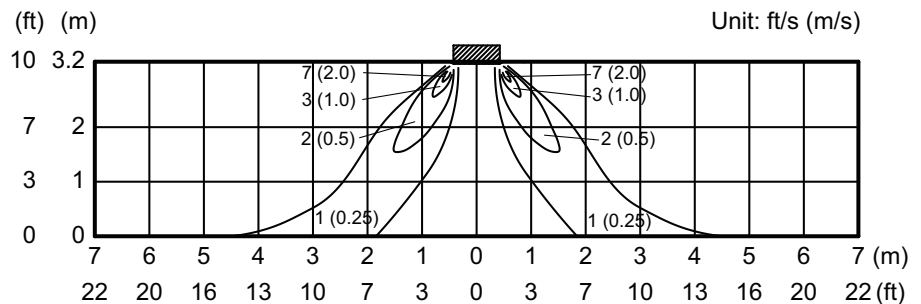

Side view  
Vertical airflow direction louver: Position 4

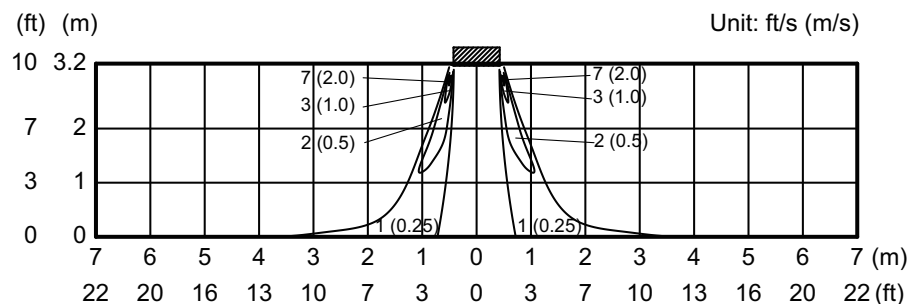


# Model: AUUB36TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution

Top view  
Vertical airflow direction louver: Position 1

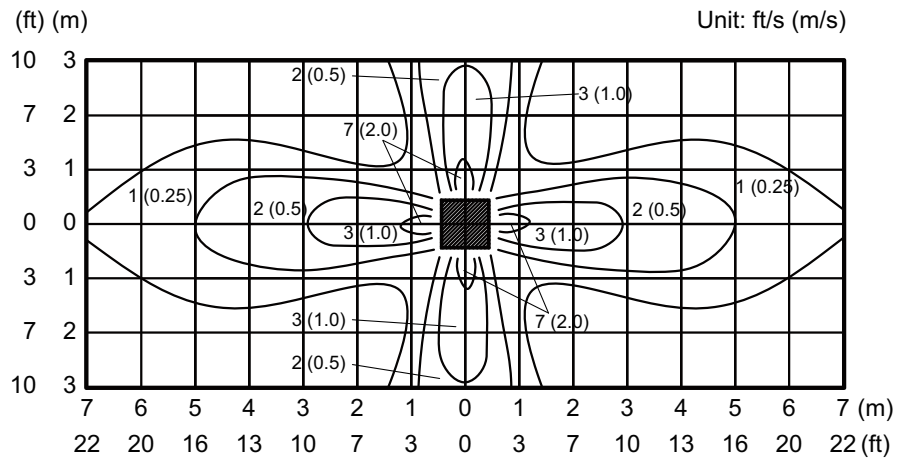


Side view  
Vertical airflow direction louver: Position 1

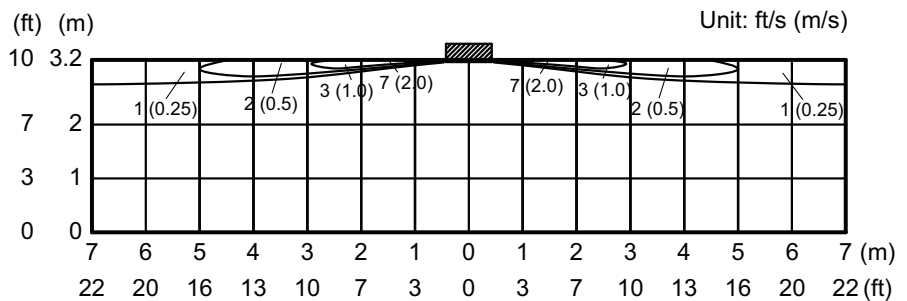


Measuring conditions	Fan speed HIGH	Operation mode HEAT
NOTE: Reference data		

## Air velocity distribution

Side view  
Vertical airflow direction louver: Position 2

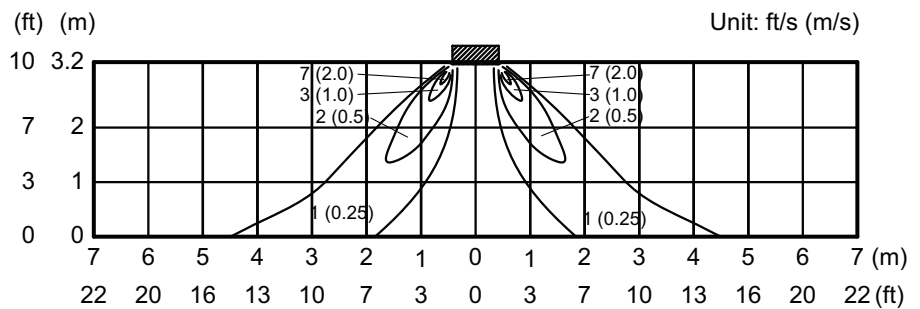

Side view  
Vertical airflow direction louver: Position 4

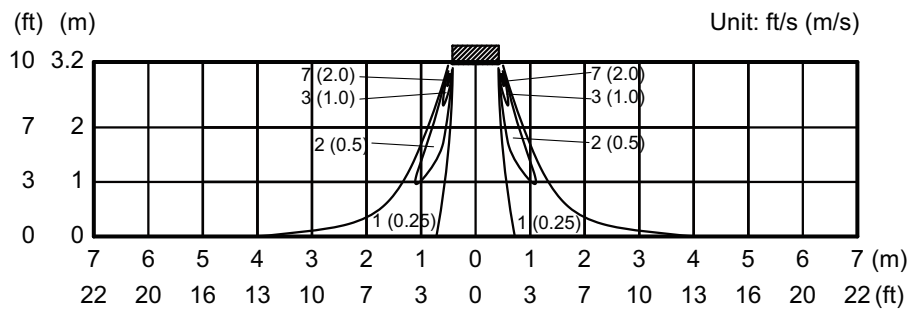


# Model: AUUB48TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution

Top view  
Vertical airflow direction louver: Position 1

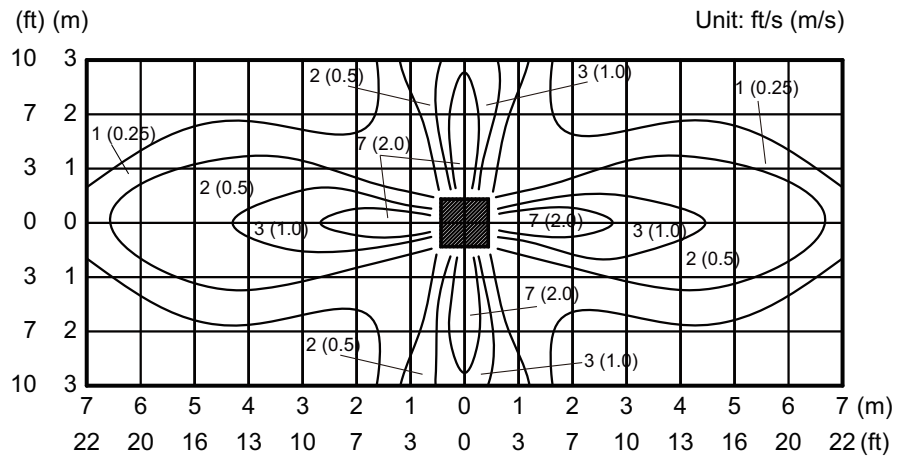


Side view  
Vertical airflow direction louver: Position 1

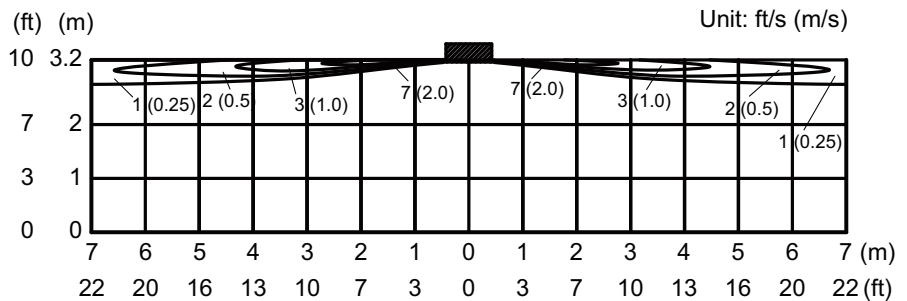


Measuring conditions	Fan speed HIGH	Operation mode HEAT
NOTE: Reference data		

## Air velocity distribution

Side view  
Vertical airflow direction louver: Position 2

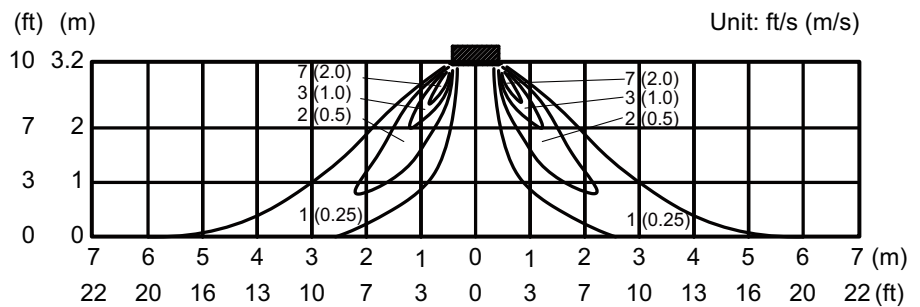

Side view  
Vertical airflow direction louver: Position 4

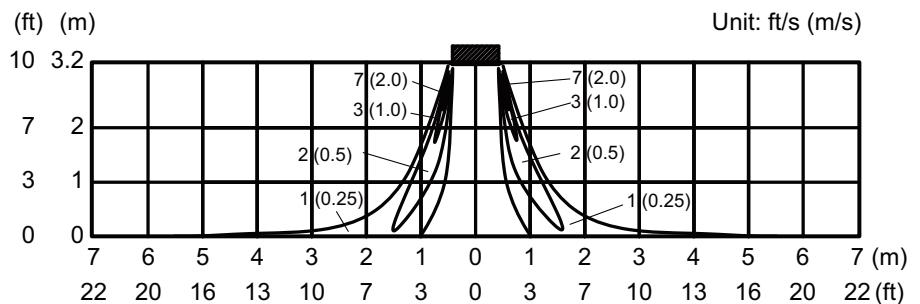

## 6-4. Mini duct type


**NOTE:** This data is measured with Auto louver grille kit (option).

### ■ Model: ARUL4TLAV2 (with UTD-GXTA-W)


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

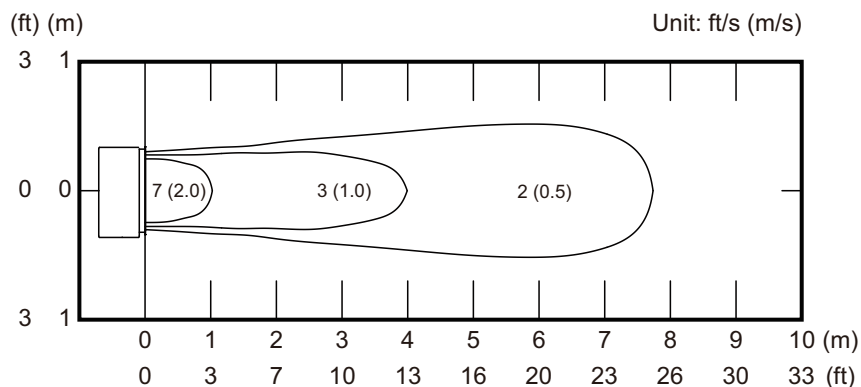

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

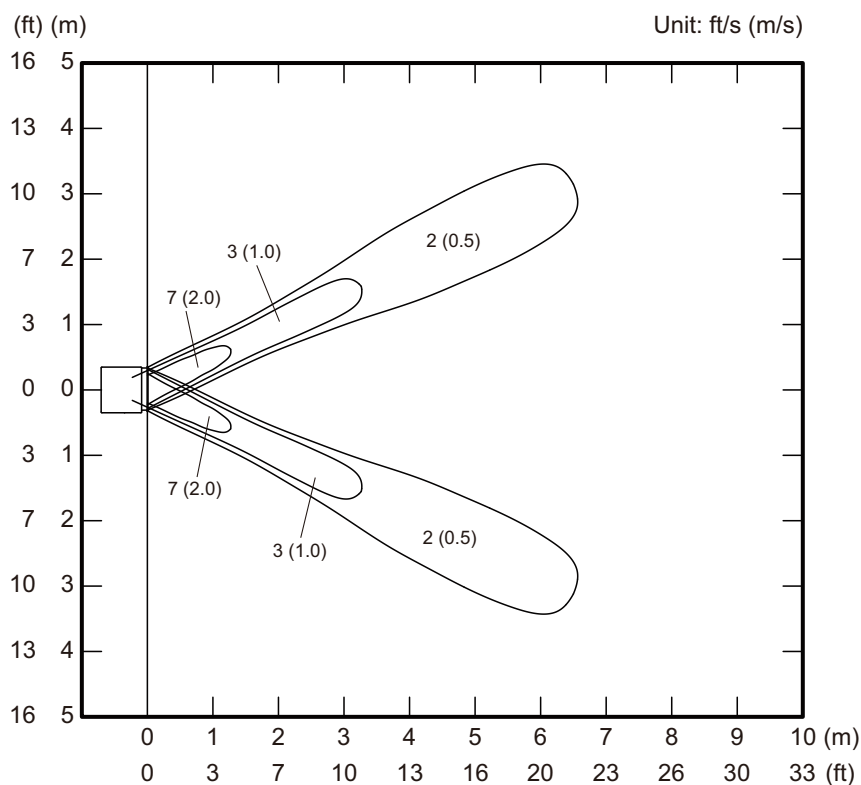


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

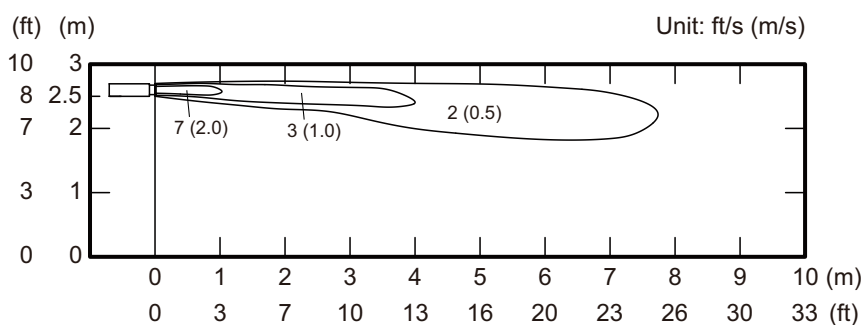

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


• Air velocity distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

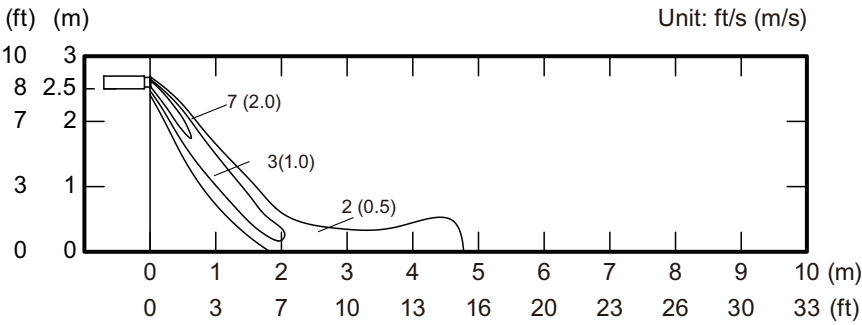

• Air temperature distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

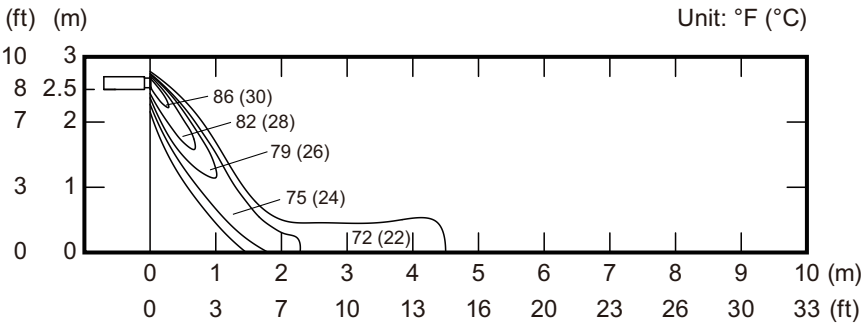

## 6-5. Slim duct/Slim concealed floor type


**NOTE:** This data is measured with Auto louver grille kit (option).

### ■ Model: ARUL7TLAV2 (with UTD-GXSA-W)


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

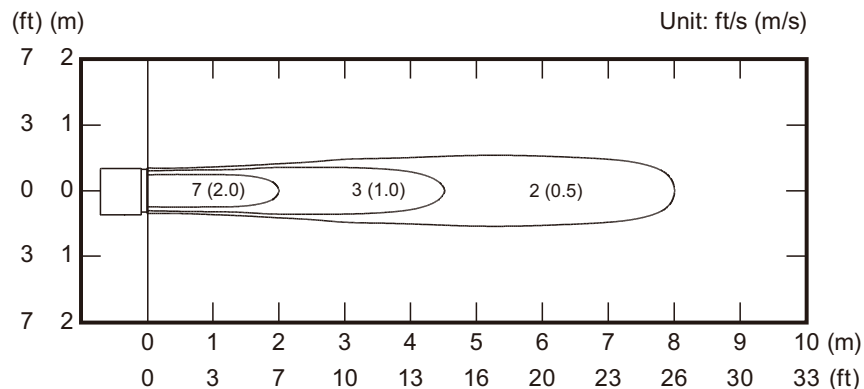

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

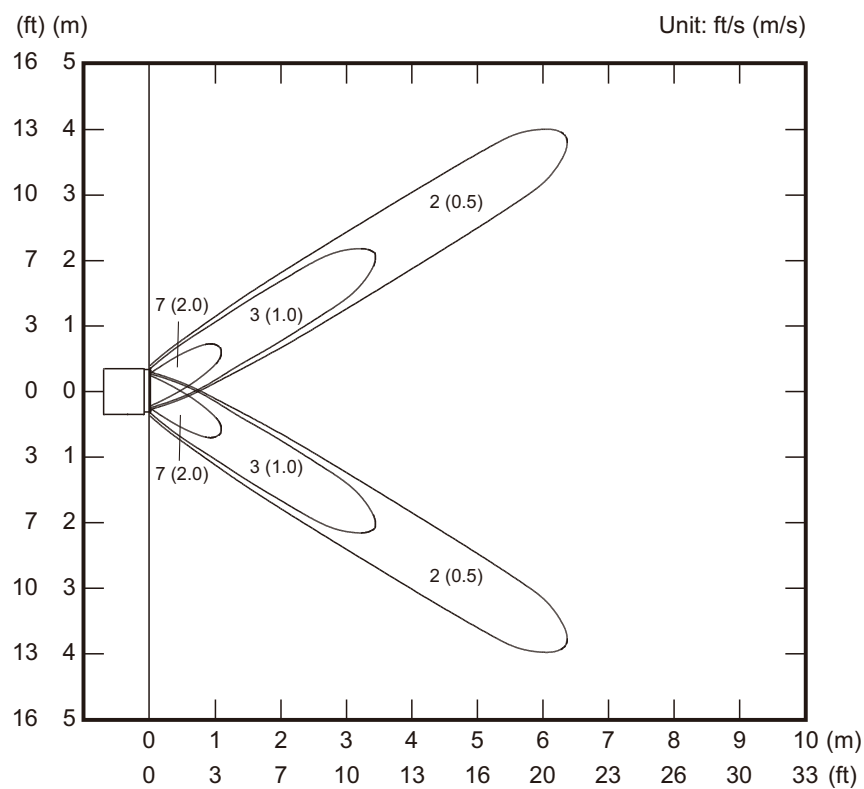


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

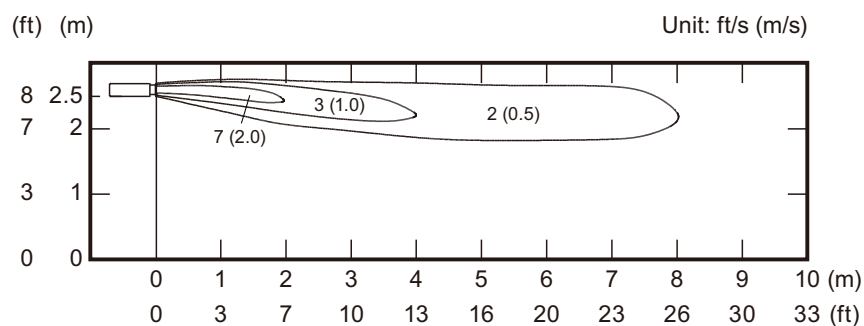

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


## • Air velocity distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

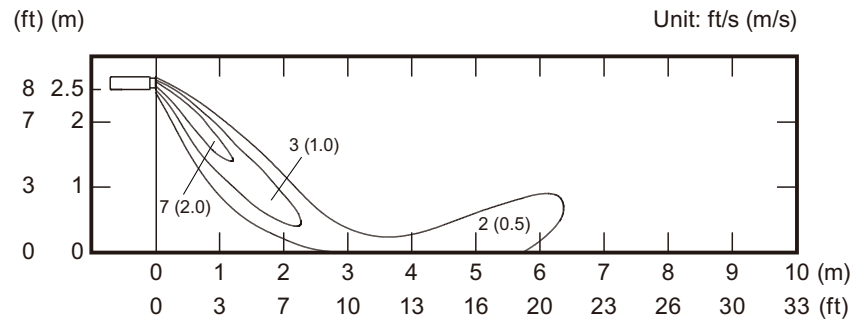

## • Air temperature distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

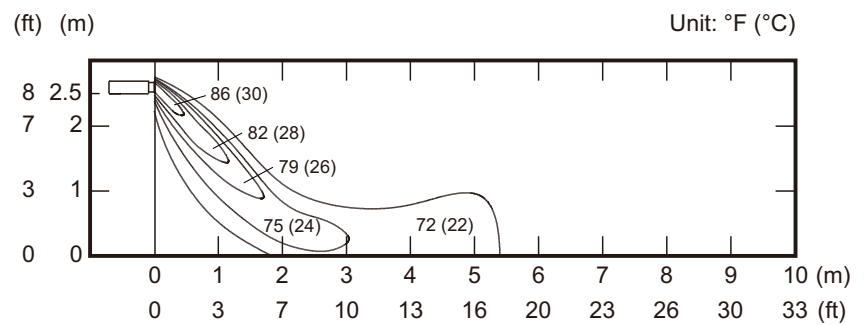


# Model: ARUL9TLAV2 (with UTD-GXSA-W)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

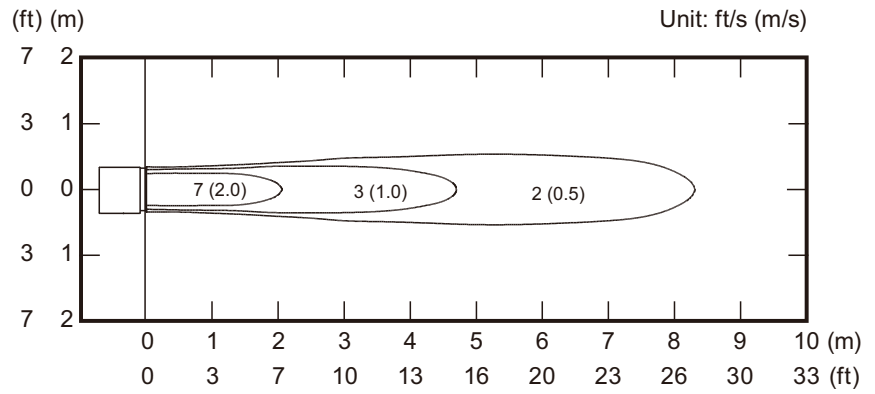

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

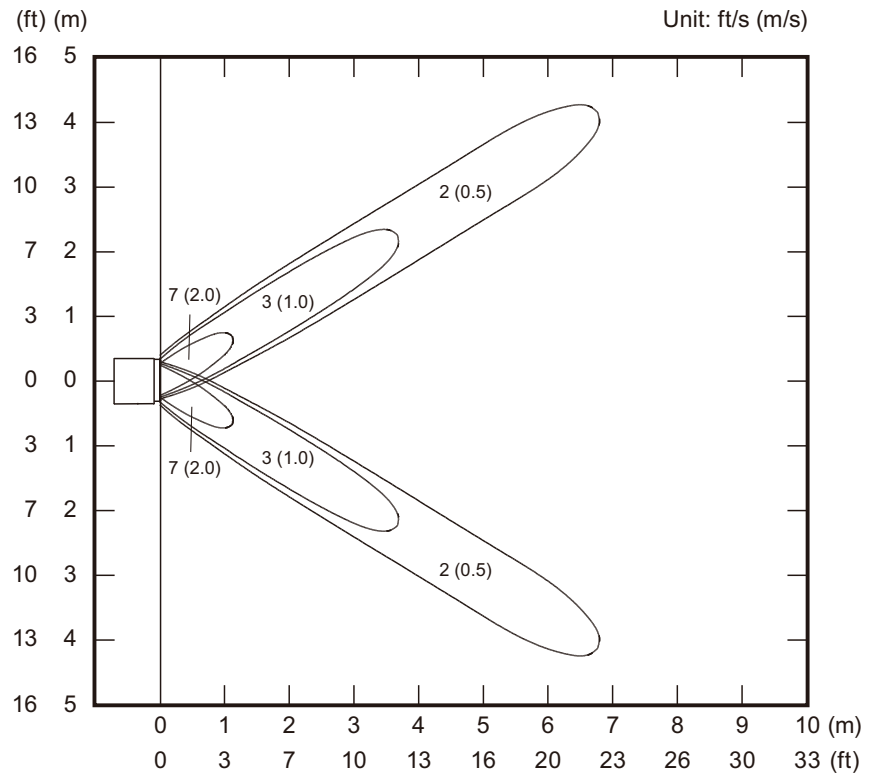

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

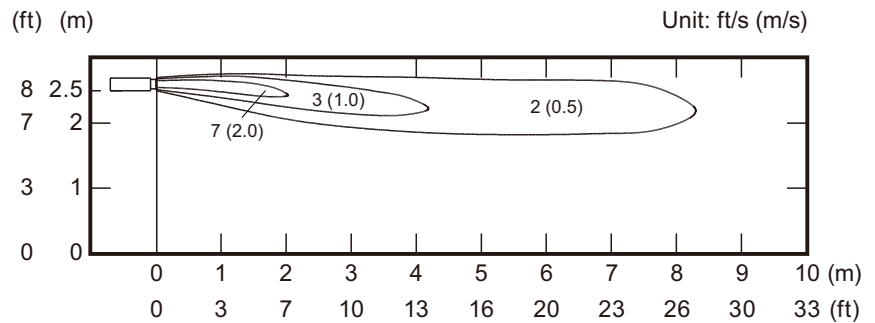




Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


## • Air velocity distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

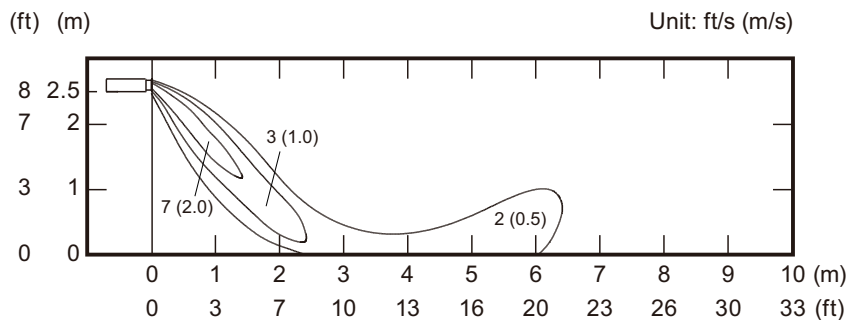

## • Air temperature distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

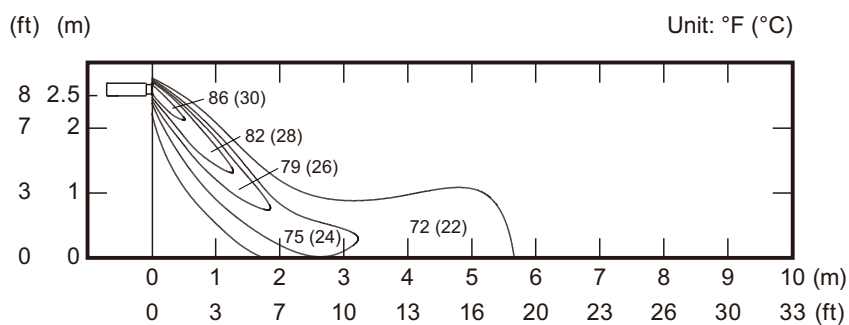


# Model: ARUL12TLAV2 (with UTD-GXSA-W)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

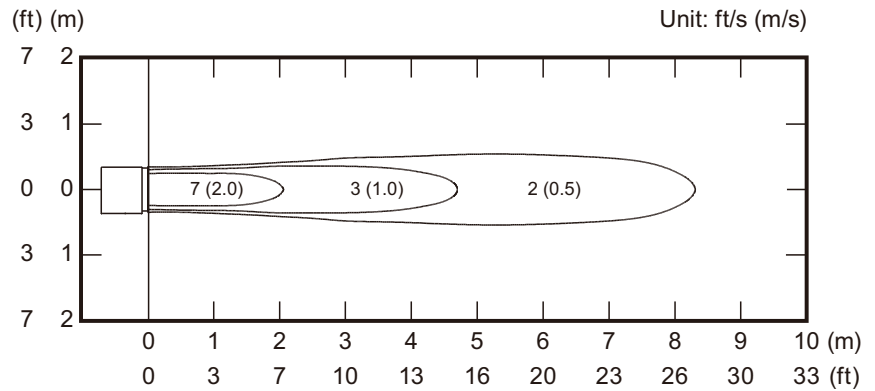

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

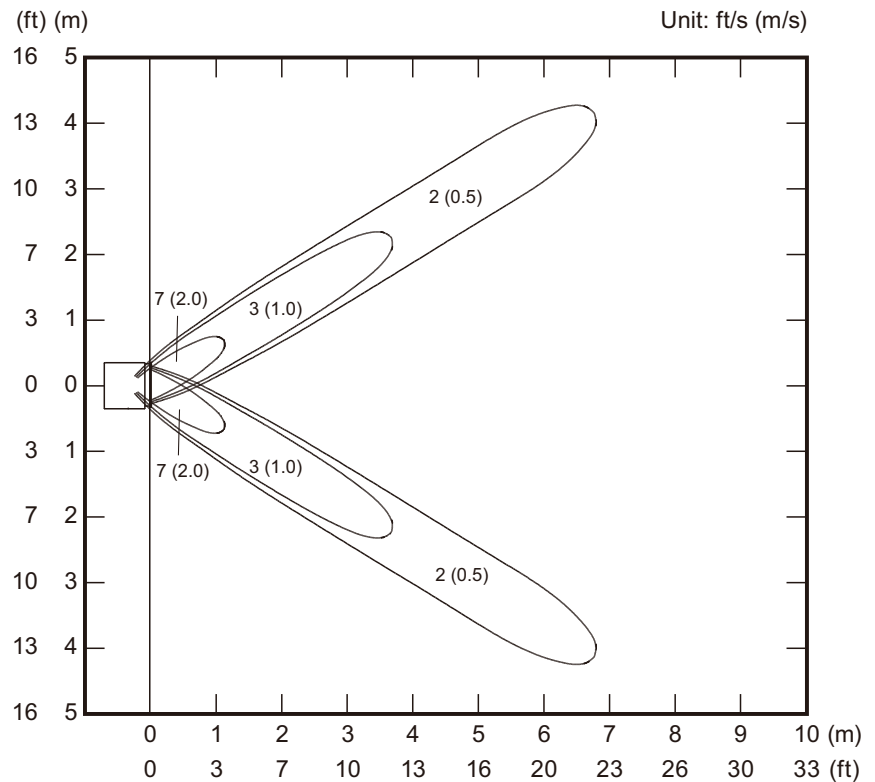


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

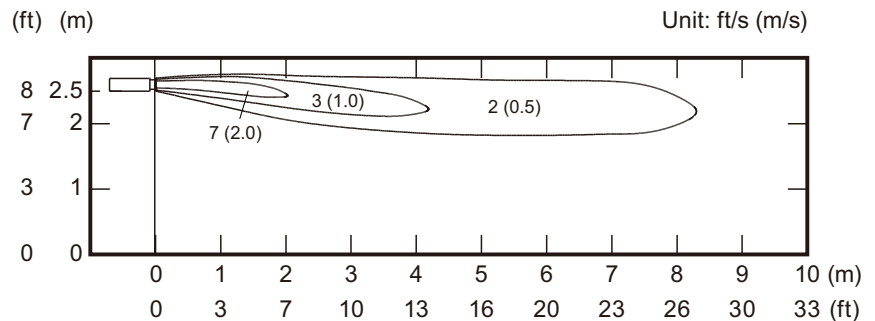

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


• Air velocity distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

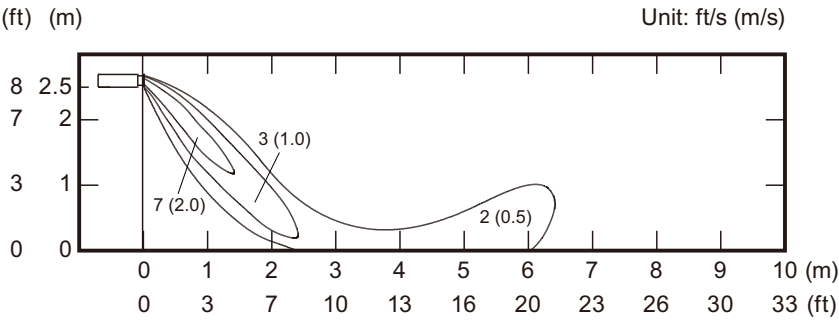

• Air temperature distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

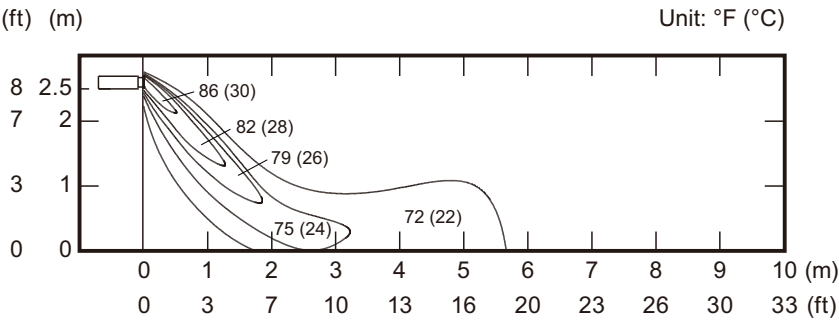


# Model: ARUL14TLAV2 (with UTD-GXSA-W)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

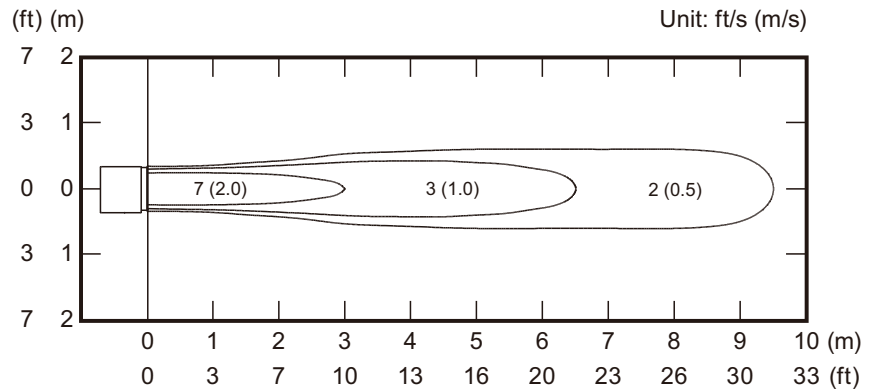

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

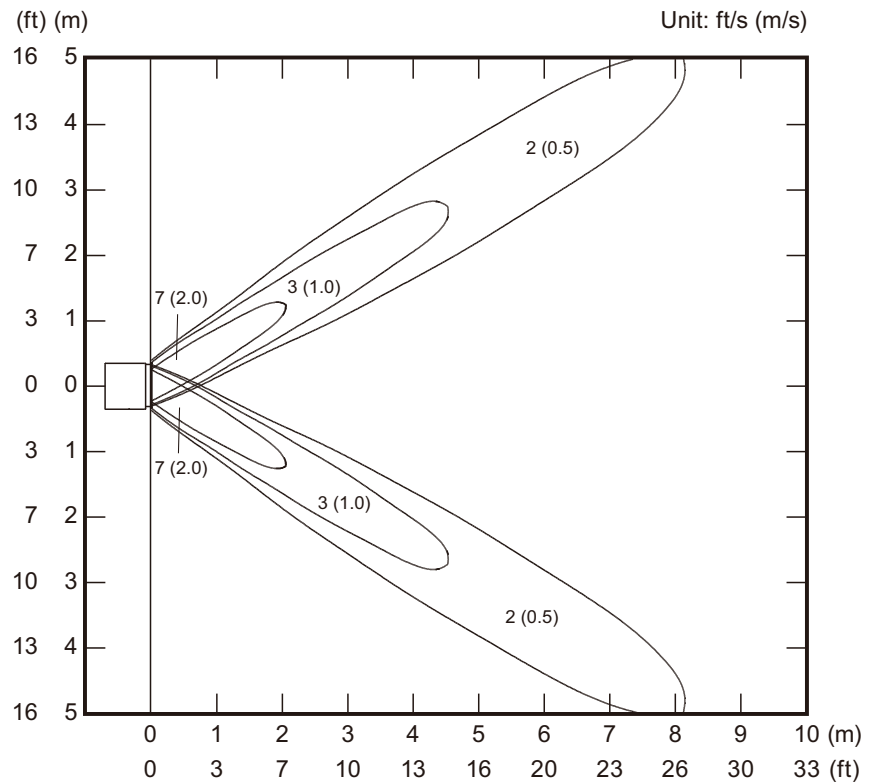


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

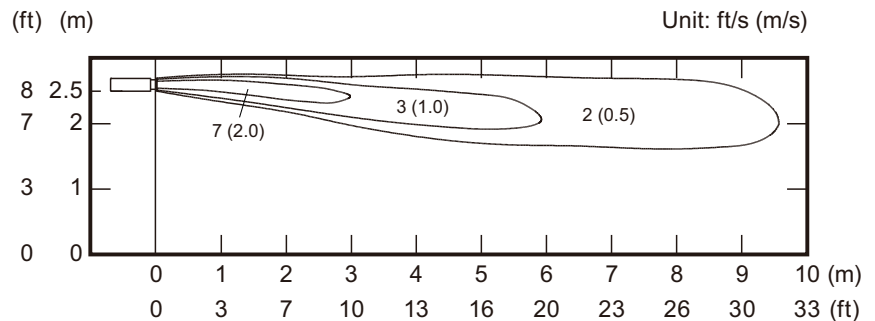

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


## • Air velocity distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

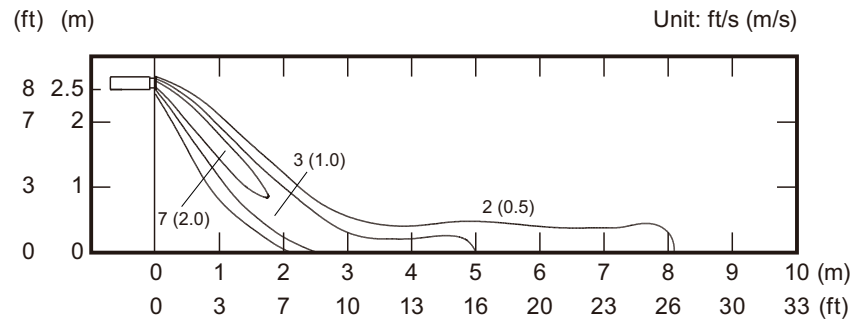

## • Air temperature distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

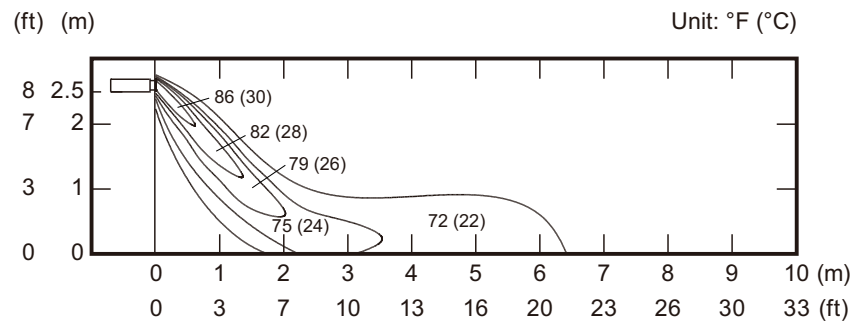


# Model: ARUL18TLAV2 (with UTD-GXSB-W)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

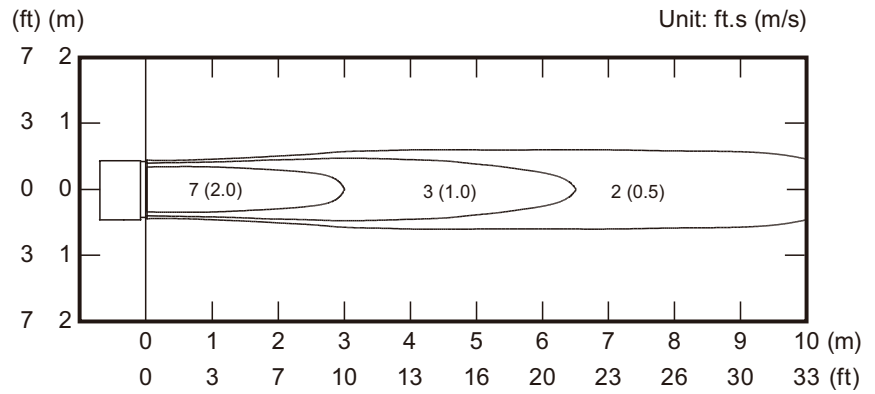

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

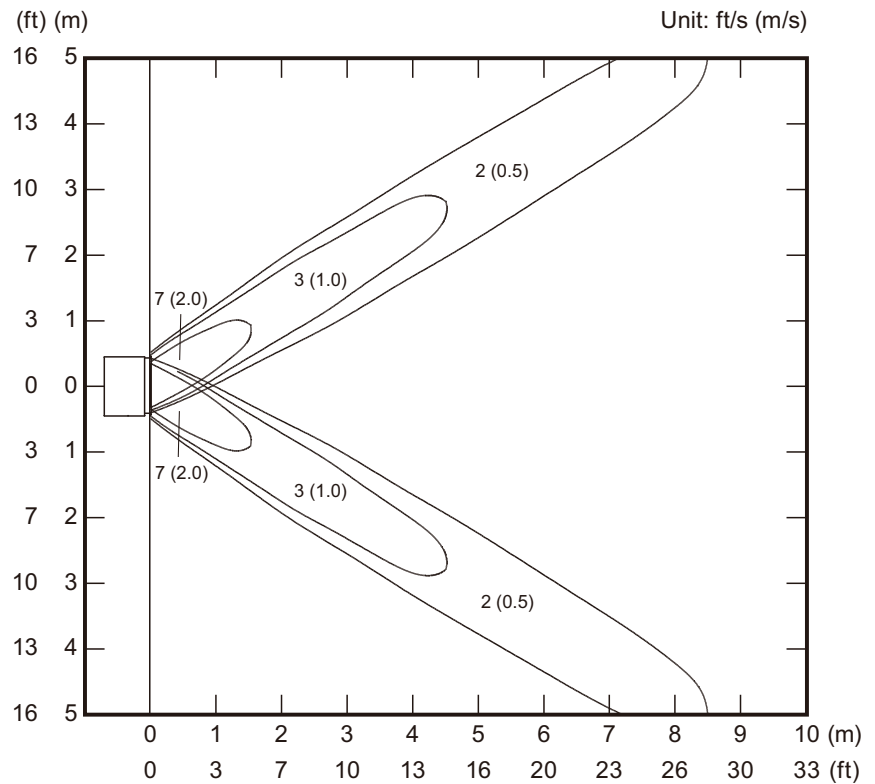


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

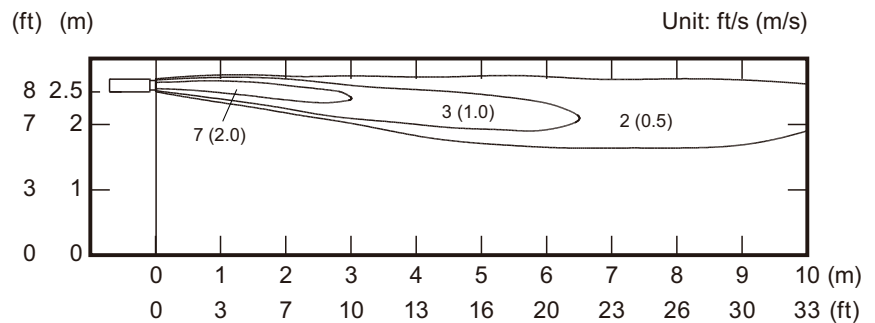

Measuring conditions	Fan speed	Operation mode
NOTE: Reference data	HIGH	HEAT


• Air velocity distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

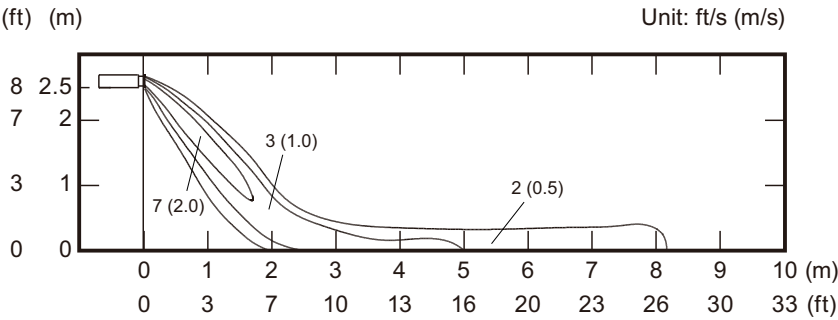

• Air temperature distribution

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

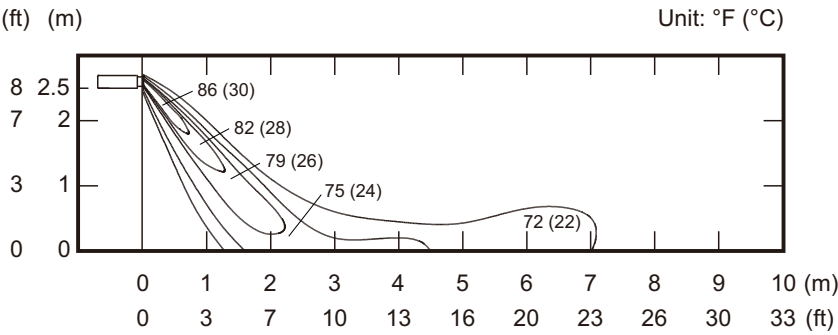


## 6-6. Compact floor type

### ■ Model: AGUA4TLAV2


Measuring conditions	Fan speed	Operation mode	Fan select
	HIGH	FAN	Upper & Lower

#### • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

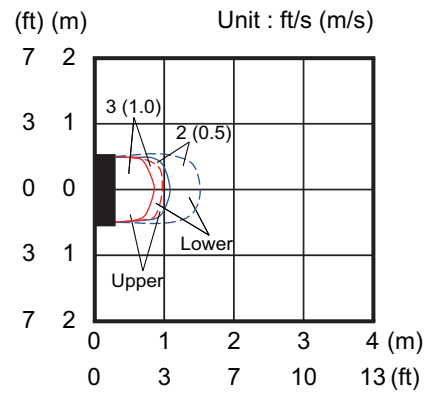


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

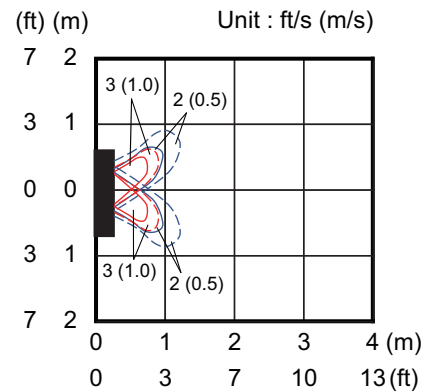

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

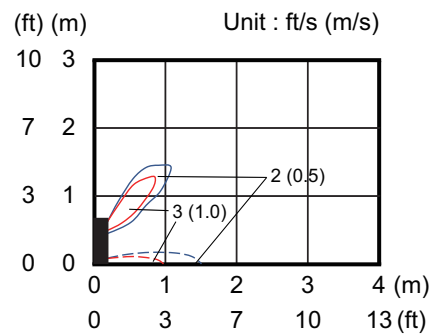

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

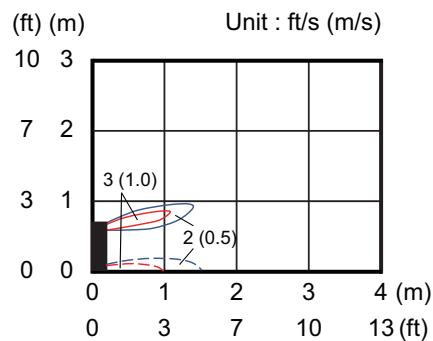




## Models: AGUA7TLAV2 and AGUA9TLAV2


Measuring conditions	Fan speed	Operation mode	Fan select
	HIGH	FAN	Upper & Lower

### • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

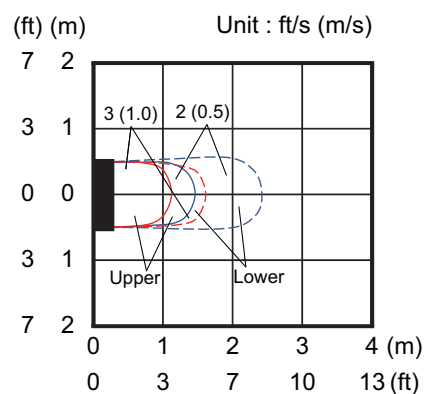


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

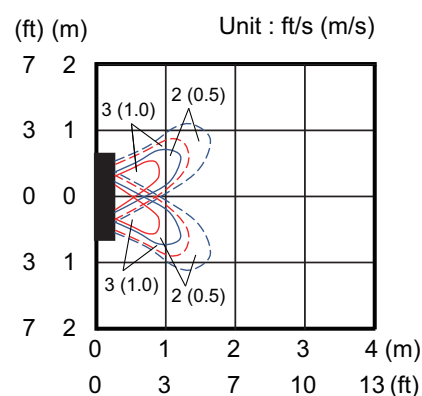

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

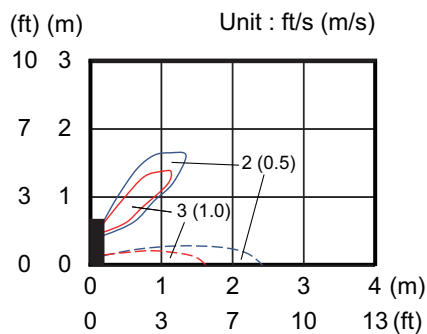

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

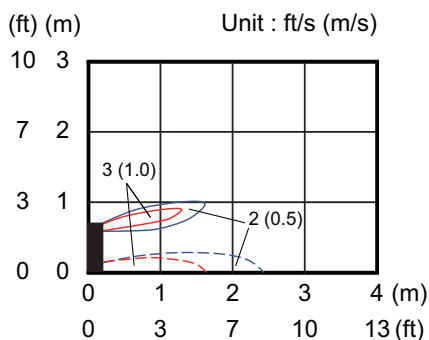


# Model: AGUA12TLAV2


Measuring conditions	Fan speed	Operation mode	Fan select
	HIGH	FAN	Upper & Lower

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

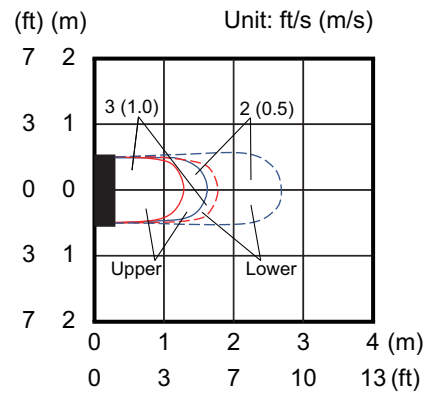


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

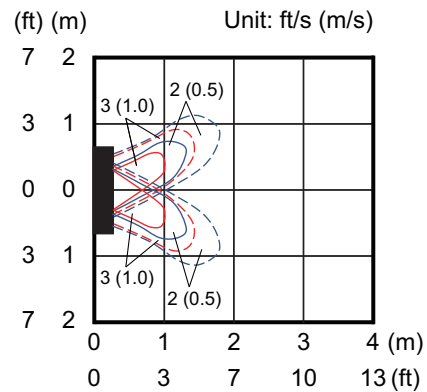

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

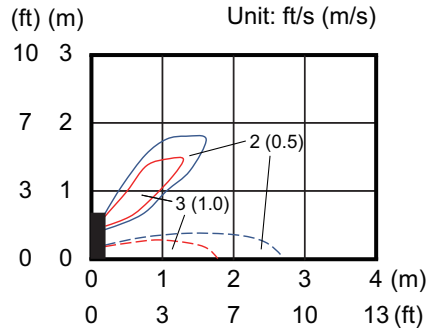

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

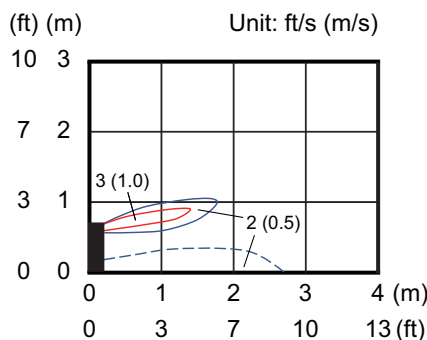


# Model: AGUA14TLAV2


Measuring conditions	Fan speed	Operation mode	Fan select
	HIGH	FAN	Upper & Lower

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

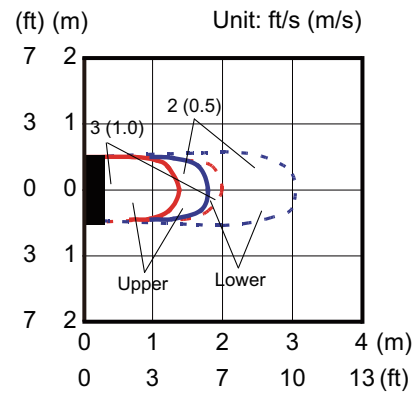


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

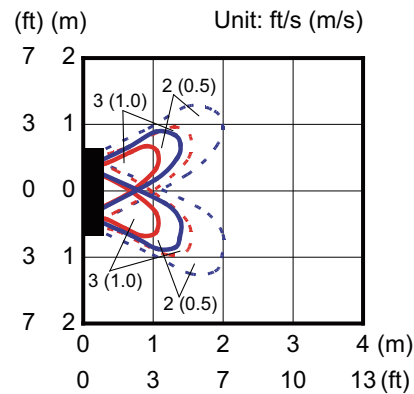

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

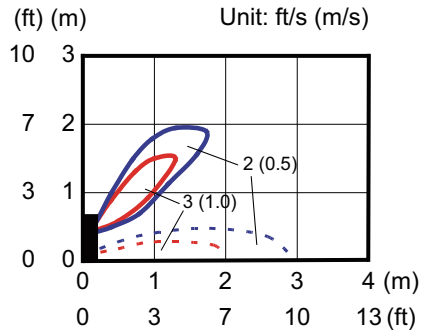

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

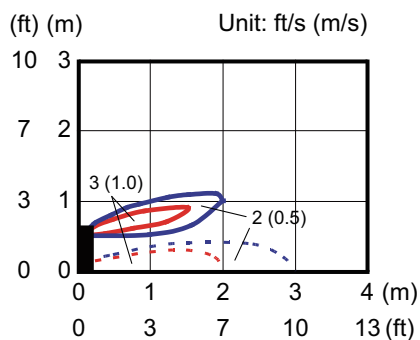


## 6-7. Floor/Ceiling type

### ■ Models: ABUA12TLAV2 and ABUA14TLAV2 (Floor console)


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution



Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

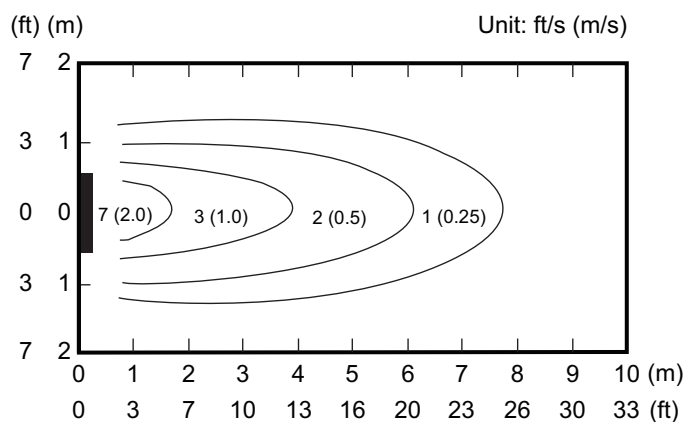


Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Left & Right

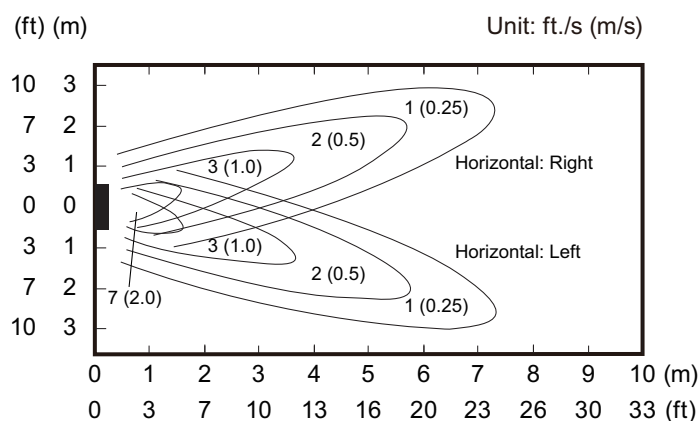

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

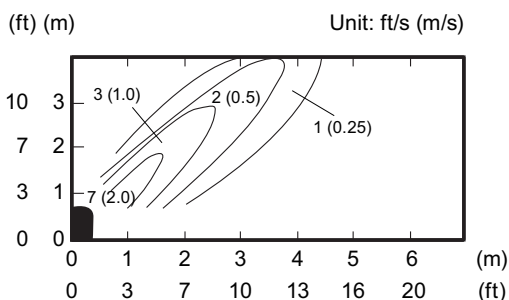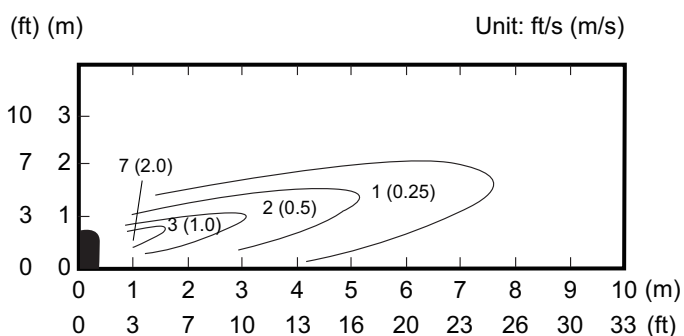

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

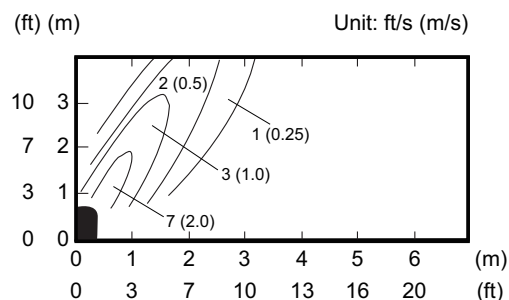


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

# Models: ABUA12TLAV2 and ABUA14TLAV2 (Under ceiling)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution



Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

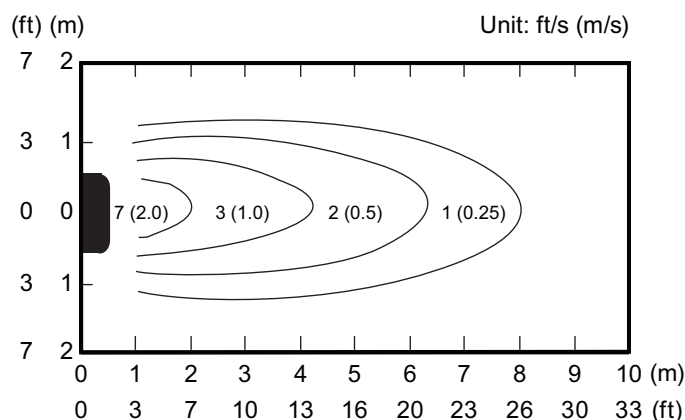


Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Left & Right

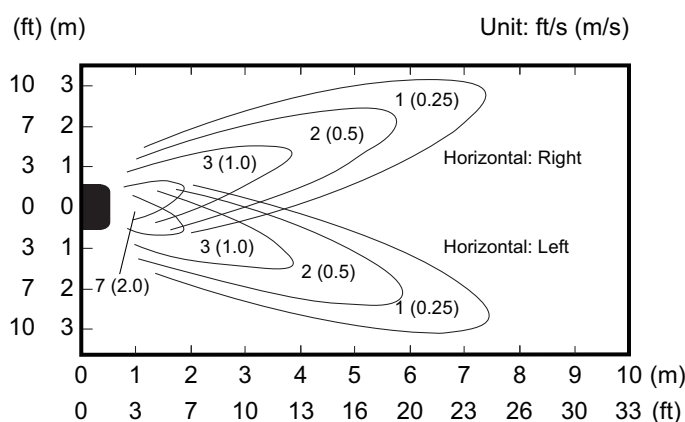

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

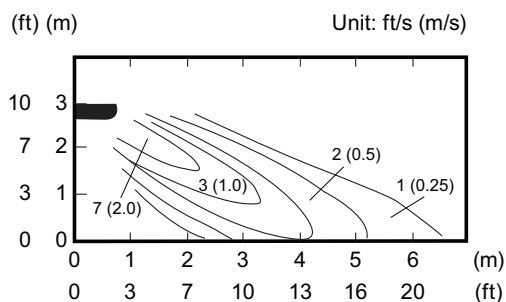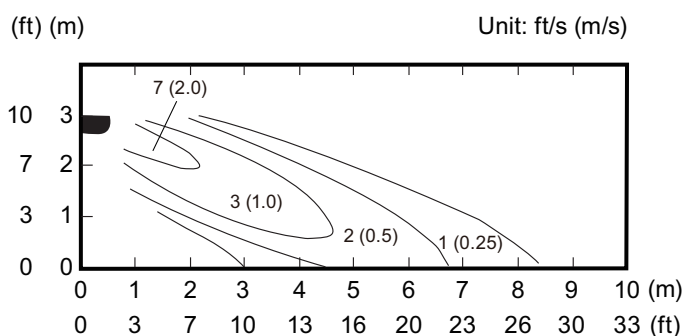

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

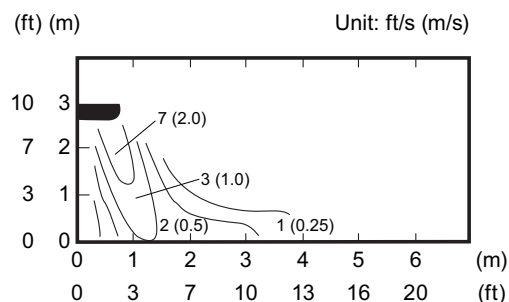


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

# Model: ABUA18TLAV2 (Floor console)


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution



Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

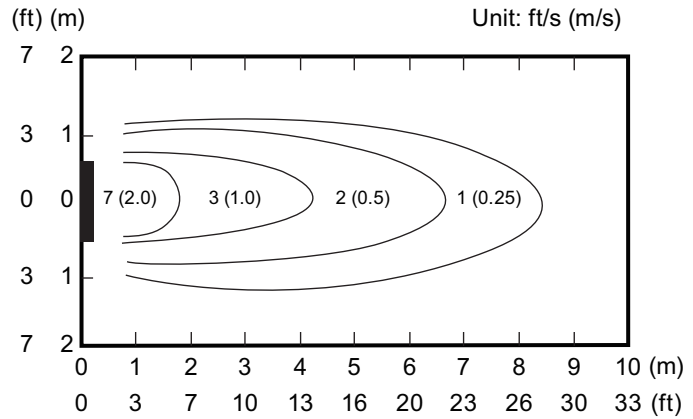


Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Left & Right

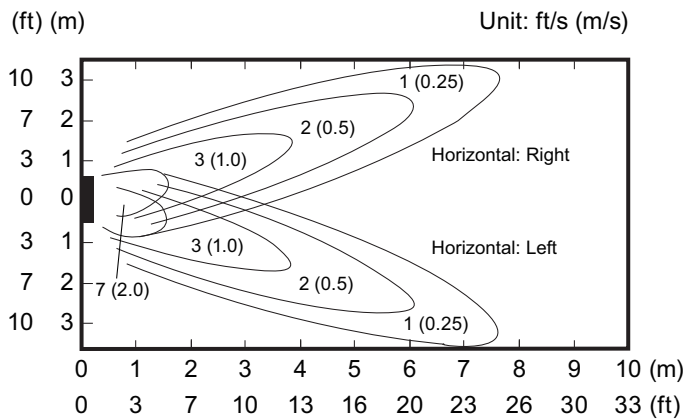

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

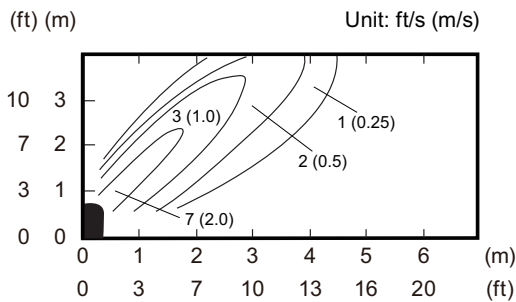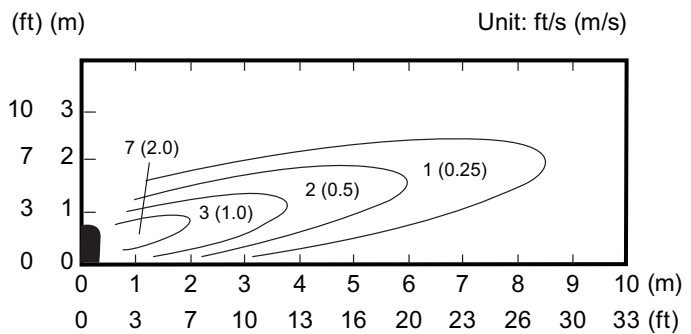

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

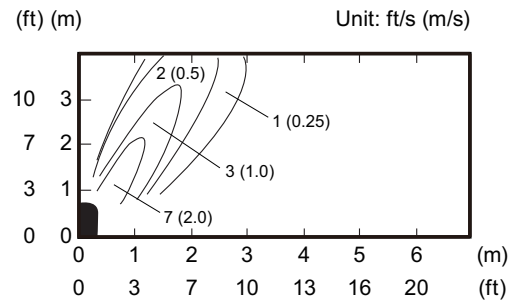


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

# Model: ABUA18TLAV2 (Under ceiling)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution



Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

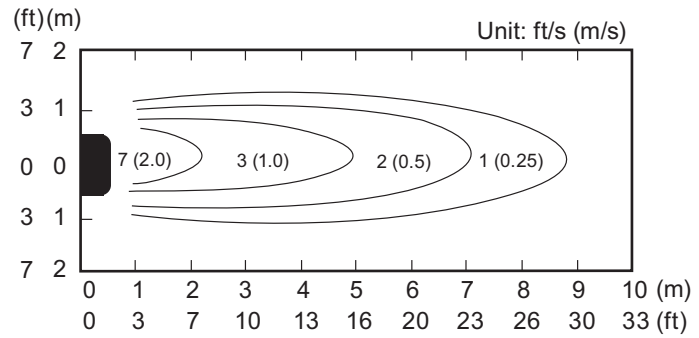


Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Left & Right

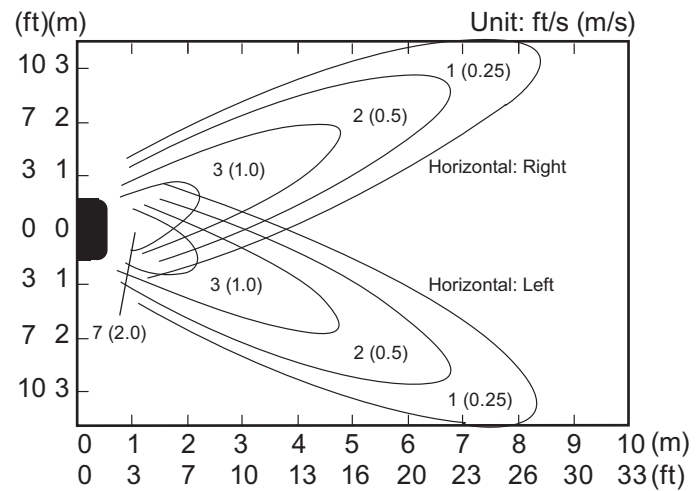

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

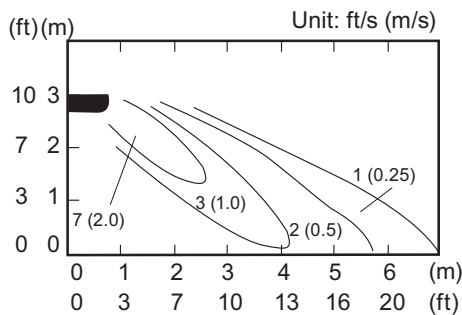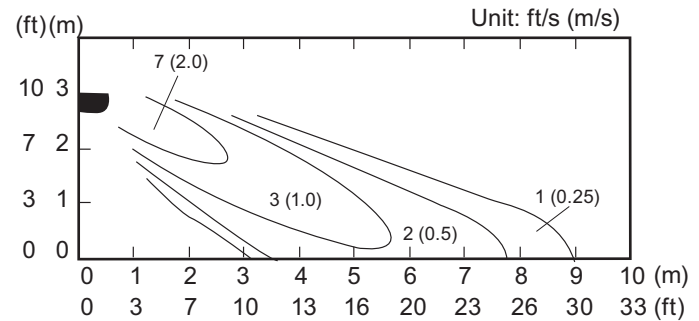

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

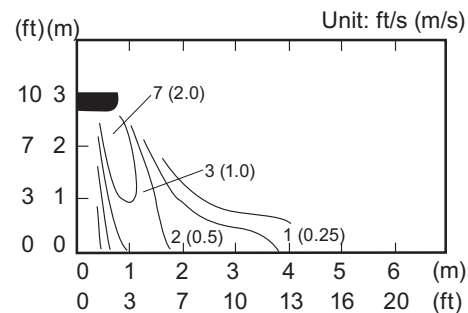


Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

# Model: ABUA24TLAV2 (Floor console)


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution



Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

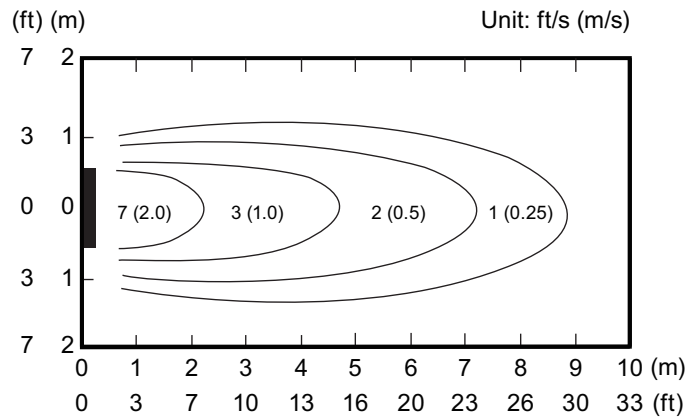


Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Left & Right

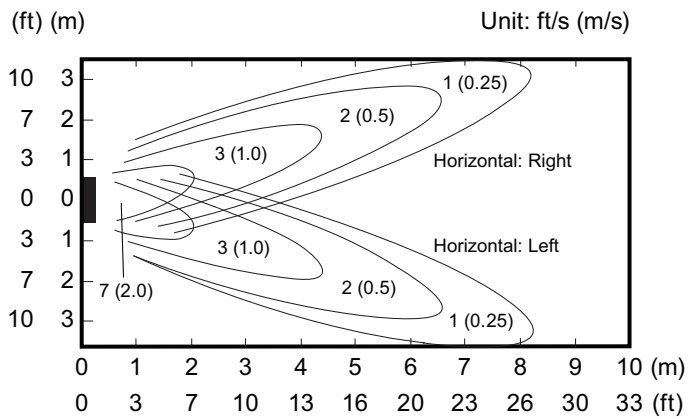

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

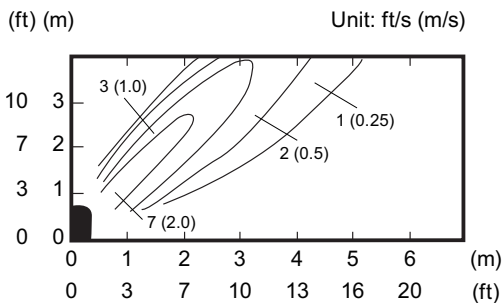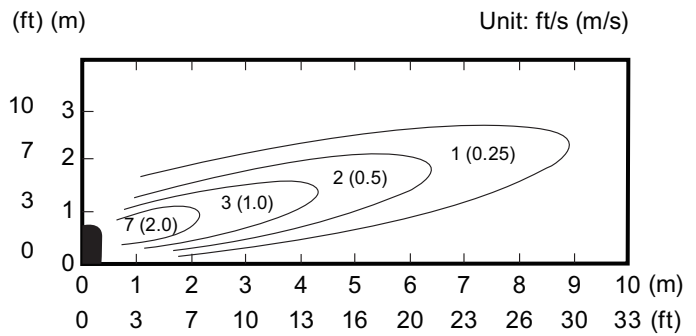

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

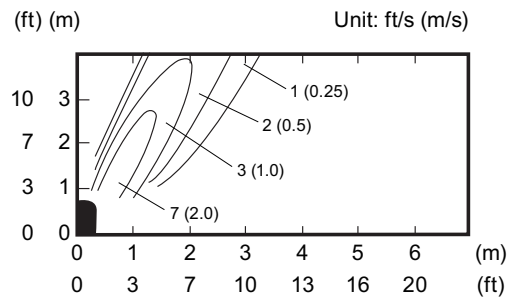

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center




# Model: ABUA24TLAV2 (Under ceiling)


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution



Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

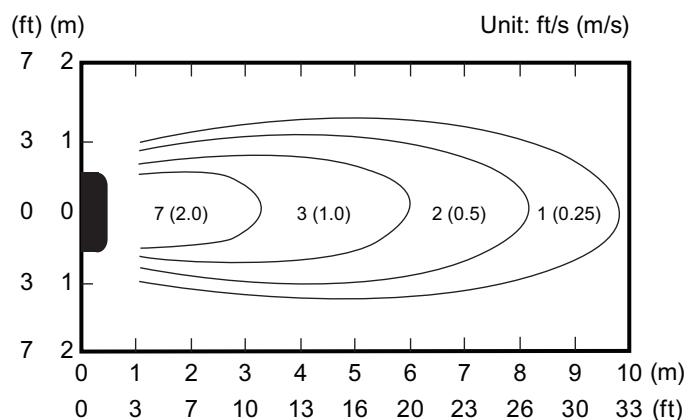


Top view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Left & Right

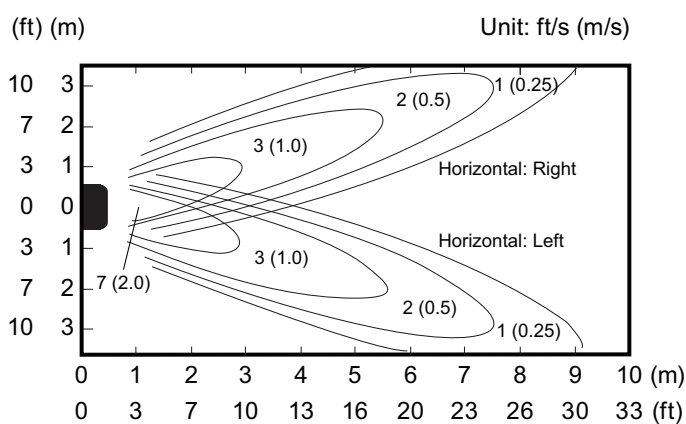

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

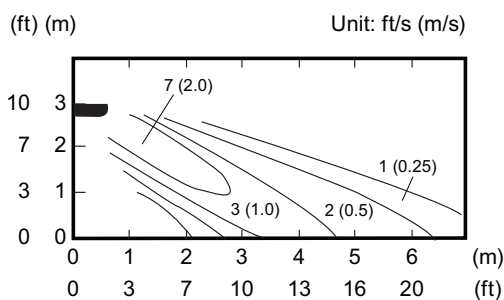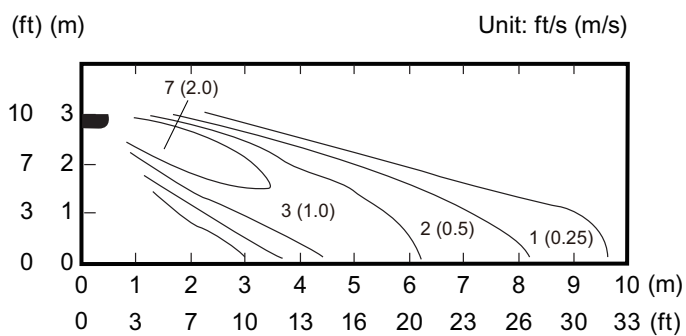

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

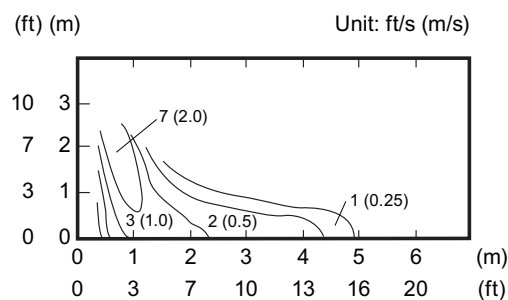

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center


## 6-8. Ceiling type

### ■ Model: ABUA30TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution



Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

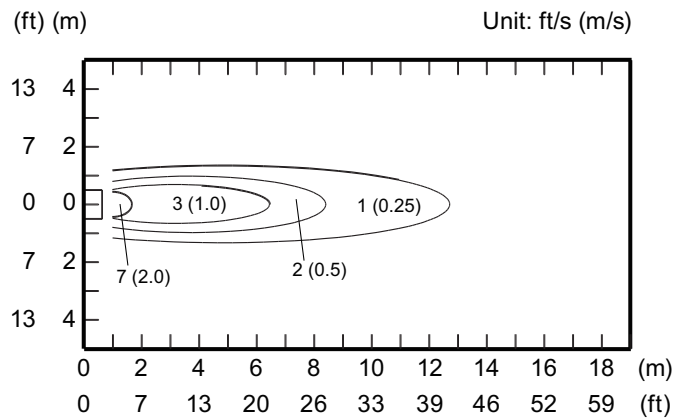


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

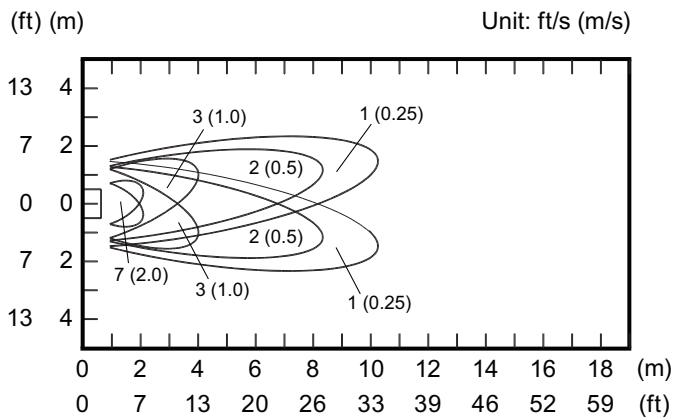

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

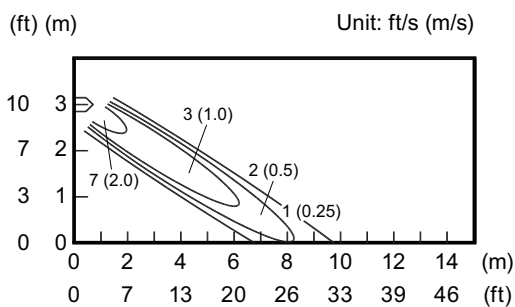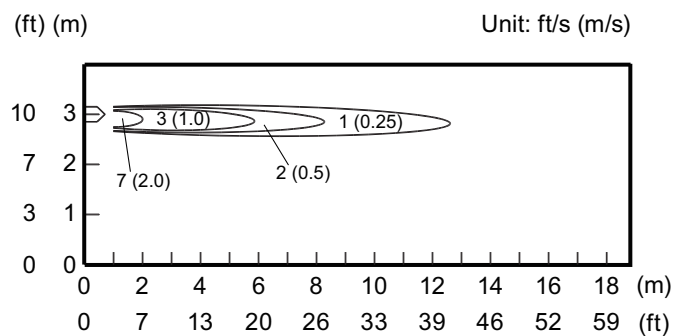

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

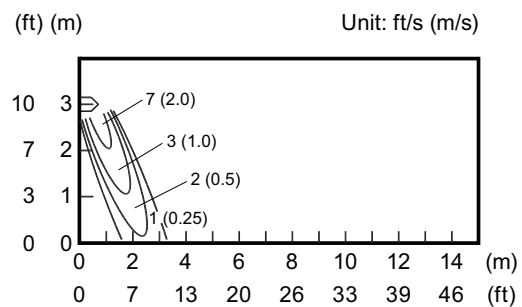


Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

# Model: ABUA36TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution



Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

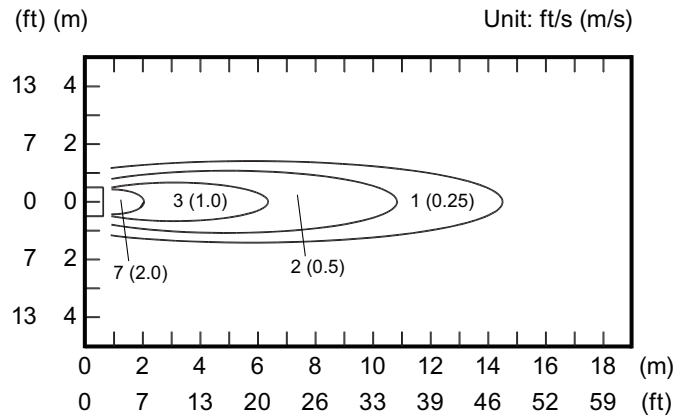


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

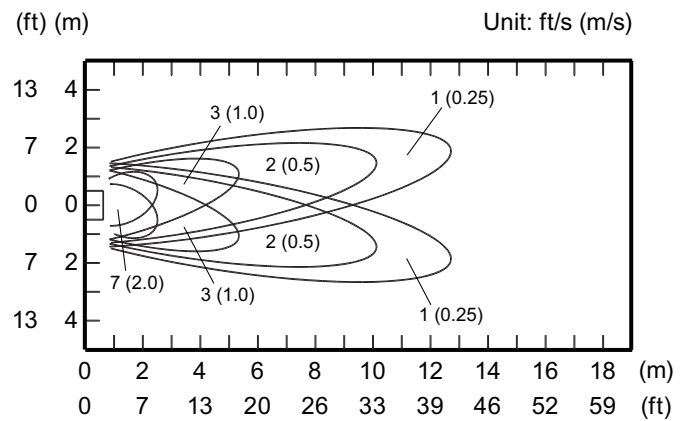

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

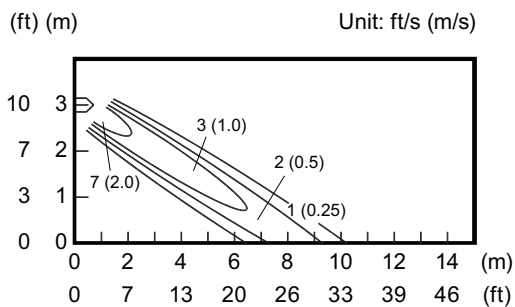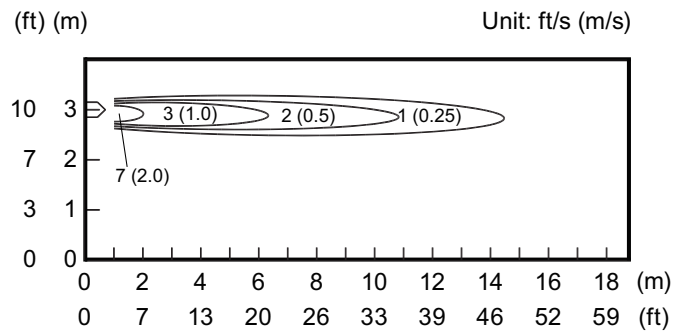

Side view  
Vertical airflow direction louver: Center  
Horizontal airflow direction louver: Center

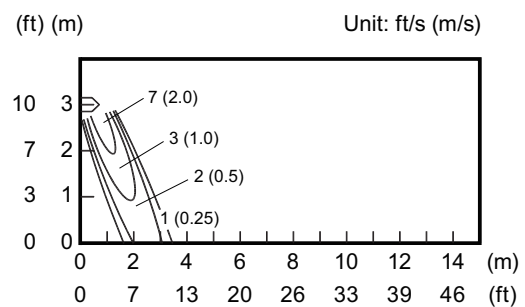

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center


## 6-9. Wall mounted type

### ■ Model: ASUA4TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

#### • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

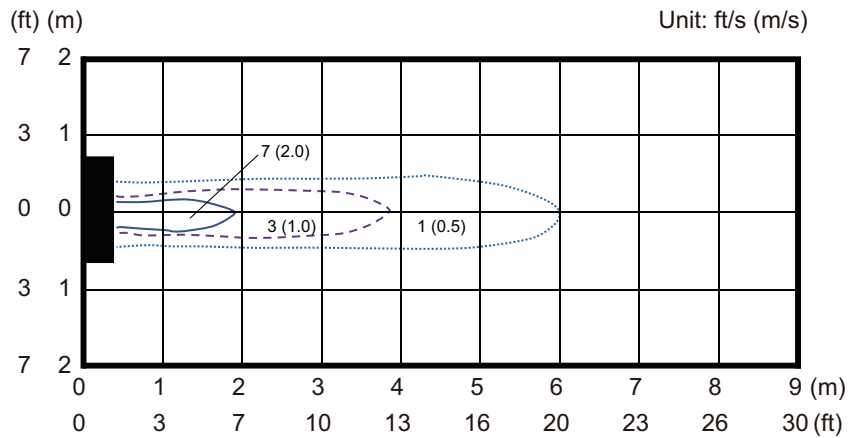


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

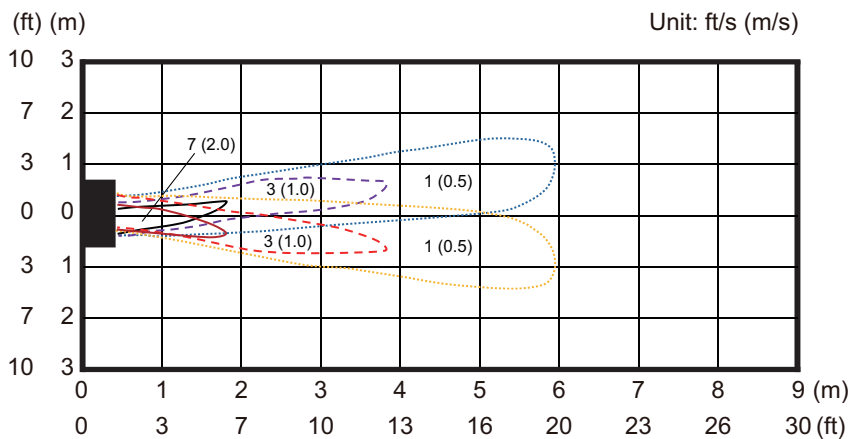

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

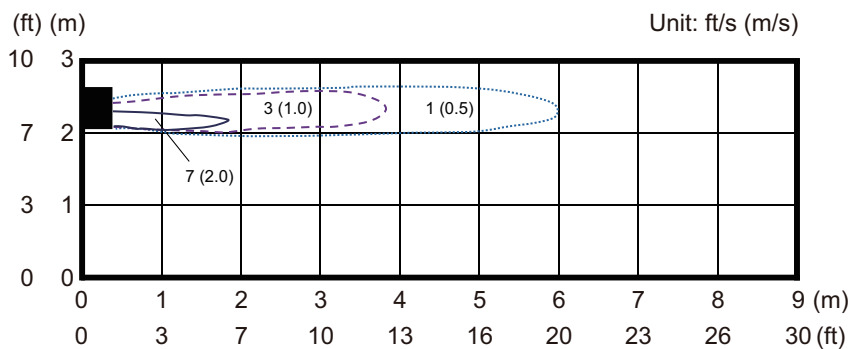

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

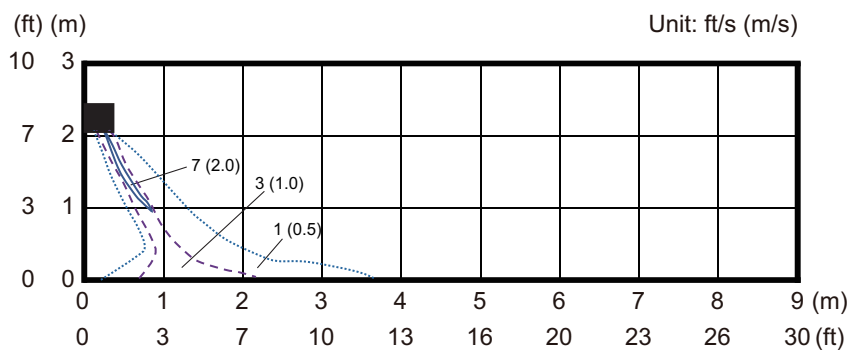


# Model: ASUA7TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

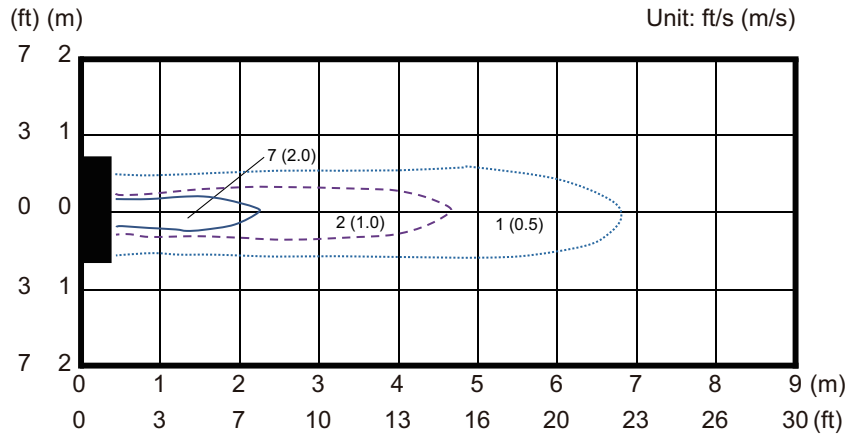


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

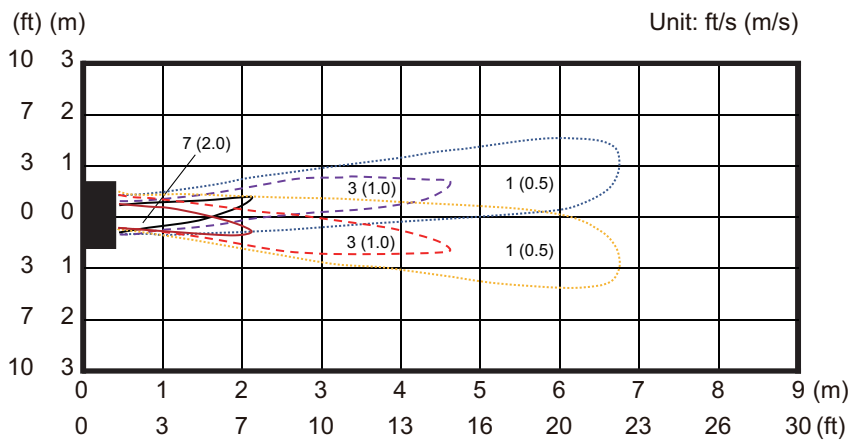

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

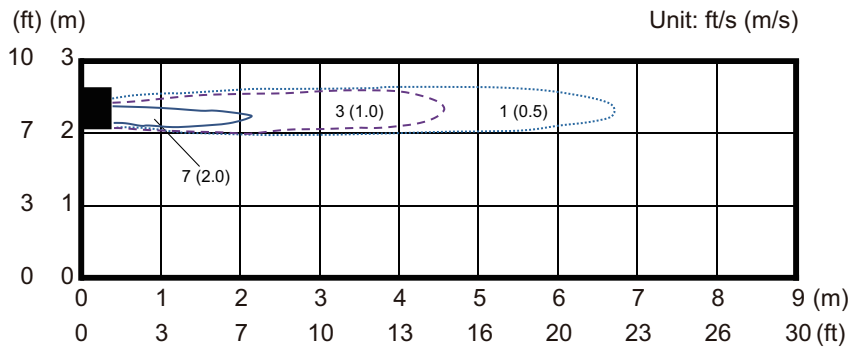

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

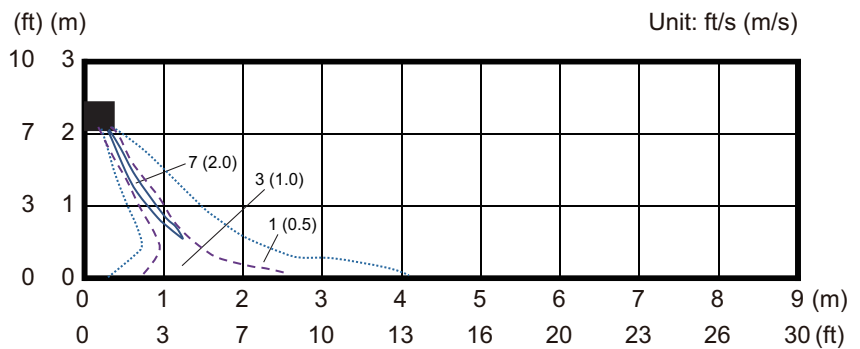


# Model: ASUA9TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

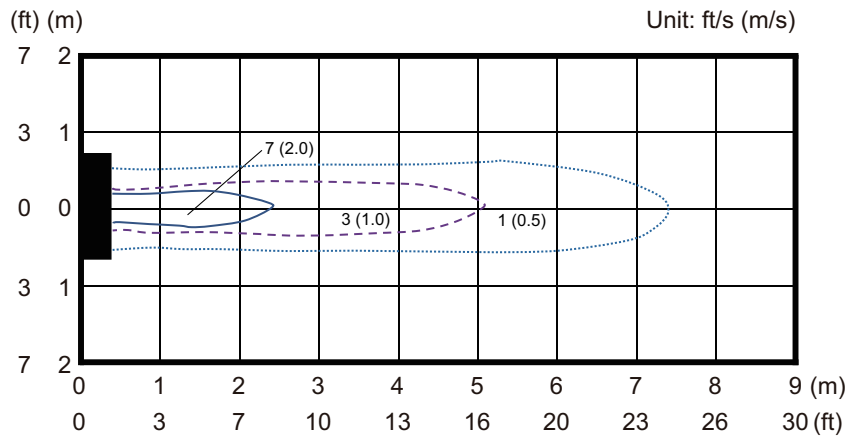


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

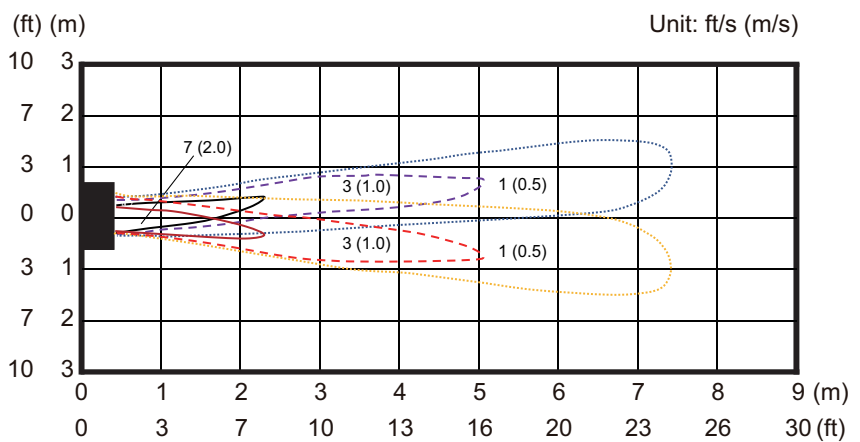

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

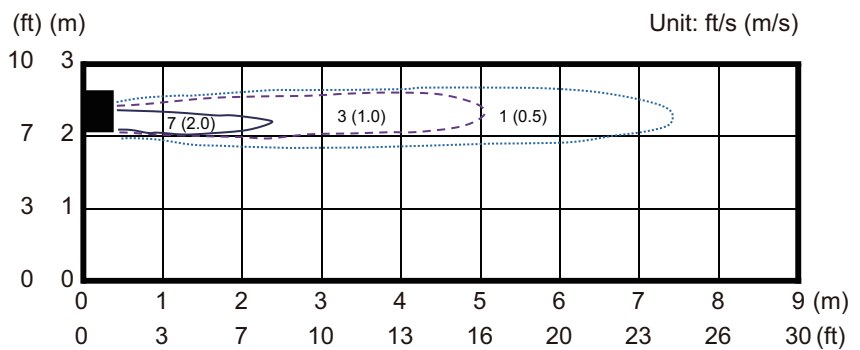

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

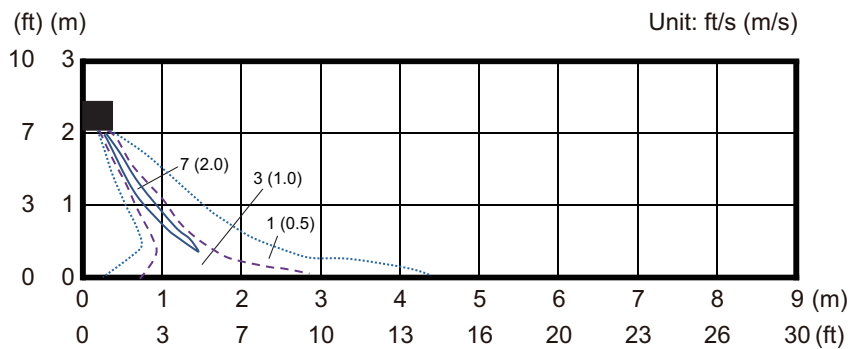


# Model: ASUA12TLAV2


Measuring conditions	Fan speed HIGH	Operation mode FAN
----------------------	-------------------	-----------------------

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

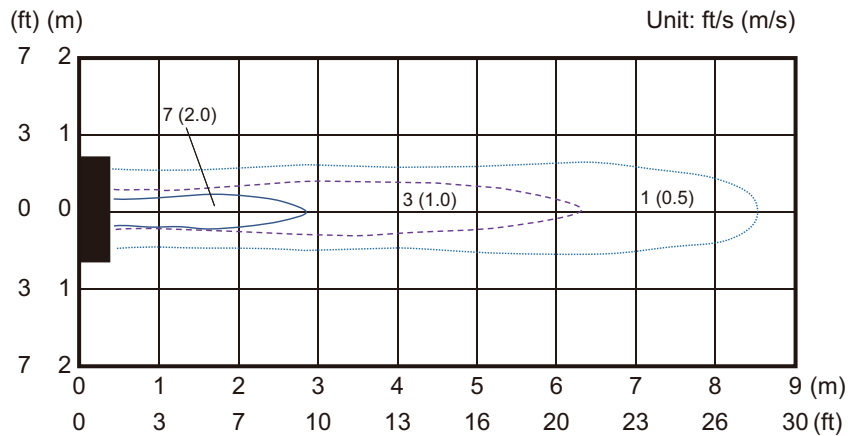


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

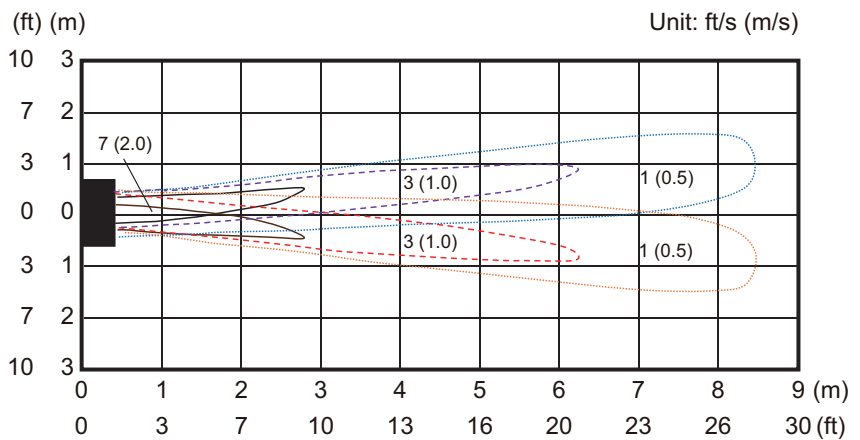

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

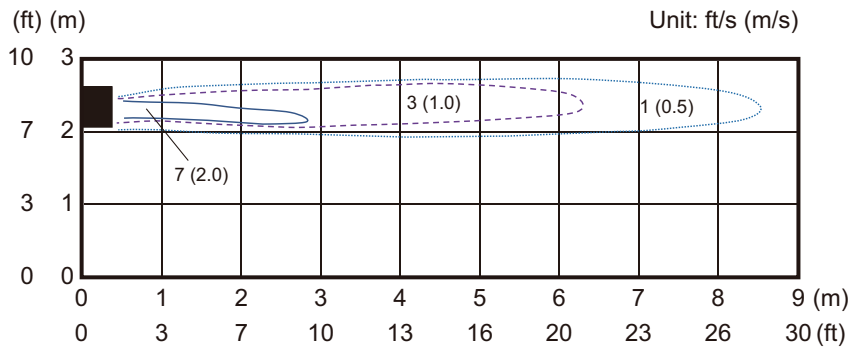

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

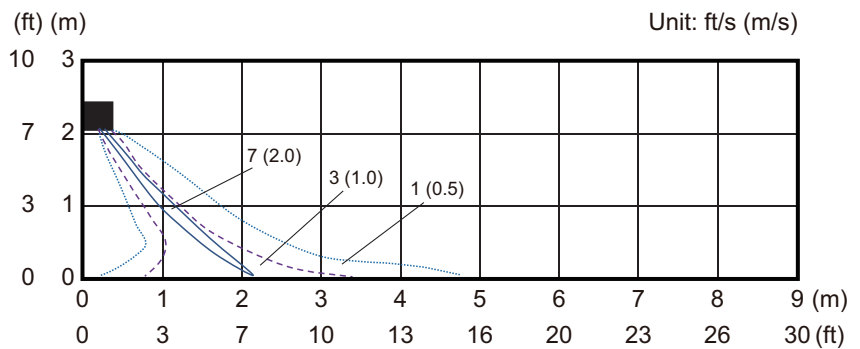


# Model: ASUA14TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

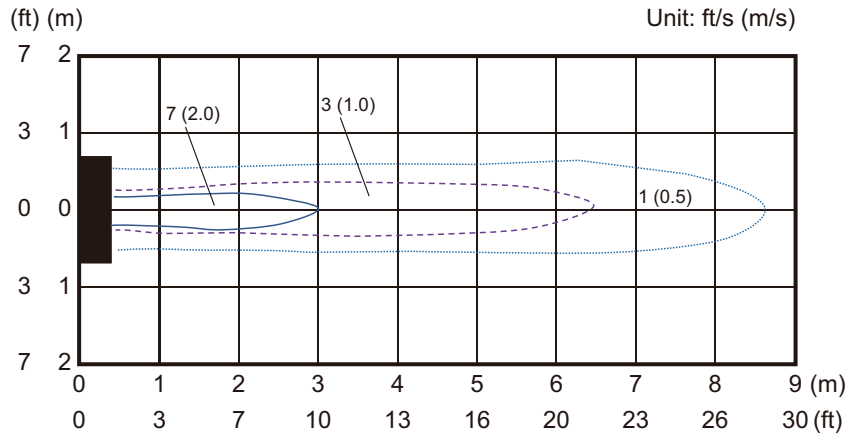


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

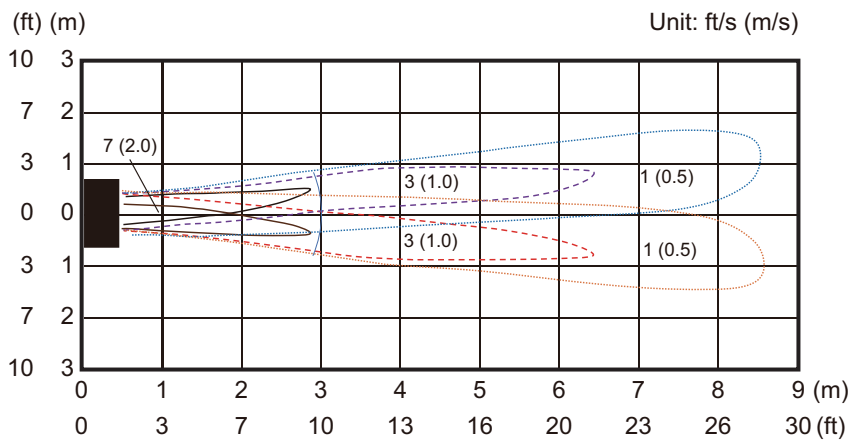

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

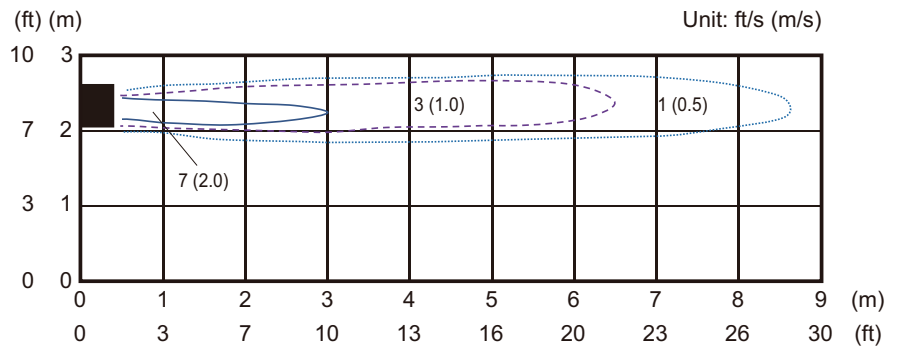

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

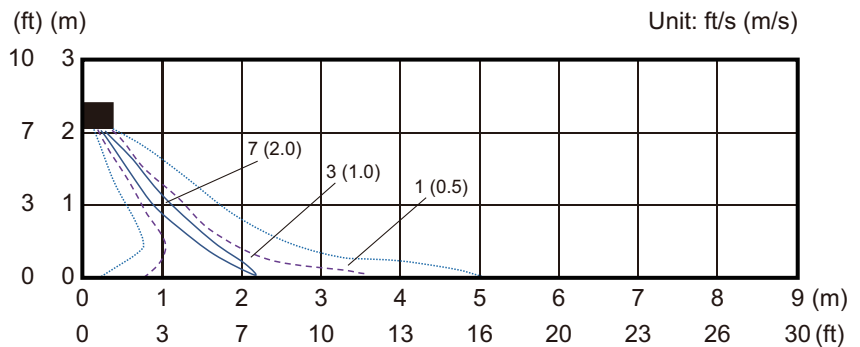




# Models: ASUB18TLAV1 and ASUB18TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

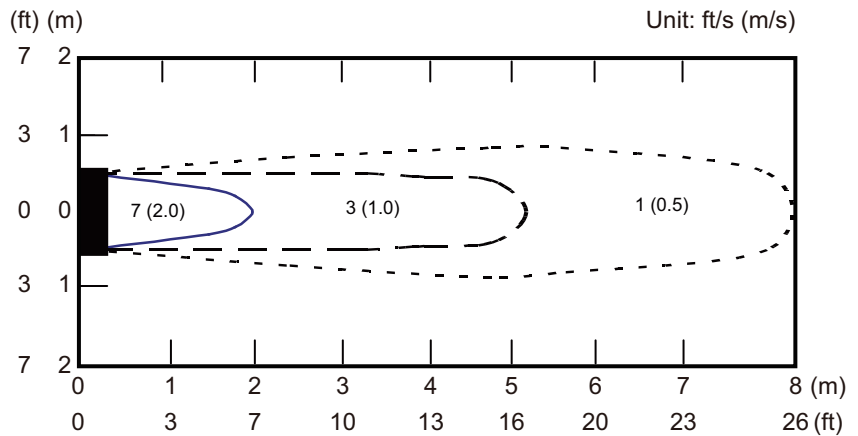


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

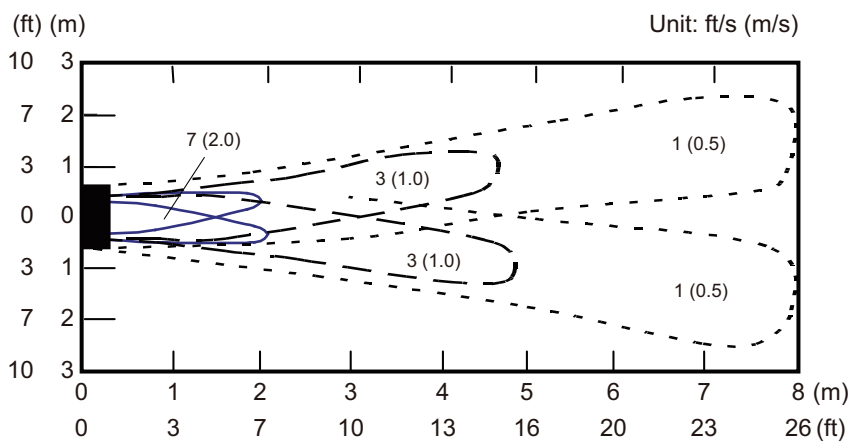

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

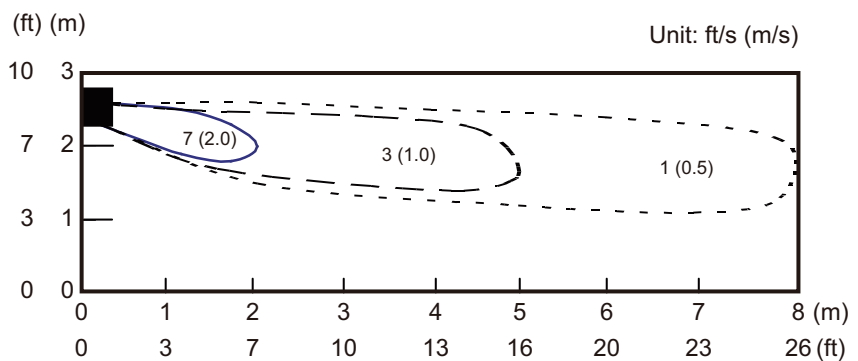

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

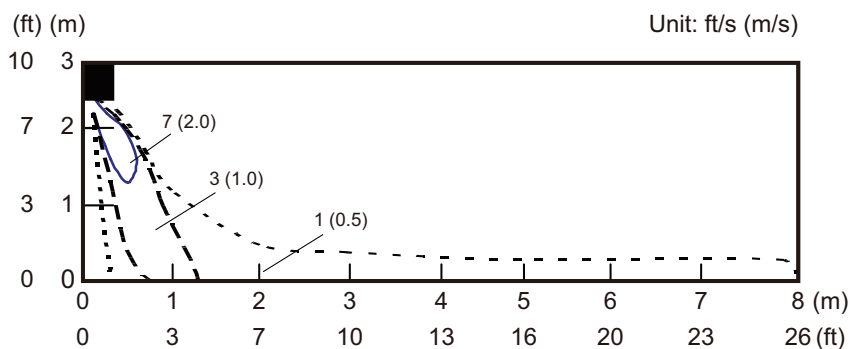


# Models: ASUB24TLAV1 and ASUB24TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

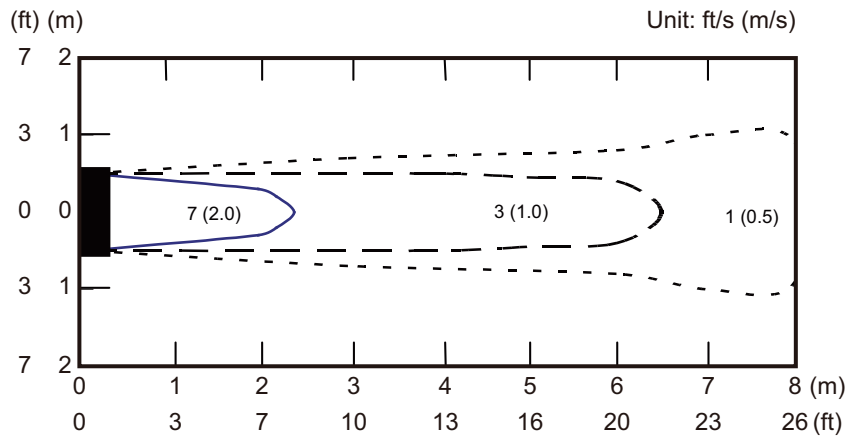


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

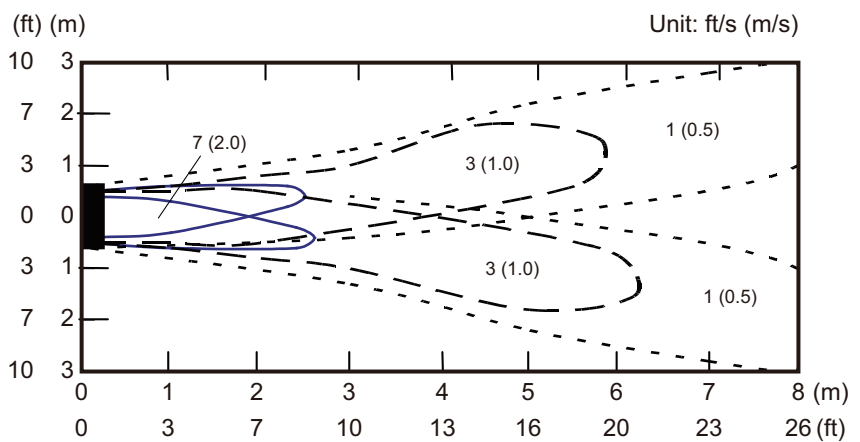

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

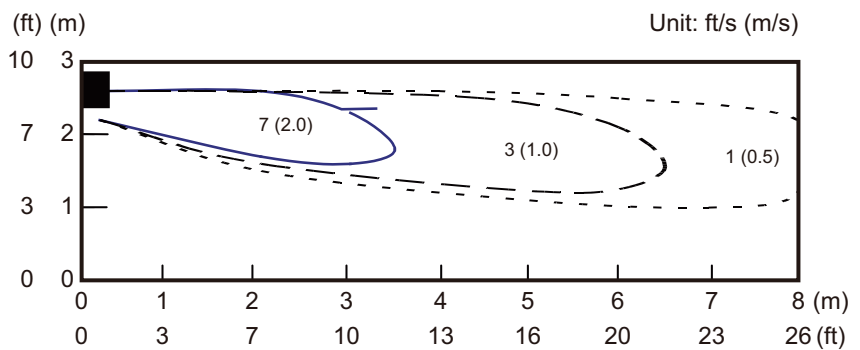

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

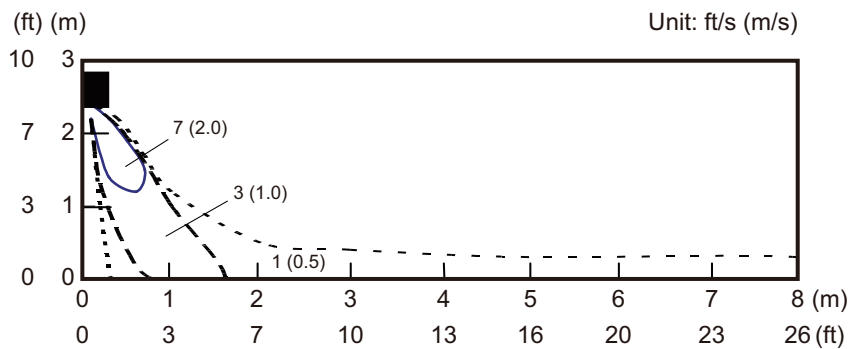


# Model: ASUA30TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

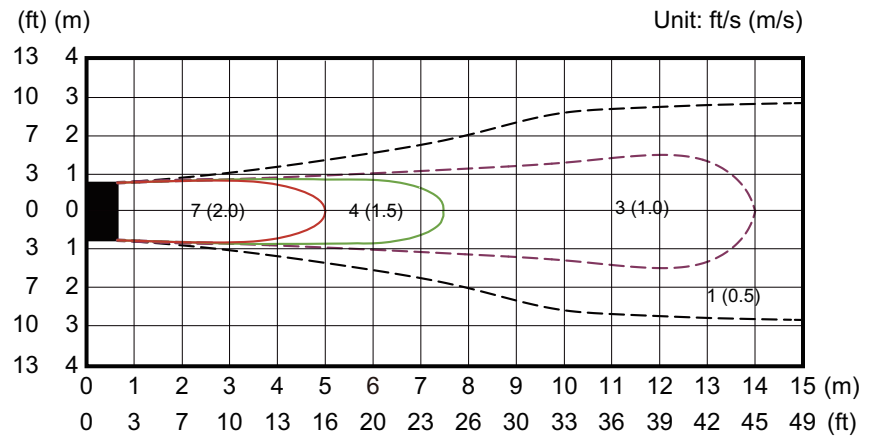

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

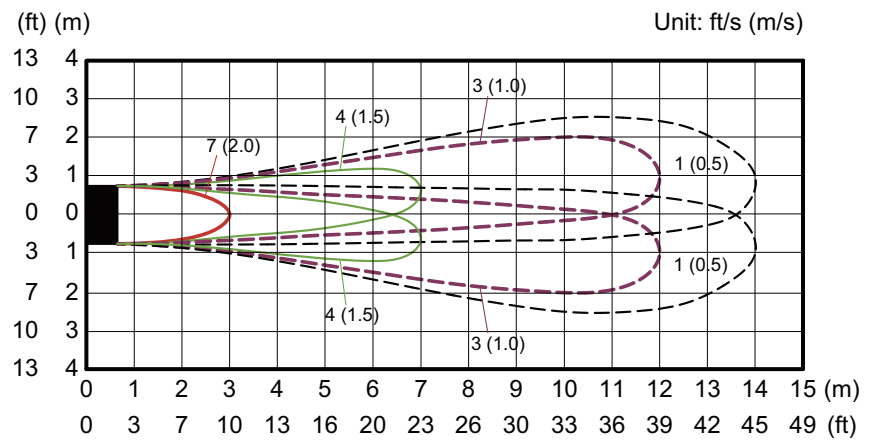

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

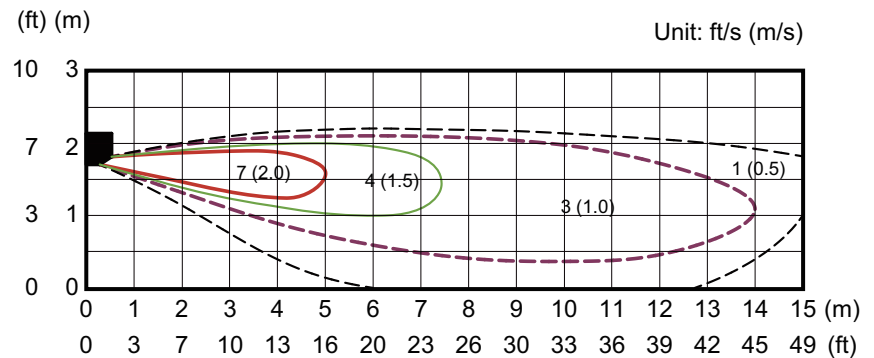


# Model: ASUA36TLAV2


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

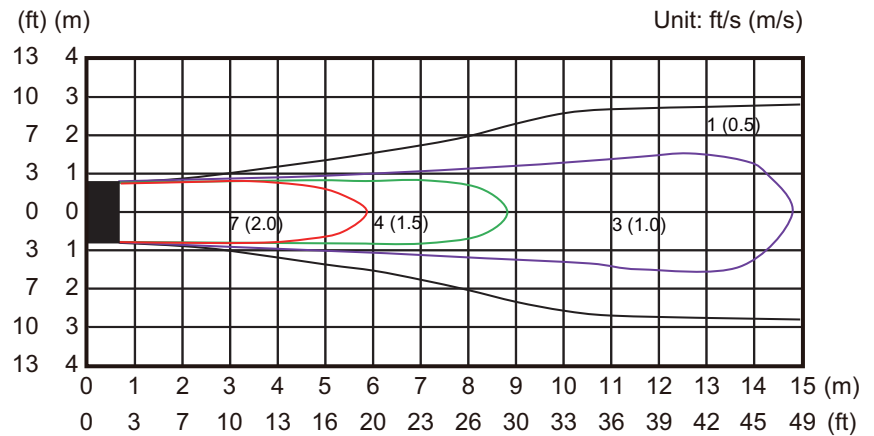

Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

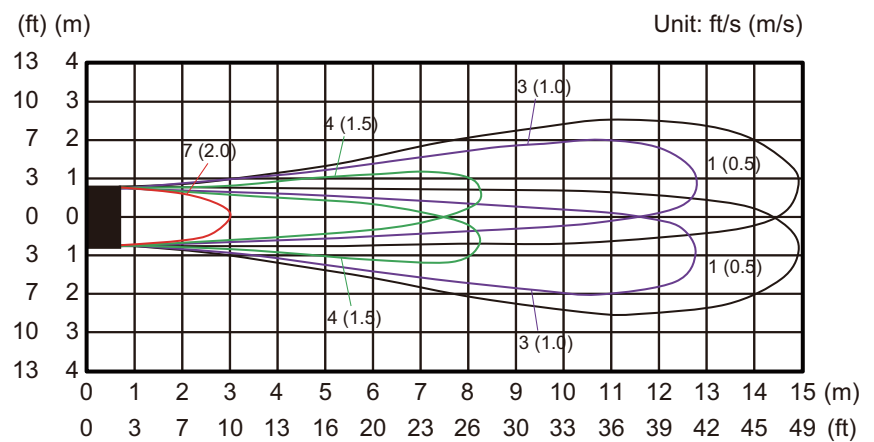

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

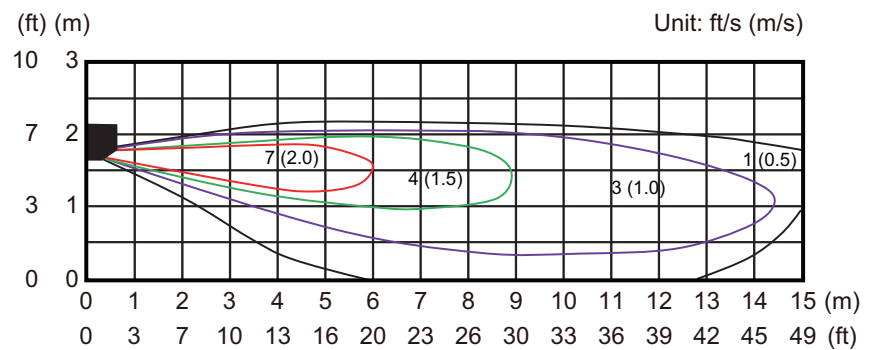


# Models: ASUA7TLAV and ASUA9TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

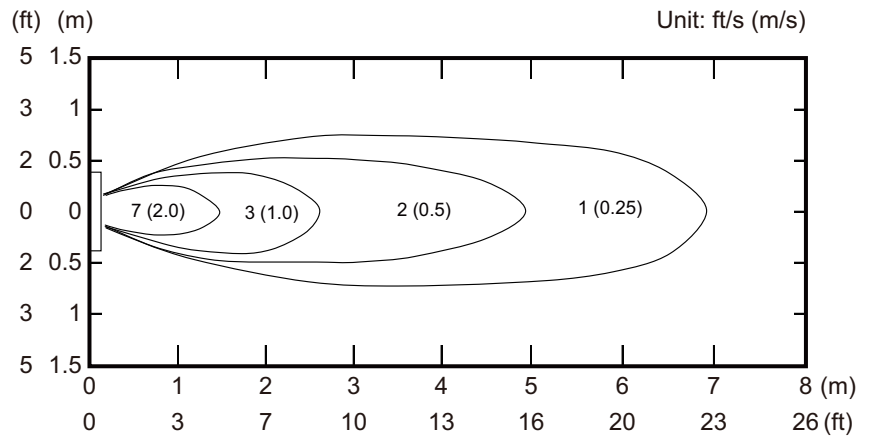


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

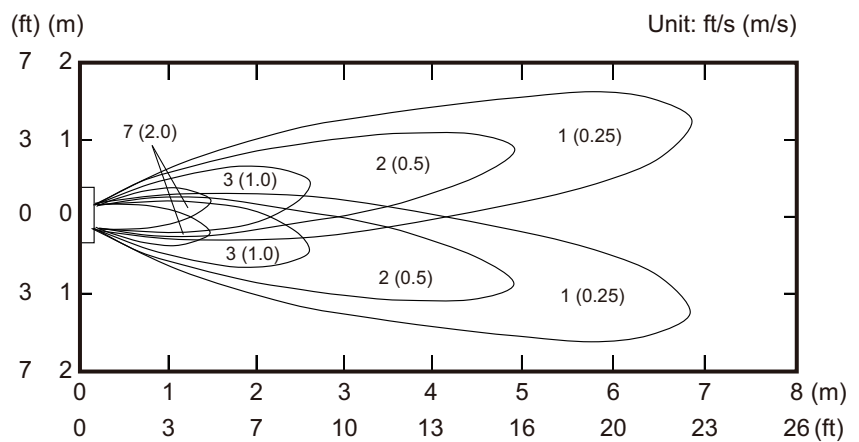

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

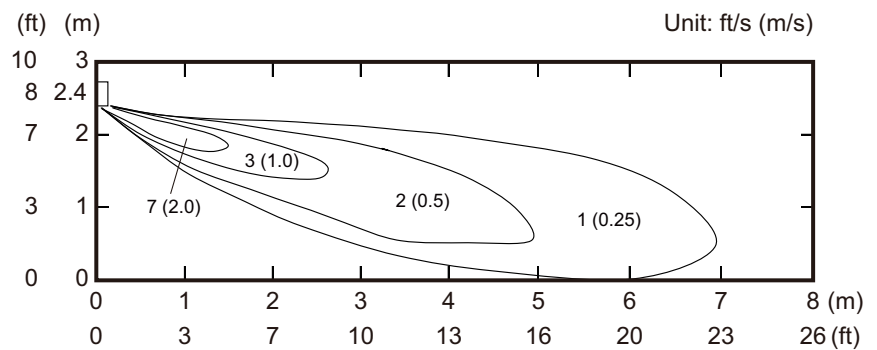

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

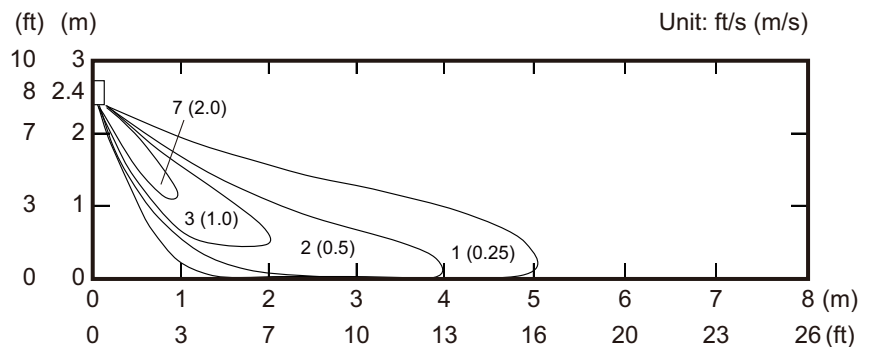


# Model: ASUA12TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

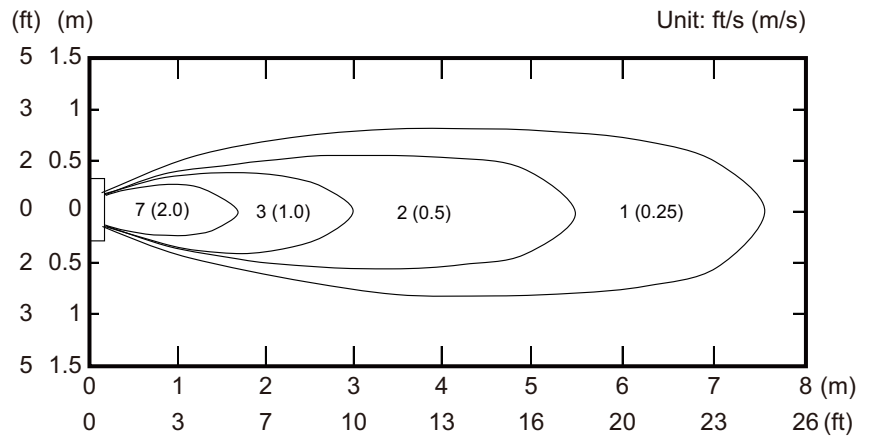


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

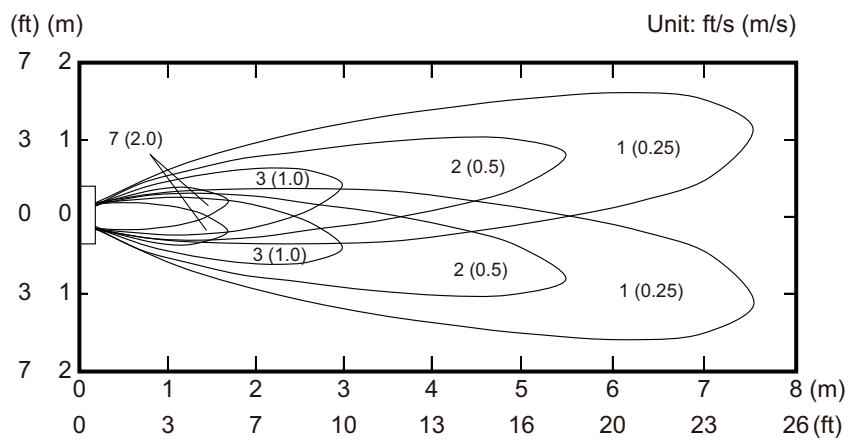

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

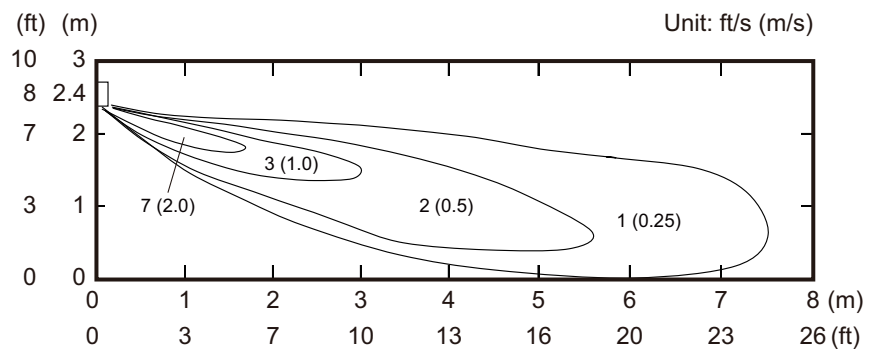

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

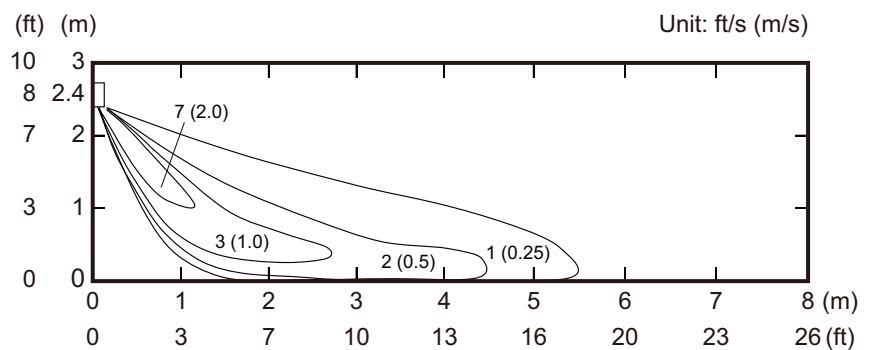


# Model: ASUA14TLAV


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

## • Air velocity distribution


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

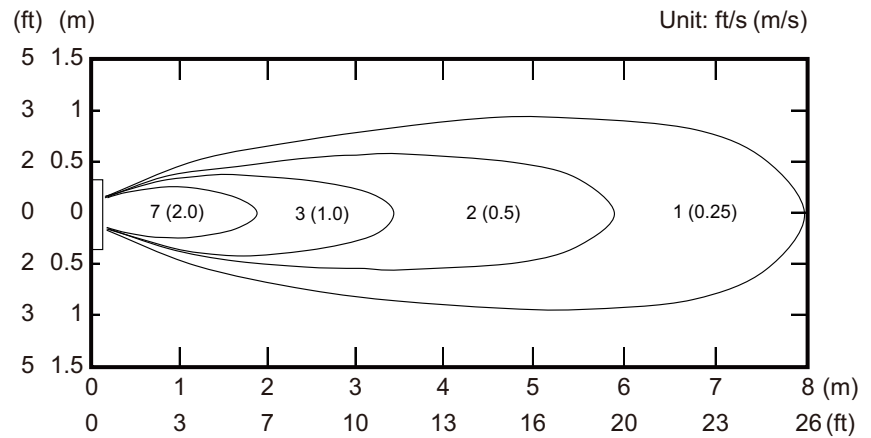


Top view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Left & Right

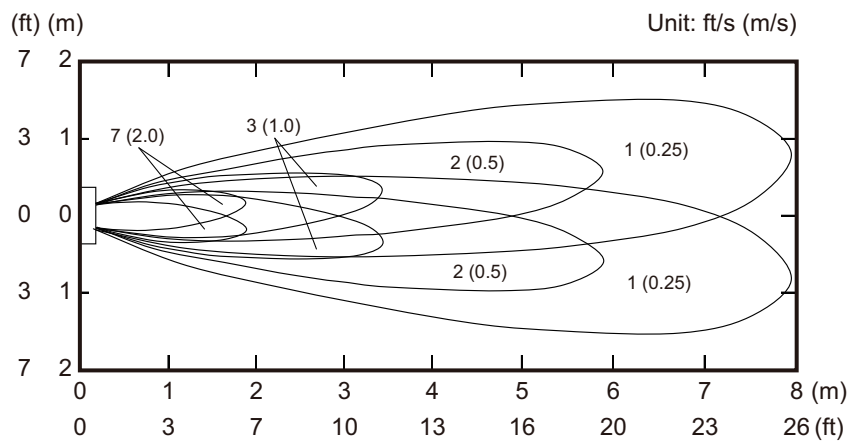

Side view  
Vertical airflow direction louver: Up  
Horizontal airflow direction louver: Center

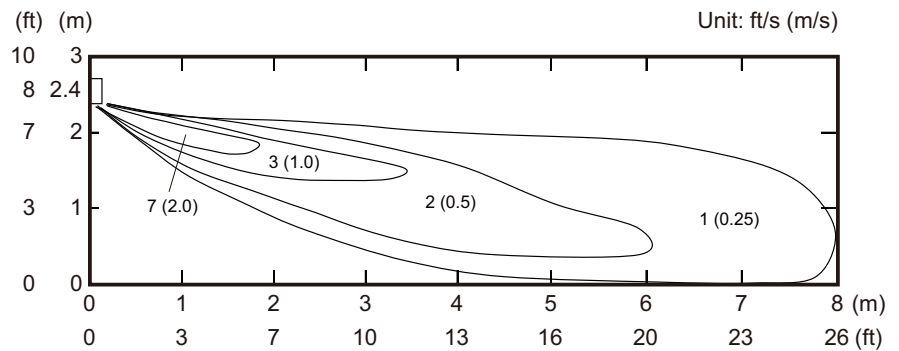

Side view  
Vertical airflow direction louver: Down  
Horizontal airflow direction louver: Center

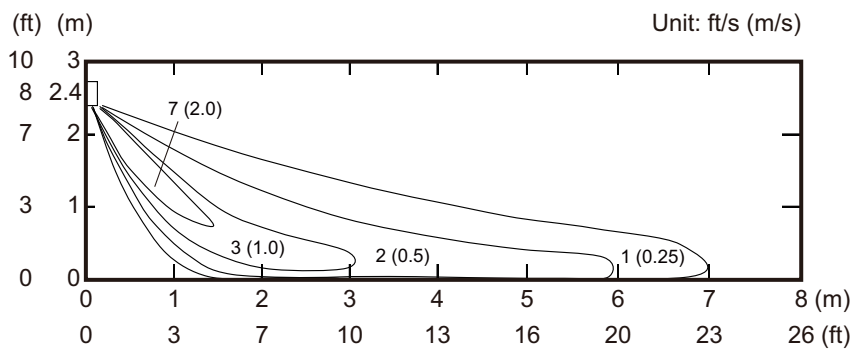


## 7. Fan performance curve


**NOTE:** Airflow and capacity/outlet temperature curve data are measured based on the same conditions mentioned in "Specifications" on page 04-4.

### 7-1. Mini duct type

#### ■ Model: ARUL4TLAV2

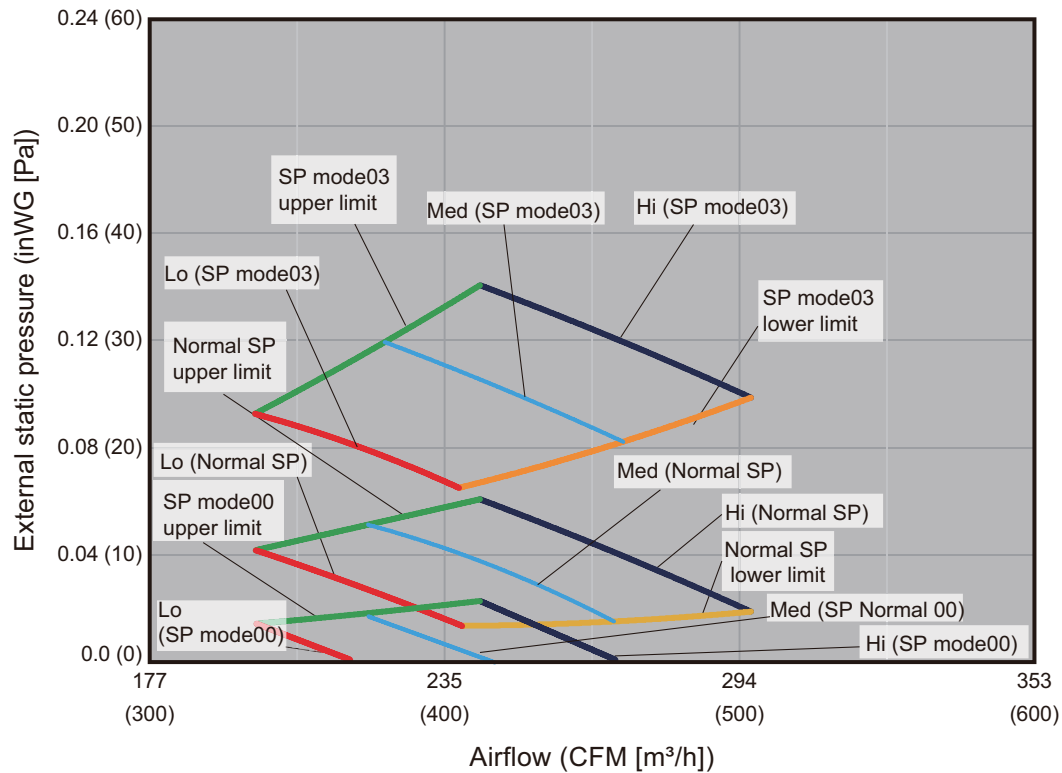




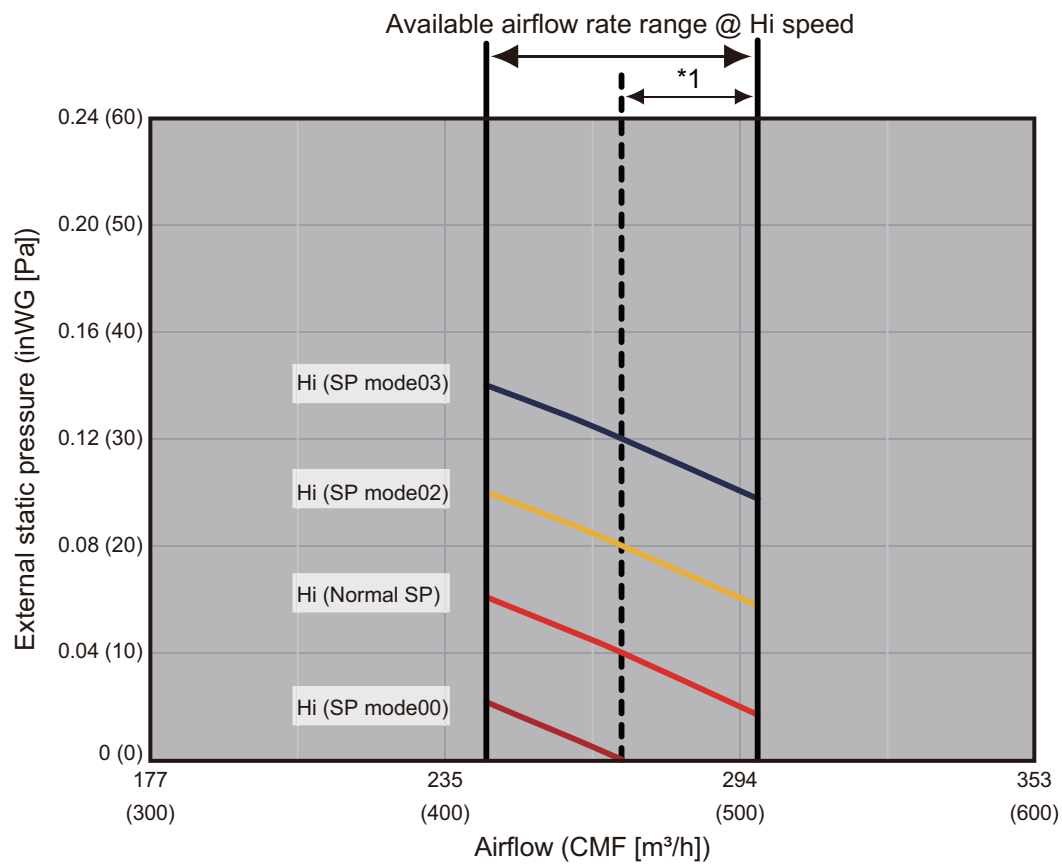



\*1: Available airflow rate range when Auto louver grille kit (option) is installed.

- Fan speed: HIGH
- Vertical airflow direction louver: Up

## Cooling


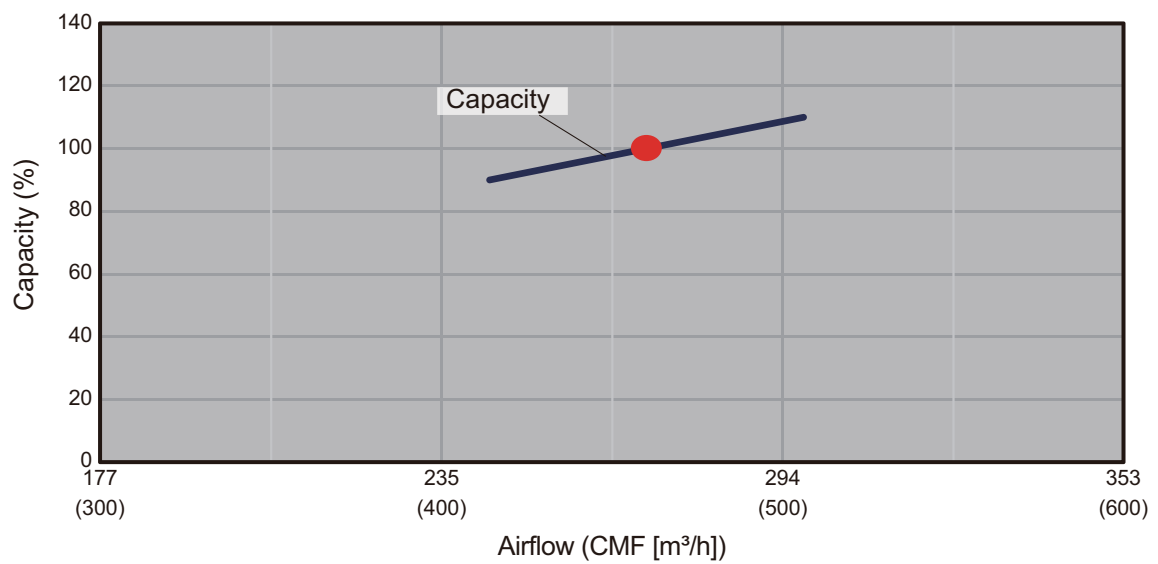


## Heating

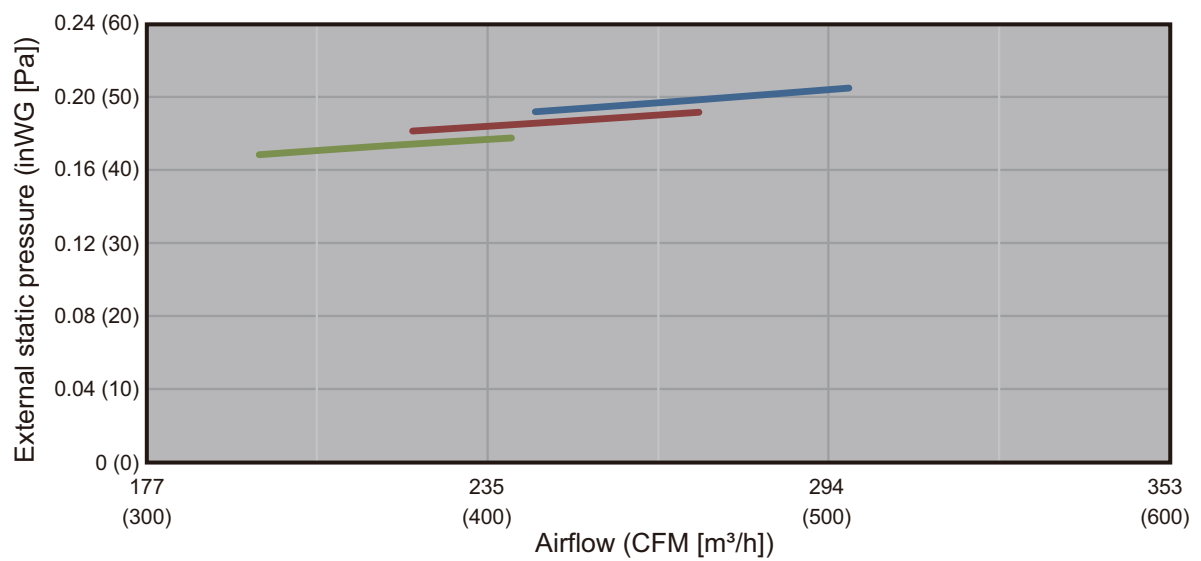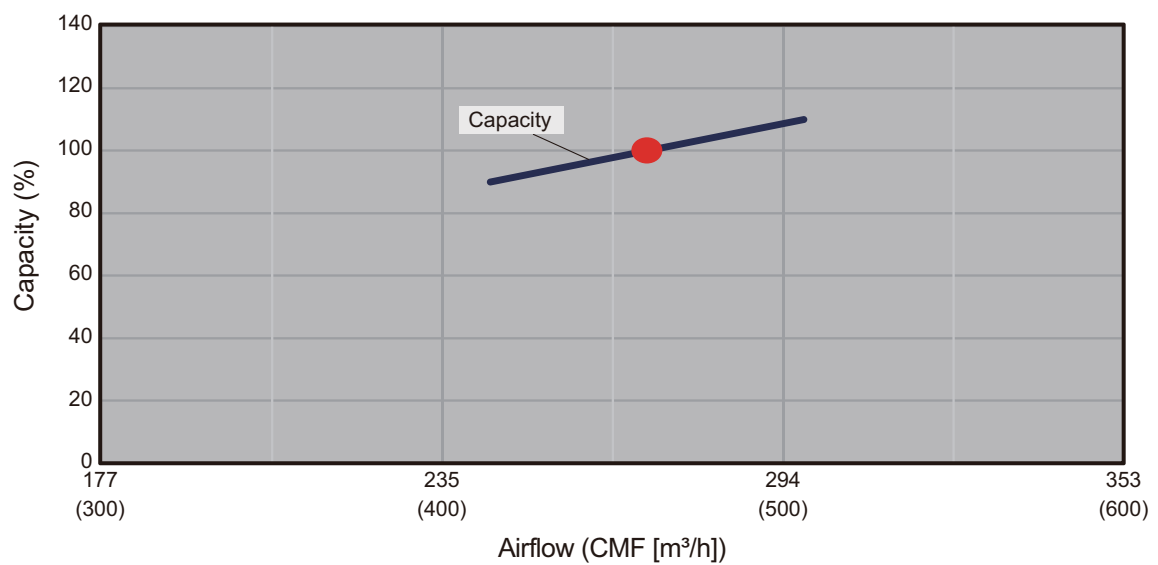

## 7-2. Slim duct/Slim concealed floor type


### Model: ARUL7TLAV2

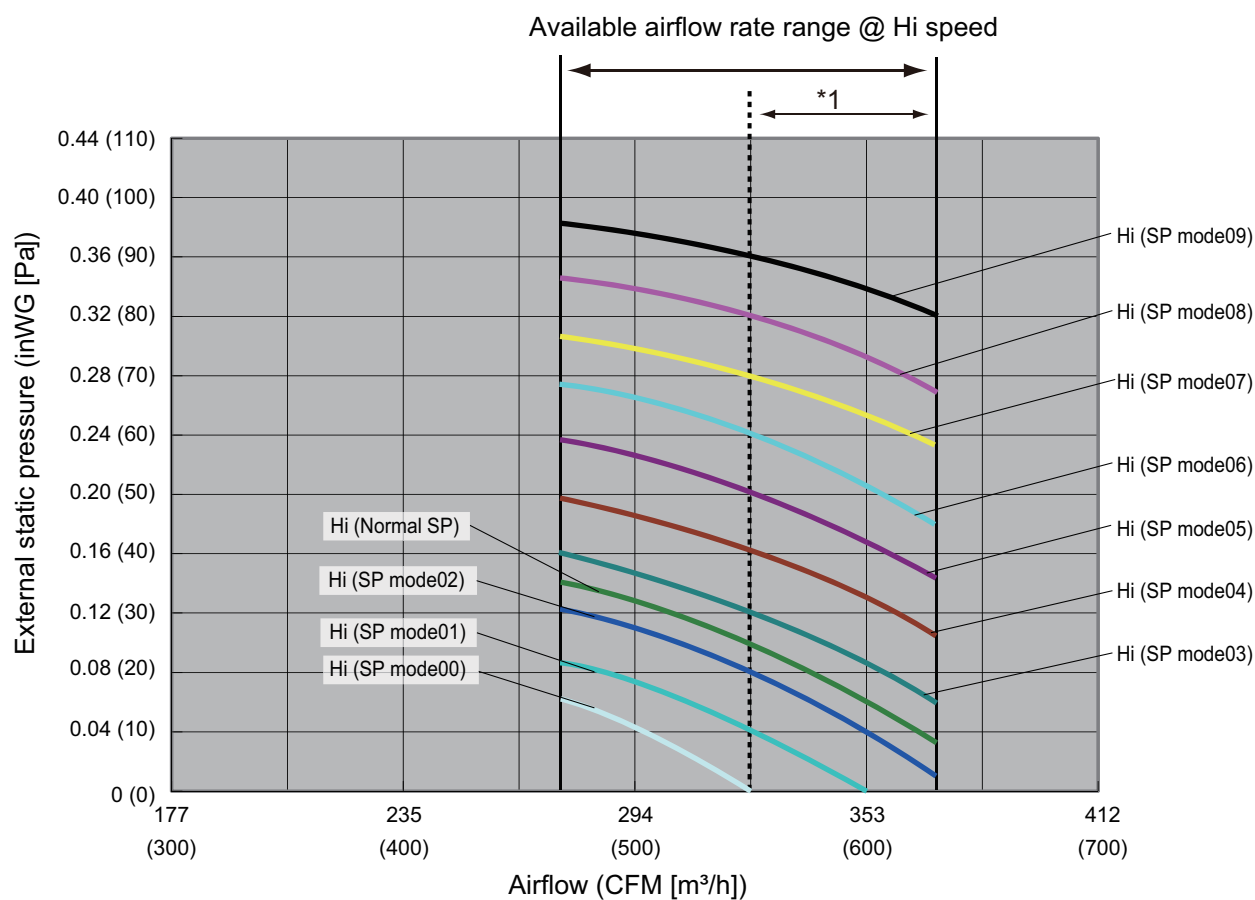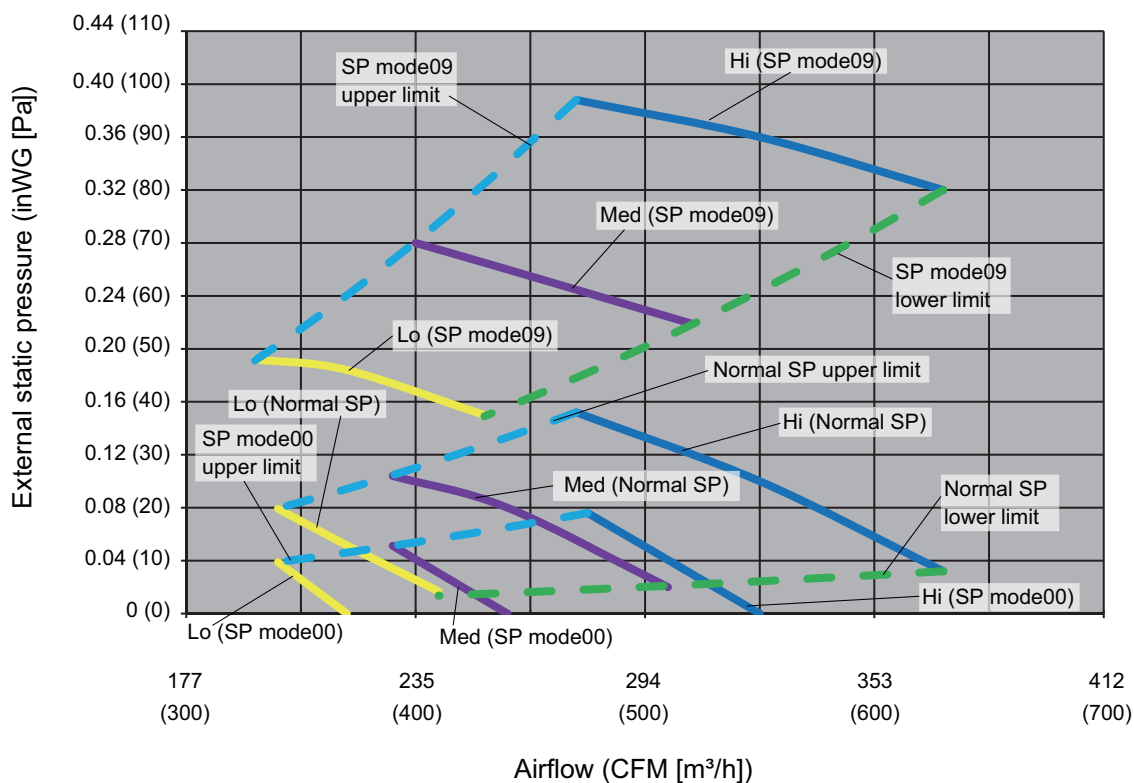


\*1: Available airflow rate range when Auto louver grille kit (option) is installed.

- Fan speed: HIGH
- Vertical airflow direction louver: Up


## Cooling

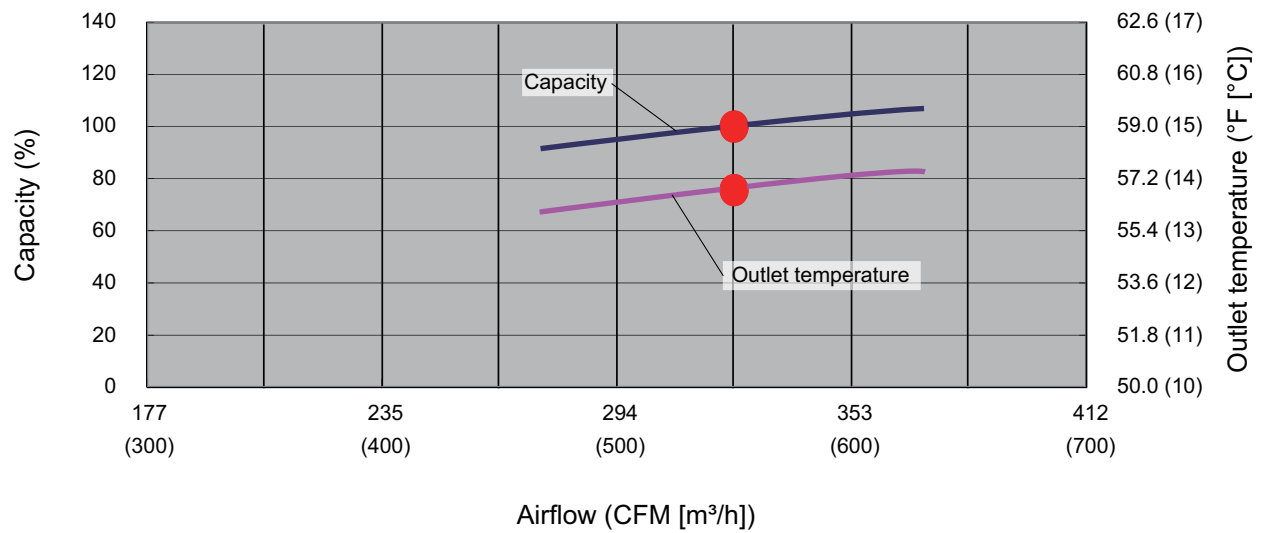


## Heating

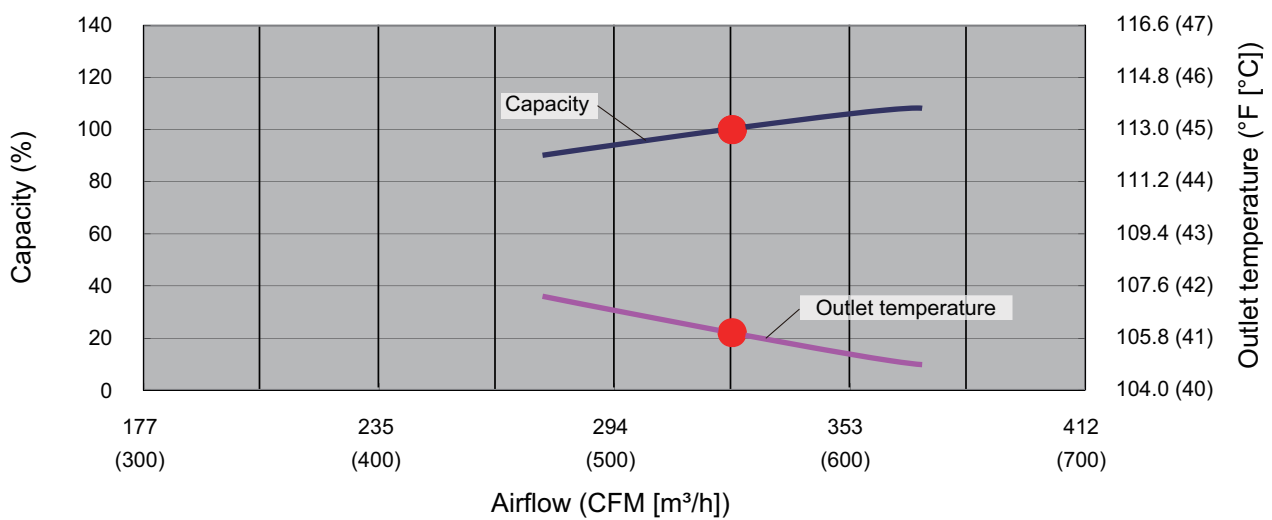

# Model: ARUL9TLAV2

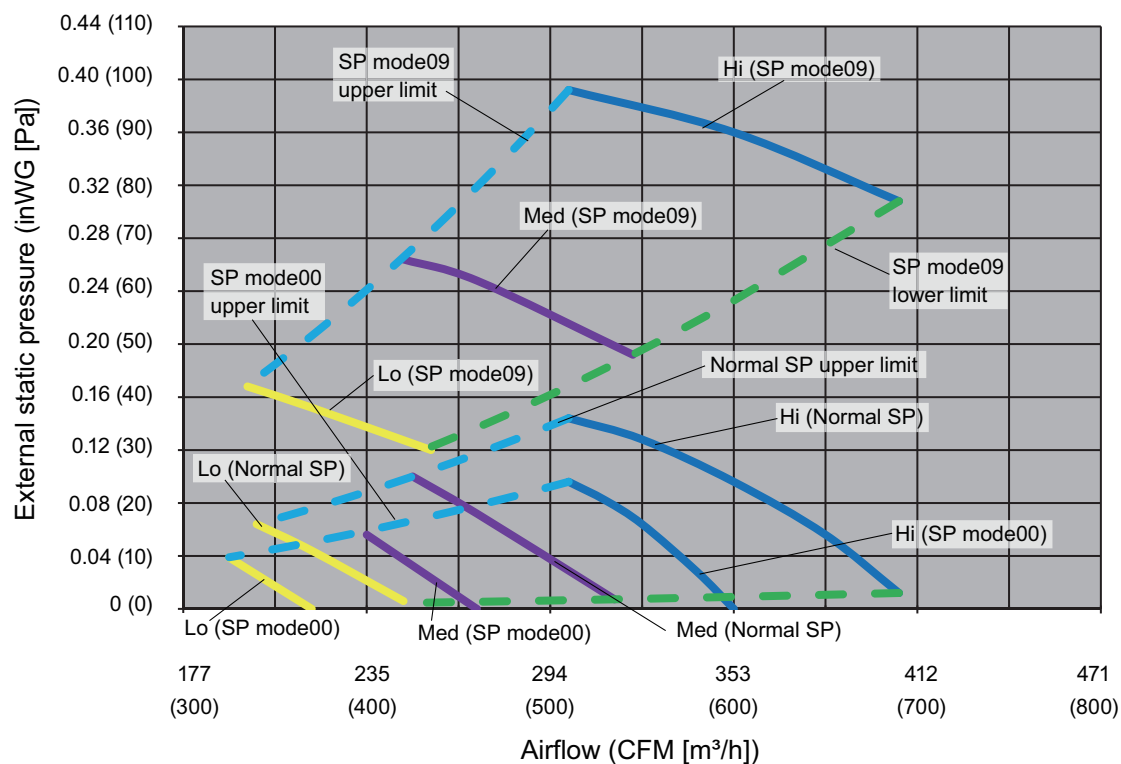


Available airflow rate range @ Hi speed

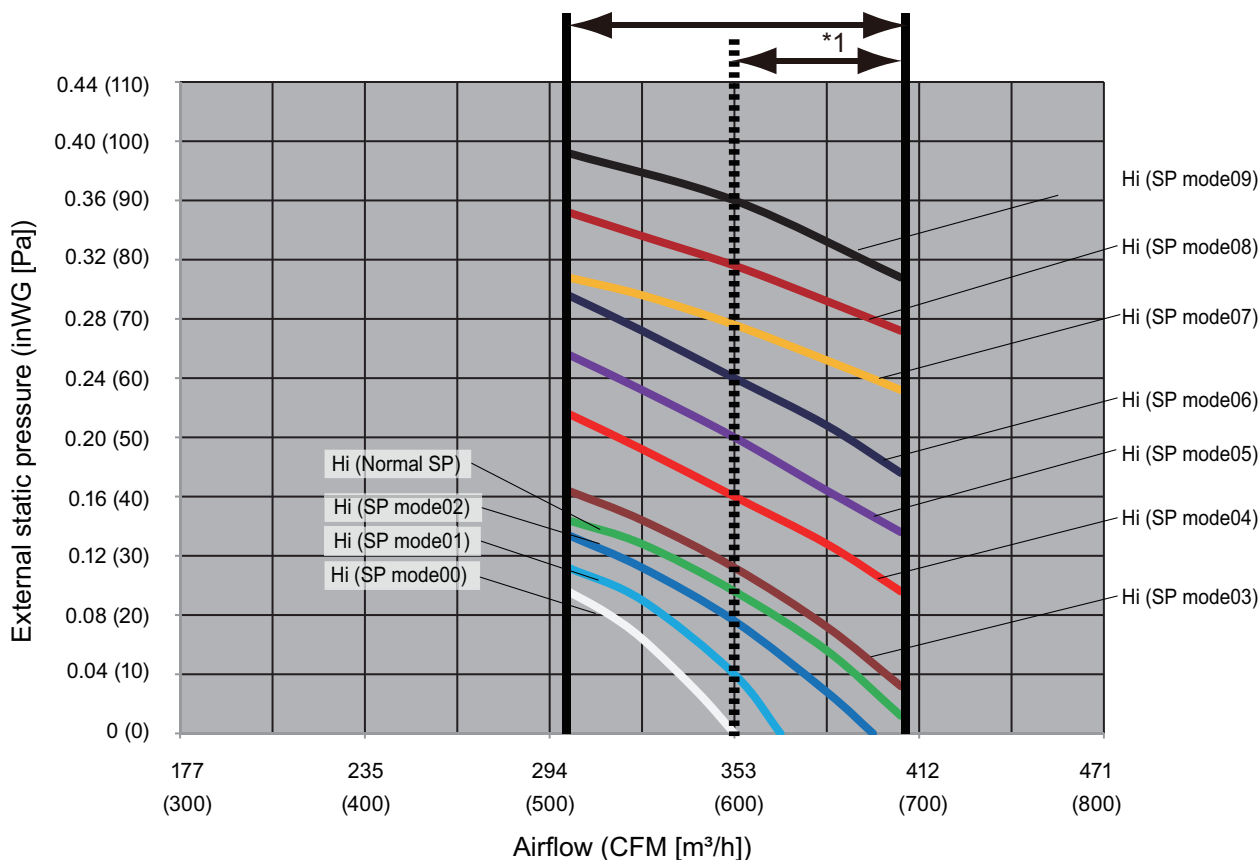


\*1: Available airflow rate range when Auto louver grille kit (option) is installed.

- Fan speed: HIGH
- Vertical airflow direction louver: Up



## Cooling

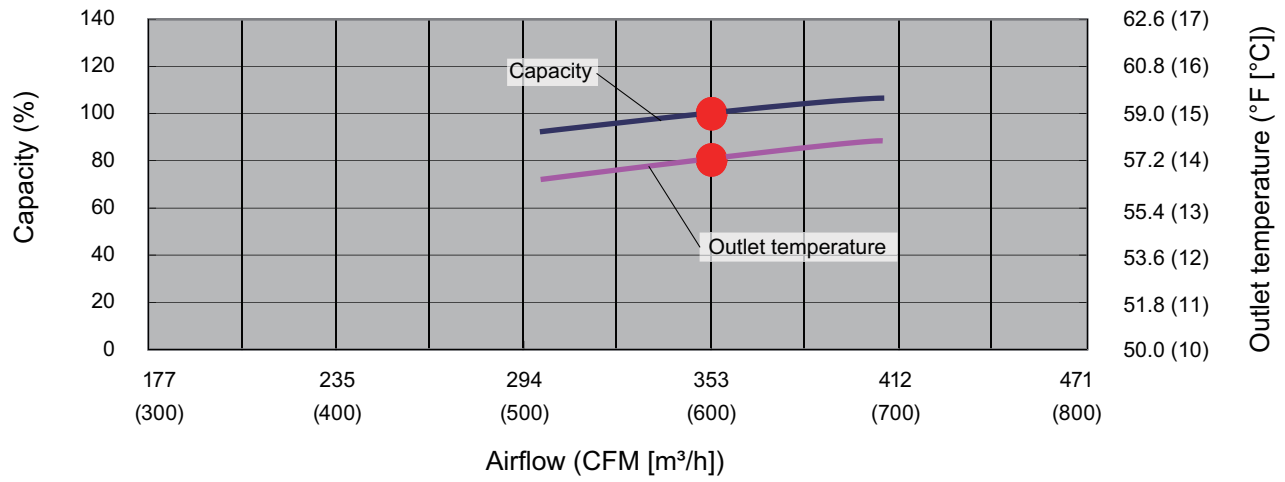

## Heating

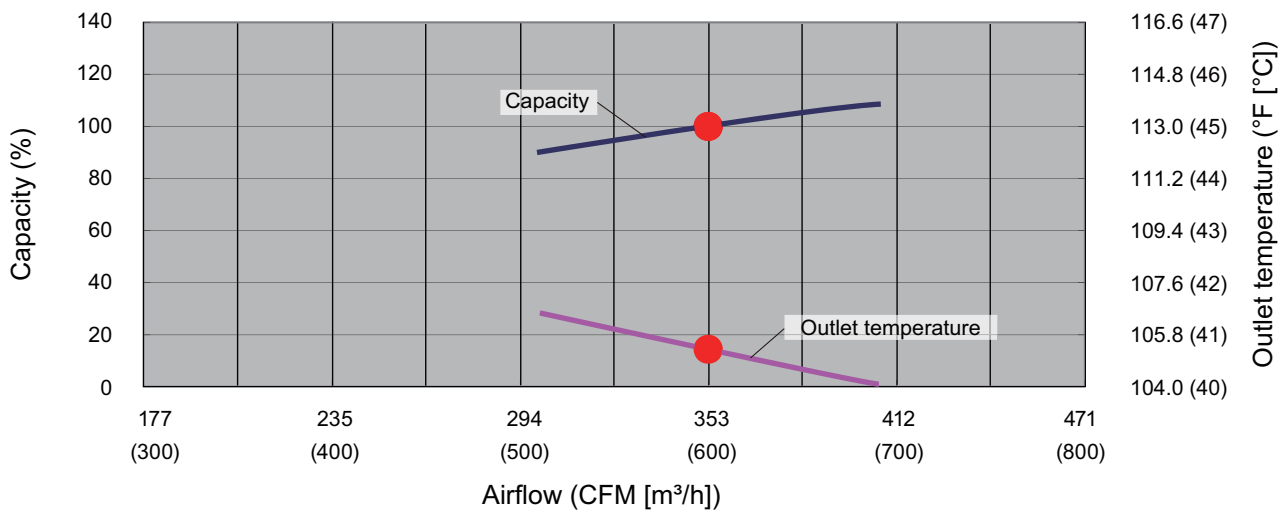


# Model: ARUL12TLAV2

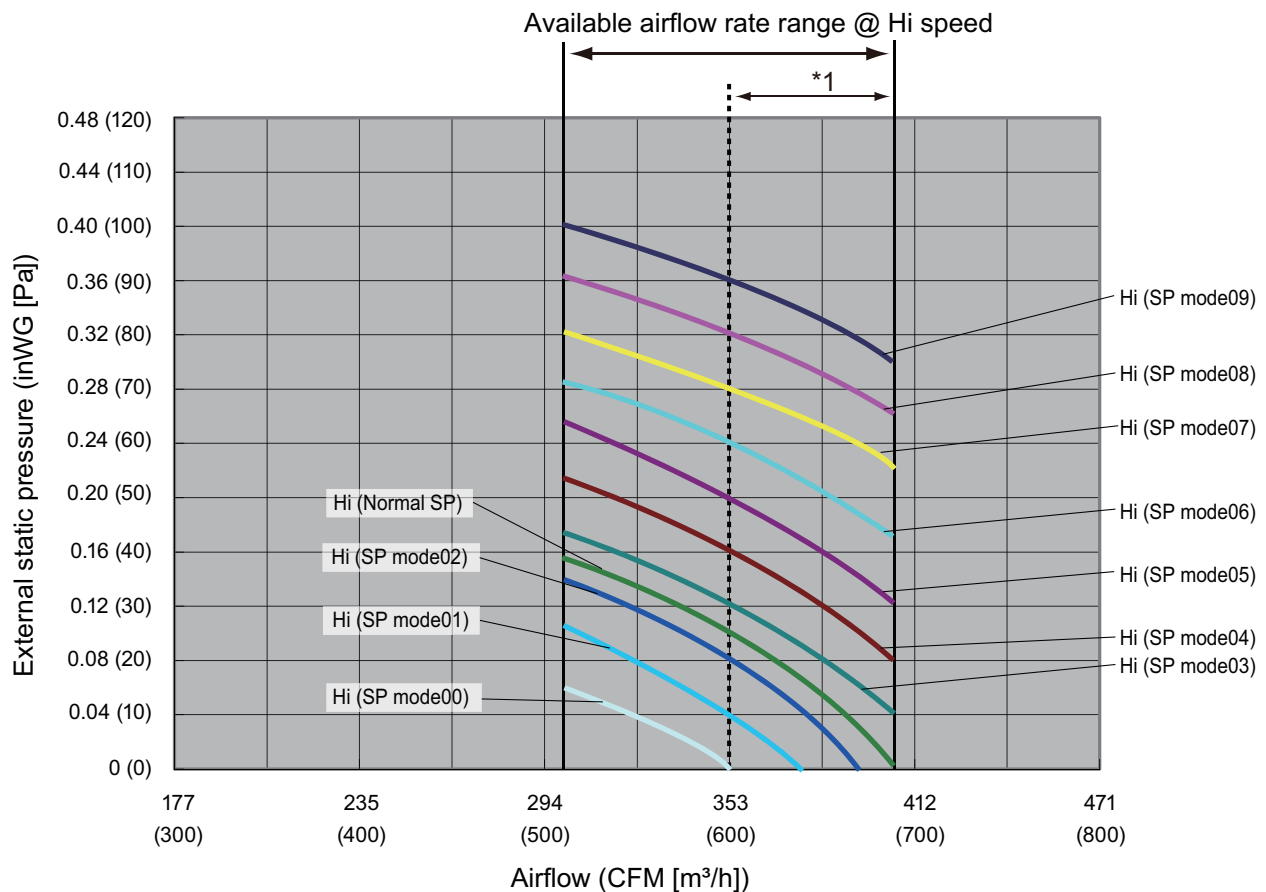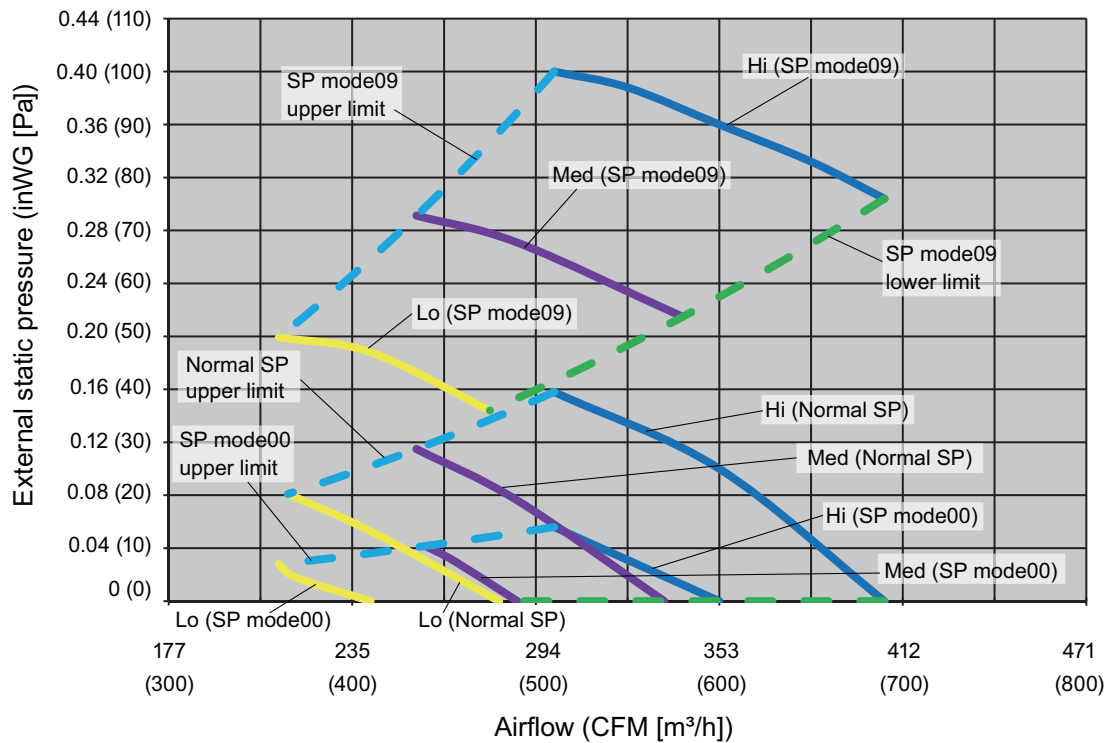


\*1: Available airflow rate range when Auto louver grille kit (option) is installed.

- Fan speed: HIGH
- Vertical airflow direction louver: Up

## Cooling


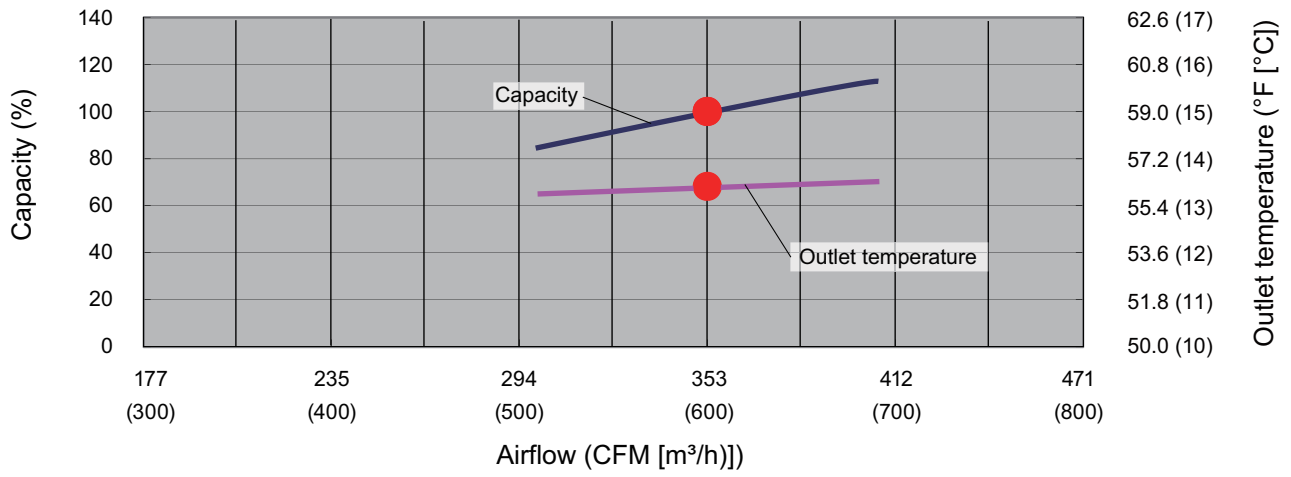


## Heating

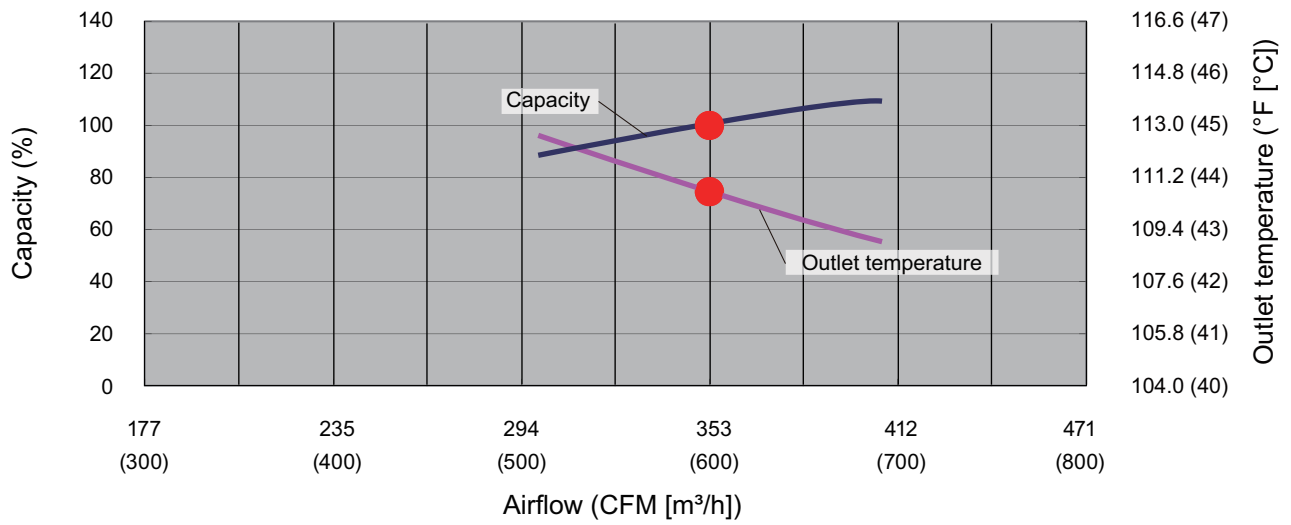




# Model: ARUL14TLAV2

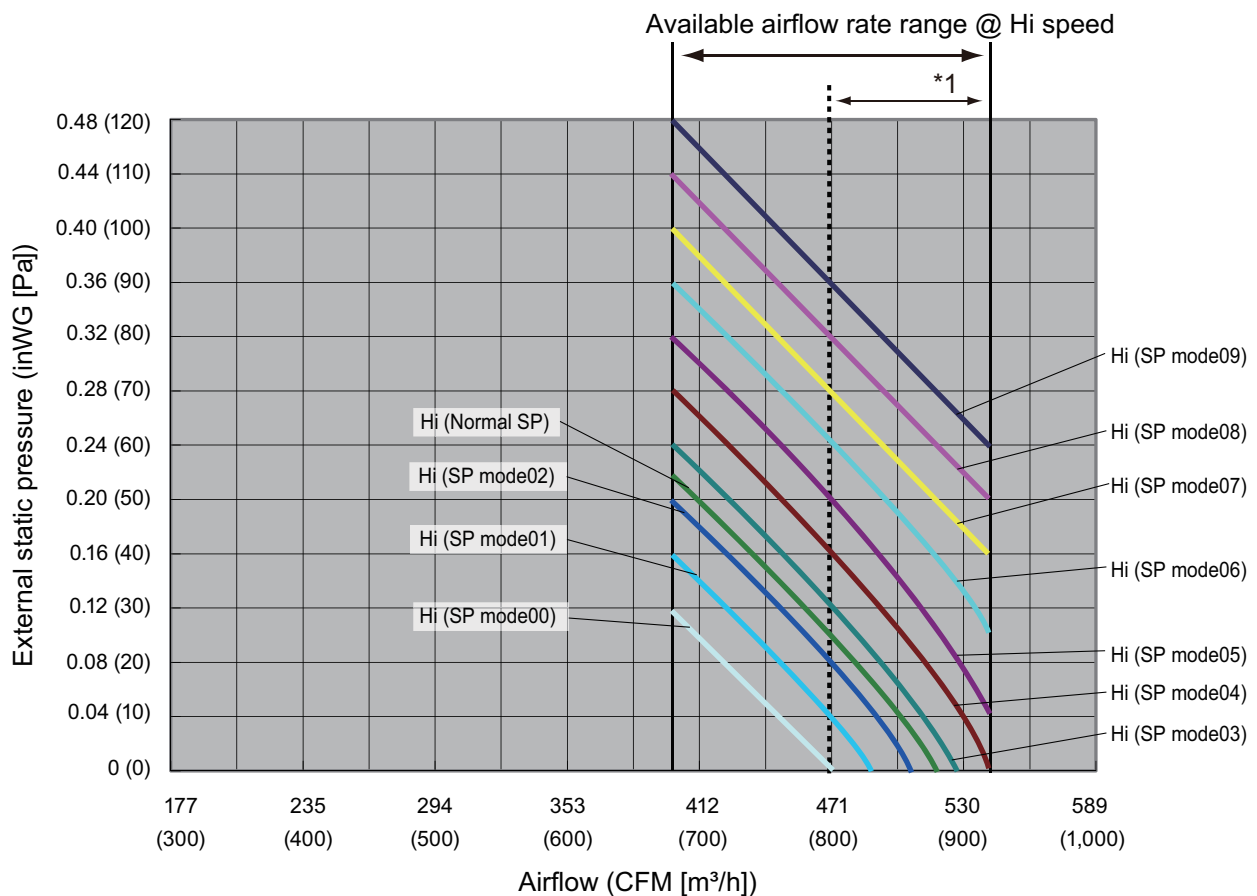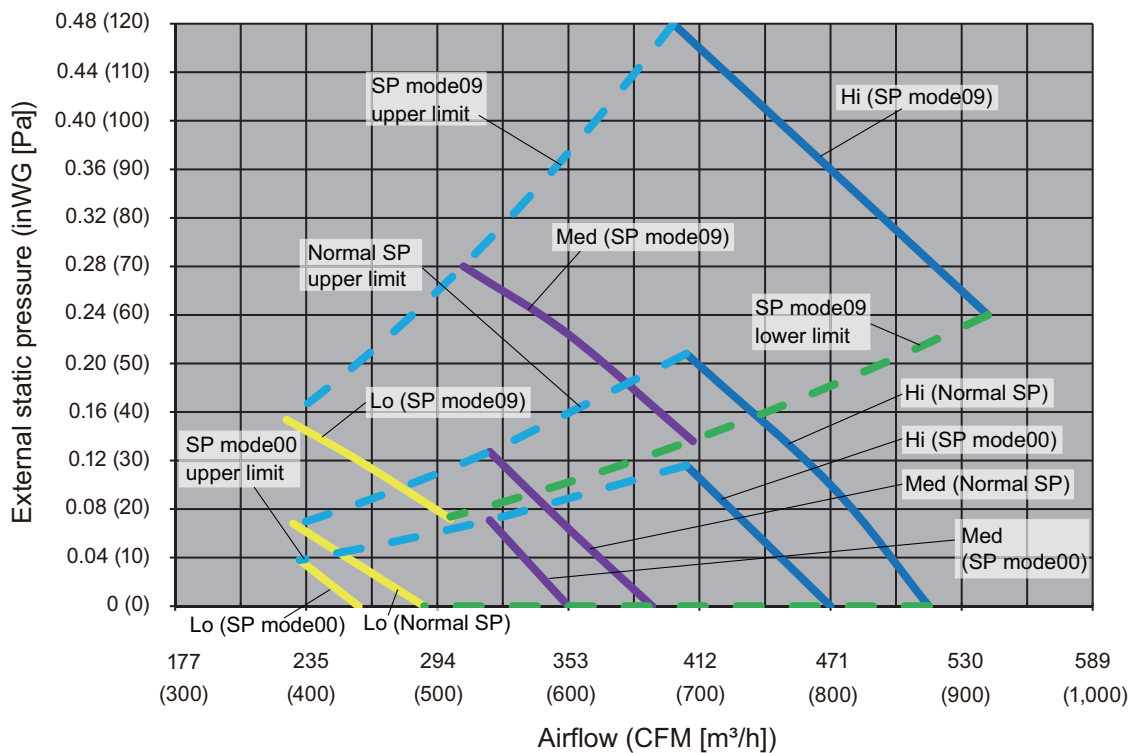


\*1: Available airflow rate range when Auto louver grille kit (option) is installed.

- Fan speed: HIGH
- Vertical airflow direction louver: Up



## Cooling

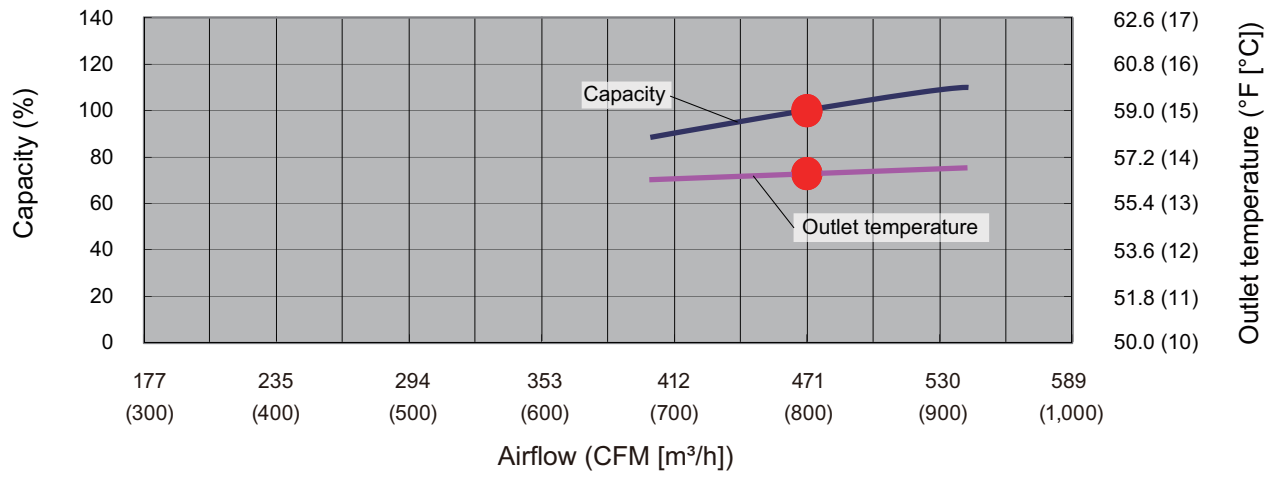

## Heating

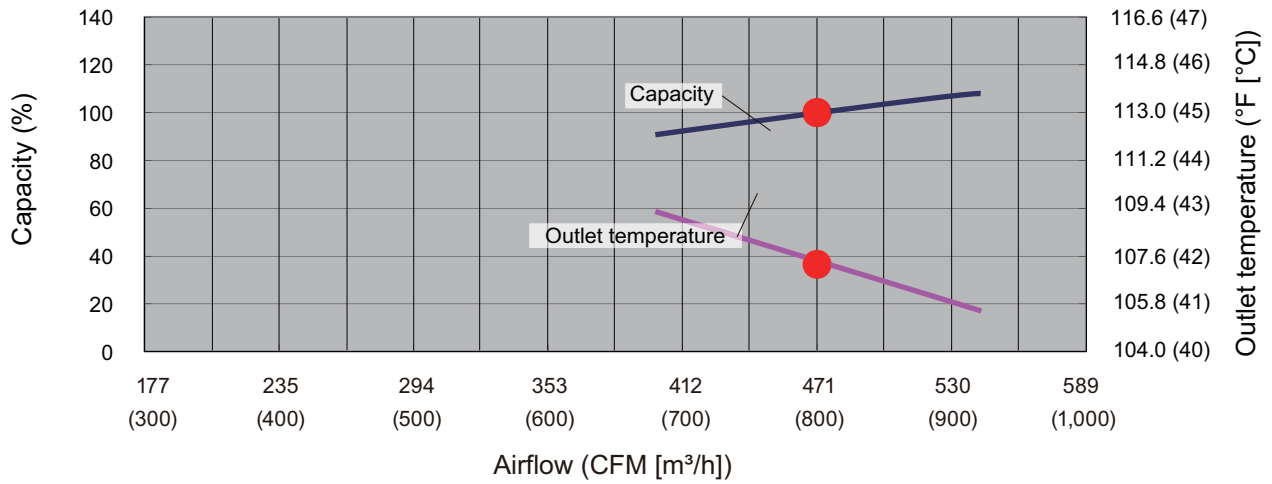


# Model: ARUL18TLAV2

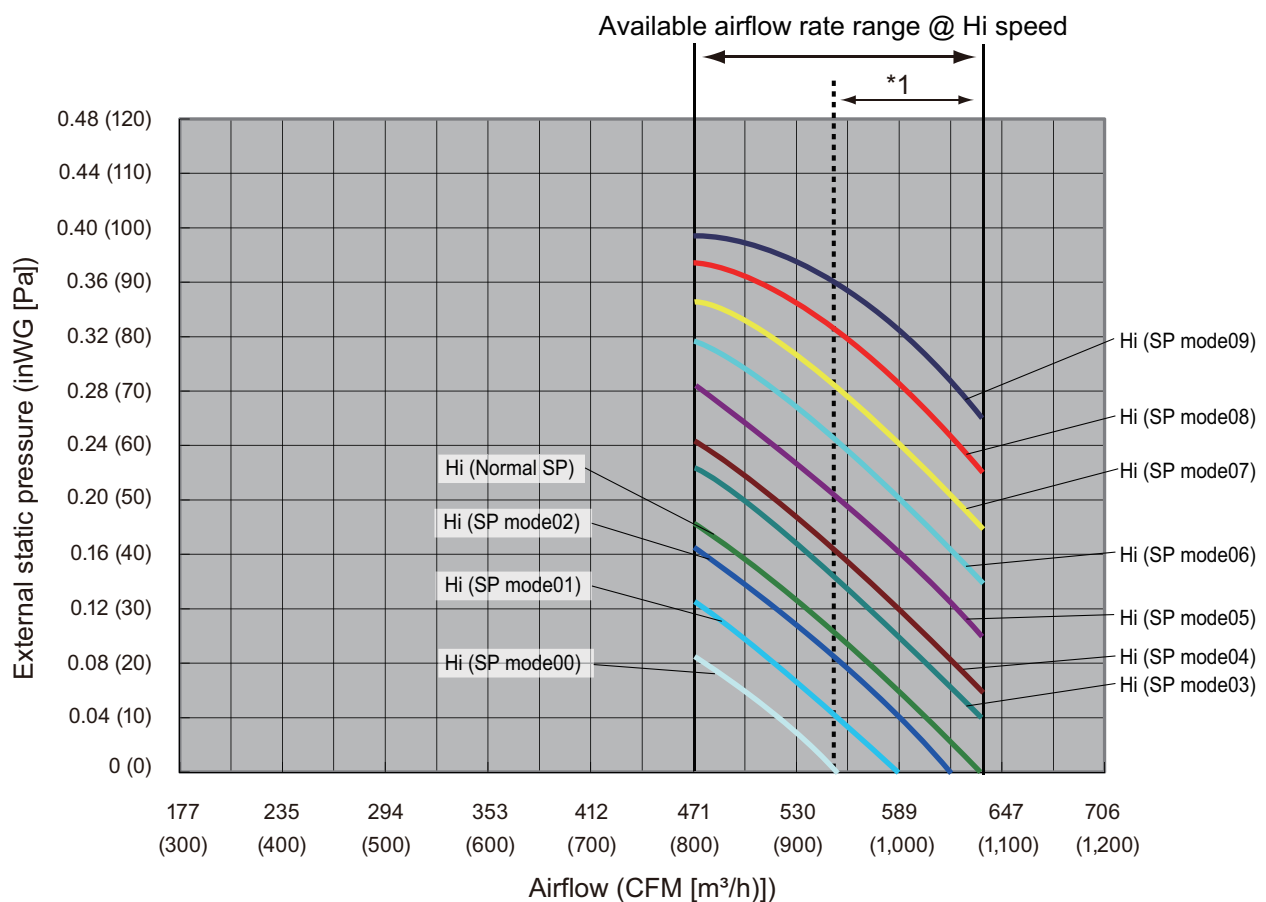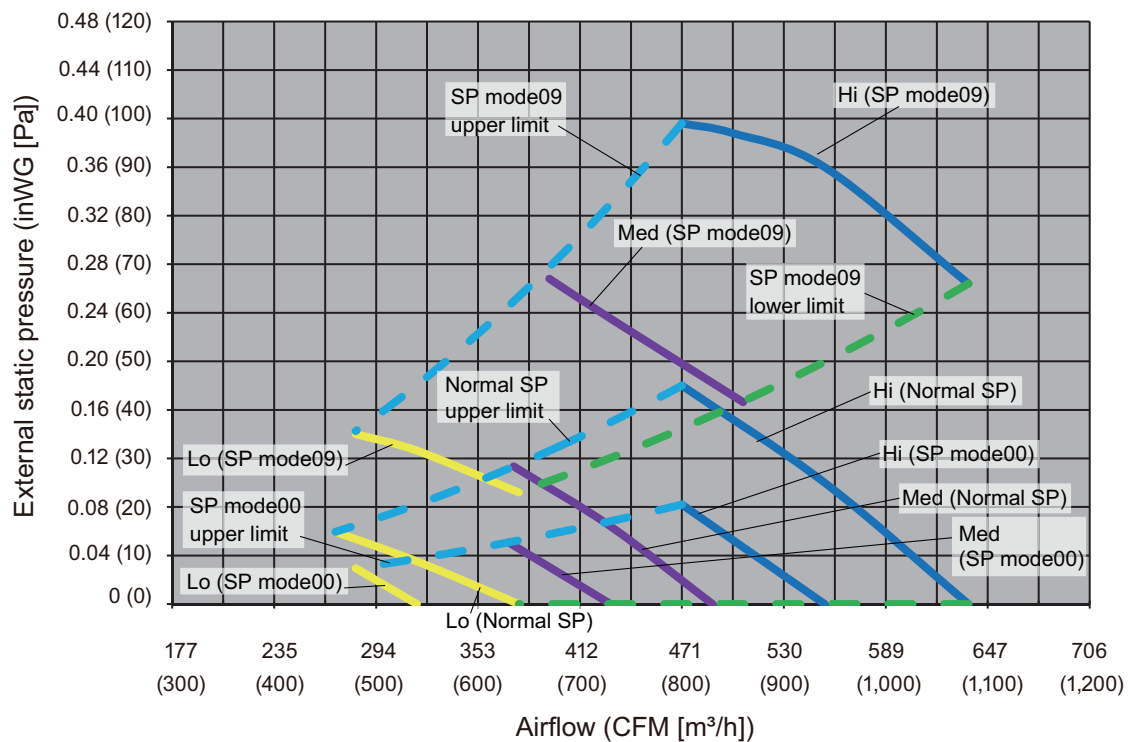


\*1: Available airflow rate range when Auto louver grille kit (option) is installed.

- Fan speed: HIGH
- Vertical airflow direction louver: Up

## Cooling


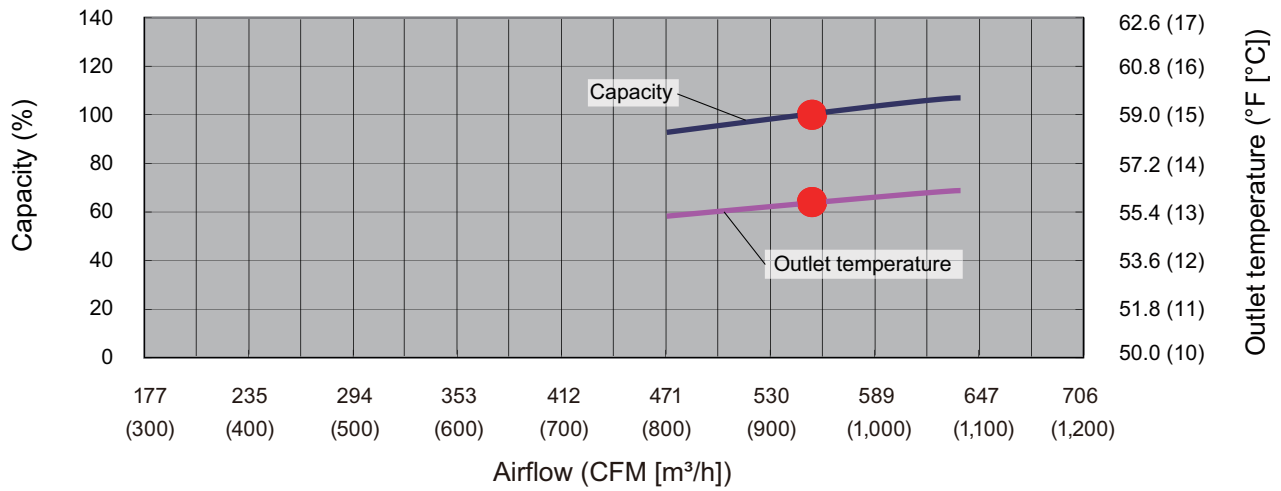


## Heating

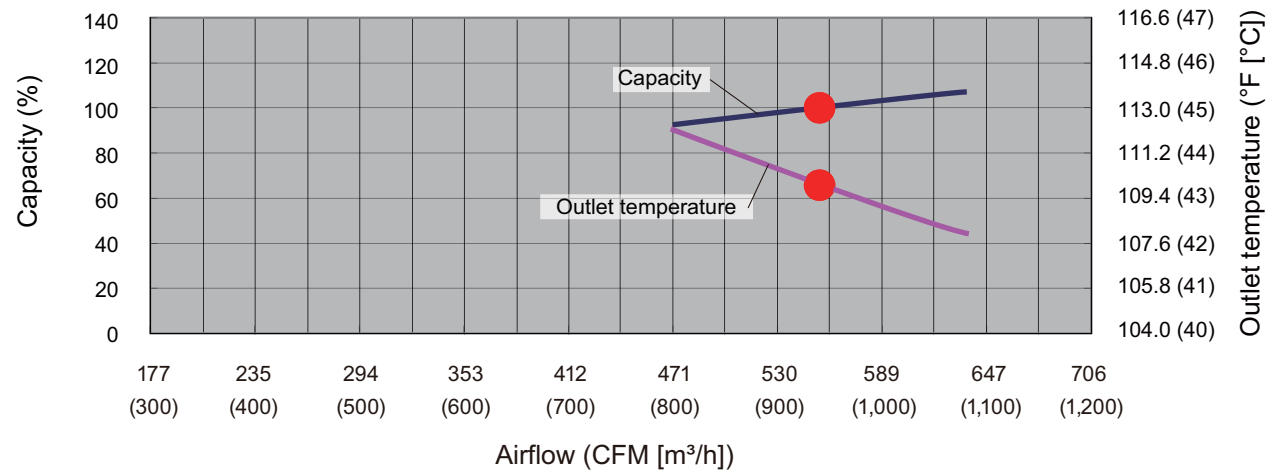


## 7-3. Medium static pressure duct type


### ■ Model: ARUM24TLAV2

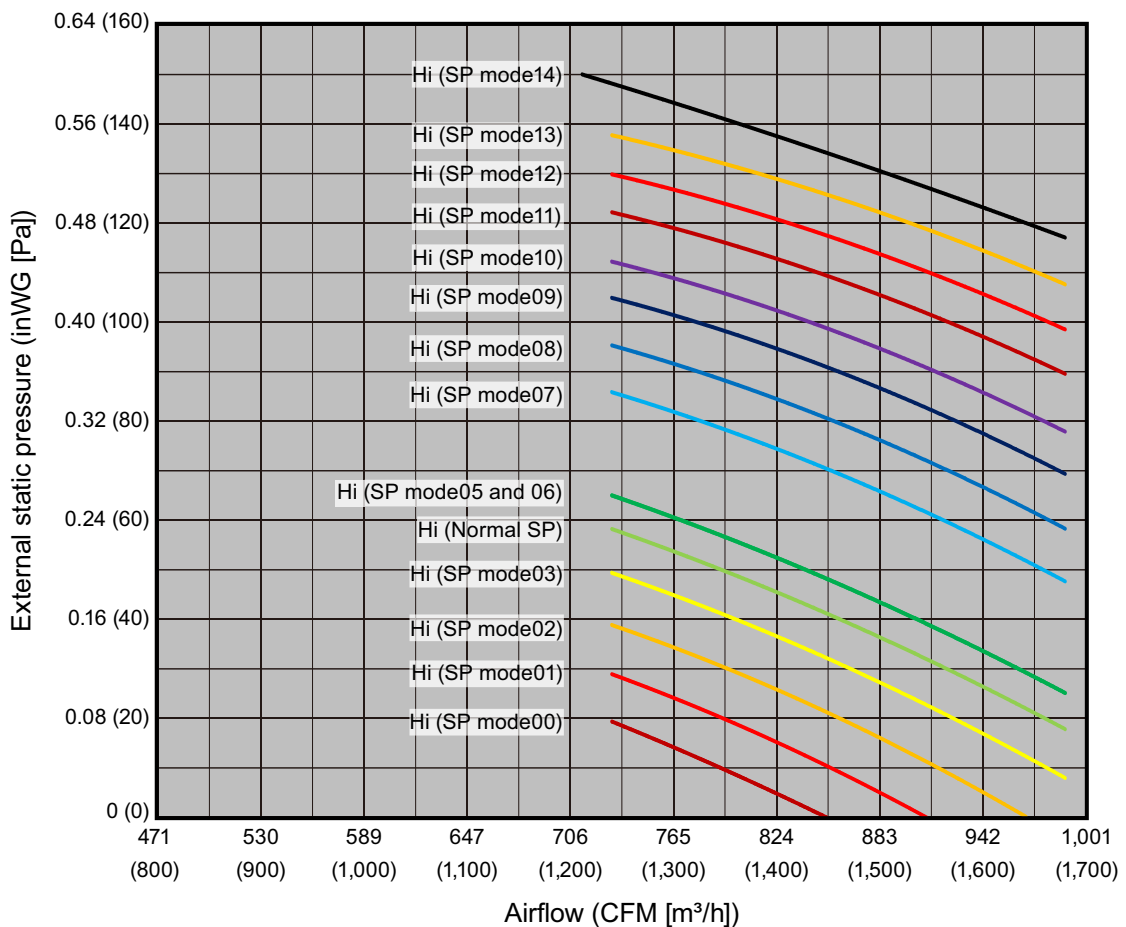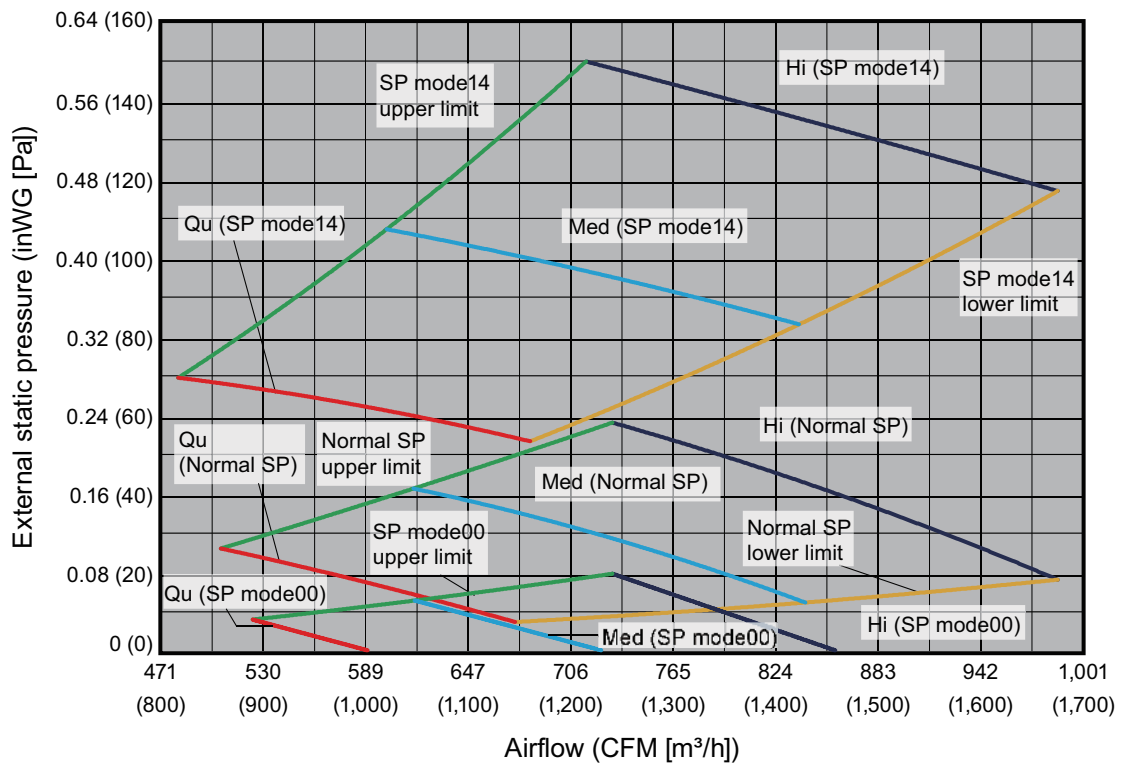

Cooling

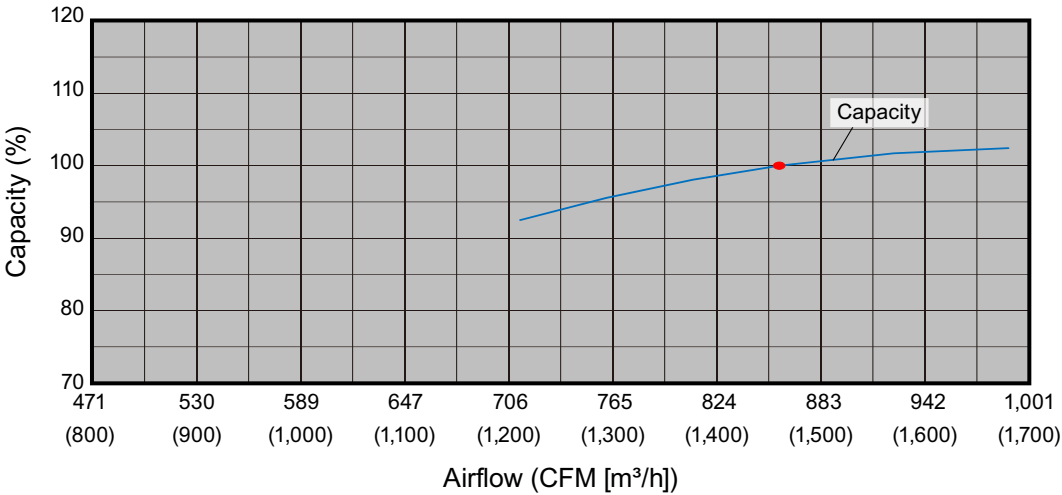



Heating

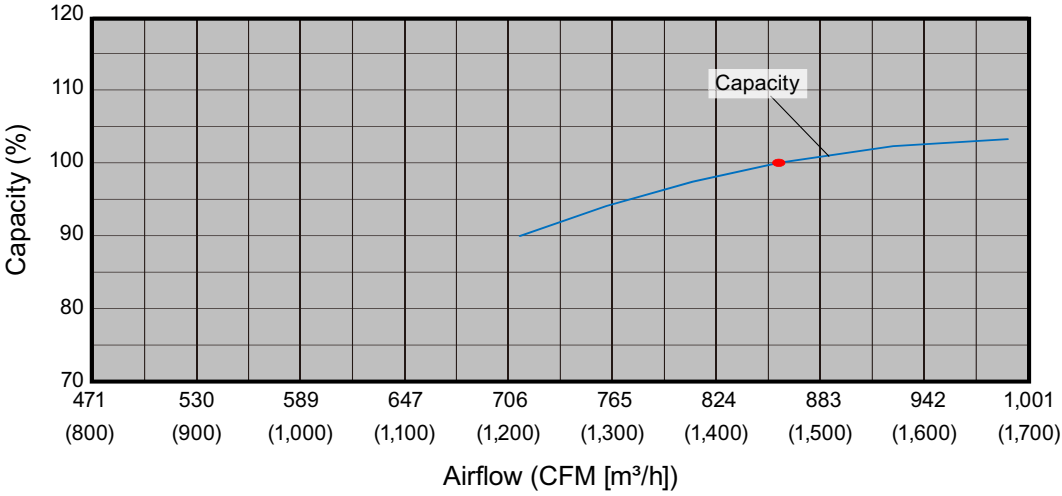


INDOOR  
UNITS

INDOOR  
UNITS


# Model: ARUM30TLAV2

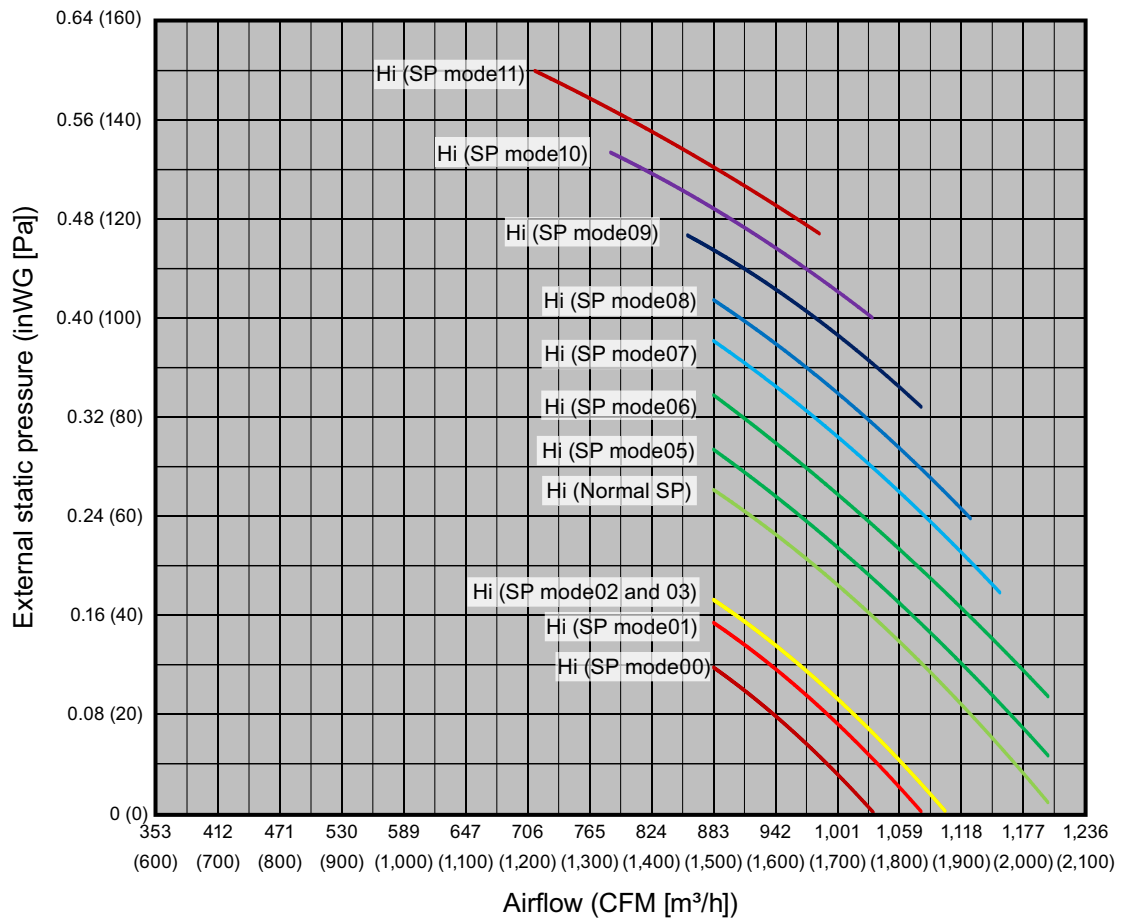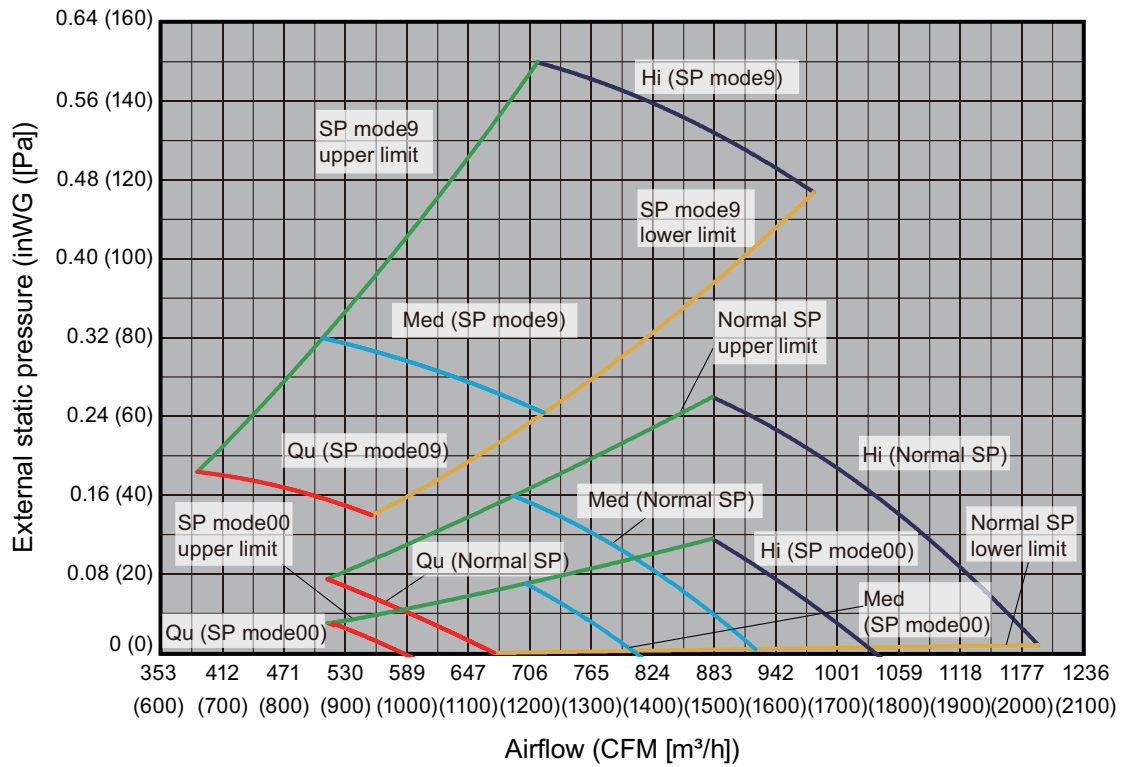

Cooling

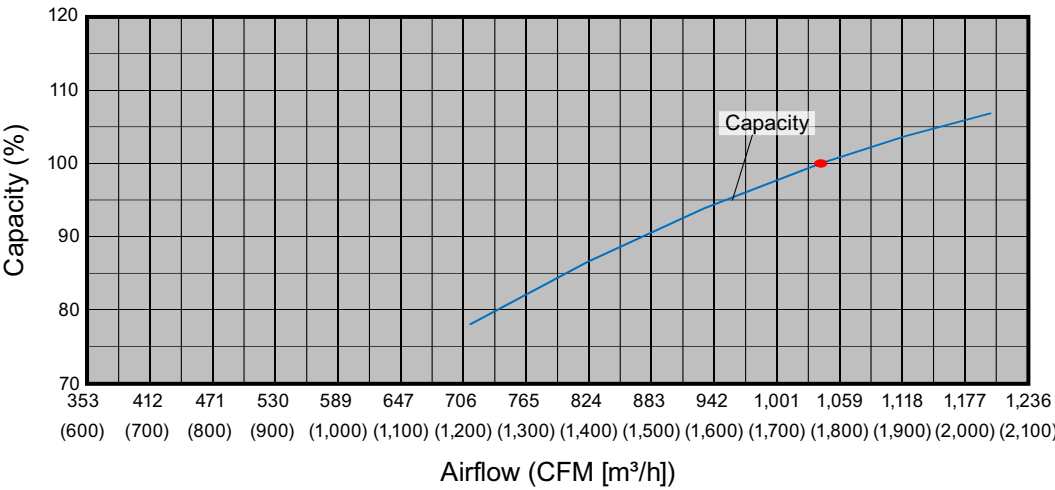

Heating


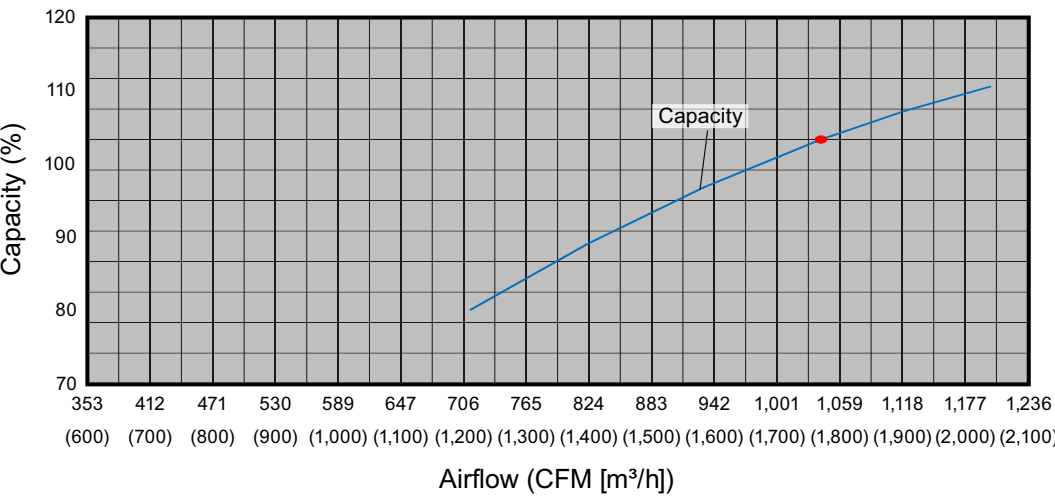


INDOOR  
UNITS


INDOOR  
UNITS




# Model: ARUM36TLAV2

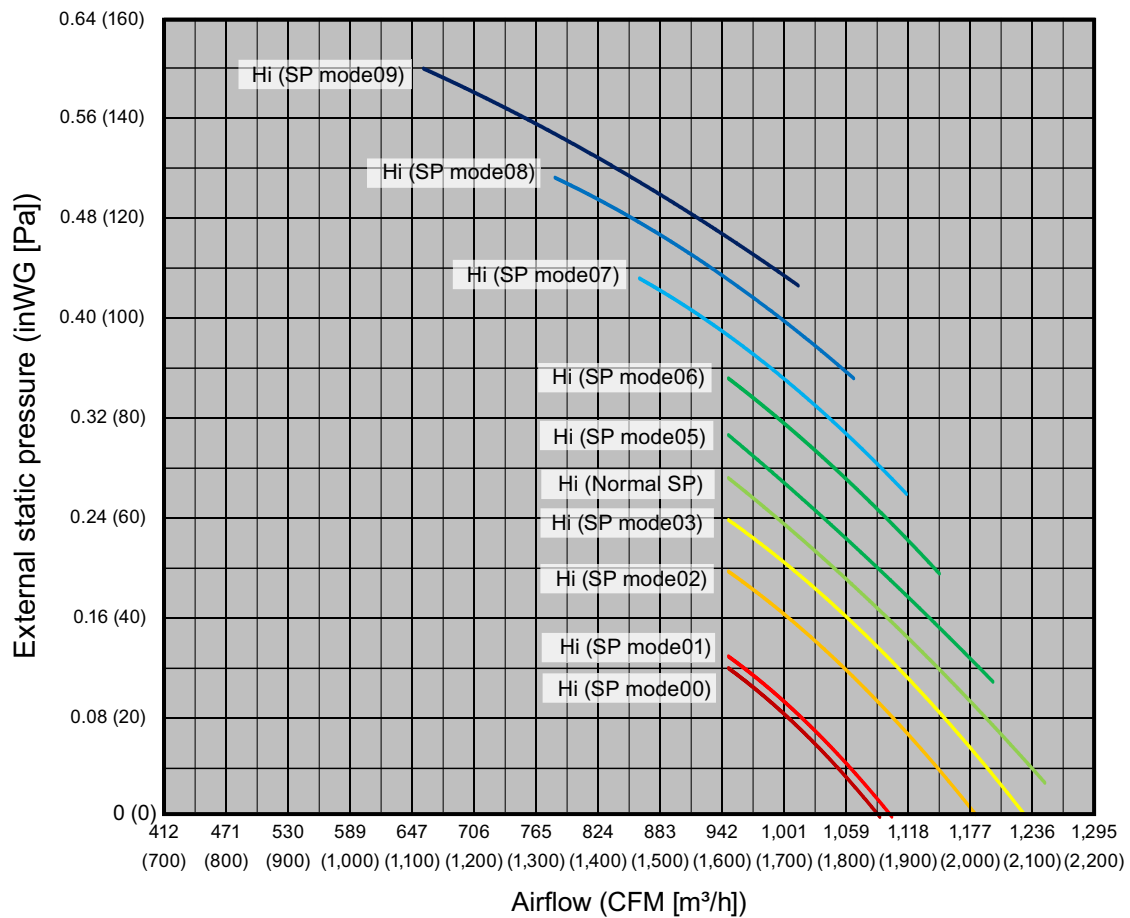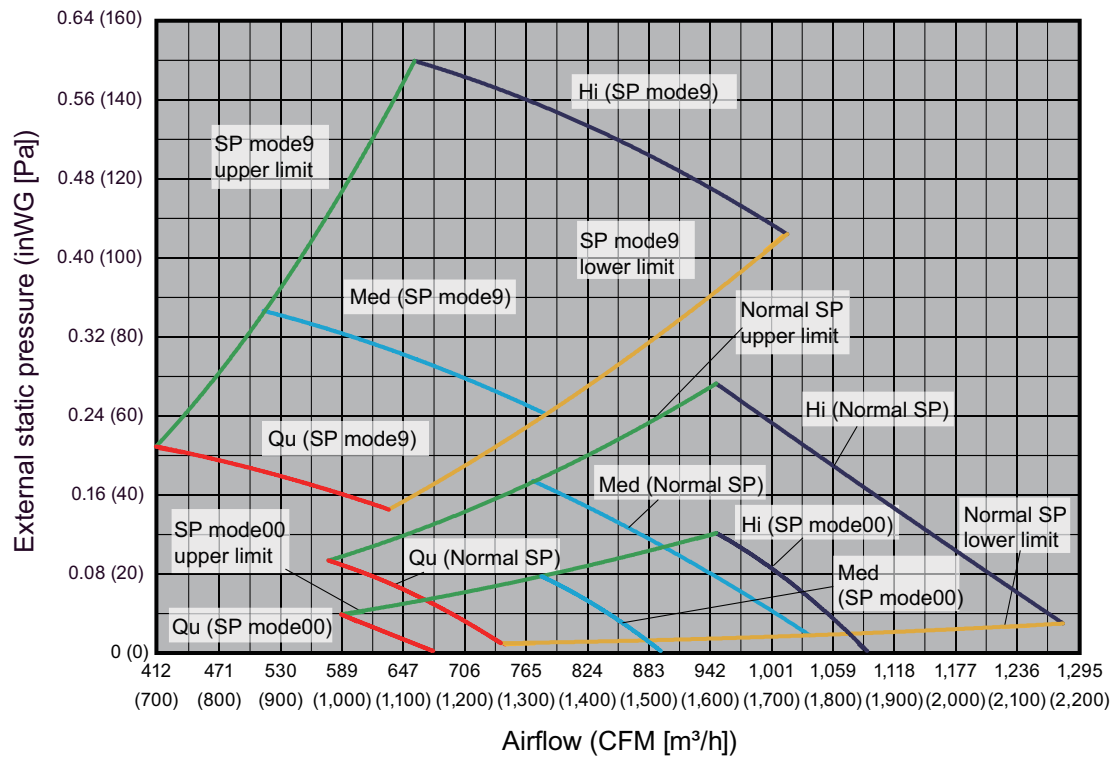

Cooling

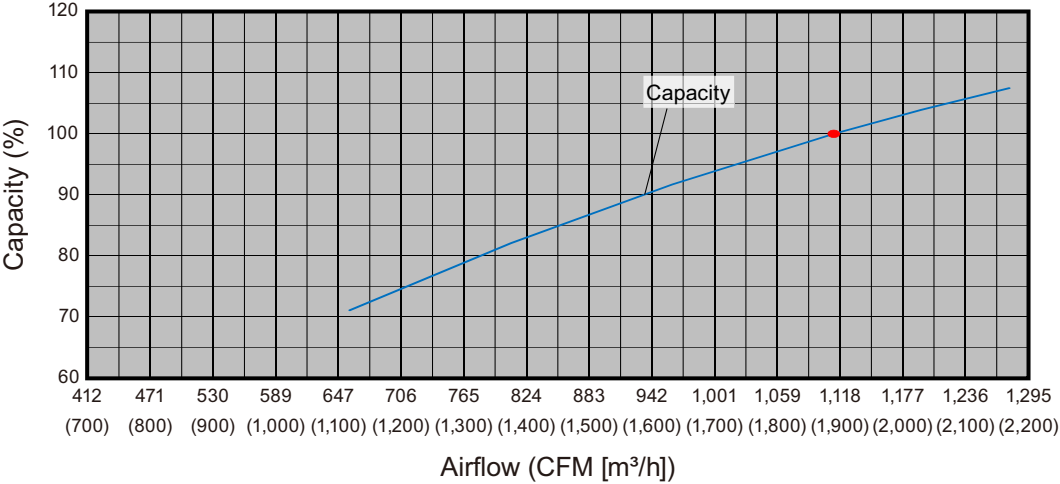

Heating

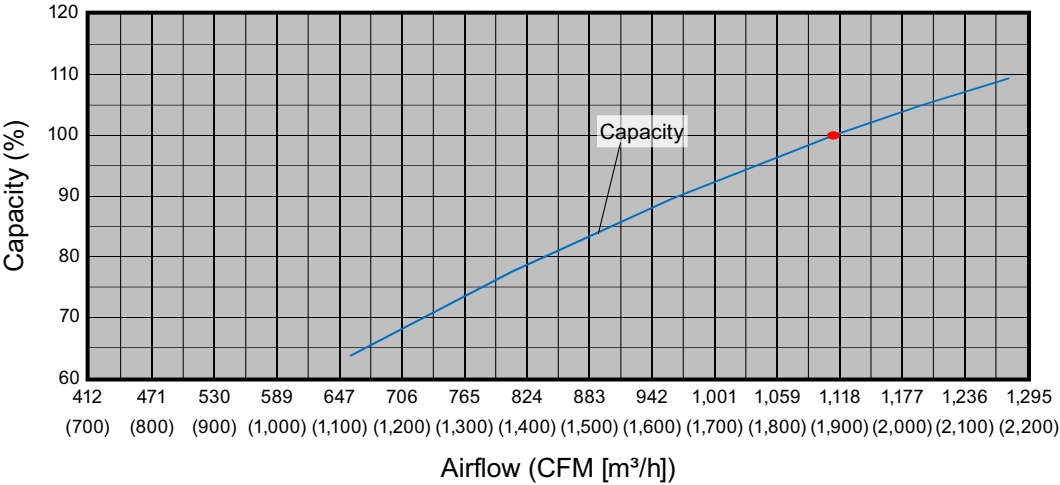


INDOOR  
UNITS


INDOOR  
UNITS

## 7-4. High static pressure duct type


### ■ Model: ARUH36TLAV

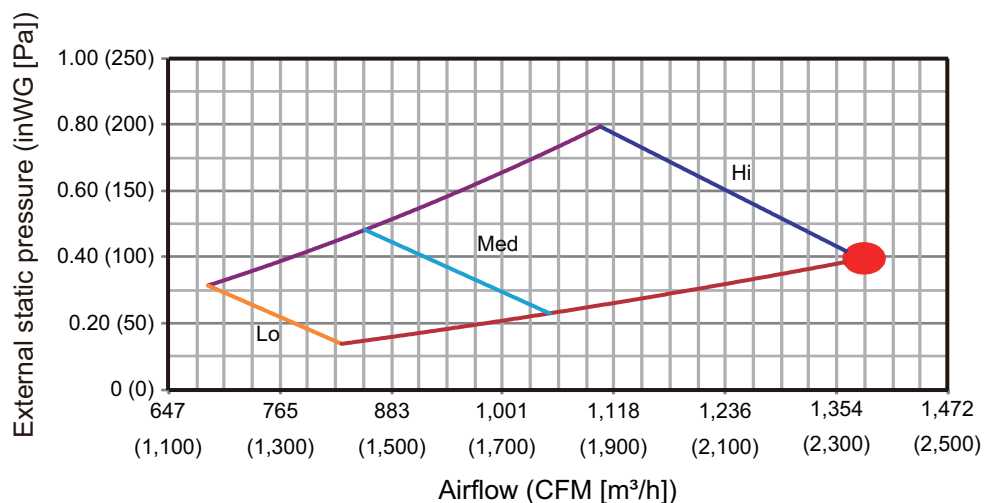


### Cooling

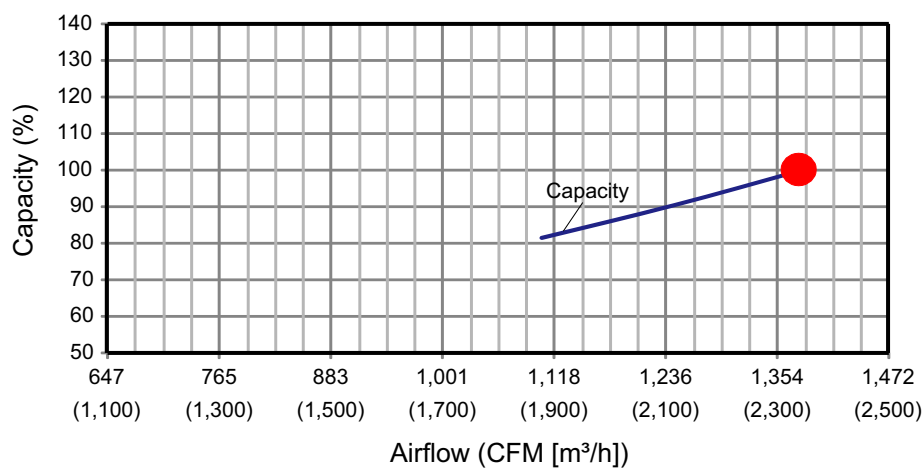


### Heating

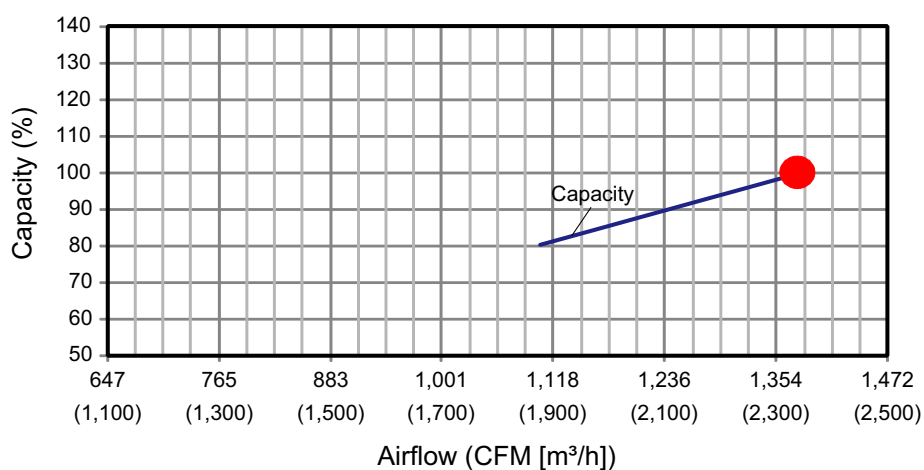


# Model: ARUH48TLAV

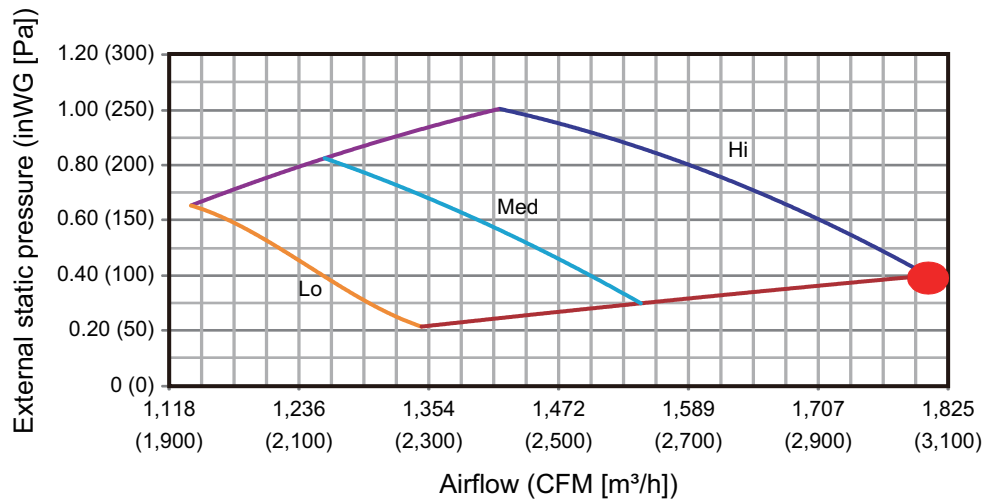


## Cooling

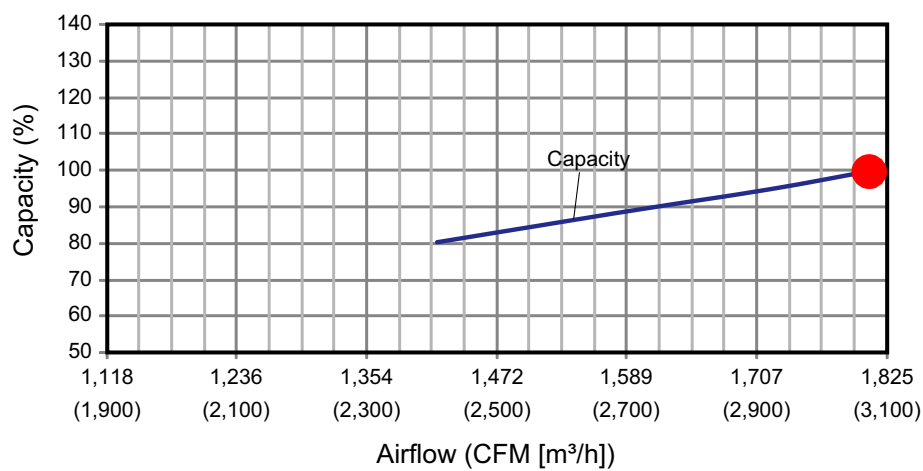


## Heating

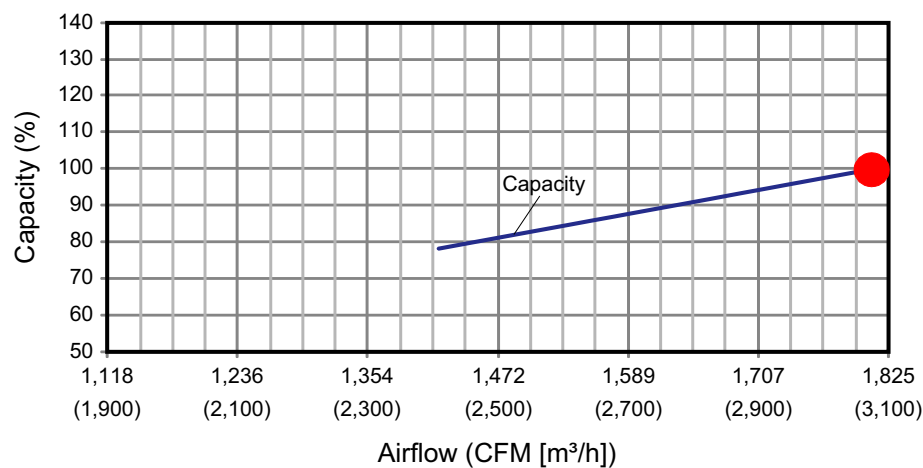


# Model: ARUH60TLAV

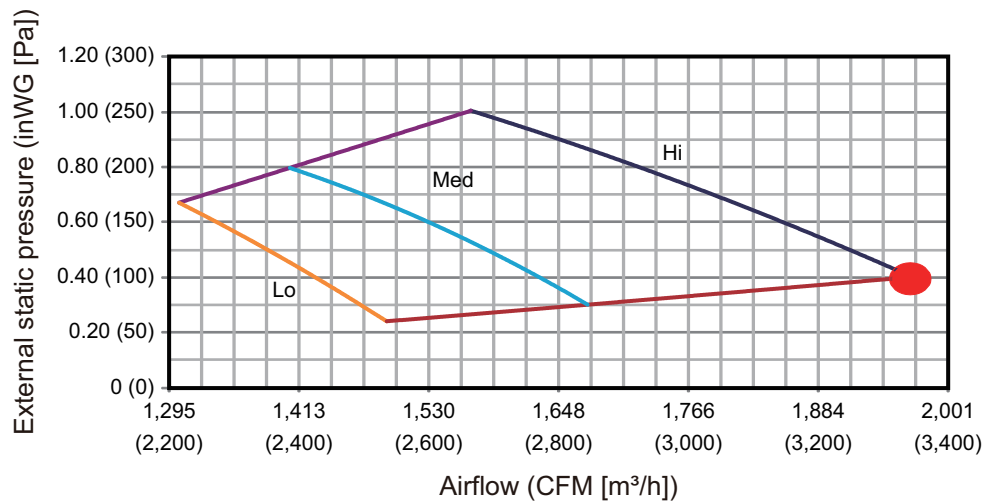



## Cooling

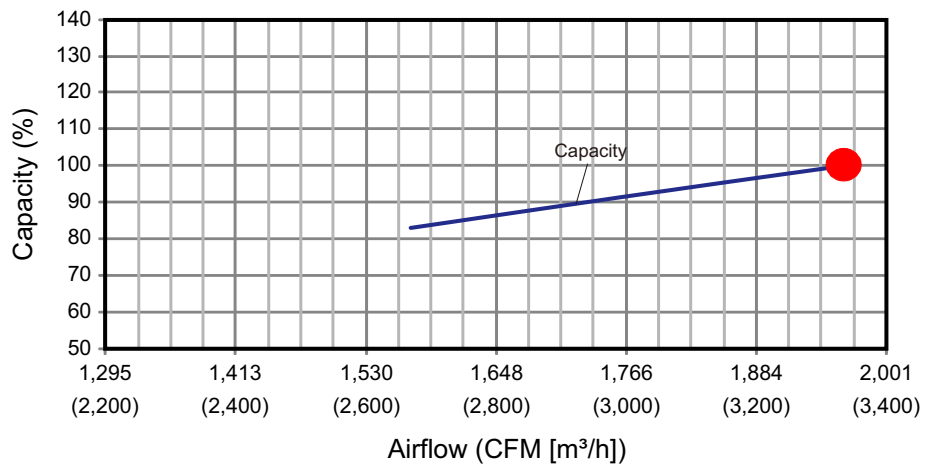


## Heating

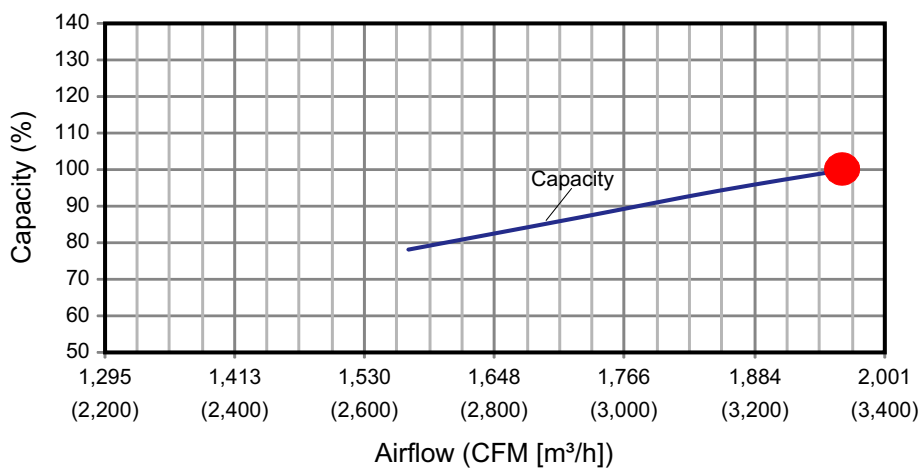


# Model: ARUH72TLAV2

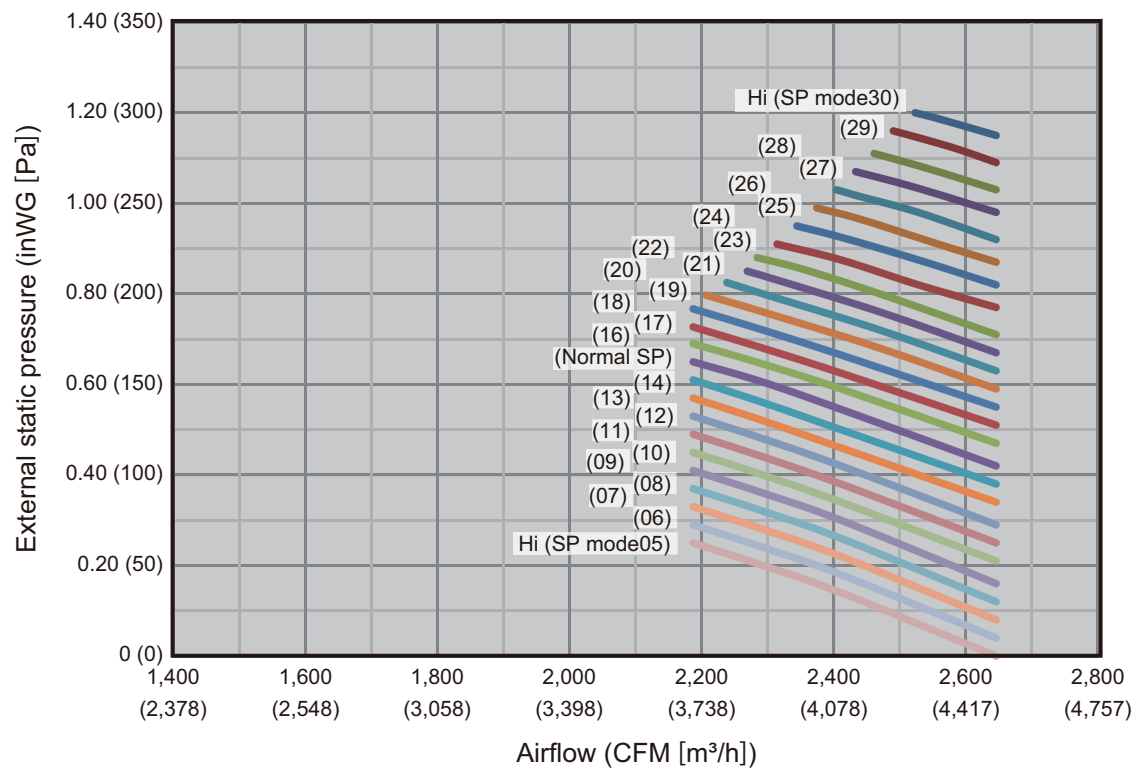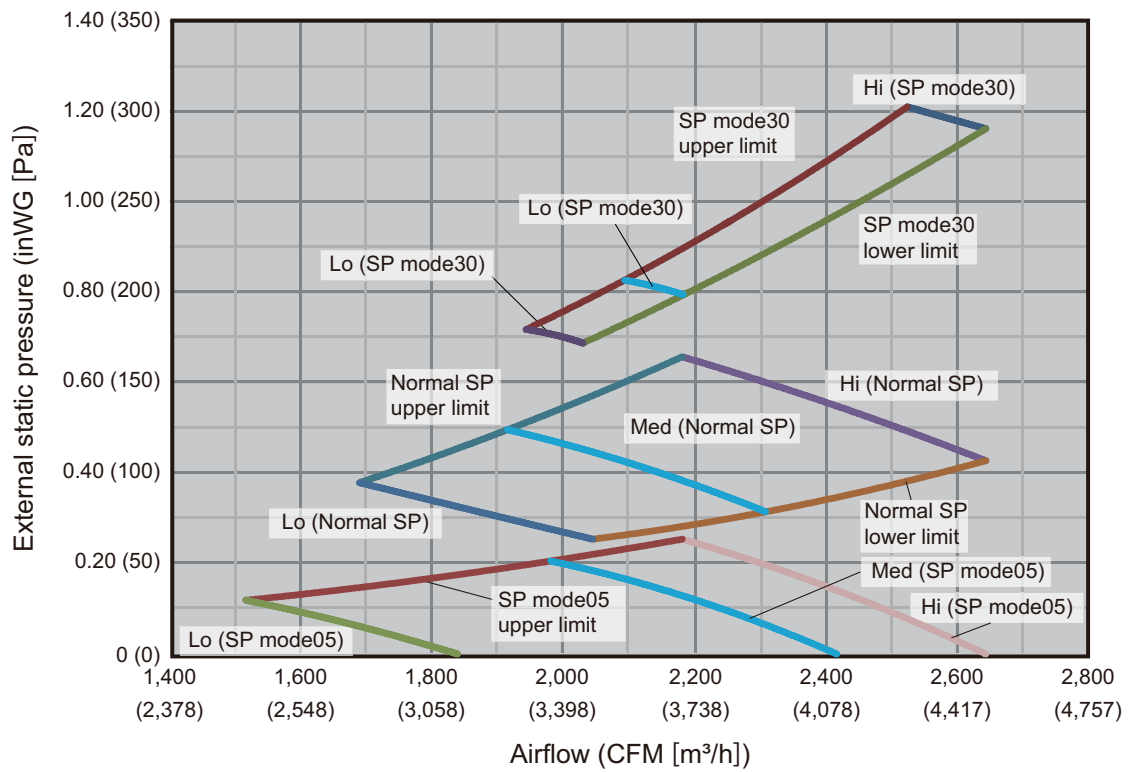

Cooling

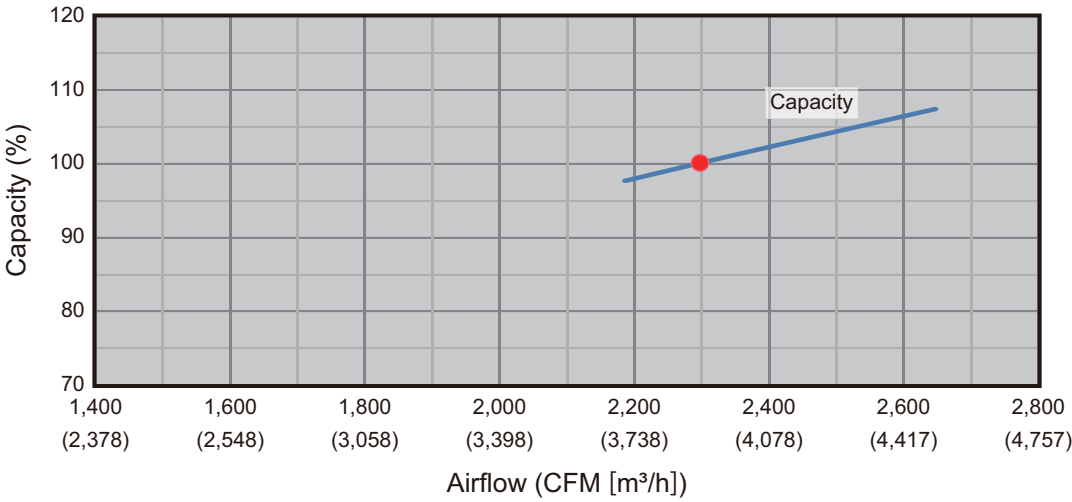



Heating

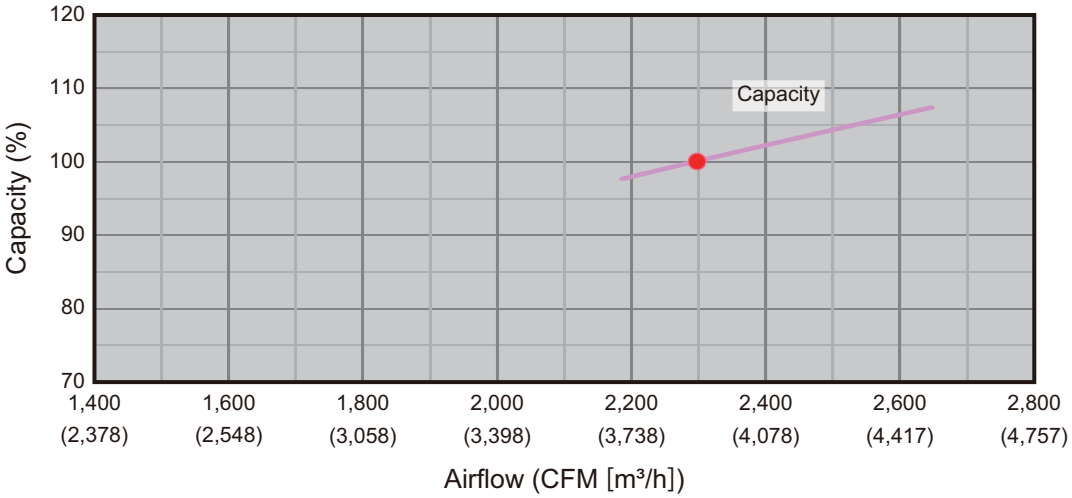

INDOOR  
UNITS


INDOOR  
UNITS

# Model: ARUH96TLAV2

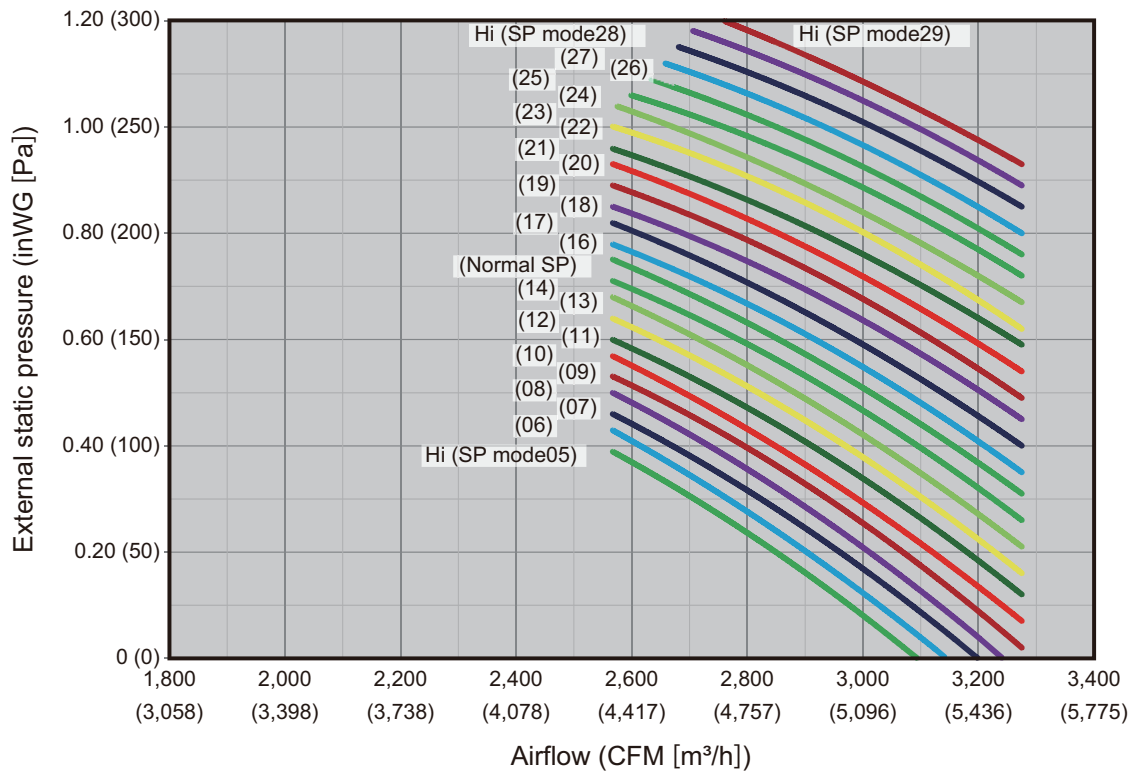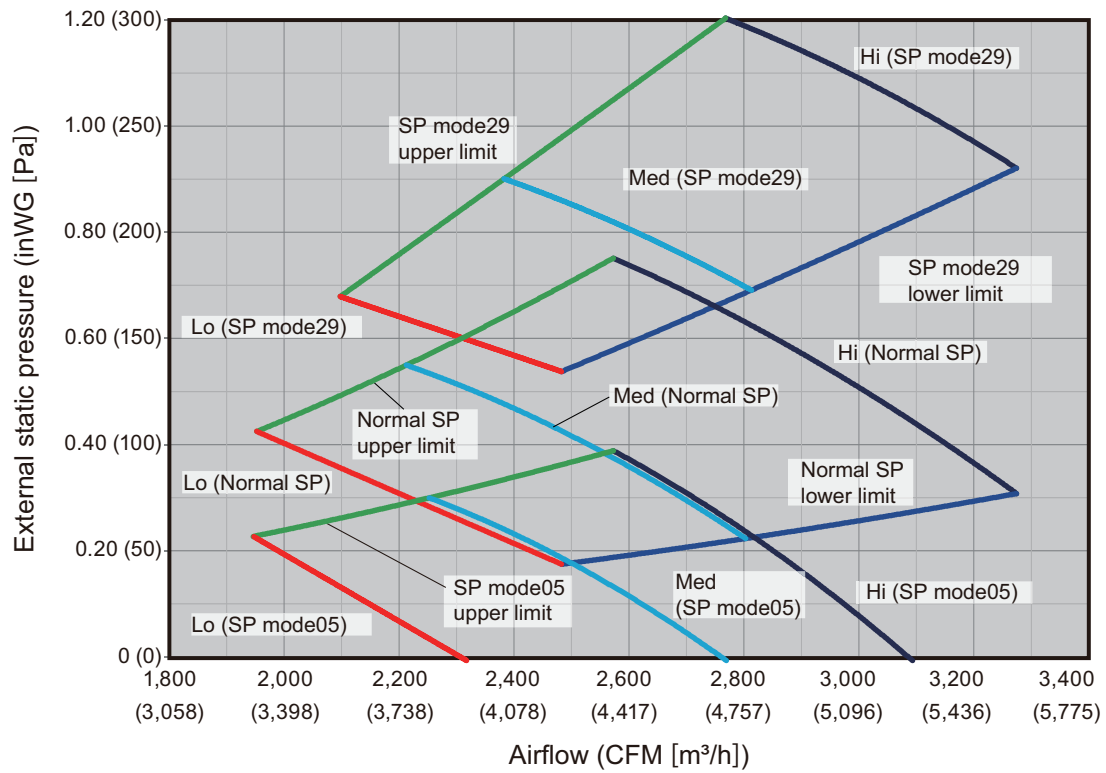




## Cooling

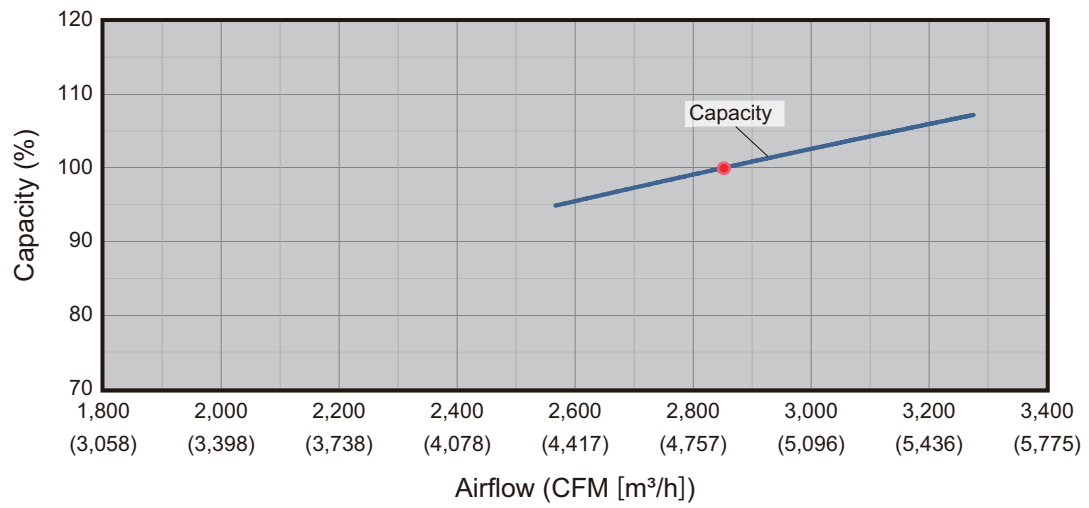

## Heating

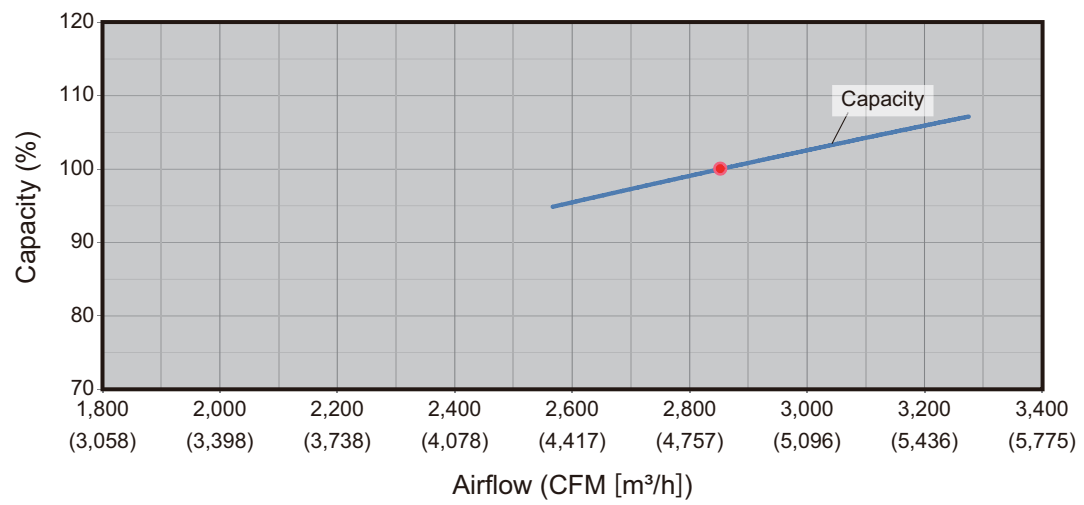



INDOOR  
UNITS

INDOOR  
UNITS


## 7-5. Fresh air characteristics

### ■ Circular flow cassette type and 4-way flow cassette type

#### ● Airflow volume—Static pressure of fresh air intake characteristics

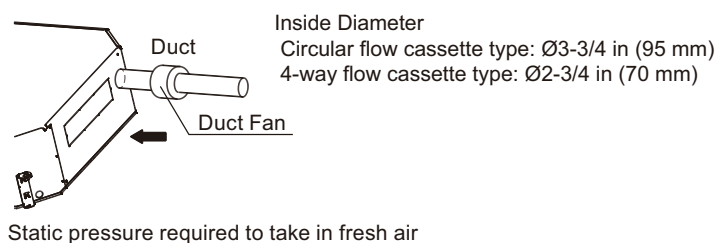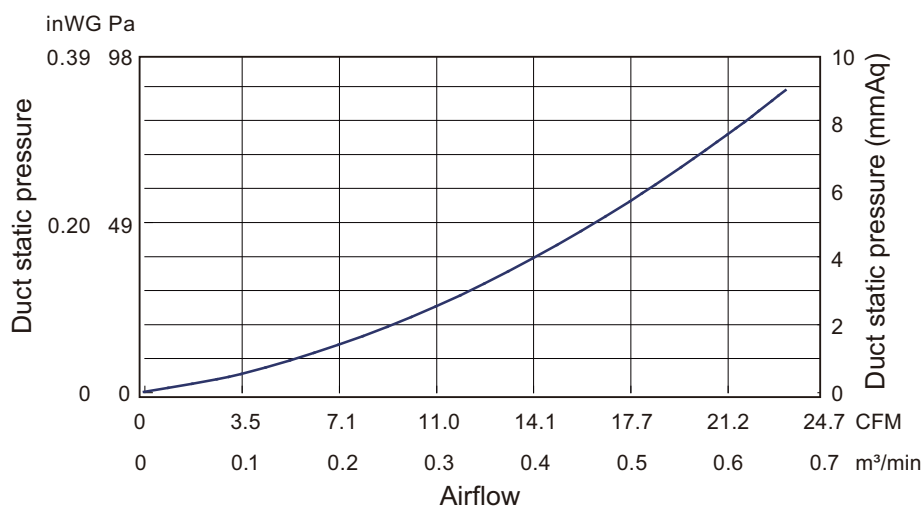

#### ● Installation

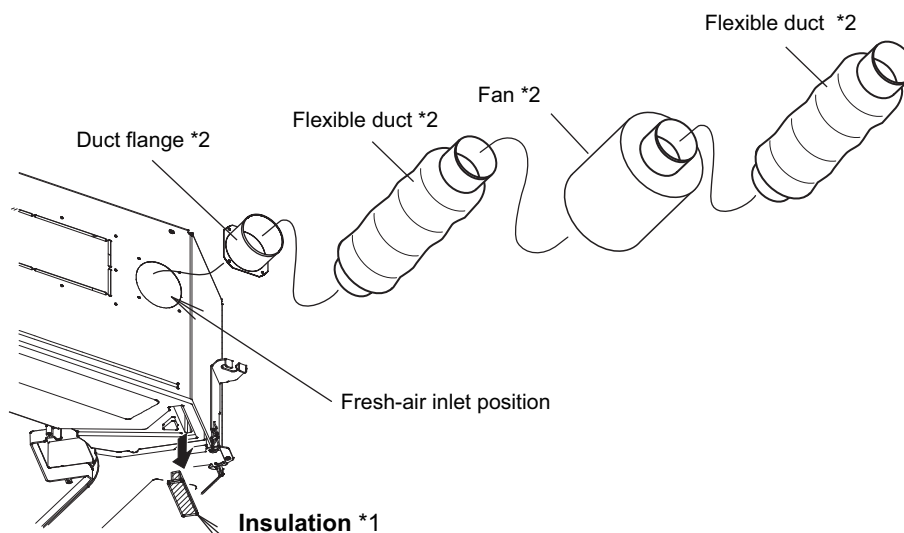


\*1: In case of fresh-air intake, remove the insulation.

\*2: Locally-purchased parts

For the fresh-air inlet position, refer to ["Circular flow cassette type"](#) on page 04-33 and ["4-way flow cassette type"](#) on page 04-30.


## ■ Ceiling type

### ● Airflow volume—Static pressure of fresh air intake characteristics

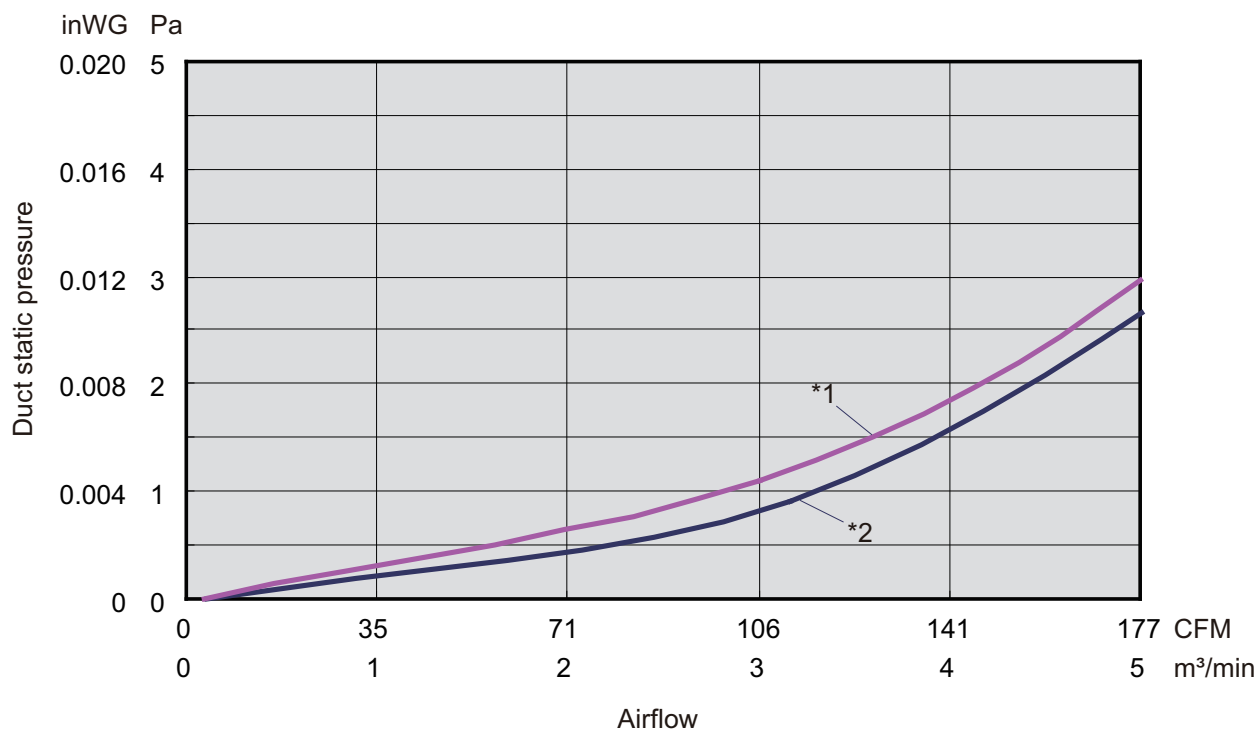

- \*1: ABUA30TLAV2
- \*2: ABUA36TLAV2

### ● Installation

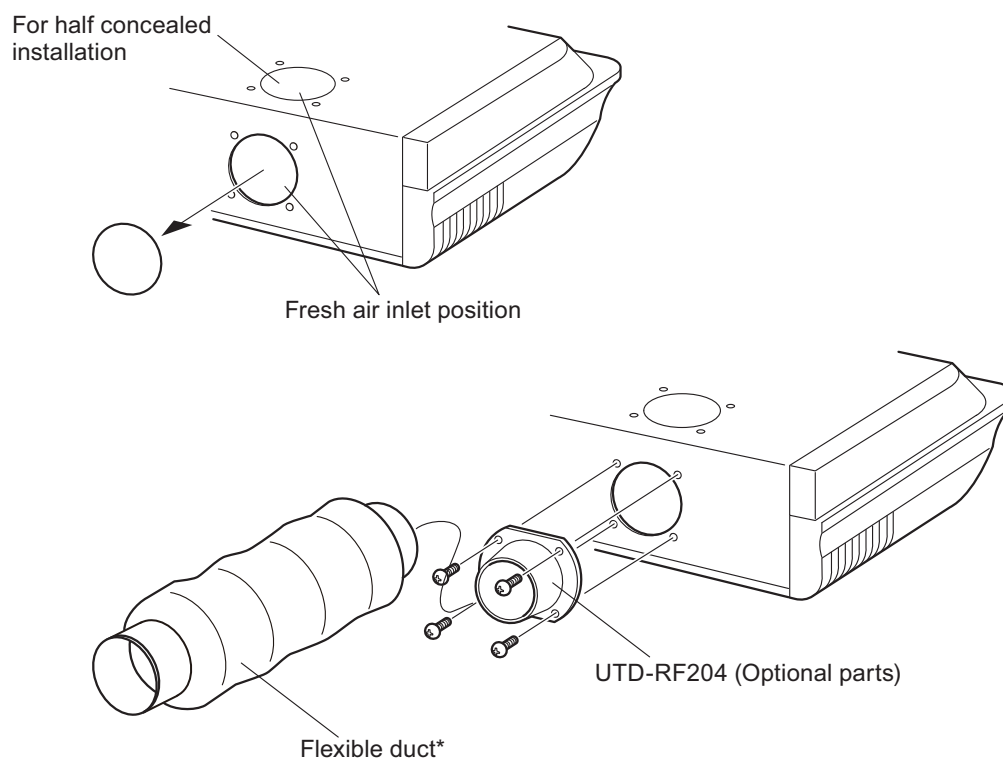

\*: Locally purchased parts

For the fresh-air inlet position, refer to "Ceiling type" on page 04-52.

## 8. Airflow

Conversion factor:

- $1 \text{ m}^3/\text{h} = 0.2778 \text{ l/s} = 0.5886 \text{ CFM}$
- $3.6 \text{ m}^3/\text{h} = 1 \text{ l/s}$
- $1.699 \text{ m}^3/\text{h} = 1 \text{ CFM}$

### 8-1. Compact cassette type

Model	Mode	Airflow		
		$\text{m}^3/\text{h}$	$\text{l/s}$	CFM
AUUA4TLAV2	HIGH	530	147	312
	MED—HIGH* <sup>1</sup>	490/480	136/133	288/283
	MED* <sup>1</sup>	450/430	125/119	265/253
	MED—LOW* <sup>1</sup>	420/380	117/106	247/224
	LOW* <sup>1</sup>	390/340	108/94	230/200
	QUIET* <sup>1</sup>	350/300	97/83	206/177
AUUA7TLAV2	HIGH	540	150	318
	MED—HIGH	500	139	295
	MED	460	128	271
	MED—LOW	420	117	247
	LOW	390	108	230
	QUIET	350	97	206
AUUA9TLAV2	HIGH	550	153	324
	MED—HIGH	520	144	306
	MED	480	133	283
	MED—LOW	440	122	259
	LOW	400	111	236
	QUIET	350	97	206
AUUA12TLAV2	HIGH	600	167	353
	MED—HIGH	560	156	330
	MED	520	144	306
	MED—LOW	480	133	283
	LOW	430	119	253
	QUIET	390	108	230
AUUA14TLAV2	HIGH	680	189	401
	MED—HIGH	620	172	365
	MED	560	156	330
	MED—LOW	500	139	295
	LOW	440	122	259
	QUIET	390	108	230
AUUA18TLAV2	HIGH	710	197	418
	MED—HIGH	660	183	389
	MED	590	164	348
	MED—LOW	520	144	306
	LOW	460	128	271
	QUIET	400	111	236
AUUA24TLAV2	HIGH	1,030	286	607
	MED—HIGH	910	253	536
	MED	790	219	465
	MED—LOW	680	189	401
	LOW	560	156	330
	QUIET	450	125	265

\*1: This value is “Cooling operation/Heating operation”.

## 8-2. 4-way flow cassette type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
AUUB18TLAV	HIGH	1,150	319	677
	MED	940	261	553
	LOW	870	242	512
AUUB24TLAV	HIGH	1,280	356	753
	MED	1,040	289	612
	LOW	870	242	512
AUUB30TLAV	HIGH	1,600	444	942
	MED	1,300	361	765
	LOW	1,100	306	647
AUUB36TLAV	HIGH	1,800	500	1,059
	MED	1,300	361	765
	LOW	1,100	306	647

## 8-3. Circular flow cassette type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
AUUB18TLAV2	HIGH	1,050	292	618
	MED—HIGH	930	258	547
	MED	900	250	530
	LOW—HIGH	870	242	512
	LOW	810	225	477
	QUIET	780	217	459
AUUB24TLAV2	HIGH	1,120	311	659
	MED—HIGH	1,050	292	618
	MED	930	258	547
	LOW—HIGH	900	250	530
	LOW	870	242	512
	QUIET	780	217	459
AUUB30TLAV2	HIGH	1,470	408	865
	MED—HIGH	1,160	322	683
	MED	1,070	297	630
	LOW—HIGH	930	258	547
	LOW	900	250	530
	QUIET	780	217	459
AUUB36TLAV2	HIGH	1,620	450	954
	MED—HIGH	1,500	417	883
	MED	1,400	389	824
	LOW—HIGH	1,340	372	789
	LOW	1,280	356	753
	QUIET	1,150	319	677
AUUB48TLAV2	HIGH	2,040	567	1,201
	MED—HIGH	1,800	500	1,059
	MED	1,590	442	936
	LOW—HIGH	1,440	400	848
	LOW	1,300	361	765
	QUIET	1,150	319	677

INDOOR  
UNITSINDOOR  
UNITS

## 8-4. Mini duct type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ARUL4TLAV2	HIGH	460	128	271
	MED—HIGH	440	122	259
	MED	420	117	247
	LOW—HIGH	400	111	235
	LOW	370	103	218
	QUIET	340	94	200

## 8-5. Slim duct/Slim concealed floor type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ARUL7TLAV2	HIGH	550	153	324
	MED—HIGH	480	133	283
	MED	440	122	259
	MED—LOW	410	114	241
	LOW	370	103	218
	QUIET	320	89	188
ARUL9TLAV2	HIGH	600	167	353
	MED—HIGH	510	142	300
	MED	460	128	271
	MED—LOW	420	117	247
	LOW	370	103	218
	QUIET	320	89	188
ARUL12TLAV2	HIGH	600	167	353
	MED—HIGH	530	147	312
	MED	490	136	289
	MED—LOW	450	125	265
	LOW	410	114	241
	QUIET	340	94	200
ARUL14TLAV2	HIGH	800	222	471
	MED—HIGH	680	189	401
	MED	600	167	353
	MED—LOW	520	144	306
	LOW	440	122	259
	QUIET	340	94	200
ARUL18TLAV2	HIGH	940	261	554
	MED—HIGH	820	228	483
	MED	730	203	430
	MED—LOW	630	175	371
	LOW	540	150	318
	QUIET	470	131	277

## 8-6. Medium static pressure duct type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ARUM24TLAV2	HIGH	1,460	406	860
	MED—HIGH	1,370	381	807
	MED	1,290	358	760
	MED—LOW	1,190	331	701
	LOW	1,100	306	648
	QUIET	1,000	278	589
ARUM30TLAV2	HIGH	1,770	492	1,043
	MED—HIGH	1,610	447	948
	MED	1,460	406	860
	MED—LOW	1,310	364	772
	LOW	1,160	322	683
	QUIET	1,000	278	589
ARUM36TLAV2	HIGH	1,890	525	1,113
	MED—HIGH	1,750	486	1,031
	MED	1,620	450	954
	MED—LOW	1,450	403	854
	LOW	1,300	361	766
	QUIET	1,150	319	677

## 8-7. High static pressure duct type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ARUH36TLAV	HIGH	2,250	625	1,324
	MED	1,750	486	1,030
	LOW	1,400	389	824
ARUH48TLAV	HIGH	3,000	833	1,766
	MED	2,700	750	1,589
	LOW	2,300	639	1,354
ARUH60TLAV	HIGH	3,350	931	1,972
	MED	2,850	792	1,678
	LOW	2,550	708	1,501
ARUH72TLAV2	HIGH	3,900	1,083	2,296
	MED	3,300	917	1,942
	LOW	3,000	833	1,766
ARUH96TLAV2	HIGH	4,850	1,347	2,855
	MED	4,250	1,181	2,502
	LOW	3,600	1,000	2,119



## 8-8. Compact floor type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
AGUA4TLAV2	HIGH* <sup>1</sup>	380/430	106/119	224/253
	MED—HIGH	350	97	206
	MED	320	89	188
	LOW—HIGH	310	86	182
	LOW	280	78	165
	QUIET	210	58	124
AGUA7TLAV2	HIGH	470	131	277
	MED—HIGH	420	117	247
	MED	390	108	230
	LOW—HIGH	360	100	212
	LOW	330	92	194
	QUIET	270	75	159
AGUA9TLAV2	HIGH	500	139	294
	MED—HIGH	450	125	265
	MED	400	111	235
	LOW—HIGH	360	100	212
	LOW	330	92	194
	QUIET	270	75	159
AGUA12TLAV2	HIGH	590	164	347
	MED—HIGH	520	144	306
	MED	470	131	277
	LOW—HIGH	420	117	247
	LOW	390	108	230
	QUIET	340	94	200
AGUA14TLAV2	HIGH	670	186	394
	MED—HIGH	590	164	347
	MED	520	144	306
	LOW—HIGH	450	125	265
	LOW	390	108	230
	QUIET	340	94	200

\*1: This value is “Cooling operation/Heating operation”.

## 8-9. Floor/Ceiling type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ABUA12TLAV2	HIGH	660	183	389
	MED—HIGH	620	172	365
	MED	580	161	342
	MED—LOW	550	153	324
	LOW	520	144	306
	QUIET	490	136	289
ABUA14TLAV2	HIGH	780	217	459
	MED—HIGH	740	206	436
	MED	690	192	406
	MED—LOW	640	178	377
	LOW	600	167	353
	QUIET	550	153	324
ABUA18TLAV2	HIGH	1,000	278	589
	MED—HIGH	910	253	536
	MED	830	231	489
	MED—LOW	750	208	442
	LOW	660	183	389
	QUIET	580	161	342
ABUA24TLAV2	HIGH	1,000	278	589
	MED—HIGH	930	258	548
	MED	870	242	512
	MED—LOW	800	222	471
	LOW	740	206	436
	QUIET	680	189	401

INDOOR  
UNITSINDOOR  
UNITS

## 8-10. Ceiling type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ABUA30TLAV2	HIGH	1,630	453	960
	MED—HIGH	1,520	422	895
	MED	1,420	394	836
	MED—LOW	1,320	367	777
	LOW	1,220	339	719
	QUIET	1,140	317	671
ABUA36TLAV2	HIGH	1,690	469	995
	MED—HIGH	1,560	433	919
	MED	1,450	403	854
	MED—LOW	1,360	378	801
	LOW	1,270	353	748
	QUIET	1,170	325	689

## 8-11. Wall mounted type

Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ASUA4TLAV2	HIGH	450	125	265
	MED—HIGH	430	119	253
	MED	400	111	235
	LOW—HIGH	380	106	224
	LOW	360	100	212
	QUIET	310	86	182
ASUA7TLAV2	HIGH	550	153	324
	MED—HIGH	510	142	300
	MED	470	131	277
	LOW—HIGH	410	114	241
	LOW	360	100	212
	QUIET	310	86	182
ASUA9TLAV2	HIGH	610	169	359
	MED—HIGH	560	156	330
	MED	510	142	300
	LOW—HIGH	440	122	259
	LOW	360	100	212
	QUIET	310	86	182
ASUA12TLAV2	HIGH	690	192	406
	MED—HIGH	610	169	359
	MED	560	156	330
	LOW—HIGH	530	147	312
	LOW	470	131	277
	QUIET	330	92	194
ASUA14TLAV2	HIGH	800	222	471
	MED—HIGH	740	206	436
	MED	680	189	400
	LOW—HIGH	610	169	359
	LOW	550	153	324
	QUIET	330	92	194
ASUB18TLAV1	HIGH	840	233	494
	MED	770	214	453
	LOW	690	192	406



Model	Mode	Airflow		
		m <sup>3</sup> /h	l/s	CFM
ASUB24TLAV1	HIGH	1,100	306	647
	MED	910	253	536
	LOW	730	203	430
ASUA30TLAV2	HIGH	1,440	400	848
	MED—HIGH	1,200	333	706
	MED	1,050	292	618
	LOW—HIGH	940	261	553
	LOW	890	247	524
	QUIET	700	194	412
ASUA36TLAV2	HIGH* <sup>1</sup>	1,620/1520	450/422	954/895
	MED—HIGH	1,300	361	765
	MED	1,120	311	659
	LOW—HIGH	980	272	577
	LOW	890	247	524
	QUIET	700	194	412
ASUA7TLAV	HIGH	490	136	288
	MED	450	125	265
	LOW* <sup>1</sup>	420/370	117/103	247/218
ASUA9TLAV	HIGH	500	139	294
	MED	450	125	265
	LOW* <sup>1</sup>	420/370	117/103	247/218
ASUA12TLAV	HIGH	560	156	330
	MED	480	133	283
	LOW	420	117	247
ASUA14TLAV	HIGH	670	186	394
	MED	490	136	288
	LOW	420	117	247
ASUB18TLAV	HIGH	840	233	494
	MED	770	214	453
	LOW	690	192	406
ASUB24TLAV	HIGH	1,100	306	647
	MED	910	253	536
	LOW	730	203	430

\*1: This value is “Cooling operation/Heating operation”.


## 9. Noise level curve

### 9-1. Compact cassette type


- Model: AUUA4TLAV2

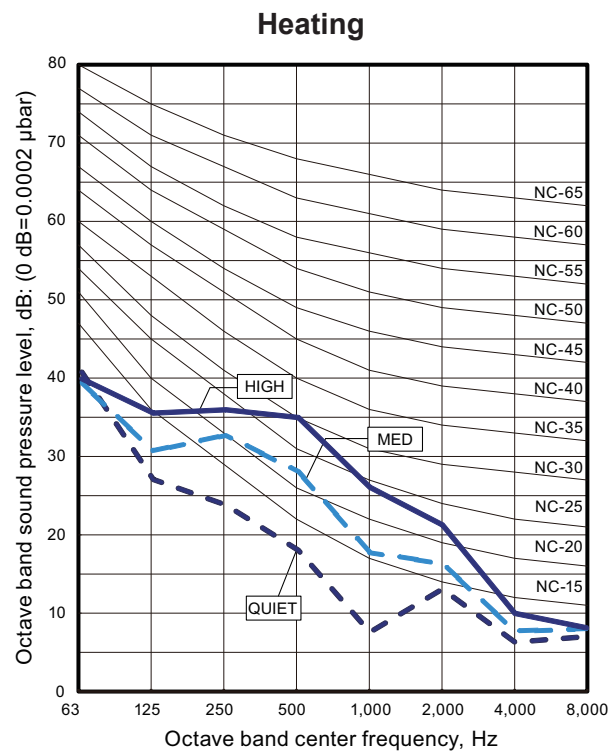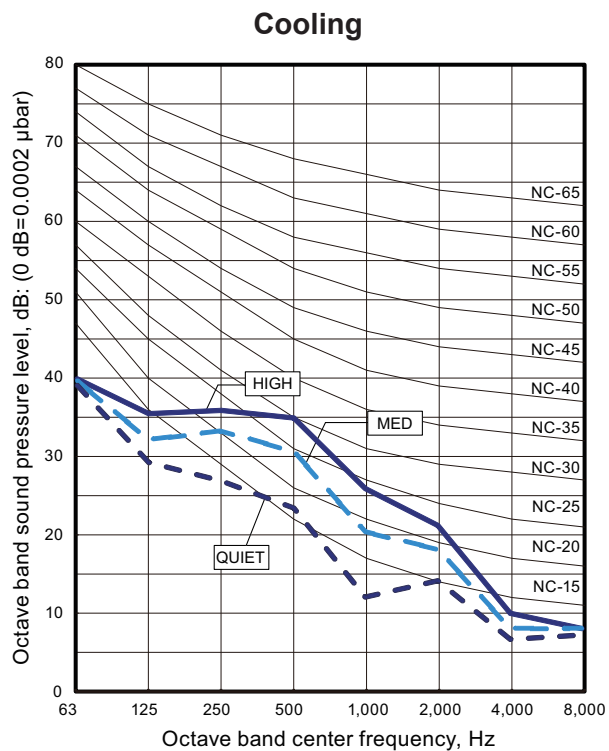


- Model: AUUA7TLAV2

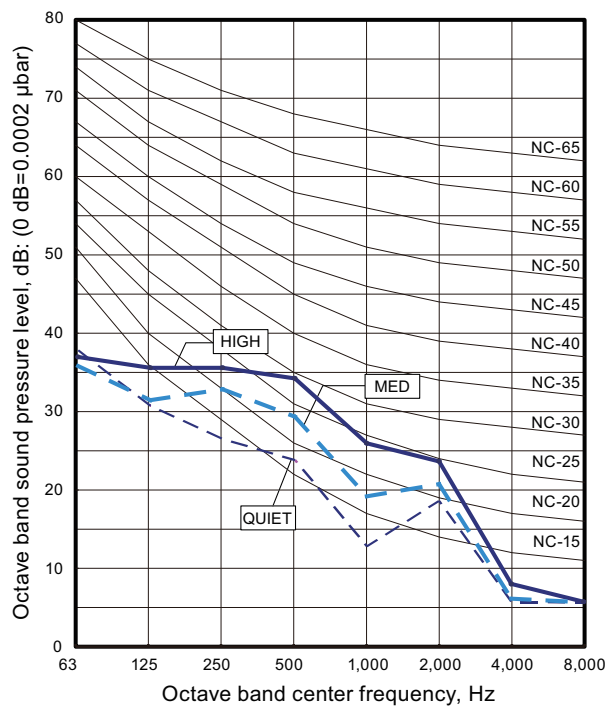


- Model: AUUA9TLAV2

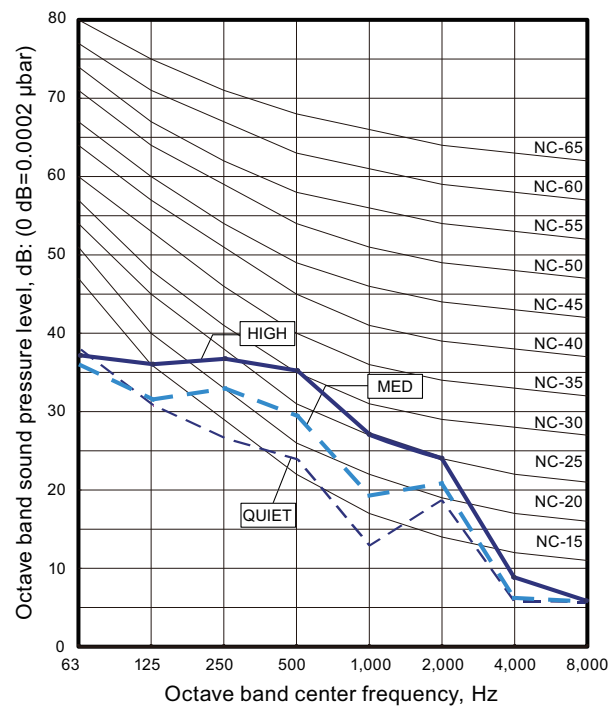


• **Model: AUUA12TLAV2**

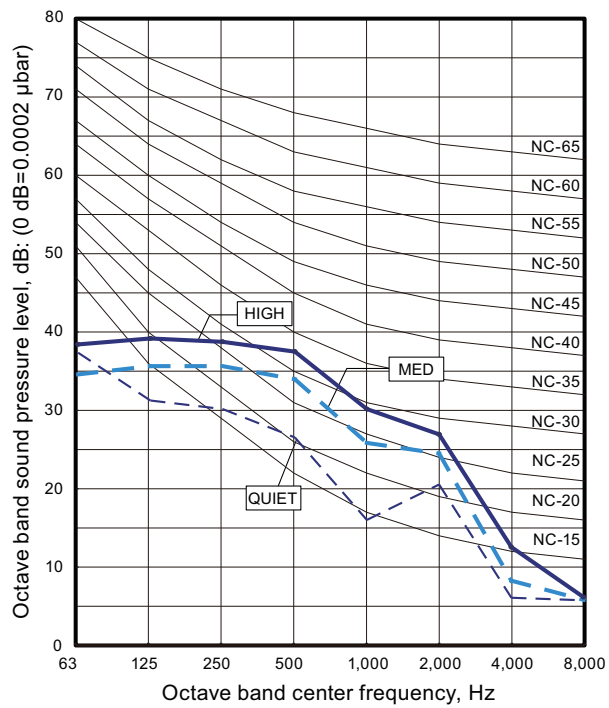


• **Model: AUUA14TLAV2**

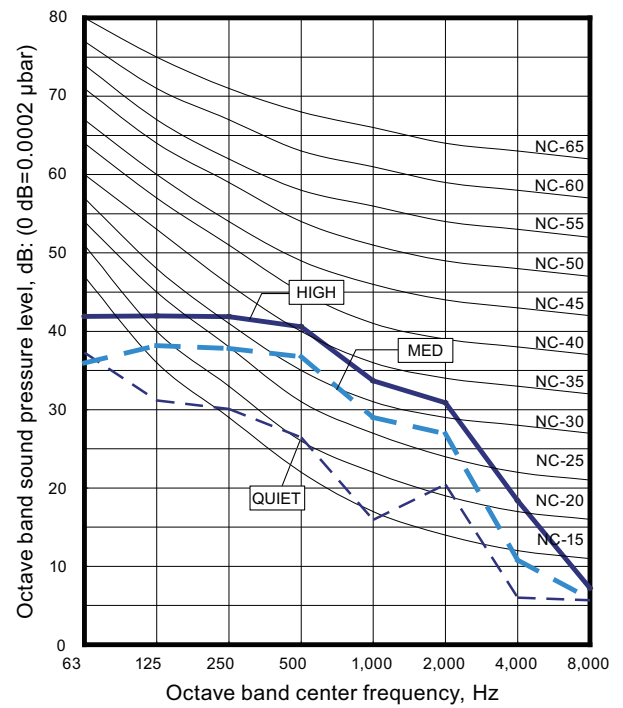

• **Model: AUUA18TLAV2**

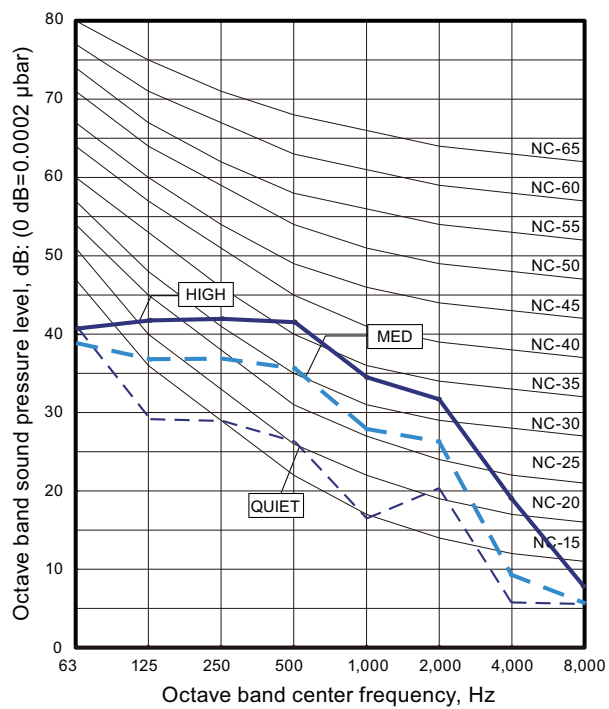


• **Model: AUUA24TLAV2**

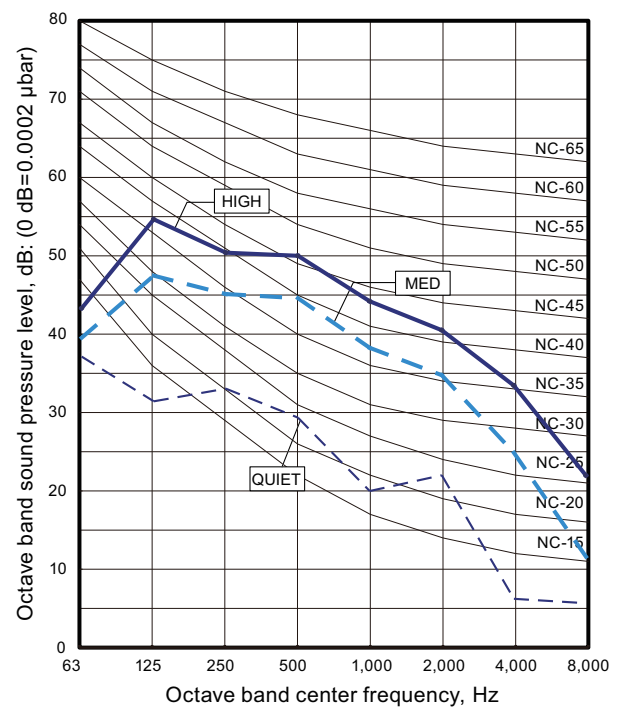


## 9-2. 4-way flow cassette type


### • Model: AUUB18TLAV

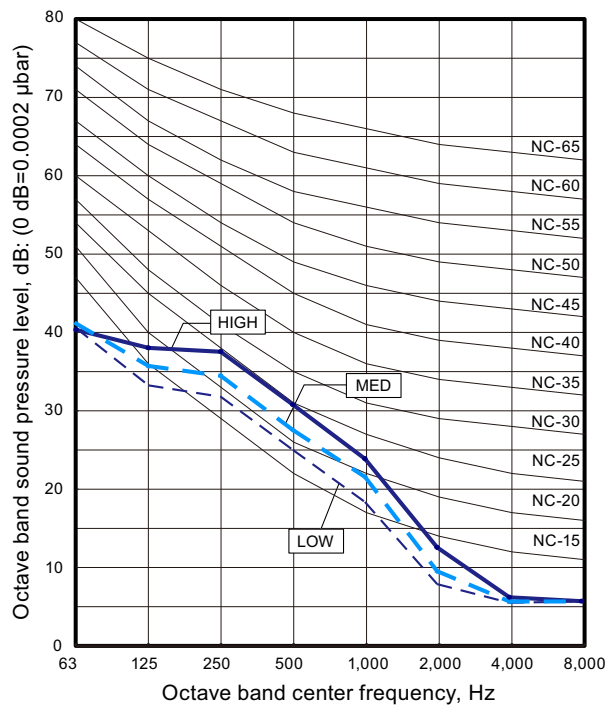


### • Model: AUUB24TLAV

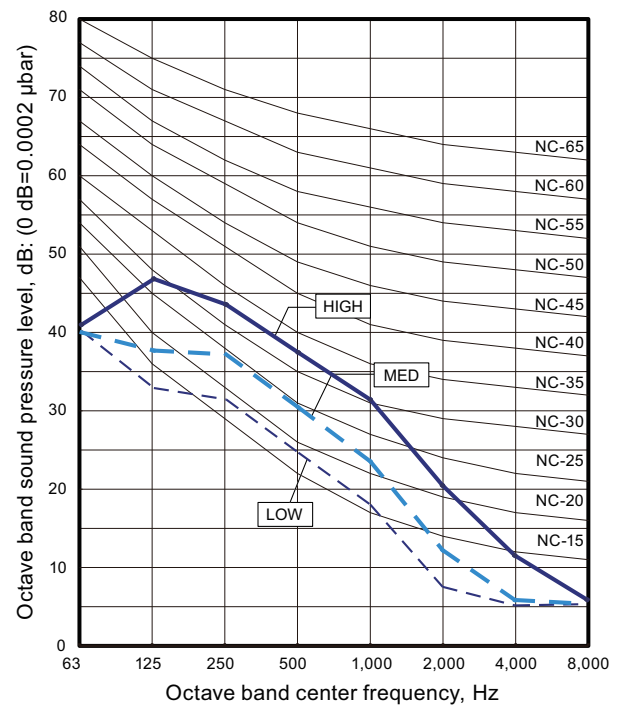

### • Model: AUUB30TLAV

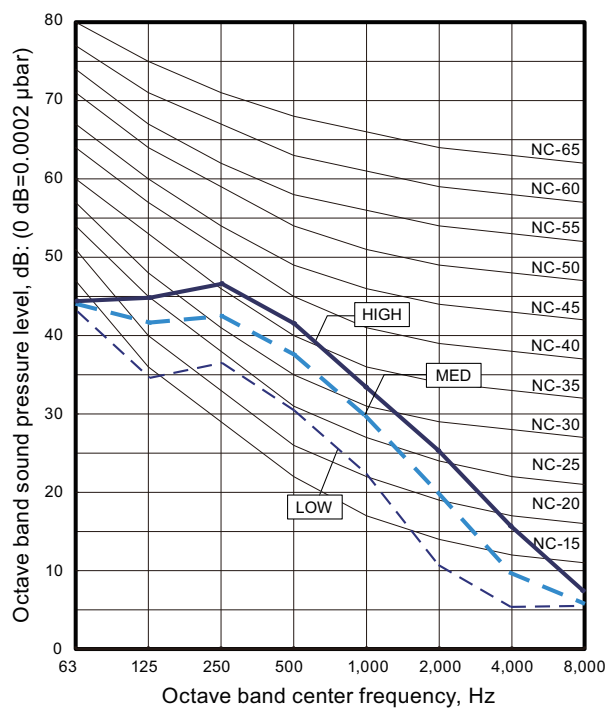


### • Model: AUUB36TLAV

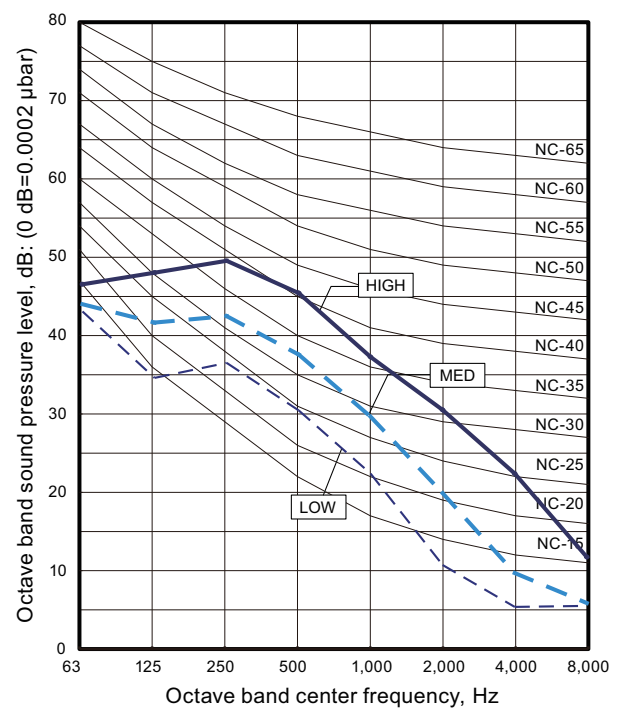


## 9-3. Circular flow cassette type


### • Model: AUUB18TLAV2

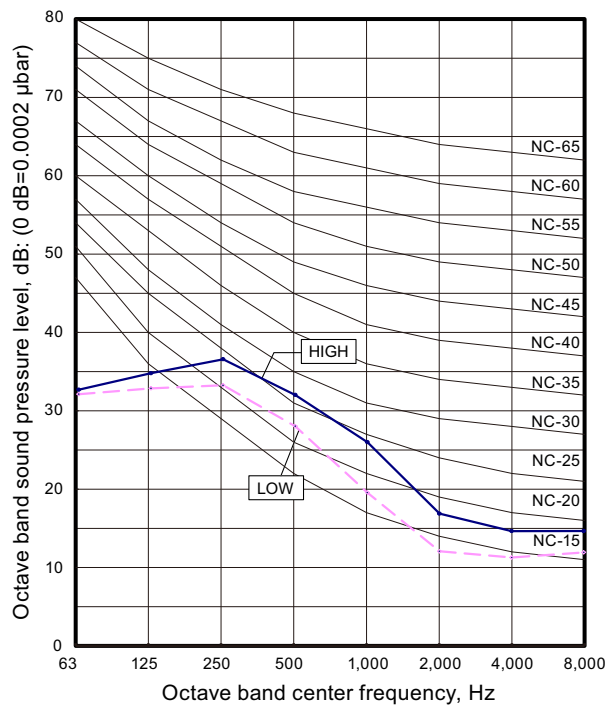

### • Model: AUUB24TLAV2

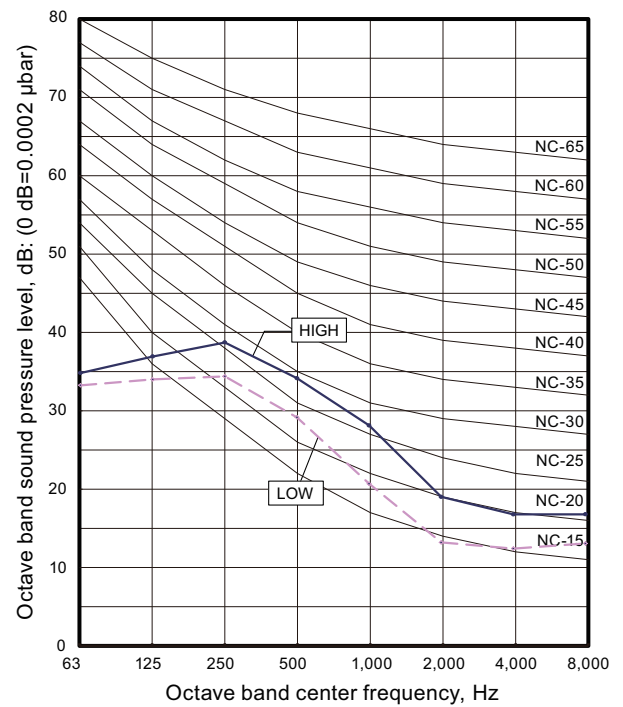


### • Model: AUUB30TLAV2

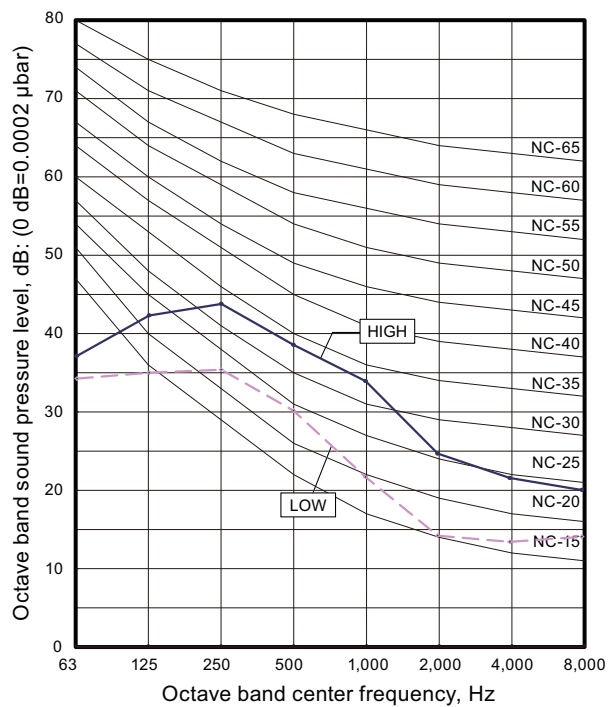




• **Model: AUUB36TLAV2**

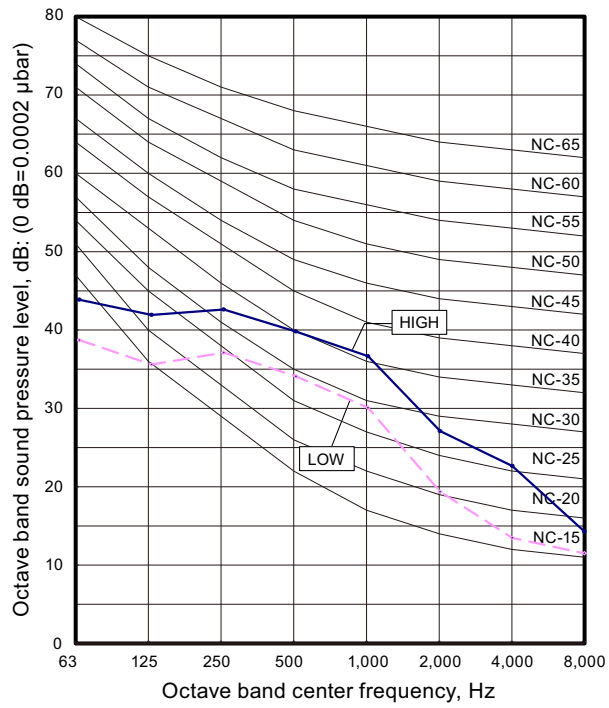

• **Model: AUUB48TLAV2**

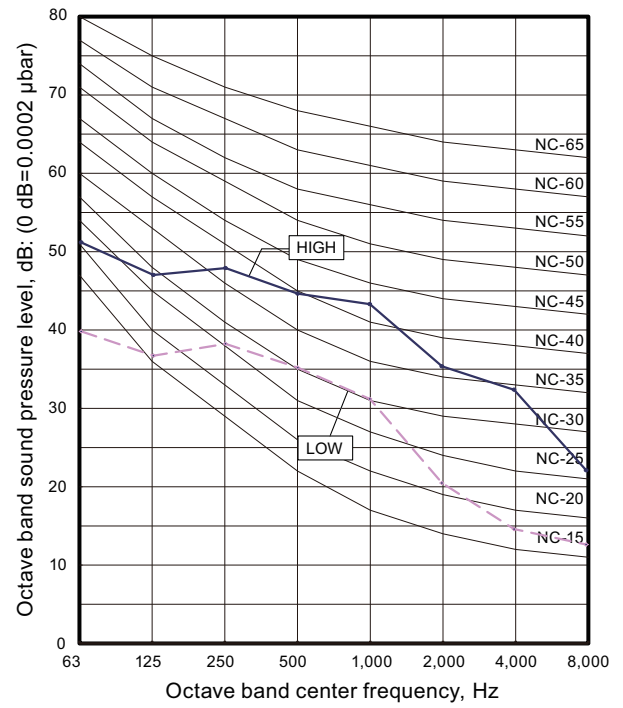


INDOOR  
UNITS

INDOOR  
UNITS


## 9-4. Mini duct type

- Model: ARUL4TLAV2

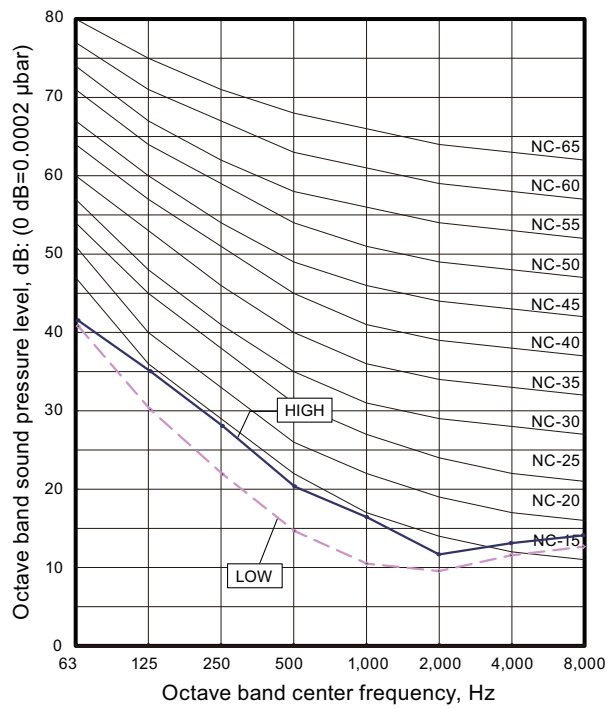


## 9-5. Slim duct/Slim concealed floor type


### • Model: ARUL7TLAV2

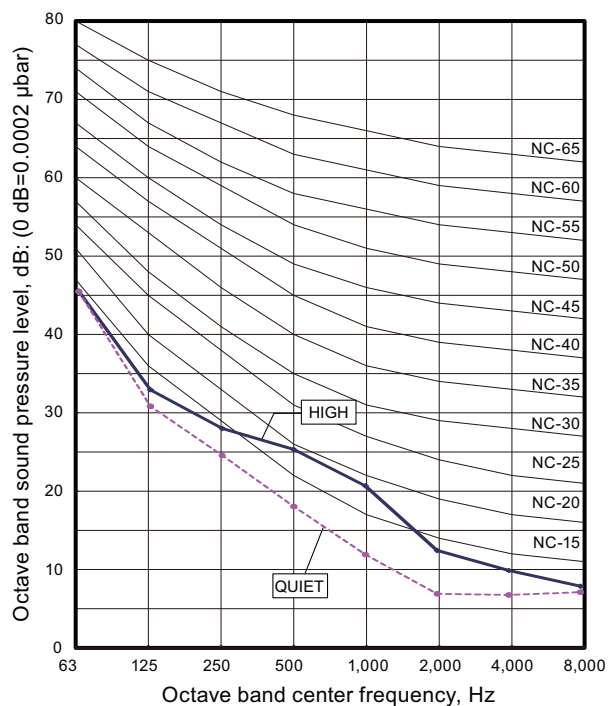


### • Model: ARUL9TLAV2

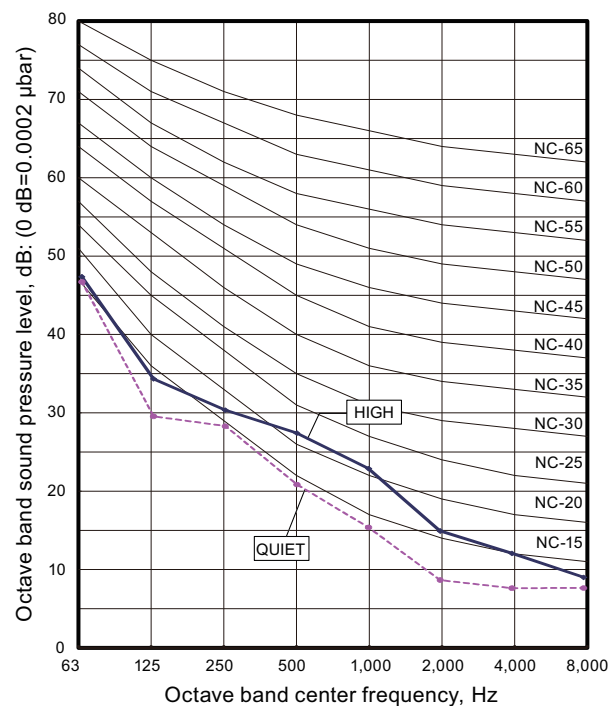


### • Model: ARUL12TLAV2

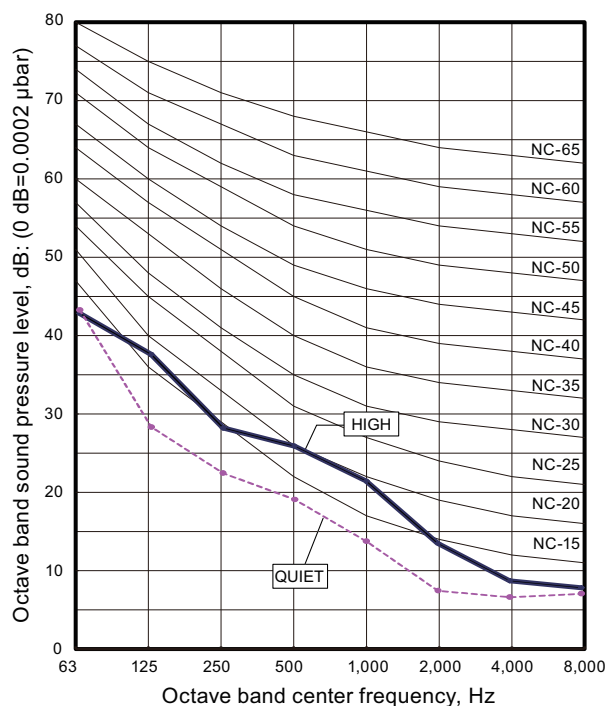

### • Model: ARUL14TLAV2

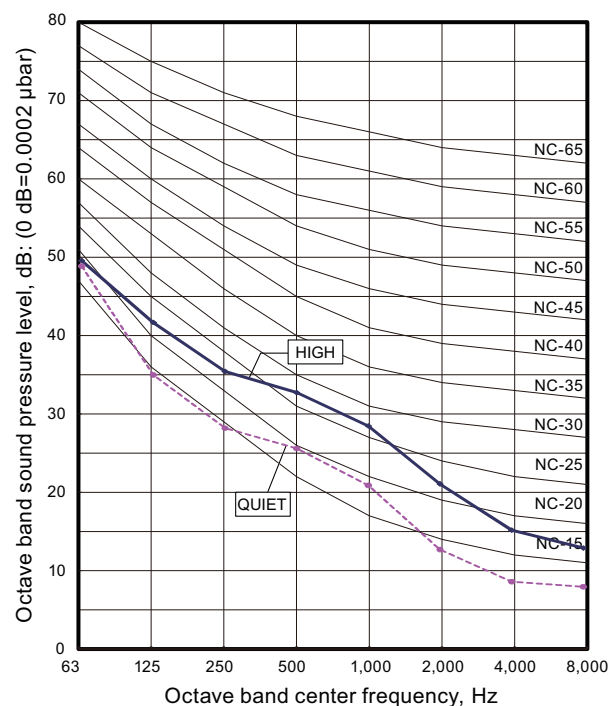


• **Model: ARUL18TLAV2**

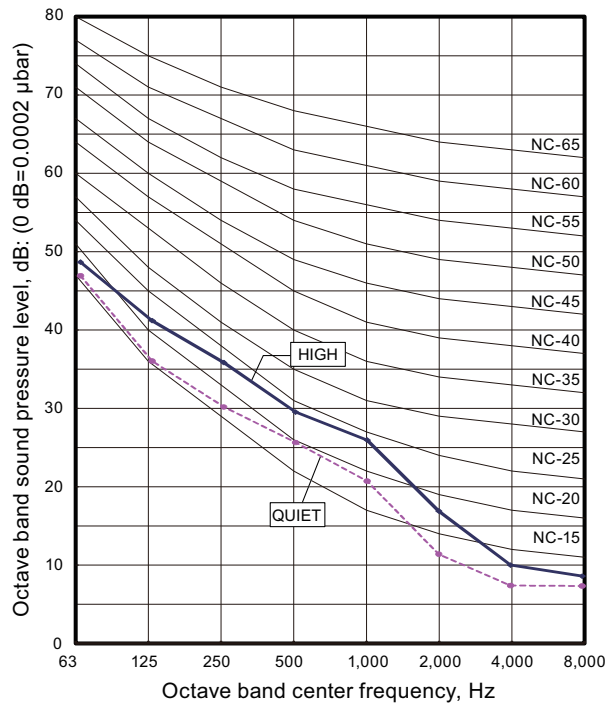
INDOOR  
UNITSINDOOR  
UNITS

## 9-6. Medium static pressure duct type


### • Model: ARUM24TLAV2

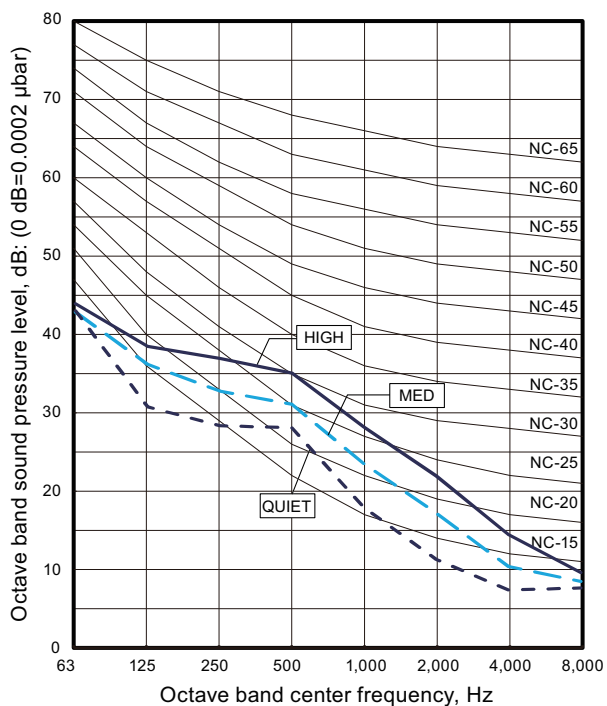

### • Model: ARUM30TLAV2

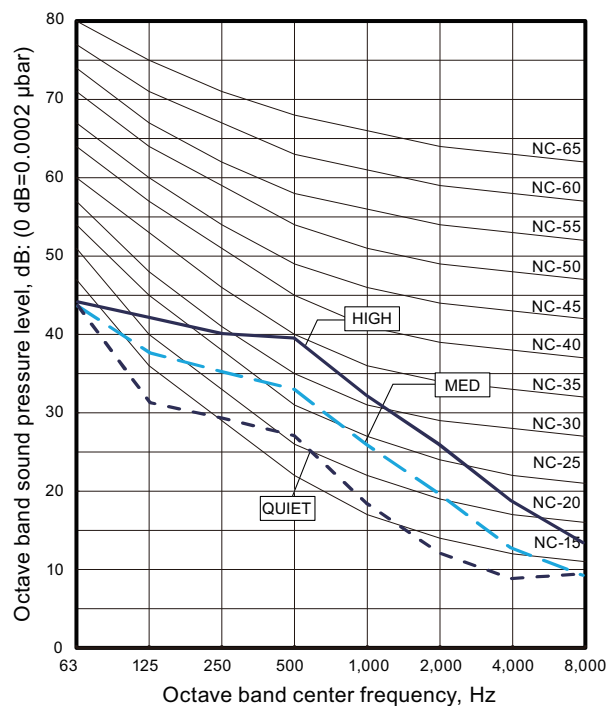


### • Model: ARUM36TLAV2

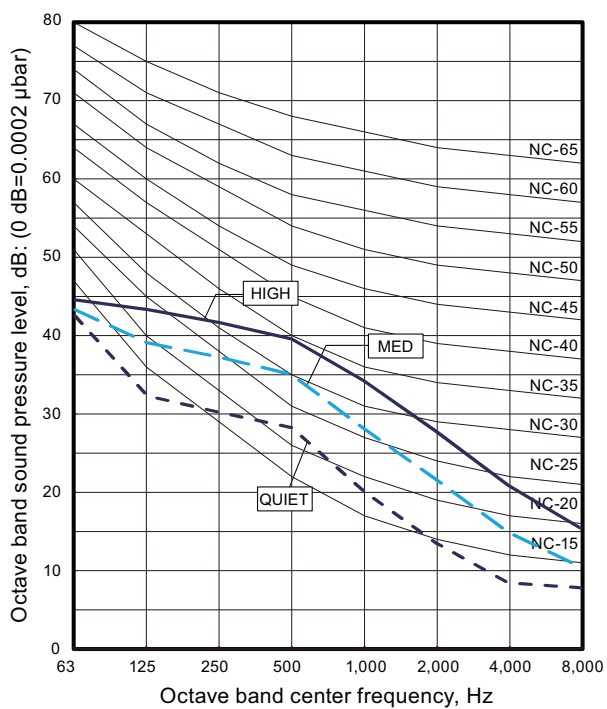


## 9-7. High static pressure duct type


- Model: ARUH36TLAV

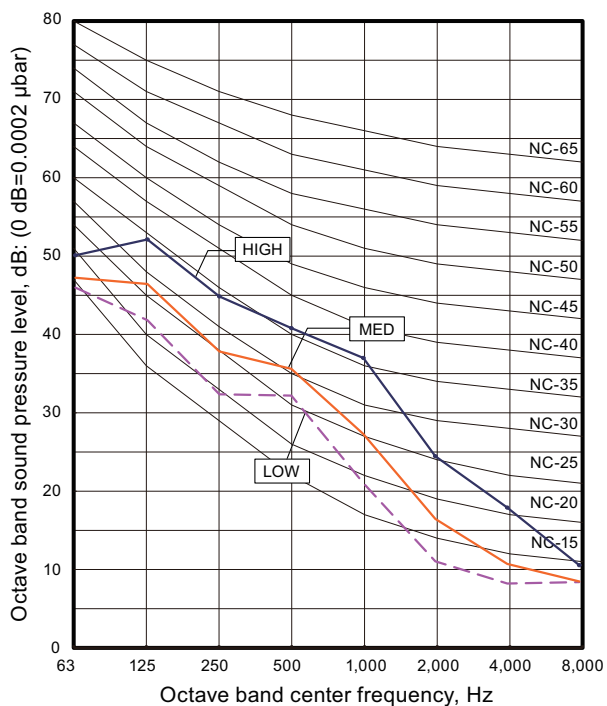


- Model: ARUH48TLAV

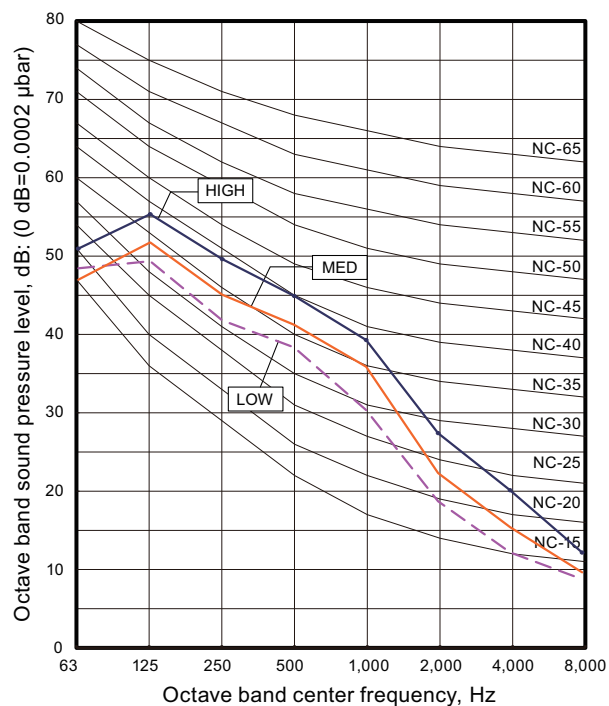


- Model: ARUH60TLAV

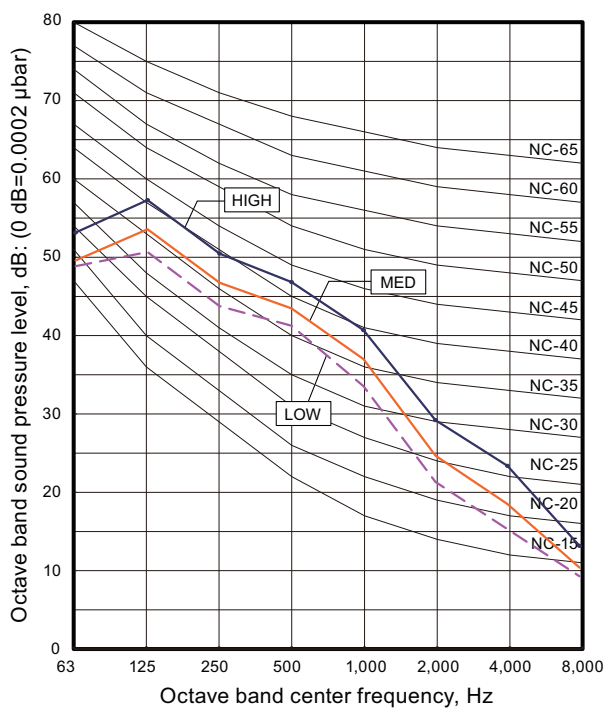

• **Model: ARUH72TLAV2**

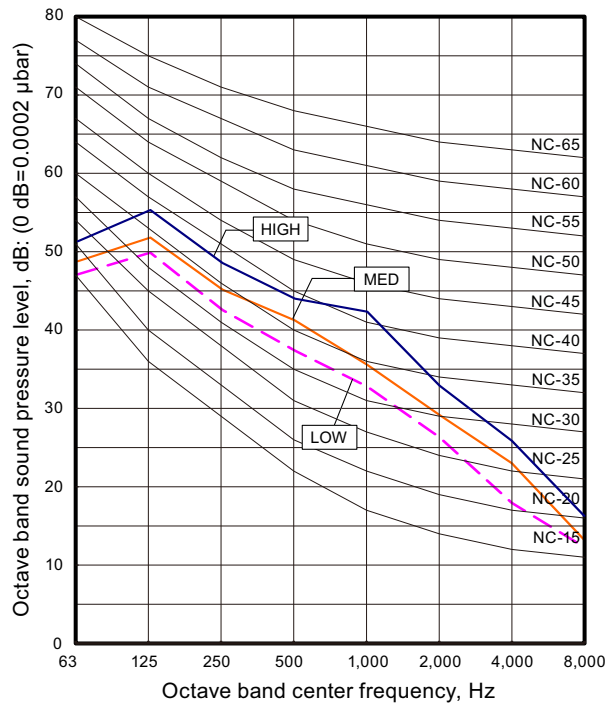

• **Model: ARUH96TLAV2**

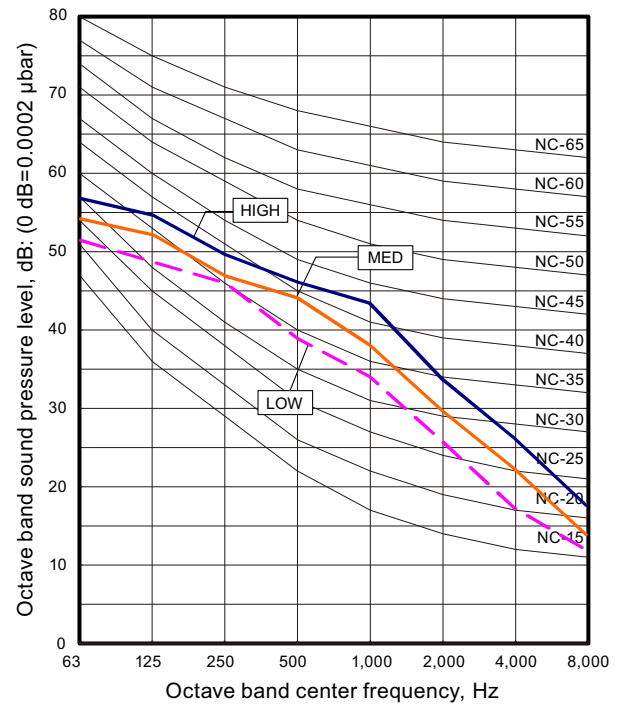


INDOOR  
UNITS


INDOOR  
UNITS

## 9-8. Compact floor type


### • Model: AGUA4TLAV2

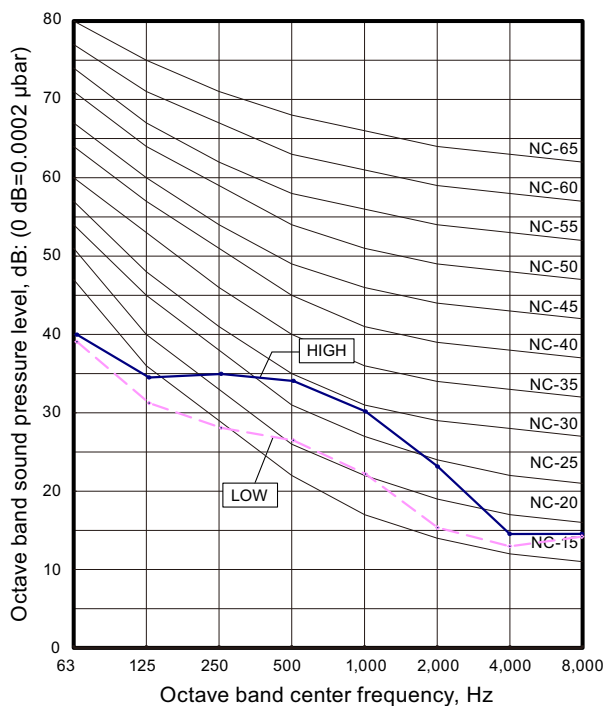


### • Model: AGUA7TLAV2

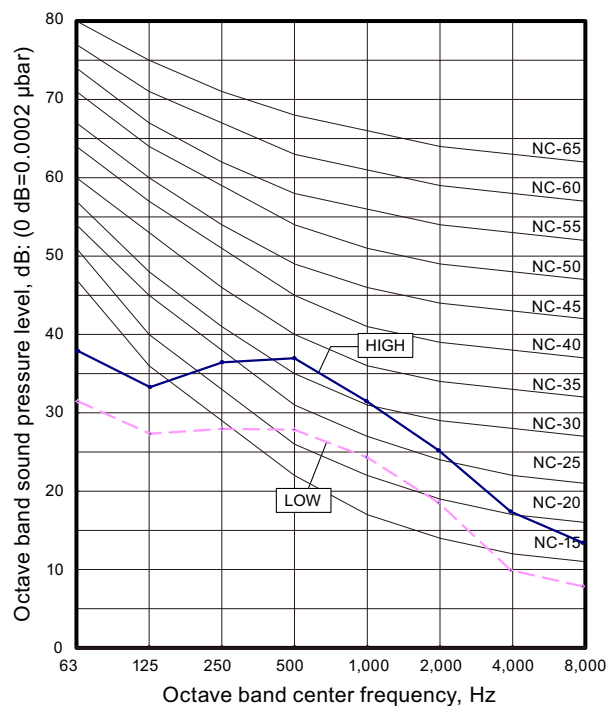

### • Model: AGUA9TLAV2

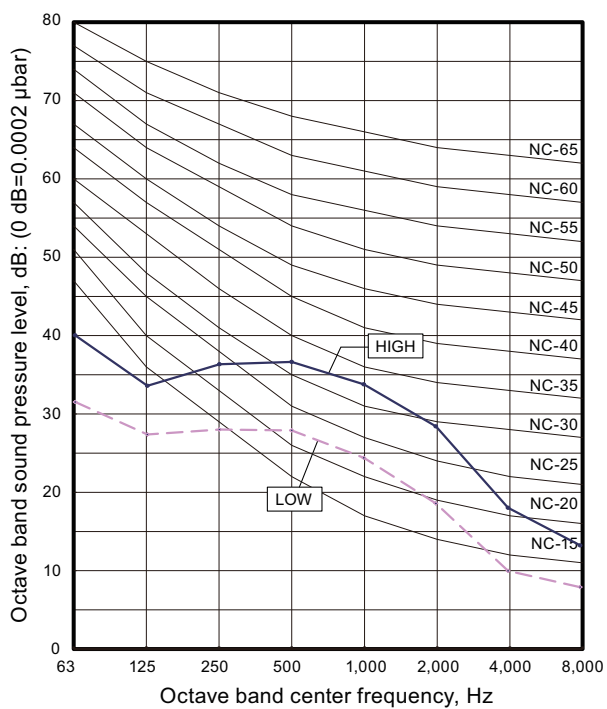


### • Model: AGUA12TLAV2

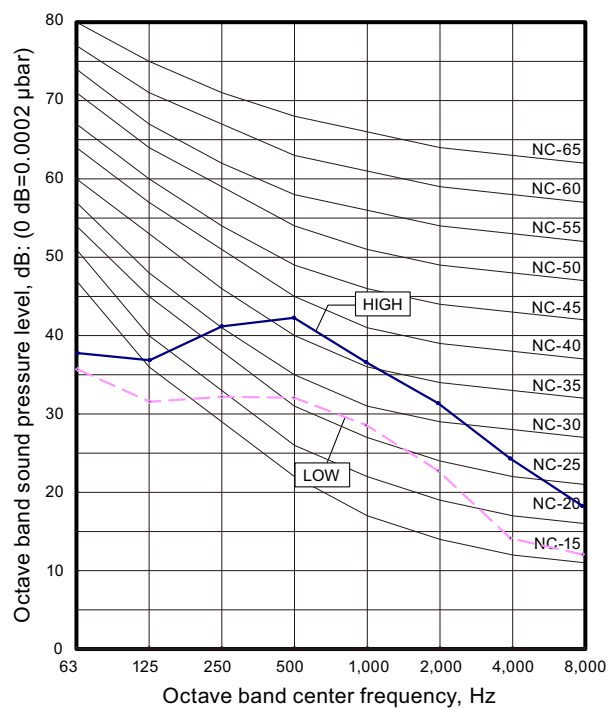




• **Model: AGUA14TLAV2**

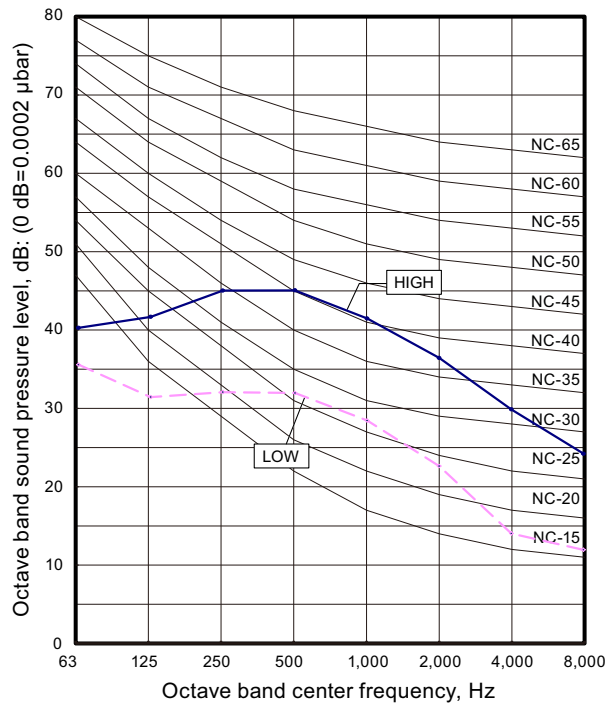


## 9-9. Floor/Ceiling type


### • Model: ABUA12TLAV2

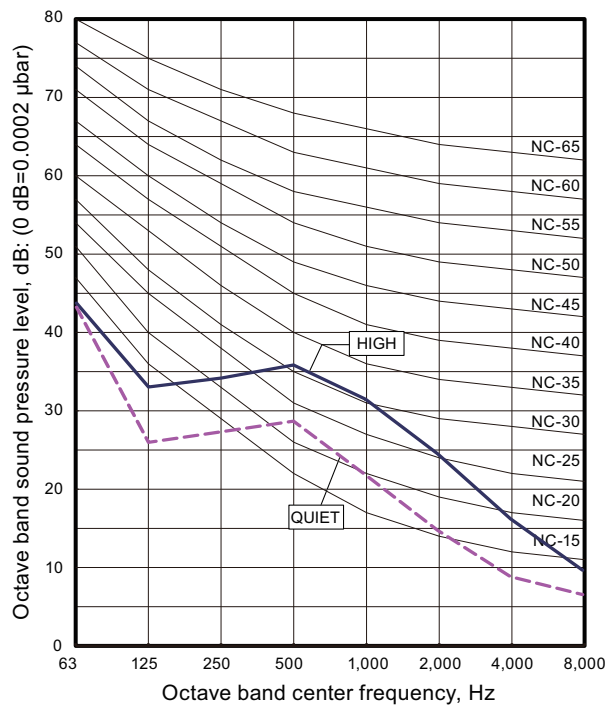


### • Model: ABUA14TLAV2

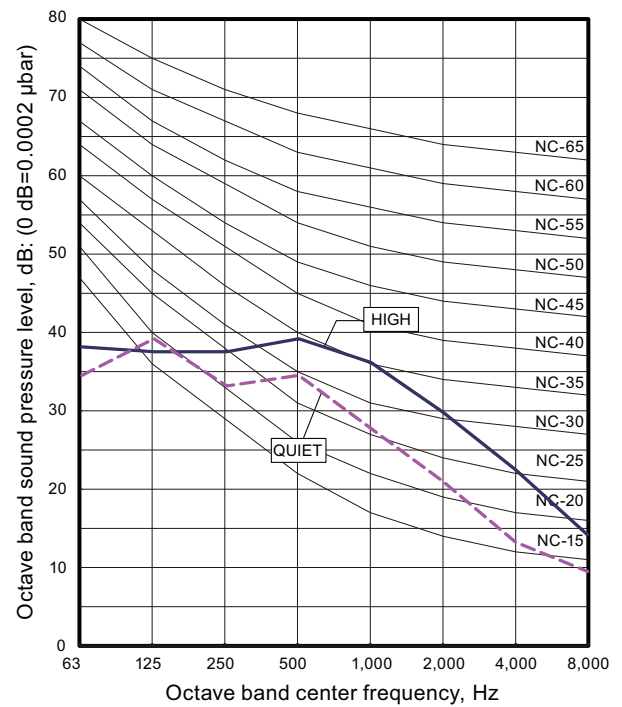

### • Model: ABUA18TLAV2

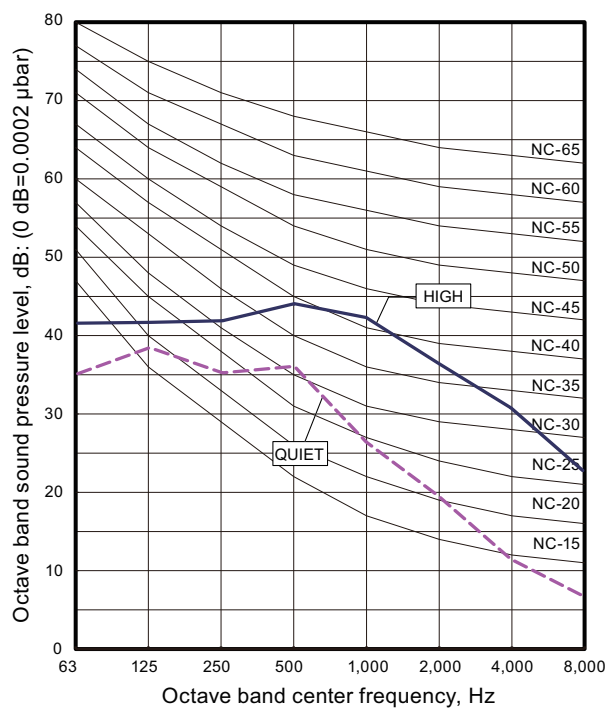


### • Model: ABUA24TLAV2

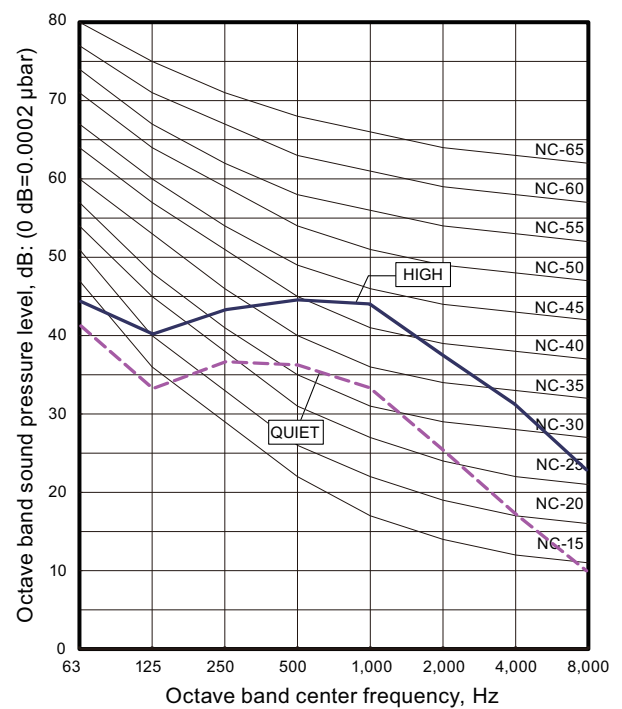


## 9-10. Ceiling type

### • Model: ABUA30TLAV2

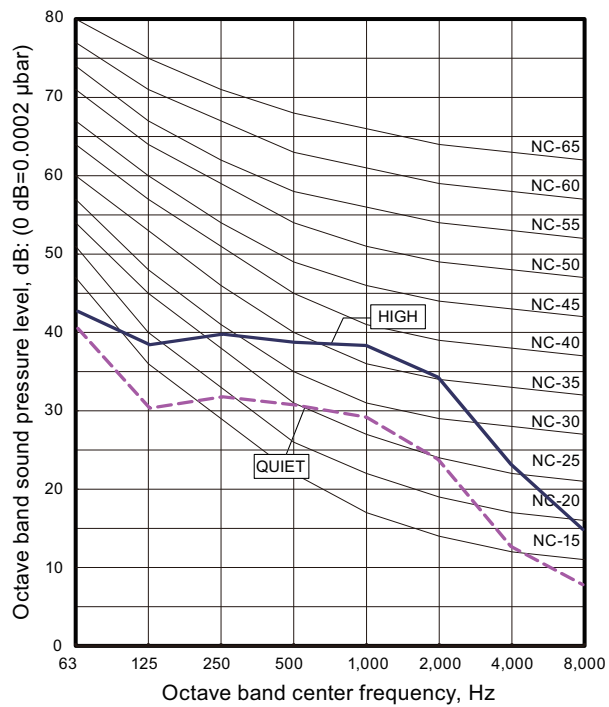


### • Model: ABUA36TLAV2

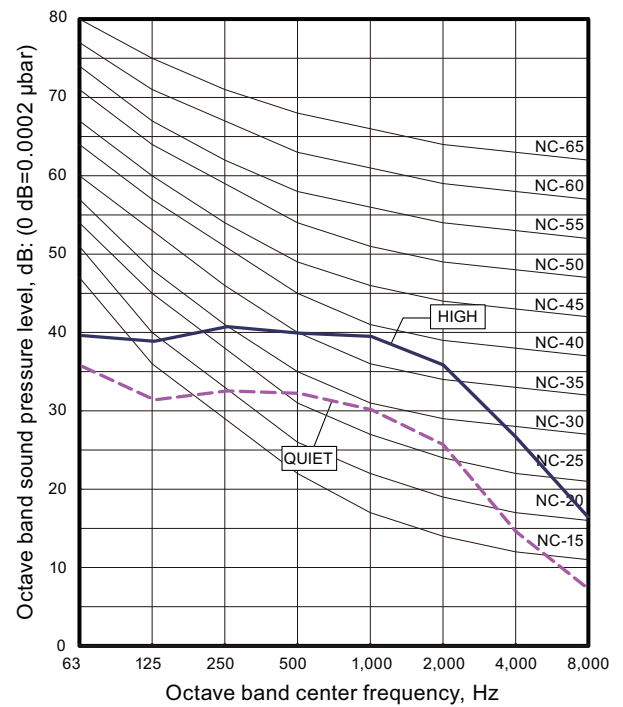


## 9-11. Wall mounted type


### • Model: ASUA4TLAV2

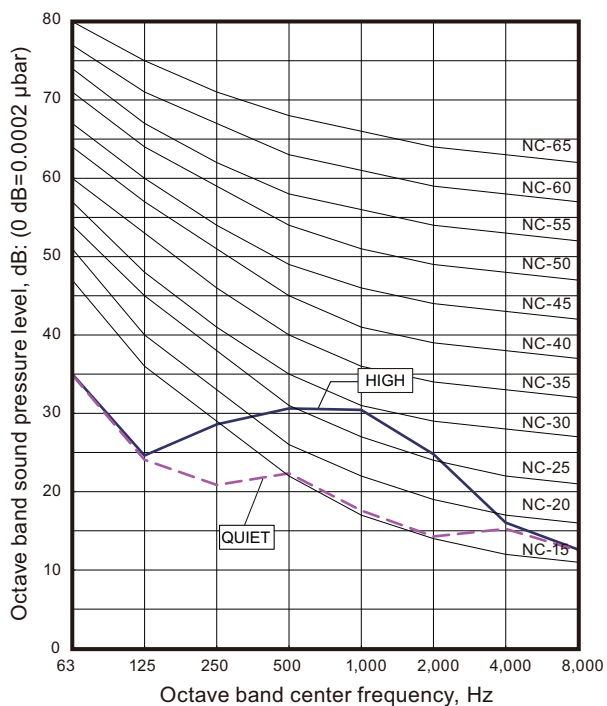


### • Model: ASUA7TLAV2

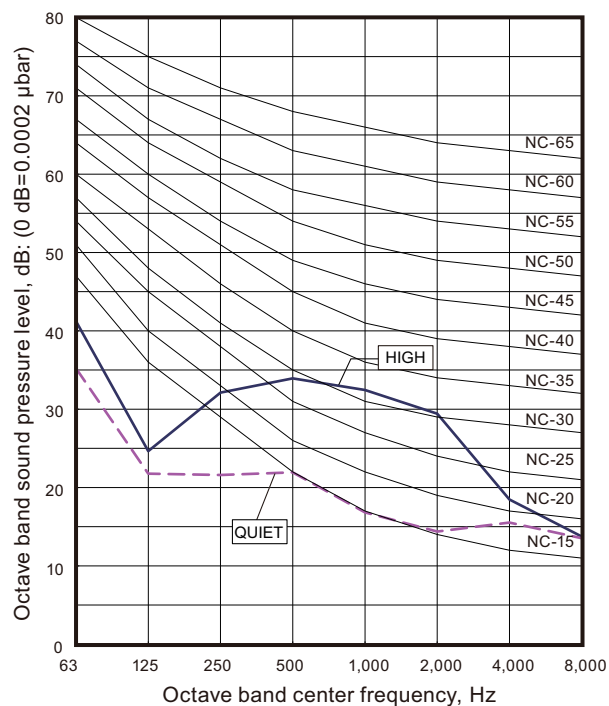


### • Model: ASUA9TLAV2

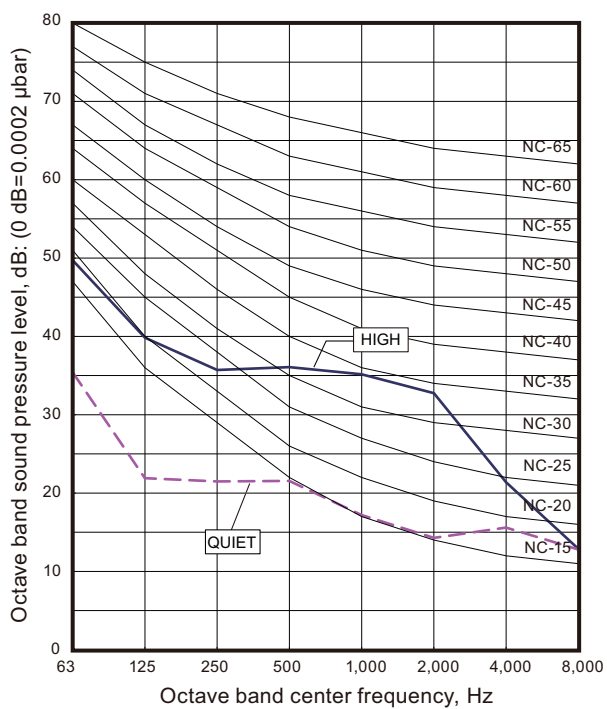


### • Model: ASUA12TLAV2

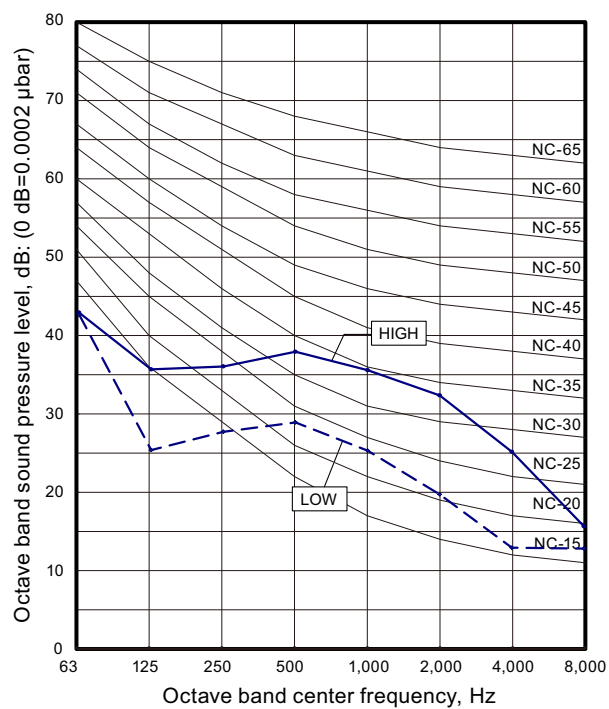


- **Model: ASUA14TLAV2**

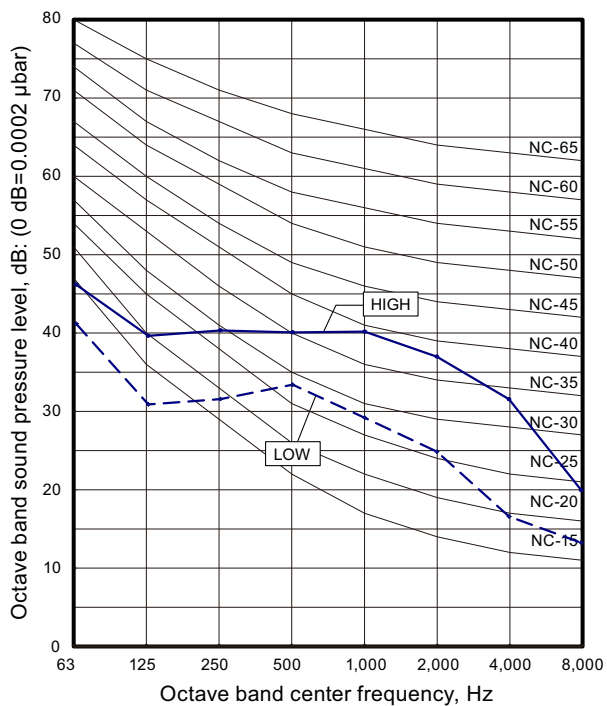


- **Models: ASUB18TLAV1 and ASUB18TLAV**

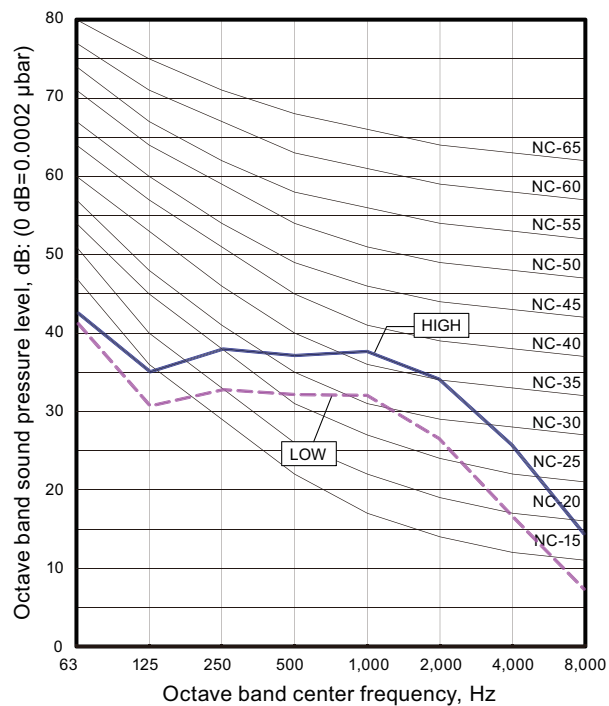


- **Models: ASUB24TLAV1 and ASUB24TLAV**

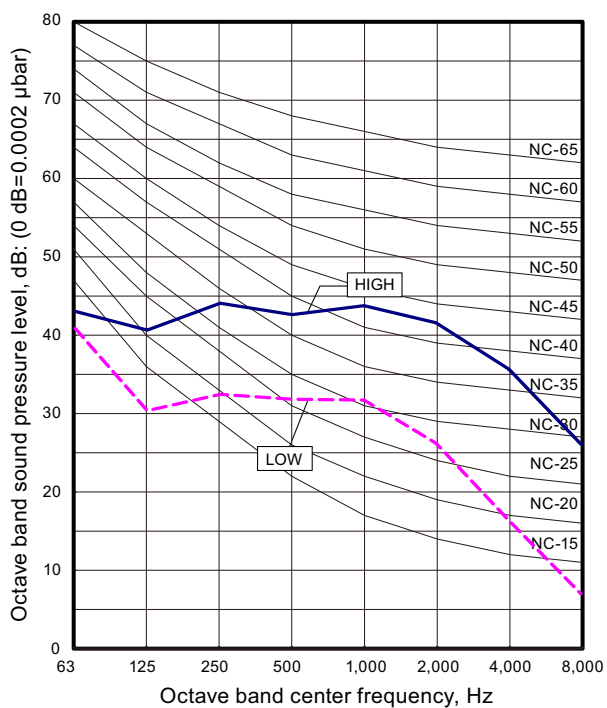


- **Model: ASUA30TLAV2**

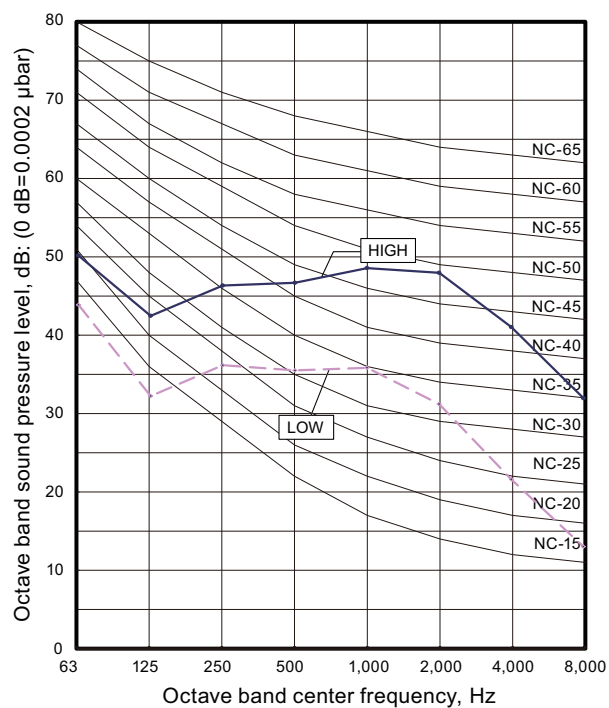


• **Model: ASUA36TLAV2**

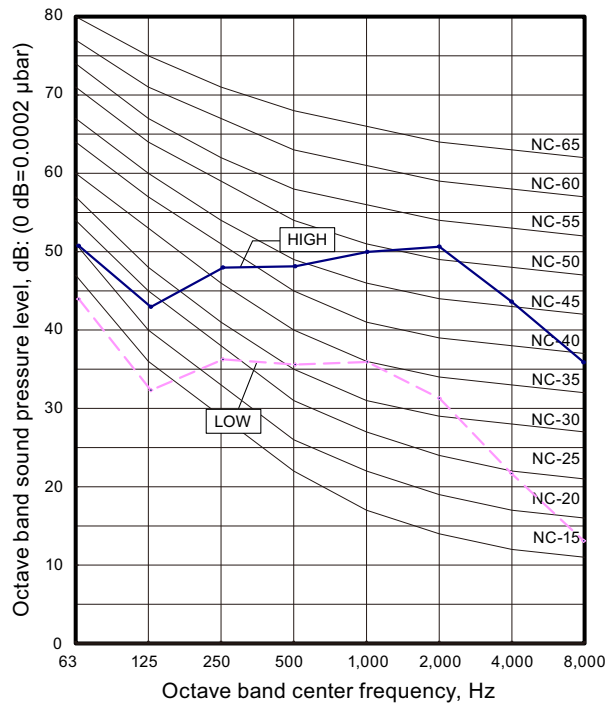


• **Model: ASUA7TLAV**

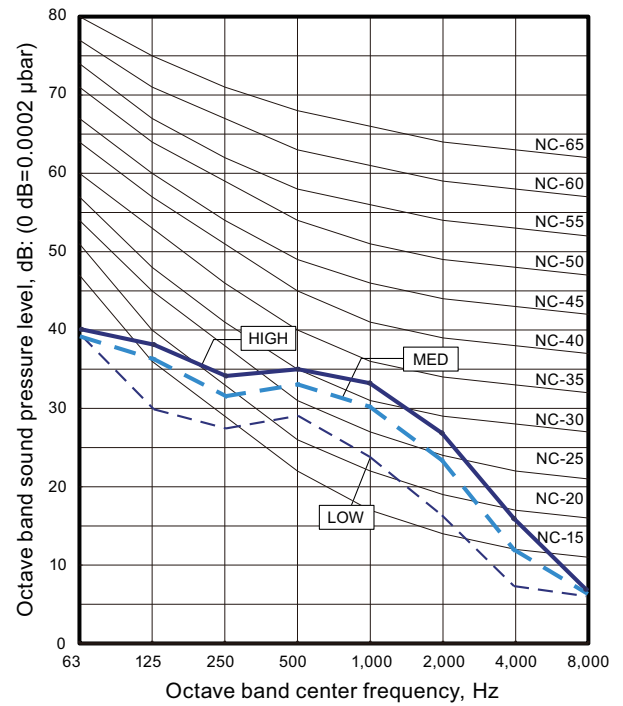


• **Model: ASUA9TLAV**

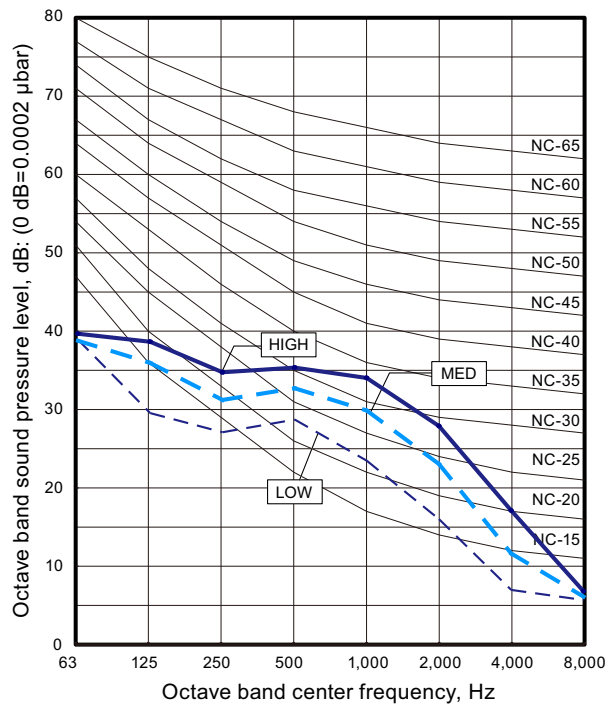

• **Model: ASUA12TLAV**

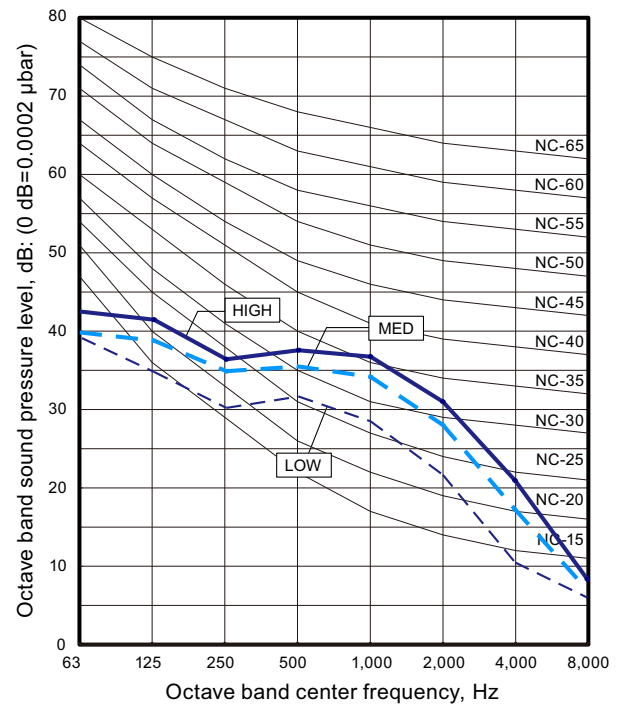


- **Model: ASUA14TLAV**

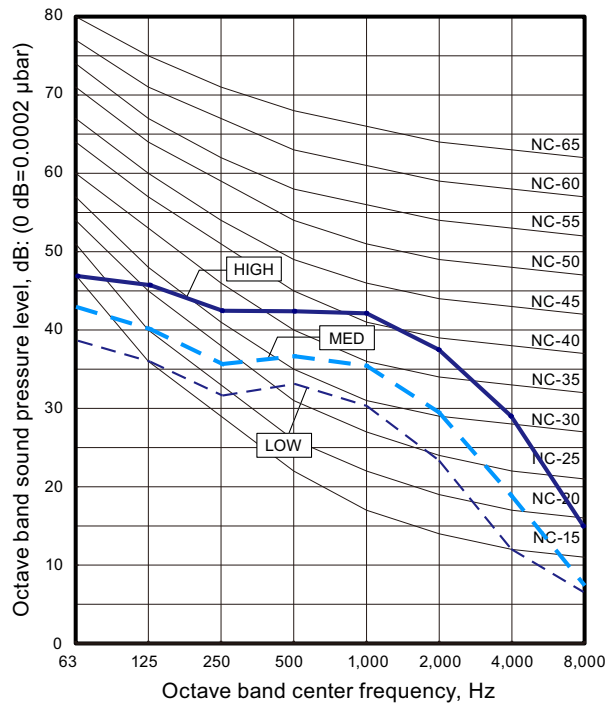
INDOOR  
UNITSINDOOR  
UNITS

## 9-12. Sound level check point


- Compact cassette type
- Circular flow cassette type
- 4-way flow cassette type

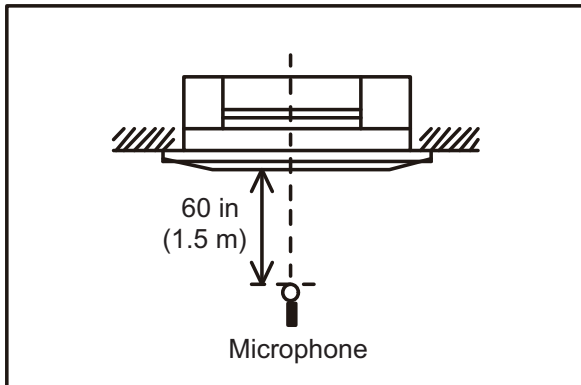


- Mini duct type
- Slim duct type
- Medium static pressure duct type
- High static pressure duct type

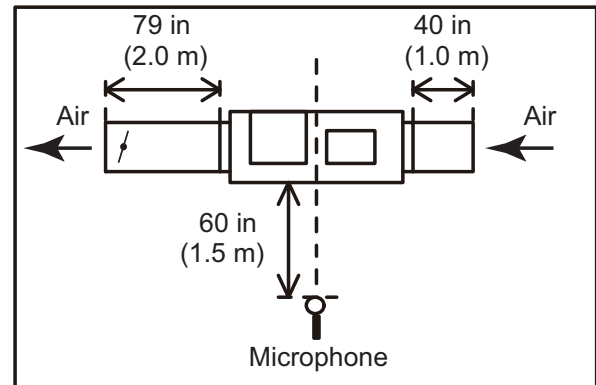


- Compact floor type

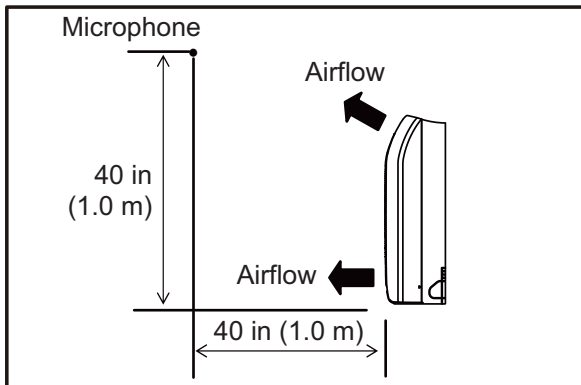

- Floor/Ceiling type
- Ceiling type

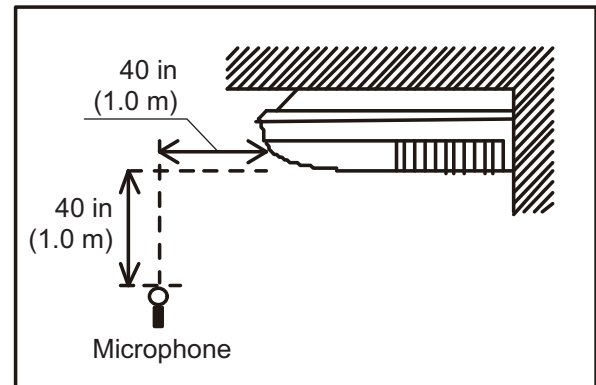

- Wall mounted type

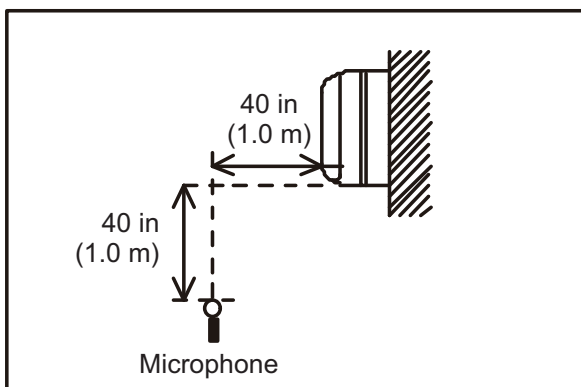



## 10. Safety devices

### 10-1. Compact cassette type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
AUUA4TLAV2	250 V 3.15 A	280.4±27 °F (138±15°C) Fan motor stop	221±36 °F (105±20°C) Fan motor restart	—	○
AUUA7TLAV2					
AUUA9TLAV2					
AUUA12TLAV2					
AUUA14TLAV2					
AUUA18TLAV2					
AUUA24TLAV2					

### 10-2. 4-way flow cassette type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
AUUB18TLAV	250 V 3.15 A	230 <sup>+27</sup> <sub>-18</sub> °F (110 <sup>+15</sup> <sub>-10</sub> °C) Fan motor stop	221 <sup>+27</sup> <sub>-18</sub> °F (105 <sup>+15</sup> <sub>-10</sub> °C) Fan motor Restart	—	○
AUUB24TLAV					
AUUB30TLAV					
AUUB36TLAV					

### 10-3. Circular flow cassette type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
AUUB18TLAV2	250 V 3.15 A	257±18 °F (125±10°C) Fan motor stop	248±18 °F (120±10°C) Fan motor restart	—	○
AUUB24TLAV2					
AUUB30TLAV2					
AUUB36TLAV2					
AUUB48TLAV2					

### 10-4. Mini duct type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ARUL4TLAV2	250 V 3.15 A	275±27°F (135±15°C) Fan motor stop	239±27°F (115±15°C) Fan motor Restart	—	○

## 10-5. Slim duct/Slim concealed floor type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ARUL7TLAV2	250 V 5 A	275±27°F (135±15°C) Fan motor stop	239±27°F (115±15°C) Fan motor Restart	—	○
ARUL9TLAV2					
ARUL12TLAV2					
ARUL14TLAV2					
ARUL18TLAV2					

## 10-6. Medium static pressure duct type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ARUM24TLAV2	250 V 5 A	275±27°F (135±15°C) Fan motor stop	239±27°F (115±15°C) Fan motor Restart	—	▲ *
ARUM30TLAV2		239±27°F (115±15°C) Fan motor stop	158°F (70°C) or less Fan motor Restart		
ARUM36TLAV2					

\*: Including in Drain pump unit (Optional parts)

## 10-7. High static pressure duct type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ARUH36TLAV	250 V, 3.15 A 250 V, 10 A*	293±9°F (145±5°C) Fan motor stop	—	—	—
ARUH48TLAV					
ARUH60TLAV					
ARUH72TLAV2	250 V, 3.15 A 250 V, 20 A*	212 <sup>+27</sup> <sub>-18</sub> °F (100 <sup>+15</sup> <sub>-10</sub> °C) Fan motor stop	203 <sup>+27</sup> <sub>-18</sub> °F (95 <sup>+15</sup> <sub>-10</sub> °C) Fan motor stop	—	—
ARUH96TLAV2					

\*: Fuse for fan motor

## 10-8. Compact floor type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
AGUA4TLAV2	250 V 3.15 A	302±27°F (150±15°C) Fan motor stop	248±27°F (120±15°C) Fan motor restart	—	○
AGUA7TLAV2					
AGUA9TLAV2					
AGUA12TLAV2					
AGUA14TLAV2					

## 10-9. Floor/Ceiling type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ABUA12TLAV2	250 V 3.15 A	275±27°F (135±15°C) Fan motor stop	239±27°F (115±15°C) Fan motor restart	—	—
ABUA14TLAV2					
ABUA18TLAV2					
ABUA24TLAV2					

## 10-10. Ceiling type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ABUA30TLAV2	250 V 5 A	275±27°F (135±15°C) Fan motor stop	239±27°F (115±15°C) Fan motor restart	—	▲ *
ABUA36TLAV2					

\*: Including in Drain pump unit (Optional parts)













## 10-11. Wall mounted type

Model	Fuse	Fan motor thermal protector		Terminal thermal fuse	Float switch
		Active	Reset		
ASUA4TLAV2	250 V 3.15 A	221±18°F (105±10°C) Fan motor stop	194±18°F (90±10°C) Fan motor restart	—	—
ASUA7TLAV2					
ASUA9TLAV2					
ASUA12TLAV2					
ASUA14TLAV2					
ASUB18TLAV1		302±27°F (150±15°C) Fan motor stop	248±27°F (120±15°C) Fan motor stop	Active at 215.6°F (102°C)	
ASUB24TLAV1		302±27°F (150±15°C) Fan motor stop	Less than 275°F (135°C) Fan motor restart	—	
ASUA30TLAV2					
ASUA36TLAV2		212±27°F (100±15°C) Fan motor stop	185±18°F (85±10°C) Fan motor stop	Active at 215.6°F (102°C)	
ASUA7TLAV					
ASUA9TLAV					
ASUA12TLAV					
ASUA14TLAV					
ASUB18TLAV					
ASUB24TLAV					













## 11. Accessories

The following installation parts are supplied. Use them as required. Do not discard any accessories until the installation work has been completed.













### 11-1. Compact cassette type

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 M10 nut A (with flange)	4	For installing indoor unit
 Installation manual	1		 M10 nut B (with spring lock washer)	4	For installing indoor unit
 Cable tie (Large)	4	For fixing the connection pipe (Large and small)	 Template (Carton top)	1	For cutting opening Also used as packing
 Cable tie (Medium)	2	For transmission cable and remote controller cable binding	 Drain hose	1	For connecting drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Hose band	1	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)	 Drain hose insulation	1	For installing drain hose

## 11-2. 4-way flow cassette type













Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Template (Carton top)	1	For installing indoor unit
 Installation manual	1		 Washer	8	For installing indoor unit
 Cable tie (Large)	4	For fixing the connection pipe (Large and small)	 Insulation	1	For installing drain pipe
 Cable tie (Medium)	2	For transmission cable and remote controller cable binding	 Drain hose	1	For installing drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Hose band	1	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)	 Drain pipe insulation	1	For installing drain pipe

## 11-3. Circular flow cassette type














Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Template (Carton top)	1	For installing indoor unit
 Installation manual	1		 Washer	8	For installing indoor unit
 Cable tie (Large)	4	For fixing the connection pipe (Large and small)	 Insulation	1	For installing drain pipe
 Push mount cable tie	1	For transmission cable and remote controller cable binding	 Drain hose	1	For installing drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Hose band	1	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)	 Drain pipe insulation	1	For installing drain pipe

INDOOR  
UNITSINDOOR  
UNITS

## 11-4. Mini duct type

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Cable tie (Large)	4	For fixing the coupler heat insulation
 Installation manual	1		 Cable tie (Medium)	2	For transmission cable and remote controller cable binding
 Template (Carton top)	1	For cutting ceiling opening Also used as packing	 Filter	2	
 Washer	8	For installing indoor unit	 Drain hose	1	For installing drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Hose band	1	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)	 Drain hose installation B	1	Insulates the drain hose













## 11-5. Slim duct/Slim concealed floor type

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Filter (Small)	2	For ARUL7TLAV2, ARUL9TLAV2, ARUL12TLAV2, and ARUL14TLAV2
 Installation manual	1		 Filter (Large)	2	For ARUL18TLAV2
 Washer	8	For installing indoor unit	 Drain hose	1	For installing drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Hose band	1	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)	 Drain hose installation B	1	Insulates the drain hose
 Cable tie (Large)	4	For fixing the coupler heat insulation	 Installation template	1	For positioning the indoor unit
 Cable tie (Medium)	2	For transmission cable and remote controller cable binding			

INDOOR  
UNITSINDOOR  
UNITS














## 11-6. Medium static pressure duct type








Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 M10 nut A (with flange)	4	For suspending the indoor unit from ceiling
 Installation manual	1		 M10 nut B (with spring lock washer)	4	For suspending the indoor unit from ceiling
 Cable tie (Large)	5	For fixing the connection pipe (large and small) and drain cap	 Hanger	4	For suspending the indoor unit from ceiling
 Cable tie (Medium)	3	For transmission cable and remote controller cable binding	 Drain hose	1	For installing drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Hose band	1	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)	 Drain hose insulation	2	Insulates drain hose and drain cap

## 11-7. High static pressure duct type





















### ■ Models: ARUH36TLAV, ARUH48TLAV, and ARUH60TLAV


Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 M10 nut A (with flange)	4	For suspending the indoor unit from ceiling
 Installation manual	1		 M10 nut B (with spring lock washer)	4	For suspending the indoor unit from ceiling
 Cable tie (Large)	4	For fixing the connection pipe (large and small)	 Drain hose	2	For installing drain hose
 Cable tie (Medium)	2	For transmission cable and remote controller cable binding	 Hose band	2	For installing drain hose
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Drain hose insulation	2	For installing drain hose
 Coupler heat insulation (Large)	1	For indoor side pipe joint (Gas pipe)			

## 11-8. Compact floor type

















Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Cloth tape	1	For indoor unit installation
 Installation manual	1		 Push mount cable tie	1	For transmission cable and remote controller cable binding
 Wall bracket	1	For indoor unit installation	 Air cleaning filter	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Tapping screw	8	For wall hook bracket installation			

## 11-9. Floor/Ceiling type

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Tapping screw	6	For fixing the wall bracket
 Installation manual	1		 Coupler heat insulation	2	For indoor side pipe joint
 Cover plate (Left)	1		 Cable tie (Large)	4	For fixing the coupler heat insulation
 Cover plate (Right)	1		 Cable tie (Medium)	2	For transmission cable and remote controller cable binding
 Tapping screw	2		 Drain hose	1	For installing drain hose
 Installation template	1	For positioning the indoor unit For under ceiling type	 Hose band	1	For installing drain hose
 Bracket (Left)	1	For suspending the indoor unit from ceiling	 Drain hose insulation	1	Adhesive type 3-15/16 × 8-11/16 in (100 × 220 mm)
 Bracket (Right)	1	For suspending the indoor unit from ceiling	 VT wire	1	For fixing the drain hose L = 11 in (280 mm)
 M10 nut A (with flange)	4	For suspending the indoor unit from ceiling	 Insulation (pipe)	1	Adhesive type 6-5/16 × 4-5/16 in (160 × 110 mm)
 Wall bracket	2	For suspending the indoor unit on the wall	 Silencer pipe	1	Connect the silencer pipe to the small (liquid) pipe

Optional parts		
Name and shape	Parts No.	Application
 Auxiliary pipe	9374714025	For indoor side pipe joint (For ABUA24TLAV2)









## 11-10. Ceiling type

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Cable tie (Extra large)	4	For fixing the coupler heat insulation
 Installation manual	1		 Cable tie (Large)	2	For fixing the coupler heat insulation
 Drain hose	1	For installing drain hose	 Cable tie (Medium)	2	For transmission cable and remote controller cable binding
 Hose band	1	For installing drain hose	 Push mount cable tie	4	For transmission cable and remote controller cable binding
 Drain hose insulation	1	Adhesive type 3-15/16 × 8-11/16 in (100 × 220 mm)	 M10 nut A (with flange)	4	For installing the indoor unit
 VT wire	1	For fixing the drain hose L = 11 in (280 mm)	 M10 nut B (with spring lock washer)	4	For installing the indoor unit
 Coupler heat insulation (Small)	1	For indoor side pipe joint (Liquid pipe)	 Installation template	1	For positioning the indoor unit
 Coupler heat insulation (Large)	2	For indoor side pipe joint (Gas pipe)	 Auxiliary pipe assembly	1	For connecting the piping











INDOOR  
UNITSINDOOR  
UNITS

## 11-11. Wall mounted type










### ■ Models: ASUA4TLAV2, ASUA7TLAV2, ASUA9TLAV2, ASUA12TLAV2, and ASUA14TLAV2

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Cloth tape	1	For indoor unit installation
 Installation manual	1		 Air cleaning filter	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Wall hook bracket	1	For indoor unit installation	 Air cleaning filter frame	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Tapping screw	5	For wall hook bracket installation	 Seal A	1	It is used when the diameter of gas pipe is $\varnothing 1/2$ in (12.70 mm) or more. It is necessary when using 014 model.

### ■ Models: ASUB18TLAV1 and ASUB24TLAV1











Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Tapping screw	8	For wall hook bracket installation
 Installation manual	1		 Air cleaning filter	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Wall hook bracket	1	For indoor unit installation	 Air cleaning filter frame	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Cable tie	1	For transmission and remote controller cable binding	 Drain hose insulation	1	For drain hose installation
 Cloth tape	1	For indoor unit installation	 Connecting cable	1	For wired remote controller installation

## ■ Models: ASUA30TLAV2 and ASUA36TLAV2

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Cloth tape	1	For indoor unit installation
 Installation manual	1		 Cable tie	2	For transmission and remote controller cable binding
 Wall hook bracket	1	For indoor unit installation	 Air cleaning filter	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Tapping screw	8	For wall hook bracket installation	 Air cleaning filter frame	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Drain hose insulation	1	For drain hose installation			

INDOOR  
UNITSINDOOR  
UNITS











## ■ Models: ASUA7TLAV, ASUA9TLAV, ASUA12TLAV, and ASUA14TLAV

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Tapping screw	8	For wall hook bracket installation
 Installation manual	1		 Connecting cable	1	For wired remote controller installation
 Wall hook bracket	1	For indoor unit installation	 Air cleaning filter	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Cable tie	1	For remote controller cable binding	 Air cleaning filter frame	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Cloth tape	1	For indoor unit installation	 Seal A	1	For indoor unit installation

INDOOR  
UNITSINDOOR  
UNITS



## ■ Models: ASUB18TLAV and ASUB24TLAV

Name and shape	Q'ty	Application	Name and shape	Q'ty	Application
 Operating manual	1		 Air cleaning filter	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Installation manual	1		 Air cleaning filter frame	2	For installation, refer to the "CLEANING AND CARE" in the operating manual
 Wall hook bracket	1	For indoor unit installation	 Drain hose insulation	1	For installing drain hose
 Cloth tape	1	For indoor unit installation	 Connecting cable	1	For wired remote controller installation
 Tapping screw	8	For wall hook bracket installation	 Cable tie	1	For transmission and remote controller cable binding

INDOOR  
UNITSINDOOR  
UNITS





## 5. CONTROL SYSTEM

# CONTENTS

## 5. CONTROL SYSTEM

<b>1. Control system .....</b>	<b>05-1</b>
1-1. Control system design example.....	05-1
1-2. System configuration examples.....	05-2
1-3. Features of control system .....	05-11
1-4. Wiring system.....	05-12
1-5. Control device design limitation .....	05-13
<b>2. Control units.....</b>	<b>05-15</b>
2-1. System controller (UTY-APGXZ1).....	05-15
2-2. System controller lite (UTY-ALGXZ1).....	05-19
2-3. Touch panel controller (UTY-DTGYZ1) .....	05-24
2-4. Central remote controller (UTY-DCGYZ*).....	05-37
2-5. Wired remote controller (Touch panel: UTY-RNRUZ*) .....	05-46
2-6. Wired remote controller (UTY-RNKU) .....	05-53
2-7. Simple remote controller (With operation mode: UTY-RSRY) .....	05-58
2-8. Simple remote controller (With operation mode: UTY-RSKU) .....	05-63
2-9. Simple remote controller (Without operation mode: UTY-RHRY) .....	05-68
2-10. Simple remote controller (Without operation mode: UTY-RHKU) .....	05-73
2-11. Wireless remote controller (UTY-LNHU).....	05-78
2-12. IR receiver unit (UTB-YWC) .....	05-82
2-13. IR receiver unit (UTY-TRHX).....	05-85
2-14. IR receiver unit (For cassette type: UTY-LRHBY1).....	05-88
2-15. IR receiver unit (For circular flow cassette type: UTY-LBHXD).....	05-90
2-16. Human sensor kit (For circular flow cassette type: UTY-SHZXC).....	05-92
2-17. Remote sensor unit (UTY-XSZX) .....	05-94
2-18. Pressure sensor kit (UTY-SPWX).....	05-96
2-19. Group control method .....	05-107
2-20. Comparison table of controllers .....	05-109
<b>3. Adaptor/Convertor units.....</b>	<b>05-111</b>
3-1. Network converter (UTY-VTGX).....	05-111
3-2. Network converter (UTY-VTGXV).....	05-117
3-3. Network converter (UTY-VGGXZ1) .....	05-123
3-4. Network converter for LonWorks (UTY-VLGX) .....	05-128
3-5. Modbus converter for VRF (UTY-VMGX) .....	05-137
3-6. Modbus converter for indoor unit (UTY-VMSX) .....	05-144
3-7. BACnet gateway (Hardware: UTY-VBGX).....	05-150
3-8. BACnet gateway (Software: UTY-ABGXZ1).....	05-158
3-9. Niagara driver for VRF .....	05-163
3-10. Signal amplifier (UTY-VSGXZ1) .....	05-166
3-11. External switch controller (UTY-TERX).....	05-171
3-12. External switch controller (UTY-TEKX).....	05-181
<b>4. Service and web monitoring tool.....</b>	<b>05-187</b>

## CONTENTS (continued)


4-1. Service tool (UTY-ASGXZ1) .....	05-187
4-2. Web monitoring tool (UTY-AMGXZ1) .....	05-191



# 1. Control system

## 1-1. Control system design example

### Advanced integrated control system example

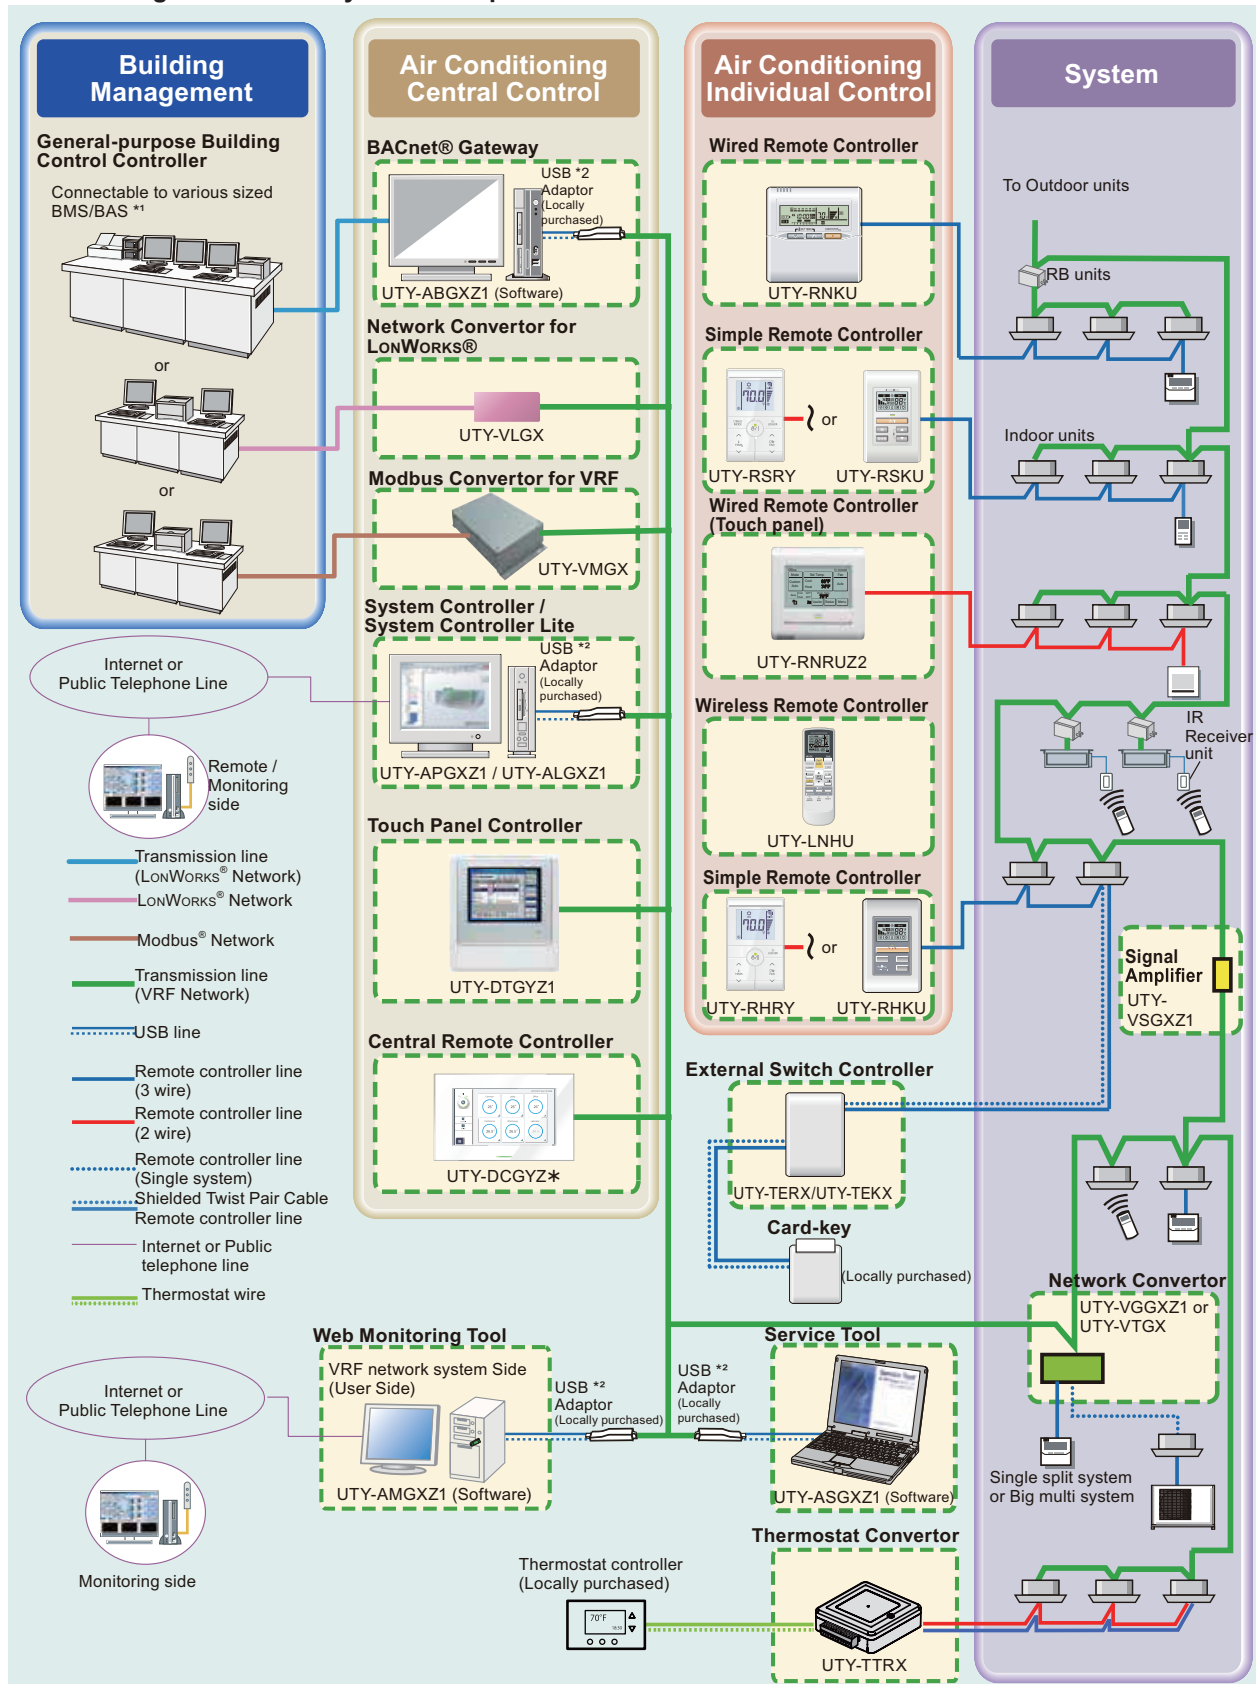

\*1: BMS/BAS: Building Management System / Building Automation System.


\*2: Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R)

## 1-2. System configuration examples

### ■ Individual control


#### Wired Remote Controller (2-wire)

- Up to 16 indoor units can be controlled with one wired remote controller.
- Wired (Touch panel) and wireless remote controllers can be used jointly.
- 4 remote controllers can be connected with single indoor unit.

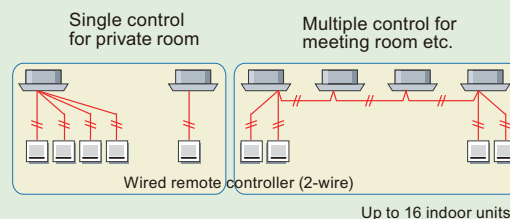


#### Wired Remote Controller (3-wire)

- Up to 16 indoor units can be controlled with one wired remote controller.
- Wired, simple, and wireless remote controllers can be used jointly.
- 2 remote controllers can be connected with single indoor unit.

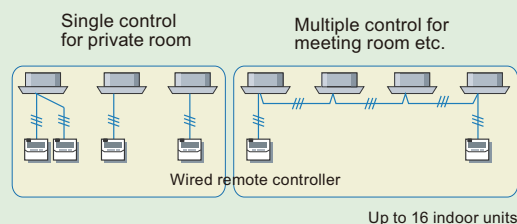


#### Simple Remote Controller (2-wire)

- Up to 16 indoor units can be controlled with one simple remote controller.
- Enables easy control of basic functions by the hotel or office guest.
- Wired, simple, and wireless remote controllers can be used jointly.
- 4 remote controllers can be connected with single indoor unit.

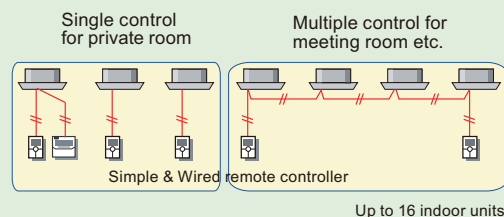


#### Simple Remote Controller (3-wire)

- Up to 16 indoor units can be controlled with one simple remote controller.
- Enables easy control of basic functions by the hotel or office guest.
- Wired, simple, and wireless remote controllers can be used jointly.
- 2 remote controllers can be connected with single indoor unit.

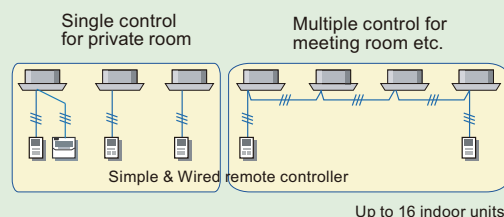

#### Wireless Remote Controller


- Up to 16 indoor units can be controlled with one wireless remote controller.
- Wired, simple, and wireless remote controllers can be used jointly.

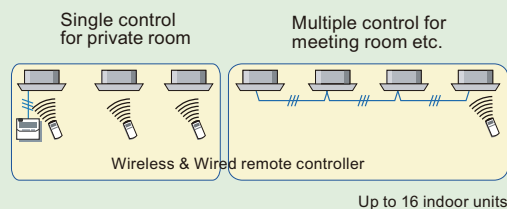




### External Switch Controller

- Up to 16 indoor units can be controlled with one external switch controller.
- In combination with a locally purchased card-key switch or other sensor, External switch controller allows control of basic functions by the hotel or office guest.

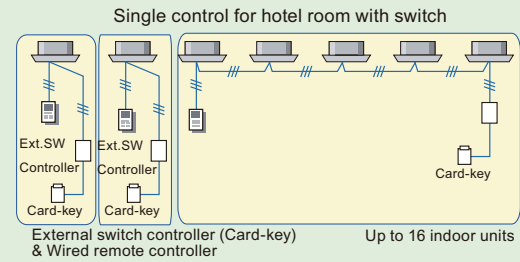


### Single Split or Big Multi System Connectivity

- Single split system or Big multi system can be connected to the VRF network system and can be controlled from Touch panel controller or System controller.

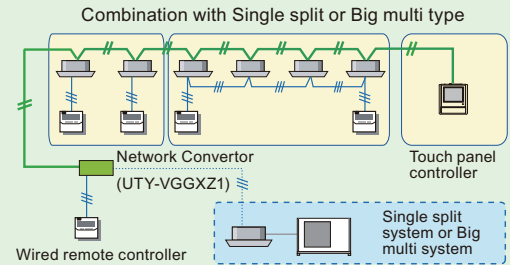


## Central control

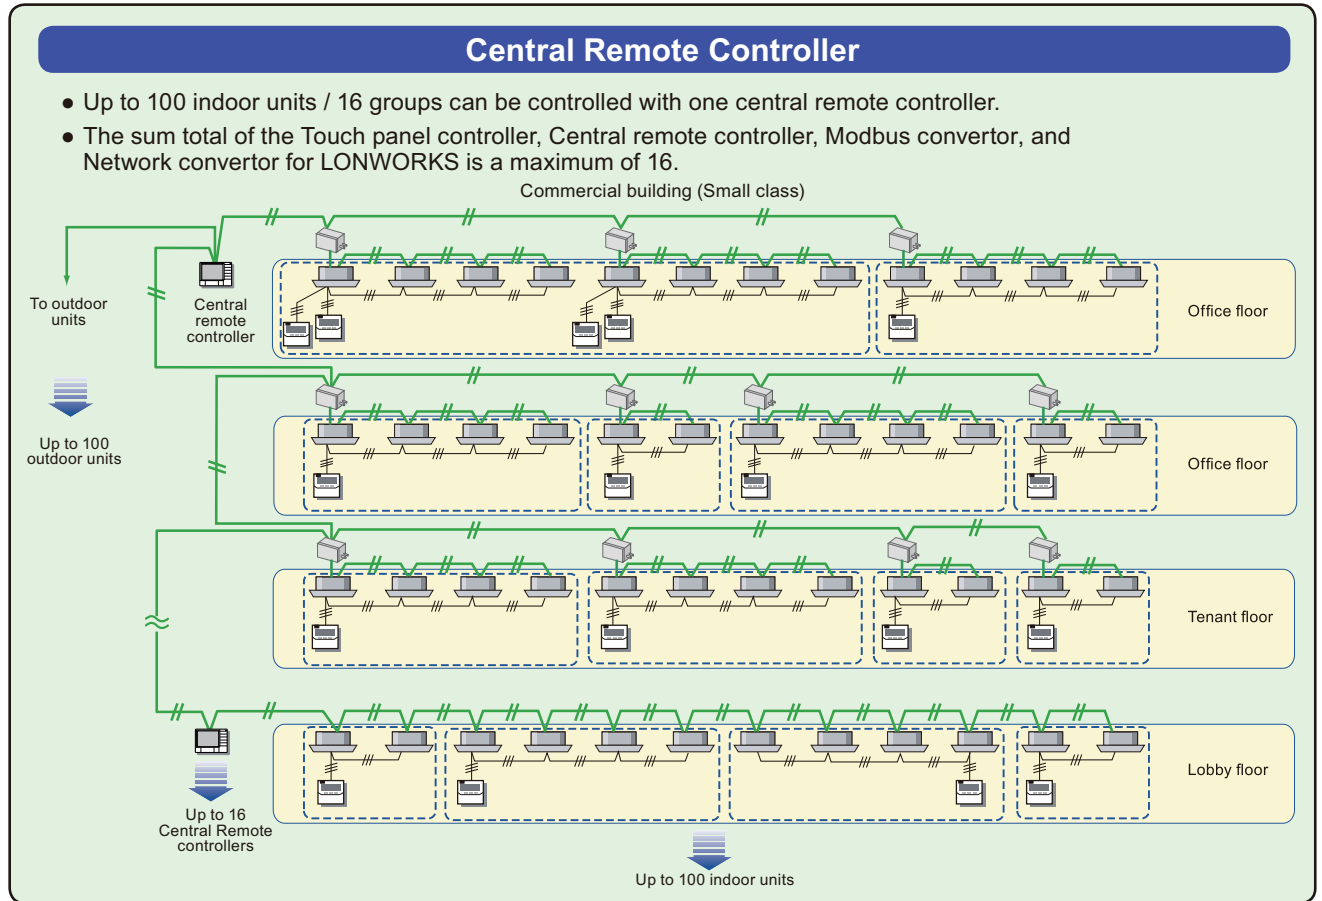


## Touch Panel Controller

- Up to 400 indoor units / 400 groups can be controlled with one touch panel controller.
- Up to a total of 16 network convertors, central remote controllers and touch panel controllers, and network convertor for LONWORKS can be connected to a single VRF network system.

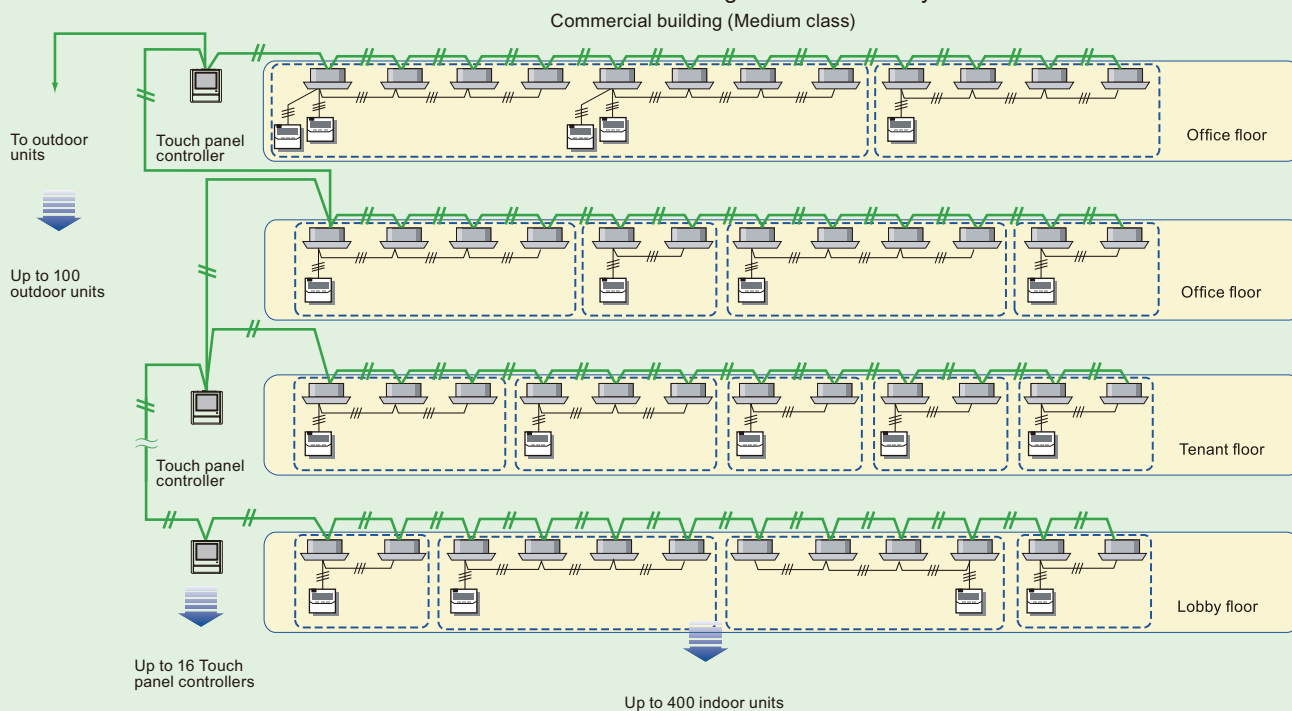


## System Controller Lite

- UP to 400 indoor units / 400 groups can be controlled with one System Controller Lite.



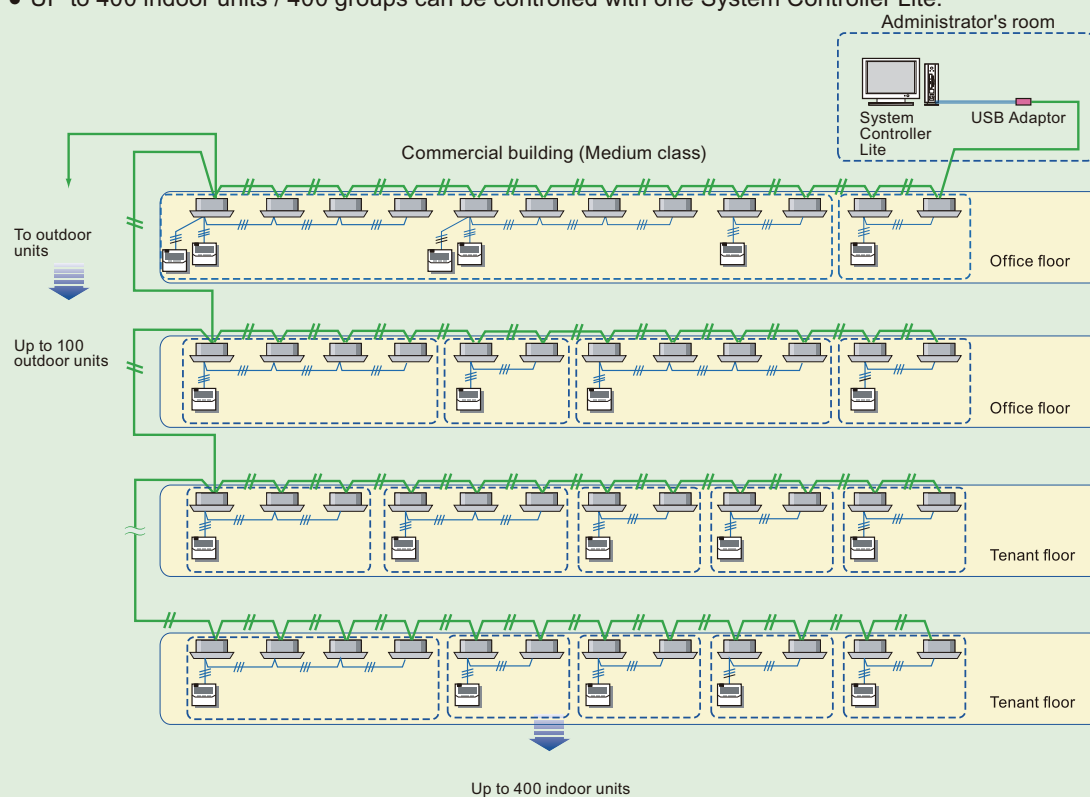


## System Controller


- UP to 1600 (400 x 4 VRF network system) indoor units / 1600 groups can be controlled with one System Controller.
- Incorporates a function that automatically calculates electrical charge.

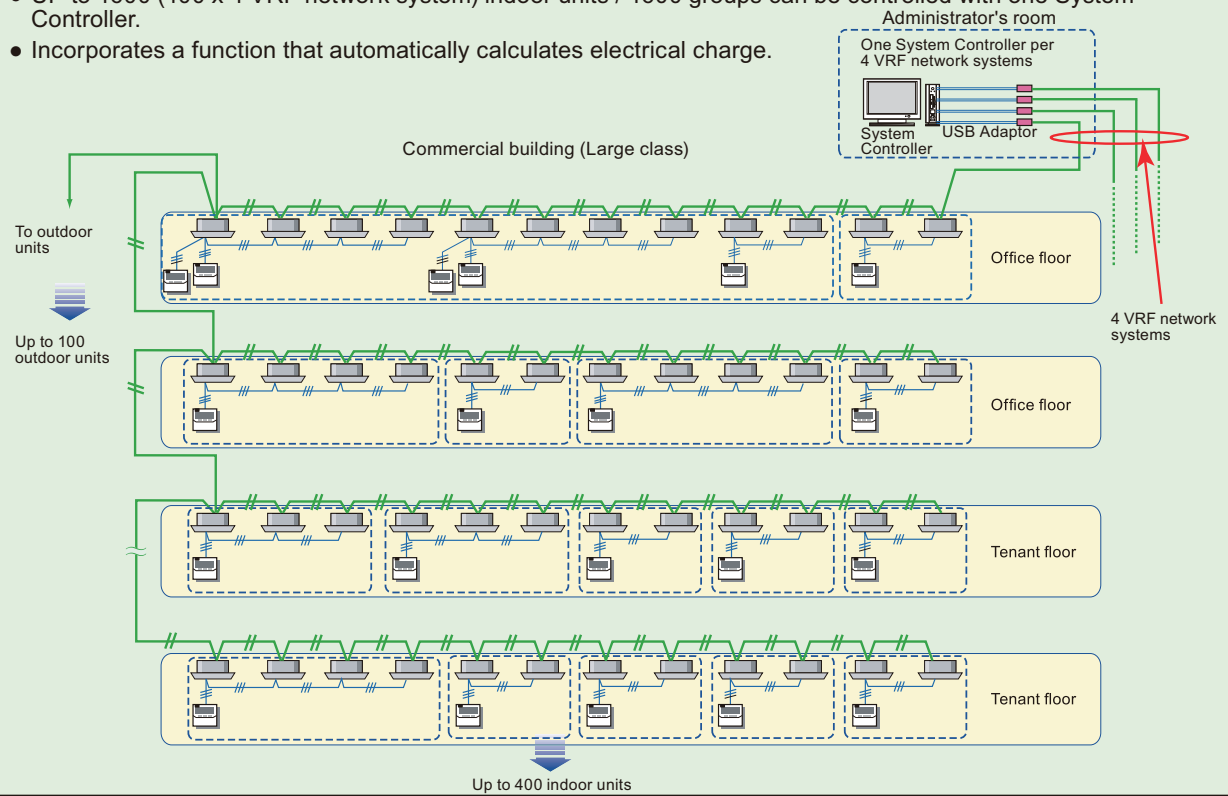

On-site central control and remote central control can be performed by system controller.

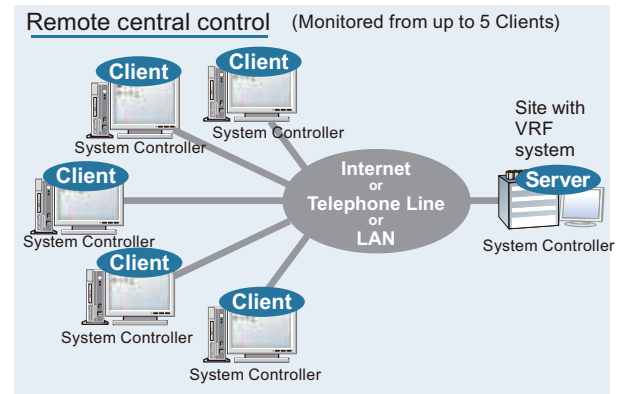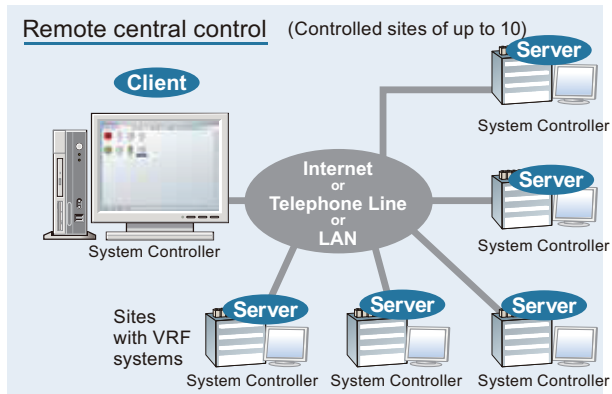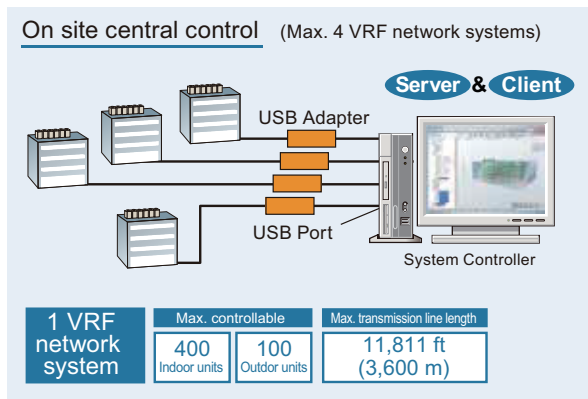

Remote central control can be performed by touch panel controller.

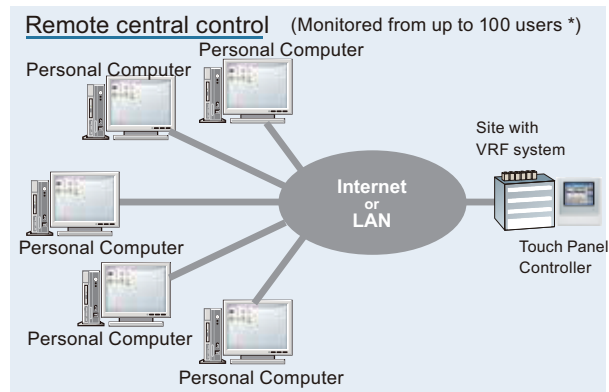

\*: Up to 4 administrators and 10 general users can log in simultaneously.

## ■ Indoor unit type and applicable control method

Indoor unit type	Wired remote controller (Touch panel)	Wired remote controller	Simple remote controller	
	UTY-RNRUZ*	UTY-RNKU	UTY-RSRY UTY-RHRY	UTY-RSKU UTY-RHKU
Compact cassette	○	—	○	—
4-way flow cassette	○	○	○	○
Circular flow cassette	○	—	○	—
Mini duct	○	○	○	○
Slim duct/Slim concealed floor	○	—	○	—
Medium static pressure duct	○	—	○	—
High static pressure duct	○	○*1	○	○*1
Compact floor	○	—	○	—
Floor/Ceiling	○	—	○	—
Ceiling	○	—	○	—
Wall mounted	○	○*2	○	○*2

- \*1: It is not connectable with ARUH72/96TLAV2 in high static pressure duct type.
- \*2: It is not connectable with ASUA4/7/9/12/14TLAV2 and ASUB30/36TLAV2 in wall mounted type.

Indoor unit type	Wireless remote controller	External switch controller		Wireless LAN adapter
	UTY-LNHU	UTY-TERX	UTY-TEKX	
Compact cassette	○	○	—	○
4-way flow cassette	○*2	○	○	—
Circular flow cassette	○*1	○	—	○
Mini duct	○*3	○	○	—
Slim duct/Slim concealed floor	○*4	○	—	○
Medium static pressure duct	○*4	○	—	○
High static pressure duct	○*5	○	○*6	○*7
Compact floor	○	○	—	○
Floor/Ceiling	○	○		○
Ceiling	○	○		○
Wall mounted	○	○	○*8	○*9

- \*1: IR receiver unit (optional part: UTY-LBHDX) is necessary.
- \*2: IR receiver unit (optional part: UTY-LRHYB1) is necessary.
- \*3: IR receiver unit (optional part: UTB-YWC) is necessary.
- \*4: IR receiver unit (optional part: UTY-TRHX) is necessary.
- \*5: Following IR receiver unit (optional part) is necessary.
  - For other than ARUH72/96TLAV2: UTB-YWC
  - For ARUH72/96TLAV2: UTY-TRHX
- \*6: It is not connectable with ARUH72/96TLAV2 in high static pressure duct type.
- \*7: ARUH72/96TLAV2 only.
- \*8: It is not connectable with ASUA4/7/9/12/14TLAV2 and ASUB30/36TLAV2 in wall mounted type.
- \*9: ASUA4/7/9/12/14TLAV2 and ASUB30/36TLAV2 only.

## RELATED LINKS

["Compatibility of VRF system"](#) in Chapter 9. NOTES on page 09-9

["Applicable parts"](#) in Chapter 10. OPTIONAL PARTS on page 10-24

## ■ Convertors (Adaptors) and related devices (system)

Convertor (Adaptor)		Within VRF network system			
		System controller	System controller lite	Touch panel controller	Central remote controller
		UTY-APGXZ1	UTY-ALGXZ1	UTY-DTGYZ1	UTY-DCGYZ*
Network converter	UTY-VTGX	—	—	—	—
	UTY-VTGXV	—	—	—	—
	UTY-VGGXZ1	—	—	—	—
USB adapter*	Locally purchased	○	○	—	—
Network converter for LonWorks	UTY-VLGX	—	—	—	—
BACnet gateway	UTY-VBGX UTY-ABGXZ1	—	—	—	—
Niagara driver for VRF	FUJ-VRF-8000	—	—	—	—
Modbus converter	UTY-VMGX UTY-VMSX	—	—	—	—

Convertor (Adaptor)		Within VRF network system		
		Web monitoring tool	Service tool	BACnet gateway
		UTY-AMGXZ1	UTY-ASGXZ1	UTY-ABGXZ1
Network converter	UTY-VTGX	—	—	—
	UTY-VTGXV	—	—	—
	UTY-VGGXZ1	—	—	—
USB adapter*	Locally purchased	○	○	○
Network converter for LonWorks	UTY-VLGX	—	—	—
BACnet gateway	UTY-VBGX UTY-ABGXZ1	—	—	—
Niagara driver for VRF	FUJ-VRF-8000	—	—	—
Modbus converter	UTY-VMGX UTY-VMSX	—	—	—

\*: Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R)

Convertor (Adaptor)		VRF network system ↔ Other system		Single split system ↔ Other system
		Single split system/ Multi system	BMS/BAS	
Network converter	UTY-VTGX	○	—	—
	UTY-VTGXV	○	—	—
	UTY-VGGXZ1	○	—	—
USB adapter*	Locally purchased	—	—	—
Network converter for LonWorks	UTY-VLGX	—	○	—
BACnet gateway	UTY-VBGX UTY-ABGXZ1	—	○	—
Niagara driver for VRF	FUJ-VRF-8000	—	○	—
Modbus converter	UTY-VMGX	—	○	—

\*: Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R)



## 1-3. Features of control system

### ■ Simple wiring system

- 1 transmission line can interlink all equipments regardless refrigerant circuit.
- Non polar 2-conductor transmission cable.
- Central control equipment can be connected anywhere on the transmission line, with no need to bring from the outdoor unit.
  - Making up the network system easily
  - Saving the total wiring length
  - Preventing incorrect connection
  - Saving installation time

### ■ Adaption to large scale buildings


- 1 single VRF network can control an entire building using:
  - Total transmission wiring length can be extended up to 11,811 ft (3,600 m) with signal amplifier unit.
  - Up to 400 indoor units per group
  - Up to 100 outdoor units per group
  - Touch panel controller can be used for primary central control.
  - Multiple touch panel controllers may be sued to provide convenient control for multiple convertor. (For details, refer to "[Network converter \(UTY-VTGX\)](#)" on page 05-111 and "[Network converter \(UTY-VTGXV\)](#)" on page 05-117.)
  - Can control Fujitsu mini-split and HFI models using a network convertor. (For details, refer to "[Network converter \(UTY-VTGX\)](#)" on page 05-111.)
- System controller allows to control up to 4 VRF network systems (max. 1,600 indoor units), suitable huge scale application.

### ■ Reliability and easy maintenance

- Stand-alone transmission network, allows each equipment to operate individually, thus failure of the units does not affect other indoor units operation.
- When a failure occurs, the error code is displayed on the individual controller and central controller excepting wireless remote controller.
- Also error histories can memorized by each individual controller and central controller excepting wireless remote controller.
- System controller and Web monitoring tool allow to monitor operation status in real time via Internet, and enable quick diagnoses.
- Maintenance works is improved efficiency, because Service tool can be connected to anywhere on the transmission line.

# 1-4. Wiring system

- Wiring configuration of the control system is made of power source wiring, transmission wiring, and remote controller wiring.
- Total wiring length (total length of transmission line) can be extended up to 11,811 ft (3,600 m) by using signal amplifier.

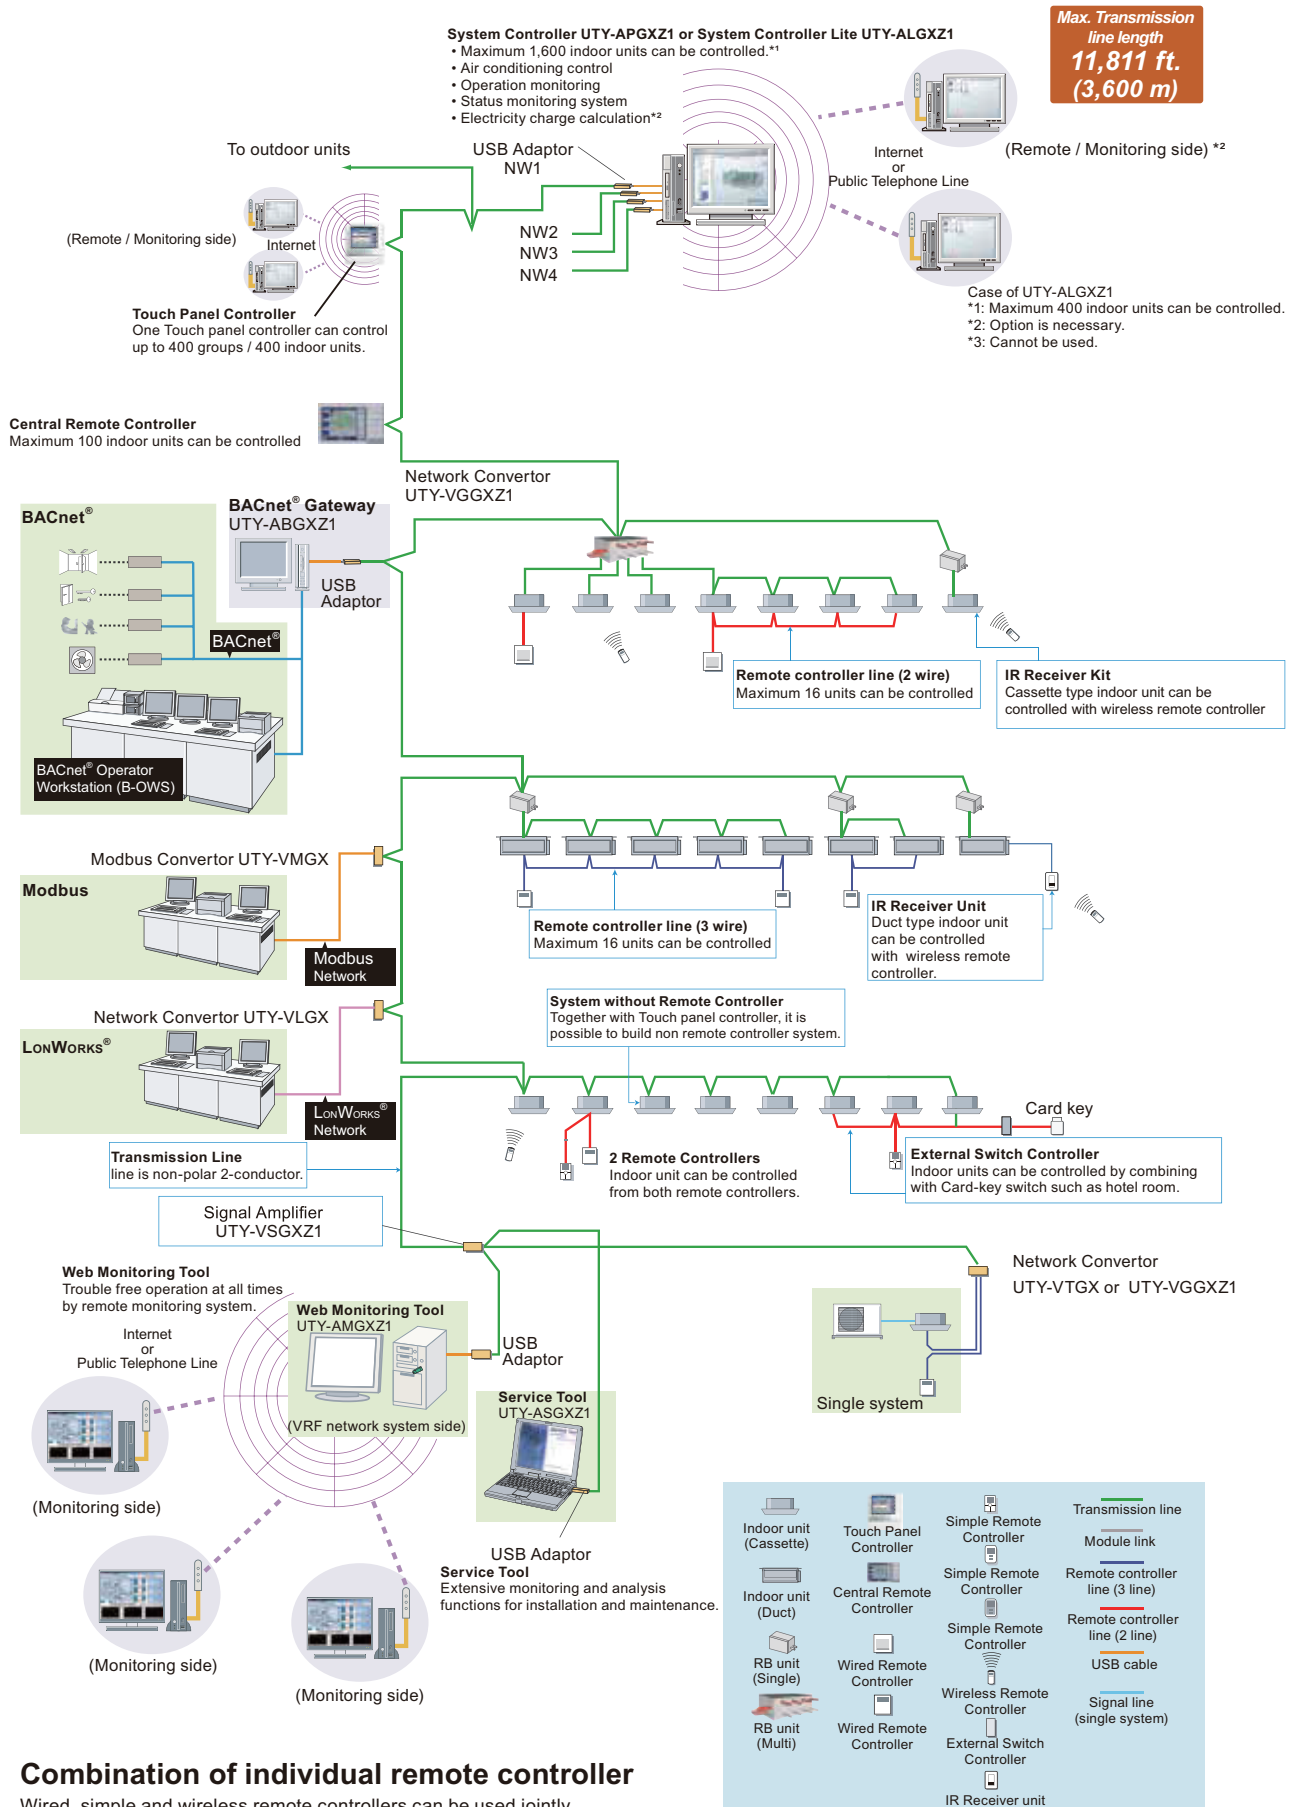

## 1-5. Control device design limitation

### ● Central control

Central controller		Necessary device	Maximum units number		
			Connectable units	Manageable indoor units	Connectable outdoor units
System controller	UTY-APGXZ1	USB adapter	1/system	1,600 (4 VRF networks)	400 (4 VRF networks)
System controller lite	UTY-ALGXZ1	USB adapter	1/system	400 (1 VRF networks)	100 (1 VRF networks)
Touch panel controller	UTY-DTGYZ1	—	16/system	400	100
Central remote controller	UTY-DCGYZ*	—		100	

Adaptor/Convertor		Necessary device	Maximum units number		
			Connectable units	Manageable indoor units	Connectable outdoor units
Network converter	UTY-VTGX UTY-VTGXV UTY-VGGXZ1	—	100/system	—	—
Network converter for LonWorks*1	UTY-VLGX	—	1/system	128*2	100
BACnet gateway	UTY-VBGX	—	4/system	128*2	100
	UTY-ABGXZ1	USB adapter	1/system	1,600 (4 VRF networks)	400 (4 VRF networks)
Niagara driver for VRF	FUJ-VRF-8000	—	4 JACE/system	250 indoor and outdoor units/ JACE	250 indoor and outdoor units/ JACE
Modbus converter	UTY-VMGX	—	9/system	128*2	100
Modbus converter	UTY-VMSX	—	—	1	—
Signal amplifier	UTY-VSGXZ1	—	40/system	—	—

- \*1: A maximum of 4 Network converters for LonWorks can be connected to 1 BMS.
- \*2: Maximum controllable indoor unit number per one convertor. (For proper configuration, refer to system diagram of each device.)

Service and Maintenance		Necessary device	Maximum units number		
			Connectable units	Manageable indoor units	Connectable outdoor units
Service tool	UTY-ASGXZ1	USB adapter	1/system	400	100
Web monitoring tool	UTY-AMGXZ1			1,600 (4 VRF networks)	400 (4 VRF networks)

## ● Individual control

Individual controller		Connectable units number	Remarks
Wireless remote controller	UTY-LNHU		
Wired remote controller (Touch panel)	UTY-RNRUZ*	4/Remote control group	2-wire type
Simple remote controller (With operation mode)	UTY-RSRY		
Simple remote controller (Without operation mode)	UTY-RHRY		
Wired remote controller	UTY-RNKU	2/Remote control group	3-wire type
Simple remote controller (With operation mode)	UTY-RSKU		
Simple remote controller (Without operation mode)	UTY-RHKU		

Adaptor/Convertor		Connectable units number	Remarks
External switch controller	UTY-TERX	2/Remote control group	2-wire or 3-wire type
	UTY-TEKX		3-wire type
IR receiver unit	UTB-YWC UTY-LRHBY1 UTY-TRHX UTY-LBHxD	1/Indoor unit	

## 2. Control units

### RELATED LINKS

"Controllers" in Chapter 1. GENERAL INFORMATION on page 01-8

### 2-1. System controller (UTY-APGXZ1)

This system realizes the advanced general monitoring & control of VRF system from small scale buildings to large scale buildings.




- Maximum of 4 network systems, 1,600 indoor units can be controlled.
- In addition to air conditioning precision control function, central remote control, electricity charge calculation, schedule management, and energy saving functions are strengthened and building manager and owner needs are met.
- Corresponds to 7 different languages. (English, Chinese, French, German, Spanish, Russian, and Polish)
- Connection between VRF network system to personal computer is possible via small U10 USB interface. However, both U10 USB interface and personal computer are locally purchased items.
- Extended feature\* supported by use of options.

#### NOTES:

- \*: Electricity charge apportionment using electricity meter, energy saving control. (without V and S series)
- Different VRF series may be connected for each of the 4 VRF networks supported by the product, but different series may not coexist within the same network. (VR-II, V-II, J-II, J-IIS, J-IIIL, J-IV, and J-IVS can exist together in same network. V and S can exist together in same network, too.)

### ■ Accessory


Name and shape	Q'ty	Application
 WHITE-USB-KEY (software protection key with software)	1	Software protection key to be connected to an USB port on the PC that System controller is installed. System controller runs only on a PC with this WHITE-USB-KEY. However, this WHITE-USB-KEY is not required for remote VRF Explorer software.

### ■ Available option


Option	Model name	Remark
Energy manager	UTY-PEGXZ1	Additional support for energy saving function and electricity charge apportionment using electricity meter.
Prepaid air conditioning	UTY-PPGXP2	Prepaid management of VRF air conditioner is performed and collection of charge for air conditioning is supported for building administrator.

## ■ System diagram

- System controller may be used on site or remotely over various networks for remote central control.
- System controller consists of VRF Controller software and VRF Explorer software, both software are working together.
- VRF Controller software runs in the background and communicate with VRF System.
- VRF Explorer software provides user interface and communicate with VRF Controller.
- VRF Controller and VRF Explorer software may run in a single PC or in different PCs separated by network.
- VRF Explorer software does not require WHITE-USB-KEY (Software protection key).

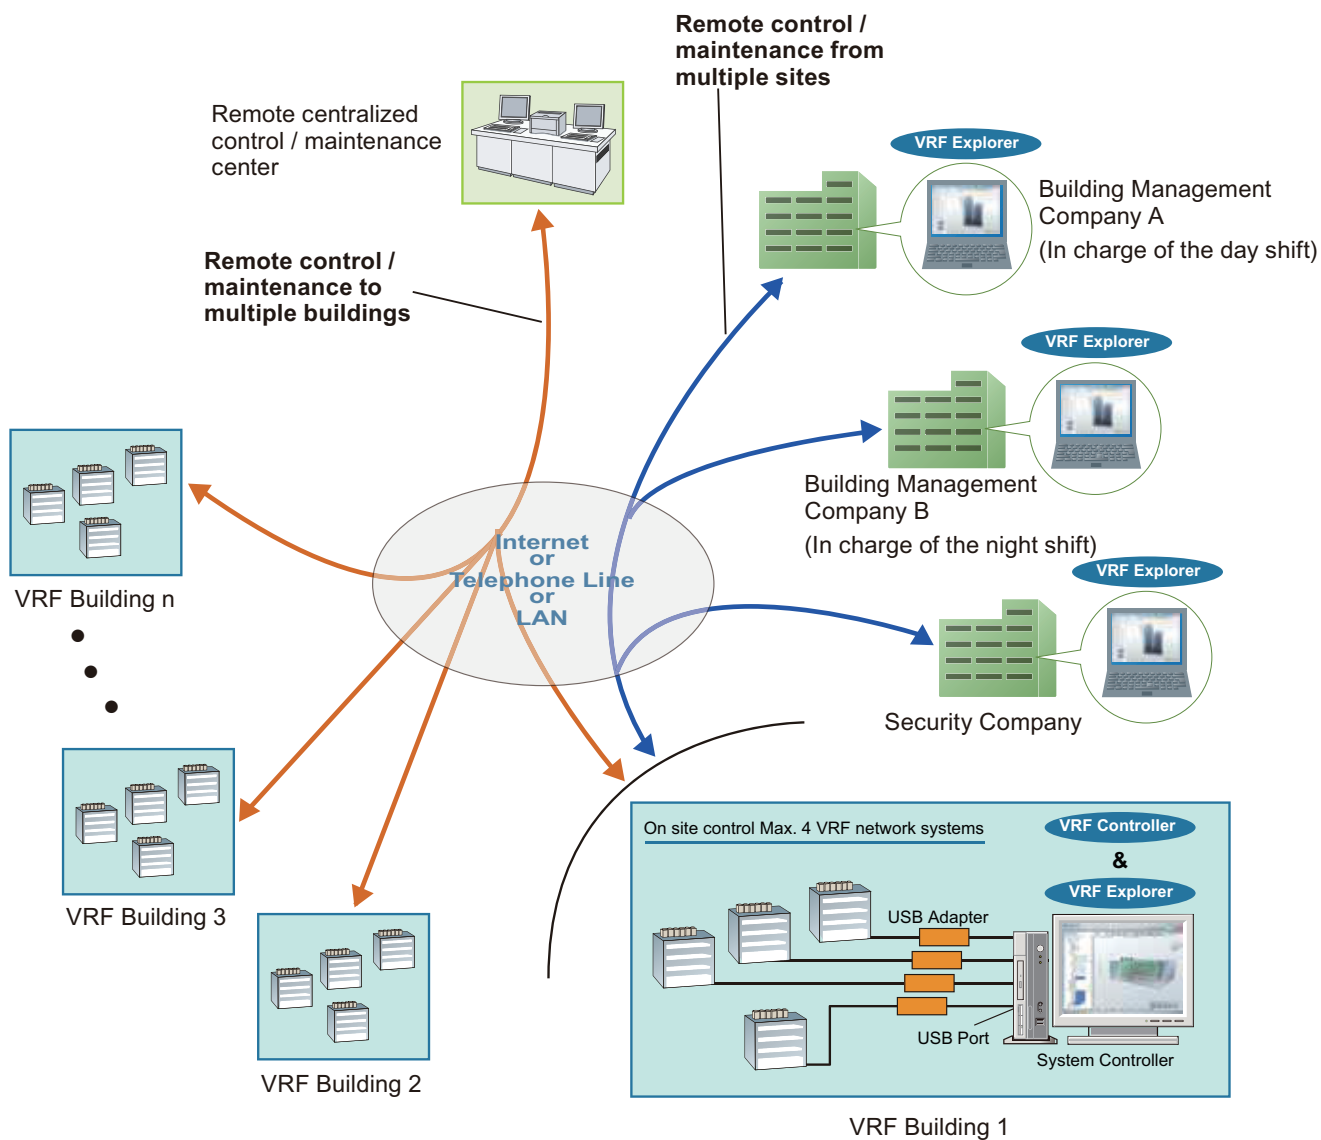

## ■ Software configuration

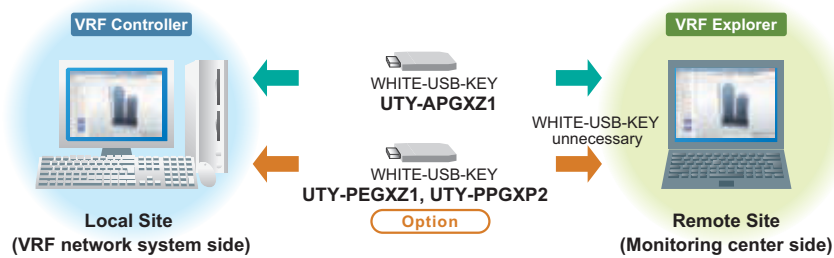

- **Any number can be installed in remote site personal computers.**
  - System controller (UTY-APGXZ1) can be installed in the local site PCs (VRF controller) connected to the VRF network system.
  - Multiple remote site PCs (VRF explorer) can be connected to VRF controller via Internet or LAN. Just this single product creates the control, management, and monitoring environment for the customer's properties including remote operation.

### NOTES:

- WHITE-USB-KEY is not required for PCs on the remote site.
- Some function, such as equipment registration and input/output are invalid on the remote site.
- **Optional software to strengthen the energy saving function**  
Installing the optional UTY-PEGXZ1 will strengthen the energy saving management function.

## ■ Other required devices (Locally purchased)

- Personal computer that satisfies the following system requirements

Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>• Microsoft Windows 7 Home Premium (32-bit or 64-bit) SP1</li> <li>• Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>• Microsoft Windows 8.1 (32-bit or 64-bit)</li> <li>• Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>• Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>• Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul> <p>Supported languages: English, Chinese, French, German, Russian, Spanish, and Polish</p>
CPU	Intel Core i3 2 GHz or higher
Memory	<ul style="list-style-type: none"> <li>• 2 GB or more (for Windows 7 [32-bit])</li> <li>• 4 GB or more (for Windows 7 [64-bit], Windows 8.1, and Windows 10)</li> </ul>
HDD	40 GB or more of free space
Display	1,024 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>• Ethernet port (for getting access to the Internet using LAN) or Modem (for getting access to the Internet using public telephone line)</li> <li>• USB ports (Maximum of 5 ports) (Required only for the server PC that works as VRF controller) <ul style="list-style-type: none"> <li>– Maximum of 1 USB ports are required for WHITE-USB-KEY connection</li> <li>– Maximum of 4 USB ports are required for Echelon U10 USB Network Interface</li> </ul> </li> </ul> <p><b>NOTE:</b> Maximum number of required USB ports depends on the applicable system configuration.</p>
Graphic accelerator	Microsoft DirectX 9.0c compatible
Software	Adobe Reader 9.0 or later

- Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R) (Required for each VRF network)

# ■ Specification summary

Type		Function	UTY-APGXZ1	UTY-PEGXZ1 (Option)	UTY-PPGXP2 (Option)	Remark
System specification		Max. system controller per VRF network	1	—	—	
		Max. VRF networks supported	4	—	—	Site with up to 4 VRF networks may ad- ministrated with 1 system controller.
		Max. indoor units/remote controller groups per VRF network	400	—	—	
		Max. indoor units/remote controller groups per system controller	1,600	—	—	4 VRF networks
Site supervision		Multiple site display	10	—	—	
		2D/3D graphical layout view	●	—	—	2D: Site, Floor 3D: Building Quick control from display available
		List display	●	—	—	Quick control from display available
		Tree display	●	—	—	Quick control from display available
Operation control	Individual	Start/Stop, Operation mode, Room tem- perature	●	—	—	
		Fan speed, Airflow direction	●	—	—	
		Economy mode	●	—	—	
		Antifreeze	●	—	—	
		Remote control prohibition setting	●	—	—	
		Temperature upper and lower limit setting	●	—	—	
		Filter sign reset	●	—	—	
		Human sensing	●	—	—	
		Schedule	Annual schedule	●	—	—
	Low noise mode weekly schedule		●	—	—	Outdoor unit control only
	Group management	Number of groups	1,600	—	—	
		Group in group	3 levels	—	—	Level 1—2—3
		Max. overlap definitions	1,600	—	—	1 unit may belong to up to 1,600 groups.
		Auto generation	●	—	—	By site, building and floor
	Others	Memory operation	●	—	—	Operation pattern memorized and reused.
Pattern operation		●	—	—	Reuse operation pattern once used.	
Operation status monitoring		Controlled status	●	—	—	See items controlled by operation.
		Special operation	●	—	—	Defrost, oil recovery
Room temperature		Room temperature	●	—	—	*
Error management		Error notification	●	—	—	
		Audible alarm	●	—	—	
		Error e-mail notification	●	—	—	
History management		Error history	1 year	—	—	
		Operation history and status history	1 year	—	—	
Energy saving management		Indoor unit rotation	—	●	—	
		Outdoor unit capacity save	—	●	—	
		Peak cut control	—	1 month	—	
		Power consumption monitor	—	●	—	
		Electricity meters supported	—	200	—	Outdoor unit required per connection.
		Power consumption information	—	3 years	—	
Electricity charge apportionment		Apportionment charge calculation	●	—	—	
		Apportionment charge bill creation	●	—	—	
		Tenant (block) setting	1,600	—	—	
		Common facilities apportionment setting	●	—	—	
		Rated power consumption allotment set- ting	●	—	—	
		Electricity meters supported	—	200	—	Same meters used for energy saving.
		Electricity charge apportionment period	2 years	—	—	
		Prepaid air conditioning	—	—	●	
		Cooling and heating information	●	—	—	
Remote control		Internet, telephone line support	●	—	—	
		Max. client connection per server	5	—	—	
		Max. host connection from client	10	—	—	
		Data encryption	●	—	—	SSL used.
Others		External device control function	●	—	—	
		Web operation	●	—	—	
		User control	●	—	—	Authorization level setting
		Database import/export (manual)	●	—	—	
		Periodical backup	●	—	—	
		The refrigerant systems of non-operation status function	●	—	—	
		Auto start setting	●	—	—	
		Multiple language display	●	●	—	English, Chinese, French, German, Span- ish, Russian, Polish
		Floor layout editor	●	—	—	
		Floor layout import/export	●	—	—	
		Online software update	●	—	—	
NOTES: • *: To display room temperature on monitor, connect wired remote controller to indoor unit and perform function setting for detecting temperature using mounted sensor. • In S and V series, there are some unusable functions, such as energy saving function and electricity meter use. • The electricity charge apportionment function of VRF system can only be performed from one equipment simultaneously.						



## 2-2. System controller lite (UTY-ALGXZ1)


System controller lite is advanced software of central controller for small and medium buildings. It can be supported by additional options such as electricity charge apportionment, remote monitoring, and energy saving in order to meet your demands.



- Supports 1 VRF network system and maximum of 400 controllable indoor units.
- Various high level functions from individual control to annual schedule management, operation history, and error history management.
- Corresponds to 7 different languages. (English, Chinese, French, German, Spanish, Russian, and Polish)
- Connection between VRF network system to personal computer is possible via small U10 USB interface. However, both U10 USB interface and personal computer are locally purchased items.
- Units status can be monitored and operated for each site, group, or unit.\*

\*: 2D floor layout/3D building display are not available. If you need these functions, use System controller.

### ■ Accessory


Name and shape	Q'ty	Application
 WHITE-USB-KEY (software protection key with software)	1	Software protection key to be connected to an USB port on the PC that System controller is installed. System controller runs only on a PC with this WHITE-USB-KEY. However, this WHITE-USB-KEY is not required for remote VRF Explorer software.

### ■ Available option

Option	Model name	Remark
Electricity charge apportionment option	UTY-PLGXA2	Apportions the power used by indoor and outdoor units, and automatically calculation the electricity charge such as for hotels or multi-tenant buildings. Computation linked with an electric meter is also possible.
Remote access option	UTY-PLGXR2	VRF system can be monitored remotely from multiple PCs. Multiple VRF systems can be controlled or monitored from 1 PC.
Energy saving option	UTY-PLGXE2	A variety of energy saving operations can be set and managed depending on the season, weather, and time period.
Prepaid air conditioning	UTY-PLGXP2	Prepaid management of VRF air conditioner is performed and collection of charge for air conditioning is supported for building administrator.
External device control	UTY-PLGXX2	By enabling central control by third-party external device, burden on maintenance and administration of the devices by the building administrator is reduced.

## ■ System diagram

- System controller lite may be used on site or remotely over various networks for remote central control.\*
  - System controller lite consists of VRF Controller software and VRF Explorer software, both software are working together.
  - VRF Controller software runs in the background and communicate with VRF System.
  - VRF Explorer software provides user interface and communicate with VRF Controller.
  - VRF Controller and VRF Explorer software may run in a single PC or in different PCs separated by network.\*
  - VRF Explorer software does not require WHITE-USB-KEY (Software protection key).
- \*: Remote access option (UTY-PLGXR2) is necessary.

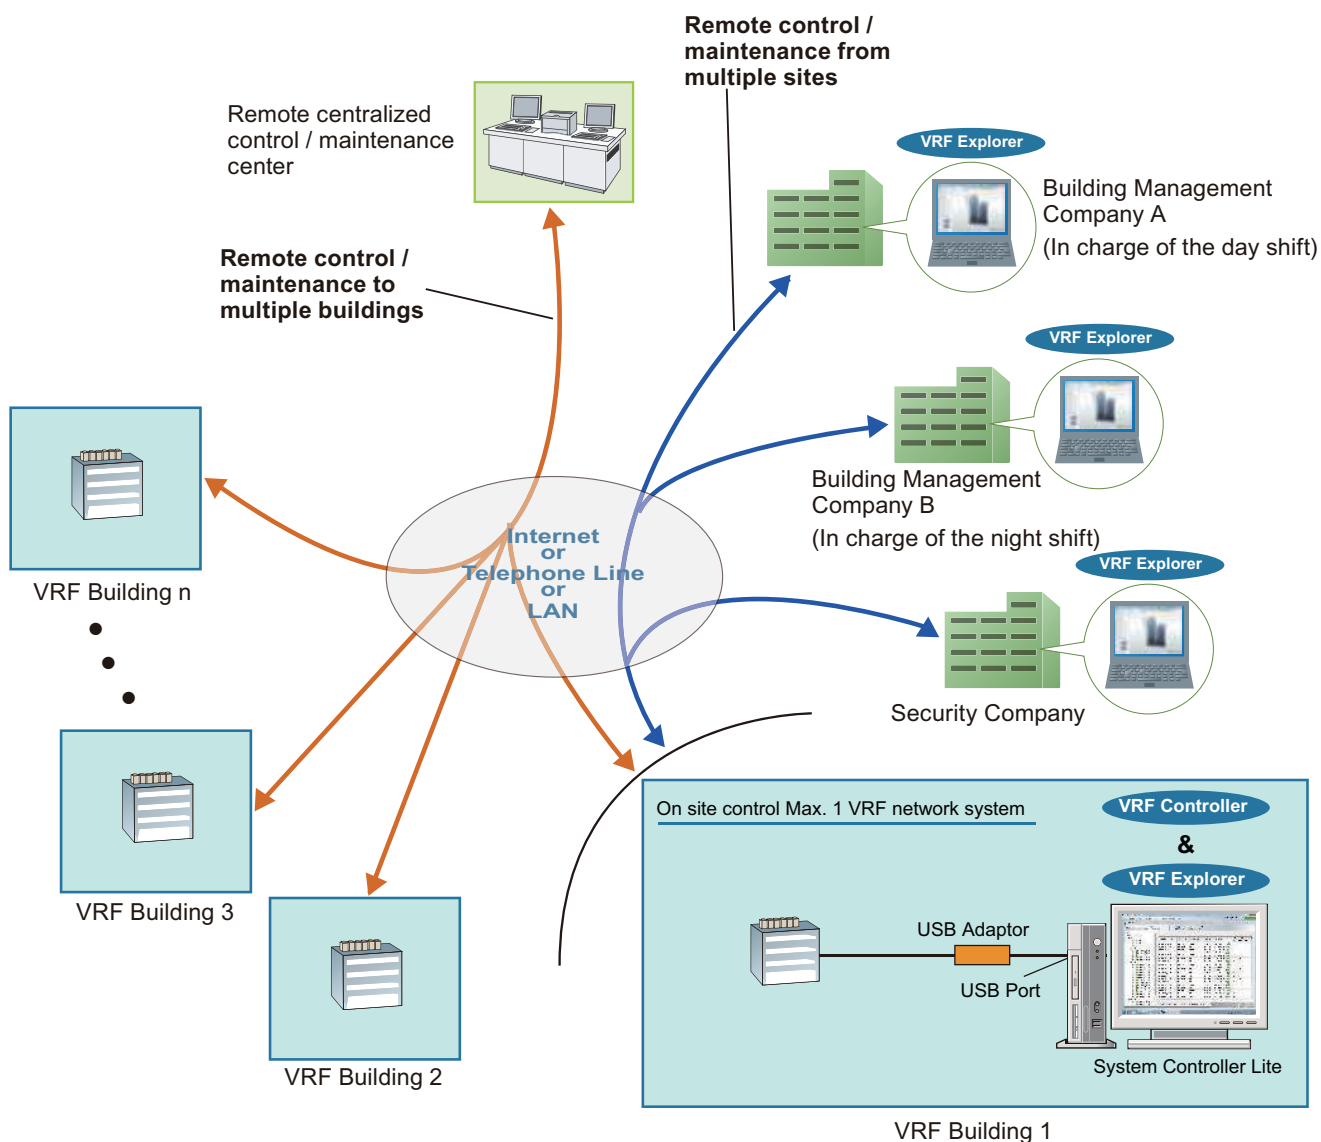

## ■ Software configuration



- **Any number can be installed in remote site personal computers.**
  - System controller lite (UTY-ALGXZ1) can be installed in the local site PCs (VRF controller) connected to the VRF network system.
  - Multiple remote site PCs (VRF explorer) can be connected to VRF controller via Internet or LAN. Just this single product creates the control, management, and monitoring environment for the customer's properties including remote operation.

### NOTES:

- WHITE-USB-KEY is not required for PCs on the remote site.
- Some function, such as equipment registration and input/output are invalid on the remote site.
- **Optional software to strengthen various function**
  - Electricity charge apportionment function can be added by installing optional UTY-PLGXA2.
  - Remote centralized control function can be added by installing optional UTY-PLGXR2.
  - Energy saving management function can be added by installing optional UTY-PLGXE2.
  - Prepaid management function can be added by installing optional UTY-PLGXP2.
  - External device control function can be added by installing optional UTY-PLGXX2.

## ■ Other required devices (Locally purchased)

- Personal computer that satisfies the following system requirements

Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>Microsoft Windows 7 Home Premium (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 8.1 (32-bit or 64-bit)</li> <li>Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul> <p>Supported languages: English, Chinese, French, German, Russian, Spanish, and Polish</p>
CPU	Intel Core i3 2 GHz or higher
Memory	<ul style="list-style-type: none"> <li>2 GB or more (for Windows 7 [32-bit])</li> <li>4 GB or more (for Windows 7 [64-bit], Windows 8.1, and Windows 10)</li> </ul>
HDD	40 GB or more of free space
Display	1,024 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>Ethernet port (for getting access to the Internet using LAN) or Modem (for getting access to the Internet using public telephone line)</li> <li>USB ports (Maximum of 2 ports) (Required only for the server PC that works as VRF controller)               <ul style="list-style-type: none"> <li>1 USB port is required for WHITE-USB-KEY connection</li> <li>1 USB port is required for Echelon U10 USB Network Interface</li> </ul> </li> </ul> <p><b>NOTE:</b> Maximum number of required USB ports depends on the applicable system configuration.</p>
Graphic accelerator	Microsoft DirectX 9.0c compatible
Software	Adobe Reader 9.0 or later

- Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R) (Required for each VRF network)

# ■ Specification summary

Type		Function	UTY-AL- GXZ1	UTY- PLGXA2 (Option)	UTY- PLGXR2 (Option)	UTY- PLGXE2 (Option)	UTY- PLGXP2 (Option)	UTY- PLGXX2 (Option)	Remark
System specification		Max. system controller per VRF network	1	—	—	—	—	—	
		Max. VRF networks supported	1	—	—	—	—	—	
		Max. indoor units/remote controller groups per VRF network	400	—	—	—	—	—	
		Max. indoor units/remote controller groups per system controller	400	—	—	—	—	—	4 VRF networks
Site supervision		Multiple site display	10	—	—	—	—	—	
		2D/3D graphical layout view	—	—	—	—	—	—	
		List display	●	—	—	—	—	—	Quick control from display available
		Tree display	●	—	—	—	—	—	Quick control from display available
Operation control	Individual	Start/Stop, Operation mode, Room temperature	●	—	—	—	—	—	
		Fan speed, Airflow direction	●	—	—	—	—	—	
		Economy mode	●	—	—	—	—	—	
		Antifreeze	●	—	—	—	—	—	
		Remote control prohibition setting	●	—	—	—	—	—	
		Temperature upper and lower limit setting	●	—	—	—	—	—	
		Filter sign reset	●	—	—	—	—	—	
		Human sensing	●	—	—	—	—	—	
	Schedule	Annual schedule	●	—	—	—	—	—	Week of year, day of month, day of week setting Holiday special day settings
		Low noise mode weekly schedule	●	—	—	—	—	—	Outdoor unit control only
	Group management	Number of groups	400	—	—	—	—	—	
		Group in group	3 levels	—	—	—	—	—	Level 1—2—3
		Max. overlap definitions	400	—	—	—	—	—	1 unit may belong to up to 400 groups.
	Others	Auto generation	●	—	—	—	—	—	By site, building and floor
		Memory operation	●	—	—	—	—	—	Operation pattern memorized and reused.
		Pattern operation	●	—	—	—	—	—	Reuse operation pattern once used.
	Operation status monitoring		Controlled status	●	—	—	—	—	See items controlled by operation.
		Special operation	●	—	—	—	—	Defrost, oil recovery	
Room temperature		Room temperature	●	—	—	—	—	—	*
Error management		Error notification	●	—	—	—	—	—	
		Audible alarm	●	—	—	—	—	—	
		Error e-mail notification	●	—	—	—	—	—	
History management		Error history	1 year	—	—	—	1 year	—	
		Operation history and status history	1 year	—	—	—	—	—	
Energy saving management		Indoor unit rotation	—	—	—	●	—	—	
		Outdoor unit capacity save	—	—	—	●	—	—	
		Peak cut control	—	—	—	1 month	—	—	
		Power consumption monitor	—	—	—	●	—	—	
		Electricity meters supported	—	—	—	200	—	—	Outdoor unit required per connection.
		Power consumption information	—	—	—	3 years	—	—	
Electricity charge apportionment		Apportionment charge calculation	—	●	—	—	—	—	
		Apportionment charge bill creation	—	●	—	—	—	—	
		Tenant (block) setting	—	1,600	—	—	—	—	
		Common facilities apportionment setting	—	●	—	—	—	—	
		Rated power consumption allotment setting	—	●	—	—	—	—	
		Electricity meters supported	—	200	—	—	—	—	Same meters used for energy saving.
		Electricity charge apportionment period	—	2 years	—	—	—	—	
		Prepaid air conditioning	—	—	—	—	●	—	
		Cooling and heating information	—	●	—	—	—	—	
Remote control		Internet, telephone line support	—	—	●	—	—	—	
		Max. client connection per server	—	—	5	—	—	—	
		Max. host connection from client	—	—	10	—	—	—	
		Data encryption	—	—	●	—	—	—	SSL used.
Others		External device control function	—	—	—	—	—	●	
		Web operation	●	—	—	—	—	—	
		User control	●	—	—	—	—	—	Authorization level setting
		Database import/export (manual)	●	—	—	—	—	—	
		Periodical backup	●	—	—	—	—	—	
		The refrigerant systems of non-operation status function	●	—	—	—	—	—	
		Auto start setting	●	—	—	—	—	—	
		Multiple language display	●	●	●	●	—	—	English, Chinese, French, German, Spanish, Russian, Polish
		Floor layout editor	●	—	—	—	—	—	
Floor layout import/export	●	—	—	—	—	—			
Online software update	●	—	—	—	—	—			

## NOTES:









- \*: To display room temperature on monitor, connect wired remote controller to indoor unit and perform function setting for detecting temperature using mounted sensor.
- In S and V series, there are some unusable functions, such as energy saving function and electricity meter use.
- The electricity charge apportionment function of VRF system can only be performed from one equipment simultaneously.

## 2-3. Touch panel controller (UTY-DTGYZ1)



- Large-sized 7.5 inch TFT color
- LCD easy finger touch operation
- Stylish shape and design to suit all application
- No additional component is required for installation.
- Up to 400 indoor units can be controlled.
- Selectable 2 display types (icon/list) in monitoring mode
- Corresponds to 7 different languages. (English, Chinese, French, German, Spanish, Russian, and Polish)

### ■ Accessory

Name and shape	Q'ty	Application
 Installation plate	1	For Touch panel controller installation (It is attached to the back of the Touch panel controller)
 Screw	8	Screw for Touch panel controller installation
 Washer	8	Washer for Touch panel controller installation
 Touch pen	1	Pen for Touch panel controller installation
 Cable tie	4	For prevention dropping off of the cable
 CD-ROM	1	Includes the operating manual and file making sheet of this controller
 Installation manual	1	
 Operation manual	1	

## ■ Available option

Option	Model name	Remark
Electricity charge apportionment option	UTY-PTGXA	Apportions the power used by indoor and outdoor units, and automatically calculation the electricity charge such as for hotels or multi-tenant buildings. Computation linked with an electric meter is also possible.

- Specifications

Number of sites	Max. 20
Number of contracts	Max. 400 (per site)
Number of blocks	Max. 1,600 (per site)
Data storage period	Max. 2 year

- Personal computer system requirements (for electricity charge apportionment tool)


Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>Microsoft Windows 7 Home Premium (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 8.1 (32-bit or 64-bit)</li> <li>Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul> <p>Supported languages: English, Chinese, French, German, Russian, Spanish, and Polish</p>
CPU	Intel Core i3 2 GHz or higher
Memory	<ul style="list-style-type: none"> <li>2 GB or more (for Windows 7 [32-bit])</li> <li>4 GB or more (for Windows 7 [64-bit], Windows 8.1, and Windows 10)</li> </ul>
HDD	40 GB or more of free space
Display	1,024 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>USB port</li> <li>Ethernet port (to communicate with TPC via LAN)</li> </ul>
Software	Adobe Reader 9.0 or later
Optical drive	DVD-ROM drive

## ■ Functions

	Item	Main unit	PC/Tablet	Description
Installation	Indoor unit registration	●	—	Indoor unit registration. Max. 400 units. (Set data can be written to and read from USB flash drive)
	Function settings	●	—	Temperature set point limitation, external input, central operation on/off setting
Monitor	Display switching	●	●	Icon display, List display
	Display units	●	●	All, Group, Individual (remote control group)
	Monitor contents (icon display)	●	●	Group name, operation, operation mode, set temperature, time, errors, timer setting, filter sign
	Monitor contents (list display)	●	●	Group name, operation, operation mode, set temperature, airflow, air direction, special operation, anti-freeze, time, errors, timer setting, filter sign, room temp., human sensor, set temp. range
	Error list	●	●	Group name, remote control group name, address, error code
	Special state	●	●	Display during special operation
Control	Control units	●	●	All, Group, Individual (remote control group)
	Control contents	●	●	Operation, operation mode, set temperature, airflow, RC prohibition, filter sign reset
	Detailed control contents	●	●	Air direction, energy saving, anti-freeze, test run
	Individual setting reset of airflow direction	—	●	Sets the position of indoor unit's airflow direction louver individually.
	Human sensor	—	●	Sets the human sensor on the indoor unit.
	Setting temperature limitation of room	●	●	Adjusts the upper and lower limits of temperature for the indoor unit.
Setting	Language setting*	●	●	Design considering multi-language correspondence
	Date and time	●	●	Time display switching, year/month/day display switching, system clock setting, summer time, Internet time adjustment setting
	Time zone	●	●	Set the time zone of the area where this unit is used.
	Panel cleaning and correction	●	—	Select display area for panel cleaning. User can select black screen on display.
	Group	●	●	Stages: Max. 3 stages settable up to 400 groups. (Set data can be written to and read from USB flash drive.)
	Back ground light and beep sound	●	—	Backlighting off time and brightness setting, beep sound operation setting
	Password	●	—	Management level: 3 kinds
	Schedule timer	●	●	Max. 30 items settable
	Temperature range	●	—	Celsius/Fahrenheit switching, cooling, heating, and AUTO each settable
	Network	●	●	Function of Email notification for malfunction, or electricity charge apportionment option is used via LAN
	Low noise operation	●	●	"Low noise operation" is set to all outdoor units registered by this controller.
	Electricity charge apportionment (Option)	●	●	Start/stop of ECA, importing/exporting of ECA setting, and exporting ECA data.
	Remote language additional registration	—	●	Additional language can be integrated on remote device by creating language database. Additional language is displayed on only the remote device and touch panel controller cannot be added other language.
	Auto OFF timer	—	●	Function to stop the operation automatically when a preset time lapses after turning on the operation
	Set temperature auto return	—	●	Function to restore the temperature to the original set temperature when a preset time lapses after changing the set temperature.
	Display item setting	—	●	Sets the items to be displayed on the monitor.
	Failure notification Email	—	●	Failure notification Email: Sends a notification Email to the preset Email address in the event of failure.
	Remote connection setting	—	●	Create Users: Max. 15 users, type, permissions, unit setting, automatic logout time
Maintenance	Error history	●	●	Recording of max. 10 errors for each touch panel controller and each indoor and outdoor unit
	Status history	●	●	Recording of max. 100 operations for each indoor unit Writable to USB flash drive
	Operation history	●	●	Recording of max. 10,000 operations Writable to USB flash drive
	TPC information	●	●	Version history, TPC MAC address, software version, Writing the TPC information
Others	External input/output	●	—	Input: Batch operation/stop, emergency stop, electricity meter Output: Operation monitoring, error
<b>NOTES:</b> <ul style="list-style-type: none"> <li>*: Product specifications are subject to change without notice.</li> <li>When Start/Stop, operation mode setting, room temp. setting, fan speed setting, air flow direction setting, swing setting, economy mode, and anti freeze setting are changed frequently by using the central controller such as System controller, Touch panel controller, etc. or from Building Management System (BMS) via BACnet gateway or via Network converter, the number of operations for each indoor unit must not exceed 7,500 times/year. If the number of setting change exceeds the above specified number, the rewriting count limit of the non-volatile memory (built into the air conditioner and used for recording settings) will be exceeded, and may cause breakdown.</li> </ul>				



## ■ State transition diagram

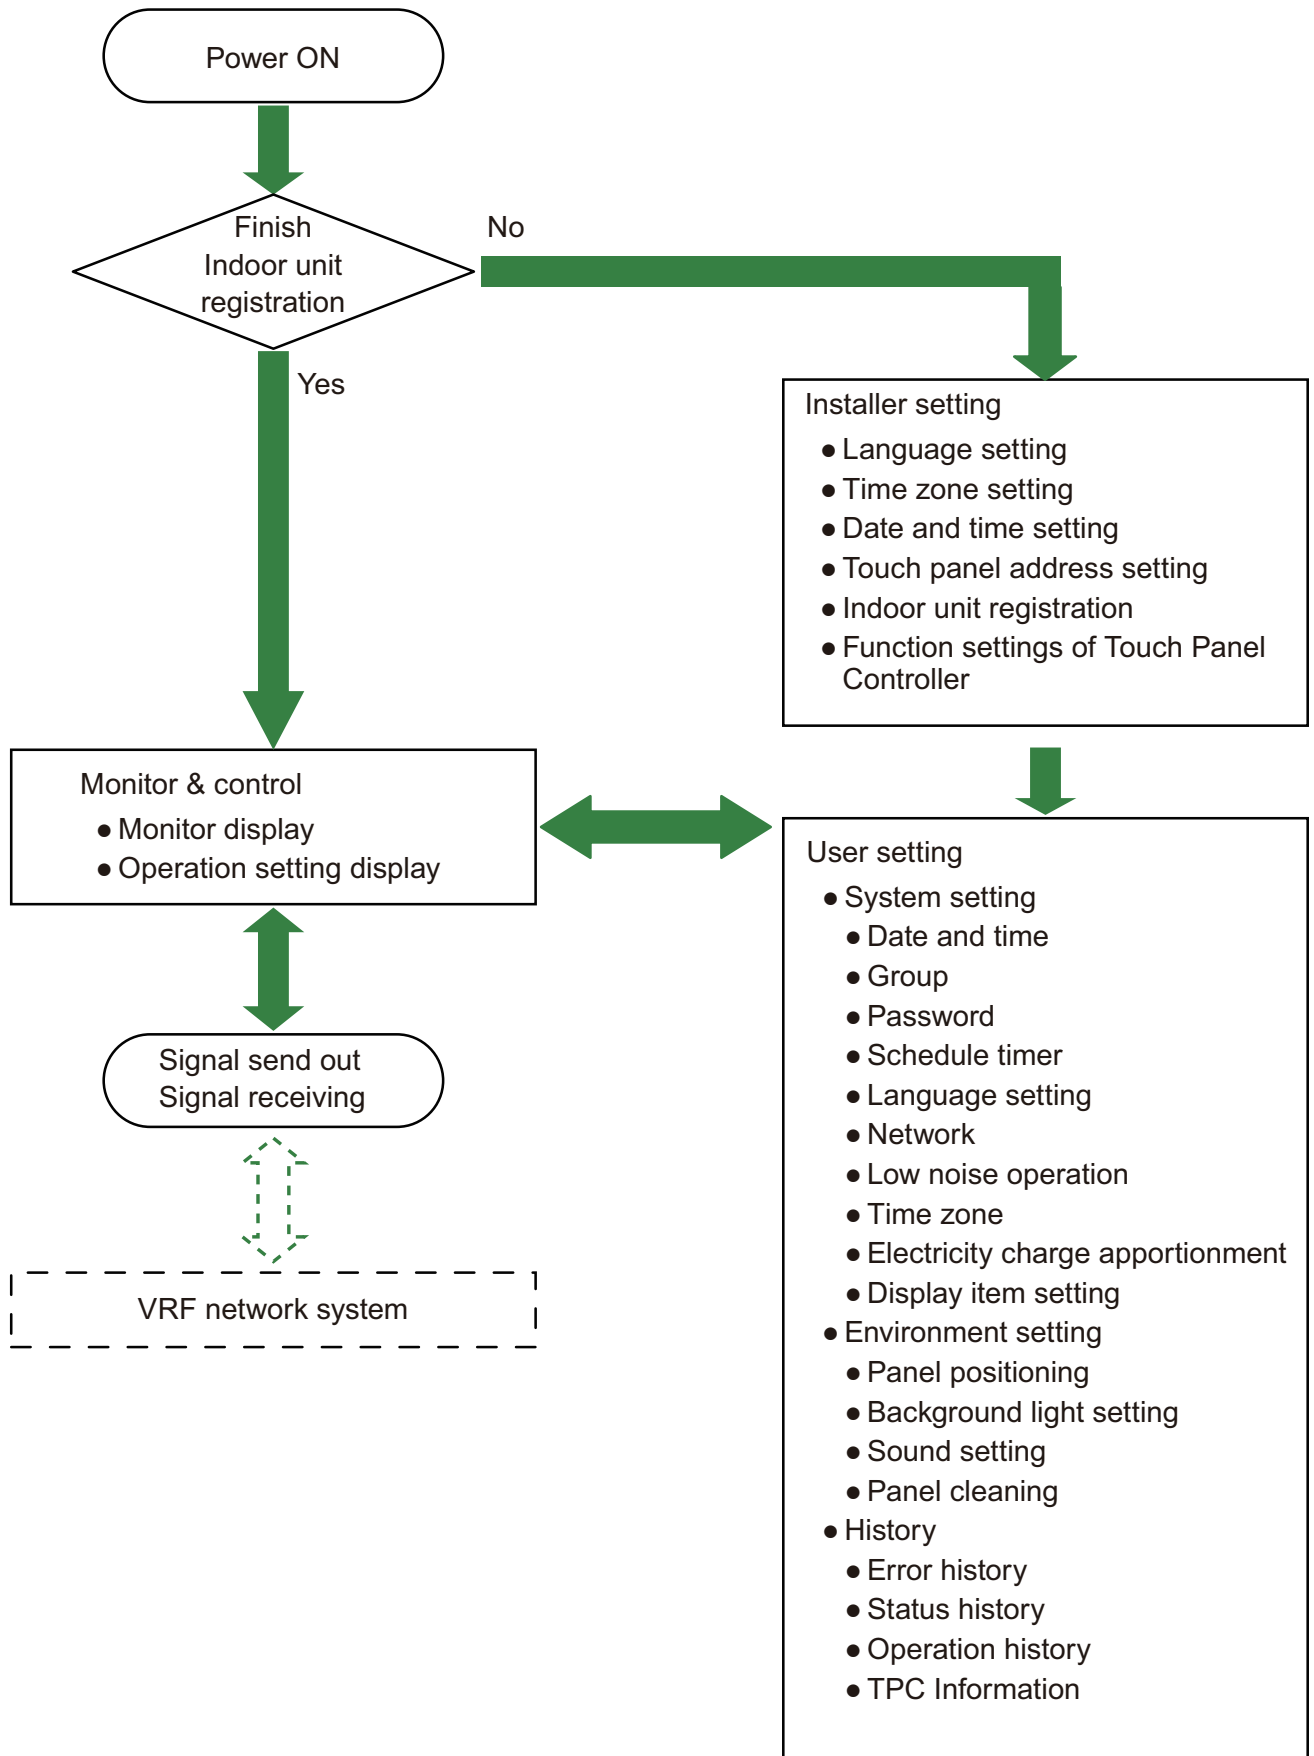

## ■ Main functions and screen examples

- **Monitor display example**

An easy-to-use display mode can be selected.  
Easy-to-understand GUI of adopted icon.

Icon display



List display



- **Operation mode setting example**

Large button is designed for easy to access.

Operation setting screen




Optional setting screen



- **Group setting**

Groups can be arbitrarily set in easy to manage units as shown in the figure.  
Control and monitoring are performed in these group units.

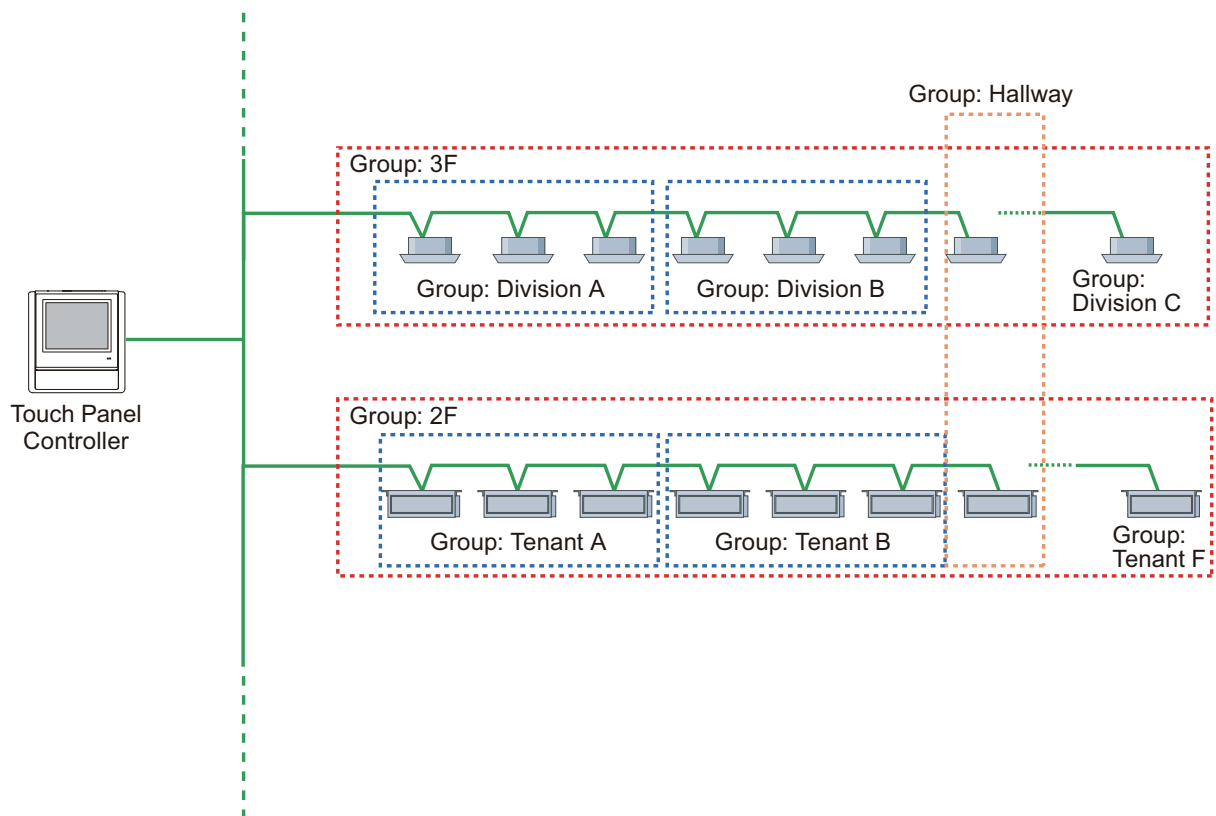


Group setting screen



- **System schedule timer**

Annual schedule can be set of a maximum 30 items.

Schedule setting screen

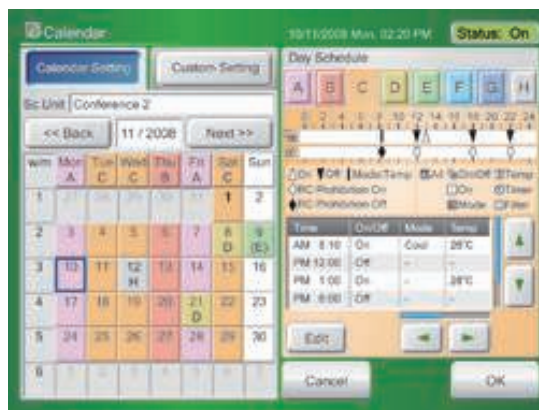


- **History recording and display**

Error, status and operation histories can be recorded. Each recording can be also written to USB flash drive.

- Error history: Max. 10 items recorded for each touch panel controller and each unit (indoor unit and outdoor unit).
- Status history: Max. 100 operations recorded for each indoor unit of each room.
- Operation history: Max. 100 operations recorded.

Optional history screen

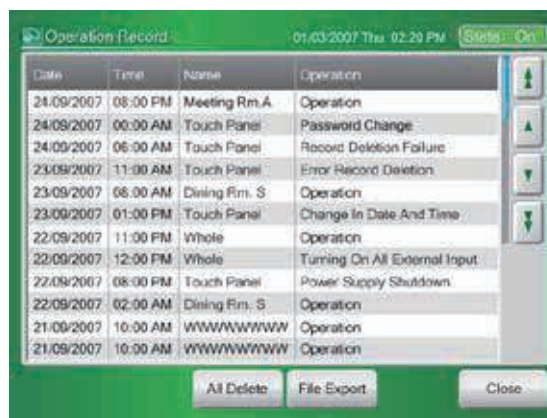


## ■ Screen examples (for remote monitoring)

- Monitor mode main screen example

Icon display



List display

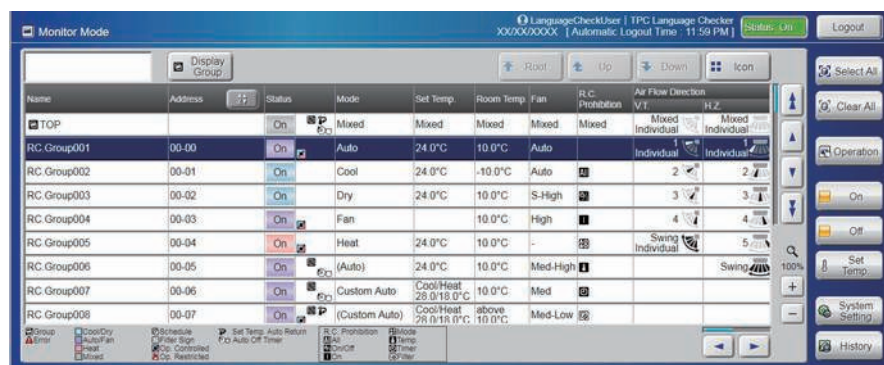

- Control main screen example


Operation setting screen






## ■ Dimensions

Unit: in (mm)

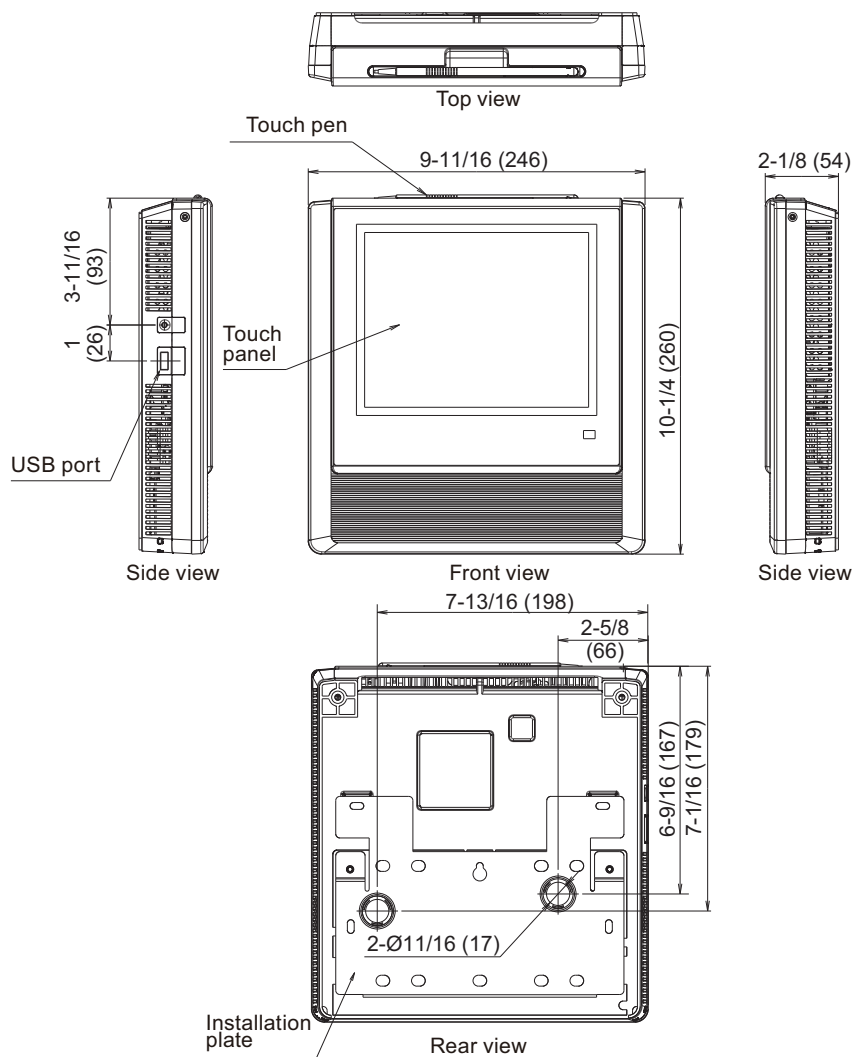

## ■ Mounting plate screw hole positions

Unit: in (mm)

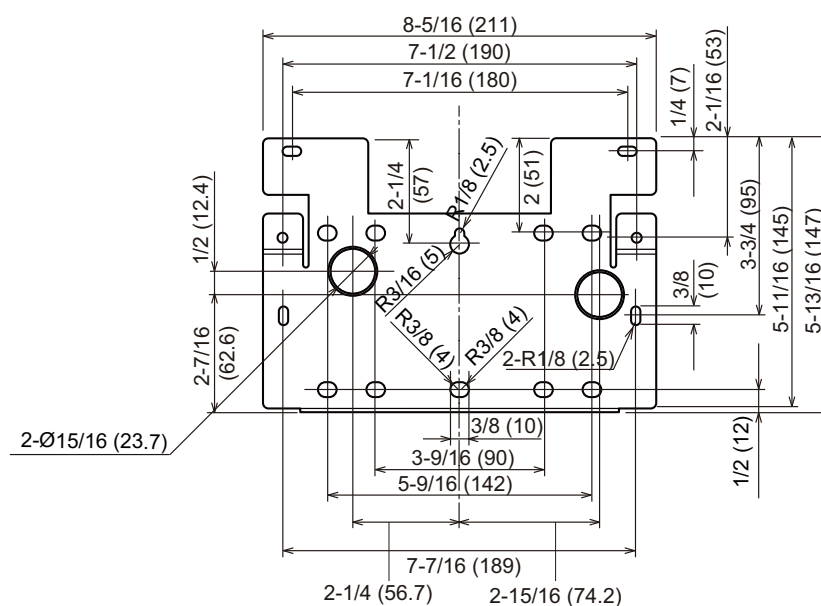


### ⚠ CAUTION

Refer to the mounting screw hole positions of the switch box that is to be installed in advance and check the compatibility.


## Terminal names

Names of connection terminals in rear cover.

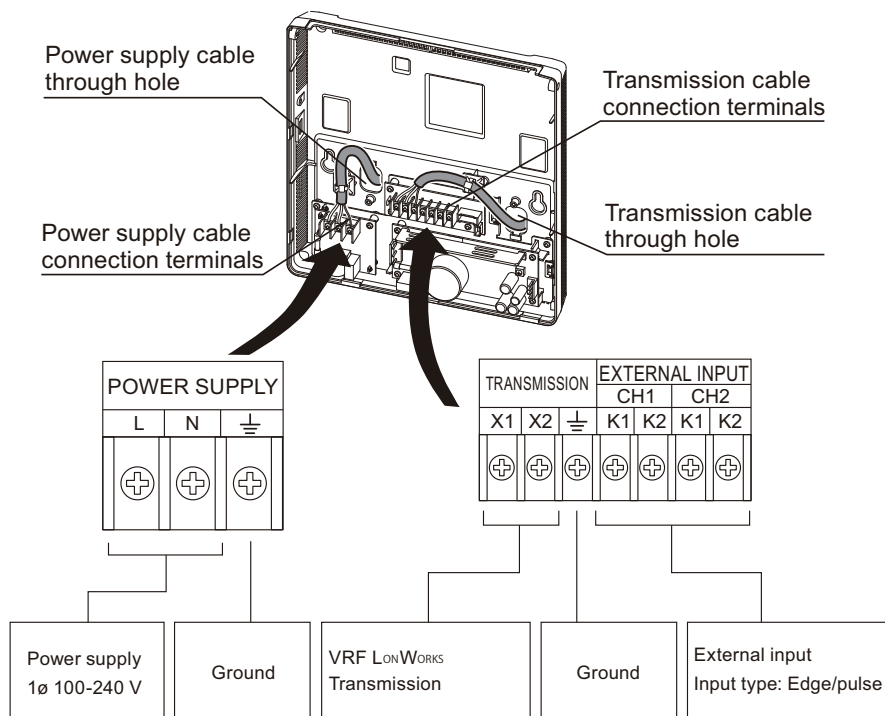


## External input terminal

- Case 1: Batch start/stop and emergency stop commands

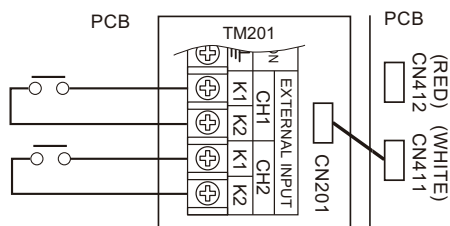


- Case 2: Electricity meter is connected

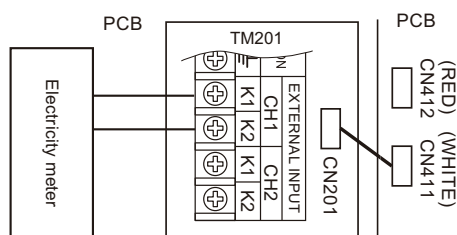

## ■ Installation space

When installing Touch panel controller in a row, keep the space shown below from the surrounding projecting parts.


Unit: in (mm)

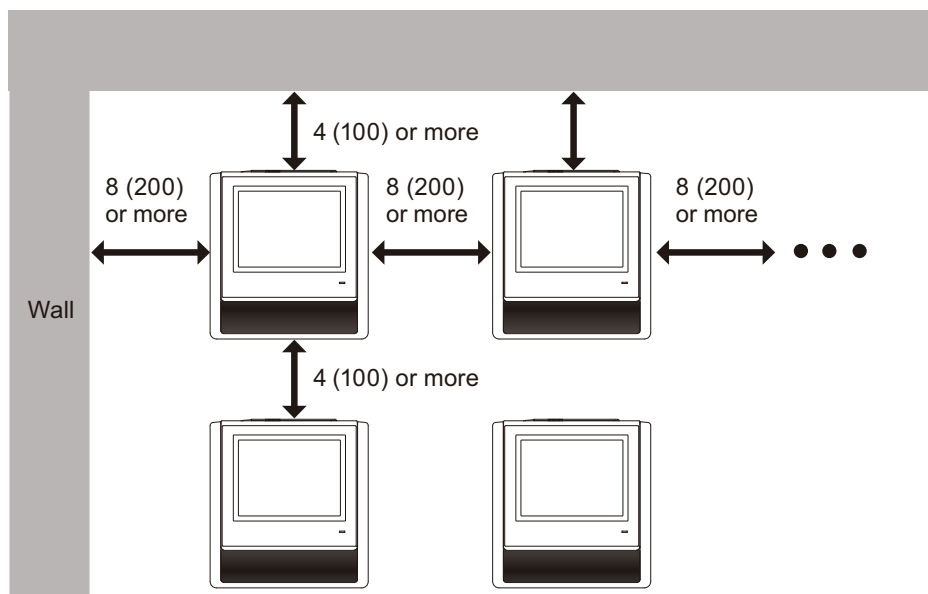

**NOTE:** The switch box that Touch panel controller is to be mounted to should be installed horizontally in advance.

### ⚠ CAUTION


Following installation positions are prohibited:

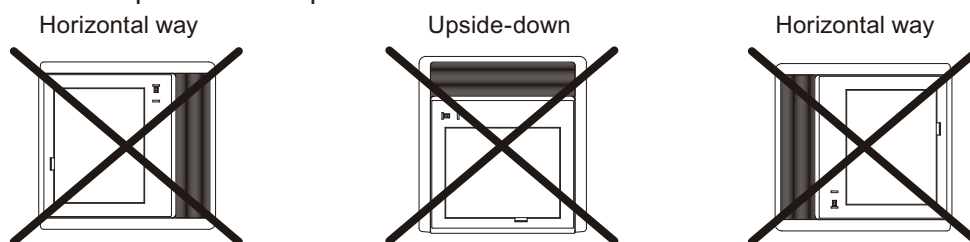



## ■ Installation

For details, refer to installation manual.

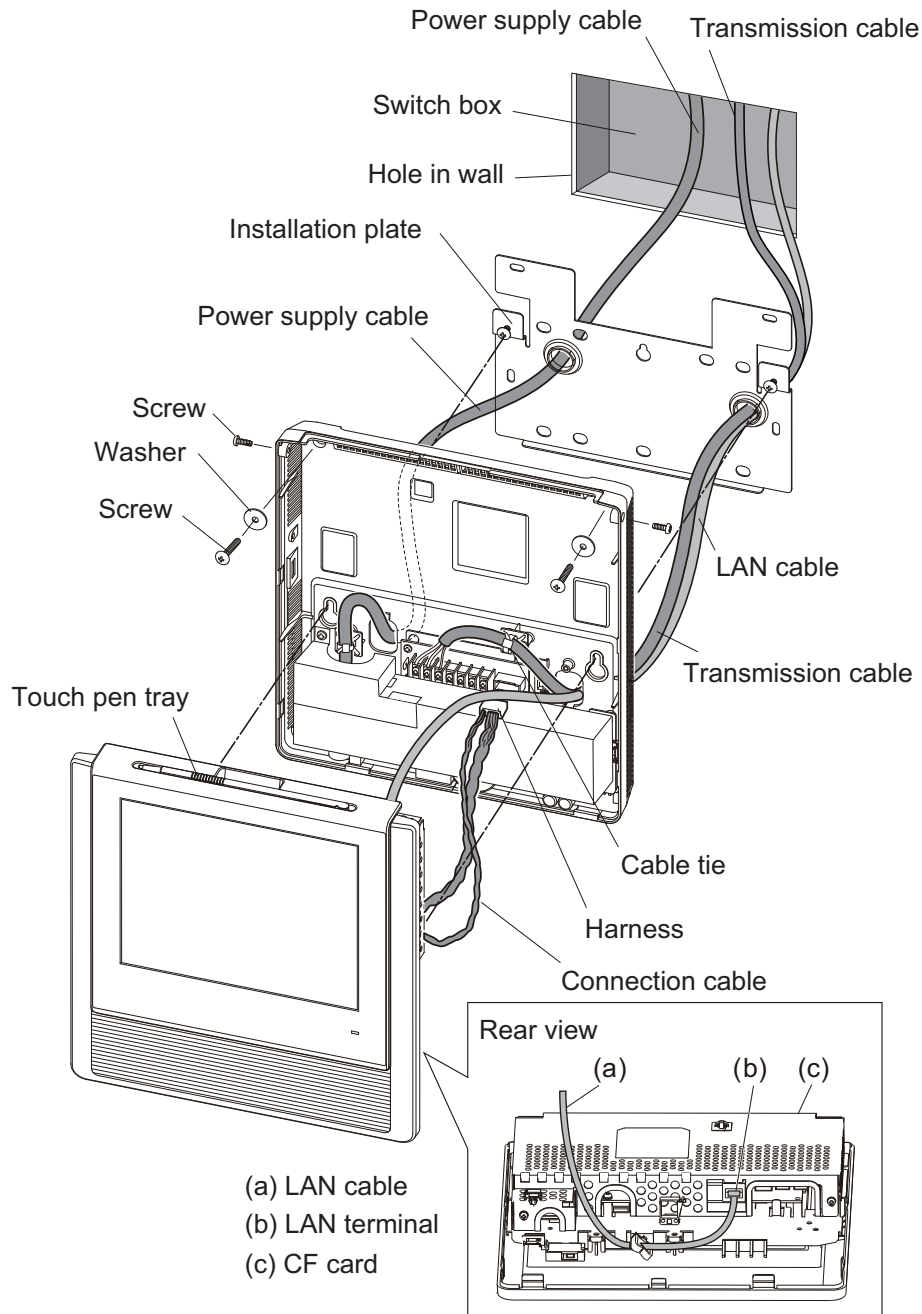

### ⚠ CAUTION

In advance, install a switch box to the wall where Touch panel controller is to be installed.

## ■ Specifications

Power source voltage	V	1 Ø AC 100—240
Power source frequency	Hz	50/60
Input power	W	22
Display		7.5-inch TFT color LCD (640 × 480 pixels), with touch panel
LED indicator		Power LED (Green)
External interface		USB 2.0
		Transmission line
		Ethernet port (Ethernet port is required for remote connection using Internet.)
		External input: Either emergency stop, batch operation/stop, electricity meter (Either Dry contact or apply voltage can be selected.)
		External output: Operation state, error state
		Reset switch
Usage temperature range	°F (°C)	32 to 104 (0 to 40)
Usage humidity range	%	0 to 85 (no condensation)
Storage temperature range	°F (°C)	-4 to 158 (-20 to 70)
Storage humidity range	%	0 to 85 (no condensation)
Dimensions (H × W × D)	in (mm)	10-1/4 × 9-11/16 × 2-1/8 (260 × 246 × 54)
Weight	lb (g)	5 (2,150)
Fuse capacity	A	5

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Power supply cable	20—16 AWG (0.5—1.25 mm <sup>2</sup> )	60245 IEC 57 or equivalent	1 Ø AC 100—240 V 50/60 Hz, 2-wire + ground (Always ground the unit)
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL4 (NEMA) non-polar 2- core, twisted pair solid core shielded	LonWorks compatible cable
External input/output cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 2-core, twisted pair	Use cable in accordance with local rules for cable.

## ■ Other required devices (Locally purchased)

- Personal computer that satisfies the following system requirements





Personal computer system requirement	
CPU	2 GHz or higher
Memory	2 GB or more
HDD	10 GB or more of free space
Display	1,366 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>USB port</li> <li>Ethernet port (Ethernet port is required for remote connection using Internet.)</li> </ul>
Software	<ul style="list-style-type: none"> <li>Microsoft Office Excel (2007, 2010, 2013, 2016), Microsoft Excel (2007, 2010, 2013)</li> <li>Adobe Reader 10.0 or later</li> <li>Internet Explorer 11</li> </ul>

## 2-4. Central remote controller (UTY-DCGYZ\*)



- Individual control and monitor of 100 indoor units
- 7-inch TFT color screen
- High visibility and easy operation
- External input/output contact
- Corresponds to 12 different languages. (English, Spanish, German, French, Italian, Russian, Portuguese, Turkish, Polish, Greek, Dutch, and Chinese)

### ■ Accessory

Name and shape	Q'ty	Application
 Installation manual	1	
 Operating manual	1	
 Screw (M4 × 16 mm)	4	For installing
 Cable tie	4	For binding power supply cable and transmission cable

# Overview



## 1 Left menu (Always display)

## 2 Group or R.C.G. button

## 3 Group scroll button

## 4 Group expansion cancel button

## 5 R.C.G. scroll button

## 6 Menu button

## 7 Icon

- **Delete**  
Deletes the currently displayed setting.
- **Copy**  
Copies the currently displayed setting.
- **New**  
Adds the new timer. However, when the number of settings reaches the upper limit, this button is disabled.
- **Select (Delete)**  
Deletes the selected line.
- **Select (Copy)**  
Copies the selected line.
- **New**  
Adds the new line. However, when the number of setting reaches upper limit, this button is disabled.


## 8 Button

- **OK button**  
Continues the appropriate process.
- **Cancel button**  
Cancels the process and closes the current screen.
- **Reset button**  
Returns the changed item to initial value.
- **Close button**  
Closes the current screen.
- **End button**  
Ends the process and closes the pop-up screen.

## ■ Main functions and screen examples



- **Individual control**

On/Off, Mode, Set temp., Fan speed, Airflow direction, Anti freeze, Economy, and Human sensor.

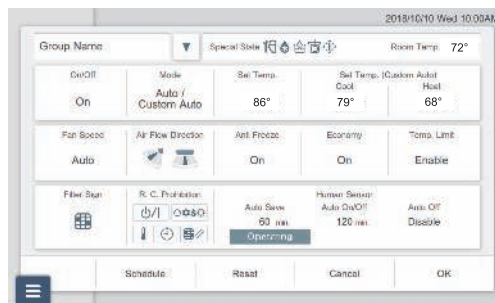


- **Vertical and Horizontal airflow direction setting**

Vertical airflow direction, Horizontal airflow direction, and Individual airflow direction.

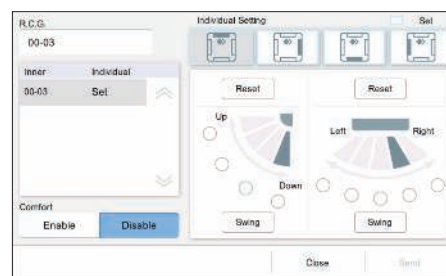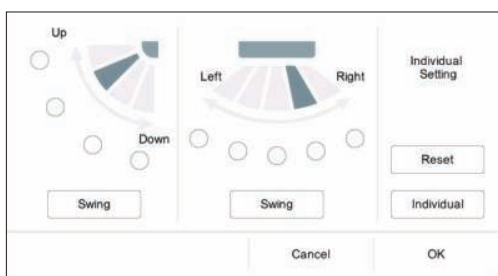


- **Room temperature upper and lower limitation setting**

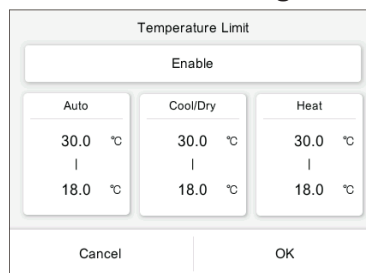



- **Remote controller prohibition**

All, On/Off, Mode, Temp., Timer, and Filter.

R.C prohibition setting prohibits individual remote control operation.

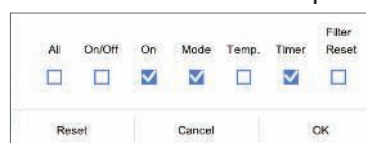

- **Schedule setting timer**

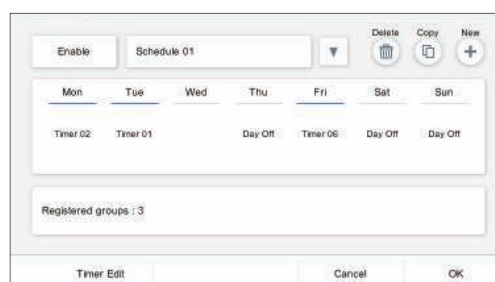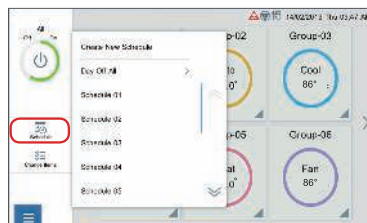


- **Error history**

- Able to memorize max. 200 errors.
- Suitable maintenance is possible by analysis of the error history data.

No.	Error No.	Name	Address	Model Name	Error Code
001	00100120113251	02-01	02-01-01	AGH415L8TH	12.1
002	00100120113249	01-01	01-01-02	AGH415L8TH	12.1
003	00100120113245	0-Error of UTM	01-02	AGH415L8TH	12.1
004	00100120113245	Central Controller	256-03	UTY-DCGYZ	164
005	00100120113245	01-03	01-03-11	AGH415L8TH	16.1
006	00100120113235	02-02	02-02-03	AGH415L8TH	16.1
007	00100120113235	02-01	02-01-01	AGH415L8TH	16.1
008	00100120113235	01-01	01-01-02	AGH415L8TH	16.1
009	00100120113235	02-04	02-04-01	AGH415L8TH	12.1
010	00100120113232	02-01	02-01-02	AGH415L8TH	12.2


## ■ Dimensions

Unit: in (mm)



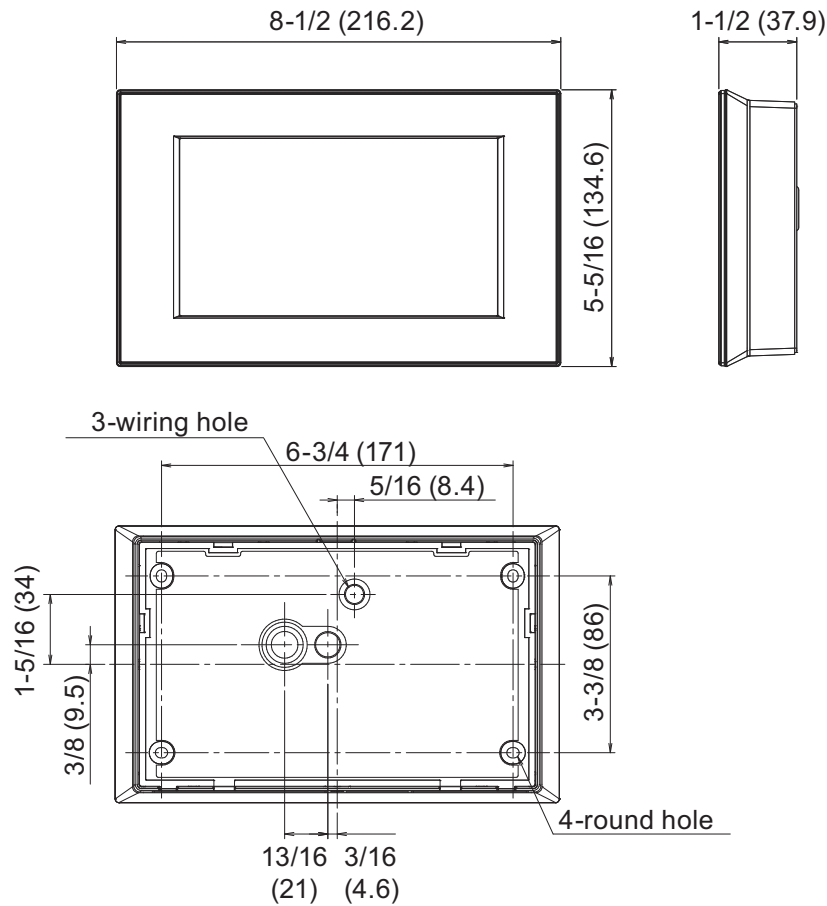


## Terminal names

Transmission line terminal name

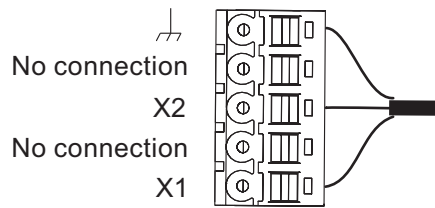


Power supply line terminal name

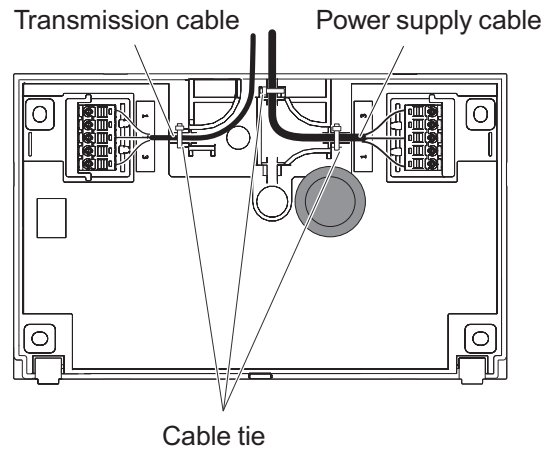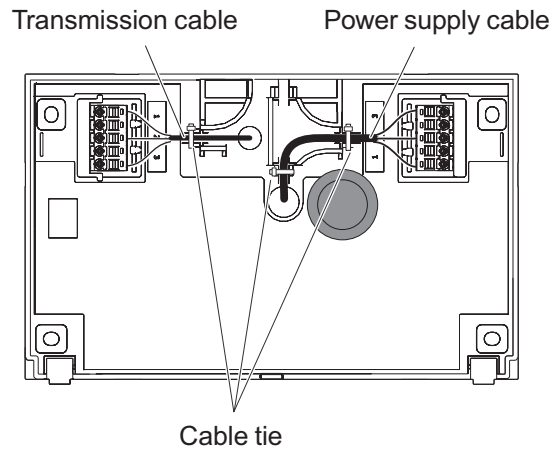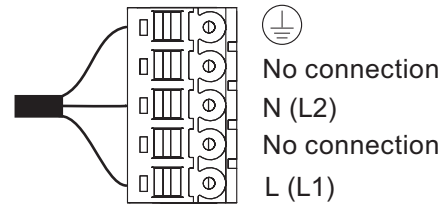

## Installation space



Make a service space to perform installation work.

Unit: in (mm)

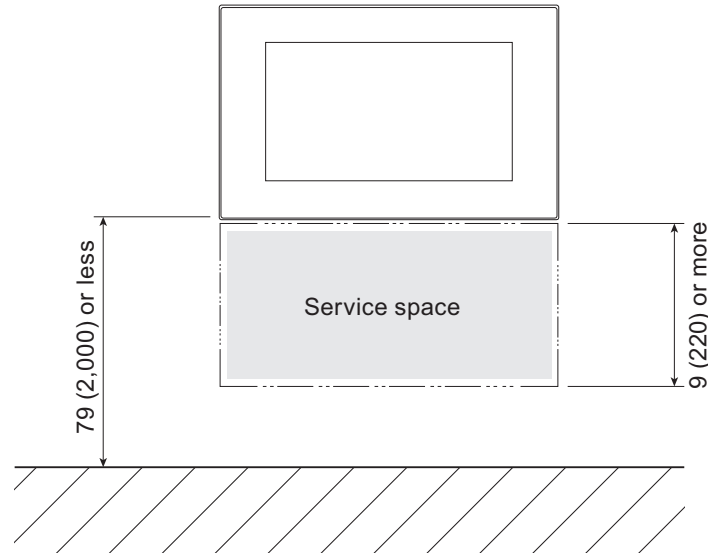

## ■ Installation


1. Separate the rear case from the front case.

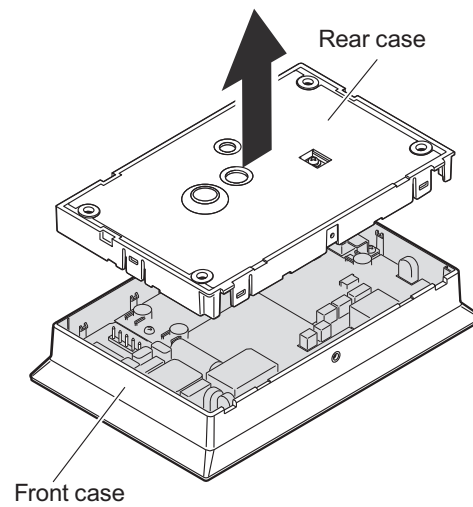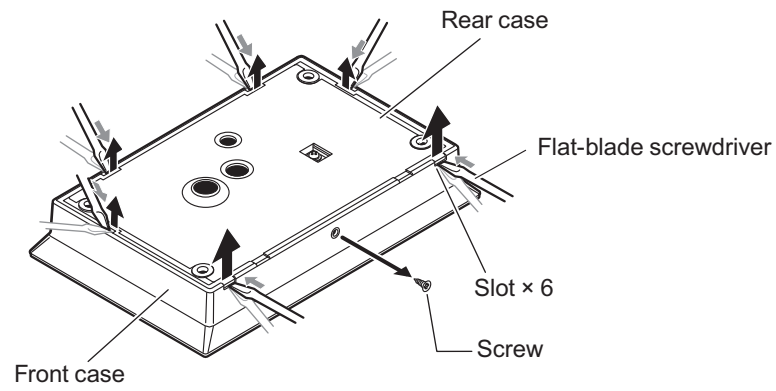




## 2. Install the rear case.


- When cable is in the wall:

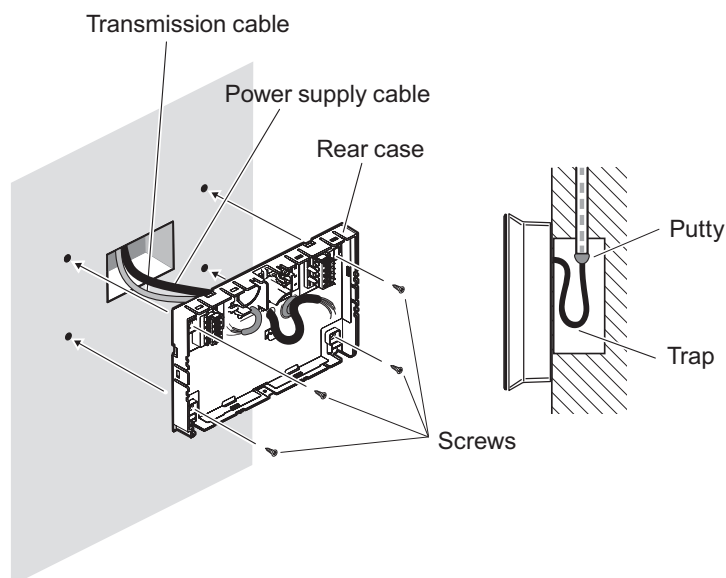

- When cable is in the wall (switch box is used):

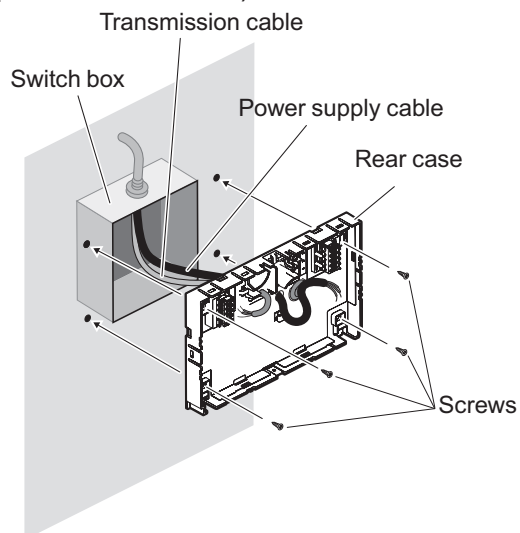

- When cable is along the wall:

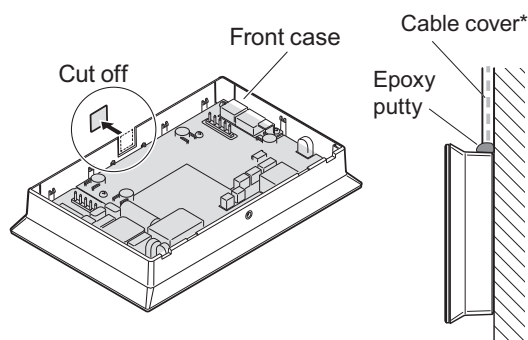


\*: More than 1/16 in (1 mm) thick

**NOTES:**

- When central remote controller (UTY-DCGYZ\*) is installed at the wall directly, install at a flat wall so that small animals do not enter from the rear side.
- When central remote controller (UTY-DCGYZ\*) is installed at the wall directly, remove the rubber bush at the rear side.

3. Install the front case to the rear case.

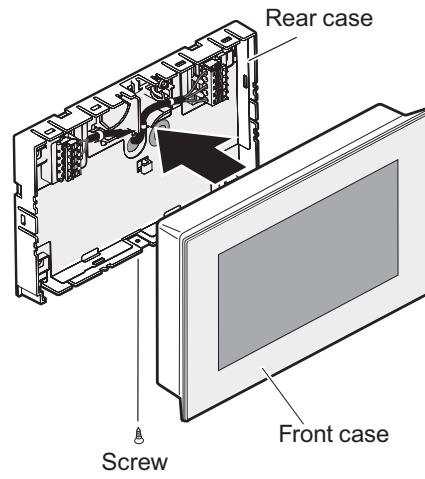

**NOTE:** For details, refer to the installation manual of the central remote controller.

## ■ Specifications

Power source voltage	V	1 Ø AC 100—240
Power source frequency	Hz	50/60
Input power	W	7
Display		7.0-inch TFT color LCD panel (WVGA)
LED indicator		Power LED (Green)
External interface		Transmission line
		External input: Either emergency stop, batch operation/stop, electricity meter (Either Dry contact or apply voltage can be selected.)
		External output: Operation state, error state
		Wired LAN (100 BASE-TX)
Usage temperature range	°F (°C)	32 to 104 (0 to 40)
Usage humidity range	%	0 to 85 (no condensation)
Storage temperature range	°F (°C)	-4 to 158 (-20 to 70)
Storage humidity range	%	0 to 85 (no condensation)
Dimensions (H × W × D)	in (mm)	5-5/16 × 8-1/2 × 1-1/2 (134.6 × 216.2 × 37.9)
Weight	oz (g)	28.2 (800)
Fuse capacity	A	5

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Power supply cable (for stranded wire)	18—16 AWG (0.8—1.25 mm <sup>2</sup> )	60245 IEC 57 or equivalent	1 Ø AC 100—240 V 50/60 Hz, 2-wire + ground (Always ground the unit)
Power supply cable (for solid wire)	18—14 AWG (0.8—2.0 mm <sup>2</sup> )	—	1 Ø AC 100—240 V 50/60 Hz, 2-wire + ground (Always ground the unit)
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL4 (NEMA) non-polar 2- core, twisted pair solid core diameter 0.03 in (0.65 mm), shielded type	LonWorks compatible cable
External input/output cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 2-core, twisted pair Max cable length: 82 ft (25 m)	Use cable in accordance with local rules for cable.
LAN cable	—	Category 5 or more straight cable	100 BASE-TX support

## 2-5. Wired remote controller (Touch panel: UTY-RNRUZ\*)








- Easy finger touch operation with LCD panel.
- Built-in Weekly/Daily time (On/Off, Temp., Mode)
- The backlit LCD enables easy operation in a dark room.
- Room temperature display
- Control up to 16 indoor units
- Corresponds to 12 different languages (English, Chinese\*, French, German, Spanish, Russian, Polish, Italian, Portuguese, Greek\*, Turkish, and Dutch\*)

\*: Following languages are not available for version 5 or later:

- Chinese
- Greek and Dutch (North America only)


### ■ Accessory

Name and shape	Q'ty	Application
 CD-ROM	1	
 Screw	2	For installing the remote controller
 Cable tie	1	For remote controller and remote controller cable binding
 Installation manual	1	
 Operation manual	1	

## Overview



Display panel

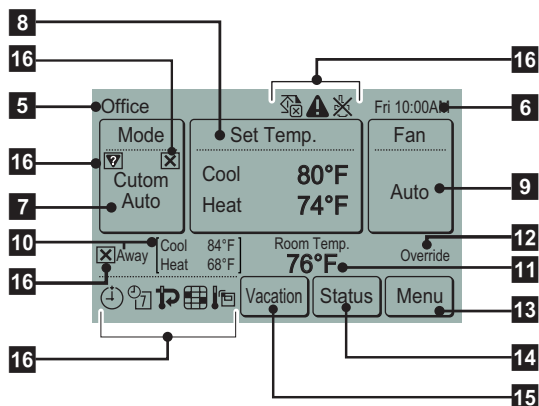

### 1 Remote temperature sensor (inside)

### 2 On/off button

Operable only while displaying the "Monitor mode" screen.

### 3 LED lamp (operation indicator)

### 4 Touch panel display

### 5 Remote controller group name

### 6 Clock

### 7 Mode

### 8 Set temperature

### 9 Fan

### 10 Away

### 11 Room temperature

### 12 Override

### 13 Menu

Various settings can be set.

### 14 Status

Status of the indoor unit and error can be checked.

### 15 Vacation

When this is touched, the schedule is disabled and the indoor unit remains unoccupied.


### 16 Status icons

**NOTE:** Functions may differ by type of the indoor unit. For details, refer to the operation manual.

## ■ System diagrams

### • Multiple remote control

Up to 4 remote controllers can be used to operate the indoor units.

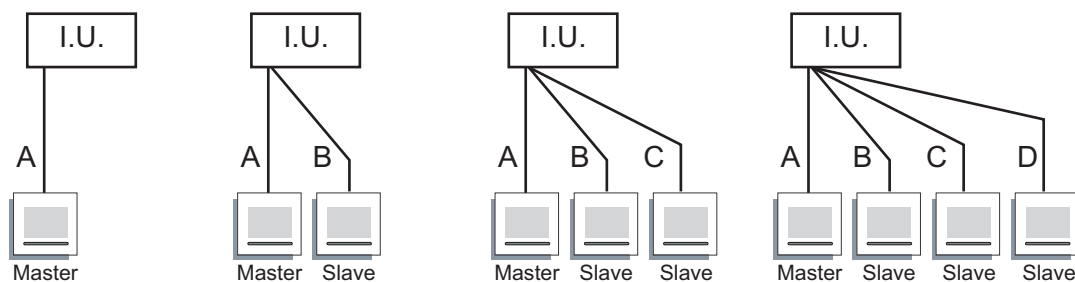


A, B, C, D: Remote controller cable (For details of controller cable specifications, refer to "[Controller cable](#)" in Chapter 6. SYSTEM DESIGN on page 06-84.)

$A \leq 1,640 \text{ ft (500 m)}$ ,  $A + B \leq 1,640 \text{ ft (500 m)}$ ,  $A + B + C \leq 1,640 \text{ ft (500 m)}$ ,  $A + B + C + D \leq 1,640 \text{ ft (500 m)}$

**NOTE:** Multiple installation method described above is prohibited to combine with 3-wired type remote controller (UTY-RNKU, UTY-RSKU, or UTY-RHKU) and 2-wired type remote controller (UTY-RNRUZ\*)

### • Group control

With a single remote controller, up to 16 indoor units can be simultaneously operated.

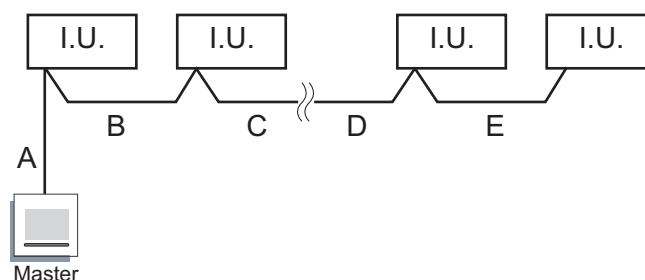


A, B, C, D, E: Remote controller cable (For details of controller cable specifications, refer to "[Controller cable](#)" in Chapter 6. SYSTEM DESIGN on page 06-84.)


$A + B + C + D + E \leq 1,640 \text{ ft (500 m)}$

## Electrical wiring


### 1 remote controller:

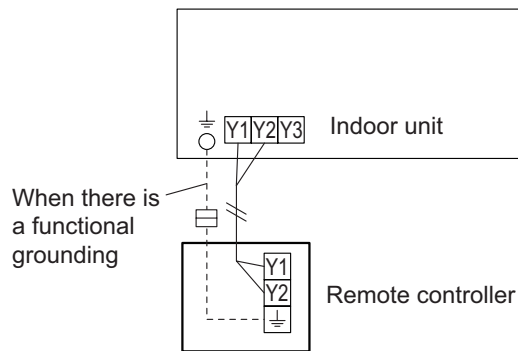


### 2 remote controllers:

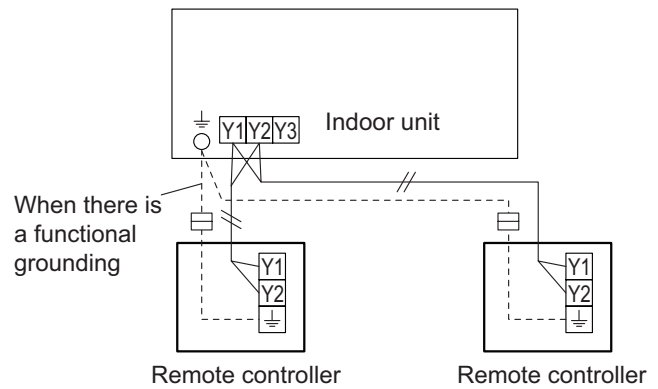

### Group control:

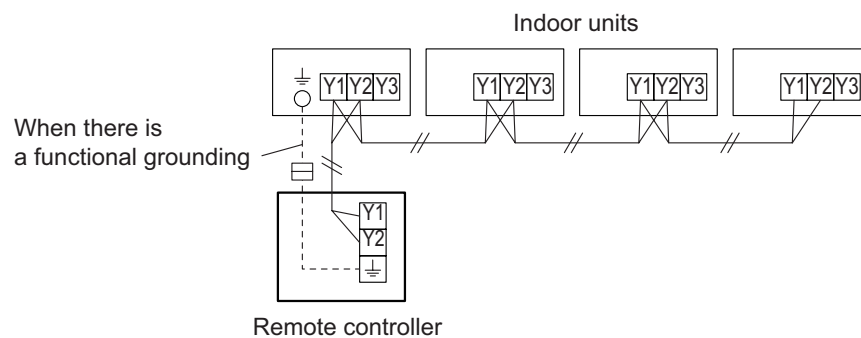


## Dimensions

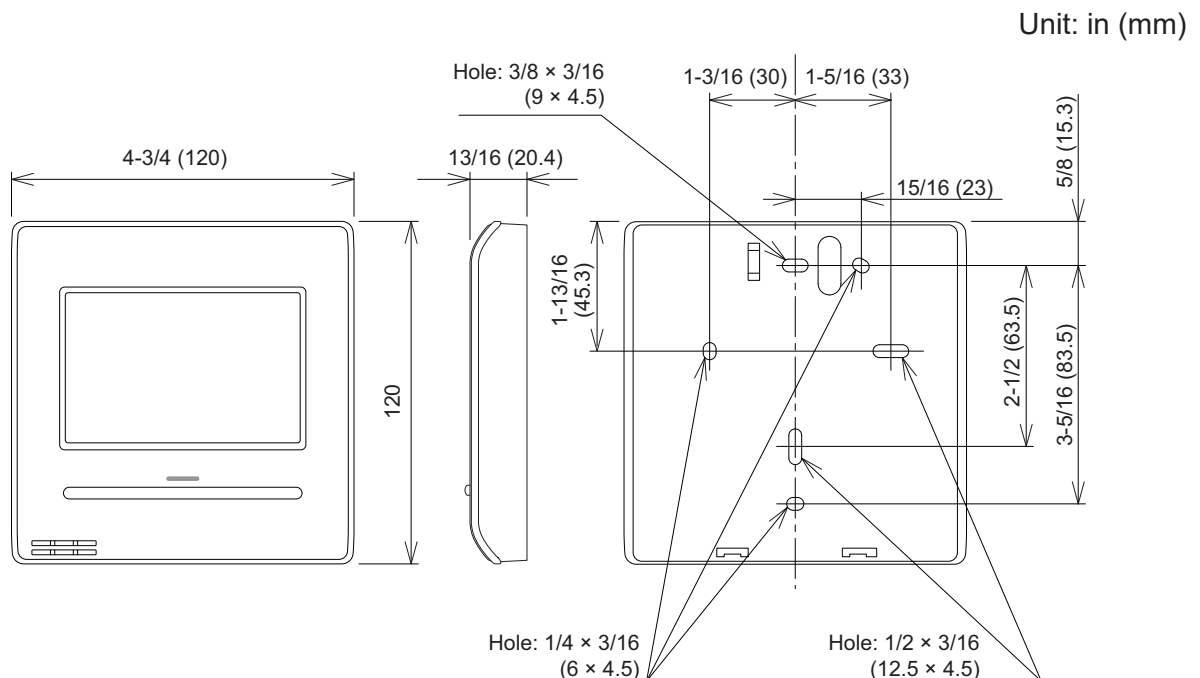

## ■ Installation space

- This product cannot be installed in wall.
- Recommendation installation height of the remote controller is 1.4 m $\pm$ 5 in (1.4 m) from the floor surface to the bottom of the remote controller.
- Even when you install a remote controller to one of a switch box and the surface of a wall, secure the space shown in following figure. If spaces run short, it will become difficult to remove a remote controller.

Unit: in (mm)

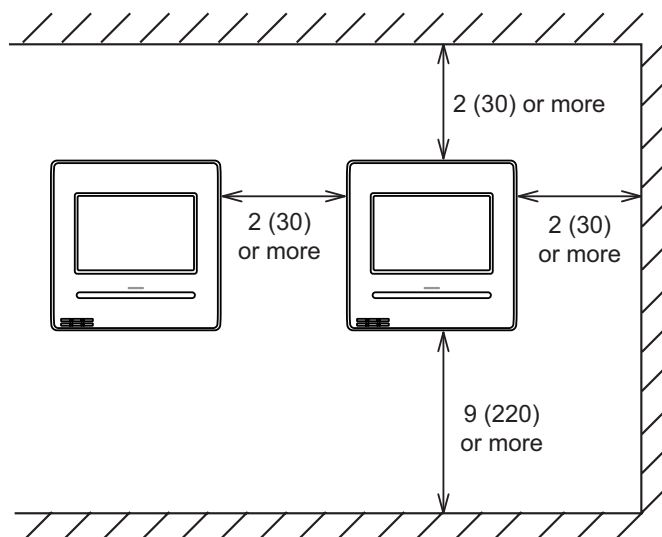

Secure enough space where a flat-blade screwdriver to take off a case can be inserted.

## ■ Installation


- **Connection pattern**

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

- **Pattern A**

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

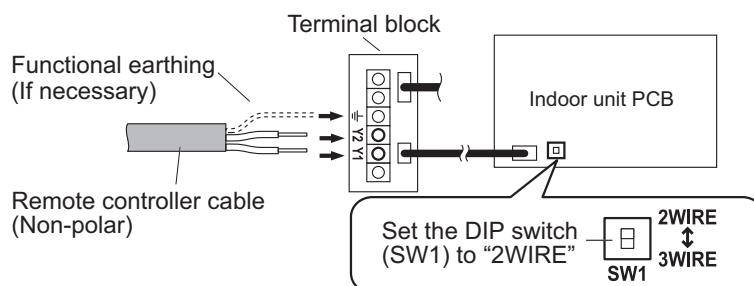


### NOTES:

- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.




- **Pattern B**


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

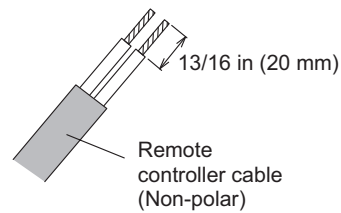


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

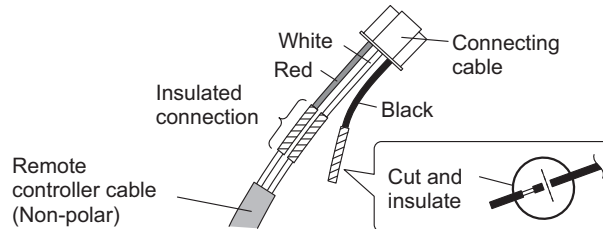

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

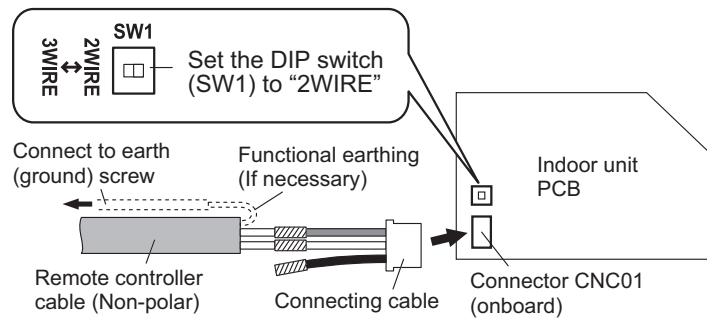

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

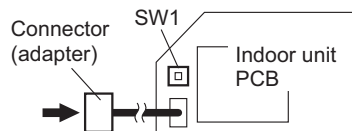

## ■ Specifications


Input voltage	V	DC 12
Power consumption	W	Max. 0.3
Display		3.8-inch FSTN LCD (255 × 160 dots) with touch panel
Usage temperature range	°F (°C)	32 to 104 (0 to 40)
Usage humidity range	%	20 to 90 (no condensation)
Storage temperature range	°F (°C)	14 to 140 (-10 to 60)
Storage humidity range	%	20 to 90 (no condensation)
Dimensions (H × W × D)	in (mm)	4-3/4 × 4-3/4 × 11/16 (120 × 120 × 20.4)
Weight	oz (g)	8 (220)

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Non polar 2-core	Use sheathed twist pair cable.*
	18 AWG	Thermostat cable 2-core	Use sheathed non twist pair cable.






\*: Use shielded cable (locally purchased) in accordance with the regional cable standard.

## 2-6. Wired remote controller (UTY-RNKU)




- Various time setup available (ON/OFF/WEEKLY)
- Equipped with weekly timer as standard function (Start/Stop function is twice per day for a week.)
- When setting up a time, start/stop, and the temperature setup can be changed.
- When a failure occurs, the error code is displayed.
- Error history (Last 16 error code can be accessed.)
- Up to 16 indoor units can be simultaneously controlled.
- The room temperature can be controlled by detecting the temperature accurately with built-in thermo sensor.


### ■ Accessory

Name and shape	Q'ty	Application
 Remote controller cable	33 ft (10 m)	For connecting the remote controller
 Screw	2	For installing the remote controller
 Cable tie	1	For remote controller and remote controller cable binding
 Installation manual	1	
 Operation manual	1	



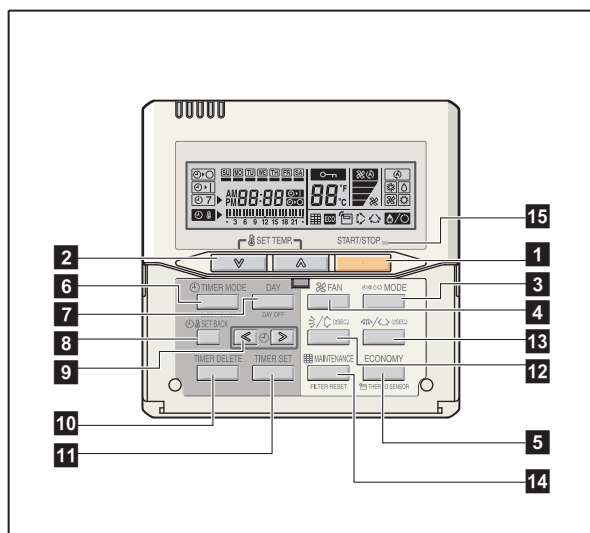



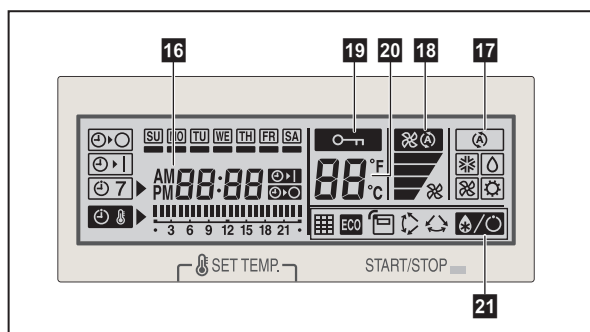









## Overview



Display panel




**NOTE:** Functions may differ by type of the indoor unit. For details, refer to the operation manual.


- 1 START/STOP button**  
Starts and stops operation.
- 2 SET TEMP. button**  
Selects the setting temperature.
- 3 MODE button**  
Selects the operating mode (AUTO , HEAT , FAN , COOL , and DRY ).
- 4 FAN button**  
Selects the fan speed AUTO , QUIET , LOW , MED , and HIGH .
- 5 ECONOMY (THERMO SENSOR) button**  
Turns the economy-efficient mode on and off.
- 6 TIMER MODE (CLOCK ADJUST) button**  
Selects the timer mode (off timer, on timer, and weekly timer). Sets the current time.
- 7 DAY (DAY OFF) button**  
Temporarily cancels one day timer.
- 8 SET BACK button**  
Selects the set back timer.
- 9 Set time button**  
Pressed to set time.
- 10 TIMER DELETE button**  
Deletes the weekly timer schedule.
- 11 TIMER SET button**  
Sets the date, hour, minute, and on-off time.
- 12 Vertical airflow direction and swing button**  
Push for 2 seconds to change the swing mode.
- 13 Horizontal airflow direction and swing button**  
Push for 2 seconds to change the swing mode.
- 14 FILTER RESET button**
- 15 Operation lamp**  
Lights during operation and when the timer is on.
- 16 Timer and clock indicator**
- 17 Operation mode indicator**
- 18 Fan speed indicator**
- 19 Operation lock indicator**
- 20 Temperature indicator**
- 21 Function indicators**
  -  Defrost indicator
  -  Thermo sensor indicator
  -  Economy indicator
  -  Vertical swing indicator
  -  Horizontal swing indicator
  -  Filter indicator

## System diagram

### 1 remote controller:

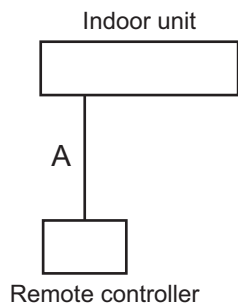


### 2 remote controllers:

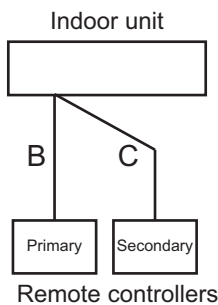

A, B, C: Remote controller cable  
 $A \leq 1,640 \text{ ft (500 m)}$ ;  $B + C \leq 1,640 \text{ ft (500 m)}$


## Electrical wiring

### 1 remote controller:

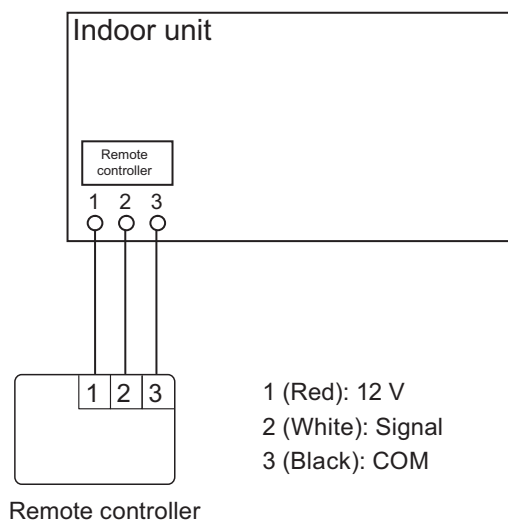

1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM


### 2 remote controllers:

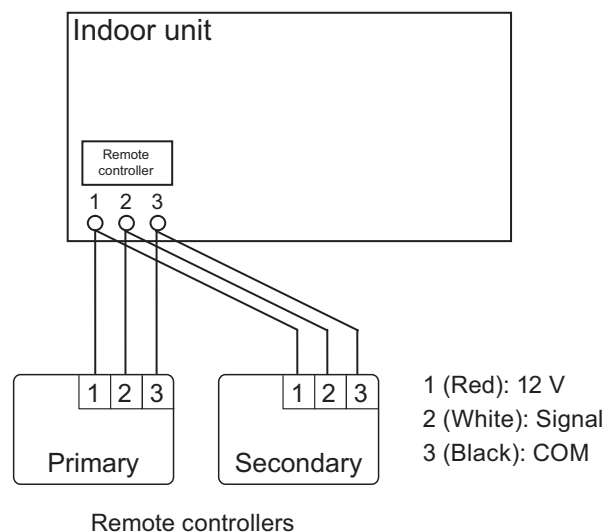


1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM

## Dimensions


Unit: in (mm)

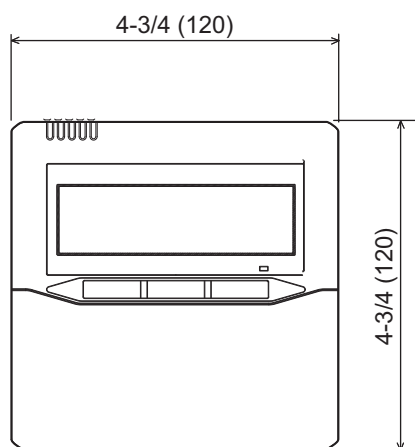

Front view

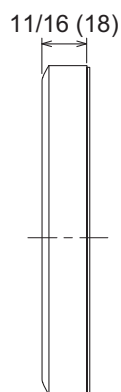

Side view

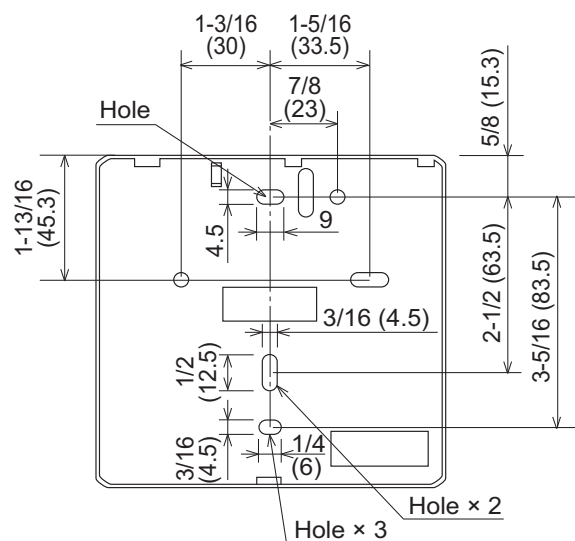

Rear View

## ■ Installation


### • Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

### • Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

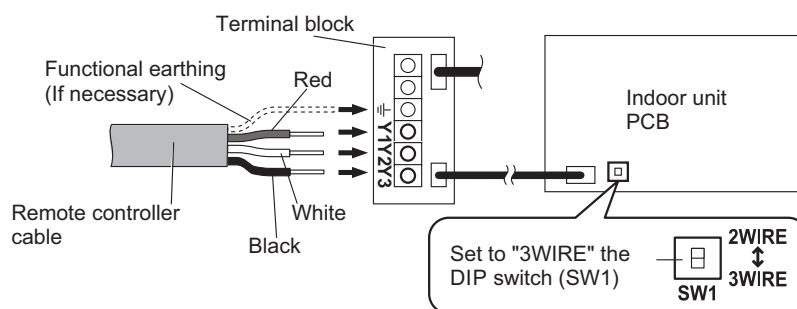


### NOTES:


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

## • Pattern B


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

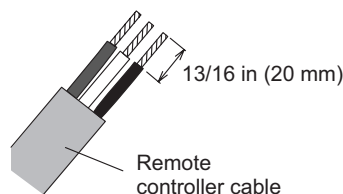


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

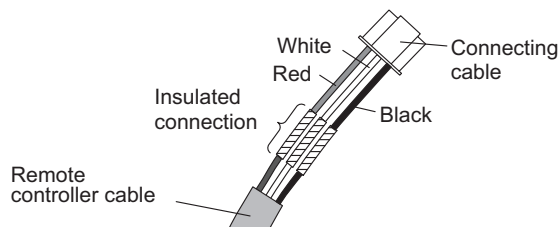

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

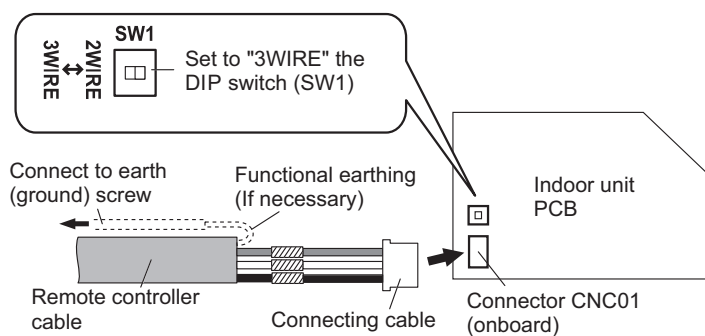

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

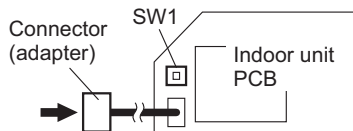


## ■ Specifications

Dimensions (H × W × D)	in (mm)	4-3/4 × 4-3/4 × 11/16 (120 × 120 × 18)
Weight	oz (g)	6 (160)

## ● Wiring specifications






Use	Cable size	Wire type	Remarks
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3-core	Use sheathed PVC cable.

## 2-7. Simple remote controller (With operation mode: UTY-RSRY)




- Easy operation
- Stylish design
- Large LCD screen and simple operation buttons
- Built-in background light function
- Easy installation with a slim shape with no bulge in the back.
- Up to 16 indoor units can be simultaneously controlled.
- Can be installed onto SW-BOX. (applies European and other country's standard)

### ■ Accessory


Name and shape	Q'ty	Application
 CD-ROM	1	
 Screw	2	For installing the remote controller
 Cable tie	1	For remote controller and remote controller cable binding
 Installation manual	1	
 Operation manual	1	



## Overview

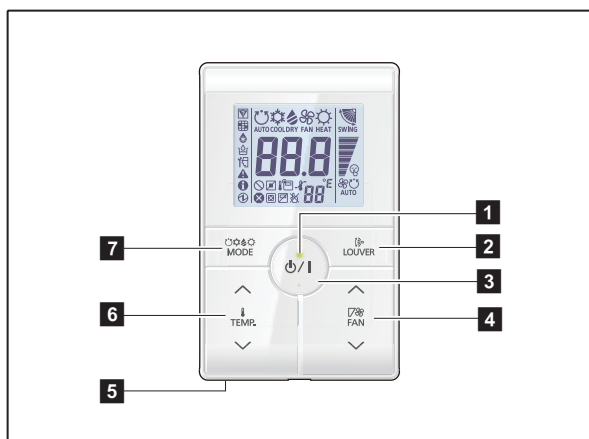

Display panel

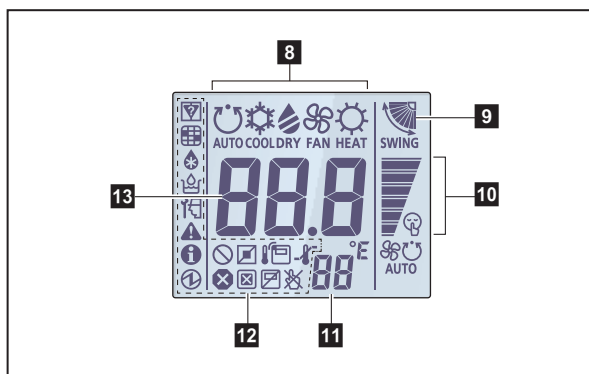

\*1: Not available for a heat pump model unless it is set up as an administrative indoor unit.

\*2: Not available for a heat pump model.

\*3: Not available for a cooling-only model.

\*4: Set the function setting of the indoor unit accordingly.

\*5: During address display mode.

### 1 LED lamp

Lights during operation.

### 2 Louver button


Adjusts the airflow direction.

### 3 START/STOP button

Starts and stops operation.

### 4 FAN control button

Switches the fan speed as follows:

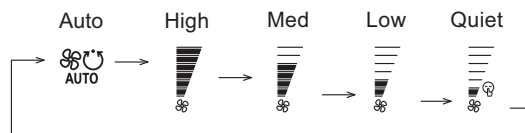

### 5 Room temperature sensor (inside)

Senses ambient temperature of unit.

### 6 Set temperature button

Selects the setting temperature.

64.4—86 °F (18—30 °C) [COOL], 50—86 °F (10—30 °C) [HEAT]

### 7 Operation mode button

Switches the operation mode as follows:



### 8 Operating mode indicator

### 9 Airflow direction indicator

### 10 FAN speed indicator

### 11 Remote controller address indicator

### 12 Status icons

Mode mismatch

Filter sign \*4

Defrost operation

Oil recovery operation

Under maintenance

Error

Special state

Conducting electricity

Emergency stop

Operation controlled

Forced stop

Remote controller sensor is enabled \*4

Central controlled

Setting temperature range is enabled


Operation prohibited

### 13 Set temperature


Indicates indoor unit address. \*5

## ■ System diagrams

- 1 remote controller



- 4 remote controllers

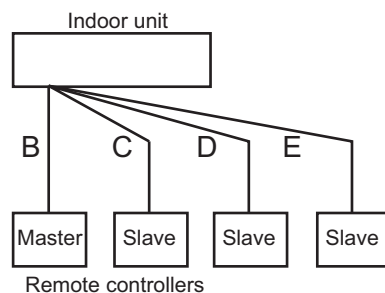


### NOTES:


- A, B, C, D, E: Remote controller cable (For details of controller cable specifications, refer to ["Controller cable"](#) in Chapter 6. SYSTEM DESIGN on page 06-84.)
- $A \leq 1,640 \text{ ft (500 m)}$ ,  $B + C + D + E \leq 1,640 \text{ ft (500 m)}$

## ■ Electrical wiring


### 1 remote controller:

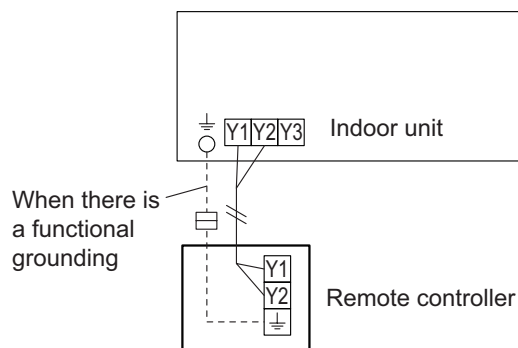

### 2 remote controllers:

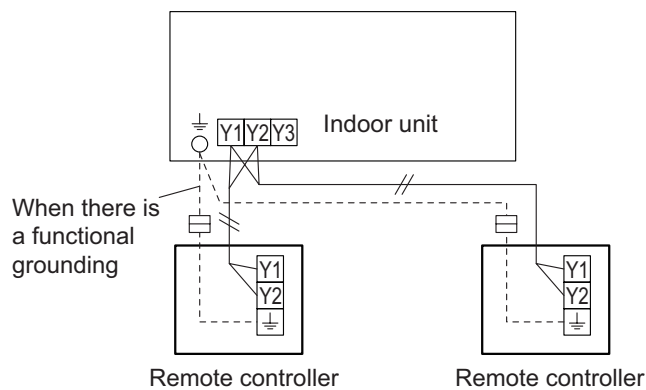


### Group control:

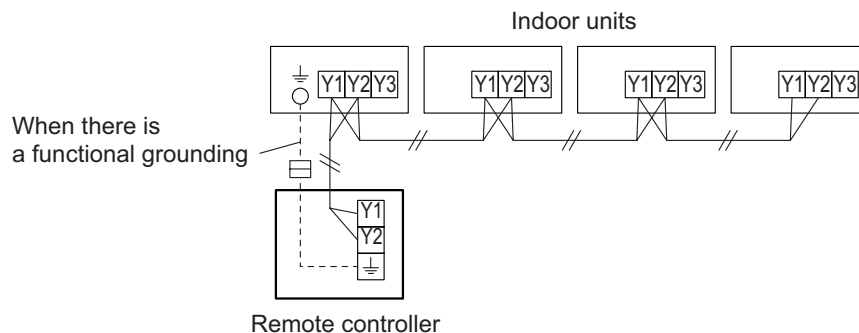

## ■ Dimensions

Unit: in (mm)

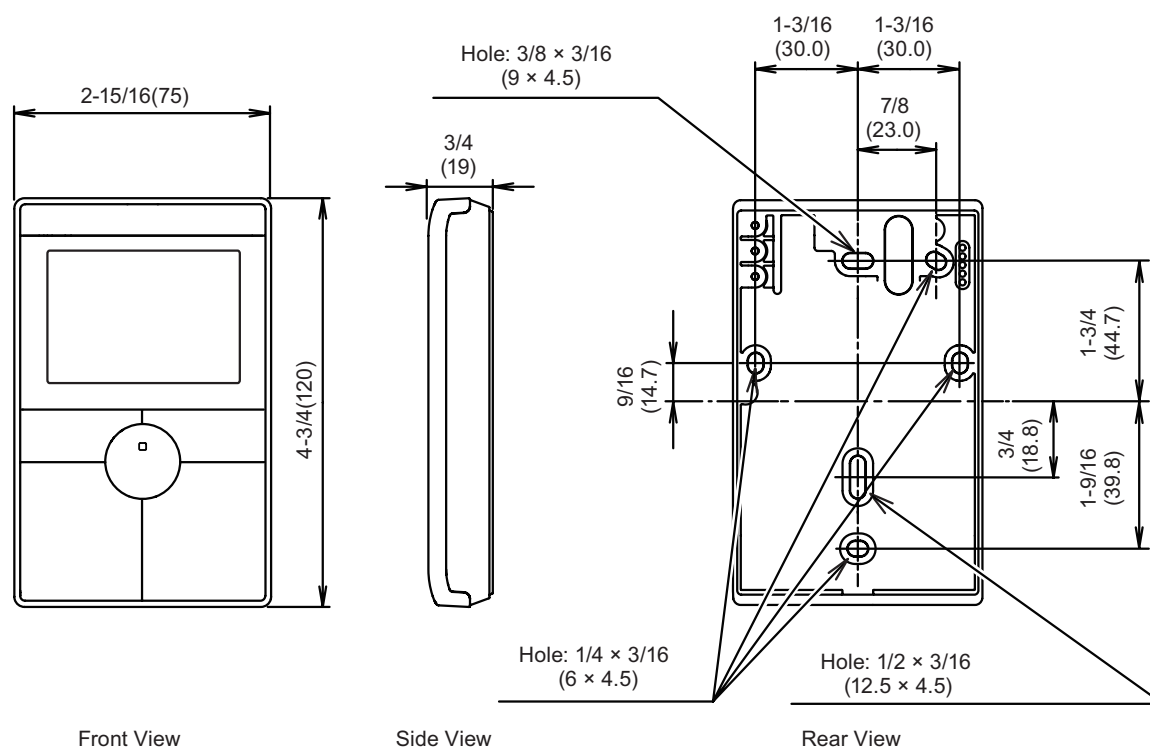

## ■ Installation


### • Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

### • Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

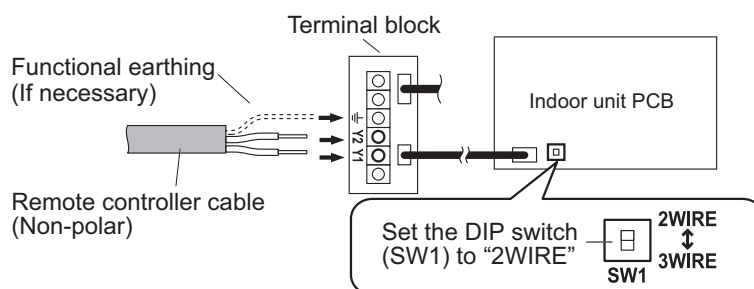


### NOTES:


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

## • Pattern B


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

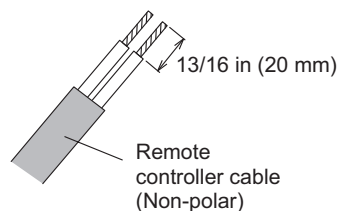


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

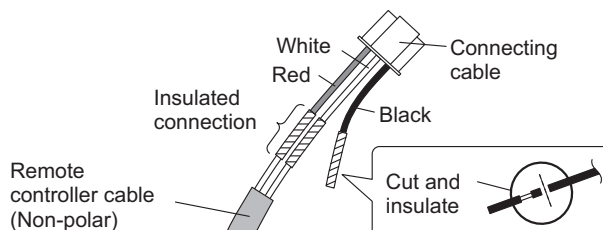

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

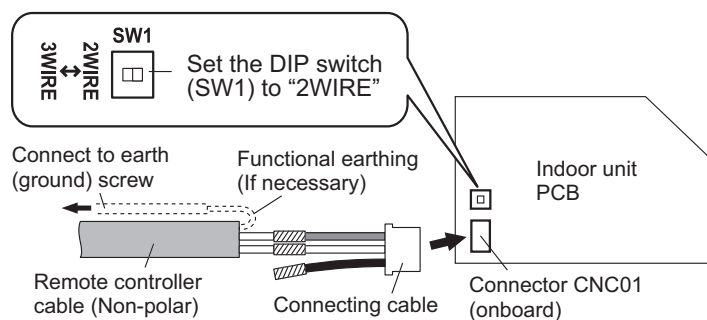

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

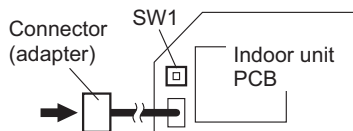

## ■ Specifications

Dimensions (H × W × D)	in (mm)	4-3/4 × 2-15/16 × 3/4 (120 × 75 × 19)
Weight	oz (g)	4 (120)

## ● Wiring specifications

Use	Cable size	Cable type	Remarks
Remote controller cable	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Sheathed cable	Non polar 2-core, Twisted pair
		Shielded cable*	






\*: Use shielded cable in accordance with local rules for remote controller cable.

## 2-8. Simple remote controller (With operation mode: UTY-RSKU)




- Easy operation
- Built-in background light function
- Easy installation with a slim shape with no bulge in the back.
- Error history (Last 16 error codes can be accessed.)
- Up to 16 indoor units can be simultaneously controlled.
- Can be installed onto SW-BOX. (applies European and other country's standard)


### ■ Accessory

Name and shape	Q'ty	Application
 Remote controller cable	33 ft (10 m)	For connecting the remote controller
 Screw	2	For installing the remote controller
 Cable tie	1	For remote controller and remote controller cable binding
 Installation manual	1	
 Operation manual	1	

## Overview

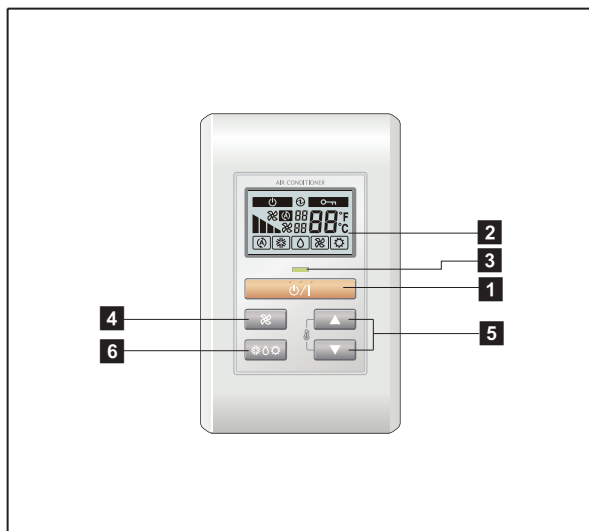

Display panel

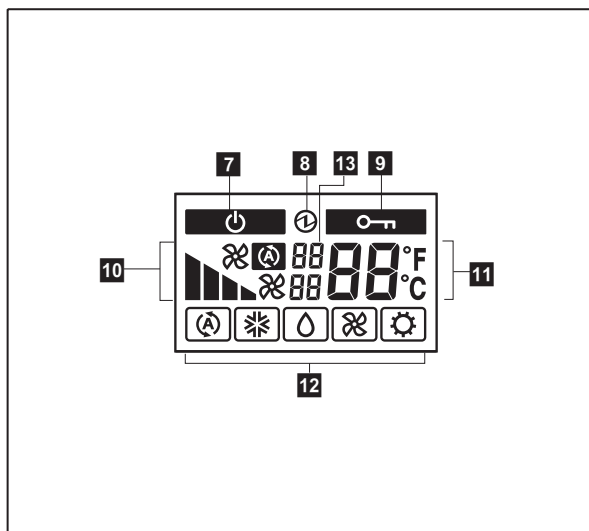

### 1 START/STOP button

Starts and stops operation.






### 2 Display backlight button

Lights during operation.

### 3 Operation lamp

Lights during operation.






### 4 FAN button

Selects the fan speed (AUTO , HIGH , MED , LOW , and QUIET .

### 5 SET TEMP. button

Selects the setting temperature.

### 6 MODE button

Selects the operating mode (AUTO , COOL , DRY , FAN , HEAT .

### 7 Standby indicator

Indicates during the oil recovery and defrosting operation.

### 8 Power source indicator

Indicates the main power is on.

### 9 Central control indicator

Indicates when function is locked.

### 10 Fan speed indicator

Deletes the weekly timer schedule.

### 11 Set temperature

- Indicates error history number in error code history display mode.
- Indicates indoor unit address in address display mode.


### 12 Operating mode indicator

### 13 Indicator


- Upper:
  - Indicates the error code in error code history display mode and in self diagnosis mode.
  - Indicates the refrigerant system address in address display mode.
- Lower: Indicates the remote controller address in error code history display mode, address display mode, and self diagnosis mode.

## System diagram

### 1 remote controller:

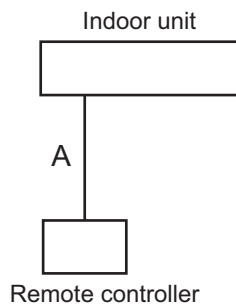


### 2 remote controllers:

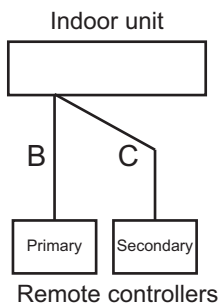

A, B, C: Remote controller cable  
 $A \leq 1,640 \text{ ft (500 m)}$ ;  $B + C \leq 1,640 \text{ ft (500 m)}$


## Electrical wiring

### 1 remote controller:

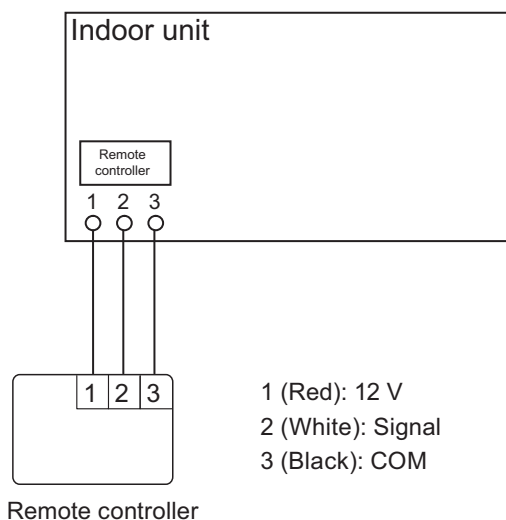

1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM


### 2 remote controllers:

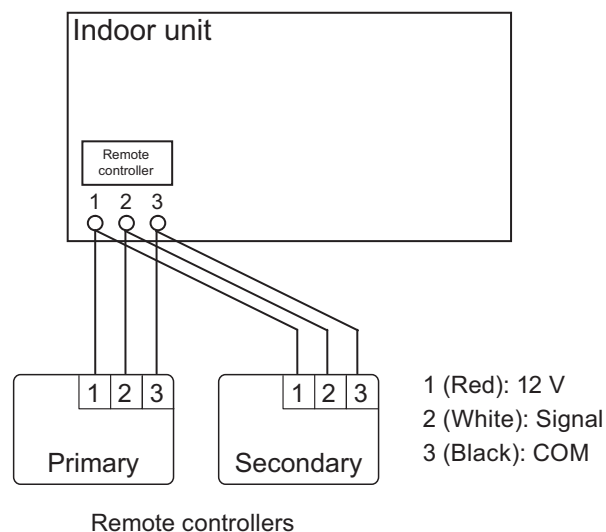


1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM

## Dimensions


Unit: in (mm)

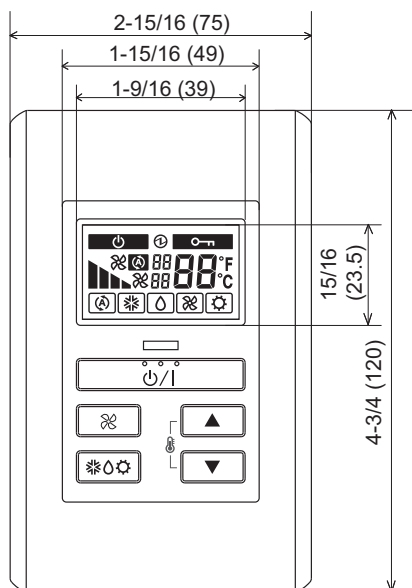

Front View

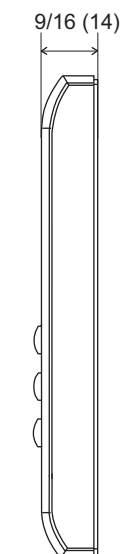

Side View

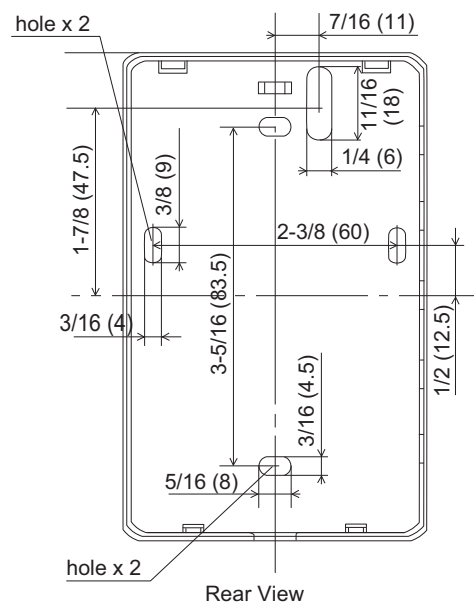

## ■ Installation


### • Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

### • Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

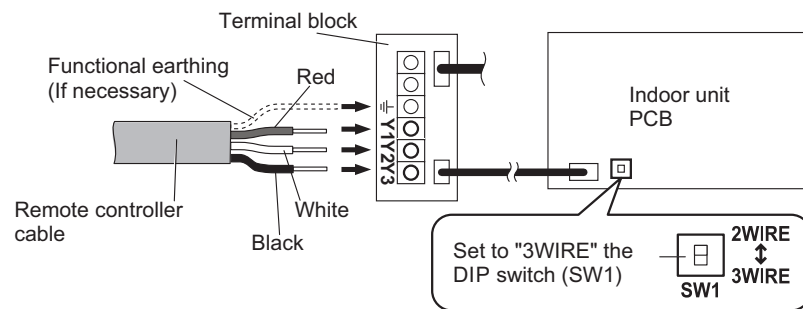


### NOTES:

- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.




## • Pattern B


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

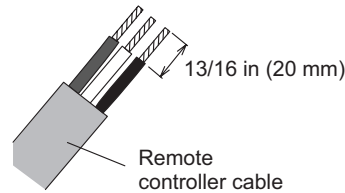


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

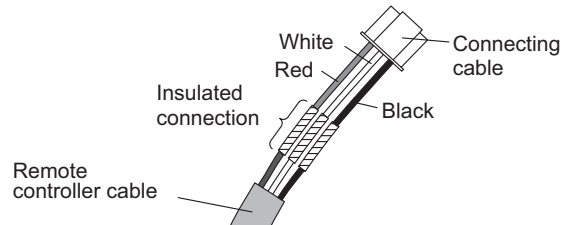

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

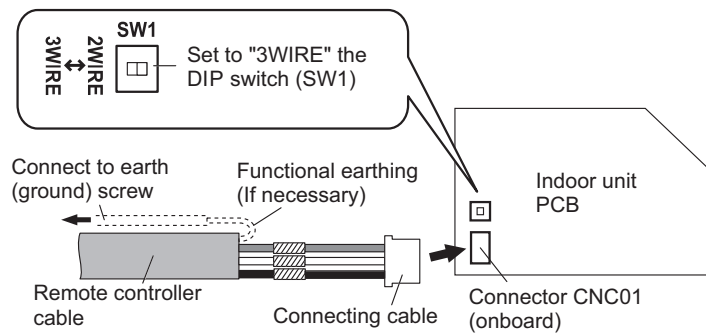

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

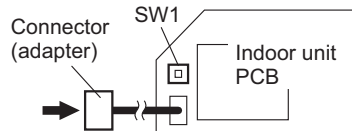

## ■ Specifications

Dimensions (H × W × D)	in (mm)	4-3/4 × 2-15/16 × 9/16 (120 × 75 × 14)
Weight	oz (g)	3 (90)

## ● Wiring specifications






Use	Cable size	Wire type	Remarks
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3-core	Use sheathed PVC cable.

## 2-9. Simple remote controller (Without operation mode: UTY-RHRY)




- Easy operation
- Stylish design
- Large LCD screen and simple operation buttons
- Built-in background light function
- Easy installation with a slim shape with no bulge in the back.
- Up to 16 indoor units can be simultaneously controlled.
- Can be installed onto SW-BOX. (applies European and other country's standard)


### ■ Accessory

Name and shape	Q'ty	Application
 CD-ROM	1	
 Screw	2	For installing the remote controller
 Cable tie	1	For remote controller and remote controller cable binding
 Installation manual	1	
 Operation manual	1	

## Overview

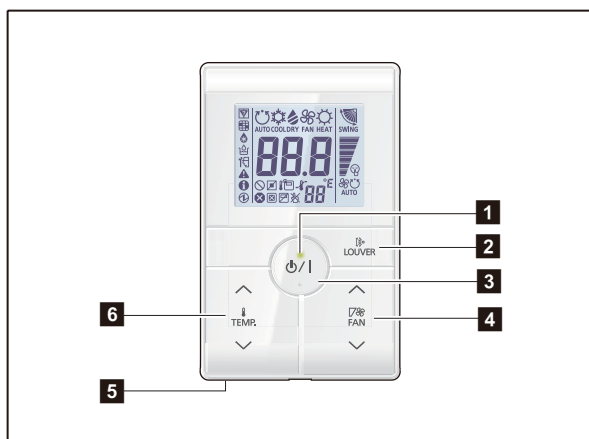

Display panel

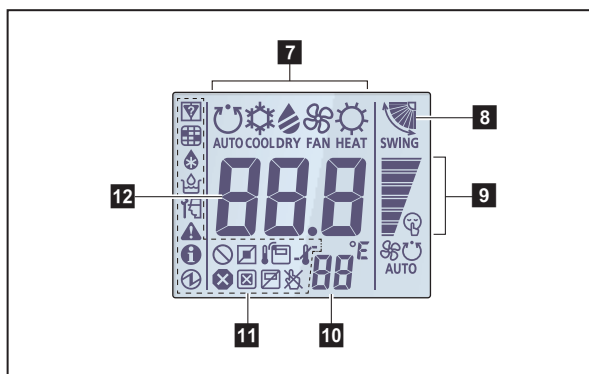

\*1: Not available for a heat pump model unless it is set up as an administrative indoor unit.

\*2: Not available for a heat pump model.

\*3: Not available for a cooling-only model.

\*4: Set the function setting of the indoor unit accordingly.

\*5: During address display mode.

### 1 LED lamp

Lights during operation.

### 2 Louver button


Adjusts the airflow direction.

### 3 START/STOP button

Starts and stops operation.

### 4 FAN control button

Switches the fan speed as follows:

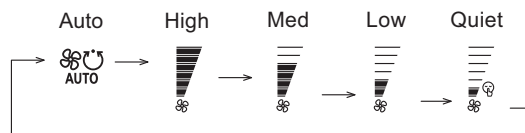

### 5 Room temperature sensor (inside)

Senses ambient temperature of unit.

### 6 Set temperature button

Selects the setting temperature.

64.4—86 °F (18—30 °C) [COOL], 50—86 °F (10—30 °C) [HEAT]

### 7 Operating mode indicator

### 8 Airflow direction indicator

### 9 FAN speed indicator

### 10 Remote controller address indicator

### 11 Status icons

Mode mismatch

Filter sign \*4

Defrost operation

Oil recovery operation

Under maintenance

Error

Special state

Conducting electricity

Emergency stop

Operation controlled

Forced stop

Remote controller sensor is enabled \*4

Central controlled

Setting temperature range is enabled


Operation prohibited

### 12 Set temperature


Indicates indoor unit address. \*5

## ■ System diagrams

- 1 remote controller



- 4 remote controllers

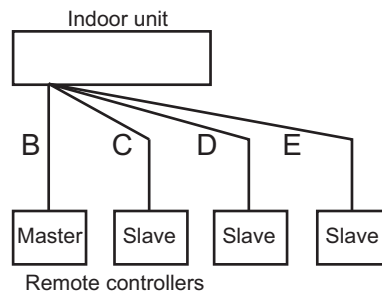


### NOTES:


- A, B, C, D, E: Remote controller cable (For details of controller cable specifications, refer to ["Controller cable"](#) in Chapter 6. SYSTEM DESIGN on page 06-84.)
- $A \leq 1,640 \text{ ft (500 m)}$ ,  $B + C + D + E \leq 1,640 \text{ ft (500 m)}$

## ■ Electrical wiring


### 1 remote controller:

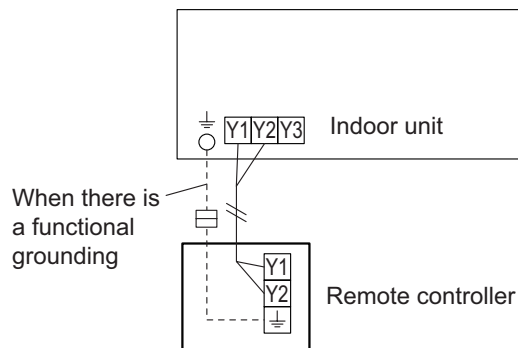

### 2 remote controllers:

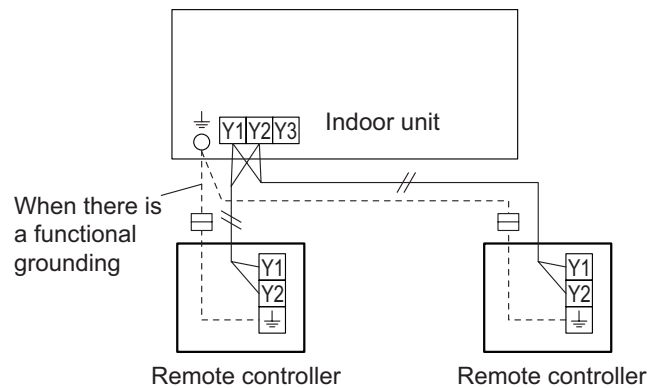


### Group control:

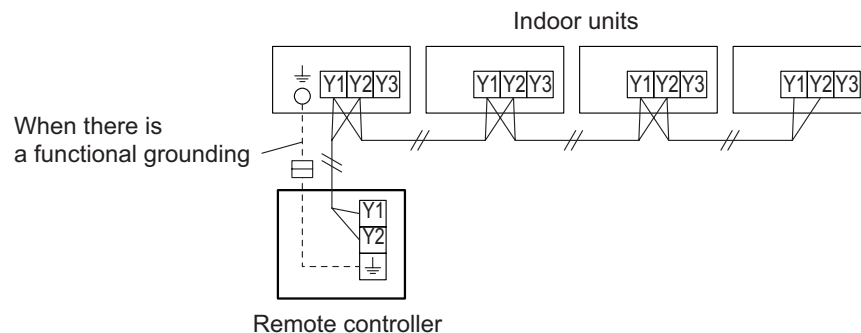

## ■ Dimensions

Unit: in (mm)

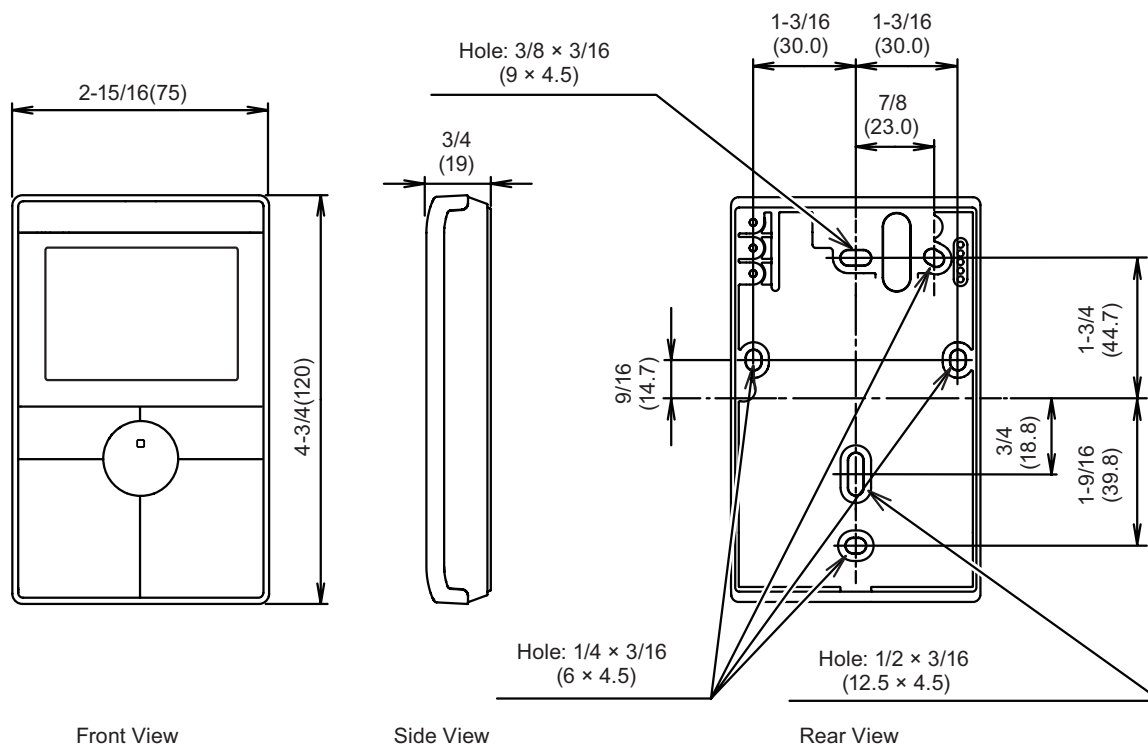

## ■ Installation


### • Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

### • Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

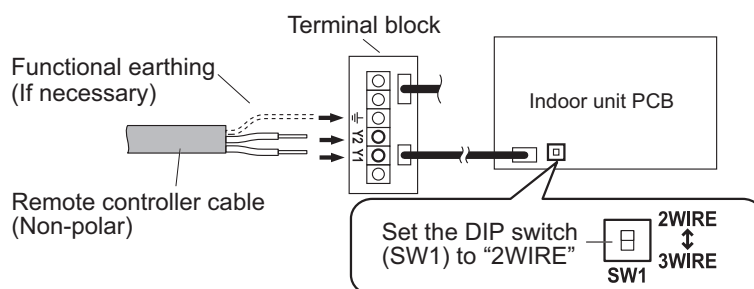


### NOTES:


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

## ● Pattern B


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

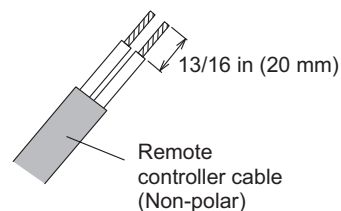


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

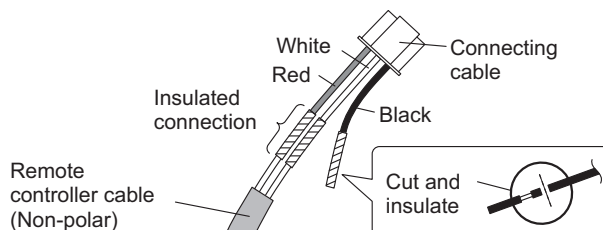

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

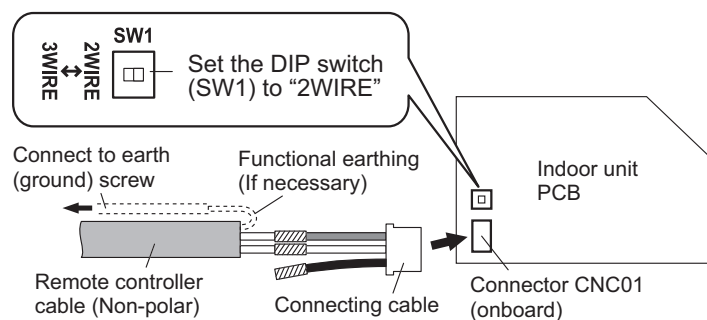

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

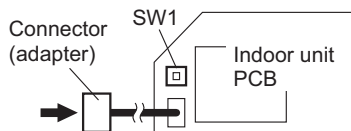

## ■ Specifications

Dimensions (H × W × D)	in (mm)	4-3/4 × 2-15/16 × 3/4 (120 × 75 × 19)
Weight	oz (g)	4 (120)

## ● Wiring specifications

Use	Cable size	Cable type	Remarks
Remote controller cable	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Sheathed cable	Non polar 2-core, Twisted pair
		Shielded cable*	






\*: Use shielded cable in accordance with local rules for remote controller cable.

## 2-10. Simple remote controller (Without operation mode: UTY-RHKU)




- Easy operation
- Built-in background light function
- Easy installation with a slim shape with no bulge in the back.
- Error history (Last 16 error codes can be accessed.)
- Up to 16 indoor units can be simultaneously controlled.
- Can be installed onto SW-BOX. (applies European and other country's standard)
- Concentrates on the basic operations such as Start/Stop, Fan control, and Temperature setting.


### ■ Accessory

Name and shape	Q'ty	Application
 Remote controller cable	33 ft (10 m)	For connecting the remote controller
 Screw	2	For installing the remote controller
 Cable tie	1	For remote controller and remote controller cable binding
 Installation manual	1	
 Operation manual	1	

## Overview

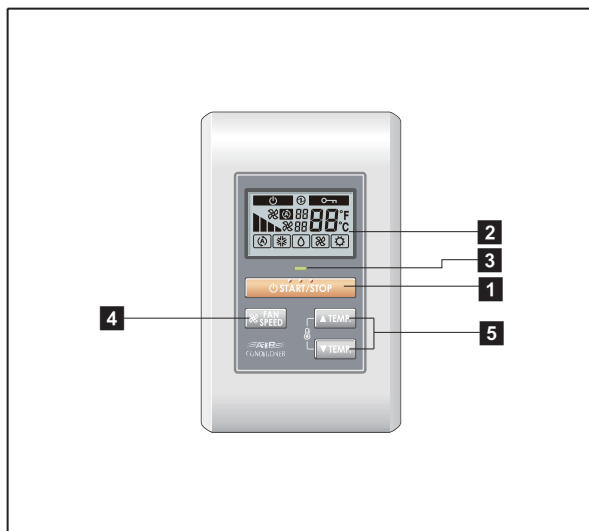

Display panel

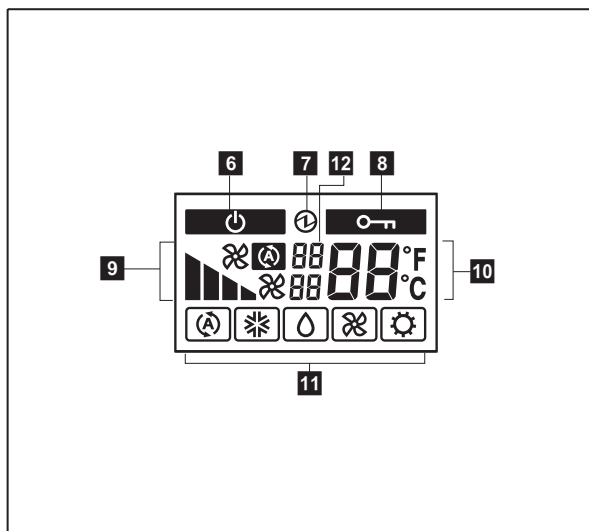

### 1 START/STOP button

Starts and stops operation.






### 2 Display backlight button

Lights during operation.

### 3 Operation lamp

Lights during operation.

### 4 FAN button

Selects the fan speed (AUTO , HIGH , MED , LOW , and QUIET )

### 5 SET TEMP. button

Selects the setting temperature.

### 6 Standby indicator

Indicates during the oil recovery and defrosting operation.

### 7 Power source indicator

Indicates the main power is on.

### 8 Central control indicator

Indicates when function is locked.

### 9 Fan speed indicator

Deletes the weekly timer schedule.

### 10 Set temperature

- Indicates error history number in error code history display mode.
- Indicates indoor unit address in address display mode.

### 11 Operating mode indicator


### 12 Indicator

- Upper:
  - Indicates the error code in error code history display mode and in self diagnosis mode.
  - Indicates the refrigerant system address in address display mode.
- Lower: Indicates the remote controller address in error code history display mode, address display mode, and self diagnosis mode.




## System diagram

### 1 remote controller:

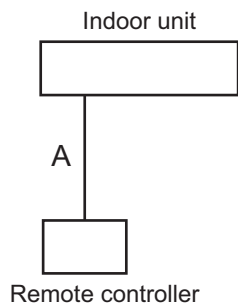


### 2 remote controllers:

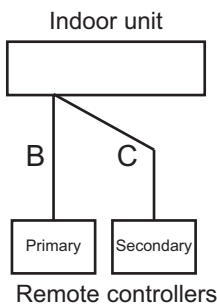

A, B, C: Remote controller cable  
 $A \leq 1,640 \text{ ft (500 m)}$ ;  $B + C \leq 1,640 \text{ ft (500 m)}$


## Electrical wiring

### 1 remote controller:

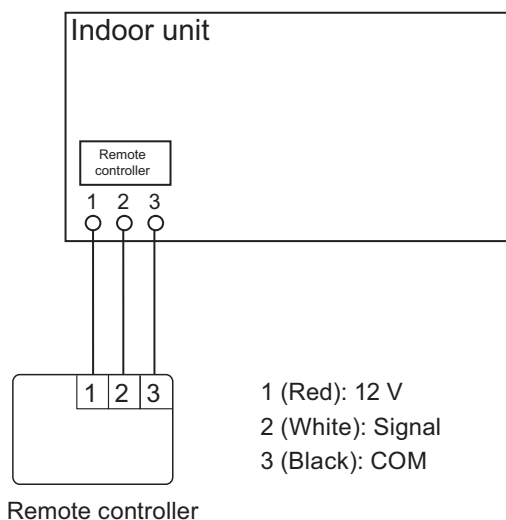

1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM


### 2 remote controllers:

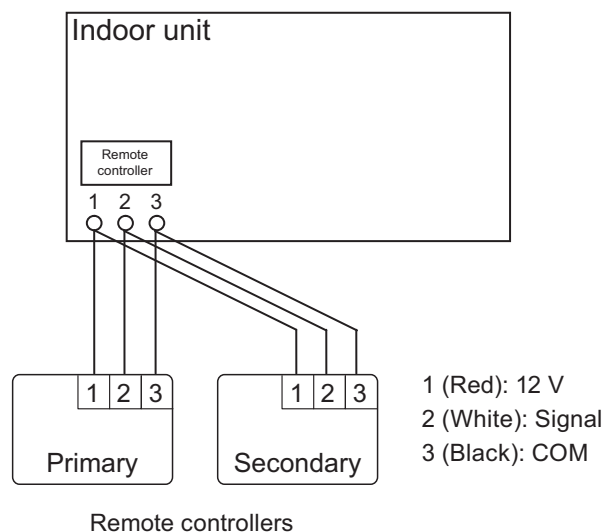


1 (Red): 12 V  
 2 (White): Signal  
 3 (Black): COM

## Dimensions


Unit: in (mm)

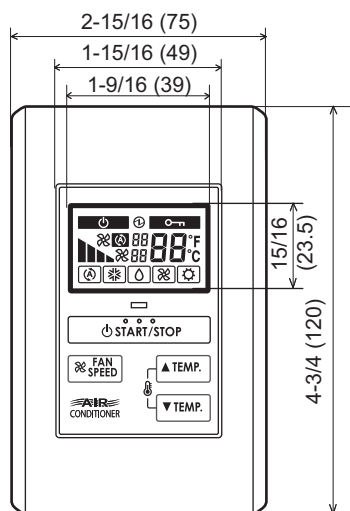

Front View



Side View

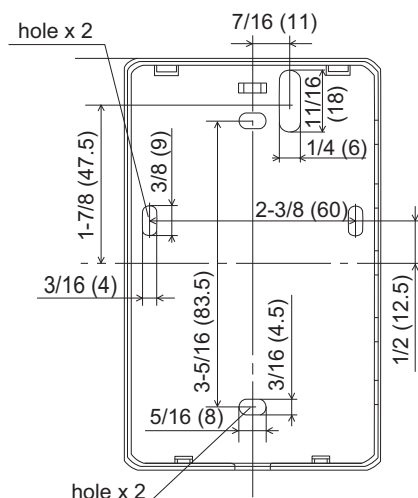

Rear View

## ■ Installation


### • Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

### • Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

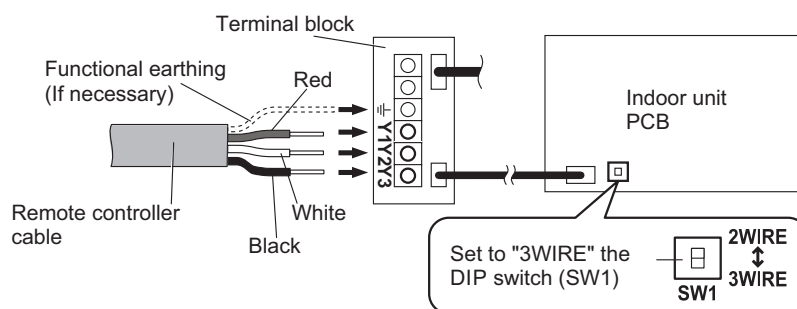


### NOTES:


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

## • Pattern B


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

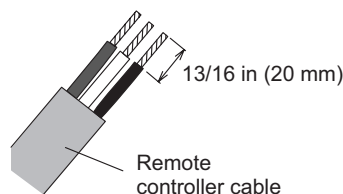


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

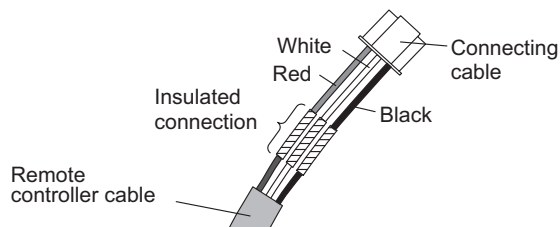

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

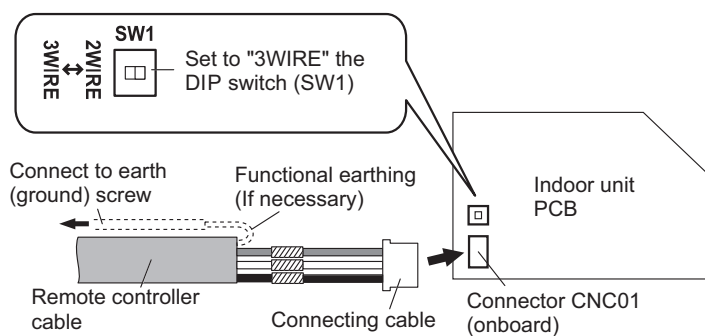

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

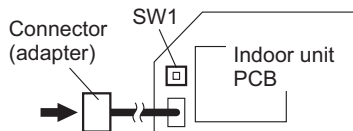

## ■ Specifications

Dimensions (H × W × D)	in (mm)	4-3/4 × 2-15/16 × 9/16 (120 × 75 × 14)
Weight	oz (g)	3 (90)

## ● Wiring specifications






Use	Cable size	Wire type	Remarks
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3-core	Use sheathed PVC cable.

2-11. Wireless remote controller (UTY-LNHU)




- 4 mode time setup available (On/Off/Program/Sleep).
- Up to 16 indoor units connected within the remote controller group can be simultaneously controlled.
- Can be used jointly with wired remote controllers.
- Easy to change custom code (max 4 codes)


■ Accessory

Name and shape	Q'ty	Application
 Screw	2	For installing the remote controller
 Battery (1.5 V [R03/AAA])	2	For remote controller
 Remote controller holder	1	For remote controller
 Installation manual	1	
 Operation manual	1	

## Overview

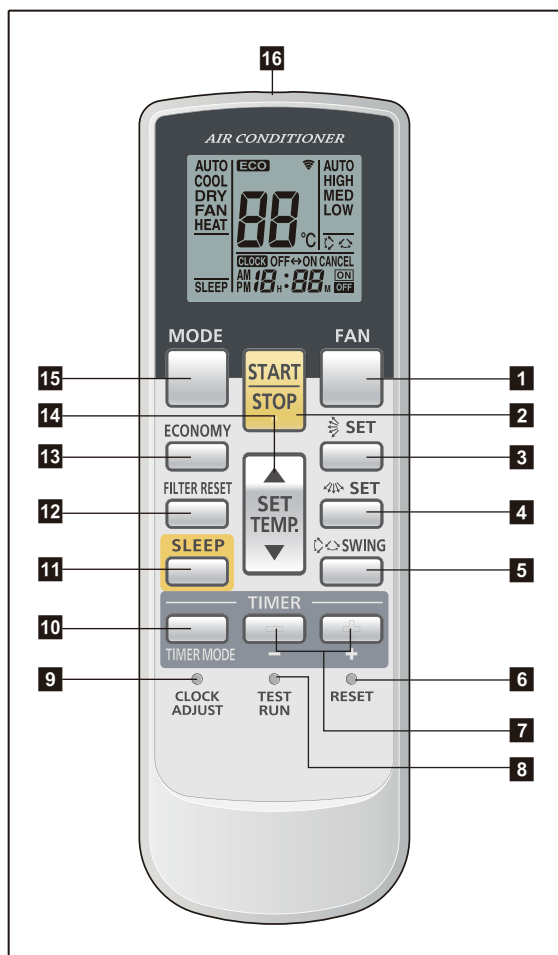

Display panel

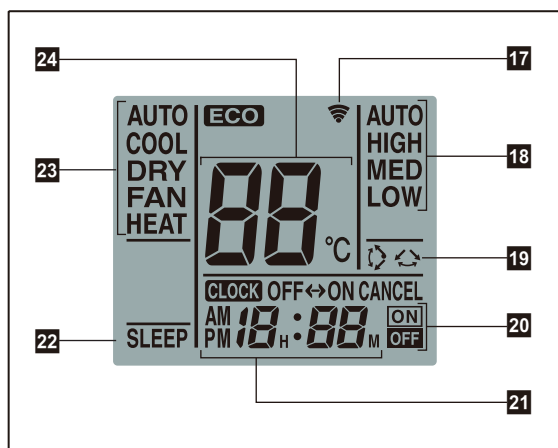

**NOTE:** Functions may differ by type of the indoor unit. For details, refer to the operation manual.

### 1 FAN button

Selects the fan speed (AUTO, HIGH, MED, and LOW).

### 2 START/STOP button

Starts and stops operation.

### 3 SET button (vertical)

Adjusts the vertical airflow direction.

### 4 SET button (horizontal)

Adjusts the horizontal airflow direction.

### 5 SWING button

Sets the automatic swing operation and selects swing mode (Up/down, Left/right, Up/down/left/right, and Stop swing).

### 6 RESET button

Used when replacing batteries.

### 7 Timer set (- / +) button

Sets the current time and on-off time.

### 8 TEST RUN button

Only used for the initial test in the unit installation.

### 9 CLOCK ADJUST button

Used for adjusting the clock.

### 10 TIMER MODE button

Selects the timer mode (off timer, on timer, program timer, and timer reset).

### 11 SLEEP button

Pressed to select sleep timer.

### 12 FILTER RESET button

### 13 ECONOMY button

### 14 SET TEMP. (temperature) (▲ / ▼) button

- Sets desired temperature.
- Sets remote controller custom code.

### 15 MODE button

- Switches operation mode (AUTO, COOL, DRY, FAN, and HEAT).
- Starts/ends the remote controller custom code (max. 4 types) change.

### 16 Signal transmitter

### 17 Signal transmit indicator

### 18 Fan speed indicator

### 19 Swing indicator

### 20 Timer mode indicator


### 21 Clock indicator

### 22 Sleep indicator

### 23 Operating mode indicator

### 24 Temperature indicator

## ■ System diagrams

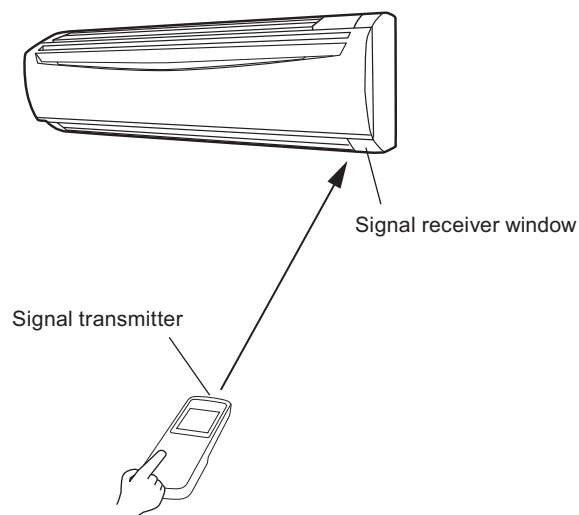


- Control signal might not be recognized in following cases:
  - A curtain or wall, etc. exists between transmitter and receiver.
  - There is an instant-start type (inverter type, etc.) fluorescent lamp in the room.
- Air conditioner might not work correctly when strong light hits the signal receiver window. Shut off the direct sunlight and also make illuminator far away from the signal receiver window.


■ Dimensions

Unit: in (mm)

• Controller

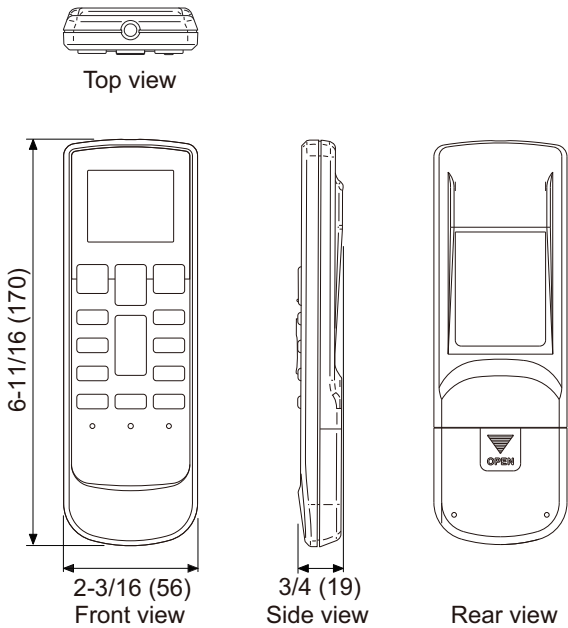

• Holder

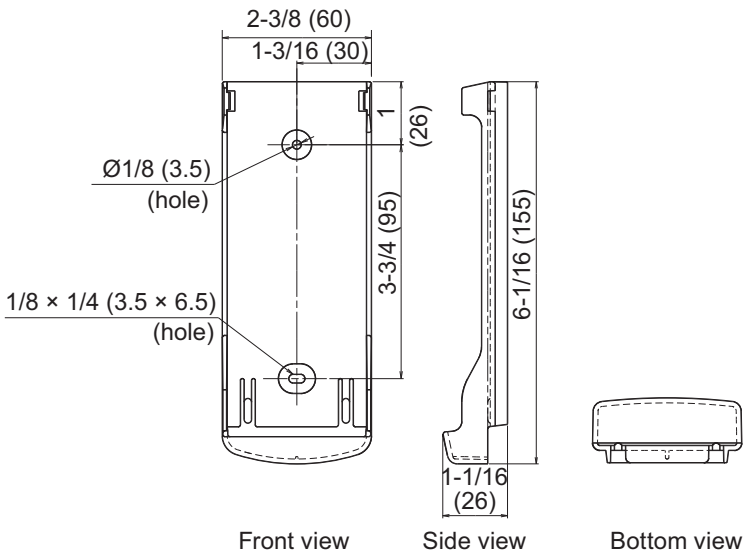

■ Specifications













Dimensions (H × W × D)	in (mm)	6-11/16 × 2-3/16 × 3/4 (170 × 56 × 19)
Weight (without batteries)	oz (g)	3 (85)

## 2-12. IR receiver unit (UTB-YWC)




Duct type indoor unit can be controlled with Wireless remote controller if the IR receiver unit is used.

### ■ Accessory

Name and shape	Q'ty	Application
 Cover	1	For receiver unit
 Insulation	1	For receiver unit
 Cable tie	Small: 1 Medium: 1	For receiver unit
 Screw (M4 × 10 mm)	2	For attaching the hook metal to the indoor unit
 Screw (M4 × 12 mm)	1	For attaching the hook metal to holder cover
 Screw (M4 × 20 mm)	2	For installing receiver unit to wall, etc.
 Connection cable A (16 ft [5 m])	1	For connecting PCB of indoor unit to receiver unit
 Connection cable B (5-7/8 in [0.15 m])	1	
 Connection cable D (5-7/8 in [0.15 m])	1	For connecting PCB of indoor unit to receiver unit
 Hook metal	1	For installing receiver unit to indoor unit
 Bracket (cover)	1	For receiver unit
 Installation manual	1	




## Overview

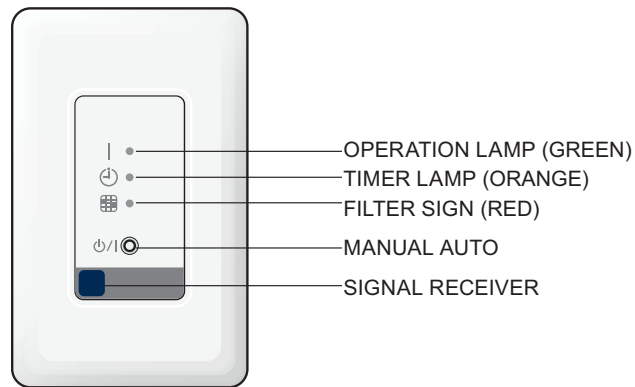

## System diagrams


### Attachment range

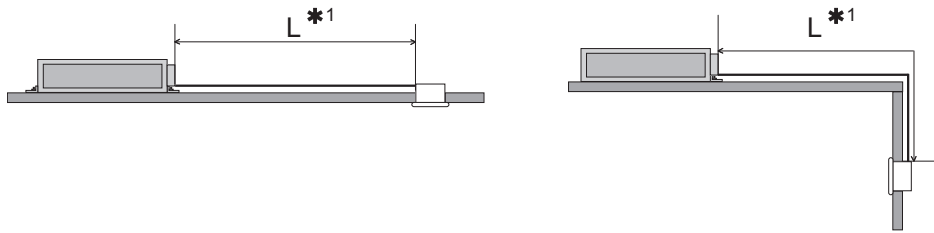


\*1: Connection cable length L

- Cable A (Standard accessory): 16 ft (5 m)
- Cable C (Optional service part): 33 ft (10 m)

### Signal angle

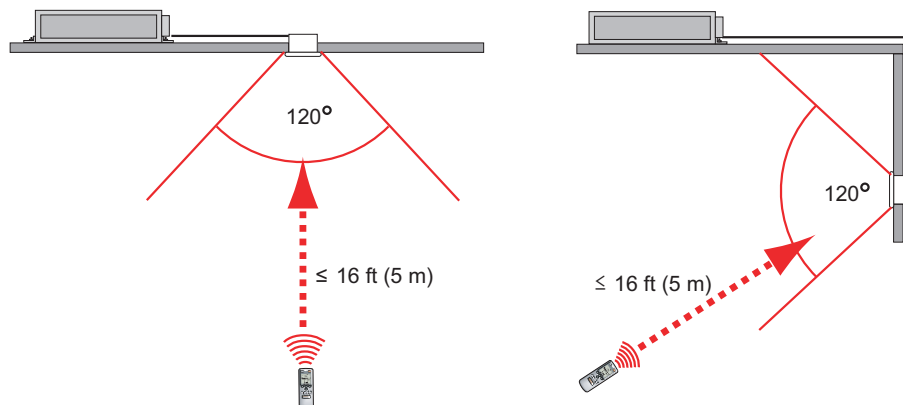


## Electrical wiring

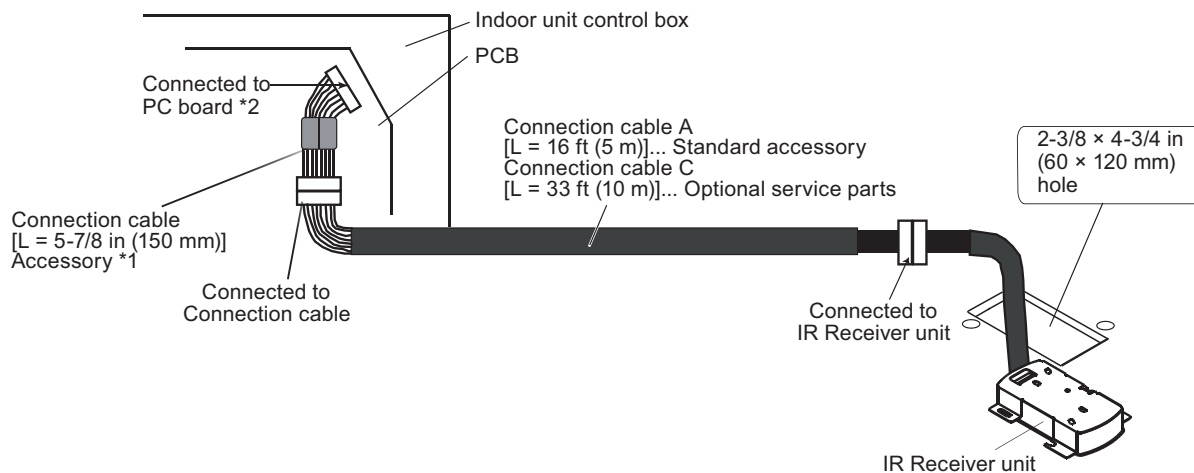

*1:	Connection cable	Connection cable D
*2:	Connected to PCB	CN18

## Dimensions

Unit: in (mm)

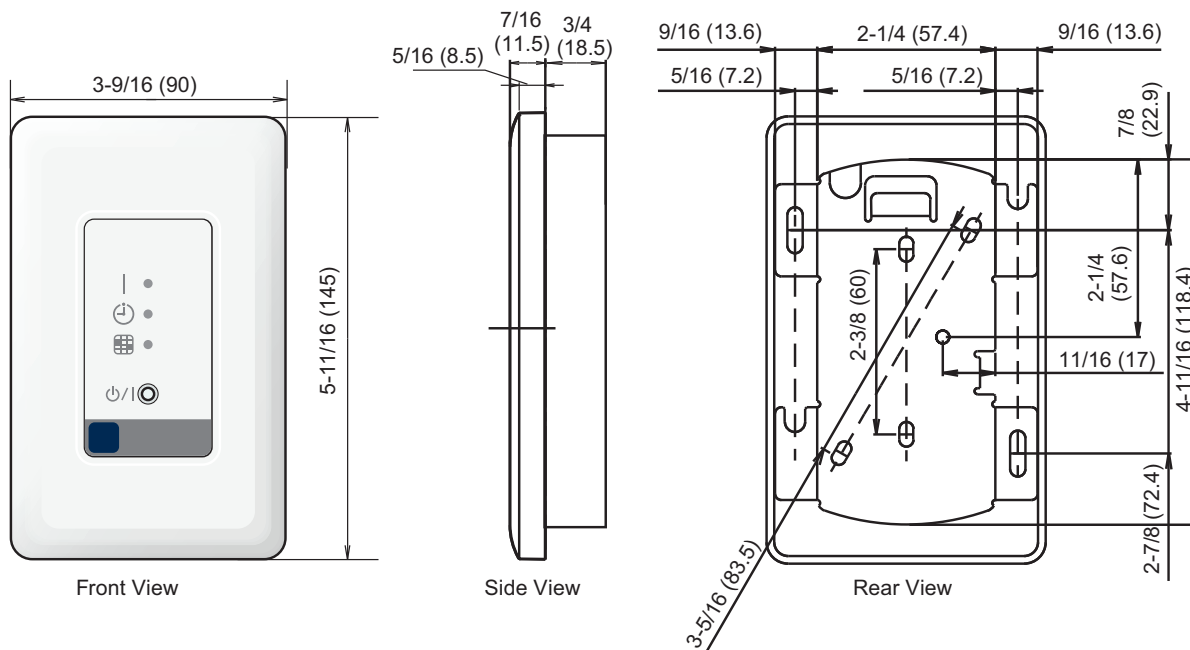

## Specifications

Dimensions (H × W × D)	in (mm)	5-11/16 × 3-9/16 × 1-3/16 (145 × 90 × 30)
Weight	oz (g)	5 (150)

## Optional service part

Use the parts number shown below to order the cable from your representative.

Use the shield type connection cable in accordance with standard of your country.












Name and shape	Type	Parts No.
 Connection cable C 33 ft (10 m)	Non-Shielded	9378143012
	Shielded	9378143036

## 2-13. IR receiver unit (UTY-TRHX)




3D flow cassette type and Duct type indoor unit can be controlled with Wireless remote controller if the IR receiver unit is used.

### ■ Accessory


Name and shape	Q'ty	Application
 Cover	1	For receiver unit
 Insulation	1	For receiver unit
 Cable tie	Small: 1 Medium: 1	For receiver unit
 Screw (M4 × 10 mm)	2	For attaching the hook metal to the indoor unit
 Screw (M4 × 12 mm)	1	For attaching the hook metal to holder cover
 Screw (M4 × 20 mm)	2	For installing receiver unit to wall, etc.
 Connection cable A (16 ft [5 m])	1	For connecting PCB of indoor unit to receiver unit
 Connection cable B (7-7/8 in [0.12 m])	1	
 Hook metal	1	For installing receiver unit to indoor unit
 Bracket (cover)	1	For receiver unit
 Installation manual	1	

## Overview

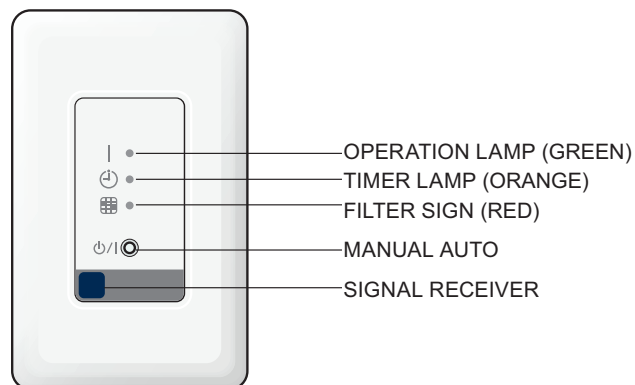

## System diagrams


### Attachment range

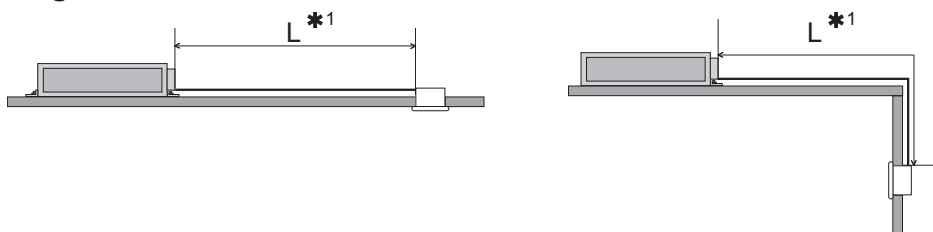


\*1: Connection cable length L

- Cable A (Standard accessory): 16 ft (5 m)
- Cable C (Optional service part): 33 ft (10 m)

### Signal angle

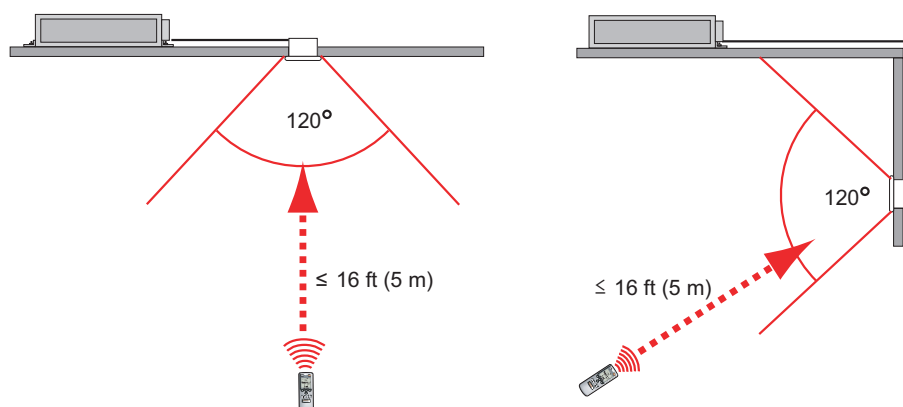

## Electrical wiring

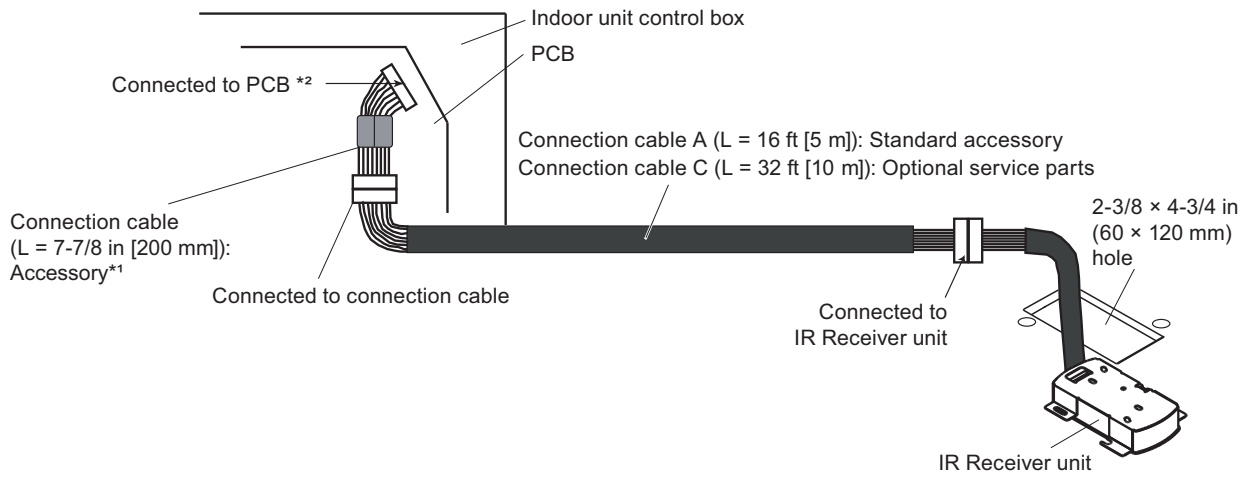


\*1: Connection cable

Connection cable B

\*2: Connected to PCB

CN48

## Dimensions

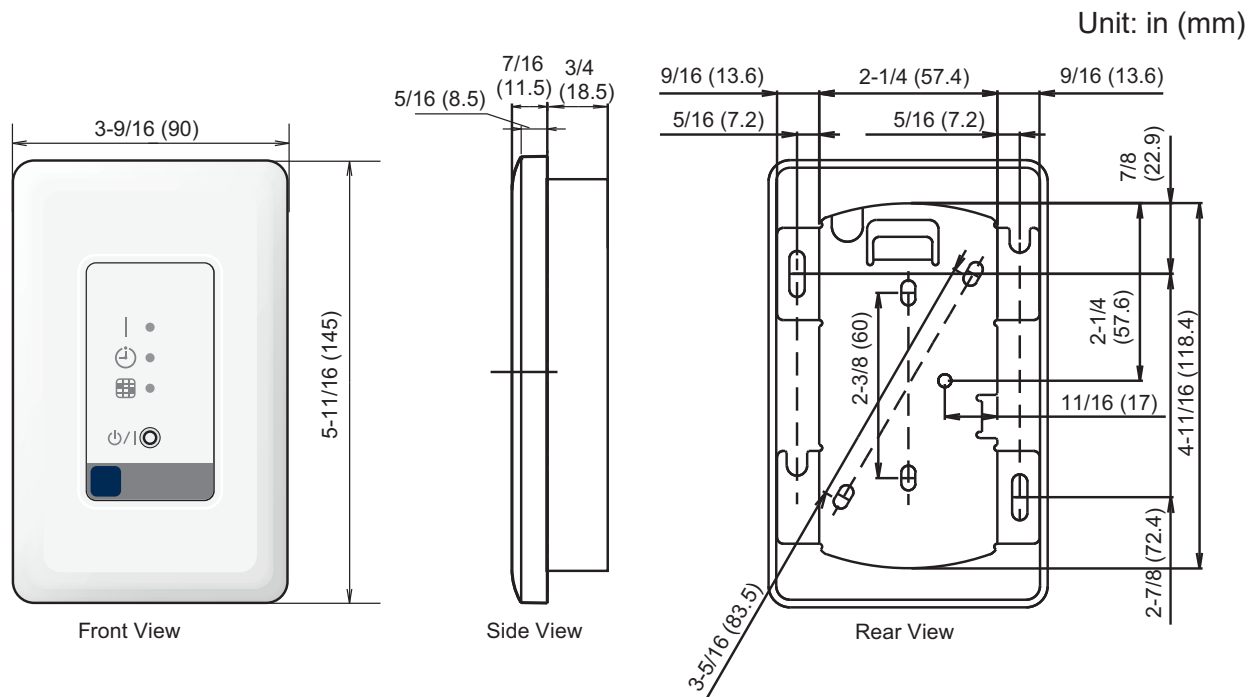


## Specifications

Dimensions (H × W × D)	in (mm)	5-11/16 × 3-9/16 × 1-3/16 (145 × 90 × 30)
Weight	oz (g)	5 (150)

## Optional service part

Use the parts number shown below to order the cable from your representative.

Use the shield type connection cable in accordance with standard of your country.

Name and shape	Application	Parts No.
 IR receiver unit cable C 33 ft (10 m)	For extending the IR receiver unit cable	9710358012



**NOTE:** This part cannot be used for 3D flow cassette type.

## 2-14. IR receiver unit (For cassette type: UTY-LRHYB1)




Cassette type indoor unit can be controlled with Wireless remote controller if the IR receiver unit is used.


### ■ Accessory

Name and shape	Q'ty	Application
 Strap	1	For preventing receiver from falling down
 Installation manual	1	

### ■ Overview

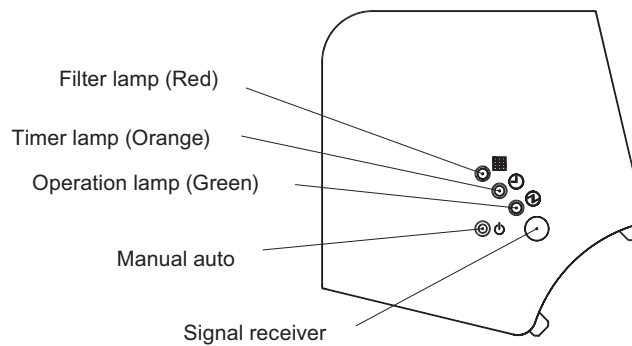


## ■ Electrical wiring

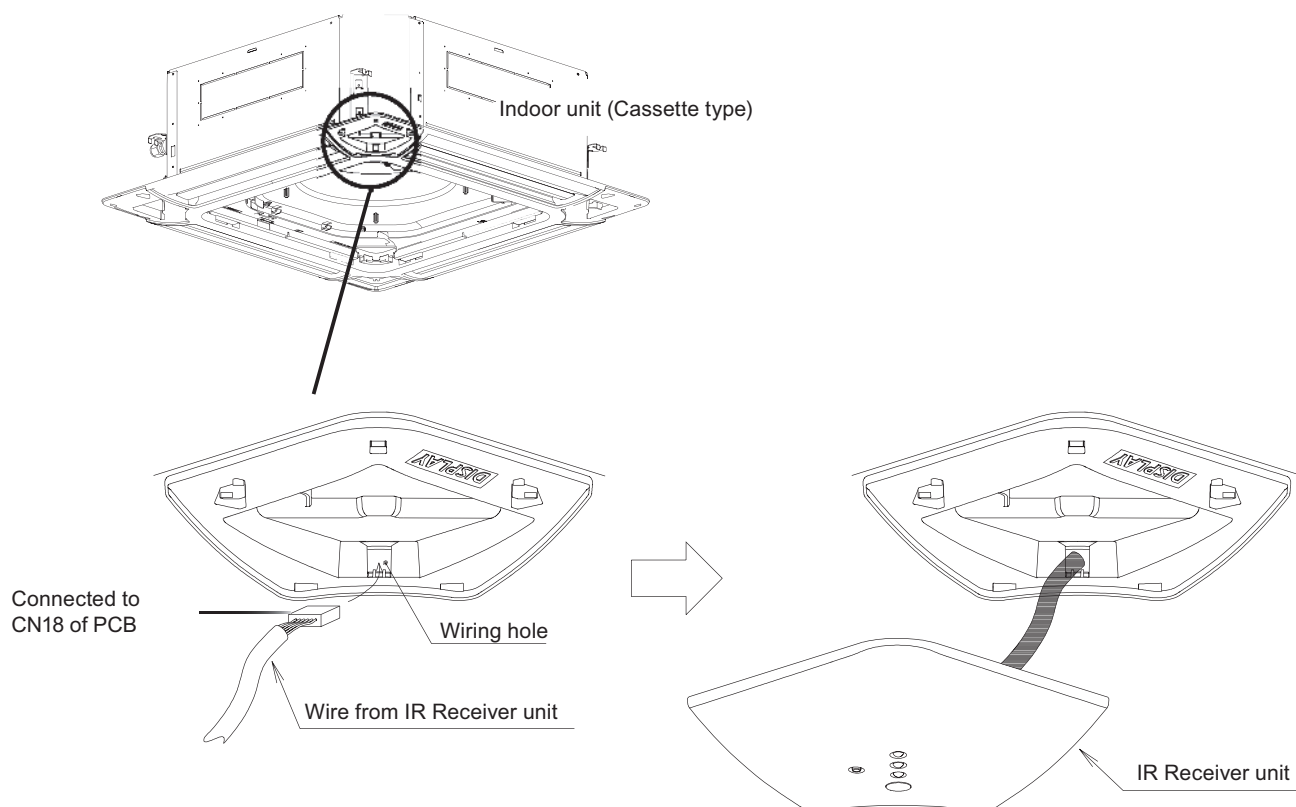

## ■ Dimensions

Unit: in (mm)

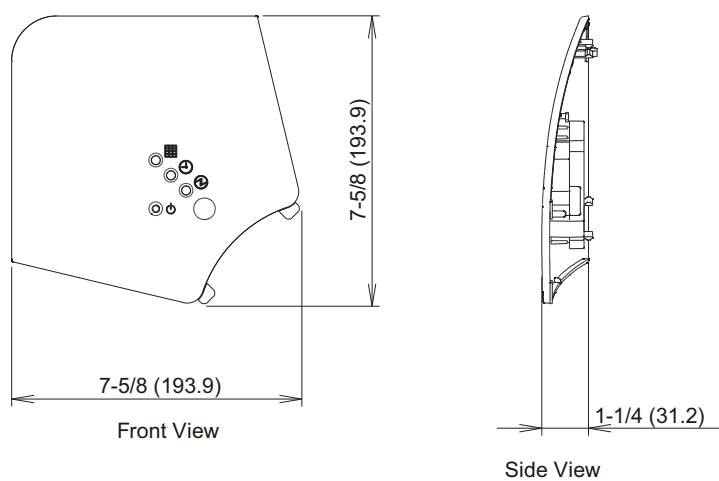

## ■ Specifications




Dimensions (H × W × D)	in (mm)	7-5/8 × 7-5/8 × 1-1/4 (193.9 × 193.9 × 31.2)
Weight	oz (g)	5 (140)

## 2-15. IR receiver unit (For circular flow cassette type: UTY-LBHXD)




Cassette type indoor unit can be controlled with Wireless remote controller if the IR receiver unit is used.



### ■ Accessory

Name and shape	Q'ty	Application
 Strap	1	For preventing receiver from falling down
 Cable tie	2	For electrical wiring
 Installation manual	1	

### ■ Overview

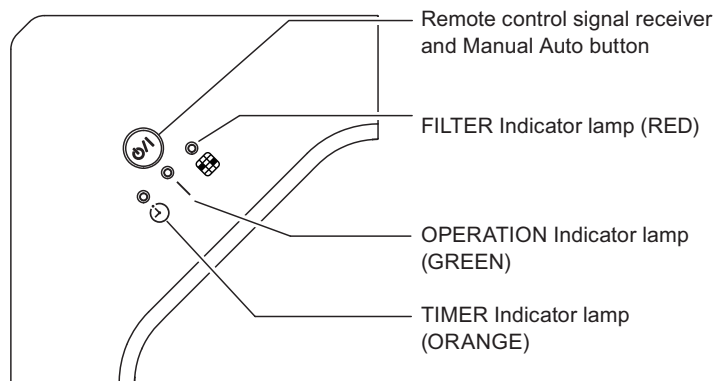


### ■ Electrical wiring

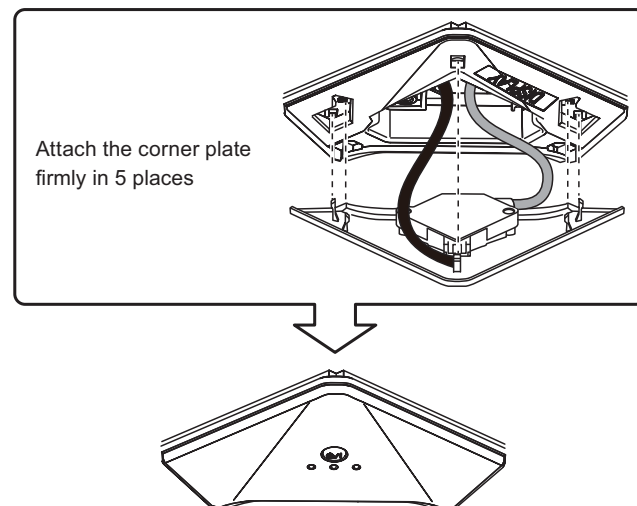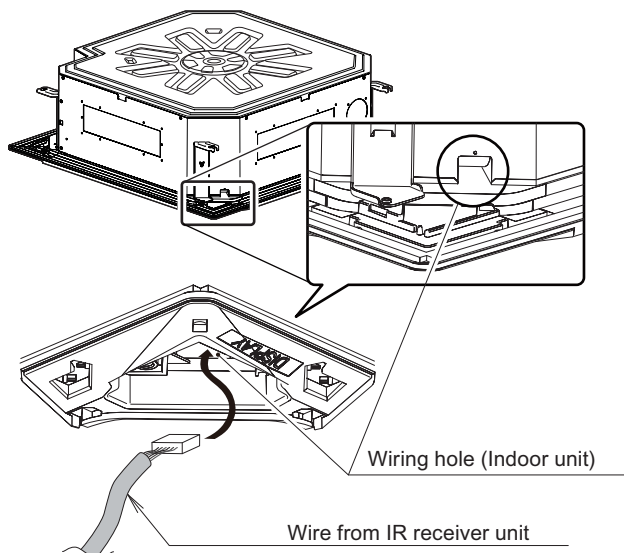




■ Dimensions

Unit: in (mm)

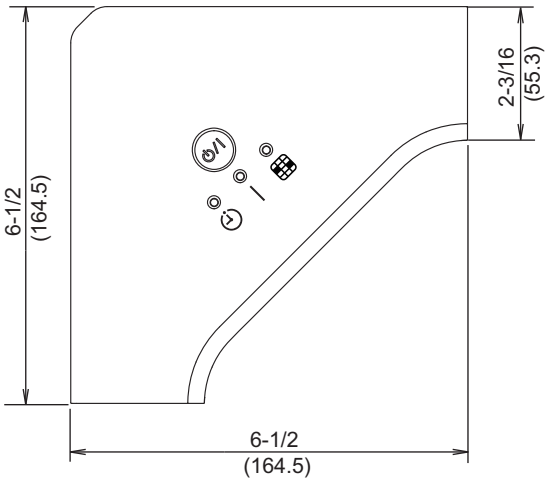

Front View



Side View

■ Specifications

Dimensions (H × W × D)	in (mm)	6-1/2 × 6-1/2 × 7/8 (164.5 × 164.5 × 22.6)
Weight	oz (g)	4 (110)

CONTROL  
SYSTEM






CONTROL  
SYSTEM

## 2-16. Human sensor kit (For circular flow cassette type: UTY-SHZXC)




Motion sensor save operation catches the movements of people for wide area and operation stop is also judged automatically.


### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	3	For binding wires
 Strap	1	For preventing human sensor from falling down
 Insulation	3	To fasten the human sensor wire
 Installation manual	1	
 Operation manual	1	

## ■ Electrical wiring

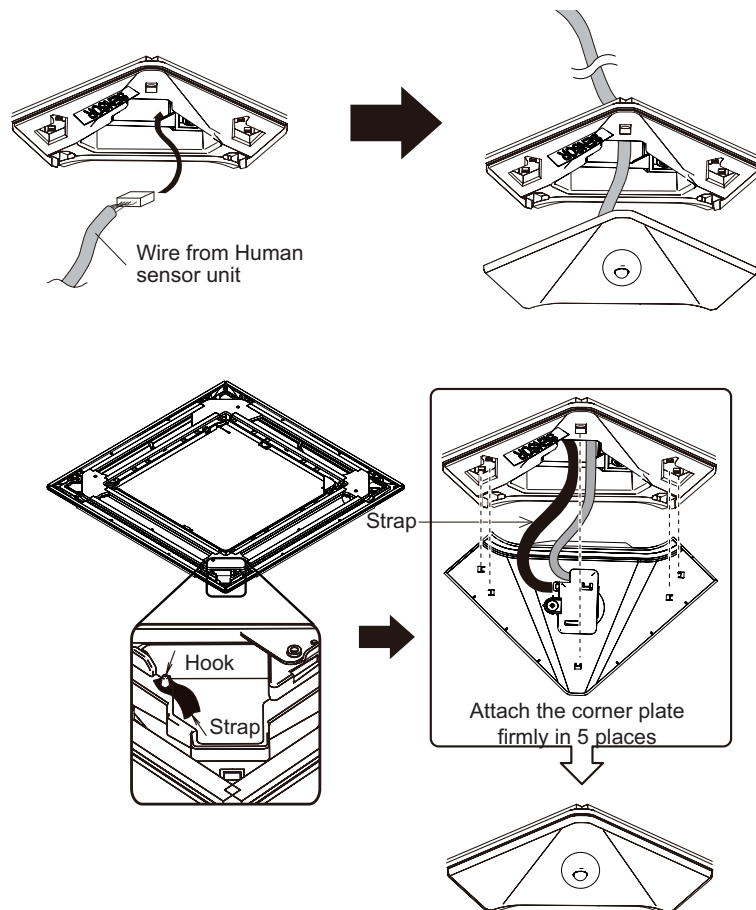

## ■ Dimensions

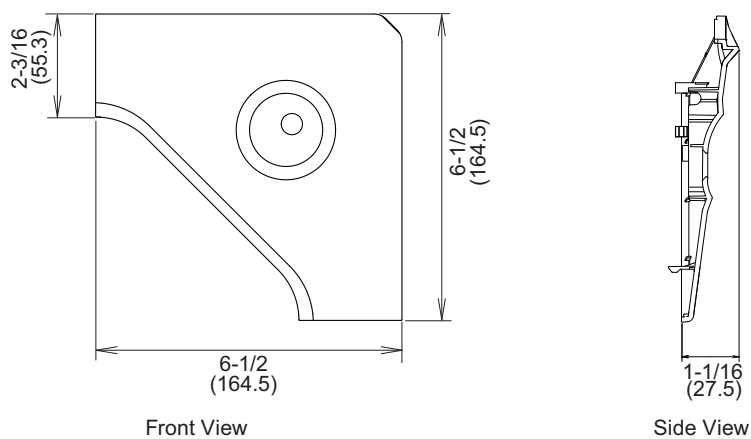

Unit: in (mm)

## ■ Specifications






Dimensions (H × W × D)	in (mm)	6-1/2 × 6-1/2 × 1-1/16 (164.5 × 164.5 × 27.5)
Weight	oz (g)	4 (110)

## 2-17. Remote sensor unit (UTY-XSZX)




The remote sensor unit allows for flexible temperature sensing for optimum temperature control.

### ■ Accessory

Name and shape	Q'ty	Name and shape	Q'ty
 Cable (33 ft [10 m])	1	 Installation manual	1
 Screw (M4 × 10 mm)	2	 Cord clamp	1
 Screw (M4 × 16 mm)	2		


### ■ Electrical wiring

- Remove the screws from the remote sensor unit, and remove the cover.
- Connect the cable to the remote sensor unit as shown below.
- Ensure that the wires do not contact each other.

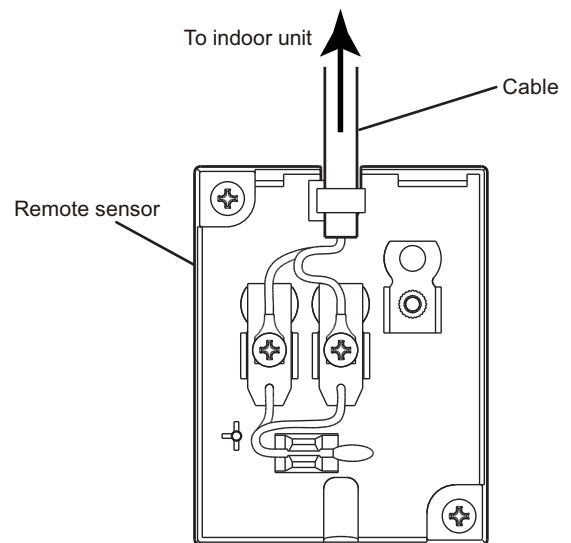

### ■ Dimensions

Unit: in (mm)

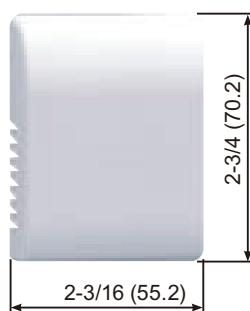


## ■ Installation

Unit: in (mm)

- **When the cable is attached to the wall:**


- Remove the material covering the wiring penetration (thin material) in the cover of the sensor unit with a pair of cutters. The cable passes through this hole.
- Attach the remote sensor unit on the wall using the screws.

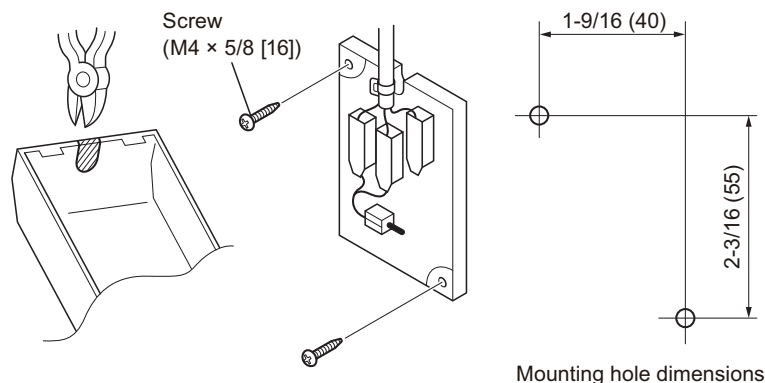

- Fit the cover on the remote sensor unit and screw it in place.

- **When the cable is buried in the wall:**

- Remove the material (thinner than the surrounding material) in the wiring hole on the remote sensor unit using a pair of cutters.
- Drill a hole in the wall for the cable.
- Seal the area around the cable penetration with putty.

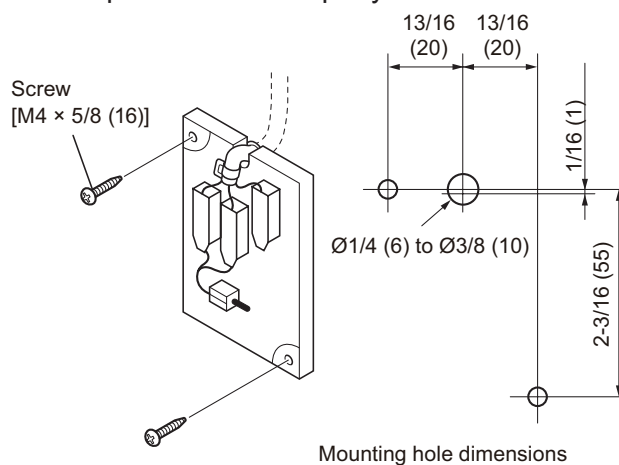

- Fit the cover on the remote sensor unit and screw it in place.

## ■ Specifications







Dimensions (H × W × D)	in (mm)	2-3/4 × 2-3/16 × 11/16 (70.2 × 55.2 × 18)
------------------------	---------	---

## 2-18. Pressure sensor kit (UTY-SPWX)




- It is used when the outdoor unit is installed higher than the indoor unit and the height different exceeds 164 ft (50 m).
- Attached the sensor part to the liquid pipe near the indoor unit.
- The communication line between the control unit and the outdoor unit is connected to the master outdoor unit (the max. length is 820 ft [250 m]).

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	4	For fixing the cables insides the control unit
 Screw	3	For mounting the control unit
 Connector	1	For connecting the cable and attaching the board connector
 Refrigerant pressure sensor	1	For refrigerant pressure measurement The cable length is 5 ft (1.6 m).
 Joint pipe	1	For attaching the refrigerant pressure sensor to the refrigerant pipe
 Installation manual	1	


## ■ System diagram

Proper system diagram

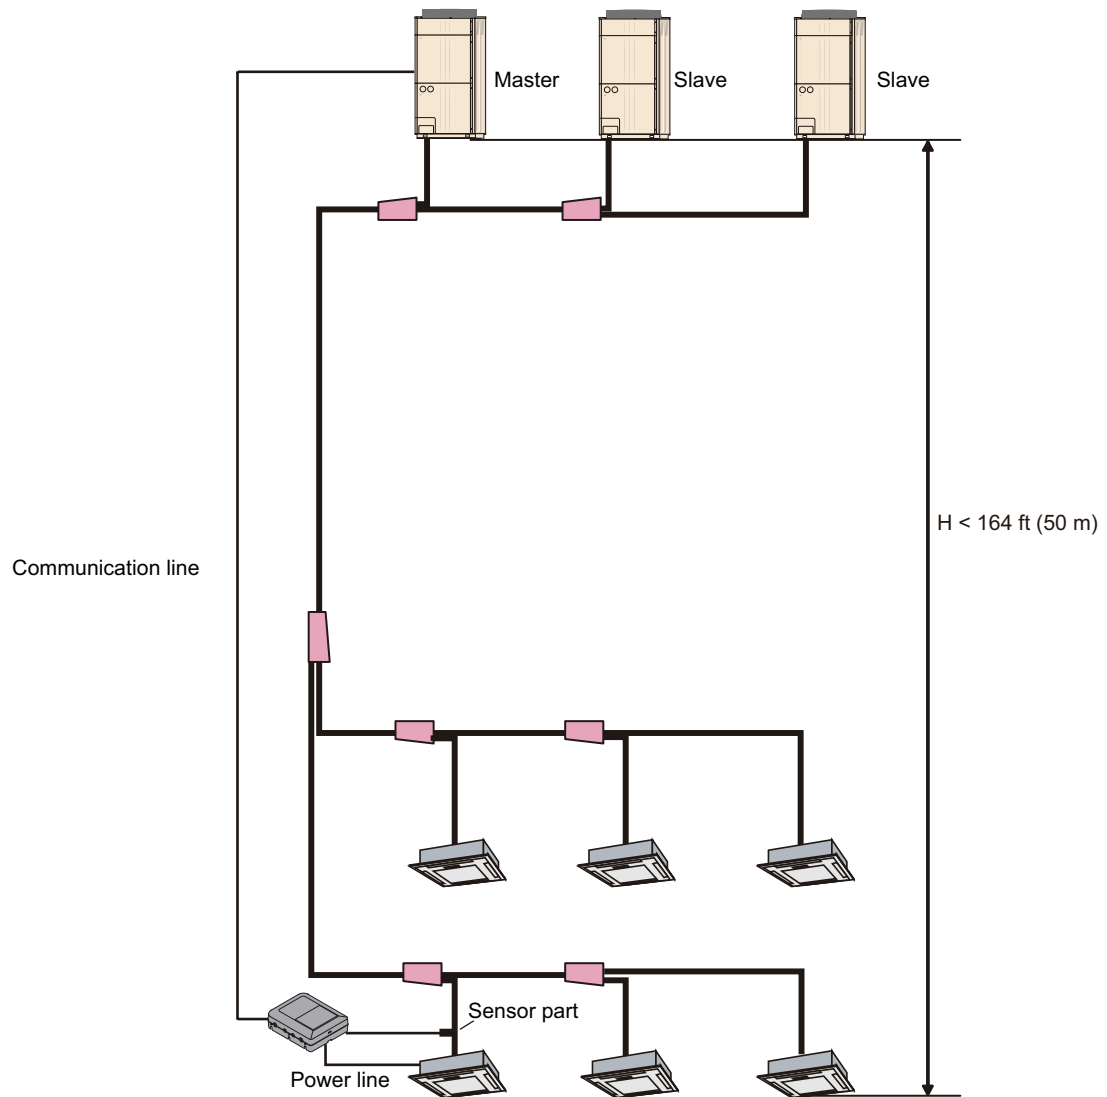

## ■ Wiring diagram

Only one pressure sensor kit is available in each refrigerant system.

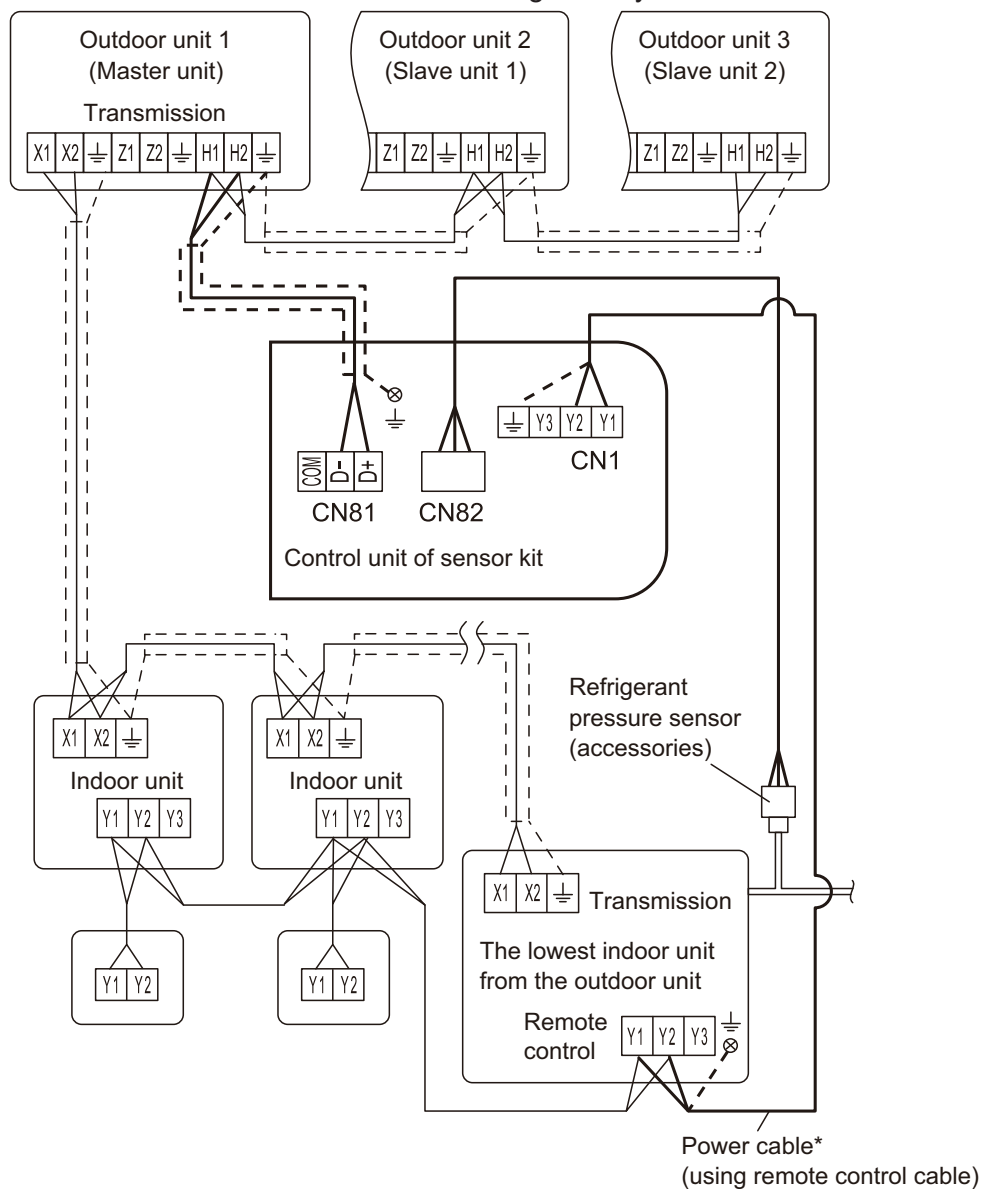


\*: This cable length should be 32 ft (10 m) or less.

For the maximum connectable number of remote controllers, refer to ["Wiring specifications"](#) on page 05-106.




## ■ Refrigerant pressure sensor installation


- Install the refrigerant pressure sensor between the indoor unit and the separation tube (or outdoor unit)

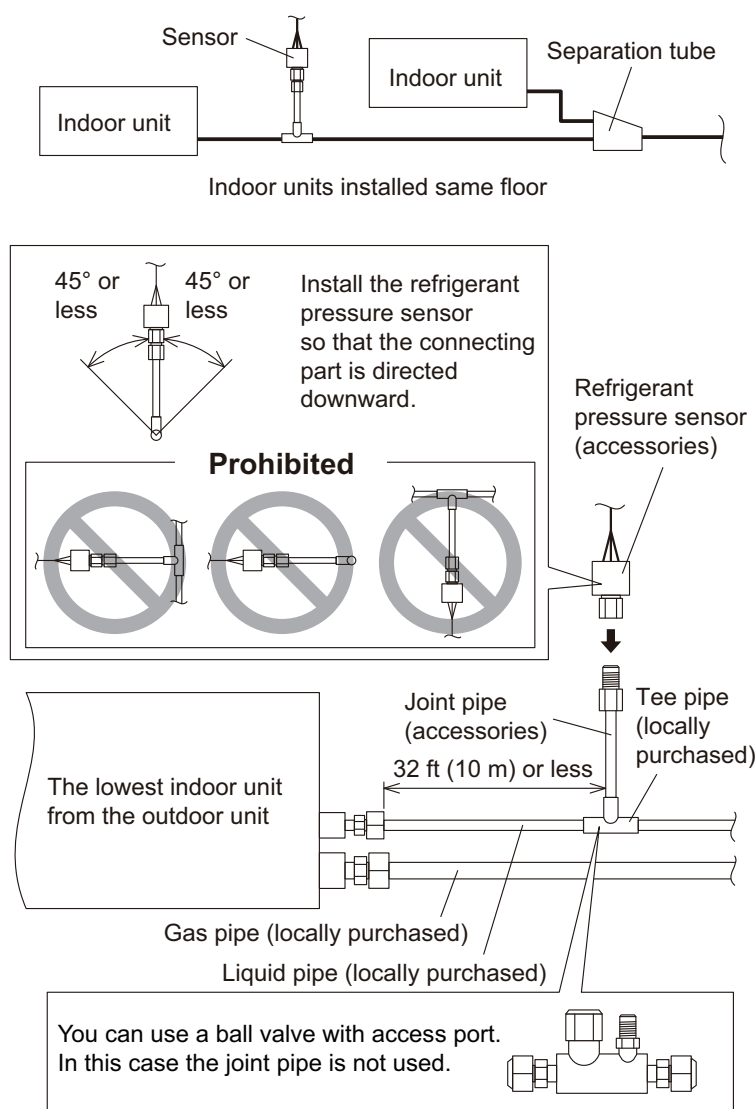

- Tighten the refrigerant pressure sensor with a torque wrench and a holding wrench. Tightening torque:  $11 \pm 1.1 \text{ lbf} \cdot \text{ft}$  ( $15 \pm 1.5 \text{ N} \cdot \text{m}$ )

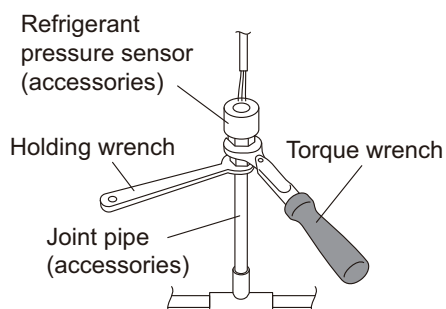


## ■ Control unit installation

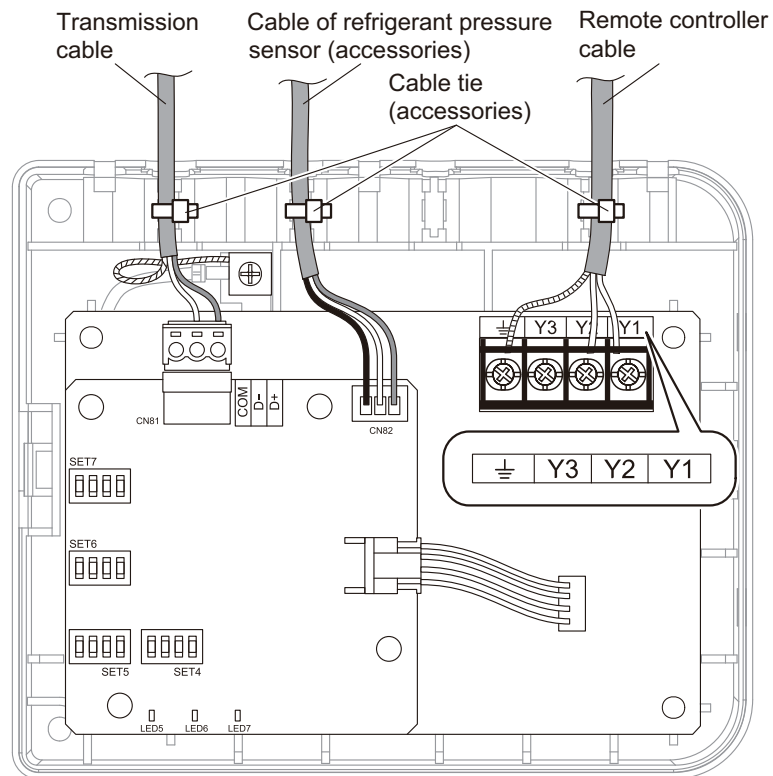


Fix the cable with cable tie using 3 fixing holes.

Fix the connection cable even outside this product as necessary.

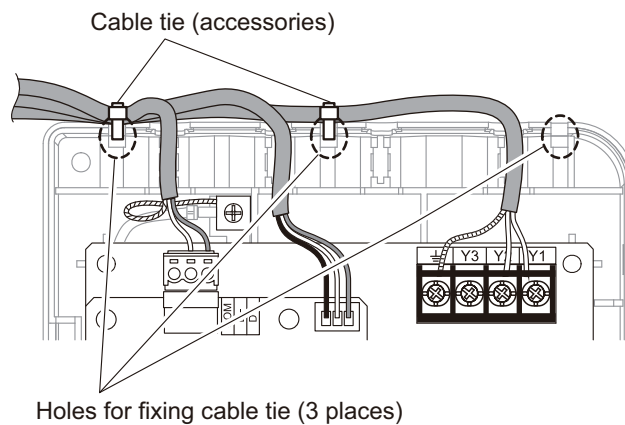

## Unit: in (mm)

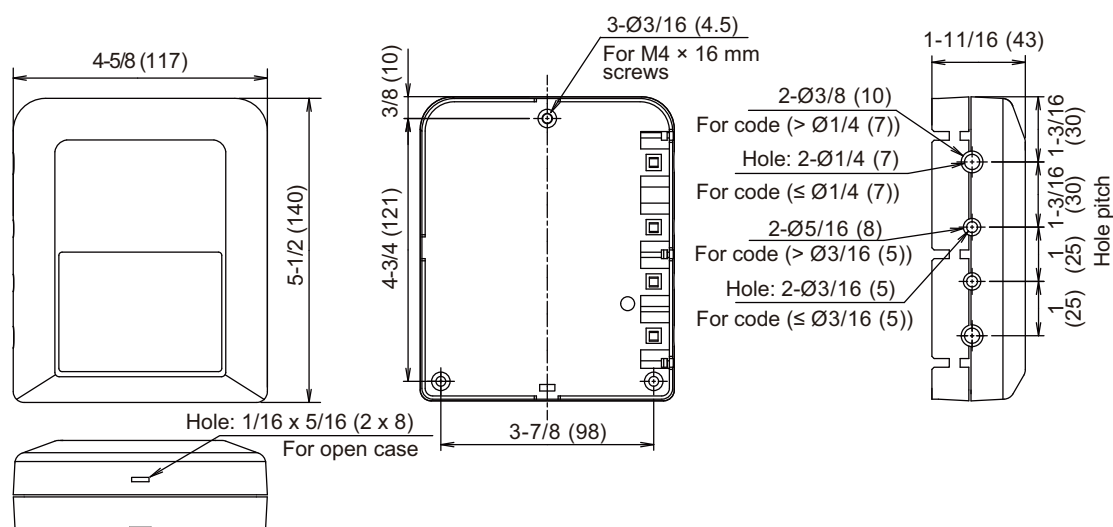


- **Connection pattern**

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

- **Pattern A**

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

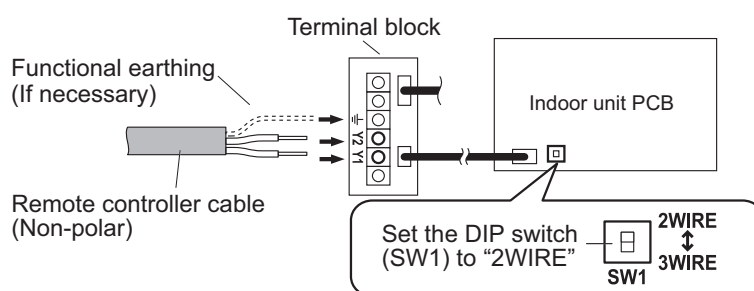


**NOTES:**


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

- **Pattern B**


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

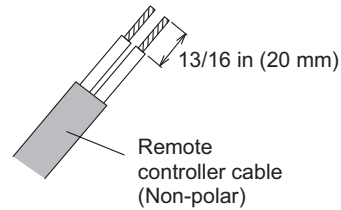


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

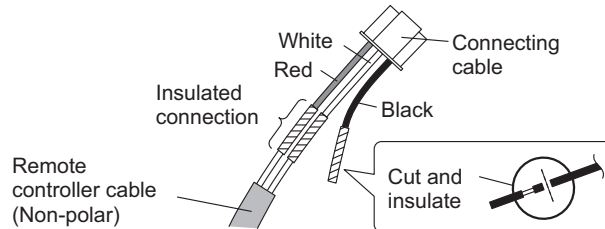

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

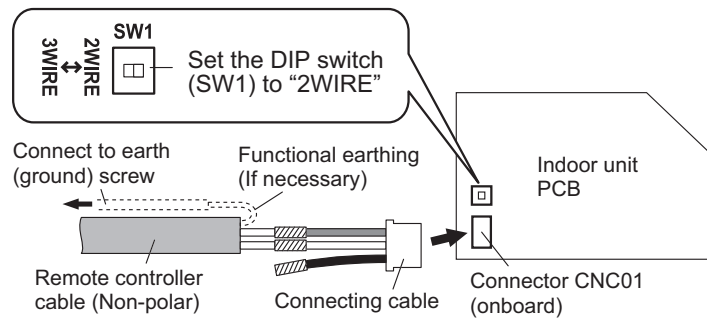


**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

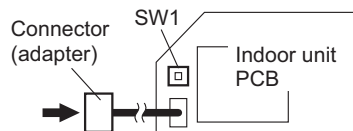

## ■ DIP switch setting


- **Control unit**

Setting of DIP switch is unnecessary.

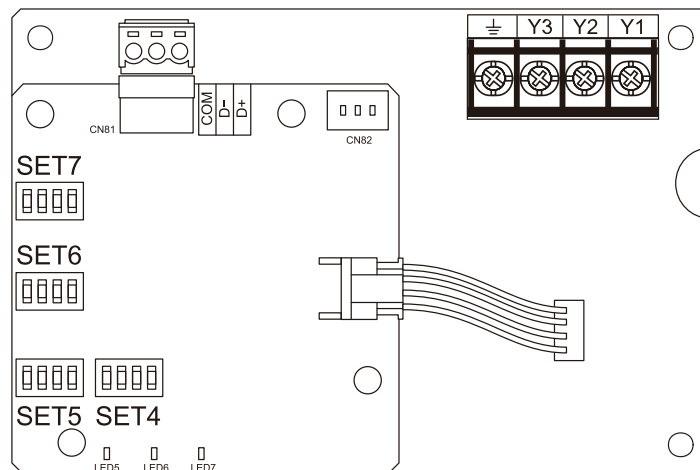


- **Outdoor unit (Master unit only)**

Change DIP switch setting of the outdoor unit as shown below.

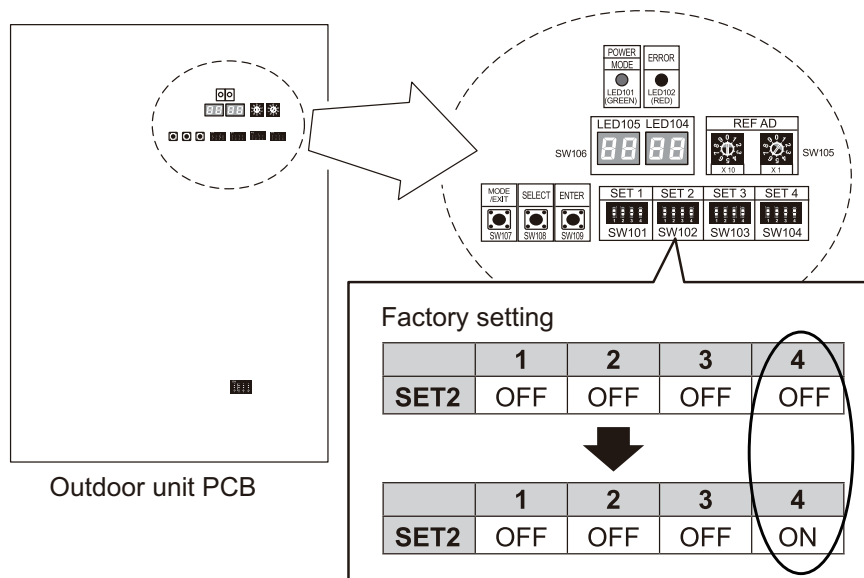

■ LED display

• Positions

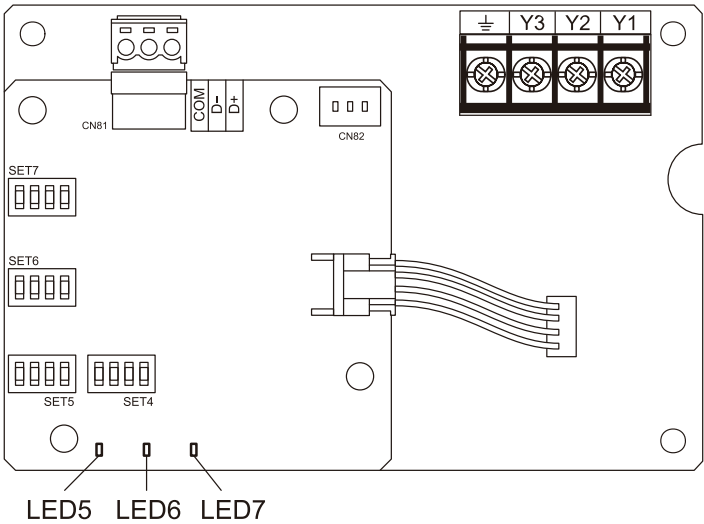

• Normal code

Flashing	Flashing	Off	During initialization sequence
On	Off	Off	Normally operating

• Error code

● (1)	● (3)	○	Communication error between outdoor units
● (8)	● (6)	○	Outdoor unit pressure sensor error

- : 0.5 s On/0.5 s Off
- : 0.1 s On/0.1 s Off
- (N): Number of flashing (Flashing N times [or once] per cycle)

CONTROL  
SYSTEM

CONTROL  
SYSTEM

## ■ Specifications

### • Control unit

Power supply		V	DC 12
Current		A	0.10
Power consumption		W	1.2
Temperature	Operating	°F (°C)	32 to 114 (0 to 46)
	Packaged	°F (°C)	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H × W × D)		in (mm)	1-11/16 × 4-5/8 × 5-1/2 (43 × 117 × 140)
Weight		oz (g)	7 (200)
Network	Electrical characteristics		RS485
	Maximum cable length	ft (m)	820 (250)

### • Refrigerant pressure sensor

Power supply		V	DC 5 ± 0.25
Current		mA	10 or less
Pressure range		MPa	0 to 5.0
Output voltage		V	DC 0.5 to 4.5
Accuracy at 1,013 hPa, at 5 V Include thermal error		%FS	± 2.0 at -4 to 176 °F (-20 to 80 °C)
Temperature	Ambient	°F (°C)	-22 to 176 (-30 to 80)
	Fluid	°F (°C)	-40 to 248 (-40 to 120)
Airtight pressure		MPa	5.5
Test pressure		MPa	7.5
Burst pressure		MPa	25 or more

### • Joint pipe

Applicable refrigerant	R410A	
Airtight proof The leakage rate shall be less than $1 \times 10^{-5}$ mmHg•L/s	MPa	Add mixgass (N <sub>2</sub> +R410A) pressure to 4.15
Airtight pressure	MPa	4.15
Proof pressure	MPa	6.23
Burst pressure	MPa	12.6
Dimensions of pipe (L × D)	in (mm)	2-3/4 × Φ1/4 (70 × Φ6.35)

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Power supply cable (using remote control cable)	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Non-polar 2 core, twisted pair sheathed PVC cable*	Maximum cable length: 32 ft (10 m)
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	22 AWG LEVEL 4 (NEMA) Non-polar 2 core, twisted pair solid core diameter 0.65 mm	LonWorks compatible cable

\*: Use shielded cable in accordance with local rules for remote controller cable.

**NOTE:** Select a flexible cable that can be bound using cable ties from over the cable sheath inside this product.

### Maximum connectable number of remote controllers by cable size and length:

Cable size		Maximum connectable number of remote controllers		
AWG	mm <sup>2</sup>	L < 328 ft (L < 100 m)	328 ft < L ≤ 820 ft (100 m < L ≤ 250 m)	820 ft < L ≤ 1640 ft (250 m < L ≤ 500 m)
16	1.25	2	2	2
18	0.75 (1.25 > S ≥ 0.75)	2	2	Prohibited
20	0.5 (0.75 > S ≥ 0.5)	2		
22	0.3 (0.5 > S ≥ 0.3)	2		

Cable size and length conditions within the remote controller group this product is connected:  
Size and length of the cable connected to this product should be included.




## 2-19. Group control method

### ■ Remote controller group

Wired, Simple, and Wireless remote controllers can be used simultaneously in the following combinations.

Examples of combination for remote controller group:

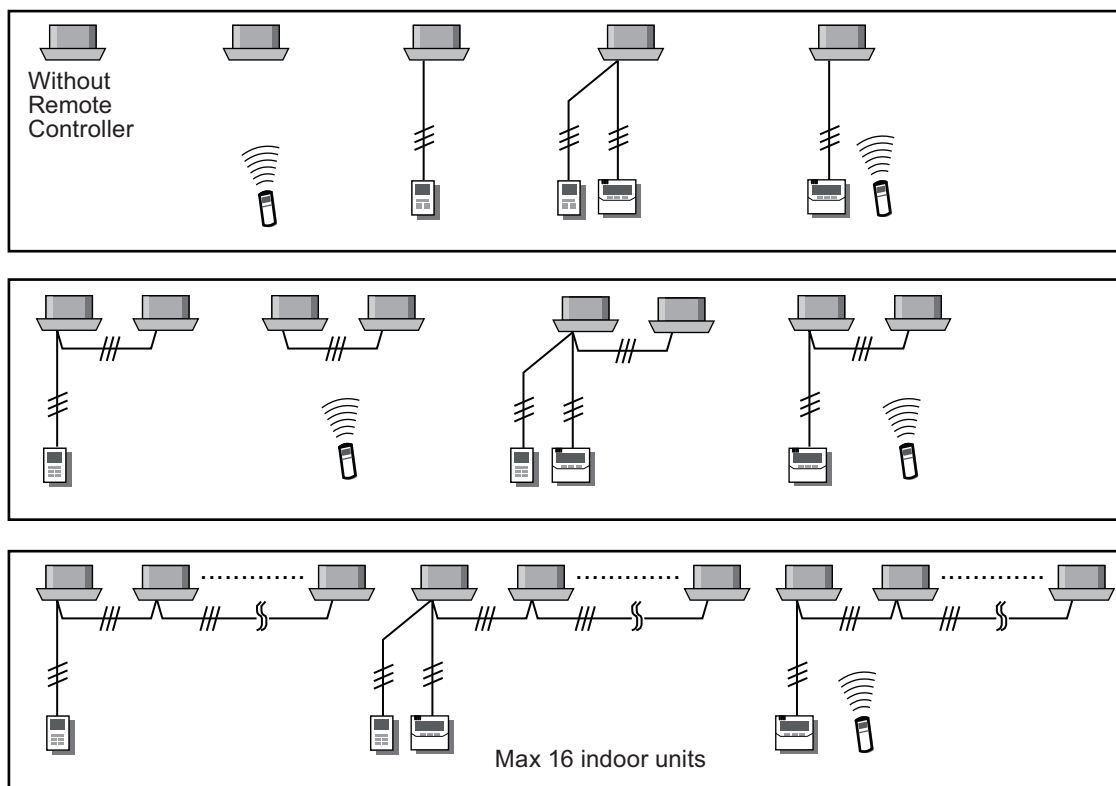

Connectable indoor unit number: 1 to 16

Connectable remote controller number: 0 to 2


#### NOTES:

- Indoor unit in the same remote controller group will be same operation.
- Remote controller group spanning refrigerant system is not allowed.
- When using 2 remote controllers:
  - Last command is priority. (Operation mode might be fixed by system operation.)
  - Timer setting function become disable from slave remote controller or wireless remote controller.
- When the airflow direction is set with combination use of wireless remote controller and wired remote controller in the same remote controller group, airflow direction setting shown on the remote controllers may differ from actual louver position of the indoor unit.
- When using a wireless remote controller in connection with a group assignment, the airflow direction of the indoor units may not match.

## ■ Group

This function is used when operating a multiple number of remote controller group at a time from System controller, Touch panel controller, or Central remote controller.

Example:

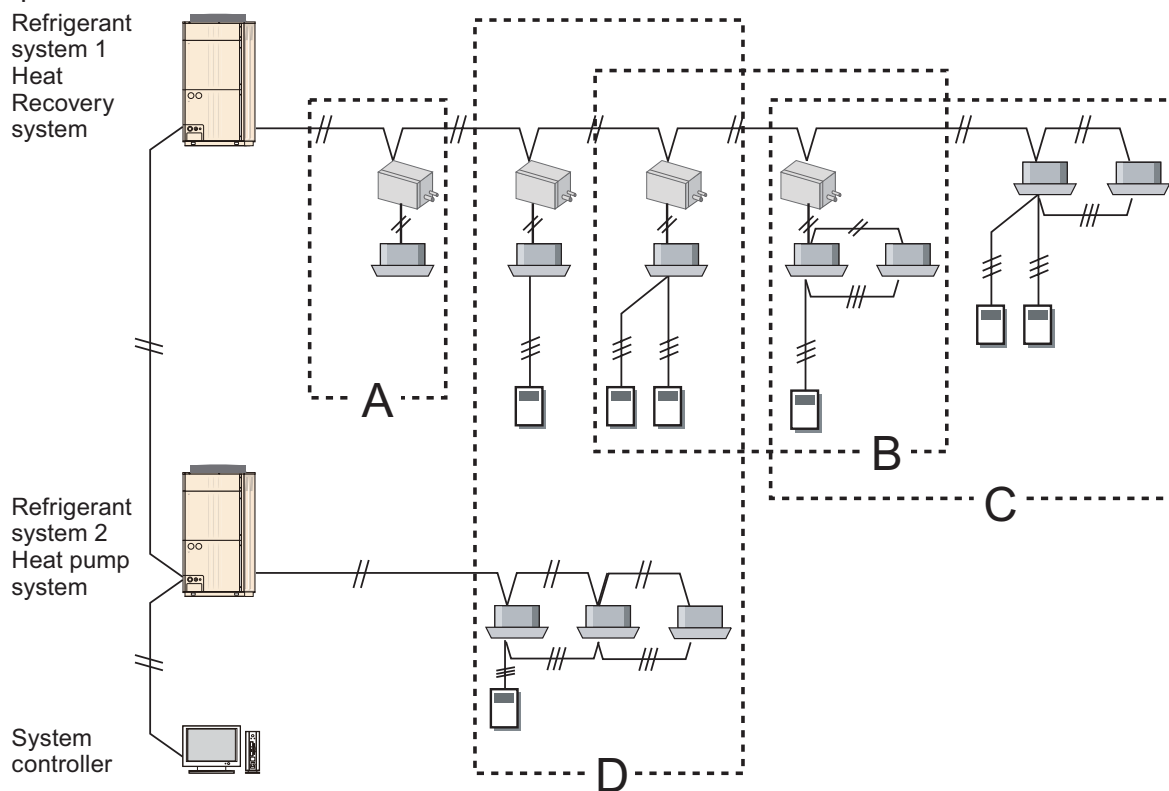

Group A: "Group" is possible with only one indoor unit.

Group B: "Group" is possible with spanning the RB groups.

Group C: "Group" is possible with spanning the RB group and indoor unit of cooling only type.

Group D: "Group" is possible with spanning the refrigerant systems.

**NOTE:** The contents of setting may not be reflected by operation status. (B, C, D group)

## 2-20. Comparison table of controllers

### • Central control

Item		System controller	System controller lite	Touch panel controller	Central remote controller	
Model		UTY-APGXZ1	UTY-ALGXZ1	UTY-DTGYZ1	UTY-DCGY	UTY-DCGYZ*
Max. controllable remote controller groups		1,600	400	400	100	100
Max controllable indoor units		1,600	400	400	100	100
Max controllable groups		1,600	400	400	16	50
<b>Air conditioning control function</b>						
On/Off		●	●	●	●	●
Operation mode setting		●	●	●	●	●
Fan speed setting		●	●	●	●	●
Room temp. setting		●	●	●	●	●
Room temp. set point limitation		●	●	●	●	●
Test operation		—	—	●	●	●
Up/Down air direction flap setting		●	●	●	●	●
Right/Left air direction flap setting		●	●	●	●	●
Individual louver control		—	—	●	—	●
Group setting		●	●	●	●	●
RC prohibition		●	●	●	●	●
Anti-freeze setting		●	●	●	●	●
Set temp. auto return		—	—	●	—	—
Economy mode setting		●	●	●	●	●
Human sensor control		●	●	●	—	●
<b>Display</b>						
Failure		●	●	●	●	●
Defrosting		●	●	●	●	●
Current time		●	●	●	●	●
Day of week		●	●	●	—	●
RC prohibition		●	●	●	●	●
Cooling/Heating priority		●	●	●	●	●
Address display		●	●	●	●	●
Room temp.		●*1	●*1	●*1	—	●*1
Multi language		●	●	●	●	●
Summer time		●	●	●	●	●
Name registration		●	●	●	●	●
Backlight		—	—	●	●	●
2D floor layout/3D floor layout		●	—	—	—	—
<b>Timer</b>						
Schedule timer	Period	Year	Year	Year	Week	Week
	On/Off, Temp., Mode, Times per day	144	144	20	20	20
On/Off timer		—	—	—	—	—
Sleep timer		—	—	—	—	—
Program timer		—	—	—	—	—
Auto off timer		—	—	—	—	●
Day off timer		●	●	●	●	●
Min. unit of timer setting (Minutes)		10	10	10	10	10
<b>Control</b>						
Status monitoring system		●	●	●	●	●
Electricity charge calculation		●	○	○	—	—
Error history		●	●	●	●	●
Emergency stop		—	—	●*2	●*2	●*2
Remote management		●	○	●	—	●
Energy saving management		○	○	—	—	—
E-mail notification for malfunction		●	●	●	—	●
Key lock		●	●	●	●	●
Low noise mode		—	—	●	—	—
<b>NOTES:</b>						
<ul style="list-style-type: none"> <li>*1: Available only when using wired remote controller.</li> <li>*2: Available only through external input control.</li> <li>●: Supported, ○: Optional function, —: Not supported yet</li> </ul>						

# • Individual control

Item	Wired remote controller (Touch panel)	Wired remote controller	Simple remote controller	Simple remote controller* <sup>1</sup>	Wireless remote controller
Model	UTY-RNRUZ*	UTY-RNKU	UTY-RSRY (UTY-RSKU)	UTY-RHRY (UTY-RHKU)	UTY-LNHU
Max. controllable remote controller groups	1	1	1	1	1
Max controllable indoor units	16	16	16	16	16
Max controllable groups	—	—	—	—	—
<b>Air conditioning control function</b>					
On/Off	●* <sup>2</sup>	●	●	●	●
Operation mode setting	●	●	●	—	●
Fan speed setting	●	●	●	●	●
Room temp. setting	●	●	●	●	●
Room temp. set point limitation	●	—	(—)	(—)	—
Test operation	●	●	●	● (—)	●
Up/Down air direction flap setting* <sup>3</sup>	●	●	● (—)	● (—)	●
Right/Left air direction flap setting* <sup>3</sup>	●	●	—	—	●
Individual louver control	●	—	—	—	—
Group setting	—	—	—	—	—
RC prohibition	—	—	—	—	—
Anti-freeze setting	●	—	—	—	—
Set temp. auto return	●	—	—	—	—
Economy mode setting	●	●	—	—	●
Human sensor control	●	—	—	—	—
Lead lag setting	●* <sup>4</sup>	—	—	—	—
<b>Display</b>					
Failure	●	●	●	●	—
Defrosting	●	●	●	●	—
Current time	●	●	—	—	●
Day of week	●	●	—	—	—
RC prohibition	●	●	●	●	—
Cooling/Heating priority	●	●	●	●	—
Address display	●	●	●	●	—
Room temp.	●* <sup>5</sup>	—	● (—)	● (—)	—
Multi language	●	—	—	—	—
Summer time	●	—	—	—	—
Name registration	●	—	—	—	—
Backlight	●	—	●	●	—
2D floor layout/3D floor layout	—	—	—	—	—
Display sensor values	●* <sup>4</sup>	—	—	—	—
<b>Timer</b>					
Schedule timer	Period	Week	Week	—	—
	On/Off, Temp., Mode, Times per day	8	4	—	—
On/Off timer	●	●	—	—	●
Sleep timer	—	—	—	—	●
Program timer	—	—	—	—	●
Auto off timer	●	—	—	—	—
Day off timer	●	●	—	—	—
Min. unit of timer setting (Minutes)	10 to 30	30	—	—	5
<b>Control</b>					
Status monitoring system	—	—	—	—	—
Electricity charge calculation	—	—	—	—	—
Error history	●	●	—	—	—
Emergency stop	—	—	—	—	—
Remote management	—	—	—	—	—
Energy saving management	—	—	—	—	—
E-mail notification for malfunction	—	—	—	—	—
Key lock	● Child lock	—	—	—	—
Low noise mode	—	—	—	—	—
<b>NOTES:</b>					
<ul style="list-style-type: none"> <li>*1: "Operation mode" setting is not available for this model.</li> <li>*2: On/Off setting of economizer can be performed simultaneously.</li> <li>*3: When the airflow direction is set with combination use of wireless remote controller and wired remote controller, airflow direction setting shown on the remote controllers may differ from actual louver position of the indoor unit.</li> <li>*4: Available only for UTY-RNRUZ* version 5 or later.</li> <li>*5: Room temperature correction function is available only for UTY-RNRUZ* version 5 or later.</li> <li>●: Supported, ○: Optional function, —: Not supported yet</li> </ul>					

## 3. Adaptor/Converter units

### RELATED LINKS




["Adapter/Converter/Maintenance tool"](#) in Chapter 1. GENERAL INFORMATION on page 01-11

### 3-1. Network converter (UTY-VTGX)




- With this Network converter, single split type and multi system air conditioners can be controlled by System controller, Touch panel controller, Central remote controller in VRF network system or by Wired remote controller connected to the Network converter.
- Start/Stop, operation mode, temperature setting, fan speed, etc. can be done with these controllers.
- One Network converter can be connected and controlled up to 16 indoor units.
- One Wired remote controller is possible for one Network converter by UTY-VTGX.
- Up to 100 Network converter can be connected in one VRF network system. (One Network converter is regarded as one refrigerant system. The total refrigerant system in one VRF network system must be within 100.)

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	7	For mounting the remote controller cable and transmission cable
 Screw (M4 × 16 mm)	4	For mounting the Network converter
 Installation manual	1	

## System diagram

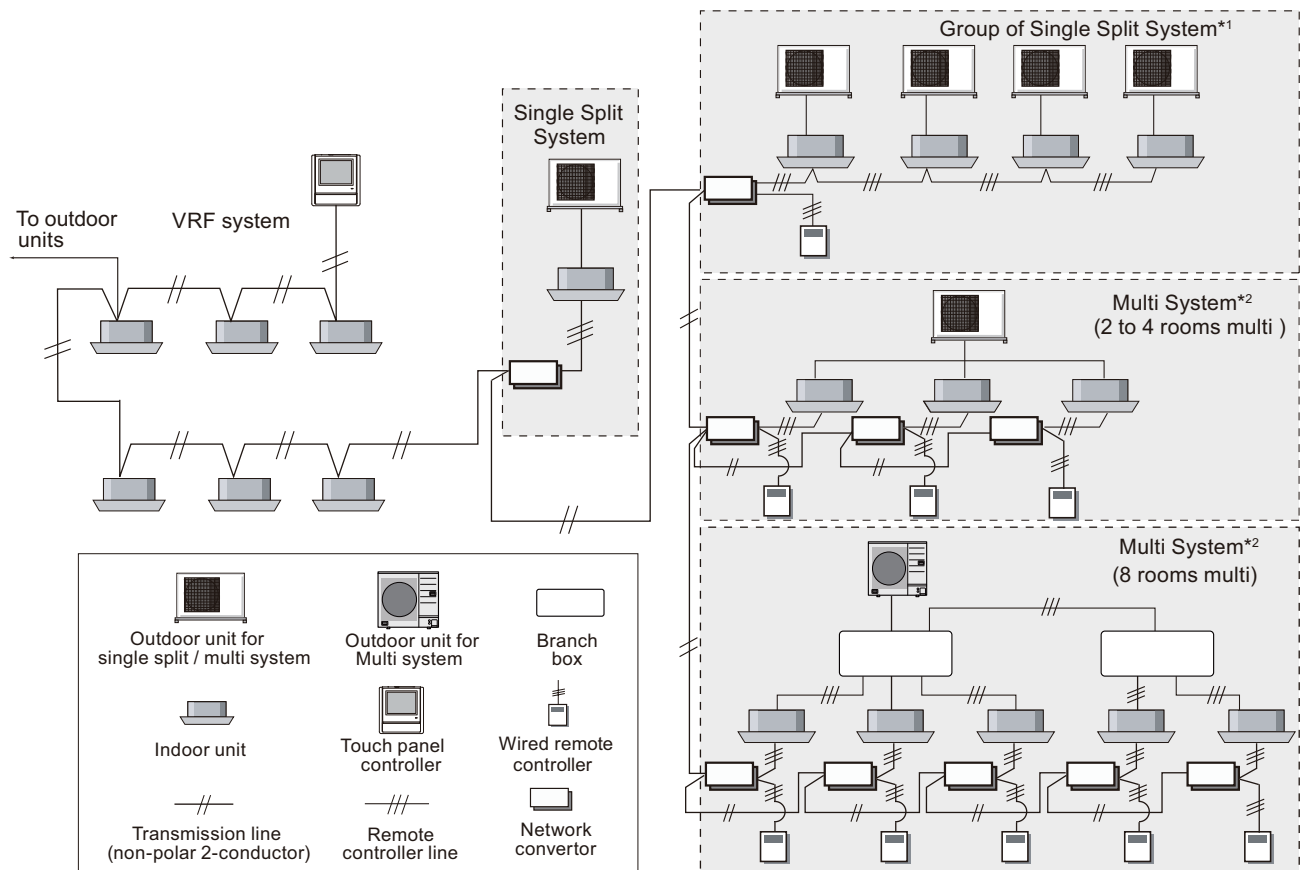


\*1: All indoor units connected to a Network converter are operated under same status.


\*2: Network converter is necessary for each indoor unit to control indoor unit individually.

## ■ Electrical wiring

### • For non-polar 2 wire

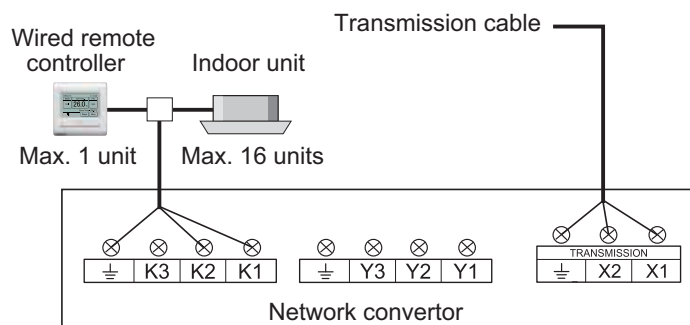

### • For polar 3 wire

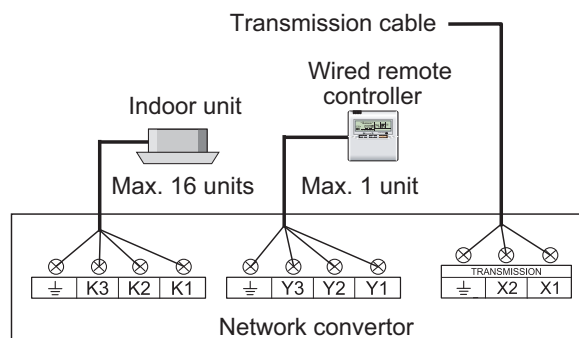


#### NOTES:

- Do not bind the power cable and the remote controller cable to avoid erroneous operation.
- Use shielded cable for transmission cable in accordance with the regional cable standard.
- Use sheathed PVC cable or shielded cable for remote controller cable in accordance with the regional cable standard.
- Use ground wire to ground the Network converter.

## ■ Limited wiring length

- **For non polar 2-wire**


Up to 4 remote controllers can be used to operate the indoor units.

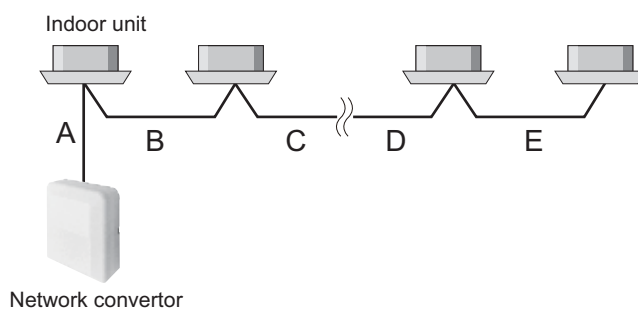

A, B, C, D, E: Remote controller cable (For details of controller cable specifications, refer to "[Controller cable](#)" in Chapter 6. SYSTEM DESIGN on page 06-84.)

$A \leq 6 \text{ ft (2 m)}$ ,  $A + B + C + D + E \leq 1,640 \text{ ft (500 m)}$

- **For polar 3-wire**

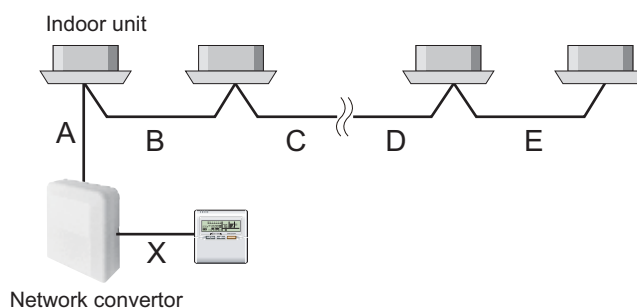

A, B, C, D, E, X: Remote controller cable (For details of controller cable specifications, refer to "[Controller cable](#)" in Chapter 6. SYSTEM DESIGN on page 06-84.)

$A \leq 6 \text{ ft (2 m)}$ ,  $A + B + C + D + E \leq 328 \text{ ft (100 m)}$  and  $X \leq 328 \text{ ft (100 m)}$



## ■ Connectable remote controllers

3 types of wired remote controller shown in the table below can be connected to this product.

This product is connectable to indoor units that following wired remote controllers can be connected.

Model name	RC number	Type
UTY-RNRU	AR-WEA** AR-WEB** AR-WEC**	Non polar 2-wire
UTB-YUD	AR-6TC**	Polar 3-wire
UTY-RNNUM	AR-WAE**	

\*: Numerical character or alphabetical character

## ■ Functions

Operation	Non polar 2-wire	Polar 3-wire
Operation of louver from VRF	○	×
Operation of louver from wired remote controller	○	○
Restriction of wireless remote controller from central control	○	×
Restriction of wired remote controller from central control	○	○
Anti-freeze	×	×
Setting high and low temperature limit	○	×
Indoor unit rotation	×	×
Turning off indoor unit external thermostat	×	×
Outdoor unit forced stop	×	×
Outdoor unit capacity save	×	×
Outdoor unit low noise	×	×
Electricity distribution	×	×
Display model name	×	×
System time	○	×
Remote setting	×	×
Local setting by the wired remote controller	○	×

## CONTROL SYSTEM

[illegible]

Input power		W	2
Temperature	Operating	°F (°C)	32 to 114.8 (0 to 46)
	Packaged	°F (°C)	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H × W × D)		in (mm)	5-1/2 × 4-5/8 × 1-11/16 (140 × 117 × 43)
Weight		oz (g)	9 (250)




Use	Cable size	Wire type	Remarks
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL 4 (NEMA) Non-polar 2 core, twisted pair solid core shielded	LonWorks compatible cable
Remote controller cable (2-wire type)	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Non-polar 2 core	Use sheathed PVC cable or shielded cable in accordance with the regional cable standard.
Remote controller cable (3-wire type)	22 AWG (0.33 mm <sup>2</sup> )	Polar 3 core	

## 3-2. Network converter (UTY-VTGXV)




- With this Network converter, single split type and multi system air conditioners can be controlled by System controller, Touch panel controller, Central remote controller in VRF network system or by Wired remote controller connected to the Network converter.
- Start/Stop, operation mode, temperature setting, fan speed, etc. can be done with these controllers.
- One Network converter can be connected and controlled up to 16 indoor units.
- Two Wired remote controllers are possible for one Network converter by UTY-VTGXV.
- Up to 100 Network converters can be connected in one VRF network system. (One Network converter is regarded as one refrigerant system. Total refrigerant systems in one VRF network system must be within 100.)

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	7	For mounting the remote controller cable and transmission cable
 Screw (M4 × 16 mm)	4	For mounting the Network converter
 Installation manual	1	

## System diagram

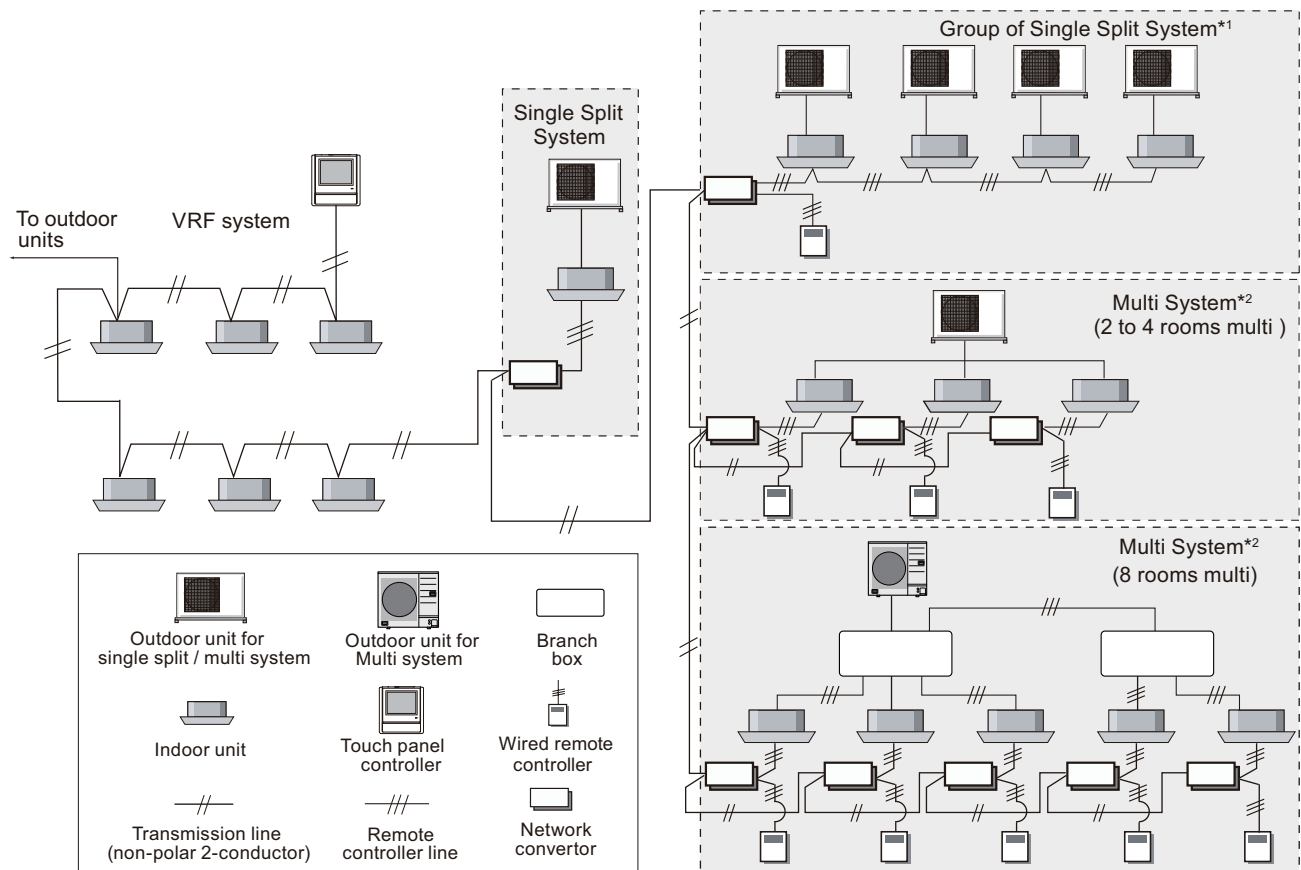


\*1: All indoor units connected to a Network converter are operated under same status.


\*2: Network converter is necessary for each indoor unit to control indoor unit individually.

## ■ Electrical wiring

### • For non-polar 2 wire

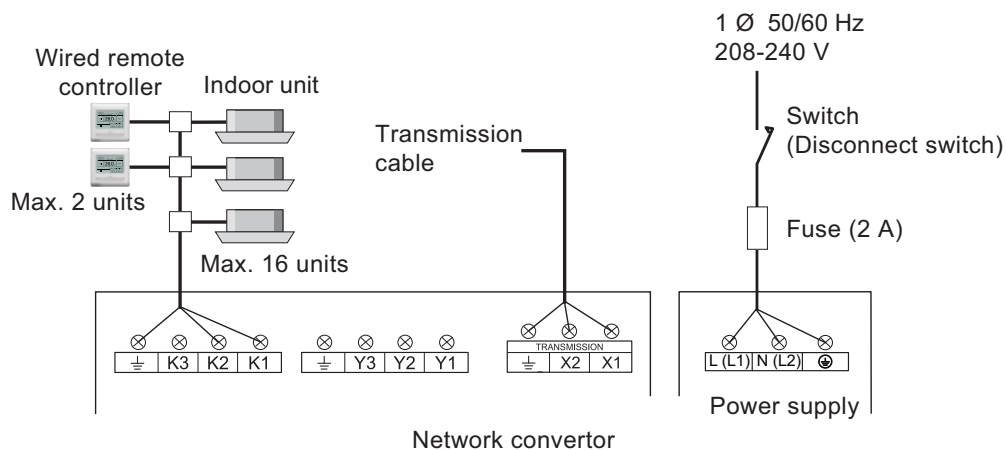

### • For polar 3 wire

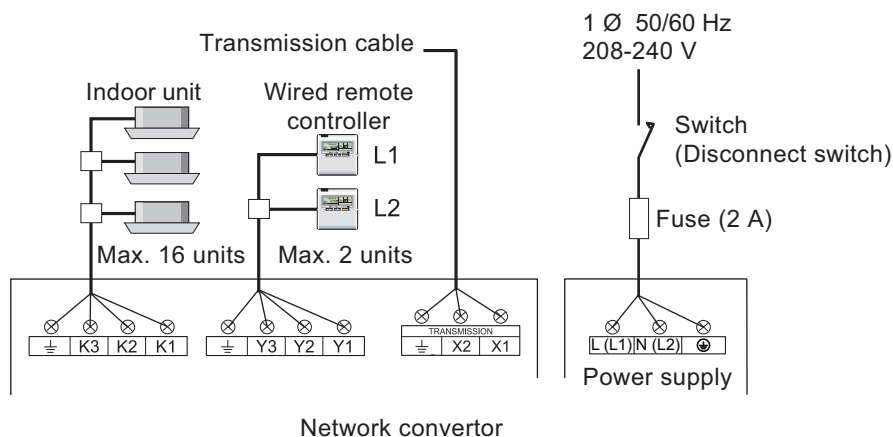


### NOTES:

- Do not bind the power cable and the remote controller cable to avoid erroneous operation.
- Use shielded cable for transmission cable in accordance with the regional cable standard.
- Use sheathed PVC cable or shielded cable for remote controller cable in accordance with the regional cable standard.
- Use ground wire to ground the Network converter.

## ■ Limited wiring length

- **For non polar 2-wire**


Up to 4 remote controllers can be used to operate the indoor units.

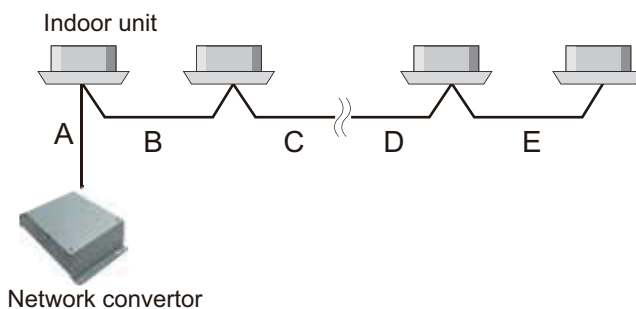

A, B, C, D, E: Remote controller cable (For details of controller cable specifications, refer to "[Controller cable](#)" in Chapter 6. SYSTEM DESIGN on page 06-84.)

$A \leq 6 \text{ ft (2 m)}$ ,  $A + B + C + D + E \leq 1,640 \text{ ft (500 m)}$

- **For polar 3-wire**

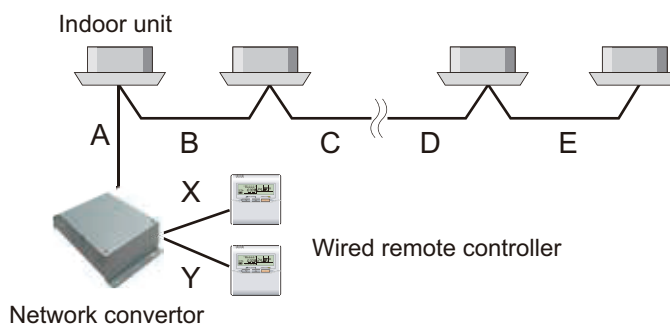

A, B, C, D, E, X, Y: Remote controller cable (For details of controller cable specifications, refer to "[Controller cable](#)" in Chapter 6. SYSTEM DESIGN on page 06-84.)

$A \leq 6 \text{ ft (2 m)}$ ,  $A + B + C + D + E \leq 328 \text{ ft (100 m)}$  and  $X + Y \leq 328 \text{ ft (100 m)}$

## ■ Connectable remote controllers

3 types of wired remote controller shown in the table below can be connected to this product.

This product is connectable to indoor units that following wired remote controllers can be connected.

Model name	RC number	Type
UTY-RNRU	AR-WEA** AR-WEB** AR-WEC**	Non polar 2-wire
UTB-YUD	AR-6TC**	Polar 3-wire
UTY-RNNUM	AR-WAE**	


\*: Numerical character or alphabetical character

## ■ Functions

Operation	Non polar 2-wire	Polar 3-wire
Operation of louver from VRF	○	×
Operation of louver from wired remote controller	○	○
Restriction of wireless remote controller from central control	○	×
Restriction of wired remote controller from central control	○	○
Anti-freeze	×	×
Setting high and low temperature limit	○	×
Indoor unit rotation	×	×
Turning off indoor unit external thermostat	×	×
Outdoor unit forced stop	×	×
Outdoor unit capacity save	×	×
Outdoor unit low noise	×	×
Electricity distribution	×	×
Display model name	×	×
System time	○	×
Remote setting	×	×
Local setting by the wired remote controller	○	×

## ■ Dimensions

Unit: in (mm)

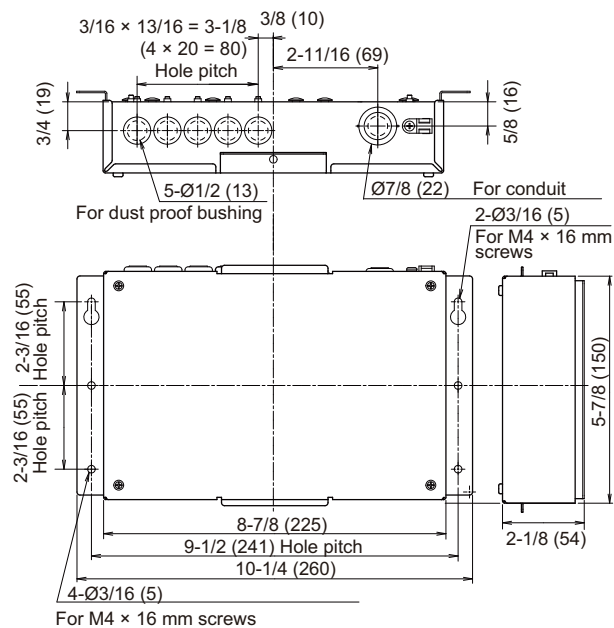

## ■ Specifications

Power supply		V	1 Ø AC 208—240
Power source frequency		Hz	50/60
Input power		W	3.0
Temperature	Operating	°C	0 to 46
	Packaged	°C	-10 to 60
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H × W × D)		mm	54 × 260 × 150
Weight		g	1,100
Fuse capacity		A	2

## ● Wiring specifications







### 3-3. Network converter (UTY-VGGXZ1)




- With this Network converter, single split type and multi system air conditioners can be controlled by System controller, Touch panel controller, Central remote controller in VRF network system or by Wired remote controller connected to the Network converter.
- Start/Stop, operation mode, temperature setting, fan speed, etc. can be done with these controllers.
- One Network converter can be connected and controlled up to 16 indoor units.
- Two Wired remote controllers are possible for one Network converter.
- Up to 100 Network converters can be connected in one VRF network system. (One Network converter is regarded as one refrigerant system. Total refrigerant systems in one VRF network system must be within 100.)

#### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	4	For mounting the power supply cable, remote controller cable, and transmission cable
 Screw (M4 × 20 mm)	4	For mounting the Network converter
 Dust proof bushing	1	For connecting the power supply cable (Except in U.S.A. and Canada)
 Installation manual	1	

## System diagram



- For connecting single split type system

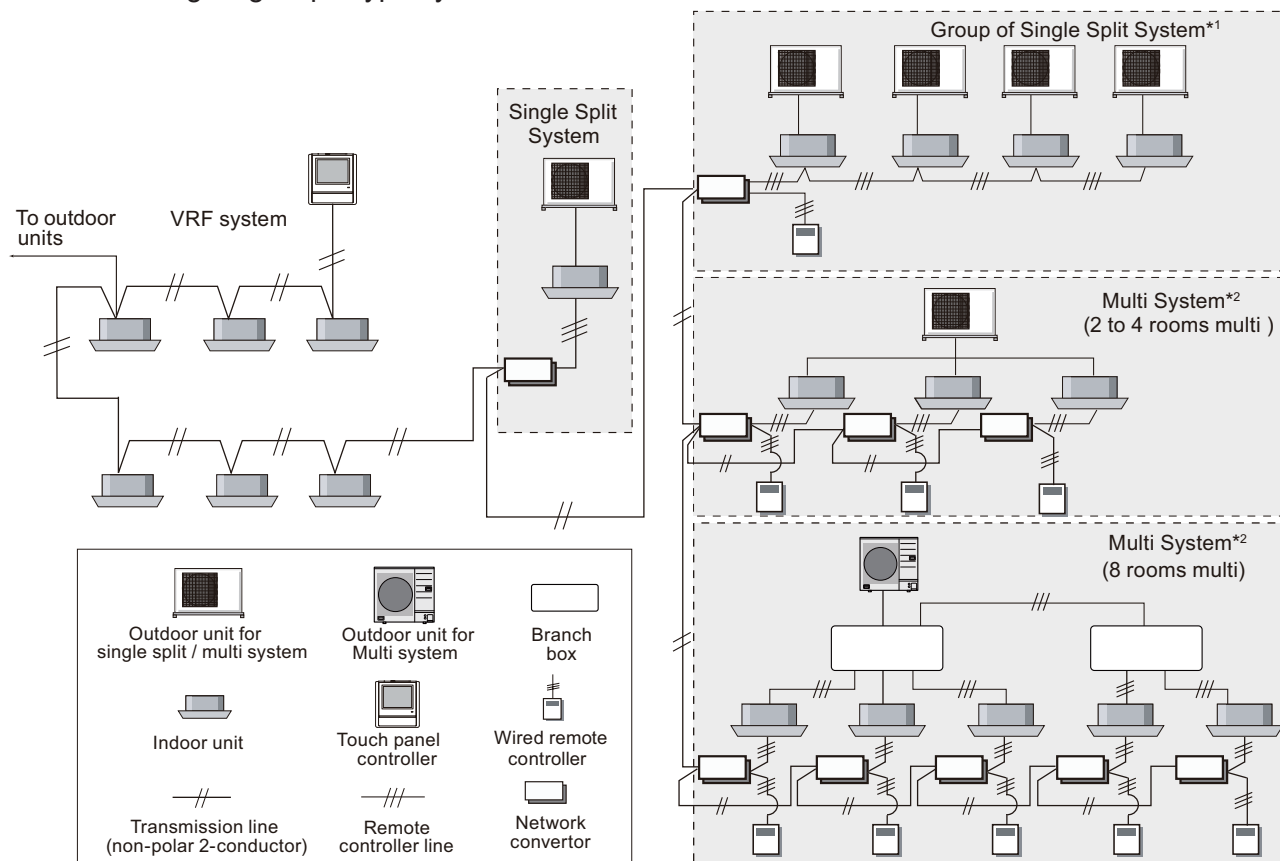

\*1: All indoor units connected to a Network converter are operated under same status.

\*2: Network converter is necessary for each indoor unit to control indoor unit individually.

## Electrical wiring

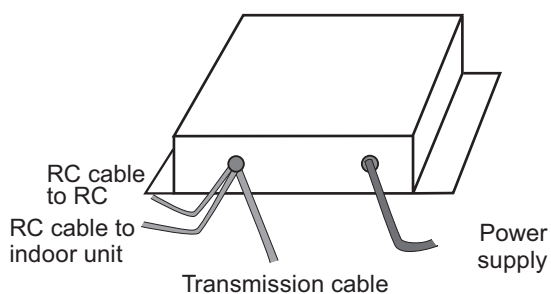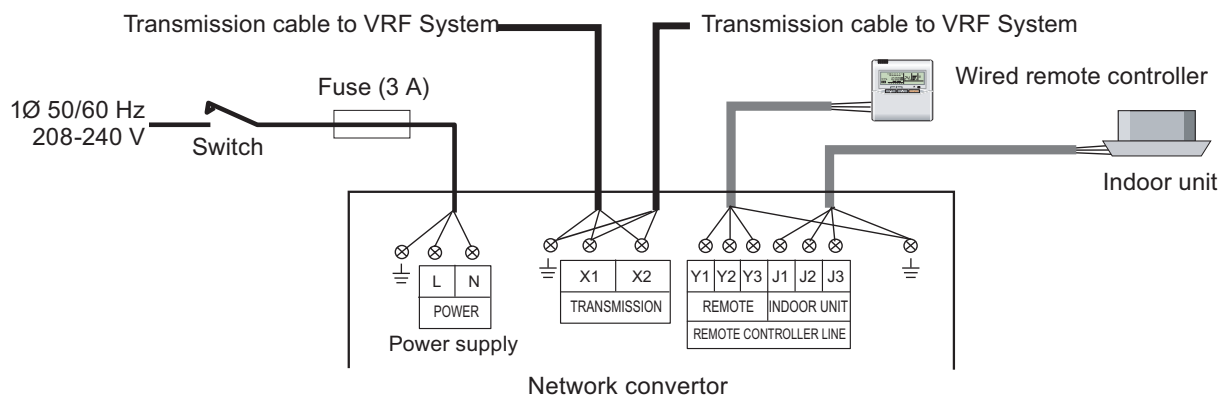

**NOTES:**

- Do not bind the power cable and the remote controller cable to avoid erroneous operation.
- Use shielded cable for transmission line and remote controller line. The shielded metal should be grounded.
- Use ground wire to ground the Network converter.

## ■ Applicable models


### ● Connectable remote controllers

In the case of connecting single split type system, Wireless remote controller cannot be connected to this product.

3 types of wired remote controller shown in the table below can be connected to this product.

Model name	RC number
UTB-UUB	AR-3TA**
UTY-RNBYU UTB-YUD	AR-6TC**
UTY-RNNUM	AR-WAE**

\*: Numerical character or alphabetical character

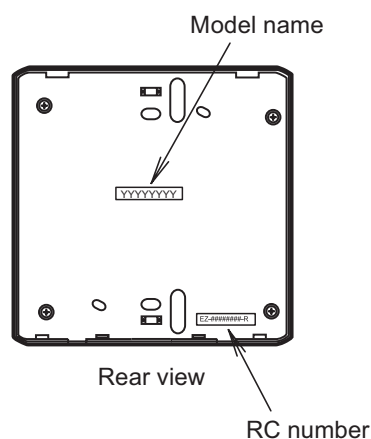

### ● Connectable indoor units

This product is connectable to indoor units that following wired remote controllers (accessories or optional parts) can be connected.

RC number		
AR-3TA**	AR-6TC**	AR-WAE**
EZ-099DHSE-R	EZ-000DHSE-R	EZ-0001HSE-R
EZ-000GHSE-R	EZ-00004HSE-R	EZ-00005HSE-R
EZ-0015HSE-R	EZ-0019HSE-R	EZ-099DHSEFR
EZ-0001HSEFR	EZ-000DHSEFR	EZ-000GHSEFR
EZ-0015HSEFR		
EZ-0994HSE-R	EZ-000EHSE-R	EZ-0994HSEFR
EZ-099CWSE-R	EZ-000AWSE-R	EZ-0001WSE-R
EZ-000FWSE-R	EZ-0012WSE-R	EZ-099CWSEFR
EZ-0001WSEFR	EZ-000AWSEFR	
EZ-09906WSE-R	EZ-000BWSE-R	EZ-09906WSEFR

\*: Numerical character or alphabetical character


**NOTE:** EZ type remote controllers cannot control indoor units via this unit. When you want to operate indoor units directly by the EZ type remote controller, the optional wired remote controller must be purchased. (For applicable wired remote controller, refer to ["Connectable remote controllers"](#) on page 05-126.)

## Functions

Start/Stop	Timer setting
Temperature control	Fan control
Operation mode	Central control (Lock the remote controller functions)

## Dimensions

Unit: in (mm)

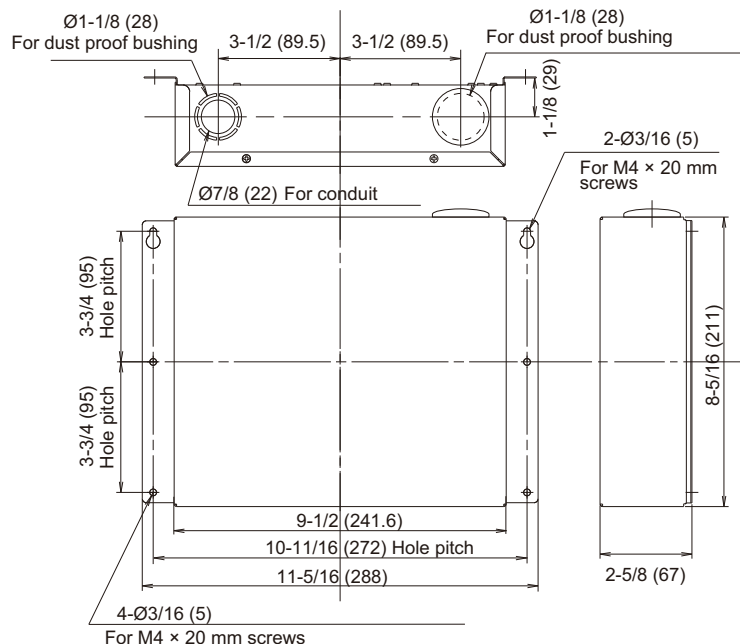

## Specifications

Power supply		V	1 Ø AC 208—240
Power source frequency		Hz	50/60
Input power		W	3.0
Temperature	Operating	°F (°C)	32 to 114.8 (0 to 46)
	Packaged	°F (°C)	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH)
			No condensation
Dimensions (H × W × D)		in (mm)	2-5/8 × 11-5/16 × 8-5/16 (67 × 288 × 211)
Weight		lb (g)	3 (1,500)
Fuse capacity		A	3

## Wiring specifications







Use	Cable size	Wire type	Remarks
Power supply cable (using remote control cable)	20 to 16 AWG (0.5 to 1.25 mm <sup>2</sup> )	60245 IEC 57 or equivalent	1 Ø AC 208—240 V 50/60 Hz, 2 wire + ground (Always ground the unit)
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL 4 (NEMA) Non-polar 2 core, twisted pair solid core shielded	LonWorks compatible cable
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3 core	Use sheathed PVC cable or shielded cable in accordance with the regional cable standard.
External input/ output cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 2 core, twisted pair	Use shielded cable in accordance with the regional cable standard.

## 3-4. Network converter for LonWorks (UTY-VLGX)



- The converter for connecting VRF network system to the BMS system built by LonWorks open network, for manage small to medium sized BMS and VRF network system.
- Maximum of 128 indoor units can be connected to one Network converter for LonWorks.
- VRF system can be centrally controlled or monitored from BMS via UTY-VLGX.
- Maximum 4 Network converter for LonWorks can be connected to 1 BMS.

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	3	For mounting the power supply cable and transmission cable
 Screw (M4 × 20 mm)	4	For mounting the Network converter
 Dust proof bushing	1	For connecting the power supply cable (Except in U.S.A. and Canada)
 CD-ROM	1	Includes the software and manuals of tools for Network converter
 Connector cable	1	For initial setting tool
 Installation manual	1	


### ■ Other required devices (Locally purchased)

- To install tool for convertor, personal computer that satisfies the following system requirements is necessary.

Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>• Microsoft Windows 7 Professional (32-bit) SP1</li> <li>• Microsoft Windows 8.1 Pro (32-bit)</li> <li>• Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>• Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul> Supported Language: English and Chinese
Memory	1 GB or more
Display	1,024 × 768 or higher resolution, 16-bit or higher color
Interface	RS232C serial port × 1 (Use "COM1" port)
Software	Adobe Reader 9.0 or later
Optical drive	CD-ROM drive


## ■ System diagram

- **Proper system diagram**

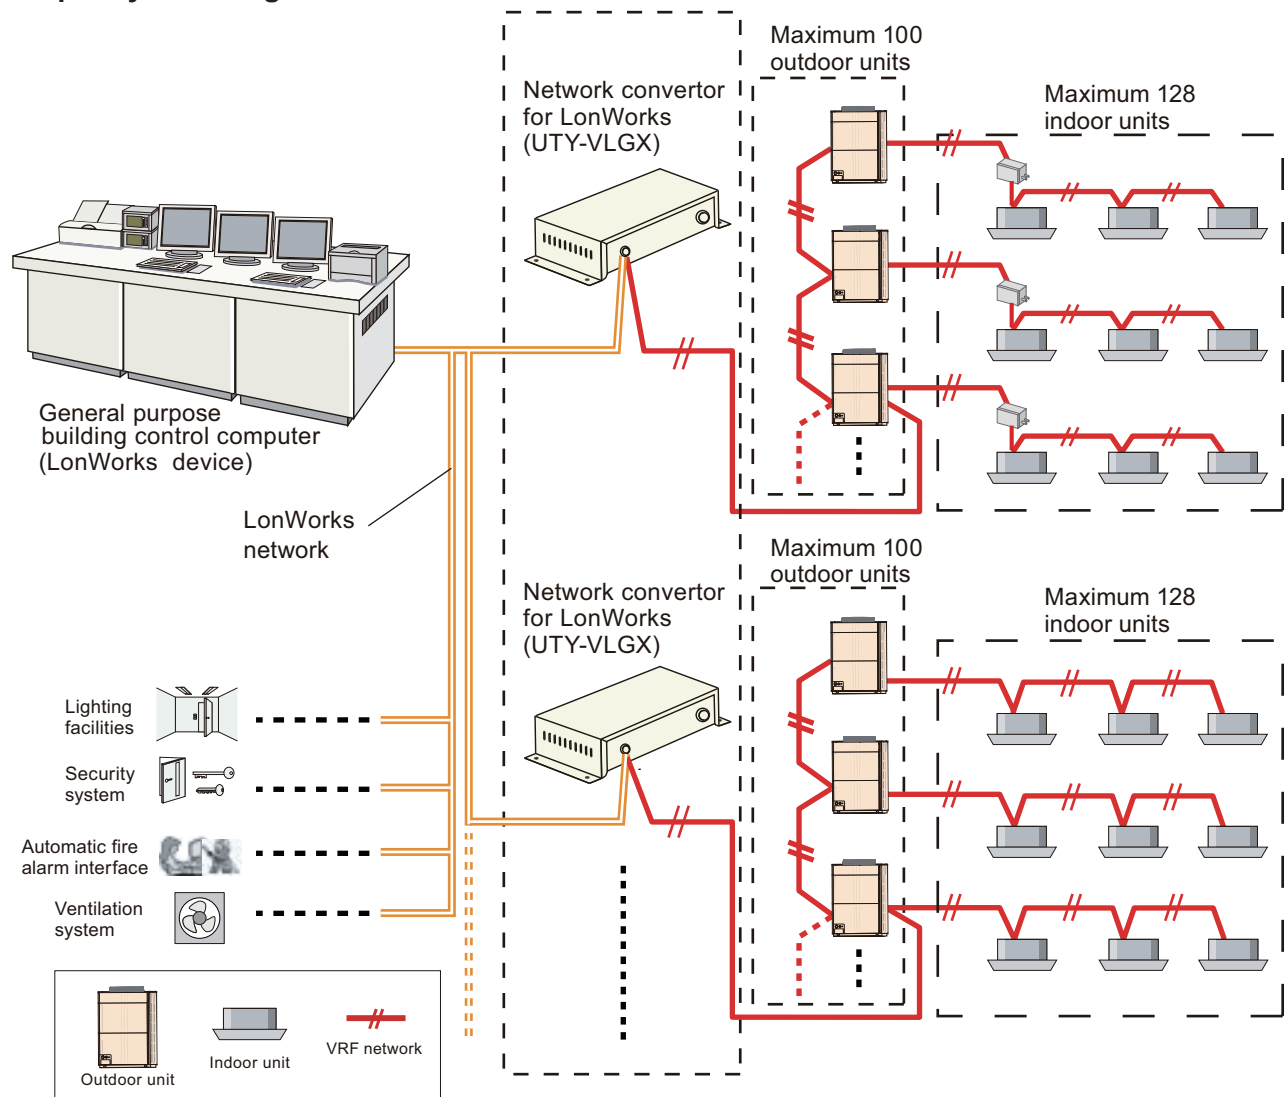


- **Improper system diagram**

- Example 1 (Prohibited)

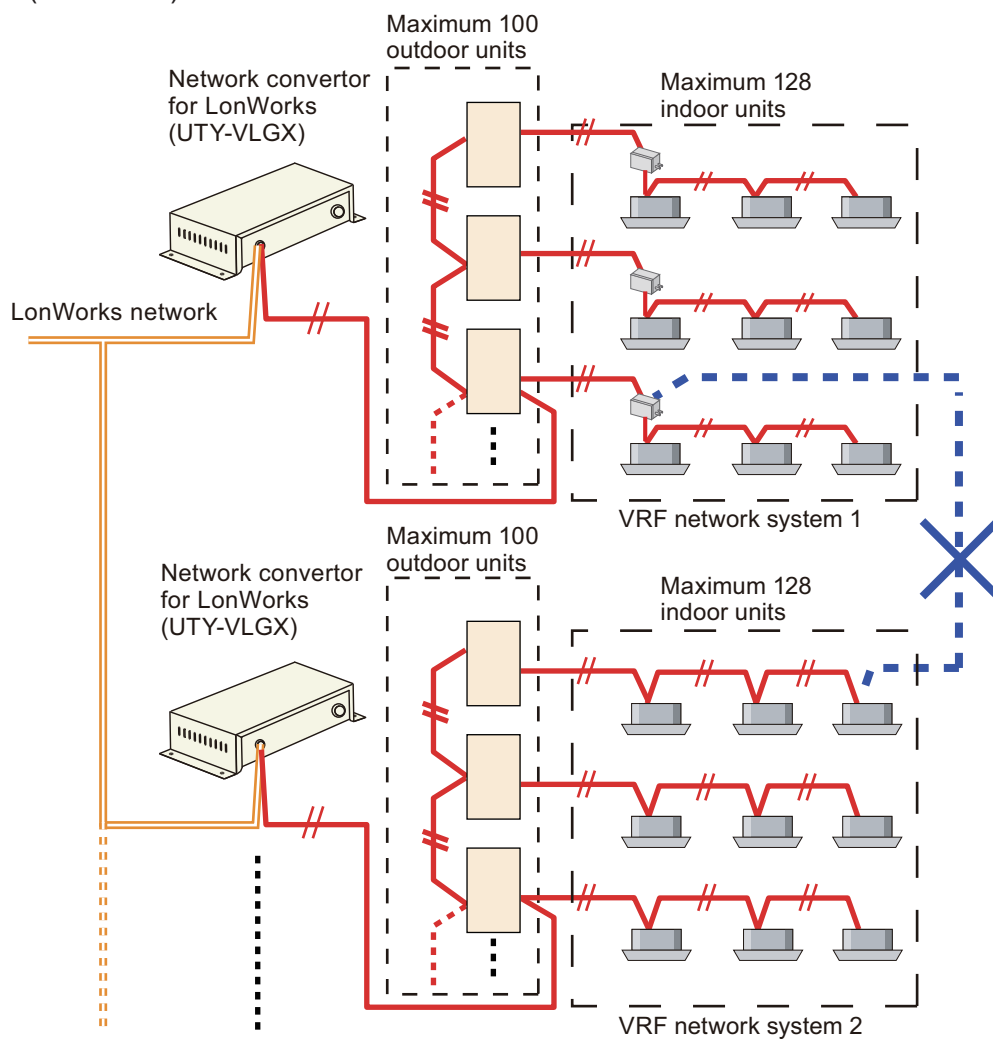


- Example 2 (Prohibited)

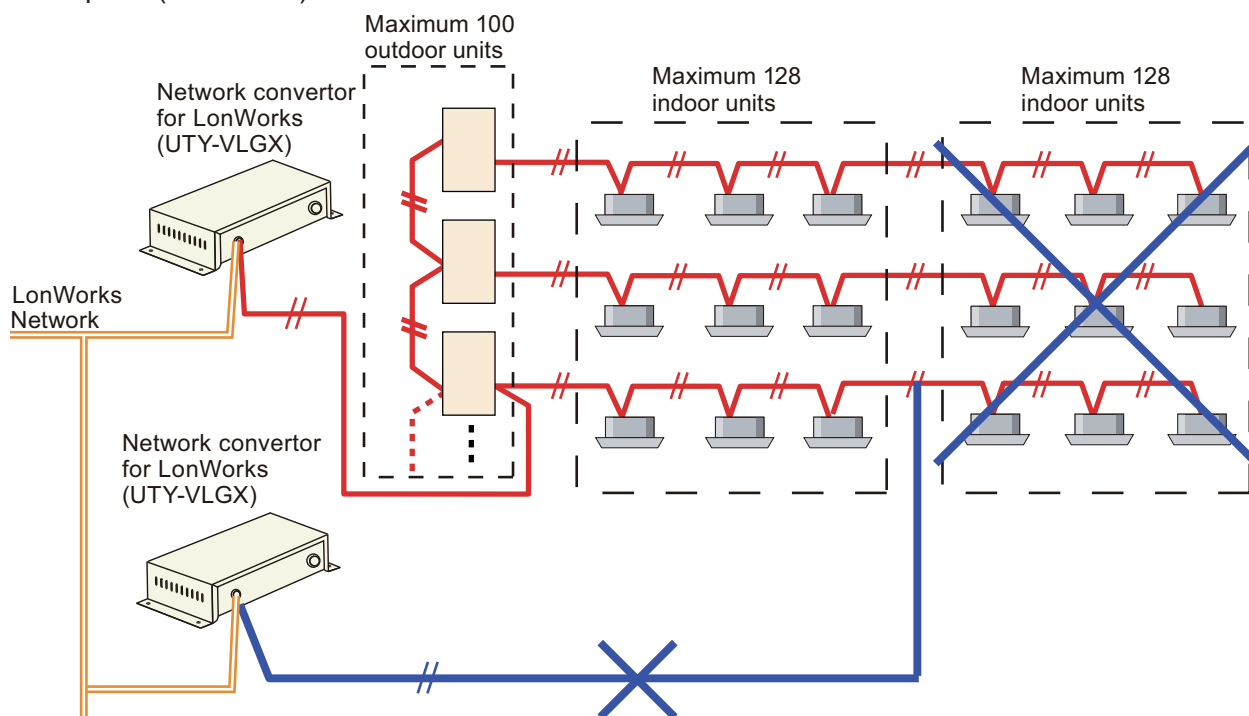




## ■ Component location of PCB

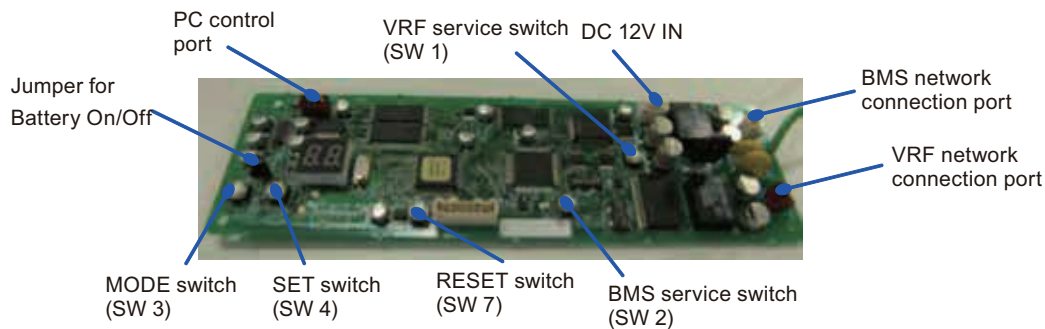

## ■ Electrical wiring

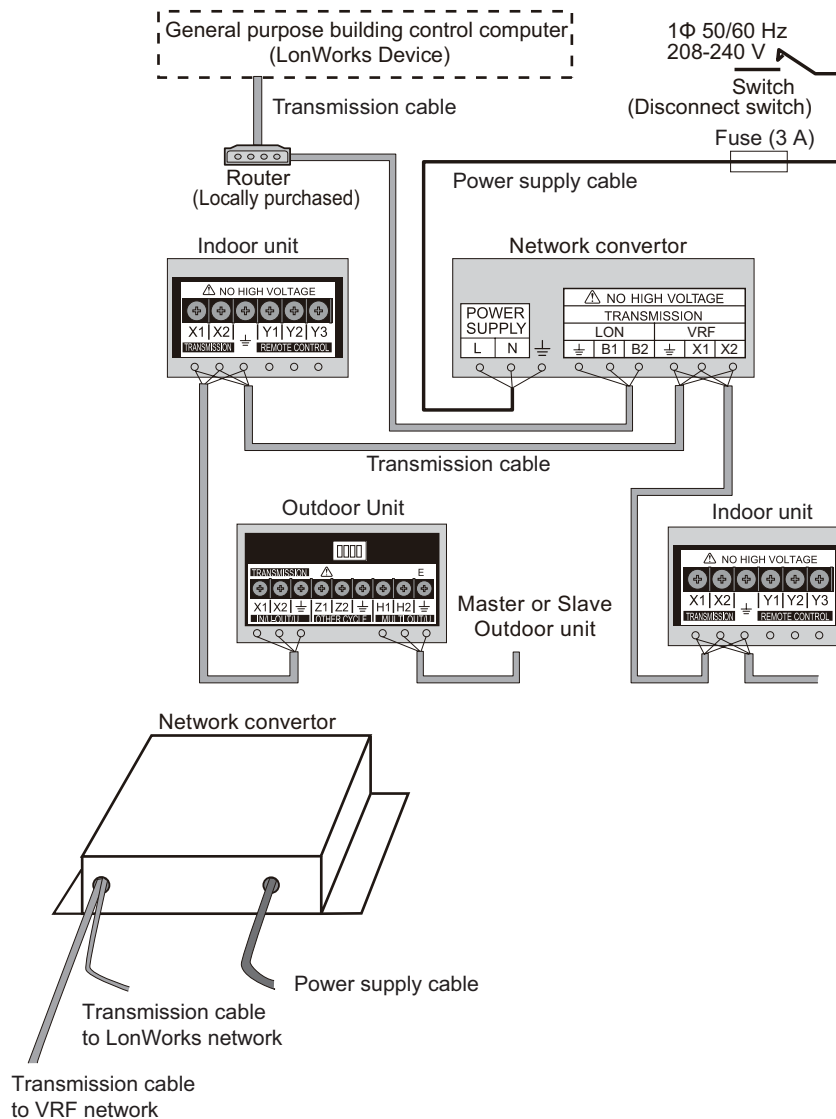

### NOTES:

- Do not bind the power cable and transmission cable to avoid an erroneous operation.
- Use shielded cable for transmission cable. The shield metal should be grounded.
- Do not forget to ground the Network converter.

## ■ Functions

### • Indoor unit control

#### – Individual control

Commands from LonWorks network are sent to the respective indoor units.

(LonWorks network → respective indoor units of VRF network)

#### – Batch control

Commands from LonWorks network are sent to all indoor units connected to VRF network.

(LonWorks network → All indoor units of VRF network)

### • Indoor unit status monitoring

Indoor unit status is communicated to the LonWorks network in the form of Lon network variables.

(LonWorks network ← All indoor units of VRF network)

## ● Control and monitoring items

Item	Function	Description
Indoor unit control (Individual/Batch)	On/Off Command* <sup>1</sup>	Start/Stop operation
	Operation mode setting	Cooling/Heating/Auto/Fan/Dry
	Temperature setting	Set room temperature
	Airflow mode setting	Set airflow
	Set point temperature limit Setting	Set room temperature lower limit & room temperature upper limit
	Thermostat off setting* <sup>1*2</sup>	Thermostat off (Only one controller in VRF network system can do this.)
	Centrally control (Filter reset)	Prohibition of filter sign reset of remote controller
	Centrally control (All mode)	Prohibition of all mode of remote controller
	Centrally control (Timer mode)	Prohibition of timer mode of remote controller
	Centrally control (Set temperature mode)	Prohibition of set temperature mode of remote controller
	Centrally control (On/Off mode)	Prohibition of On/Off mode of remote controller
	Centrally control (On mode)	Prohibition of On mode of remote controller
	Centrally control (Operation mode)	Prohibition of operation mode of remote control
Indoor unit control (Individual)	Filter sign reset	Set filter sign reset command
	Anti-freeze setting	Set anti-freeze command
	Energy save mode setting	Set energy save command
Indoor unit control (Batch)	Time setting	Set time setting command (The controllers those are connected in VRF network system are an object.)
	Emergency stop setting	Set emergency stop command
Outdoor unit control (Individual)	Outdoor unit low noise	Outdoor unit low noise level setting
	Outdoor unit capacity save	Outdoor unit capacity save setting

Item	Function	Description
Indoor unit monitoring (Individual)	On/Off Status* <sup>1</sup>	The indoor unit which is now operating can be monitored in all indoor units
	Operation mode setting status	Cooling/Heating/Auto/Fan/Dry mode status
	Temperature setting status	Room set temperature status
	Airflow mode setting status	Airflow mode status
	Set point temperature limit status	Room set temperature limit status
	Thermostat off setting status* <sup>1*2</sup>	Thermostat off set value status
	Centrally control (Filter reset) status	Remote controller filter reset prohibition status
	Centrally control (All mode) status	Remote controller all mode prohibition status
	Centrally control (Timer mode) status	Remote controller timer mode prohibition status
	Centrally control (Set temperature) status	Remote controller set temp. prohibition status
	Centrally control (On/Off) status	Remote controller On/Off prohibition status
	Centrally control (On) status	Remote controller On prohibition status
	Centrally control (Operation) status	Remote controller operation prohibition status
	Anti-freeze setting status	Anti-freeze set status
	Energy save mode setting status	Energy save mode set status
	Filter sign reset status	Filter sign reset status
	Room temperature status	Room temperature status
	Error code status	Error code status can be monitored.
	Operation mode restriction status	Restriction item* <sup>3</sup> can be monitored.
Indoor unit monitoring (Batch)	Maintenance mode status	Maintenance status
	Emergency stop setting status	Emergency stop setting status
Outdoor unit monitoring (Individual)	Error code Status	Error code status
Convertor unit monitoring (Individual)	Error code Status	Error code status


**NOTES:**

- For detailed information, refer to the interface specification posted on “Service & Supports” page of the web site.  
<https://www.fujitsu-general.com/global/support/>
- \*1: To protect the compressor of the outdoor unit, carefully read and understand the following caution that may affect the operation of compressor before executing the setting.

**⚠ CAUTION**

When performing periodical settings like schedule settings for the following functions, perform the setting to all indoor units in the same refrigerant system simultaneously, conforming to the timing restriction described below.


<Corresponding function>

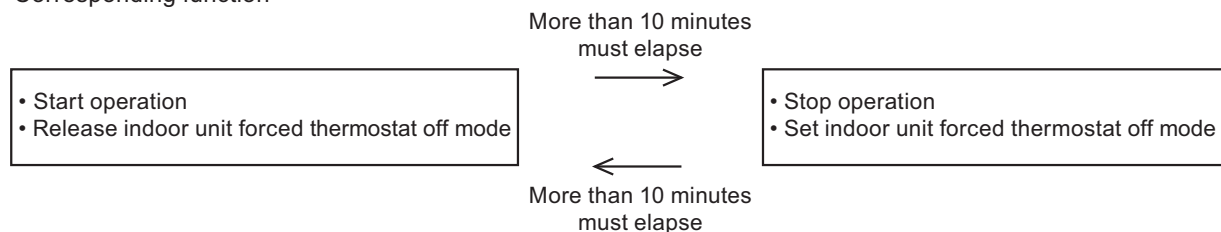

- \*2: Forced thermostat off instruction
  - Only one equipment can send these instructions for each refrigerant system.
  - When these instructions are sent by multiple equipment, the system may not respond as instructed or may cause malfunction.
- \*3: All operation setting, Timer setting, Room temperature setting, Operation mode setting, On/Off Operation, Filter reset operation, On operation setting

## ■ Dimensions

Unit: in (mm)

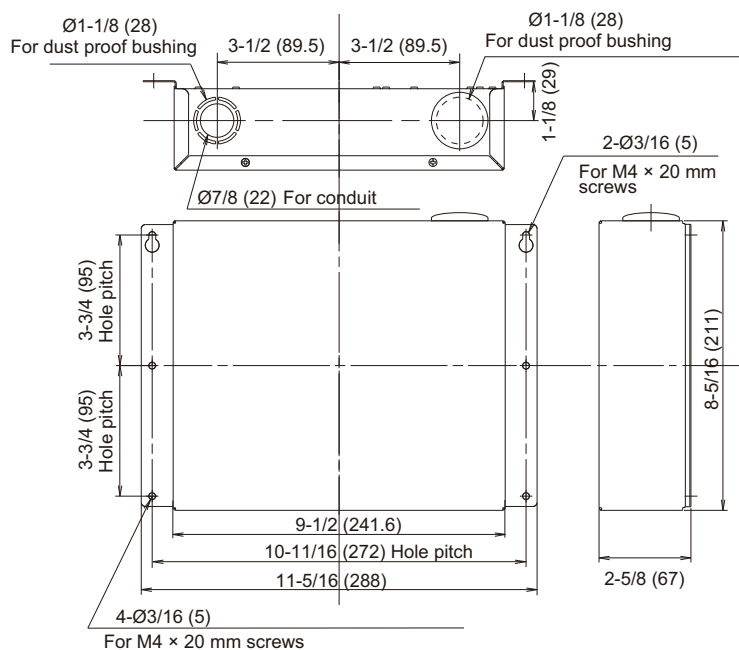

## ■ Specifications

Power supply		V	1 $\varnothing$ AC 208—240
Power source frequency		Hz	50/60
Input power		W	4.5
Temperature	Operating	$^{\circ}\text{F}$ ( $^{\circ}\text{C}$ )	32 to 114.8 (0 to 46)
	Packaged	$^{\circ}\text{F}$ ( $^{\circ}\text{C}$ )	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H $\times$ W $\times$ D)		in (mm)	2-5/8 $\times$ 11-5/16 $\times$ 8-5/16 (67 $\times$ 288 $\times$ 211)
Weight		lb (g)	3 (1,500)
Fuse capacity		A	3


## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Power supply cable	20 to 16 AWG (0.5 to 1.25 mm <sup>2</sup> )	60245 IEC 57 or equivalent	1 $\varnothing$ AC 208—240 V 50/60 Hz, 2 wire + ground (Always ground the unit)
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL 4 (NEMA) Non-polar 2 core, twisted pair solid core shielded	LonWorks compatible cable

## ● Transmission specifications

LonWorks network		
Transmission speed	kbps	78
Transceiver	FT-X1 (Echelon corporation)	
Transmission way form	Free topology	
Cable	Twisted pair cable (Shield)	
	22 AWG Equivalent	
Network connector	One terminal	
Terminal register	None attachment (It attaches at the terminal of a network)	

## ■ Total system configuration layout

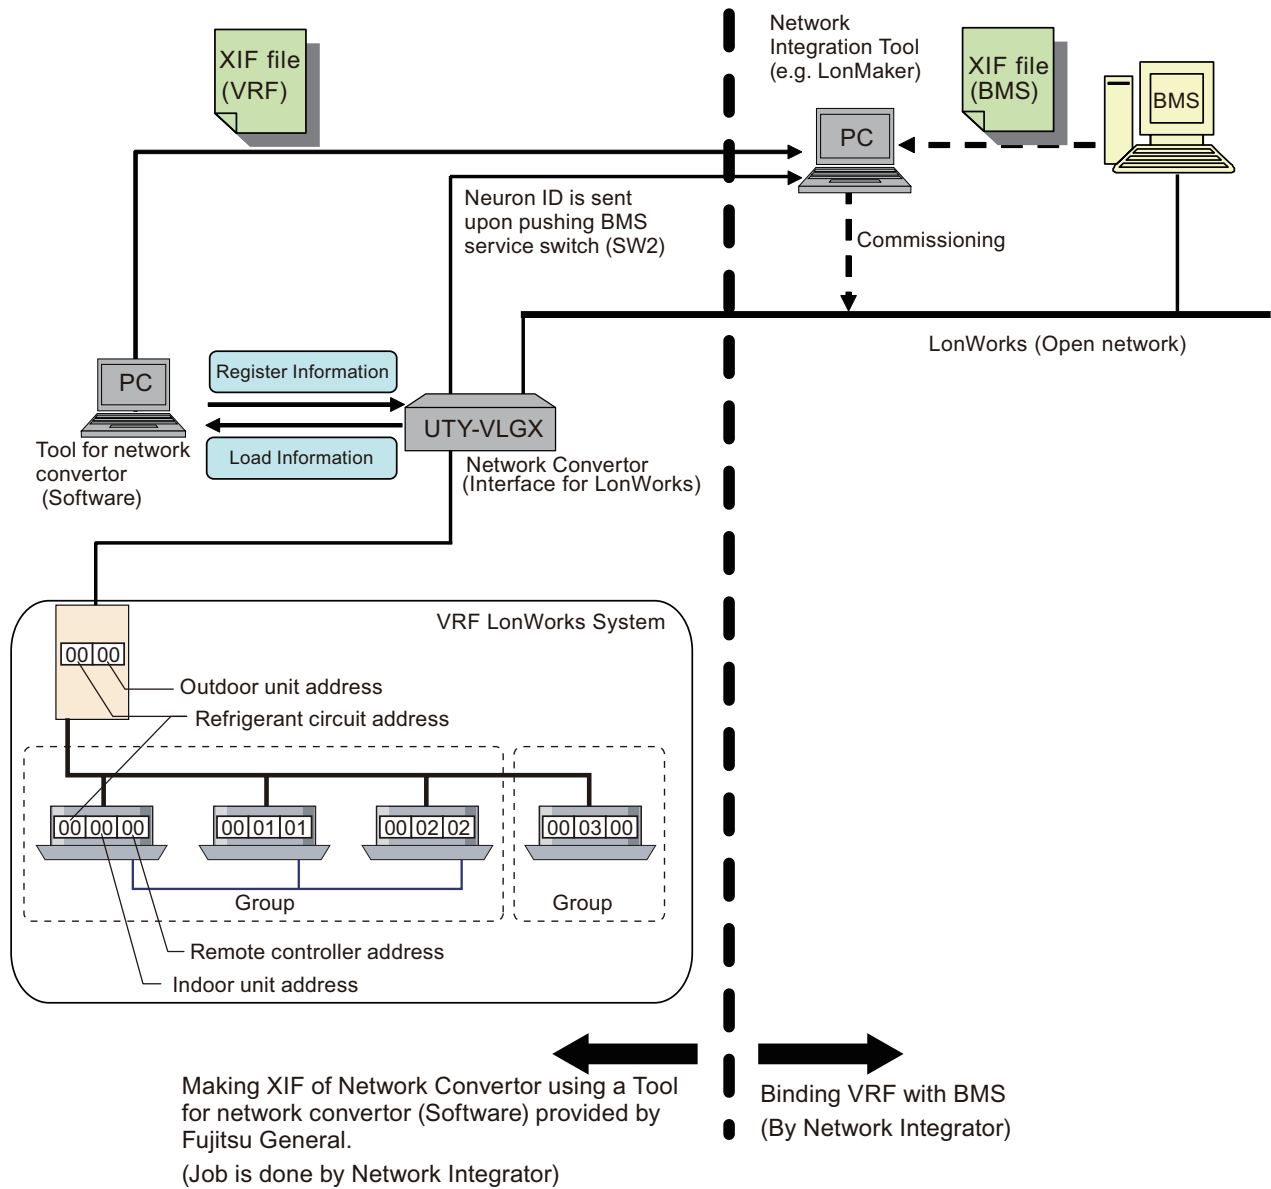

## ■ Simple procedure for create XIF and register data to Network converter for LonWorks

### ! Important

Network converter will not operate if,

- VRF network system address (Outdoor and Indoor units address) allocation information are not registered to Network converter.
- XIF data information and VRF network system address allocation information must not be the same.
- Binding and commissioning are not executed. (During binding, read out the Network converter Neuron ID by pushing BMS service switch [SW2] on the main PCB of Network converter.)
- If the ID number registered to the Network converter is not same as the ID number which is included in the XIF of Network converter.

**NOTE:** For detailed information, refer to the application manual which is included inside packaged CD-ROM.

The following is the on-line procedure. It is also possible to create XIF and register data off-line.







1. Connect the PC and this product.  
Connection will be done by the connector cable provided as an accessory item of this product.
2. Install tool for convertor (software) in PC.  
Tool for convertor is the accessory item of this product.
3. Set this product to installation mode.
4. Setting ID number of this product on PC screen of tool for convertor.  
(ID number is required to identify this product from BMS. A maximum number of four Network converters can be connected to one BMS, and ID number allocation is like 00, 01, and so on.)
5. Initial setting of indoor unit and outdoor unit address by using the tool for convertor.
6. Register the initial setting data to this product. Click "Register" dialog.
7. Set configuration properties.  
To set the communication properties of this product, select the following communication properties and types; otherwise, the default value will be used.
  - Select communication items
    - Event driven communication or Cyclic communication (Default: Cyclic 3 minutes)
    - Communication interval time during turning on all together (Default: 3 minutes)
  - Select communication type (to communicate data with BMS)
    - Communicate only when changing network variable or communicate all network variable. (Default: Only when changing network variable)
    - Communicate only when changing room temperature value (Default: Room temperature changed value 1.8 °F [1 °C])
8. Register the configuration properties data to this product. Click the "Register" dialog.
9. Creating/Modifying XIF, and transfer XIF data by USB memory or floppy disk for binding.
10. Press "Reset SW7" to reset this product.
11. Turn off the power. After that, remove the connection of PC and this product respectively. In this stage, Network converter is ready for binding and commissioning.

### 3-5. Modbus converter for VRF (UTY-VMGX)



The convertor for connecting VRF network system to the BMS system built by Modbus open network, for manage small to medium sized BMS and VRF network system.

#### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	7	For mounting the power supply cable and transmission cable
 Screw (M4 × 16 mm)	4	For mounting the Modbus converter
 DVD	1	For initial setting
 Modbus connector	1	For connecting the cable and attaching the board connector
 USB cable	1	For initial setting tool
 Installation manual	1	


#### ■ Other required devices (Locally purchased)

- To install tool for convertor, personal computer that satisfies the following system requirements is necessary.

Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>Microsoft Windows 7 Home Premium (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 8.1 (32-bit or 64-bit)</li> <li>Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul> <p>Supported languages: English, Chinese, French, German, Russian, Spanish, and Polish</p>
Memory	1 GB or more
Display	1,366 × 768 or higher resolution
Interface	USB port (× 1)
Software	Adobe Reader 11.0 or later
Optical drive	DVD drive

## ■ System diagram

### • Proper system diagram

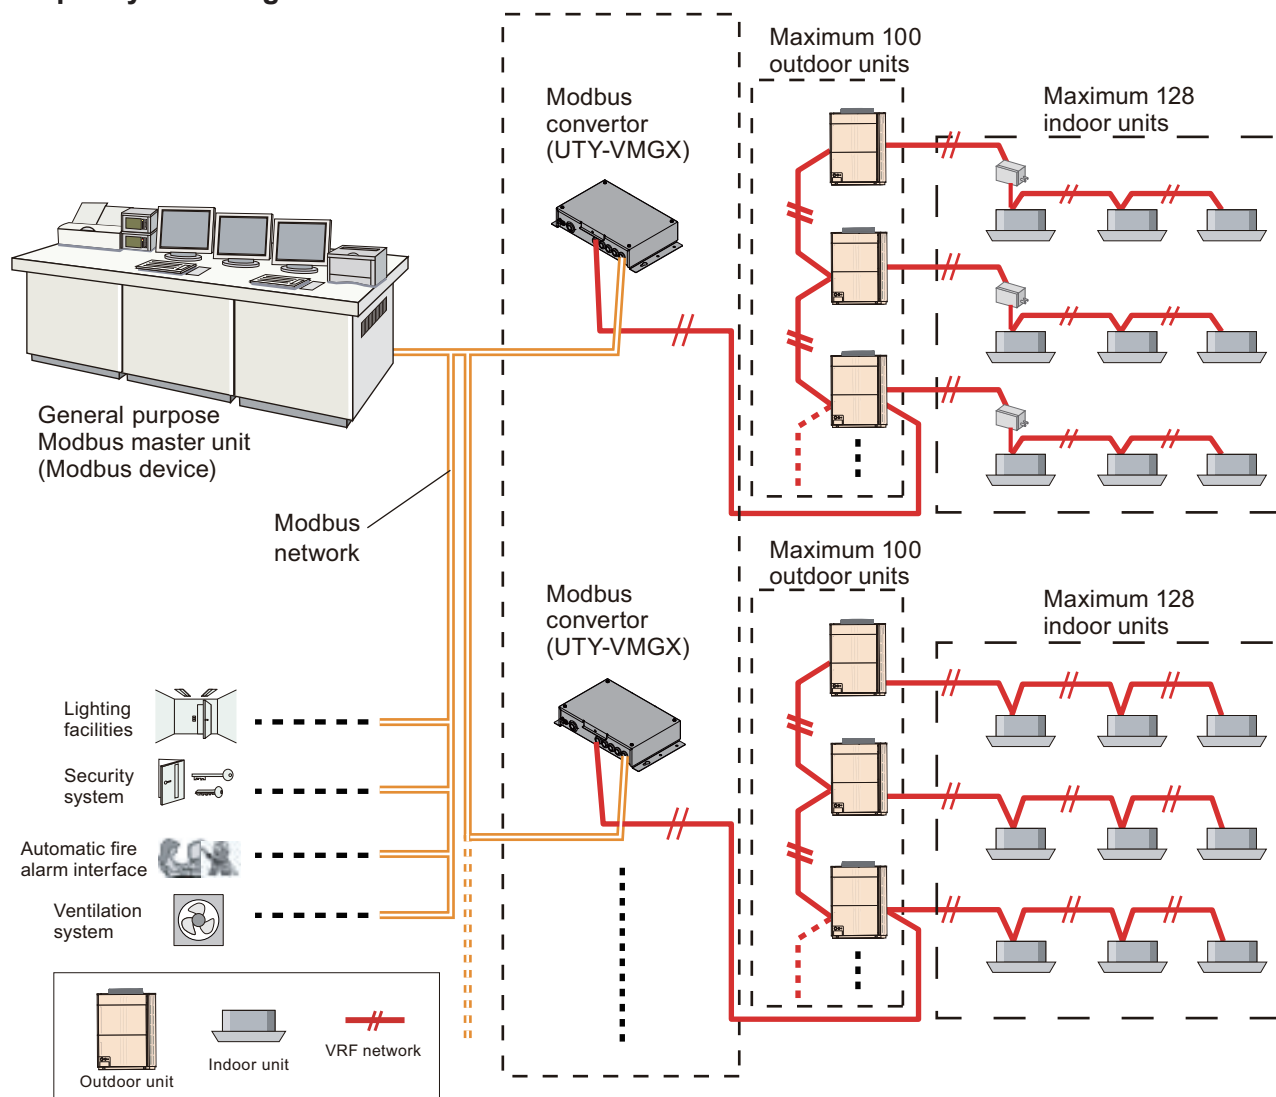


### • Connected unit


Maximum controllable indoor units number per 1 Modbus converter		128
Maximum controllable outdoor units number per 1 Modbus converter		100
Maximum connectable Modbus converter number per 1 VRF network system		9
Maximum number of connected Modbus converter units to one Modbus master unit	Without repeater	31
	With repeater	247



## ■ Component location of PCB

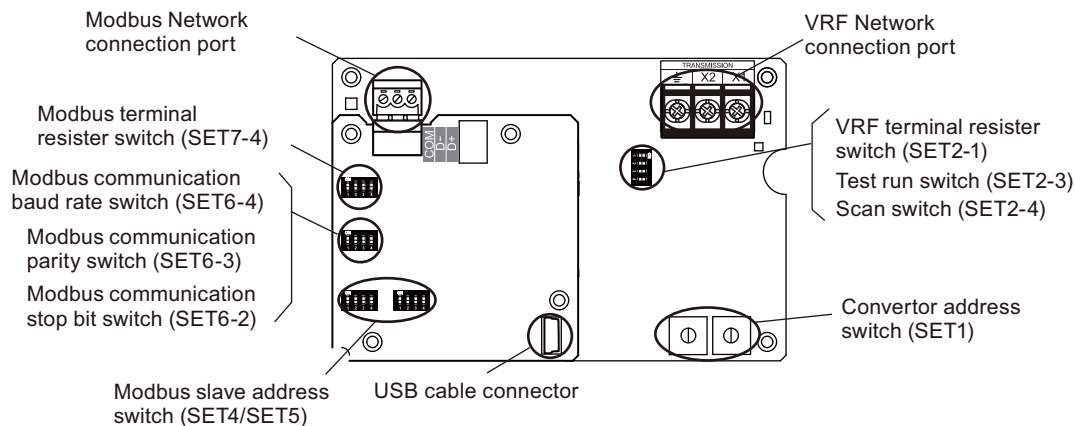

## ■ Electrical wiring

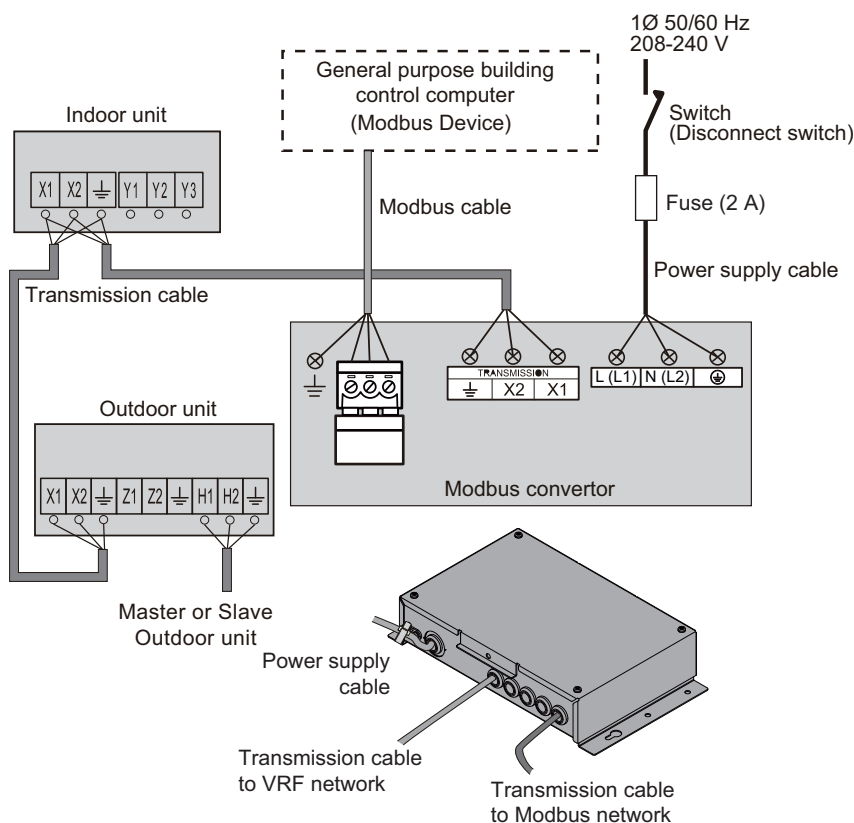

## ■ Functions

### • Indoor unit control

#### – Individual control

Commands from Modbus network are sent to the respective indoor units.  
(Modbus network → respective indoor units of VRF network)

#### – Batch control

Commands from Modbus network are sent to all indoor units connected to VRF network.  
(Modbus network → All indoor units of VRF network)

### • Indoor unit status monitoring

Indoor unit status is communicated to the Modbus network in the form of Lon network variables.  
(Modbus network ← All indoor units of VRF network)

## ● Control and monitoring items

Item	Function	Description
Indoor unit control (Individual/Batch)	On/Off Command* <sup>1</sup>	Start/Stop operation
	Operation mode setting	Cooling/Heating/Auto/Fan/Dry
	Temperature setting	Set room temperature
	Airflow mode setting	Set airflow
	Set point temperature limit Setting	Set room temperature lower limit & room temperature upper limit
	Thermostat off setting* <sup>1*2</sup>	Thermostat off (Only one controller in VRF network system can do this.)
	Centrally control (Filter reset)	Prohibition of filter sign reset of remote controller
	Centrally control (All mode)	Prohibition of all mode of remote controller
	Centrally control (Timer mode)	Prohibition of timer mode of remote controller
	Centrally control (Set temperature mode)	Prohibition of set temperature mode of remote controller
	Centrally control (On/Off mode)	Prohibition of On/Off mode of remote controller
	Centrally control (On mode)	Prohibition of On mode of remote controller
	Centrally control (Operation mode)	Prohibition of operation mode of remote control
Indoor unit control (Individual)	Filter sign reset	Set filter sign reset command
	Anti-freeze setting	Set anti-freeze command
	Energy save mode setting	Set energy save command
	Vertical/Horizontal airflow direction louver	Set Vertical/Horizontal airflow direction louver
Indoor unit control (Batch)	Time setting	Set time setting command (The controllers those are connected in VRF network system are an object.)
	Emergency stop setting	Set emergency stop command
Outdoor unit control (Individual)	Outdoor unit low noise	Outdoor unit low noise level setting
	Outdoor unit capacity save	Outdoor unit capacity save setting
Indoor unit monitoring (Individual)	On/Off Status* <sup>1</sup>	The indoor unit which is now operating can be monitored in all indoor units
	Operation mode setting status	Cooling/Heating/Auto/Fan/Dry mode status
	Temperature setting status	Room set temperature status
	Airflow mode setting status	Airflow mode status
	Set point temperature limit status	Room set temperature limit status
	Thermostat off setting status* <sup>1*2</sup>	Thermostat off set value status
	Centrally control (Filter reset) status	Remote controller filter reset prohibition status
	Centrally control (All mode) status	Remote controller all mode prohibition status
	Centrally control (Timer mode) status	Remote controller timer mode prohibition status
	Centrally control (Set temperature) status	Remote controller set temp. prohibition status
	Centrally control (On/Off) status	Remote controller On/Off prohibition status
	Centrally control (On) status	Remote controller On prohibition status
	Centrally control (Operation) status	Remote controller operation prohibition status
	Anti-freeze setting status	Anti-freeze set status
	Energy save mode setting status	Energy save mode set status
	Filter sign reset status	Filter sign reset status
	Room temperature status	Room temperature status
	Error code status	Error code status can be monitored.
	Vertical/Horizontal airflow direction louver status	Vertical/Horizontal airflow direction louver status
	Indoor unit status	Defrost/oil recovery/pump down can be monitored.

Item	Function	Description
Indoor unit monitoring (Batch)	On/Off status*1	The indoor unit which is now operating can be monitored in all indoor units.
	Maintenance mode status	Maintenance status
	Emergency stop setting status	Emergency stop setting status
	Error status	The indoor unit which is now error can be monitored in all indoor units.
Outdoor unit monitoring (Individual)	Outdoor unit low noise	Outdoor unit low noise level can be monitored.
	Outdoor unit capacity save	Outdoor unit capacity save can be monitored.
Convertor unit monitoring (Individual)	Error code Status	Error code status
	Modbus communication setting Information	Baud rate/slave address can be monitored.
	Model name	Convertor model name can be confirmed.
	Software version	Convertor software version can be confirmed.


**NOTES:**

- For detailed information, refer to the interface specification posted on “Service & Supports” page of the web site.  
<https://www.fujitsu-general.com/global/support/>
- \*1: To protect the compressor of the outdoor unit, carefully read and understand the following caution that may affect the operation of compressor before executing the setting.

**⚠ CAUTION**

When performing periodical settings like schedule settings for the following functions, perform the setting to all indoor units in the same refrigerant system simultaneously, conforming to the timing restriction described below.

<Corresponding function>

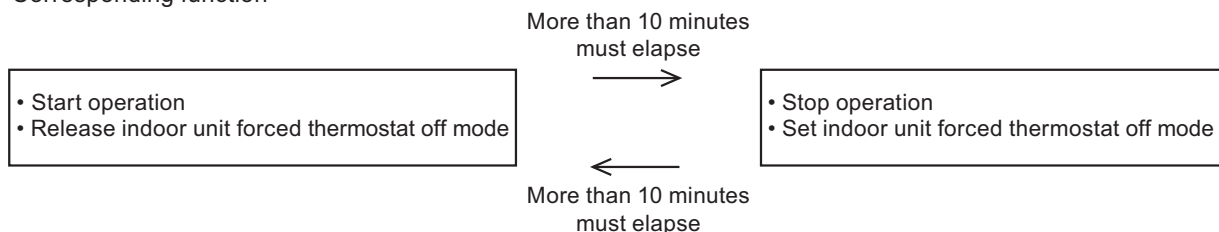

- \*2: Forced thermostat off instruction
  - Only one equipment can send these instructions for each refrigerant system.
  - When these instructions are sent by multiple equipment, the system may not respond as instructed or may cause malfunction.

## CONTROL SYSTEM

### 3. Adaptor/Converter units



## ● Wiring specifications

## ● Transmission specifications

Transfer mode		RTU mode
Communication method		Half-duplex operation, Master/Slave method
Communication speed	bps	9,600/19,200
Synchronous system		Asynchronous communication method
Data bit	bit	8
Parity		even/odd/none
Stop bit	bit	2 (no parity)/1
Network		3 wire RS485
Maximum cable length	ft (m)	3,280 (1,000)

## ■ Simple procedure for register data to Modbus converter for VRF

### ! Important

Modbus converter for VRF will not operate, if VRF network system address (outdoor and indoor units address) allocation information are not registered to Modbus converter for VRF.

Address initial settings are 3 methods as follows:

### ● Default addresses of indoor unit and outdoor unit are used (Initial setting is not necessary)

Default address value ([Ref No.—Node No.]

Indoor unit: [00—00] [00—01] ... [00—63]

[01—00] [01—01] ... [01—63]

Outdoor unit: [00—00] [00—01] ... [00—03]

[01—00] [01—01] ... [01—03]

### ● Scan of connected indoor units address

Scan procedure is as follows:

1. Turn on the switch of scan setting.
2. “Scan display” by LED (Address is registering inside the convertor).
3. “Number of connected indoor unit display” by LED (Scan is complete).
4. Turn off the switch of scan setting.
5. “Address update display” by LED
6. Turn on the main power again.
7. “Address rewriting display” by LED (Address are synchronized among boards).

If scan error is generated, perform the scan again.

### ● Setting from PC

**NOTE:** For detailed information, refer to the application manual included inside packaged DVD.






1. Install tool for convertor (software) in PC.  
Tool for convertor is the accessory item of this product.
2. Connect the PC and this product.  
Connection will be done by the connector cable provided as an accessory item of this product.
3. Set this product to USB mode.
4. Initial setting of indoor unit and outdoor unit addresses by using the tool for convertor.
5. Register the initial setting data to this product. Click “Register” dialog.  
In this stage, this product is ready for binding and commissioning.

## 3-6. Modbus converter for indoor unit (UTY-VMSX)




The convertor for connecting indoor unit to the BMS system built by Modbus open network, for manage small to medium sized BMS and indoor unit.

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	4	For mounting transmission cable
 Screw (M4 × 16 mm)	3	For mounting the Modbus converter
 Modbus connector	1	For connecting the cable and attaching the board connector
 Connector cable	1	For connecting to indoor unit (1.5 m)
 Installation manual	1	

## ■ System diagram


### • Proper system diagram

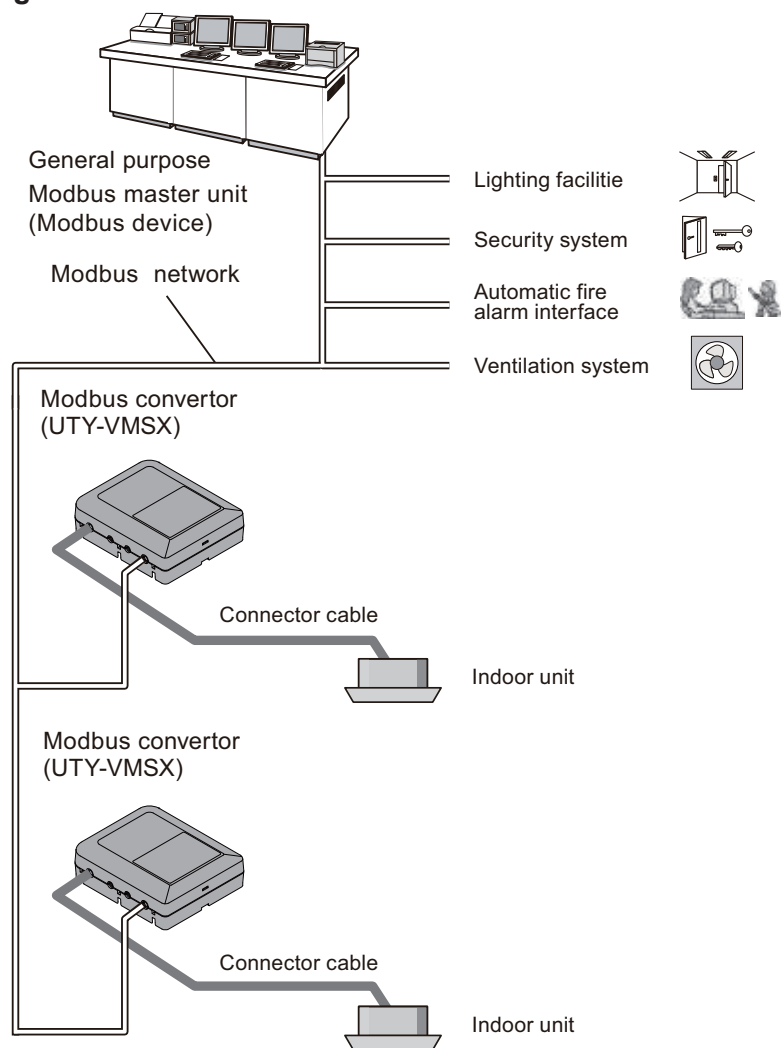



### • Connected unit

Maximum controllable indoor units number per 1 Modbus converter		1
Maximum number of connected Modbus converter units to one Modbus master unit	Without repeater	31
	With repeater	247

## ■ Component location of PCB

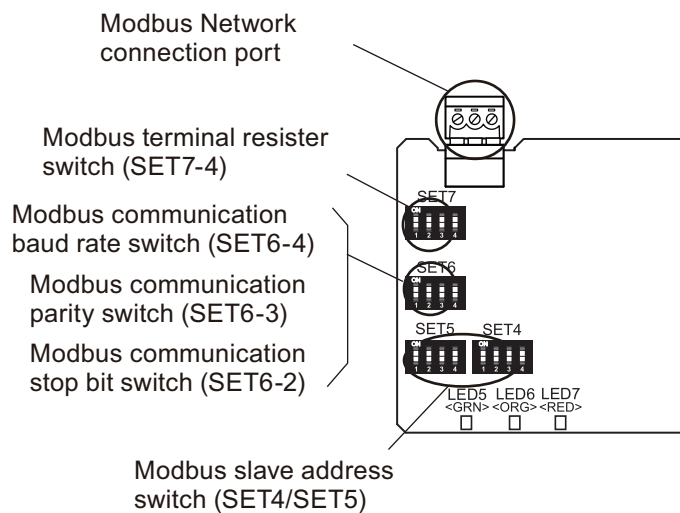

## ■ Electrical wiring

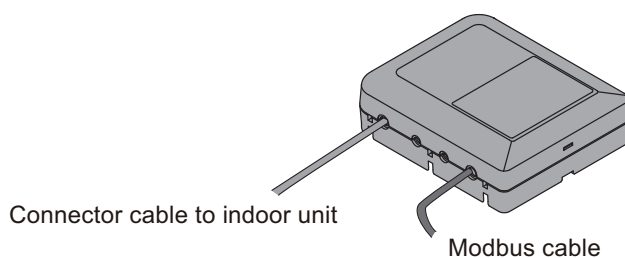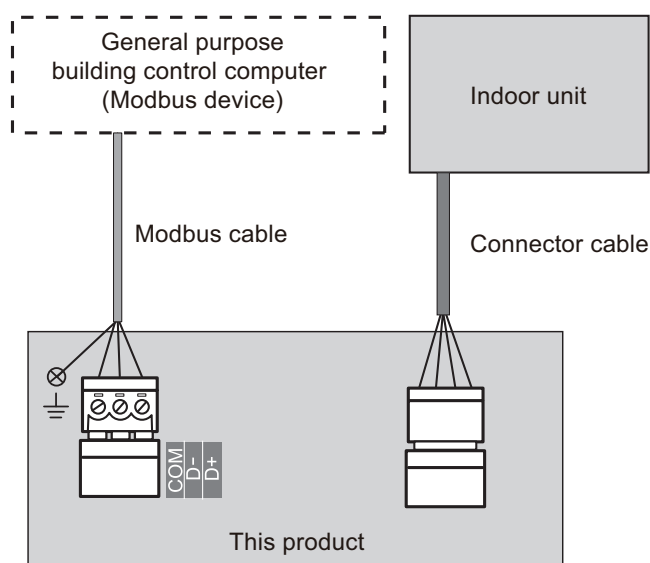



## ■ Functions

- **Indoor unit control**

Commands from Modbus network are sent to the respective indoor units.

(Modbus network → indoor units)

- **Indoor unit status monitoring**

Indoor unit status is communicated to the Modbus network in the form of indoor unit variables.

(Modbus network ← indoor units)

## ● Control and monitoring items

Item	Function	Description
Indoor unit control	On/Off Command*	Start/Stop operation
	Operation mode setting	Cooling/Heating/Auto/Fan/Dry
	Temperature setting	Set room temperature
	Airflow mode setting	Set airflow
	Thermostat off setting*	Thermostat off (Only one controller in VRF network system can do this.)
	Centrally control (Filter reset)	Prohibition of filter sign reset of remote controller
	Centrally control (All mode)	Prohibition of all mode of remote controller
	Centrally control (Timer mode)	Prohibition of timer mode of remote controller
	Centrally control (Set temperature mode)	Prohibition of set temperature mode of remote controller
	Centrally control (On/Off mode)	Prohibition of On/Off mode of remote controller
	Centrally control (On mode)	Prohibition of On mode of remote controller
	Centrally control (Operation mode)	Prohibition of operation mode of remote control
	Filter sign reset	Set filter sign reset command
	Anti-freeze setting	Set anti-freeze command
	Energy save mode setting	Set energy save command
	Vertical/Horizontal airflow direction louver	Set Vertical/Horizontal airflow direction louver
	Human detection auto save	Set human detection auto save
	Human detection auto off	Set human detection auto off

Item	Function	Description
Indoor unit monitoring	On/Off Status*	The indoor unit which is now operating can be monitored in all indoor units
	Operation mode setting status	Cooling/Heating/Auto/Fan/Dry mode status
	Temperature setting status	Room set temperature status
	Airflow mode setting status	Airflow mode status
	Set point temperature limit status	Room set temperature limit status
	Thermostat off setting status*	Thermostat off set value status
	Centrally control (Filter reset) status	Remote controller filter reset prohibition status
	Centrally control (All mode) status	Remote controller all mode prohibition status
	Centrally control (Timer mode) status	Remote controller timer mode prohibition status
	Centrally control (Set temperature) status	Remote controller set temp. prohibition status
	Centrally control (On/Off) status	Remote controller On/Off prohibition status
	Centrally control (On) status	Remote controller On prohibition status
	Centrally control (Operation) status	Remote controller operation prohibition status
	Anti-freeze setting status	Anti-freeze setting status
	Energy save mode setting status	Energy save mode set status
	Filter sign reset status	Filter sign reset status
	Room temperature status	Room temperature status
	Error code status	Error code status can be monitored.
	Vertical/Horizontal airflow direction louver status	Vertical/Horizontal airflow direction louver status
	Indoor unit status	Defrost/oil recovery/pump down can be monitored.
	Human detection auto save	Set human detection auto save status
	Human detection auto off	Set human detection auto off status
	Demand status	Demand control status
Convertor unit monitoring	Error code Status	Error code status
	Modbus communication setting information	Baud rate/slave address can be monitored.
	Model name	Convertor model name can be confirmed.
	Software version	Convertor software version can be confirmed.


**NOTES:**

- For detailed information, refer to the interface specification posted on “Service & Supports” page of the web site.  
<https://www.fujitsu-general.com/global/support/>
- \*: To protect the compressor of the outdoor unit, carefully read and understand the following caution that may affect the operation of compressor before executing the setting.

**⚠ CAUTION**

When performing periodical settings like schedule settings for the following functions, perform the setting to all indoor units in the same refrigerant system simultaneously, conforming to the timing restriction described below.

<Corresponding function>

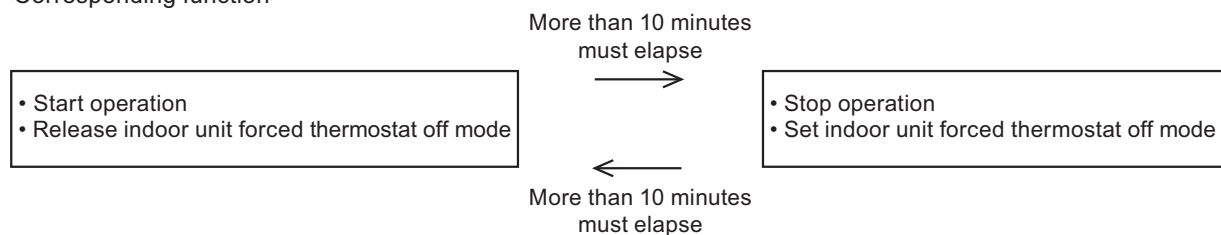






### 3-7. BACnet gateway (Hardware: UTY-VBGX)



- The convertor for connecting VRF network system to the BMS system using BACnet protocol.
- Maximum of 128 indoor units can be connected to one BACnet gateway.
- VRF system can be centrally controlled or monitored by BMS via BACnet gateway (UTY-VBGX).
- Maximum of 4 BACnet gateway can be connected to one BMS.

#### ■ Accessory


Name and shape	Q'ty	Application
 USB memory	1	Includes the software and manuals of tool for BACnet gateway
 Connector cable	1	For initial setting tool
 Dust proof bushing	2	For connecting the power supply cable

#### ■ Other required devices (Locally purchased)

- To install tool for BACnet gateway, personal computer that satisfies the following system requirements is necessary.


Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>• Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>• Microsoft Windows 8.1 Pro (32-bit)</li> <li>• Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>• Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul>
Memory	1 GB or more
Display	1,024 × 768 or higher resolution, 16-bit or higher color
Interface	USB port (× 1)
Software	Adobe Reader 9.0 or later

## System diagram

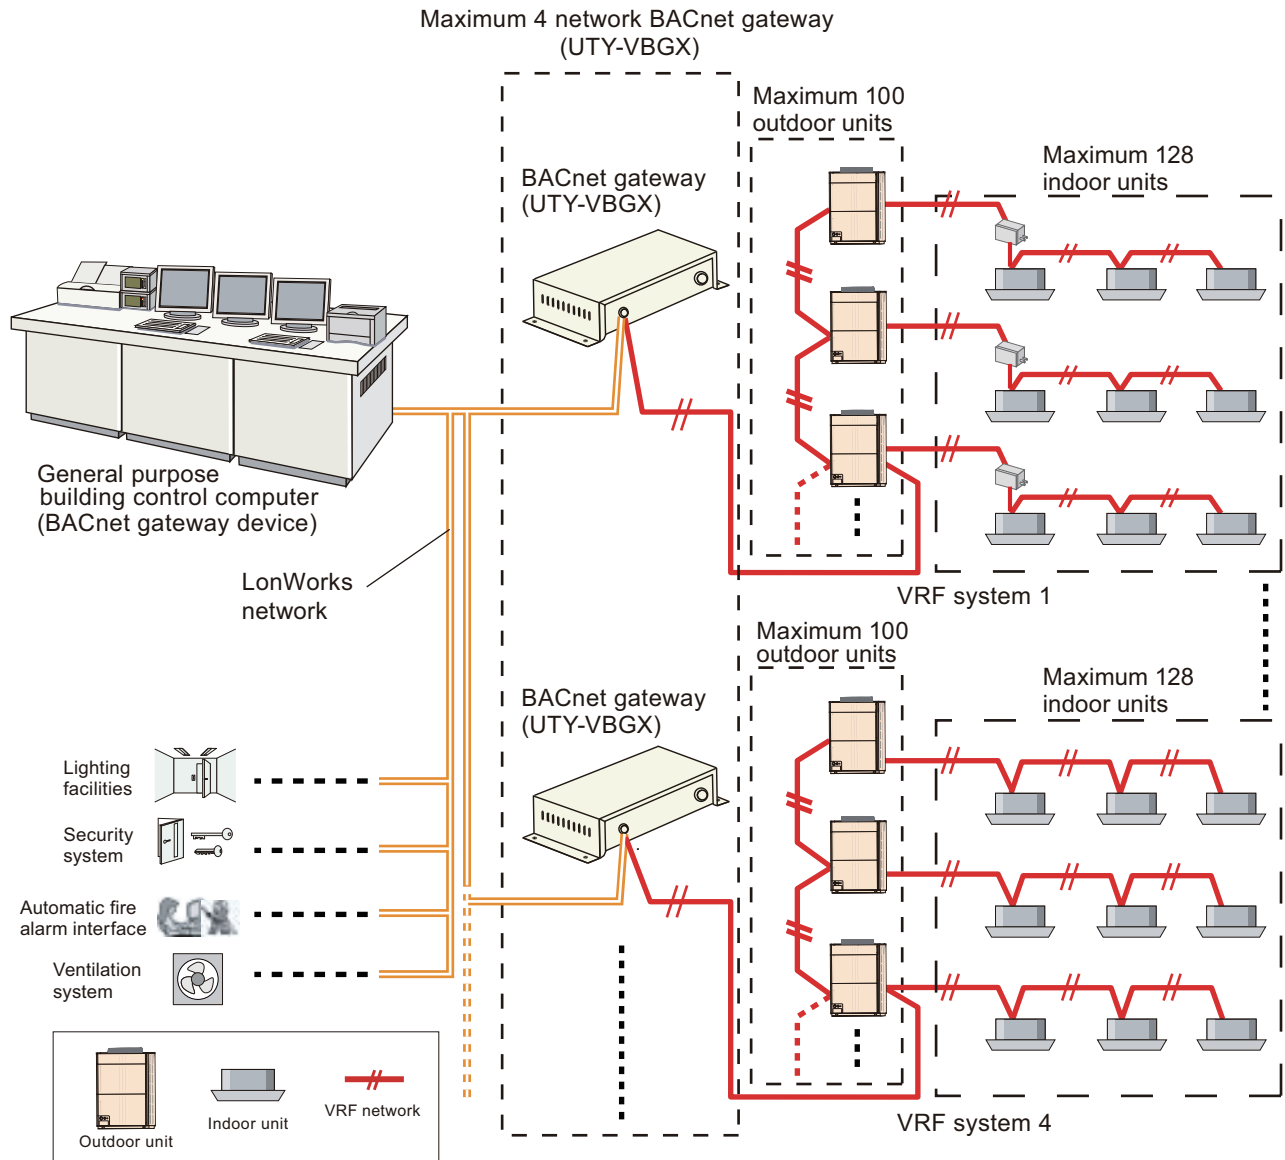

**NOTE:** BACnet gateway (Hardware) and BACnet gateway (Software) cannot co-exist within a VRF system.

## ■ Component location of PCB

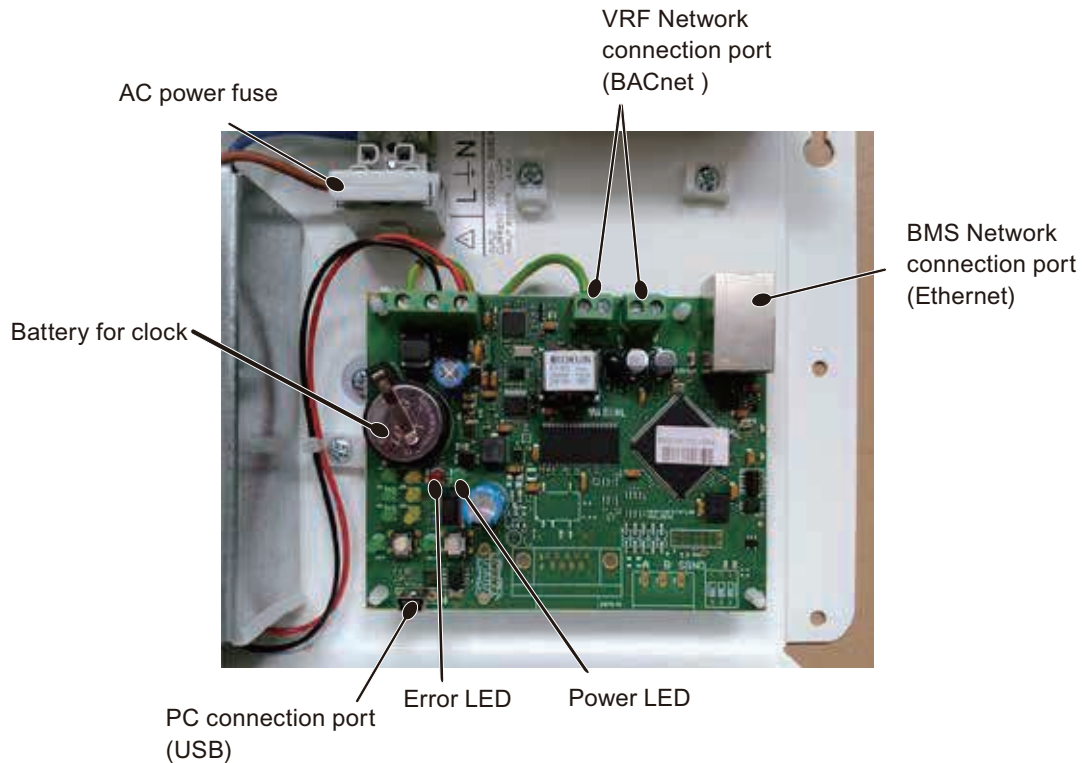

**NOTE:** Ensure proper space for all connectors when mounted.

### ⚠ CAUTION

Risk of explosion if battery is replaced by an incorrect type. Dispose of used batteries according to the instructions.

### ! Important

Tight the power supply and the Lon cables to one of the 4 cable tie holes fixed to the casing with the plastic ties inside the BACnet gateway (Hardware). Do not use 2 holes to tie one cable.

#### • Power supply

Connect mains to the power supply connector as:

- Brown: Line (L)
- Yellow: Earth/Ground (E)
- Blue: Neutral (N)

#### • Ethernet/BACnet IP (UDP)/Console (UDP and TCP)

Connect the cable coming from the IP network to the connector ETH of the gateway. Use an Ethernet CAT5 or higher cable.

#### • VRF network

Connect the Lon bus to connectors A (+), B (-) and (SNGD) of gateway's PCB.


#### • Console port

Connect a mini-type B USB cable from your computer to the gateway to allow communication between the configuration software and the gateway. Ethernet connection is also allowed for configuration.

## ■ Configuration procedure

The following procedures presume that all VRF indoor/outdoor units are commissioned and operational, and that BACnet network toward the BMS workstation is operational.

1. Turn on the device.  
Power supply working with any of the voltage range allowed is necessary. Once connected the LED power will turn on.
2. Connect to BACnet interface.  
Connect the communication cable coming from the network hub or switch to the Ethernet port of the gateway. The cable to be used is a straight Ethernet STP CAT5 or higher cable.  
In case there is no response from the BACnet devices to the frames sent by gateway, check that they are optional and reachable from the network connection used by the gateway.  
Check the gateway Ethernet interface sending pings to its IP address using a PC connected to the same Ethernet IP network. If the problem persists communicating through the LAN of the building, contact the network administrator.  
BACnet gateway for VRF systems comes with DHCP functionality enabled by default.
3. Connect to VRF network.  
Use the Lon connector in the left bottom corner of the gateway in order to connect the VRF network to BACnet gateway.

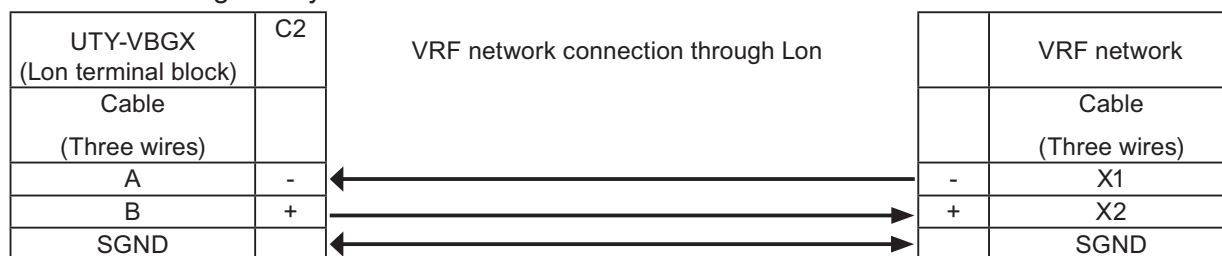


4. Connect to PC (Configuration tool).  
This action allows the user to have access to configuration and monitoring of the device. Two methods to connect to the PC can be used:
  - USB cable: To connect the device to the PC the USB cable supplied should be plugged to USB console port. (This method is recommended.)
  - Ethernet: Using ETH port of the gateway

**NOTE:** Install the configuration tool to the PC before connecting to the gateway.

5. Execute the configuration tool from the PC and perform necessary settings.  
For details, refer to Instruction manual.
6. Perform scan from the configuration tool, and check that all VRF indoor/outdoor units are detected and available.
7. Remove the USB cable from the gateway, and close the case.  
In this stage, BACnet gateway should be accessible from the BMS workstation. Integration of BACnet system is ready to be performed.

## ■ Electrical wiring

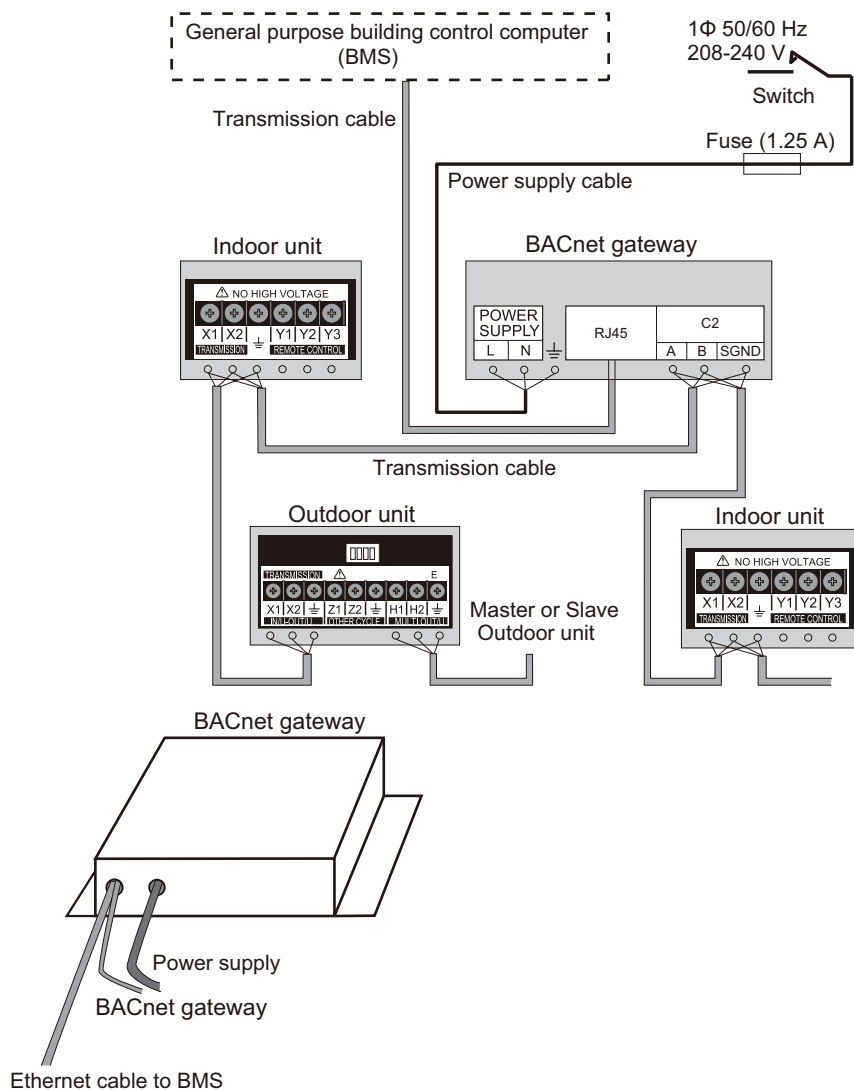

### NOTES:

- Do not bind the power supply cable and transmission cable to avoid an erroneous operation.
- Use shield cable for transmission cable. The shield metal should be grounded.
- Do not forget to ground the BACnet gateway.

## ■ Functions

### • Indoor unit control

#### – Individual control

Commands from BACnet network are sent to the respective indoor units.  
(BACnet network → respective indoor units of VRF network)

#### – Batch control

Commands from BACnet network are sent to all indoor units connected to VRF network.  
(BACnet network → All indoor units of VRF network)

### • Indoor unit status monitoring

Indoor unit status is communicated to the BACnet network in the form of BACnet objects.  
(BACnet network ← All indoor units of VRF network)



## ● Control and monitoring items with object types

Function name	Category			BACnet object type*1	Remarks
	Target	Monitor	Control		
Operation setting*2	Bat	—	○	BO	
Operation mode	Bat	—	○	MO	
Temperature setting	Bat	—	○	AO	
Fan speed	Bat	—	○	MO	
R/C prohibition	Bat	—	○	MO	
Gateway	GW	○	—	D	No monitor/control difference
Representative error	GW	○	—	BI	Gateway, Lon communication
Error code	GW	○	—	MI	Gateway, Lon communication Error codes to signal gateway status will be agreed with FGL during development.
Energy saving status/setting	GW	○	○	BI/BO	
Existence check	In	○	—	BI	
Temperature status/setting	In	○	○	AI/AO	
Operation status/setting	In	○	○	BI/BO	
Operation mode status/setting	In	○	○	MI/MO	
Fan speed status/setting	In	○	○	MI/MO	
Suction/Room temperature	In	○	—	AI	
Representative error	In	○	—	BI	
Error code	In	○	—	MI	
Temperature H/L limit status/setting	In	○	○	AI/AO	H/L limit per 3 operation Mode: HEAT, COOL-DRY, and AUTO
Temperature limit validity status/setting	In	○	○	BI/BO	
Filter sign status/reset	In	○	○	BI/BO	Only reset for control
Forced thermo off status/setting*3	In	○	○	BI / BO	
Emergency stop	In	○	—	BI	
R/C prohibition status/setting	In	○	○	MI/MO	
Vertical fan status/setting	In	○	○	MI/MO	
Horizontal fan status/setting	In	○	○	MI/MO	
Outdoor unit save status/setting	Out	○	○	MI/MO	
Low noise operation status/setting	Out	○	○	MI/MO	Monitor not supported by all
Representative error	Out	○	—	BI	
Error code	Out	○	—	MI	
Forced off status/setting	Out	○	○	BI/BO	


**NOTES:**

- For detailed information, refer to the instruction manual posted on “Service & Supports” page of the web site.  
<https://www.fujitsu-general.com/global/support/>
- \*1: BACnet object type
  - BI: OBJECT\_BINARY\_INPUT
  - BO: OBJECT\_BINARY\_OUTPUT
  - MI: OBJECT\_MULTISTATE\_INPUT
  - MO: OBJECT\_MULTISTATE\_OUTPUT
  - AI: OBJECT\_ANALOG\_INPUT
  - AO: OBJECT\_ANALOG\_OUTPUT
  - D: OBJECT\_DEVICE
- \*2: To protect the compressor of the outdoor unit, carefully read and understand the following caution that may affect the operation of compressor before executing the setting.

**⚠ CAUTION**

When performing periodical settings like schedule settings for the following functions, perform the setting to all indoor units in the same refrigerant system simultaneously, conforming to the timing restriction described below.


<Corresponding function>

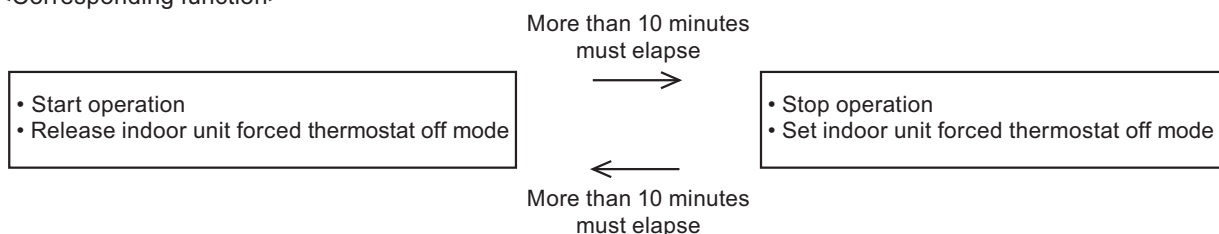

- \*3: Forced thermostat off instruction
  - Only one equipment can send these instructions for each refrigerant system.
  - When these instructions are sent by multiple equipment, the system may not respond as instructed or may cause malfunction.

## ■ Dimensions

Unit: in (mm)

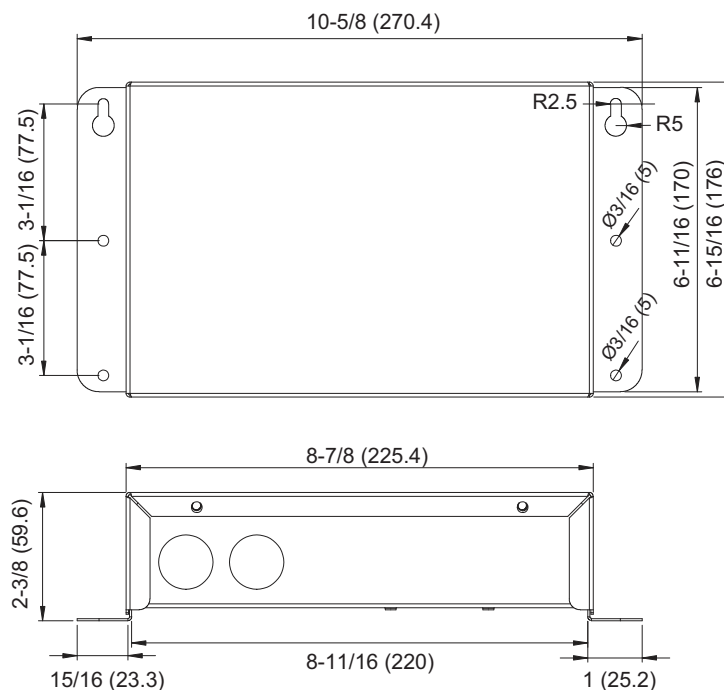

## ■ Specifications

Power supply		V	1 Ø AC 208—240
Power source frequency		Hz	50/60
Input power		W	4.6
Temperature	Operating	°F (°C)	32 to 114.8 (0 to 46)
	Packaged	°F (°C)	14 to 140 (-10 to 60)
Humidity	Packaged	%	5 to 95 (RH) No condensation
Dimensions (H × W × D)		in (mm)	2-3/8 × 10-5/8 × 6-15/16 (60 × 270 × 176)
Weight		lb (g)	3 (1,200)
Fuse capacity		A	1.25

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Power supply cable	20 to 16 AWG (0.5 to 1.25 mm <sup>2</sup> )	60245 IEC 57 or equivalent	1 Ø AC 208—240 V 50/60 Hz, 2 wire + ground (Always ground the unit)
Transmission cable	Ethernet category 5 or higher STP LAN cable with RJ45		Straight cable


## ● Transmission specifications

BACnet/IP (ASHRAE 135 Annex J)		
Transmission speed	Mbps	10/100
Cable	Ethernet category 5 or higher STP 22 AWG equivalent	
Network connector	RJ45	

### 3-8. BACnet gateway (Software: UTY-ABGXZ1)

- It is possible to connect medium to large sized BMS to VRF network system via BACnet, a global standard for open networks.
- A Maximum of 1,600 indoor units with 4 VRF network systems (a maximum of 400 indoor units and 100 outdoor units for one network system) can be connected to one BACnet gateway.
- It is possible to control or monitor VRF network system from BMS via BACnet gateway.
- Compatible with BACnet (ANSI/ASHRAE-135-2012) application specific controller (B-ASC).
- Compatible with BACnet/IP over Ethernet.
- Scheduling function, alarm and event functions, electricity charge apportionment functions as well as energy saving function are provided in BACnet gateway.
- Connection between VRF network system to personal computer is possible via small U10 USB interface. However, both U10 USB interface and personal computer are locally purchased items.

#### ■ Accessory

Name and shape	Q'ty	Application
 WHITE-USB-KEY (Software protection key with software)	1	Includes the software and manuals of tool for BACnet gateway. Additionally, it works as the software protection key. Software protection key to be connected to an USB port on the PC that the BACnet gateway is installed. BACnet gateway runs only on a PC with this WHITE-USB-KEY.


#### ■ Other required devices (Locally purchased)

- To install tool for BACnet gateway, personal computer that satisfies the following system requirements is necessary.

Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>• Microsoft Windows 7 Home Premium (32-bit or 64-bit) SP1</li> <li>• Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>• Microsoft Windows 8.1 (32-bit or 64-bit)</li> <li>• Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>• Microsoft Windows 10 Home (32-bit or 64-bit)</li> <li>• Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul> Supported languages: English, Chinese, French, German, Russian, Spanish, and Polish
CPU	Intel Core i3 2 GHz or higher
Memory	<ul style="list-style-type: none"> <li>• 2 GB or more (for Windows 7 [32-bit])</li> <li>• 4 GB or more (for Windows 7 [64-bit], Windows 8.1, and Windows 10)</li> </ul>
HDD	40 GB or more of free space
Display	1,024 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>• Ethernet port (for getting access to the Internet using LAN) or Modem (for getting access to the Internet using public telephone line)</li> <li>• USB ports (Maximum of 5 ports) (Required only for the server PC that works as VRF controller)               <ul style="list-style-type: none"> <li>– Maximum of 1 USB ports are required for WHITE-USB-KEY connection</li> <li>– Maximum of 4 USB ports are required for Echelon U10 USB Network Interface</li> </ul> </li> </ul> <p><b>NOTE:</b> Maximum number of required USB ports depends on the applicable system configuration.</p>
Software	Adobe Reader 9.0 or later

- Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R) (Required for each VRF network)

## System diagram

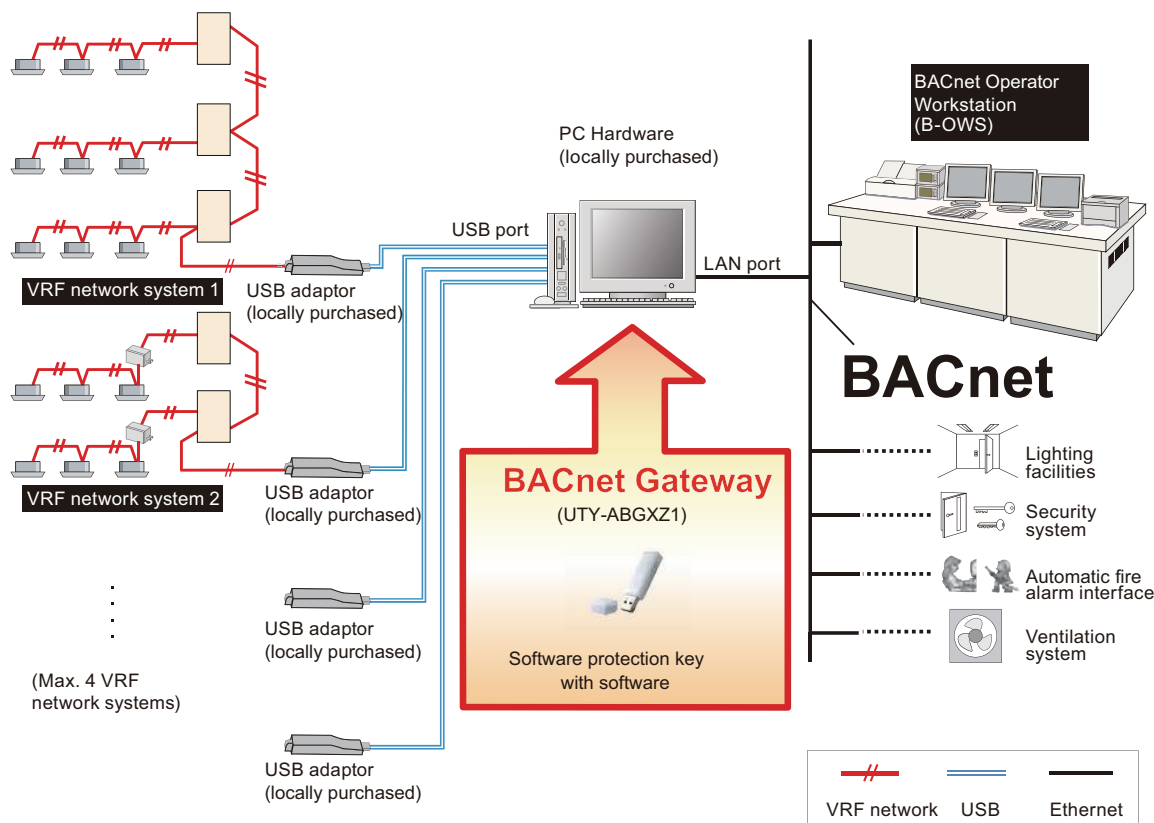

## Functions

- Indoor unit control (Output object)**  
 Commands from BMS are sent to the respective indoor units via BACnet gateway.  
 (BMS → BACnet gateway → respective indoor units of VRF network system)
- Indoor unit status monitoring (Input object)**  
 Indoor unit status is communicated to the BMS via BACnet gateway.  
 (BMS ← BACnet gateway ← respective indoor units of VRF network system)
- Outdoor unit control (Output object)**  
 Commands from BMS are sent to the respective outdoor units via BACnet gateway.  
 (BMS → BACnet gateway → respective outdoor units of VRF network system)
- Outdoor unit status monitoring (Input object)**  
 Outdoor unit status is communicated to the BMS via BACnet gateway.  
 (BMS ← BACnet gateway ← respective outdoor units of VRF network system)

# ● BACnet object list

## • Type: Indoor

BACnet object type	Code (II)	Function name	Unit						
			Inactive	Active					
			Text-1	Text-2	Text-3	Text-4	Text-5	Text-6	Text-7
AI	10	Set temp. status	°F						
	11	Space temp.	°F						
	12	Auto temp. (Low limit status)	°F						
	13	Auto temp. (High limit status)	°F						
	14	Cool/Dry temp. (Low limit status)	°F						
	15	Cool/Dry temp. (High limit status)	°F						
	16	Heat temp. (Low limit status)	°F						
AO	17	Heat temp. (High limit status)	°F						
	10	Temp. setting	°F						
	11	Auto temp. (Low limit setting)	°F						
	12	Auto temp. (High limit setting)	°F						
	13	Cool/Dry temp. (Low limit setting)	°F						
	14	Cool/Dry temp. (High limit setting)	°F						
AV	15	Heat temp. (Low limit setting)	°F						
	16	Heat temp. (High limit setting)	°F						
BI	10	ECA* operation data							
	10	Operation status	OFF	ON					
	14	Filter sign status	Unsigned	Signed					
	15	Indoor unit error status	Normal	Fault					
	16	Anti-freeze operation status	Reset	Set					
	17	SAVE operation status	Normal	SAVE					
	18	Forced thermostat off status	Reset	Set					
	19	Emergency stop status	Normal	Stop					
	20	Mode mismatch status	Normal	Mismatch					
	21	Protect anti-freeze status	Reset	Set					
BO	22	Temp. limit valid status	Invalid	Valid					
	10	Operation setting	OFF	ON					
	14	Filter sign resetting	Reset	Not reset					
	15	Anti-freeze operation setting	Reset	Set					
	16	SAVE operation setting	Reset	Set					
	17	Forced thermostat OFF setting	Reset	Set					
MI	18	Emergency stop setting	Reset	Set					
	19	Temp. limit valid setting	Invalid	Valid					
	10	Operation mode status	COOL	HEAT	FAN	DRY	AUTO		
	11	Fan speed status	LOW	HIGH	MED	AUTO	QUIET	MED-LOW	MED-HIGH
	12	Indoor unit error code	Refer to FGL original error code						
	13	R.C. prohibition status	Refer to R.C. prohibition setting chart						
	14	Vertical airflow direction status	1	2	3	4	SWING		
	15	Horizontal airflow direction status	1	2	3	4	5	SWING	
MO	16	Special driving status	Normal	Defrost	Oil recovery				
	17	Managed mode	None	Master	Slave	External			
	10	Operation mode status	COOL	HEAT	FAN	DRY	AUTO		
	11	Fan speed setting	LOW	HIGH	MED	AUTO	QUIET	MED-LOW	MED-HIGH
	12	R.C. prohibition setting	Refer to R.C. prohibition setting chart						
TL	13	Vertical airflow direction setting	1	2	3	4	SWING		
	14	Horizontal airflow direction setting	1	2	3	4	5	SWING	
TL	10	ECA* operation data log							

\*: Electricity charge apportionment

## • Type: Outdoor

BACnet object type	Code (II)	Function name	Unit							
			Inactive	Active						
			Text-1	Text-2	Text-3	Text-4	Text-5	Text-6	Text-7	Text-8
BI	30	Outdoor unit error status	Normal	Fault						
	31	Forced off status	Reset	Set						
BO	10	Forced off setting	Reset	Set						
MI	30	Outdoor unit priority operation status*1	COOL	HEAT	Neutral	None				
	31	Outdoor error code	Refer to FGL original error code							
	32	Capacity save status	Not set	100%	90%	80%	70%	60%	50%	45%
MO	33	Outdoor low noise operation status*2								
	30	Outdoor low noise operation status*3	Stop	Level-1 Quiet	Level-1 Ability	Level-2 Quiet	Level-2 Ability	Level-3 Quiet	Level-3 Ability	
	32	Capacity save setting	Not set	100%	90%	80%	70%	60%	50%	45%

\*1: Priority operation status is for Heat pump type VRF. In other types of systems, this status is not necessary.

\*2: Refer to the "Outdoor unit low noise operation value table" for the texts used with the "Outdoor low noise operation status".

\*3: Outdoor unit firmware may need to be updated for this function to work. For details, contact your local sales company.

## • Type: Gateway

BACnet object type	Code (II)	Function name	Unit					
			Inactive	Active				
			Text-1	Text-2	Text-3	Text-4	Text-5	Text-6
Device	—	Device information						
BI	00	Lon network adapter error status	Normal	Abnormal				
	01	Gateway status error	Normal	Abnormal				
	02	ES status	Not used	Energy saving				
BO	02	ES setting	Not used	Energy saving				
MI	00	Lon network adapter error code	Refer to FGL original error code					
	01	Gateway error code	Refer to FGL original error code					
	02	ECA* status	Invalid	Invalid (Stop)	Include indoor unit only	Exclude indoor and RB unit	Include indoor and RB unit	Include RB unit
MO	01	ECA* setting	Stop	Include indoor unit only	Exclude indoor and RB unit	Include indoor and RB unit	Include RB unit	
Notification	00—99	Notification class						
CAL	00	Calendar "Holiday-1"						
	01	Calendar "Holiday-2"						
	02—32	Calendar "Special day-1"—"Special day-30"						
Schedule	00—99	Schedule timer						

\*: Electricity charge apportionment


### NOTES:

- To protect the compressor of the outdoor unit, carefully read and understand the following cautions that may affect the operation of compressor before executing the setting.

#### **⚠ CAUTION**


- When regularly making the following settings to the same outdoor unit by using schedule function etc., leave the following interval.

<Corresponding function>

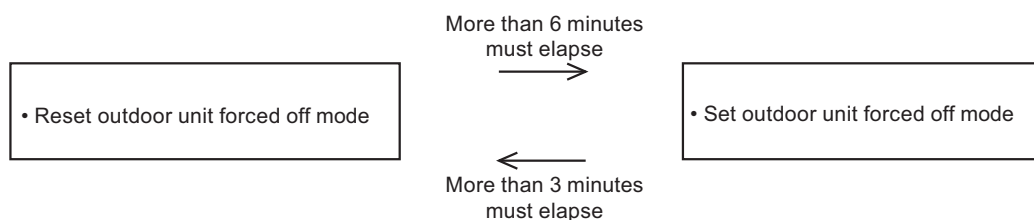

- When performing periodical settings like schedule settings for the following functions, perform the setting to all indoor units in the same refrigerant system simultaneously, conforming to the timing restriction described below.

<Corresponding function>

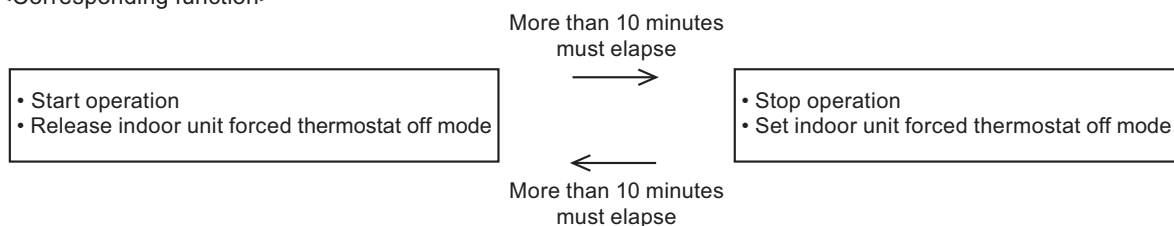

- Forced thermostat off instruction, outdoor unit forced off instruction, and capacity saving setting
  - Only one equipment can send these instructions for each refrigerant system.
  - When these instructions are sent by multiple equipment (eg. from System controller and BACnet gateway at the same time), the system may not respond as instructed or may cause malfunction.
- The electricity charge apportionment function of VRF system can only be performed from one equipment simultaneously. Therefore, ECA setting, required to be set before performing electricity charge apportionment, can only be sent from one equipment simultaneously.
- The energy saving function of VRF system can only be performed from one equipment simultaneously. Therefore, ES setting, required to be set before performing energy saving, can only be sent from one equipment simultaneously.

## ■ Installation procedure

Before installation, connect between the VRF network system and the USB adapter.

For details of installation, refer to the instruction manual.

Brief installation steps are follows:

1. Install an appropriate driver for the USB adapter to the PC.  
In this step, do not connect the USB adapter to the PC.
2. Install the BACnet gateway (application software) to the PC.
3. Restart the PC.
4. After restarting the PC, make sure that the USB adapter, WHITE-USB-KEY, and Ethernet cable for the BACnet gateway are connected to the PC.
5. Start the application.
6. Configure necessary settings for startup operation as follows:
  - a. Perform all necessary initial settings such as IP address, etc. Then, click OK button.  
Adapter setting window appears automatically.
  - b. Select the connected adapter and click OK button. Then unit registration window appears and starts scanning all connected units automatically.
  - c. After finishing the scanning, click OK button.  
Gateway execution window appears on the display when the startup operation is completed.
7. Arrange the information between BMS and BACnet gateway using the read property service, etc.



## 3-9. Niagara driver for VRF



- Niagara driver for VRF is a software driver for the Niagara framework. With the driver, direct connection of VRF system to Niagara system becomes possible using JACE, or Supervisor running on PC.
- Data in the VRF network becomes available as points/properties using the driver. These points/properties can be exported to other interfaces.
- The driver supports maximum 250 indoor/outdoor units for JACEs.
- The number of points handled by the driver is 50 multiplied by as many number of units supported by the license (licenses required separately).
- The driver supports data supported by BACnet gateway (UTY-VBGX) plus much more.
- Connection to the VRF network requires Lon adapter
- In addition to the bundled JACE, various products like stand-alone driver, Supervisor, and upgrade products are available. For details, ask your distributor.

### ■ Other required devices (Locally purchased) and licenses

Niagara driver for VRF requires a working environment of Niagara 4.9 or later.


Specifications and requirements			
Item		Specification	Remarks
VRF	Supported series	V-II series or later	
	Maximum VRF network	4	1 network/Lon adapter
	Maximum number of JACEs	4/Network	
	Maximum number of units	250/JACE	<ul style="list-style-type: none"> <li>• Limited within the license</li> <li>• Maximum of 125/JACE is recommended for constant use of appliance tools as means of daily operation.</li> </ul>
	Maximum number of points	50 points × units	
	Supported interface	NPB-8000-LON	When using JACE
Niagara	Supported version	Niagara 4.9 or later	<ul style="list-style-type: none"> <li>• JACE-8000</li> <li>• Supervisor (Microsoft Windows 10 64 bit)</li> </ul>
	Maximum point to BACnet	All points on the VRF	
	Supported browser	Google Chrome™	

Item	Model name	Remark
License	DR-FUJ-DEVICE-25	Driver license for 25 indoor/outdoor units.
	DR-FUJ-DEVICE-50	Driver license for 50 indoor/outdoor units.
	SMA-8005-1YR-INIT	18 months maintenance, must be initially purchased.
Lon adapter	NPB-8000-LON	Lon adapter, required for each VRF network (1-4).

### ■ Available option

Option	Model name	Remark
Additional license	DR-FUJ-DEV-UP-50	Driver license for additional 50 indoor/outdoor units, added later.
AC adapter	WPM-8000	AC adapter for JACE8000, when power is not available on site.

## ■ System diagram

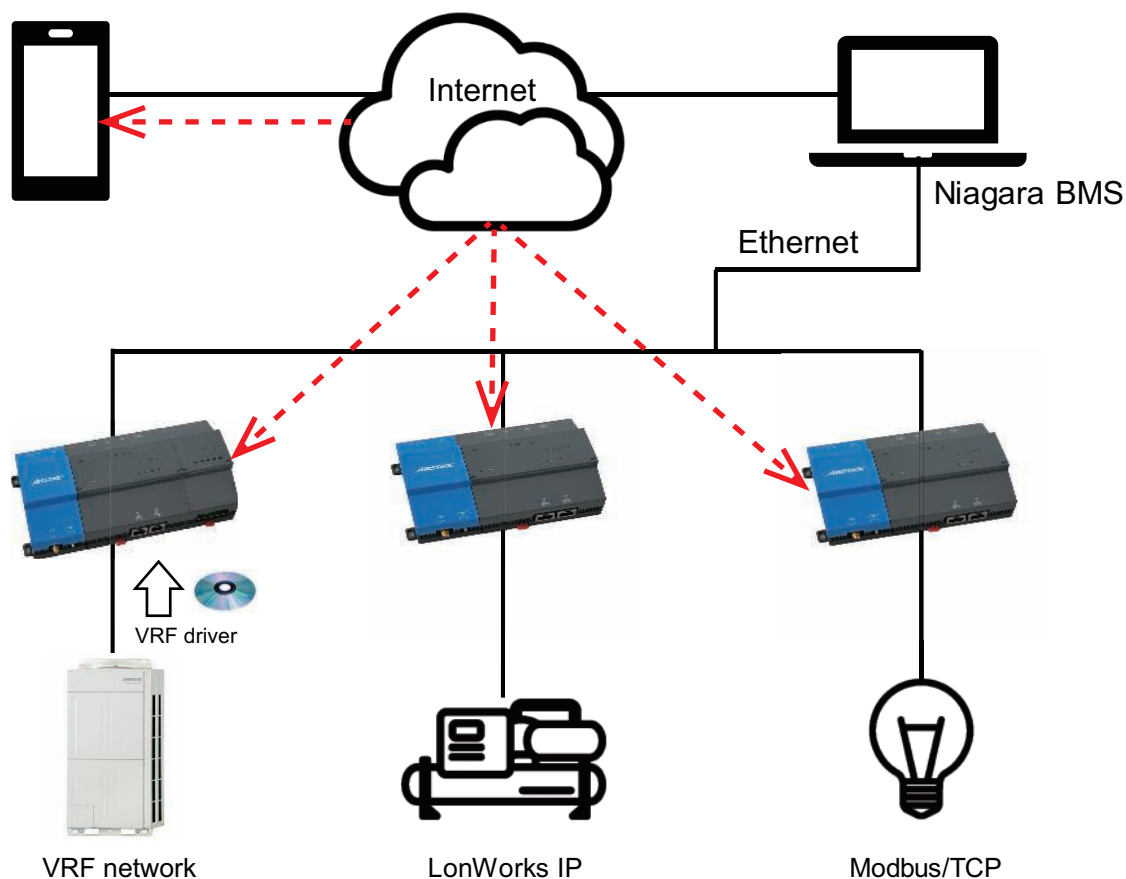

## ■ Data available as points/properties

Range	Monitor	Control
Network	Error, Error code, On/off, Mode, Fan speed, Fan direction, Set temperature, Remote controller prohibition	On/Off, Mode, Fan speed, Fan direction, Set temperature, Remote controller prohibit
Outdoor unit	Capacity save, Forced off, Low noise, Error, Error code	Capacity save, Forced off, Low noise
Indoor unit	Alive, On/Off, Mode, Fan speed, Fan direction, Set temperature, Space temperature, Remote controller prohibition, Thermostat off, Filter sign, Emergency status, Error, Error code, Setpoint limitation, Master/Slave status	On/Off, Mode, Fan speed, Fan direction, Set temperature, Space temperature, Remote controller prohibition, Thermostat off, Filter sign reset, Emergency status, Setpoint limitation

## ■ Installation procedure

- When installing add-on single port Lon FTT 10 A module (NPB-8000-LON), refer to the manual that comes with the module and consider following conditions.
  - Maximum of 4 add-on Lon module can be connected to one JACE.
  - Lon module can only be used to connect to VRF systems.
  - Mixed connection of VRF network and standard LonWorks from a single JACE is prohibited.
- When connecting Ethernet cable, connect it to the RPI (primary) port unless specifically instructed otherwise.
- To change the default IP address or the assignment method of IP address (Fixed/DHCP) already set to the JACE, direct connection from a terminal software running on a PC to the JACE is required. Use a cable with USB connector (Micro B type) at the JACE-end for the connection. For details, refer to the manual that comes with the JACE.

### 3-10. Signal amplifier (UTY-VSGXZ1)







If the total length of transmission cable exceeds 1,640 ft (500 m), or the number of the elements exceeds 64 units, Signal amplifier will be required.



- Transmission cable length can be extended up to 11,811 ft (3,600 m) with multiple Signal amplifier.
- Up to 8 Signal amplifier (Filter mode is off) can be installed in one VRF network system.
- Up to 40 Signal amplifier (Filter mode is on) can be installed in one VRF network system. (For Heat recovery system)


To prevent the drop of signal level by taking distance of length or quantity of unit in VRF network with installing Signal amplifier, signal level can be recovered.

#### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	3	For mounting the power supply cable and transmission cable
 Screw (M4 × 20 mm)	4	For mounting the Network converter
 Terminal register	1	
 Dust proof bushing	1	For connecting the power supply cable (Except in U.S.A. and Canada)
 Connecting wire	1	For setting the filter mode
 Installation manual	1	


## ■ Electrical wiring

- Except in the case of V and S series (indoor units is installed 320 units or less)

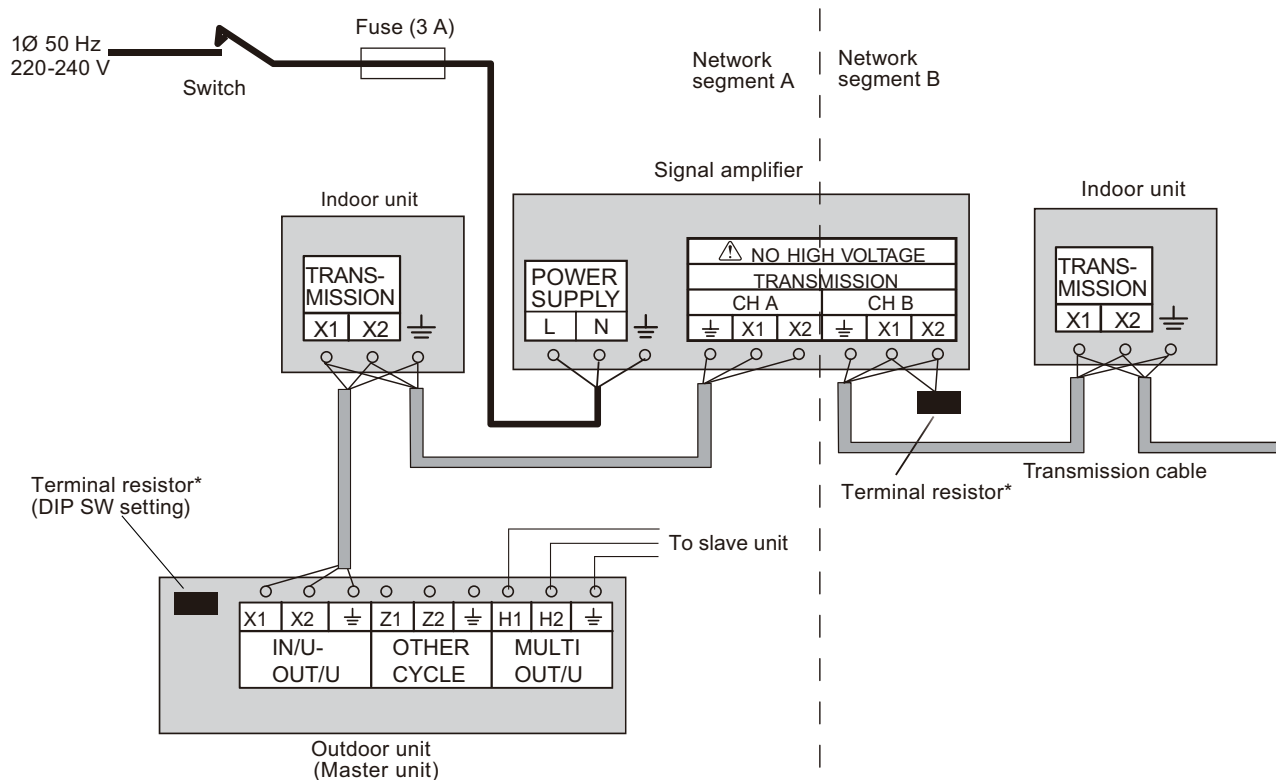

\*: Make sure to install 1 piece of terminal resistor to each segment. Terminal resistor is provided for each outdoor unit, but confirm that there is only one terminal resistor in the same segment.

- Case of VR-II (321 or more indoor units are installed)

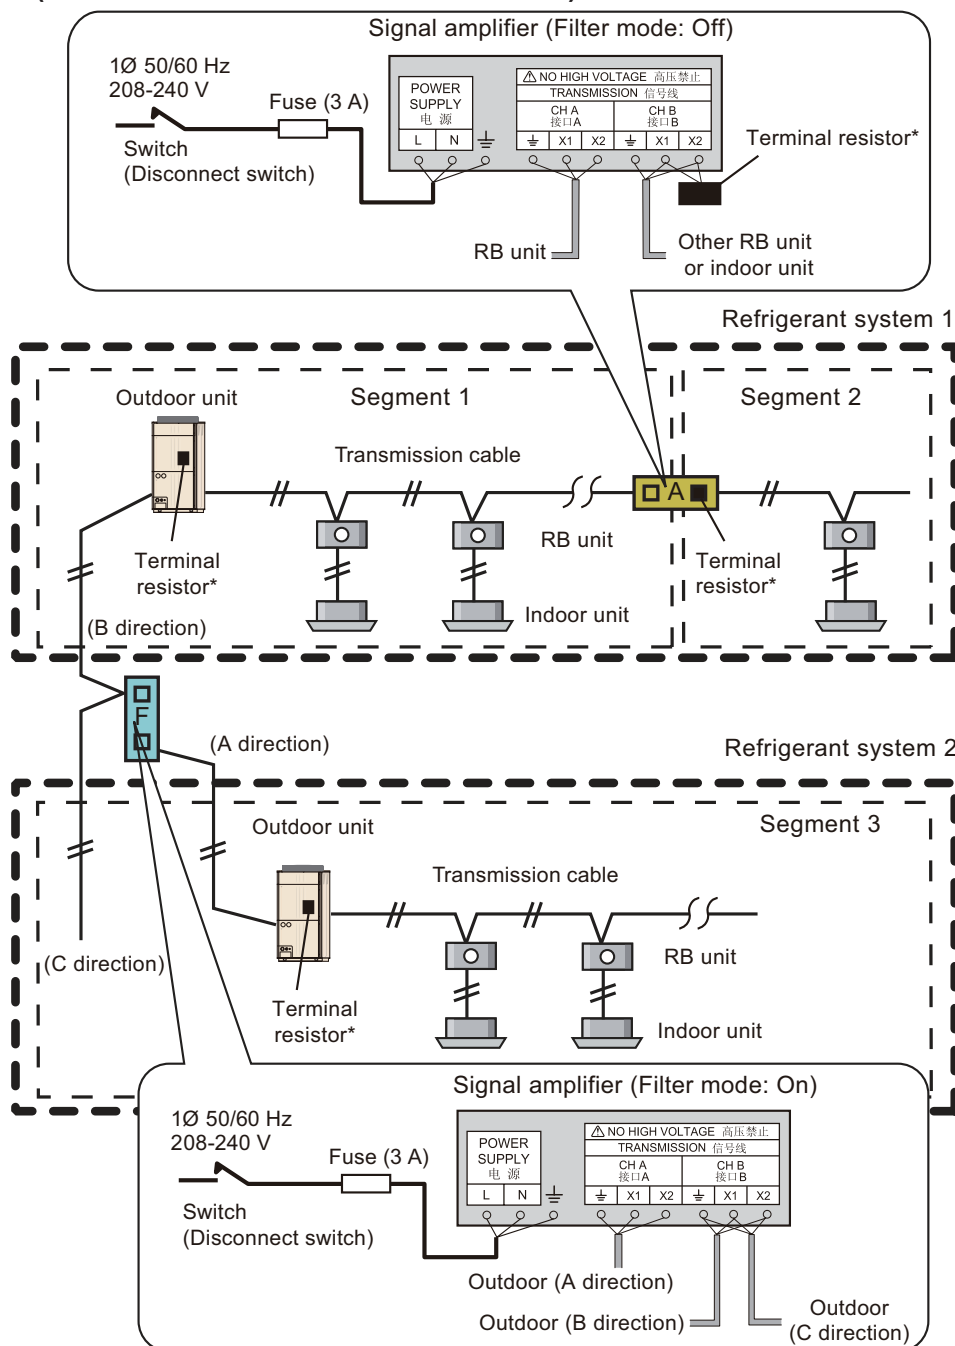


\*: Make sure to install 1 piece of terminal resistor to each segment. Terminal resistor is provided for each outdoor unit, but confirm that there is only one terminal resistor in the same segment.

### • Filter mode setting


Set the filter mode to suppress an increase of the amount of communication information in the Heat recovery system.

- Filter mode is turned on by inserting the accessory connecting wire at the CN4 connector on the PCB.
- When the filter mode setting is changed, turn the power off once. Otherwise, the setting will not be recognized.

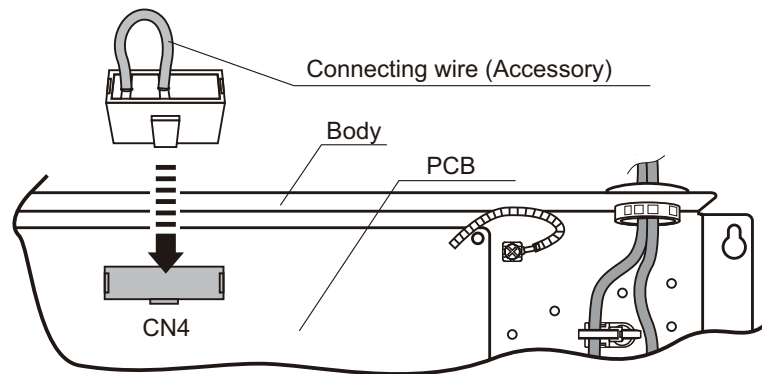

## ■ Dimensions

Unit: in (mm)

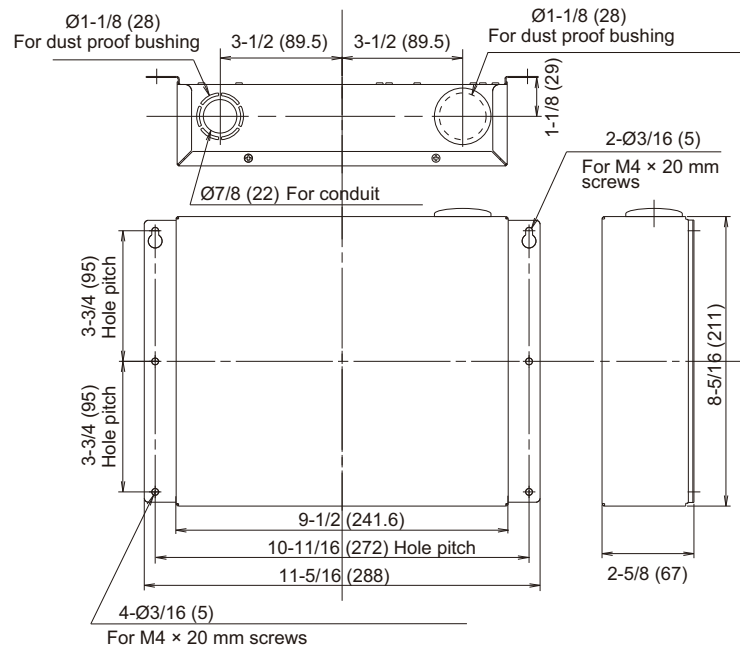

## ■ Specifications

Power supply		V	1 Ø AC 208—240
Power source frequency		Hz	50/60
Input power		W	4.5
Temperature	Operating	°F (°C)	32 to 114.8 (0 to 46)
	Packaged	°F (°C)	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H × W × D)		in (mm)	2-5/8 × 11-5/16 × 8-5/16 (67 × 288 × 211)
Weight		lb (g)	3 (1,500)
Fuse capacity		A	3

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Power supply cable	20 to 16 AWG (0.5 to 1.25 mm <sup>2</sup> )	60245 IEC 57 or equivalent	1 Ø AC 208—240 V 50/60 Hz, 2 wire + ground (Always ground the unit)
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL 4 (NEMA) Non-polar 2 core, twisted pair solid core shielded	LonWorks compatible cable






## 3-11. External switch controller (UTY-TERX)




- Switching of air conditioner settings can be performed using an External switch controller and a third-party device.
- On/Off, temperature, fan speed, operating mode, and remote controller prohibition mode can be switched using external device, such as a room card-key.
- Card-key or other sensor switches are available as a locally purchased parts.

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	4	For securing controller cable
 Screw (M4 × 16 mm)	3	For installing the External switch controller
 Installation manual	1	


### ■ System diagram

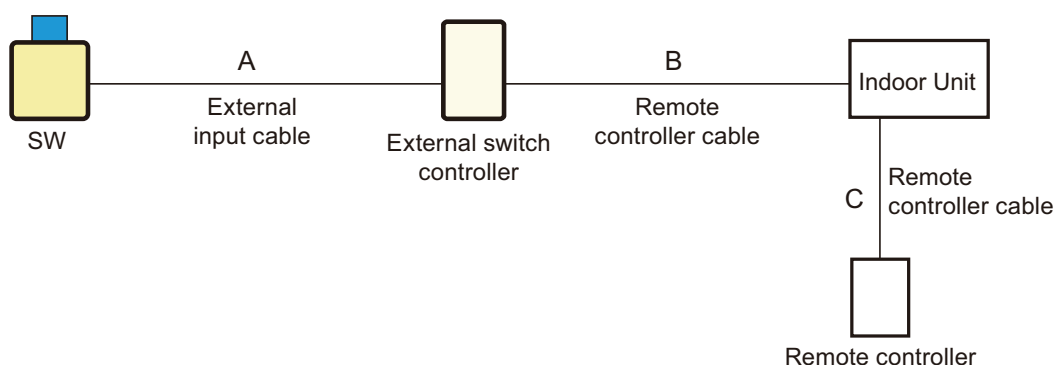


Use	A	B	B + C
2-wire type	164 ft (50 m) or less	—	1,640 ft (500 m) or less
3-wire type	164 ft (50 m) or less	82 ft (25 m) or less	1,640 ft (500 m) or less

## ■ Electrical wiring


- For non-polar 2 wire

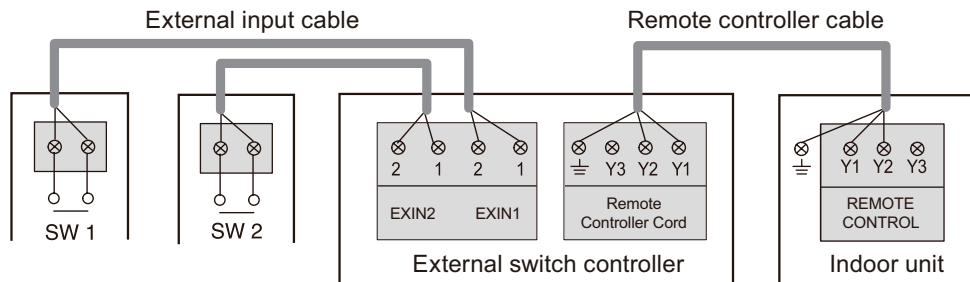

- For polar 3 wire

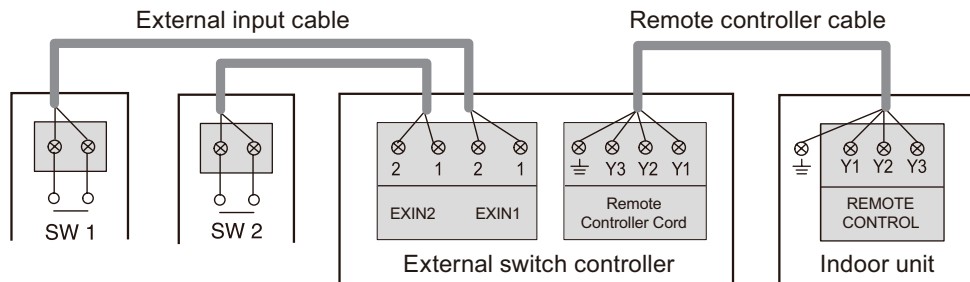

## • Connection to external contacts

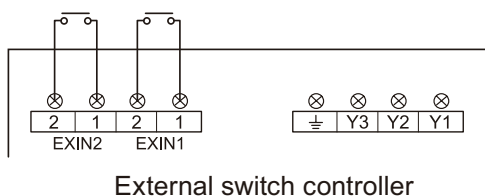

- Select low current use contacts (usable at DC 5 V, 2 mA or less).
- Short circuit detection resistance (R on):  $\leq 500 \Omega$
- Open circuit detection resistance (R off):  $\geq 100 \text{ k}\Omega$
- A twisted pair cable 22 to 16 AWG (0.33 to 1.25 mm<sup>2</sup>) should be used.
- Maximum cable length: 164 ft (50 m)


### ⚠ CAUTION

When using setback function and remote controller prohibition setting is used, leave more than 5 seconds between sensor switchings such as opening and closing the window. Otherwise, the operation signal cannot be received properly, and the control from your remote controller will not work. In such case, canceling of the setting by using Service tool is required.

### Prohibited connection example


#### – Example 1

Series connection of window contacts and card holder is prohibited.

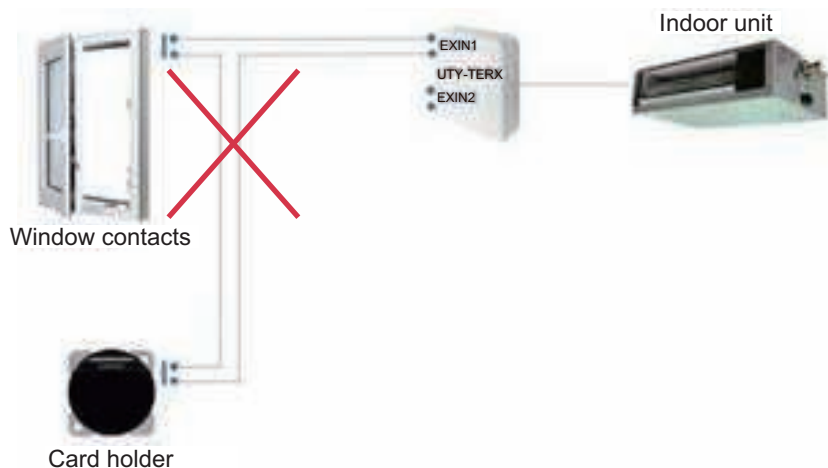


#### – Example 2

Parallel connection of CH1 and CH2 is prohibited.

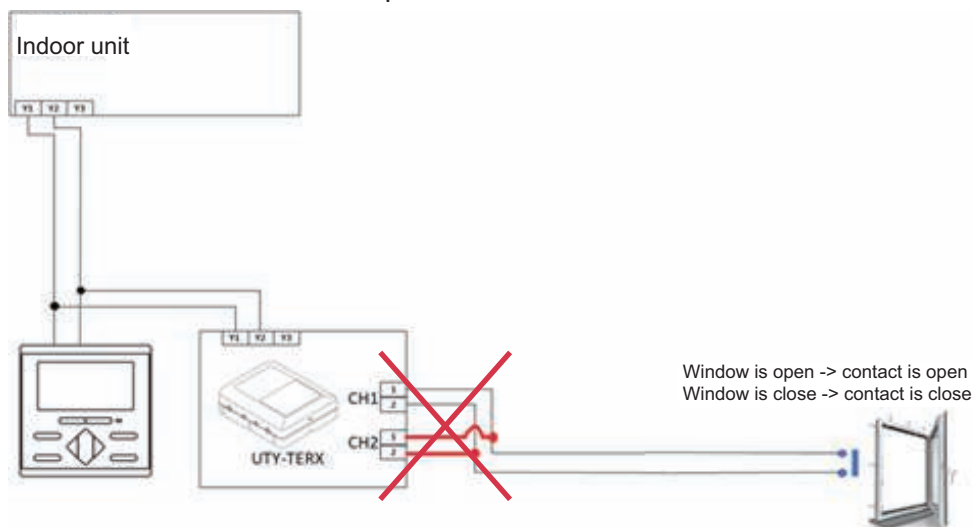

## ■ Dimensions

Unit: in (mm)

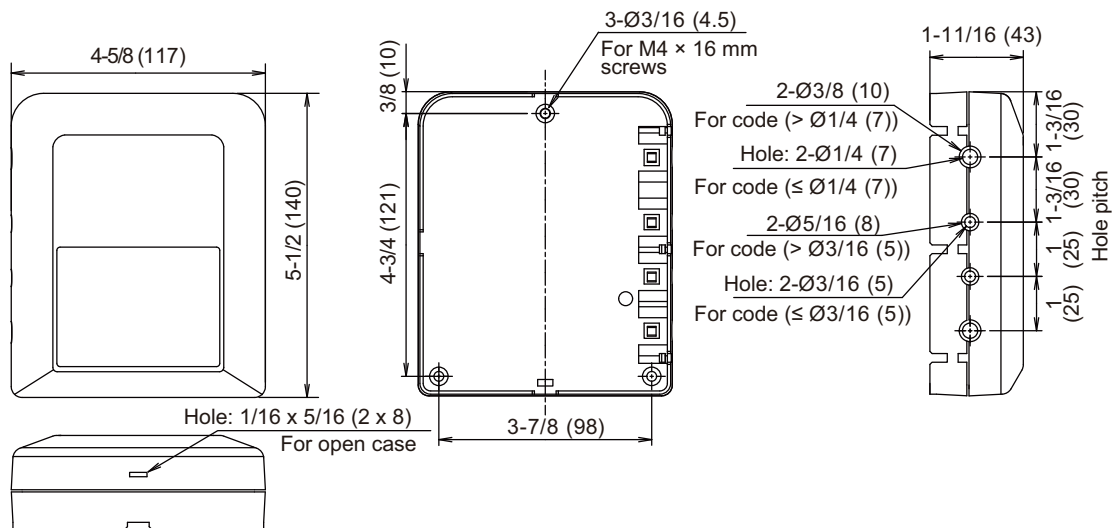


## ■ Installation


- When connecting to the connector

- For non-polar 2 wire


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

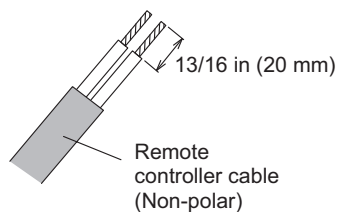


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

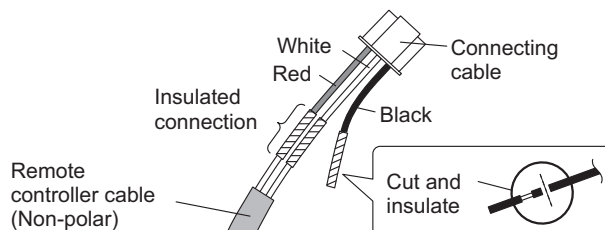

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

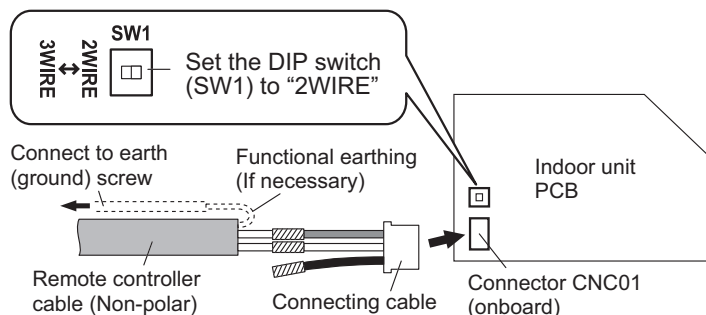


**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

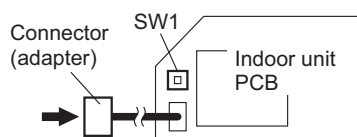


### – For polar 3 wire


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

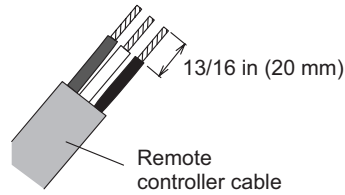


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

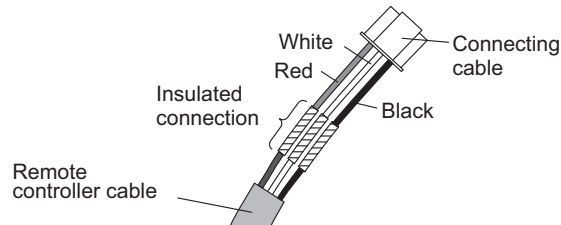

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

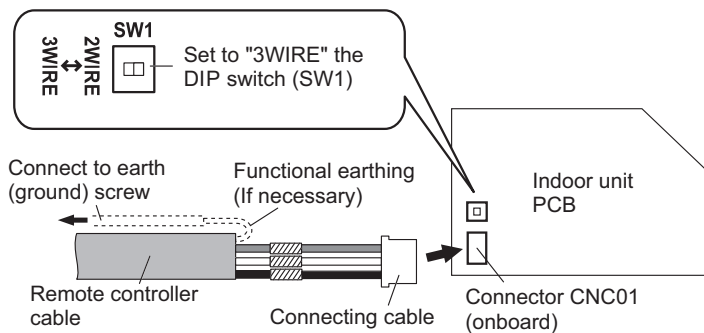


**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

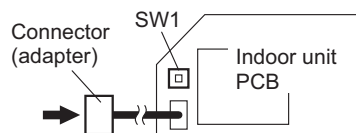

- **When connecting to the exclusive terminal block**

- **For non-polar 2 wire**

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "2WIRE" on the PCB of the indoor unit.

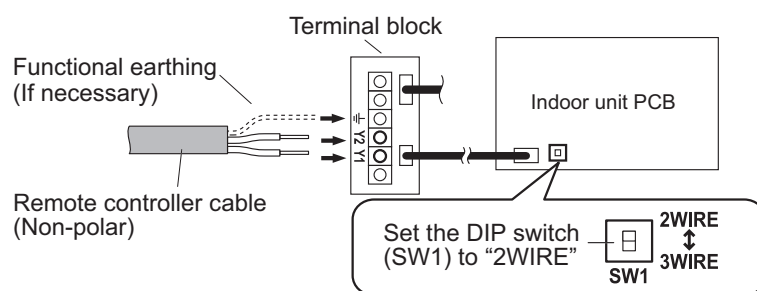


**NOTES:**

- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

- **For polar 3 wire**

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

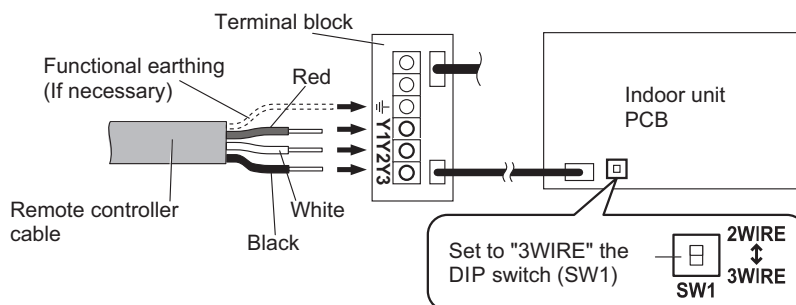

**NOTES:**

- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

## ■ Specifications

Input power		W	0.6
Temperature	Operating	°C	32 to 114.8 (0 to 46)
	Packaged	°C	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H × W × D)		mm	1-11/16 × 4-5/8 × 5-1/2 (43 × 117 × 140)
Weight		oz (g)	9 (250)

## ● Wiring specifications


Use	Cable size	Wire type	Remarks
Remote controller cable (2-wire type)	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Sheathed PVC cable*	Non-polar 2 core, twisted pair Maximum cable length: 1,640 ft (500 m)
Remote controller cable (3-wire type)	22 AWG (0.33 mm <sup>2</sup> )		Polar 3 core, twisted pair Maximum cable length: 82 ft (25 m)
External input cable	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )		2 core, twisted pair Maximum cable length: 164 ft (50 m)

\*: Use sheathed cable in accordance with local rules for remote controller cable.




## Example



- Controlling the individual operation status with two external contact switch

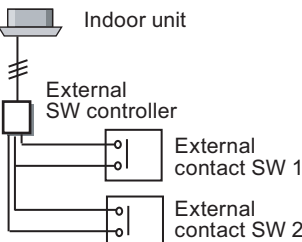Setting	Wiring	Operation example
Mode 0 P1: Arbitrary operation state Contact Off → On P2: Arbitrary operation state Contact Off → On  Other settings are arbitrary.		P1: On, Cool, 80 °F (26 °C) P2: Off SW1 On Off — P1 — SW2 On Off — P2 — Operation state On — Cool 80 °F (26 °C) — Off —



- Controlling operation by On or Off of an external contact switch

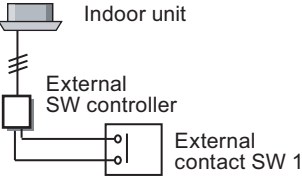Setting	Wiring	Operation example
Mode 1 P1: Arbitrary operation state P2: Arbitrary operation state  Other settings are arbitrary.		P1: Off P2: On, Cool, 80 °F (26 °C) SW1 On Off — P2 — Operation state On — Cool 80 °F (26 °C) — Off —
Mode 1 P1: Arbitrary operation state P2: Arbitrary operation state  Other settings are arbitrary.		P1: On (Cool, 80 °F (26 °C) Heat, 68 °F (20 °C)) P2 (88 °F (30 °C) 60 °F (16 °C)) SW1 On — P1 — P2 — Off — (Cool) 80 °F (26 °C) 88 °F (30 °C) — Operation state — 68 °F (20 °C) 60 °F (16 °C) — (Heat)
Mode 1 P1: Arbitrary operation state P2: Off timer (1, 3, 6, 12, 24 hr)  Other settings are arbitrary.		P1: On, Heat, 20 °C P2: 16 °C SW1 On — P1 — P2 — Off — On — Off timer — Operation state — Heat 68 °F (20 °C) Heat 60 °F (16 °C) — Off —



- Operates when the external contact switch is turned on, and returns to the original operation state when the switch is turned off.

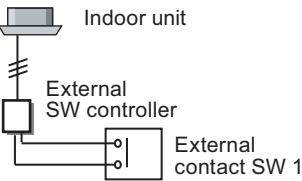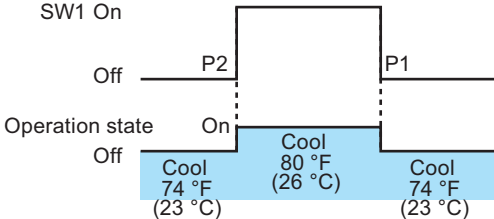Setting	Wiring	Operation example
Mode 1 or 0 P1: Setback P2: Arbitrary operation state Other settings are arbitrary.		Mode 1, P1: Setback P2: On, Cool, 80 °F (26 °C) SW1 On 



- Operates when the external contact switch is turned off, and returns to the original operation state when the switch is turned on.

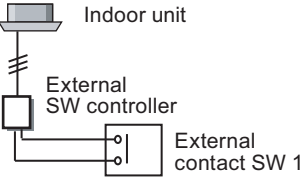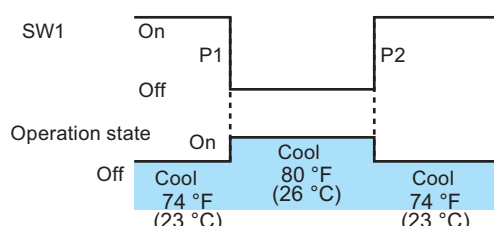Setting	Wiring	Operation example
Mode 1 or 0 P1: Arbitrary operation state P2: Setback Other settings are arbitrary.		Mode 1, P1: On, Cool, 80 °F (26 °C) P2 : When setback SW1 On 

- Thermal sensor switch is connected and cooling and heating operations are switched.

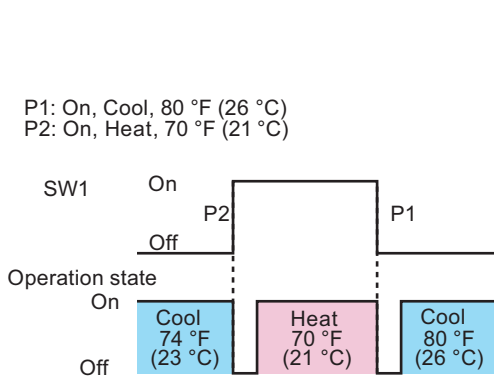Setting	Wiring	Operation example
Mode 1 Off output: Enabled P1: On, Cool or Heat P2: On, Cool or Heat Operation conditions: Unit operating only Other settings are arbitrary.	 <p>External switch controller is connected to all indoor units in the same refrigerant system and cooling and heating operations are switched by one thermal sensor.</p>	P1: On, Cool, 80 °F (26 °C) P2: On, Heat, 70 °F (21 °C) SW1 On 

- Preventing chatter noise within 1 minute after external contact switch is turned on

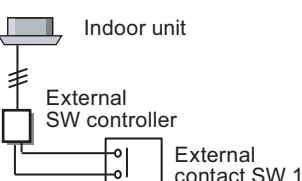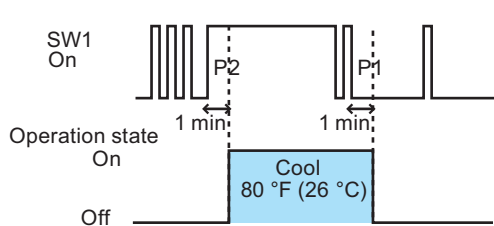


Setting	Wiring	Operation example
Mode 1 Delay-time setting: Delay P1: Arbitrary operation state P2: Arbitrary operation state Other settings are arbitrary.		P1: Off P2: On, Cool, 80 °F (26 °C) SW1 On 

## 3-12. External switch controller (UTY-TEKX)




- Air conditioner switching can be controlled by connecting other sensor switches.
- On/Off, temperature, fan speed, operating mode can be switched in combination with card-key switches equipped in facilities such as hotel rooms.
- Card-key or other sensor switches are available as a locally purchased parts.

### ■ Accessory

Name and shape	Q'ty	Application
 Cable tie	5	For External switch controller and cable binding
 Screw (M4 × 16 mm)	2	For installing the External switch controller
 Installation manual	1	

### ■ System diagram

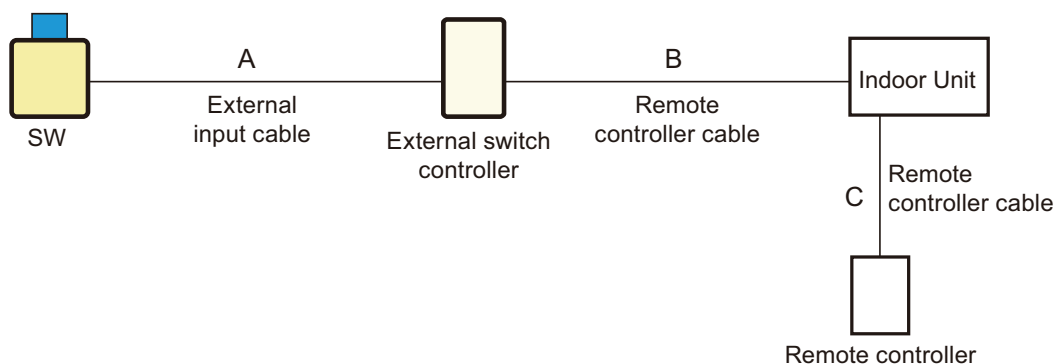

A	B	B + C
164 ft (50 m) or less	82 ft (25 m) or less	1,640 ft (500 m) or less

## Unit: in (mm)

Unit: in (mm)

## ■ Installation


### • Connection pattern

**NOTE:** Connection pattern is different according to type of Indoor unit.

Indoor unit type	Connection pattern
All cassette type	Pattern A
All duct type	
All floor type	
Floor/Ceiling type	
All ceiling type	
All wall mounted type	Pattern B

### • Pattern A

1. Connect the end of remote controller cable directly to the exclusive terminal block.
2. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

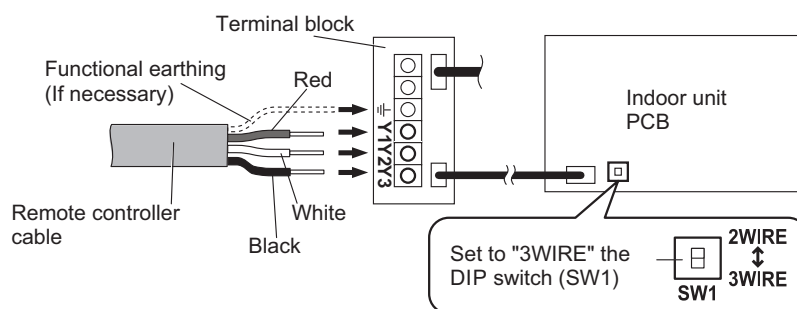


### NOTES:


- Layout of terminal block and PCB is varies depending on the type of indoor unit.
- Operation may fail if it is connected to the outdoor unit or the terminal block for power supply.

### • Pattern B


1. Use a tool to cut off the terminal on the end of the remote controller cable, and then remove the insulation from the cut end of the cable as shown below.

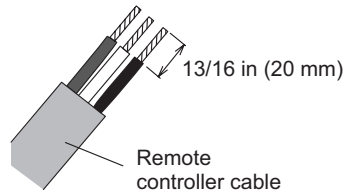


2. Connect the remote controller cable and connecting cable as shown below. Be sure to insulate the connection between the cables.

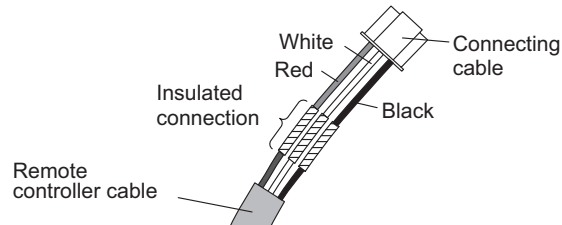

3. Connect the remote controller cable to the connecting cable, and insert it to the connector. Set the DIP switch (SW1) to "3WIRE" on the PCB of the indoor unit.

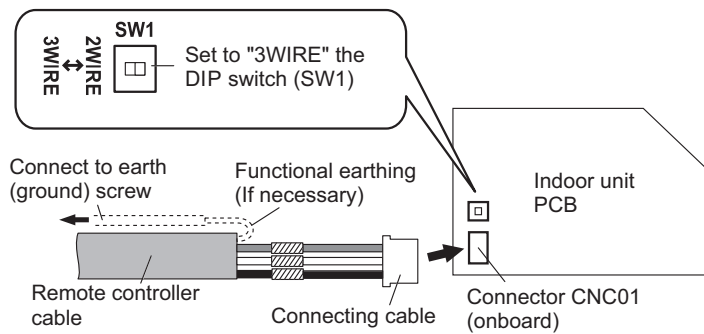

**NOTE:** Layout of terminal block and PCB is varies depending on the type of indoor unit.

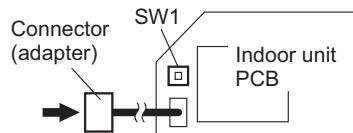

## ■ Specifications

Power supply	V	DC 12
Dimensions (H × W × D)	in (mm)	4-3/4 × 2-15/16 × 1-3/16 (120 × 75 × 30)
Weight	oz (g)	4 (100)

## ● Wiring specifications

Use	Cable size	Wire type	Remarks
Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Polar 3 core	Use sheathed PVC cable or shielded cable in accordance with the regional cable standard
External input cable		Polar 2 core, twisted pair	Use shielded cable in accordance with the regional cable standard

## ■ Example

- Controlling the individual operation status with two external contact switch

Setting	Wiring	Operation example
Mode 0 P1: Arbitrary operation state Contact Off → On P2: Arbitrary operation state Contact Off → On Other settings are arbitrary.		P1: On, Cool, 80 °F (26 °C) P2: Off SW1 On Off — P1 — SW2 On Off — P2 — Operation state On — Cool 80 °F (26 °C) — Off —


- Controlling operation by On or Off of an external contact switch

Setting	Wiring	Operation example
Mode 1 P1: Arbitrary operation state P2: Arbitrary operation state Other settings are arbitrary.		P1: Off P2: On, Cool, 80 °F (26 °C) SW1 On Off — P2 — P1 — Operation state On — Cool 80 °F (26 °C) — Off —


- Operates when the external contact switch is turned on, and returns to the original operation state when the switch is turned off.

Setting	Wiring	Operation example
Mode 1 or 0 P1: Setback P2: Arbitrary operation state Other settings are arbitrary.		Mode1, P1: Setback P2: On, Cool, 80 °F (26 °C) SW1 On Off — P2 — P1 — Operation state On — Cool 80 °F (26 °C) — Off — Cool 74 °F (23 °C) — Cool 80 °F (26 °C) — Cool 74 °F (23 °C) —


- Operates when the external contact switch is turned off, and returns to the original operation state when the switch is turned on.

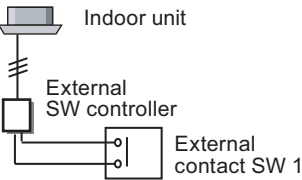Setting	Wiring	Operation example
Mode 1 or 0 P1: Arbitrary operation state P2: Setback Other settings are arbitrary.		<p>Mode 1, P1: On, Cool, 80 °F (26 °C)            P2 : When setback</p> <p>SW1      On      P1      P2</p> <p>Off      Off      On</p> <p>Operation state</p> <p>On      Cool 80 °F (26 °C)</p> <p>Off      Cool 74 °F (23 °C)      Cool 74 °F (23 °C)</p>

- Thermal sensor switch is connected and cooling and heating operations are switched.

Setting	Wiring	Operation example
Mode 1 Off output: Enabled P1: On, Cool or Heat P2: On, Cool or Heat Operation conditions: Unit operating only Other settings are arbitrary.	 <p>External switch controller is connected to all indoor units in the same refrigerant system and cooling and heating operations are switched by one thermal sensor.</p>	<p>P1: On, Cool, 80 °F (26 °C)            P2: On, Heat, 70 °F (21 °C)</p> <p>SW1      On      P2      P1</p> <p>Off      Off      On</p> <p>Operation state</p> <p>On      Cool 74 °F (23 °C)      Heat 70 °F (21 °C)      Cool 80 °F (26 °C)</p> <p>Off</p>

- Preventing chatter noise within 1 minute after external contact switch is turned on

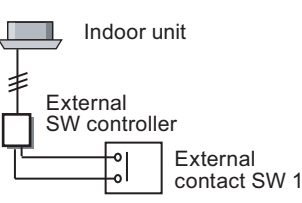Setting	Wiring	Operation example
Mode 1 Delay-time setting: Delay P1: Arbitrary operation state P2: Arbitrary operation state Other settings are arbitrary.		<p>P1: Off    P2: On, Cool, 80 °F (26 °C)</p> <p>SW1      On</p> <p>On      P2      P1</p> <p>1 min.      1 min.</p> <p>Operation state</p> <p>On      Cool 80 °F (26 °C)</p> <p>Off</p>




## 4. Service and web monitoring tool

### 4-1. Service tool (UTY-ASGXZ1)

Extensive monitoring and analysis functions for installation and maintenance.  
Operation status and error history can be grasped promptly and adequately.

#### ■ Accessory

Name and shape	Q'ty	Application
 WHITE-USB-KEY (software protection key with software)	1	Includes the software and manuals for Service tool. Additionally, it works as the software protection key. Software protection key to be connected to an USB port on the PC that Service tool is installed. Service tool runs only on a PC with this WHITE-USB-KEY.

#### ■ Other required devices (Locally purchased)

- Personal computer that satisfies the following system requirements
  - For VRF system side PC


Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul>
CPU	1 GHz or higher
Memory	<ul style="list-style-type: none"> <li>1 GB or more (for Windows 7 [32-bit], Windows 8.1 [32-bit], and Windows 10 [32-bit])</li> <li>2 GB or more (for Windows 7 [64-bit], Windows 8.1 [64-bit], and Windows 10 [64-bit])</li> </ul>
HDD	40 GB or more of free space
Display	1,366 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>2 USB ports               <ul style="list-style-type: none"> <li>1 USB port is required for WHITE-USB-KEY connection</li> <li>1 USB port is required for Echelon U10 USB Network Interface</li> </ul> </li> </ul>
Software	Adobe Reader 9.0 or later
Internet transmission rate (in remote access)	Internet environment capable for communication speed of 3 Mbps or more (for uploading) all the time (including when accessing to overseas website)

- For remote side PC

Personal computer system requirement	
Web browser	Internet Explorer 11.0 or Microsoft Edge
Display	1,366 × 768 or higher resolution (Before use, set the resolution so that the resolution of remote side PC monitor screen is higher than that of VRF system side PC.)
Internet transmission rate (in remote access)	Internet environment capable for communication speed of 4 Mbps or more (for downloading) all the time (including when accessing to overseas website)





- Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R) (Required for each VRF network)



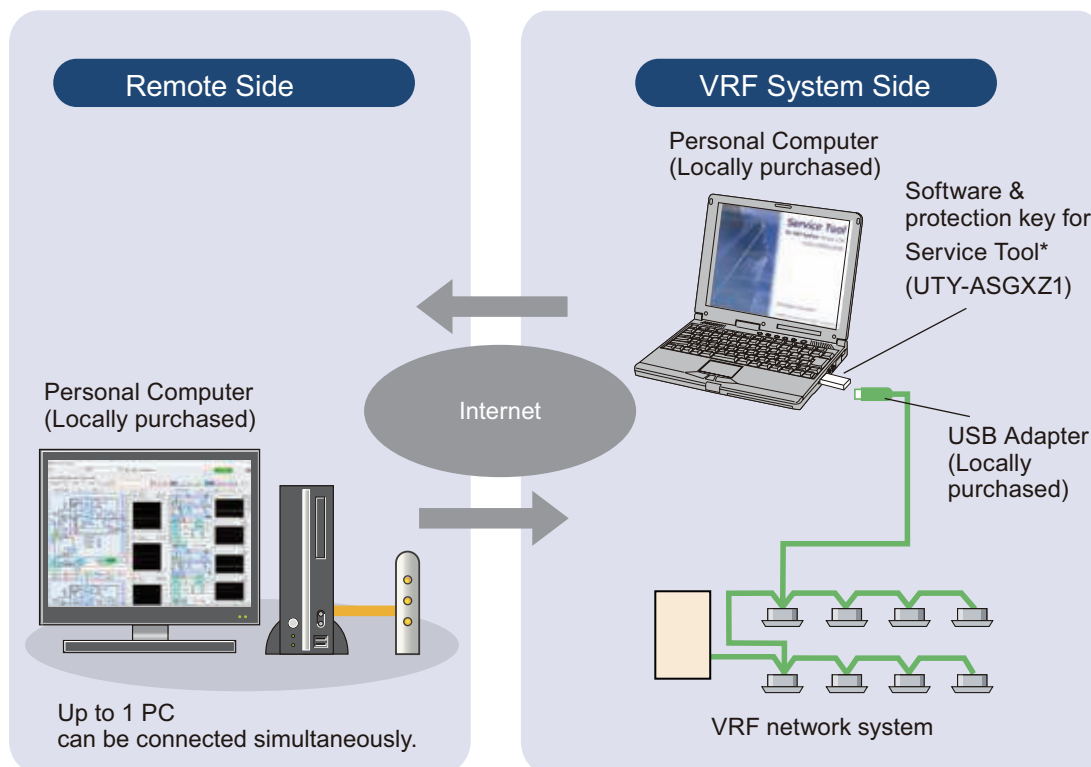

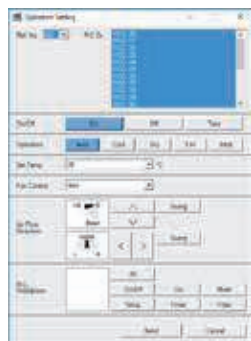

## System diagram




\*: WibuKey of UTY-ASGX can be used.
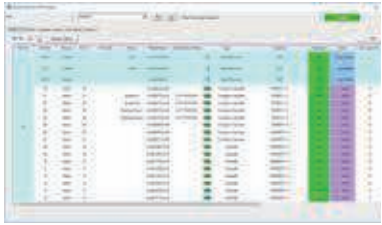
## Functions


Function	Summary
System list	Displays the overall operation status of all or specified units in the system in a list form. 
Equipment detail (Diagram)	Displays the detail information for sensor values, electrical components etc. for the specified units in schematic. The information here can be used along with the detailed information in list form, to check the operation status of units and make detail analysis on the cause, in case an error occurs. 
Equipment detail (Status list)	Displays the detail information for sensor values, electrical components etc. of units in a specified refrigerant system in list form. The information here can be used along with the detailed information in diagram form, to check the operation status of units and make detail analysis on the cause, in case an error occurs. 
Equipment detail (Check list)	Judges the sensor valves of outdoor units and indoor units are appropriate, and displays the result. By saving the result as a CSV file, it can be outputted with a report format. 

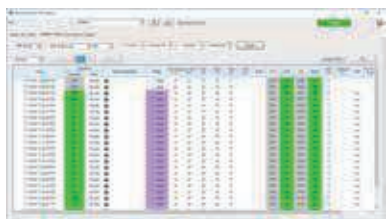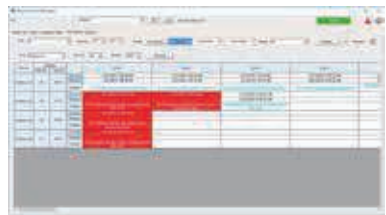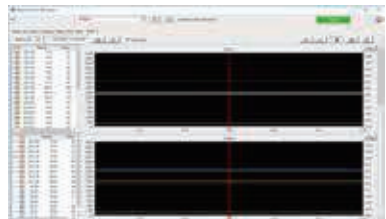Function	Summary
Operation history	<p>The indoor units or outdoor units operation history can be recorded. The displayed operation history can be printed out and saved to a CSV file.</p> 
Error history	<p>Displays the error information for each unit. The error information can sequentially be displayed up to 50 items as they occur starting with the latest error.</p> 
Graph	<p>Displays the sensor values of outdoor units and indoor units in more detail and more easier to see. Sensor information that the user want to check can be selected freely, and combined information can be displayed. Up to 6 graph screens can be displayed simultaneously.</p> 
Data backup	<p>Operation and error history data can be downloaded. Only the required data may be downloaded specifying the refrigerant system, unit, and time range.</p> 
Operation setting	<p>Changeable the operation status of the indoor unit individually or by group.</p> 
Network topology analyzer	A list of units connected to the VRF system network is displayed in network segments in tree form.
Remote setting	Function (Field) setting for indoor units is realized remotely.
System time setting	An arbitrary time is set for all the remote controllers within the system.
Central control forced release	The operation setting restriction function of the indoor units set from the controller can be forcibly released. (remote controller inhibit, temperature upper/lower limit setting)
Model name writer	An arbitrary model name can be written to the target unit.
Error memory reader	<p>When an error occurs at an outdoor unit, the operation data records before the error are acquired over a network, and saved to a CSV file.</p> <p><b>NOTE:</b> To perform "Error memory reading", Service tool and the corresponding outdoor unit must be connected directly with each other. Refer to the operation manual of the Service tool for details.</p>
Time guard information	Reference data for judging the maintenance period of indoor and outdoor units (compressor, fan, etc. integrated time) is output to a CSV file.
Off line data reader	<p>Displays and compares the current data and the backup data saved in the past on dual screen.</p> 

Function	Summary
Version	<p>Confirm the current version of the software, and it is not the latest, it can be updated to the latest version.</p> 
Remote operation	<p>Through the Internet, Service tool in the PC on VRF system side can be operable in real-time from remote side PC. Chat-enabled, and the acquired data by the Service tool can be downloaded by remote side PC.</p>

## 4-2. Web monitoring tool (UTY-AMGXZ1)

### ■ Accessory

Name and shape	Q'ty	Application
 WHITE-USB-KEY (software protection key with software)	1	Includes the software and manuals for Web monitoring tool. Additionally, it works as the software protection key. Software protection key to be connected to an USB port on the PC that Web monitoring tool is installed. Web monitoring tool runs only on a PC with this WHITE-USB-KEY.

### ■ Other required devices (Locally purchased)

- Personal computer that satisfies the following system requirements
  - For VRF system side PC

Personal computer system requirement	
Operating system	<ul style="list-style-type: none"> <li>Microsoft Windows 7 Professional (32-bit or 64-bit) SP1</li> <li>Microsoft Windows 8.1 Pro (32-bit or 64-bit)</li> <li>Microsoft Windows 10 Pro (32-bit or 64-bit)</li> </ul>
CPU	1 GHz or higher
Memory	<ul style="list-style-type: none"> <li>1 GB or more (for Windows 7 [32-bit], Windows 8.1 [32-bit], and Windows 10 [32-bit])</li> <li>2 GB or more (for Windows 7 [64-bit], Windows 8.1 [64-bit], and Windows 10 [64-bit])</li> </ul>
HDD	40 GB or more of free space
Display	1,366 × 768 or higher resolution
Interface	<ul style="list-style-type: none"> <li>USB port (for Echelon U10 USB Network Interface, Max. 4, software protection key)</li> <li>Either of the following interface is required for remote connection:               <ul style="list-style-type: none"> <li>Internet using LAN: Ethernet port is required.</li> </ul> </li> </ul>
Software	Adobe Reader 9.0 or later
Internet transmission rate (in remote access)	Internet environment capable for communication speed of 3 Mbps or more (for uploading) all the time (including when accessing to overseas website)


- For remote side PC

Personal computer system requirement	
Web browser	Internet Explorer 11.0 or Microsoft Edge
Display	1,366 × 768 or higher resolution (Before use, set the resolution so that the resolution of remote side PC monitor screen is higher than that of VRF system side PC.)
Internet transmission rate (in remote access)	Internet environment capable for communication speed of 4 Mbps or more (for downloading) all the time (including when accessing to overseas website)

- Echelon U10 USB Network Interface – TP/FT-10 Channel (Model number: 75010R) (Required for each VRF network)

## ■ System diagram


### • System components

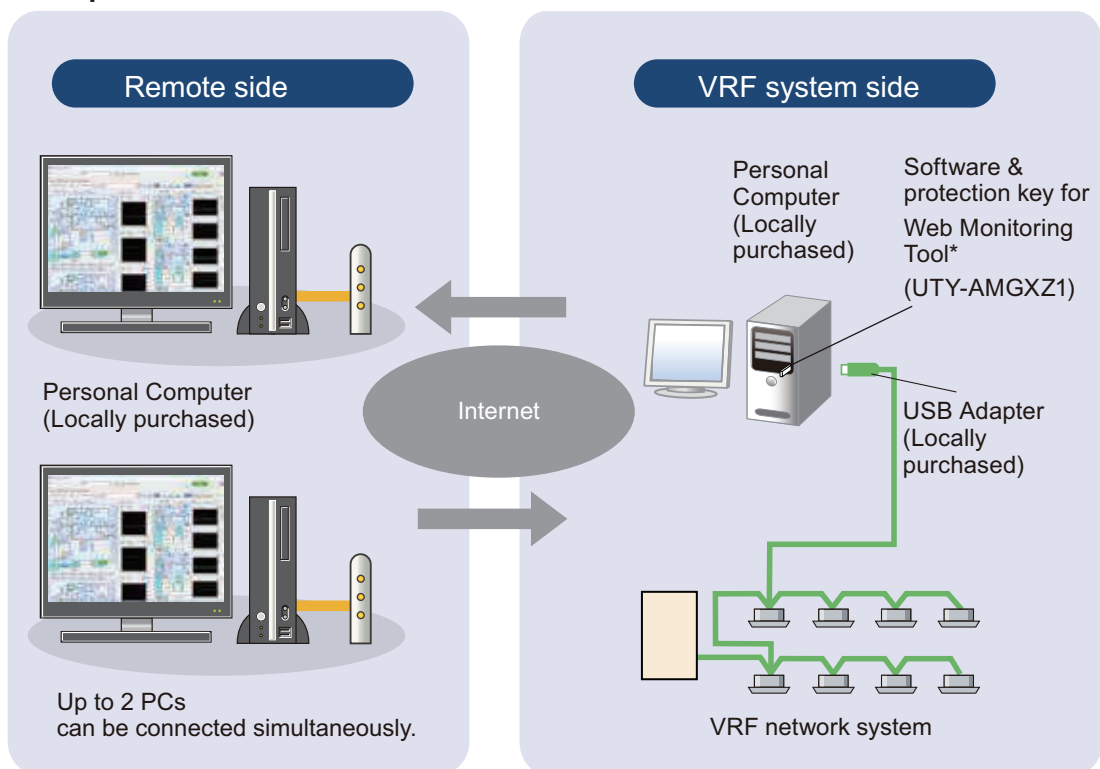

\*WibuKey of UTY-AMGX can be used.

### • Support 4 VRF network systems

PC USB adapters (Max. 4 ports per PC) permit control and monitoring of up to 1,600 units. Suitable for large-scale buildings or hotels.

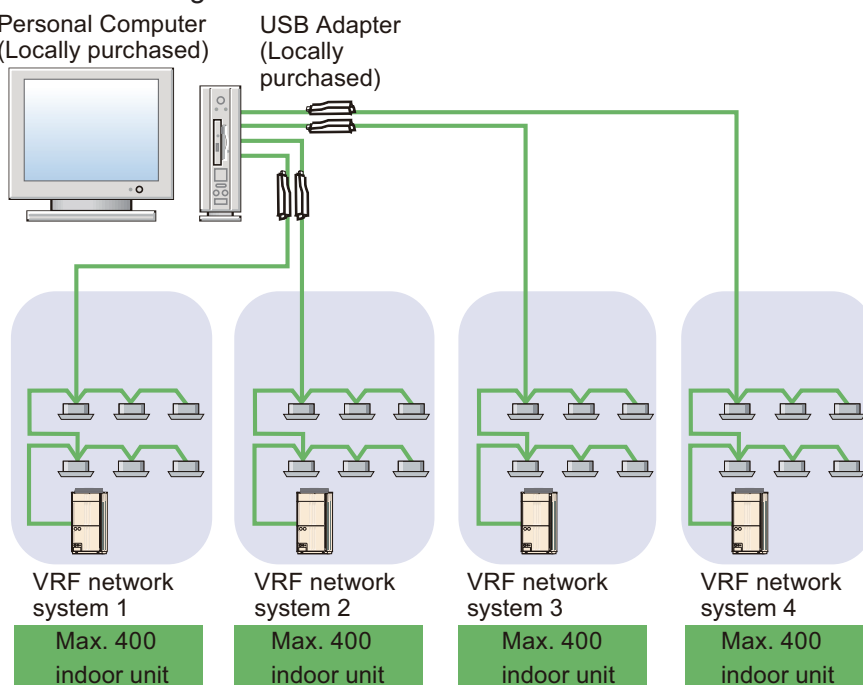

## ■ Comparison table

Function	Service tool (UTY-ASGXZ1)		Web monitoring tool (UTY-AMGXZ1)	
	VRF system side	Remote side	VRF system side	Remote side
System list	●	●	●	●
Equipment detail (Diagram)	●	●	●	●
Equipment detail (Status list)	●	●	●	●
Equipment detail (Check list)	●	●	●	●
Operation history	●	●	●	●
Error history	●	●	●	●
Graph	●	●	●	●
Data backup	●	●	●	●
Operation setting	●	●	●	●
E-mail automatic transmission of system malfunction	—	—	●*	—
Network topology analyzer	●	●	●	●
Remote setting	●	●	●	●
System time setting	●	●	●	●
Central control forced release	●	●	●	●
Model name writer	●	●	—	—
Error memory reader	●	●	—	—
Time guard information	●	●	●	●
Off line data reader	●	●	—	—
Version	●	●	●	●
Software update	●	—	●	—

\*: Available only during connection to the Internet







## 6. SYSTEM DESIGN

# CONTENTS

## 6. SYSTEM DESIGN

<b>1. System design</b>	<b>06-1</b>
1-1. Refrigerant system	06-1
1-2. VRF network system	06-8
1-3. Installation place	06-15
1-4. Transportation the outdoor unit	06-18
<b>2. Piping design</b>	<b>06-19</b>
2-1. Important items when using refrigerant (R410A)	06-19
2-2. Piping limitation	06-22
2-3. Pipe size	06-33
2-4. Selection of pipe heat insulating material	06-40
2-5. Additional charge calculation	06-41
2-6. Piping design example	06-43
<b>3. Piping connection</b>	<b>06-49</b>
3-1. Piping to outdoor unit	06-51
3-2. Outdoor unit branch kit	06-57
3-3. Separation tube	06-61
3-4. Header	06-65
<b>4. Wiring design</b>	<b>06-68</b>
4-1. Electrical wiring	06-68
4-2. Power supply cable	06-70
4-3. Transmission cable	06-74
4-4. Controller cable	06-84
<b>5. Drain connection</b>	<b>06-87</b>
5-1. Outdoor unit	06-87
5-2. Indoor unit	06-88

# 1. System design

## 1-1. Refrigerant system

### ■ Connectable unit within 1 refrigerant system

Unit	Quantity	Remarks
Outdoor unit	1 to 3 units	
Indoor unit	2 *1 to 63 units	

\*1 : One indoor unit connection is not allowed, except for the connection of ARUH96TLAV2 — AOUA72RLBV1 or ARUH96TLAV2 — AOUA96RLBV1.

#### • Table 1 (Combination)

Ton	Cooling capacity (Btu/h)	Outdoor unit quantity	Maximum connectable indoor unit quantity	Connectable cooling capacity range
6	72,000	1	16	50 to 150%
8	96,000	1	21	
10	120,000	1	26	
12	144,000	2	32	
14	168,000	2	37	
16	192,000	2	42	
18	216,000	2	47	
20	240,000	2	52	
22	264,000	3	58	
24	288,000	3	63	


#### ⚠ CAUTION

- When all indoor units are operating at maximum capacity, individual indoor unit operates at a slightly lower capacity. (When connecting more than 100%)
- Based on the capacity table in ["2. MODEL SELECTION"](#), select the optimum combination of outdoor units.
- Do not exceed both of connectable cooling capacity range and maximum connectable indoor unit quantity, otherwise it may cause hinder the return of the refrigerant oil and cause a compressor breakdown.
- Minimum connectable indoor unit number is two.

## Refrigerant system examples

**NOTE:** For cooling capacity range of connectable indoor units, refer to "Refrigerant system" on page 06-1.


- **Example 1 (OK)**

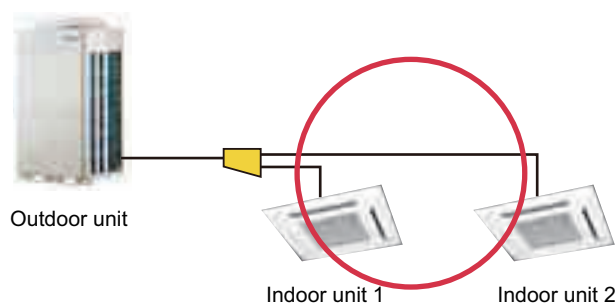

Capacity ratio	58%
----------------	-----

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AQUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	(2) ≤ (1) ≤ (3) 36,000 < 42,000 < 108,000 → OK
Indoor unit 1	AUUA24TLAV2	24,000	(1)			
Indoor unit 2	AUUA18TLAV2	18,000	42,000			


- **Example 2 (OK)**

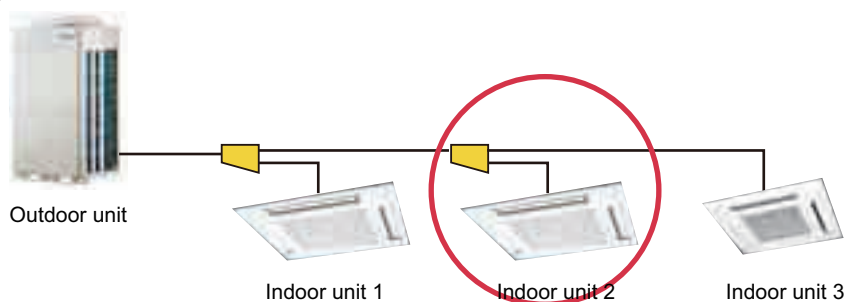

Capacity ratio	100%
----------------	------

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	(2) ≤ (1) ≤ (3) 36,000 < 72,000 < 108,000 → OK
Indoor unit 1	AUUB30TLAV	30,000	(1) 72,000			
Indoor unit 2	AUUB24TLAV	24,000				
Indoor unit 3	AUUB18TLAV	18,000				


• **Example 3 (Prohibited)**

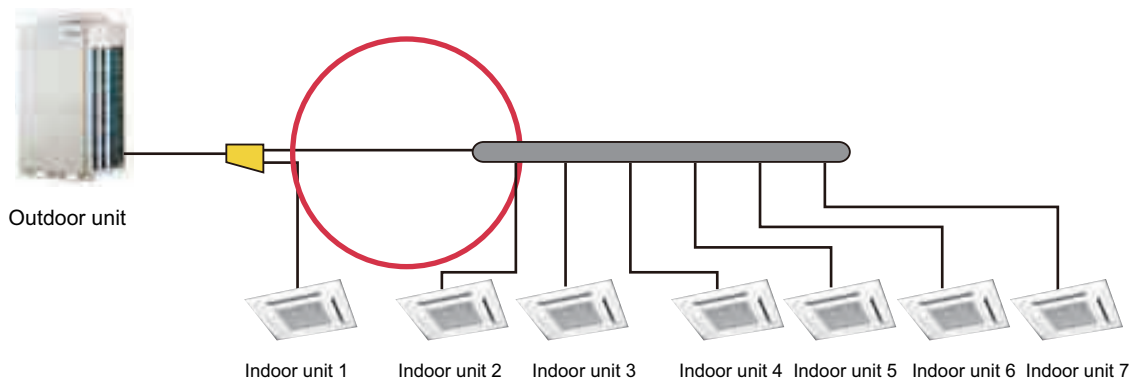

Capacity ratio	106%
----------------	------

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA96RLBV1	96,000	96,000	(2) 50% 48,000	(3) 150% 144,000	(1) ≤ (3) 48,000 < 102,000 < 144,000 → OK
Indoor unit 1	AUUA18TLAV2	18,000	(1) 102,000			
Indoor unit 2	AUUA14TLAV2	14,000				
Indoor unit 3	AUUA14TLAV2	14,000				
Indoor unit 4	AUUA14TLAV2	14,000				
Indoor unit 5	AUUA14TLAV2	14,000				
Indoor unit 6	AUUA14TLAV2	14,000				
Indoor unit 7	AUUA14TLAV2	14,000				


• **Example 4 (Prohibited)**

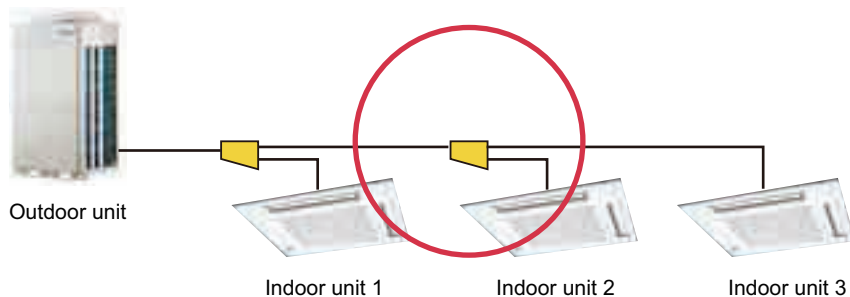

Capacity ratio	150%
----------------	------

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	(2) ≤ (1) ≤ (3) 108,000 = 108,000 → OK
Indoor unit 1	AUUB36TLAV	36,000	(1) 108,000			
Indoor unit 2	AUUB36TLAV	36,000				
Indoor unit 3	AUUB36TLAV	36,000				


• **Example 5 (Prohibited)**

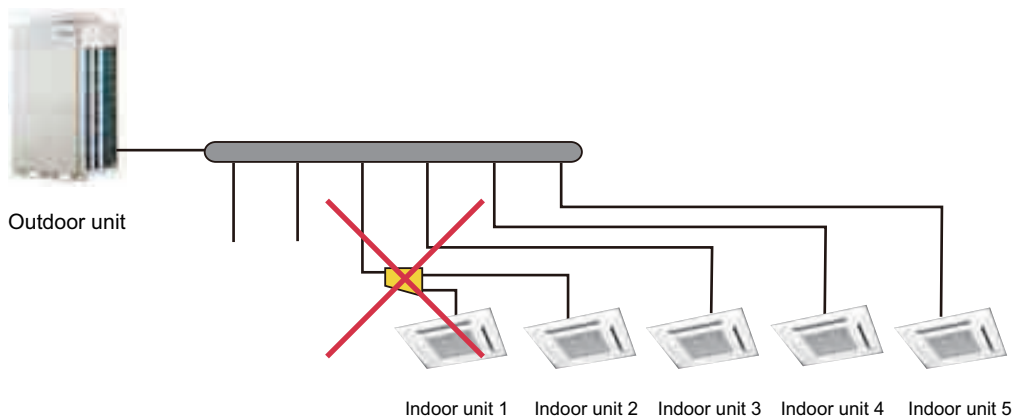

Capacity ratio	97%
----------------	-----

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	Prohibited Because separation tube is installed in the down stream of header.
Indoor unit 1	AUUA14TLAV2	14,000	(1) 70,000			
Indoor unit 2	AUUA14TLAV2	14,000				
Indoor unit 3	AUUA14TLAV2	14,000				
Indoor unit 4	AUUA14TLAV2	14,000				
Indoor unit 5	AUUA14TLAV2	14,000				


• **Example 6 (OK)**

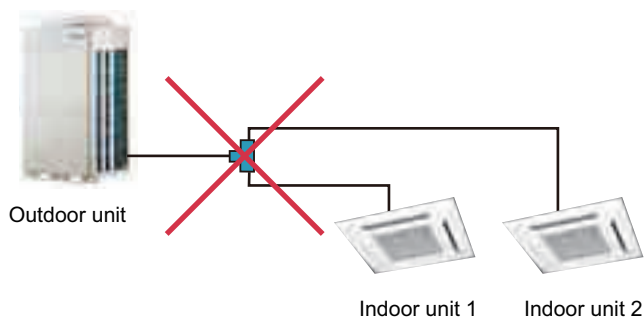

Capacity ratio	67%
----------------	-----


Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	Prohibited  Do not use standard pipe Tees for branches.Fujitsu branch kits should be used instead.
Indoor unit 1	AUUB24TLAV	24,000	(1) 48,000			
Indoor unit 2	AUUB24TLAV	24,000				

- **Example 7 (OK)**

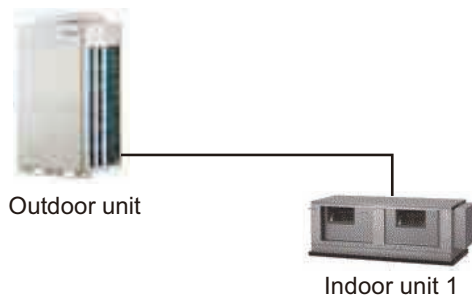


Capacity ratio				100%		
Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA96RLBV1	96,000	96,000	(2) 50% 48,000	(3) 150% 144,000	(2) ≤ (1) ≤ (3) 48,000 < 96,000 < 144,000 → OK
Indoor unit 1	ARUH96TLAV2	96,000	(1) 96,000			

- **Example 8 (OK)**

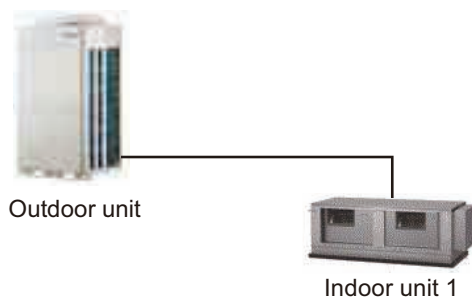

Capacity ratio				100%		
Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AQUA72RLBV1	72,000	72,000	(2) 50%	(3) 150%	(2) ≤ (1) ≤ (3) 36,000 < 72,000 < 108,000 → OK
Indoor unit 1	ARUH72TLAV2	72,000	(1) 72,000	36,000	108,000	


• **Example 9 (Prohibited)**

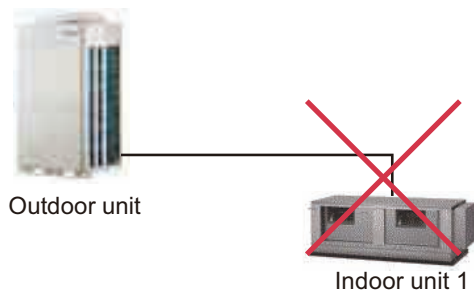

Capacity ratio	75%
----------------	-----

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA96RLBV1	96,000	96,000	(2) 50% 48,000	(3) 150% 144,000	Prohibited  This connection is not allowed.
Indoor unit 1	ARUH72TLAV2	72,000	(1) 72,000			

• **Example 10 (Prohibited)**

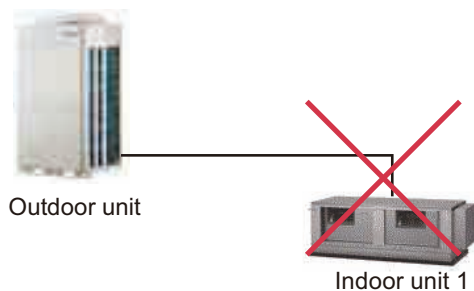


Capacity ratio	133%
----------------	------

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	Prohibited  This connection is not allowed.
Indoor unit 1	ARUH96TLAV2	96,000	(1) 96,000			



- **Example 11 (Prohibited)**

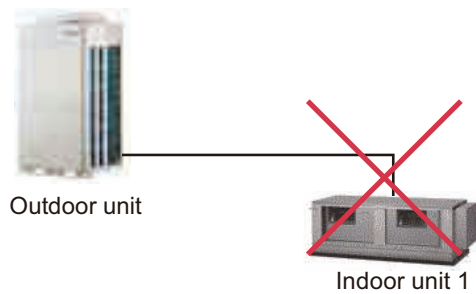

Capacity ratio	83%
----------------	-----

Model name		Cooling capacity	Total capacity	Connectable indoor unit capacity		Judge
				Min.	Max.	
		(Btu/h)				
Outdoor unit	AOUA72RLBV1	72,000	72,000	(2) 50% 36,000	(3) 150% 108,000	Prohibited This connection is not allowed.
Indoor unit 1	ARUH60TLAV	60,000	(1) 60,000			

## 1-2. VRF network system

### ■ Definition

#### **VRF network**

VRF network means global VRF network.

#### **Network segment (NS)**

Network segment (NS) means each networks shut off by Signal amplifier.

Network segments mean divided block which has been connected with Signal amplifier within conditions that required Signal amplifier.

When a Signal amplifier is installed, network is divided into two network segments.

#### **Element**

Generic name for indoor unit, outdoor unit, Signal amplifier, TPC, CRC, and so on in network segment.

#### **Terminal resistor**

Terminal resistor means resistor should set in network segment.

## ■ Maximum wiring length

Transmission cable	Maximum wiring length
Total wiring length of transmission	11,811 ft (3,600 m)
Maximum wiring length between units	1,312 ft (400 m)
Total wiring length in 1 segment	1,640 ft (500 m)

	VRF network system	Segment
Wiring length	11,811 ft (3,600 m)	1,640 ft (500 m)
Number of units	400	64

In the following case, Signal amplifier is required.

- When the total length of the transmission cable exceeds 1,640 ft (500 m).
- When transmission cable length between each units exceeds (in segment) 1,312 ft (400 m).
- When the number of total unit exceeds 64 units. (For how to count units, refer to ["How to count element in a network segment"](#) on page 06-14.

## ● Maximum wiring length of units





Name	Model name	Maximum wiring length		Remarks
Network converter	UTY-VGGXZ1	Total length of group remote controller cable to Network converter	328 ft (100 m)	Used for group remote controller
	UTY-VTGX UTY-VTGXV	Remote controller to Network converter	328 ft (100 m)	Used for single split air conditioner
		Indoor unit to Network converter	328 ft (100 m)	
Network converter for LonWorks	UTY-VLGX	In each network segment	1,640 ft (500 m)	
Modbus converter	UTY-VMGX	In each network segment	1,640 ft (500 m)	
Signal amplifier	UTY-VSGXZ1	In each network segment	1,640 ft (500 m)	
External switch controller	UTY-TERX UTY-TEKX	External switch to External switch controller	164 ft (50 m)	Maximum connectable indoor units: 16 2 remote controllers can be used jointly.
		Indoor unit to External switch controller	82 ft (25 m)	
Wired remote controller	UTY-RNRUZ* UTY-RNKU	Remote controller cable	1,640 ft (500 m)	
Simple remote controller	UTY-RSRY UTY-RSKU UTY-RHRY UTY-RHKU			

## ■ Maximum connectable unit numbers in 1 VRF network system

Outdoor unit	100
Indoor unit	400

### ● Controller






#### • Central controller

Exterior	Part name	Model name	Max. connectable number	Max. controllable number			
				VRF network system	Remote controller group	Indoor unit	Group
	System controller*1	UTY-APGXZ1	1	4	1,600 per VRF network system		
	System controller lite	UTY-ALGXZ1	1	1	400		
	Touch panel controller	UTY-DTGYZ1	16*2	—	400		
	Central remote controller	UTY-DCGYZ*	16*2	—	100	100	50

#### NOTES:


- \*1: Different VRF series may be connected for each of the 4 VRF networks supported by the product, but different series may not coexist within the same network. (VR-II, V-II, J-II, J-IIS, J-IIIL, J-IV, and J-IVS can exist together in same network. V and S can exist together in same network, too.)
- \*2: For 1 VRF network system, total number of Touch panel controller, Central remote controller, Network converter for Group remote controller, KNX converter for VRF, Modbus converter for VRF, BACnet gateway (Hardware), Niagara driver for VRF is 16, including 1 Network converters for LonWorks.
- \*3: When Group remote controller is used, Network converter (UTY-VGGXZ1) is required.

- Individual controller

Exterior	Part name	Model name	Max. number	Remarks
	Wired remote controller (Touch panel)	UTY-RNRUZ*	—	Maximum controllable indoor units: 16
	Wired remote controller	UTY-RNKU	—	Maximum controllable indoor units: 16
	Simple remote controller	UTY-RSRY UTY-RSKU	—	Maximum controllable indoor units: 16
	Simple remote controller (Without operation mode)	UTY-RHRY UTY-RHKU	—	Maximum controllable indoor units: 16
	Wireless remote controller	UTY-LNHU	—	

## ● Adaptor/Converter/Maintenance tool

Exterior	Part name	Model name	Max. number	Remarks
	Network converter	UTY-VTGX	100	<ul style="list-style-type: none"> <li>Total number of refrigerant system and Network converter is maximum 100.</li> <li>Maximum connectable single split type or multi type: 16 units</li> </ul>
	Network converter	UTY-VGGXZ1	For split system: 100	<ul style="list-style-type: none"> <li>Total number of refrigerant system and Network converter is maximum 100.</li> <li>Maximum connectable single split type or multi type: 16 units</li> <li>This Network converter covers 2 refrigerant systems.</li> </ul>
	Network converter for LonWorks	UTY-VLGX	1*1	Maximum controllable indoor units: 128
	Modbus converter for VRF	UTY-VMGX	9*1	Maximum controllable indoor units: 128
	Modbus converter for indoor unit	UTY-VMSX	—	Maximum controllable indoor units: 1
	BACnet gateway (Hardware)	UTY-VBGX	4*1	Maximum controllable indoor units: 128
	BACnet gateway (Software)	UTY-ABGXZ1	1*2	<ul style="list-style-type: none"> <li>Maximum controllable VRF network system: 4</li> <li>Maximum controllable remote controller group: 1,600 per 4 VRF network system</li> <li>Maximum controllable indoor units: 1,600 per 4 VRF network system</li> <li>Maximum controllable group: 1,600 per 4 VRF network system</li> </ul>
	Niagara driver for VRF	FUJ-VRF-8000	4*4	Maximum controllable units: 250. Use under 125 units is recommended.
	Signal amplifier	UTY-VSGXZ1	8	Signal amplifier is required when 1,640 ft (500 m) or more in transmission cable length or connected units exceed 64 units.
	External switch controller	UTY-TERX UTY-TEKX	—	Maximum controllable indoor units: 16
	Service tool	UTY-ASGXZ1	1*3	<ul style="list-style-type: none"> <li>PC: Locally purchased</li> <li>USB adapter is required.</li> </ul>

Exterior	Part name	Model name	Max. number	Remarks
	Web monitoring tool	UTY-AMGXZ1	1*2*3	<ul style="list-style-type: none"> <li>• PC: Locally purchased</li> <li>• Up to 4 VRF network system can be observed with one Web monitoring tool.</li> </ul>

**NOTES:**

- \*1: For 1 VRF network system, total number of Touch panel controller, Central remote controller, Network converter for Group remote controller, KNX converter for VRF, Modbus converter for VRF, BACnet gateway (Hardware) is 16, including 1 Network converters for LonWorks.
- \*2: Different VRF series may be connected for each of the 4 VRF networks supported by the product, but different series may not coexist within the same network. (VR-II, V-II, J-II, J-IIS, J-IIIL, J-IV, and J-IVS can exist together in same network. V and S can exist together in same network, too.)
- \*3: 1 Service tool or 1 Web monitoring tool can be connected.
- \*4: For 1 VRF network system, total number of Touch panel controller, Central remote controller, Network converter for Group remote controller, KNX converter for VRF, Modbus converter for VRF, BACnet gateway (Hardware), Niagara driver for VRF is 16, including 1 Network converters for LonWorks.

## ● How to count element in a network segment

Each unit must be counted in the network segment as in the table below.

Element		Model name	Count
Outdoor unit (each)	Master	—	1
	Slave	—	0
Indoor unit (each)		—	1
Controller	System controller	UTY-APGXZ1	1
	System controller lite	UTY-ALGXZ1	1
	Touch panel controller	UTY-DTGYZ1	1
	Central remote controller	UTY-DCGY	1
	Central remote controller	UTY-DCGYZ*	1
	Wired remote controller (Touch panel)	UTY-RNRUZ*	0
	Wired remote controller	UTY-RNKU	0
	Simple remote controller (With operation mode)	UTY-RSRY	0
		UTY-RSKU	
	Simple remote controller (Without operation mode)	UTY-RHRY	0
		UTY-RHKU	
	Wireless remote controller	UTY-LNHU	0
	IR receiver unit	UTY-TRHX	0
	IR receiver unit	UTB-YWC	0
	IR receiver unit for 4-way flow cassette type	UTY-LRHYB1	0
	IR receiver unit for circular flow cassette type	UTY-LBHDX	0
	Human sensor kit for circular flow cassette type	UTY-SHZXC	0
	Remote sensor unit	UTY-XSZX	0
Adaptor/ Convertor	Network converter	UTY-VTGX	1
		UTY-VTGXV	
		UTY-VGGXZ1	
	Network converter for LonWorks	UTY-VLGX	1
	Modbus converter for VRF	UTY-VMGX	1
	Modbus converter for indoor unit	UTY-VMSX	0
	Thermostat converter	UTY-TTRX	0
	BACnet gateway (Hardware)	UTY-VBGX	1
	BACnet gateway (Software)	UTY-ABGXZ1	1
	Niagara driver for VRF	FUJ-VRF-8000	1
Maintenance	Signal amplifier	UTY-VSGXZ1	1*
	External switch controller	UTY-TERX	0
		UTY-TEKX	
Maintenance	Service tool	UTY-ASGXZ1	1
	Web monitoring tool	UTY-AMGXZ1	1
Option	Other optional parts	—	0

\*: Signal amplifier should be count per each network segment.



## 1-3. Installation place

### ■ Outdoor unit

For installing the outdoor unit, select a place where satisfies following conditions.

- A place where satisfies the installation space described in "[Installation space](#)" in Chapter 3. OUT-DOOR UNITS on page 03-22.
- A place where the unit can be installed horizontally.
- A place with enough space for performing pipe work, service, and maintenance.
- A place where satisfies the pipe limitations of height and length between the outdoor units to be connected.

For satisfactory operation of the air conditioner, install the outdoor unit with referring the outlines described in the installation manual.

### ● Installation limitation



Do not install at the place of following conditions:

- A place exposed to strong or seasonal winds
- A place where the blown air accumulate
- A place where there are obstructions to the air near to the inlet and outlet
- A place exposed to radiation from other heat sources
- A place where the discharged air will affect animals or plants
- A place where the noise and hot air will disturb the neighbor
- A place that transmit noise or vibration
- A place where drain water is problem
- A place where snow accumulate
- A place where is affected easily by electrical noise
- A place where children can reach
- A place where there is danger of the generation, influx, or accumulation of flammable gas
- A place that have a special environment such as large amount of oil, vapor, or sulfide gas

## ● Precaution for installation place

- Install the outdoor unit in a position where its tilt is 3 degrees or less. However, do not install the unit with it tilted towards the side containing the compressor.
- Install the outdoor unit on the place with strong installation fixings, which can sufficiently bear the product weight
- When installing the multiple units at one place, secure enough outlet space to prevent a effect of short circuit.
- In cold or snowy regions, make sure that installation position is high enough, and install a snow protection hood.
- Drain water is discharged from the outdoor unit during operation, so make sure that this drain water is possible to flow.
- Use material such as vibration-resistant rubber to prevent the transmission of vibration to the floor.
- Securely fix the unit when it may be in a position exposed to strong winds.
- When cooling operation will be conducted at outdoor air temperature below 23 °F (-5 °C), the outdoor unit must be installed in a position that is higher than or equal to those of indoor units.
- When cooling operation will be conducted at outdoor air temperature below 23 °F (-5 °C), the outdoor unit must be installed in a position that is higher than or equal to those of indoor units.

Make sure to mount the outdoor unit 1 (master) closest to indoor unit side.

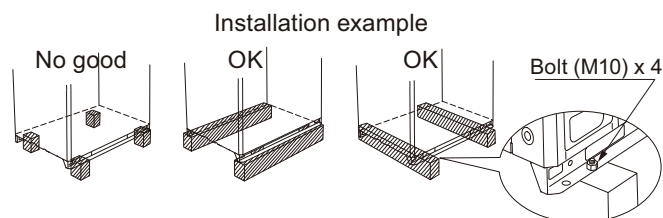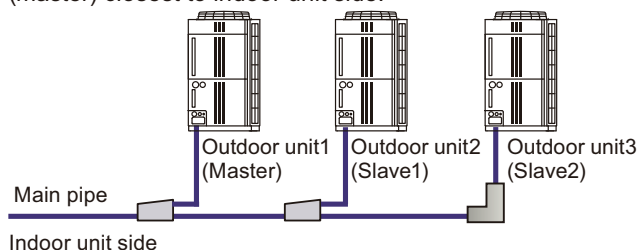


\*Do not use a four-corner support foundation.

- Do not install directly on the ground, this may cause equipment failure.
- Secure enough space for ice buildup by condensation between the bottom of the unit and the flat surface which it is installed. Otherwise, there is risk that the drain water will freeze between the device and the surface and disable drainage.

### ⚠ CAUTION

- If the unit is installed in a region that is exposed to high winds, freezing conditions, freezing rain, snow fall or heavy snow accumulation, take appropriate measures to protect it from those elements.
- To ensure stable operation, the outdoor unit must be installed on a raised stand or rack, at or above the anticipated snow depth for the region.
- The installation of snow hoods and drift prevention fencing is recommended when blowing and drifting snow is common to the region.



## ■ Indoor unit

For installing the indoor unit, with considering your customer's request select a place where satisfies following conditions.

- Install the unit level on a strong wall, floor, ceiling, which is not subject to vibration.
- The inlet and outlet ports should not be obstructed. The air should be able to blow all over the room.
- Install the unit where the connection pipe can be easily installed.
- Install the unit where the drain pipe can be easily installed.
- Take servicing, etc. into consideration and leave the spaces. Also install the unit where the filter can be removed.
- Install the unit where satisfy the pipe length and height.

Also, install the unit at a place of following conditions:

- A well-ventilated place avoiding rains and direct sunlight.
- A place where air from the outlet and noise do not disturb the neighbor.
- A place that can withstand the weight of the indoor unit and install positively so that the unit will not topple or fall.
- A place where drainage does not cause any trouble.

For satisfactory operation of the air conditioner, install the indoor unit with referring the outlines described in the installation manual.

## ● Installation limitation

Do not install the unit the place of following conditions:

- A place where there is the danger of flammable gas leakage.
- A place near heat sources and the location with high temperature.
- A place near a source of heat, steam, or flammable gas.
- A place where there is oily smoke, machine oil (i.e. factory), salty environment with direct sea breeze, and too much of dust.


Mind the following when installing or using the unit:

- Install with the lowest moving parts at least 95 in (2.4 m) above floor or grade level.
- Install the indoor and outdoor units, power wiring, signal wiring and remote control wiring 40 in (1 m) away from televisions and radios to avoid distorted images and noise. (However, distorted images and noise may not be avoidable even if the units and wiring mentioned above are installed 40 in (1 m) away from televisions and radios depending on conditions of the electromagnetic disturbance.)
- When installing an indoor unit in a small room, a care must be taken to keep refrigerant concentrations from exceeding limitations if there is a refrigerant leak.
- Control may not operate correctly if the unit is installed near machinery which emit electromagnetic waves.
- Ducted units should be considered for rooms that require quiet operation, such as bedrooms and hotel guest rooms.
- If children may approach the unit, take preventive measures so that they cannot reach the unit.
- Welded parts may be damaged if the unit is installed where corrosive gases such as sulphuric acid are generated.
- Do not use the unit for air conditioning or saving precision instrument, food, art, plants, and animal as special place.

## 1-4. Transportation the outdoor unit

### ■ Hoisting method


- When hanging the outdoor unit and conveying it to installation place, hang the unit with rope by passing through the 4 opening holes on bottom of front and rear side as shown in figure.
- Use 2 ropes at least 26 ft (8 m) long. If used shorter length, it may cause to damage the unit.
- Use sufficiently strong rope to bear weight of the unit.
- Place the protective board or filter cloth at the place where the cabinet may come into contact with the rope to prevent damages. Without using them, cabinet may cause to damage or deform.
- During hang the unit, make sure to keep the unit horizontally to prevent drop.
- Be careful not to be shocked during hang the unit.

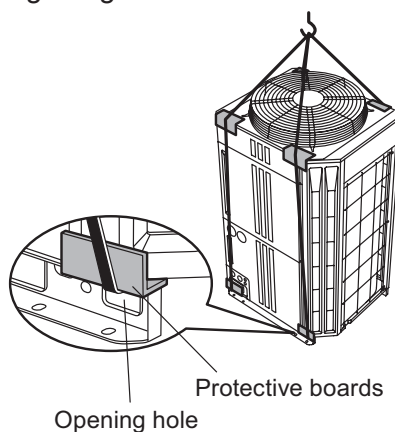

Model name	Weight
AQUA72RLBV1	564 lb (256 kg)
AQUA96RLBV1	
AQUA120RLBV1	611 lb (277 kg)

### ■ Lifting by forklift

- **When using forklift to lift the unit:**
  - Place the forks in the pallet as shown below.
    - Front: Bottom of the wooden delivery pallet
    - Side: Space between pallet and cabinet (The unit is removed from the pallet from the side)
  - Enable to remove the pallet from cabinet.
  - Be careful not to damage the unit.
- **When using manual forklift (Pallet jack) to lift the unit:**  
Pass the forks through to the opening space between pallet and cabinet from side.

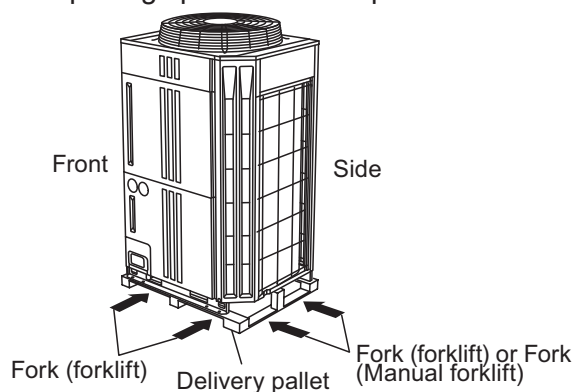

## 2. Piping design

### 2-1. Important items when using refrigerant (R410A)

R410A operates at higher pressure and has less solubility with mineral oil than traditional R22 refrigerant. Therefore, R410A systems use a different lubricant and have different piping requirements.

- **Refrigerant piping material and wall thickness**

Only seamless copper tubes should be used for refrigerant piping. Thickness of tubes are shown in table below.

Endurance pressure of the pipes must be 609 psi (4.2 MPa).

Nominal diameter	in	1/4	3/8	1/2	5/8	3/4	7/8	1-1/8	1-3/8	1-5/8
Outside diameter	mm	6.35	9.52	12.70	15.88	19.05	22.22	28.58	34.92	41.27
Material		JIS H3300 C1220T-O or equivalent* <sup>1</sup>					JIS H3300 C1220T-H or equivalent* <sup>2</sup>			
Wall thickness* <sup>3</sup>	mm	0.8			1.0	1.2	1.0		1.2	1.43

– \*1: Allowable tensile stress  $\geq 33 \text{ N/mm}^2$

– \*2: Allowable tensile stress  $\geq 61 \text{ N/mm}^2$

– \*3: Endurance pressure of the pipes must be 609 psi (4.2 MPa).

Select the pipe size in accordance with the regional standard.

- **Lubricant**

Refrigerant	R410A (Mixed refrigerant)
Lubricant	Synthetic oil


- **Tools**


R410A work requires a number of special tools. The items below (with \* symbol) are specialized for R410A. Make sure that R22 tools cannot be used on R410A systems.

Tool name	Process and application	
Pipe cutter	Pipe cutting	Refrigerant piping work
Flaring tool*	Pipe flaring work	
Torque wrench*	Flare nut connection	
Expander	Expansion at pipe connection	
Pipe bender	Pipe bending work	
Nitrogen gas	Pipe interior oxidation prevention	Air pressure test
Welder	Pipe brazing	
Gauge manifold*	Vacuum evacuation and refrigerant charging operation check	Air pressure test through Refrigerant additional charging
Charging hose*		
Vacuum pump (with adapter)*		Vacuum drying
Electronic scale for refrigerant charging		Refrigerant additional charging
Gas leak tester*	Gas leakage test	

\*: For details, refer to the service manual.

## ■ Work flow example

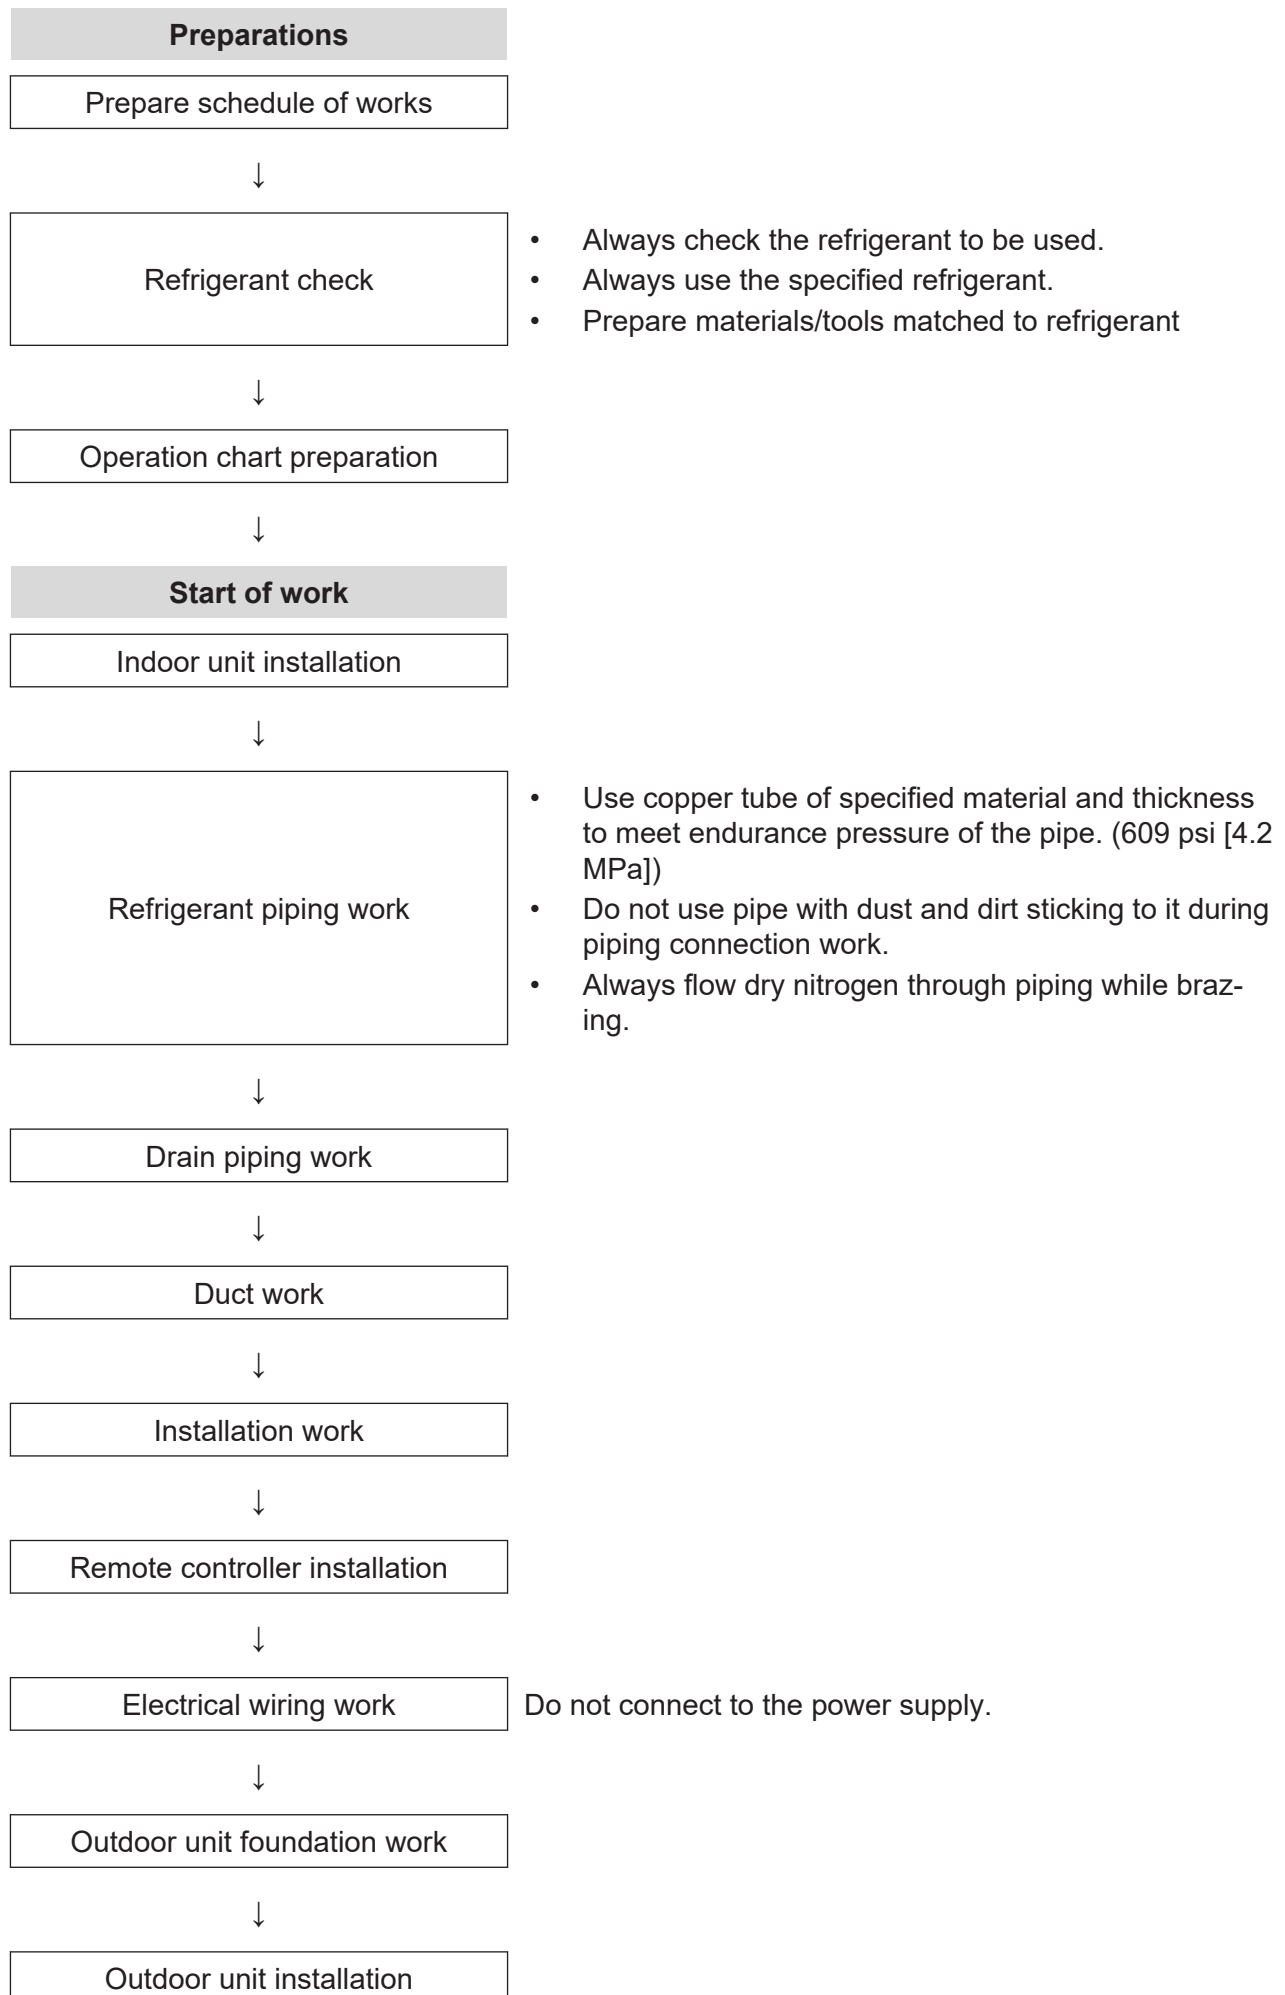

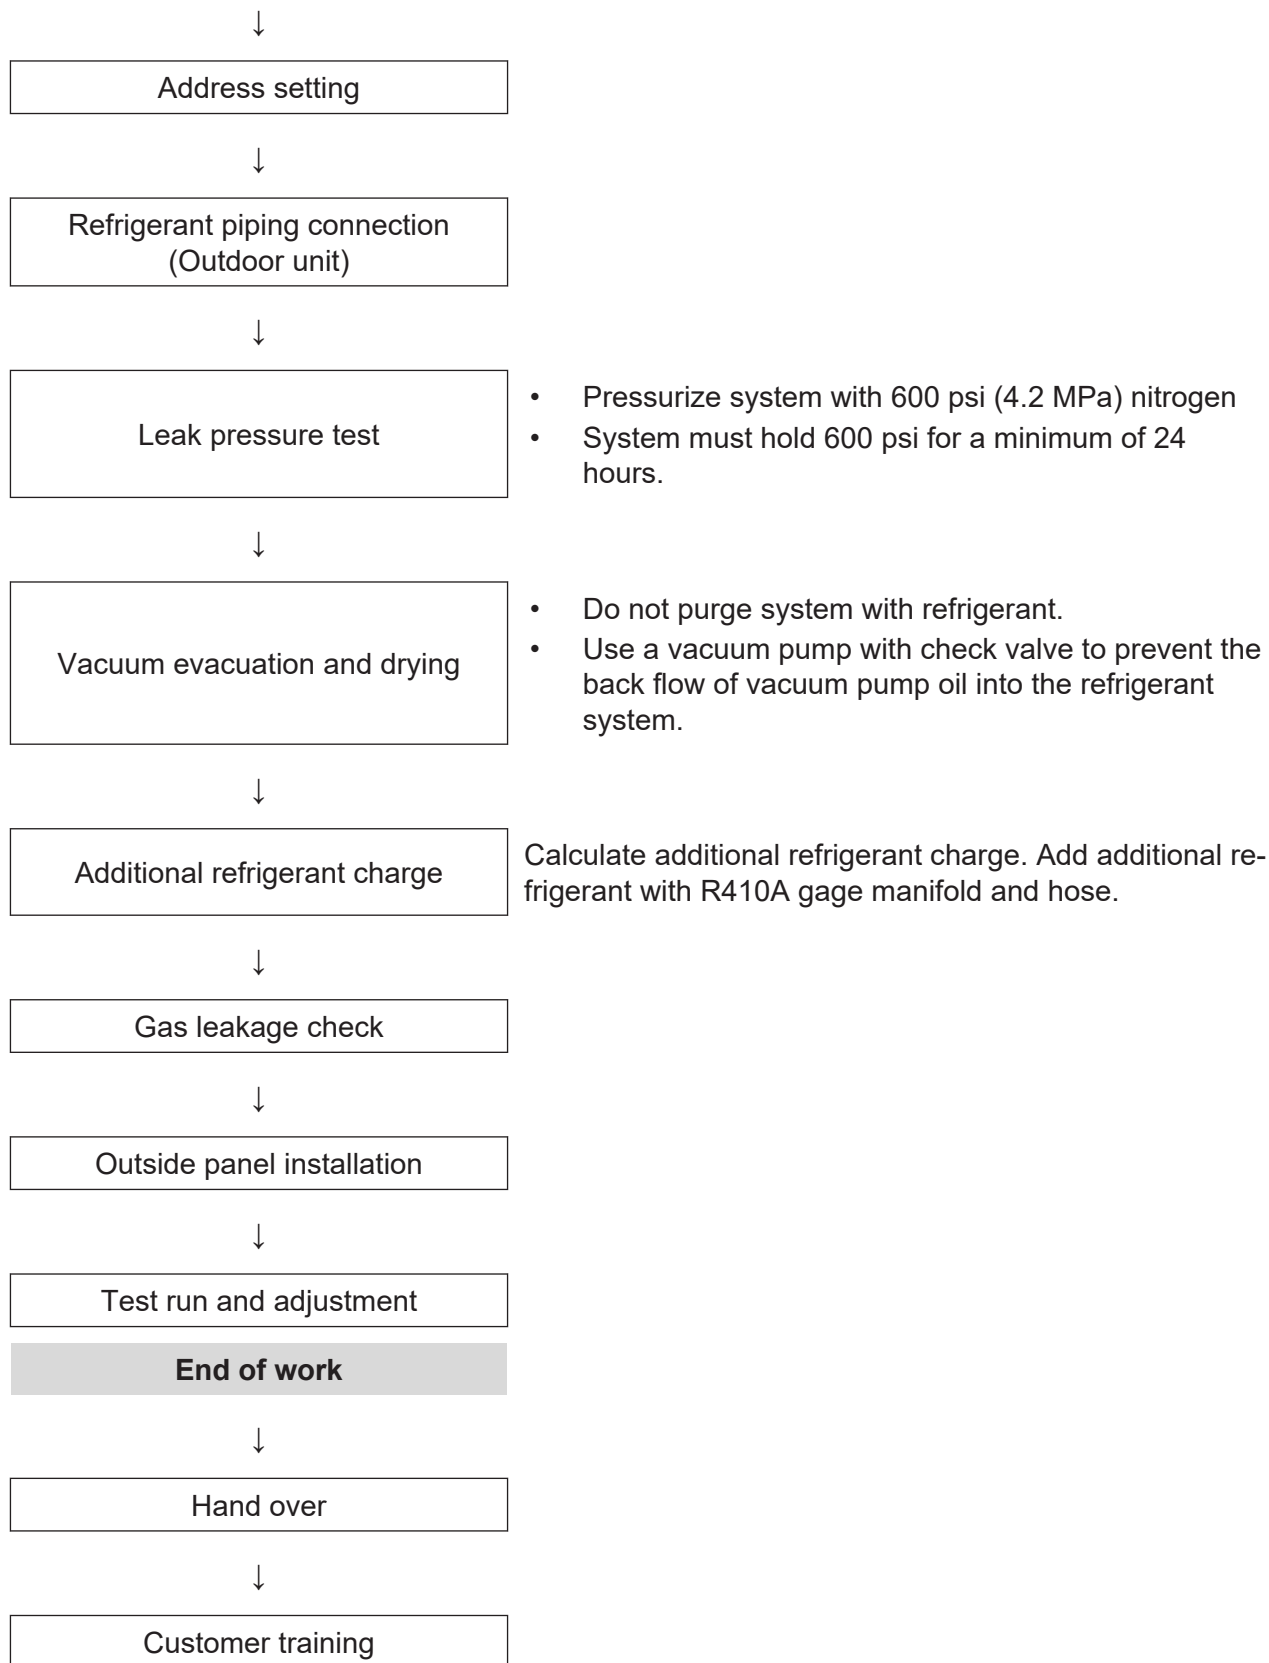

## 2-2. Piping limitation

For proper system operation, keep all the piping limitation mentioned here.

### ⚠ CAUTION

- **Allowable height difference:**

- If the height difference between indoor unit and outdoor unit is larger than the allowable value:
  - The pressure loss will be larger. → Insufficient cooling and heating
  - The refrigerant in liquid pipe will flush. → Refrigerant flow noise generate at indoor unit
  - The refrigerant oil will not return.
    - Insufficient refrigerant oil resulting in compressor damage
- If the height difference between indoor units is larger than the allowable value:
  - The refrigerant flow balance will be poor. → Insufficient cooling and heating (poor balance)
  - Refrigerant oil will collect in the piping or non-operating indoor units.
    - Insufficient refrigerant oil resulting in compressor damage

- **Piping length:**

If the piping length is longer than prescribed:

- The pressure loss will be larger. → Insufficient cooling and heating
- Too much refrigerant will be charged. → Liquid backs up resulting in compressor damage
- The refrigerant oil will not return. → Insufficient refrigerant oil resulting in compressor damage

- **Pipe size:**


- If the pipe size is larger than designated size:
  - The refrigerant flow velocity will drop. Refrigerant oil will not return to the outdoor unit.
    - Insufficient refrigerant oil resulting in compressor damage
  - The refrigerant in liquid pipe will flush easily. → Insufficient cooling and heating
- If the pipe size is smaller than designated size:
  - The refrigerant circulation volume will drop. → Insufficient cooling and heating
  - The pressure loss will be larger. → Insufficient cooling and heating

- **Indoor unit connected capacity:**

- If the indoor unit connected capacity is larger than the system capacity:
  - Insufficient system performance. → Insufficient cooling and heating
  - When heating, refrigerant will collect in non-operating indoor units resulting in an insufficient refrigerant circulation volume. → Insufficient cooling and heating
  - The refrigerant oil will not return. → Compressor damage
- If the indoor unit connected capacity is too small compared to the system capacity:
  - The liquid return will be too great. → Compressor damage
  - The refrigerant will concentrate in the outdoor unit.
    - Continuous operation will become difficult due to the outdoor unit stopping due to high head pressure. Also, excessive noise will be generated by the refrigerant flow when in heating mode.



## ■ In the case of 3 outdoor units are connected

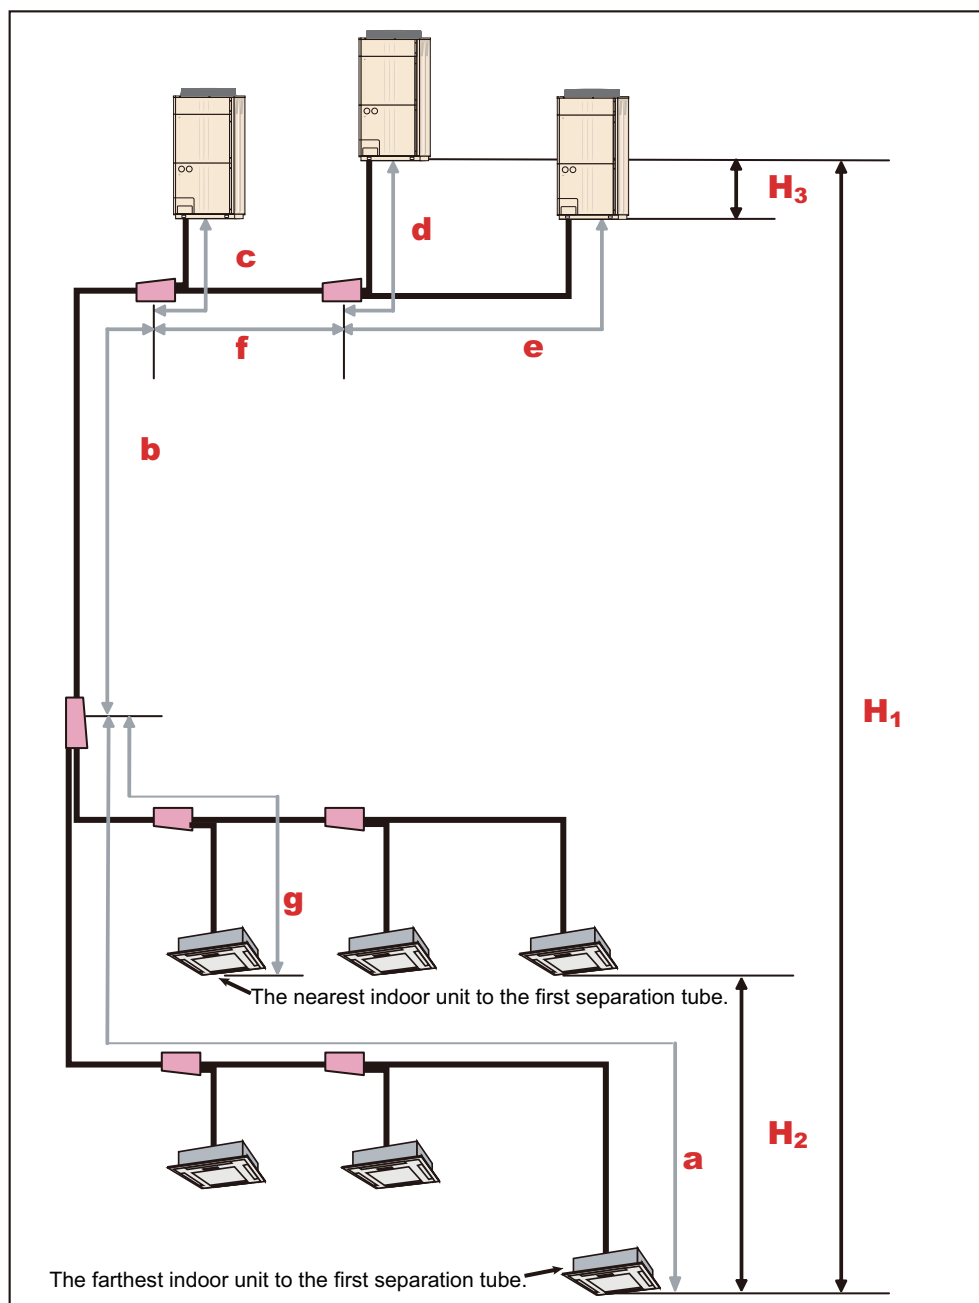


Limitation		Diagram
<b>Allowable pipe length (Actual pipe length)</b>		
Between master outdoor unit and the farthest indoor unit	541 ft (165 m) or less	a + b + c
Between the first separation tube and farthest indoor unit	295 ft (90 m) or less	a
(The farthest indoor unit to the first separation tube) - (The nearest indoor unit to the first separation tube)	196 ft (60 m) or less	a - g
Total pipe length	3,280 ft (1,000 m) or less*1	Total
Between outdoor unit and outdoor unit branch kit	9 ft (3 m) or less	c, d, e
Between the farthest outdoor unit to the first outdoor unit branch kit	39 ft (12 m) or less	d + f, e + f
<b>Allowable height difference</b>		
Between outdoor unit and indoor unit	Outdoor unit is higher than indoor unit	360 ft (110 m)*2/164 ft (50 m) or less
	Outdoor unit is lower than indoor unit	131 ft (40 m) or less
Between indoor unit	49 ft (15 m) or less	H <sub>2</sub>
Between outdoor unit	20 in (0.5 m) or less	H <sub>3</sub>

\*1: Total pipe length is limited by the condition that total refrigerant amount should not exceed 208 lb (94.5 kg).

\*2: When installing the pressure sensor kit on the nearest pipe to the indoor unit with the largest difference in elevation with the outdoor unit, size of the main liquid pipe must be one size larger than the standard size.

**NOTE:** The pipe length between master outdoor unit and the nearest indoor unit is 24 ft (7.5 m) or more.

## ■ In the case of 2 outdoor units are connected

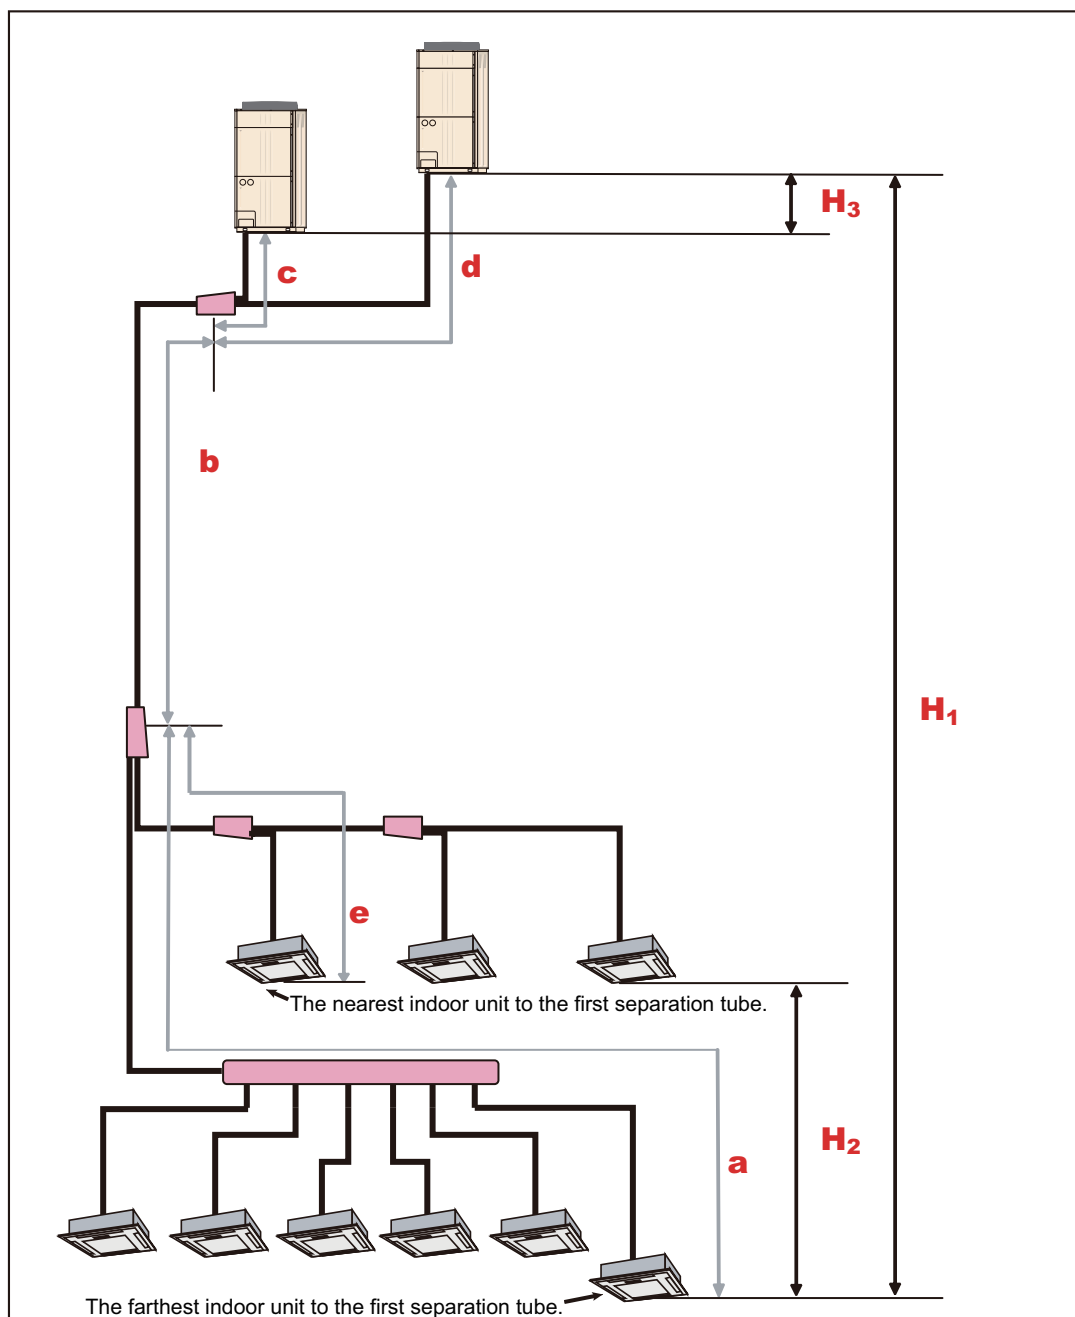


Limitation		Diagram
<b>Allowable pipe length (Actual pipe length)</b>		
Between master outdoor unit and the farthest indoor unit	541 ft (165 m) or less	a + b + c
Between the first separation tube and farthest indoor unit	295 ft (90 m) or less	a
(The farthest indoor unit to the first separation tube) - (The nearest indoor unit to the first separation tube)	196 ft (60 m) or less	a - e
Total pipe length	3,280 ft (1,000 m) or less*1	Total
Between outdoor unit and outdoor unit branch kit	9 ft (3 m) or less	c, d
<b>Allowable height difference</b>		
Between outdoor unit and indoor unit	Outdoor unit is higher than indoor unit	360 ft (110 m)*2/164 ft (50 m) or less
	Outdoor unit is lower than indoor unit	131 ft (40 m) or less
Between indoor unit		49 ft (15 m) or less
Between outdoor unit		20 in (0.5 m) or less

\*1: Total pipe length is limited by the condition that total refrigerant amount should not exceed 139 lb (63 kg).

\*2: When installing the pressure sensor kit on the nearest pipe to the indoor unit with the largest difference in elevation with the outdoor unit, size of the main liquid pipe must be one size larger than the standard size.

**NOTE:** The pipe length between master outdoor unit and the nearest indoor unit is 24 ft (7.5 m) or more.

## ■ In the case of 1 outdoor unit is connected

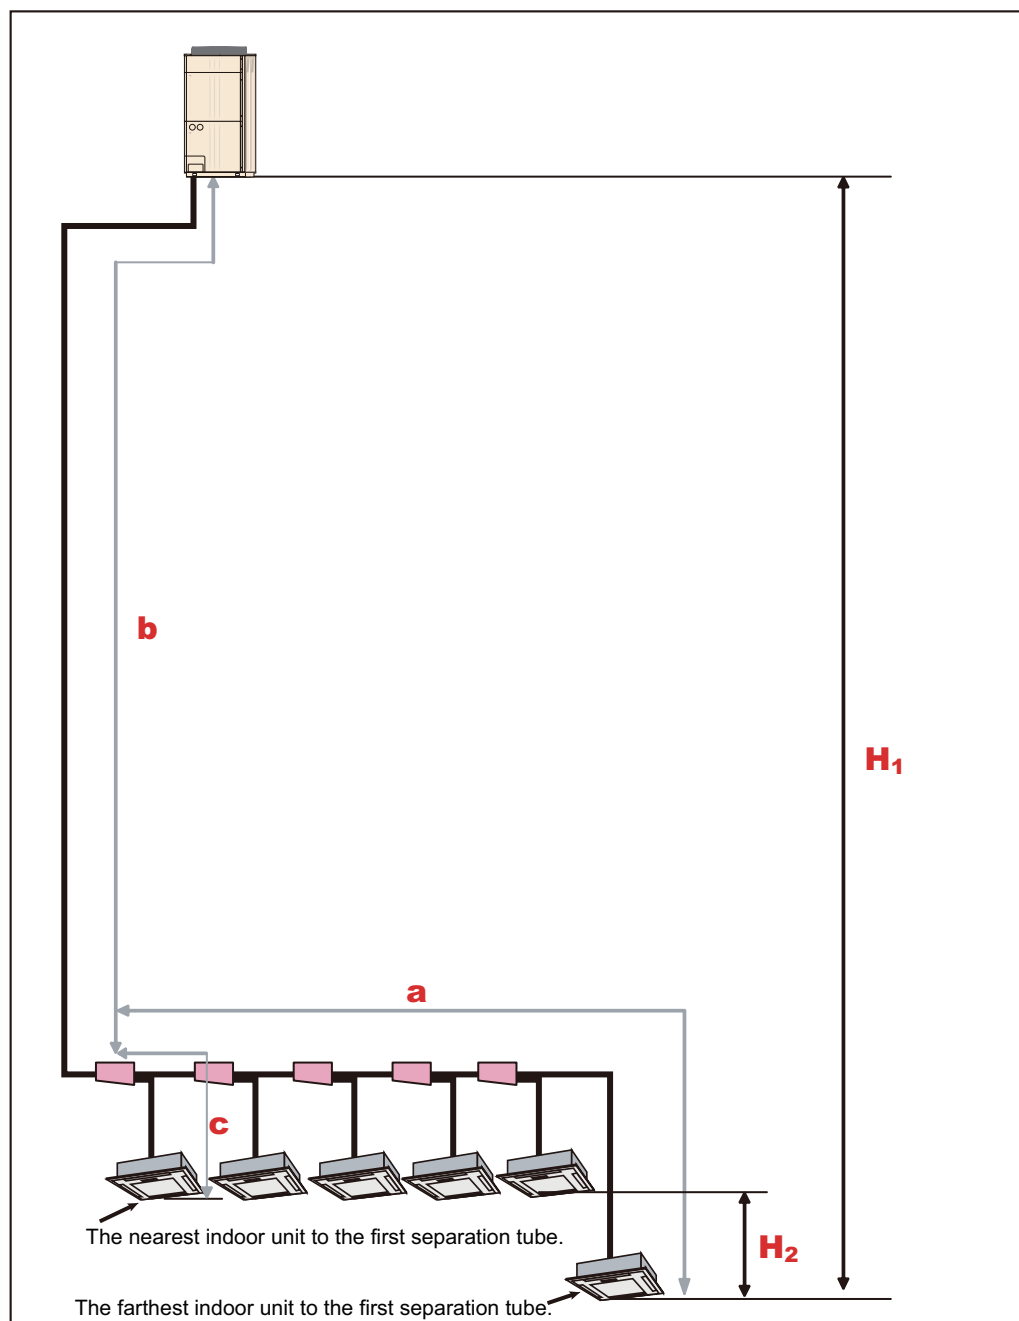


Limitation			Diagram	
Allowable pipe length (Actual pipe length)				
Between master outdoor unit and the farthest indoor unit		541 ft (165) or less	a + b	
Between the first separation tube and farthest indoor unit		295 ft (90 m) or less	a	
(The farthest indoor unit to the first separation tube) - (The nearest indoor unit to the first separation tube)		196 ft (60 m) or less	a - c	
Total pipe length		2,296 ft (700 m) or less* <sup>1</sup>	Total	
Allowable height difference				
Between outdoor unit and indoor unit	Outdoor unit is higher than indoor unit		360 ft (110 m)* <sup>2</sup> /164 ft (50 m) or less	H <sub>1</sub>
	Outdoor unit is lower than indoor unit	O.T.* <sup>3</sup> ≥ 23°F (-5°C)	131 ft (40 m) or less	
		O.T.* <sup>3</sup> < 23°F (-5°C)	16 ft (5 m) or less	
Between indoor unit		49 ft (15 m) or less	H <sub>2</sub>	

\*1: Total pipe length is limited by the condition that total refrigerant amount should not exceed 69 lb (31.5 kg).

\*2: When installing the pressure sensor kit on the nearest pipe to the indoor unit with the largest difference in elevation with the outdoor unit, size of the main liquid pipe must be one size larger than the standard size.

**NOTE:** The pipe length between master outdoor unit and the nearest indoor unit is 24 ft (7.5 m) or more.

## ■ In the case of one outdoor unit and one indoor unit connected

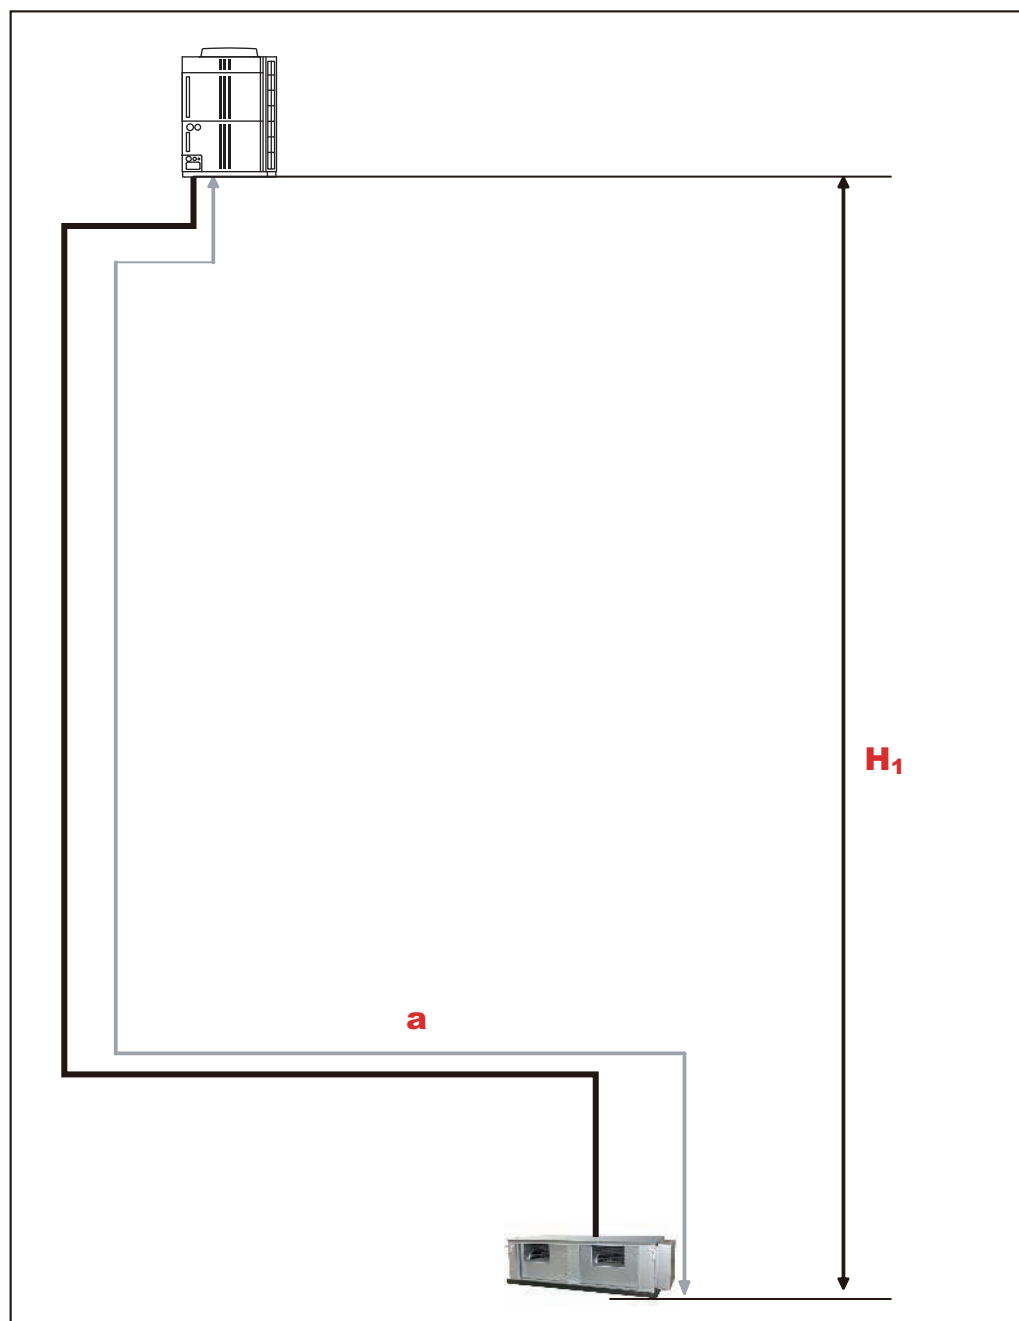

Limitation			Diagram
<b>Allowable pipe length (Actual pipe length)</b>			
Between master outdoor unit and the farthest indoor unit		541 ft (165 m) or less	a
Total pipe length		2,296 ft (700 m) or less*1	Total
Between master outdoor unit and indoor unit		25 ft (7.5m) or less	a
<b>Allowable height difference</b>			
Between outdoor unit and indoor unit	Outdoor unit is higher than indoor unit		360 ft (110 m)*2/164 ft (50 m) or less
	Outdoor unit is lower than indoor unit	O.T.*3 $\geq 23^{\circ}\text{F}$ ( $-5^{\circ}\text{C}$ )	131 ft (40 m) or less
		O.T.*3 $< 23^{\circ}\text{F}$ ( $-5^{\circ}\text{C}$ )	16 ft (5 m) or less


\*1: Total pipe length is limited by the condition that total refrigerant amount should not exceed 69 lb (31.5 kg).

\*2: When installing the pressure sensor kit on the nearest pipe to the indoor unit with the largest difference in elevation with the outdoor unit, size of the main liquid pipe must be one size larger than the standard size.

**NOTE:** The pipe length between master outdoor unit and the nearest indoor unit is 24 ft (7.5 m) or more.



## ■ In the case of indoor units are connected to both of higher side and lower side than the outdoor units

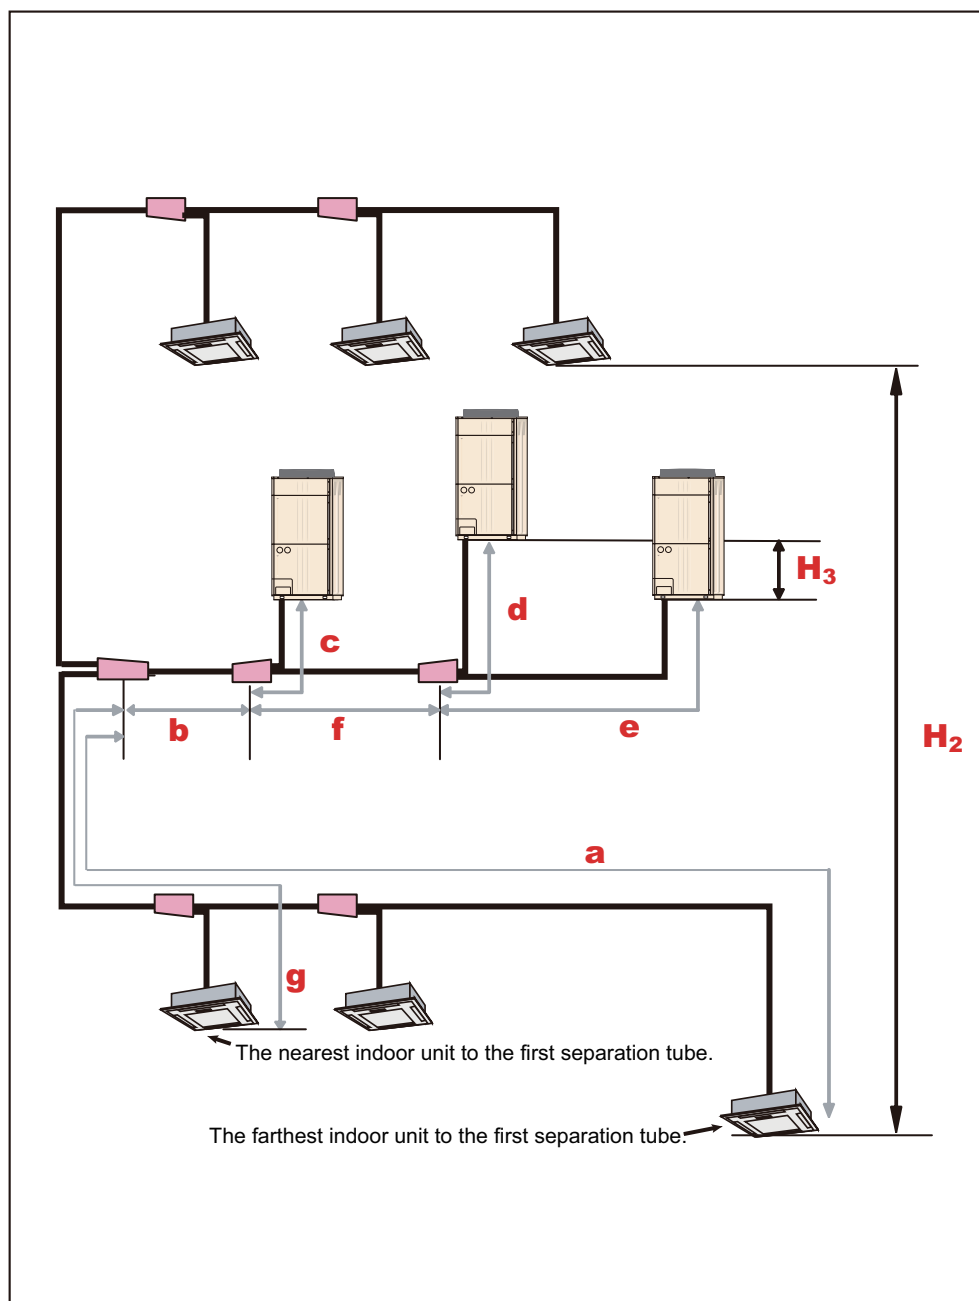

Limitation		Diagram
<b>Allowable pipe length (Actual pipe length)</b>		
Between master outdoor unit and the farthest indoor unit	541 ft (165 m) or less	a + b + c
Between the first separation tube and farthest indoor unit	295 ft (90 m) or less	a
(The farthest indoor unit to the first separation tube) - (The nearest indoor unit to the first separation tube)	196 ft (60 m) or less	a - e
Total pipe length	3,280 ft (1,000 m) or less* <sup>1</sup>	Total
Between outdoor unit and outdoor unit branch kit	9 ft (3 m) or less	c, d, e
Between the farthest outdoor unit to the first outdoor unit branch kit	39 ft (12 m) or less	d + f, e + f
<b>Allowable height difference</b>		
Between indoor unit	49 ft (15 m) or less	H <sub>2</sub>
Between outdoor unit	20 in (0.5 m) or less	H <sub>3</sub>

\*1: Total pipe length is limited by the condition that total refrigerant amount should not exceed 208 lb (94.5 kg).

\*2: When installing the pressure sensor kit on the nearest pipe to the indoor unit with the largest difference in elevation with the outdoor unit, size of the main liquid pipe must be one size larger than the standard size.

**NOTE:** The pipe length between master outdoor unit and the nearest indoor unit is 24 ft (7.5 m) or more.

## 2-3. Pipe size

After referring to cooling capacity table below, select each Pipe size, Separation tube, and Header from the cooling capacity of outdoor unit and indoor unit connected in the system.

**NOTE:** For pipe diameter, material, and wall thickness, refer to ["Important items when using refrigerant \(R410A\)"](#) on page 06-19.

### ■ Cooling capacity table

#### ● Outdoor unit

##### • Combination

Ton	Cooling capacity (Btu/h)	Set model name	Model name			Maximum number of connectable indoor units
			Unit 1	Unit 2	Unit 3	
12	144,000	AOUA144RLBVG1	AOUA72RLBV1	AOUA72RLBV1	—	32
14	168,000	AOUA168RLBVG1	AOUA96RLBV1	AOUA72RLBV1	—	37
16	192,000	AOUA192RLBVG1	AOUA120RLBV1	AOUA72RLBV1	—	42
18	216,000	AOUA216RLBVG1	AOUA120RLBV1	AOUA96RLBV1	—	47
20	240,000	AOUA240RLBVG1	AOUA120RLBV1	AOUA120RLBV1	—	52
22	264,000	AOUA264RLBVG1	AOUA96RLBV1	AOUA96RLBV1	AOUA72RLBV1	58
24	288,000	AOUA288RLBVG1	AOUA96RLBV1	AOUA96RLBV1	AOUA96RLBV1	63


## ● Indoor unit

Type	Rated capacity (Btu/h)		Model name	Dimensions	Remarks
	Cooling	Heating		H × W × D	
Compact cassette	4,000	4,400	AUUA4TLAV2	9-5/8 × 22-7/16 × 22-7/16 (245 × 570 × 570)	Cassette grille: UTG-CCGVG (Grid type)
	7,500	9,500	AUUA7TLAV2		
	9,500	10,900	AUUA9TLAV2		
	12,000	13,500	AUUA12TLAV2		
	14,000	15,600	AUUA14TLAV2		
	18,000	20,000	AUUA18TLAV2		
	24,000	27,000	AUUA24TLAV2		
4-way flow cassette	18,000	20,000	AUUB18TLAV	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)	Cassette grille: UTG-LCGV
	24,000	27,000	AUUB24TLAV	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)	
	30,000	34,000	AUUB30TLAV		
	36,000	40,000	AUUB36TLAV		
Circular flow cassette	18,000	20,000	AUUB18TLAV2	9-11/16 × 33-1/16 × 33-1/16 (246 × 840 × 840)	Cassette grille: UTG-LCGVCW (White) UTG-LCGVCB (Black)
	24,000	27,000	AUUB24TLAV2		
	30,000	34,000	AUUB30TLAV2	11-5/16 × 33-1/16 × 33-1/16 (288 × 840 × 840)	
	36,000	40,000	AUUB36TLAV2		
	48,000	54,000	AUUB48TLAV2		
Mini duct	4,000	4,400	ARUL4TLAV2	7-13/16 × 27-9/16 × 17-11/16 (198 × 700 × 450)	
Slim duct/Slim concealed floor	7,500	9,500	ARUL7TLAV2	7-13/16 × 27-9/16 × 24-7/16 (198 × 700 × 620)	
	9,500	10,900	ARUL9TLAV2		
	12,000	13,500	ARUL12TLAV2		
	14,000	15,600	ARUL14TLAV2		
	18,000	20,000	ARUL18TLAV2	7-13/16 × 35-7/16 × 24-7/16 (198 × 900 × 620)	
Medium static pressure duct	24,000	27,000	ARUM24TLAV2	10-5/16 × 44-11/16 × 27-9/16 (270 × 1,135 × 700)	
	30,000	34,000	ARUM30TLAV2		
	36,000	40,000	ARUM36TLAV2		
High static pressure duct	36,000	40,000	ARUH36TLAV	15-3/4 × 41-5/16 × 19-11/16 (400 × 1,050 × 500)	
	48,000	54,000	ARUH48TLAV		
	60,000	67,000	ARUH60TLAV		
	72,000	81,000	ARUH72TLAV2	17-11/16 × 62-1/2 × 27-9/16 (450 × 1,587 × 700)	
	96,000	108,000	ARUH96TLAV2	21-5/8 × 62-1/2 × 27-9/16 (550 × 1,587 × 700)	
Compact floor	4,000	4,400	AGUA4TLAV2	23-5/8 × 29-1/8 × 7-7/8 (600 × 740 × 200)	
	7,500	9,500	AGUA7TLAV2		
	9,500	10,900	AGUA9TLAV2		
	12,000	13,500	AGUA12TLAV2		
	14,000	15,600	AGUA14TLAV2		
Floor/Ceiling	12,000	13,500	ABUA12TLAV2	7-13/16 × 39 × 25-13/16 (199 × 990 × 655)	
	14,000	15,600	ABUA14TLAV2		
	18,000	20,000	ABUA18TLAV2		
	24,000	27,000	ABUA24TLAV2		
Ceiling	30,000	34,000	ABUA30TLAV2	9-7/16 × 65-3/8 × 27-9/16 (240 × 1,660 × 700)	
	36,000	40,000	ABUA36TLAV2		

Type	Rated capacity (Btu/h)		Model name	Dimensions	Remarks
	Cooling	Heating		H × W × D	
Wall mounted	4,000	4,400	ASUA4TLAV2	10-9/16 × 33-1/16 × 8 (268 × 840 × 203)	
	7,500	9,500	ASUA7TLAV2		
	9,500	10,900	ASUA9TLAV2		
	12,000	13,500	ASUA12TLAV2		
	14,000	15,600	ASUA14TLAV2		
	18,000	20,000	ASUB18TLAV1	12-5/8 × 39-5/16 × 9-3/8 (320 × 998 × 238)	
	24,000	27,000	ASUB24TLAV1		
	30,000	34,000	ASUA30TLAV2	13-3/8 × 45-1/4 × 11 (340 × 1,150 × 280)	
	34,000	38,000	ASUA36TLAV2		
	7,500	9,500	ASUA7TLAV	10-13/16 × 31-1/8 × 8-7/16 (275 × 790 × 215)	
	9,500	10,900	ASUA9TLAV		
	12,000	13,500	ASUA12TLAV		
	14,000	15,600	ASUA14TLAV		
	18,000	20,000	ASUB18TLAV	12-5/8 × 39-5/16 × 9 (320 × 998 × 228)	
	24,000	27,000	ASUB24TLAV		

## ■ Pipe size selection

Use the following tables to select the Refrigeration Pipe Size, Separation tube and Header.

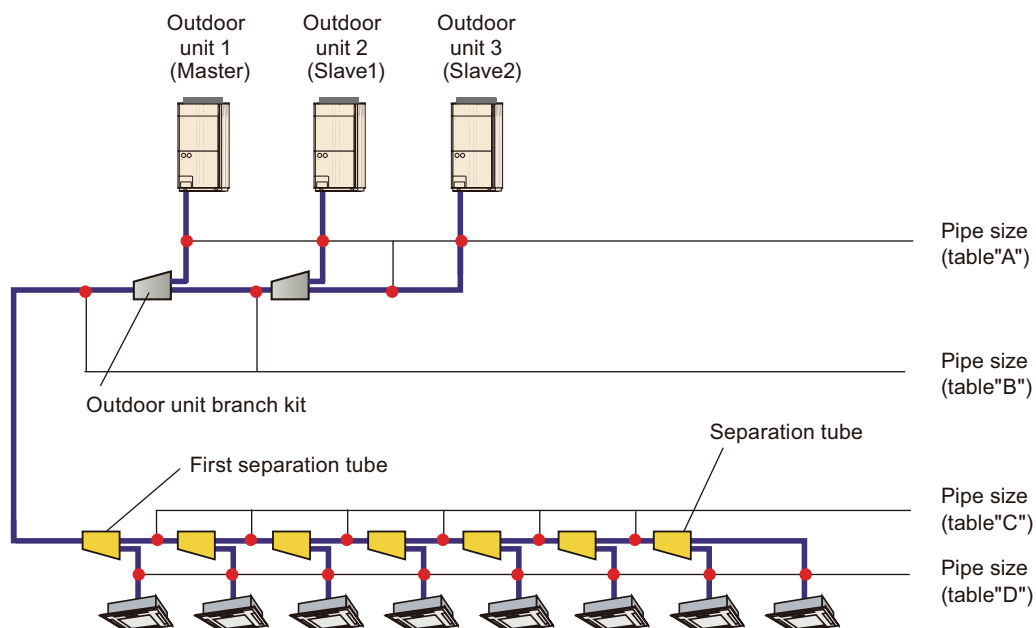

### • Pipe size table "A"

Between Outdoor unit and Outdoor unit branch kit

Ton	Outdoor unit model code	Outdoor unit cooling capacity	Outside diameter	
			Liquid pipe	Discharge gas pipe
		Btu/h	in (mm)	
6	72	72,000	1/2 (12.70)	7/8 (22.22)
8	90	96,000	1/2 (12.70)	7/8 (22.22)
10	120	120,000	1/2 (12.70)	1-1/8 (28.58)

• **Pipe size table “B”**

From Outdoor unit branch kit(s) to first Separation tube

Total cooling capacity of outdoor unit	Outside diameter		
	Liquid pipe*1		Gas pipe
	Size 1	Size 2	
Btu/h (Ton)	in (mm)		
72,000 (6)	1/2 (12.70)	5/8 (15.88)	7/8 (22.22)
96,000 (8)	1/2 (12.70)	5/8 (15.88)	7/8 (22.22)
120,000 (10)	1/2 (12.70)	5/8 (15.88)	1-1/8 (28.58)
144,000 (12)	1/2 (12.70)	5/8 (15.88)	1-1/8 (28.58)
168,000 (14) 192,000 (16)	5/8 (15.88)	3/4 (19.05)	1-1/8 (28.58)
216,000 (18) 240,000 (20) 264,000 (22)	5/8 (15.88)	3/4 (19.05)	1-3/8 (34.92)
288,000 (24)	3/4 (19.05)	7/8 (22.22)*2	1-3/8 (34.92)

\*1: Size of the liquid pipe differs depending on the height difference (H) between the outdoor unit and the indoor unit as follows:

Size 1: H is or less 164 ft (50 m)

Size 2: H is longer than 164 ft (50 m)

\*2: Reducer (locally purchased) is necessary.

**NOTE:** Discharge gas pipe size selection:

- In the case of discharge gas pipe is not separated, pipe diameter is different between pipes which come from outdoor unit side and connected to RB unit. Thinner piping diameter should be selected.

• **Pipe size table “C”**

Between Separation tubes

Total cooling capacity of indoor unit (x)	Outside diameter	
	Liquid pipe	Gas pipe
	in (mm)	
Btu/h		
8,000 ≤ x < 36,000	3/8 (9.52)	5/8 (15.88)
36,000 ≤ x < 48,000	3/8 (9.52)	3/4 (19.05)
48,000 ≤ x < 66,000	1/2 (12.70)	3/4 (19.05)
66,000 ≤ x < 96,500	1/2 (12.70)	7/8 (22.22)
96,500 ≤ x < 153,000	1/2 (12.70)	1-1/8 (28.58)
153,000 ≤ x < 193,000	5/8 (15.88)	1-1/8 (28.58)
193,000 ≤ x < 274,000	5/8 (15.88)	1-3/8 (34.92)
274,000 ≤ x	3/4 (19.05)	1-3/8 (34.92)

**NOTES:**

- If the selected pipe diameter between Separation tubes (based on the table “C”) becomes larger than the pipe diameter between Outdoor unit branch kit and the first Separation tube (base on the table “B”), select the pipe whose diameter is equal to the one between Outdoor unit branch kit and the first Separation tube.

**(If pipe diameter C > B, select pipe size from table B)**

- ‘Total Cooling Capacity of Indoor Unit’ is the sum of all the cooling capacities of all units connected downstream.

- Pipe size table “D”

Indoor unit cooling capacity	Outside diameter	
	Liquid pipe	Discharge gas pipe
Btu/h	in (mm)	
4,000, 7,500, 9,500, 12,000, 14,000	1/4 (6.35)	1/2 (12.70)
18,000, 24,000, 30,000, 34,000	3/8 (9.52)	5/8 (15.88)
36,000, 48,000, 60,000	3/8 (9.52)	3/4 (19.05)
72,000, 96,000	1/2 (12.70)	7/8 (22.22)

**NOTE:** For connecting to 4/7/9/18/36/48TLAV2, reducer (locally purchased) is necessary.  
For details of reducer diameter, refer to the table below.

Indoor unit cooling capacity	Reducer diameter	
	Liquid pipe	Gas pipe
Btu/h	in (mm)	
4,000, 7,500, 9,500	—	3/8 (9.52) → 1/2 (12.70)
18,000	1/4 (6.35) → 3/8 (9.52)	1/2 (12.70) → 5/8 (15.88)
34,000, 36,000, 48,000	—	5/8 (15.88) → 3/4 (19.05)



## ■ Optional parts selection

### ● Outdoor unit

#### • Outdoor unit branch kit

System	Model name	Quantity
2 outdoor unit	UTP-CX567A	1
3 outdoor unit		2

When using single outdoor unit, Outdoor unit branch kit is not necessary.

### ● Indoor unit

#### • Separation tube

Total cooling capacity of indoor unit (x) (Btu/h)	Model name
$x \leq 96,500$	UTP-AX090A
$96,500 \leq x \leq 193,000$	UTP-AX180A
$193,000 \leq x$	UTP-AX567A

#### • Header

Total cooling capacity of indoor units (x) (Btu/h)	3 to 6 Branches	3 to 8 Branches
$x < 96,500$	UTR-H0906L	UTR-H0908L
$96,500 \leq x < 193,000$	UTR-H1806L	UTR-H1808L

## 2-4. Selection of pipe heat insulating material



Always insulate the refrigerant pipe to prevent condensation and water droplets by the refrigerant pipe. For selection of pipe heat insulating material, refer to following items.

- Decide the thickness of the heat insulating material by referring to the recommended minimum thickness in Table 1. (For installation condition T = 90 °FDB [32 °CDB]), humidity ≤ 70%, humidity ≤ 75%, humidity ≤ 80%, humidity ≤ 85%)

Table 1. Size of refrigerant pipe and recommended minimum thickness of heat insulating material  
In case a heat insulating material which thermal conductivity is equal to or less than 0.040 W/(m•k) is used.

		Recommended minimum thickness for heat insulating material			
		in (mm)			
Relative humidity		≤ 70%	≤ 75%	≤ 80%	≤ 85%
Refrigerant pipe outside diameter (in [mm])	1/4 (6.35)	5/16 (8)	13/32 (10)	1/2 (13)	21/32 (17)
	3/8 (9.52)	11/32 (9)	7/16 (11)	9/16 (14)	23/32 (18)
	1/2 (12.70)	13/32 (10)	15/32 (12)	19/32 (15)	3/4 (19)
	5/8 (15.88)	13/32 (10)	15/32 (12)	5/8 (16)	25/32 (20)
	3/4 (19.05)	13/32 (10)	1/2 (13)	5/8 (16)	13/16 (21)
	7/8 (22.22)	7/16 (11)	1/2 (13)	21/32 (17)	7/8 (22)
	1-1/8 (28.58)	7/16 (11)	9/16 (14)	23/32 (18)	29/32 (23)
	1-3/8 (34.92)	7/16 (11)	9/16 (14)	23/32 (18)	15/16 (24)
	1-5/8 (41.27)	15/32 (12)	19/32 (15)	3/4 (19)	31/32 (25)

- When the outdoor unit is installed in a higher position than the indoor unit, fill the connecting part gap with putty, etc. to prevent the dew condensation water of the valve of the outdoor unit from flowing to the indoors from the gap between the pipe and the heat insulating material.
- Liquid pipe and gas pipe should be completely insulated with same specification.
- Water may leak from the refrigerant lines if the insulation is not completely sealed.
- In application where the ambient temperature and humidity exceed 90 °FDB (32 °CDB) and 95% relative humidity, increase the size of the pipe insulation. It may also be necessary to insulate the indoor unit casing. Condensation may form on the insulation in these conditions if the thickness of the insulation is not increased.
- Since the gas line gets very hot during heating operation, select a pipe insulating material rated for at least 248 °F (120 °C).

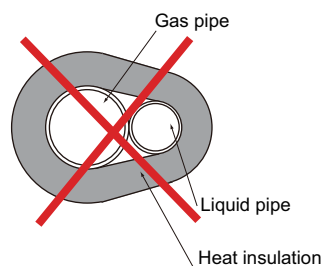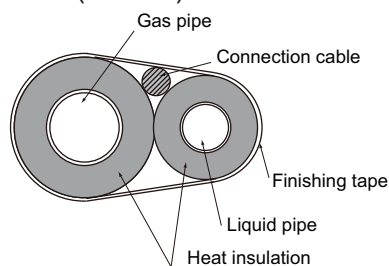

- Make sure that pipe is covered completely by the heat insulation, not exposing to air. Inadequate heat insulation may cause condensation.
- Do not cover heat insulation gas and liquid pipes together as figure below. It may cause condensation and capacity drop by heat loss.

## 2-5. Additional charge calculation

### NOTES:

- The outdoor unit is charged refrigerant at the factory.
- Additional refrigerant required to be charged on site depending on pipe length and outdoor unit model.
- The additional refrigerant charge amount is calculated according to the following formula.
- The overall refrigerant amount should not exceed 66.1 lb (30 kg) per outdoor unit.
- Round up the calculated result to two decimal places.

### ■ Calculation formula

- **Calculation of additional amount for outdoor unit (A)**

Model name	Ton	a: Additional amount for outdoor unit (lb (kg))
AOUA72RLBV1	6	— (—)
AOUA96RLBV1	8	— (—)
AOUA120RLBV1	10	7.27 (3.30)

$$\begin{array}{c}
 \text{A} = \\
 \begin{array}{|c|} \hline \text{a: Outdoor unit 1} \\ \hline \text{Additional amount} \\ \text{for outdoor unit} \\ \hline \text{lb (kg)} \\ \hline \end{array}
 + 
 \begin{array}{|c|} \hline \text{a: Outdoor unit 2} \\ \hline \text{Additional amount} \\ \text{for outdoor unit} \\ \hline \text{lb (kg)} \\ \hline \end{array}
 + 
 \begin{array}{|c|} \hline \text{a: Outdoor unit 3} \\ \hline \text{Additional amount} \\ \text{for outdoor unit} \\ \hline \text{lb (kg)} \\ \hline \end{array}
 = 
 \begin{array}{|c|} \hline \text{Total} \\ \hline \text{lb (kg)} \\ \hline \end{array}
 \end{array}$$

- **Calculation of additional amount for pipe length (B)**

Diameter of liquid pipe (mm)	b: Additional amount for pipe length (lb/ft) (kg/m)
Ø1/4 (6.35)	0.014 (0.021)
Ø3/8 (9.52)	0.039 (0.058)
Ø1/2 (12.70)	0.077 (0.114)
Ø5/8 (15.88)	0.120 (0.178)
Ø3/4 (19.05)	0.180 (0.268)
Ø7/8 (22.22)	0.242 (0.360)

B =	Total length of Ø7/8 (22.22 mm) liquid pipe	b: × 0.242 (lb/ft) (0.360 kg/m)	+	Total length of Ø3/4 (19.05 mm) liquid pipe	b: × 0.180 (lb/ft) (0.268 kg/m)	+	Total length of Ø5/8 (15.88 mm) liquid pipe	b: × 0.120 (lb/ft) (0.178 kg/m)	+
	ft (m)			ft (m)			ft (m)		
	lb (kg)			lb (kg)			lb (kg)		

=	Total length of Ø1/2 (12.70 mm) liquid pipe	b: × 0.077 (lb/ft) (0.114 kg/m)	+	Total length of Ø3/8 (9.52 mm) liquid pipe	b: × 0.039 (lb/ft) (0.058 kg/m)	=	Total length of Ø1/4 (6.35 mm) liquid pipe	b: × 0.014 (lb/ft) (0.021 kg/m)	=
	ft (m)			ft (m)			ft (m)		
	lb (kg)			lb (kg)			lb (kg)		

Total  lb (kg)
----------------------

• **Calculation of additional charge refrigerant (C)**

C = A + B = lb (kg) Round up C to 2 decimal places.

• **Calculation of additional charge refrigerant (D)**

Model name	Ton	d: Additional amount for outdoor unit (lb (kg))
AOUA72RLBV1	6	25.79 (11.70)
AOUA96RLBV1	8	25.79 (11.70)
AOUA120RLBV1	10	26.01 (11.80)

D =	d: Outdoor unit 1 Factory charge amount	+	d: Outdoor unit 2 Factory charge amount	+	d: Outdoor unit 3 Factory charge amount	=	Total
	lb (kg)		lb (kg)		lb (kg)		
	lb (kg)				lb (kg)		

• **Total refrigerant amount check (E)**

E = C + D = lb (kg)

**NOTES:**


- Check the total refrigerant amount under the following conditions.

Condition
For 1 outdoor unit per refrigerant system: Total amount of refrigerant (E) ≤ 69.40 lb (31.50 kg)
For 2 outdoor units per refrigerant system: Total amount of refrigerant (E) ≤ 138.80 lb (63.00 kg)
For 3 outdoor units per refrigerant system: Total amount of refrigerant (E) ≤ 208.20 lb (94.50 kg)

- When total refrigerant amount exceed limitation:
  - Reduce pipe length for refrigerant system.
  - Change the refrigerant system configuration.

## 2-6. Piping design example

### ■ Example 1

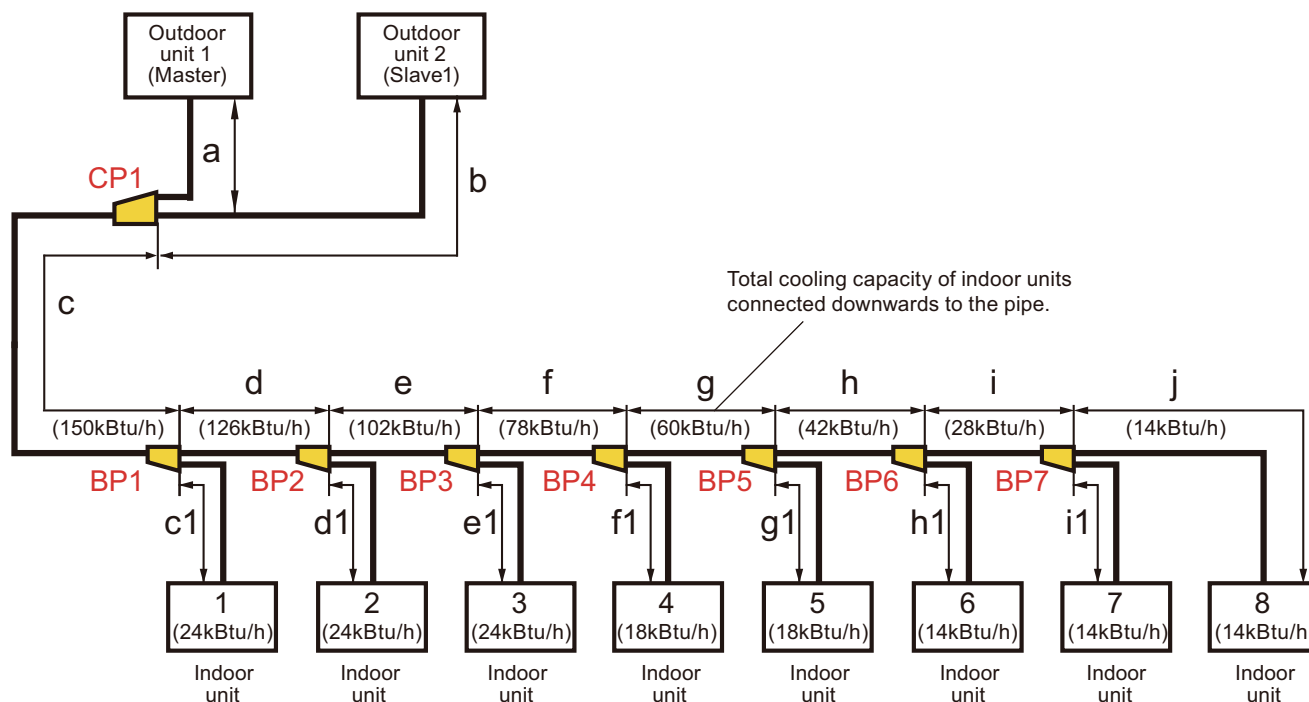

#### • System configuration

Indoor unit	Model name	Capacity (kBtu/h)
1	AUUA24TLAV2	24.0
2	AUUA24TLAV2	24.0
3	AUUA24TLAV2	24.0
4	AUUA18TLAV2	18.0
5	AUUA18TLAV2	18.0
6	AUUA14TLAV2	14.0
7	AUUA14TLAV2	14.0
8	AUUA14TLAV2	14.0
Total capacity		150.0

Outdoor unit	Model name	Capacity (kBtu/h)
1	AOUA72RLBV1	72.0
2	AOUA72RLBV1	72.0
Total capacity		144.0

#### • Capacity ratio

(Total capacity of indoor unit)/(Total capacity of outdoor unit)  
 = 150.0/144.0 = 104.2% (Within 50% to 150%)

- Selection of Outdoor unit branch kit and Outdoor unit branch kit

Branch kit no.	Total cooling capacity of downstream indoor units (kBtu/h)	Model name	Quantity
BP1	150.0	UTP-AX180A	3
BP2	126.0		
BP3	102.0		
BP4	78.0	UTP-AX090A	4
BP5	60.0		
BP6	42.0		
BP7	28.0		
CP1	—	UTP-CX567A	1

- Selection of pipe size

Pipe no.		Pipe diameter (in (mm))		Length example (ft (m))
		Liquid pipe	Gas pipe	
For 2 pipes	a	Ø1/2 (12.70)	Ø7/8 (22.22)	6(2)
	b	Ø1/2 (12.70)	Ø7/8 (22.22)	6(2)
	c	Ø1/2 (12.70)	Ø1-1/8 (28.58)	131(40)
	c1	Ø3/8 (9.52)	Ø5/8 (15.88)	33(10)
	d	Ø1/2 (12.70)	Ø1-1/8 (28.58)	16(5)
	d1	Ø3/8 (9.52)	Ø5/8 (15.88)	33(10)
	e	Ø1/2 (12.70)	Ø1-1/8 (28.58)	16(5)
	e1	Ø3/8 (9.52)	Ø5/8 (15.88)	33(10)
	f	Ø1/2 (12.70)	Ø7/8 (22.22)	16(5)
	f1	Ø3/8 (9.52)	Ø5/8 (15.88)	33(10)
	g	Ø1/2 (12.70)	Ø3/4 (19.05)	16(5)
	g1	Ø3/8 (9.52)	Ø5/8 (15.88)	33(10)
	h	Ø3/8 (9.52)	Ø3/4 (19.05)	16(5)
	h1	Ø1/4 (6.35)	Ø1/2 (12.70)	33(10)
	i	Ø3/8 (9.52)	Ø5/8 (15.88)	16(5)
	i1	Ø1/4 (6.35)	Ø1/2 (12.70)	33(10)
	j	Ø1/4 (6.35)	Ø1/2 (12.70)	33(10)

- **Calculation of additional charge refrigerant**
  - **Calculation of additional amount for outdoor unit (A)**

Outdoor unit	Model name	Additional amount for outdoor unit (lb (kg))
1	AOUA72RLBV1	— (—)
2	AOUA72RLBV1	— (—)

$$A = 0 + 0 = 0 \text{ (lb)}$$

$$A = 0 + 0 = 0 \text{ (kg)}$$

- **Calculation of additional amount for pipe length (B)**

Diameter of liquid pipe (in (mm))	Additional amount for pipe length (lb/ft)(kg/m)	Liquid pipe length (ft)(m)
Ø3/4 (19.05)	0.180 (0.268)	0
Ø5/8 (15.88)	0.120 (0.178)	0
Ø1/2 (12.70)	0.077 (0.114)	207 (64)
Ø3/8 (9.52)	0.039 (0.058)	197 (60)
Ø1/4 (6.35)	0.014 (0.021)	99 (30)

$$B = (0.077 \times 207) + (0.039 \times 197) + (0.014 \times 99) = 25.01 \text{ (lb)}$$

$$B = (0.114 \times 64) + (0.058 \times 60) + (0.021 \times 30) = 11.41 \text{ (kg)}$$

- **Calculation of additional charge refrigerant (C)**

$$C = A + B = 0 + 25.01 = 25.01 \text{ (lb)}$$

$$C = A + B = 0 + 11.41 = 11.41 \text{ (kg)}$$

- **Calculation of factory charge amount (D)**

Outdoor unit	Model name	Factory charge amount (lb (kg))
1	AOUA72RLBV1	25.79 (11.70)
2	AOUA72RLBV1	25.79 (11.70)

$$D = 25.79 + 25.79 = 51.58 \text{ (lb)}$$

$$D = 11.70 + 11.70 = 23.40 \text{ (kg)}$$


- **Total refrigerant amount check (E)**

$$E = C + D = 25.01 + 51.58 = 76.59 \text{ (lb)} < 138.80 \text{ (lb)} \rightarrow \text{OK}$$

$$E = C + D = 11.41 + 23.40 = 34.81 \text{ (kg)} < 63.00 \text{ (kg)} \rightarrow \text{OK}$$

Check pipe length and height difference between the units by comparing with "[Piping limitation](#)" on page 06-22.

## Example 2

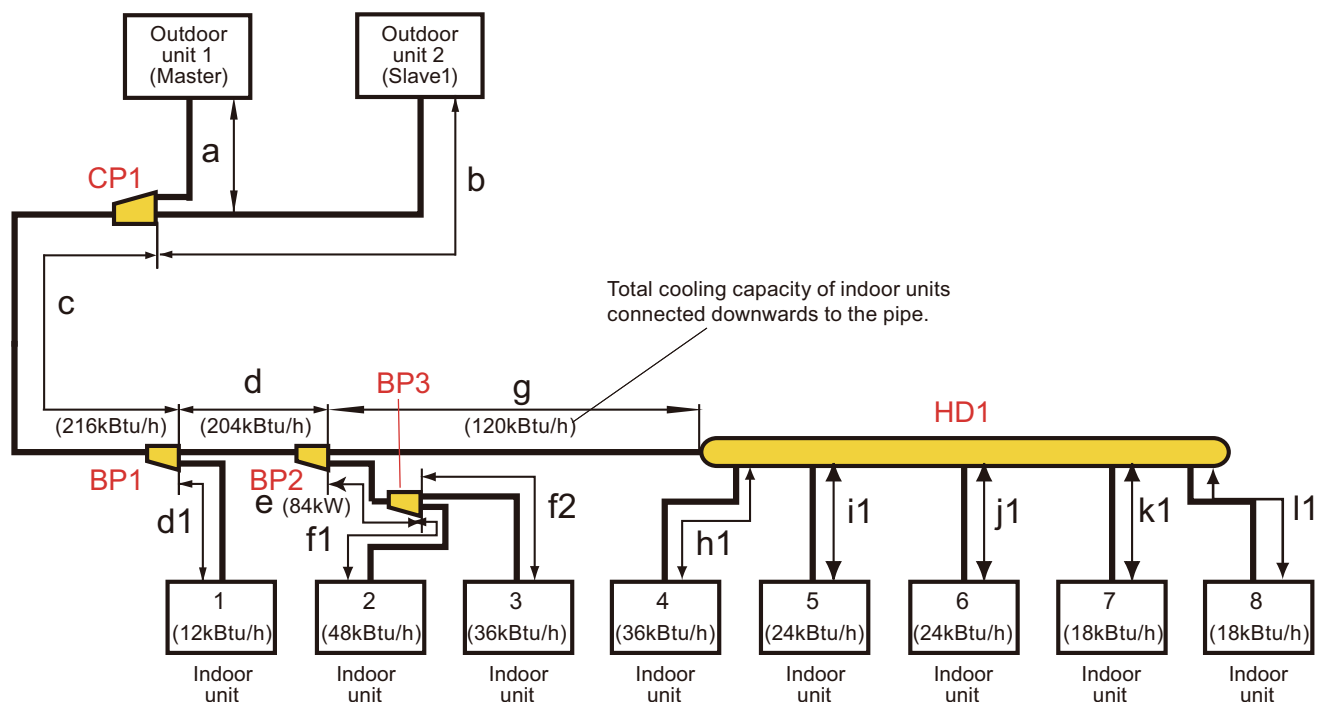

### System configuration

Indoor unit	Model name	Capacity (kBTu/h)
1	ARUL12TLAV2	12.0
2	ARUH48TLAV	48.0
3	ARUM36TLAV2	36.0
4	ARUM36TLAV2	36.0
5	ARUM24TLAV2	24.0
6	ARUM24TLAV2	24.0
7	ARUL18TLAV2	18.0
8	ARUL18TLAV2	18.0
Total capacity		216.0

Outdoor unit	Model name	Capacity (kBTu/h)
1	AOUA96RLBV1	96.0
2	AOUA72RLBV1	72.0
Total capacity		168.0

### Capacity ratio

(Total capacity of indoor unit)/(Total capacity of outdoor unit)  
 $= 216.0/168.0 = 128.6\%$  (Within 50% to 150%)

### Selection of Outdoor unit branch kit, Separation tube, and Header

Branch kit no.	Total cooling capacity of downstream indoor units (kBTu/h)	Model name	Quantity
BP1	216.0	UTP-AX567A	2
BP2	204.0		
BP3	84.0	UTP-AX090A	1
HD1	120.0	UTR-H1806L	1
CP1	—	UTP-CX567A	1



- Selection of pipe size

Pipe no.		Pipe diameter (in (mm))		Length example (ft (m))
		Liquid pipe	Gas pipe	
For 2 pipes	a	Ø1/2 (12.70)	Ø7/8 (22.22)	6 (2)
	b	Ø1/2 (12.70)	Ø7/8 (22.22)	6 (2)
	c	Ø5/8 (15.88)	Ø1-1/8 (28.58)	131 (40)
	d*	Ø5/8 (15.88)	Ø1-1/8 (28.58)	33 (10)
	d1	Ø1/4 (6.35)	Ø1/2 (12.70)	33 (10)
	e	Ø1/2 (12.70)	Ø7/8 (22.22)	16 (5)
	f1	Ø3/8 (9.52)	Ø3/4 (19.05)	16 (5)
	f2	Ø3/8 (9.52)	Ø3/4 (19.05)	33 (10)
	g	Ø1/2 (12.70)	Ø1-1/8 (28.58)	66 (20)
	h1	Ø3/8 (9.52)	Ø3/4 (19.05)	33 (10)
	i1	Ø3/8 (9.52)	Ø5/8 (15.88)	16 (5)
	j1	Ø3/8 (9.52)	Ø5/8 (15.88)	33 (10)
	k1	Ø3/8 (9.52)	Ø5/8 (15.88)	16 (5)
	l1	Ø3/8 (9.52)	Ø5/8 (15.88)	33 (10)

\* Pipe size d selection: Even though this pipe size might be selected based on downstream cooling capacity (204 kBtu/h) 5/8 in. (15.88 mm) / 1-3/8 in. (34.92 mm), This pipe size should not be larger than pipe size c. Therefore select pipe size equal to pipe size c (5/8 in. (15.88 mm)/1-1/8 in. (28.58 mm)).

- **Calculation of additional charge refrigerant**
  - **Calculation of additional amount for outdoor unit (A)**

Outdoor unit	Model name	Additional amount for outdoor unit (lb (kg))
1	AOUA96RLBV1	— (—)
2	AOUA72RLBV1	— (—)

$$A = 0 + 0 = 0 \text{ (lb)}$$

$$A = 0 + 0 = 0 \text{ (kg)}$$

- **Calculation of additional amount for pipe length (B)**

Diameter of liquid pipe (in (mm))	Additional amount for pipe length (lb/ft)(kg/m)	Liquid pipe length (ft)(m)
Ø3/4 (19.05)	0.180 (0.268)	0
Ø5/8 (15.88)	0.120 (0.178)	164 (50)
Ø1/2 (12.70)	0.077 (0.114)	94 (29)
Ø3/8 (9.52)	0.039 (0.058)	180 (55)
Ø1/4 (6.35)	0.014 (0.021)	33 (10)

$$B = (0.120 \times 164) + (0.077 \times 94) + (0.039 \times 180) + (0.014 \times 33) = 34.40 \text{ (lb)}$$

$$B = (0.178 \times 50) + (0.114 \times 29) + (0.058 \times 55) + (0.021 \times 10) = 15.61 \text{ (kg)}$$

- **Calculation of additional charge refrigerant (C)**

$$C = A + B = 0 + 34.40 = 34.40 \text{ (lb)}$$

$$C = A + B = 0 + 15.61 = 15.61 \text{ (kg)}$$

- **Calculation of factory charge amount (D)**

Outdoor unit	Model name	Factory charge amount (lb (kg))
1	AOUA96RLBV1	25.97 (11.70)
2	AOUA72RLBV1	25.97 (11.70)

$$D = 25.97 + 25.97 = 51.94 \text{ (lb)}$$

$$D = 11.70 + 11.70 = 23.40 \text{ (kg)}$$

- **Total refrigerant amount check (E)**

$$E = C + D = 34.40 + 51.94 = 86.34 \text{ (lb)} < 138.80 \text{ (lb)} \rightarrow \text{OK}$$

$$E = C + D = 15.61 + 23.40 = 39.01 \text{ (kg)} < 63.00 \text{ (kg)} \rightarrow \text{OK}$$

Check pipe length and height difference between the units by comparing with "[Piping limitation](#)" on page 06-22.


### 3. Piping connection

Keep the permissible length of every piping limitation to prevent a defect or cooling/heating failure.

#### ⚠ CAUTION

- **Piping material:**

- Use the designated size (diameter and thickness) of refrigerant pipes.
- Those pipes purchased locally may contain dust inside. Use dry nitrogen to blow out any dust.
- Do not use standard pipe tees for branches, these can cause uneven refrigerant flow to the indoor units. Optionally available standard branch kits should be used instead.

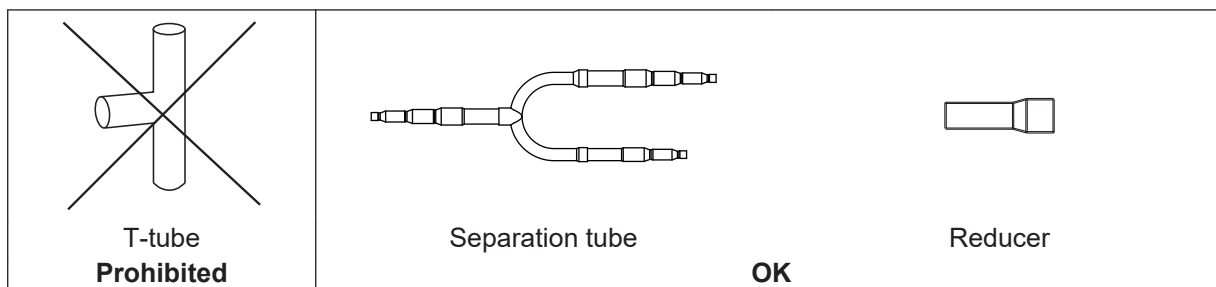

- When replacing the unit, never use piping which has been used for previous installations. Only use the new piping.

- **Piping preparation and installation:**


- Make sure that no dust or water enters the pipe during preparation or installation.
- When installing the pipe, make bends as few as possible, and make radius as large as possible.
- Cut the branch kit at the right size or use the reducer to match the pipe to the branch kit.

- **Piping treatment:**

- The pipes vibrate, expand, and contract during operation, so if loads are concentrated in one area, it could cause cracks in the pipes. Provide the pipe supports every 6 to 9 ft (2 to 3 m).
- Make sure to insulate the refrigeration pipes separately with appropriately sized insulation as described earlier. Make sure to overlap the ends to prevent any gap.

- **Brazing:**

- While brazing the pipes, be sure to blow dry nitrogen gas through them.

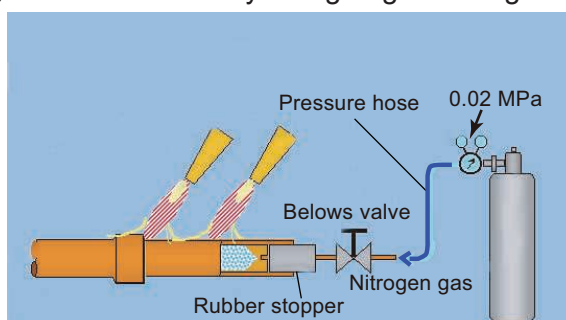

(continued)

**⚠ CAUTION****• Brazing:**

- If nitrogen gas is not blown through the pipes while they are being brazed, an oxidized layer may form on the inside of the pipes. If this occurs, the cooling efficiency may decrease and it will be caused to damage for compressor and clog the strainer and electronic expansion valve.


Example: Inside state of brazing pipe section




- When brazing the pipes, do not use flux. If the flux is chlorine-based, the pipes will corrode and when the flux contains fluorine, the refrigerant oil will deteriorate, etc. Using the flux has an adverse affect on the refrigerant piping system.
- For brazing materials, use phosphor copper solder that does not require flux.

## 3-1. Piping to outdoor unit


### Outdoor unit position

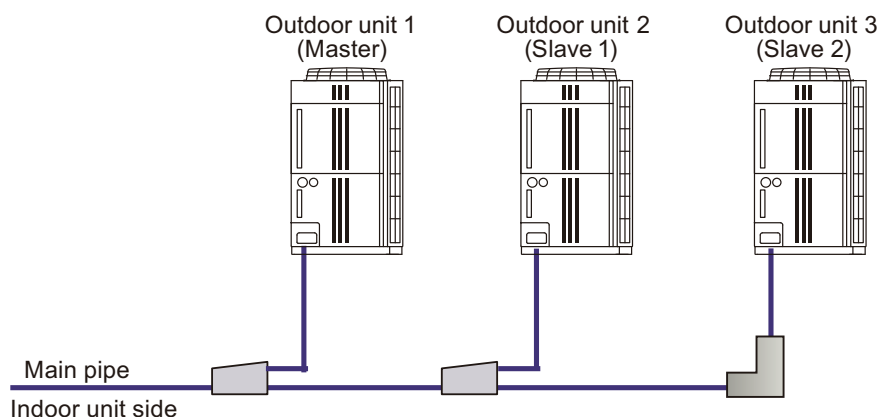

- When installing outdoor units, make the master unit closest to the main pipe.
- Select outdoor unit capacity in the order below:  
Outdoor unit 1 (Master)  $\geq$  Outdoor unit 2 (Slave 1)  $\geq$  Outdoor unit 3 (Slave 2)
- When connecting master unit with slave unit(s), install them as close as possible.
- Selecting the mounting position of the master and slave unit to keep piping limitation.

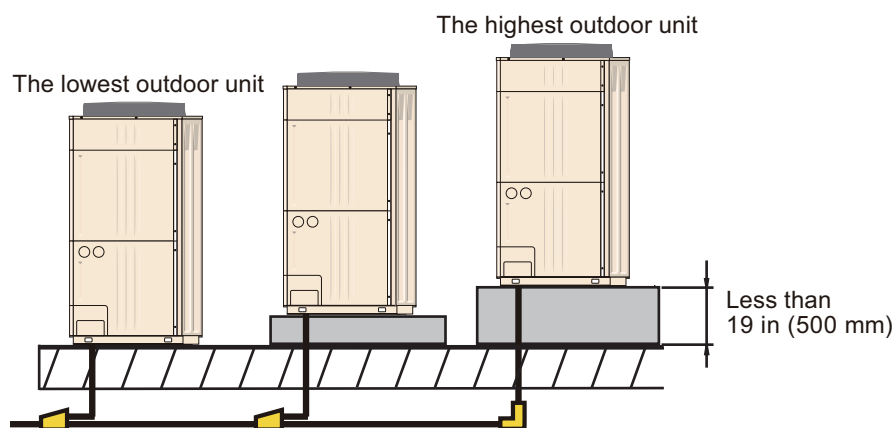

The height difference between the lowest and the highest outdoor unit bottom in the same refrigerant system  $\leq 19$  in (500 mm)

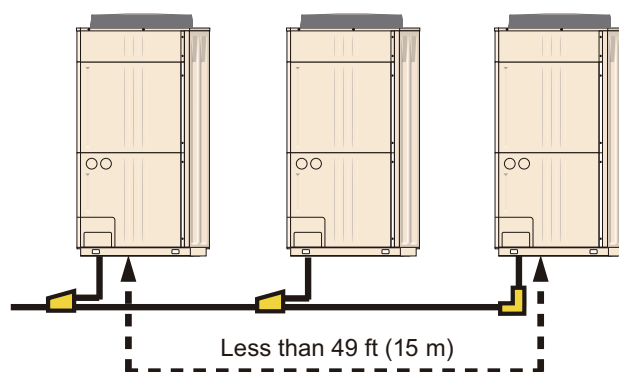

The maximum pipe length between master unit and the farthest slave unit  $\leq 49$  ft (15 m)

#### NOTES:


- Install the Outdoor unit branch kit horizontally. (See "[Outdoor unit branch kit](#)" on page 06-57)
- Mounting the outdoor unit with enough space to installing the piping, service, and maintenance.

## Outdoor unit piping direction


### Piping pattern

Use the optional branch kit for multiple outdoor unit connection.


- Example 1

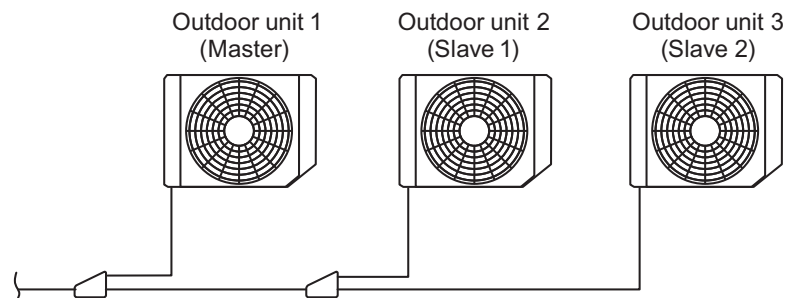

- Example 2

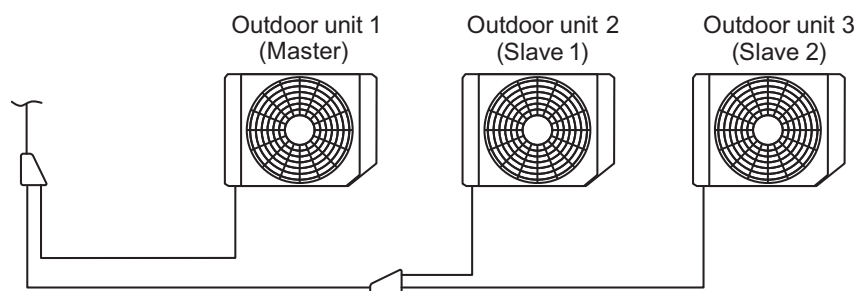


- Example 3

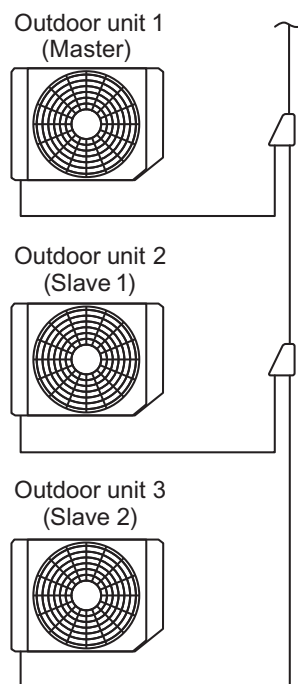


## ● Main pipe connection

Make sure to arrange the pipe horizontally or upward as shown bellow to prevent oil from accumulating into stopped outdoor unit.

### • Installable pattern

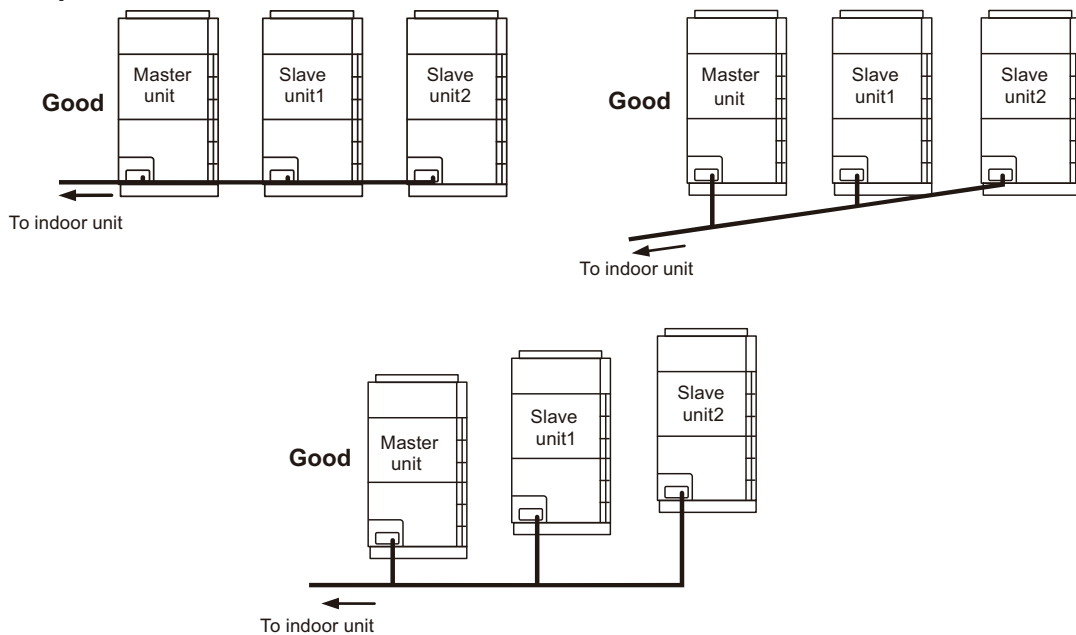


### • Non-installable pattern

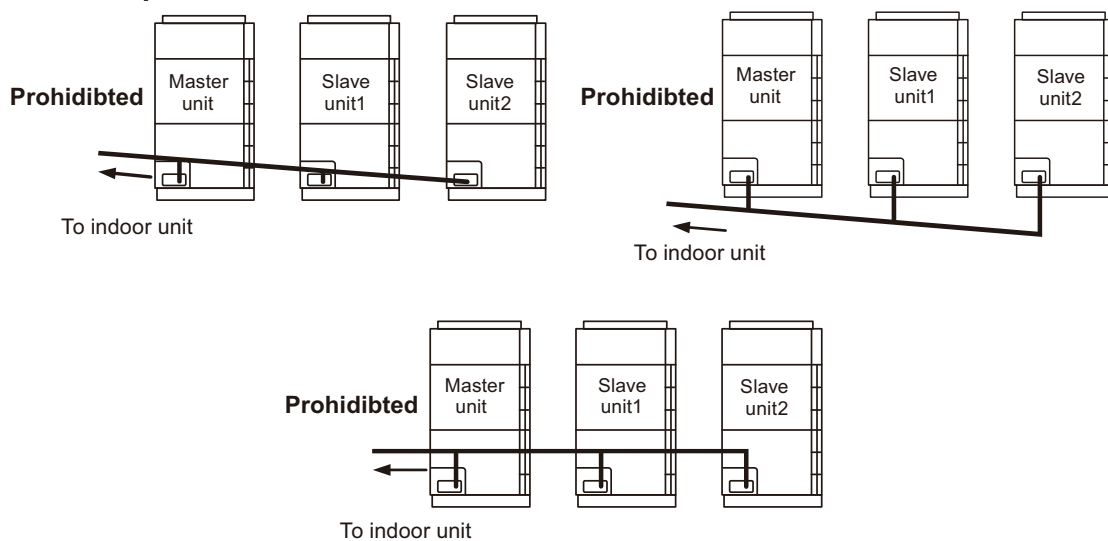

**NOTE:** If the pipe length between Outdoor unit branch kit and Outdoor unit branch kit (or slave unit) is longer than 6 ft (2 m), or a lower pipe line exists between outdoor units, rise for gas pipe should be arranged to eliminate oil from entering into and remaining at pipes and the stopped outdoor unit. (See following example.)

Example:

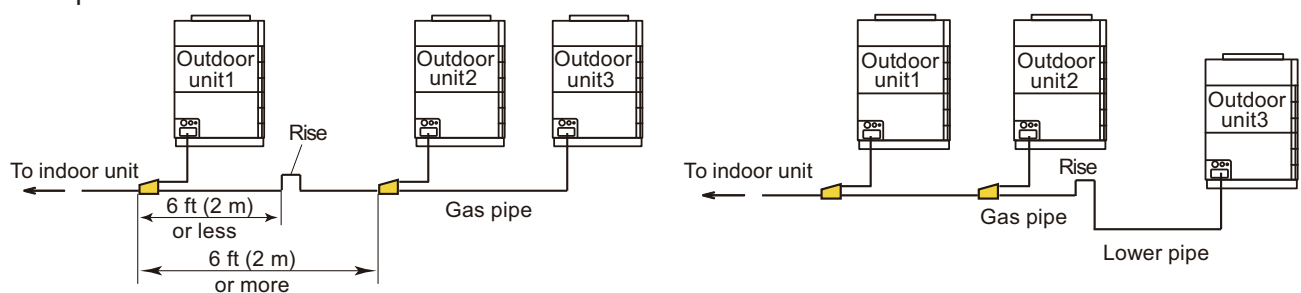


Rise height: 7-7/8 in (200 mm) or more

## ■ Piping method

### ● Opening the knockout hole


#### ⚠ CAUTION

- Be careful to prevent panel deformation or damaged while opening the knockout hole.
  - To prevent cutting of the wiring after the knockout hole was opened, remove the burrs along the edge. In addition, to prevent rusting, painting the edge with rust preventive paint is recommended.
- 
- The piping can be connected from 2 directions of the front and the bottom. (Knockout holes are provided so that the piping can be connected from 2 different directions.)
  - Use the front knockout hole, as required.

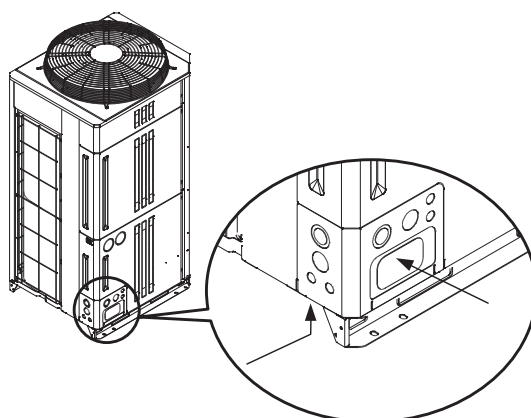


Knockout hole position

Unit: in (mm)

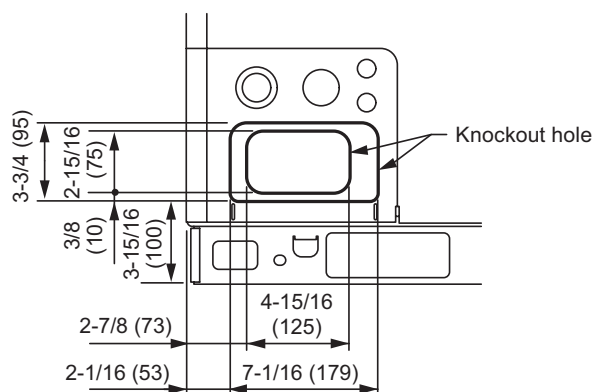

Detail of knockout position (front)

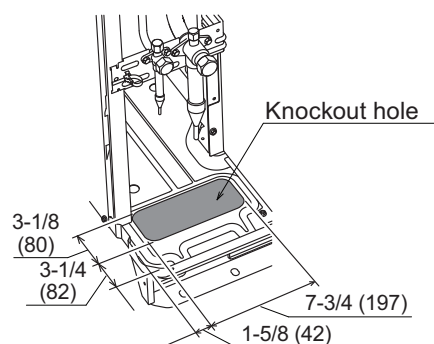

Detail of knockout position (bottom)






## ● Removing the pinch pipe

### ⚠ CAUTION

- Remove the pinch pipe only when the internal gas is completely drained as shown on the below instructions.
- If gas still remains inside, the piping may crack if you melt the brazing filter of the junction area with a burner.

Before connecting the piping, remove the pinch pipe in accordance with the following instructions:

1. Verify that the liquid side and gas side 3-way valves are closed. (Fig. A)
2. Cut the end of the liquid side and gas side pinch pipe and vent the gas inside the pinch pipe. (Fig. B)
3. After all the gas is vented, melt the brazing filler metal on connecting part using a torch and remove the pinch pipe. (Fig. C)

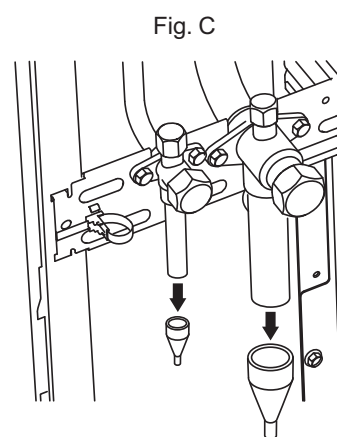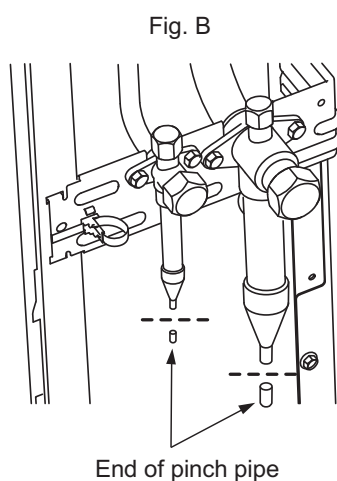
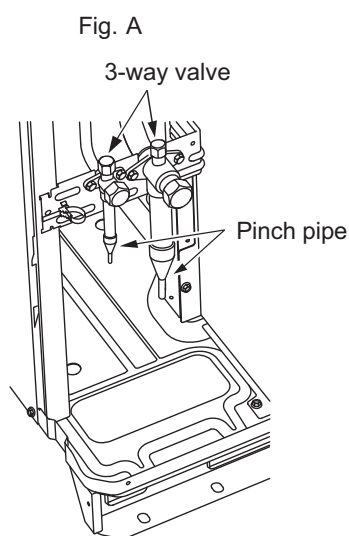


## ● Pipe connection

### ⚠ CAUTION

- Seal the pipe route hole with putty (locally purchased) such that there are no gaps. Small insects or animals that are trapped in the outdoor unit may cause a short circuit in the electrical component box.
  - To prevent pipe damage: do not make sharp bends in the pipe. Bend the pipe at a radius of 2-3/4 in (70 mm) or greater.
  - To prevent pipe damage, avoid bending pipe many times at same part.
  - After completing all the pipe connection by brazing, perform the indoor unit pipe connection with a flare joint.
  - When removing the pinch pipe or brazing the joint pipe, carry out the work while cooling down the 3-way valve sufficiently.
- 
- Braze the joint pipe onto the 3-way valve at the liquid and gas side. Install the joint pipe appropriately so that it can be connected easily with the main pipe.
  - Braze the joint pipe at the liquid and gas side with the main pipe.

**NOTE:** Be sure to supply nitrogen when brazing.

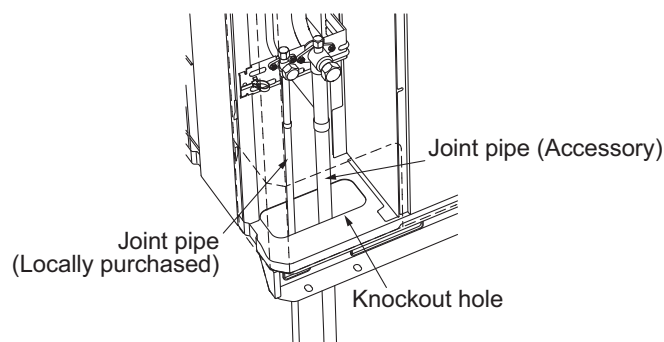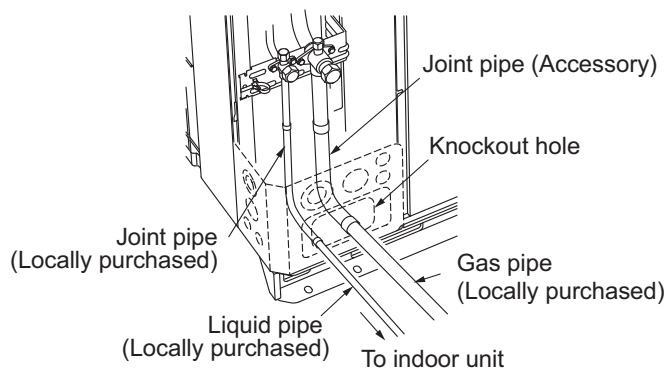


## 3-2. Outdoor unit branch kit

System	Model name	Quantity
2 outdoor unit	UTP-CX567A	1
3 outdoor unit		2


When using single outdoor unit, Outdoor unit branch kit is not necessary.

### ■ Installation

Make sure to connect Outdoor unit branch kit in correct direction.

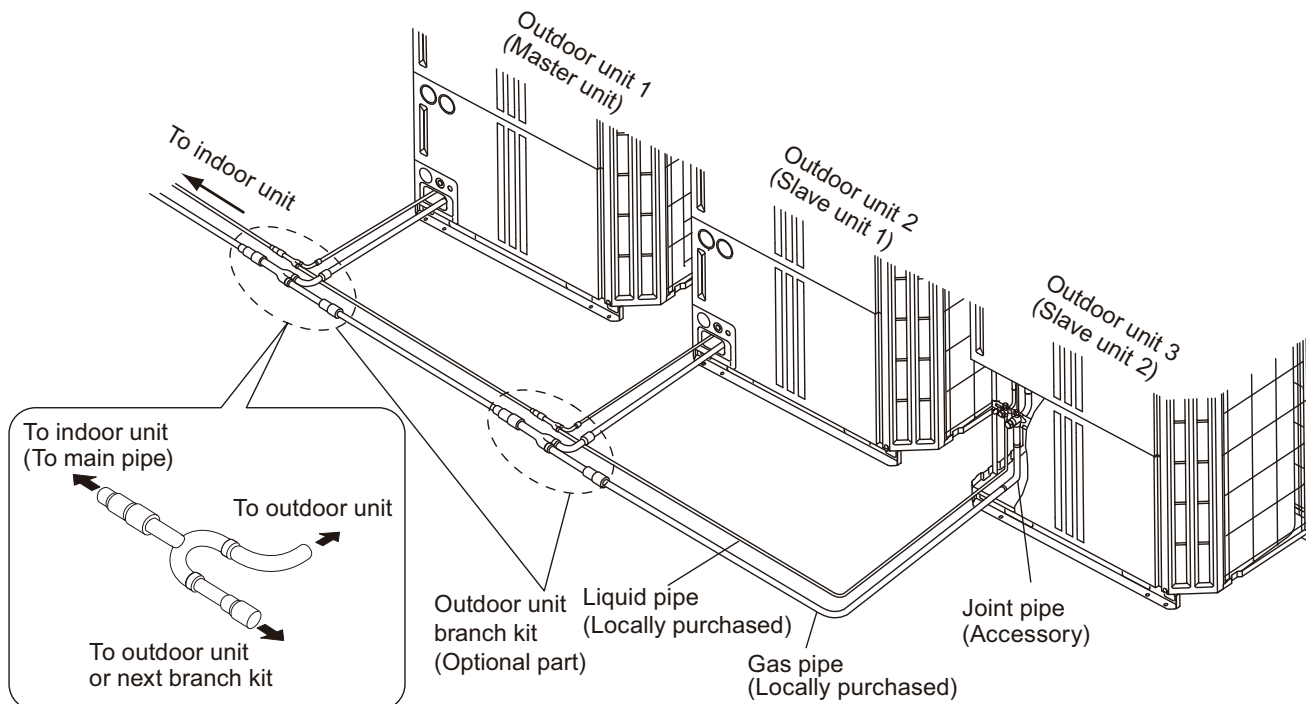


Use pipe cutter to cut at the location which matches the piping size when the piping size is different.

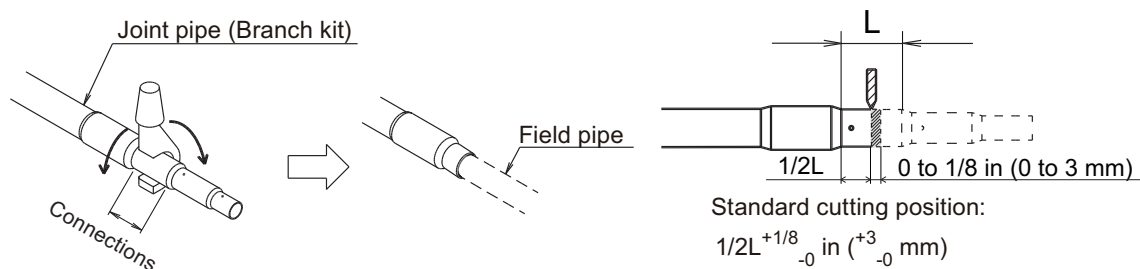

**NOTE:** Insert the field pipe firmly until it touches the joint pipe (Outdoor unit branch kit).

When the pipe size of the Outdoor unit branch kit itself does not match, or when piping sizes differ even if it cuts the pipe, use attached reducer or attached expander.

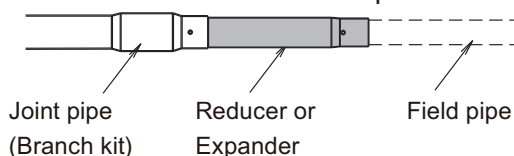


## ■ Restriction when install

Be sure following restriction.

For details, refer to the installation instruction sheet of the Outdoor unit branch kit.

### • Installation angle

Outdoor unit branch kit should be installed horizontally.

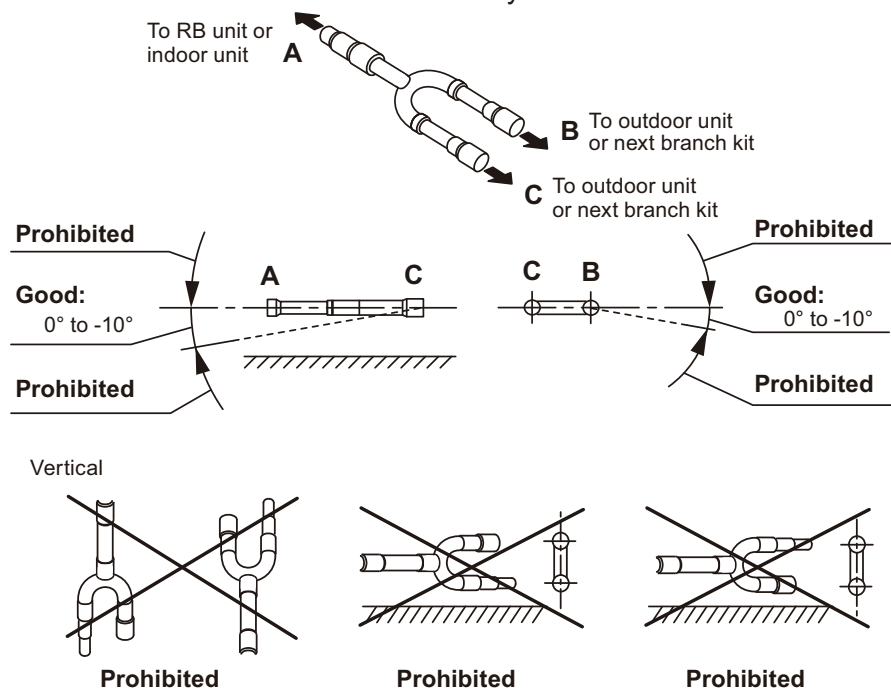


### NOTES:

- Install the Outdoor unit branch kit horizontally level within 0° to -10° so that the refrigerant separate evenly.
- Do not install the Outdoor unit branch kit vertically.


### • Straight pipe length

Leave the distance 2 ft (0.5 m) or more for straight part to Outdoor unit branch kit.

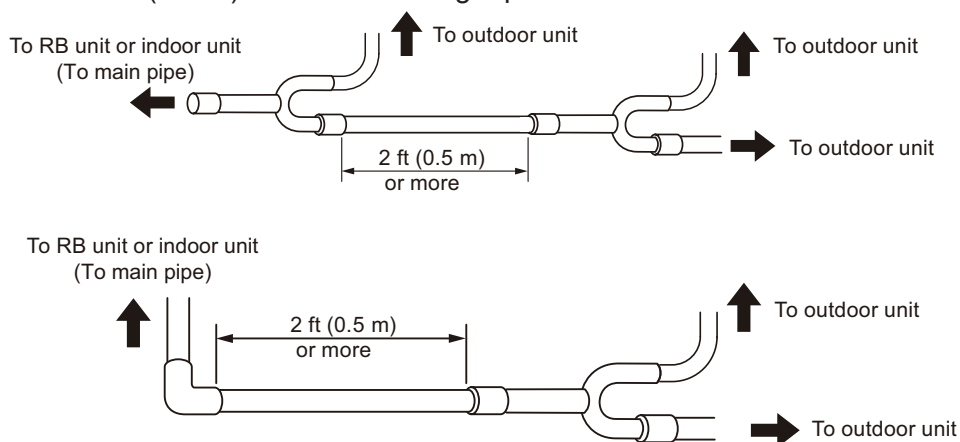


**⚠ CAUTION****About the connecting curvature of field pipe and Outdoor unit branch kit:**

The filed pipe should be connected to the Outdoor unit branch kit so that the curved angle on each side is 3 degree or less.

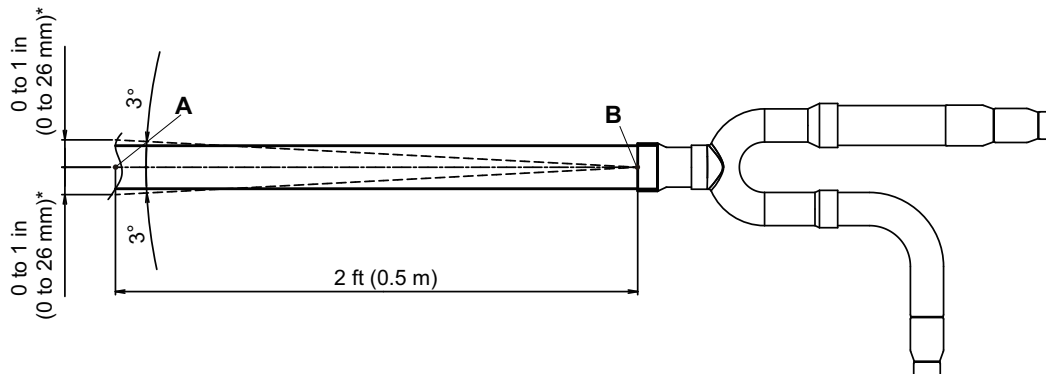

\*: Allowed value based on "A" (center of field pipe) at 2 ft (0.5 m) from "B" (junction of the Outdoor unit branch kit).


If the field pipe is connected with angle larger than specified, the balance of split refrigerant flow will be lost, and the refrigerant may concentrate upon specific outdoor unit as shown in the following figure. Such unbalanced refrigerant flow may cause a compressor malfunction.

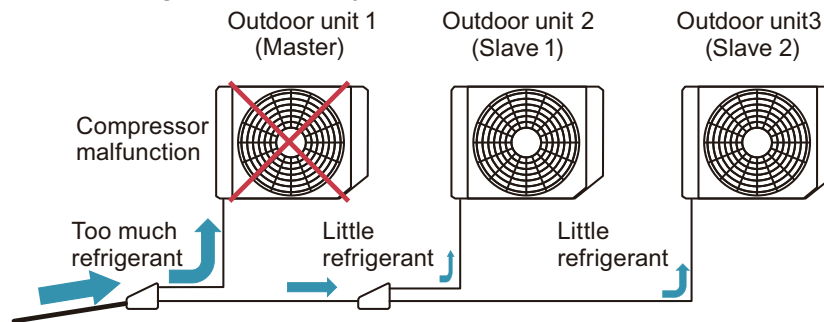


## ■ Heat insulation installation

After brazing the pipes and leak check, use the supplied insulation to insulate them. (on liquid and gas pipes)


1. Remove the protective sheet from the double-stick tape that is affixed to the heat insulation.

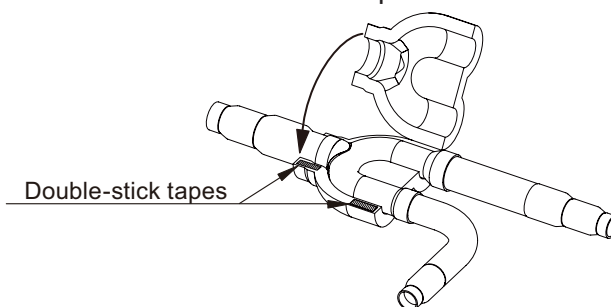

2. Be sure to install the tape (accessory) in each heat insulation to the 2 positions as shown in the following figure.

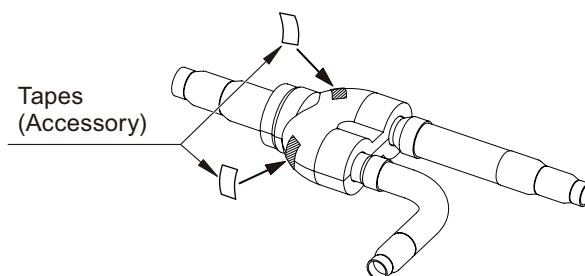


3. Use tape (locally purchased) to seal the seam so that there will be gap at the junction between the aforementioned heat insulation and the heat insulation on the local piping.

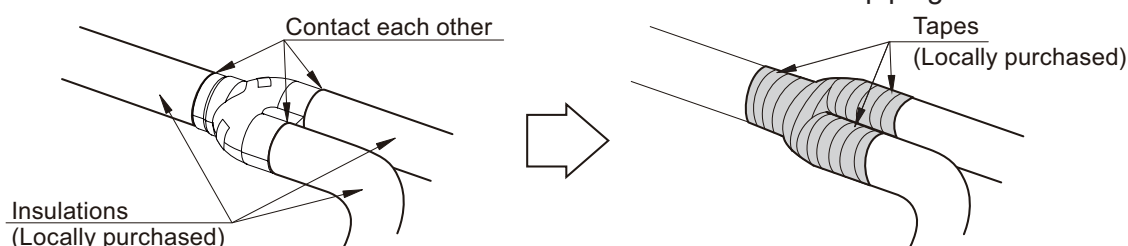

### ⚠ CAUTION

- Insulate the liquid and gas pipe completely. If not, it may cause the water condensation or performance reduction.
- Wrap the heat insulation with tape or pipe cover in order to extend the life time of heat insulation.
- Take proper measurement to strengthen by using another heat insulation at the following installation environment.
  - Environment temperature  $\geq 95^{\circ}\text{F}$  ( $35^{\circ}\text{C}$ ) and humidity 85%
  - Environment temperature  $\geq 77^{\circ}\text{F}$  ( $25^{\circ}\text{C}$ ) and humidity 90%

Installation example

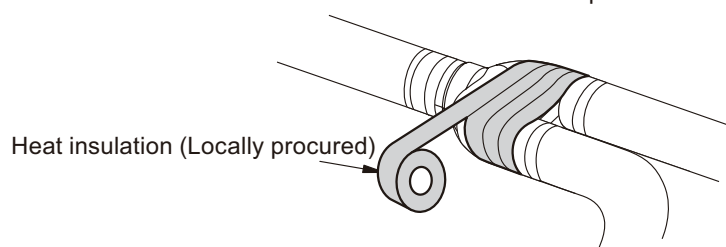


### 3-3. Separation tube

Total cooling capacity of indoor unit (x) (Btu/h)	Model name
$x \leq 96,500$	UTP-AX090A
$96,500 \leq x \leq 193,000$	UTP-AX180A
$193,000 \leq x$	UTP-AX567A

**NOTE:** Total cooling capacity of indoor unit is the total value for the cooling capacity at rated condition of indoor unit connected downstream.


#### ■ Installation

Select the connections with the pipe diameter that match the selected pipe sizes from the Separation tube, and cut them with a pipe cutter.

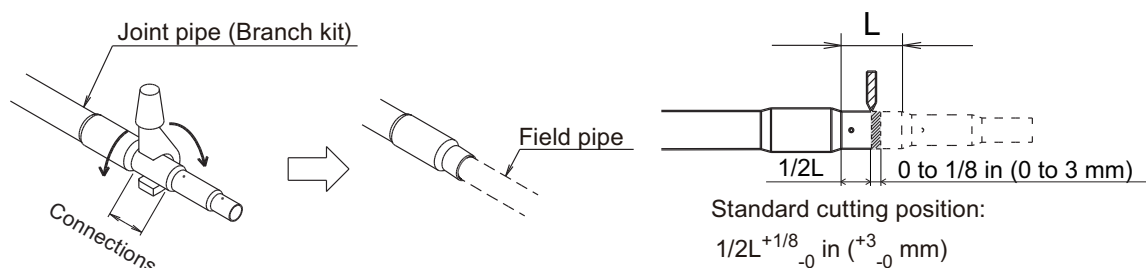

**NOTE:** Insert the field pipe firmly until it touches the joint pipe (Separation tube).

When the pipe size of the Separation tube itself does not match, or when piping sizes differ even if it cuts the pipe, use attached reducer or attached expander.

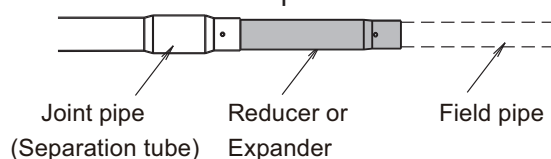


## ■ Restriction when install

Be sure following restriction.


- **Installation angle**

Place the Separation tube horizontally or vertically so that the refrigerant separates evenly.

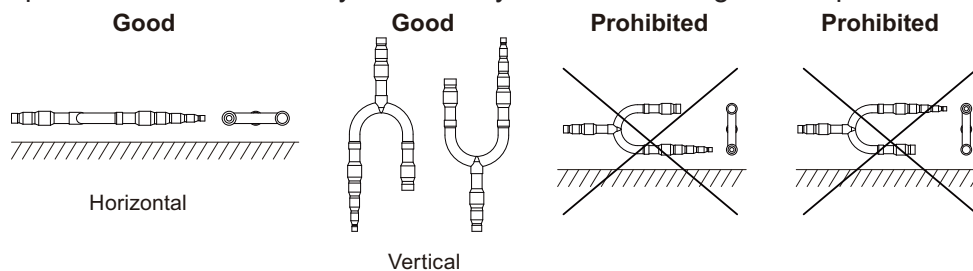

### ⚠ CAUTION

- If it is placed horizontally, keep it within allowable mounting angle below. Otherwise, it will not separate the refrigerant evenly, causing a reduction in performance.

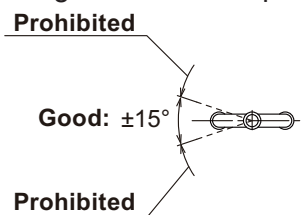


- During piping work, apply nitrogen gas while brazing the pipes. If pipes are brazed without applying nitrogen gas, it will create a large amount of oxidation film, which will cause a critical malfunction.
- To prevent moisture or foreign matter from entering during work, do not leave the piping open.
- Refer to the installation manual supplied with the outdoor unit for airtightness test and evacuation procedures.



- **Straight pipe length**


A straight pipe (minimum length 2 ft [0.5 m]) before Separation tube is necessary in order to separate the refrigerant exactly.

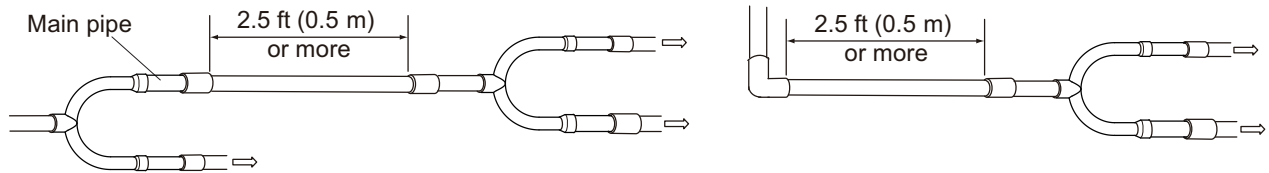

⇒ To indoor unit, separation tube, or header

### ⚠ CAUTION

- Keep the distance 2 ft (0.5 m) or more for straight part to Separation tube, in order to prevent the outdoor unit malfunction and generation of refrigerant noise.
- **About the connecting curvature of field pipe and Separation tube:**  
The field pipe should be connected to the Separation tube so that the curved angle on each side is 3 degree or less.

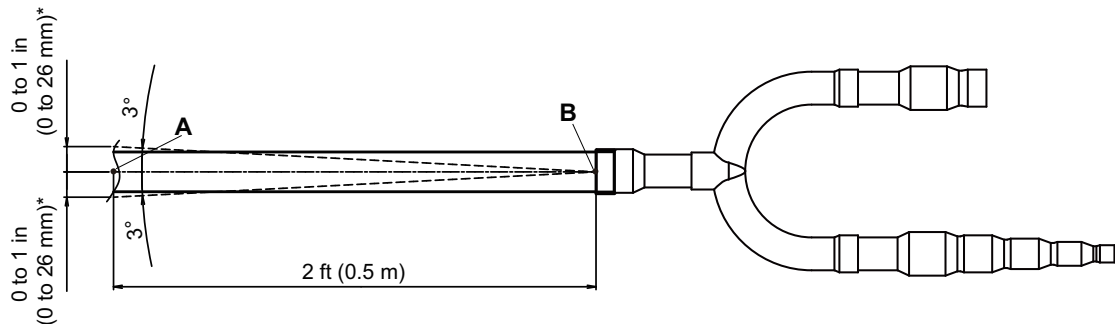


\*: Allowed value based on "A" (center of field pipe) at 2 ft (0.5 m) from "B" (junction of the Separation tube).


## Heat insulation installation

After brazing the pipes and leak check, use the supplied insulation to insulate them. (on liquid and gas pipes)


1. Remove the protective sheet from the double-stick tape that is affixed to the heat insulation.

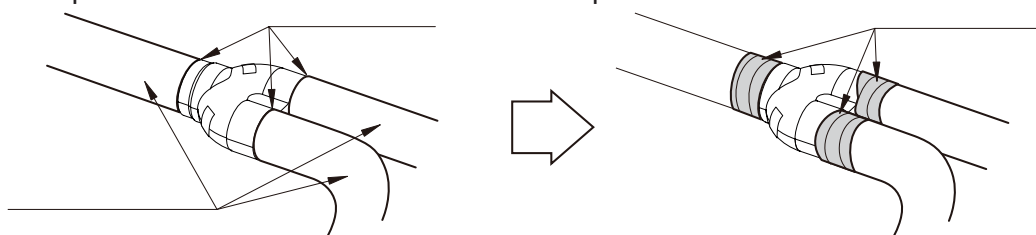

2. Be sure to install the tape (accessory) in each heat insulation to the 2 positions as shown in the following figure.

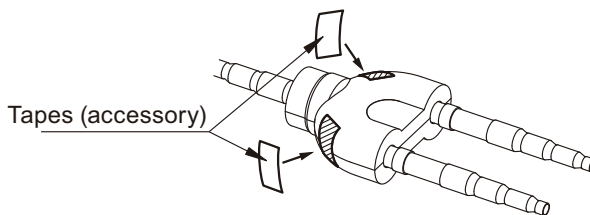


3. Use tape (locally purchased) to seal the seam so that there will be gap at the junction between the aforementioned heat insulation and the heat insulation on the local piping.

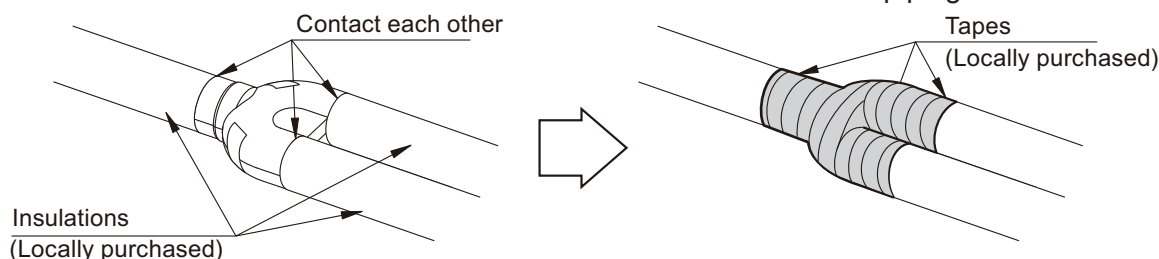

### ⚠ CAUTION

- Insulate the liquid and gas pipe completely. If not, it may cause the water condensation or performance reduction.
- Wrap the heat insulation with tape or pipe cover in order to extend the life time of heat insulation.
- Take proper measurement to strengthen by using another heat insulation at the following installation environment.
  - Environment temperature  $\geq 95^{\circ}\text{F}$  ( $35^{\circ}\text{C}$ ) and humidity 85%
  - Environment temperature  $\geq 77^{\circ}\text{F}$  ( $25^{\circ}\text{C}$ ) and humidity 90%

Installation example

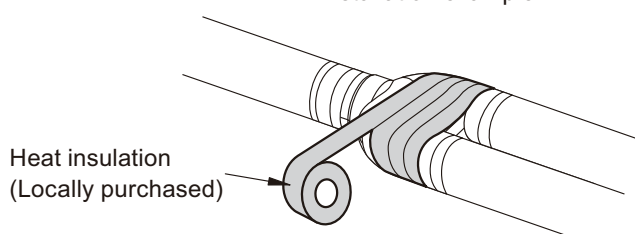

## 3-4. Header


Total cooling capacity of indoor units (x) (Btu/h)	3 to 6 Branches	3 to 8 Branches
$x < 96,500$	UTR-H0906L	UTR-H0908L
$96,500 \leq x < 193,000$	UTR-H1806L	UTR-H1808L

### NOTES:


- Total cooling capacity of indoor unit is the total value for the cooling capacity at rated condition of indoor unit connected downstream.
- When total cooling capacity exceeds 193,000 Btu/h or separate into 2 branches, use a Separation tube instead.

## ■ Installation


- Connecting the connection pipes from the indoor units.

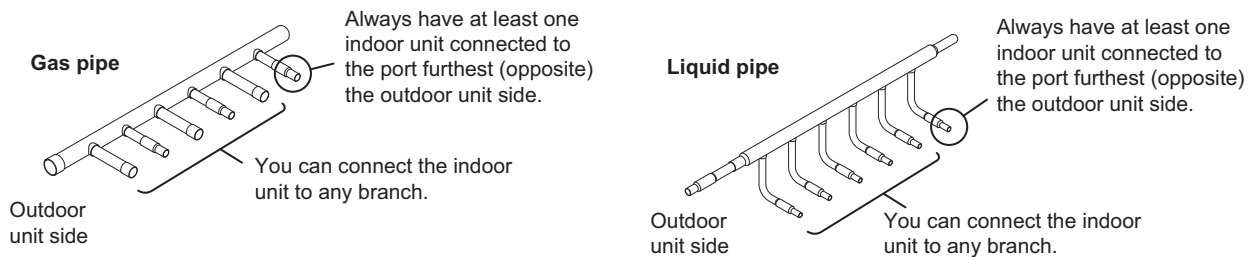


- Use a pipe cutter to cut at the location that matches the piping size or use expanders as necessary.

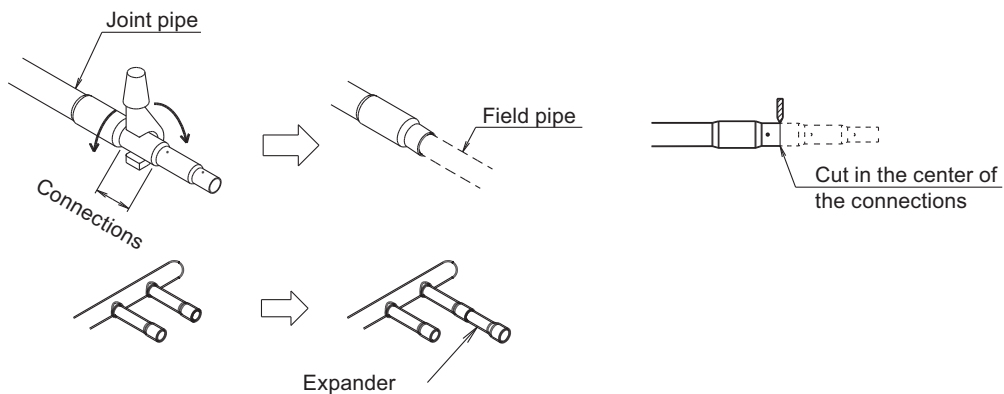


- Attach a plugging pipe provided if there is no piping connected at the Headers.

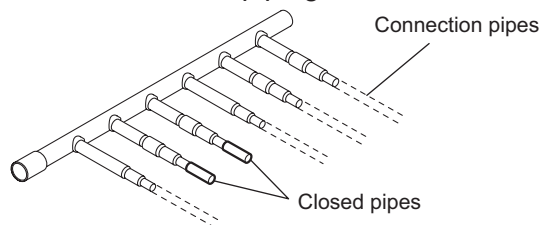


- Connecting pipe locally purchased from outdoor unit, cut the pipe end to connect the pipe and close the opposite end.

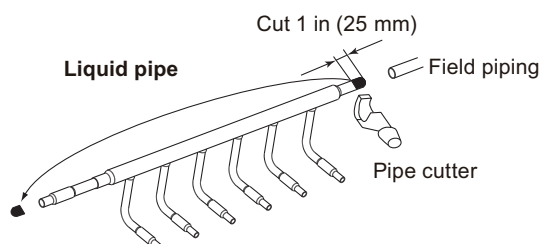

5. Use Header support as necessary.

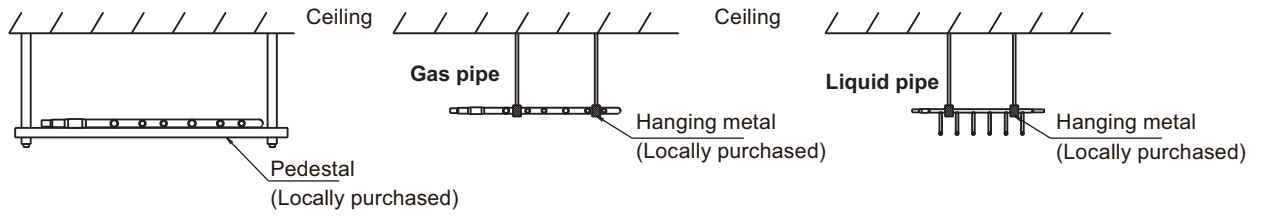

**CAUTION**

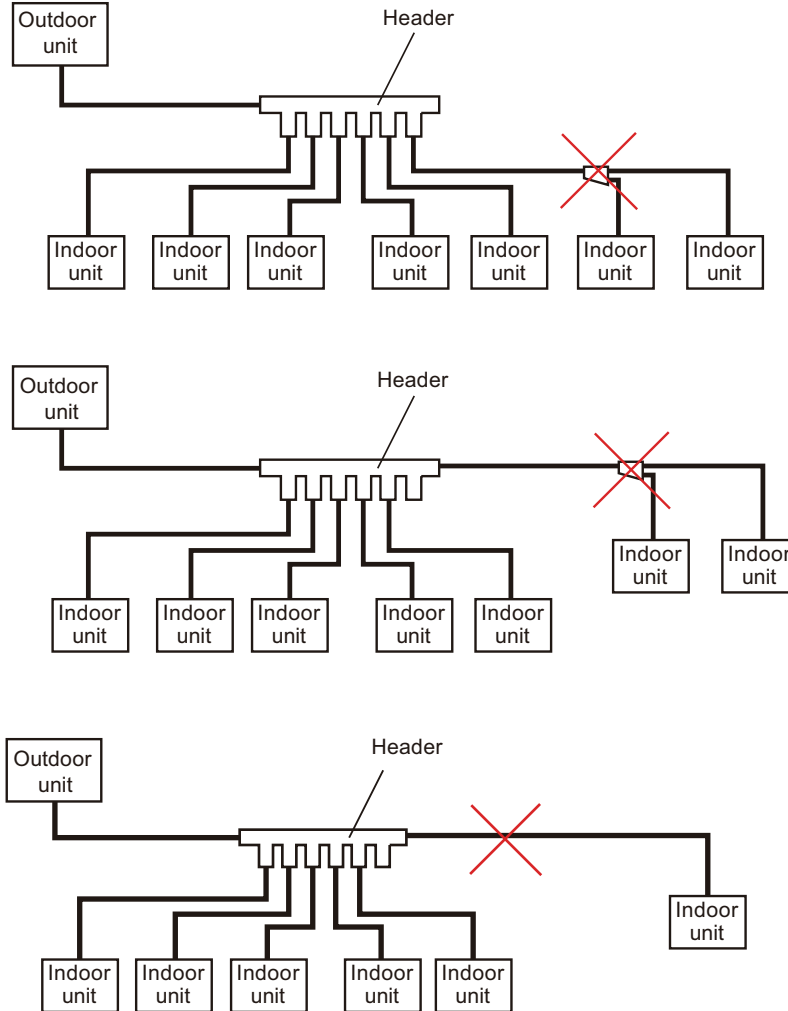



## ■ Restriction when install

Be sure following restriction.


### • Installation angle

Install the Header so that it branches horizontally.


#### Gas pipe

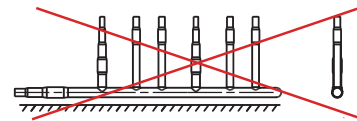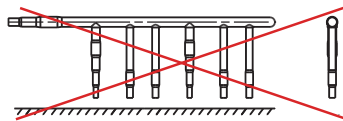


#### Liquid pipe



OK

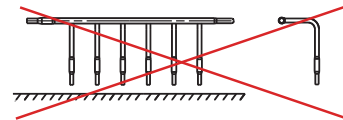


Prohibited

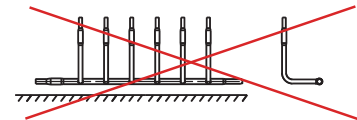


Prohibited

Use a level to make sure that the Header is positioned as shown in following figure, and then sure it in place.

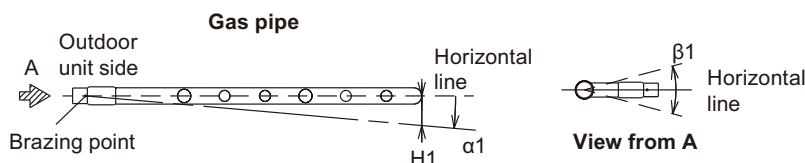


$H1 = 0 \text{ to } 3/8 \text{ in (0 to 10 mm)}$   
 $\alpha1: 0^\circ \text{ to } 1^\circ$   
 $\beta1: -10^\circ \text{ to } +10^\circ$

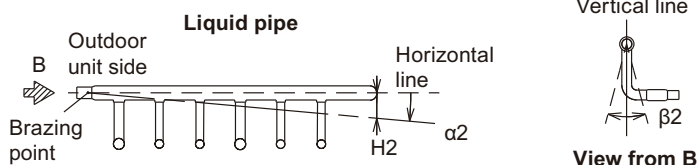


$H2 = 0 \text{ to } 3/8 \text{ in (0 to 10 mm)}$   
 $\alpha2: 0^\circ \text{ to } 1^\circ$   
 $\beta2: -10^\circ \text{ to } +10^\circ$

### • Straight pipe length

A straight pipe (minimum length 2 ft [0.5 m]) before Header is necessary in order to separate the refrigerant exactly.

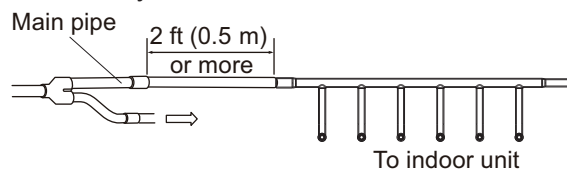



⇒ To indoor unit, separation tube, or header

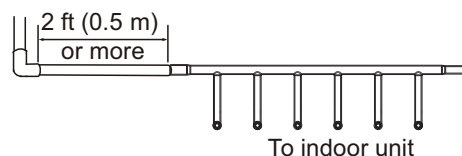



## ■ Heat insulation installation

After brazing the piping, attach heat insulation.

1. Remove the protective paper for the tape on the heat insulation for the header and attach it. Tighten by using binders at five locations.

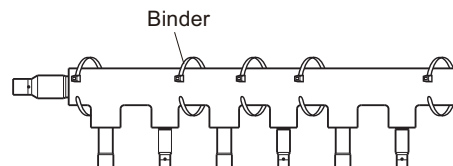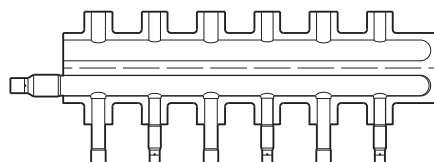

2. Cover the plugging pipe with heat insulation and seal with tape.

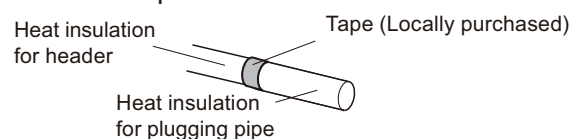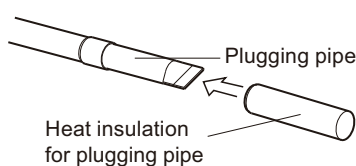

## 4. Wiring design

### 4-1. Electrical wiring

#### ■ Precaution

Regulations for wire diameter and selecting circuit breaker size differ from locality.  
Always install in accordance with local standard.


##### **⚠ WARNING**

- Do not turn on the power until all installation work is complete.
- Before starting work, check the power is not being supplied to the unit.
- Connect the connection cable firmly to the terminal board. Imperfect installation may cause fire.
- Always install a circuit breaker for each power supply circuit. Failure to use a circuit breaker could result in electrical shock or fire.
- Always install a disconnect switch for each power supply circuit.
- Always connect the ground wire.
- Always fasten the outside covering of the connection cable with the cord clamp. (If the insulator is chafed, electric leakage may occur.)
- Never install a condenser for improve the power factor. (It will not improve the power factor and the condenser will become abnormally hot.)
- When installing this system in high humidity locations, install using Ground Fault Equipment Breaker (GFEB) to reduce the risk of leaking current which may result in electric shock or potential fire.

##### **⚠ CAUTION**

- When approved for use in local code, we suggest installing Ground Fault Equipment Breaker (GFEB). In that case, GFEB shall be per Fujitsu recommended capacity in order to prevent malfunction of breaker device.
- Always use a dedicated power circuit for each condensing unit (outdoor unit). Never use a power supply shared by another appliance.
- "Wire size" and "Breaker" are for reference only; always install according to local regulations.
- Make the wire length between disconnect switch and unit terminal as short as possible provided that it complies with local code.
- Installation and service of this product is only to be performed by qualified professionals.
- All field wiring and components must be provided by a licensed electrician.
- Use copper conductors only.
- Use crimp-type terminals and tighten the terminal screws to the specified torques, otherwise, abnormal overheating may be produced and possibly cause serious damage inside the unit.

# Wiring system outline

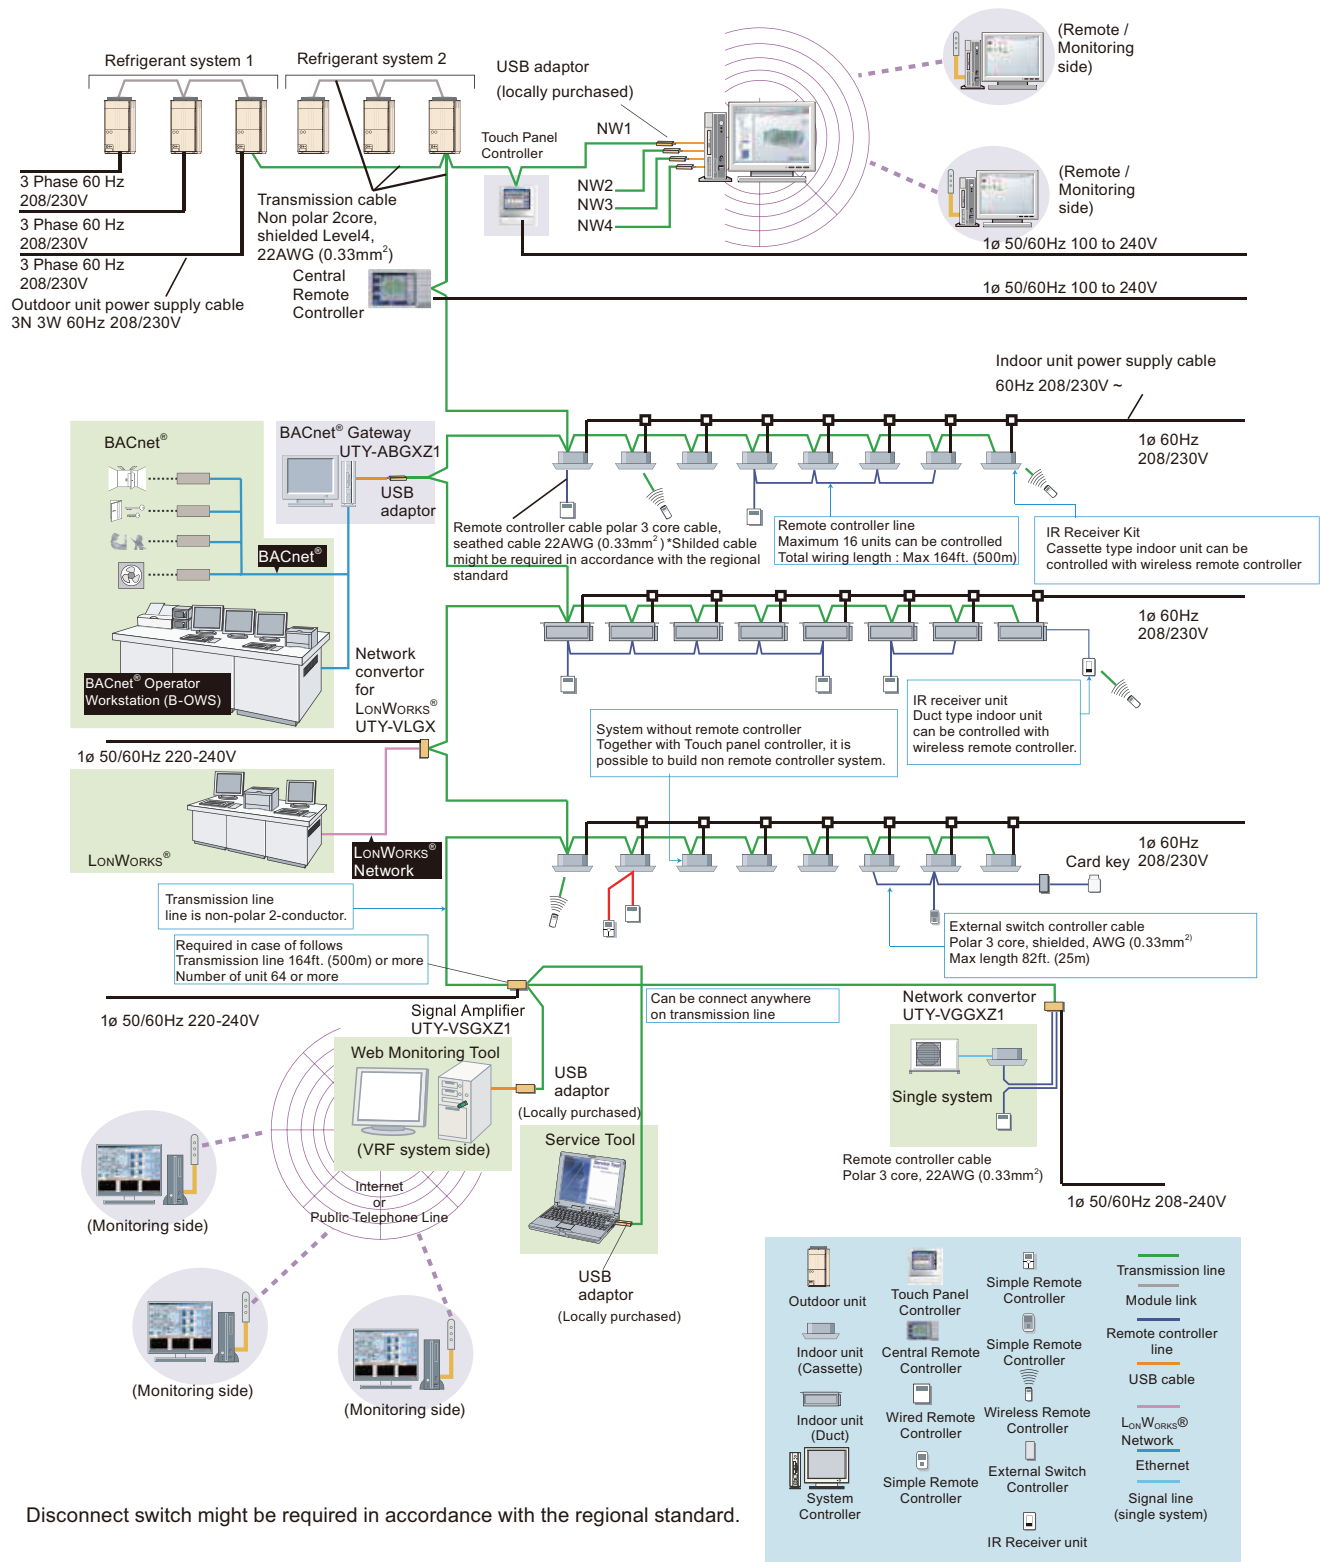

Disconnect switch might be required in accordance with the regional standard.

## 4-2. Power supply cable

### RELATED LINKS

"Electrical characteristics" in Chapter 3. OUTDOOR UNITS on page 03-37

"Electrical characteristics" in Chapter 4. INDOOR UNITS on page 04-26

## ■ Specifications

Use a separate power supply for the outdoor unit and indoor unit.

### ● Outdoor unit

Model	MCA (A)	MAX. CKT. BKR (A)	GFEB
AOUA72RLBV1	41	50	100 mA, 0.1 sec or less
AOUA96RLBV1			
AOUA120RLBV1	50	60	

- MCA: Minimum Circuit Ampacity
- MAX. CKT. BKR: Maximum Circuit Breaker
- GFEB: Ground Fault Equipment Breaker
- Select the power cable type and size in accordance with local regulations.
- Select a wire length (maximum wire length) so that the voltage drop is less than 2%.
- When the wire length is long and voltage drop exceeds this value, increase the wire diameter to stay within design limits.

### ● Indoor unit

Model	Recommended cable size (AWG)	MAX. CKT. BKR (A)	Breaker for leakage current	Remarks
All models	16 to 10	15	Refer to Table B	208/230 V ~ 60 Hz 2 wire + ground

Refer to the table for the breaker specifications of each installation condition.

Perform the power crossover wiring within the range of the same refrigerant system. When the power crossover wiring is done, make a connection for indoor units to satisfy conditions of Table A and B below.

- Select the power cable type and size in accordance with local regulations.
- Include at least one breaker and one disconnect per refrigerant circuit.
- Power supply circuits should only be connected to units and the same refrigerant circuit.
- Design the power supply circuit to keep the voltage drop within 2%.



• **Table A. Current breaker requirements**

Model	MCA (A)	MAX. CKT. BKR (A)
All models	Refer to " <a href="#">Electrical characteristics</a> " in Chapter 4. INDOOR UNITS on page 04-26	15

- MCA: Minimum Circuit Ampacity
- MAX. CKT. BKR: Maximum Circuit Breaker

When the power crossover wiring is done, make it so that the total of the MCA of the connected indoor units does not exceed the 11 A.

• **Table B. Ground Fault Equipment Breaker requirements**

Breaker capacity	Maximum connectable "Units"
30 mA, 0.1 sec or less	36 or less
100 mA, 0.1 sec or less	37 to 121

If the total number of units connected to the breaker exceeds 36, either add a 30 mA breaker or use a breaker with a greater capacity.

**NOTE:** For how to count the units, refer to the table below.

Connected unit	Q'ty	Count
Indoor units Except High static pressure duct	1	1
Indoor units High static pressure duct (ARUH72TLAV2, ARUH96TLAV2)	1	3


- Example 1:  
Connected units: AUUA9TLAV2 × 4 + AUUB18TLAV × 2 + ARUL9TLAV2 × 1  
Amount of units:  $1 \times 4 + 1 \times 2 + 1 \times 1 = 7$
- Example 2:  
Connected units: ARUH72TLAV2 × 1 + AUUA9TLAV2 × 2 + ARUL9TLAV2 × 2  
Amount of units:  $3 \times 1 + 1 \times 2 + 1 \times 2 = 7$

## ■ Wiring example


### ⚠ CAUTION

- Except for emergency, never turn off main as well as sub breaker of the indoor units during operation. It will cause compressor failures as well as water leakage.
- First, stop the indoor unit by operating the control unit, converter, or external input device, and then cut the breaker.
- Make sure to operate through the control unit, converter, or external input device.
- When the breaker is designed, locate it at a place where the users cannot start and stop in the daily work.
- Regulation of wire size and circuit breaker differs from each locality, refer in accordance with the regional standard.
- When approved for use in local code, we suggest installing Ground Fault Equipment Breaker (GFEB). In that case, GFEB shall be per Fujitsu recommended capacity in order to prevent malfunction of breaker device.


- Example 1: Using terminal board for indoor unit

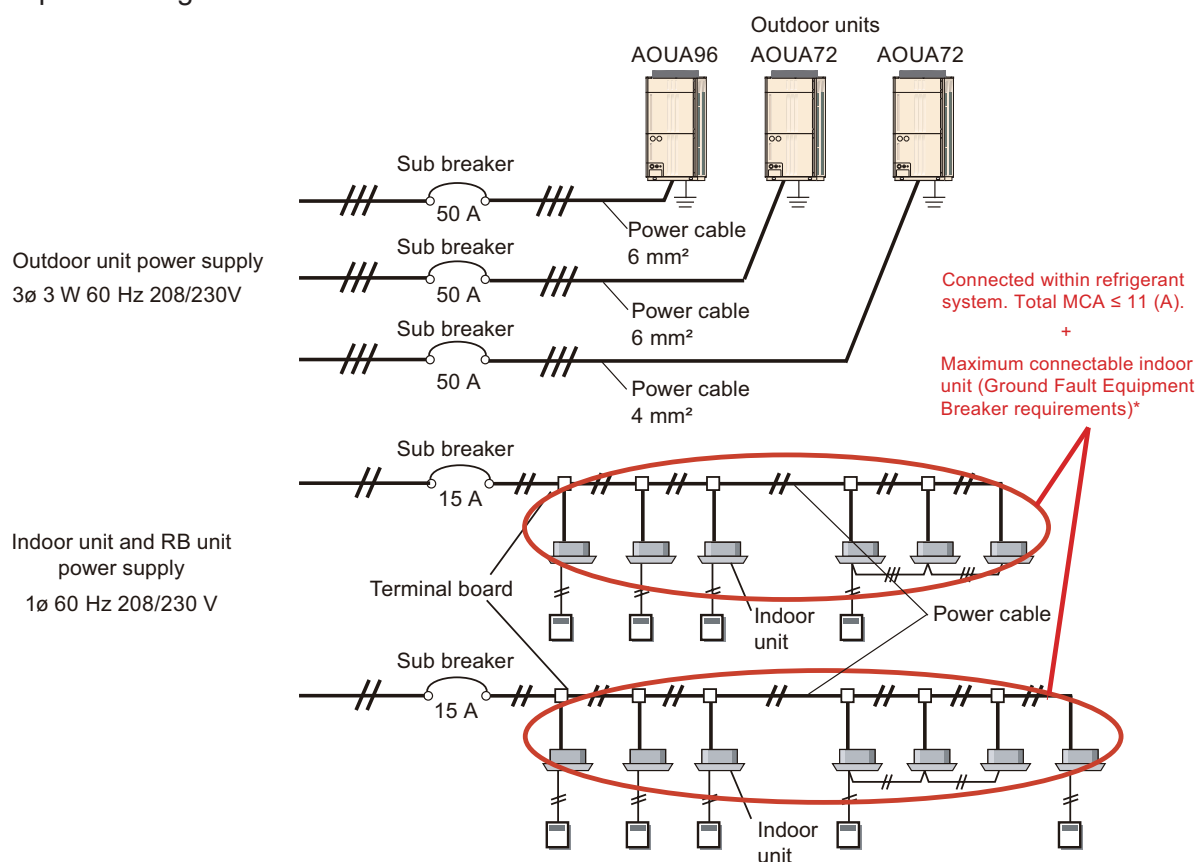

- Example 2: Using external power supply unit  
When operating multiple indoor units with one remote controller, make sure that AC 230 V power is supplied with one breaker as shown below.

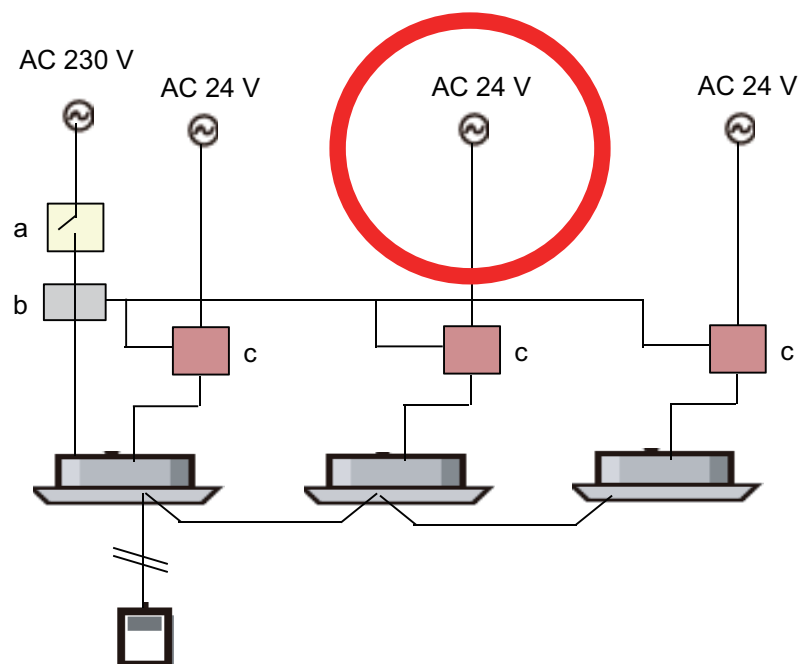

a: Circuit breaker  
b: Relay  
c: External power supply unit

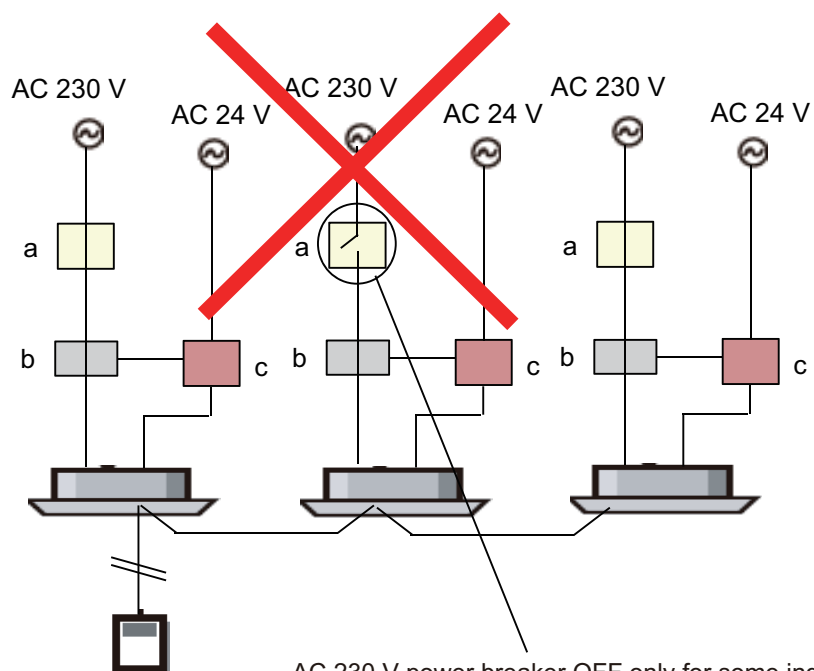

AC 230 V power breaker OFF only for some indoor units  
connected with remote controller cable

## 4-3. Transmission cable

### RELATED LINKS

"Definition" on page 06-8

### ■ Wiring specifications

Use	Cable size	Cable type	Remarks
Transmission cable	22 AWG (0.33 mm <sup>2</sup> )	LEVEL4 (NEMA) non polar 2-core, twisted pair solid core, diameter 0.65 mm	LonWorks compatible cable

Use shielded cable specified below and always ground it both end.

22 AWG (0.65 mm) LEVEL4 cable with shielded (National Electrical Manufacturers Association [NEMA]) differs from the Category 4 specification proposed by the Electronic Industries Association/Telecommunication Industry Association (EIA/TIA).

Reference specifications for transmission cable			
Item		Unit	Specifications
Wire type		mm	0.65 dia (22 AWG) Twisted pair with shield
Pair (Twisted pair cable)* <sup>1</sup>		—	1 pair or 2 pair
Loop DC resistance (68 °F [20 °C])		Ohm/1,000 ft (Ohm/305 m)	Less than 18
DC resistance unbalancing (68 °F [20 °C])		%	Less than 5
Dielectric voltage (Between conductor and conductor)		V/min	AC 350
Insulation resistance (68 °F [20 °C]) (Between conductor and conductor)		Mohm-km	More than 500 (After charging DC 500 V 1 min)
Mutual capacitance of a pair		pF/foot (pF/305 mm)	Less than 17
Pair-to-ground capacitance unbalance		pF/1,000 ft (pF/305 m)	Less than 1,000
Characteristic impedance	772 KHz	Ohm	102±15% (87 to 117)
	1 MHz		100±15% (85 to 115)
	4 MHz		
	8 MHz		
	10 MHz		
	16 MHz		
	20 MHz		
Attenuation	772 KHz	dB/1,000 ft (dB/305 m)	Less than 4.5
	1 MHz		Less than 5.5
	4 MHz		Less than 11.0
	8 MHz		Less than 15.0
	10 MHz		Less than 17.0
	16 MHz		Less than 22.0
	20 MHz		Less than 24.0
Cross talk attenuation* <sup>2</sup>	772 KHz	dB/1,000 ft (dB/305 m)	Less than 58
	1 MHz		Less than 56
	4 MHz		Less than 47
	8 MHz		Less than 42
	10 MHz		Less than 41
	16 MHz		Less than 38
	20 MHz		Less than 36

Reference specifications for transmission cable		
Item	Unit	Specifications
<b>NOTES:</b> <ul style="list-style-type: none"> <li>• *1: Number of twist is not specified. However, it shall satisfy the electrical specifications such as characteristic impedance, attenuation, etc. (Example: More than 40 times/m)</li> <li>• *2: Cross talk attenuation is applied when the twisted cable has 2 pairs (2 P).</li> <li>• Material is not specified. However, it shall be selected by considering the operating environment (temperature, humidity) and the local regulation by the environment condition (ROHS directive, etc.).</li> <li>• Mechanical specification is not specified. However, it shall be selected by considering the operating environment.</li> <li>• Never bundle transmission cable with power supply cable.</li> </ul>		

## ■ Wiring rules

- In the following cases, Signal Amplifier is required.
  - (1) When the total length of the transmission line exceeded 1640 ft. (500 m)  
 $AB+BC+BD+DE+EF > 1640 \text{ ft. (500 m)}$  (Fig. 1)
  - (2) When the total number of element \*<sup>1</sup> is over 64.
- Transmission line length between each unit\*<sup>1</sup>: Max 1312 ft. (400 m)
- Total transmission line length: Max 11811 ft. (3600 m).  
 $AB+BC+BD+DE+EF+EG+GH < 11811 \text{ ft. (3600 m)}$  (Fig. 2)

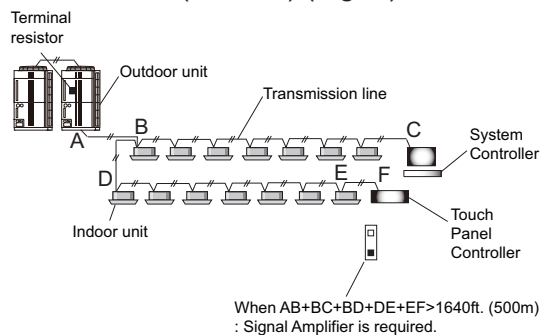


Fig. 1

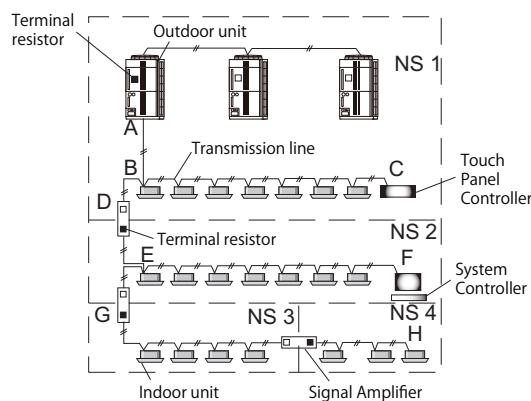


Fig. 2

\*1: Refer detail Meaning of element on refer to ["VRF network system"](#) on page 06-8.

## ■ Wiring flow

1. Decide to use feature of automatic address setting depending on system design.  
Decide to use automatic address setting or manual address setting.
  - Automatic address setting: Go to ["Auto address setting"](#) on page 06-77 in step 2.
  - Manual address setting: Go to ["Manual address setting"](#) on page 06-78 in step 2.
2. Confirm transmission wiring.
  - Auto address setting  
Connect the transmission cable like as Fig. 1 and Fig. 2

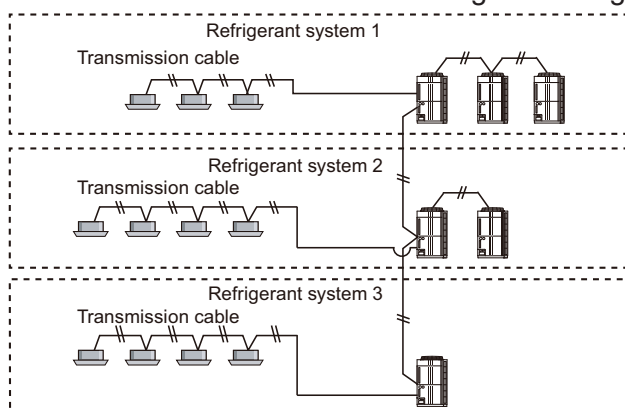


Fig. 1


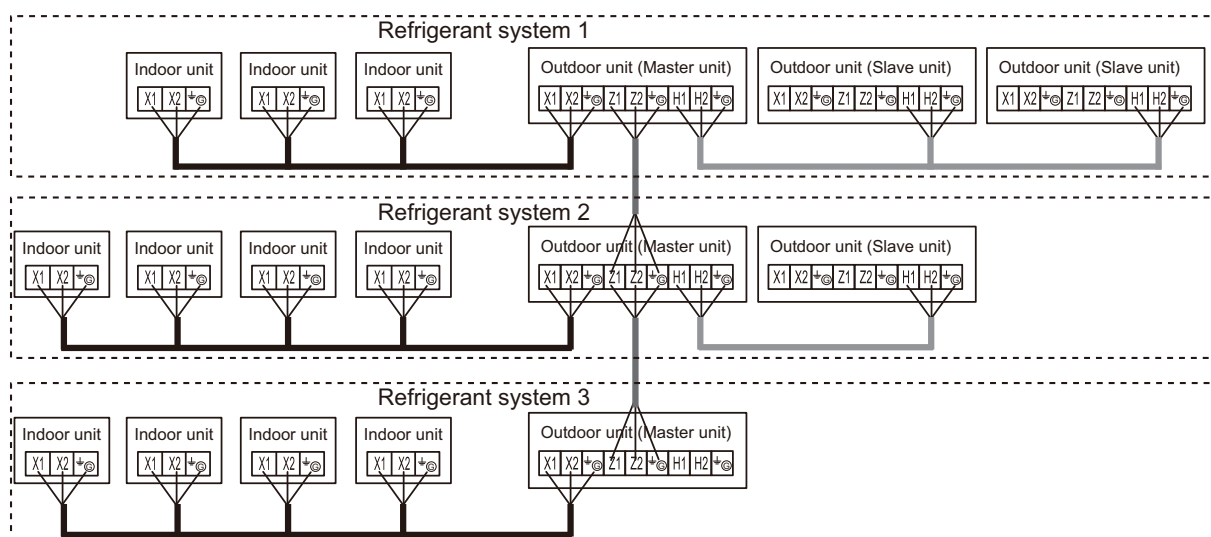


Fig. 2


- X1, X2: Indoor units to outdoor unit
- Z1, Z2: Connection for different refrigerant circuit of outdoor unit
- H1, H2: Module link connection between master and slave outdoor units  
(It is required for combination use.)

- Manual address setting

Connect the transmission cable like as Fig. 3 and Fig. 4

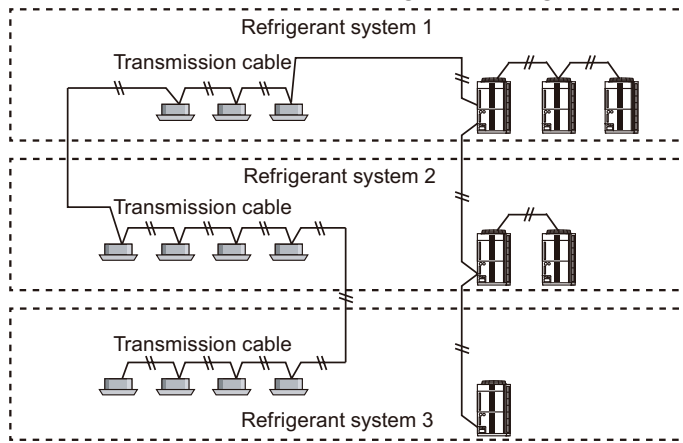

**Fig. 3**

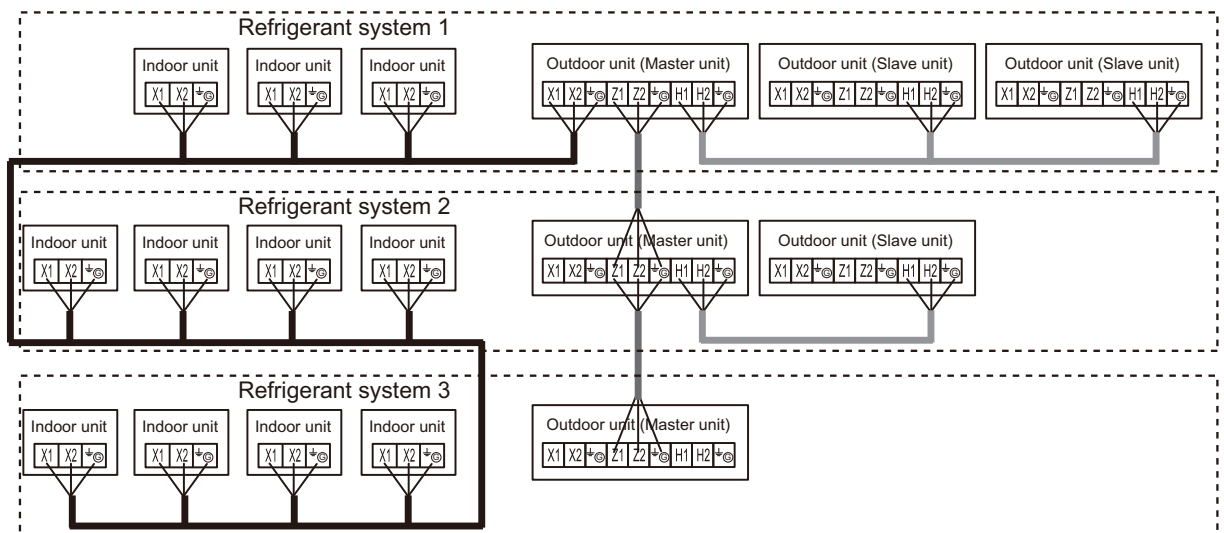


**Fig. 4**

- X1, X2: Indoor units to outdoor unit
- Z1, Z2: Connection for different refrigerant circuit of outdoor unit
- H1, H2: Module link connection between master and slave outdoor units  
(It is required for combination use.)

3. Confirm the transmission wiring rule.  
For details of wiring rules, refer to Wiring rules.
4. Confirm how to install Signal amplifier.  
For details of wiring rules, refer to Wiring rules.



5. Confirm how to wire transmission cable.  
 Confirm how to connect transmission cable between indoor units.
- Arrange so that there is one terminal resistor for each network segment.
  - Always take a ground from both ends of transmission cable.

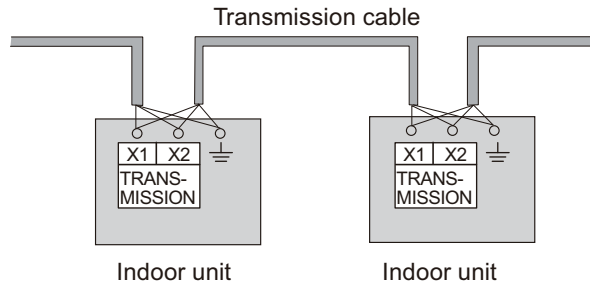

6. Confirm transmission wiring system.  
 Confirm your transmission wiring system if transmission wiring system is ensured wiring rule.

#### Check list


- ☐ Total transmission wiring length
- ☐ Total number of unit

**NOTE:** For details, refer to "[VRF network system](#)" on page 06-8.


## ■ Separation rules

- The transmission cable between indoor units, outdoor unit, and controllers can be connected by one cable.
- Terminal board available on the market or the ones inside the indoor unit or outdoor unit should be used for transmission cable separation.
- Connection of 3 or more lines may cause poor communication for one terminal. In this case, use a terminal box.


**NOTE:** Do not loop.




- Example 1: Connecting each outdoor unit and RB unit with one wiring

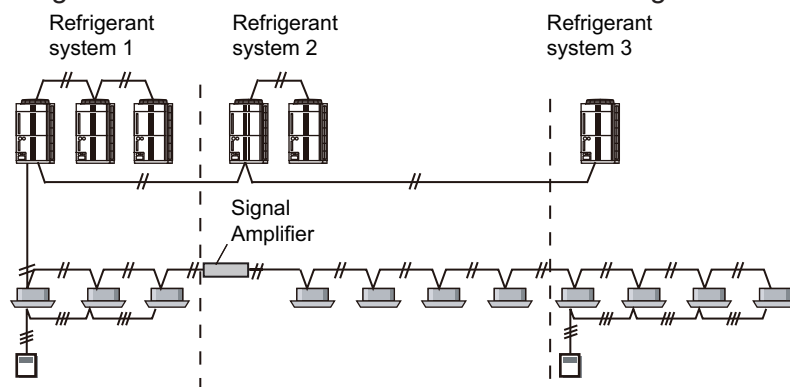

- Example 2: Separating transmission cable

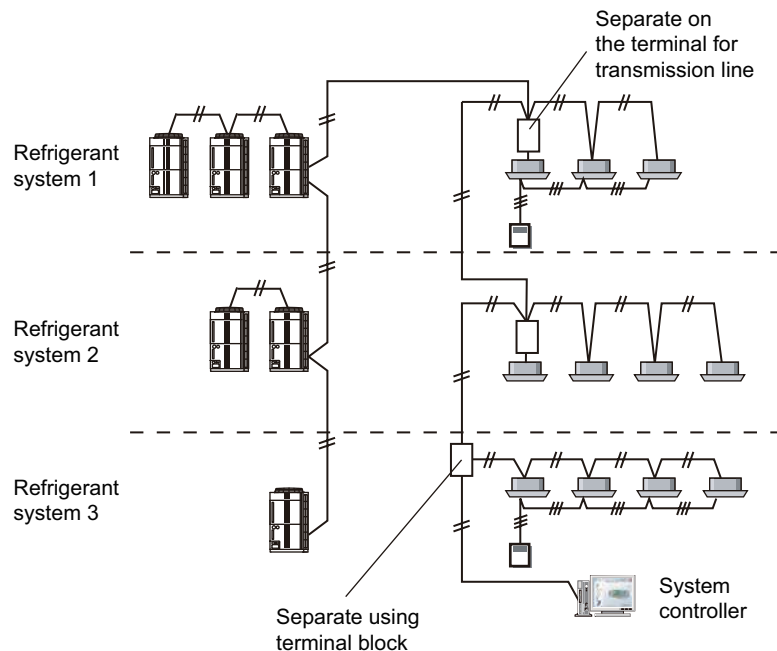


- Example 3: Separation wiring from one terminal board radially

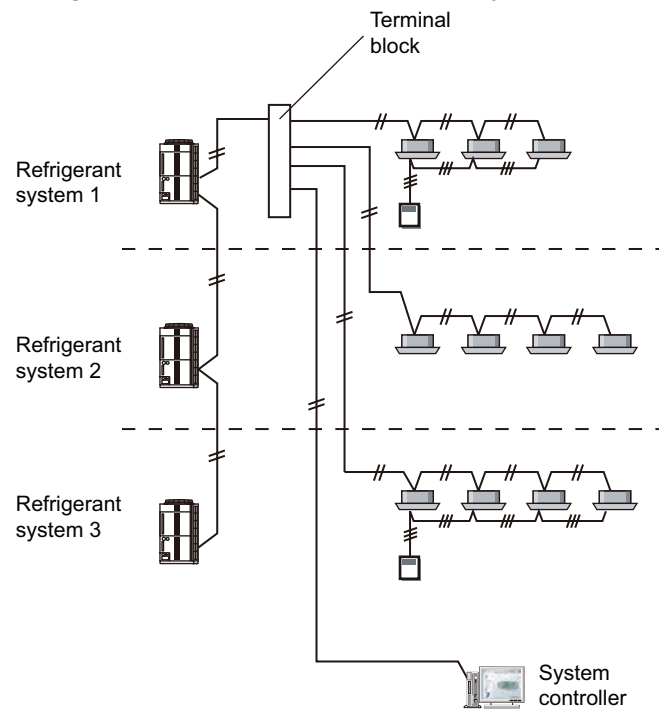

## Wiring method

Practical transmission wiring method is shown below.

Each terminal has to be connected the following rules.

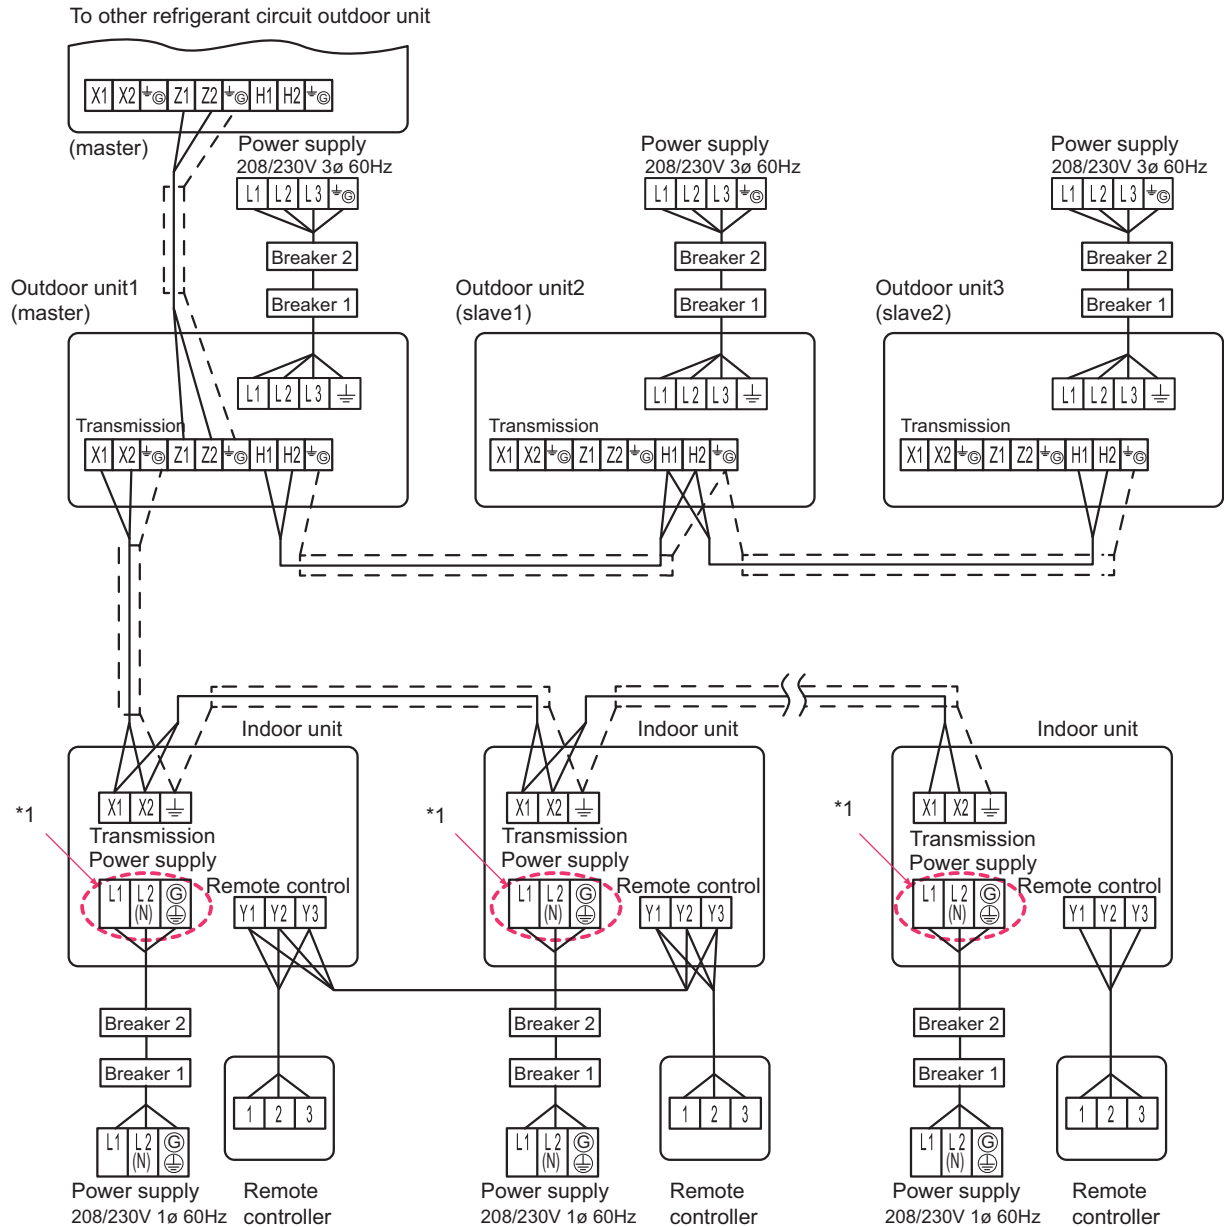

- X1, X2: Indoor unit to outdoor unit (Master)
- Z1, Z2: Connection for different refrigerant circuit of master outdoor unit
- H1, H2: Module link connection between master and slave outdoor units (It is required for combination use.)
- Breaker 1: Ground Fault Equipment Breaker (GFEB)
- Breaker 2 : Maximum Circuit Breaker (MAX.CKT.BKR)

\*1: The number of power supply terminals is different depending on the indoor unit model.

For the wiring, refer to the indoor unit installation manual.

\*Caution: When installing this system in high humidity locations, install using ground fault equipment breakers (often referred to in other countries as an ELCB earth leakage current breaker) to reduce the risk of leaking current which may result in electric shock or potential fire. We suggest installing GFEB or follow local electrical code. This system uses an inverter, which means that when used with a ground fault breaker you must use breakers that can handle higher harmonics such as a (GFEB) Ground Fault Equipment Breaker (30 mA or greater) in order to prevent malfunctioning of ground fault device

## 4-4. Controller cable

### RELATED LINKS

"Indoor unit type and applicable control method" in Chapter 5. CONTROL SYSTEM on page 05-8

"Control device design limitation" in Chapter 5. CONTROL SYSTEM on page 05-13

"Applicable parts" in Chapter 10. OPTIONAL PARTS on page 10-24

### ■ Wiring specifications

Model type	Connection to	Wire	Size	Specification		
System controller	USB adapter	USB cable	—			
System controller lite						
Touch panel controller	Transmission cable	Refer to "Wiring specifications" on page 06-74				
Central remote controller						
Wired remote controller (2-wire type)* <sup>1</sup>	Indoor unit	Remote controller cable	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Sheathed, non-polar 2 core, twisted pair* <sup>2</sup>		
			18 AWG	Sheathed, Thermostat cable 2core, Non Twisted pair* <sup>2</sup>		
Simple remote controller (2-wire type)* <sup>1</sup>	Indoor unit	Remote controller cable	22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )	Sheathed, non-polar 2 core, twisted pair* <sup>2</sup>		
Wired remote controller (3-wire type)	Indoor unit	Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Sheathed PVC cable, polar 3 core* <sup>2</sup>		
Simple remote controller (3-wire type)						
External switch controller	Indoor unit	Remote controller cable	22 AWG (0.33 mm <sup>2</sup> )	Shielded, polar 3 core		
			22 to 16 AWG (0.33 to 1.25 mm <sup>2</sup> )			
	External input		22 AWG (0.33 mm <sup>2</sup> )	Shielded, non-polar 2 core, twisted pair		
IR receiver unit (for All duct type)	Indoor unit	Connection cable	—	16 ft (5 m) cable attached		
IR receiver unit (for Circular flow cassette type)						
IR receiver unit (for Cassette type)						
Human sensor kit (for Circular flow cassette type)						
Remote sensor unit				33 ft (10 m) cable attached		
Drain pump unit						

\*1: For maximum connectable number, refer to "Maximum connectable number of remote controller (2-wire type)" on page 06-86.

\*2: Use shielded cable (locally purchased) in accordance with the regional cable standard.

**⚠ CAUTION**

---

- Install in accordance with the regional standard.
  - Never bundle the power supply cable and controller cable together. Bundling these cords together will cause misoperation.
  - Always ground for shielded cable both end.
  - For details of specification and connection, refer to "[Control system](#)" in Chapter 5. CONTROL SYSTEM on page 05-1.
  - Controller might be required to connect power supply cable and transmission cable. For power supply cable, use separate connection with other units.
-

## ■ Maximum connectable number of remote controller (2-wire type)

Maximum connectable number of remote controller (2-wire type) is limited by cable size and maximum cable length.

Maximum connectable number of remote controller (2-wire type)				
Cable size (S)		Total cable length (L)		
AWG	mm <sup>2</sup>	$L \leq 328 \text{ ft (100 m)}$	$328 \text{ ft (100 m)} \leq L \leq 820 \text{ ft (250 m)}$	$820 \text{ ft (250 m)} \leq L \leq 1,640 \text{ ft (500 m)}$
16	1.25	4	4	4
18	0.75 ( $1.25 > S \geq 0.75$ )	4	4	2
20	0.5 ( $0.75 > S \geq 0.5$ )	4	2	2
22	0.3 ( $0.5 > S \geq 0.3$ )	4	1	1




## 5. Drain connection

### 5-1. Outdoor unit

- The drain water is discharged from the bottom of the unit. Construct the foundation such that water drains away from the unit properly.
- When installing on a roof, make sure that the roof is properly waterproofed.

#### **⚠ CAUTION**

- The drain water from the base of the outdoor unit may generate during operations.
- Perform drain processing, as necessary.
- When you want to prevent the drain water from leaking at the perimeter, construct a ditch for the drain water as shown in the figure below.
- Provide a central drain pan, as necessary.


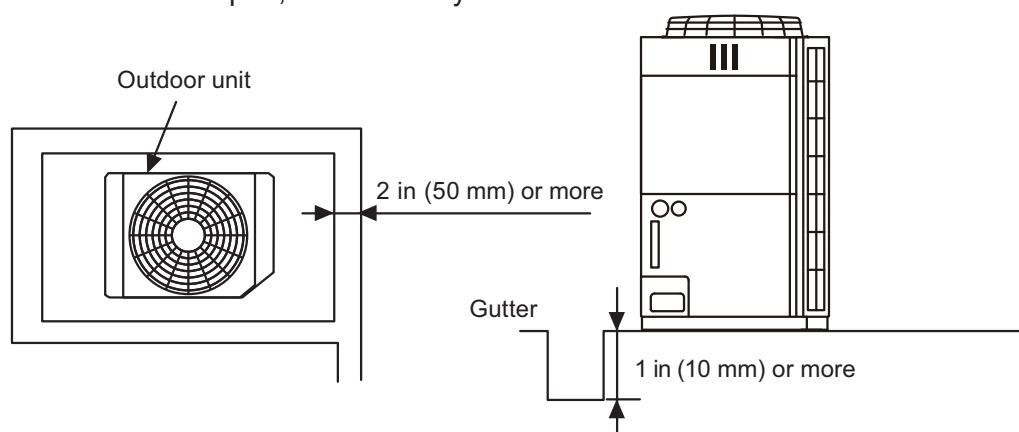


## 5-2. Indoor unit

### ■ General rules of drain piping



- Install the drain pipe with downward slope (1/100 or more) and so there are no rises in the pipe.
- Use general hard polyvinyl chloride pipe ( ) and connect it with adhesive (polyvinyl chloride) so that there is no leakage.
- Support the drain pipe with supports each 60 to 79 in (1.5 to 2.0 m).
- Do not install any air vents or traps.
- Always insulate the drain pipe to prevent condensation.
- When connecting the drain hose to the indoor unit, use the accessory band. (Except wall mounted type)

### ■ Compact cassette type

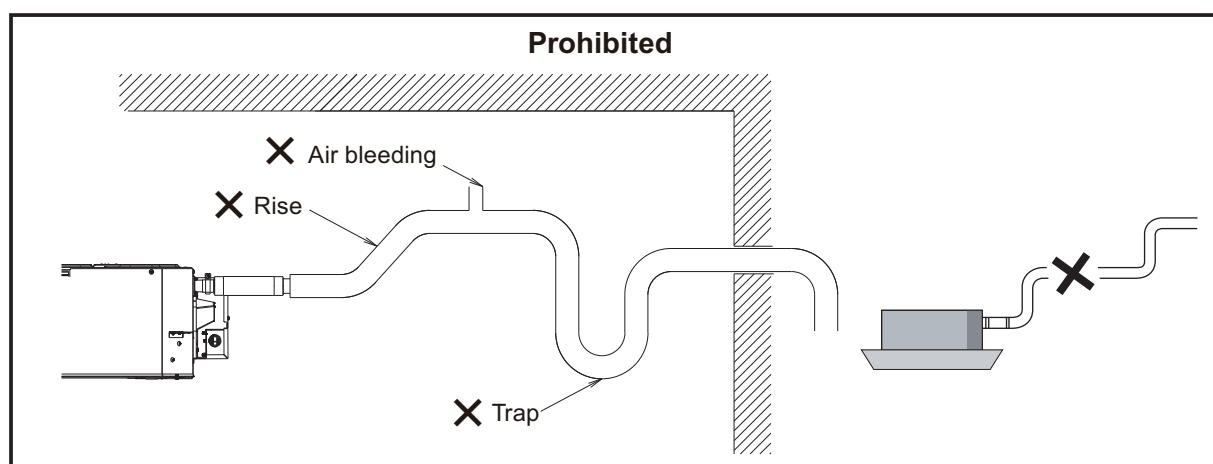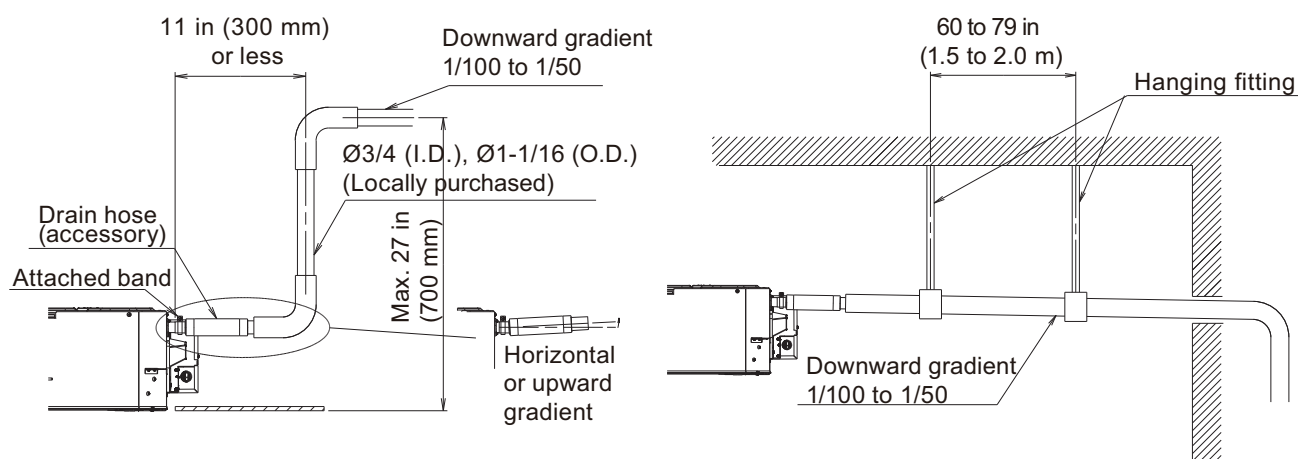




- Drain lift-up pipe restrictions:
  - Lift-up height  $\leq$  27 in (700 mm) (from ceiling)
  - Drain hose (pipe) length  $\leq$  11 in (300 mm) (between indoor unit and lift-up pipe)
- Water leakage may result from a failure to adhere to the restrictions above.

## ■ Circular flow cassette type and 4-way flow cassette type

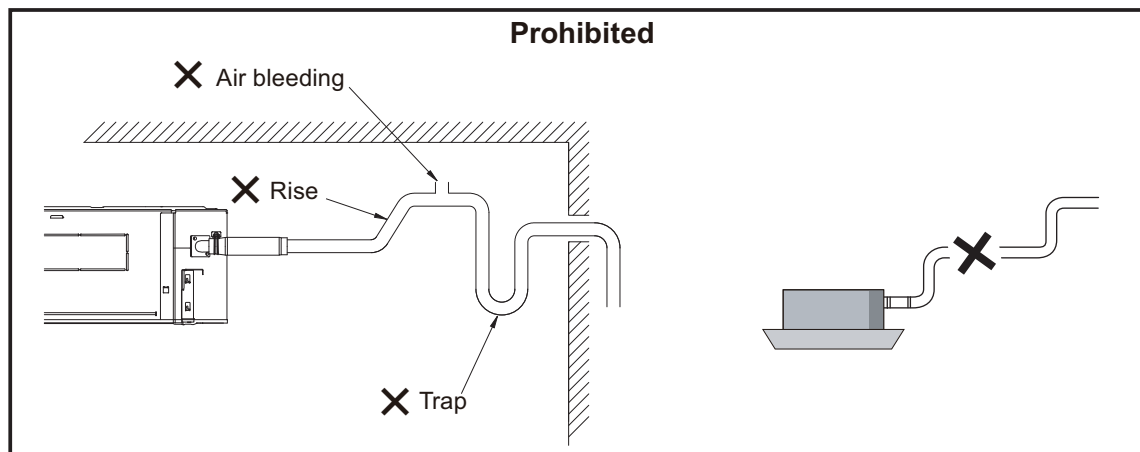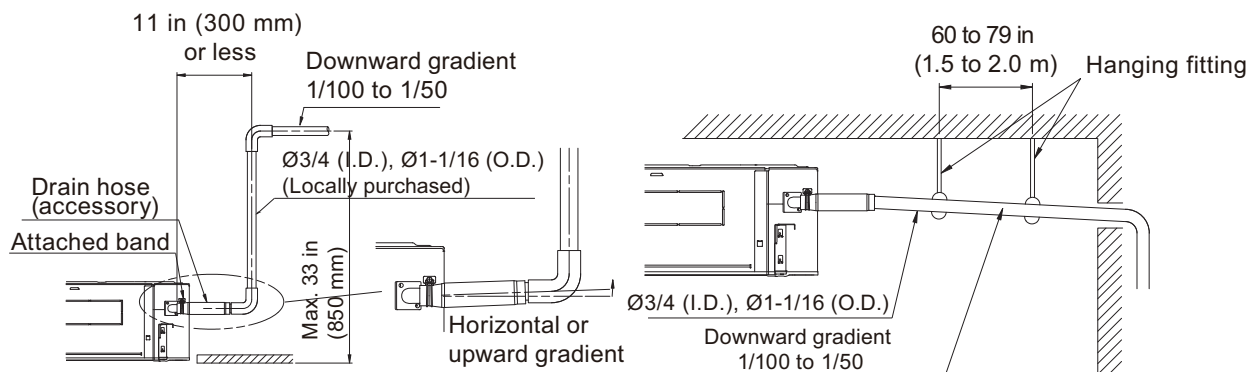

- Drain lift-up pipe restrictions:
  - Lift-up height  $\leq$  33 in (850 mm) (from ceiling)
  - Drain hose (pipe) length  $\leq$  11 in (300 mm) (between indoor unit and lift-up pipe)
- Water leakage may result from a failure to adhere to the restrictions above.





## ■ Mini duct type

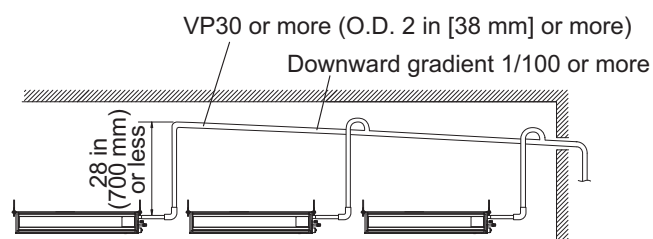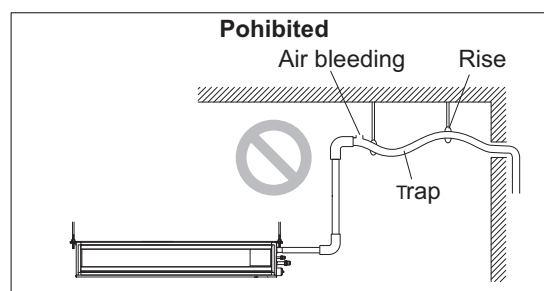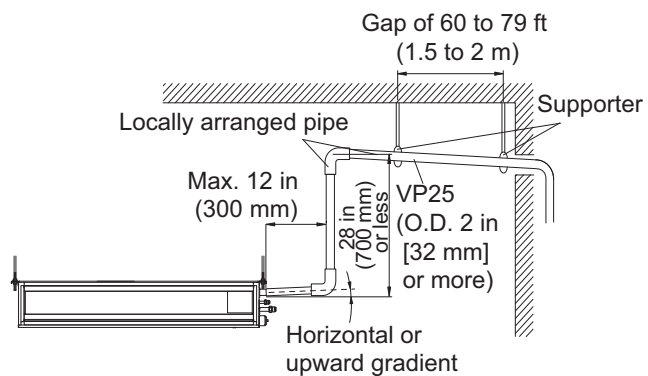



- Use general hard polyvinyl chloride pipe (VP25) (O.D. 2 in [32 mm]).
- Do not perform a rise, trap, and air bleeding.
- Provide a downward gradient (1/100 or more).
- Provide supporters when long pipes are installed.
- Use an insulation material as needed to prevent the pipes from freezing.
- Install the pipes in a way that allows for the removal of the control box.

## ■ Slim duct/Slim concealed floor type

### • Ceiling concealed setting

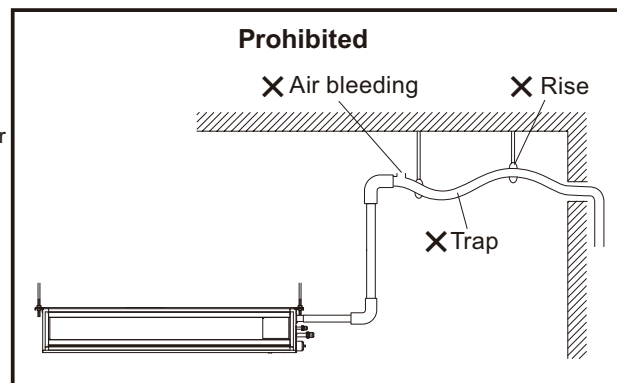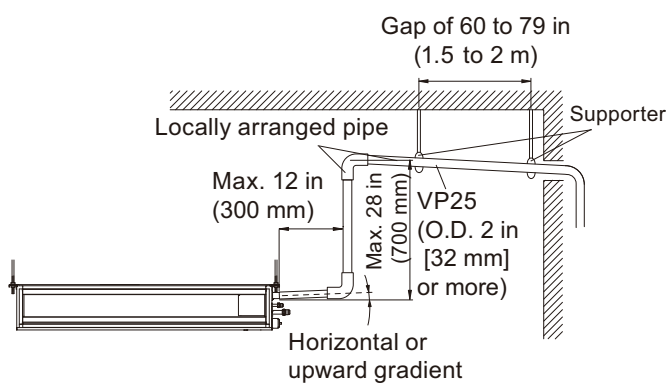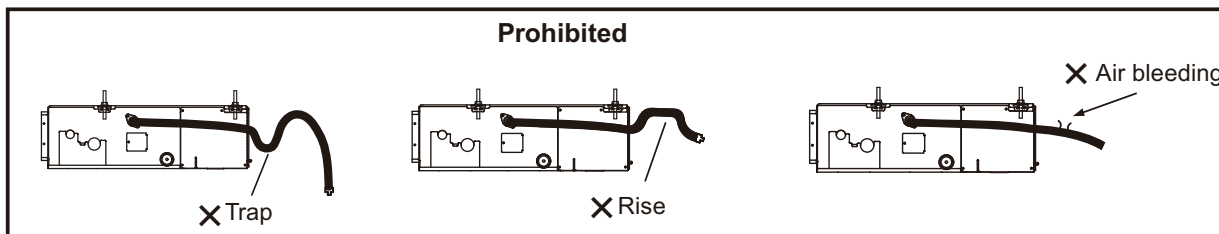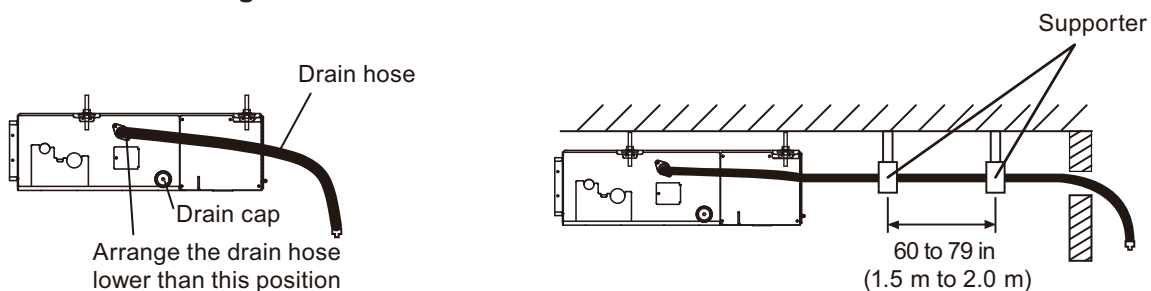


### • Floor standing concealed setting

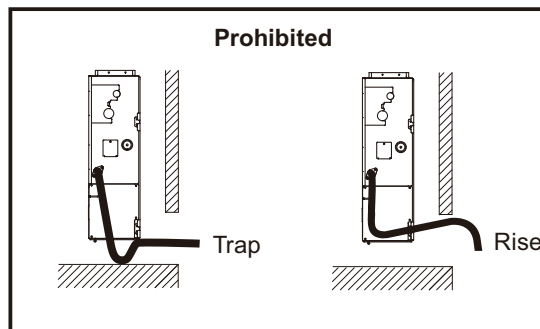



- Install the drain pipe with downward gradient (1/100 or more) and so there are no rises or traps in the pipe.
- Use general hard polyvinyl chloride pipe (VP25) (O.D. 2 in [32 mm]) and connect it with adhesive (polyvinyl chloride) so that there is no leakage.
- When the pipe is long, install supporters.
- Do not perform air bleeding.
- Always heat insulate the indoor side of the drain pipe.

## ■ Medium static pressure duct type

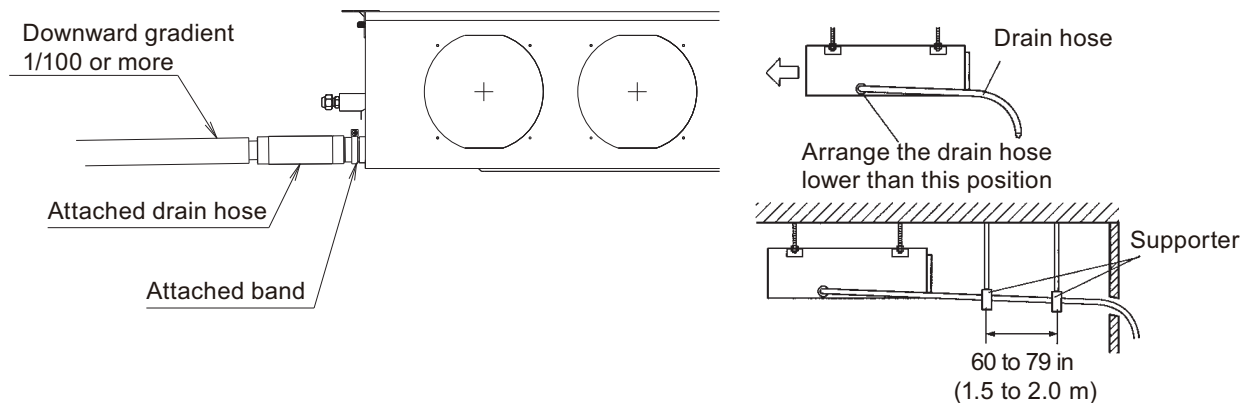

There is a drain port on the left and right sides. Select the drain port to match the local conditions.

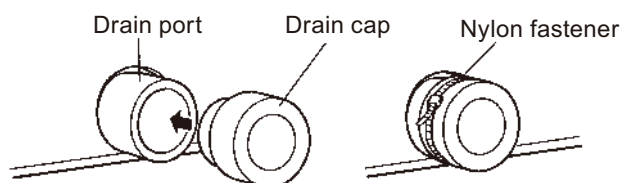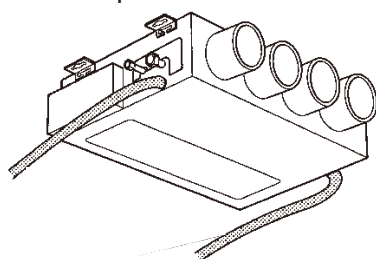


### ⚠ CAUTION

- Always check that the drain cap is installed to the unused drain port and fastened with the nylon fastener.
- If the drain cap is not installed, or is not sufficiently fastened by the nylon fastener, water may drip during the cooling operation.

## ■ High static pressure duct type


### • Main drain pipe

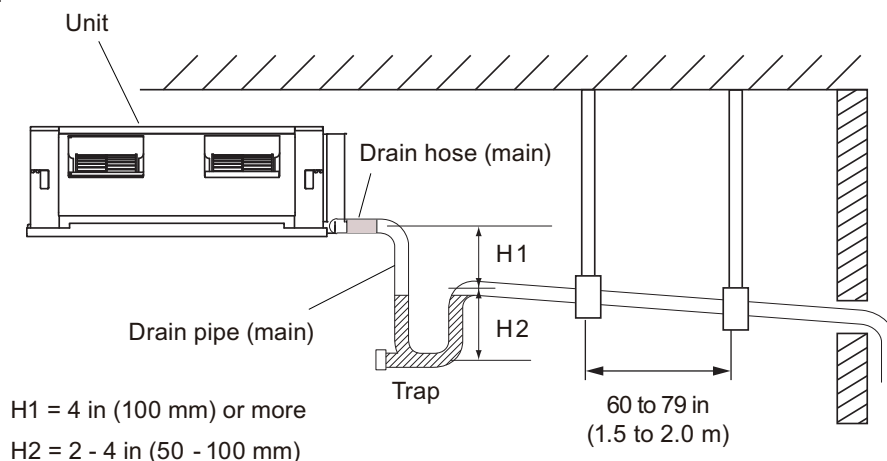

- Be sure to provide a drain trap for each indoor units.
- The drain trap will have no effect if placed after multiple indoor units.
- The position of the installed drain hose should have a downward slope of 1/100 or more.
- Make sure that the drain hose is installed without rises.
- Make the trap near to the indoor unit, position the trap in a location where it can be cleaned.


### • Safety drain pipe

There is no need to provide a trap for the overflow drain. If the overflow drain is connected to the main drain pipe, make the connection below the trap on the main drain pipe. Once installation is completed, checked the flow of the drain water.

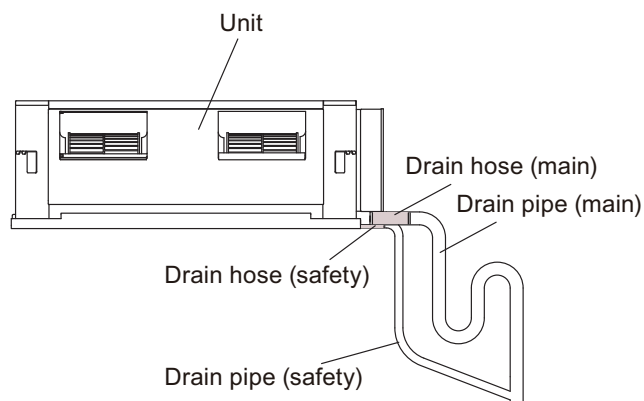


## ■ Floor/Ceiling type


### • Under ceiling setting

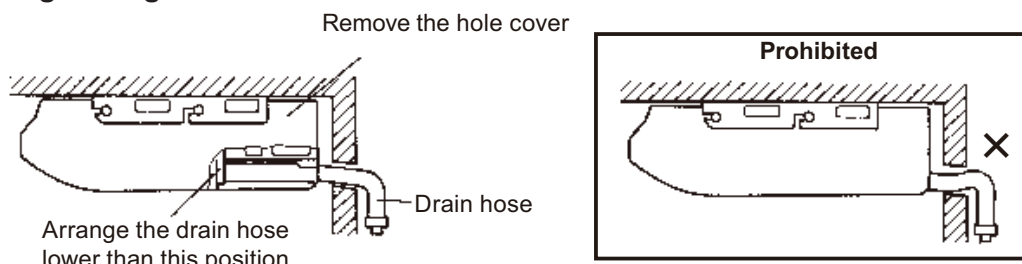

When drain hose is arranged backward, secure the drain hose with the VT wire.

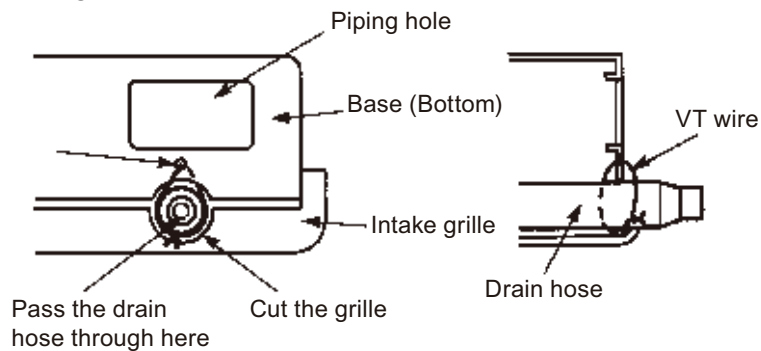


### • Floor console setting

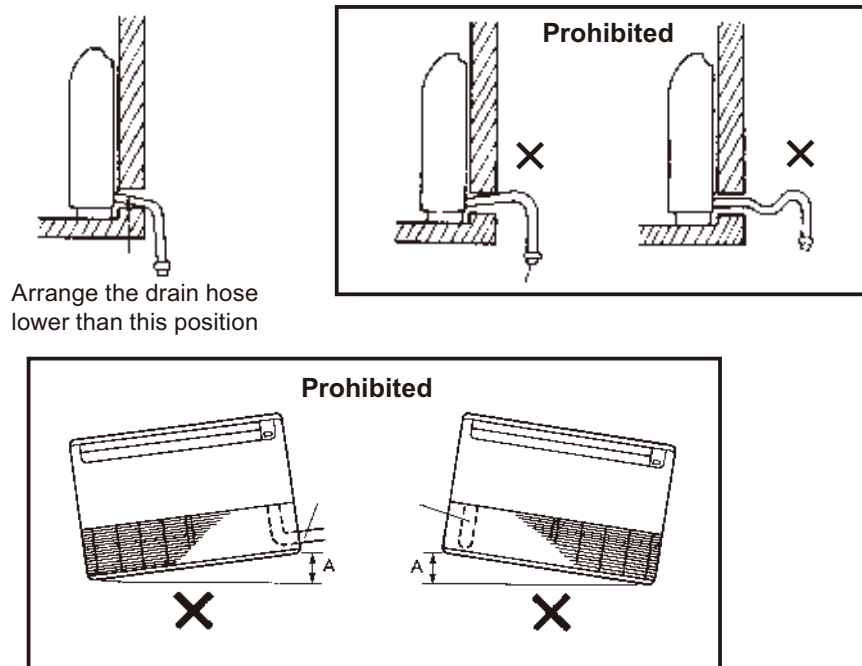


- Do not install the unit so that the drain hose side is too high.
- Height A should be less than 3/16 in (5 mm).




## ■ Ceiling type

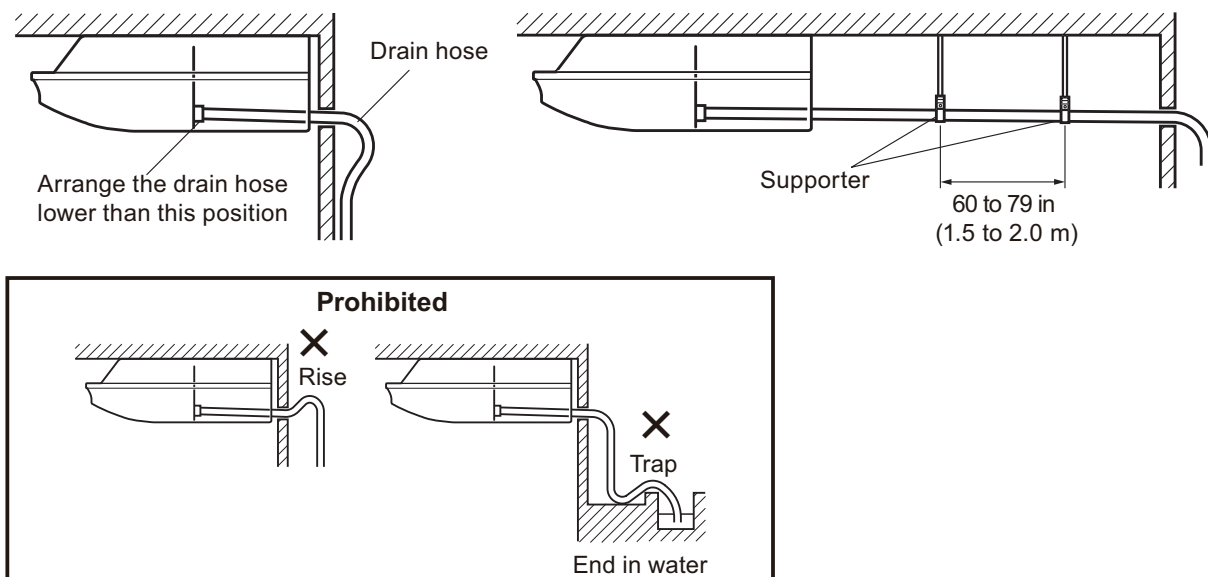







Fasten the drain pipe with VT wire so that the pipe slopes correctly within the indoor unit.

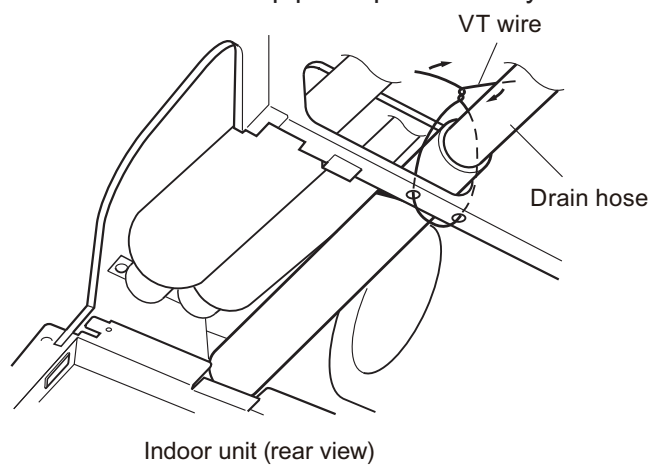

## ■ Compact floor type

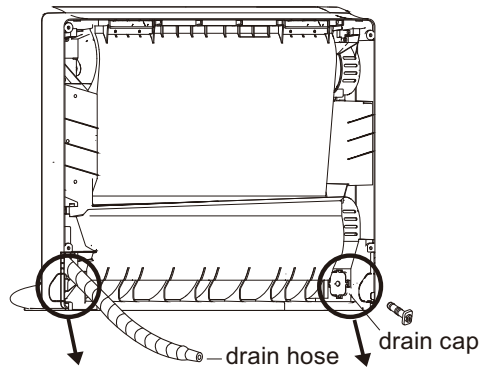


The drain hose can be connected at either side of the indoor unit.

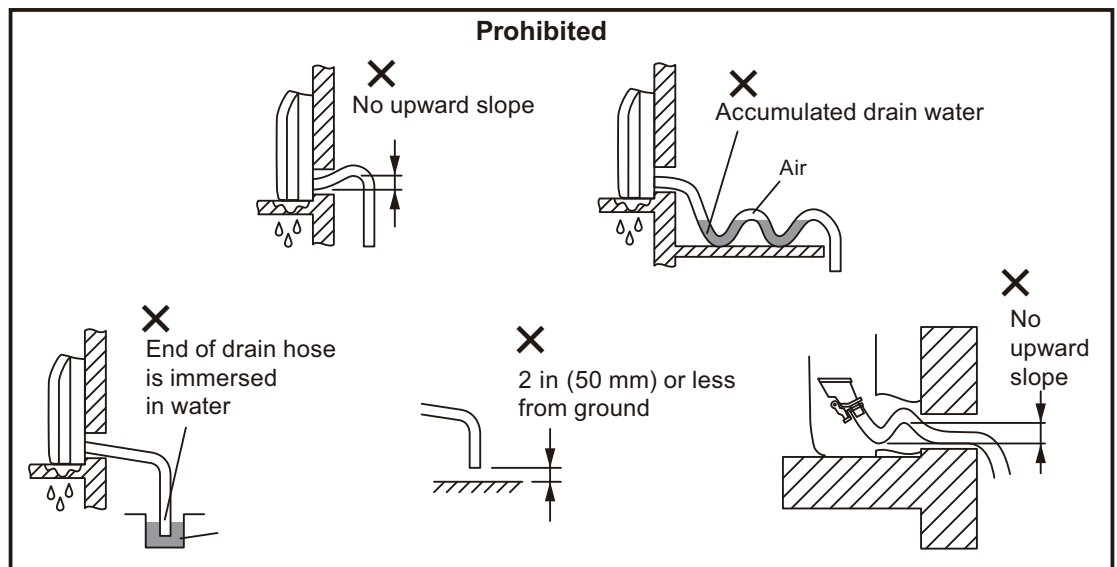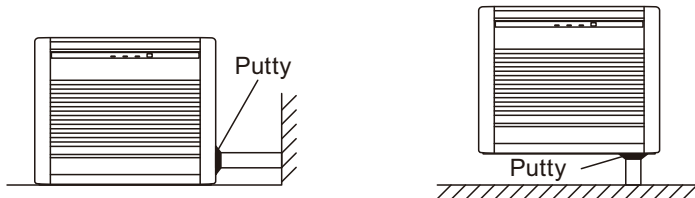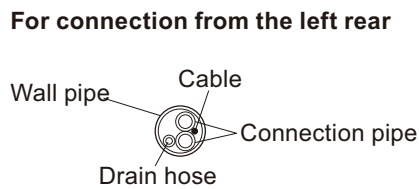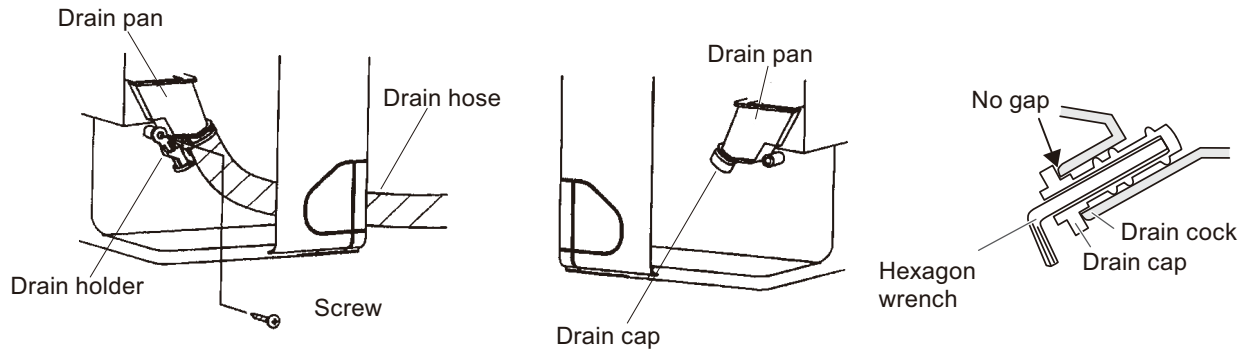


## ■ Wall mounted type

### • Models: ASUB18TLAV1 and ASUB24TLAV1

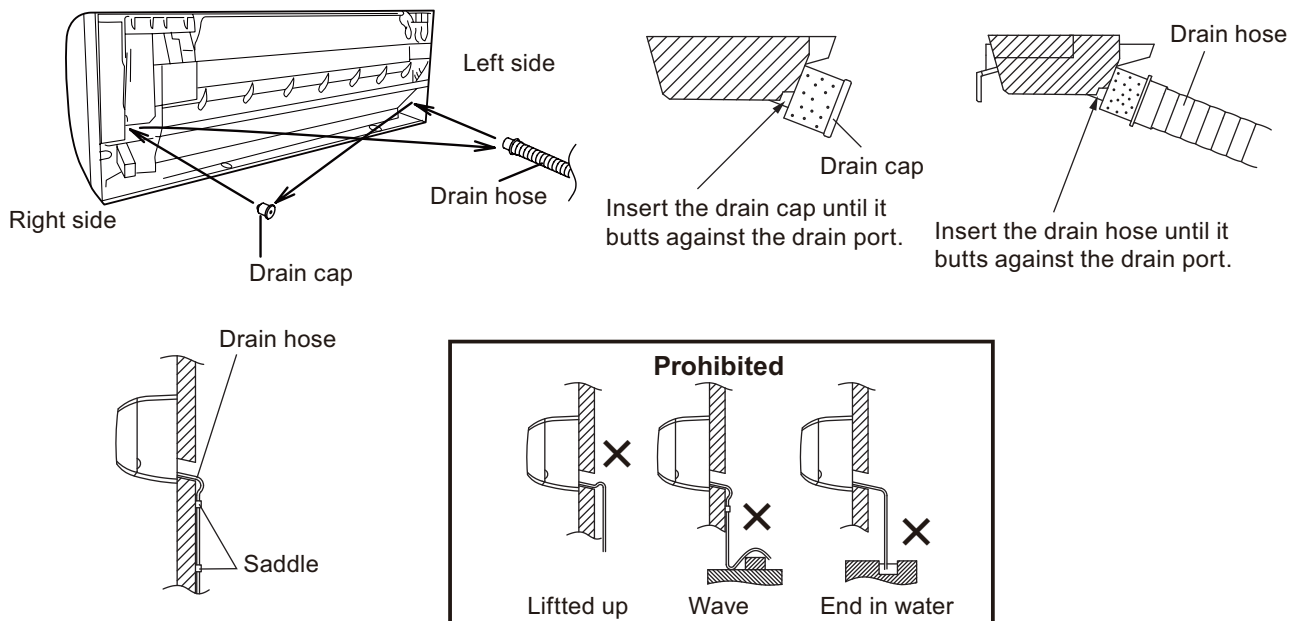



### • Other than ASUB18TLAV1 and ASUB24TLAV1

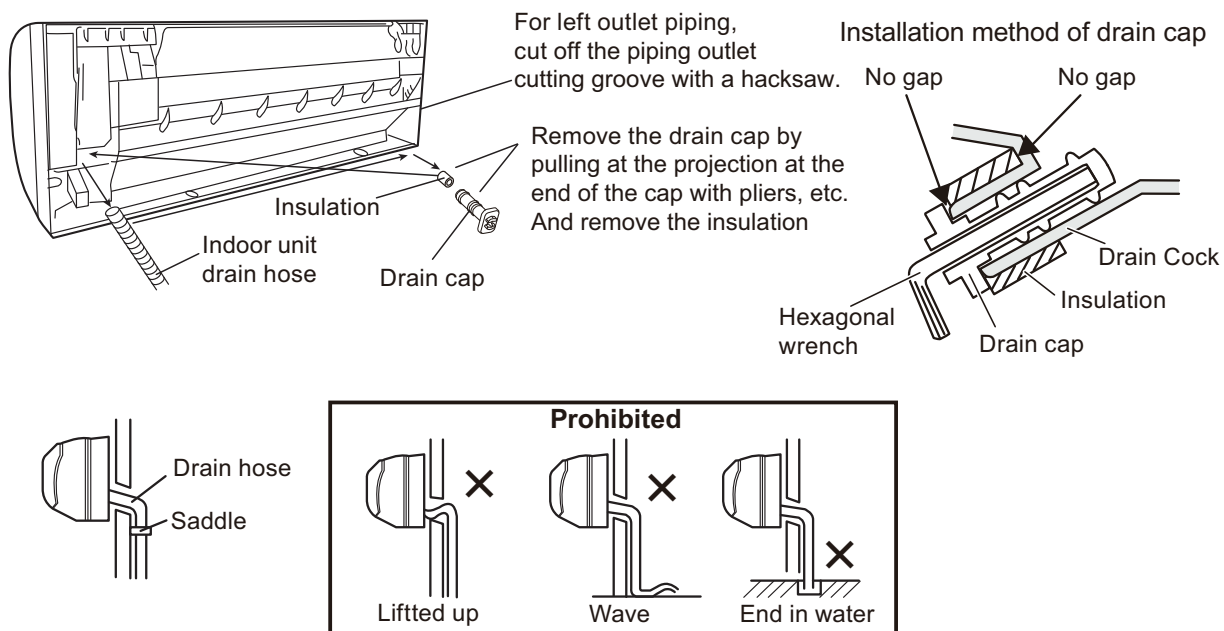

## ■ Central drain process


When conveying multiple drain pipes, install according to the procedure shown below.

- For Compact cassette type, and Circular flow cassette type, and 4-way flow cassette type

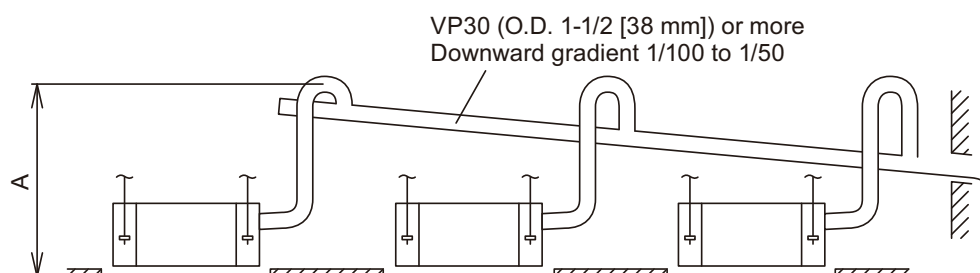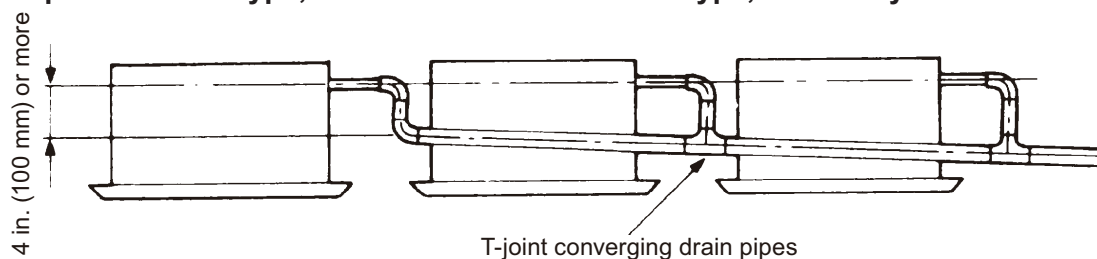


A	Compact cassette type	28 in (700 mm) or less
	Circular flow cassette type	34 in (850 mm) or less
	4-way flow cassette type	34 in (850 mm) or less

- For High static pressure duct type

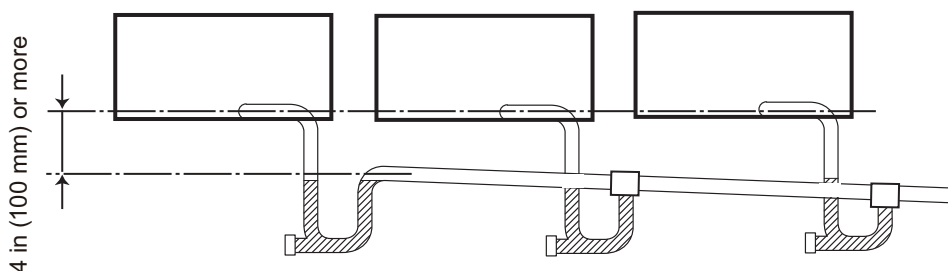


- For Mini duct type and Slim duct type

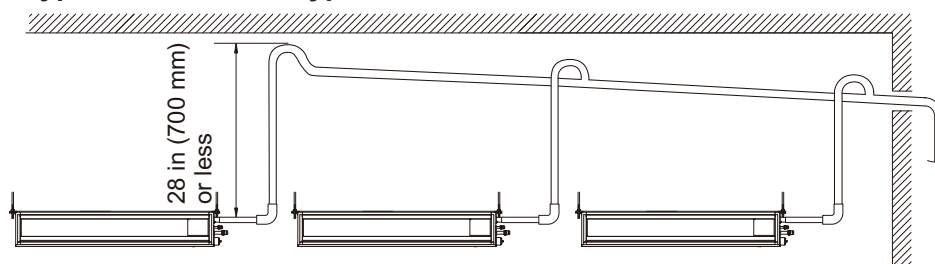


Select converging drain pipes whose diameter is suitable for the operating capacity of the unit.

## ■ Drain insulation

- Confirm water flows into drain pan of the indoor unit and drains from the pan once the drain hose is connected.
- Check drain pipes for leaks.
- Insulate the drain to prevent condensation.
- Secure the drain pipe to the wall with a saddle.

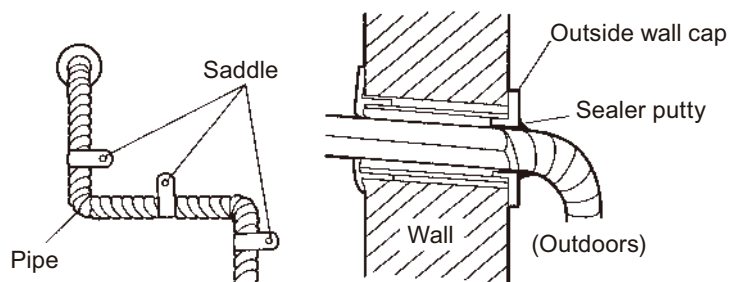

- Seal the hole around drain pipe with caulk.

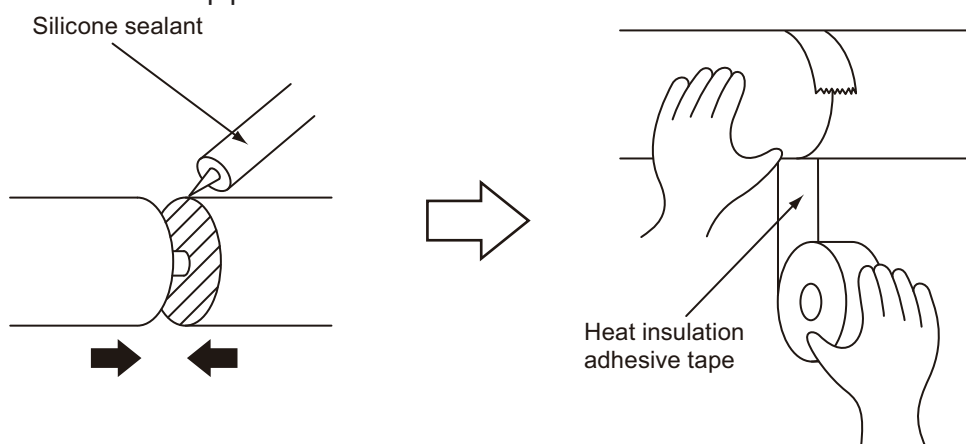

- Be sure to coat the entire end surface. If there is a gap it could cause condensation.





## 7. FUNCTION SETTINGS

# CONTENTS

## 7. FUNCTION SETTINGS

<b>1. System settings</b>	<b>07-1</b>
1-1. System type setting	07-2
1-2. Address setting	07-4
1-3. Manual address setting method	07-9
1-4. Address setting by remote controller	07-18
1-5. Automatic address setting	07-52
1-6. Terminal resistor setting	07-60
<b>2. Function settings</b>	<b>07-61</b>
2-1. Setting on outdoor unit PCB	07-62
2-2. Setting on indoor unit PCB	07-70
2-3. Setting by service tool (UTY-ASGXZ1)	07-77
2-4. Indoor unit (setting by wireless remote controller)	07-81
2-5. Indoor unit (setting by UTY-RNKU)	07-87
2-6. Indoor unit (setting by UTY-RSRY, UTY-RHRY)	07-90
2-7. Indoor unit (setting by UTY-RSKU, UTY-RHKU)	07-93
2-8. Indoor unit (setting by UTY-RNRUZ*)	07-96
2-9. Function details	07-99
2-10. Wired remote controller (UTY-RNKU)	07-104
2-11. Simple remote controller (UTY-RSKU, UTY-RHKU)	07-106
2-12. Touch panel controller	07-108
2-13. Central remote controller (UTY-DCGYZ*)	07-109
2-14. Wired remote controller (Touch panel)	07-111
2-15. Simple remote controller (UTY-RSRY, UTY-RHRY)	07-115
2-16. Network convertor (UTY-VTGX)	07-117
2-17. Network convertor (UTY-VGGXZ1)	07-119
2-18. Signal amplifier	07-121
2-19. KNX convertor for VRF	07-123
2-20. KNX convertor for Indoor unit	07-125
2-21. Modbus converter for VRF	07-126
2-22. Modbus converter for indoor unit	07-129
2-23. Network converter for LonWorks	07-131
2-24. Duct static pressure setting	07-132
2-25. Administrative indoor unit setting	07-133
2-26. Energy saving setting on System controller	07-135
2-27. Electricity charge apportionment setting (System controller, Touch panel controller)	07-141



# 1. System settings

Set each switch to the corresponding system type as described in the accompanying explanation, and do not use a nonexistent switch combination.

## CAUTION

- Perform the system type setting and address setting, before turning on the power.
- For proper operation of the air conditioner, perform the setting as described in the instruction.

## RELATED LINKS

["System type setting"](#) on page 07-2

["Address setting"](#) on page 07-4

["Manual address setting method"](#) on page 07-9

["Address setting by remote controller"](#) on page 07-18

["Automatic address setting"](#) on page 07-52

["Terminal resistor setting"](#) on page 07-60

# 1-1. System type setting

Other than the units mentioned below, refer to ["Function settings"](#) on page 07-61 and the installation manual.

## ■ Outdoor unit setting

(◆: Factory setting)

<Step 1>  
Outdoor unit address setting

### Setting for master unit and slave unit:

Set the DIP switch SET3-1 and 3-2.

- Master: SET3-1 OFF, SET3-2 OFF ◆
- Slave 1: SET3-1 OFF, SET3-2 ON
- Slave 2: SET3-1 ON, SET3-2 OFF



<Step 2>  
Slave units number setting

### Setting for master unit only:

Set the DIP switch SET3-3 and 3-4.

1. SET3-3 OFF, SET3-4 OFF: Master × 1 ◆
2. SET3-3 OFF, SET3-4 ON: Master × 1, Slave × 1
3. SET3-3 ON, SET3-4 OFF: Master × 1, Slave × 2



<Step 3>  
Number setting of installing outdoor units

### Setting for master unit and slave unit:

Set the DIP switch SET5-1 and 5-2.

1. SET5-1 OFF, SET5-2 OFF: Number of 1 ◆
2. SET5-1 OFF, SET5-2 ON: Number of 2
3. SET5-1 ON, SET5-2 OFF: Number of 3



<Step 4>  
Refrigerant circuit address setting

### Setting for master unit and slave unit:

Set the rotary switch REF AD x10 and x1.

For details of switch, refer to ["Address setting"](#) on page 07-4.



<Step 5>  
Terminal resistor setting

### Setting for master unit and slave unit:

Set the DIP switch SET5-4.


For details of switch, refer to ["Terminal resistor setting"](#) on page 07-60.



<Step 6>  
Function setting

## ■ Indoor unit setting

For the actual switch positions, refer to ["Function settings"](#) on page 07-61.

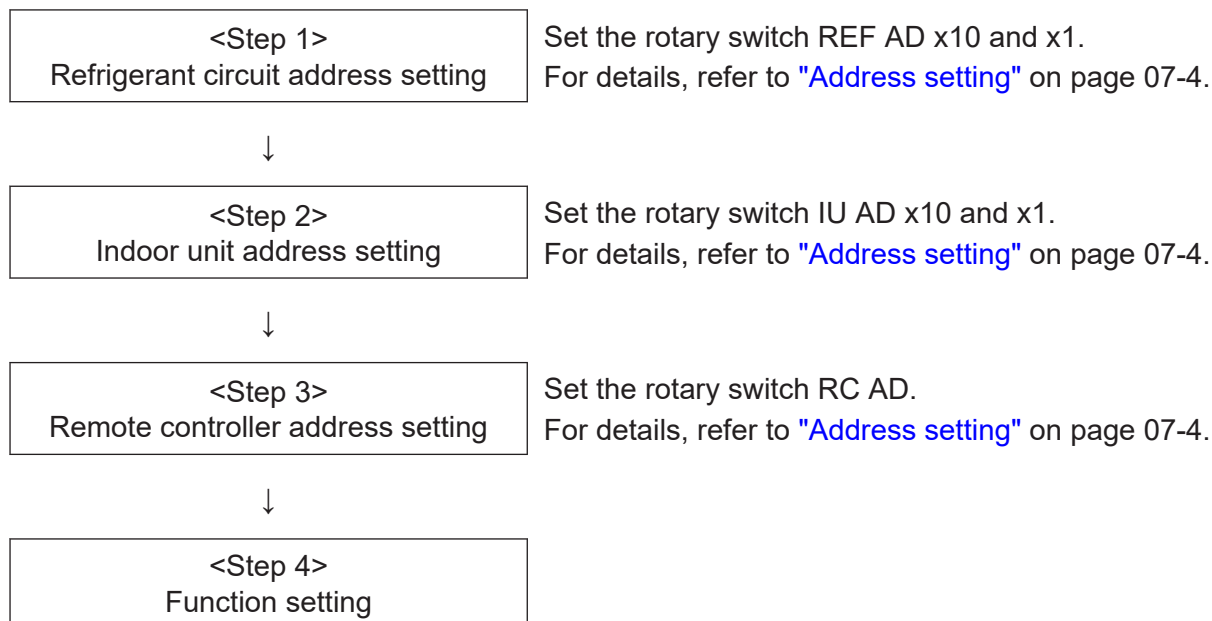

## ■ Remote controller setting




(Only for Wired remote controller and Simple remote controller.)

Dual remote controller setting	Set the SW2 of DIP switch 1. For details, refer to <a href="#">"Function settings"</a> on page 07-61.
--------------------------------	--





## 1-2. Address setting

Address for each unit should be preset before starting system operation. Refer to ["System design"](#) in Chapter 6. SYSTEM DESIGN on page 06-1 to confirm the details of each unit, and perform the setting.

### ■ Outdoor unit addresses and setting ranges

Setting		Setting range	Type of switch	Remarks
A	Refrigerant circuit address	00—99	Setting example 01 	Arbitrary numbers can be set in range of 00—99.
B	Outdoor unit address	0—2	 SET3	DIP switch SET3-1 DIP switch SET3-2
C	Number of slave unit	0—2		DIP switch SET3-3 DIP switch SET3-4 (Master unit only)
L	Number of outdoor units installed	1—3	 SET5	DIP switch SET5-1 DIP switch SET5-2
	Terminal resistor	ON/OFF		DIP switch SET5-4 Refer to <a href="#">"Terminal resistor setting"</a> on page 07-60.

## Indoor unit addresses and setting ranges

Setting	Setting range	Type of switch	Remarks
D	Refrigerant circuit address	00—99	<b>Manual address setting:</b>  Setting example 01  
			Arbitrary numbers can be set in range of 00—99.
			<b>Wireless R. C.:</b> This switch is set to 00 at factory setting.
			<b>Wired R. C. (3-wire type):</b> This switch is set to 00 at factory setting.
			<b>Simple R. C.:</b> This switch is set to 00 at factory setting.
			<b>Wired R. C. (2-wire type):</b> This switch is set to 00 at factory setting.
E	Indoor unit address	00—63	<b>Automatic address setting:</b> This switch is set to 00 at factory setting.
			<b>Manual address setting:</b>  Setting example 12  
			Arbitrary numbers can be set in range of 00—63.
			<b>Wireless R. C.:</b> This switch is set to 00 at factory setting.
			<b>Wired R. C. (3-wire type):</b> This switch is set to 00 at factory setting.
			<b>Simple R. C.:</b> This switch is set to 00 at factory setting.
F	Remote controller address	00—15	<b>Wired R. C. (2-wire type):</b> This switch is set to 00 at factory setting.
			<b>Automatic address setting:</b> This switch is set to 00 at factory setting.
			<b>Manual address setting:</b>  Setting example 10 
			<b>Wireless R. C.:</b> This switch is set to 0 at factory setting.
			3-wire type R. C. can be set in range of 0—15.
			2-wire type only.

## ■ Addresses and setting ranges for controllers, convertors or other devices

Unit	Setting		Setting range	Type of switch	Setting references
Touch panel controller	G	Controller address	00—15 *1	<b>Automatic address setting:</b> This switch is set to 00 at factory setting.	"Touch panel controller" on page 07-108
Network converter	H	Convertor address	00—15 *1		"Network converter (UTY-VTGX)" on page 07-117 and "Network converter (UTY-VGGXZ1)" on page 07-119
		Refrigerant circuit address	00—99	Setting example 01  SW 110 (10 digit) SW 111 (1 digit)	
Wired, simple remote controller (3-wire type)	J	Dual remote control	ON/OFF	Switch 2 of DIP switch 1	"Wired remote controller (UTY-RNKU)" on page 07-104 "Simple remote controller (UTY-RSKU, UTY-RHKU)" on page 07-106
Signal amplifier	K	Signal amplifier address	1—8	<b>Manual address setting</b>	"Signal amplifier" on page 07-121
				<b>Automatic address setting:</b> This switch is set to 1 at factory setting.	"Automatic address setting of signal amplifier" on page 07-54
Modbus converter	Q	Controller/ convertor address	00—15 *1		"Modbus converter for VRF" on page 07-126
Network converter for LonWorks	M				"Network converter for LonWorks" on page 07-131
Central remote controller	N				"Central remote controller (UTY-DCGYZ*)" on page 07-109
Wired remote controller (2-wire type)	F	Remote controller address	1—32 *2 0—15	<b>Manual address setting</b> <b>Automatic address setting</b>	"Wired remote controller (Touch panel)" on page 07-111
	J	Dual remote control	ON/OFF		


\*1: The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.


**NOTE:** For Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks connected in same VRF network system, set an exclusive address on each device.

\*2: The address can be set in the range of 1 to 32. However, do not set the same number as that for the remote controller address of an indoor unit connected using the same remote-control cable.

Set the remote controller address of 2-wire type remote controller in manual address setting only. It is not necessary to set in automatic address setting.

## Setting example

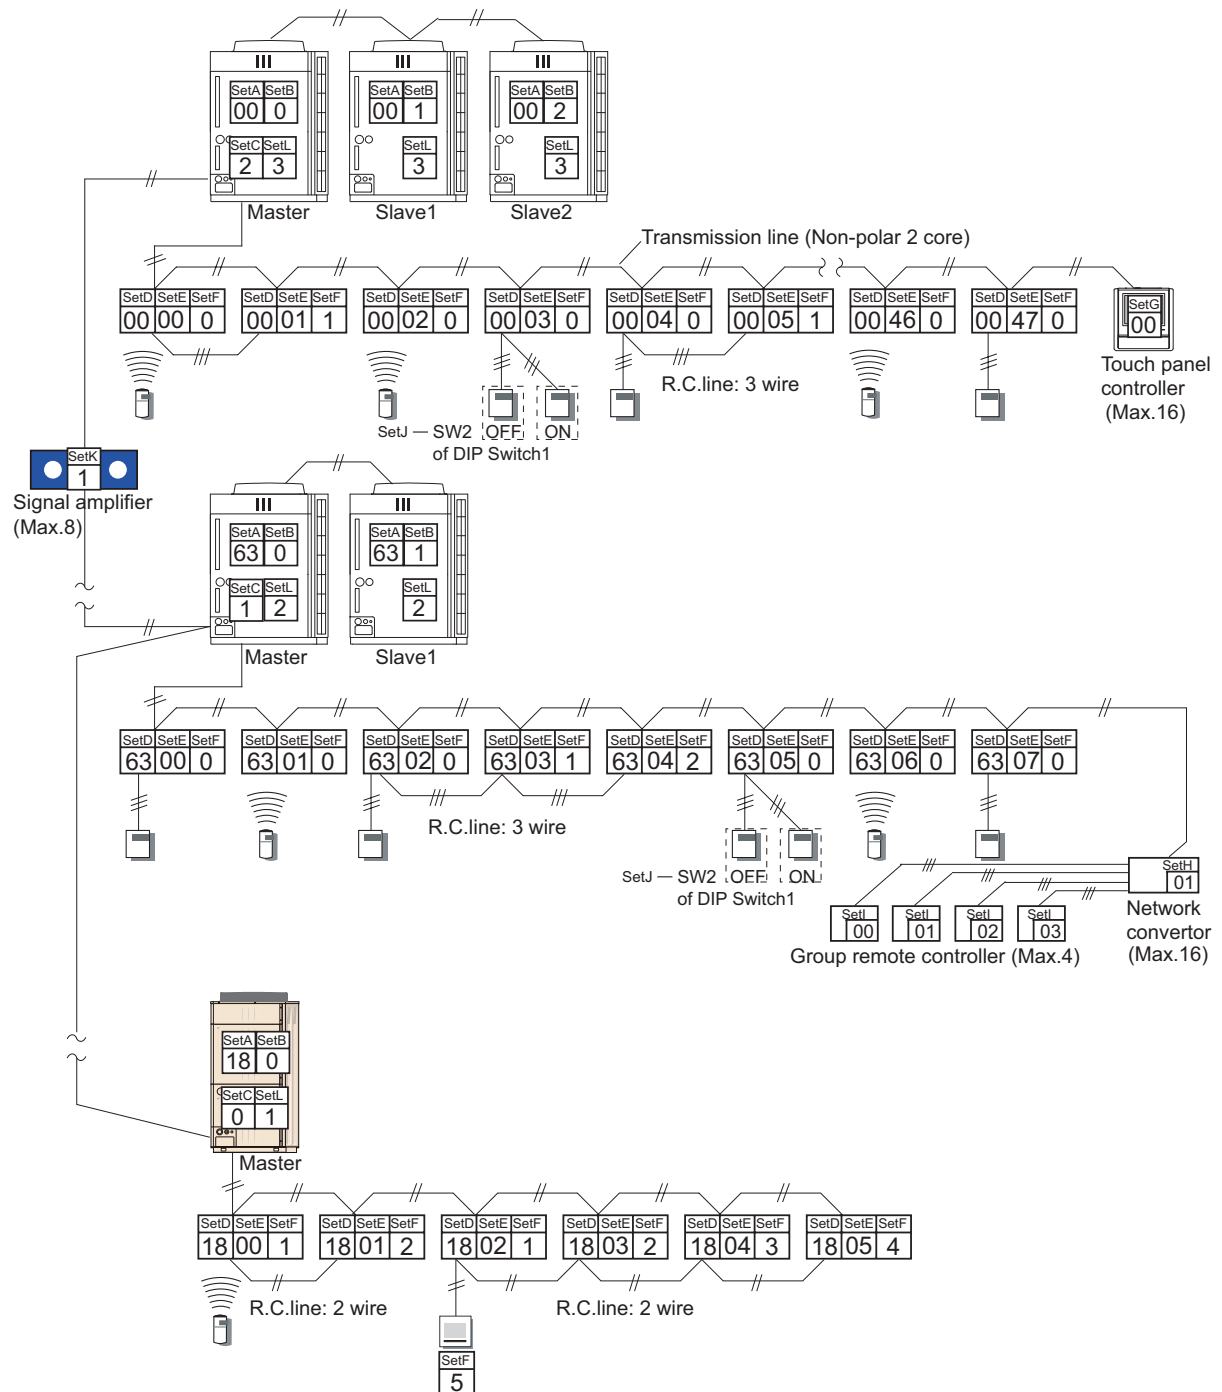

Setting subject		Set	Application	Remarks						
Outdoor unit		Set A	Refrigerant circuit address	Rotary switch REF AD x10, x1						
		Set B	Outdoor unit address	DIP switch SET3-1, 3-2						
		Set C	Number of slave unit	DIP switch SET3-3, 3-4 (Master unit only)						
		Set L	Number of outdoor units installed	DIP switch SET5-1, 5-2						
Indoor unit	<table border="1"><tr><td>SetD</td><td>SetE</td><td>SetF</td></tr><tr><td>63</td><td>06</td><td>0</td></tr></table>	SetD	SetE	SetF	63	06	0	Set D	Refrigerant circuit address	REF AD x10 REF AD x1
		SetD	SetE	SetF						
		63	06	0						
		Set E	Indoor unit address	IU AD x10 IU AD x1						
Set F	Remote controller address	RC AD								
Wired remote controller (2-wire)		Set F	Remote controller address	Self: 0 (Fixed)						
Touch panel controller		Set G	Controller address	Max. 16						
Network converter		Set H	Refrigerant circuit address	For single split AC: Max. 100						
Wired, simple remote controller (3-wire)		Set J	Dual remote control	Switch 2 of DIP switch 1						
Signal amplifier		Set K	Signal amplifier address							
Network convertor for LonWorks		Set M	Convertor address							
Central remote controller		Set N	Controller address	Max. 16						

### Instructions for setting the address:

- The refrigerant circuit address of the indoor units and outdoor units can be set to arbitrary numbers in the range of 0 to 99.
- The indoor unit address can be set to arbitrary numbers in the range of 0 to 63.
- In case of 3-wire type of remote controller, set the remote controller address in the order of 0, 1, 2.....15. (Blank is not allowed.)
- In the automatic address setting of 2-wire type remote controller, the remote controller address is set to "0" automatically.
- In the manual address setting of 2-wire type remote controller, the remote controller address can be set to arbitrary numbers in the range of 1 to 15. (Setting to "0" is prohibited.)
- Touch panel controller address can be set to arbitrary numbers in the range of 0 to 15.
- The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.
- For Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks connected in same VRF network system, set an exclusive address on each device.




## 1-3. Manual address setting method

### ■ Address setting description







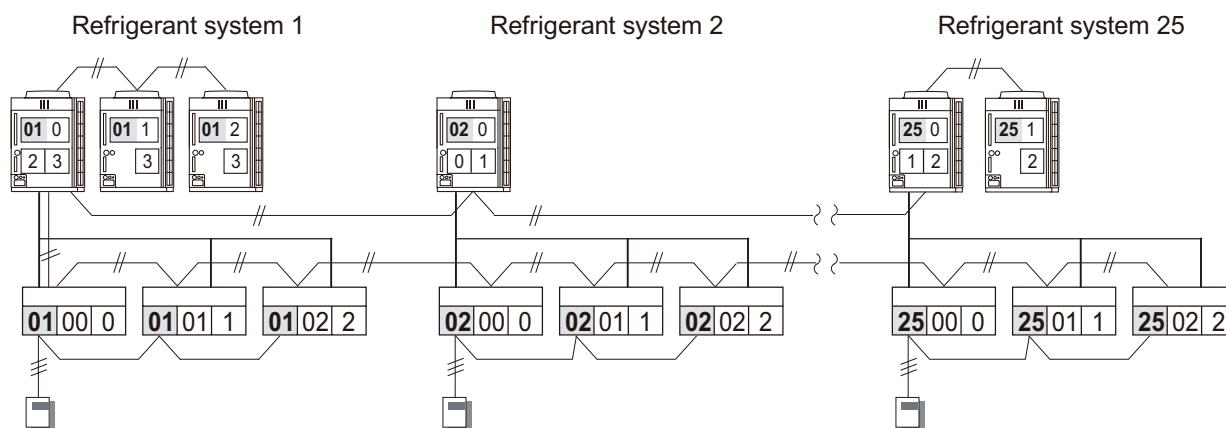









- **Refrigerant circuit address (Set A and Set D)**

When there are 2 or more refrigerant systems in one VRF network system, an exclusive refrigerant circuit address should be set for each refrigerant system.

Refrigerant system: One refrigerant circuit which has connected between outdoor unit and indoor unit by piping.



- **Setting example**

	Outdoor unit (Set A)		Indoor unit (Set D)	
Refrigerant circuit address	Rotary switch setting		Rotary switch setting	
	REF AD x10	REF AD x1	REF AD x10	REF AD x1
01	 0	 1	 0	 1
11	 1	 1	 1	 1
25	 2	 5	 2	 5
50	 5	 0	 5	 0




- Setting range: 00—99 (Arbitrary numbers can be set.)
- Same address should be set in all the indoor unit and outdoor unit in the same refrigerant circuit.

- **Outdoor unit address (Set B)**

Set the outdoor unit address for each outdoor unit.

In 1 outdoor unit system, no field setting is required since the outdoor unit is preset to "0" at factory setting.







When 2 or 3 outdoor units are connected in the same refrigerant circuit, set the slave unit which has been installed farther from the master unit to Slave 2 with setting "2".

				
		Master	Slave1	Slave2
Outdoor unit address		0	1	2
DIP switch	SET3-1	OFF	OFF	ON
	SET3-2	OFF	ON	OFF
Factory setting		◆		

- **Number of slave unit (Set C)**

Set the number of slave unit on the master unit PCB.







**NOTE:** This setting should be performed only on the master unit PCB.

Number of slave unit		0	1	2
Master				
Slave1		—		
Slave2		—	—	
DIP switch	SET3-3	OFF	OFF	ON
	SET3-4	OFF	ON	OFF
Factory setting		◆		

- **Number of outdoor units installed (Set L)**


The number of outdoor units installed in one refrigerant system must be set.







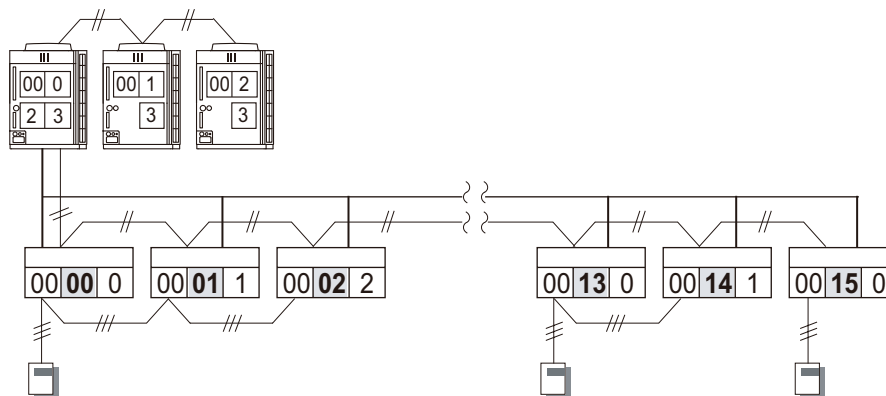

**NOTE:** This setting is required for all outdoor units.

Number of outdoor unit		1	2	3
Master				
Slave1		—		
Slave2		—	—	
DIP switch	SET5-1	OFF	OFF	ON
	SET5-2	OFF	ON	OFF
Factory setting		◆		

### • Indoor unit address (Set E)

An exclusive indoor unit address should be set for each indoor unit in the same refrigerant system.



Indoor unit address	Rotary switch setting	
	IU AD x10	IU AD x1
03	 0	 3
11	 1	 1
30	 3	 0
47	 4	 7


- Setting range: 00—63 (Arbitrary numbers can be set.)
- Do not set indoor unit address to the range of 64—99.
- Do not set the same address number to 2 or more indoor units.

- **Remote controller address (Set F)**

Maximum of 16 indoor units can be controlled by 1 individual remote controller with connecting remote controller cable.

Those units connected with remote controller cable are regarded as a remote controller group. Even there is only 1 indoor unit with one or no wired controller is connected, it is regarded as one remote controller group.

- **3-wire type (Only for manual address setting):**

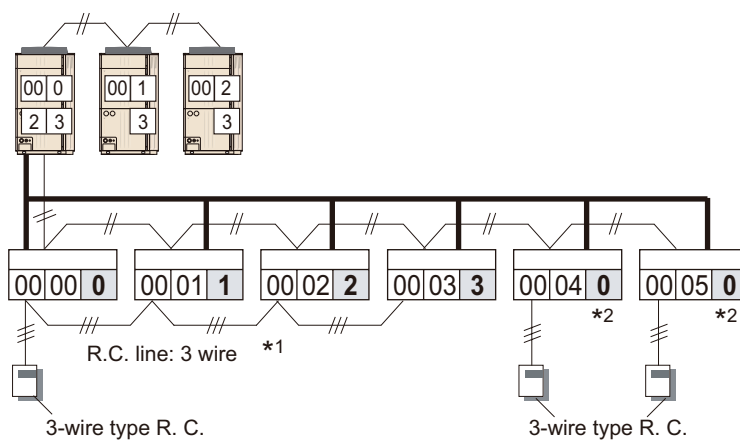


Remote controller address	Rotary switch	Switch position
	RC AD	
0	0	
1	1	
2	2	•
3	3	•
4	4	•
5	5	•
6	6	•
7	7	•
8	8	•
9	9	•
10	A	•
11	B	
12	C	•
13	D	•
14	E	•
15	F	

\*1: Set the remote controller address in order of 0, 1, 2, ..., 15. (Blank is now allowed.)

\*2: When remote controller group is not constructed (1:1 connection of indoor unit and remote controller), be sure that the remote controller address is set to the initial setting "0" (factory setting).

- **2-wire type:**

In initial starting up of this unit, addresses will be automatically set. Do not change the remote controller address for the indoor unit. (Keep it at the initial setting "0".)

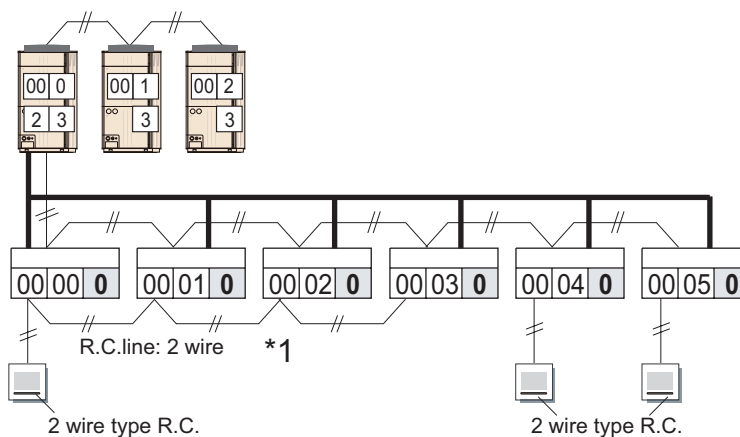


\*1: Set the remote controller address "0" only.

Address is automatically assigned from Remote controller.

- **Touch panel controller setting (Set G)**


Before performing the initial setting, set the Touch panel controller address first. For details, refer to the setting manual.

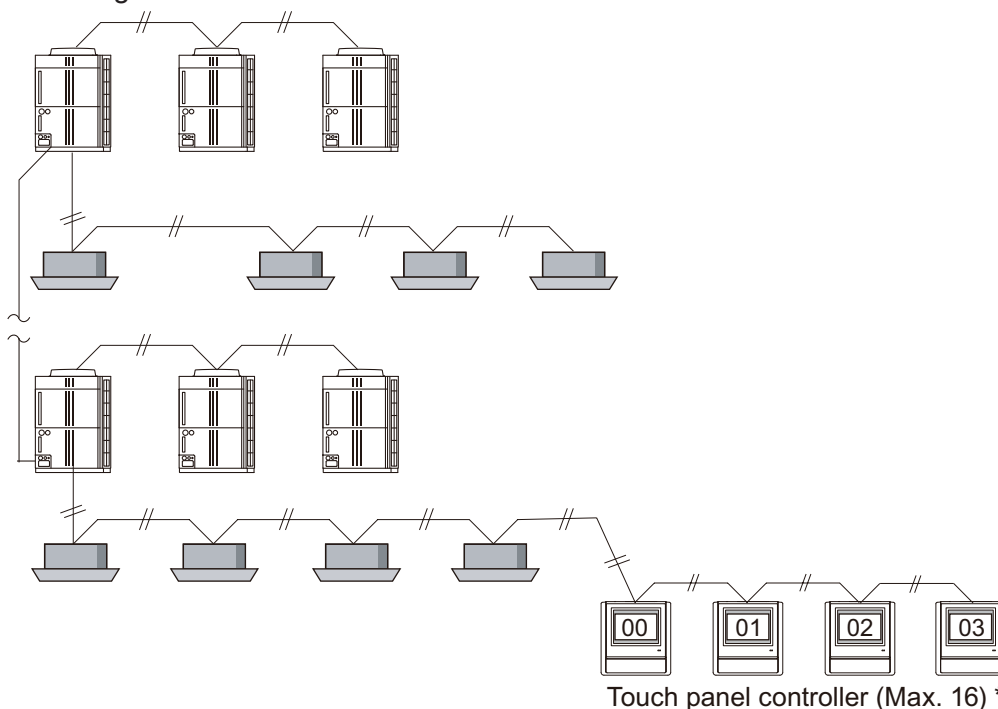

\*: The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.

### • Network converter setting (Set H)

Set the rotary switches 110 and 111 on the Network converter PCB.

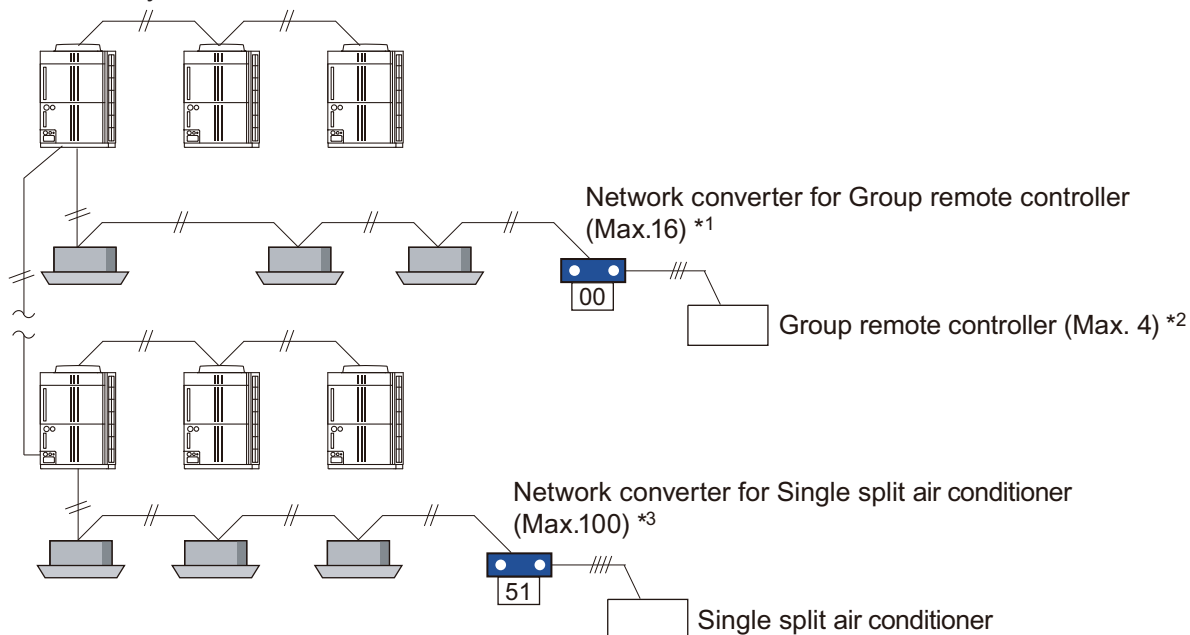

\*1: The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.

\*2: Up to 64 Group remote controllers are connectable in one VRF Network system.

\*3: When connecting the Network converter for single split air conditioner, set up the number so that the refrigerant circuit address number of the outdoor unit and indoor unit does not overlap. The sum total of the refrigerant circuit address of Network converter for single split air conditioner, outdoor unit and the indoor unit is a maximum of 100.

### • Dual remote control switch (Set J)

According to the number of connecting wired remote controller(s), turn “ON” or “OFF” the switch 2 of DIP switch 1 on the slave remote controller.

	2 wired remote controllers are connected in a remote-control group	Only 1 wired remote controller is connected in a remote-control group
	<p>Master Slave</p>	<p>Master</p>
	Switch 2 of DIP switch1	
Master controller	OFF	OFF
Slave controller	ON	—


When two wired remote controllers are connected in a remote-control group, turn the switch 2 of DIP switch 1 on the slave remote controller “ON”.

When only one wired remote controller is connected in a remote-control group, turn the switch 2 of DIP switch 1 on the slave remote controller “OFF”.

#### NOTES:


- Timer setting is not available on the slave remote controller.
- Last command takes priority.

- **Signal amplifier address (Set K)**

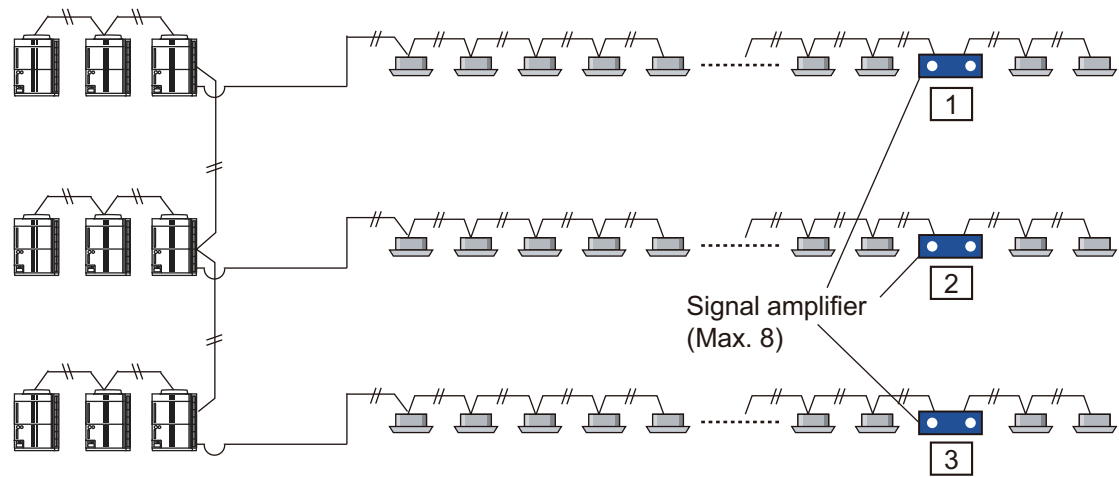

- **Network converter for LonWorks® setting (Set M)**

**NOTE:** Setting up more than one Network converter in one VRF network system is prohibited.

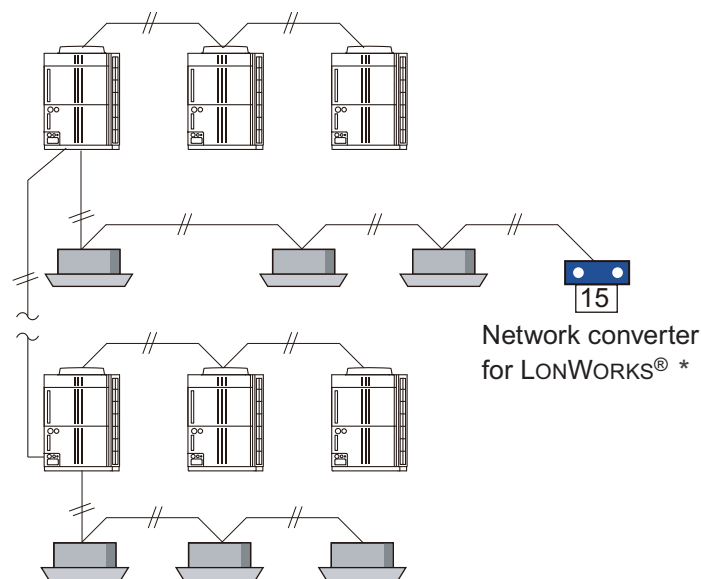


\*: The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.



- **Central remote controller address (Set N)**

Before performing the initial setting, set the Central remote controller address first.

For details, refer to the setting manual.

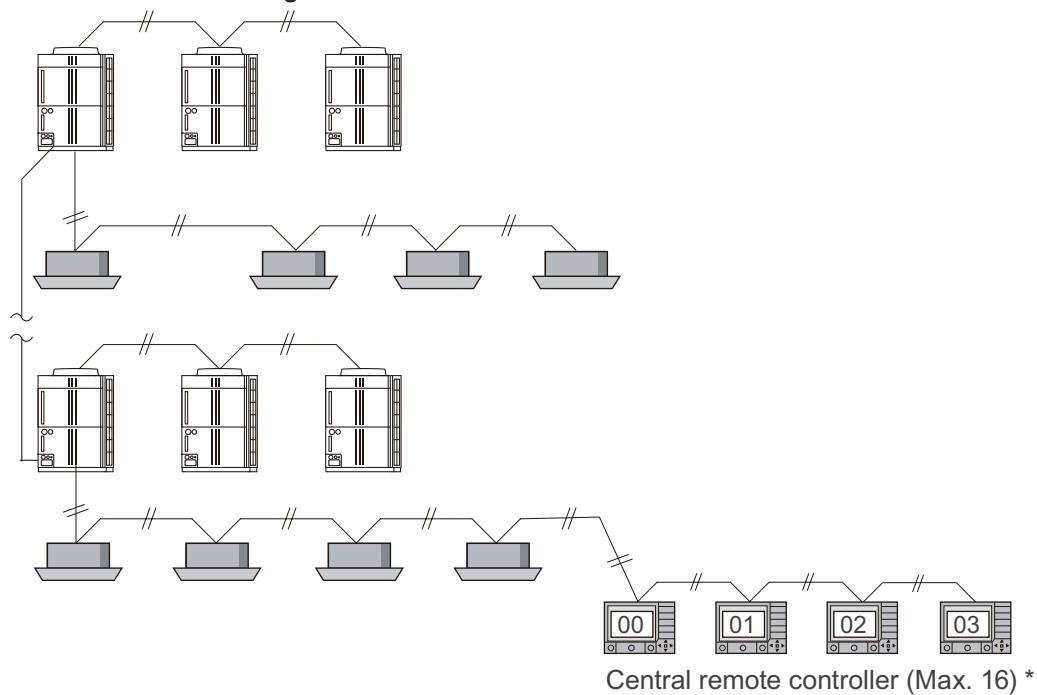

\*1: Setting up more than one Network converter in one VRF network system is prohibited.

\*2: The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.

## 1-4. Address setting by remote controller

### ■ Address setting by wireless remote controller


- A wireless remote controller is required to set the infrared address setting.
- Infrared address setting function is available in all indoor units with infrared signal receiver.
- Infrared address setting for duct type and cassette type models can be performed by using the optional IR receiver unit.

**NOTE:** The beeping sound is emitted from the Indoor unit PCB. Since the indoor unit is installed far away, the sound might not be heard. (The sound is not emitted from the IR receiver unit.)


- The indoor unit address and the indoor unit refrigerant circuit address can be set by performing the infrared address setting.
- When remote controller address setting is required, set by the rotary switch on the indoor unit PCB.

### ● Preparation

1. (This step is unnecessary for newly installed and not yet set the switch.)  
Set the rotary switch on the indoor unit PCB for manual address setting. (Initially set to "00" as factory setting.)  
The layout of the switches differs by the type of the indoor unit. For the details, refer to ["Setting on indoor unit PCB"](#) on page 07-70.

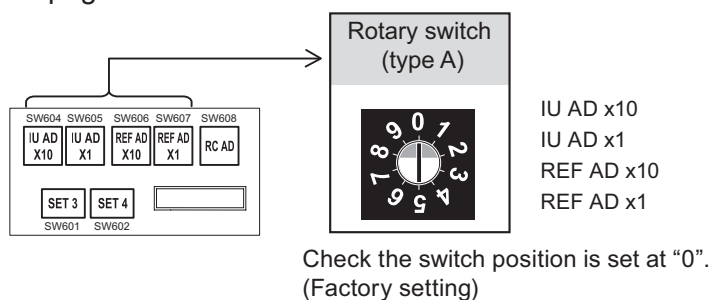

2. Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
3. Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

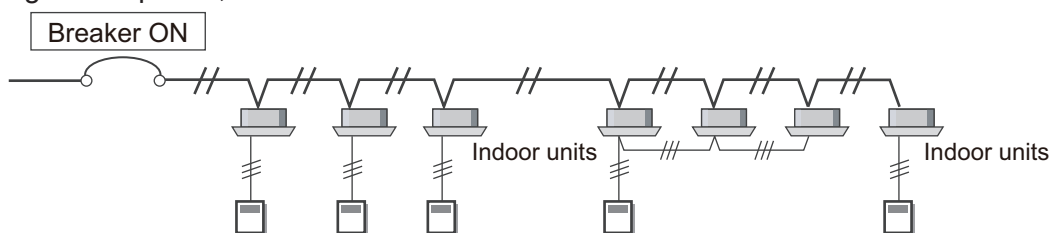


## ● Button name and function


Address code indicator on the remote controller and the operation lamp on IR receiver unit and on the indoor unit are as shown in the figures below.

- For an outline of the address setting, refer to ["Address setting"](#) on page 07-4.
- For the details of function number and setting number used for the function setting, refer to ["Function details"](#) on page 07-99.
- It does not matter whether the refrigerant circuit address or indoor unit address is set first. (The method shown here sets the indoor unit address first.)
- During address setting mode, indoor unit reject the any operation command from remote controller.

### Wireless remote controller

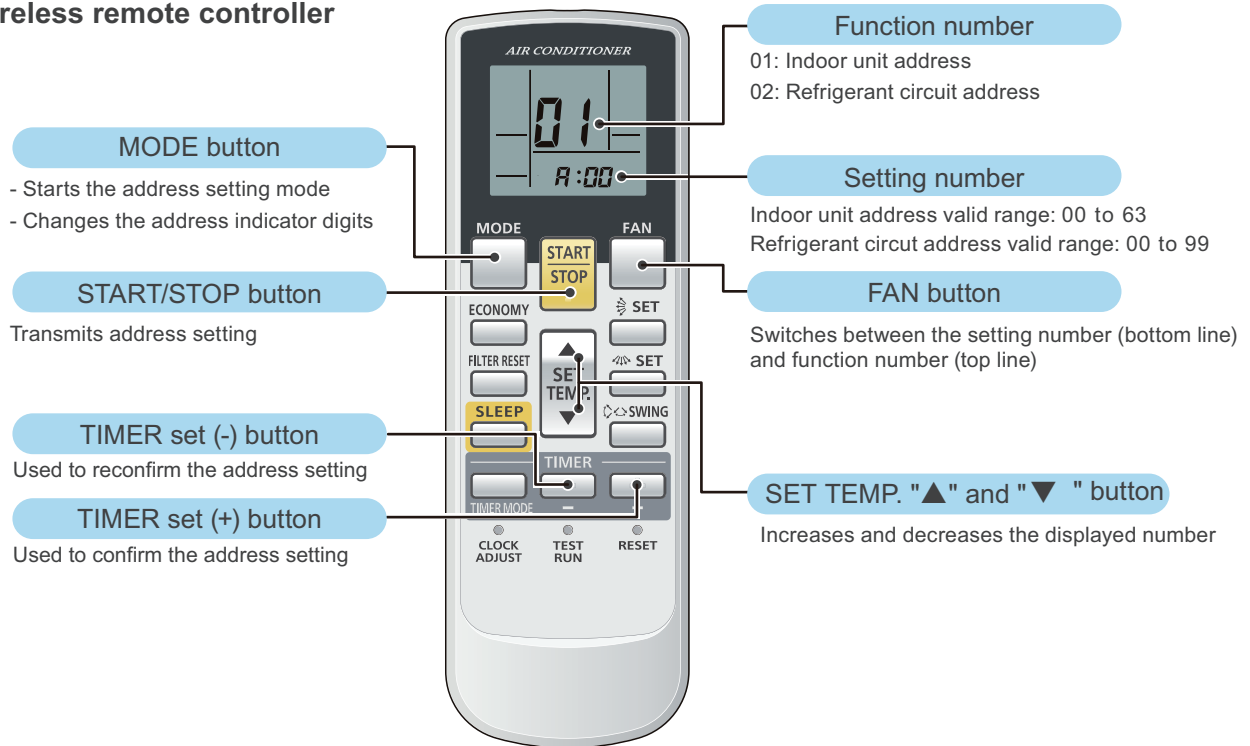

### IR receiver unit

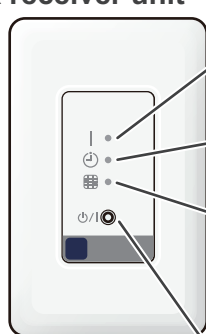

#### OPERATION lamp

Indication of address code

#### TIMER lamp

Indication of address data number (the right digit)

#### FILTER lamp


Indication of address data number (the left digit)

#### MANUAL/AUTO button

Long press (3 sec or more): Switches between the address setting mode and the address setting complete mode

Short press: Switches the lamp indication

### Indoor unit

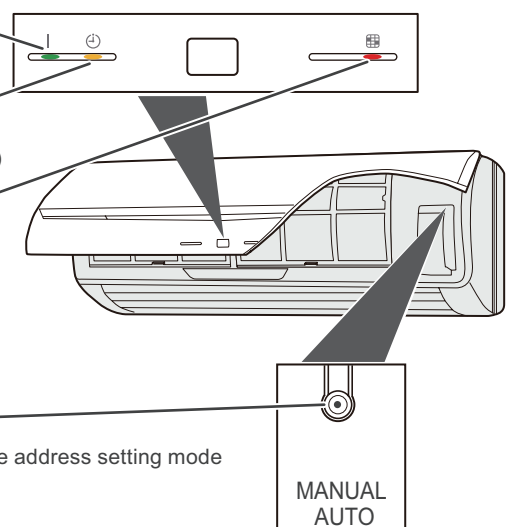

	Indoor unit address display	Refrigerant circuit address display
Operation lamp	ON  (Light continuously) OFF	ON  (Light 1 sec. ON / 1 sec. OFF) OFF

## RELATED LINKS


["Indoor unit \(setting by wireless remote controller\)"](#) on page 07-81

## ● Entering function setting mode


**NOTE:** Be sure that all the procedures described in "Preparation" on page 07-18 are completed.

- The position of the MANUAL AUTO button varies depending on the model. For the actual position of the button on each unit, refer to the operation manual.
- If the MANUAL AUTO button is pressed continuously for 10 seconds or more, the error will be displayed. In this case, release the button or turn off the power.

1. Press and hold the MANUAL AUTO button for 3 seconds.

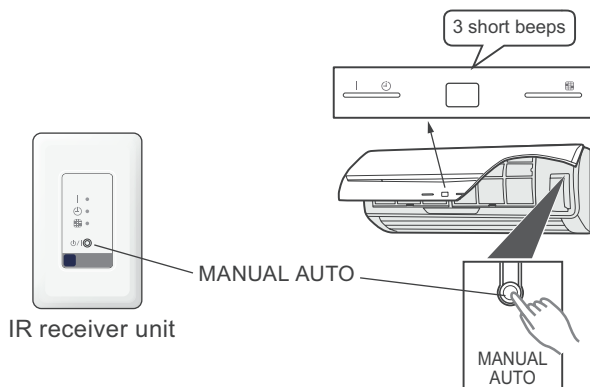


2. While holding down the FAN and the SET TEMP.▲ buttons, press the RESET button. The function setting mode will be activated.

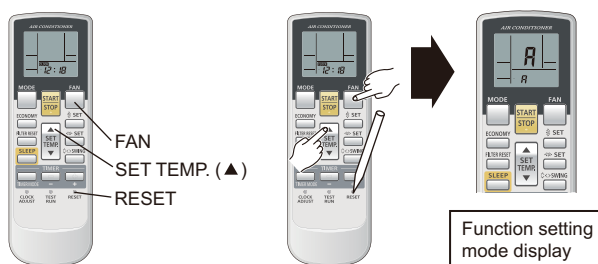


## ● Selection and confirmation of custom code

1. In function setting mode display, press the SET TEMP.▲ or ▼ button to select the custom code that matches the setting with the indoor unit. By selecting the appropriate custom code, the communication between the indoor unit and the wireless remote controller become possible.

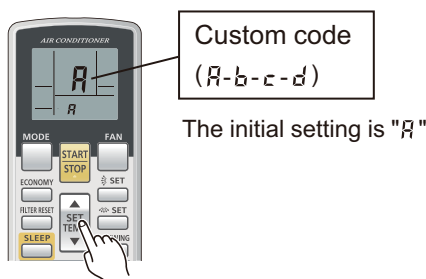


2. For confirming the custom code, press the **TIMER MODE** button to send the code to the indoor unit.

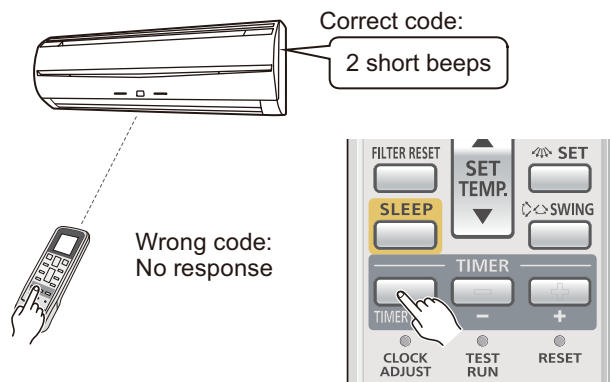


## ● Indoor unit address setting


1. In the function setting mode display, press the MODE button to enter the address setting mode.

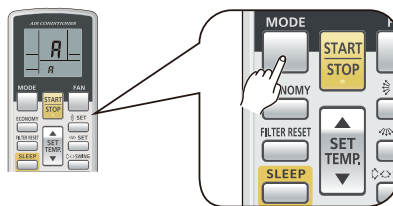


2. Make sure that the function number displayed on the remote controller LCD is "01". If the number is other than "01", press the SET TEMP.▲ or ▼ button to change the number.




3. Press the FAN button to enter the address data setting mode. The address data will flash when this button is pressed.

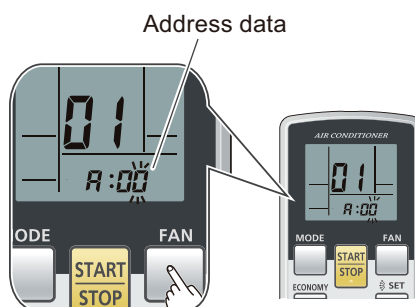

4. Press the SET TEMP.▲ or ▼ button to adjust the address data. The indoor unit address range is between "00" and "63".  
Each time the MODE button is pressed, it switches between the left digit and the right digit.

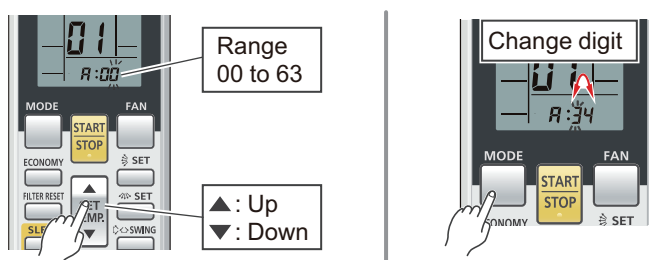


5. Send the information by pressing the START/STOP button once. A beeping sound (2 short beeps, 1 long beep, 2 short beeps, and 1 long beep) will be emitted if the command is accepted.

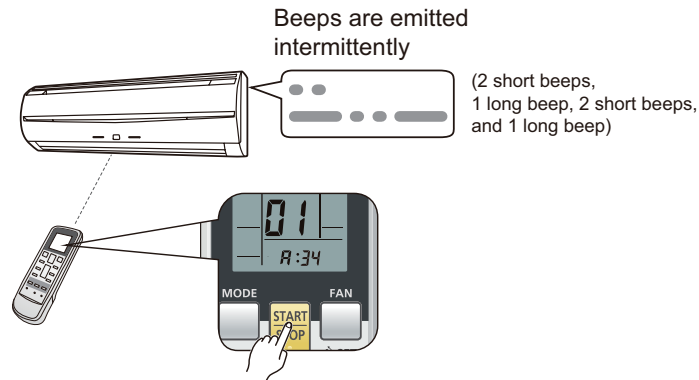

In the following cases, the setting signal will not be accepted correctly and 5 short beeps will be emitted:

- The indoor unit address number is set out of range (64 or more)
  - The setting of the rotary switch on the indoor unit PCB is not set to "00"
6. Indoor unit lamps will indicate the indoor unit address data number as follows:

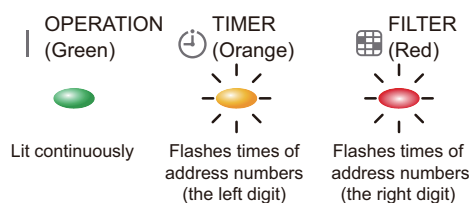


#### Example) ADDRESS: 34

OPERATION lamp (Green)

TIMER lamp (Orange)


FILTER lamp (Red)

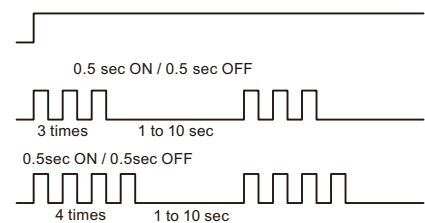

When the address setting is "0", TIMER lamp and FILTER lamp will not flash.

## ● Confirmation of address setting

To confirm the address setting is properly configured, press the TIMER set (+) button.

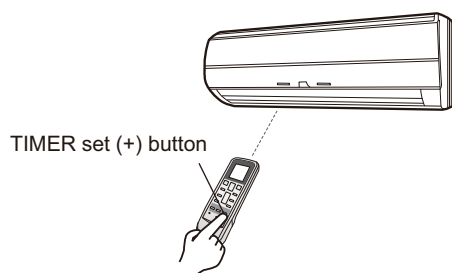

Beeps are emitted intermittently as follows:

Correct: (2 short beeps, 1 long beep, 4 short beeps, and 1 long beep)


Wrong: (2 short beeps and 1 long beep) (3 sec)

## ● Refrigerant circuit address setting

**NOTE:** Even while an indoor unit address is indicated on the indoor unit LED lamp, the indication will be switched to the refrigerant circuit address if the following operation is performed.

1. Press the FAN button to select the function number.

Function number

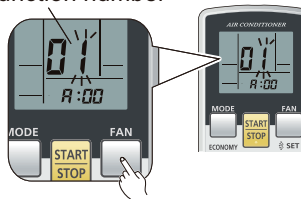


2. Press the SET TEMP.▲ or ▼ button to adjust function number "02".




Set at "02"

3. Press the FAN button to enter the address data setting mode. The address data will flash when this button is pressed.

Address data

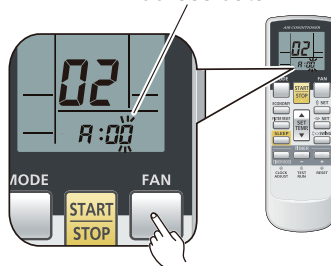


4. Press the SET TEMP.▲ or ▼ button to adjust the address data. The refrigerant circuit address range is between "00" and "99". Each time the MODE button is pressed, it switches between the left digit and the right digit.

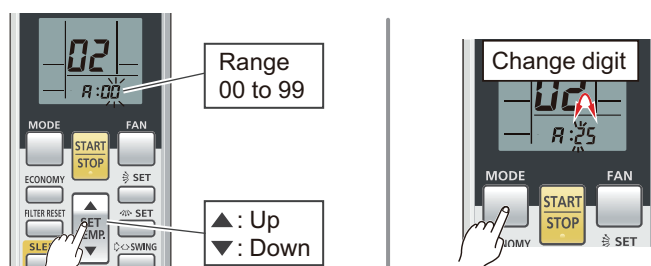




5. Send the information by pressing the START/STOP button once. A beeping sound (2 short beeps, 1 long beep, 2 short beeps, and 1 long beep) will be emitted if the command is accepted.

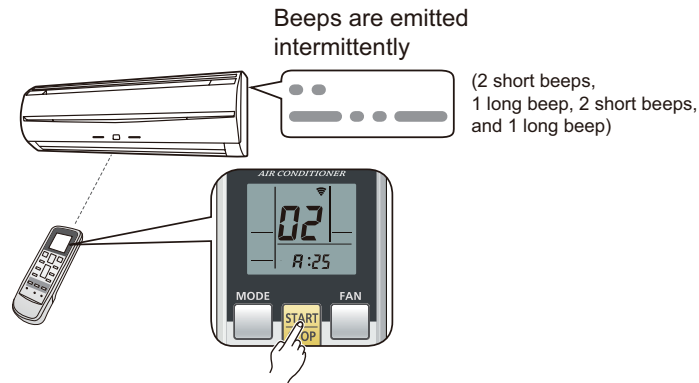

In the following cases, the setting signal will not be accepted correctly and 5 short beeps will be emitted:

- The indoor unit address number is set out of range (64 or more)
  - The setting of the rotary switch on the indoor unit PCB is not set to "00"
6. Indoor unit lamps will indicate the refrigerant circuit address data number as follows:

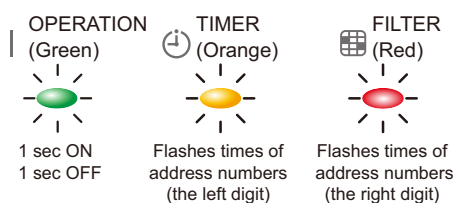


#### Example) ADDRESS: 25


OPERATION lamp (Green)



TIMER lamp (Orange)




FILTER lamp (Red)



- When the address setting is "0", TIMER lamp and FILTER lamp will not flash.
- Address indication will be switched automatically from indoor unit address to refrigerant circuit address.

## ● Confirmation of address setting

To confirm the address setting is properly configured, press the TIMER set (+) button.

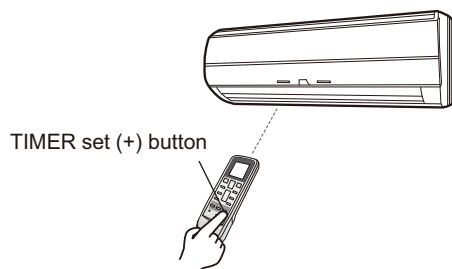


Beeps are emitted intermittently as follows:

Correct: (2 short beeps, 1 long beep, 4 short beeps, and 1 long beep)


Wrong: (2 short beeps and 1 long beep)

## ● Completion of address setting mode

- The position of the MANUAL AUTO button varies depending on the model. For the actual position of the button on each unit, refer to the operation manual.
  - If the MANUAL AUTO button is pressed continuously for 10 seconds or more, the error will be displayed. In this case, release the button or turn off the power.
1. Press and hold the MANUAL AUTO button for 3 seconds. The brightness of each LED lamp is darkening though the content of the display does not change.

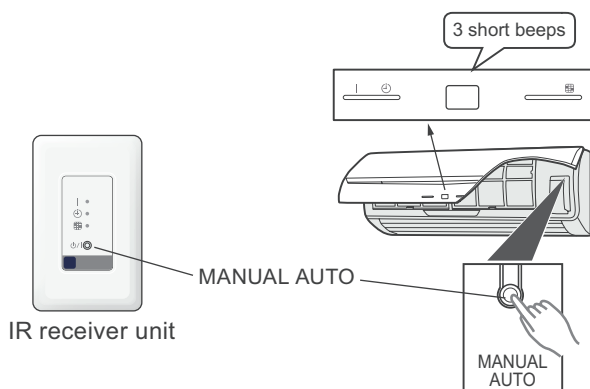

2. Press the RESET button.




For the custom code setting of b, c, or d, perform the setting after pressing the RESET button.

- After completing the procedure above, no address setting signal is received. If the address setting signal is sent, 5 short beeps will be emitted indicating an error.
- When returning the address setting mode again, press the MANUAL AUTO button for 3 seconds.


## ● Reconfirmation of address setting

Press and hold the MANUAL AUTO button for 3 seconds.

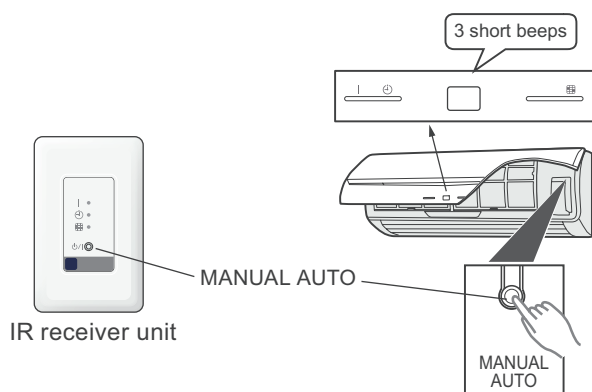


### • Indoor unit address setting

1. Make sure that the function number is set to "01" with referring the step 2. in ["Indoor unit address setting"](#) on page 07-22.
2. Press the TIMER set (-) button. Associating indication will be shown on the indoor unit LED lamps.

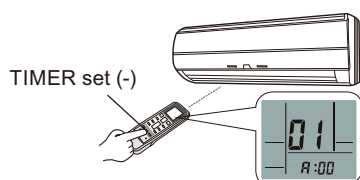


#### Example) ADDRESS: 34

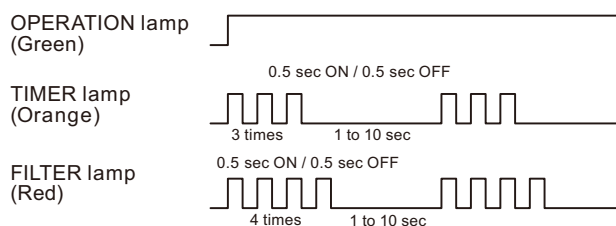


### • Refrigerant circuit address setting

1. Make sure that the function number is set to "01" with referring the step 2. in ["Refrigerant circuit address setting"](#) on page 07-24.
2. Press the TIMER set (-) button. Associating indication will be shown on the indoor unit LED lamps.

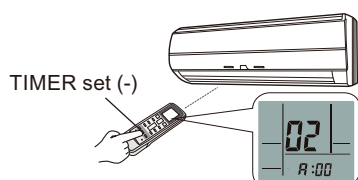


#### Example) ADDRESS: 25

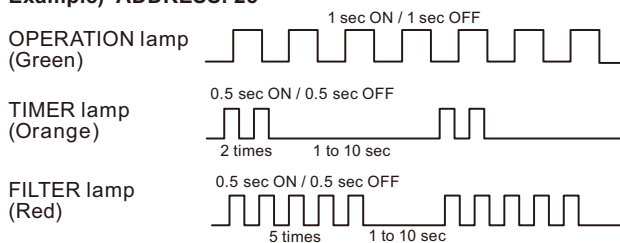

## ● Setting up each indoor unit

Setting must be performed on each indoor unit by repeating following procedures:

- "Preparation" on page 07-18
- "Entering function setting mode" on page 07-20
- "Selection and confirmation of custom code" on page 07-20
- "Indoor unit address setting" on page 07-22
- "Refrigerant circuit address setting" on page 07-24
- "Completion of address setting mode" on page 07-26
- "Reconfirmation of address setting" on page 07-27

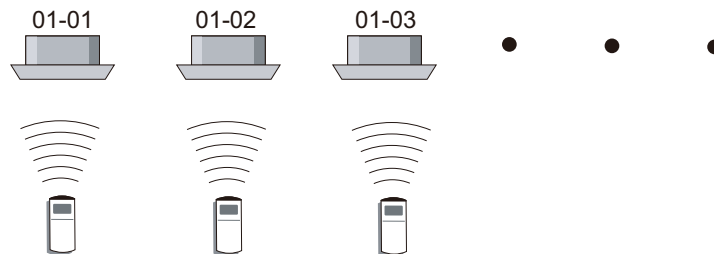

When the custom code is different to "F" (factory setting), only following procedures need to be performed.

- "Preparation" on page 07-18
- "Entering function setting mode" on page 07-20
- "Selection and confirmation of custom code" on page 07-20
- "Completion of address setting mode" on page 07-26
- "Reconfirmation of address setting" on page 07-27

## ● Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, address cannot be read correctly.
- After all the addresses have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set address is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting address is effective after disconnecting the power supply and then reconnecting it.
- Record the address set in the indoor unit on a label, and put the label on the unit so it can be used for after-sales service operations.

Address "0" setting will not be indicated on TIMER lamp and FILTER lamp.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.

Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.


**NOTE:** If custom code other than "F" is set, the remote control must be set accordingly to the indoor unit setting.

## ■ Address setting by wired remote controller (UTY-RNKU)

- Indoor unit addresses and refrigerant circuit addresses can be set up using wired remote controllers.
- This function allows setting the addresses of all indoor units to which a wired remote controller is being connected.
- This function cannot be used to set up remote controller addresses.  
Be sure to set them up using the rotary switches on the PCB of each indoor unit. (Refer to ["Manual address setting method"](#) on page 07-9.)
- This function cannot be used on the slave units.
- This device is connectable to 3-wire type remote controller compatible models only. As for the compatible models, refer to ["System configuration examples"](#) in Chapter 5. CONTROL SYSTEM on page 05-2.


### ● Preparation

- Make sure that all indoor unit address switches (IU AD x10, IU AD x1) and refrigerant circuit address switches (REF AD x10, REF AD x1) on the PCB of each indoor unit are set at 0 (factory setting).  
The layout of the switches differs by the type of the indoor unit. For the details, refer to ["Setting on indoor unit PCB"](#) on page 07-70.

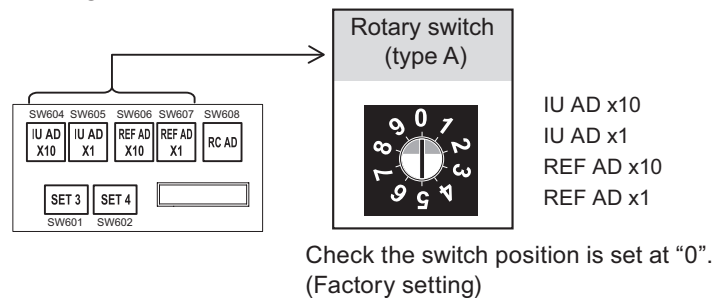


- If multiple indoor units are connected to a single wired remote controller, set up the remote controller address (RC AD) manually on the indoor units PCBs by referring ["Manual address setting method"](#) on page 07-9.

**Example: When 4 indoor units are connected**

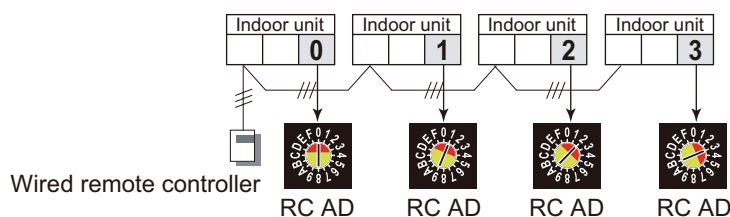


- Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
- Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

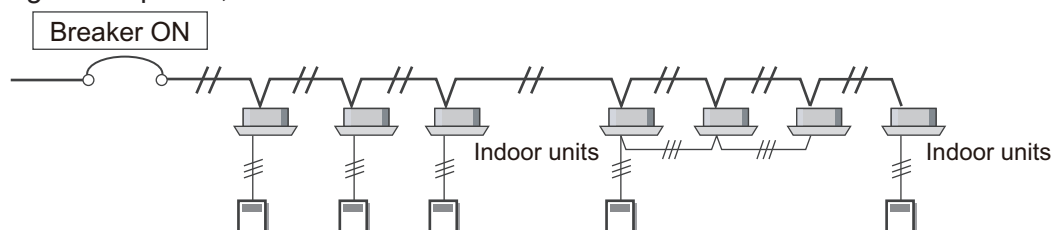

## ● Button name and function

Address code or function indicator on the remote controller is as shown in the figures below.

- For an outline of the address setting, refer to ["Address setting"](#) on page 07-4.
- For the details of function number and setting number used for the function setting, refer to ["Function details"](#) on page 07-99.
- It does not matter whether the refrigerant circuit address or indoor unit address is set first. (The method shown here sets the indoor unit address first.)
- During address setting mode, indoor unit reject the any operation command from remote controller.

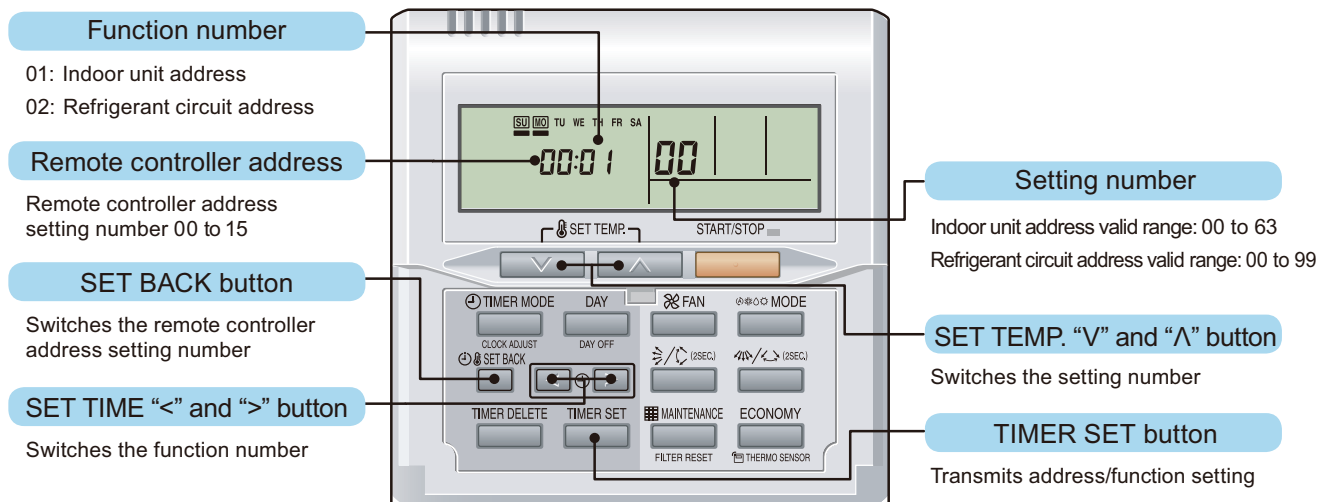


## RELATED LINKS

["Indoor unit \(setting by UTY-RNKU\)"](#) on page 07-87


## ● Entering setting mode

Hold down the 3 buttons of SET TEMP. "V", SET TEMP. "Λ", and FAN at the same time for 5 seconds or longer. The setting mode will be activated.

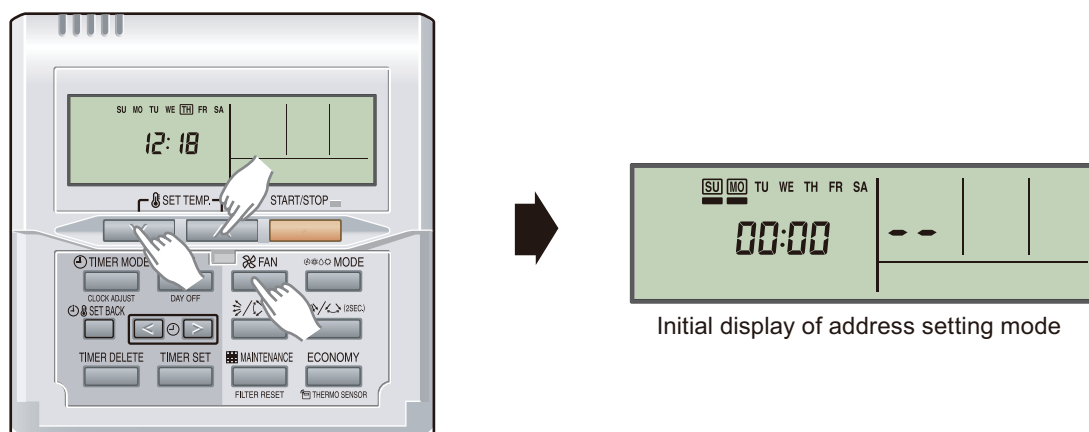


## ● Indoor unit address setting

1. In the initial display of setting mode, by pressing the SET BACK button, select a remote controller address. (Select the indoor unit you want to operate.)

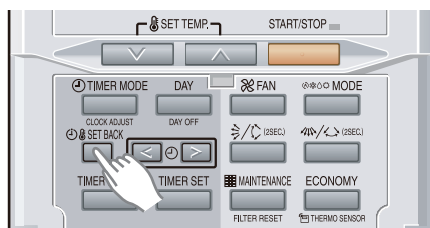


Remote controller address

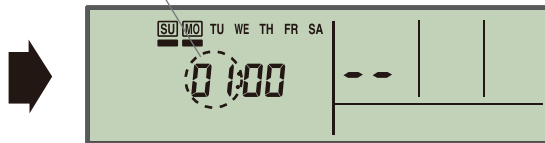


Example: When remote controller address "01" is selected


2. Display the function number "01" by pressing the SET TIME "<" button or SET TIME ">" button.

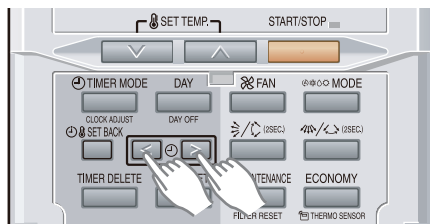

Function number

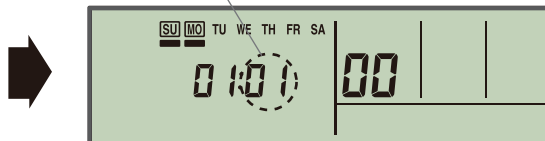

3. Set up the indoor unit address by pressing the SET TEMP. "∨" or the SET TEMP. "∧" button. (The setting range is from "00" to "63".)


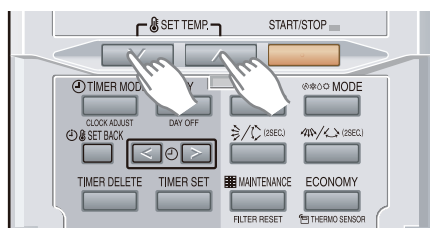


Indoor unit address data



Example: When indoor unit address data "12" is set up


4. Confirm the selected indoor unit address data by pressing the TIMER SET button. The data will be transferred to the indoor unit.

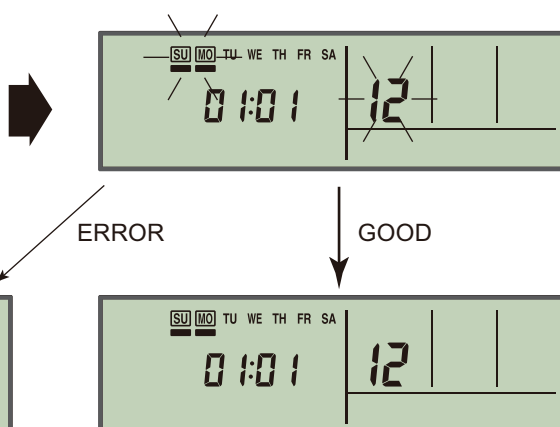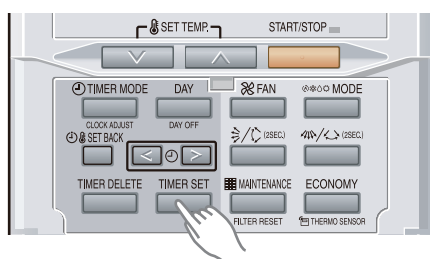


- When the address data is properly set up on the indoor unit, the flashing of the number stops and the set number will be displayed. (GOOD)
- When the address data is not set up correctly, "- -" is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.

## ● Refrigerant circuit address setting

1. In the initial display of address setting mode, by pressing the SET BACK button, select a remote controller address. (Select the indoor unit you want to operate.)  
If the indoor unit you want to operate has already been selected, skip this step.

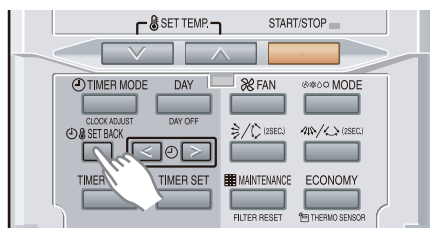


Remote controller address

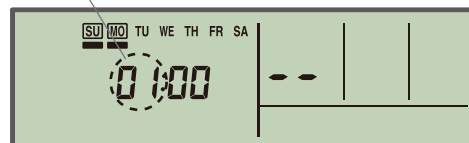


Example: When remote controller address "01" is selected

2. Display the function number "02" by pressing the SET TIME "<" button or SET TIME ">" button.

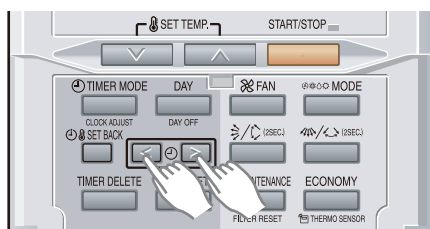


<: Down button  
>: Up button


Function number

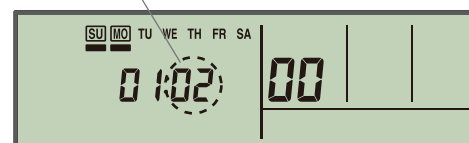

3. Set up the refrigerant circuit address by pressing the SET TEMP. "∨" or the SET TEMP. "∧" button. (The setting range is from "00" to "99".)


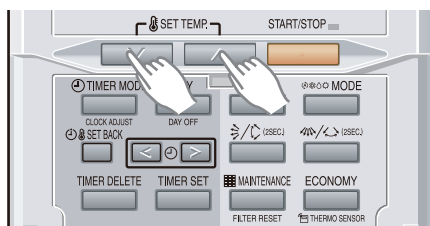


Refrigerant circuit address data

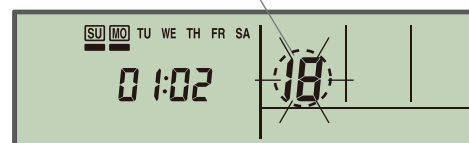



Example: When refrigerant circuit address data "18" is set up

4. Confirm the selected refrigerant circuit address data by pressing the TIMER SET button. The data will be transferred to the indoor unit.

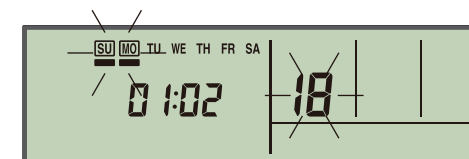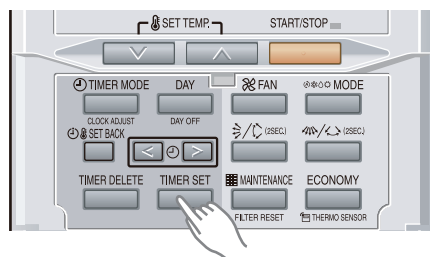

ERROR

GOOD

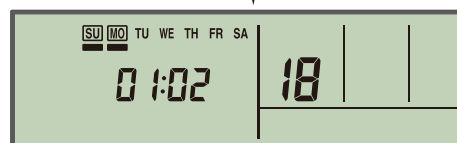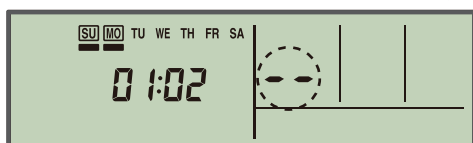

- When the address data is properly set up on the indoor unit, the flashing of the number stops and the set number will be displayed. (GOOD)
- When the address data is not set up correctly, "- -" is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.



## ● Completion of setting mode

To exit the setting mode and return to the regular display, hold down the 3 buttons of SET TEMP. “▼”, SET TEMP. “^”, and FAN at the same time.


If there is no key entry for 60 seconds, even though none of the above buttons is pressed, the setting mode will be cleared automatically.

If the setting mode is automatically cleared during setting, you need to enter the setting mode again by performing the procedure in ["Entering setting mode"](#) on page 07-30.

## ● Setting up each indoor unit

Setting must be performed on each indoor unit requiring address setting by repeating following procedures:

- ["Preparation"](#) on page 07-29
- ["Entering setting mode"](#) on page 07-30
- ["Indoor unit address setting"](#) on page 07-31
- ["Refrigerant circuit address setting"](#) on page 07-32
- ["Completion of setting mode"](#) on page 07-33

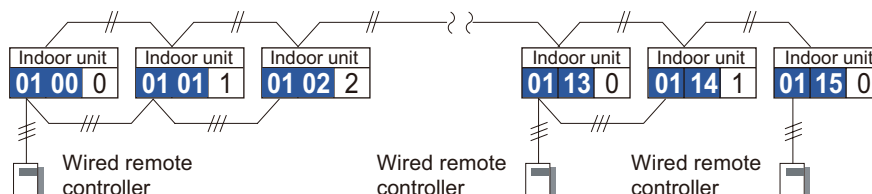

## ● Resetting the power after setting up all indoor units

### NOTES:


- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off. However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## ■ Address setting by simple remote controller (UTY-RSRY and UTY-RHRY)

- Indoor unit addresses and refrigerant circuit addresses can be set up using wired remote controllers.
- This function allows setting the addresses of all indoor units to which a wired remote controller is being connected.
- This function cannot be used to set up remote controller addresses.  
Be sure to set them up using the rotary switches on the PCB of each indoor unit. (Refer to ["Manual address setting method"](#) on page 07-9.)
- This function cannot be used on the slave units.
- This function can be set up on both UTY-RSRY (with operation mode) and UTY-RHRY (without operation mode) types.


### ● Preparation

- Make sure that all indoor unit address switches (IU AD x10, IU AD x1) and refrigerant circuit address switches (REF AD x10, REF AD x1) on the PCB of each indoor unit are set at 0 (factory setting).  
The layout of the switches differs by the type of the indoor unit. For the details, refer to ["Setting on indoor unit PCB"](#) on page 07-70.

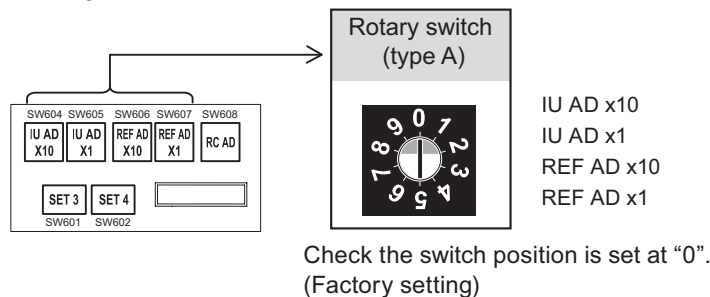


- If multiple indoor units are connected to a single wired remote controller, set up the remote controller address with "Automatic address setting".

**Example: When 4 indoor units are connected**

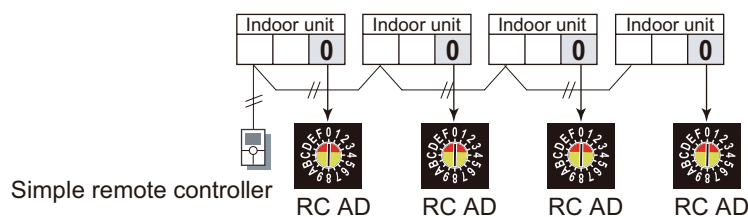


- Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
- Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

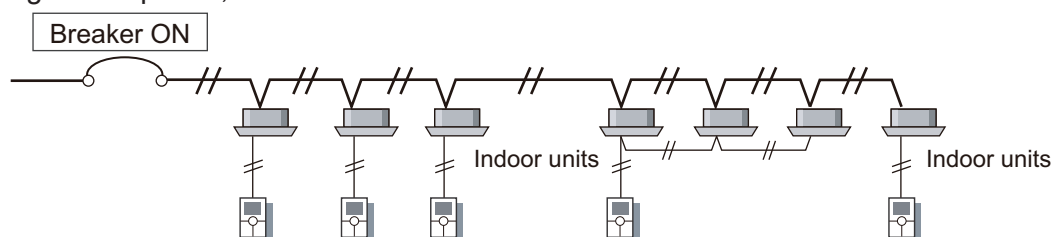


## ● Entering setting mode

1. While displaying Monitor Mode screen, press and hold the TEMP. “^” button and FAN “v” button at the same time for 2 seconds or longer. Menu 1 screen will be displayed.



Monitor Mode screen




Menu 1 screen

2. While displaying the Menu 1 screen, press and hold the FAN “^” button for 2 seconds or longer. Setting mode selection screen will be displayed.



Menu 1 screen




Setting mode selection screen

3. Press the TEMP. “^” or TEMP. “v” button to select “F1” (Menu 2-F1) settings mode or F2 (Menu 2-F2) settings mode.
  - F1: Initial settings mode
  - F2: Maintenance settings mode
4. While displaying the settings mode selection screen, press START/STOP  $\phi$ /I button. Setting item selection screen with item number will be displayed.




Setting mode selection screen




Setting item selection screen


5. While displaying the setting item selection screen with item number, press the TEMP. “^” or TEMP. “v” button to select the item number “13”.



Setting item selection screen



6. After adjusting the item number to “13” in Menu 2-F1 settings, press the START/STOP $\phi$ /I button to switch to the function setting screen.

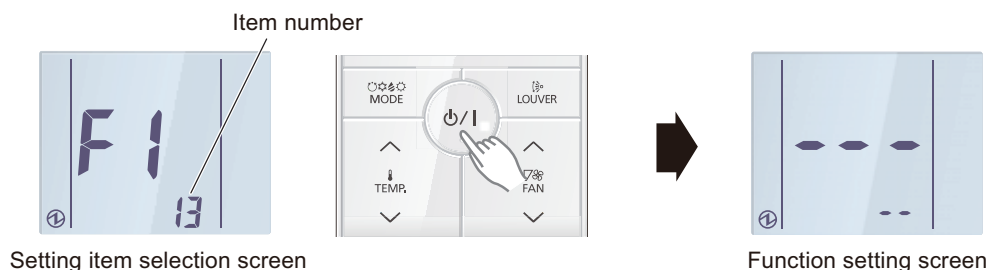

## RELATED LINKS

["Indoor unit address setting"](#) on page 07-36


["Refrigerant circuit address setting"](#) on page 07-38

["Indoor unit function setting"](#) on page 07-91


## ● Indoor unit address setting

**NOTE:** Perform this setting on the master remote controller.


1. While displaying the function setting screen, press the TEMP. “ $\wedge$ ” or TEMP. “ $\vee$ ” button to select the 2-wire remote controller address.

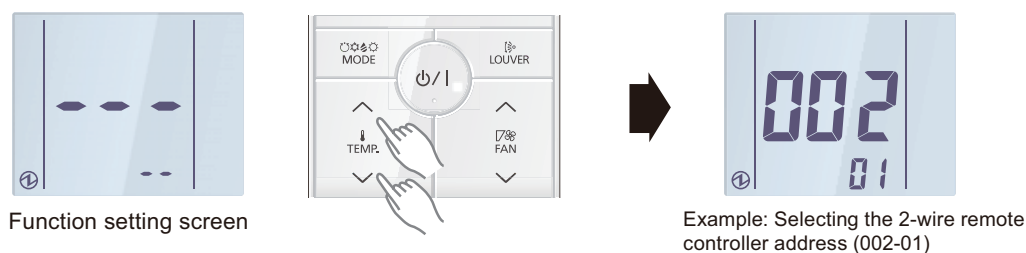


2. Press the START/STOP $\phi$ /I button to switch to the function number setting.

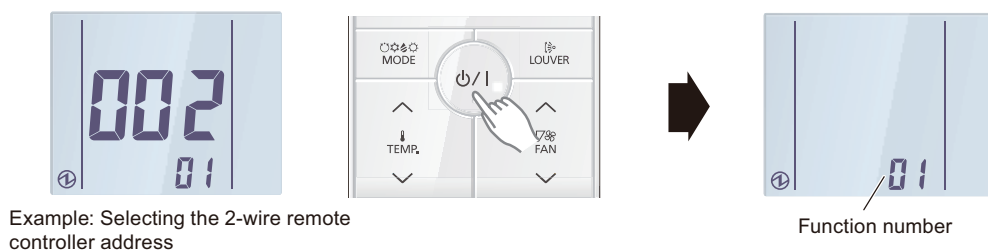


3. Press the TEMP. “ $\wedge$ ” or TEMP. “ $\vee$ ” button to adjust the function number.

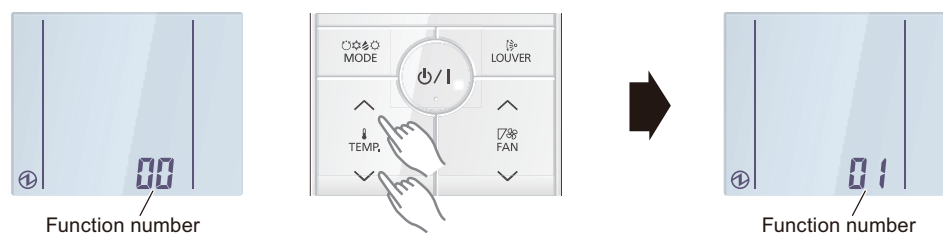


4. Press the START/STOP  $\phi/I$  button to switch to the indoor unit address setting.

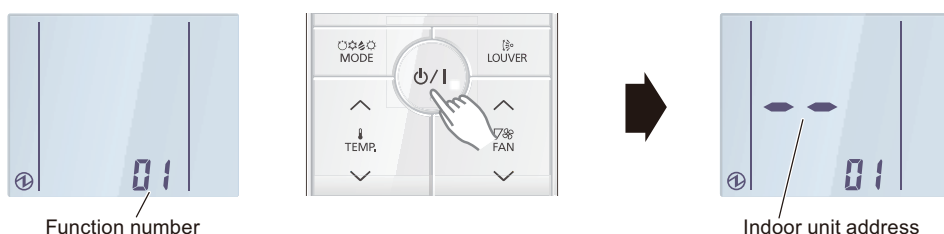

5. Press the TEMP. “^” or TEMP. “v” button to adjust the indoor unit address number.

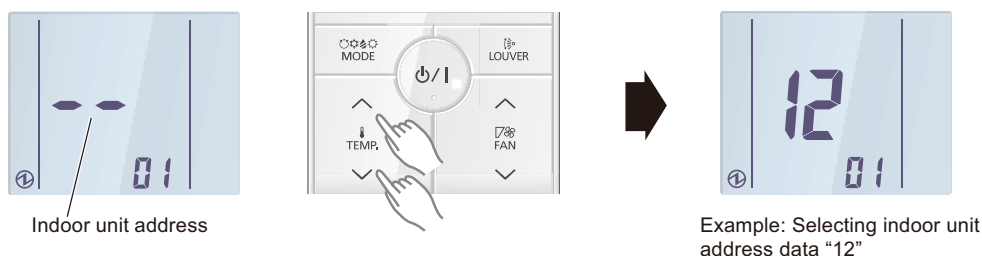


6. Confirm the selected indoor unit address data by pressing the START/STOP  $\phi/I$  button. The data will be transferred to the indoor unit.

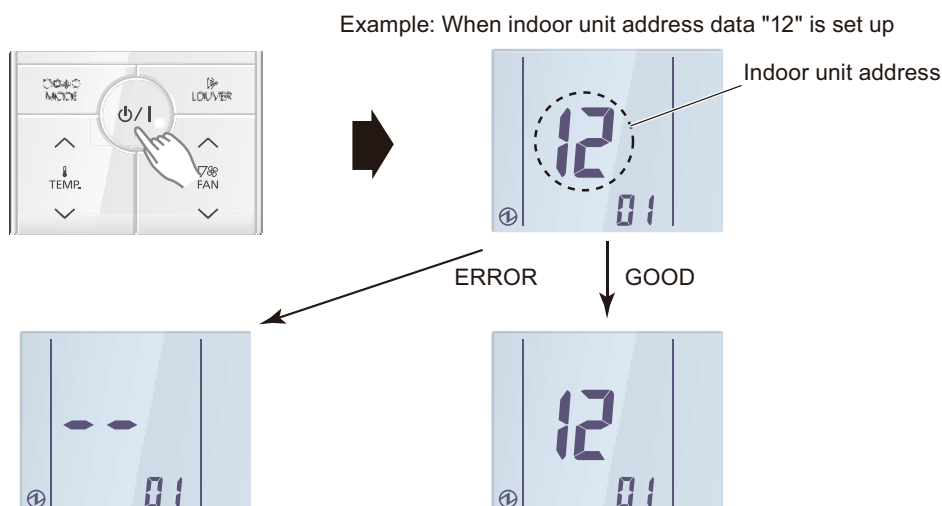


- When the address data is properly set up on the indoor unit, the set number will be displayed. (GOOD)
- When the address data is not set up correctly, “- -” is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.

7. To return to the 2-wire remote controller address selection screen, press the START/STOP  $\phi/I$  button. If setting has been completed, press FAN “v” button to return to the Menu 2-F1 item selection screen.

When returning to the 2-wire remote controller address selection screen



Setting completed and returning to the Menu 2-F1 item selection screen




## ● Refrigerant circuit address setting

**NOTE:** Perform this setting on the master remote controller.

1. While displaying the function setting screen, press the TEMP. “^” or TEMP. “v” button to select the 2-wire remote controller address.



Function setting screen





Example: Selecting the 2-wire remote controller address (002-01)

2. Press the START/STOP  $\phi/I$  button to switch to the function number setting.



Example: Selecting the 2-wire remote controller address




Function number

3. Press the TEMP. “^” or TEMP. “v” button to adjust the function number.



Function number





Function number

4. Press the START/STOP  $\phi/I$  button to switch to the refrigerant circuit address setting.




Function number




Refrigerant circuit address

5. Press the TEMP. “^” or TEMP. “v” button to adjust the refrigerant circuit address number.




Refrigerant circuit address




Example: Selecting refrigerant circuit address data “18”

6. Confirm the selected refrigerant circuit address data by pressing the START/STOP $\phi$ /I button. The data will be transferred to the indoor unit.

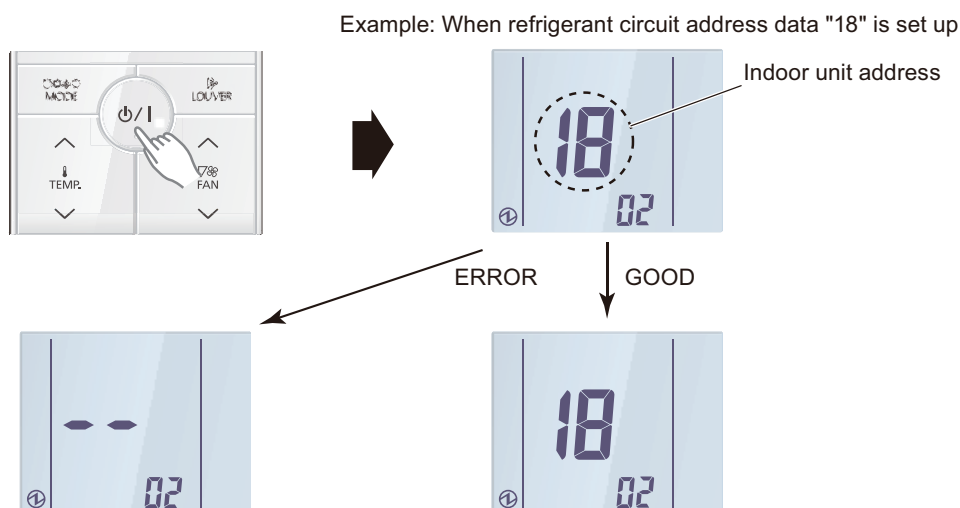


- When the address data is properly set up on the indoor unit, the set number will be displayed. (GOOD)
  - When the address data is not set up correctly, “- -” is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.
7. To return to the 2-wire remote controller address selection screen, press the START/STOP $\phi$ /I button. If setting has been completed, press FAN “ $\vee$ ” button to return to the Menu 2-F1 item selection screen.

When returning to the 2-wire remote controller address selection screen



Setting completed and returning to the Menu 2-F1 item selection screen




## ● Completion of setting mode

1. To exit the setting mode and return to the Menu 1 item selection screen, press and hold the FAN “ $\wedge$ ” button for 2 seconds or longer.
2. To return to the Monitor Mode screen, press and hold the TEMP. “ $\wedge$ ” button and FAN “ $\vee$ ” button at the same time for 2 seconds or longer.

## ● Setting up each indoor unit

Setting must be performed on each indoor unit requiring address setting by repeating following procedures:

- "Preparation" on page 07-34
- "Entering setting mode" on page 07-35
- "Indoor unit address setting" on page 07-36
- "Refrigerant circuit address setting" on page 07-38

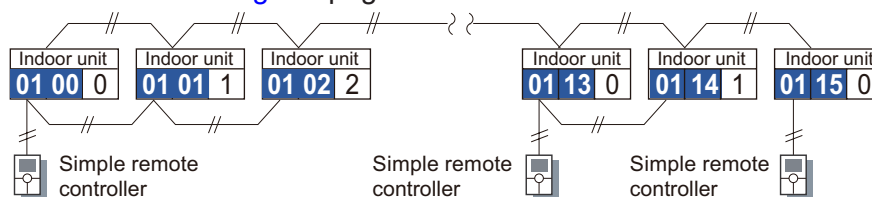

## ● Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off. However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.




## ■ Address setting by simple remote controller (UTY-RSKU and UTY-RHKU)

- Indoor unit addresses and refrigerant circuit addresses can be set up using wired remote controllers.
- This function allows setting the addresses of all indoor units to which a wired remote controller is being connected.
- This function cannot be used to set up remote controller addresses.  
Be sure to set them up using the rotary switches on the PCB of each indoor unit. (Refer to ["Manual address setting method"](#) on page 07-9.)
- This function cannot be used on the slave units.
- This function can be set up on both UTY-RSKU (with operation mode) and UTY-RHKU (without operation mode) types.


### ● Preparation

- Make sure that all indoor unit address switches (IU AD x10, IU AD x1) and refrigerant circuit address switches (REF AD x10, REF AD x1) on the PCB of each indoor unit are set at 0 (factory setting).  
The layout of the switches differs by the type of the indoor unit. For the details, refer to ["Setting on indoor unit PCB"](#) on page 07-70.

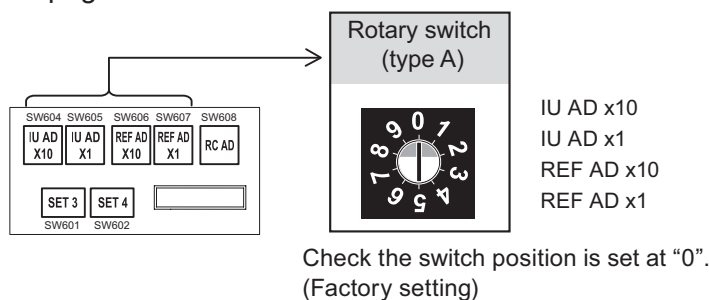


- If multiple indoor units are connected to a single simple remote controller, set up the remote controller address (RC AD) manually on the indoor units PCBs by referring ["Manual address setting method"](#) on page 07-9.

**Example: When 4 indoor units are connected**

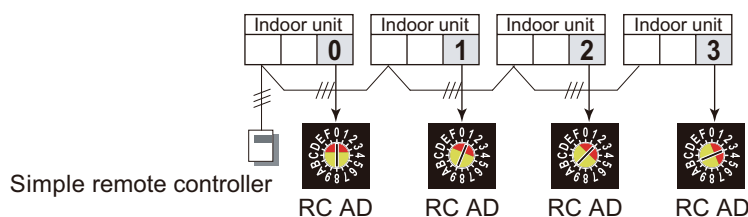



- Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
- Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

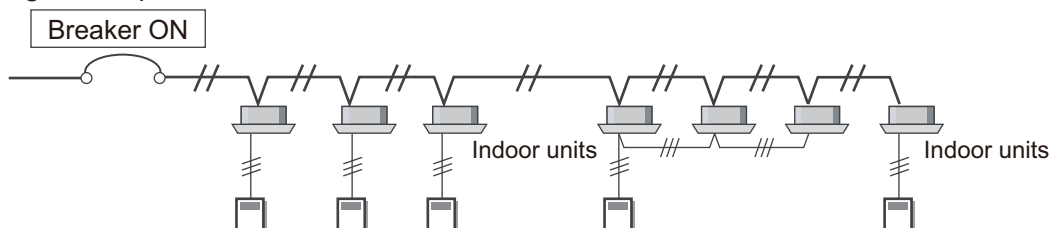

## ● Button name and function

Address code or function indicator on the remote controller is as shown in the figures below.

- For an outline of the address setting, refer to ["Address setting"](#) on page 07-4.
- For the details of function number and setting number used for the function setting, refer to ["Function details"](#) on page 07-99.
- It does not matter whether the refrigerant circuit address or indoor unit address is set first. (The method shown here sets the indoor unit address first.)
- During address setting mode, indoor unit reject the any operation command from remote controller.

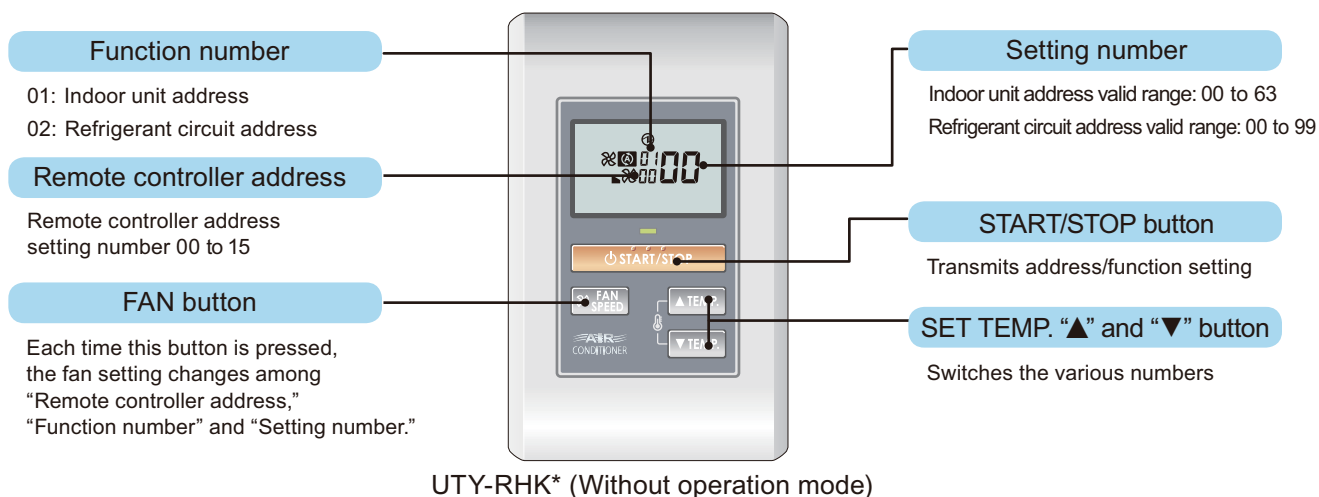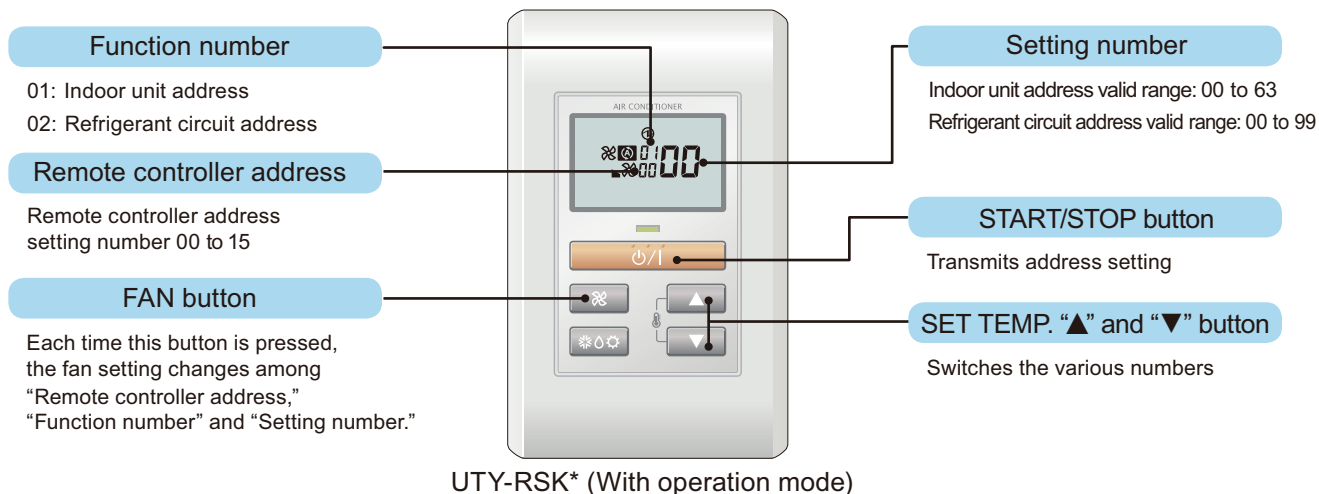


### RELATED LINKS

["Indoor unit \(setting by UTY-RSKU, UTY-RHKU\)"](#) on page 07-93


## ● Entering setting mode

Hold down the 3 buttons of SET TEMP. "▲", SET TEMP. "▼", and FAN at the same time for 5 seconds or longer. The setting mode will be activated.

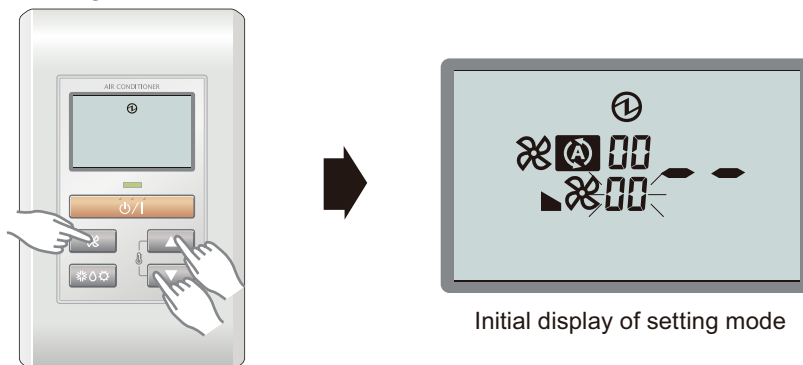


## ● Indoor unit address setting


1. In initial display of the setting mode, by pressing SET TEMP. “▲” button or SET TEMP. “▼” button, select a remote controller address. (Select the indoor unit you want to operate.)

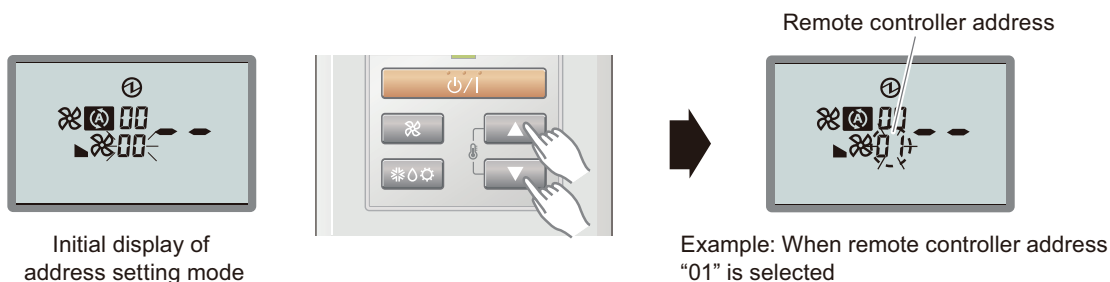


2. Press the FAN button. “Function number” indicator flashes.

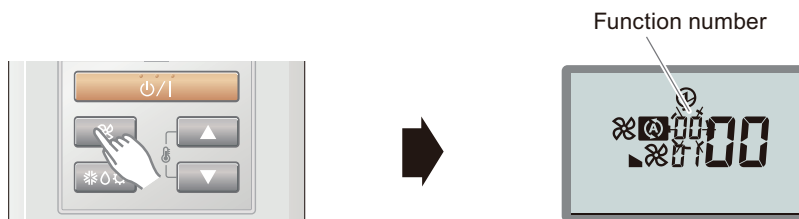


3. Display the function number “01” by pressing SET TEMP. “▲” button or SET TEMP. “▼” button.

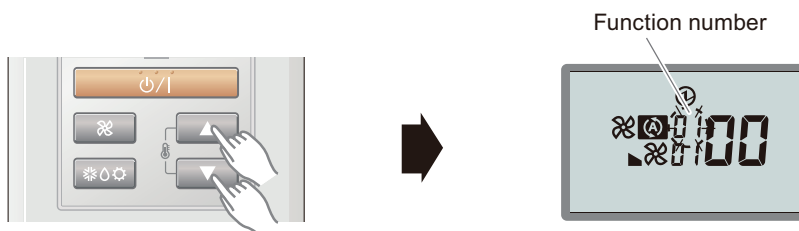


4. Press the FAN button. “Setting number” indicator flashes.

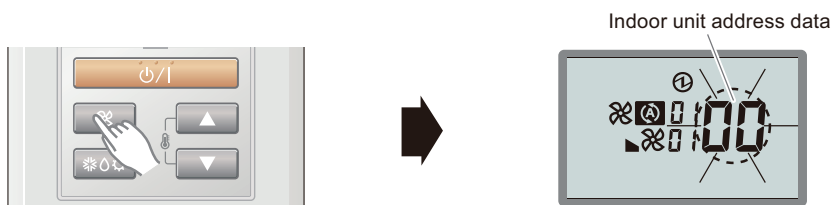

5. Set up the indoor unit address data by pressing SET TEMP. “▲” button or SET TEMP. “▼” button. (Setting range is from “00” to “63”.)

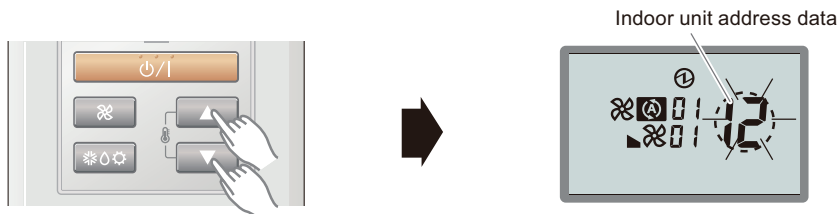

6. Confirm the selected indoor unit address data by pressing the START/STOP<sup>⏻</sup>/I button. The data will be transferred to the indoor unit.

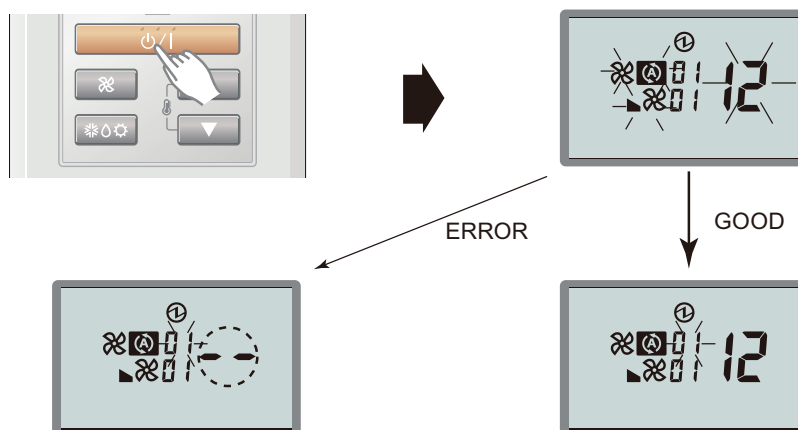


- When the address data is properly set up on the indoor unit, the set number will be displayed. (GOOD)
- When the address data is not set up correctly, “-” is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.


## ● Refrigerant circuit address setting

**NOTE:** Perform this setting on the master remote controller.


1. In initial display of the address setting mode, by pressing SET TEMP. “▲” button or SET TEMP. “▼” button, select a remote controller address. (Select the indoor unit you want to operate.)  
If the indoor unit you want to operate has already been selected, skip this step.

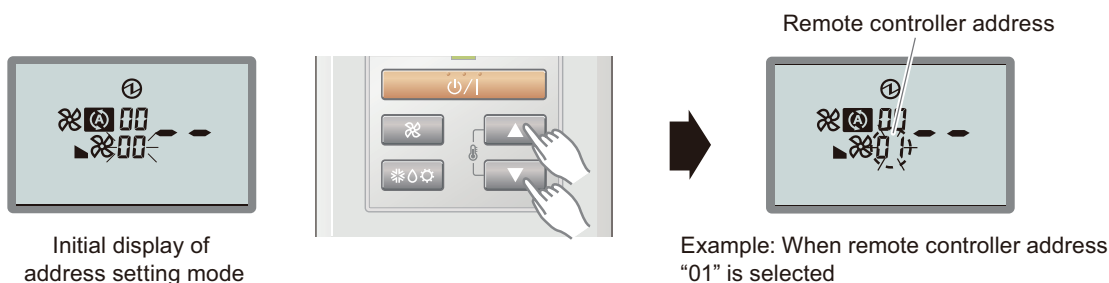


2. Press the FAN button. “Function number” indicator flashes.

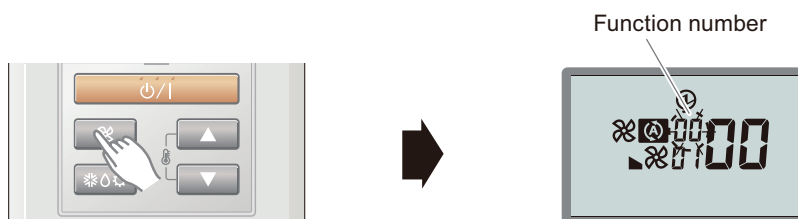


3. Display the function number “02” by pressing SET TEMP. “▲” button or SET TEMP. “▼” button.

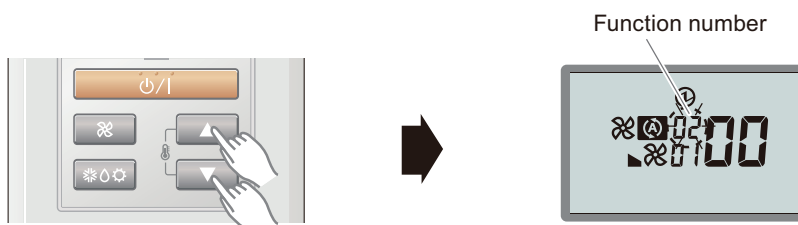


4. Press the FAN button. "Setting number" indicator flashes.

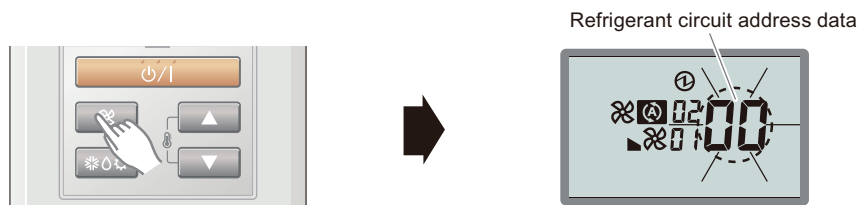

5. Set up the refrigerant circuit address data by pressing SET TEMP. "▲" button or SET TEMP. "▼" button. (Setting range is from "00" to "99".)

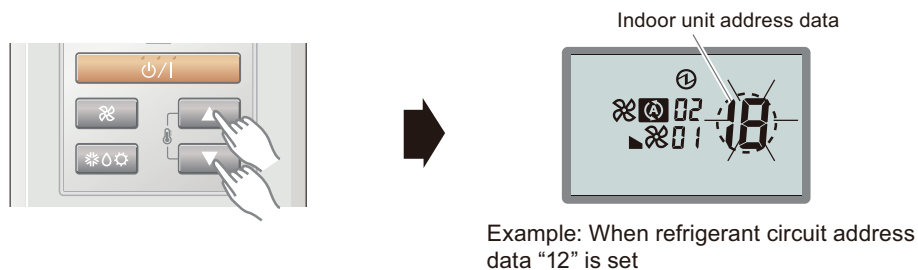

6. Confirm the selected refrigerant circuit address data by pressing the START/STOP<sup>⏻</sup>/I button. The data will be transferred to the indoor unit.

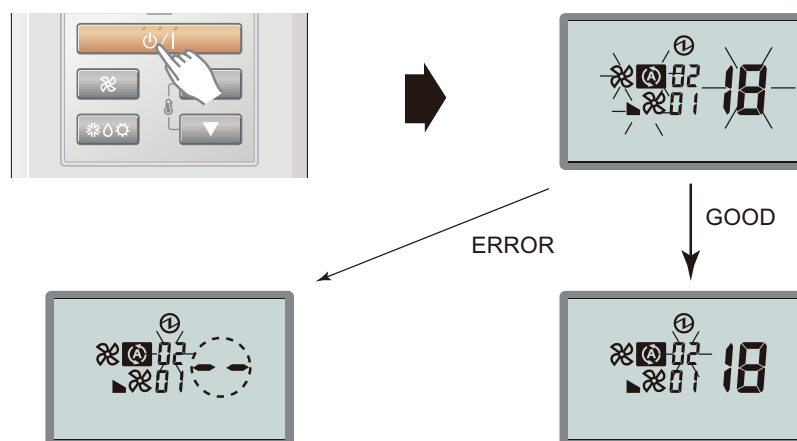

- When the address data is properly set up on the indoor unit, the set number will be displayed. (GOOD)
- When the address data is not set up correctly, "- -" is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.

## ● Completion of setting mode

To exit the setting mode and return to the regular display, hold down the 3 buttons of SET TEMP.

“▲”, SET TEMP. “▼”, and FAN at the same time for 5 seconds or longer.


If there is no key entry for 60 seconds, even though none of the above buttons is pressed, the setting mode will be cleared automatically.

If the setting mode is automatically cleared during setting, you need to enter the setting mode again by performing the procedure in ["Entering setting mode"](#) on page 07-42.

## ● Setting up each indoor unit

Setting must be performed on each indoor unit requiring address setting by repeating following procedures:

- ["Preparation"](#) on page 07-41
- ["Entering setting mode"](#) on page 07-42
- ["Indoor unit address setting"](#) on page 07-43
- ["Refrigerant circuit address setting"](#) on page 07-44

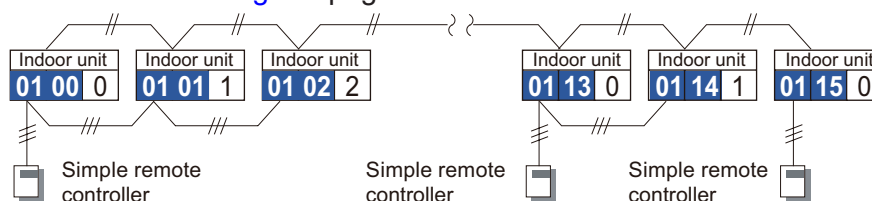

## ● Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.


However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## ■ Address setting by wired remote controller (Touch panel) (UTY-RNRUZ\*)

- Indoor unit addresses and refrigerant circuit addresses can be set up using wired remote controllers.
- This function allows setting the addresses of all indoor units to which a wired remote controller is being connected.
- This function cannot be used to set up remote controller addresses.  
Be sure to set them up using the rotary switches on the PCB of each indoor unit. (Refer to ["Manual address setting method"](#) on page 07-9.)
- This function cannot be used on the slave units.


### ● Preparation

- Make sure that all indoor unit address switches (IU AD x10, IU AD x1) and refrigerant circuit address switches (REF AD x10, REF AD x1) on the PCB of each indoor unit are set at 0 (factory setting).  
The layout of the switches differs by the type of the indoor unit. For the details, refer to ["Setting on indoor unit PCB"](#) on page 07-70.

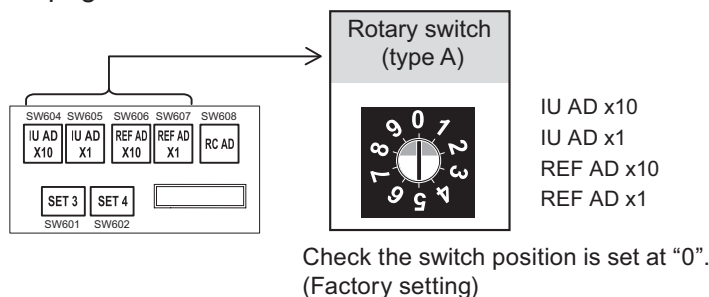


- If multiple indoor units are connected to a single wired remote controller, set up the remote controller address with "Automatic address setting".

**Example: When 4 indoor units are connected**

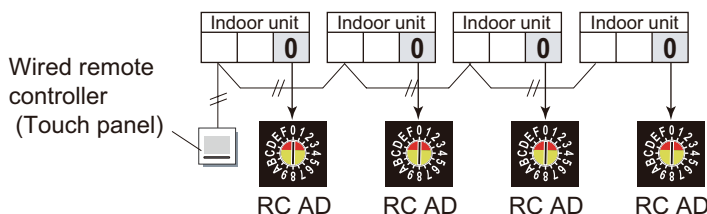


- Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
- Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

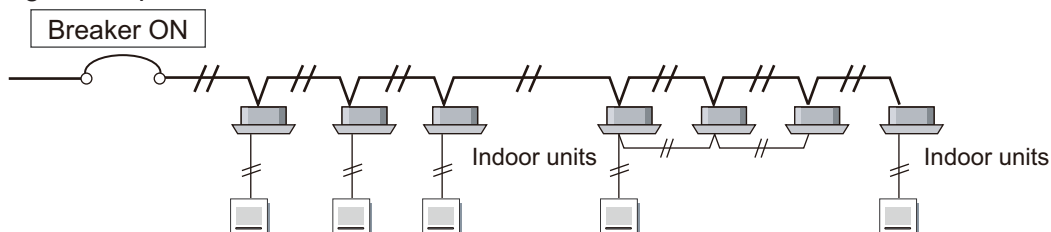

## ● Entering setting mode

When “Function Setting” on the Maintenance screen is touched, Installer Password Verification screen is displayed.


Enter the Installer Password, and touch “OK”. Function Setting screen is displayed.

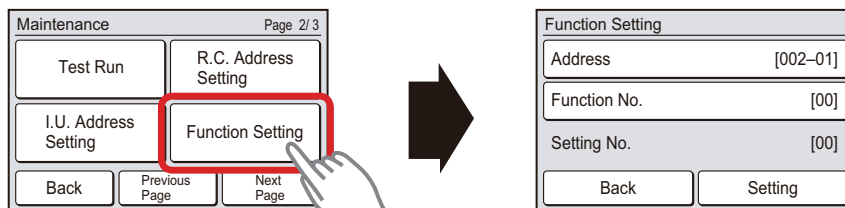


Function setting mode initial display

## ● Indoor unit address setting

1. Touch “Address” on the Function Setting screen.

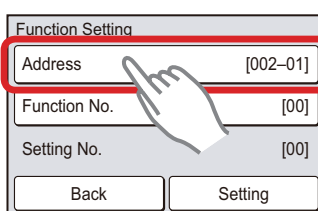


2. Address screen is displayed. Select the address of the indoor unit whose function number is to be set by touching “▲” or “▼”.

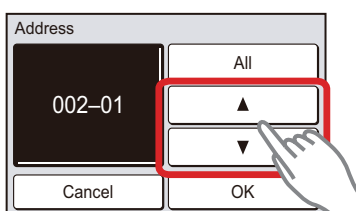


When “OK” is touched, the display returns to the Function Setting screen.

3. Touch “Function No.” on the Function Setting screen.

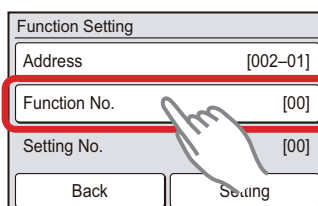


4. Function No. screen is displayed. Set the Function No. “01” by touching “▲” or “▼”.

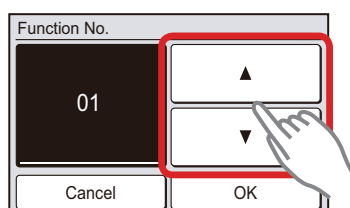


When “OK” is touched, the display returns to the Function Setting screen.



5. Touch "Setting" on the Function Setting screen.

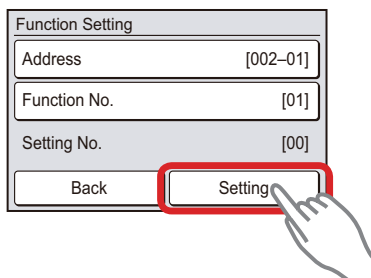


6. Setting screen of "Setting No." is displayed. Set the Setting No. by touching "▲" or "▼". (Setting range is from "00" to "63".)

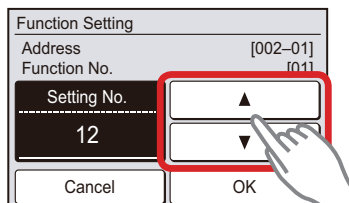

Example: When indoor unit address data "12" is set


When "OK" is touched, the Function Setting verification screen is displayed.

7. Touch "Yes" on the verification screen.

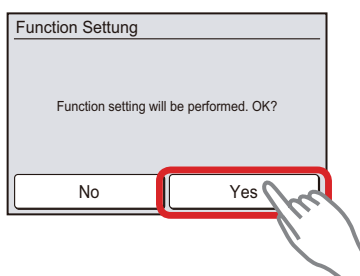


## ● Refrigerant circuit address setting

1. Touch "Address" on the Function Setting screen.

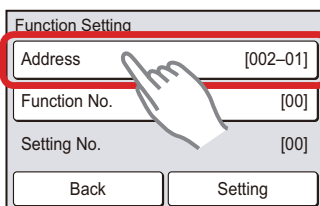


2. Address screen is displayed. Select the address of the indoor unit whose function number is to be set by touching "▲" or "▼". When setting at all the indoor units, touch "All".

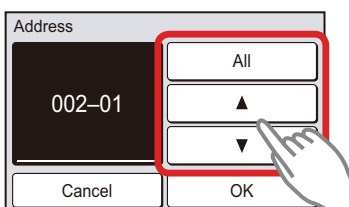


When "OK" is touched, the display returns to the Function Setting screen.

3. Touch "Function No." on the Function Setting screen.

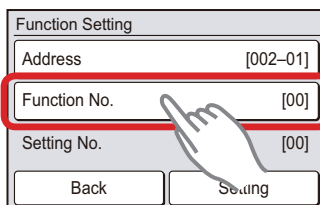


4. Function No. screen is displayed. Set the Function No. "02" by touching "▲" or "▼".

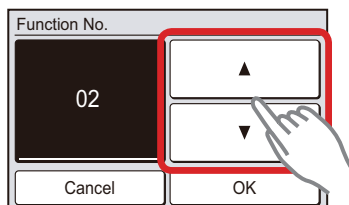


When "OK" is touched, the display returns to the Function Setting screen.

5. Touch "Setting" on the Function Setting screen.

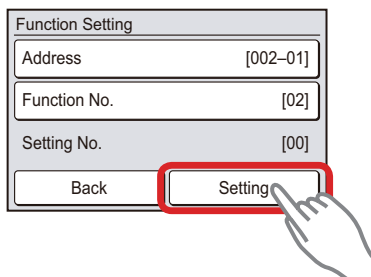


6. Setting screen of "Setting No." is displayed. Set the Setting No. by touching "▲" or "▼". (Setting range is from "00" to "99".)

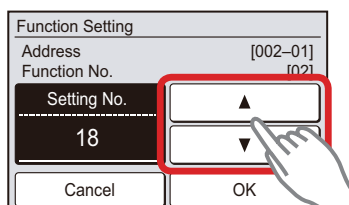

Example: When refrigerant circuit address data "18" is set

When "OK" is touched, the Function Setting verification screen is displayed.

7. Touch "Yes" on the verification screen.

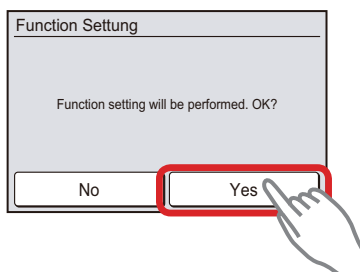

After the Setting screen was displayed, the display returns to the Function Setting screen.


## ● Completion of setting mode

To exit the setting mode and return to the Maintenance screen, touch "Back" on the Function Setting screen.

## ● Setting up each indoor unit

Setting must be performed on each indoor unit requiring address setting by repeating following procedures.

- "Preparation" on page 07-47
- "Entering setting mode" on page 07-48
- "Indoor unit address setting" on page 07-48
- "Refrigerant circuit address setting" on page 07-49
- "Completion of setting mode" on page 07-50

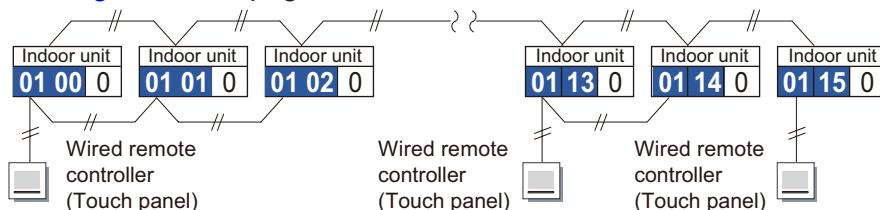

## ● Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## 1-5. Automatic address setting


The addresses of signal amplifiers and indoor units can be set automatically.

### ⚠ CAUTION

- Mind the following items when performing automatic address setting.
  - The controller cannot be used.
  - Automatic address setting may take about 30 minutes.
  - Emergency stop signal is not accepted.
- When setting both addresses of Signal amplifiers and indoor units automatically, be sure to always set the addresses of signal amplifiers first.

## ■ Automatic address setting method


Automatic address setting needs to be performed by following steps mentioned below in order.

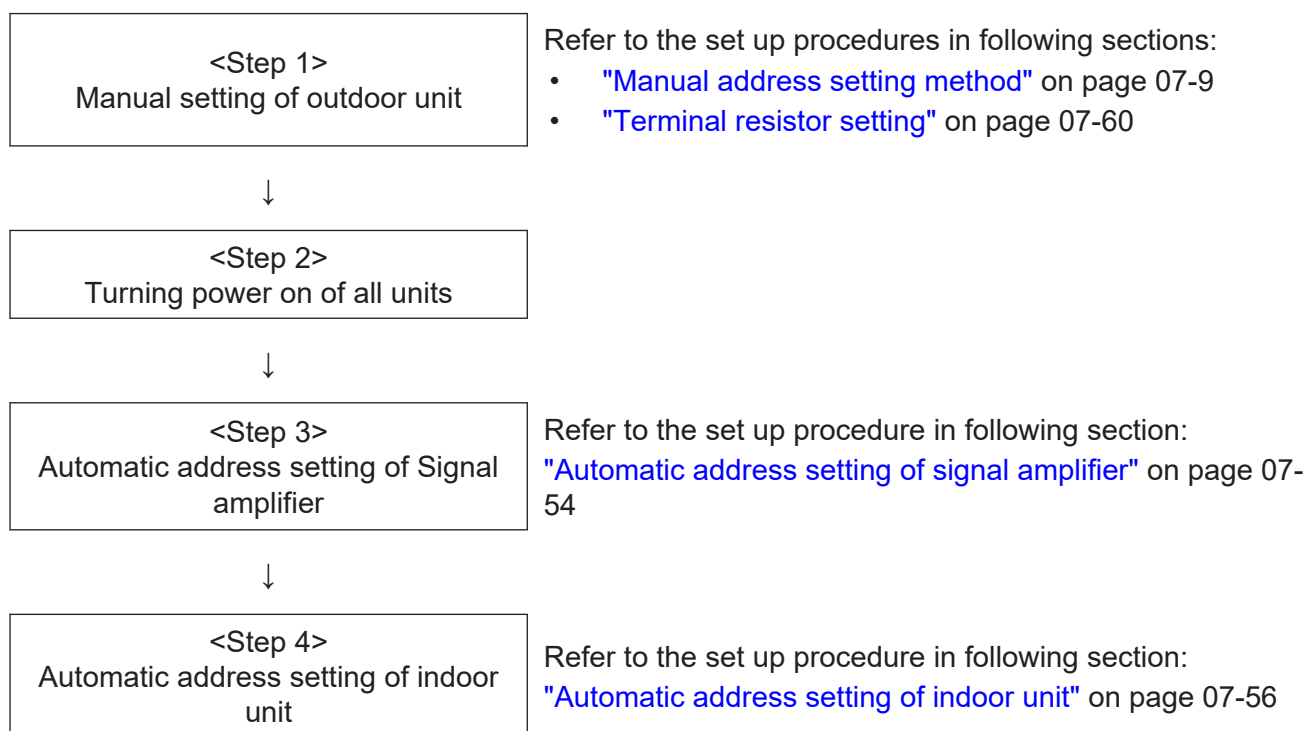

## ■ Components location

Components related to automatic address setting are located on the outdoor unit PCB.

Set the functions of an outdoor unit with the push buttons (SW107, SW108, and SW109) while observing the 7-segment LED lamps (LED105 and LED104) on the PCB.

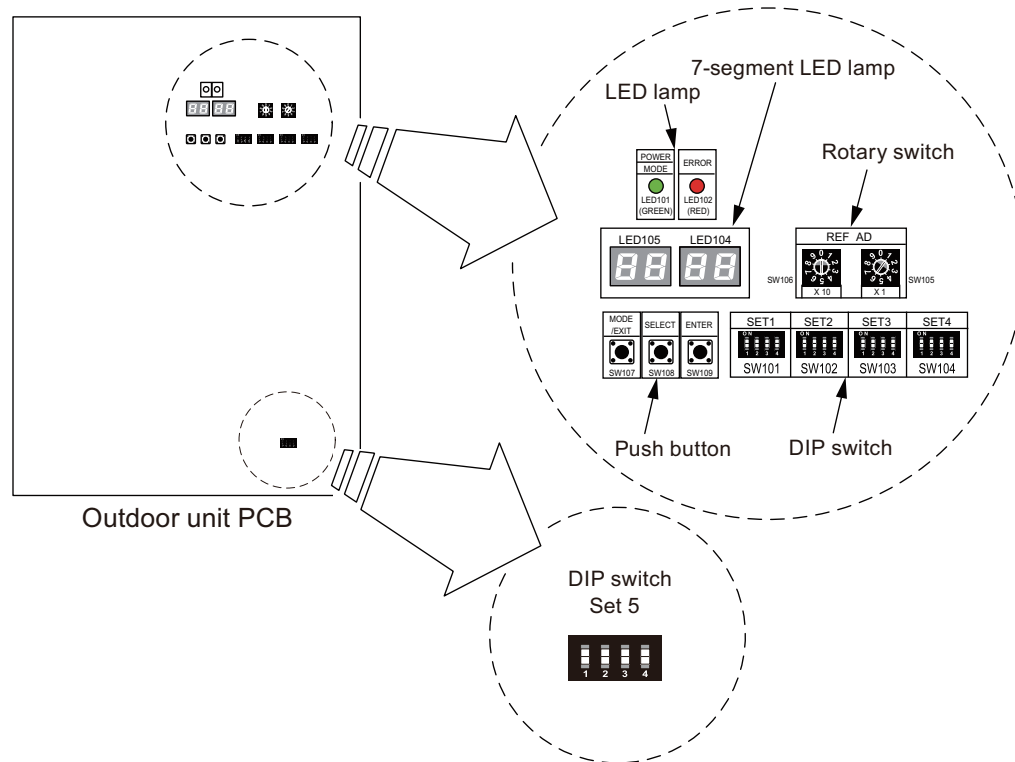


**NOTE:** For details of DIP switch set 5, refer to ["Terminal resistor setting"](#) on page 07-60.

## ■ Preparation

Before performing the setting, be sure to conducting necessary preparations.

1. Make sure that the operation of the outdoor unit has stopped (if it is still running, stop the operation), and turn off the power.
2. Remove the front panel of the outdoor unit.
3. Remove the lid of the electrical component box to expose the PCB.
4. Turn on the power of the outdoor unit. When the system is operated normally, the indicator lamps may light as in following figure:

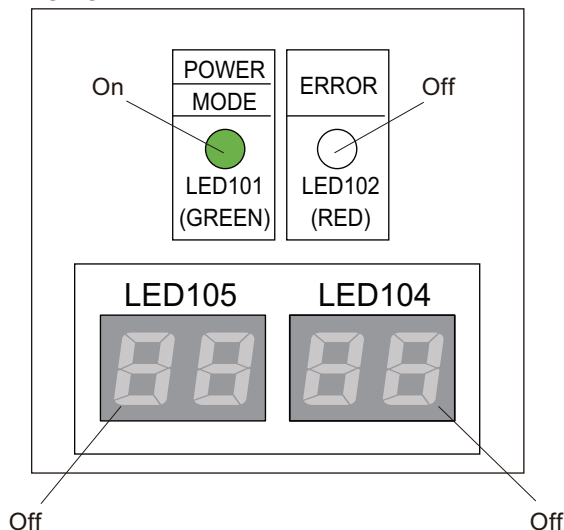


- Make sure that the POWER/MODE indicator lamp (LED101) is on and the ERROR indicator lamp (LED102) is off.
- If there is a system error, the ERROR indicator lamp (LED102) flashes. Check the wiring and power supply. After confirming the ERROR indicator lamp (LED102) has turned off, proceed to the setting procedure.

## ■ Automatic address setting of signal amplifier

### ⚠ CAUTION


- This function can be used for a maximum of 8 signal amplifiers installed within a same refrigerant system.
- Perform this setting on only 1 outdoor unit (master unit) within the same network. No duplicate setting of this function from other outdoor unit is allowed.
- When setting the address of a signal amplifier automatically, be sure to always set the address on the PCB of the signal amplifier to “1” (factory setting).

1. After verifying that the system is operating normally, press the MODE/EXIT button (SW107) once.




2. Press the SELECT button (SW108) to display “F3” on LED104.


\*1: Do not set “F1” and “F9” usually since they are used for maintenance.

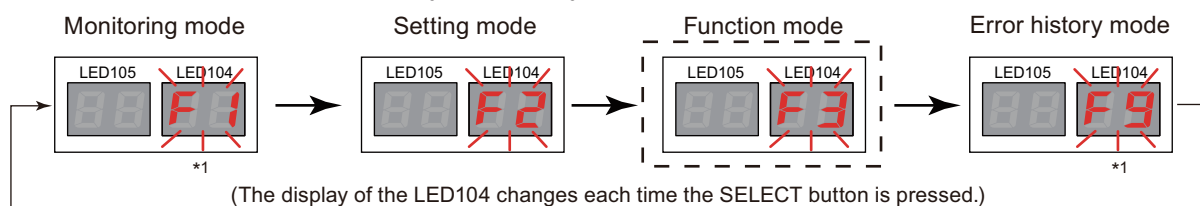


3. When "F3" is displayed on the LED104, press the ENTER button (SW109). Indicator on the LED105 flashes.



4. Press the SELECT button (SW108) to display "10" on the LED105.




5. When "10" is displayed on the LED105, hold down the ENTER button (SW109) for 3 seconds or longer. (Unless it is held down for at least 3 seconds, the selection will not be confirmed.) When the automatic address setting function is activated, the display changes to "run."




6. When the automatic address setting is completed, the number of signal amplifier is displayed on the LED104. Verify that the count matches the number of signal amplifiers being installed.


Example: When 8 signal amplifiers are being connected



7. To exit the automatic address setting, press the ENTER button (SW109) in the setting completed status shown in the previous step.



8. To exit the function mode, press the MODE/EXIT button (SW107).



## RELATED LINKS


["Signal amplifier" on page 07-121](#)

## ■ Automatic address setting of indoor unit

### ⚠ CAUTION


- This function can be used for a maximum of 64 indoor units installed within a same refrigerant system. However, a maximum of 48 indoor units can be installed within the same refrigerant system.
- This function cannot be used for indoor units being connected to other refrigerant systems via the network. For details, refer to ["Transmission cable"](#) in Chapter 6. SYSTEM DESIGN on page 06-74
- When setting the addresses automatically, make sure that the position of following switches are set at "0" (Factory setting).
  - IU AD x10 (SW6)
  - IU AD x1 (SW7)
  - REF AD x10 (SW8)
  - REF AD x1 (SW9)
- When an indoor unit address is set up, a refrigerant circuit address is also set up at the same time. (The refrigerant circuit address of an outdoor unit being connected within the same refrigerant system is set up.)

1. After verifying that the system is operating normally, press the MODE/EXIT button (SW107) once.




2. Press the SELECT button (SW108) to display "F3" on LED104.


\*1: Do not set "F1" and "F9" usually since they are used for maintenance.

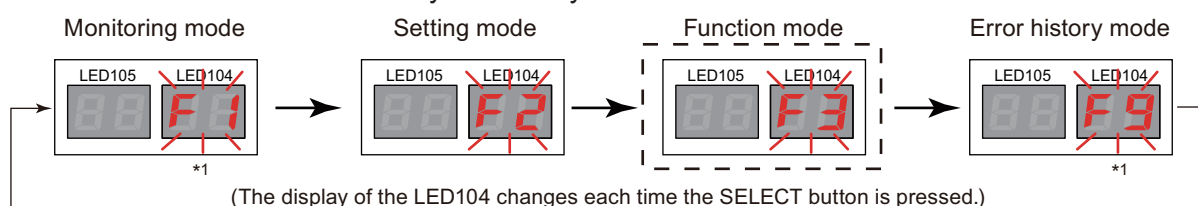


3. When "F3" is displayed on the LED104, press the ENTER button (SW109). Indicator on the LED105 flashes.



4. Press the SELECT button (SW108) to display "11" on the LED105.





5. When "11" is displayed on the LED105, hold down the ENTER button (SW109) for 3 seconds or longer. (Unless it is held down for at least 3 seconds, the selection will not be confirmed.) When the automatic address setting function is activated, the display changes to "run."






6. When the automatic address setting is completed, the number of indoor units of which the automatic address setting succeeded is displayed on the LED105, and the number of indoor units of which the automatic address setting failed is displayed on the LED104.

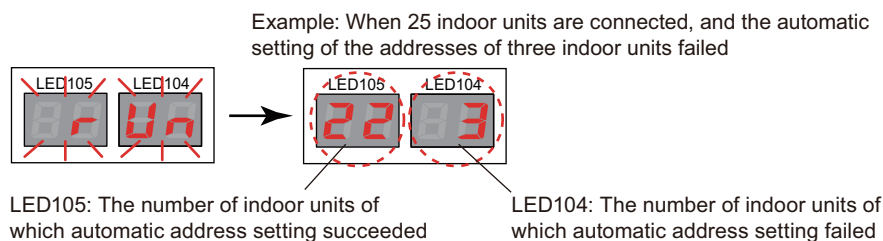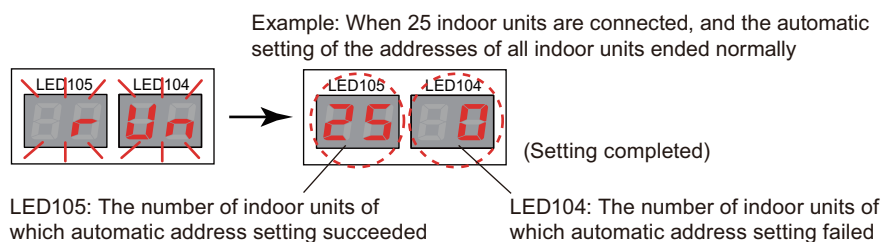

If automatic address setting failed, make sure that all of the rotary switches SW6 to SW9 on the PCBs of the failed indoor units are positioned at "0" and that wiring and power supply are correct, and then perform the automatic address setting again.

7. When the ENTER button (SW109) is pressed, end processing will begin and the LED displays start to blink. For completing this process will take about 30 seconds.




When the setting is completed, the LED displays go off.

## ■ Example of setting flow

### ● Example 1: Setting both addresses of signal amplifiers and indoor units automatically

#### ⚠ CAUTION

- Complete the refrigerant circuit address setting of outdoor units before activating the automatic address setting function.
- Setting the indoor units addresses automatically does not necessarily mean that the addresses are assigned sequentially starting from the indoor unit which is located the closest to the outdoor units. (Instead, addresses are assigned randomly.)  
With respect to the setting of refrigerant circuit addresses, the same address numbers of the refrigerant circuit addresses of the outdoor units being connected within the same refrigerant system are assigned.
- To find out what addresses have been assigned to individual indoor units, perform a separate address check operation.

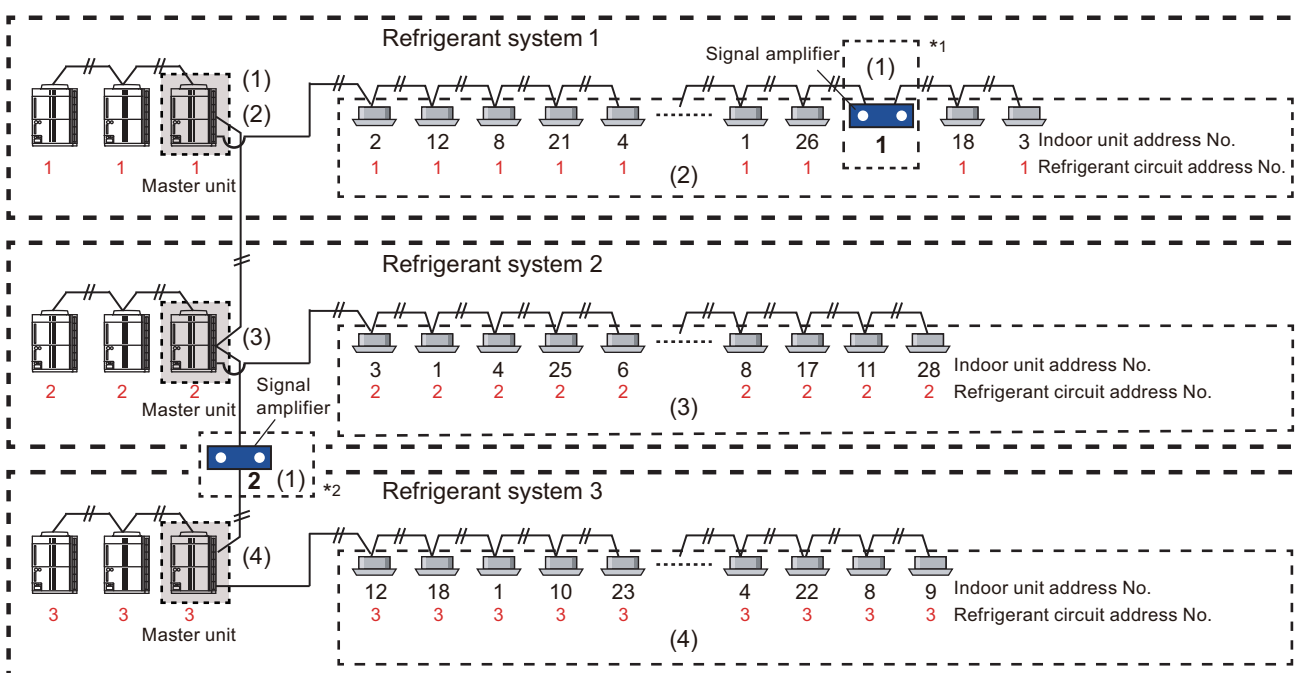

1. Activate the automatic address setting function of signal amplifier on the master unit of Refrigerant system 1. (1)  
An address is automatically assigned to all signal amplifiers on the network.  
(Because an address is also assigned to the signal amplifiers being connected in Refrigerant system 2 and 3, it is not necessary to perform the automatic address setting of these signal amplifiers again on the master units of Refrigerant system 2 and 3.)
2. Activate the automatic address setting function of indoor unit on the master unit of Refrigerant system 1. (2)  
An indoor unit address and a refrigerant circuit address are automatically set up for all indoor units being connected in Refrigerant system 1.
3. Activate the automatic address setting function of indoor unit on the master unit of Refrigerant system 2. (3)  
An indoor unit address and a refrigerant circuit address are automatically set up for all indoor units being connected in Refrigerant system 2.

4. Activate the automatic address setting function of indoor unit on the master unit of Refrigerant system 3. (4)

An indoor unit address and a refrigerant circuit address are automatically set up for all indoor units being connected in Refrigerant system 3.


\*1: If the total wiring length within a segment is expected to exceed 500 m, insert a signal amplifier.  
For details, refer to "Signal amplifier (UTY-VSGXZ1)" in Chapter 5. CONTROL SYSTEM on page 05-166.

\*2: If the number of nodes (the number of units of indoor units, outdoor units, controllers, and others) is expected to exceed 64 (including signal amplifiers), insert a signal amplifier. For details refer to "Signal amplifier (UTY-VSGXZ1)" in Chapter 5. CONTROL SYSTEM on page 05-166.

## ● Example 2: Setting automatically the address of signal amplifiers only (When the addresses of indoor units will be set manually)

### ⚠ CAUTION

- When indoor units are being connected via different refrigerant systems, never activate the automatic address setting function of indoor unit.
- As long as master units are on the same network, any master unit can set the addresses of signal amplifiers automatically. Perform this setting on only 1 outdoor unit (master unit) within the same network. No duplicate setting of this function from other outdoor unit is allowed.

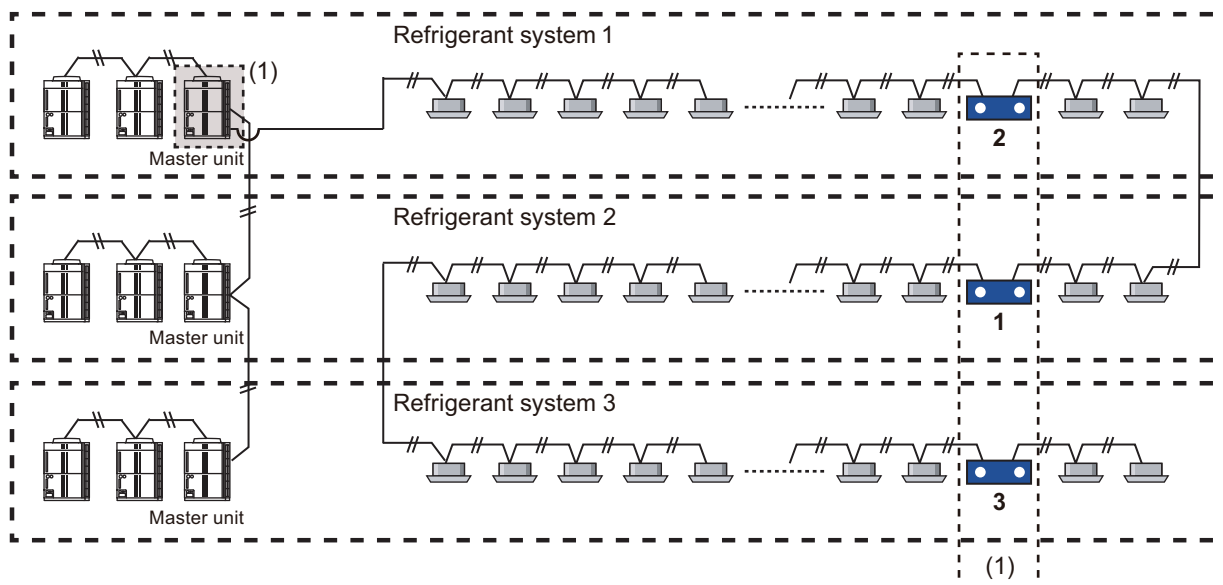

Activate the automatic address setting function of signal amplifier on the master unit of Refrigerant system 1.

An address is automatically assigned to all signal amplifiers on the network.

## 1-6. Terminal resistor setting

### ⚠ CAUTION

- Be sure to set the terminal resistor according to specifications.
- Set the terminal resistor for every network segment (NS).
  - If terminal resistor is set in multiple devices, the overall communication system may be damaged.
  - If terminal resistor is not set in a device, abnormal communication may occur.

The layout of the switches differs by the type of the indoor unit. For the details, refer to "[Setting on indoor unit PCB](#)" on page 07-70.

### NOTES:


- Be sure to set one terminal resistor in a network segment. You can set the terminal resistor at the outdoor unit or signal amplifier.
- When setting the terminal resistor of a signal amplifier, refer to the installation manual of the signal amplifier.
- When setting multiple terminal resistors, take note of the following conditions:
  - How many network segments are there in a VRF system?
  - Where will you set the terminal resistors in a network segment?  
(Condition for 1 segment: Total number of outdoor units, indoor units, and signal amplifiers is less than 64, or the total length of the transmission line is less than 500 m)
  - How many outdoor units are connected in 1 refrigerant system?

Based on the conditions mentioned above, set the outdoor unit DIP switch SET5-4 in accordance with the table below.

DIP switch SET5-4	Terminal resistor	Factory setting
Off	Disabled	◆
On	Enabled	

## ■ Setting example

NS (Network segment ) 1

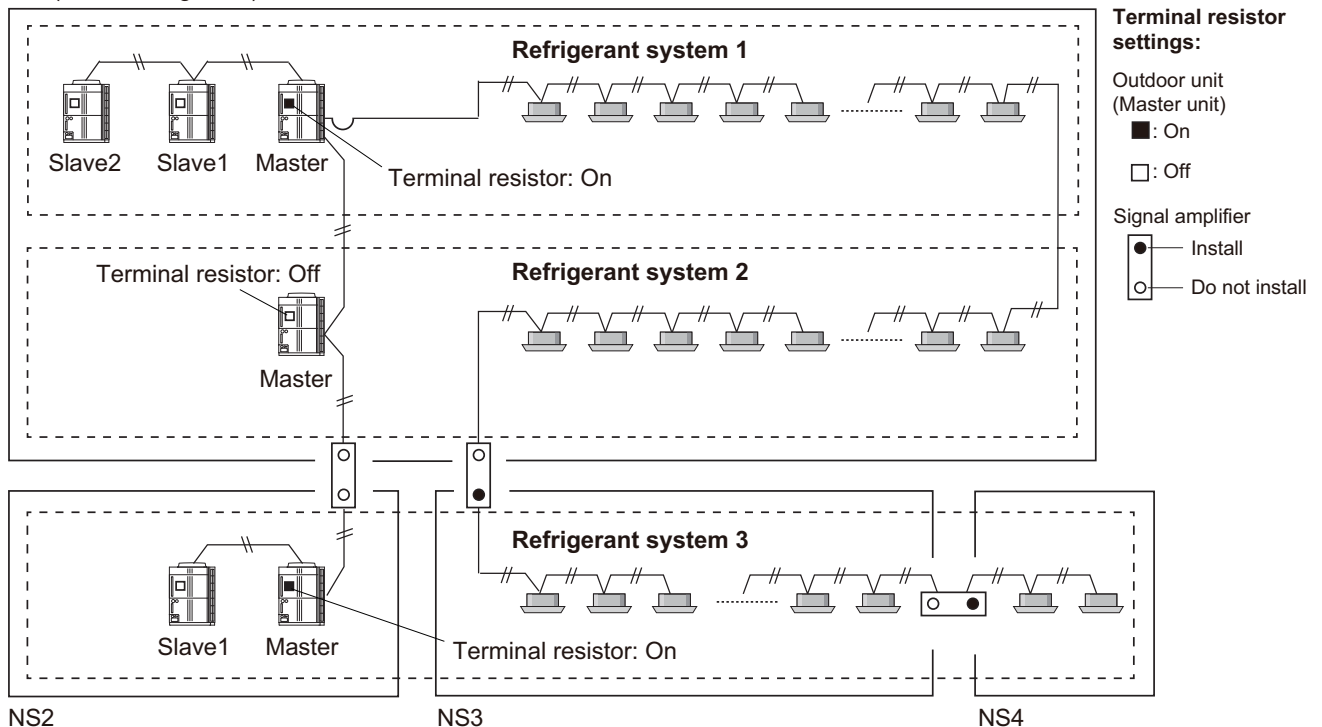

## 2. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

**NOTE:** Incorrect settings can cause a product malfunction.


### RELATED LINKS

- ["Setting on outdoor unit PCB" on page 07-62](#)
- ["Setting on indoor unit PCB" on page 07-70](#)
- ["Setting by service tool \(UTY-ASGXZ1\)" on page 07-77](#)
- ["Indoor unit \(setting by wireless remote controller\)" on page 07-81](#)
- ["Indoor unit \(setting by UTY-RNKU\)" on page 07-87](#)
- ["Indoor unit \(setting by UTY-RSRY, UTY-RHRY\)" on page 07-90](#)
- ["Indoor unit \(setting by UTY-RSKU, UTY-RHKU\)" on page 07-93](#)
- ["Indoor unit \(setting by UTY-RNRUZ\\*\)" on page 07-96](#)
- ["Function details" on page 07-99](#)
- ["Wired remote controller \(UTY-RNKU\)" on page 07-104](#)
- ["Simple remote controller \(UTY-RSKU, UTY-RHKU\)" on page 07-106](#)
- ["Touch panel controller" on page 07-108](#)
- ["Central remote controller \(UTY-DCGYZ\\*\)" on page 07-109](#)
- ["Wired remote controller \(Touch panel\)" on page 07-111](#)
- ["Simple remote controller \(UTY-RSRY, UTY-RHRY\)" on page 07-115](#)
- ["Network convertor \(UTY-VTGX\)" on page 07-117](#)
- ["Network convertor \(UTY-VGGXZ1\)" on page 07-119](#)
- ["Signal amplifier" on page 07-121](#)
- ["Modbus converter for VRF" on page 07-126](#)
- ["Modbus converter for indoor unit" on page 07-129](#)
- ["Network converter for LonWorks" on page 07-131](#)
- ["Duct static pressure setting" on page 07-132](#)
- ["Administrative indoor unit setting" on page 07-133](#)
- ["Energy saving setting on System controller" on page 07-135](#)
- ["Electricity charge apportionment setting \(System controller, Touch panel controller\)" on page 07-141](#)

## 2-1. Setting on outdoor unit PCB

### ■ Components location

Set the functions of an outdoor unit with the push buttons (SW107, SW108, and SW109) while observing the 7-segment LED lamps (LED105 and LED104) on the PCB.

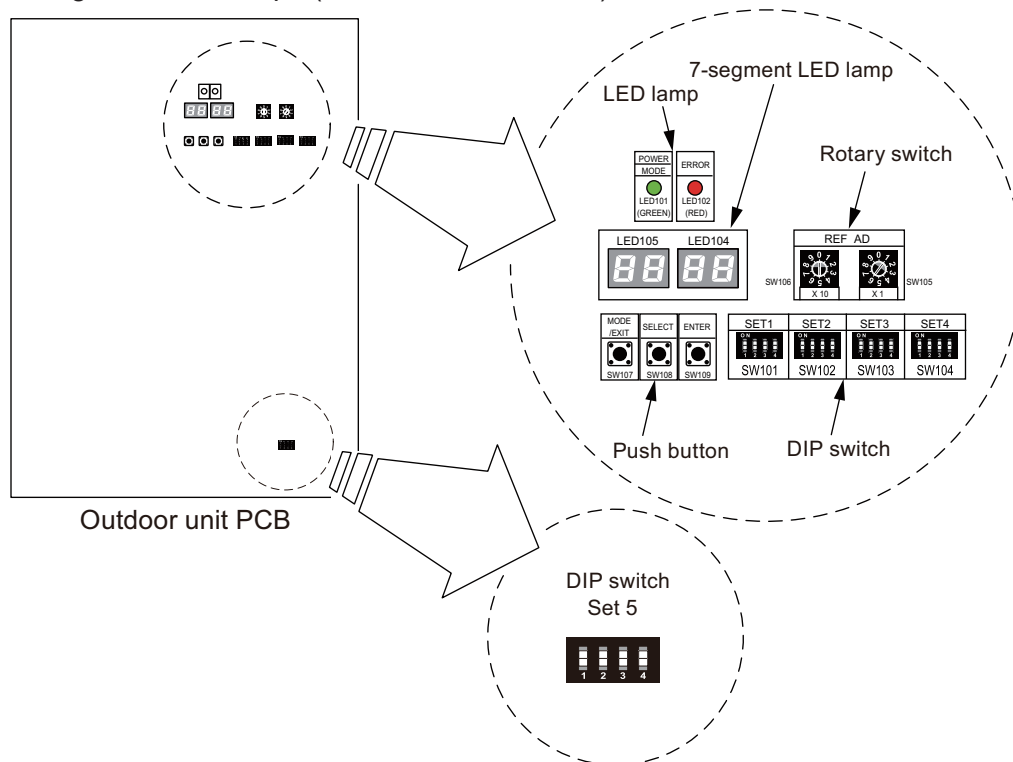


Actual switch position may differ depending on the outdoor unit.

### ■ Preparation

Before performing the setting, be sure to conducting necessary preparations.

1. Make sure that the operation of the outdoor unit has stopped (if it is still running, stop the operation), and turn off the power.
2. Remove the front panel of the outdoor unit.
3. Remove the lid of the electrical component box to expose the PCB.


4. Turn on the power of the outdoor unit. When the system is operated normally, the indicator lamps may light as in following figure:

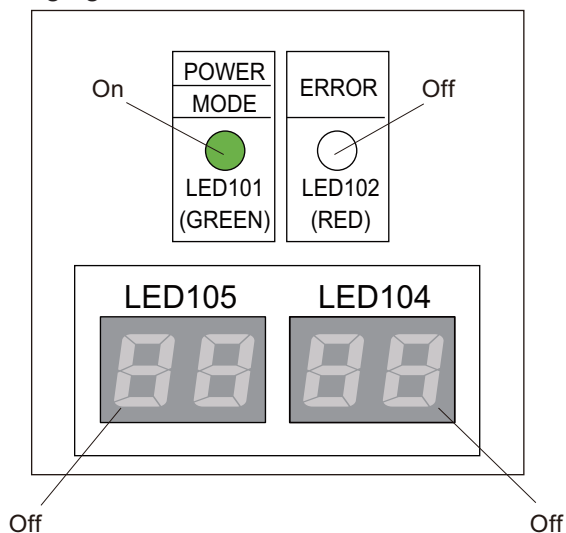

- Make sure that the POWER/MODE indicator lamp (LED101) is on and the ERROR indicator lamp (LED102) is off.
- If there is a system error, the ERROR indicator lamp (LED102) flashes. Check the wiring and power supply. After confirming the ERROR indicator lamp (LED102) has turned off, proceed to the setting procedure.


## ■ Function setting method

1. After verifying that the system is operating normally, press the MODE/EXIT button (SW107) once.




2. Press the SELECT button (SW108) to display "F2" on LED104.

\*1: Do not set "F1" and "F9" usually since they are used for maintenance.

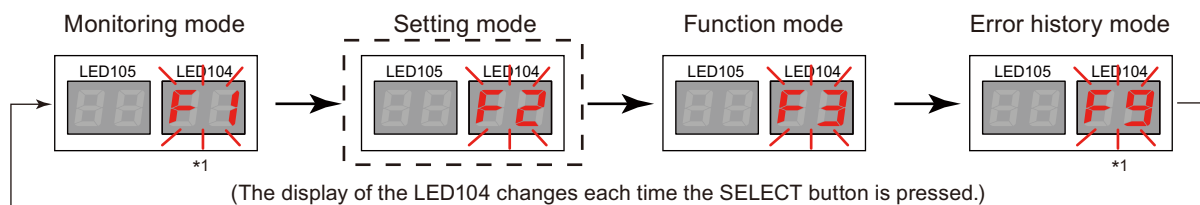


3. When "F2" is displayed on the LED104, press the ENTER button (SW109). Indicator on the LED105 flashes, and the flashing of "F2" on the LED104 stops and lights a number.




4. With referring to "Setting list" on page 07-65, press the SELECT button (SW108) to display the code number of the mode you want to set on the LED105.

Example: To select switching between Forced stop and Emergency stop



Then, press the ENTER button (SW109) to confirm the mode you want to set.

Flashing of LED105 stops and lights a number, and the lit number on the LED104 starts to flash.




5. Again, with referring to "Setting list" on page 07-65, press the SELECT button (SW108), and display the code number of the function you want to set on the LED104.

Example: To select the Emergency stop function




Then, press the ENTER button (SW109) to confirm the function you want to set.


Flashing of LED104 stops and lights a number.




To set another function, press the ENTER button (SW109) in the completed state of current setting. Then, repeat steps 4. and 5. to set each function.



6. After all necessary function settings are completed, press the ENTER button (SW109) in the setting completed state shown in the previous step. 5 seconds after, even if the ENTER button (SW109) is not pressed, the LED105 starts to flash automatically.



Then, press the MODE/EXIT button (SW107) to exit the function setting mode.





## Setting list

**NOTE:** Code numbers not listed in the table blow are not available in this product. Do not set the unsupported code numbers.

LED105 code no.		Setting mode	LED104 code no.		Setting function	Factory setting	Outdoor unit		Remarks
							Master	Slave	
0	0	Pipe length setting	0	0	Standard (131 to 213 ft) (40 to 65 m)	◆	○	—*1	Pipe length means the length between master outdoor unit and the nearest indoor unit.
			0	1	Short (less than 131 ft) (less than 40 m)				
			0	2	Medium (213 to 295 ft) (65 to 90 m)				
			0	3	Long 1 (295 to 394 ft) (90 to 120 m)				
			0	4	Long (394 to 492 ft) (120 to 150 m)				
1	0	Sequential start shift	0	0	Normal	◆	○	—*1	The start up timing of outdoor unit (compressor) can be set so that it can be delayed several seconds. This feature is useful when multiple outdoor units are installed and turned on at the same time to limit the starting current.
			0	1	21 sec delay				
			0	2	42 sec delay				
			0	3	63 sec delay				
1	1	Cooling capacity shift	0	0	Normal mode	◆	○	—*1	
			0	1	Save energy mode				
			0	2	High power mode 1				
			0	3	High power mode 2				
			0	4	Prohibited				
1	2	Heating capacity shift	0	0	Normal mode	◆	○	—*1	
			0	1	Save energy mode				
			0	2	High power mode 1				
			0	3	High power mode 2				
1	3	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
1	7	Height difference between indoor units	0	0	Standard	◆	○	—*1	If installing the indoor units (even only one unit) to a lower floor than the outdoor unit, and the height difference between the indoor units is 3 m or more (i.e., if installing the indoor units on separate floors), set "02 (height difference)."
			0	1	Prohibited				
			0	2	Height difference				
			0	3	Prohibited				
			0	4	Prohibited				
1	9	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
			0	2	Prohibited				

LED105 code no.		Setting mode	LED104 code no.		Setting function	Factory setting	Outdoor unit		Remarks
							Master	Slave	
2	0	Switching between batch stop or emergency stop	0	0	Batch stop	◆	○	—*1	<p>This mode selects the pattern of the stop function to be operated by the external input terminal (CN134).</p> <ul style="list-style-type: none"> <li>Batch stop: The stop of all indoor units connected to same refrigerant system due to input signal coming from CN134.</li> <li>Emergency stop: When emergency stop is actuated, the indoor unit does not accept the operation command from the remote controller. On the other hand, when the emergency stop is released (no input from CN134), the air conditioner does not return to the original operation until operate indoor unit by the remote controller.</li> </ul>
			0	1	Emergency stop				
2	1	Operation mode selecting method	0	0	Priority given to the first command	◆	○	—*1	<p>Select the priority setting of the operation mode.</p> <ul style="list-style-type: none"> <li>Priority given to the first command: Priority is given to the operation mode which is set first.</li> <li>Priority given to external input of outdoor unit: Priority is given to the operation mode which is set by the external input terminal (CN132).</li> <li>Priority given to administrative indoor unit: Priority is given to the operation mode of the administrative indoor unit which is set by the wired remote controller.</li> </ul>
			0	1	Priority given to external input of outdoor unit				
			0	2	Priority given to administrative indoor unit				
2	2	Snow falling protection fan mode	0	0	Normal mode	◆	○	—*1	<p>This mode operates the fans of outdoor units in order to prevent the units from stopping operation when they are covered by snow.</p>
			0	1	Snow falling protection fan mode				
2	3	Interval setting for snow falling protection fan mode	0	0	Standard (30 min)	◆	○	—*1	<p>When the snow falling protection fan mode is set, the operation interval of the fans of outdoor units can be selected.</p>
			0	1	Short 1 (5 min)				
			0	2	Short 2 (10 min)				
			0	3	Short 3 (20 min)				

LED105 code no.		Setting mode	LED104 code no.		Setting function	Factory setting	Outdoor unit		Remarks
							Master	Slave	
2	4	High static pressure mode	0	0	Standard	◆	○	○	When installing a duct to the blow-off outlet of an outdoor unit, set the high static pressure mode according to the static pressure of the duct to be installed. Furthermore, use this setting if the air blow of an outdoor unit is poor, such as when installed in a place with a low ceiling.
			0	1	High static pressure 1 (Equivalent to 30 Pa)				
			0	2	High static pressure 2 (Equivalent to 80 Pa)				
			0	3	Prohibited				
2	5	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
2	6	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
2	7	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
2	8	Prohibited	0	0	Celsius (°C)	◆	○	○	
			0	1	Fahrenheit (°F)				
2	9	Prohibited	0	0	MPa	◆	○	○	
			0	1	psi				
3	0	Energy saving level setting	0	0	Level 1 (Stop)	◆	○	—*1	The capacity limit in Energy saving peak cut control operation can be selected by the external input terminal (CN133). With lowering the level, the energy efficiency get higher but the cooling or heating performance gets lower.
			0	1	Level 2 (Operated at 40% capacity)				
			0	2	Level 3 (Operated at 60% capacity)				
			0	3	Level 4 (Operated at 80% capacity)				
			0	4	Level 5 (Operated at 100% capacity)				
3	2	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
			0	2	Prohibited				
3	3	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
3	5	Presence of heater selection control using outdoor temperatur e	0	0	Disabled	◆	○	—*1	For heater control switching, setting of heater selection control using outdoor temperature 1 and 2 is required. (Setting value of function setting number 61 on indoor unit: 03 or 04) For details, refer to "External output" in Chapter 8. EXTERNAL INPUT AND OUTPUT on page 08-5.
			0	1	Enabled				
3	6	Outdoor temperatur e zone boundary temperatur e A	0	0	-4.0 °F (-20 °C)	◆	○	—*1	Setting if changing the outdoor temperature setting for heat pump prohibition zone is required when heater selection control using outdoor temperature 1 and 2 are performed on indoor unit. For details, refer to "External output" in Chapter 8. EXTERNAL INPUT AND OUTPUT on page 08-5.
			0	1	-0.4 °F (-18 °C)				
			0	2	3.2 °F (-16 °C)				
			0	3	6.8 °F (-14 °C)				
			0	4	10.4 °F (-12 °C)				
			0	5	14.0 °F (-10 °C)				
			0	6	17.6 °F (-8 °C)				
			0	7	21.2 °F (-6 °C)				
			0	8	24.8 °F (-4 °C)				

LED105 code no.		Setting mode	LED104 code no.		Setting function	Factory setting	Outdoor unit		Remarks
							Master	Slave	
3	7	Outdoor temperatur e zone boundary temperatur e B	0	0	42.8 °F (6 °C)	◆	○	—*1	Setting if changing the outdoor temperature setting for heat pump only zone is required when heater selection control using outdoor temperature 1 is performed on indoor unit. For details, refer to "External output" in Chapter 8. EXTERNAL INPUT AND OUTPUT on page 08-5.
			0	1	14.0 °F (-10 °C)				
			0	2	17.6 °F (-8 °C)				
			0	3	21.2 °F (-6 °C)				
			0	4	24.8 °F (-4 °C)				
			0	5	28.4 °F (-2 °C)				
			0	6	32.0 °F (-0 °C)				
			0	7	35.6 °F (2 °C)				
			0	8	39.2 °F (4 °C)				
			0	9	42.8 °F (6 °C)				
			1	0	46.4 °F (8 °C)				
			1	1	50.0 °F (10 °C)				
			1	2	53.6 °F (12 °C)				
			1	3	57.2 °F (14 °C)				
			1	4	60.8 °F (16 °C)				
			1	5	64.4 °F (18 °C)				
4	0	Capacity priority setting (in low noise mode)	0	0	Off (Quiet priority)	◆	○	—*1	If the cooling/heating performance becomes insufficient when the low noise mode is set, it is possible to set "Capacity priority" that automatically cancels the low noise mode. (Once performance is restored, the mode will automatically return to the low noise mode.)
			0	1	On (Capacity priority)				
4	1	Low noise mode setting	0	0	Off (Normal)	◆	○	—*1	
			0	1	On (Low noise mode)				
4	2	Low noise mode operation level setting	0	0	Level 1 (55 dB)	◆	○	—*1	The noise level when operating in the low noise mode can be set.
			0	1	Level 2 (50 dB)				
6	1	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
6	2	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
6	3	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
7	0	Electricity meter no. setting 1 *2	0	0	Setting number x00	◆	○	○	Set the ones digit and tens digit of the number of the electricity meter connected to CN135.
			0	1	Setting number x01				
			•	•	•				
			•	•	•				
			•	•	•				
			9	8	Setting number x98				
7	1	Electricity meter no. setting 2 *2	9	9	Setting number x99		○	○	Set the hundreds digit of the number of the electricity meter connected to CN135.
			0	0	Setting number 0xx	◆			
			0	1	Setting number 1xx				
			0	2	Setting number 2xx				

LED105 code no.		Setting mode	LED104 code no.		Setting function	Factory setting	Outdoor unit		Remarks
							Master	Slave	
7	2	Electricity meter pulse setting 1 *3	0	0	Setting number xx00	◆	○	○	Set the ones digit and tens digit of the number of the electricity meter pulse setting connected to CN135.
			0	1	Setting number xx01				
			•	•	•				
			•	•	•				
			•	•	•				
			9	8	Setting number xx98				
			9	9	Setting number xx99				
7	3	Electricity meter pulse setting 2 *3	0	0	Setting number 00xx	◆	○	○	Set the hundreds digit and thousands digit of the electricity meter pulse setting connected to CN135.
			0	1	Setting number 01xx				
			•	•	•				
			•	•	•				
			•	•	•				
			9	8	Setting number 98xx				
			9	9	Setting number 99xx				
9	1	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
			0	2	Prohibited				
			0	3	Prohibited				
			0	4	Prohibited				
9	5	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
9	6	Prohibited	0	0	Prohibited	◆			Setting prohibited
			0	1	Prohibited				
			0	2	Prohibited				

\*1: Do not set this for outdoor units with "Slave" setting.

\*2: When electricity meter number is set to "000" and "201 to 299", the pulses input to CN135 become ineffective. Available setting number is "001" to "200".

\*3: When the electricity meter pulse setting is set to "0000", the pulses input to CN135 become ineffective. Available setting number is "0001" to "9999".

## 2-2. Setting on indoor unit PCB


Components related to function setting are located on the indoor unit main PCB.

### ■ Components location


Related components location is differ depending on the type of the indoor unit as follows:

Type of PCB	Type of indoor unit
Type 1	Compact cassette, Cassette, Mini duct, Slim duct/Slim concealed floor, Medium static pressure duct, High static pressure duct, Floor/ ceiling, Ceiling
Type 2	Wall mounted (ASUB18, 24)
Type 3	Wall mounted (ASUA7, 9, 12, 14TLAV)
Type 4	Circular flow cassette
Type 5	Wall mounted (ASUA4, 7, 9, 12, 14TLAV2)
Type 6	Wall mounted (ASUB30, 36)
Type 7	Compact floor


#### • Type 1:

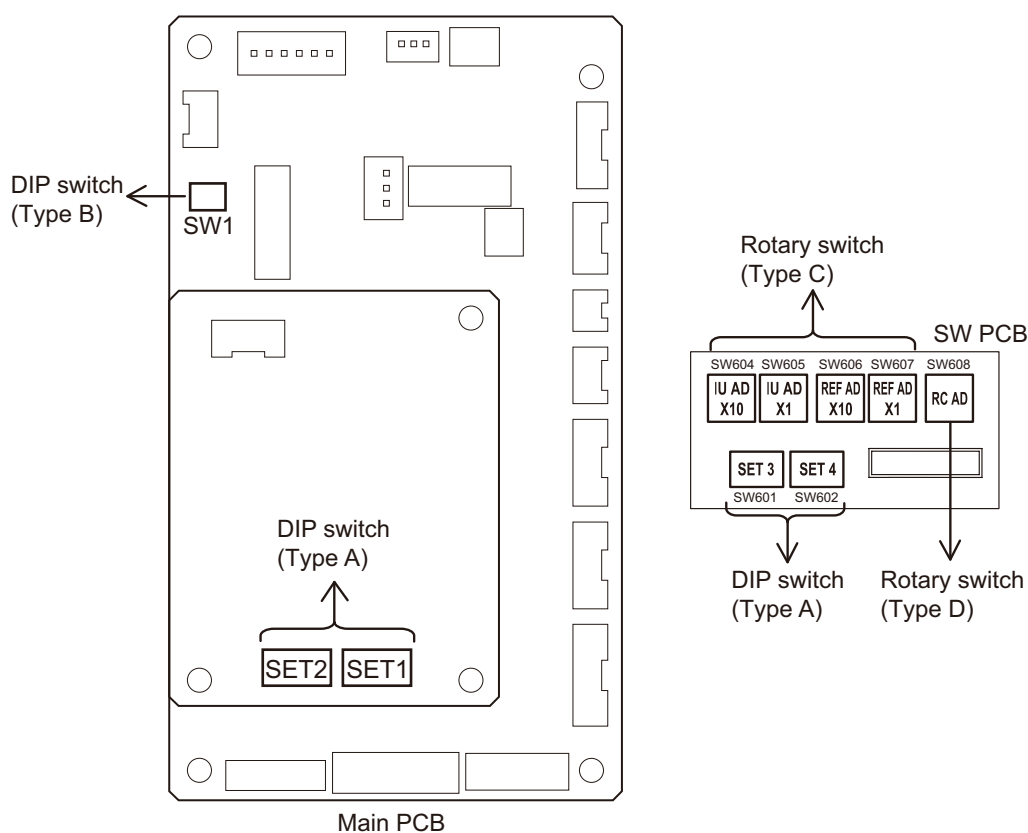



- **Type 2:**

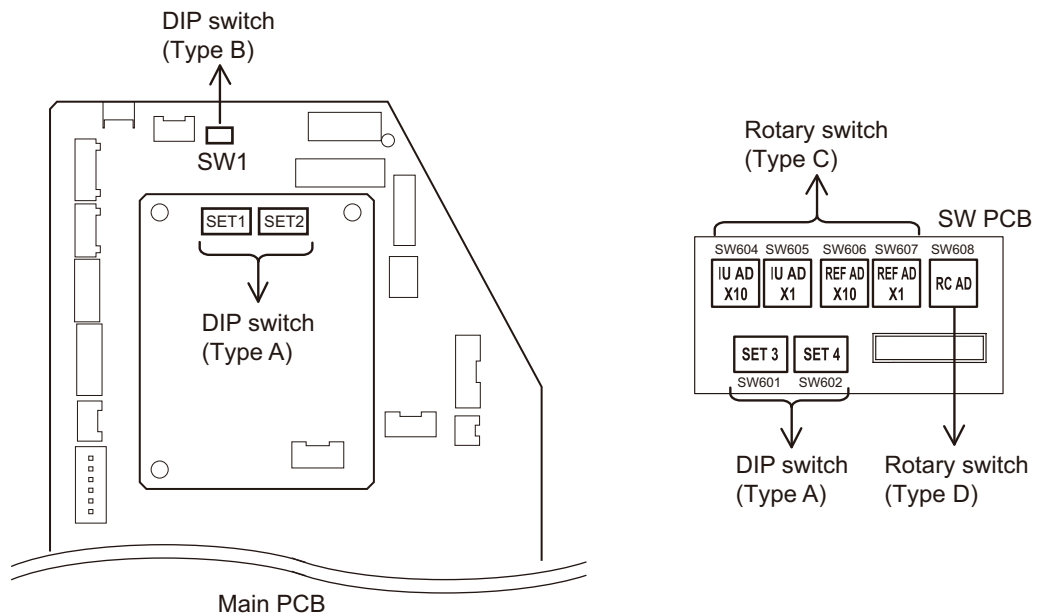



- **Type 3:**

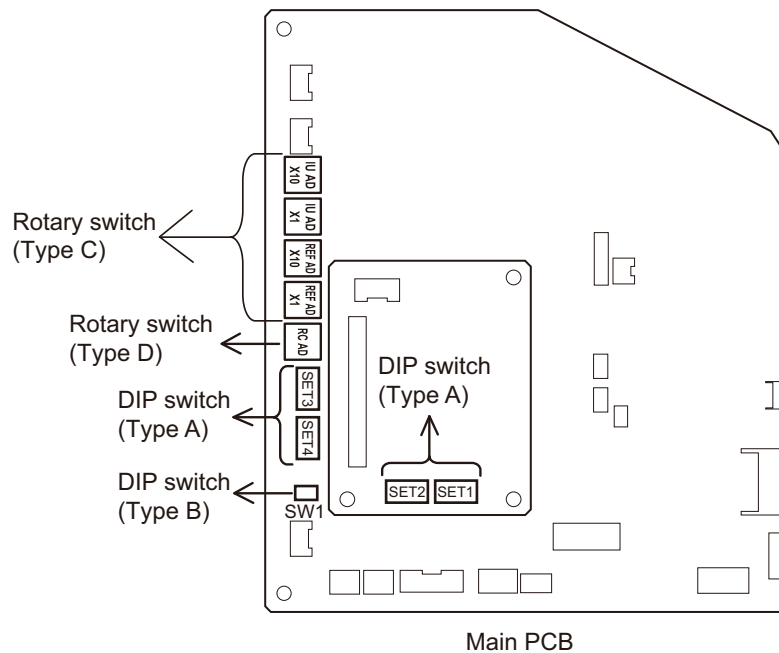



- **Type 4:**

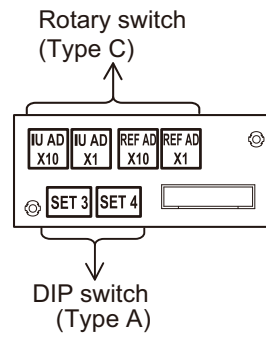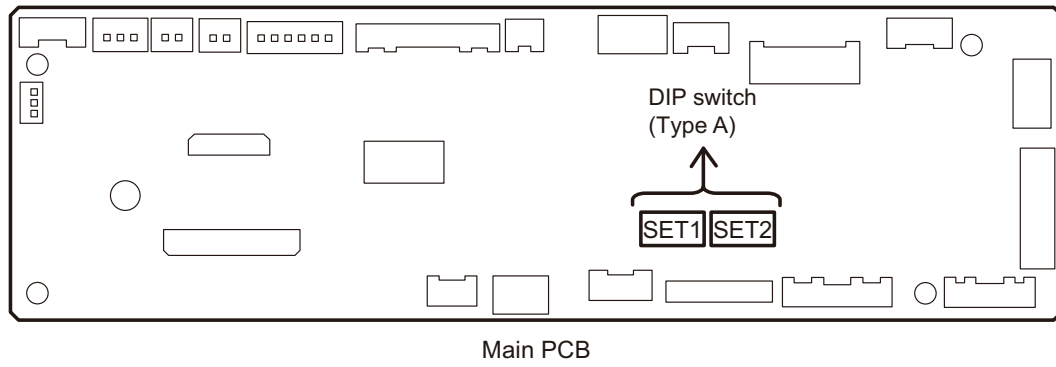

- **Type 5:**

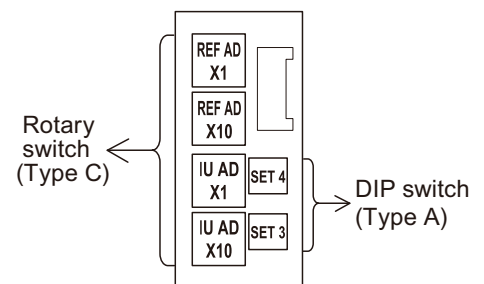
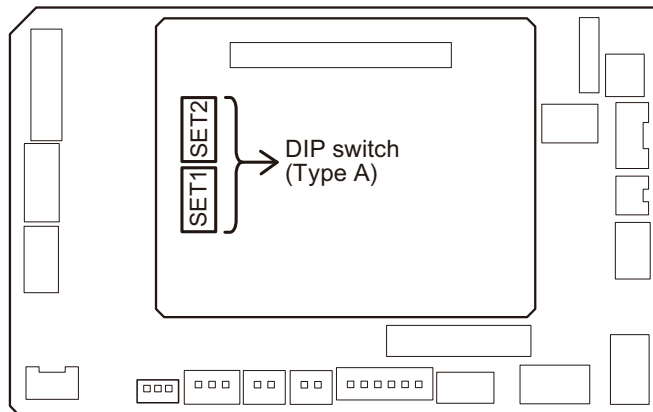


- **Type 6:**

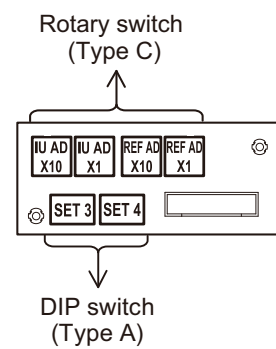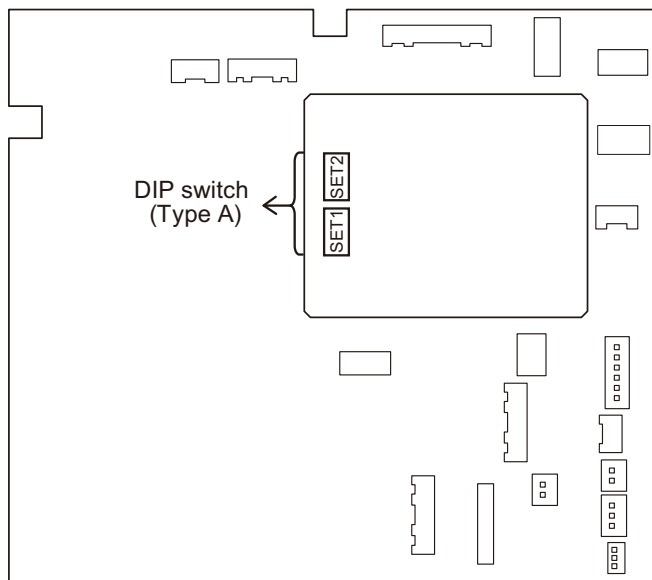



• Type 7:

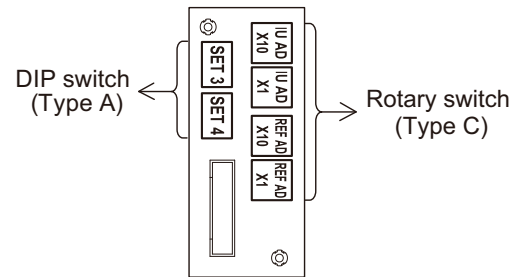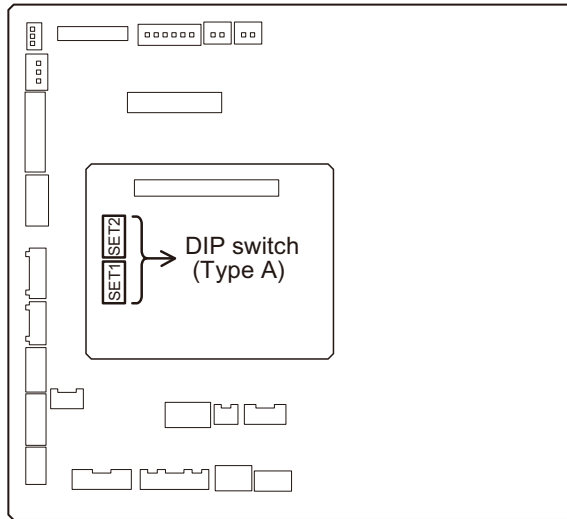

## Switch type and setting item

DIP switch	Type A	SET1	1	Prohibited (Indoor unit capacity setting)
			2	Prohibited (Indoor unit capacity setting)
			3	Prohibited (Indoor unit capacity setting)
			4	Prohibited (Indoor unit capacity setting)
		SET2	1	Prohibited (Indoor unit capacity setting)
			2	External input select "edge/pulse"
			3	Fan delay switch
			4	Prohibited
		SET3	1	Wireless remote controller custom code switch 1
			2	Wireless remote controller custom code switch 2
			3	Prohibited
			4	Prohibited
Rotary switch	Type C	SET3	1	Drainage function switch (Mini duct type and Slim duct type only)
			2	Auto louver grille setting switch (Mini duct type and Slim duct type only)
			3	Prohibited
			4	Prohibited
		SW1		Remote controller wire type switch
		IU AD	x1	Indoor unit address switch 1
			x10	Indoor unit address switch 2
			REF AD	Refrigerant circuit address switch 1
			x10	Refrigerant circuit address switch 2
Rotary switch	Type D	RC AD		Remote controller address switch
		IU AD	x1	Indoor unit address switch 1
			x10	Indoor unit address switch 2
			REF AD	Refrigerant circuit address switch 1
			x10	Refrigerant circuit address switch 2
		RC AD		Remote controller address switch

## ■ DIP switch setting

- **SET2-2: “Edge” or “Pulse” selection of external input**

SET2-2	External input select	Factory setting
Off	Edge	◆
On	Pulse	

- **SET2-3: Switching of Fan delay function**

Fan delay is a function to delay the stop of cooling fan when the air conditioner is stopped.

When auxiliary heater is connected, this switch should be set at “On (Enabled)”. When connecting the auxiliary heater, be careful enough.

SET2-3	Fan delay	Factory setting
Off	Disabled	◆
On	Enabled	

**NOTE:** When SET2-3 is set to “Off (Disabled)”, use room temperature sensor of wired remote controller to prevent erroneous detection of room temperature.

- **SET2-4: Setting prohibited**

SET2-4	Fan delay	Factory setting
Off	Off (Fixed)	◆
On	Setting prohibited	

- **SET3-1, 3-2: Custom code switching of wireless remote controller**


This DIP switch sets the custom code of the wireless remote controller of an indoor unit.

If multiple indoor units are being installed in the same room, switch the custom codes of the corresponding wireless remote controllers in order to prevent their signals from being mixed.

When switching the custom code of the wireless remote controller of an indoor unit, be sure to also switch the code setting on the paired wireless remote controller at the same time.

SET3-1	SET3-2	Custom code	Factory setting
Off	Off	Type A	◆
On	Off	Type B	
Off	On	Type C	
On	On	Type D	

**How to switch the code on the wireless remote controller:**

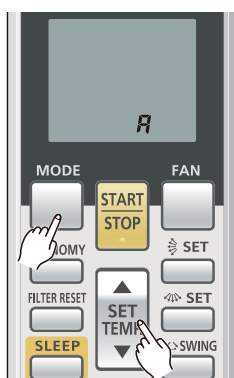

1. Press the MODE button for more than 5 seconds to start the code change.
2. Press the SET TEMP.▲ or ▼ button to select the desired code.

→ A → B → C → D →

3. Press the MODE button again to complete the code change.

- **SET3-3, SET3-4: Setting prohibited**

SET3-3	SET3-4	Factory setting
Off (Fixed)	Off (Fixed)	◆
On (Setting prohibited)	On (Setting prohibited)	

- **SET4-1: Switching of Drainage function** (for Mini duct type and Slim duct type only)  
If the drain pump is not used, this switch should be set at “On (Disabled)”.

SET4-1	Drainage function	Factory setting
Off	Enabled	◆
On	Disabled	

**NOTE:** When set to “On” (Drainage function: Disabled), be careful not to cause water leakage by the drainage.

- **SET4-2: Switching of Auto louver grille setting** (for Mini duct type and Slim Duct type only)  
When Auto louver grille kit (optional parts) is attached, this switch should be set “On (Enabled)”.

SET4-2	Auto louver grille setting	Factory setting
Off	Disabled	◆
On	Enabled	

- **SET4-3: Setting prohibited**

SET4-3	Factory setting
Off (Fixed)	◆
On (Setting prohibited)	

- **SET4-4: Setting prohibited**

SET4-4	Factory setting
Off (Fixed)	◆
On (Setting prohibited)	

- **SW1: Switching of Remote controller wire type setting**

SW1	Remote controller wire type	Factory setting
2WIRE	2-wire	◆
3WIRE	3-wire	

## ■ Rotary switch setting

- **IU AD (Indoor unit address): Switching of Indoor unit address**

Sets the indoor unit addresses. For details, refer to the indoor unit address conversion table in "Address setting" on page 07-4.

Rotary switch	Description	Remarks	Factory setting
IU AD x1	Indoor unit address Switch 1	Indoor unit address (the first digit)	0
IU AD x10	Indoor unit address Switch 2	Indoor unit address (the second digit)	0

- **REF AD (Refrigerant circuit address): Switching of Refrigerant circuit address**

Sets the refrigerant circuit addresses. For details, refer to the refrigerant circuit address conversion table in "Address setting" on page 07-4.

Rotary switch	Description	Remarks	Factory setting
REF AD x1	Refrigerant circuit address Switch 1	Refrigerant circuit address (the first digit)	0
REF AD x10	Refrigerant circuit address Switch 2	Refrigerant circuit address (the second digit)	0

- **RC AD (Remote controller address): Switching of Remote controller address**

When the indoor unit is wired by remote controller group, to identify the indoor unit in the remote controller group, the number (remote controller address) in the remote controller group is set.

- **3-wire type** (only for manual address setting)

Set the remote controller address in order of 0, 1, 2, 3..., 15. (Blank is not allowed.)

Rotary switch	Description	Remarks	Factory setting
RC AD	Remote controller address	Remote controller address	0

- **2-wire type**

It can choose either automatic address setting or manual address setting.

- When setting the automatic address:

Set the remote controller address at "0 (Factory setting)" only.

- When setting the manual address:

Set the remote controller address in the 1, 2, 3..., 15.

Rotary switch	Description	Remarks	Factory setting
RC AD	Remote controller address	Remote controller address	0


**NOTE:** When performing manual address setting, this setting cannot be set at "0 (Factory setting)".

## 2-3. Setting by service tool (UTY-ASGXZ1)

### Remote setting

Function setting of the indoor unit and function setting defined as Function “F2” on the outdoor unit can be changed remotely. (Some settings are not available.)

The processed result can also be output to a CSV file.

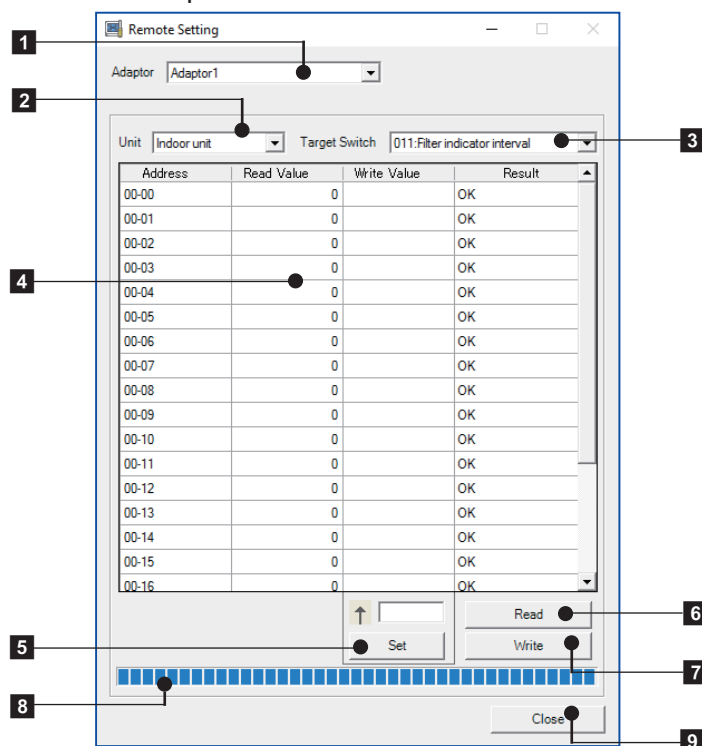

#### 1 Adapter selection

Selects the transmission adaptor that connects the system containing units perform processing.

#### 2 Unit type

Selects the unit type of the indoor unit and the outdoor unit that perform processing.

#### 3 Target switch

Displays the target item of the local function setting. (No. + name)

#### 4 Unit list

Displays a list of addresses (Refrigerant no. - Unit no.) of the target unit selected in 1 and 2. In addition, multiple units can be handled simultaneously by arbitrary selection (background blue color) for target unit selection. This list displays the following information, in addition to address.

- Read value  
Displays the value of the item selected by combo box in 3 acquired from the target unit.
- Write value  
Displays the set value specified in 5.
- Result  
Displays the result (OK/NG) when 6 and 7 are pressed. When outside the target, '--' is displayed.

**5 Write value input**

The value input here is set at the write value field of the unit selected in **4**. This input value becomes the setting change value of the item selected in **3**.

**NOTES:**

- For the set value of each function setting, refer to "[Function details](#)" on page 07-99, or the Installation manual of the indoor unit or the outdoor unit.
- When clearing the write value, click the Set button with the field blank after selecting the target unit.

**6 Read button**

Acquires the value of the item selected in **3** from the unit selected in **4**, and displays it at the read value field in **4**. After the acquirement of the value is completed, subsequent processing can be canceled by clicking the button again.

**7 Write button**

Performs setting of the value input at the write value field of **4**. for the unit selected in **4**.

Thereafter, the setting contents result is displayed at the read value field of **4** for check use. After the setting is completed, subsequent processing can be canceled by clicking the button again.

**8 Progress bar**

Displays the processing progress of **6** or **7**.

**9 Close button**


Closes this screen (Remote Setting screen). However, when read/write processing for unit was performed, confirmation dialog box opens to confirm whether to save the data to a CSV file.

**NOTES:**


- When both remote setting of the outdoor unit and the setting from the push button on the PCB of the outdoor unit are performed, the setting performed later will be valid.
- When the remote setting of the outdoor unit and the setting from the push button on the PCB of the outdoor unit are performed at the same time, the remote setting will be invalid. Check that the push button is not used before starting the remote setting.

## Remote perform function

Function defined as “F3” on the outdoor unit can be performed remotely.

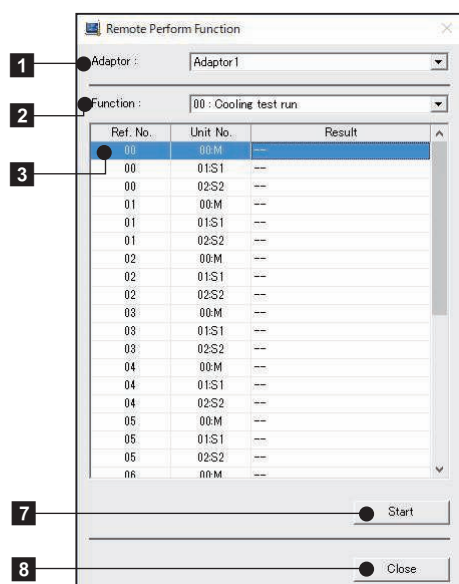

When selecting the function applied to multiple outdoor units

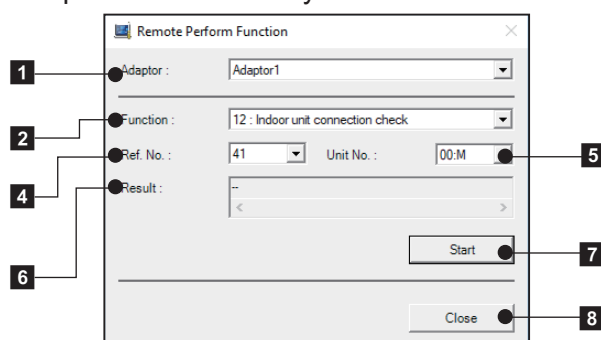

When selecting the function applied to one outdoor unit

### 1 Adapter name selection

Selects the transmission adapter that connects the target unit.

### 2 Function selection

Selects the function to be operated remotely. The window display varies depending on the selected function.

### 3 Outdoor unit selection (for the function applied to multiple outdoor units)

Specifies the outdoor unit to be operated remotely. After the function is performed, the result is displayed.

### 4 Refrigerant system address selection

Specifies the refrigerant system address which the outdoor unit to be operated remotely belongs to.

### 5 Outdoor unit selection

Specifies the outdoor unit to be operated remotely.

### 6 Result (for the function applied to one outdoor unit)

After the function is performed, the result is displayed.

### 7 Start button

Performs setting of the value input at the write value field of **4** for the unit selected in **4**.

Thereafter, the setting contents result is displayed at the read value field of **4** for check use.

After setting is completed, subsequent processing can be canceled by clicking the button again.

**8 Close button**

Closes this screen. (Remote Perform Function screen)

**NOTES:**

- Even if you perform another function by the remote perform function or the push button on the PCB of the outdoor unit while a function is operating, the function may not be changed.
- When the remote perform function and the function by the push button on the PCB of the outdoor unit are performed at the same time, the remote perform function will not be operated. Check that the push button is not used before starting the remote perform function.



## 2-4. Indoor unit (setting by wireless remote controller)


### ⚠ CAUTION

This setting changes the function settings used to control the indoor unit according to the installation conditions. Incorrect settings can cause a product malfunction.

- After the power is turned on, perform the "Function setting" according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.

### ■ Preparation

1. Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
2. Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

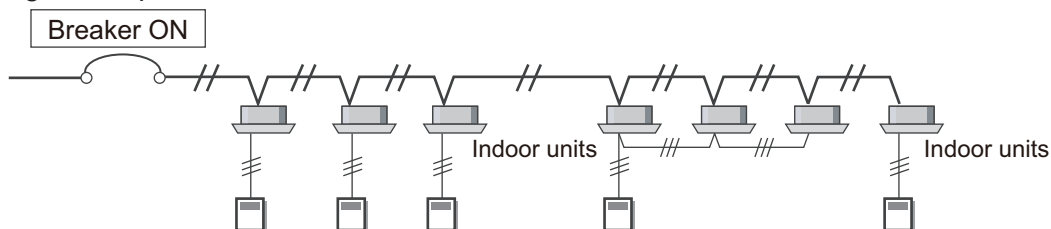


Before proceeding the function setting, refer to the following sections and perform necessary steps:


- ["Button name and function"](#) on page 07-19
- ["Entering function setting mode"](#) on page 07-20
- ["Selection and confirmation of custom code"](#) on page 07-20

### ■ Indoor unit function setting

1. Press the MODE button to enter the function setting mode.

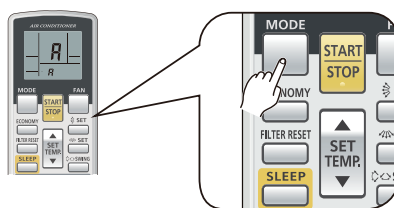


2. Press the SET TEMP.▲ or ▼ button to adjust the function number.  
Each time the MODE button is pressed, it switches between the left digit and the right digit.

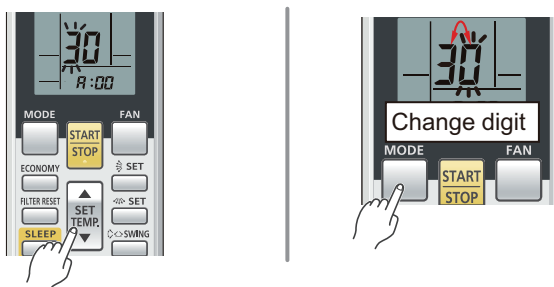


- Press the FAN button to proceed to number setting. To return to the function number adjustment, press the FAN button again.



- Press the SET TEMP.▲ or ▼ button to adjust the setting number. Each time the MODE button is pressed, it switches between the left digit and the right digit.

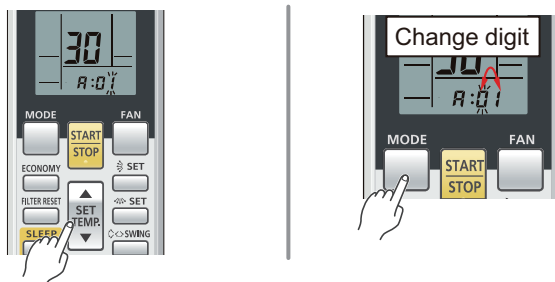

- Send the information by pressing the START/STOP button once. A beeping sound (2 short beeps, 1 long beep, 2 short beeps, and 1 long beep) will be emitted if the command is accepted.

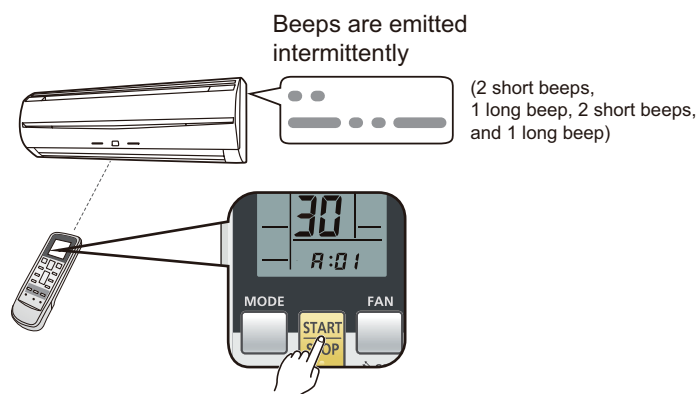


In the following case, the setting signal will not be accepted correctly and 5 short beeps will be emitted:

- The function setting number is set out of range


6. Indoor unit lamps will indicate the function setting number as follows:

**Case 1: When setting number is one digit**

Indoor unit lamps will indicate the function setting number on the OPERATION (Green) lamp, TIMER (Orange) lamp, and FILTER (Red) lamp.

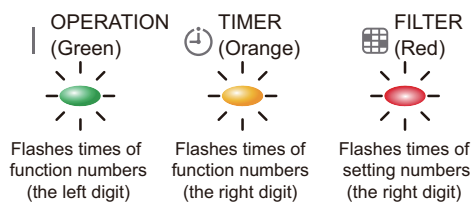


**Example) Function number: 30; Setting number: 01**

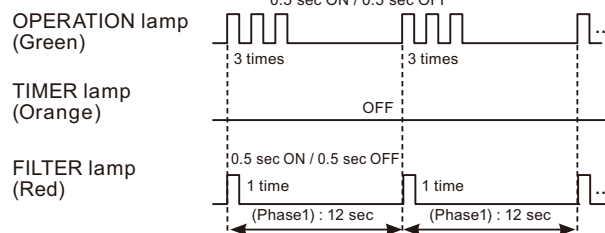


When the number setting is "0", TIMER lamp and FILTER lamp will not flash.

**Case 2: When setting number is two digits**

Indoor unit lamps will indicate the function setting number on the OPERATION (Green) lamp, TIMER (Orange) lamp, and FILTER (Red) lamp.

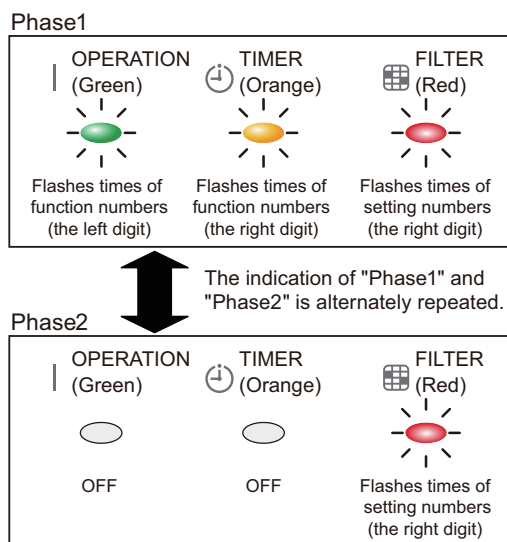

**Example) Function number: 26; Setting number: 31**

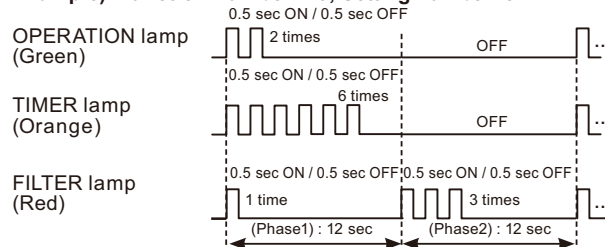


When the number setting is "0", TIMER lamp and FILTER lamp will not flash.

**RELATED LINKS**


["Function details"](#) on page 07-99

**Confirmation of function setting**

To confirm the function setting is properly configured, press the TIMER set (+) button.

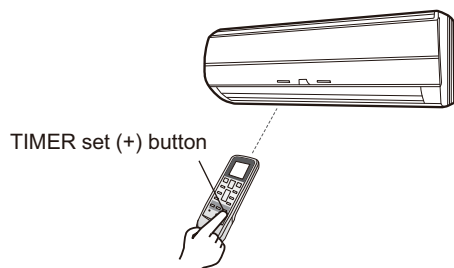


Beeps are emitted intermittently as follows:

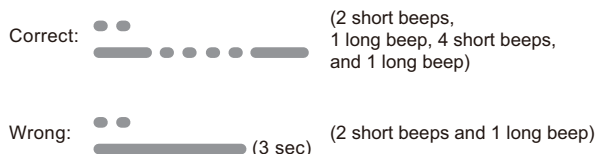

## ■ Completion of function setting mode

- The position of the MANUAL AUTO button varies depending on the model. For the actual position of the button on each unit, refer to the operation manual.
  - If the MANUAL AUTO button is pressed continuously for 10 seconds or more, the error will be displayed. In this case, release the button or turn off the power.
1. Press and hold the MANUAL AUTO button for 3 seconds. The brightness of each LED lamp is darkening though the content of the display does not change.

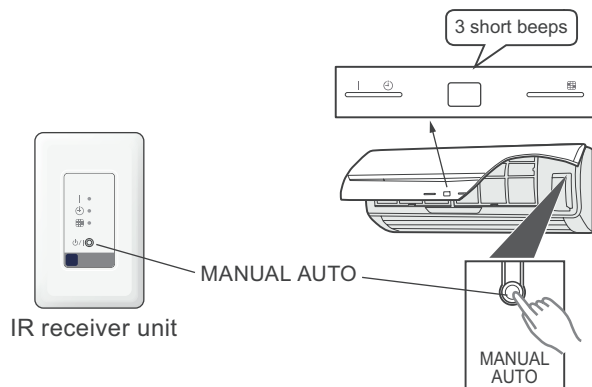

2. Press the RESET button.




For the custom code setting of b, c, or d, perform the setting after pressing the RESET button.


- After completing the procedure above, no function setting signal is received. If the function setting signal is sent, 5 short beeps will be emitted indicating an error.
- When returning the function setting mode again, press the MANUAL AUTO button for 3 seconds.

## ■ Reconfirmation of function setting

1. While holding down the FAN and the SET TEMP. ▲ buttons, press the RESET button. The function setting mode will be activated.

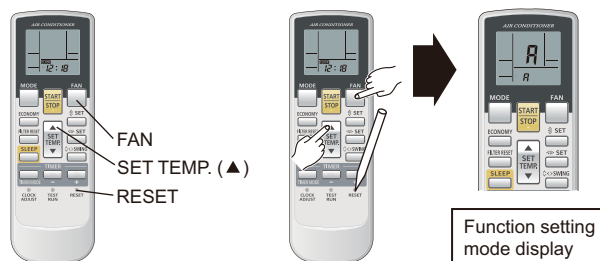


2. Function number to be confirmed is displayed on the remote controller LCD.  
Press the SET TEMP.▲ or ▼ button to adjust the setting number. Each time the MODE button is pressed, it switches between the left digit and the right digit.  
Press the TIMER set (-) button.

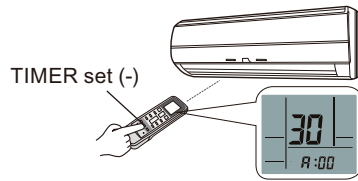


### Case1: When setting number is one digit

**Example) Function number: 30; Setting number: 01**

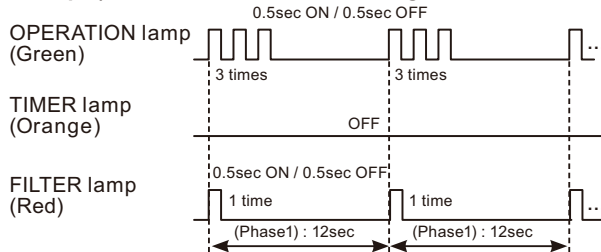

### Case2: When setting number is two digits


**Example) Function number: 26; Setting number: 31**

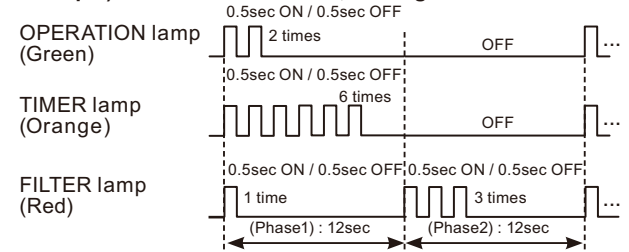

## ■ Setting up each indoor unit

Setting must be performed on each indoor unit by repeating following procedures.

- "Preparation" on page 07-81
- "Indoor unit function setting" on page 07-81
- "Confirmation of function setting" on page 07-83
- "Completion of function setting mode" on page 07-84
- "Reconfirmation of function setting" on page 07-84

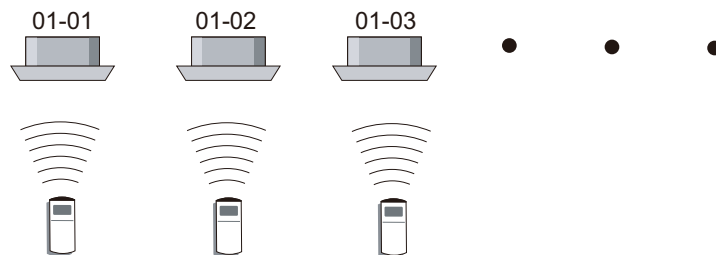

When the custom code is different to "H" (factory setting), only following procedures need to be performed.

- "Preparation" on page 07-81
- "Completion of function setting mode" on page 07-84
- "Reconfirmation of function setting" on page 07-84

## ■ Resetting the power after setting up all indoor units

### Important:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

Number "0" setting will not be indicated on TIMER lamp and FILTER lamp.

Once the RESET button is pressed on the remote controller, the operation mode will be set to the AUTO MODE.

Adjust the operation mode to either cooling or heating before starting the operation of the air conditioner.

**NOTE:** If custom code other than "H" is set, the remote control must be set accordingly to the indoor unit setting.

## 2-5. Indoor unit (setting by UTY-RNKU)

### ⚠ CAUTION


This setting changes the function settings used to control the indoor unit according to the installation conditions. Incorrect settings can cause a product malfunction.

- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function is not available on the slave units.


## ■ Preparation

1. If multiple indoor units are connected to a single wired remote controller, set up the remote controller address (RC AD) manually on the indoor units PCBs by referring ["Manual address setting method"](#) on page 07-9.

**Example: When 4 indoor units are connected**

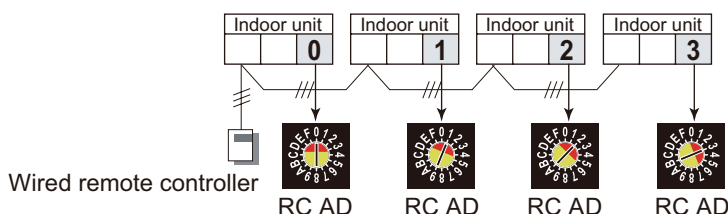

2. Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
3. Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

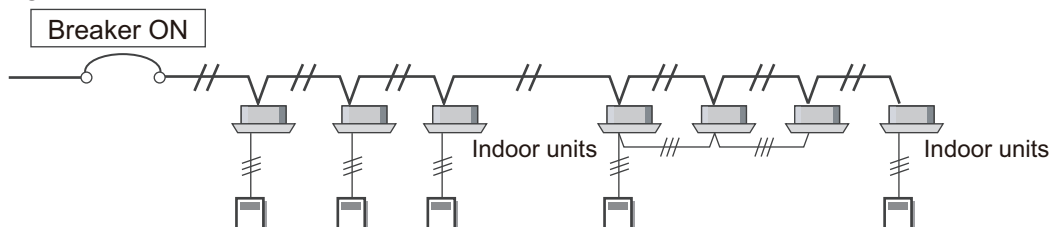


Before proceeding the function setting, refer to the following sections and perform necessary steps:


- ["Button name and function"](#) on page 07-30
- ["Entering setting mode"](#) on page 07-30

## ■ Indoor unit function setting

1. In the initial display of setting mode, by pressing the SET BACK button, select a remote controller address. (Select the indoor unit you want to operate.)

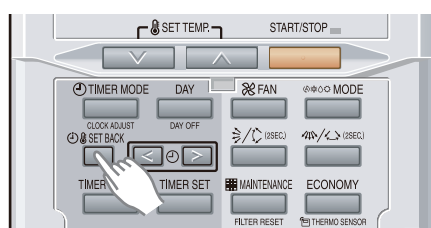


Remote controller address

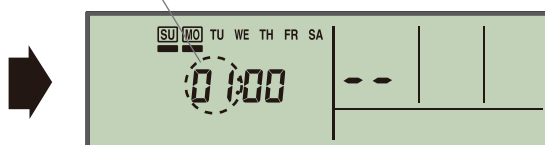


Example: When remote controller address “01” is selected


2. Select the function number by pressing the SET TIME “<” button or SET TIME “>” button.

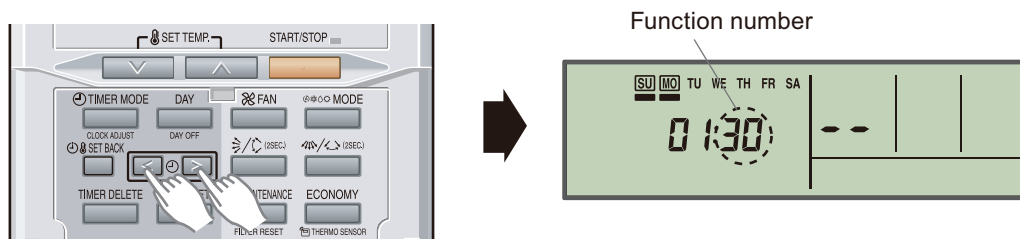

3. Select the setting number by pressing the SET TEMP. “∨” or the SET TEMP. “∧” button. The setting number indication flashes during number selection setting.

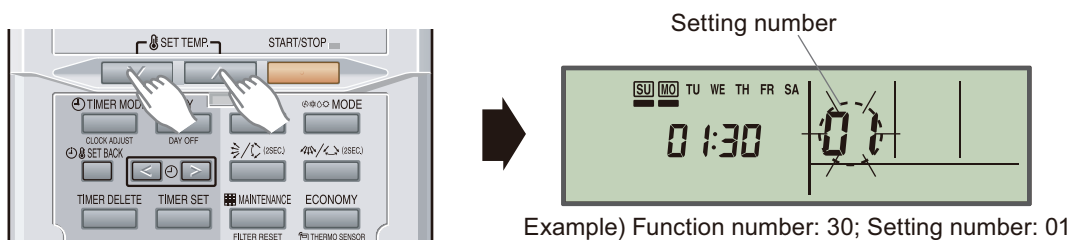

4. Confirm the setting by pressing the TIMER SET button. The data will be transferred to the indoor unit.

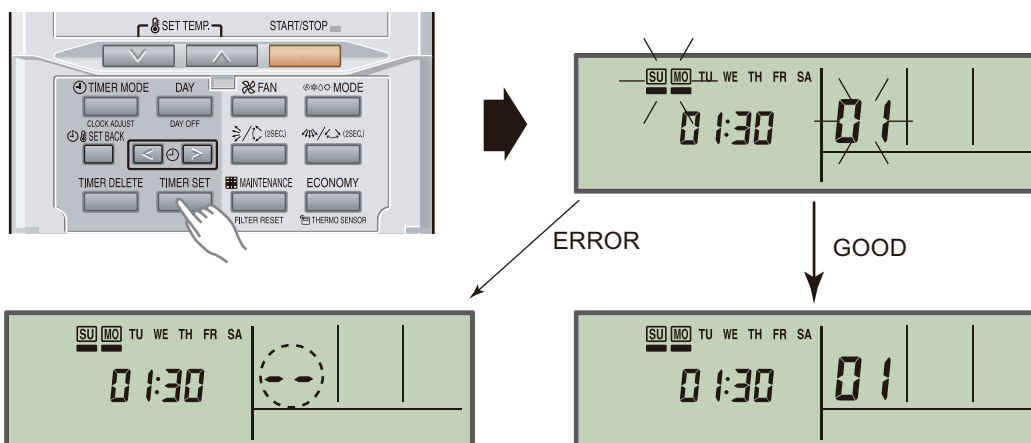

- When the address data is properly set up on the indoor unit, the flashing of the number stops and the set number will be displayed. (GOOD)
- When the address data is not set up correctly, “- -” is displayed. (ERROR) Back to the previous step and set up the indoor unit address data again.

## RELATED LINKS

["Completion of setting mode" on page 07-33](#)


["Function details" on page 07-99](#)



## ■ Setting up each indoor unit

Setting must be performed on each indoor unit by repeating following procedures.

- "Preparation" on page 07-87
- "Indoor unit function setting" on page 07-87
- "Completion of setting mode" on page 07-33

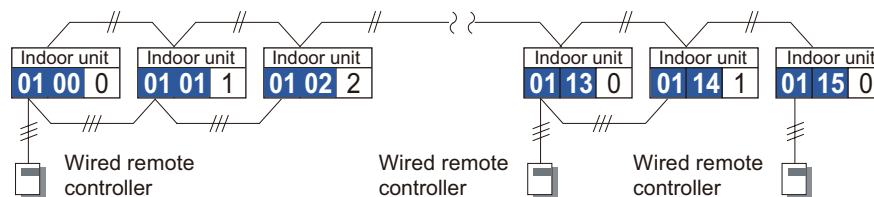

## ■ Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.  
However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## 2-6. Indoor unit (setting by UTY-RSRY, UTY-RHRY)

### ⚠ CAUTION


This setting changes the function settings used to control the indoor unit according to the installation conditions. Incorrect settings can cause a product malfunction.

- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function is not available on the slave units.
- Before starting the function setting, refer to the indoor unit installation manual and prepare for the setting.
- For details on the function numbers and setting numbers, refer to the indoor unit installation manual.


## ■ Preparation

1. If multiple indoor units are connected to a single wired remote controller, set up the remote controller address with “Automatic address setting”.

**Example: When 4 indoor units are connected**

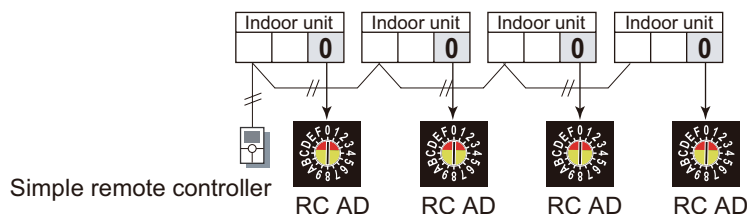

2. Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
3. Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

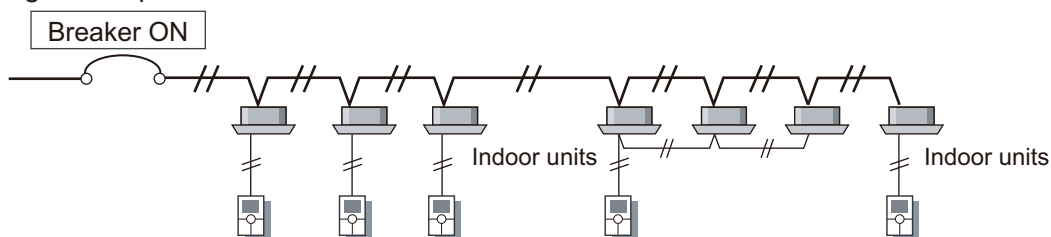


Before proceeding the function setting, refer to the following section and perform necessary steps:

- ["Entering setting mode"](#) on page 07-35



## Indoor unit function setting

**NOTE:** Perform this setting on the master remote controller.

- While displaying the function setting screen, press the TEMP. “^” or TEMP. “v” button to select the 2-wire remote controller address.



Function setting screen





Example: Selecting the 2-wire remote controller address (002-03)

- Press the START/STOP  $\phi/I$  button to switch to the function number setting.




Example: Selecting the 2-wire remote controller address




Function number

- Press the TEMP. “^” or TEMP. “v” button to adjust the function number.





Function number

- Press the START/STOP  $\phi/I$  button to switch to the setting number adjustment.




Function number




Setting number

- Press the TEMP. “^” or TEMP. “v” button to adjust the setting number.




Setting number




- Press the START/STOP  $\phi/I$  button. The data will be transferred to the indoor unit, and the setting result will be displayed.

7. To return to the 2-wire remote controller address selection screen, press the START/STOP  $\phi/I$  button. If setting has been completed, press FAN “ $\nabla$ ” button to return to the Menu 2-F1 item selection screen.

When returning to the 2-wire remote controller address selection screen



Setting completed and returning to the Menu 2-F1 item selection screen



## RELATED LINKS


["Completion of setting mode"](#) on page 07-39

["Function details"](#) on page 07-99

## ■ Setting up each indoor unit

Setting must be performed on each indoor unit by repeating following procedures.

- ["Preparation"](#) on page 07-90
- ["Indoor unit function setting"](#) on page 07-91
- ["Completion of setting mode"](#) on page 07-39

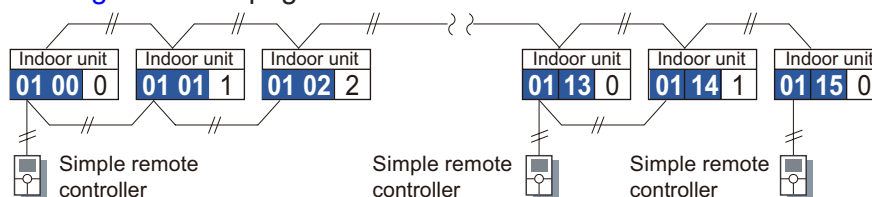

## ■ Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.
 However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## 2-7. Indoor unit (setting by UTY-RSKU, UTY-RHKU)

### ⚠ CAUTION


This setting changes the function settings used to control the indoor unit according to the installation conditions. Incorrect settings can cause a product malfunction.

- After the power is turned on, perform the "Function setting" according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function is not available on the slave units.


## ■ Preparation

1. If multiple indoor units are connected to a single simple remote controller, set up the remote controller address (RC AD) manually on the indoor units PCBs by referring ["Manual address setting method"](#) on page 07-9.

**Example: When 4 indoor units are connected**

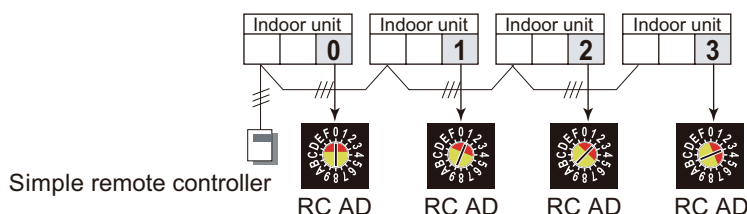

2. Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
3. Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

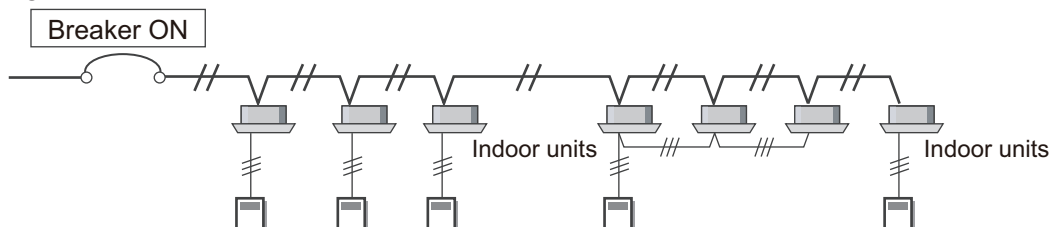


Before proceeding the function setting, refer to the following sections and perform necessary steps:


- ["Button name and function"](#) on page 07-42
- ["Entering setting mode"](#) on page 07-42

## Indoor unit function setting


1. In initial display of the setting mode, by pressing SET TEMP. “▲” button or SET TEMP. “▼” button, select a remote controller address. (Select the indoor unit you want to operate.)



Initial display of address setting mode




Remote controller address




Example: When remote controller address “01” is selected


2. Press the FAN button. “Function number” indicator flashes.

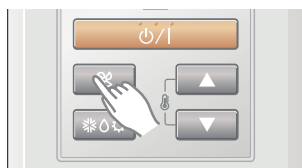

Function number



3. Set up the function number by pressing SET TEMP. “▲” button or SET TEMP. “▼” button.

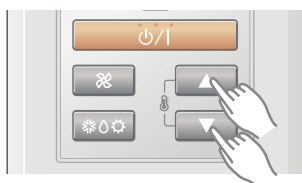


Function number




4. Press the FAN button. “Setting number” indicator flashes.




Setting number



5. Set up the setting number by pressing SET TEMP. “▲” button or SET TEMP. “▼” button.

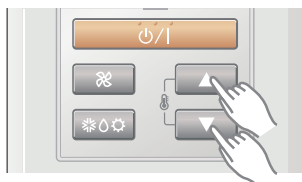


Setting number



Example) Function number: 30; Setting number: 01

6. Confirm the setting by pressing the START/STOP<sup>⏻</sup>/I button. The data will be transferred to the indoor unit.

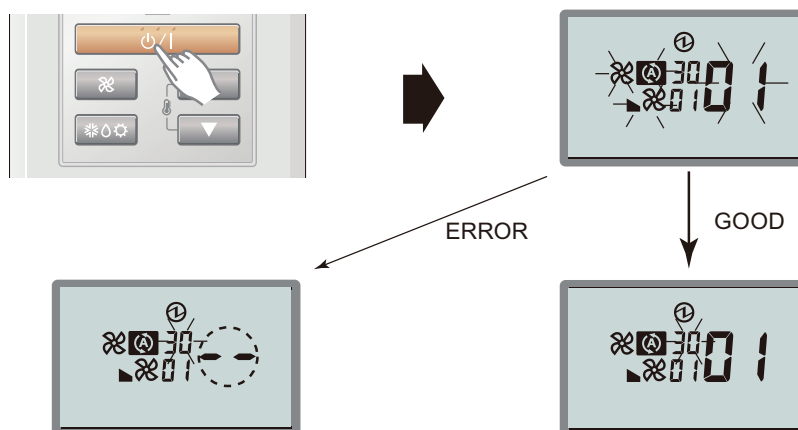

- When the setting is properly set up on the indoor unit, the set number will be displayed. (GOOD)
- When the setting is not set up correctly, “- -” is displayed. (ERROR) Back to the previous step and perform the setting again.

## RELATED LINKS


["Completion of setting mode"](#) on page 07-46

["Function details"](#) on page 07-99

## Setting up each indoor unit

Setting must be performed on each indoor unit by repeating following procedures.

- ["Preparation"](#) on page 07-93
- ["Indoor unit function setting"](#) on page 07-94

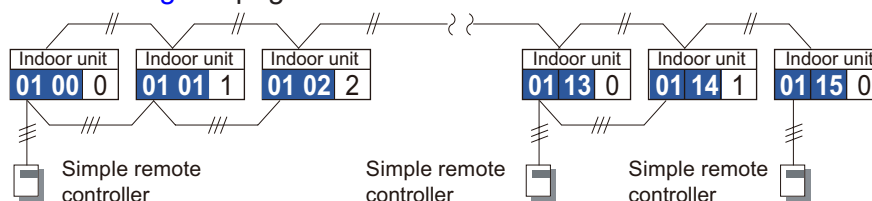

## Resetting the power after setting up all indoor units

### NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off.

However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## 2-8. Indoor unit (setting by UTY-RNRUZ\*)

### ⚠ CAUTION


This setting changes the function settings used to control the indoor unit according to the installation conditions. Incorrect settings can cause a product malfunction.

- After the power is turned on, perform the “Function setting” according to the installation conditions using the remote controller.
- The settings may be selected between the following two: Function number or Setting number.
- Settings will not be changed if invalid numbers or setting numbers are selected.
- This function is not available on the slave units.


## ■ Preparation

1. If multiple indoor units are connected to a single wired remote controller, set up the remote controller address with “Automatic address setting”.

**Example: When 4 indoor units are connected**

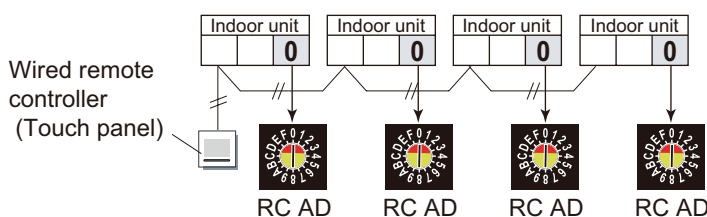

2. Before turning on the power of indoor unit, reconfirm following items:
  - Piping air tight test and vacuuming have been performed firmly.
  - There is no wiring mistake.
3. Turn on the power of indoor units.  
By turning on the power, the indoor units initialize EEV.

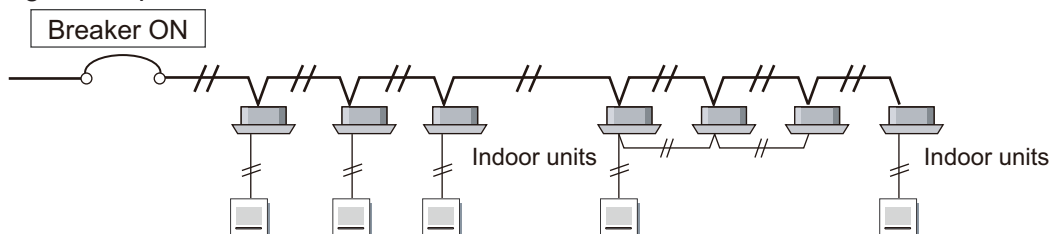


Before proceeding the function setting, refer to the following sections and perform necessary steps:

- "Entering setting mode" on page 07-48
- "Entering setting mode" on page 07-30


## ■ Indoor unit function setting

1. Touch “Address” on the Function Setting screen.

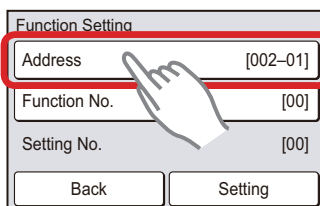




- Address screen is displayed. Select the address of the indoor unit whose function number is to be set by touching “▲” or “▼”. When setting at all the indoor units, touch “All”.

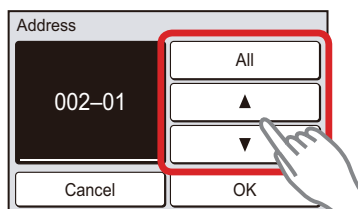


When “OK” is touched, the display returns to the Function Setting screen.

- Touch “Function No.” on the Function Setting screen.

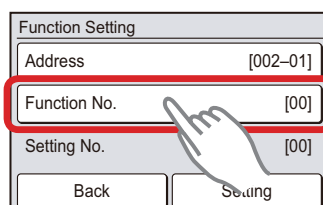


- Function No. screen is displayed. Set the Function No. by touching “▲” or “▼”.

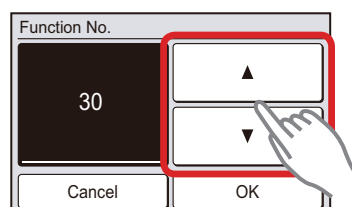


When “OK” is touched, the display returns to the Function Setting screen.

- Touch “Setting” on the Function Setting screen.

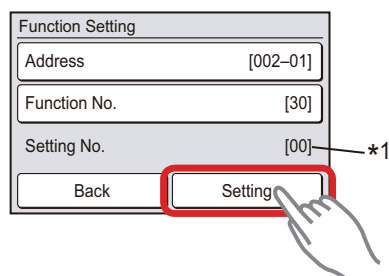

\*1: When “All” is selected in step 2, and different Setting No. is set from 2 or more indoor units, “-” is displayed here.


- Setting screen of “Setting No.” is displayed. Set the Setting No. by touching “▲” or “▼”.

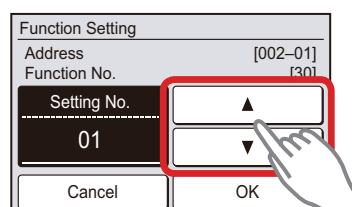

Example) Function number: 30; Setting number:01

When “OK” is touched, the Function Setting verification screen is displayed.

## 7. Touch "Yes" on the verification screen.

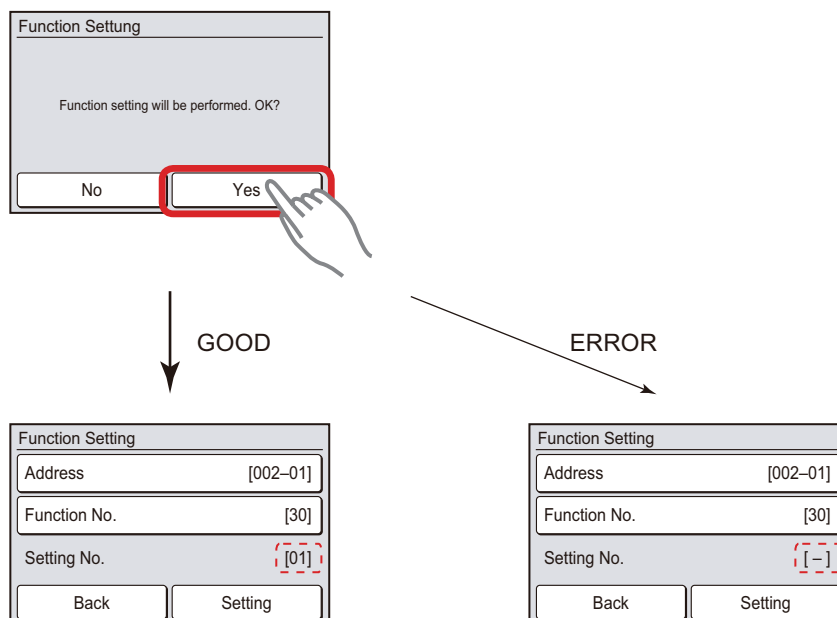

- When the setting is properly set up on the indoor unit, the set number will be displayed in Setting No. (GOOD)
- When the setting is not set up correctly, "-" is displayed in Setting No. (ERROR) Back to the previous step and perform the setting again.

## RELATED LINKS


["Completion of setting mode"](#) on page 07-50

["Function details"](#) on page 07-99

## Setting up each indoor unit

Setting must be performed on each indoor unit by repeating following procedures.

- ["Preparation"](#) on page 07-96
- ["Indoor unit function setting"](#) on page 07-96

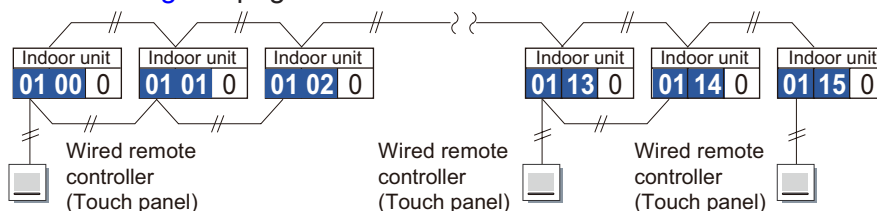

## Resetting the power after setting up all indoor units

## NOTES:

- If the reset is not performed, function cannot be read correctly.
- After all the functions have been set, the circuit breaker needs to be switched off for at least 2 minutes.
  - After the 2 minutes has passed, power can be restored.
  - The set function is stored in the PCB and will remain in memory even when the power of indoor unit is turned off. However setting function is effective after disconnecting the power supply and then reconnecting it.
- Record the latest configuration of the indoor unit function setting on a label, and put the label on the unit so it can be used for after-sales service operations.

## 2-9. Function details

Function	Function number	Setting number		Factory setting	Details
Filter indicator interval	11	00	Standard	◆	Adjusts the filter cleaning interval notification. If the notification is too early, change to setting "01". If the notification is too late, change to setting "02".
		01	Longer		
		02	Shorter		
Filter indicator action	13	00	Enable	◆	Enables or disables the filter indicator. Setting "02" is for use with a central remote controller.
		01	Disable		
		02	Display only on central remote controller		
Ceiling airflow	20	00	Standard	◆	Regulates the airflow according to the needs of the installation location. When set to 01, the air flow will be stronger. (Cassette type only)
		01	High ceiling		
Vertical airflow direction	23	00	Standard	◆	Adjusts the vertical airflow direction. All airflow direction louvers are adjusted together. (Cassette type only)
		01	Raise		
Horizontal swing airflow direction	24	00	Standard	◆	Adjusts the horizontal swing airflow direction. (For horizontal swing equipped models)
		01	Left half		
		02	Right half		
Static pressure	26	00	SP mode 00		Range of static pressure mode varies on the indoor unit models. (For details, refer to " <a href="#">Range of static pressure mode by model</a> " on page 07-102). As for the characteristics of each indoor unit, refer to " <a href="#">Fan performance curve</a> " in Chapter 4. INDOOR UNITS on page 04-138.
		01	SP mode 01		
		02	SP mode 02		
		03	SP mode 03		
		04	SP mode 04		
		05	SP mode 05		
		06	SP mode 06		
		07	SP mode 07		
		08	SP mode 08		
		09	SP mode 09		
		10	SP mode 10		
		11	SP mode 11		
		12	SP mode 12		
		13	SP mode 13		
		14	SP mode 14		
		15	SP mode 15		
		16	SP mode 16		
		17	SP mode 17		
		18	SP mode 18		
		19	SP mode 19		
		20	SP mode 20		
		21	SP mode 21		
		22	SP mode 22		
		23	SP mode 23		
		24	SP mode 24		
		25	SP mode 25		
		26	SP mode 26		
		27	SP mode 27		
		28	SP mode 28		
		29	SP mode 29		
		30	SP mode 30		
		31	Normal SP	◆	

Function	Function number	Setting number		Factory setting	Details
Cool air temperature trigger	30	00	Standard	◆	Adjusts the cool air trigger temperature.
		01	Adjust (1)		To make the trigger temperature lower than the standard temperature, use setting "01".
		02	Adjust (2)		To make the trigger temperature higher than the standard temperature, use setting "02".
Heat air temperature trigger	31	00	Standard	◆	Adjusts the heat air trigger temperature.
		01	Adjust (1)		To make the trigger temperature 6 degrees C lower than the standard temperature, use setting "01".
		02	Adjust (2)		To make the trigger temperature 4 degrees C lower than the standard temperature, use setting "02".
		03	Adjust (3)		To make the trigger temperature higher than the standard temperature, use setting "03".
Auto restart	40	00	Enable		Enables or disables automatic system restart after a power outage.
		01	Disable	◆	<b>NOTE:</b> Auto restart is an emergency function such as for power failure etc. Do not start and stop the indoor unit by this function in normal operation. Be sure to operate by the control unit, converter or external input device.
Cool-air prevention	43	00	Super low	◆	Restrains the cold airflow with making the airflow lower when starting heating operation. To correspond to the ventilation, set to "01".
		01	Follow the setting on the remote controller		
External control	46	00	Start/Stop	◆	Allows an external controller to start or stop the system, or to perform an emergency stop, or to perform a forced stop. <ul style="list-style-type: none"> <li>If an emergency stop is performed from an external controller, same refrigerant system will be disabled.</li> <li>If forced stop is set, indoor unit stops by the input to the external input terminals, and Start/Stop by a remote controller is restricted.</li> </ul>
		01	Emergency stop		
		02	Forced stop		
Error report target	47	00	All	◆	Changes the target for reporting errors. Errors can either be reported in all locations, or only on the wired remote.
		01	Display only on central remote control		
Fan setting when cooling thermostat OFF	49	00	Follow the setting on the remote controller	◆	<ul style="list-style-type: none"> <li>When set "00", indoor unit is continued operation based upon central remote controller or individual controller set. Once indoor unit received signal from external controller, indoor unit changed fan mode forcibly.</li> <li>When set "01", indoor unit is continued operation based upon central remote controller or individual controller set. Once indoor unit received signal from external controller, indoor unit stop forcibly.</li> <li>Connection of the wired remote controller (2-wire type or 3-wire type) and switching its thermistor are necessary.</li> </ul>
		01	Stop		

Function	Function number	Setting number	Factory setting	Details
Switching functions for external inputs and external outputs terminals	60	00	Mode 0	<p>◆</p> <p>Sets this function when connected to external devices such as the VRF system ventilator, economizer, humidifier, etc.</p> <p>The connection terminal functions can be changed depending on the type of external device.</p> <p>For details of the connection terminal functions, refer to "<a href="#">Indoor unit</a>" in Chapter 8. EXTERNAL INPUT AND OUTPUT on page 08-8.</p> <p><b>NOTE:</b> Inappropriate setting may cause an external device malfunction. Confirm whether all setting have been performed appropriately according to the installing condition.</p>
		01	Mode 1	
		02	Mode 2	
		03	Mode 3	
		04	Mode 4	
		05	Mode 5	
		06	Mode 6	
		07	Mode 7	
		08	Mode 8	
Control switching of external heaters	61	00	Auxiliary heater control 1	<p>◆</p> <p>Sets the control method for external heater being used.</p> <p>For details of the control method, refer to "<a href="#">External output</a>" in Chapter 8. EXTERNAL INPUT AND OUTPUT on page 08-5.</p> <ul style="list-style-type: none"> <li>Heater: external heater</li> <li>Heat pump: VRF outdoor unit</li> </ul>
		01	Auxiliary heater control 2	
		02	Heat pump prohibition control	
		03	Auxiliary heater control by outdoor temperature 1	
		04	Auxiliary heater control by outdoor temperature 2	
		05	Auxiliary heater control by outdoor temperature 3	
		06	Auxiliary heat pump control	
		07	Auxiliary heat pump control by outdoor temperature 1	
		08	Auxiliary heat pump control by outdoor temperature 2	
		09	Auxiliary heat pump control by outdoor temperature 3	

Function	Function number	Setting number		Factory setting	Details
Control switching of external heaters	62	00	Setting 0	◆	Sets the temperature conditions when the external heater is on. For the temperature conditions, refer to <a href="#">"Temperature conditions when the external heater is on/off"</a> on page 07-103.
		01	Setting 1		
		02	Setting 2		
		03	Setting 3		
		04	Setting 4		
		05	Setting 5		
		06	Setting 6		
		07	Setting 7		
		08	Setting 8		
		09	Setting 9		
		10	Setting 10		
		11	Setting 11		
		12	Setting 12		
		13	Setting 13		
		14	Setting 14		
		15	Setting 15		
		16	Setting 16		
		17	Setting 17		
Auto mode type	68	00	Single setpoint auto mode (traditional)	◆	Switches the setting method of auto mode to single or dual (cooling/heating). For heat pump systems, it is necessary to set the master indoor unit by using wired remote controller. <b>NOTE:</b> Auto mode type will be usable provided that the corresponding operating device is connected.
		01	Dual setpoint auto mode		
Deadband value	69	00	0 °F (0 °C)	◆	Choose the minimum temperature between cooling and heating settings (deadband) for dual setpoint auto mode (function number 68). <b>NOTE:</b> Deadband value will be usable provided that the corresponding operating device is connected.
		01	0.9 °F (0.5 °C)		
		02	1.8 °F (1.0 °C)		
		03	2.7 °F (1.5 °C)		
		04	3.6 °F (2.0 °C)		
		05	4.5 °F (2.5 °C)		
		06	5.4 °F (3.0 °C)		
		07	6.3 °F (3.5 °C)		
		08	7.2 °F (4.0 °C)		
		09	8.1 °F (4.5 °C)		
Standby time for auxiliary equipment operation	71	00	Disabled	◆	Sets the standby time until the auxiliary equipment operation starts during primary equipment operation. For details, refer to <a href="#">"External output"</a> in Chapter 8. EXTERNAL INPUT AND OUTPUT on page 08-5.
		01	1 minute		
		02	2 minutes		
		•	•		
		•	•		
		•	•		
		98	98 minutes		
		99	99 minutes		
Emergency heat	73	00	Disabled	◆	Enables or disables the emergency heat input.
		01	Enabled		
Fan delay time	74	00	1 minute	◆	Sets the fan delay time when the heater is turned off.
		01	50 seconds		
		02	40 seconds		
		03	30 seconds		
External heater use in defrosting	75	00	Disabled	◆	Enables or disables the external heater use in defrosting. <b>NOTE:</b> When using function number 75, inappropriate heater selection may cause cold air in defrosting.
		01	Enabled		

### Range of static pressure mode by model

Model name	Range of static pressure mode	Normal static pressure
ARUL4TLAV2	SP mode 00 to 03	0.04 inWG (10 Pa)
ARUL7TLAV2	SP mode 00 to 09	0.10 inWG (25 Pa)
ARUL9TLAV2		
ARUL12TLAV2		
ARUL14TLAV2		
ARUL18TLAV2		
ARUM24TLAV2	SP mode 00 to 14	0.16 inWG (40 Pa)
ARUM30TLAV2	SP mode 00 to 11	
ARUM36TLAV2	SP mode 00 to 09	
ARUH36TLAV	Setting prohibited because of AC motor	0.40 inWG (100 Pa)
ARUH48TLAV		
ARUH60TLAV		
ARUH72TLAV2	SP mode 05 to 30	0.60 inWG (150 Pa)
ARUH96TLAV2	SP mode 05 to 29	

### Temperature conditions when the external heater is on/off


Temperature (t) = Room temperature - set temperature

		Set value of function: 61			
		00		01 to 99	
		External heater: On	External heater: Off	External heater: On	External heater: Off
Set value of function: 62	00	t < -5.4 °F (-3 °C)	t ≥ -1.8 °F (-1 °C)	t ≤ -0.9 °F (-0.5 °C)	t ≥ 0.9 °F (0.5 °C)
	01	t < -3.6 °F (-2 °C)	t ≥ -1.8 °F (-1 °C)	t ≤ -1.8 °F (-1 °C)	t ≥ 0.9 °F (0.5 °C)
	02	t < -3.6 °F (-2 °C)	t ≥ -1.8 °F (-1 °C)	t ≤ -3.6 °F (-2 °C)	t ≥ 0.9 °F (0.5 °C)
	03	t < -5.4 °F (-3 °C)	t ≥ -1.8 °F (-1 °C)	t ≤ -5.4 °F (-3 °C)	t ≥ 0.9 °F (0.5 °C)
	04	t < -7.2 °F (-4 °C)	t ≥ -1.8 °F (-1 °C)	t ≤ -7.2 °F (-4 °C)	t ≥ 0.9 °F (0.5 °C)
	05	t < -9.0 °F (-5 °C)	t ≥ -1.8 °F (-1 °C)	t < -9.0 °F (-5 °C)	t ≥ 0.9 °F (0.5 °C)
	06	t < -5.4 °F (-3 °C)	t ≥ -0.9 °F (-0.5 °C)	t ≤ -0.9 °F (-0.5 °C)	t ≥ 0 °F (0 °C)
	07	t < -3.6 °F (-2 °C)	t ≥ -0.9 °F (-0.5 °C)	t ≤ -1.8 °F (-1 °C)	t ≥ 0 °F (0 °C)
	08	t < -3.6 °F (-2 °C)	t ≥ -0.9 °F (-0.5 °C)	t ≤ -3.6 °F (-2 °C)	t ≥ 0 °F (0 °C)
	09	t < -5.4 °F (-3 °C)	t ≥ -0.9 °F (-0.5 °C)	t ≤ -5.4 °F (-3 °C)	t ≥ 0 °F (0 °C)
	10	t < -7.2 °F (-4 °C)	t ≥ -0.9 °F (-0.5 °C)	t ≤ -7.2 °F (-4 °C)	t ≥ 0 °F (0 °C)
	11	t < -9.0 °F (-5 °C)	t ≥ -0.9 °F (-0.5 °C)	t < -9.0 °F (-5 °C)	t ≥ 0 °F (0 °C)
	12	t < -5.4 °F (-3 °C)	t ≥ 0 °F (0 °C)	t ≤ -0.9 °F (-0.5 °C)	t ≥ -0.9 °F (-0.5 °C)
	13	t < -3.6 °F (-2 °C)	t ≥ 0 °F (0 °C)	t ≤ -1.8 °F (-1 °C)	t ≥ -0.9 °F (-0.5 °C)
	14	t < -3.6 °F (-2 °C)	t ≥ 0 °F (0 °C)	t ≤ -3.6 °F (-2 °C)	t ≥ -0.9 °F (-0.5 °C)
	15	t < -5.4 °F (-3 °C)	t ≥ 0 °F (0 °C)	t ≤ -5.4 °F (-3 °C)	t ≥ -0.9 °F (-0.5 °C)
	16	t < -7.2 °F (-4 °C)	t ≥ 0 °F (0 °C)	t ≤ -7.2 °F (-4 °C)	t ≥ -0.9 °F (-0.5 °C)
	17	t < -9.0 °F (-5 °C)	t ≥ 0 °F (0 °C)	t < -9.0 °F (-5 °C)	t ≥ -0.9 °F (-0.5 °C)

## 2-10. Wired remote controller (UTY-RNKU)

DIP switch 1	SW1	Prohibited
	SW2	Dual remote controller setting
	SW3	Prohibited
	SW4	Fahrenheit (°F)/Celsius (°C) setting
	SW5	Prohibited
	SW6	Memory backup setting (Only for wired remote controller)
DIP switch 2	Do not use. (All switches fixed at OFF.)	

### ■ Switch location

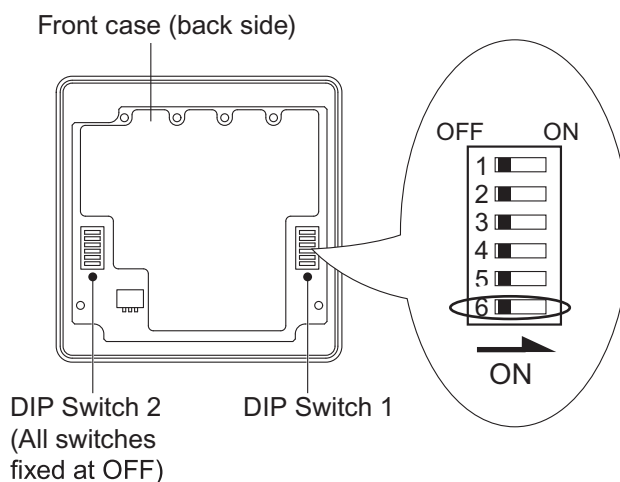

### ■ DIP switch 1 setting


- **SW1: Setting prohibited**

SW1		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SW2: Dual remote controller setting**

Set the remote controller SW2 according to the following table.

Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	◆
2 (Dual)	OFF	ON	

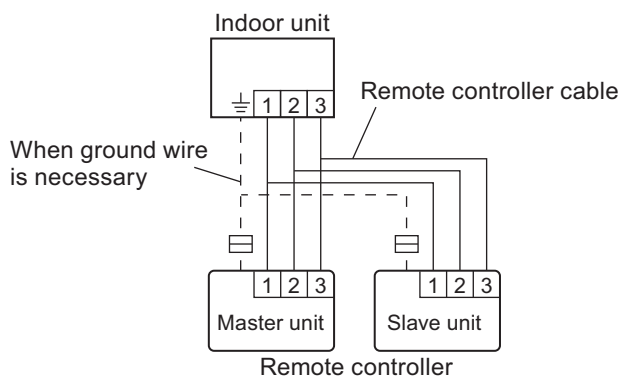



- **SW3: Setting prohibited**

SW3		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SW4: Fahrenheit (°F)/Celsius (°C) setting**

SW4		Factory setting
OFF	Celsius (°C)	
ON	Fahrenheit (°F)	◆

- **SW5: Setting prohibited**

SW5		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SW6: Memory backup setting** (Only for wired remote controller)

Set to “ON” to use batteries for the memory backup.

If there is a power failure when this setting is enabled, all the settings stored in the memory will be saved.


SW6	Memory backup	Factory setting
OFF	Disable	◆
ON	Enable	

**NOTE:** Never turn it “ON” in the case of simple remote controller.

## 2-11. Simple remote controller (UTY-RSKU, UTY-RHKU)

DIP switch 1	SW1	Prohibited
	SW2	Dual remote controller setting
	SW3	Fahrenheit (°F)/Celsius (°C) setting
	SW4	Prohibited
	SW5	Prohibited
	SW6	Prohibited
DIP switch 2	Do not use. (All switches fixed at OFF.)	

### Switch location

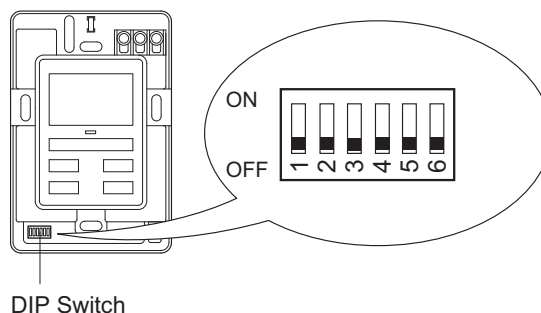

\* Number of buttons differs by model.

### DIP switch 1 setting


- **SW1: Setting prohibited**

SW1		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SW2: Dual remote controller setting**

Set the remote controller SW2 according to the following table.

Number of remote controller	Primary unit	Secondary unit	Factory setting
	SW2	SW2	
1 (Normal)	OFF	—	◆
2 (Dual)	OFF	ON	

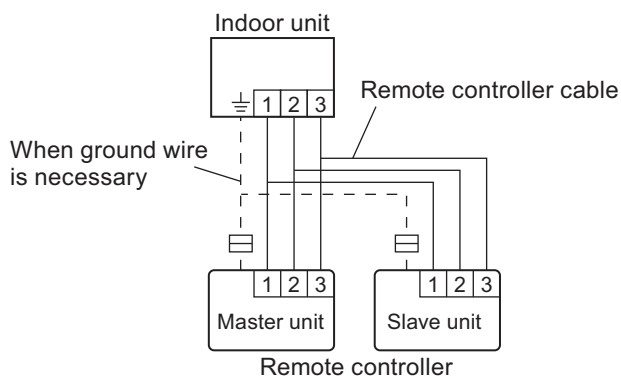

- **SW3: Fahrenheit (°F)/Celsius (°C) setting**

SW3		Factory setting
OFF	Celsius (°C)	
ON	Fahrenheit (°F)	◆

- **SW4: Setting prohibited**

SW4		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SW5: Setting prohibited**

SW5		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	


- **SW6: Setting prohibited**

SW6		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

## 2-12. Touch panel controller

### ■ Address setting

1. Display the Installer Setting screen, and press “Change” button of “1. The Controller Address Number Setting”.

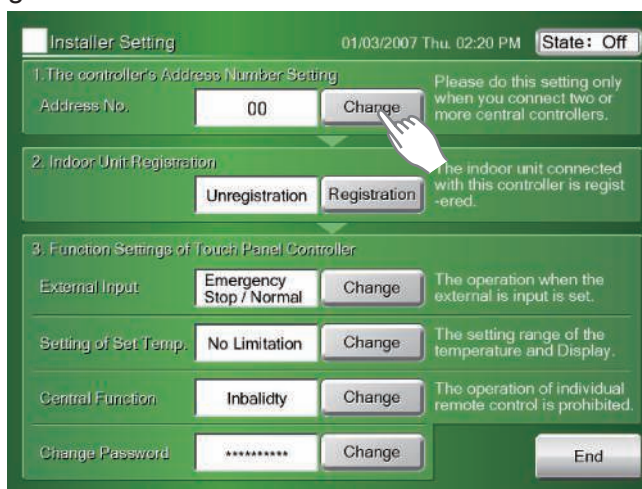


2. If it changes to “1. The controller Address Number Setting” screen, press “01” button of Address No., and then press “OK” button.



Example: When setting the Address Number to "01"

3. When it returns to Installer Setting screen, make sure that Address No. is “01”, and then complete the setting.

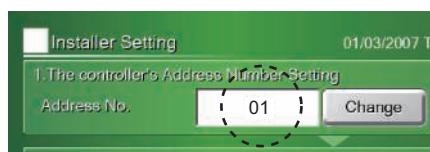

#### NOTES:


- Address No. can be set between “00” and “15”. (Up to 16 of this controller can be installed in 1 system.)
- When installing 2 or more controllers, set up so that Address No. does not overlap.
- When installing multiple controllers in the same VRF network system, avoid to overlap the Address No. of following controllers. (Even the same type of controllers, the Address No. is not allowed to overlap.)
  - Touch panel controller, Central remote controller
  - Modbus convertor
  - Network convertor for LONWORKS, Network convertor for Group remote controller
- For details, refer to the operating manual of the controller.

## 2-13. Central remote controller (UTY-DCGYZ\*)

### ■ DIP switch setting

DIP switch	Memory backup setting
------------	-----------------------

#### ● Switch location

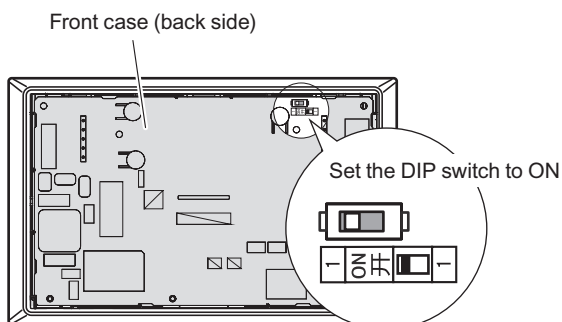

#### ● Memory backup setting

DIP switch		Factory setting
OFF	Disabled	◆
ON	Enabled	

### ■ Address setting

1. Tap Menu button.




2. Tap "Installer Setting".



3. Tap "Central controller Address Setting".



4. Tap the address list “00” to “15”.

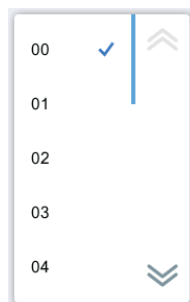

#### NOTES:


- Address No. can be set between “00” and “15”. (Up to 16 of this controller can be installed in 1 system.)
- When installing 2 or more controllers, set up so that Address No. does not overlap.
- When installing multiple controllers in the same VRF network system, avoid to overlap the Address No. of following controllers. (Even the same type of controllers, the Address No. is not allowed to overlap.)
  - Touch panel controller, Central remote controller
  - Modbus convertor
  - Network convertor for LONWORKS, Network convertor for Group remote controller
- For details, refer to the operating manual of the controller.

## 2-14. Wired remote controller (Touch panel)

### ■ Remote controller address confirmation

When “R.C. Address Setting” on the Maintenance screen is touched, Installer Password Verification screen is displayed.

Enter the Installer Password, and touch “OK”. R.C. Address Setting screen is displayed.

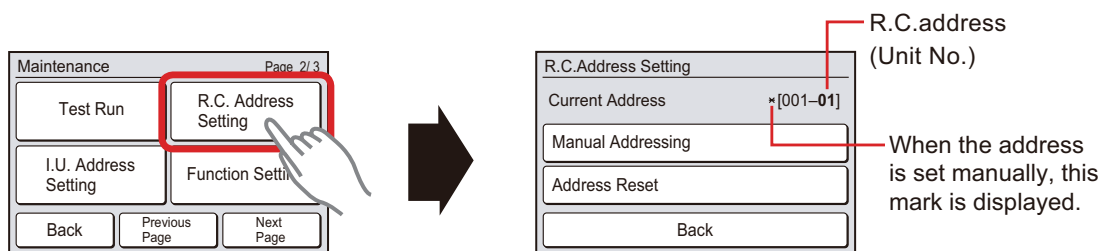


When the “Back” is touched, the display returns to the Maintenance screen.


**NOTE:** The address of this unit is set automatically. Do not change the indoor unit remote controller address from the factory setting “0”. (Verify that the address is “0”.)

### ■ Manual address setting of the remote controller

1. Touch “Manual Addressing” on the R.C. Address Setting screen.

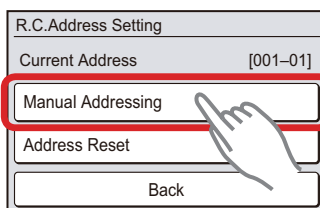


2. Manual Addressing screen is displayed. Set the address by touching “▲” or “▼”.

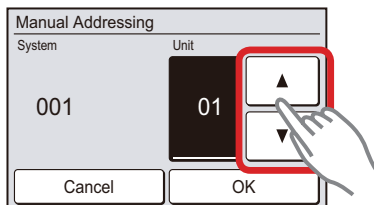


When “OK” is touched, a verification screen is displayed.

3. When the “Yes” on the verification screen is touched, a message screen is displayed.

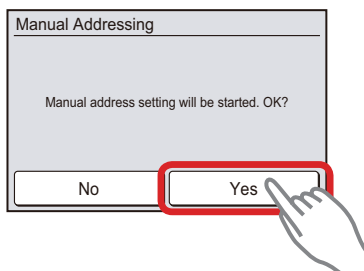

- When the “Close” on the message screen is touched, the display returns to the R.C. Address Setting screen. Turn on the power again.

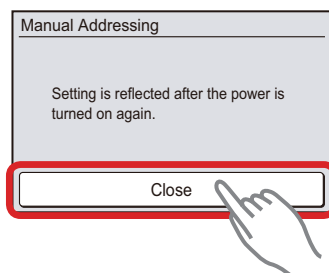


#### NOTES:


- Perform manual address setting only when setting the address with an arbitrary number. Indoor unit remote controller address setting is necessary. Set the remote controller address of indoor units connected by the same remote controller cable within a range of 1 to 9 and A (10) to F (15) so that there is no duplication. (Do not set to “0”.)
- The address of this unit is set within a range of 1 to 32, but set it so that it does not duplicate the remote controller address of an indoor unit connected by the same remote controller cable.

## ■ Resetting the manual address setting number


- Touch “Address Reset” on the R.C. Address Setting screen.

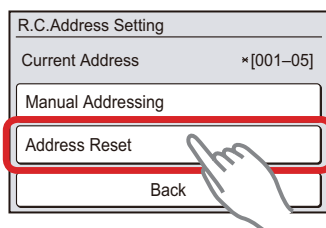

- A verification screen is displayed. When the “Yes” is touched, a message screen is displayed.

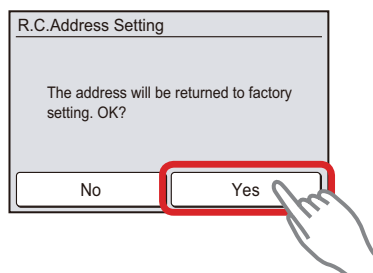


- When the “Close” on the message screen is touched, the display returns to the R.C. Address Setting screen. Turn on the power again.

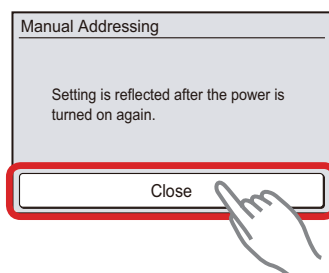




## ■ Master or slave setting of remote controller

1. Touch "RC Master/Slave Setting" on the Initial Setting screen.

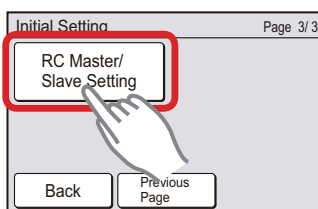

2. RC Master/Slave Setting screen is displayed. Select "Master" or "Slave".

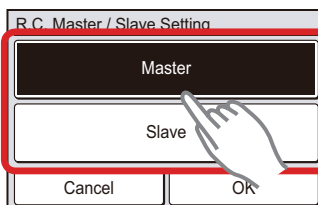


When the "OK" is touched, the display returns to the Initial Setting screen.


**NOTE:** Set only one master remote controller. Units other than "Master" are set to "Slave" automatically. Do not perform "RC Mater/Slave Setting" during setting or operating from the master unit.

## ■ Indoor unit address verification


1. When "I.U. Address Verification" on the Maintenance screen is touched, Installer Password Verification screen is displayed. Enter the Installer Password, and touch "OK". I.U. Address Verification screen is displayed.

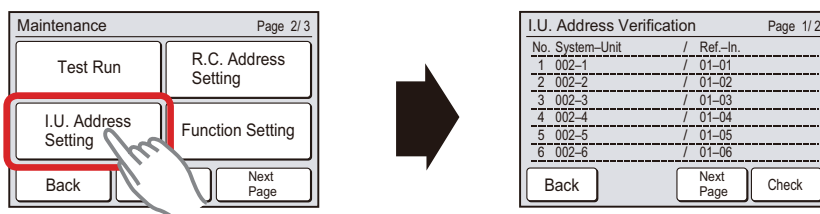


2. When the screen has multiple pages, they can be switched by touching the "Next Page" or "Previous Page".

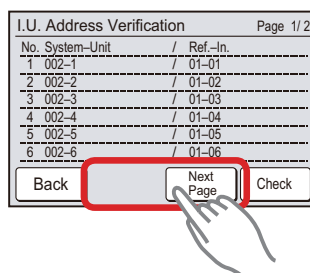


3. Touch the "Check" on the I.U. Address Verification screen.

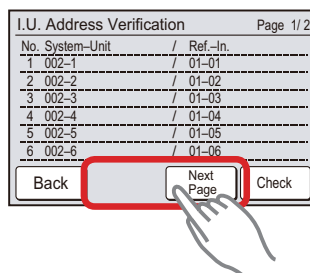


4. When the “Yes” on the verification screen of indoor unit verification is touched, all indoor units will stop, and the verification mode starts.

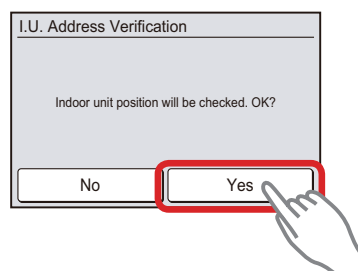


5. When indoor unit position verification ends, a screen displaying the indoor units in a list is displayed. When the screen has multiple pages, they can be switched by touching the “Next Page” or “Previous Page”.

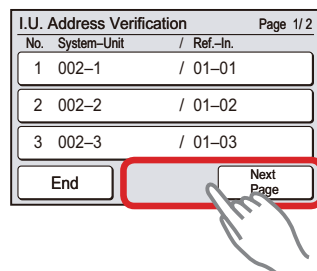


When the indoor unit address to be verified is touched, the appropriate indoor unit performs the air blow and the LED lamps blink\*. (\*Only when the indoor unit has that function.)

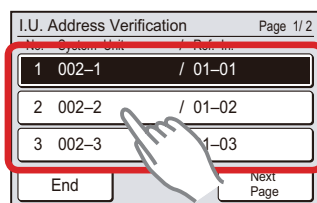

6. When the “End” is touched, the display returns to the I.U. Address Verification screen mentioned in step 2.

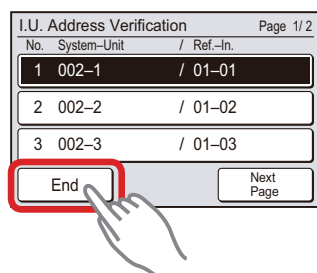


When “Back” on the I.U. Address Verification screen is touched, the display returns to the Maintenance screen.

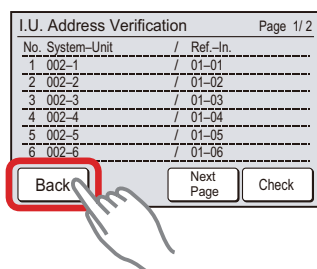


## 2-15. Simple remote controller (UTY-RSRY, UTY-RHRY)

### ■ Remote controller address confirmation

1. Select the "15" in Menu 2-F1 Settings. Then press the "⏻/I" button.



2. You can check current allocation of 2-wire remote controller address (system number and unit number).

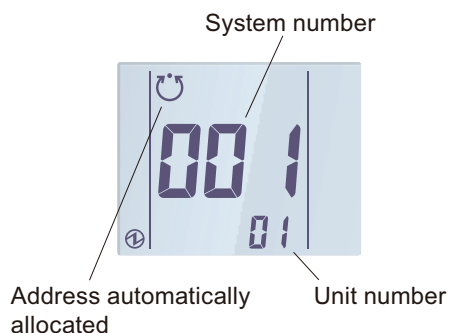

Press the "⏻/I" button to return to the Menu 2-F1 item selection screen.


**NOTE:** In the case of automatic address settings, do not change the remote controller address for the indoor unit, and keep it at the initial setting of "0". Addresses will be automatically set when initially starting up this unit.

### ■ Master or slave setting of remote controller


1. Select the "06" in Menu 2-F1 Settings. Then press the "⏻/I" button.



2. Select the "0: Master" or the "1: Slave" with the TEMP. "∧" or TEMP. "∨" button.

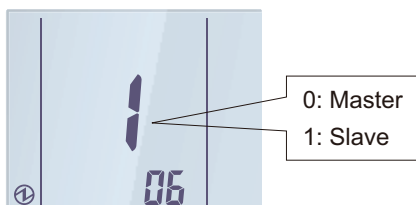


3. Press the “ $\phi$ /I” button. If there is no problem, return to Menu 2-F1 items selection screen. In the case of settings at initial booting, display Monitor mode screen.  
If there is 0 or more than 2 Master units, the number will be displayed.
  - If “Master” is 0, press the “ $\phi$ /I” button to return to the Menu 2-F1 item selection screen.
  - If “Master” is more than 2, press the “ $\phi$ /I” button to return to the screen in previous step.
  - To suspend the settings part way through and return to the Menu 2-F1 item screen, press FAN “ $\nabla$ ” button.

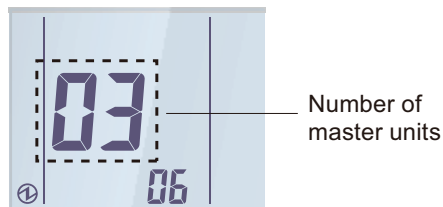

**NOTE:** Set only one master remote controller.



## ■ Indoor unit address verification

1. Select the “10” in Menu 2-F2 Settings. Then press the “ $\phi$ /I” button.



2. Display the smallest 2-wire remote controller address of indoor unit (system number and unit number) of the remote controller group. This address displayed can be switched by the TEMP. “ $\wedge$ ” or TEMP. “ $\nabla$ ” button. If an indoor unit other than VRF is connected, “-” is displayed.  
Press the “ $\phi$ /I” button to display the refrigerant system address and indoor unit address.

- (a) System number (002: Indoor unit)
- (b) Unit number (01 to 32)
- (c) Refrigerant system address (00 to 99)
- (d) Indoor unit address (00 to 63)




3. Press the FAN “ $\nabla$ ” button to return to the Menu 2-F2 item selection screen.

## 2-16. Network convertor (UTY-VTGX)



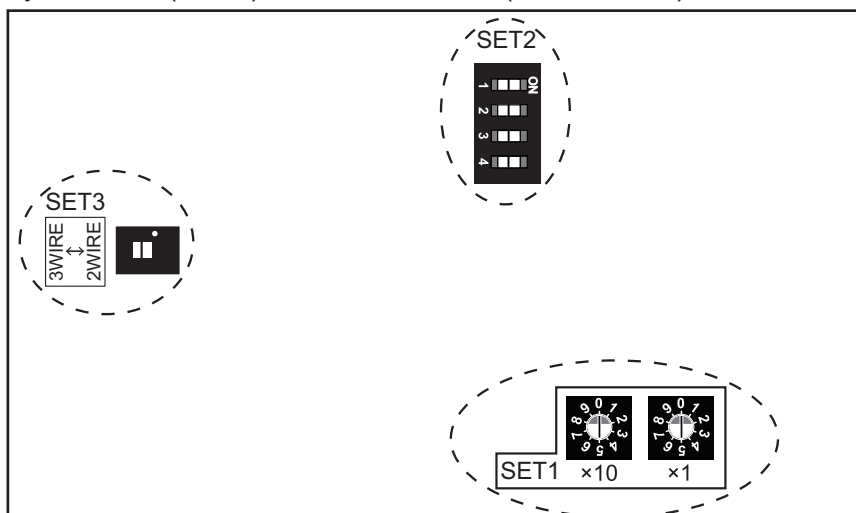

### ■ Switch location

Set the rotary switches (SET1) and DIP switches (SET2, SET3) on the network convertor PCB.



### ■ Rotary switch setting

- SET1: Refrigerant circuit address setting

Refrigerant circuit address (Example)	Rotary switch setting	
	SET1 (x10) (10 digit)	SET1 (x1) (1 digit)
01	 0	 1
99	 9	 9

#### NOTES:

- Setting range: 00 to 99 (Arbitrary numbers can be set.)
- When connecting the Network converter for single split air conditioner, set up the number so that the refrigerant circuit address number of the outdoor unit and indoor unit does not overlap. The sum total of the refrigerant circuit address of Network converter for single split air conditioner, outdoor unit and the indoor unit is a maximum of 100.

## ■ DIP switch setting

### • SET2-1: Terminal resistance setting

When there is no other terminal resistance in the network segment to which the convertor is connected, set to "ON".

SET2-1	Terminal resistance	Factory setting
ON	Enable	
OFF	Disable	◆

### • SET2-2: Setting prohibited

SW1		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	



### • SET2-3: Setting prohibited

SW1		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

### • SET2-4: Used remote controller setting

Change the DIP switch setting depending on the remote controller model name attached to the indoor unit.

**NOTE:** When 2-wire type remote controller is connected, set to "OFF" for all models.

SET2-4		Factory setting
ON	Wireless remote controller model name: AR-RAK1E  Model name Rear view	
	3-wire type wired remote controller model name: AR-WAG1E (UTY-RNNGU)  Model name Rear view	
OFF	Other than the remote controller mentioned above	◆

### • SET3: Remote controller 2-wire/3-wire switching

Set this setting so that the configuration match with the setting of the used indoor unit.


Also, set matched with the connection method of the remote controller cable to be connected.

SET3	RC 2-wire/3-wire	Factory setting
2WIRE	2-wire type	◆
3WIRE	3-wire type	

## 2-17. Network convertor (UTY-VGGXZ1)



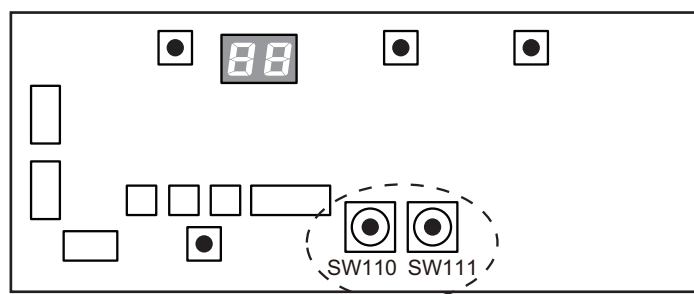

### ■ Switch location

Set the rotary switches (SW110, SW111) on the network convertor PCB.



### ■ Rotary switch setting





- Converter address setting for Group remote controller

Converter address (Example)	Rotary switch setting	
	SW110 (10 digit)	SW111 (1 digit)
01	 0	 1
15	 1	 5

#### NOTES:

- Setting range: 00 to 15 (Arbitrary numbers can be set.)
- The sum total of the Touch panel controller, Central remote controller, Network convertor for Group remote controller, Modbus converter, and Network convertor for LonWorks is a maximum of 16.
- For Touch panel controller, Central remote controller, Network convertor for Group remote controller, Modbus converter, and Network convertor for LonWorks connected in same VRF network system, set an exclusive address on each device.

- Refrigerant circuit address setting for split system

Refrigerant circuit address (Example)	Rotary switch setting	
	SW110 (10 digit)	SW111 (1 digit)
01	 0	 1
99	 9	 9


**NOTES:**

- Setting range: 00 to 99 (Arbitrary numbers can be set.)
- When connecting the Network converter for single split air conditioner, set up the number so that the refrigerant circuit address number of the outdoor unit and indoor unit does not overlap. The sum total of the refrigerant circuit address of Network converter for single split air conditioner, outdoor unit and the indoor unit is a maximum of 100.



## 2-18. Signal amplifier

### ■ Switch location

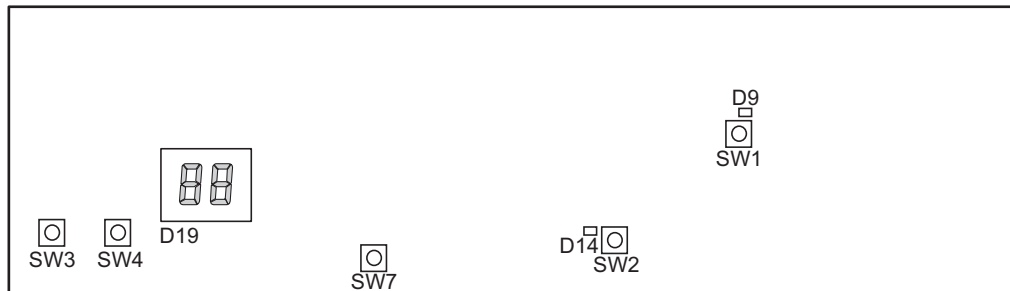

### ■ Automatic address setting

Refer to ["Automatic address setting of signal amplifier"](#) on page 07-54.


### ■ Manual address setting

1. Turn on the power for the signal amplifier.



2. While holding down SW4 (the set button), press and release SW7 (the reset button) to enter the address setting mode.

The address setting mode is activated only if the set button is held down when SW7 is released.



3. Press SW4 (the set button) to display the current address. The address is set to A1 at the factory.




Example 1: When A1 is set




Example 2: When A12 is set

4. Press SW3 (the mode button) to select the address. The displayed address changes as follows each SW3 button is pressed. When the manual setting is selected, the indicators change as follows:

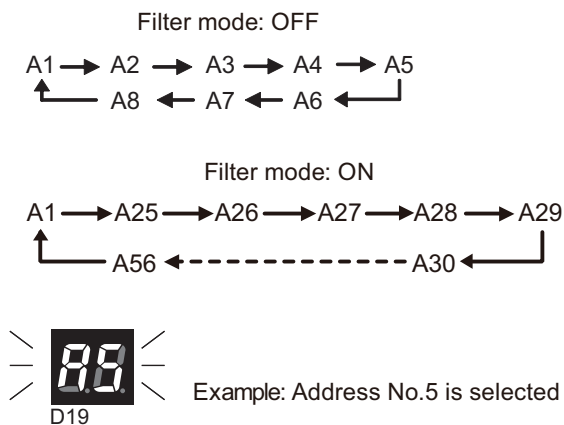

- Press the SW3 when A9-A16 or A57-A88 is displayed, then A1 will be displayed.
- If connecting multiple signal amplifiers, be sure to select a different address for each amplifier.
- If the same address is used for different signal amplifiers, normal communication cannot be done.

5. Press SW4 (the set button) to set the selected address.




6. Turn the power off and on or press SW7 (the reset button) to exit the address setting mode and return to the normal mode. If an address setting error occurs ("26" is displayed on the D19-indicator), the address will not be set. Perform address setting again.



## 2-19. KNX convertor for VRF



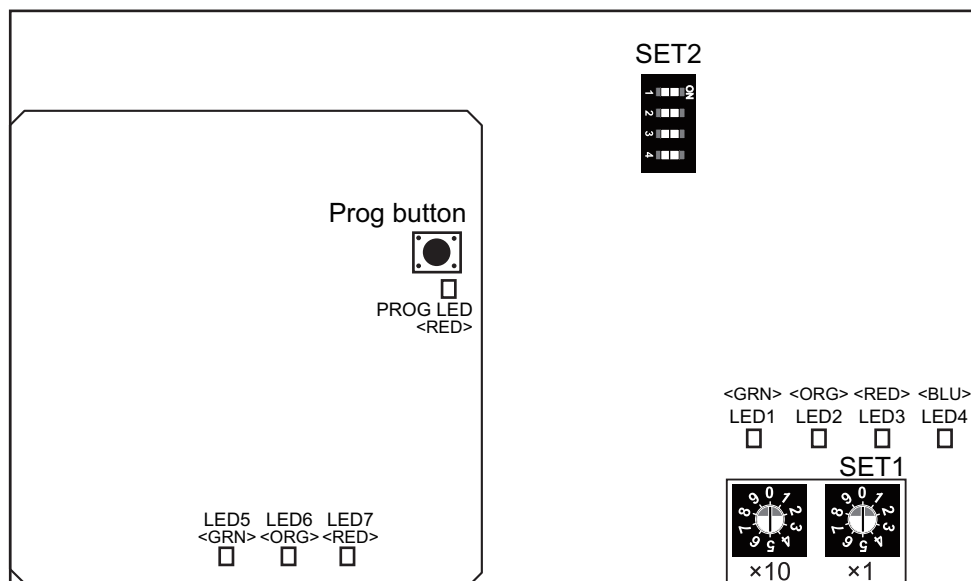

### ■ Switch location

Set the rotary switch (SET1), DIP switch (SET2), and Programming (Prog) button on the KNX convertor PCB.



### ■ Rotary switch setting

- **SET1: KNX convertor remote controller address setting**

Refrigerant circuit address (Example)	Rotary switch setting	
	SET1 (x10) (10 digit)	SET1 (x1) (1 digit)
01	 0	 1
15	 1	 5

#### NOTES:

- Factory setting: 00
- Setting range: 00 to 15 (Arbitrary numbers can be set.)
- When the rotary switch is set to 16 or more, the remote controller address of the convertor is 15.
- The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.
- For Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks connected in same VRF network system, set an exclusive address on each device.
- This convertor is connectable a maximum of 9 in 1 VRF network system.

## ■ DIP switch setting

- **SET2-1: VRF terminal resistance setting**

When there is no outdoor unit or signal amplifier in the VRF network segment to which the convertor is connected, set to "ON".

SET2-1	VRF terminal resistance	Factory setting
ON	Enable	
OFF	Disable	◆

- **SET2-2: Setting prohibited**

SET2-2		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SET2-3: Test run setting**

SET2-3	Test run	Factory setting
OFF	Reset	◆
ON	Start	

- **SET2-4: Scan setting**

SET2-4	Scan	Factory setting
OFF	Reset	◆
ON	Start	

## ■ Programming (Prog) button setting

- **Prog button: Mode setting when communicating with the ETS**

Push to switch between Runtime mode and Programming mode.

PROG LED	Mode setting	Factory setting
ON	Programming mode	
OFF	Runtime mode	◆

## ■ Configuration and setting up

This is a fully compatible KNX device which must be configured and setup using standard KNX tool ETS.

For how to configure the settings from the ETS, refer to the Interface Specification.


ETS database for this device can be downloaded from:

<https://fujitsu-general.com/global/support/downloads/vrf/index.html>

## 2-20. KNX convertor for Indoor unit

### ■ Switch location

Set Programming (Prog) button on the KNX convertor PCB.

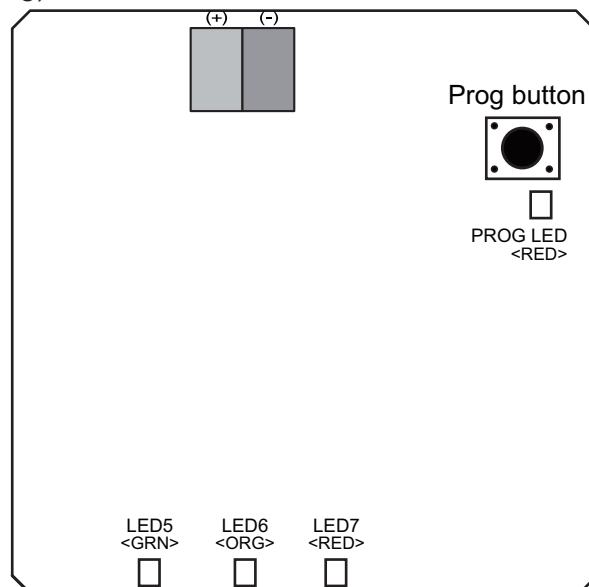

### ■ Programming (Prog) button setting

- **Prog button: Mode setting when communicating with the ETS**  
Push to switch between Runtime mode and Programming mode.

PROG LED	Mode setting	Factory setting
ON	Programming mode	
OFF	Runtime mode	◆

### ■ Configuration and setting up

This is a fully compatible KNX device which must be configured and setup using standard KNX tool ETS.

For how to configure the settings from the ETS, refer to the Interface Specification.


ETS database for this device can be downloaded from:

<https://fujitsu-general.com/global/support/downloads/vrf/index.html>

## 2-21. Modbus converter for VRF



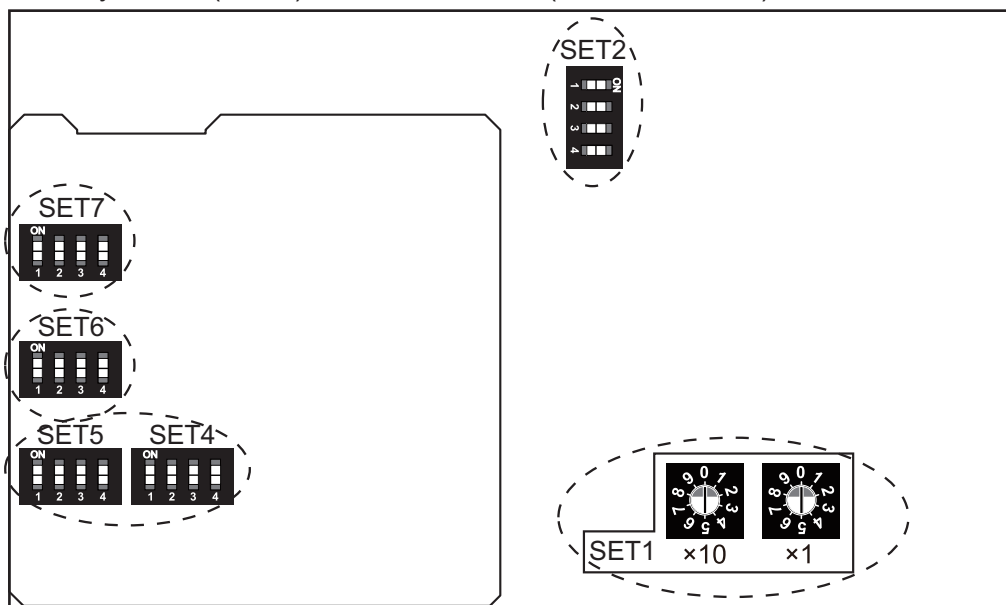

### ■ Switch location

Set the rotary switch (SET1) and DIP switches (SET2, 4, 5, 6, 7) on the PCB.



### ■ Rotary switch setting

- SET1: Modbus converter remote controller address setting

Refrigerant circuit address (Example)	Rotary switch setting	
	SET1 (x10) (10 digit)	SET1 (x1) (1 digit)
01	 0	 1
15	 1	 5

#### NOTES:

- Factory setting: 00
- Setting range: 00 to 15 (Arbitrary numbers can be set.)
- When the rotary switch is set to 16 or more, the remote controller address of the convertor is 15.
- The sum total of the Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks is a maximum of 16.
- For Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks connected in same VRF network system, set an exclusive address on each device.
- This convertor is connectable a maximum of 9 in 1 VRF network system.

## ■ DIP switch setting

- **SET2-1: VRF terminal resistance setting**

When there is no outdoor unit or signal amplifier in the VRF network segment to which the convertor is connected, set to “ON”.

SET2-1	VRF terminal resistance	Factory setting
ON	Enable	
OFF	Disable	◆

- **SET2-2: Setting prohibited**

SET2-2		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SET2-3: Test run setting**

SET2-3	Test run	Factory setting
OFF	Reset	◆
ON	Start	

- **SET2-4: Scan setting**

SET2-4	Scan	Factory setting
OFF	Reset	◆
ON	Start	

- **SET4, SET5: Modbus slave address setting**

Setting range: 1-247 (Arbitrary numbers can be set.)

For details, refer to the installation manual.

- **SET6-1: Setting prohibited**

SET6-1		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SET6-2: Modbus communication stop bit setting**

SET6-2	Mod bus communication stop bit	Factory setting
OFF	1 bit	◆
ON	2 bit	

- **SET6-3: Modbus communication parity setting**

SET6-3	Mod bus communication parity	Factory setting
OFF	Even	◆
ON	Odd	

**NOTE:** When SET6-2 (Modbus communication stop bit setting) is set to “ON” (2 bit), the parity is set to “None” regardless of the setting of this switch.

- **SET6-4: Modbus communication baud rate setting**

SET6-4	Mod bus communication baud rate	Factory setting
OFF	9,600 bps	◆
ON	19,200 bps	

- **SET7-1, 7-2, 7-3: Setting prohibited**

SET7-1, 2, 3		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SET7-4: Terminal resistance setting**

Terminal resistance of Modbus communication can be set. (Terminal resistance: 120 Ω)

In case of circuit terminal resistance, set the terminal resistance to be enabled.


SET7-4	Terminal resistance	Factory setting
OFF	Disable	◆
ON	Enable	



## 2-22. Modbus converter for indoor unit

### ■ Switch location

Set the DIP switches (SET4, 5, 6, 7) on the PCB.

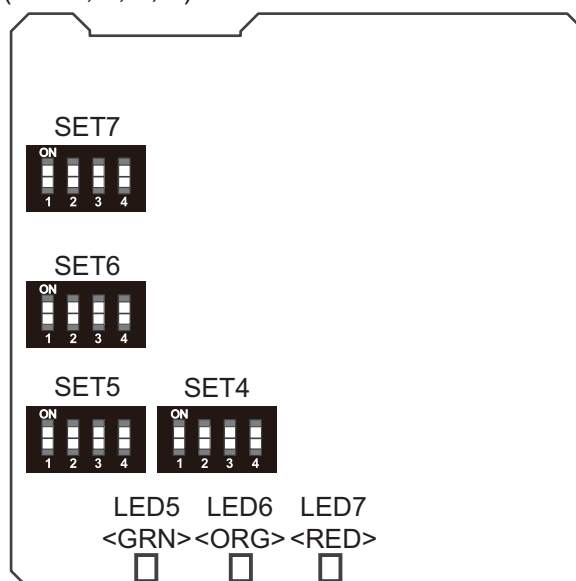

### ■ DIP switch setting

- **SET4, SET5: Modbus slave address setting**  
Setting range: 1-247 (Arbitrary numbers can be set.)  
For details, refer to the installation manual.

- **SET6-1: Setting prohibited**

SET6-1		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SET6-2: Modbus communication stop bit setting**

SET6-2	Mod bus communication stop bit	Factory setting
OFF	1 bit	◆
ON	2 bit	

- **SET6-3: Modbus communication parity setting**

SET6-3	Mod bus communication parity	Factory setting
OFF	Even	◆
ON	Odd	

**NOTE:** When SET6-2 (Modbus communication stop bid setting) is set to “ON” (2 bit), the parity is set to “None” regardless of the setting of this switch.

- **SET6-4: Modbus communication baud rate setting**

SET6-4	Mod bus communication baud rate	Factory setting
OFF	9,600 bps	◆
ON	19,200 bps	

- **SET7-1, 7-2, 7-3: Setting prohibited**

SET7-1, 2, 3		Factory setting
OFF	Fixed at OFF	◆
ON	Setting prohibited	

- **SET7-4: Terminal resistance setting**


Terminal resistance of Modbus communication can be set. (Terminal resistance: 120 Ω)

In case of circuit terminal resistance, set the terminal resistance to be enabled.

SET7-4	Terminal resistance	Factory setting
OFF	Disable	◆
ON	Enable	

## 2-23. Network converter for LonWorks

### ■ Switch location

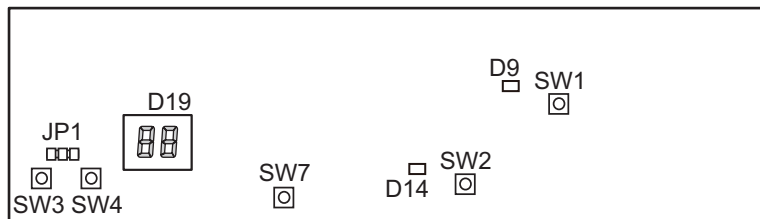


### ■ Address setting

Following steps are necessary for setting address of Network converter.

For Touch panel controller, Central remote controller, Network converter for Group remote controller, Modbus converter, and Network converter for LonWorks connected in same VRF network system, set an exclusive address on each device.


1. Turn on the power of the Network converter.
2. Select the special mode by pressing and releasing SW7 (reset button) while holding down SW4 (set button) until special mode "1" is displayed. Special mode changes from "1" to "4" as shown in the following figure.

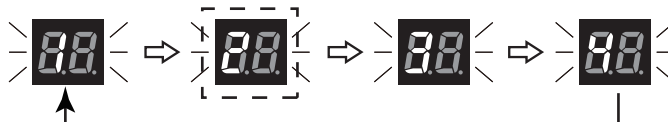

3. Press SW3 (mode button) to set special mode "2". Special mode "2" is the address setting mode.
4. Press SW4 (set button). Current set address is displayed.




5. Press SW3 (mode button) to select the address. The displayed address changes as follows each time the mode button is pressed.




6. Press SW4 (set button) to set the selected address.



7. Turn the power off and on or press SW7 (reset button) to exit from address setting mode. Anyone of the following indication will disappear:

 : VRF Network address allocation is not registered by using Tool for Network converter

 : Binding and commissioning is not executed

 : Normal mode (Ready for operation)

Others : Refer to the installation manual for more details.

## 2-24. Duct static pressure setting

### ■ Mini duct type, Slim duct/Slim concealed floor type, Medium static pressure duct type, and 72TLAV1 and 96TLAV in High static pressure duct type

When the external static pressure is different from the normal static pressure, change the airflow setting.

Setting of airflow can be changed by wireless remote controller, wired remote controller, and simple remote controller.

#### How to set airflow (external static pressure):

- **Wireless remote controller**

Airflow is set by function number 26 (static pressure).

For details, refer to the following sections:

- "Button name and function" on page 07-19
- "Indoor unit (setting by wireless remote controller)" on page 07-81
- "Function details" on page 07-99

- **Wired remote controller (UTY-RNKU)**

Airflow is set by function number 26 (static pressure).

For details, refer to the following sections:

- "Button name and function" on page 07-30
- "Indoor unit (setting by UTY-RNKU)" on page 07-87
- "Function details" on page 07-99

- **Simple remote controller (UTY-RSKU, UTY-RHKU)**

Airflow is set by function number 26 (static pressure).

For details, refer to the following sections:

- "Button name and function" on page 07-42
- "Indoor unit (setting by UTY-RSKU, UTY-RHKU)" on page 07-93
- "Function details" on page 07-99

- **Wired remote controller (Touch panel)**

Airflow is set by function number 26 (static pressure).

For details, refer to the following sections:

- "Indoor unit (setting by UTY-RNRUZ\*)" on page 07-96
- "Function details" on page 07-99

#### ⚠ CAUTION

- Setting of static pressure must be fall within the static pressure setting range described in "Fan performance curve" in Chapter 4. INDOOR UNITS on page 04-138.
- Static pressure setting out of the static pressure setting range may cause product malfunction such as capacity degradation or water leakage.

## 2-25. Administrative indoor unit setting

An indoor unit which decides the priority mode (cooling or heating) in a same refrigerant system can be set as an administrative indoor unit.

**NOTE:** Administrative indoor unit can be set to only 1 unit in a same refrigerant system.


### ■ Setting method

Administrative indoor unit setting can be performed by outdoor unit function setting and wired remote controller setting.


1. Perform outdoor unit function setting with referring ["Setting on outdoor unit PCB"](#) on page 07-62.
2. Perform wired remote controller setting. Depend on the type of the wired remote controller, setting method is different as follows:

#### • Wired remote controller (Touch panel)


- a. Touch the "Master Indoor Unit Setting" on the Initial Setting screen. Master Indoor Unit Setting screen is displayed. (Master indoor unit = Administrative indoor unit)

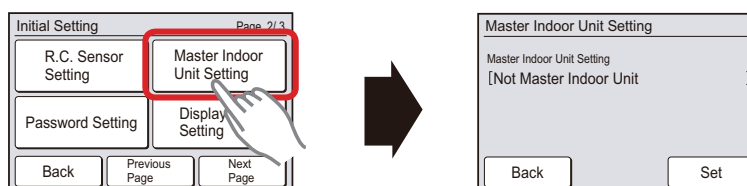


- b. When "Set" is touched on the Master Indoor Unit Setting screen, a verification screen is displayed.

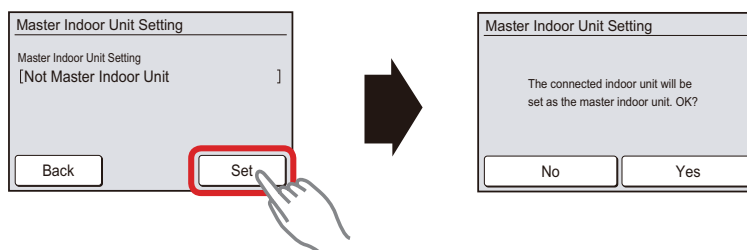

- c. When "Yes" is touched on the verification screen, the setting data is transmitted to the indoor unit and the display returns to the Master Indoor Unit Setting screen.

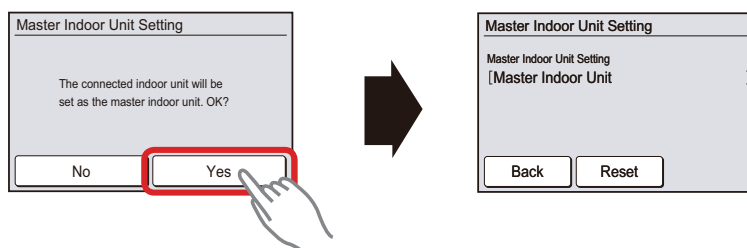

- d. When "Back" is touched on the Master Indoor Unit Setting screen, the display returns to the Initial Setting screen.




\*: To clear the master indoor unit setting, touch "Reset". (Resetting cannot be performed while the indoor unit is operating.)

**NOTE:** For canceling the existing master unit setting and applying the master unit setting to other indoor unit, always perform the resetting of current setting first. Then perform the master unit setting to the other indoor unit.


• **Wired remote controller**

- a. After the indoor unit stops operation, press the MODE button of wired remote controller for 5 seconds continuously.  
After 5 seconds, the operating mode indicator on the wired remote controller display lights on.

When the unit is not set as the administrative indoor unit (A):




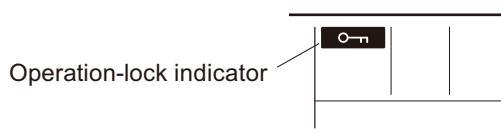
When the unit is set as the administrative indoor unit (B):



- b. Press the MODE button.
  - The indicator blinks when the MODE button is pressed, and the indication of 1-(A) and 1-(B) alters whenever the MODE button is pressed.
  - The setting configured on the wired remote controller is transmitted to the indoor unit immediately after the selection of (A) or (B) is completed. It may take 10 seconds or so depending on the communication conditions. During this period, the button operation will be suspended.
  - It automatically returns to the regular display after 20 seconds if there is no button entry.
  - When the setting or canceling is completed, the indication on the wired remote controller changes to the regular indication from blinking.

**NOTES:**

When operation lock indicator  lights on, the MODE button is locked because of the following reasons:



- “Priority on administrative indoor unit” is not selected in the setting of priority mode of the outdoor unit.  
In this case, select “Priority on administrative indoor unit” in setting of priority mode of the outdoor unit first. Then set the administrative indoor unit on the wired remote controller.
  - Another indoor unit has already been set as the administrative indoor unit.  
In this case, cancel the administrative indoor unit setting of another indoor unit.
- c. Complete the setting or canceling of the administrative indoor unit.  
Press the MODE button of the wired remote controller again for 5 seconds continuously. The indication returns to the regular display.  
(It returns to regular indication after 20 seconds even if the MODE button is not pressed.)

## 2-26. Energy saving setting on System controller


By installing System controller or System controller lite, energy saving function using electricity meters can be performed.

### ■ Features of energy saving function

- **Power consumption graph**

Displays the power consumption measured by the electricity meter connected to the air conditioner by bar graph, and makes it easier to understand the power consumption conditions.

- Power consumption data for 3 years can be saved
- Past record can be referenced as history
- Data of an arbitrary 2 periods can be displayed for comparison

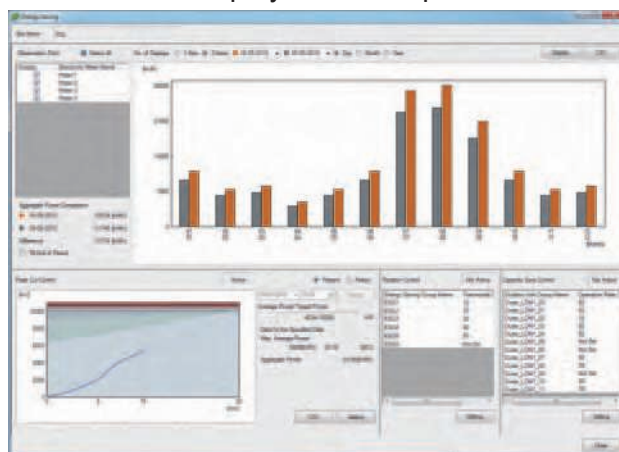


- **Indoor unit rotation operation**


Reduces the power consumption by changing the indoor unit which is to be set forced thermostat OFF in turn.

Operating the air conditioner even in the spring and autumn when the heat load is comparatively light may have an energy saving effect. Because it is an intermittent operation, it does not lose much comfort, and is a control which is difficult for the user of the room to sense its operation.


- The electric power consumed in the arbitrarily defined group is reduced by changing indoor units which are set to forced thermostat OFF in turn.

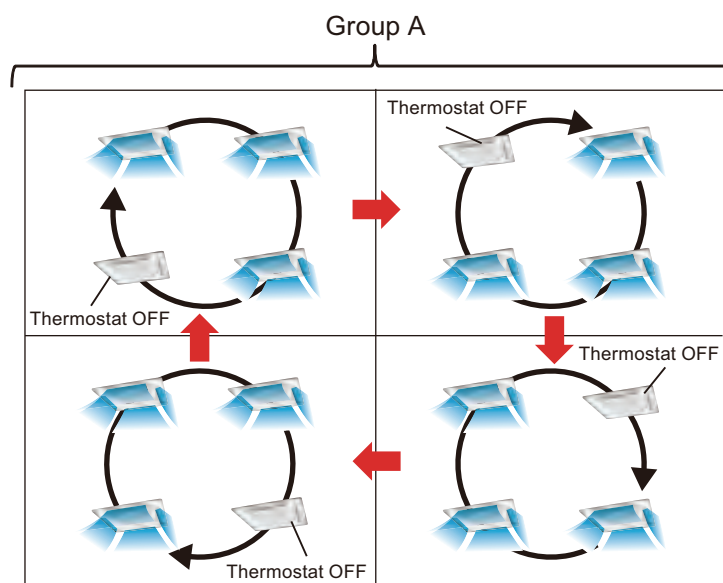

- Indoor units can be changed in turn according to the stoppage rate set for each group.

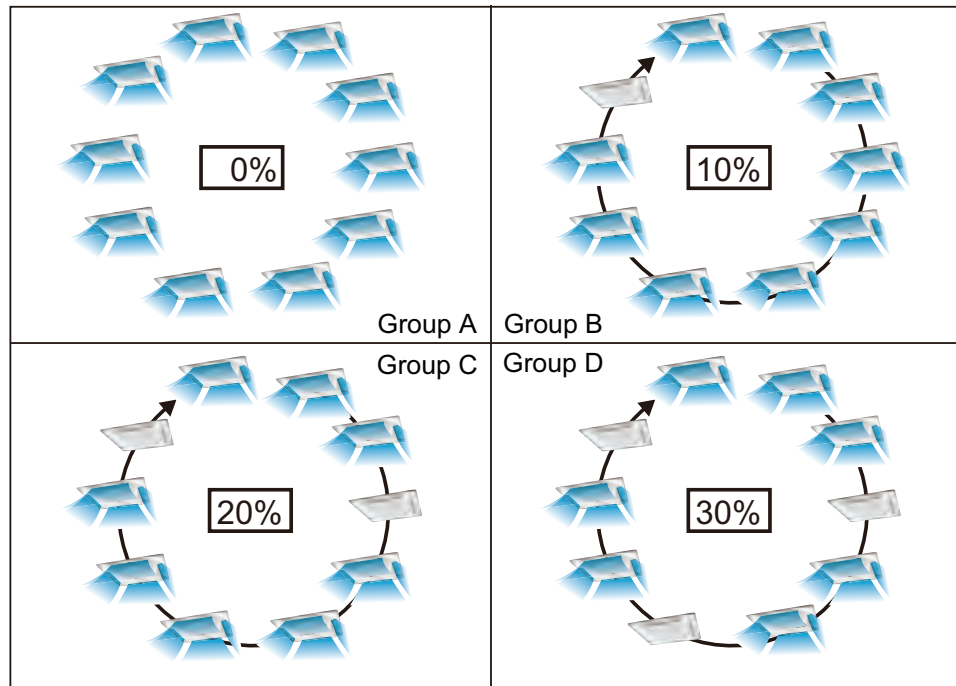

\*The indoor unit operation stoppage rate can be selected from 10% to 30%.

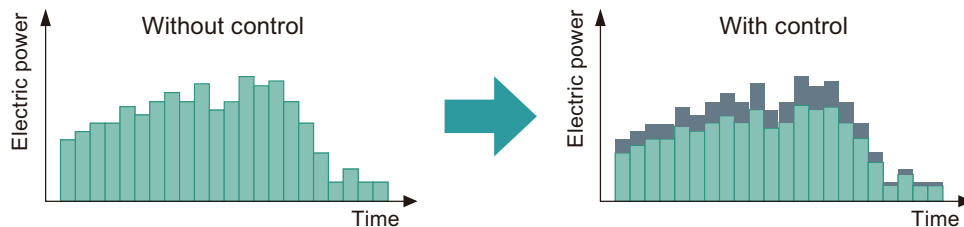


### • Outdoor unit capacity saving

The power consumption is reduced by limiting the upper limit of the outdoor unit capacity for each refrigerant system.

This has a reducing effect especially in the summer, winter and other times when the heat load is high.

In addition, because the upper limit capacity of the outdoor unit is limited directly, it is a control which easily exhibits an energy saving effect compared to rotation control. However, because the outdoor unit does not operate above the limited capacity, there may be a loss of comfort, depending on the indoor heat load. (The operation capacity upper limit rate [%] of the outdoor unit is specified for each refrigerant system.)

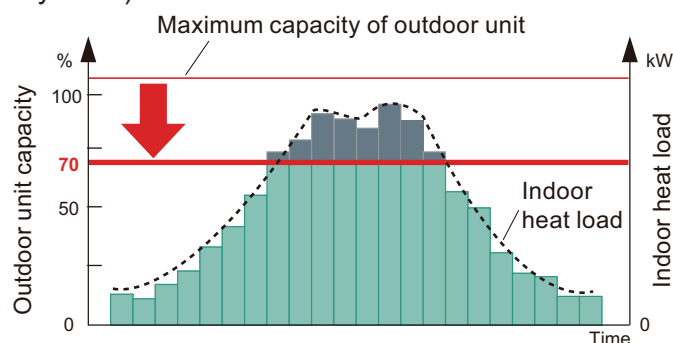




- **Peak cut operation**

Reduces the power consumption by setting a specific target value (maximum average power [kW]) for all the air conditioners and controlling operation so that this value is not exceeded.

Limit control is performed in 3 steps of “Step 1: Set temperature shift” → “Step 2: Thermostat OFF” → “Step 3: Outdoor unit stop”.

To perform this control, an electricity meter must be installed.

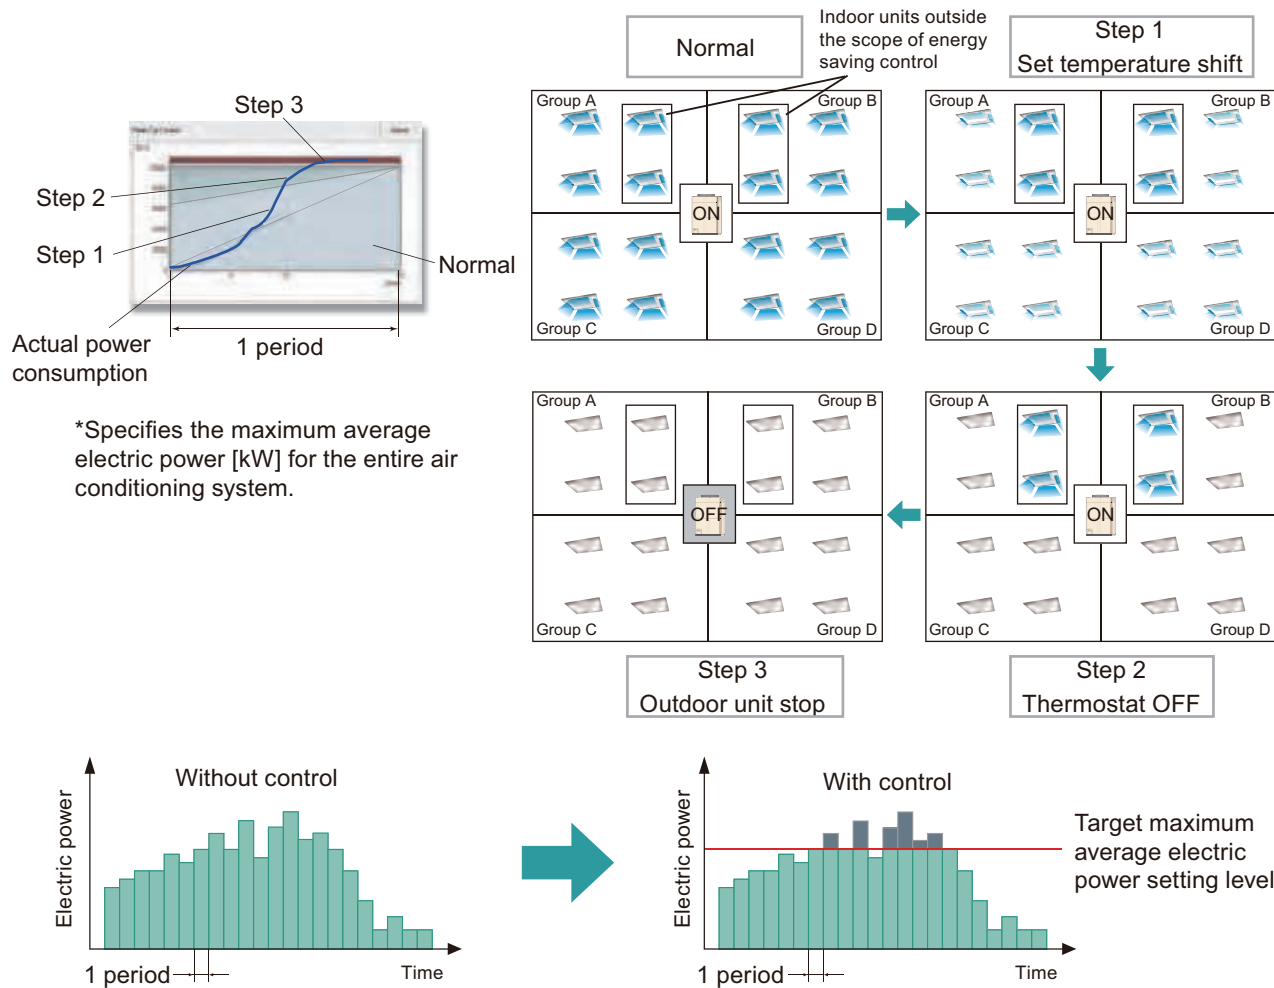

## ■ General setting flow for energy saving and electricity charge apportionment using electricity meter


Description mentioned here is an example of general setting flow for performing an energy saving function and an electricity charge apportionment function using an electricity meter.

**NOTE:** Layout of the outdoor units and indoor units, combination of the remote controller group, and other design shall be performed separately from the following steps.

1. Understand the overview of the energy saving function and electricity charge apportionment function using an electricity meter, the usage method, and restrictions, etc.  
For details, refer to:
  - ["Features of energy saving function"](#) on page 07-135
  - ["Operation example"](#) on page 07-139
  - ["Notes on energy saving function"](#) on page 07-139
  - ["Installation restriction and requirement of energy saving units"](#) on page 07-140
  - ["Electricity charge apportionment and electricity meter"](#) on page 07-141
2. Decide following items:
  - Power source supply system
  - Electricity meter installation sites, number(s), and connecting outdoor units
  - Appropriate VT/CT specifications
 For details, refer to:
  - ["Electrical wiring"](#) on page 07-142
  - ["Installation restriction and requirement of energy saving units"](#) on page 07-140
  - ["Electricity meter system"](#) on page 07-154
3. Purchase the electricity meters and related hardware and materials.  
For details, refer to:
  - ["Electrical wiring"](#) on page 07-142
4. Perform the installation of the electricity meters and related hardware or materials.  
For details, refer to:
  - ["Electrical wiring"](#) on page 07-142
5. Perform the setting of the electricity meter.  
For details, refer to
  - ["Setting of outdoor unit and System controller"](#) on page 07-155
6. Perform the setting of the outdoor unit.  
For details, refer to:
  - ["Setting of outdoor unit and System controller"](#) on page 07-155
  - ["Accessories"](#) in Chapter 3. OUTDOOR UNITS on page 03-51
7. Perform the setting of the system controller.  
For details, refer to:
  - ["Setting of outdoor unit and System controller"](#) on page 07-155
  - System controller instruction manual

## ■ Operation example

Breakdown of electricity charges in general and the corresponding operation of the system for each item is as follows.

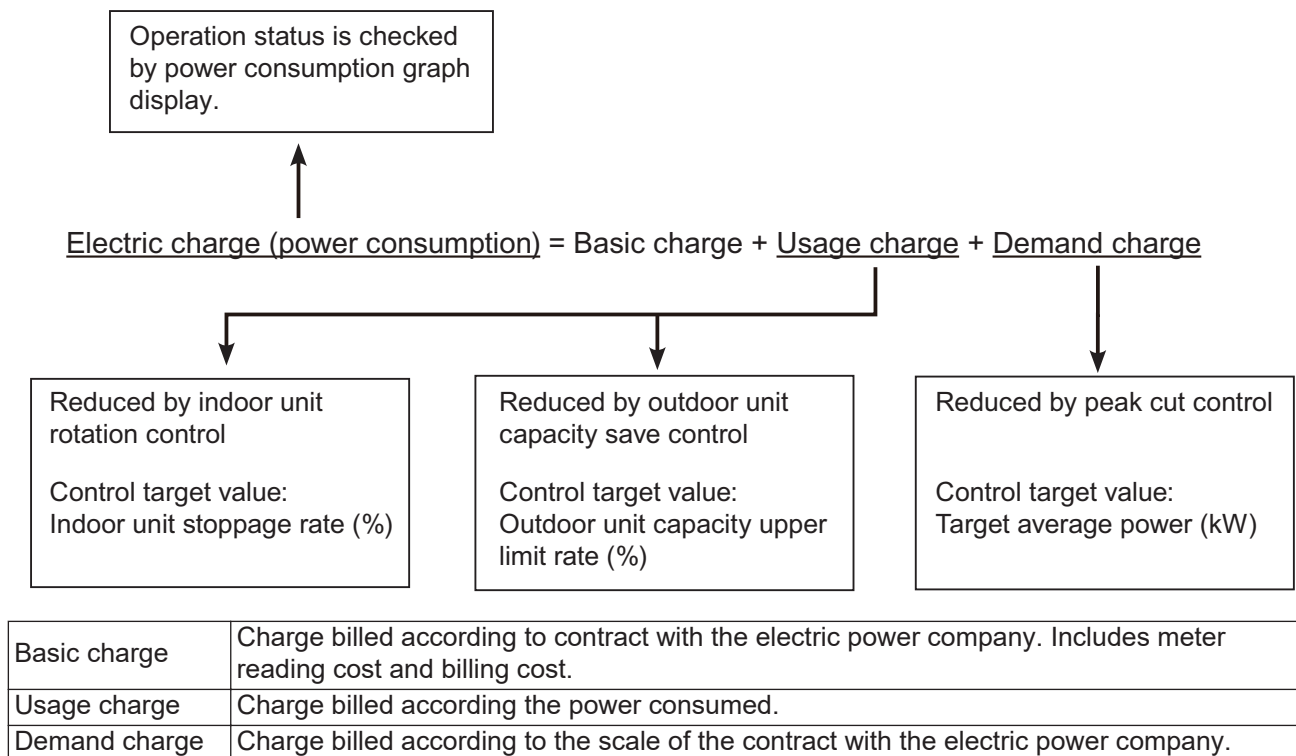

## ■ Notes on energy saving function

### Energy saving function precautions and scope of guarantee:

The effect of the energy saving function depends on the units used in the system, usage environment, installation environment, and so forth. Each energy saving function is not guaranteed to display a fixed effect and function for operation by specific setting. Before using the function, read and understand the following precautions.

- **How to use the energy saving function:**

Since the effect of the energy saving function depends on the units used in the system, usage environment, installation environment, and so forth, a different effect may appear according to the building and operating period even when operated with the same settings and schedule. Try to gain an understanding of the features of each energy saving function and confirm the actual effect through operation and apply appropriate settings, etc. as required.

- **Target electric power of peak cut function:**

These are values used as target values when performing peak cut control. These values do not always guarantee that the consumed power is within the target value. For example, even if forced thermostat off and outdoor unit stoppage are activated, the control become ineffective if the outdoor unit is performing a protective operation (oil recovery and defrosting). As a result, the electric power consumed may exceed the target electric power.

- **Relationship between unit protection and energy saving function:**

For VRF, there are operations and restrictions for protecting units. The energy saving function operates within the range of these protective operations and restrictions. When the energy saving function performs control against these protective operations and restrictions, the protective operations and restrictions have priority and the energy saving function is either restricted or may not operate. As protective operations of units, there are oil recovery, defrosting, etc. which are automatically performed periodically or under specified conditions.

- **Failure, etc.:**

An energy saving function operates only when the related units are operating normally. When the power of the electricity meter and the outdoor units connected to an electricity meter and the System controller is turned off due to a failure, etc. the energy saving function will not operate normally.

- **Explaining to the building tenants:**

During energy saving function operation, control from the remote controller may be overridden by the energy saving control. For this reason, it is recommended that the building tenants be informed of this beforehand.


## ■ Installation restriction and requirement of energy saving units

- **Only 1 unit may perform energy saving control at a time.**

When energy saving control is performed by System controller (UTY-APGXZ1, UTY-PEGXZ1), stop energy saving control such as forced thermostat OFF, outdoor unit forced OFF, and outdoor unit capacity save from the building management system through the following units:

- BACnet gateway (Software)
- Network converter for LonWorks

When energy saving control is performed from multiple points, trouble may occur.

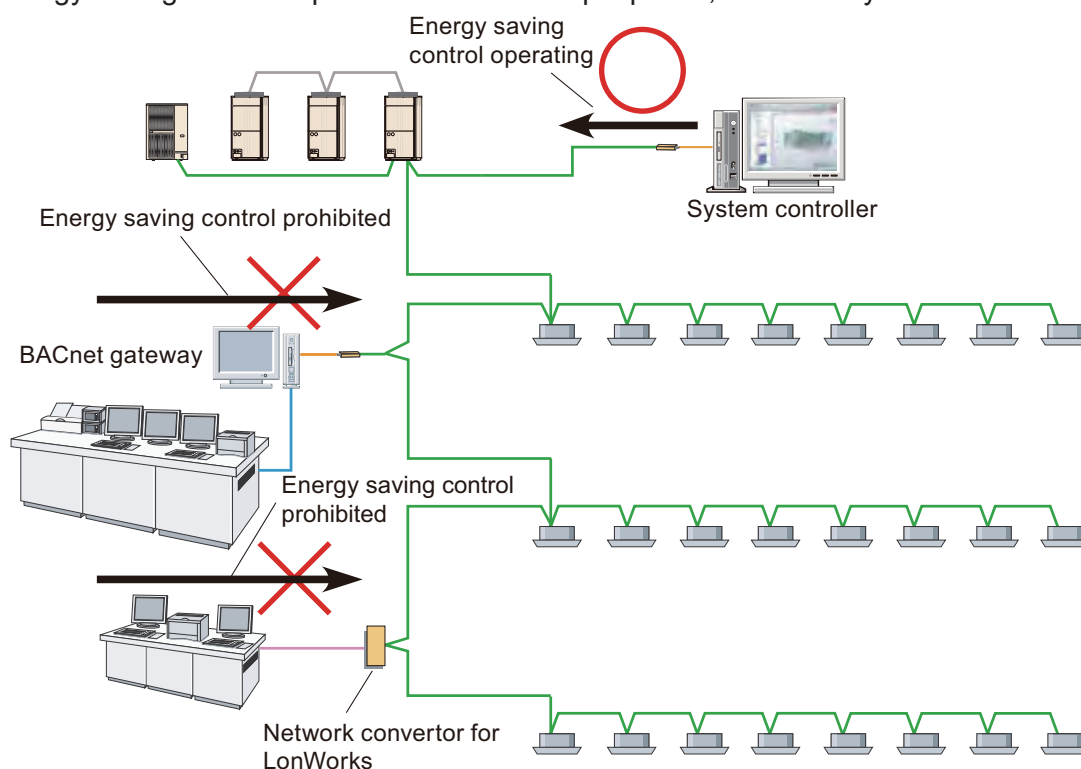

- **Electricity meter installation required for some functions.**

For using following functions under energy saving control, installation of an electricity meter is required.

- Power consumption graph display function
- Peak cut control

When these functions are necessary, install an electricity meter in advance with referring the installation manual.

## 2-27. Electricity charge apportionment setting (System controller, Touch panel controller)

Electricity meters are required to use an electricity charge apportionment function. To perform the functions mentioned here, one of the controller listed below is required:

- System controller
- System controller lite
- Touch panel controller

### ■ Electricity charge apportionment and electricity meter

When implementing the electricity charge apportionment function in a VRF System, a configuration which does not use electricity meters or a configuration which uses electricity meters can be selected. The differences between these two configurations are explained below.

The electricity charge apportionment function apportions the power consumption to each block (tenant indoor unit) defined in advance according to the usage record, after the power consumption (electricity charge) of the air conditioners is input to the System Controller. Electricity charge apportionment calculation becomes possible only after inputting the power consumption (or electricity charge).

#### Electricity charge apportionment when electricity meter not used

Only after the electricity bill is received from the electric power company and the billed amount is input into the System Controller, can electricity charge apportionment for the billed period be calculated.

#### Electricity charge apportionment when electricity meter used

Since the power consumption data is sent from the electricity meter to the System Controller at any time, basically electricity charge apportionment calculation can be performed at any time. Because an actual System Controller calculate power charge apportionment data in one day units, electricity charge apportionment calculation can be performed at an arbitrary day in one day units.

#### Example 1:

When the tenants of a tenant building, etc. are billed for their air conditioning electricity charge once a month, if the electricity bill arrives from the electric power company each month, the electricity charge apportionment function can be used without electricity meters because electricity charge apportionment can be performed based on that bill and the tenants can be billed. Even if there are tenants moving in and out within a month, appropriate billing can be performed after the bill was received from the electric power company. However, when the electricity bill is received from the electric power company once every 3 months, electricity charge apportionment for 3 months cannot be calculated until the bill is received. In this case, building owner can only bill the building tenants for air conditioning electricity charges every 3 months. However, if electricity meters are installed, billing at an arbitrary interval, for example, once a month, is possible.


#### Example 2:

When air conditioning electricity charge is billed based on the electricity charge apportionment function for each room in hotels etc., because guests leave and arrive daily and the electricity charge is calculated each time, you cannot wait for the electricity bill to arrive from the electric power company. In such cases, it must be possible to be able to calculate electricity charge apportionment at any time using electricity meter.

## ■ Electrical wiring

### • Electricity meter connection composition

To perform energy saving peak cut control, basically, electricity meters with pulse transmission function measuring all the power consumed by the air conditioner are necessary. Multiple meters installations are also possible as long as the number of electricity meters is within the specified limit. A general electricity meter installation configuration is shown below.

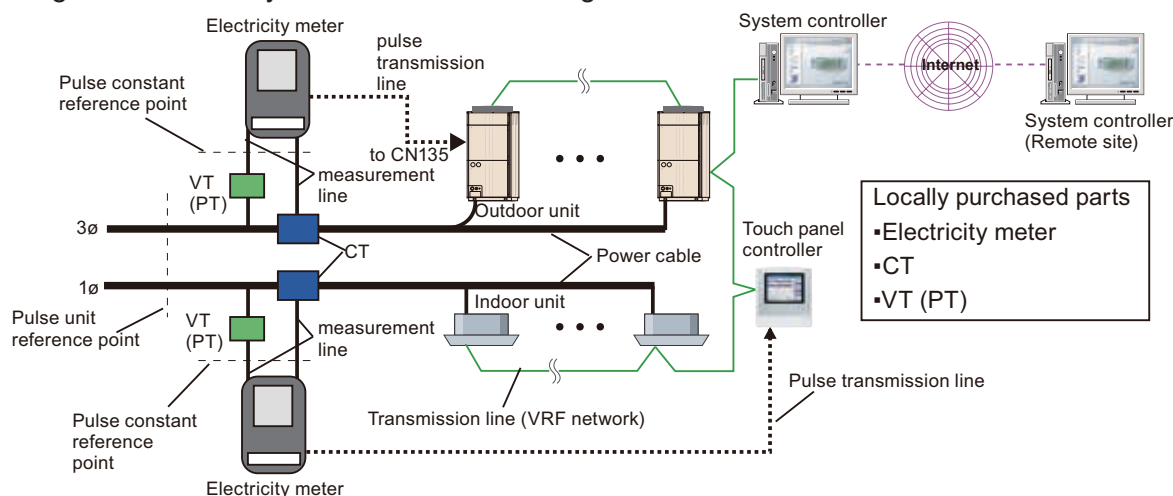

Item	Description
Electricity meter	Measures the voltage and current of the power cable to which measurement line is connected and finds the power consumption from these. In addition, pulses corresponding to the measured value are output to the transmission line.
Voltage Transformer (VT)	Transform the power source voltage to a measurable voltage. Transformation ratio is indicated by VT (PT) ratio. Normally unnecessary for the voltage value level used by outdoor units and indoor units.
Power Transformer (PT)	
Current Transformer (CT)	Transform the power line current value to a current measurable by an electricity meter. Transformation ratio is indicated by CT ratio. There are types which is inserted between power cables and types which are coupled to the power cables.
Pulse unit	<p>Pulse unit indicates the relationship between electricity meter output pulse and measured power. The value specified in pulse unit indicates the power in kWh consumed on the power cable for 1 pulse. Units: kWh/pulse</p> <p>The value specified by pulse unit takes into account the VT and CT ratio used and corresponds to the actual power consumption itself.</p>
Pulse unit reference point	Indicates the measurement point of the power consumption specified in pulse units.
Pulse constant	<p>Pulse constant indicates the relationship between electricity meter measured power and output pulses. The value specified by pulse constant indicates how many pulses are equivalent to 1 kWh of power consumption input to an electricity meter. Units: pulse/kWh</p> <p>Because the ratio of VT and CT used is not taken into account in the value specified by pulse constant, to find the actual power consumption on the power cable, the pulse constant value must be multiplied by both the VT and CT ratio.</p>
Pulse constant reference point	Indicates the measurement point of power consumption specified by pulse constant.

### • Selection of Electricity meter, CT, and VT

Select the electricity meter, CT, and VT by considering the following items:

- Install electricity meters for each refrigerant system, if circumstances allow.
- Select VT/CT with a small VT/CT ratio.
- When using an electricity meter which is specified in pulse units (kWh/pulse), usually select a meter with a 1 kWh/pulse output.

- **Outdoor unit connection interface (CN135) or touch panel controller connection interface (TM201 CH1) to electricity meter**

Item		Specifications	Remarks
Interface		Dry contact "a" contacts	"a" contacts: ON when shorted *1
Pulse	Specifications	Width: 50 ms or more Interval: 50 ms or more	
	Units	1 kWh/pulse (pulse units) recommended.	
	Constant	Considering the electricity meters available in some countries, use of electricity meters with 3,200 pulse/kWh (pulse constant) or less pulses are possible.	
Line length restriction		150 m or less	Between electricity meter and outdoor unit
Wiring specification		Control and instrumentation cable: CVV-S (Control-use Vinyl insulated Vinyl sheathed cable – Shielding) *2 2-conductor: 1.25 mm <sup>2</sup>	
Line length restriction		25 m or less	Between electricity meter and touch panel controller
Wiring specifications		2 core, twisted pair, 0.33 mm <sup>2</sup> (22 AWG) *3	

\*1 Pulse signal: normally OFF (open), ON (closed) when shorted

\*2 When affected by interference by induction, select shielded CVV cable (CVV-S cable). This is because copper shielding tape is wrapped around CVV cable and induction interference from adjacent power cables is alleviated and normal communication is maintained. In addition, when the wiring is outdoors, select weather resistance cable.


\*3 Use cable in accordance with local regulations and rules for cable.

- **Number of installing electricity meters**

Item	Specifications	Remarks
Number of installing electricity meters	Max. 200	Per site (include Max. 4 VRF systems)


- **Installation examples of electricity meter**

– Installation example for each refrigerant system:

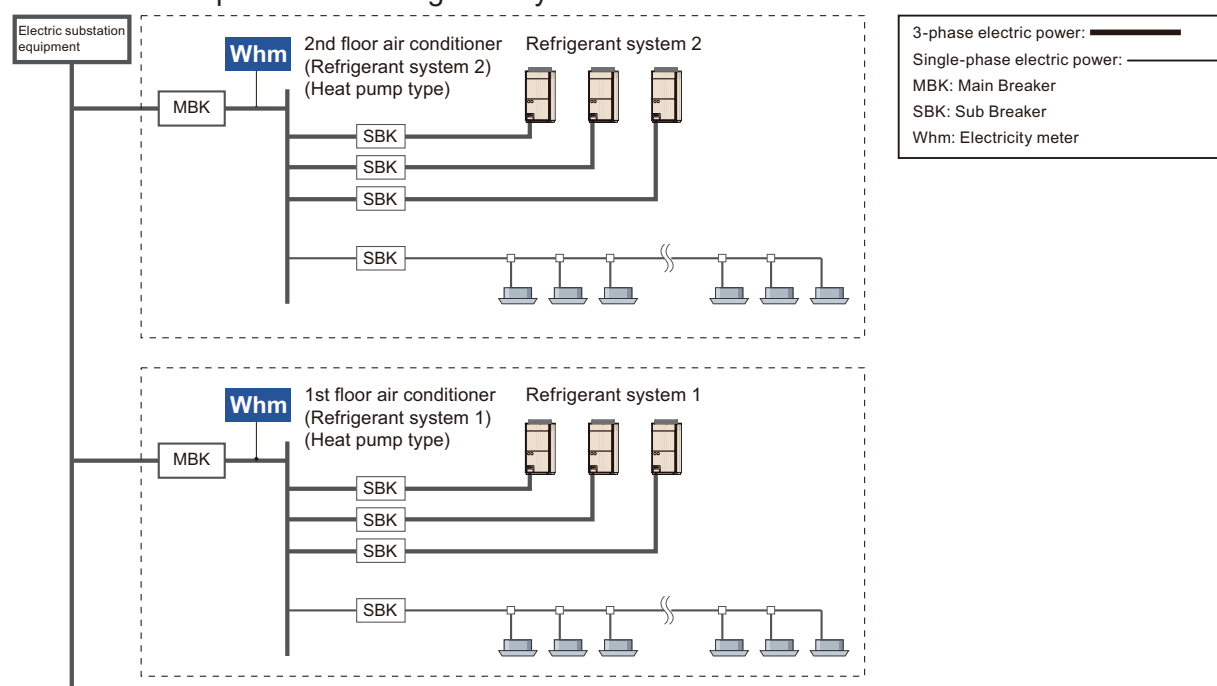




– Installation example for indoor units and outdoor units:

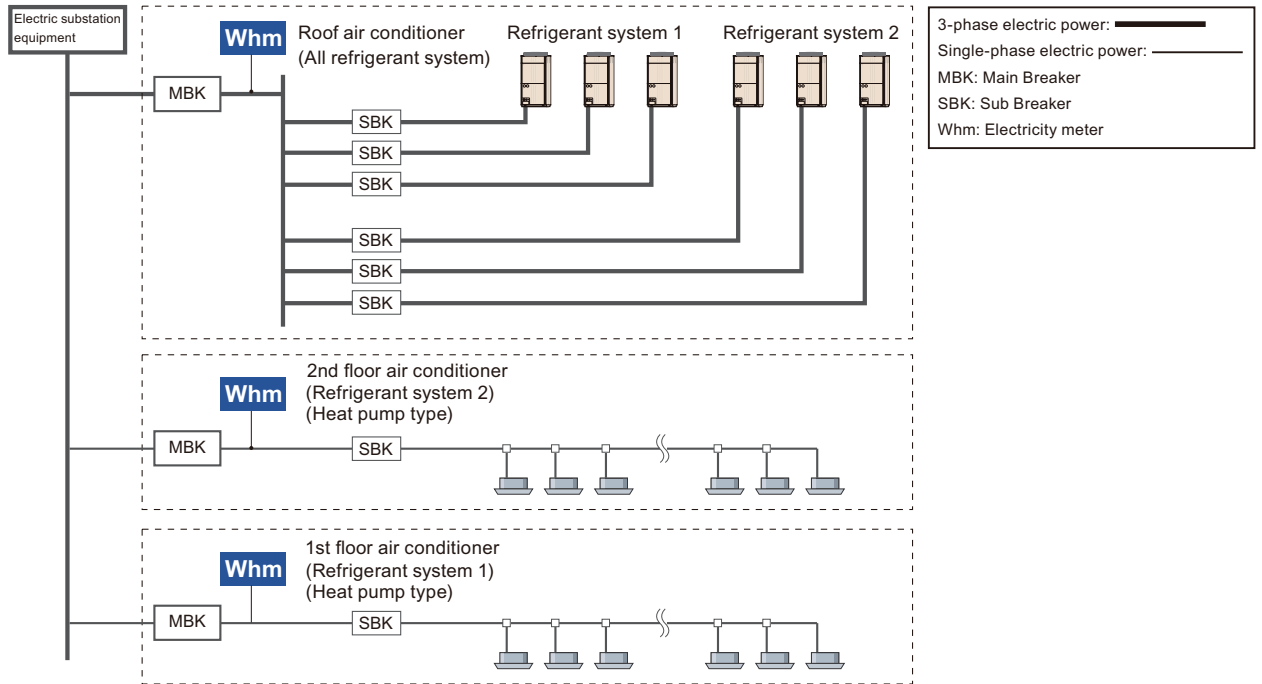

– Installation example for each tenant:

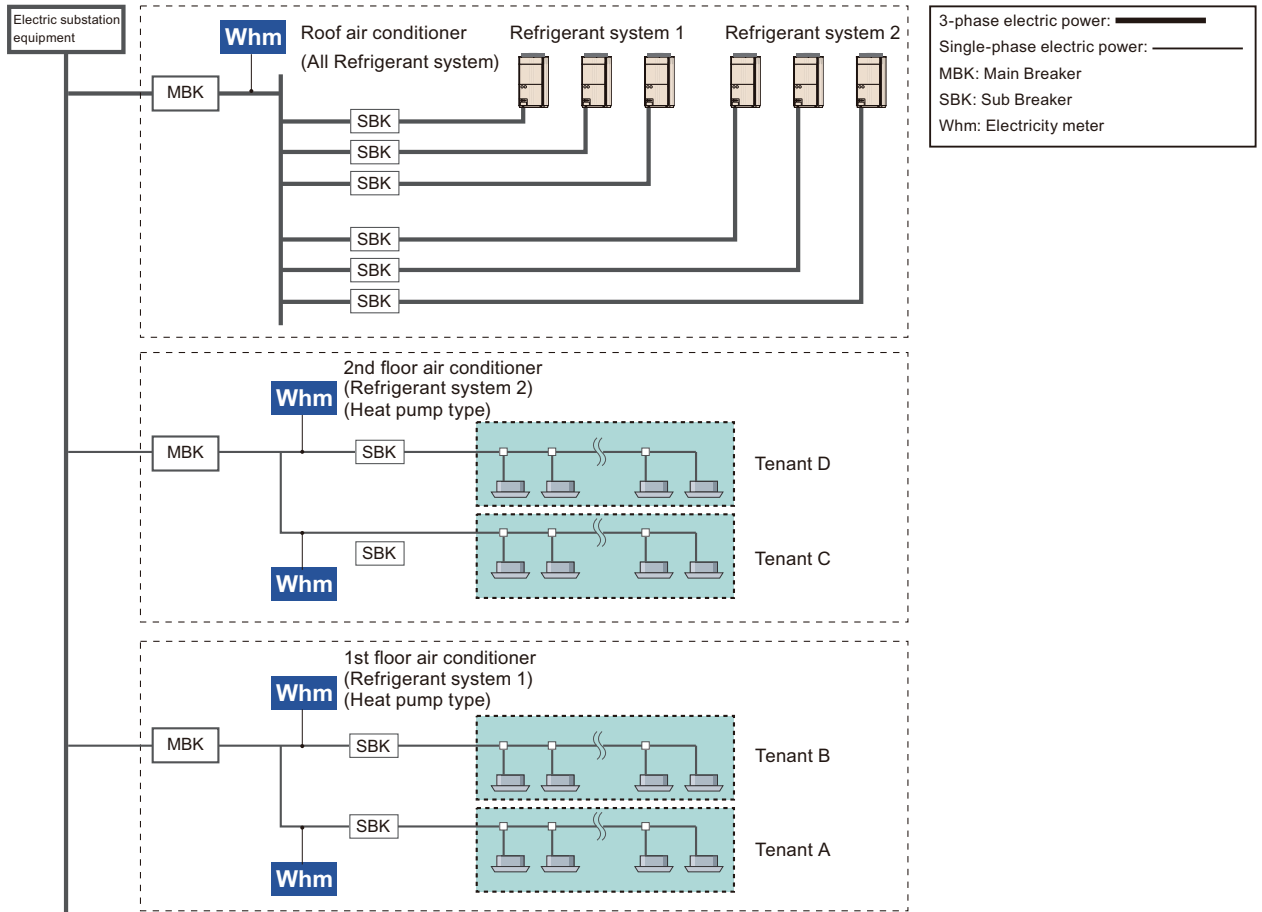



## ■ Installation restriction and requirement of electricity meter

### • Functions that requires installation of electricity meter

To use the following functions, use an electricity meter:

#### – Electricity charge apportionment

Install for operation using an electricity meter. (Operation without an electricity meter is also possible.)

When using an electricity meter, an electricity meter must be installed for all the units which perform apportionment calculation.


#### – Peak cut control (Only for System controller)

Installation of an electricity meter is essential.

#### – Power consumption graph display (Only for System controller)

Installation of an electricity meter is essential.

[Installation example]

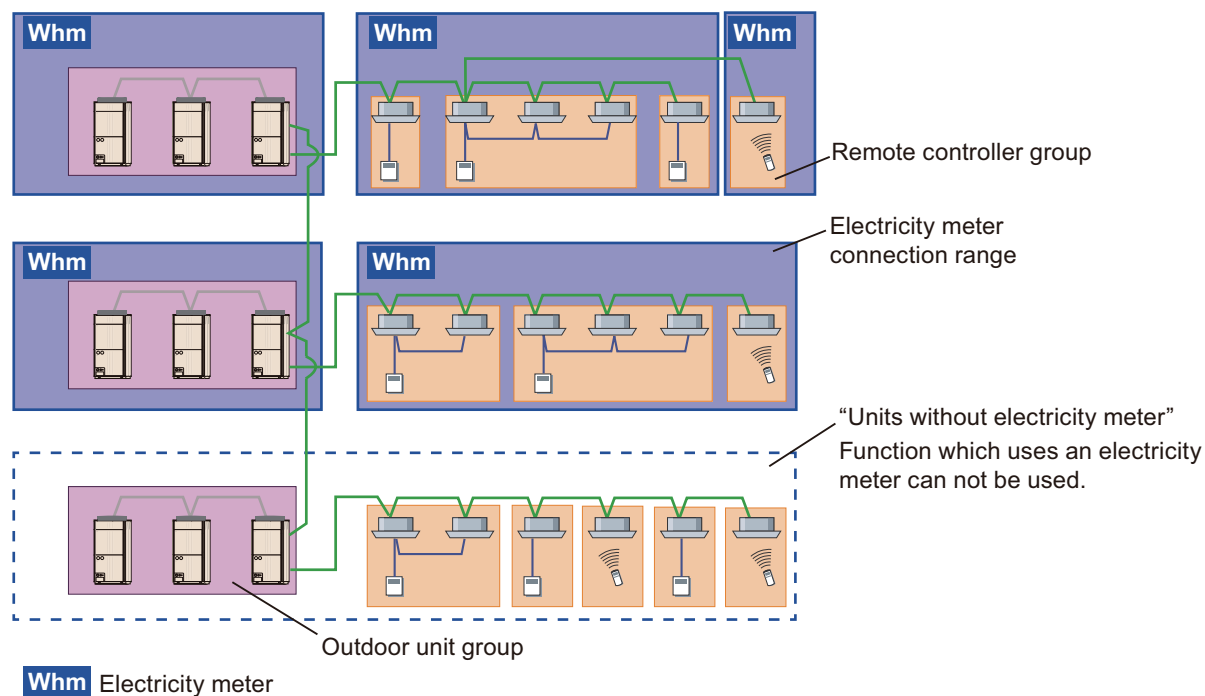


## • Installation abstract


Electricity meter connection methods mentioned here can be adapted for the System controller and Touch panel controller (TPC). However, the setting restrictions mentioned here must be observed.

- Multiple VRF networks can be connected to 1 electricity meter. (with network crossover)


**NOTE:** Combination of UTY-ALGXZ1 and UTY-PLGXE2 does not multiple VRF networks.

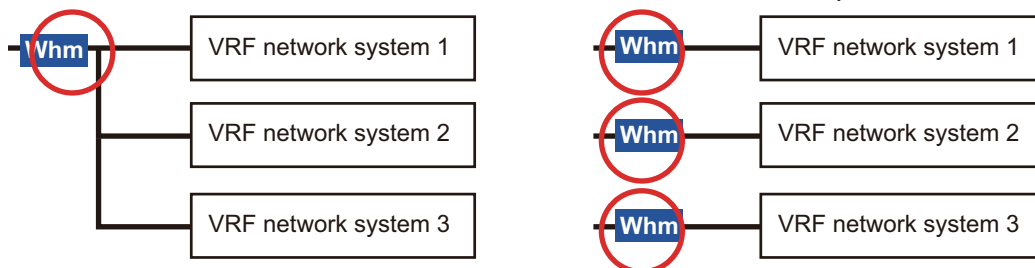


- With the electricity charge apportionment function, an electricity meter system cannot span TPC.

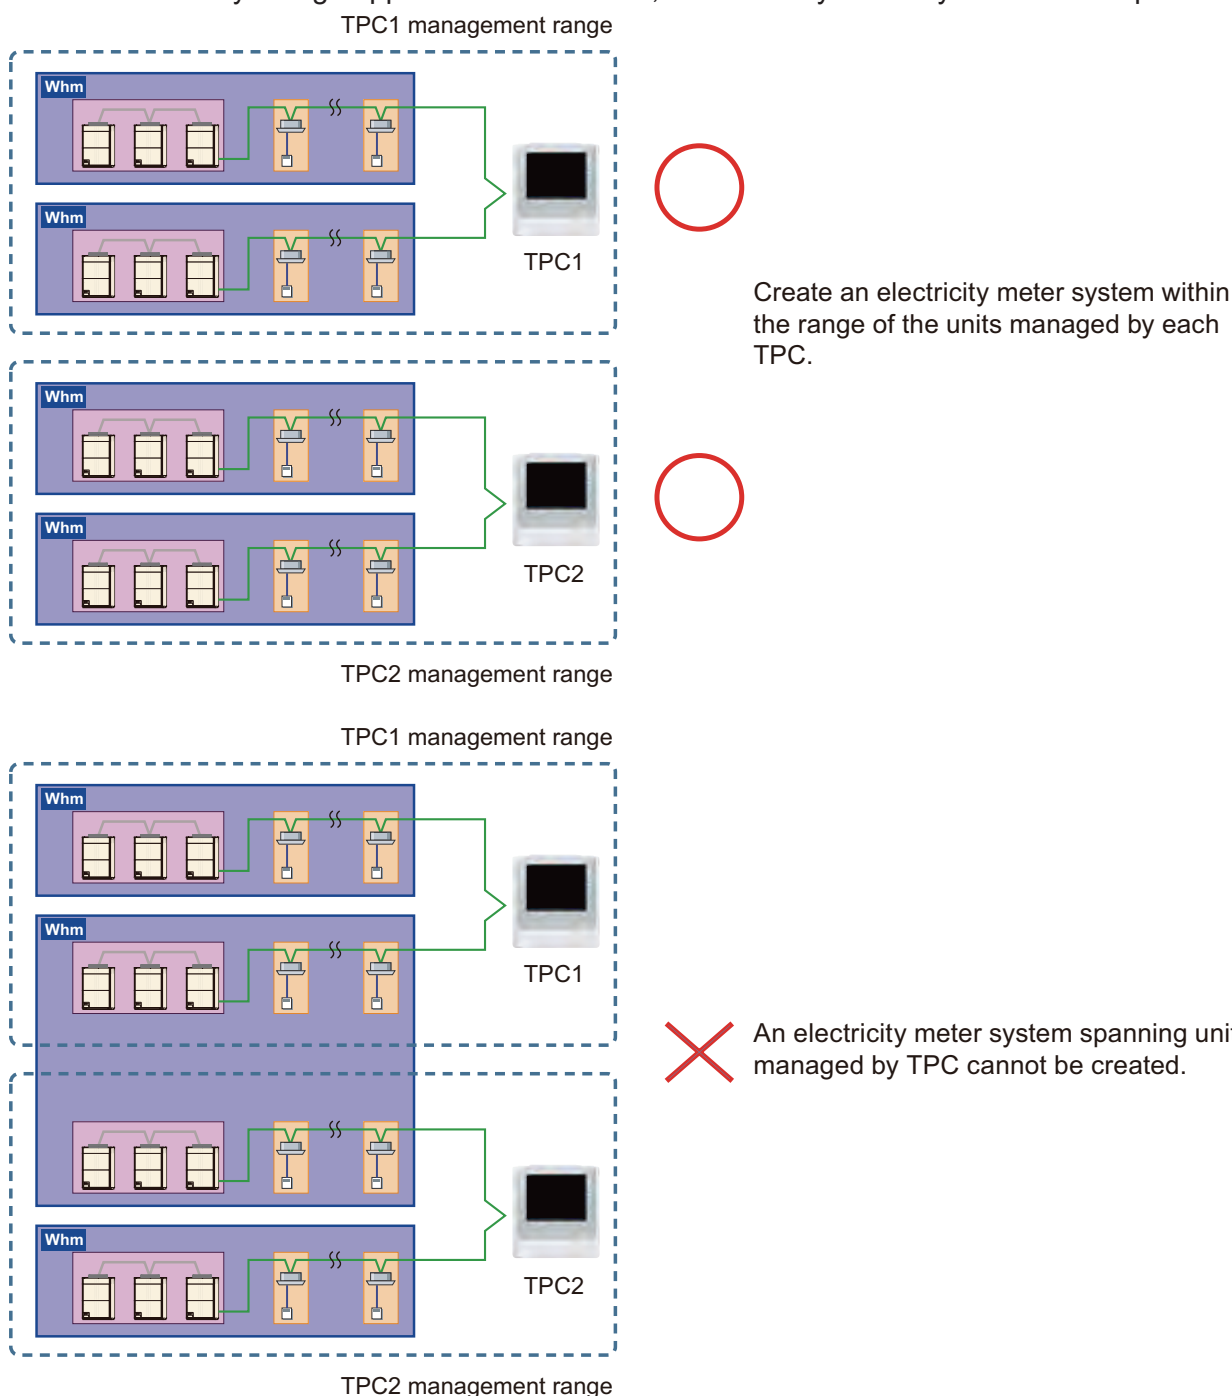

TPC1 management range

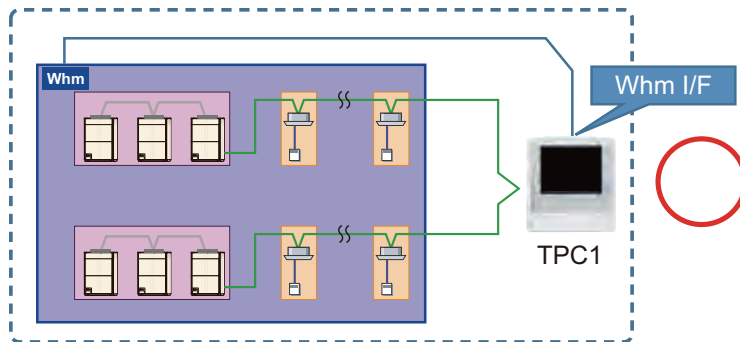


TPC2 management range

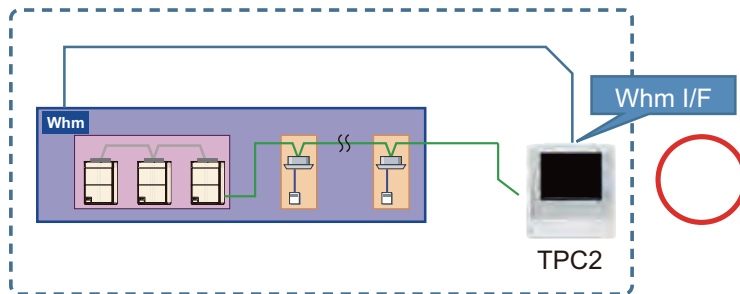


Connect the electricity meter that measures the units managed by the appropriate TPC to the electricity meter I/F belonging to the TPC main unit.


TPC1 management range

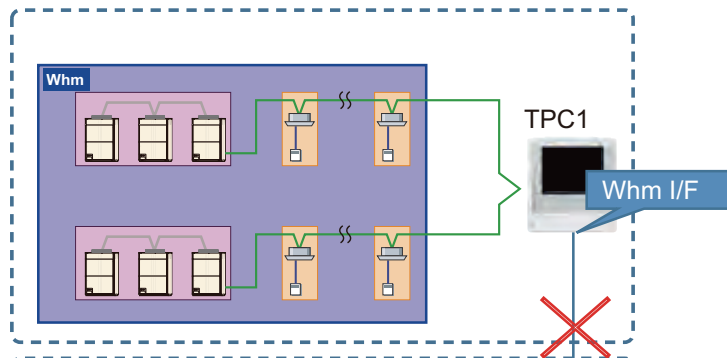


TPC2 management range

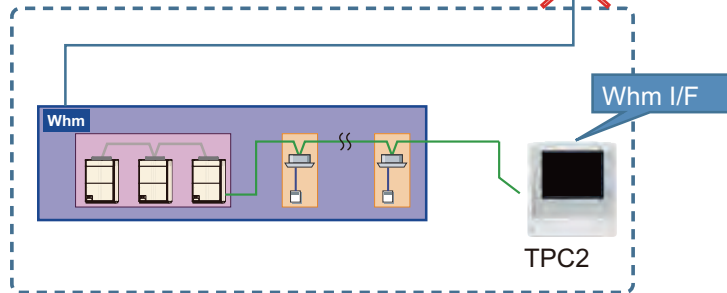

- Installation crossing over refrigerant system is possible.

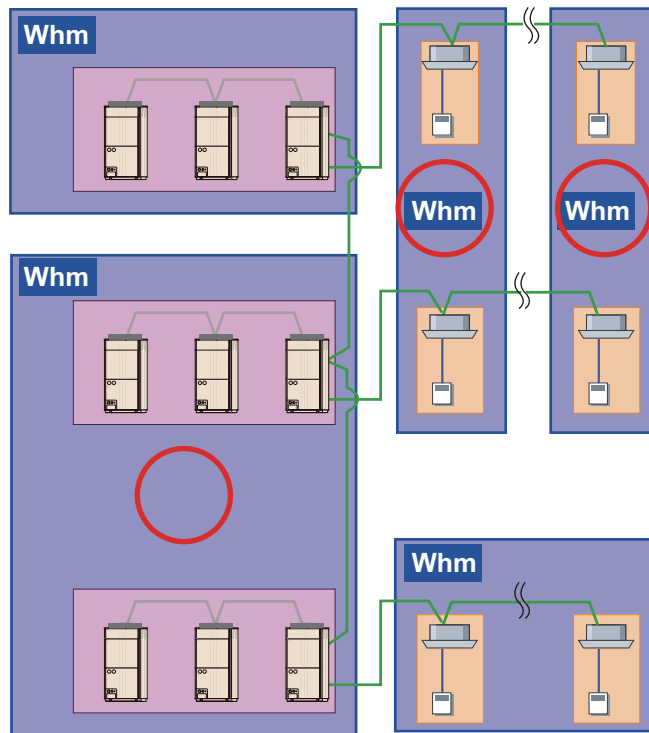

- Outdoor unit/indoor unit mixed in 1 electricity meter is possible.

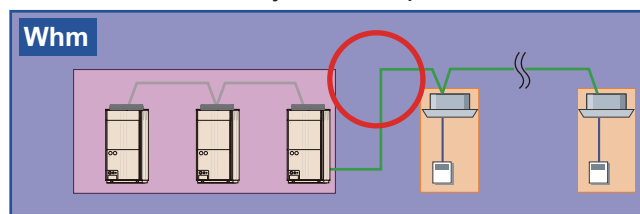

- There are no restrictions on outdoor units which connect an electricity meter. An arbitrary electricity meter can be connected to an arbitrary outdoor unit.

## • Installation restriction

Install electricity meters in accordance with the following restrictions:

- Install an electricity meter only to air conditioners which are the target of the function. When electric lights and other OA equipment are connected to the electricity meter, also their power consumptions are calculated.

Connect electricity meters to only the necessary air conditioners.


- An electricity meter cannot be connected to S series and V series units because they are not electricity meter supported.

- Electricity meter supported/unsupported units cannot be mixed under 1 electricity meter. (Because the available functions are different.)

When connecting single type air conditioners via Network converter (UTY-VGGXZ1), separately connect the electricity meter to VRF air conditioners because there are some functions that are electricity meter unsupported such as Electricity charge apportionment function\*<sup>1</sup> or Energy saving function\*<sup>2</sup>. However, UTY-VGGXZ1 which connects a group remote controller is an exception.


\*1: The electricity charge apportionment function cannot be used with single types air conditioners which are connected to a network converter.

\*2: In the peak cut control, though the power will be included in the target power, the actual control will not be performed.

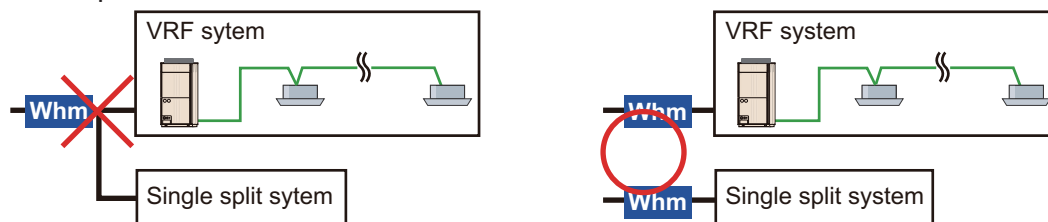


- Electricity power meters cannot be nested

Installation of the meters themselves is possible, but use only 1 electricity meter for the System controller. (If both are used, the power consumption will be measured twice.)

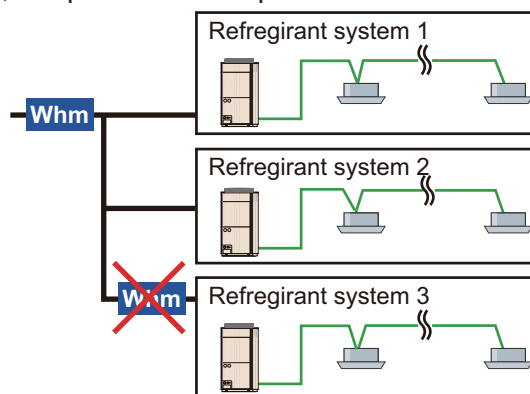


- The externally linked units\* shall be connected to the same electricity meter as the air conditioner to which they are connected.

\*: General-purpose unit which performs calculation as an externally linked unit by electricity charge apportionment function.

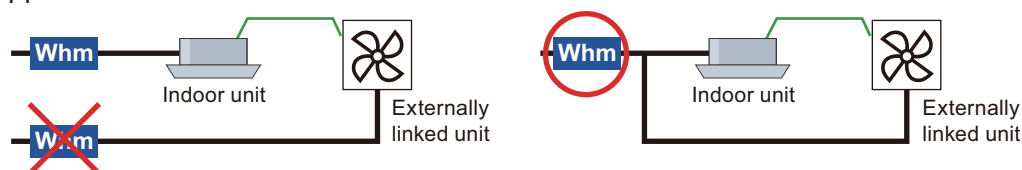

- Installation of electricity meter which divides remote control groups is prohibited.

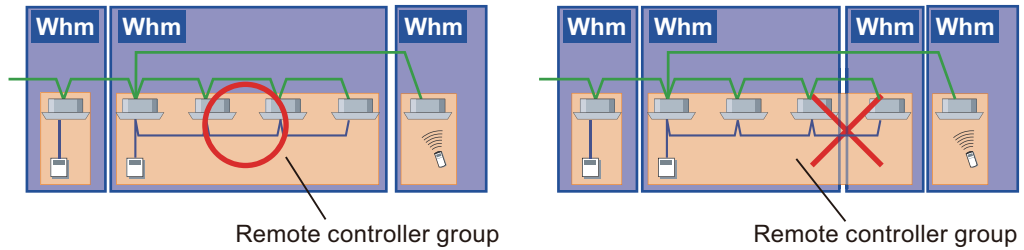


- Installation of electricity meter which divides outdoor unit groups is prohibited.





- Installation of electricity meter which crosses the contract is prohibited.


When an electricity meter is used by electricity charge apportionment function, install the electricity meter so that it does not cross over the “contract setting” set by electricity charge apportionment.

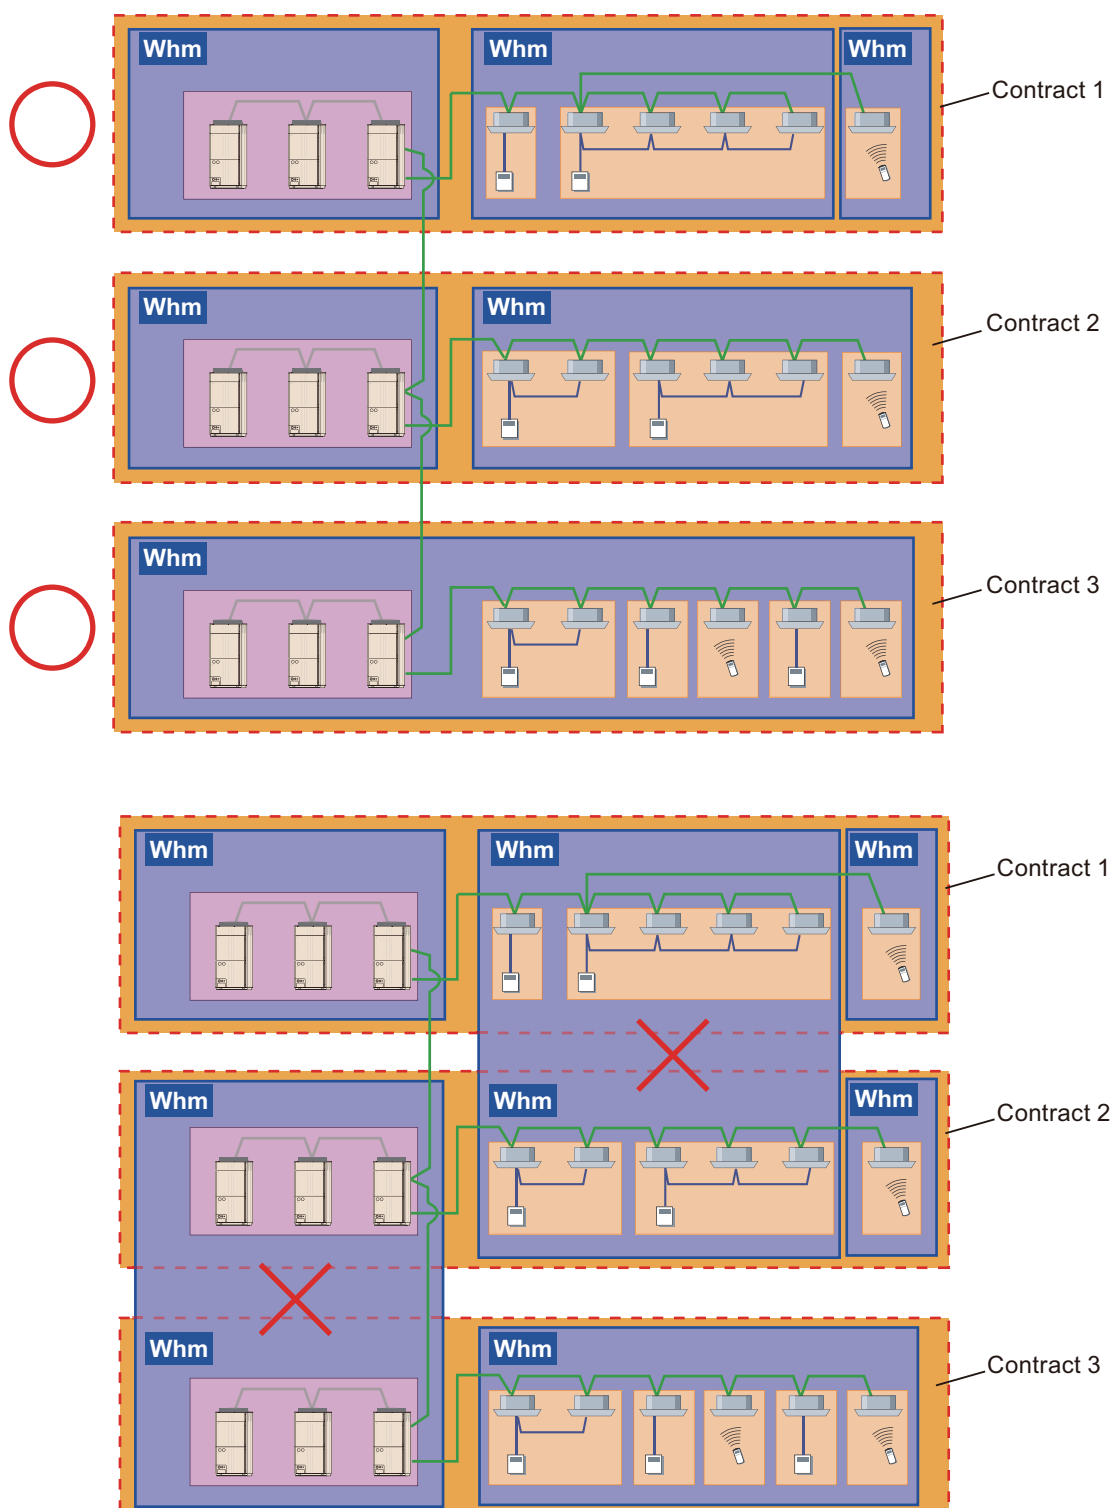

- When performing apportionment calculation using electricity meter  
The electricity meter shall be connected to the necessary air conditioners which are the target of calculation by the electricity charge apportionment function.  
When an electricity meter is not connected, electricity charge apportionment calculation using an electricity meter may not be possible.
- [Electricity charge apportionment with outdoor unit only]  
--> Connect the electricity meter to the outdoor unit.

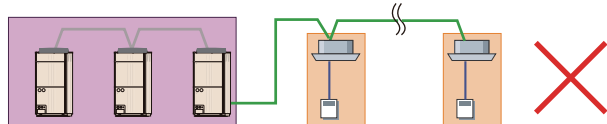
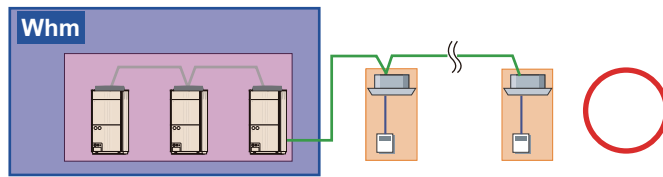


Electricity meter is not connected to outdoor unit

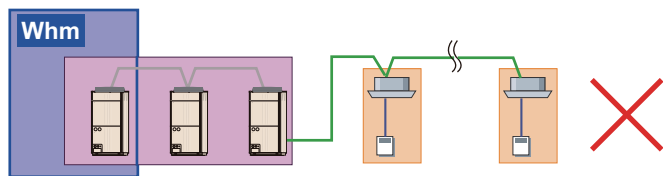


Electricity meter is not connected to only some outdoor units

- [Outdoor unit + indoor unit electricity charge apportionment]  
--> Connection of an electricity meter to the outdoor unit and indoor unit is necessary.

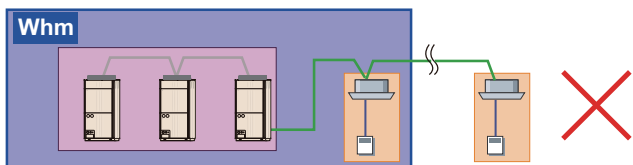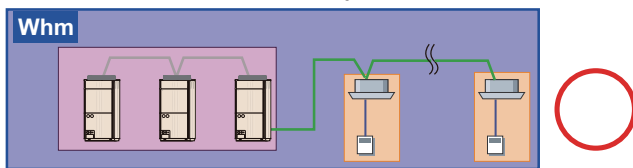

Electricity meter is not connected to some indoor units

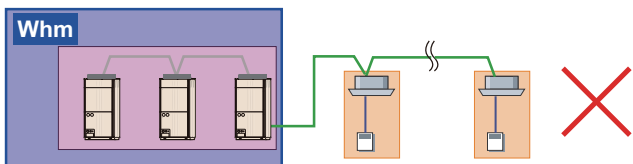

Electricity meter is connected to outdoor unit only even though outdoor unit + indoor unit electricity charge apportionment is performed



- Electricity apportionment for DX kit


### [When electricity meter not connected]

The following units can be linked to the DX-Kit, by using external output terminals.

[A]: External fan


[B]: Units linked to run/stop state external output

At electricity apportionment, the DX-Kit itself and units [A] and [B] mentioned above can be handled. Set the electricity value at ON beforehand for the units [A] and [B] from the “Parameter Setting” screen. The input value is included in the calculation as a constant value when the external output terminal is ON.

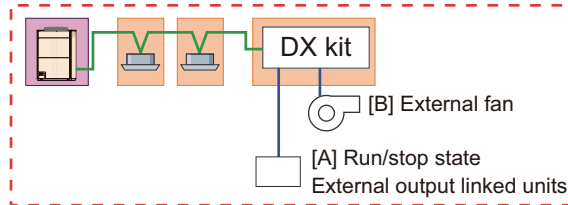


### [When electricity meter is connected]

At electricity apportionment, the DX-Kit itself and units [A] and [B] mentioned above can be handled the same as when an electricity meter is not connected. Set the electricity value at ON beforehand for the units [A] and [B] from the “Parameter Setting” screen and install the electricity meter so that the units [A] and [B] are included. The input value in the calculation as a constant value when the external output value is ON is included.

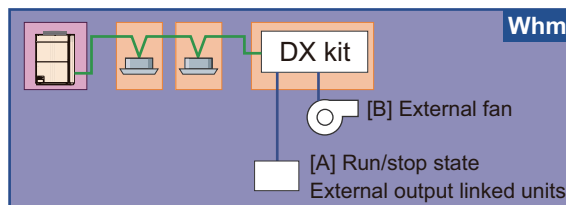


The electricity meter is installed so that the units [A] and [B] are included.

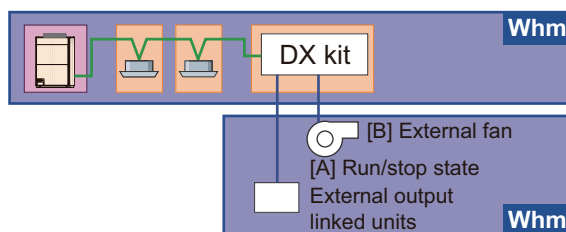


The electricity meter is installed independently from the units [A] and [B].

If there is a unit related to the DX-Kit other than [A] and [B], if the DX-Kit is connected as an independent electricity meter system and installed so that other units are included, it may be included in electricity charge apportionment. (All the value of that electricity meter is charged to the DX-Kit.

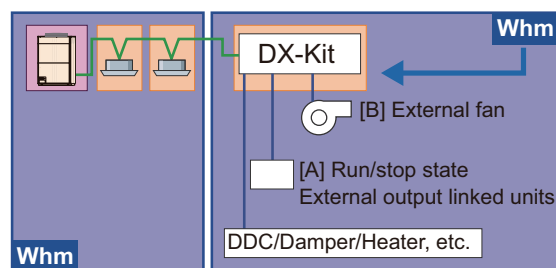

The electricity meter is installed so that [A], [B], and other units are included.

Units other than [A] and [B] must not be connected to an electricity meter together with other indoor units. If connected, the electricity amount of DDC, damper and heater is also charged to the other indoor units.

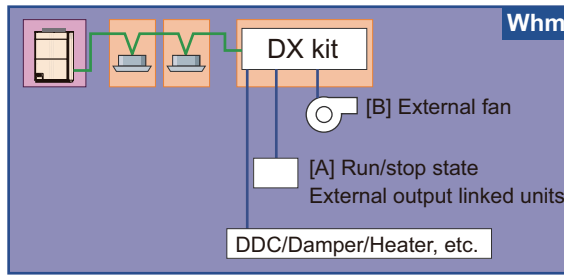

The electricity meter is installed so that the units other than [A], [B] and indoor units are included.


## Electricity meter system

Electricity meter system is the connection configuration of 1 electricity meter and the air conditioner units which are connected to the power line under it. This is set on the System controller.

Set the System controller to match the actual electricity meter installation configuration.

Since the electricity charge apportionment function and energy saving function perform the control using the power consumption data from an electricity meter, it is necessary to set an electricity meter system on the System controller.

When installing electricity meters as shown below, 5 electricity meters systems are set as follows.

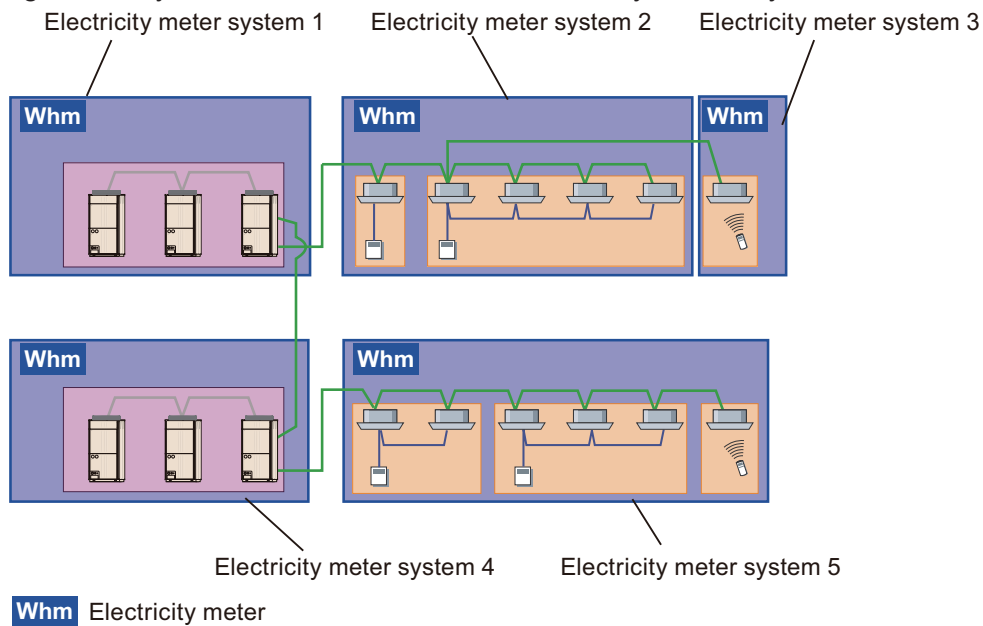


## ■ Setting of outdoor unit and System controller

To obtain the appropriate power consumption by System controller, the power value measured by an electricity meter must be properly conveyed. To do this, appropriate setting at the electricity meter, outdoor unit, and System controller is necessary.

The method of setting the pulse from the electricity meter received by an outdoor unit and the method of setting the pulse value set by System controller are described here. When electricity meter setting is necessary, perform it in accordance with the instruction manual supplied with the electricity meter.

Below, the setting method of electricity meters specified in pulse units and that specified in pulse constant are described.

- When electricity meter used is specified in pulse units  
The connection configuration is shown below.

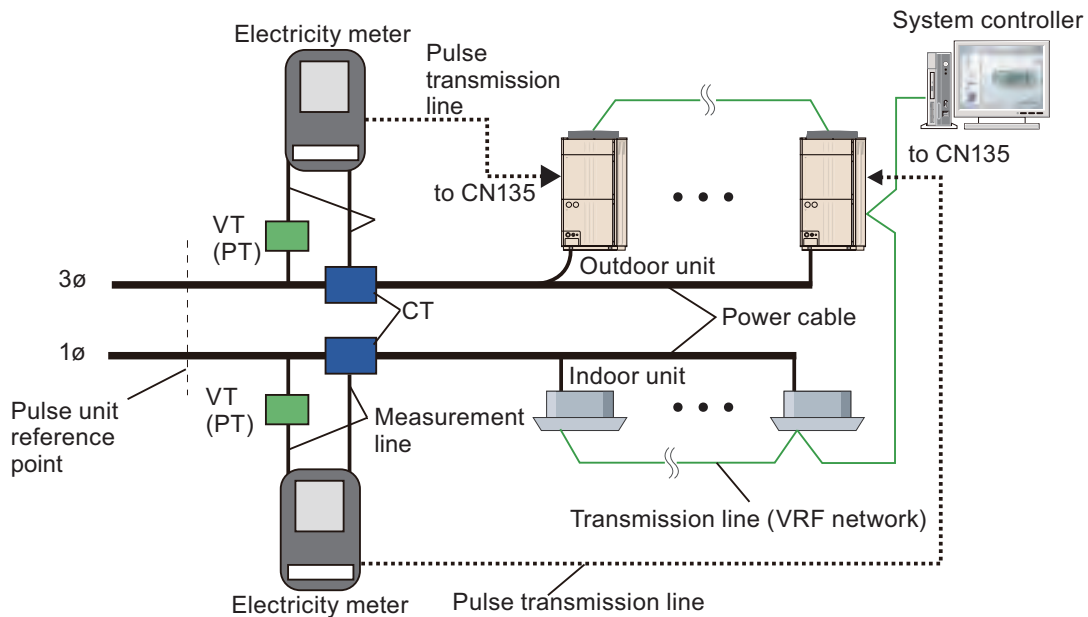

For the electricity meter specified in pulse units, the output pulses are normalized in advance (normally 1 kWh/pulse) and is output. In this case, the settings are as follows:

Set point	Set item	Set value	Description	Remarks
Electricity meter	Set in accordance with the product manual.	—	When there is a product unique setting, setting is performed in accordance with the product manual. (Pulse units value, VT/CT ratio, output coefficient, etc.)	
Outdoor unit	Meter no. setting	Arbitrary	Set an unique electricity meter no. for electricity meter identification.	The information will become necessary when setting System controller later. Refer also to <a href="#">"Setting on outdoor unit PCB"</a> on page 07-62.
	Electricity meter pulse setting	1	Fixed to "1". When 1 pulse comes from the electricity meter, the outdoor unit communicates "1" to the System controller.	
System controller	Electricity meter system setting	Units measured by electricity meter	Set the outdoor unit and indoor unit, measured by the electricity meter of the meter no. set at the outdoor unit.	The value set by each outdoor unit is used.
	Pulse setting	Electricity meter pulse units value (Usually either of 1, 10, or 100 [kWh/ pulse])	Set the pulse units specified by the electricity meter as they are. Set the number of kWh that corresponds to the "1" communicated from the outdoor unit.	Refer to the value set by each outdoor unit.

### [Setting example]


Equipment conditions:

VT ratio=1 (not used), CT ratio=50 (250/5 A), electricity meter=1 kWh/pulse

Set value:

Electricity meter pulse setting=1 (fixed), pulse setting=1 (corresponds to electricity meter used)

- When electricity meter used is specified by pulse constant  
The connection configuration is shown below.

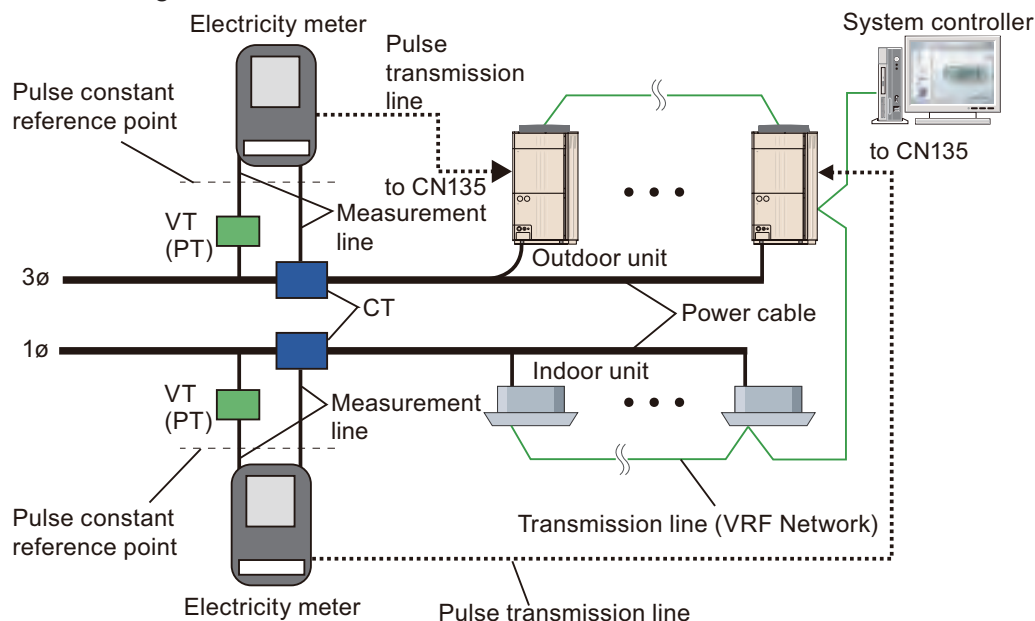

For the electricity meter specified by pulse constant, the power consumption indicated by output pulse must be corrected by VT/CT ratio. In this case, the settings are as follows:

Set point	Set item	Set value	Description	Remarks
Electricity meter	Set in accordance with the product manual.	—	When there is a product unique setting, setting is performed in accordance with the product manual. (Pulse constant value, output coefficient, etc.)	
Outdoor unit	Meter no. setting	Arbitrary	Set an unique electricity meter no. for electricity meter identification.	The information will become necessary when setting System controller later. Refer also to "Setting on outdoor unit PCB" on page 07-62.
	Electricity meter pulse setting	The pulse constant value / (VT ratio × CT ratio). However, truncated after the decimal point	Set the approximate number of power meter pulses that are equivalent to 1kWh. When set number of pulses come from the electricity meter, the outdoor unit communicates "1" to the system controller.	
System controller	Electricity meter system setting	Units measured by electricity meter	Set the outdoor unit and indoor unit, measured by the electricity meter of the meter no. set at the outdoor unit.	The value set by each outdoor unit is used.
	Pulse setting	(Electricity meter pulse setting value) × (VT ratio × CT ratio) / pulse constant Values after the decimal point must be also input.*	Set the standard number of kWh for the value communicated from the outdoor unit. Set the number of kWh that corresponds to the "1" communicated from the outdoor unit.	Refer to the value set by each outdoor unit.

\*: Input up to 6 decimal digits

### [Setting example]

Equipment conditions:

VT ratio=1 (not used), CT ratio=500(2500/5 A), electricity meter=3,200 pulse/kWh

Set value:

Electricity meter pulse setting=6 (3200/ [1 × 500]), Pulse setting=0.9375 (6 × [1 × 500]/3200) For details, refer to the calculating formula of the table above.





## 8. EXTERNAL INPUT AND OUTPUT

# CONTENTS

## 8. EXTERNAL INPUT AND OUTPUT


<b>1. Design precautions .....</b>	<b>08-1</b>
<b>2. Outdoor unit .....</b>	<b>08-2</b>
2-1. Component location.....	08-2
2-2. Wiring specifications .....	08-3
2-3. External input.....	08-3
2-4. External output .....	08-5
2-5. Optional parts .....	08-6
2-6. Function summary of outdoor unit external input/output.....	08-7
<b>3. Indoor unit .....</b>	<b>08-8</b>
3-1. External input.....	08-9
3-2. External output .....	08-23
3-3. Optional parts .....	08-26
3-4. Function summary of indoor unit external input and output .....	08-27
<b>4. Controller .....</b>	<b>08-28</b>
4-1. Touch panel controller .....	08-28
4-2. Central remote controller (UTY-DCGYZ*).....	08-34
4-3. Function summary of controller external input/output .....	08-40



# 1. Design precautions

## Cable length regulations:

Maximum length for each cable in-between the units are as follows:

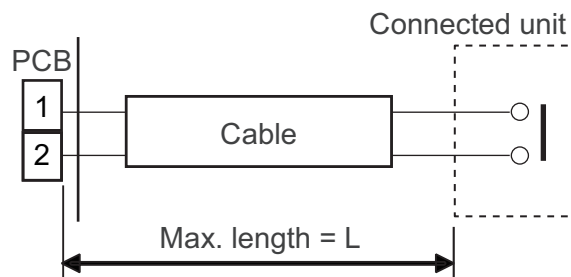

Type	L : ft (m)	
	Input	Output
Outdoor unit	492 (150)	492 (150)
Indoor unit	492 (150)	82 (25)
Touch panel controller	82 (25)	82 (25)
Central remote controller	82 (25)	82 (25)

## 2. Outdoor unit

External input and output functions and related components are as follows:

		Function	Connector	External connect kit (Optional parts)
External input	1	Low noise mode	CN131	UTY-XWZXZ6
	2	Cooling/Heating priority	CN132	
	3	Outdoor unit operation peak control	CN133	
	4	Emergency/batch stop	CN134	
	5	Electricity meter pulse	CN135	UTY-XWZXZF
External output	1	Error status	CN136	UTY-XWZXZ6
	2	Operation status	CN137	
	3	Base heater	CN115	UTY-XWZXZ9

### RELATED LINKS

["Component location"](#) on page 08-2

["Wiring specifications"](#) on page 08-3


["External input"](#) on page 08-3

["External output"](#) on page 08-5

["Optional parts"](#) on page 08-6

["Function summary of outdoor unit external input/output"](#) on page 08-7


### 2-1. Component location

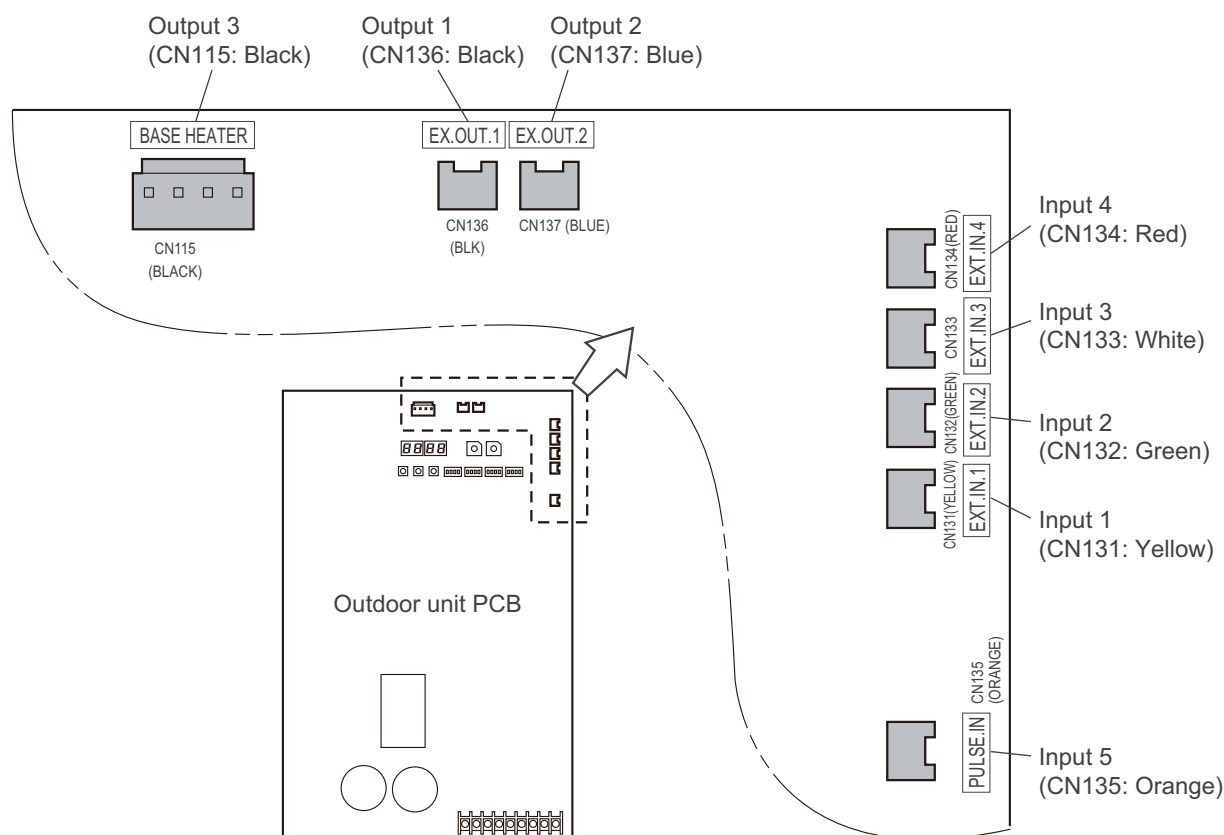

## 2-2. Wiring specifications

Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.

Cable type	Cable size	Max. cable length
Twisted pair cable	22 AWG (0.33 mm <sup>2</sup> )	492 ft (150 m)

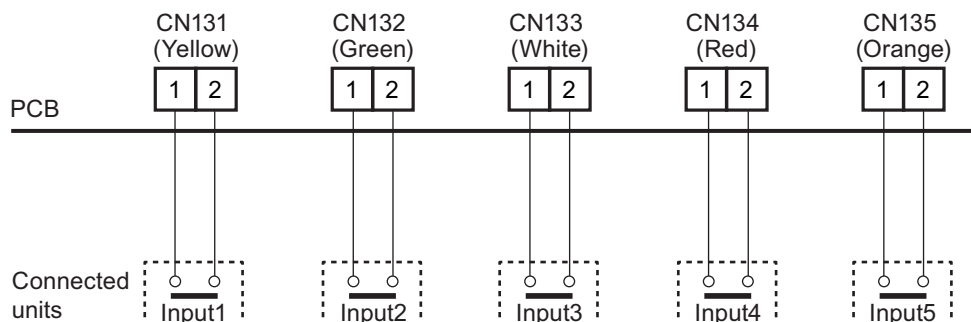

For each input, pin no.1 is of positive polarity and pin no.2 is of ground level.

## 2-3. External input


Setting to Low noise mode, Cooling priority/Heating priority selection, Outdoor unit operation peak control, Batch/Emergency stop, and Electricity meter pulse are possible from the outside.

Connector	Input signal	Status	Outdoor unit	
			Master	Slave *1
CN131 (Yellow)	Off	Normal operation	○	×
	On	Low noise mode operation		
CN132 (Green) *2	Off	Cooling priority	○	×
	On	Heating priority		
CN133 (White)	Off	Normal operation	○	×
	On	Outdoor unit operation peak control		
CN134 (Red)	Off	Normal operation	○	×
	On	Batch stop or Emergency stop operation *3,*4		
CN135 (Orange) *5	No pulse	No information from electricity meter	○	○
	Pulse	Power usage information from electricity meter		

- \*1: Slave unit can connect only Input 5 (CN135).
- \*2: The external input priority mode must be set by pressing push button on outdoor unit PCB.
- \*3: Batch stop or Emergency stop pattern can be selected by pressing push button on outdoor unit PCB.
- \*4: The emergency stop function mounted in the equipment does not guarantee the regulations of each country. For this reason, sufficient checking is necessary regarding use. Especially, since the fact that the equipment may not be emergency-stopped in the case of breaking of the wiring to the external input terminals and communication line, communication error due to noise, VRF external input circuit trouble, etc. must be considered, the provision of double measures that add direct interruption of the power supply by switch, etc. is recommended as a precaution.
- \*5: The width of Pulse input signal to CN135 must be 50 ms or more, and the interval of the signal must be 50 ms or more.

- When function setting is Batch stop mode:


Connector	Input signal	Command
CN134	Off → On	Batch stop
	On → Off	—

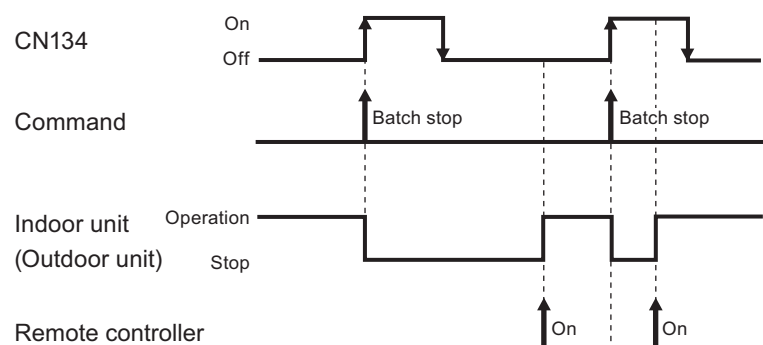**NOTES:**

- All indoor units of same refrigerant system stops when Batch stop operates.
- After batch stop operates, the operation by remote controller is possible.

- When function setting is Emergency stop mode

Connector	Input signal	Command
CN134	On	Emergency stop
	Off	Normal

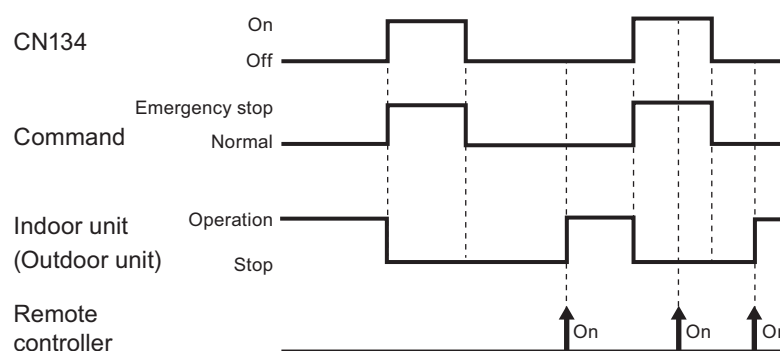**NOTES:**

- All indoor units of same refrigerant system stops when Emergency stop operates.
- When the Emergency stop is triggered, indoor unit stops and Start/Stop operation by a remote controller is restricted.


## 2-4. External output

Connector	Output signal	Status
CN136 (Black)	0 V	Normal
	DC 12 to 24 V	Error
CN137 (Blue)	0 V	Stop
	DC 12 to 24 V	Operation

### ■ Error status (for Master unit only)

This output indicates Normal or Error status of the outdoor unit and connected indoor units.

As for the required wiring specifications, refer to ["Wiring specifications"](#) on page 08-3.

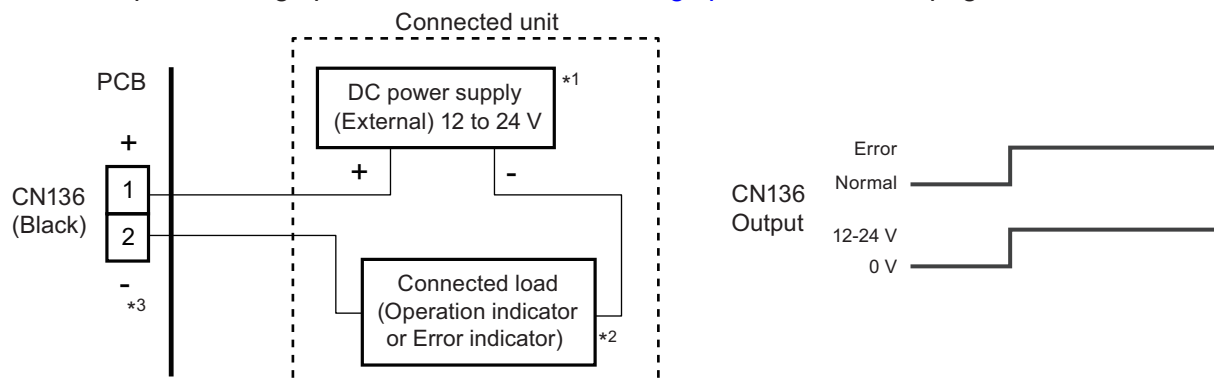


- \*1: Provide a DC 12 to 24 V power supply. Select a power supply capacity with an ample surplus for the connected load. Do not impress a voltage exceeding 24 V across pins 1 to 2.
- \*2: The allowable current is 30 mA or less. Provide a load resistance such that the current becomes 30 mA or less.
- \*3: Polarity is "+" for pin no. 1 and "-" for pin no. 2. Connect correctly.

### ■ Operation status (for Master unit only)

This output indicates Operation status of the outdoor unit.

As for the required wiring specifications, refer to ["Wiring specifications"](#) on page 08-3.

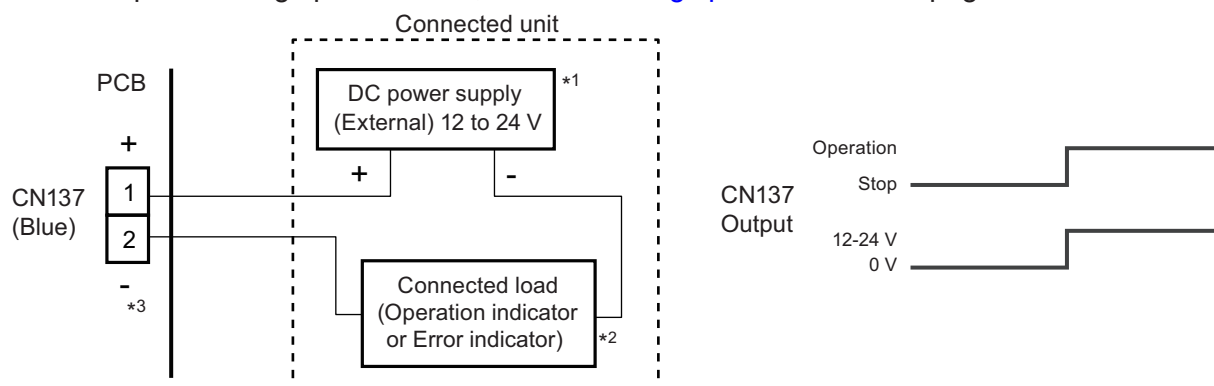


- \*1: Provide a DC 12 to 24 V power supply. Select a power supply capacity with an ample surplus for the connected load. Do not impress a voltage exceeding 24 V across pins 1 to 2.
- \*2: The allowable current is 30 mA or less. Provide a load resistance such that the current becomes 30 mA or less.
- \*3: Polarity is "+" for pin no. 1 and "-" for pin no. 2. Connect correctly.

## ■ Base heater

This is the output signal for base heater.




The output signal is on when the outdoor temperature goes down below 36°F (2°C), and signal is off at the outdoor temperature 39°F (4°C).

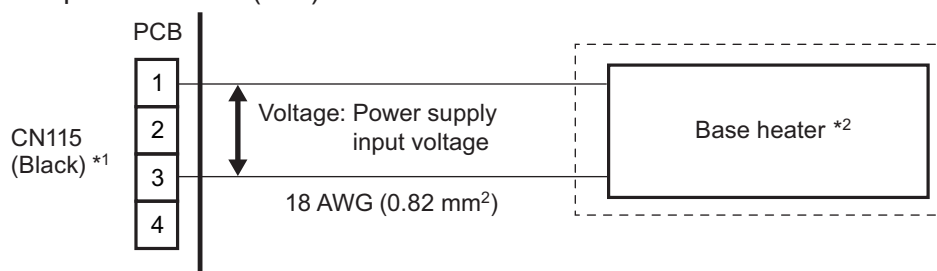

\*1: Connect to pin no.1 and pin no.3. No connection to pin no.2 and pin no.4.

\*2: The allowable current is 1 A or less.

## 2-5. Optional parts

External connect kit			
Model name	Exterior	Q'ty	Usage
UTY-XWZXZ6		1	For external input. (Low noise mode, Cooling/Heating priority, Outdoor unit operation peak control, Emergency/ Batch stop)
			For external output. (Error status, Operation status)
UTY-XWZXZ9		1	For external output. (Base heater)
UTY-XWZXZF		1	For external input. (Electricity meter pulse)

## 2-6. Function summary of outdoor unit external input/output

### Outdoor unit external input function

Dry contact/ Apply voltage		Dry contact DC 12 V				—
Function	Emergency stop	—	—	—	● (20-01)	—
	Low noise mode operation	● *1	—	—	—	—
	Cooling/Heating priority	—	●	—	—	—
	Outdoor unit operation peak control	—	—	● *2	—	—
	Batch stop	—	—	—	● (20-00)	—
	Power usage information from electricity meter	—	—	—	—	●
Specifications	Terminal	CN131 (Pin1-2)	CN132 (Pin1-2)	CN133 (Pin1-2)	CN134 (Pin1-2)	CN135 (Pin1-2)
	Signal type	Edge				Pulse

\*1: When using this function, select appropriate level from the following options:

- 42-00 Low noise level 1 (lower than rated value)
- 42-01 Low noise level 2 (lower than level 1)

\*2: When using this function, select appropriate level from the following options:

- 30-00 Energy saving level 1 (Stop)
- 30-01 Energy saving level 2 (Operated at 40% capacity)
- 30-02 Energy saving level 3 (Operated at 60% capacity)
- 30-03 Energy saving level 4 (Operated at 80% capacity)
- 30-03 Energy saving level 5 (Operated at 100% capacity)

#### NOTES:

- For selecting relay, minimum permissible load must be less than 1 mA.
- When using Apply voltage, take “+” polarity for Pin 1.
- Number inside bracket such as “(20-00)” in the table above indicates function number and setting number.
- ●: Equipping the function.

### Outdoor unit external output function

Dry contact/ Apply voltage			Apply voltage		Dry contact
Function	Operation status		—	●	—
	Error status		●	—	—
	Base heater		—	—	●
Specifications	Terminal		CN136 (Pin1-2)	CN137 (Pin1-2)	CN115 (Pin1-3)
	Terminal output voltage		—		AC 240 V
	External power supply	Allowable voltage	DC 12—24 V		—
		Allowable current	30 mA or less		1 A or less

#### NOTES:

- When using Apply voltage, take “+” polarity for Pin 1.
- ●: Equipping the function.

### 3. Indoor unit

External input and output functions and related components are as follows:

External input	External output	Input select	Connector	External connect kit (Optional parts)
Control input	—	Apply voltage	CNA01	UTY-XWZXZB
		Dry contact	CNA02	UTY-XWZXZD
Forced thermostat off	—	Apply voltage	CNA03	UTY-XWZXZ7
		Dry contact	CNA04	UTY-XWZXZE
—	Operation status	—	CNB01	UTY-XWZXZC
—	Error status			
—	Indoor unit status			
—	Auxiliary heater output			

#### RELATED LINKS

["External input"](#) on page 08-9

["External output"](#) on page 08-23

["Optional parts"](#) on page 08-26

["Function summary of indoor unit external input and output"](#) on page 08-27



## 3-1. External input


- Operation/Stop, Emergency stop, or Forced stop of the indoor unit can be set by using CNA01 or CNA02 on the indoor unit PCB.
- Start/Stop mode, Emergency stop mode, or Forced stop mode can be selected with function setting of the indoor unit.
- Forced thermostat off of the indoor unit can be set by using CNA03 or CNA04 on the indoor unit PCB.
- A twisted pair cable 22 AWG (0.33 mm<sup>2</sup>) should be used. Maximum length of cable is 492 ft (150 m).
- Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.
- When connecting the external input wire, do not route the wire closely to the power cable line.

### Input select

Use either one of Apply voltage terminal of Dry contact terminal according to the application. (Both types of terminals cannot be used simultaneously.)


#### • CNA01, CNA03: Apply voltage terminal

When a power supply must be provided at the input device you want to connect, use the Apply voltage terminal (CNA01, CNA03).

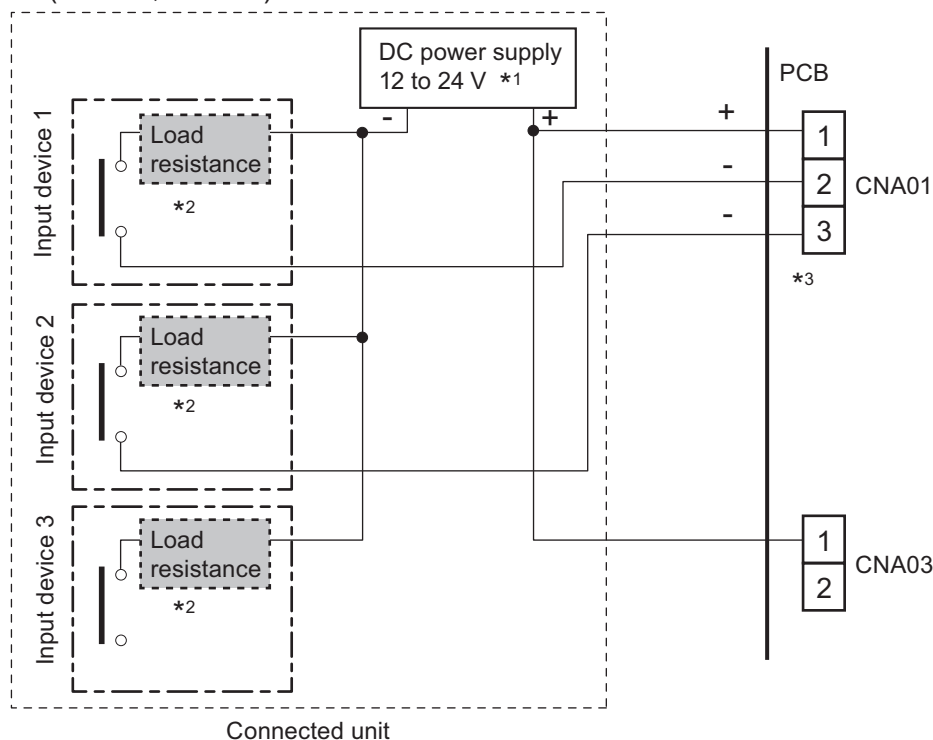


- \*1: Make the power supply DC12 to 24 V. Select a power supply capacity with an ample surplus for the connected load. Do not impress a voltage exceeding 24 V across pins 1-2, and 1-3.
- \*2: The allowable current is DC 5 mA to 10 mA. (Recommended: DC 5 mA)  
Select very low current use contacts (usable at DC 12 V, DC 1 mA or less).
- \*3: The polarity is “+” for pin 1, and “-” for pin 2 and 3. Connect correctly.

When connecting to Apply voltage terminals of multiple indoor units, be sure to make a branch outside the indoor unit using a pull box, etc. as shown in example below.

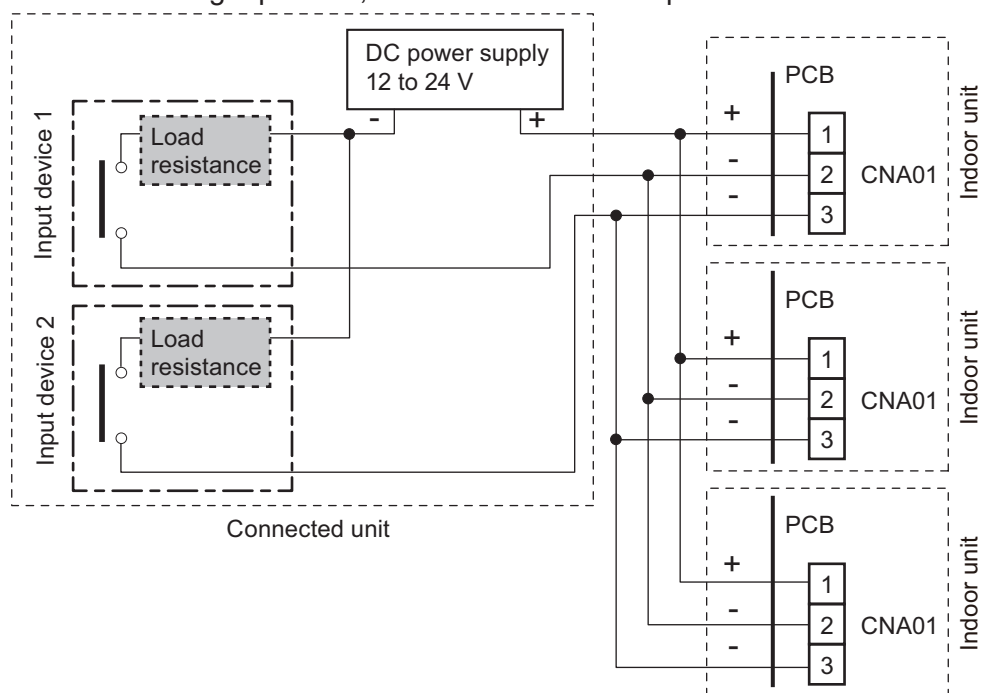

- **CNA02, CNA04: Dry contact terminal**


When a power supply is unnecessary at the input device you want to connect, use the Dry contact terminal (CNA02, CNA04).

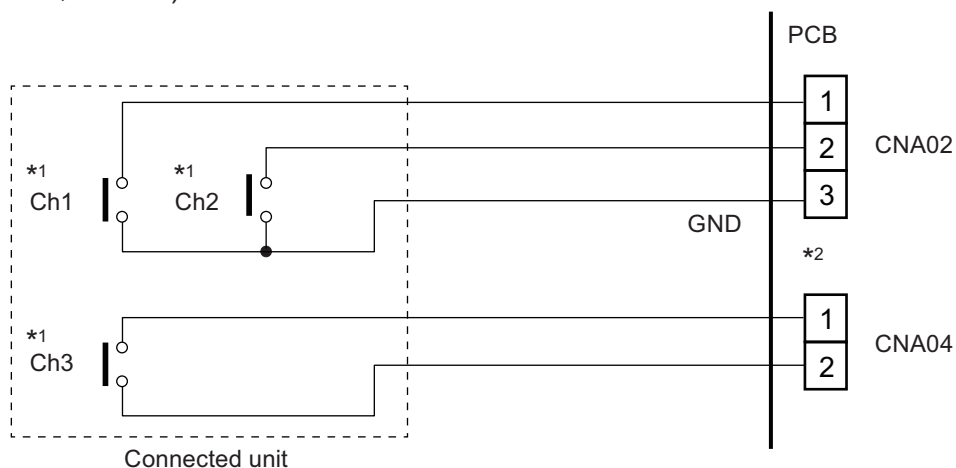

\*1: Select very low current use contacts (usable at DC 12 V, DC 1 mA or less).

\*2: The wiring is different from Apply voltage terminals. Be sufficiently careful when wiring.

When connecting to Dry contact terminals of multiple indoor units, insulate each indoor unit with relay, etc. as shown in example below.

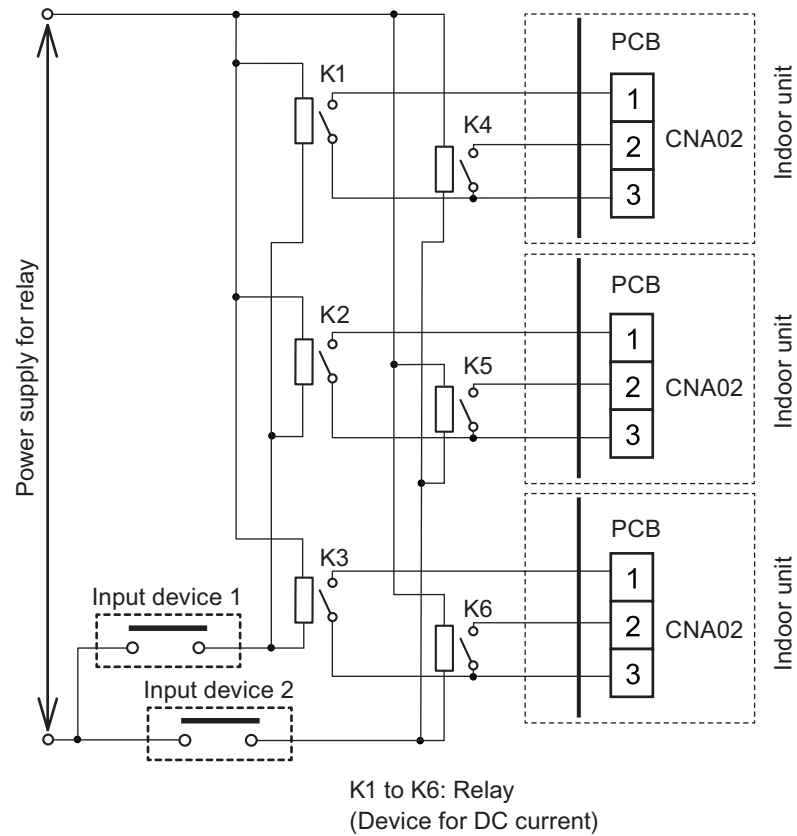

### **⚠ CAUTION**

Do not connect to multiple indoor units directly since it will cause breakdown.

## ■ Input signal type

The input signal type can be selected by switching the DIP switch on the indoor unit PCB.

- **DIP switch SET2-2: Edge or Pulse selection of external input**

SET2-2	External input select	Factory setting
Off	Edge	◆
On	Pulse	



**NOTE:** Input signal type of Ch3 (Forced thermostat off) is only Edge.

## ■ Control input function


### NOTES:

- The latest command has priority.
- The indoor units within the same remote controller group are operated in the same mode.

- When function setting is Operation/Stop mode


- In case of Edge input:

Function setting	DIP switch	Connector	Channel no.	Input signal	Command
46-00	SET2-2: Off (Factory setting)	CNA01 or CNA02 (EXT. IN1)	Ch1	Off → On	Operation
				On → Off	Stop

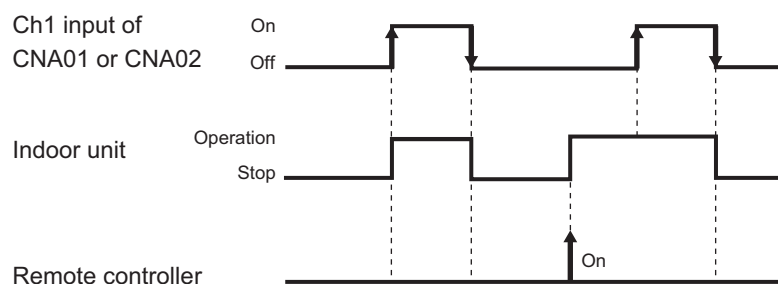

- In case of Pulse input:

Function setting	DIP switch	Connector	Channel no.	Input signal	Command
46-00	SET2-2: On	CNA01 or CNA02 (EXT. IN1)	Ch1	Off → On	Operation
			Ch2	Off → On	Stop

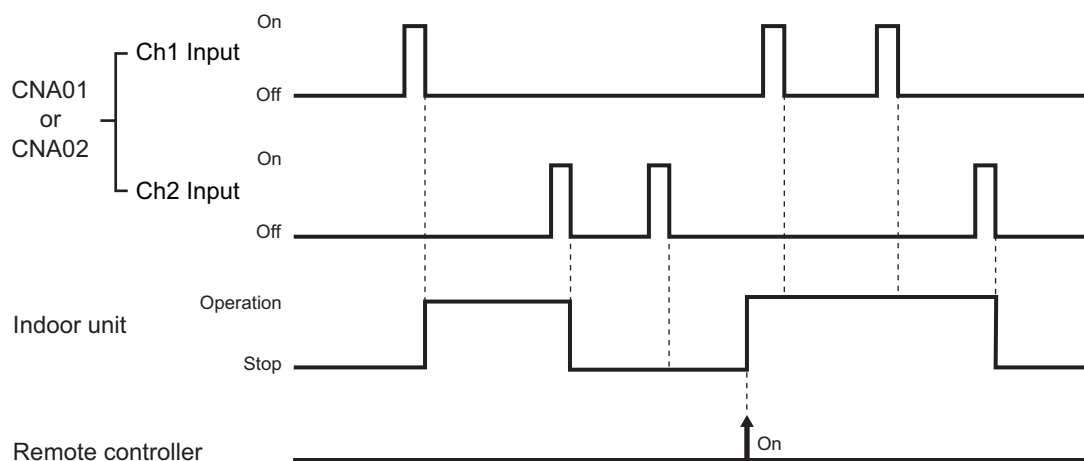


• When function setting is Emergency stop mode

**NOTE:** All the indoor units in the same refrigerant system stop when Emergency stop is operated.


– In case of Edge input:

Function setting	DIP switch	Connector	Channel no.	Input signal	Command
46-01	SET2-2: Off (Factory setting)	CNA01 or CNA02 (EXT. IN1)	Ch1	Off → On	Emergency stop
				On → Off	Normal

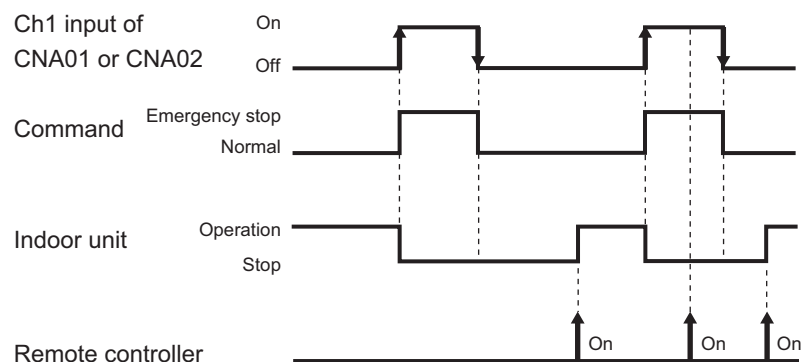

– In case of Pulse input:

Function setting	DIP switch	Connector	Channel no.	Input signal	Command
46-01	SET2-2: On	CNA01 or CNA02 (EXT. IN1)	Ch1	Off → On	Emergency stop
			Ch2	Off → On	Normal

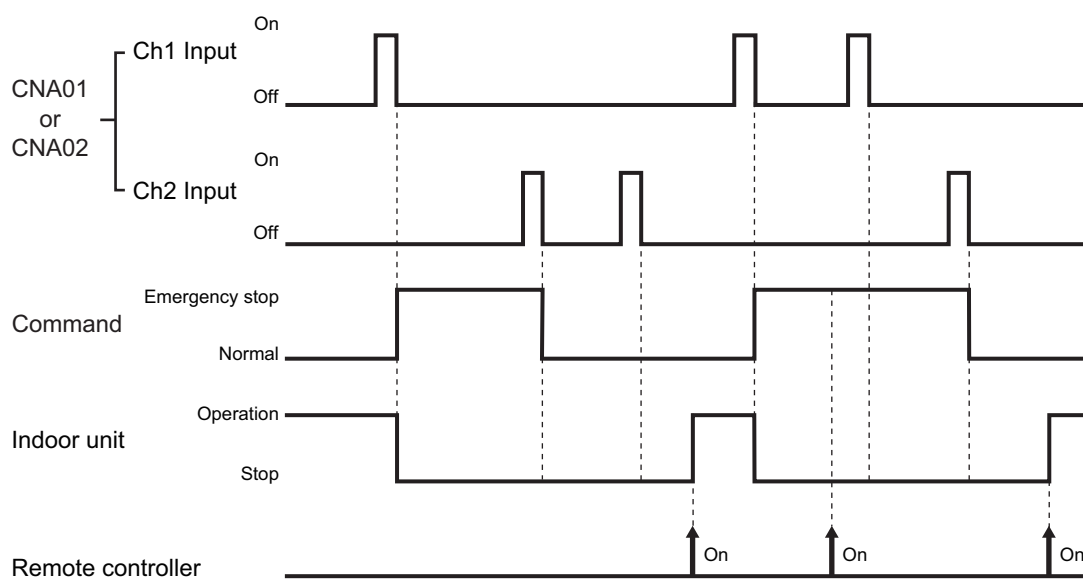


• When function setting is Forced stop mode

**NOTE:** If it enters the Forced stop mode once, the indoor unit stops and Operation/Stop operation by a remote controller will be restricted.


– In case of Edge input:

Function setting	DIP switch	Connector	Channel no.	Input signal	Command
46-02	SET2-2: Off (Factory setting)	CNA01 or CNA02 (EXT. IN1)	Ch1	Off → On	Forced stop
				On → Off	Normal

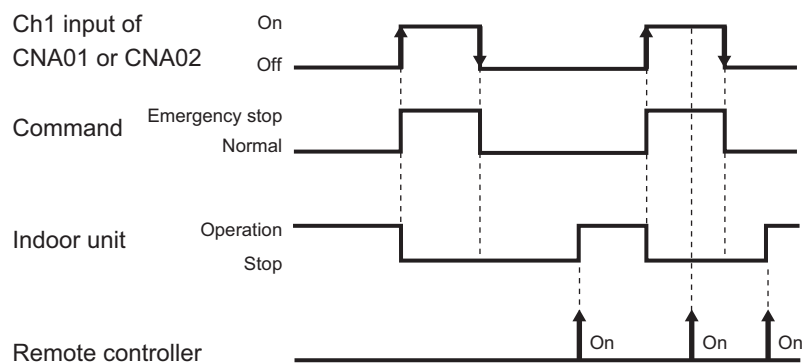

– In case of Pulse input:

Function setting	DIP switch	Connector	Channel no.	Input signal	Command
46-02	SET2-2: On	CNA01 or CNA02 (EXT. IN1)	Ch1	Off → On	Forced stop
			Ch2	Off → On	Normal


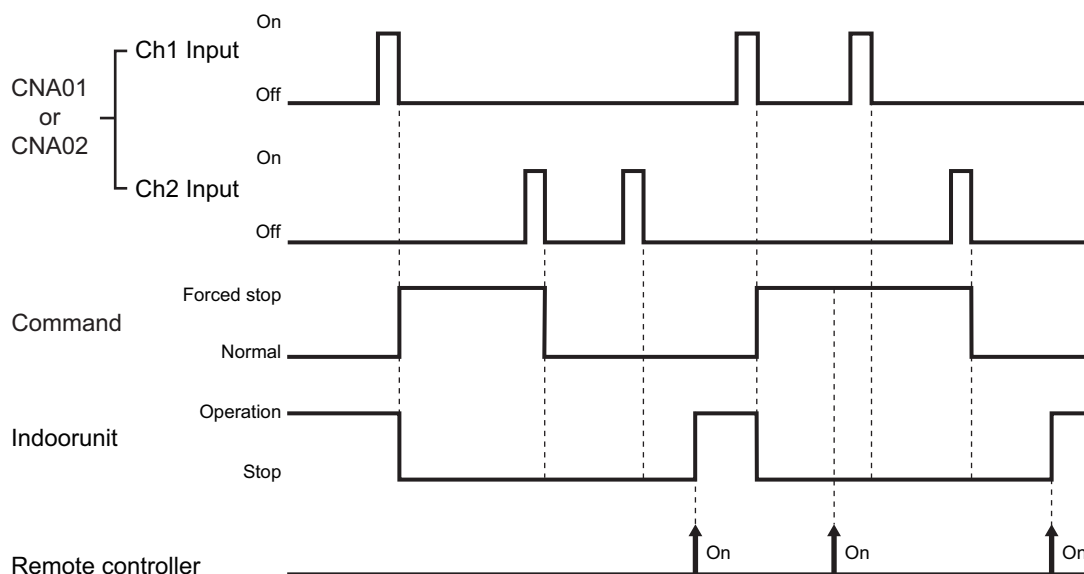


- **Considerations when setting Forced stop**

### ⚠ CAUTION

When Forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

**Connection example:**

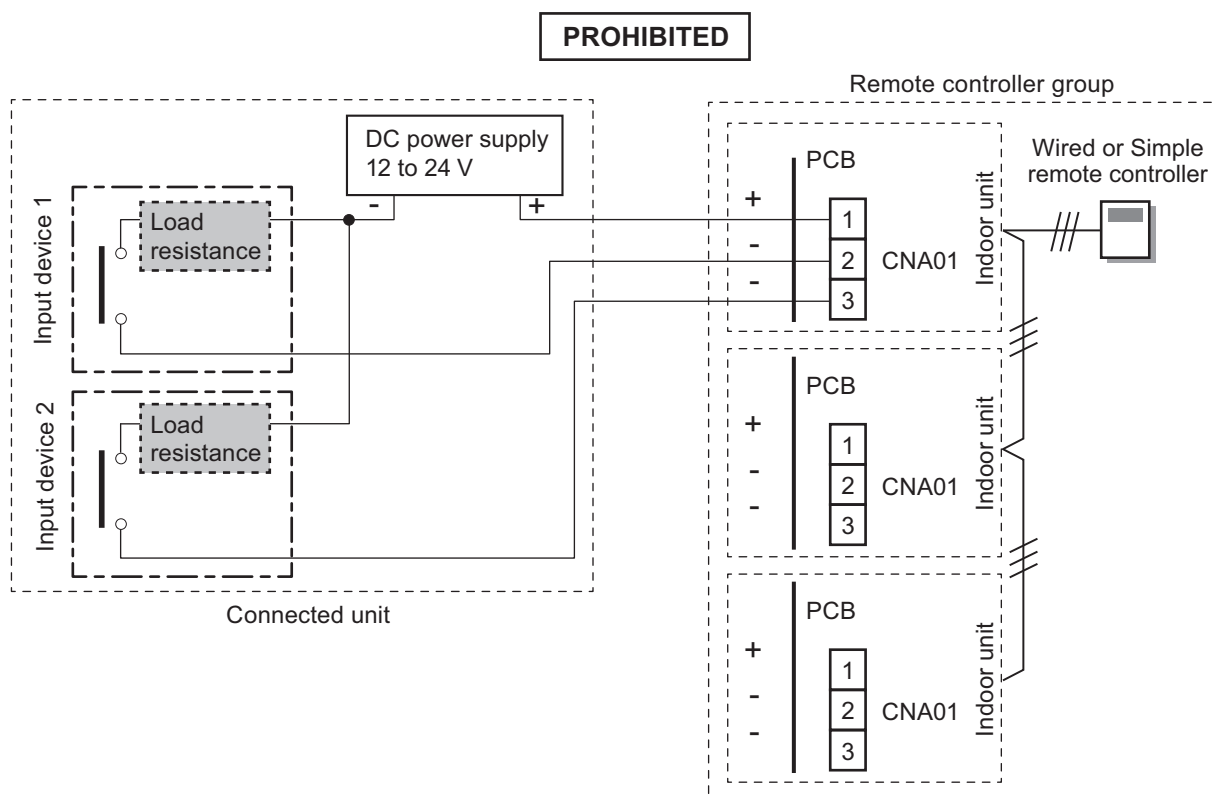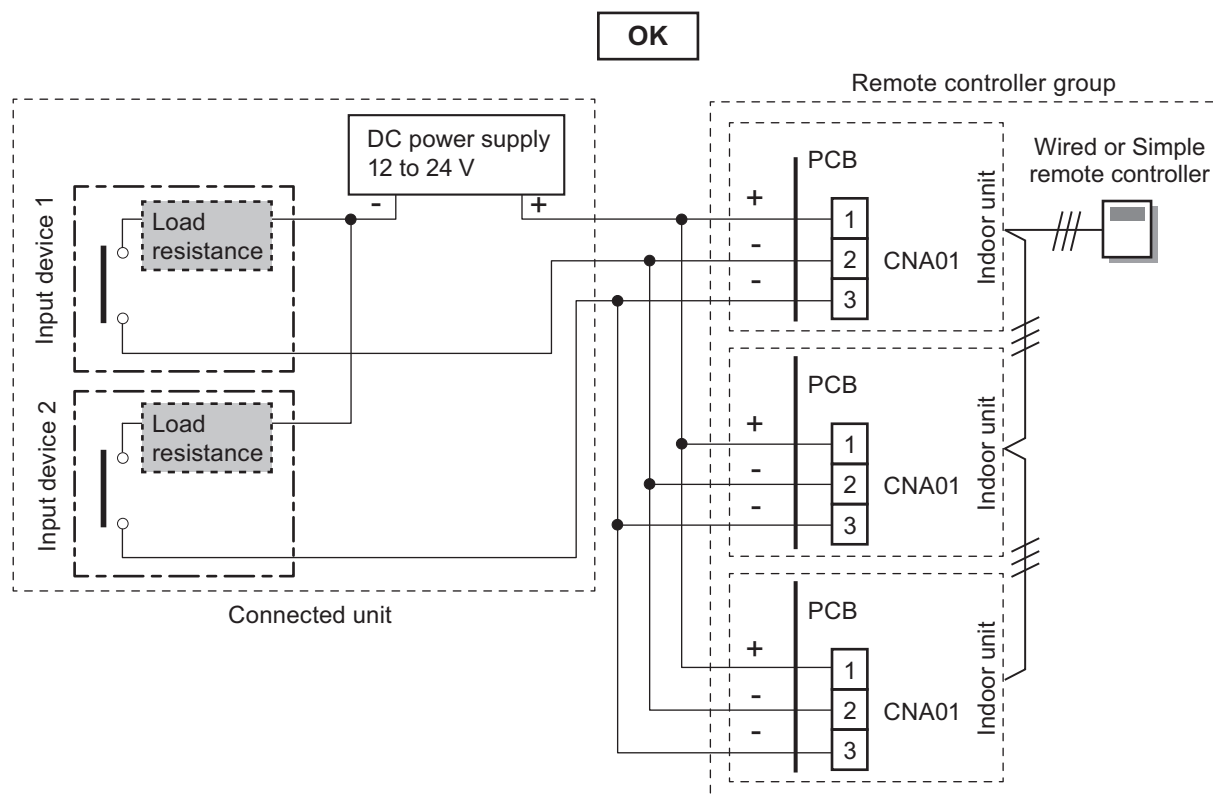




## ■ Forced thermostat off function

**NOTE:** When the signal is received from another unit on the refrigerant circuit, there may be a delay in thermostat off function at the unit.

- Edge input only

Function setting	Connector	Channel no.	Input signal	Command
60-00 60-02 60-05 60-06 60-07	CNA03 or CNA04 (EXT. IN2)	Ch3	Off → On	Thermostat off
			On → Off	Normal


**Example of cooling mode:**

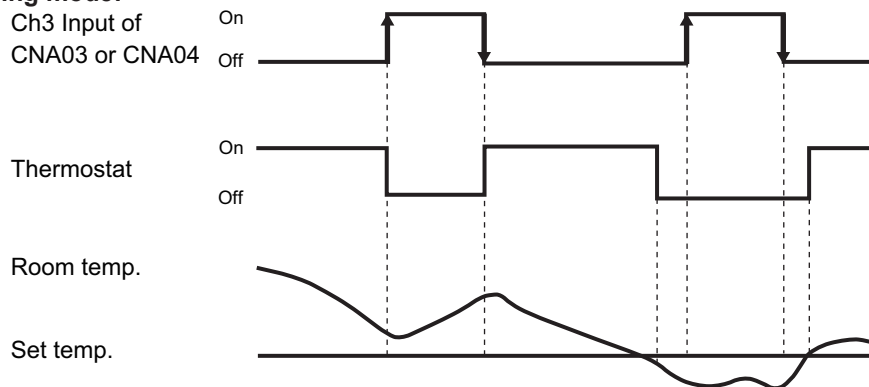


## ● Forced thermostat off examples

- **Example 1:**
  - In-line connection
  - **Function setting for Fan setting when cooling thermostat off**  
Number 49-00 (Follow the setting on the remote controller)


Forced thermostat off is one of the energy-saving functions. For example, when the outdoor temperature is lower than the indoor temperature, indoor unit of air conditioner perform Fan operation based on the received signal from external controller. (Cooling only)

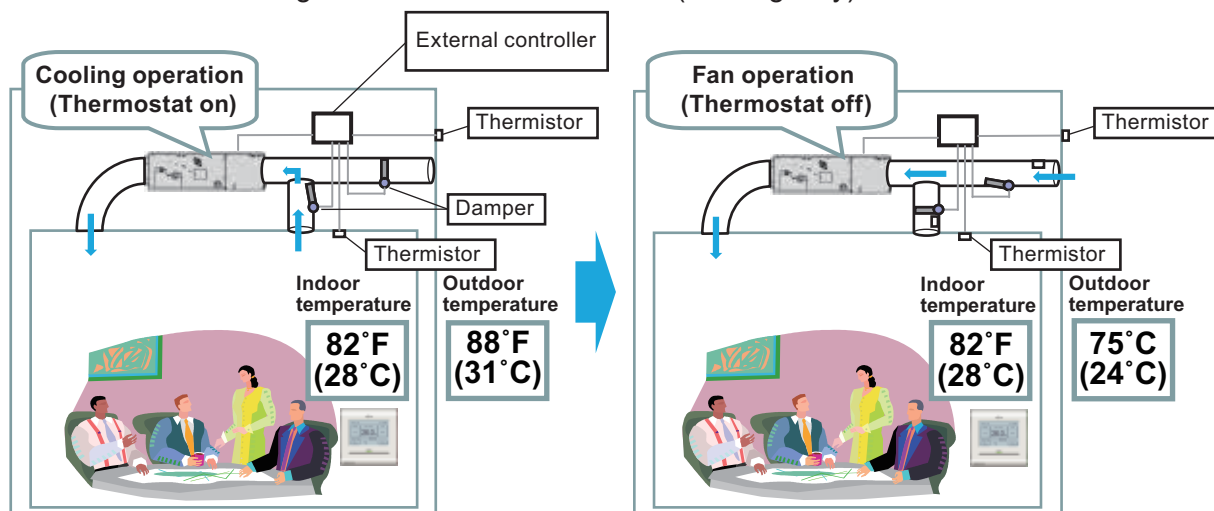

## [System diagram example]

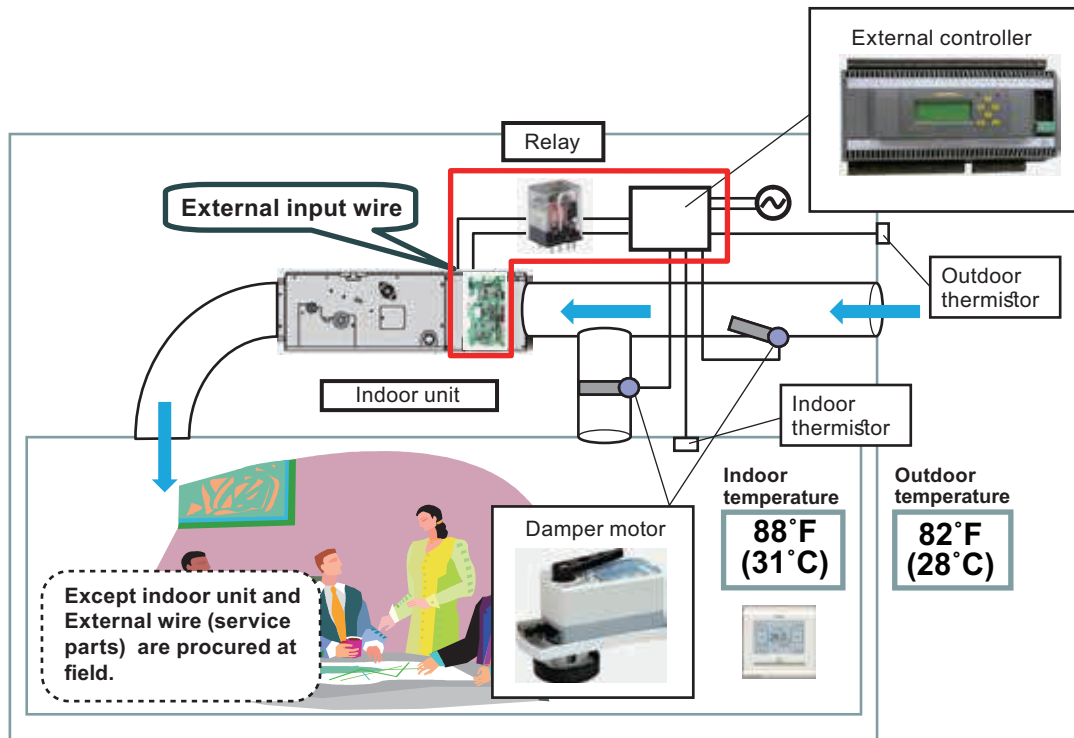


## [Operation status]

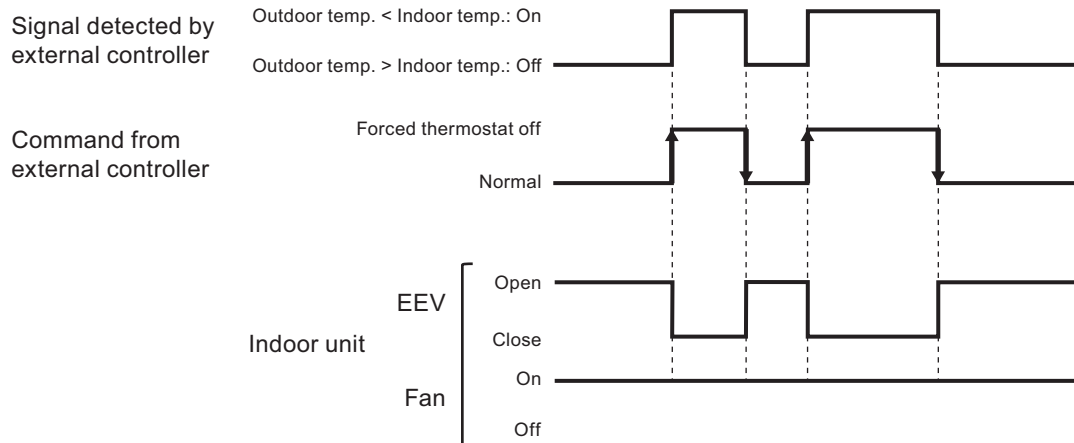


Normal means that the indoor unit continues appropriate operation until Forced thermostat off signal is received, at condition which are set by central and individual controller or detected by thermo sensors of the indoor unit.

### [Function setting of indoor unit]

Indoor unit continues appropriate operation until Forced thermostat off signal is received, at condition which are set by central and individual controller or detected by thermo sensors of the indoor unit. Once the Forced thermostat off signal is received, the indoor unit start operation under fan mode.

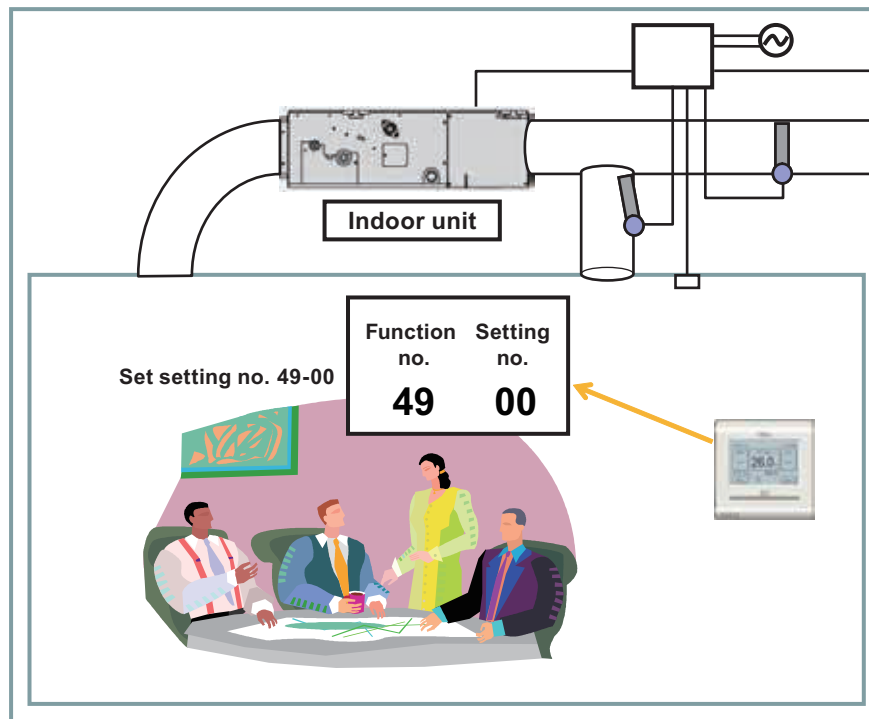

### [Example of electrical circuit]

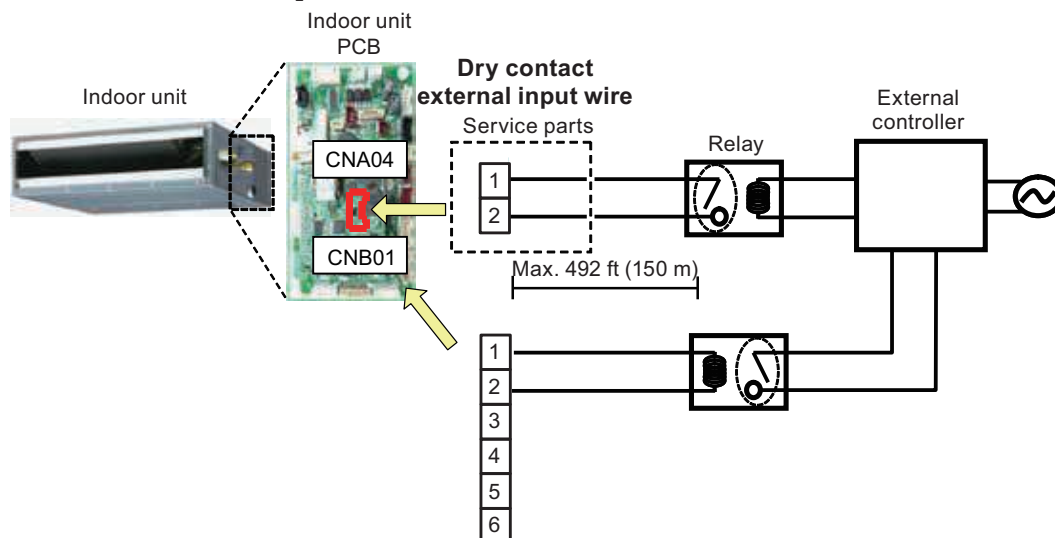


Specification of external input	Item	Specification
	Terminal	CNA04
	Output voltage	DC 12 V
	Wire diameter	22 AWG (0.33 mm <sup>2</sup> ), Twisted
	Service part no.	9368778019


Requirement for relay switch	Item	Specification
	Minimum permissible load	1 mA or less


- **Example 2:**
  - **Individual connection**
  - **Function setting for Fan setting when cooling thermostat off**  
**Number 49-01 (Stop)**

Forced thermostat off is one of the energy-saving functions. For example, when using ventilator at condition of the outdoor temperature is lower than the indoor temperature, indoor unit of air conditioner stops based on the received signal from external controller. (Cooling only)

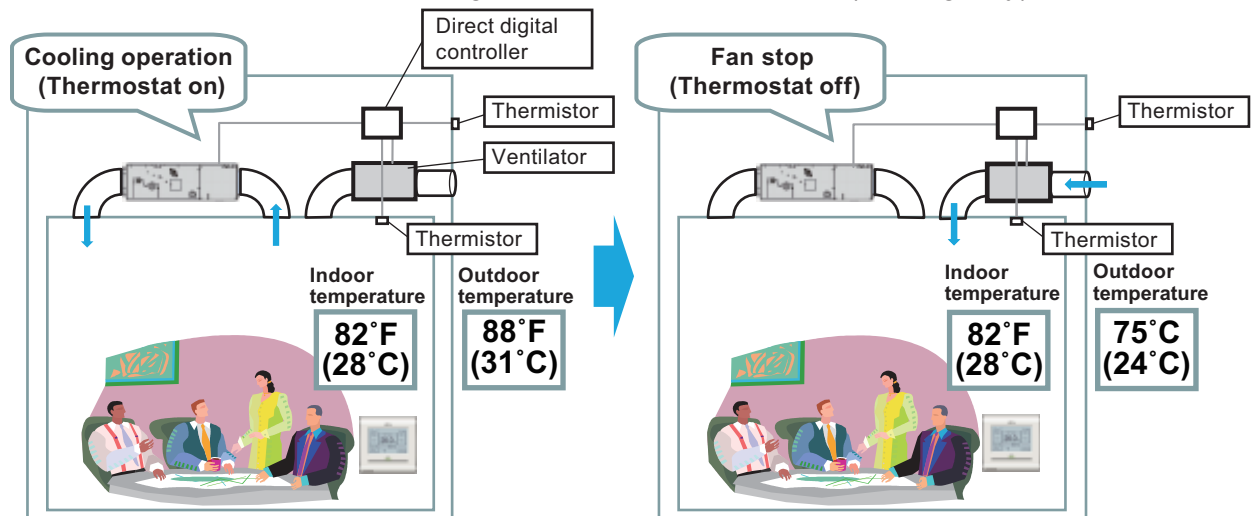

[System diagram example]

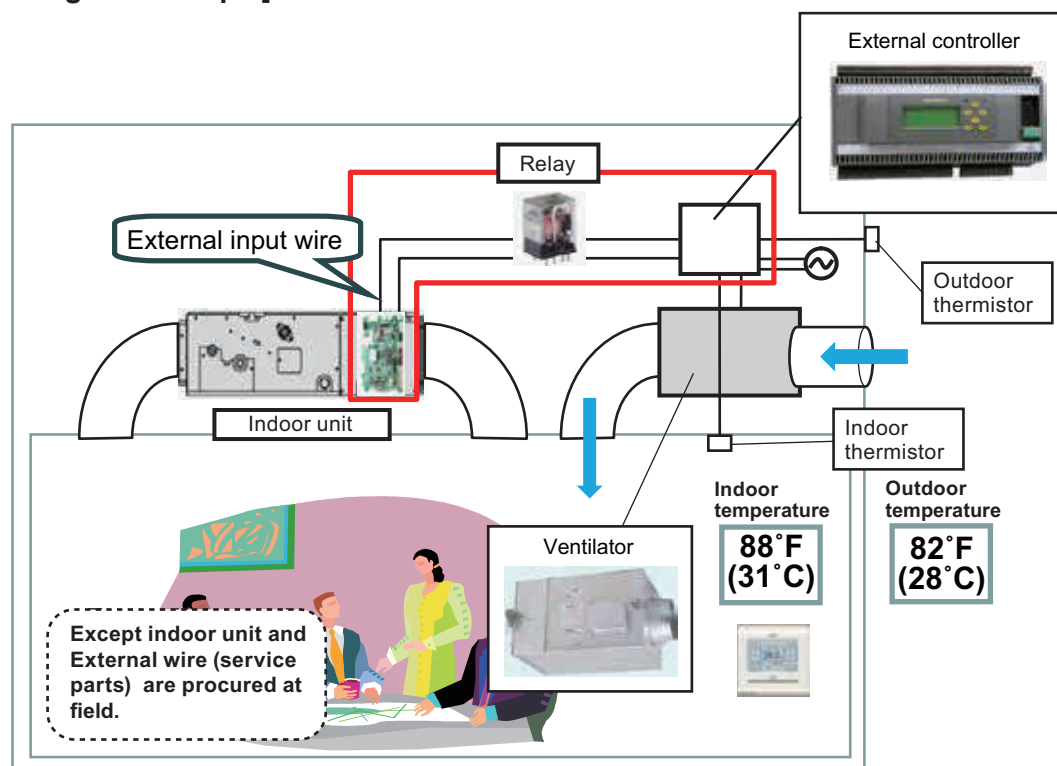


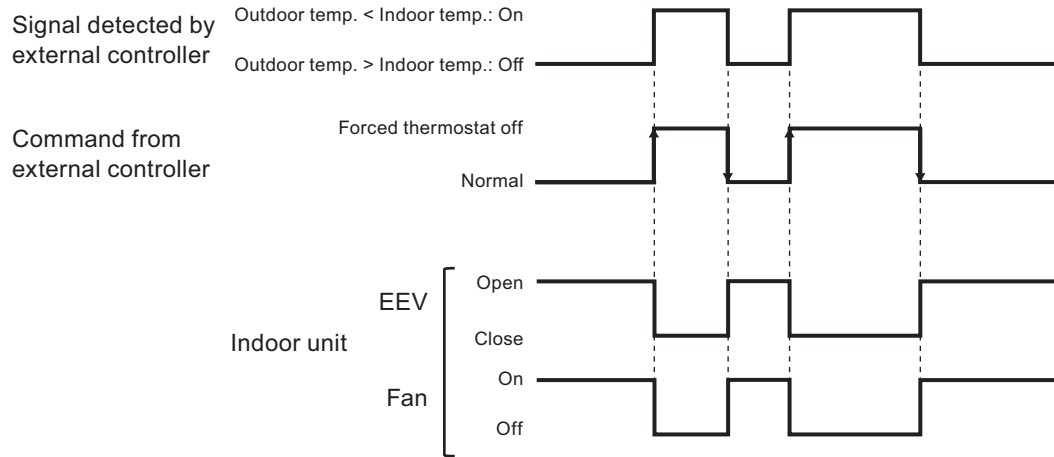
**[Operation status]**

Normal means that the indoor unit continues appropriate operation until Forced thermostat off signal is received, at condition which are set by central and individual controller or detected by thermo sensors of the indoor unit.

**[Function setting of indoor unit]**

Indoor unit continues appropriate operation until Forced thermostat off signal is received, at condition which are set by central and individual controller or detected by thermo sensors of the indoor unit. Once the Forced thermostat off signal is received, the indoor unit stops operation.

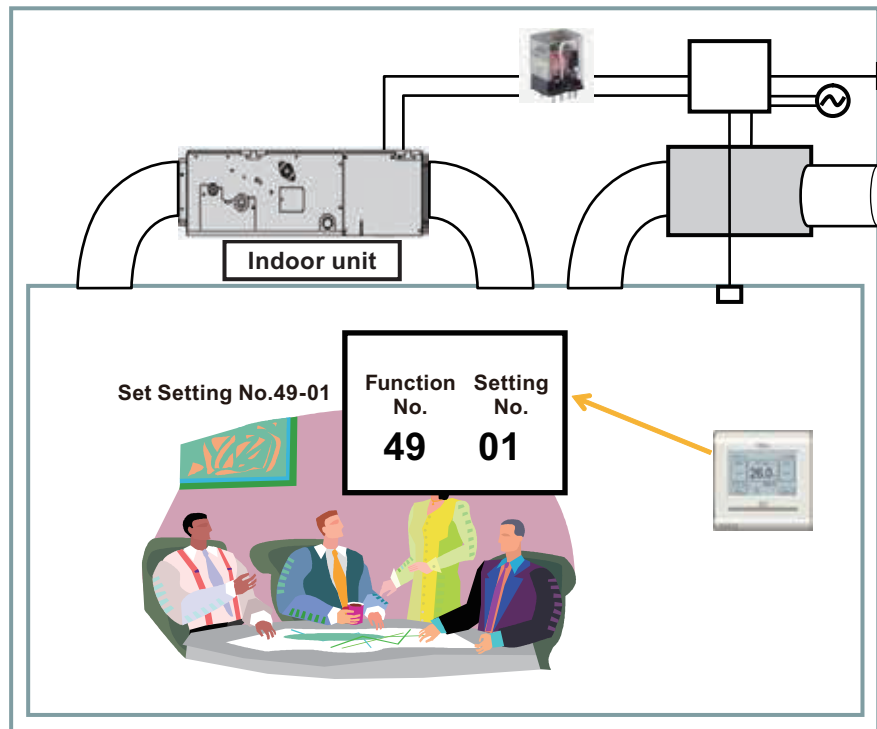

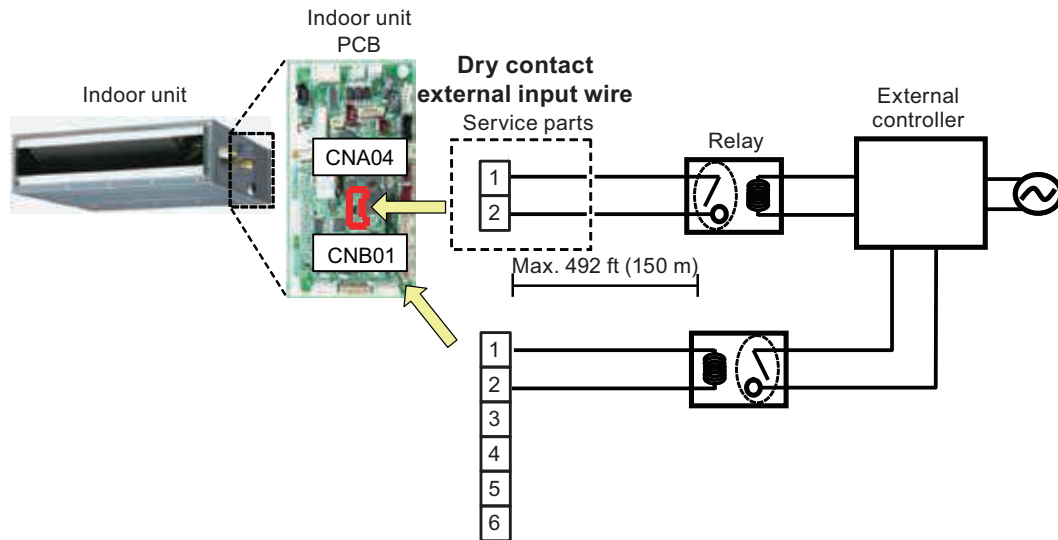**[Example of electrical circuit]**

Specification of external input	Item	Specification
	Terminal	CNA04
	Output voltage	DC 12 V
	Wire diameter	22 AWG (0.33 mm <sup>2</sup> ), Twisted
	Service part no.	9368778019


Requirement for relay switch	Item	Specification
	Minimum permissible load	1 mA or less

## 3-2. External output

- A twisted pair cable 22 AWG (0.33 mm<sup>2</sup>) should be used. Maximum length of cable is 82 ft (25 m).
- Use an external input and output cable with appropriate external dimension, depending on the number of cables to be installed.
- Output voltage: DC 12 V at HIGH, 0 V at LOW
- Permissible current: 50 mA


### ■ Output select

- When indicator etc. are connected directly

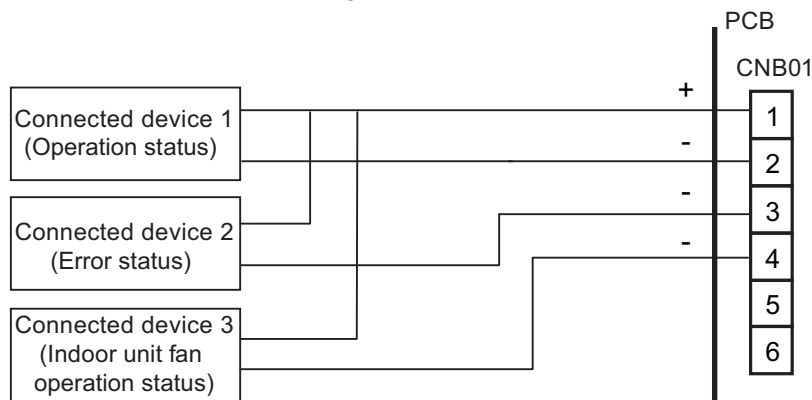

Actual number of pin might be different from the figure above.

- When connecting to unit equipped with a power supply

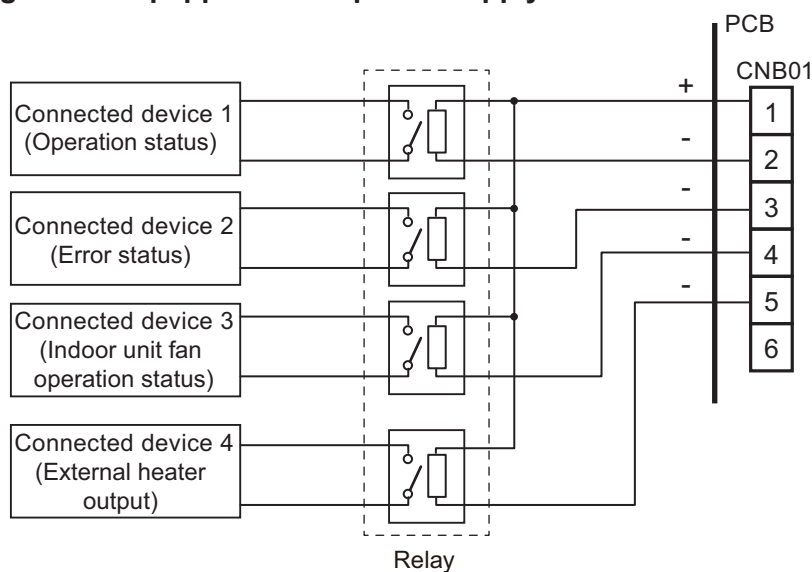


Actual number of pin might be different from the figure above.

## ■ Operation status (External output 1)

Function setting	Connector	Output signal	Command
60-00	CNB01 (Pins 1-2)	0 V → 12 V	Operation
60-06		12 V → 0 V	Stop

The output for CNB01 (1-2) is on when the indoor unit is operating.  
The output is off when the unit is stopped.

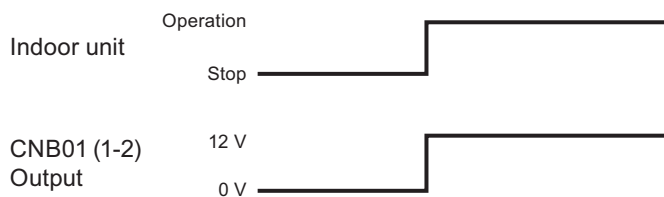

## ■ Error status (External output 2)

Function setting	Connector	Output signal	Command
60-00 60-01 60-02 60-04 60-05 60-06 60-07	CNB01 (Pins 1-3)	0 V → 12 V	Error
		12 V → 0 V	Normal


The output for CNB01 (1-3) is on when an error is generated for the indoor unit.



## ■ Indoor unit fan operation status (External output 3)

Function setting	Connector	Output signal	Command
60-00 60-01 60-05 60-06	CNB01 (Pins 1-4)	0 V → 12 V	Fan run
		12 V → 0 V	Fan stop

The output for CNB01 (1-4) is on when the indoor unit fan is operating.  
The output is off when the fan is stopped or during cold air prevention.  
The output for CNB01 (1-4) is off during thermostat off when DRY mode operation.

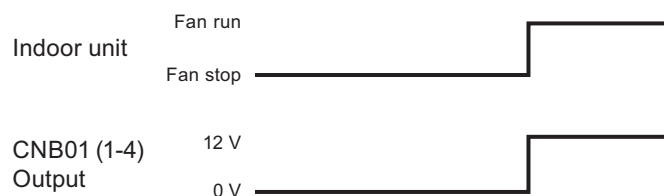

Ex.: Used for interlock energize for exhaust fan

## ■ Auxiliary heater output (External output 4)

When indoor unit fan and compressor is turned on in heating operation, the signal is output from connector.


**NOTE:** Corresponding indoor units: All duct type



Specifications of the signal output performance are as shown as follows:

**Example:** When set temperature ( $T_s$ ) is set at 72 °F (22 °C);


- And room temperature ( $T_r$ ) increase above 52 °F (12 °C), signal output is on.
- And  $T_r$  increase above 70 °F (21 °C), signal output is off.
- And  $T_r$  decrease below 66 °F (19 °C), signal output is on.
- And  $T_r$  decrease below 48 °F (10 °C), signal output is off.

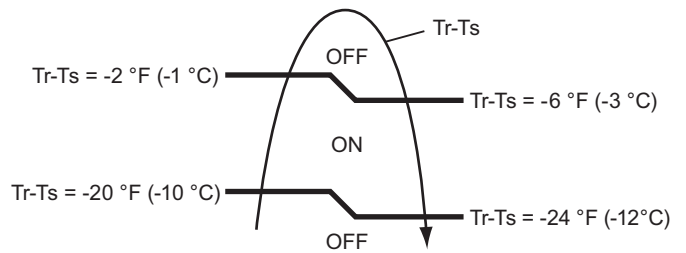

The output also turns off on defrost operation and oil recovery operation.


- **Fan delay switch (Indoor unit)**

This is used to continue the indoor unit fan operation for 1 minute after thermo off in heating mode. 1 minute delay control setting by DIP switch (2-3) on the PCB is "On".

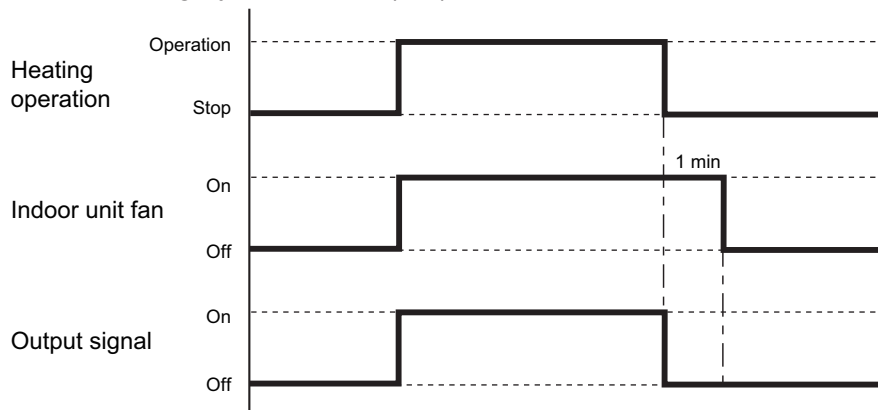

### ⚠ CAUTION

- Install an auxiliary heater between the indoor unit and the outlet.



- Be sure to use delay control of the fan.
- To avoid a fire caused by self heat of the auxiliary, design and install the auxiliary properly with considering protection by auxiliary itself.  
Our company is not responsible for the system designed including auxiliary with improper installation.

## 3-3. Optional parts

External connect kit			
Model name	Exterior	Q'ty	Usage
UTY-XWZXZ7		1	For forced thermostat off port. (Apply voltage terminal)
UTY-XWZXZC		1	For output port.
UTY-XWZXZB		1	For control input port. (Apply voltage terminal)
UTY-XWZXZD		1	For control input port. (Dry contact terminal)
UTY-XWZXZE		1	For forced thermostat off port. (Dry contact terminal)

## 3-4. Function summary of indoor unit external input and output

### ■ Indoor unit external input function

Dry contact/ Apply voltage			Dry contact DC 12 V			Apply voltage			
Function	Operation/Stop		<div>●</div> <div>(46-00)</div>		—	<div>●</div> <div>(46-00)</div>		—	
	Emergency stop		<div>●</div> <div>(46-01)</div>		—	<div>●</div> <div>(46-01)</div>		—	
	Forced stop		<div>●</div> <div>(46-02)</div>		—	<div>●</div> <div>(46-02)</div>		—	
	Forced thermostat off		—		<div>●</div> <div>(60-00)</div>	—		<div>●</div> <div>(60-00)</div>	
Specifications	Terminal		CNA02 (Pin1-3)	CNA02 (Ch1: Pin1-3) (Ch2: Pin2-3)	CNA04 (Pin1-2)	CNA01 (Pin1-2)	CNA01 (Ch1: Pin1-2) (Ch2: Pin1-3)	CNA03 (Pin1-2)	
	Signal type		Edge	Pulse *	Edge	Edge	Pulse *	Edge	
	External power supply	Allowable voltage	—			DC 12 to 24 V			
		Allowable current	—			10 mA or less			
	Wire size			22 AWG (0.33 mm <sup>2</sup> ), Twisted					
	Max. cable length			492 ft (150 m)					

\*: Default setting is Edge signal. If you use Pulse signal, DIP switch 2-2 must be set to “On”.

### ■ Indoor unit external output function

Dry contact/ Apply voltage			Dry contact			
Function	Operation status		●	—	—	—
	Error status		—	●	—	—
	Indoor unit fan operation status		—	—	●	—
	Auxiliary heater output		—	—	—	● *
Specifications	Terminal		CNB01 (Pin1-2)	CNB01 (Pin1-3)	CNB01 (Pin1-4)	CNB01 (Pin1-5)
	Terminal output voltage		DC 12 V			
	Wire size		22 AWG (0.33 mm <sup>2</sup> ), Twisted			
	Max. cable length		82 ft (25 m)			

\*: Auxiliary heater is only available for duct type indoor unit. If you use Auxiliary heater output, DIP switch 2-3 must be set to “On”.

## 4. Controller

### RELATED LINKS

["Touch panel controller"](#) on page 08-28

["Central remote controller \(UTY-DCGYZ\\*\)"](#) on page 08-34

["Function summary of controller external input/output"](#) on page 08-40

### 4-1. Touch panel controller

External input and output functions and related components are as follows:

External input	External output	Connector	External connect kit (Optional parts)
Control input	—	TM201 (CN411 or CN412)	—
Electricity meter	—		—
—	Operation status	CN410	UTY-XWZXZA
—	Error status		

### RELATED LINKS

["External input"](#) on page 08-28

["External output"](#) on page 08-33

["Optional parts"](#) on page 08-33

["Function summary of controller external input/output"](#) on page 08-40

### ■ External input

This function performs "Emergency stop" or "All On / All Off" by using the signal to be input externally at external input terminals.

#### ● Input select

Use either one of Apply voltage terminal or Dry contact terminal according to the application. (Both types of terminals cannot be used simultaneously.) For more details, refer to the operation manual of Touch panel controller.

It is possible to switch to the Dry contact terminal or the Apply voltage terminal by connecting CN201 of TM201 on the PCB to CN411 or CN412 on the PCB of the panel side.


\* The Dry contact terminal (connected to the CN411) is set at the time of factory shipment.

TM201 - K1, K2	Connect with the CN201
Dry contact terminal	CN411
Apply voltage terminal	CN412

- **TM201 (CN411): Dry contact terminal**

When a power supply is unnecessary at the input device you want to connect, use the Dry contact terminal TM201 (CN411).

**Connection example 1: When the switch is connected**

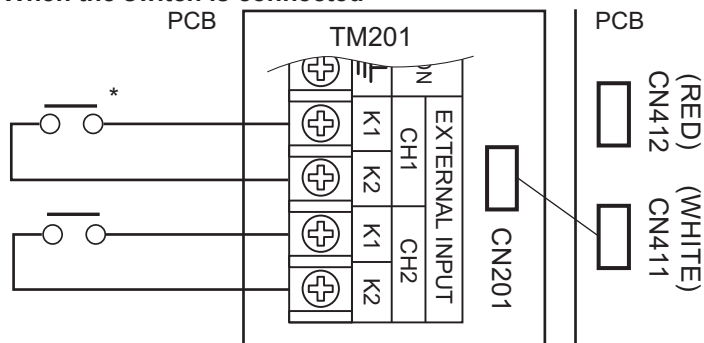


\*: Short circuit detection resistance ( $R_{ON}$ ):  $\leq 500 \Omega$

Open circuit detection resistance ( $R_{OFF}$ ):  $\geq 100 \text{ k}\Omega$

A twisted pair cable 22 AWG ( $0.33 \text{ mm}^2$ ) should be used. (Maximum cable length: 82 ft [25 m])

**Connection example 2: When the electricity meter is connected**

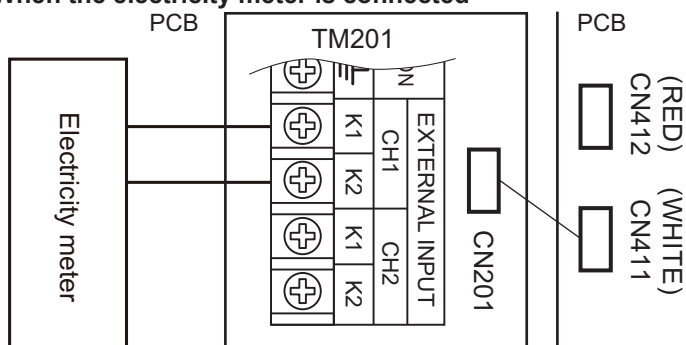


Connect the electricity meter to CH1. In this case, the use of CH2 is prohibited.


- **TM201 (CN412): Apply voltage terminal**

When a power supply must be provided at the input device you want to connect, use the Apply voltage terminal TM201 (CN412).

**Connection example1: When the switch is connected**

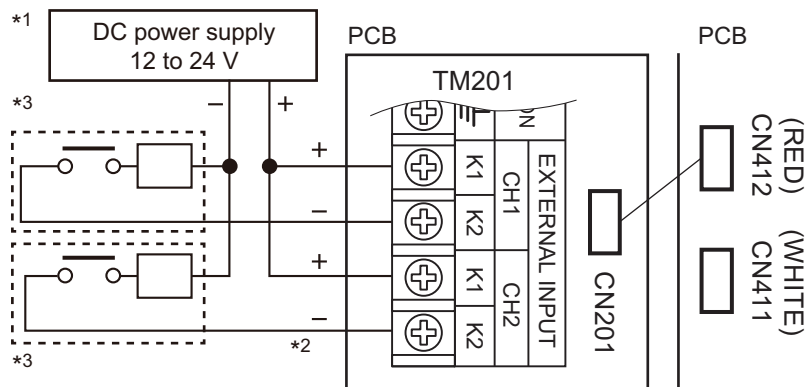

**Connection example2: When the electricity meter is connected**

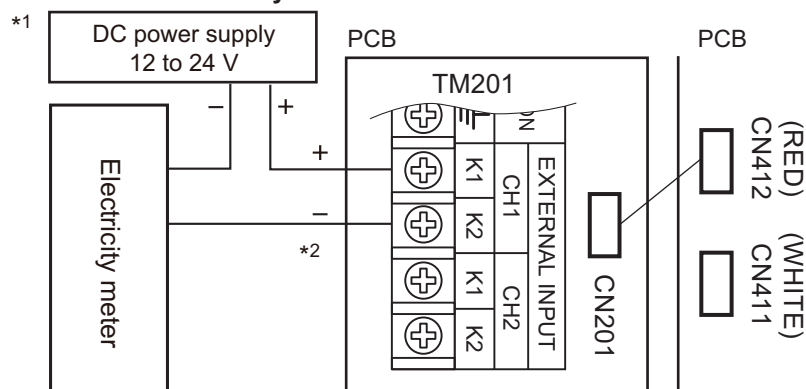

- \*1: Make the power supply DC12 to 24 V. Select a power supply capacity with an ample surplus for the connected load.
- \*2: Do not impress a voltage exceeding 24 V across K1-K2.
- \*3: The allowable current is DC 10 mA or less. (Recommended: DC 5 mA)  
Provide a load resistance such that the current becomes DC10 mA or less.  
Select very low current use contacts (usable at DC 12 V, DC 1 mA or less).  
A twisted pair cable 22 AWG (0.33 mm<sup>2</sup>) should be used. (Maximum cable length: 82 ft [25 m])

## ● Selecting the function





The function of the external input terminals is disabled at the time of factory shipment. Select the function to be used by installer setting of application.

Turn on the power and select by installer setting after starting the application.

Emergency stop	Edge/Pulse
All on/All off	
Electricity meter	Pulse

## ● Input signal type

The input signal type can be selected.


Edge	H L		Emergency stop or All on	Ch1
	H L		Emergency stop reset or All off	
Pulse	H L		Emergency stop or All on	Ch1
	H L		Emergency stop reset or All off	Ch2
	H L		Electricity meter signal	Ch1

When Edge is selected, only Ch1 can be used.

## ● Control input function


- In case of Edge input:

Terminal	Channel no.	Input signal	Command
TM201	Ch1	Off → On	All on / Emergency stop
		On → Off	All off / Normal

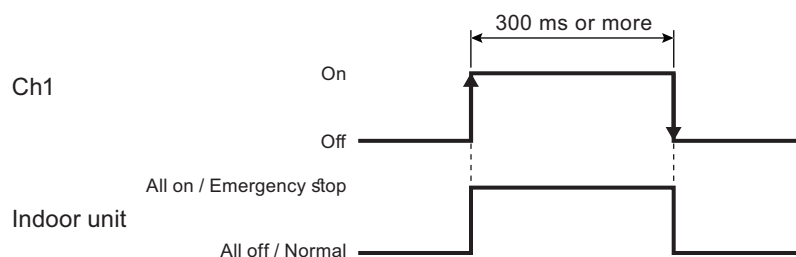

- In case of Pulse input:


Terminal	Channel no.	Input signal	Command
TM201	Ch1	Pulse	All on / Emergency stop
	Ch2		All off / Normal

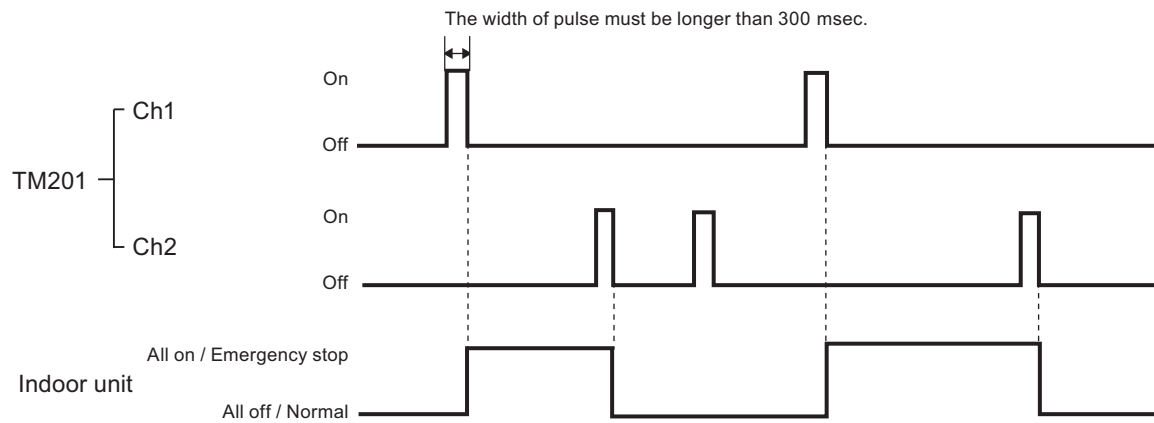



## External output


Connector		Output voltage	Status
CN410 (Black)	Ch1	0 V	All indoor units: Stop
	Pins 1-2	DC 12 V	One or more indoor units: Operation
	Ch2	0 V	Normal
	Pins 3-4	DC 12 V	Error

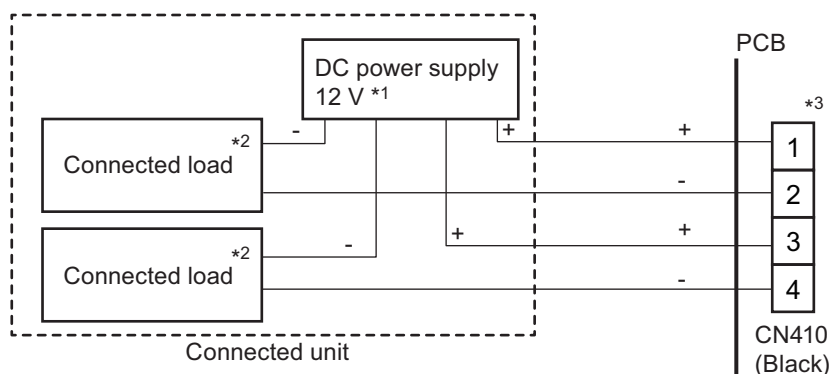

- \*1: Provide a DC 12 V power supply. Select a power supply capacity with an ample surplus for the connected load. Do not impress a voltage exceeding 12 V across pins 1-2 and 3-4.
- \*2: The allowable current is DC15 mA or less. Provide a load resistance such that the current becomes DC 15 mA or less.
- \*3: Polarity is “+” for pins 1 and 3, “-” for pins 2 and 4. Connect correctly.


### ● Operation status (External output 1)

The output for CN410 (1-2) is on when one or more indoor units are operating. The output is off when all of the indoor units are stopped.

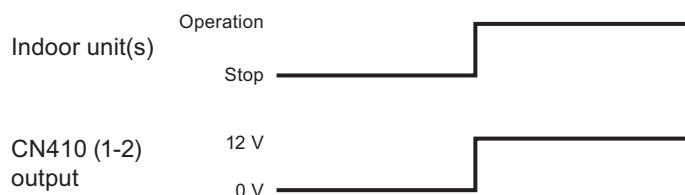

### ● Error status (External output 2)

The output for CN410 (3-4) is on when an error is generated at one or more indoor units, outdoor unit, or Touch panel controller.

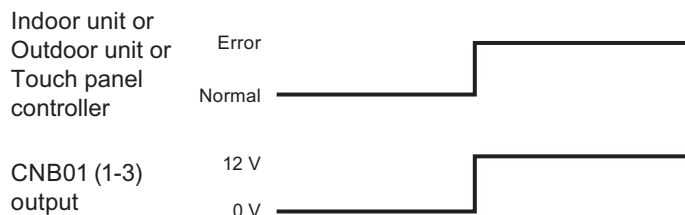

## Optional parts

External connect kit			
Model name	Exterior	Q'ty	Usage
UTY-XWZXZA		1	For output port.

## 4-2. Central remote controller (UTY-DCGYZ\*)

External input and output functions and related components are as follows:

External input	External output	Input select	Connector	External connect kit (Optional parts)
Control input	—	Dry contact	CN12, CN13	UTY-XWZXZ7
		Apply voltage	CN14, CN15	UTY-XWZXZ8
—	Operation status	—	CN18	UTY-XWZXZA
	Error status			

### RELATED LINKS

["External input"](#) on page 08-34

["External output"](#) on page 08-38

["Optional parts"](#) on page 08-39

["Function summary of controller external input/output"](#) on page 08-40

## ■ External input


This function performs “Emergency stop” or “All On / All Off” by using the signal to be input externally at external input terminals.

### ● Input select

Use either one of Apply voltage terminal or Dry contact terminal according to the application. (Both types of terminals cannot be used simultaneously.)

#### • CN12 (CH1) and CN13 (CH2): Dry contact terminal

When a power supply is unnecessary at the input device you want to connect, use the Dry contact terminal CN12 (Ch1) and CN13 (Ch2).

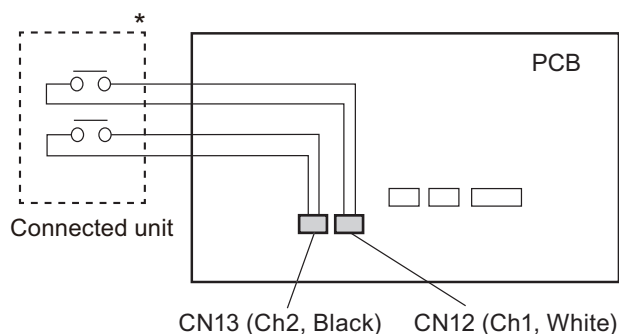


- \*: Short circuit detection resistance ( $R_{ON}$ ):  $\leq 500 \Omega$   
 Open circuit detection resistance ( $R_{OFF}$ ):  $\geq 100 \text{ k}\Omega$

A twisted pair cable 22 AWG (0.33 mm<sup>2</sup>) should be used. (Maximum cable length: 82 ft [25 m])

Input method	Terminal	Input signal	Operation
Edge	CN12 (Ch1)	Low → High	“Emergency Stop” or “All on”
		High → Low	“Emergency Stop” reset or “All Off”
Pulse	CN12 (Ch1)	Low → High	“Emergency Stop” or “All on”
	CN13 (Ch2)	Low → High	“Emergency Stop” reset or “All Off”

- **CN14 (Ch1) and CN15 (Ch2): Apply voltage terminal**

When a power supply must be provided at the input device you want to connect, connect to CN14 (Ch1) and CN15 (Ch2).

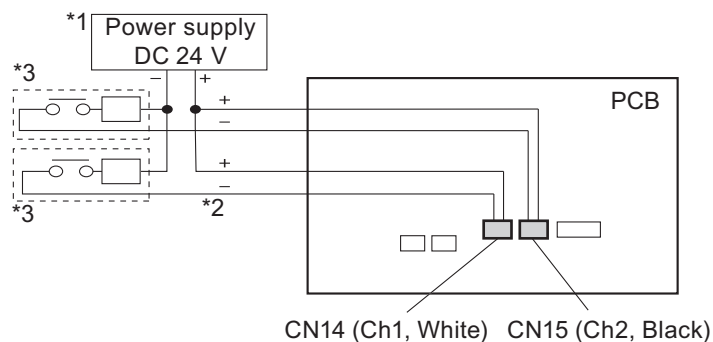

- \*1: Make the power supply DC 24 V. Select a power supply capacity with an ample surplus for the connected load.
- \*2: Do not impress a voltage exceeding 24 V across pin 1-3.
- \*3: The allowable current is DC 5 mA or less. (Recommended: DC 5 mA)  
Provide a load resistance such that the current becomes DC 5 mA or less.

A twisted pair cable 22 AWG (0.33 mm<sup>2</sup>) should be used. (Maximum cable length: 82 ft [25 m])

Input method	Terminal	Input signal	Operation
Edge	CN14 (Ch1)	Low → High	"Emergency Stop" or "All on"
		High → Low	"Emergency Stop" reset or "All Off"
Pulse	CN14 (Ch1)	Low → High	"Emergency Stop" or "All on"
	CN15 (Ch2)	Low → High	"Emergency Stop" reset or "All Off"

## ● Input signal type


The input signal type can be selected by using Central remote controller interface.

To select the input signal type, do as follows:



1. Tap Menu button.



2. Tap "Installer Setting".

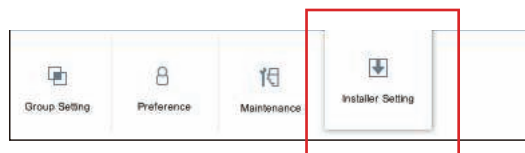

3. Tap "External Input Setting".

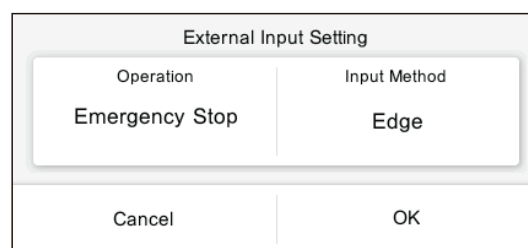

4. Tap "Operation" and select following operation for external input.




- Emergency Stop: Enables Emergency stop by external input
- All On/Off: Enables batch operation on or off by external input
- Not Used: Does not receive external input signals

5. Tap "Input method" and select following input method.



- Edge button: Detects the signal rise and fall
- Pulse button: Detects the signal level

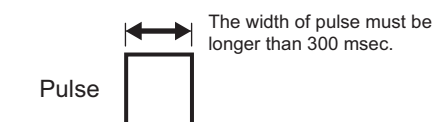


6. When "OK" button is tapped, setting is complete.

## ● Control input function


### • In case of Edge input:

Connector	Input signal	Command
CN12 (Ch1) or CH14 (Ch1)	Off → On	All on / Emergency stop
	On → Off	All off / Normal

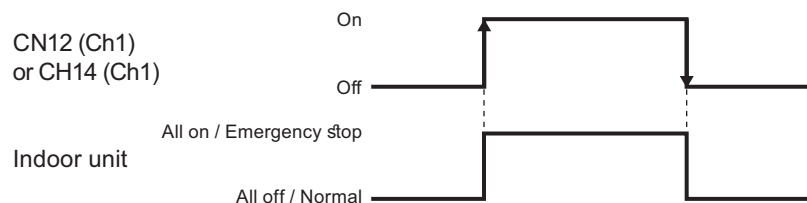


### • In case of Pulse input:

Connector	Input signal	Command
CN12 (Ch1) or CN14 (Ch1)	Off → On	All on / Emergency stop
CN13 (Ch2) or CN15 (Ch2)	Off → On	All off / Normal

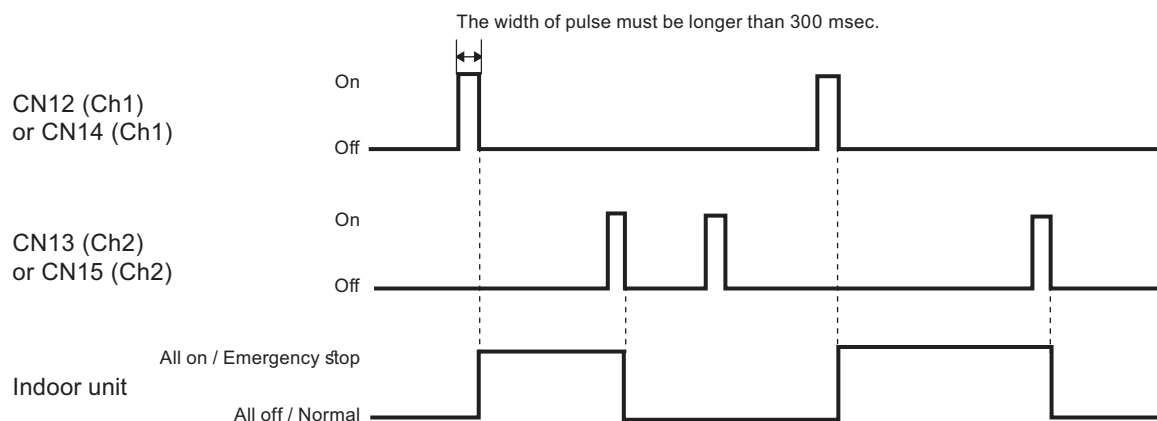

## External output


Terminal	Ch	Pin	Output voltage	Status
CN18	Ch1	4	0 V	One or more indoor units: Operation
		3	DC 12 V	All indoor units: Stop
	Ch2	2	0 V	Error
		1	DC 12 V	Normal

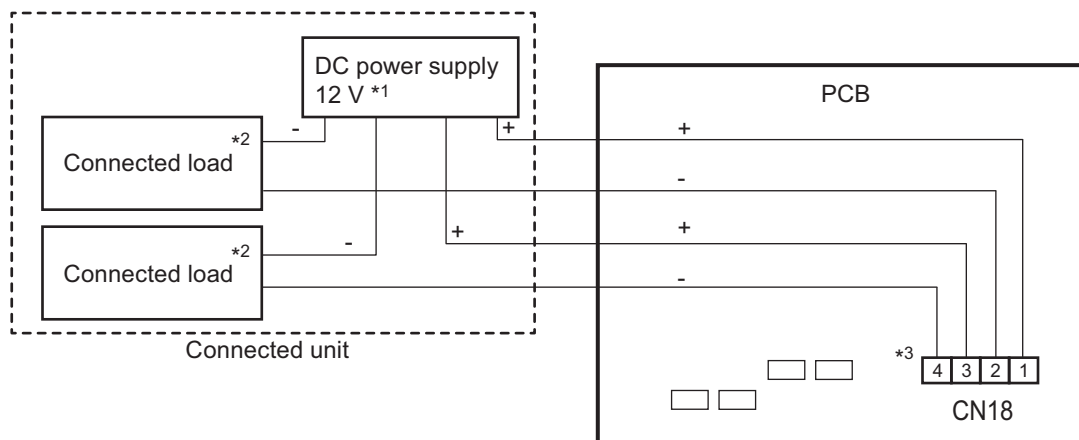

- \*1: Provide a DC 12 V power supply. Select a power supply capacity with an ample surplus for the connected load. Do not impress a voltage exceeding 12 V across pins 1-2 and 3-4.
- \*2: The allowable current is DC15 mA or less. Provide a load resistance such that the current becomes DC 15 mA or less.
- \*3: Polarity is “+” for pins 1 and 3, “-” for pins 2 and 4. Connect correctly.


### ● Operation status (External output 1)

The output for CN18 (3-4) is on when one or more indoor units are operating.  
The output is off when all of the indoor units are stopped.



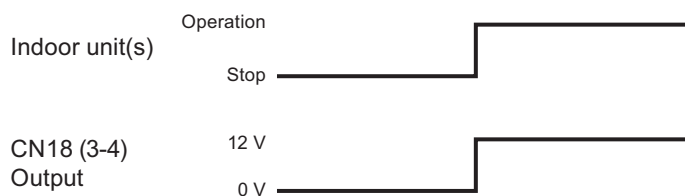


### ● Error status (External output 2)

The output for CN18 (1-2) is on when an error is generated at one or more indoor units, outdoor unit or Central remote controller.

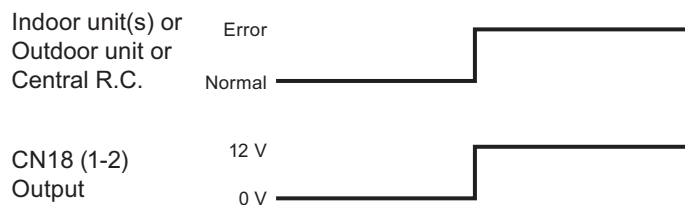

■ Optional parts

External connect kit				
Model name	Exterior	Q'ty		Usage
UTY-XWZXZ7		Edge	Pulse	For control input port. (Dry contact terminal)
		1	2	
UTY-XWZXZ8		Edge	Pulse	For control input port. (Apply voltage terminal)
		1	2	
UTY-XWZXZA		1		For output port.

EXTERNAL INPUT  
AND OUTPUT

EXTERNAL INPUT  
AND OUTPUT

## 4-3. Function summary of controller external input/output

### ■ Controller external input function

#### Touch panel controller (UTY-DTGYZ1)

Dry contact/Apply voltage			Dry contact		Apply voltage	
Function	Emergency stop		● (Screen icon)		● (Screen icon)	
	All on/All off		● (Screen icon)		● (Screen icon)	
Specifications	Terminal		TM201 (Ch1-K1, K2) CN201 ↑ CN411	TM201 (Ch1-K1, K2) (Ch2-K1, K2) CN201 ↑ CN411	TM201 (Ch1-K1, K2) CN201 ↑ CN412	TM201 (Ch1-K1, K2) (Ch2-K1, K2) CN201 ↑ CN412
	Signal type		Edge	Pulse *	Edge	Pulse *
	External power supply	Allowable voltage	—		DC12 V	
		Allowable current	—		10 mA or less	
	Wire size		22 AWG (0.33 mm <sup>2</sup> ), Twisted			
	Max. cable length		82 ft (25 m)			

#### Central remote controller (UTY-DCGYZ\*)

Dry contact/Apply voltage			Dry contact		Apply voltage	
Function	Emergency stop		● (Screen icon)		● (Screen icon)	
	All on/All off		● (Screen icon)		● (Screen icon)	
Specifications	Terminal		CN12 (Ch1: Pin 1-2)	CN12 (Ch1: Pin 1-2) CN13 (Ch2: Pin 1-2)	CN14 (Pin 1-3)	CN14 (Ch1: Pin 1-3) CN15 (Ch2: Pin 1-3)
	Signal type		Edge	Pulse	Edge	Pulse
	External power supply	Allowable voltage	—		DC 24 V	
		Allowable current	—		5 mA or less	
	Wire size		22 AWG (0.33 mm <sup>2</sup> ), Twisted			
	Max. cable length		82 ft (25 m)			



## ■ Controller external output function

Controller			Touch panel controller	
Dry contact/ Apply voltage			Apply voltage	
Function	Operation status		●	—
	Error status		—	●
Specifications	Terminal		CN410 (Pin1-2)	CN410 (Pin3-4)
	External power supply	Allowable voltage	DC12 V	
		Allowable current	15 mA or less	
	Wire size		22 AWG (0.33 mm <sup>2</sup> ), Twisted	
	Max. cable length		82 ft (25 m)	

Controller			Central remote controller	
Model name			UTY-DCGYZ*	
Dry contact/ Apply voltage			Apply voltage	
Function	Operation status		●	—
	Error status		—	●
Specifications	Terminal		CN18 (Pin3-4)	CN18 (Pin1-2)
	External power supply	Allowable voltage	DC12 V	
		Allowable current	15 mA or less	
	Wire size		22 AWG (0.33 mm <sup>2</sup> ), Twisted	
	Max. cable length		82 ft (25 m)	





## 9. NOTES

# CONTENTS

## 9. NOTES

<b>1. Refrigerant leakage caution .....</b>	<b>09-1</b>
1-1. Introduction.....	09-1
1-2. Checking concentration limit.....	09-2
1-3. Refrigerant concentration countermeasures.....	09-4
<b>2. Installation precautions .....</b>	<b>09-5</b>
2-1. Indoor unit installation precautions .....	09-5
2-2. Outdoor unit installation precautions .....	09-8
<b>3. Compatibility of VRF system.....</b>	<b>09-9</b>
3-1. Compatibility of controller system .....	09-9
3-2. Compatibility of adapter/convertor/maintenance tool .....	09-12
<b>4. About connection between series .....</b>	<b>09-14</b>
4-1. Piping connection .....	09-14
4-2. Wiring connection .....	09-15

# 1. Refrigerant leakage caution

The system designer and installer are to ensure that the system adhere to all local regulations regarding refrigerant leakage.

## 1-1. Introduction


Designing VRF systems requires special attention to codes and standards relating to Refrigeration Concentration Limit (RCL). The RCL is intended to “reduce the risks of acute toxicity, asphyxiation and flammability hazards in normally occupied, enclosed spaces”. Because R410A is neither toxic nor flammable, the primary safety concern is asphyxiation due to oxygen deprivation.

### Concentration limit

The purpose of the concentration limit is to protect occupants in the unlikely event that the entire refrigerant system leaks into the smallest room served by the system. To calculate the potential refrigerant concentration, divide the total refrigerant in the system by the volume of the smallest space served by the system.

Concentration limit for R410A	25 lb/1,000 ft <sup>3</sup> (0.40 kg/m <sup>3</sup> )
-------------------------------	---

**NOTE:** Based on ASHRAE 34-2007 and IMC-2009

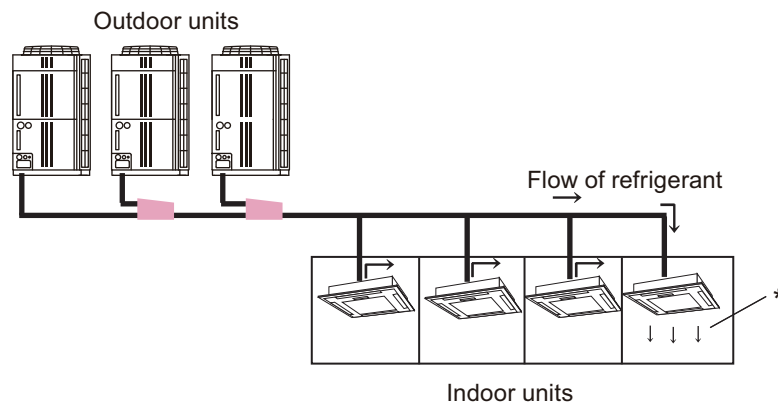

\*: Entire refrigerant charge in the system leaks into the smallest room.

## 1-2. Checking concentration limit

Check concentration limit following step 1 and 2, and take appropriate measures depending on the situation.


1. Calculate amount of refrigerant per refrigerant system.

Unit: lb (kg)


Amount of refrigerant system	+	Amount of additional refrigerant	=	Total amount of refrigerant in system
Amount of factory charge		Amount of refrigerant added to system based on pipe length, pipe size, and indoor units		When one refrigerant system is divided into 2 or more refrigerant systems and each system is independent, total amount of refrigerant of each system shall be adopted.

2. Calculate room volume by regarding portion marked in gray as one room or the smallest room.


(a) Without partition

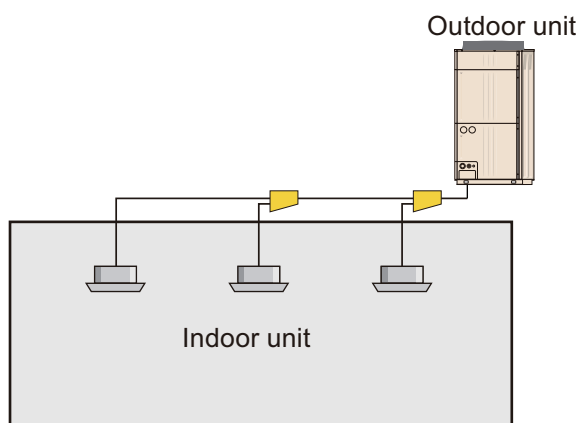

(b) When there are partitions, but there is an effective opening for ventilation between the rooms.

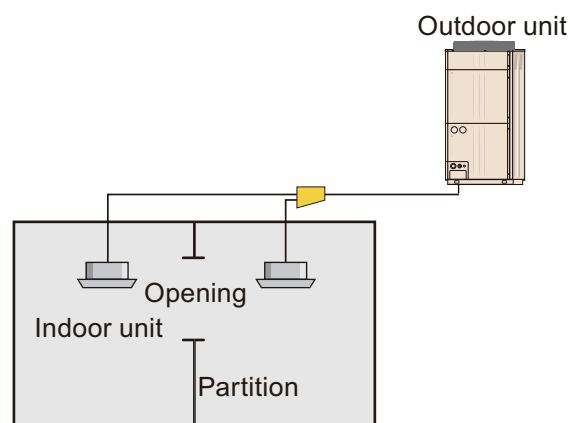

(c) When there are partitions, but there is an effective opening for ventilation between the rooms.

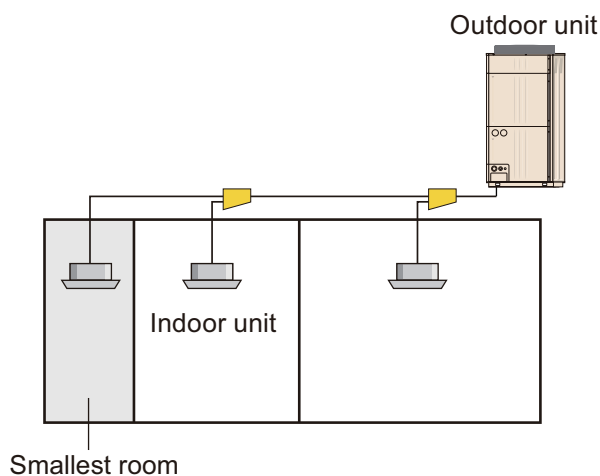

3. Calculate refrigerant concentration from the results of step 1 and 2.

$$\frac{\begin{array}{c} \text{Total amount of refrigerant in refrigerant} \\ \text{system} \\ \text{Unit: lb (kg)} \end{array}}{\begin{array}{c} \text{Capacity of smallest room where indoor unit} \\ \text{is installed} \\ \text{Unit: ft}^3 \text{ (m}^3\text{)} \end{array}} \leq \begin{array}{c} \text{Refrigerant concentration (R410A)} \\ \text{Unit: lb/ft}^3 \text{ (kg/m}^3\text{)} \end{array}$$

When the result of calculation exceeds the limiting concentration, perform the same calculation by shifting to second smallest, and the third smallest rooms until the final result is below the limiting concentration.

## 1-3. Refrigerant concentration countermeasures

When the concentration limit is exceeded, the designer will need to change the original design or use one of the countermeasures below to reduce potential exposure to refrigerant. Always consult local codes to ensure proper design.

- **Countermeasure 1**

Provide opening for ventilation.

Provide 0.15% or more opening to floor space both above and below, or provide opening without door.

**NOTE:** 0.15% floor opening based on standard ceiling height of 8.8 ft (2.7 m)

- **Countermeasure 2**

Reduce the total refrigerant charging amount of the refrigerant equipment.

- Shorten the length of the refrigerant pipes.

Move the location of the outdoor unit closer to the indoor unit, and reduce the total refrigerant charging amount by shortening the length of the refrigerant pipes.


- Lower the capacity of the outdoor unit.

Separate the outdoor unit into multiple units to lower the outdoor unit capacity for each refrigerant system and reduce the refrigerant charging amount.

For example, by changing a 12 ton × 1 unit system to a 6 ton × 2 units system, the refrigerant amount for each refrigerant system can be reduced by about half.

- **Countermeasure 3**

Provide gas leak alarm linked with mechanical ventilator. If using the mechanical ventilator, the backup power supply is required.

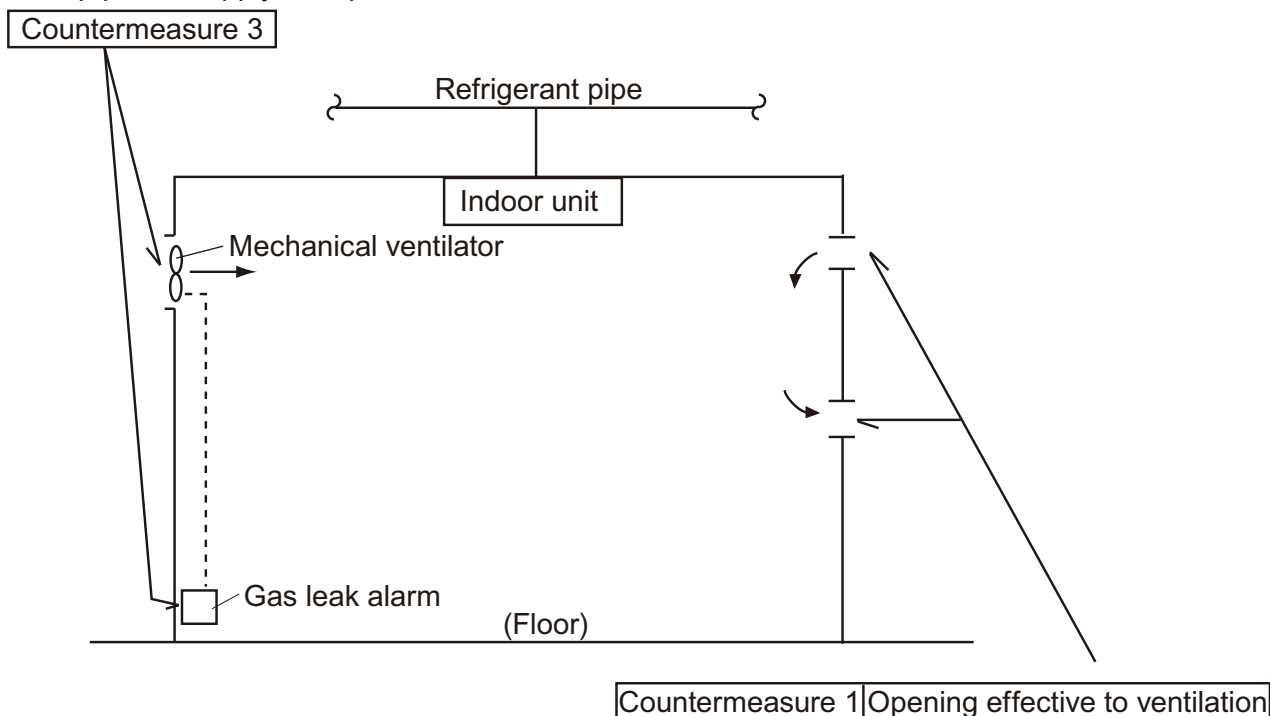

Pay special attention to the place, such as a basement, etc. Since refrigerant is heavier than air, refrigerant may accumulate.



---

## 2. Installation precautions

---

### 2-1. Indoor unit installation precautions

**NOTE:** The information listed below are general precautions.  
Some models also include items that do not apply.

#### ■ Places where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places where there is a lot of oil splash and steam such as kitchen or machinery room.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Places where carbon fibers or any kind of powder suspended in the air.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are large such as a factory.

## ■ Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the indoor.
- To allow maintenance after refrigerant piping, drain piping, and electric wiring connection and installation, provide an installation service space and an inspection port, as required.  
\*Installation service space is shown on "Dimensions" in Chapter 4. INDOOR UNITS on page 04-28.
- Be careful when installing the unit at the following places.

Condition	Contents	Countermeasures (Reference)
When the ceiling is high.	If the indoor unit is installed where the installation height given in the installation manual is exceeded, the temperature difference between the floor and ceiling of the room will be large and the heating effect will be poor. Moreover, even if the indoor unit is installed within the installation height, a similar phenomena will occur when installed in a room in which the doors are opened and closed frequently and hot air circulation is obstructed by furniture such as desks or chairs.	1. Switch the setting to the high ceiling mode. 2. Install a circulator. 3. Arrange the furniture in the room so that it does not obstruct the hot air.
When lower level directly contacts the outside air.	When the lower level of the room is a semi-open space such as warehouse or parking lot the surface temperature of the flooring will become low and the radiation of cold from the floor will increase. In this case, even if the room temperature is suitable, you may feel the foot level is cold.	
When the airflow distribution is poor.	When an indoor unit is installed in a position where the outlet airflow will directly contact people, a draft may be felt. In addition, when there are obstructions in the path of the intake and outlet airflow, the air distribution may become extremely bad.	1. Adjust the louver fins or take other measures matched to the site. 2. Change the indoor unit outlet.
When inside the ceiling is high temperature and high humidity.	When the indoor unit is installed where the inside of the ceiling is 86 °F (30 °C) RH80% or greater, the dew point temperature of the outer perimeter may become higher than the cabinet surface temperature and moisture will condense on the surface of the cabinet and water drops may fall inside the room. ("Figure 2-1 Moist air curve") In addition, the humidity may vary considerably the same as when the inside of the ceiling is close to hermetically sealed and used as the outside air intake path.	1. Add heat insulating material to the outside of the indoor unit cabinet. *Regarding the cassette type, use of optional High humidity correspondence kit is recommended. 2. Strengthen the heat insulating material of the refrigerant piping and drain piping too. ("Figure 2-2 Work method when reinforcing the heat insulation of on-site piping") 3. When the humidity inside the ceiling changes considerably, install a ventilation port.
When using an external duct.	When using an external duct to take in new fresh air, etc., condensation may form on the surface of the duct due to the effect of the outside air temperature and the humidity inside the ceiling.	Always perform heat insulation processing. (Heat insulating material: Glass wool 1 in [25 mm] thick or more.)
When the remote controller installation site is bad.	If the cold or warm air blown out from the air conditioner directly contacts the thermostat section of the remote controller, the outlet temperature of the air conditioner may be sensed and room temperature control will be different from the room temperature, and "not cooled" or "not heated" or other trouble may occur. In addition, there is the possibility that the same kind of trouble may also occur when the remote controller is effected by direct sunlight.	1. Install the remote controller where it will not be directly exposed to the cold or hot air. 2. Install the remote controller where it will not be directly exposed to sunlight or strong lighting.

Condition	Contents	Countermeasures (Reference)
When installing duct type in ceiling chamber system.	In the case of the ceiling chamber system (duct is not installed at indoor unit inlet side and room air is sucked into the indoor unit through the inside of the ceiling), the thermistor inside the indoor unit may not correctly detect the room temperature. <ul style="list-style-type: none"> <li>Heating operation: Room is not heated because the indoor unit is easily turned off by the thermostat.</li> <li>Cooling operation: Room is too cold because the indoor unit is difficult to turn off by the thermostat.</li> </ul>	Replace the indoor unit thermistor with optional Remote sensor unit, and install the sensor where the room temperature can be correctly detected.
When the outlet air is sucked in at duct type.	Cooling operation does not cool the room and heating operation does not heat the room because the short circuited indoor unit is not turned on by the thermostat.	<ol style="list-style-type: none"> <li>1. Reconsider the ventilation port construction.</li> <li>2. Replace the indoor unit thermistor with optional Remote sensor unit, and install the sensor where the room temperature can be correctly detected.</li> </ol>
When using the wireless remote controller.	Signals may not be received when using it in a room illuminated by an inverter fluorescent lamp.	Turn on the fluorescent lamp and check if the indoor unit receives the signals from the remote controller. If the indoor unit does not receive the signals, consult an authorized service personnel.
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.

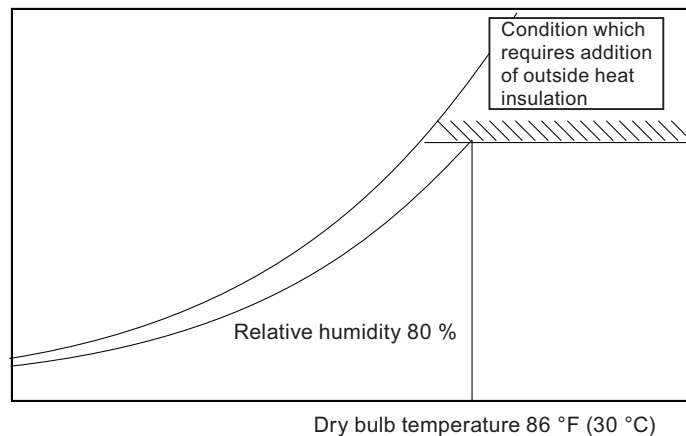


Figure 2-1 Moist air curve

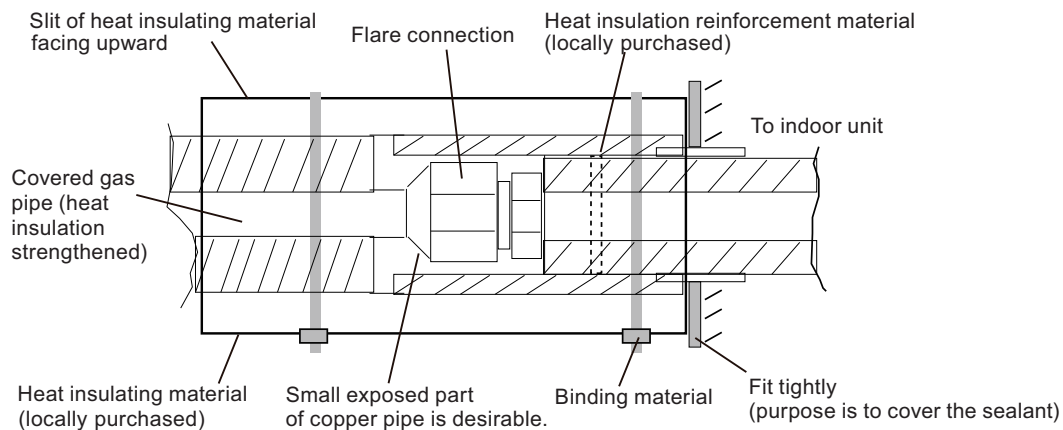


Figure 2-2 Work method when reinforcing the heat insulation of on-site piping

## 2-2. Outdoor unit installation precautions

**NOTE:** The information listed below are general precautions.  
Some models also include items that do not apply.

### ■ Places where prohibited for use

- Places where there is a danger of combustible gas leakage.
- Places where sulfur gas, chlorine gas, acid, alkali, or other matter which effects equipment is generated.
- Places affected by heat radiation from other heat sources.
- Places where the air is stagnant.
- Places where machinery which generates high frequencies is used.
- Ocean beaches and other areas where there is a lot of salt.
- Inside of vehicles, ships, and other conveyances.
- Places where voltage fluctuations are large such as a factory.

### ■ Points to remember when installing

- The product shall be installed at a place which can withstand the weight and vibration of the outdoor unit.
- To allow maintenance after refrigerant piping, drain piping, and electric wiring connection, and installation, provide an installation service space.  
\*Installation service space is shown in "[Installation space](#)" in Chapter 3. OUTDOOR UNITS on page 03-22.
- Be careful when installing the set at the following places.

Condition	Contents	Countermeasures (Reference)
When installed near adjacent houses.	Perform installation work so that operating sound does not disturb the neighbors.	<ol style="list-style-type: none"> <li>1. Install a soundproof barrier.</li> <li>2. Change the installation site.</li> </ol>
When there is the possibility of strong wind.	<ul style="list-style-type: none"> <li>• If the outdoor unit is exposed to strong wind, capacity may drop, frost may form during heating, and operation may be stopped by high pressure rise. In addition, when a very strong wind blows, the fan may be damaged.</li> <li>• When a very strong wind blows, there is the possibility of the outdoor unit being toppled over if held only by foundation bolts.</li> </ul>	<ol style="list-style-type: none"> <li>1. Install the outdoor unit with keeping a sufficient distance between the outlet side of the unit and a facing wall or fence.</li> <li>2. Make the outlet direction and wind direction perpendicular.</li> <li>3. Fasten the outdoor unit using toppling prevention hardware (purchased locally).</li> </ol>
When snow accumulates.	If the outdoor unit is covered by accumulated snow, it may not be able to operate.	<ol style="list-style-type: none"> <li>1. Make the foundation as high as possible.</li> <li>2. Perform snow prevention work.</li> </ol>
When installing the inverter type.	It may generate noise in TV sets, stereos and PCs.	The inverter type should be installed at a sufficient distance from these equipments.

### 3. Compatibility of VRF system

#### RELATED LINKS

"Outdoor unit and indoor unit lineup" in Chapter 1. GENERAL INFORMATION on page 01-1





"Optional parts" in Chapter 1. GENERAL INFORMATION on page 01-8

"Indoor unit type and applicable control method" in Chapter 5. CONTROL SYSTEM on page 05-8

"Applicable parts" in Chapter 10. OPTIONAL PARTS on page 10-24


### 3-1. Compatibility of controller system


#### • Central controller

Exterior	Part name	Model name	All series of outdoor unit
	System controller	UTY-APGXZ1	○ OK*
	System controller lite	UTY-ALGXZ1	○ OK
	Touch panel controller	UTY-DTGYZ1	○ OK
	Central remote controller	UTY-DCGYZ*	○ OK

\*: Different VRF series may be connected for each of the 4 VRF networks supported by the product, but different series may not coexist within the same network. (VR-II, V-II, J-II, J-IIS, J-IIIL, J-IV, and J-IVS can exist together in same network. V and S can exist together in same network, too.)

## • Individual controller

Exterior	Part name	Model name	All series of outdoor unit
	Wired remote controller (Touch panel)	UTY-RNRUZ*	○ OK*
	Wired remote controller	UTY-RNKU	○ OK
	Simple remote controller	UTY-RSRY	○ OK
	Simple remote controller (Without operation mode)	UTY-RHRY	○ OK
	Simple remote controller	UTY-RSKU	○ OK
	Simple remote controller (Without operation mode)	UTY-RHKU	○ OK

Exterior	Part name	Model name	All series of outdoor unit
	Wireless remote controller	UTY-LNHU	○ OK

\*: It is not connectable with indoor units of previous model.



NOTES

NOTES

## 3-2. Compatibility of adapter/converter/maintenance tool

Exterior	Part name	Model name	All series of outdoor unit
	Network converter	UTY-VTGX	○ OK
	Network converter (AC power supply)	UTY-VTGXV	○ OK
	Network converter	UTY-VGGXZ1	○ OK
	Network converter for LonWorks	UTY-VLGX	○ OK
	Modbus converter for VRF	UTY-VMGX	○ OK
	Modbus converter for indoor unit	UTY-VMSX	○ OK
	BACnet gateway (Hardware)	UTY-VBGX	○ OK
	BACnet gateway (Software)	UTY-ABGXZ1	○ OK*
	Niagara driver for VRF	FUJ-VRF-8000	○ OK
	Signal amplifier	UTY-VSGXZ1	○ OK
	External switch controller	UTY-TERX UTY-TEKX	○ OK



Exterior	Part name	Model name	All series of outdoor unit
	Service tool	UTY-ASGXZ1	○ OK
	Web monitoring tool	UTY-AMGXZ1	○ OK*

- \*: Different VRF series may be connected for each of the 4 VRF networks supported by the product, but different series may not coexist within the same network. (VR-II, V-II, J-II, J-IIS, J-IIIL, J-IV, and J-IVS can exist together in same network. V and S can exist together in same network, too.)


## 4. About connection between series

### 4-1. Piping connection


#### NOTES:

- Connection over different series in same refrigerant system is prohibited.
- Mixed connection of 230 V series and 460 V series is prohibited.

#### • Example 1 (OK)

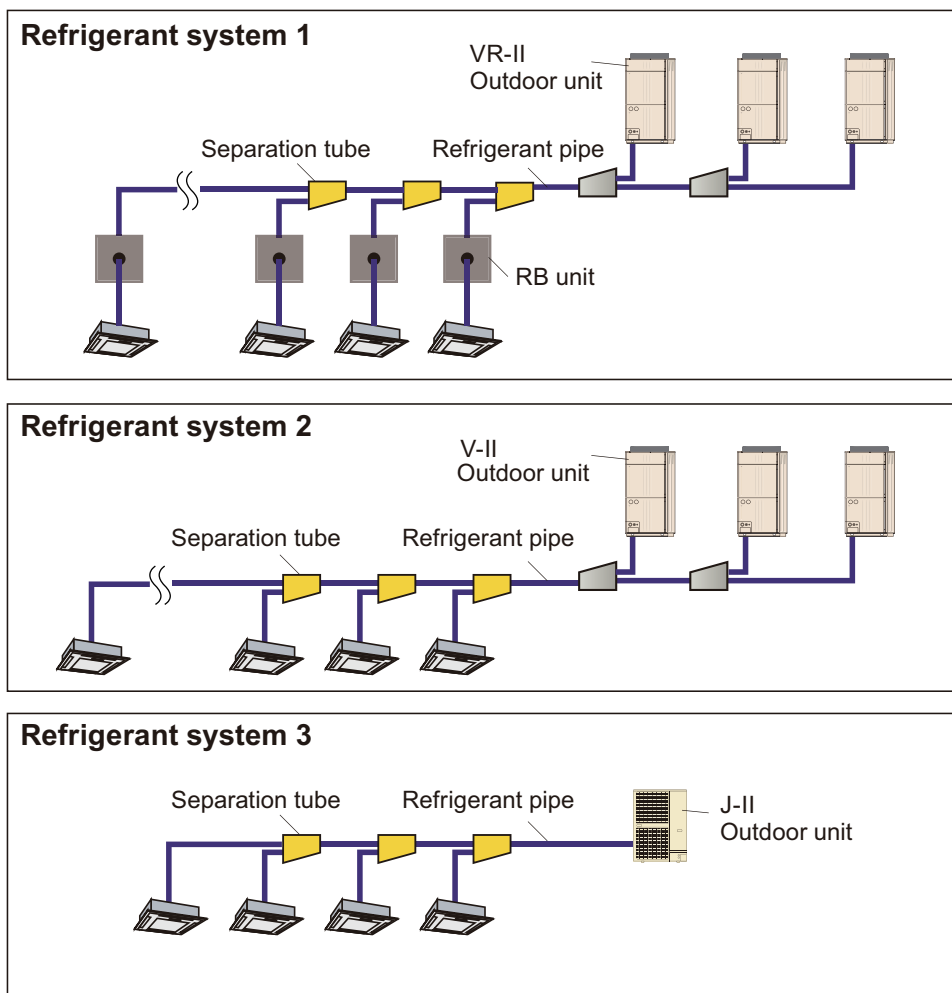

#### • Example 2 (Prohibited)

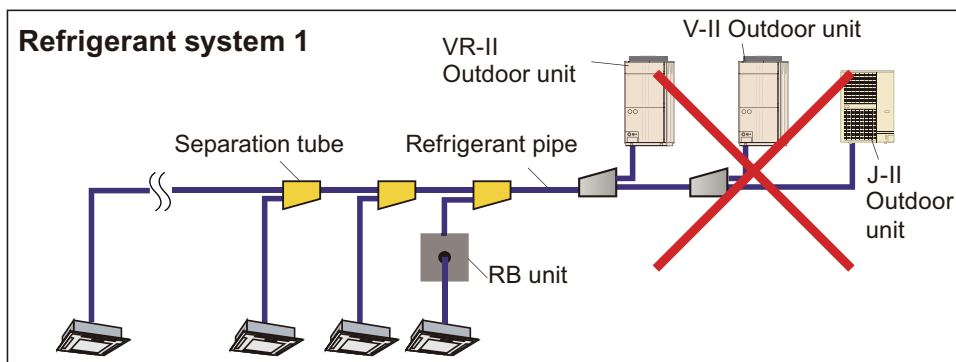

## 4-2. Wiring connection

### NOTES:

- Connection over different series in same refrigerant system is prohibited.
- Mixed connection of 230 V series and 460 V series is prohibited.

### • Example 1 (OK)

When wiring to each refrigerant system

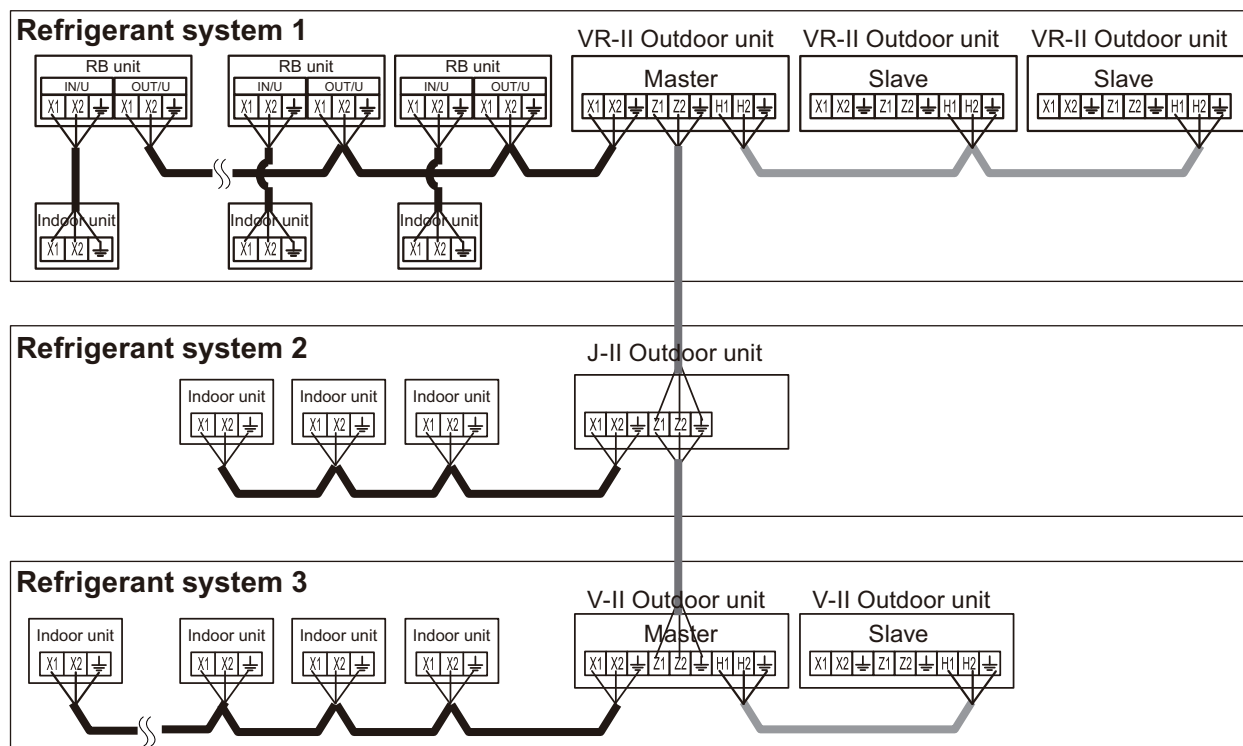
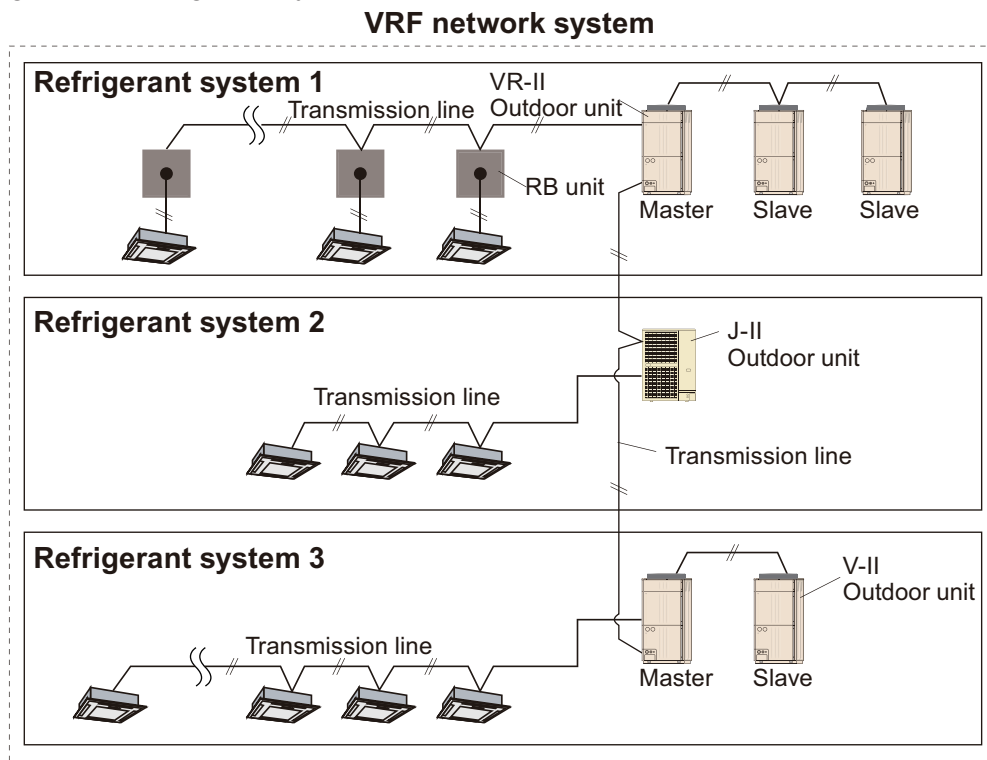


Figure 4-4 Connection method to terminal

## • Example 2 (OK)

When stepping over, and wiring to the refrigerant system

### VRF network system

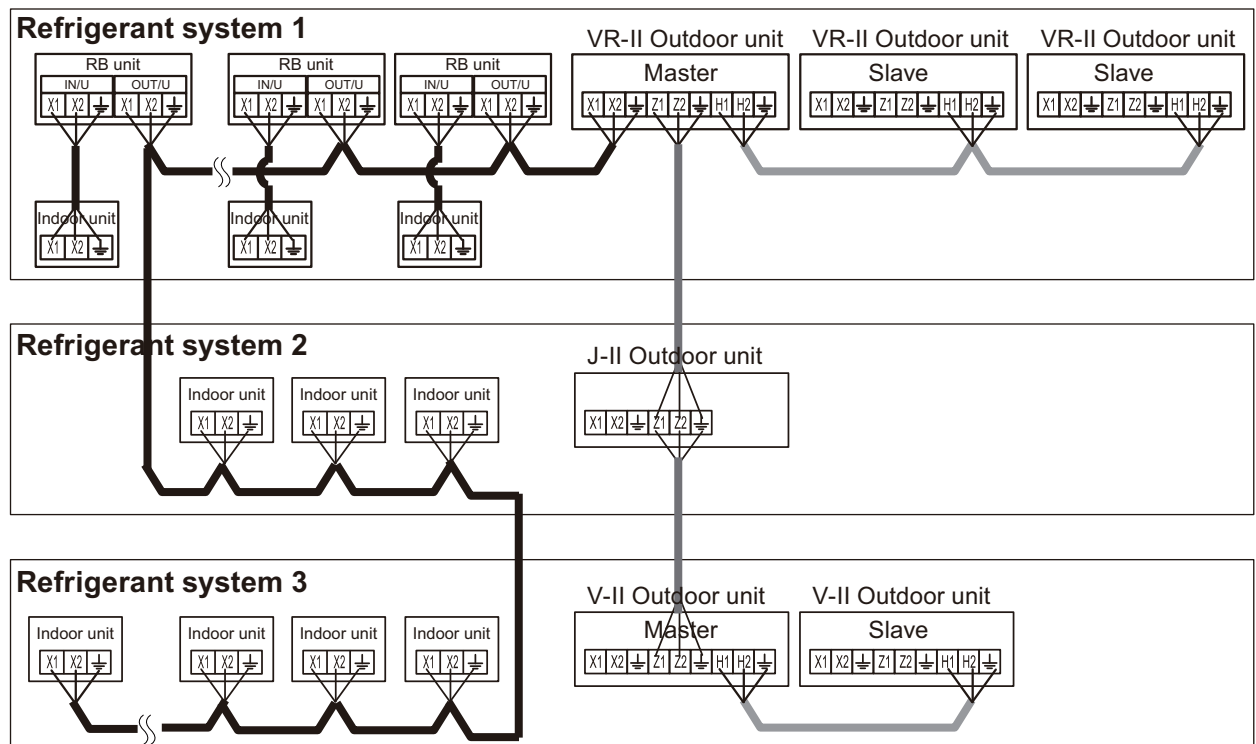
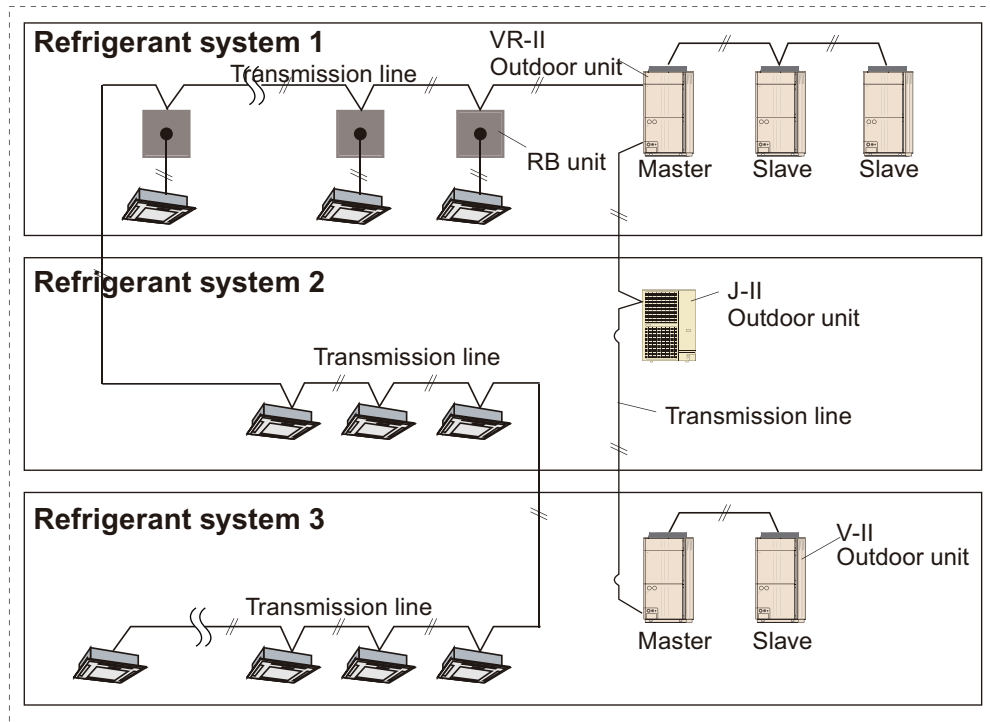


Figure 4-6 Connection method to terminal

## • Example 3 (Prohibited)

**NOTE:** Slave units of V series and J series cannot be connected.

### VRF network system


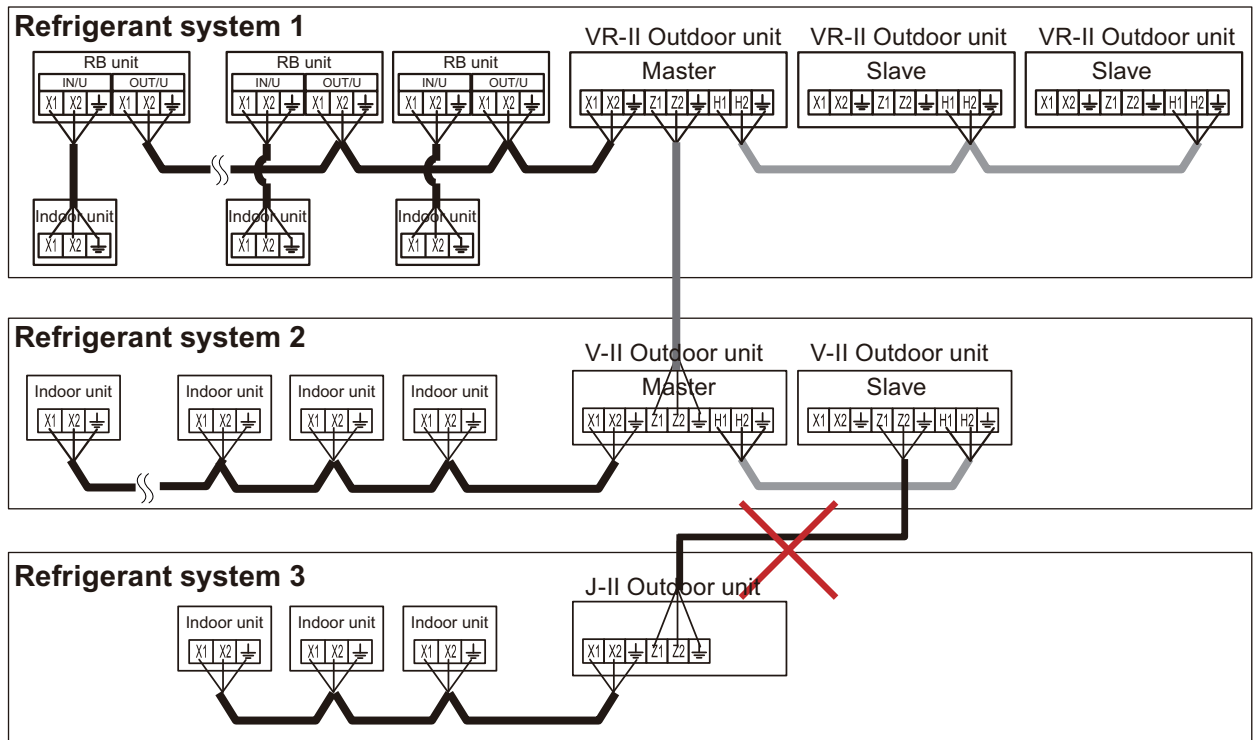


Figure 4-8 Connection method to terminal



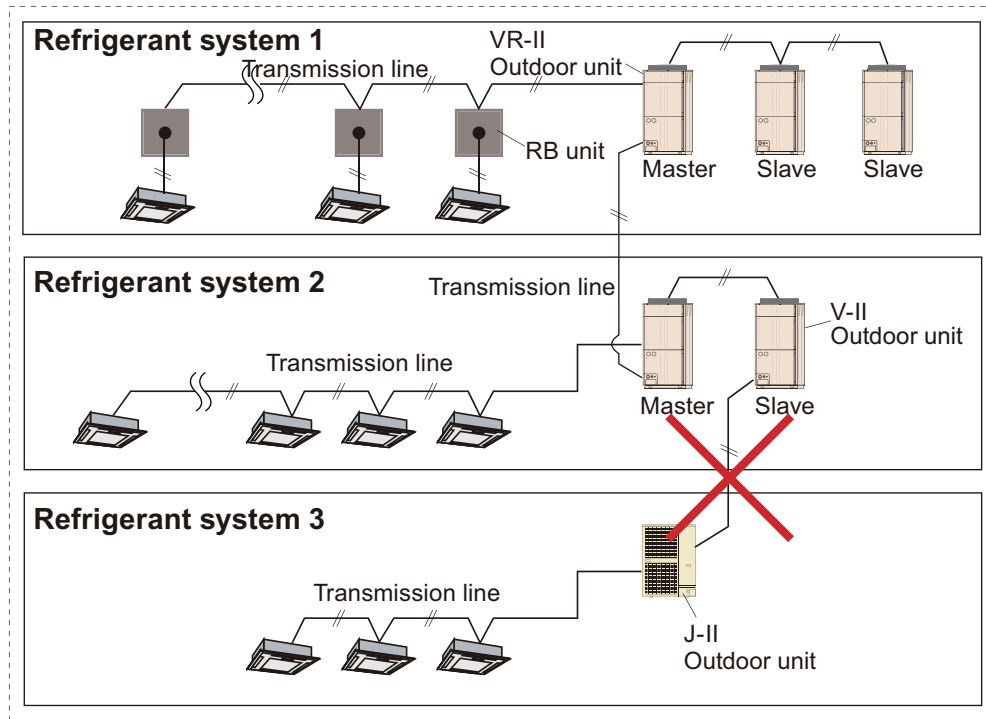

## 10. OPTIONAL PARTS

# CONTENTS

## 10. OPTIONAL PARTS

<b>1. Outdoor unit branch kit .....</b>	<b>10-1</b>
1-1. Model: UTP-CX567A (Only for V-II series) .....	10-1
<b>2. Separation tube .....</b>	<b>10-3</b>
2-1. Connection capacity .....	10-3
2-2. Dimensions.....	10-4
<b>3. Header .....</b>	<b>10-7</b>
3-1. Connection capacity .....	10-7
3-2. Dimensions.....	10-8
<b>4. Controllers .....</b>	<b>10-15</b>
4-1. Central control .....	10-15
4-2. Individual control.....	10-15
<b>5. Adapter/Converter/Maintenance tool.....</b>	<b>10-17</b>
<b>6. Cassette grille.....</b>	<b>10-19</b>
<b>7. Others.....</b>	<b>10-20</b>
7-1. Parts list.....	10-20
7-2. Applicable parts .....	10-24
<b>8. Optional parts installation .....</b>	<b>10-27</b>
8-1. Drain pump unit for duct type.....	10-27
8-2. Drain pump unit for Ceiling type .....	10-34
8-3. Fresh air intake kit for Compact cassette type .....	10-35
8-4. Fresh air intake kit for Circular flow cassette type and 4-way flow cassette type .....	10-45
8-5. Auto louver grille kit .....	10-56
8-6. External power supply unit .....	10-59




# 1. Outdoor unit branch kit

## 1-1. Model: UTP-CX567A (Only for V-II series)

Unit: in (mm)







Exterior	Part name	Q'ty
	Liquid pipe	1
	Gas pipe	1
	Heat insulation	2

Exterior		Part name	Q'ty
		Tape	8

## 2. Separation tube

### 2-1. Connection capacity

Connection capacity values written in this section are reference values. For pipe designing, refer to "Piping design" in Chapter 6. SYSTEM DESIGN on page 06-19.

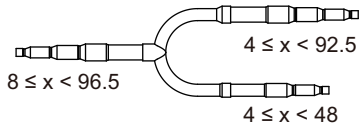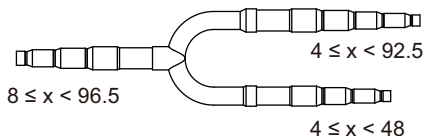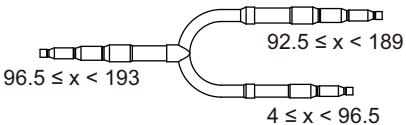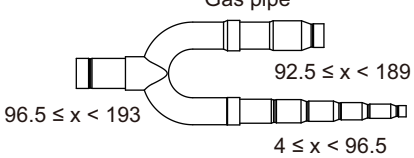

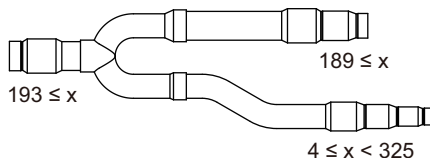

For 2 pipes		
Total cooling capacity of indoor units at rated condition (x) (kBtu/h)	Model name	Connection capacity of separation tube (kBtu/h)
$x < 96.5$	UTP-AX090A	<p>Liquid pipe</p>  <p>Gas pipe</p> 
$96.5 \leq x < 193$	UTP-AX180A	<p>Liquid pipe</p>  <p>Gas pipe</p> 
$193 \leq x$	UTP-AX567A	<p>Liquid pipe</p>  <p>Gas pipe</p> 

## 2-2. Dimensions





### ■ Model: UTP-AX090A

Exterior [Unit: in (mm)]		Part name	Q'ty
<p>Diagram of the liquid pipe assembly. The top horizontal section has a length of 14-1/4 (362). The bottom horizontal section has a length of 13-1/16 (331). The vertical section on the right has a height of 3-1/8 (80). The pipe is U-shaped. Part numbers and dimensions are labeled: Ø1/4 (6.35), Ø3/8 (9.52), Ø1/2 (12.70), and Ø5/8 (15.88) for the liquid pipe.</p>		Liquid pipe	1
<p>Diagram of the gas pipe assembly. The top horizontal section has a length of 16-13/16 (427). The bottom horizontal section has a length of 15-9/16 (396). The vertical section on the right has a height of 3-1/8 (80). The pipe is U-shaped. Part numbers and dimensions are labeled: Ø1/2 (12.70), Ø5/8 (15.88), Ø3/4 (19.05), and Ø7/8 (22.22) for the gas pipe. Two inset diagrams show the expander details: one for Ø1-1/8 (28.58) with a length of 13/16 (20) and a total length of 3-15/16 (100), and another for Ø7/8 (22.22) with a length of 13/16 (20) and a total length of 3-1/8 (80).</p>		Gas pipe	1
<p>Diagram showing two heat insulation parts. One is labeled 'For liquid pipe × 1' and the other is labeled 'For gas pipe × 1'.</p>		Heat insulation	2
<p>Diagram showing a single piece of tape.</p>		Tape	8

Model: UTP-AX180A

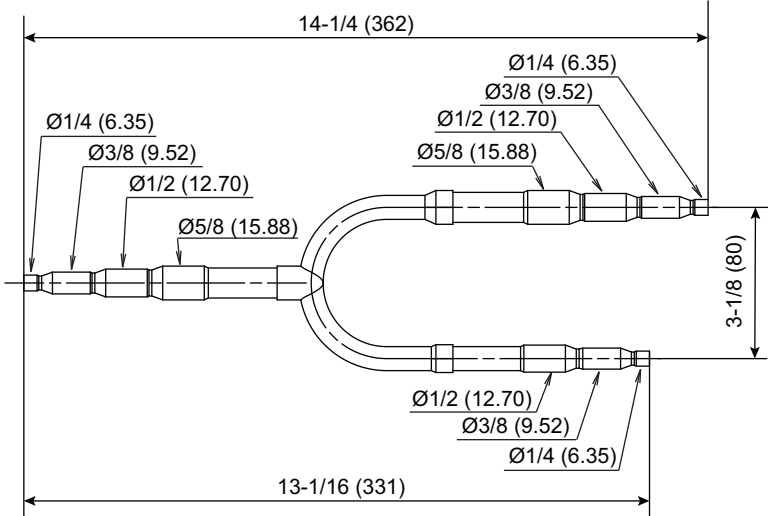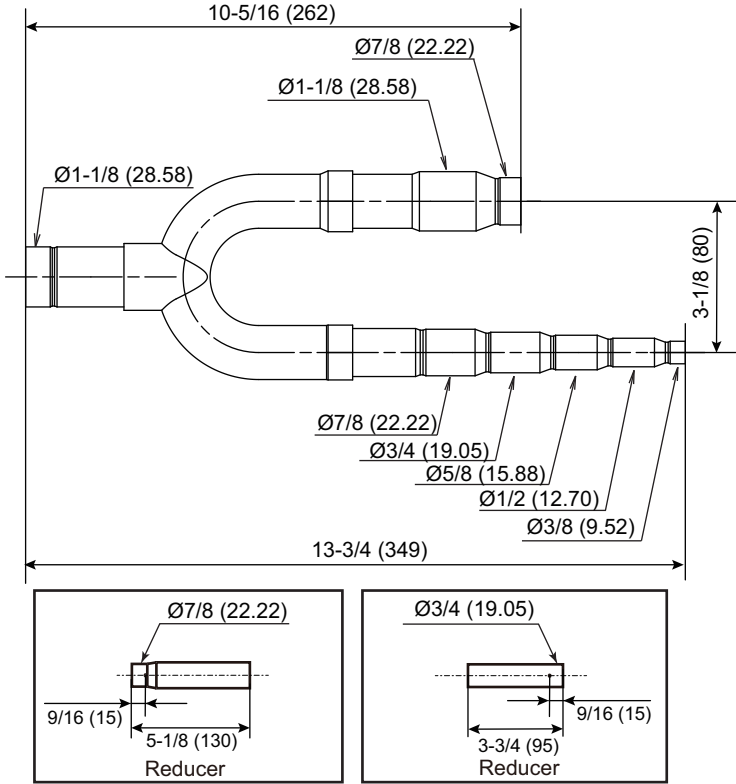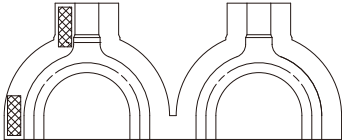Exterior [Unit: in (mm)]	Part name	Q'ty
	Liquid pipe	1
	Gas pipe	1
 <p>For liquid pipe × 1 For gas pipe × 1</p>	Heat insulation	2
	Tape	8

# Model: UTP-AX567A

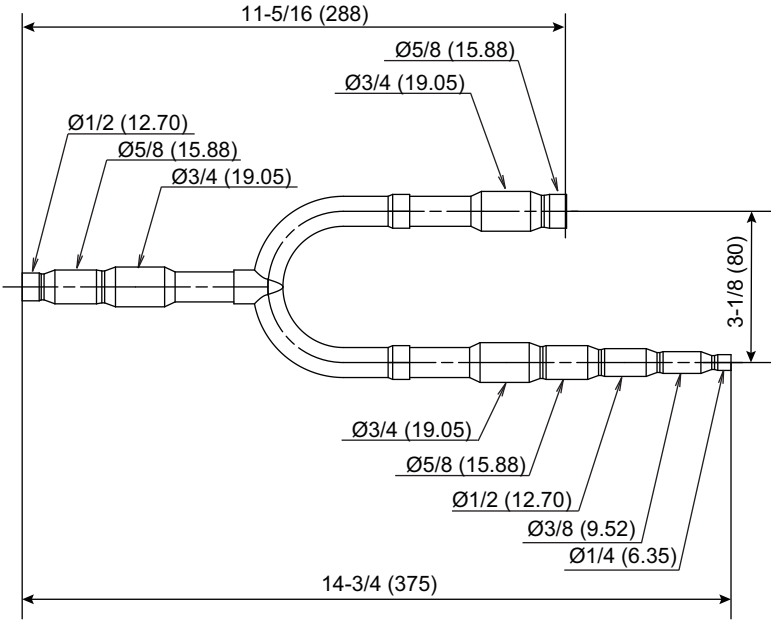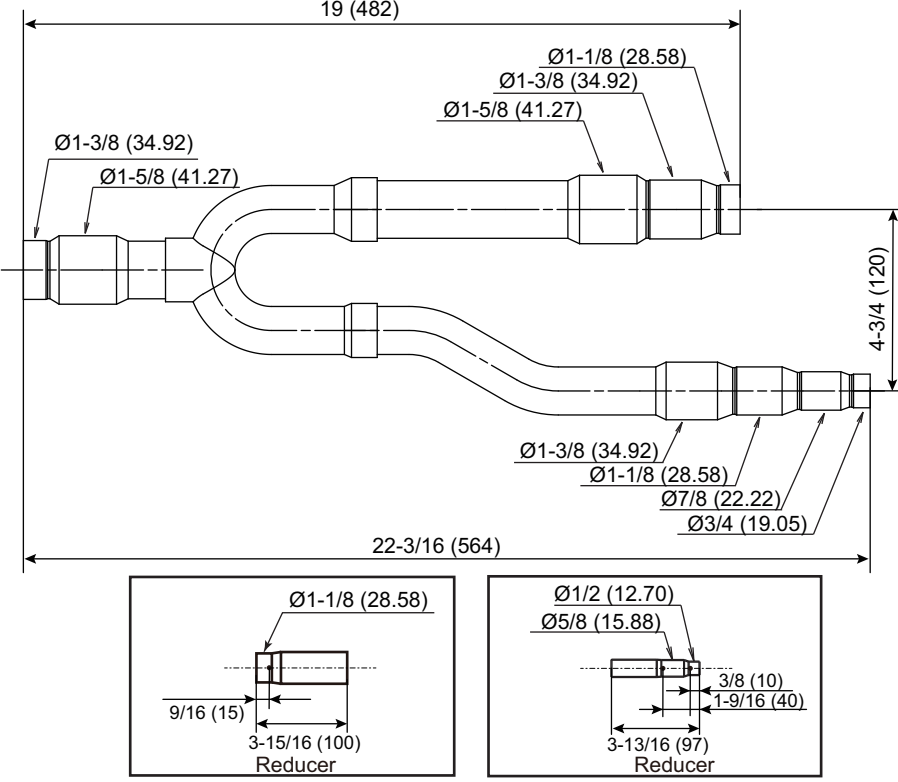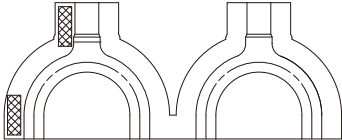Exterior [Unit: in (mm)]	Part name	Q'ty
	Liquid pipe	1
	Gas pipe	1
 <p>For liquid pipe × 1 For gas pipe × 1</p>	Heat insulation	2
	Tape	8

## 3. Header

### 3-1. Connection capacity

For pipe designing, refer to "Piping design" in Chapter 6. SYSTEM DESIGN on page 06-19.

Total cooling capacity of indoor units (x) (Btu/h)	3 to 6 Branches	3 to 8 Branches
$x < 96,500$	UTR-H0906L	UTR-H0908L
$96,500 \leq x < 193,000$	UTR-H1806L	UTR-H1808L


Total cooling capacity of indoor unit is the total value for the cooling capacity at rated condition of indoor unit connected downstream.

## 3-2. Dimensions

### ■ Model: UTR-H0906L

Exterior [Unit: in (mm)]		Part name	Q'ty
		Liquid pipe	1
		Gas pipe	1
		Closed pipe A	4
		Closed pipe B	2
		Closed pipe C	2
		Closed pipe insulation	6
		Heat insulation for liquid pipe	1
		Heat insulation for gas pipe	1





Exterior [Unit: in (mm)]	Part name	Q'ty
	Binder	10

# Model: UTR-H0908L

Exterior [Unit: in (mm)]		Part name	Q'ty
		Liquid pipe	1
		Gas pipe	1
		Closed pipe A	6
		Closed pipe B	4
		Closed pipe C	2
		Closed pipe insulation	8
		Heat insulation for liquid pipe	1
		Heat insulation for gas pipe	1
		Binder	10


# Model: UTR-H1806L

Exterior [Unit: in (mm)]		Part name	Q'ty
		Liquid pipe	1
		Gas pipe	1
		Closed pipe A	4
		Closed pipe B	2
		Closed pipe C	2
		Closed pipe insulation	6
		Heat insulation for liquid pipe	1

Exterior [Unit: in (mm)]	Part name	Q'ty
	Heat insulation for gas pipe	1
	Binder	10





# Model: UTR-H1808L

Exterior [Unit: in (mm)]		Part name	Q'ty
		Liquid pipe	1
		Gas pipe	1
		Closed pipe A	6
		Closed pipe B	2
		Closed pipe C	4
		Closed pipe insulation	8
		Heat insulation for liquid pipe	1
		Heat insulation for gas pipe	1




Exterior [Unit: in (mm)]	Part name	Q'ty
	Binder	10





## 4. Controllers

### 4-1. Central control

Exterior	Part name	Model name	Summary
	System controller	UTY-APGXZ1	System controller realizes the advanced integrated monitoring & control of VRF network system from small scale buildings to large scale buildings. Optional: UTY-PEGXZ1, UTY-PPGXP2
	System controller lite	UTY-ALGXZ1	System controller lite has standard functions sufficient for air conditioner management in small and medium scale buildings. Optional: UTY-PLGXA2, UTY-PLGXR2, UTY-PLGXE2, UTY-PLGXP2, UTY-PLGXX2
	Touch panel controller	UTY-DTGYZ1	Controls and monitors our air conditioner via LAN or Internet. Allows user or tenant to manage the air conditioning by using assigned equipment only such as their PCs or smart devices from anywhere. Optional: UTY-PTGXA
	Central remote controller	UTY-DCGYZ*	Central control of small and medium sized buildings and tenants. Central remote controller realizes the trouble support function, remote monitoring, and remote operation.










### 4-2. Individual control





Exterior	Part name	Model name	Summary
	Wired remote controller (Touch panel)	UTY-RNRUZ*	Easy finger touch operation with LCD panel. Backlight LCD enables easy operation in a dark room. Wire type: Non-polar 2-wire
	Wired remote controller	UTY-RNKU	Room temperature can be controlled by detecting the temperature accurately with built-in thermo sensor. Wire type: Polar 3-wire
	Simple remote controller	UTY-RSRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Non-polar 2-wire

Exterior	Part name	Model name	Summary
	Simple remote controller (Without operation mode)	UTY-RHRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting. Wire type: Non-polar 2-wire
	Simple remote controller	UTY-RSKU	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Polar 3-wire
	Simple remote controller (Without operation mode)	UTY-RHKU	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting. Wire type: Polar 3-wire
	Wireless remote controller	UTY-LNHU	Unit control is performed by wireless remote controller.






## 5. Adapter/Converter/Maintenance tool

Exterior	Part name	Model name	Summary
	Network converter	UTY-VTGX	Split type systems can be controlled from a central controller via the converter.
	Network converter (AC power supply)	UTY-VTGXV	Split type systems can be controlled from a central controller via the converter.
	Network converter	UTY-VGGXZ1	Split type systems can be controlled from a central controller via the converter. Group remote controller can be controlled up to two refrigerant systems via the converter.
	Network converter for LonWorks	UTY-VLGX	For connection between VRF network system and a LonWorks open network for management of small to medium-sized BMS.
	Modbus converter for VRF	UTY-VMGX	For connection between VRF network system and a Modbus open network.
	Modbus converter for indoor unit	UTY-VMSX	For connection between Single split indoor unit and a Modbus open network.
	BACnet gateway (Hardware)	UTY-VBGX	For connection between VRF network system to the BMS system using BACnet protocol. Supports max. 128 indoor units.
	BACnet gateway (Software)	UTY-ABGXZ1	The central control of maximum 1600 indoor units can be realized by connecting the VRF network system to the BACnet, a global standard for open network.
	Niagara driver for VRF	FUJ-VRF-8000 (Tridium part No.)	JACE8000. Niagara driver for VRF is a software driver for the Niagara framework. With the driver, direct connection of VRF system to Niagara system becomes possible using JACE, or Supervisor running on PC. Required: DR-FUJ-DEVICE-25 and/or DR-FUJ-DEVICE-50, NPB-8000-LON, SMA-8005-1YR-INIT Optional: WPM-8000 Later addition: DR-FUJ-DEV-UP-50

Exterior	Part name	Model name	Summary
	Signal amplifier	UTY-VSGXZ1	If the total length of transmission line exceeds 500m, or the number of units exceeds 64, a Signal amplifier will be necessary.
	External switch controller	UTY-TERX UTY-TEKX	Air conditioner switching can be controlled by connecting other external sensor switches.
	Service tool	UTY-ASGXZ1	Extensive monitoring and analysis functions for installation and maintenance. Operation status and error history can be grasped promptly and adequately.
	Web monitoring tool	UTY-AMGXZ1	Trouble free operation at all times by web monitoring system. The operation status of the VRF network system within the building can be monitored in real time over the Internet.

## 6. Cassette grille










Exterior	Model name	Remarks
 <p>For Compact cassette type</p>	UTG-CCGVG	Grid type grille
 <p>For Circular flow cassette type</p>	UTG-LCGVCW UTG-LCGVCB	
 <p>For 4-way flow cassette type</p>	UTG-LCGV	

## 7. Others


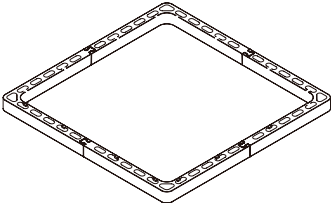








### 7-1. Parts list

**NOTE:** For applicable indoor unit type, refer to "[Applicable parts](#)" on page 10-24.

Exterior	Part name	Model name
	Flange (Square)	UTD-SF045T
	Flange (Round)	UTD-RF204
 × 2 pcs	Air filter	UTD-LF25NA
 × 2 pcs	Air filter	UTD-LF60KA
	Drain pump unit	UTZ-PX1BBA UTZ-PU1NBA
	Drain pump unit	UTR-DPB24T
	Air outlet shutter plate	UTR-YDZB
	Air outlet shutter plate	UTR-YDZK UTR-YDZC
	Pressure sensor kit	UTY-SPWX

Exterior	Part name	Model name
	Panel spacer	UTG-BGYA-W UTG-BKXA-W
	Wide panel	UTG-AGYA-W UTG-AKXA-W
	Half concealed kit	UTR-STA
	IR receiver unit	UTY-TRHX
	IR receiver unit	UTB-YWC
	IR receiver unit	UTY-LRHYB1
	IR receiver unit	UTY-LBHxD
	Human sensor kit	UTY-SHZXC
	Remote sensor unit	UTY-XSZX

Exterior	Part name	Model name
<p>Install when the condition under the roof is over 80% in humidity and over 86 °F (30 °C) in temperature.</p>  <p>Insulation kit</p>	Insulation kit for high humidity	UTZ-KXRA UTZ-KXGA UTZ-KXGB UTZ-KXGC
	Fresh air intake kit	UTZ-VXAA
	Fresh air intake kit	UTZ-VXGA UTZ-VXRA
	Auto louver grille kit	UTD-GXTA-W
	Auto louver grille kit	UTD-GXSA-W UTD-GXSB-W
	External power supply unit	UTZ-GXXA

Exterior	Model name
 For Outdoor unit	UTY-XWZXZ6
 For Indoor unit and Central remote controller	UTY-XWZXZ7
 For Central remote controller	UTY-XWZXZ8
 For Outdoor unit	UTY-XWZXZ9
 For Touch panel controller and Central remote controller	UTY-XWZXZA
 For Indoor unit	UTY-XWZXZB
 For Indoor unit	UTY-XWZXZC
 For Indoor unit	UTY-XWZXZD
 For Indoor unit	UTY-XWZXZE
 For Outdoor unit	UTY-XWZXZF

## 7-2. Applicable parts

### RELATED LINKS

"Indoor unit type and applicable control method" in Chapter 5. CONTROL SYSTEM on page 05-8

"Compatibility of VRF system" in Chapter 9. NOTES on page 09-9

### ■ For cassette type

Type	Air outlet shutter plate		Panel spacer	Wide panel
	UTR-YDZB	UTR-YDZK UTR-YDZC	UTG-BGYA-W UTG-BKXA-W	UTG-AGYA-W UTG-AKXA-W
Compact cassette	•			
Circular flow cassette		•	•	•
4-way flow cassette		•	•	•

Type	IR receiver unit		Human sensor kit	External power supply unit
	UTY-LRHYB1	UTY-LBHxD	UTY-SHZXC	UTZ-GXXA
Compact cassette				•
Circular flow cassette		•	•	•
4-way flow cassette	•			

Type	Fresh air intake kit	
	UTZ-VXAA	UTZ-VXRA
Compact cassette	•	
Circular flow cassette		•
4-way flow cassette		•

Type	Insulation kit for high humidity	
	UTZ-KXRA UTZ-KXGA	UTZ-KXGC
Compact cassette		•
Circular flow cassette	•	
4-way flow cassette	•	

Type	External connect kit				
	UTY-XWZXZ7	UTY-XWZXZB	UTY-XWZXZC	UTY-XWZXZD	UTY-XWZXZE
Compact cassette	•	•	•	•	•
Circular flow cassette	•	•	•	•	•
4-way flow cassette	•	•	•	•	•



## ■ For duct type

Type	Flange		Drain pump unit	Remote sensor unit
	UTD-SF045T	UTD-RF204	UTZ-PU1NBA	UTY-XSZX
Mini duct				●
Slim duct/Slim concealed floor				●
Medium static pressure duct	●	●	●	●
High static pressure duct				●

Type	External connect kit				
	UTY-XWZXZ7	UTY-XWZXZB	UTY-XWZXZC	UTY-XWZXZD	UTY-XWZXZE
Mini duct	●	●	●	●	●
Slim duct/Slim concealed floor	●	●	●	●	●
Medium static pressure duct	●	●	●	●	●
High static pressure duct	●	●	●	●	●

Type		IR receiver unit		Air filter		External power supply unit
	Model name	UTB-YWC	UTY-TRHX	UTD-LF25NA	UTD-LF60KA	UTZ-GXXA
Mini duct		●				●
Slim duct/Slim concealed floor			●			●
Medium static pressure duct			●	●		●
High static pressure duct	ARUH36TLAV	●			●	
	ARUH48TLAV	●			●	
	ARUH60TLAV	●			●	
	ARUH72TLAV2		●			●
	ARUH96TLAV2		●			●

Type		Auto louver grille kit		
	Model name	UTD-GXTA-W	UTD-GXSA-W	UTD-GXSB-W
Mini duct		●		
Slim duct/ Slim concealed floor	ARUL7TLAV2	●	●	
	ARUL9TLAV2	●	●	
	ARUL12TLAV2	●	●	
	ARUL14TLAV2	●	●	
	ARUL18TLAV2			●
Medium static pressure duct				
High static pressure duct				

## ■ For floor type, floor/ceiling type, and ceiling type

Type	Flange	Drain pump unit	Half concealed kit	External power supply unit
	UTD-RF204	UTZ-PU1EBA	UTR-STA	UTZ-GXXA
Compact floor			•	•
Floor/Ceiling				•
Ceiling	•	•		•

Type	External connect kit				
	UTY-XWZXZ7	UTY-XWZXZB	UTY-XWZXZC	UTY-XWZXZD	UTY-XWZXZE
Compact floor	•	•	•	•	•
Floor/Ceiling	•	•	•	•	•
Ceiling	•	•	•	•	•

## ■ For wall mounted type

Type	External connect kit				
	UTY-XWZXZ7	UTY-XWZXZB	UTY-XWZXZC	UTY-XWZXZD	UTY-XWZXZE
Wall mounted	•	•	•	•	•

Type		External power supply unit			
		UTZ-GXXA			
Wall mounted	Model name				
	ASUA4TLAV2	•			
	ASUA7TLAV2	•			
	ASUA9TLAV2	•			
	ASUA12TLAV2	•			
	ASUA14TLAV2	•			
	ASUB18TLAV1				
	ASUB24TLAV1				
	ASUA30TLAV2	•			
	ASUA36TLAV2	•			
	ASUA7TLAV				
	ASUA9TLAV				
	ASUA12TLAV				
	ASUA14TLAV				
	ASUB18TLAV				
	ASUB24TLAV				

## ■ For others

Type	External connect kit			
	UTY-XWZXZ6	UTY-XWZXZ7	UTY-XWZXZ8	UTY-XWZXZ9
Outdoor unit	•			•
Touch panel controller				
Central remote controller		•	•	

Type	External connect kit	
	UTY-XWZXZA	UTY-XWZXZF
Outdoor unit		•
Touch panel controller	•	
Central remote controller	•	

## 8. Optional parts installation

### 8-1. Drain pump unit for duct type


#### RELATED LINKS

"Applicable parts" on page 10-24


#### ■ Specifications

Model name		UTZ-PU1NBA
Height of drain up	in (mm)	Maximum 39-3/8 (1,000)
Power source		220—240 V, 50/60 Hz
Power input (230 V, 50/60 Hz)	W	12/10.8
Current (230 V, 50/60 Hz)	mA	114/92
Dimensions (H × W × D)	in (mm)	6-15/16 × 7 × 6-1/16 (176 × 178 × 154)
Weight	lb (kg)	6 (2.5)
Connection pipe diameter	in (mm)	I.D.: 3/4 (19.05), O.D.: 1-1/16 (27)
Direction of pipe connection*1		360°
Angle of pipe connection *2		0° to 90° (Horizontal to vertical)
Control method		Control board of indoor unit
Safety device		Float switch, Thermal fuse

\*1: Direction of pipe connection




\*2: Angle of pipe connection






## • Installing

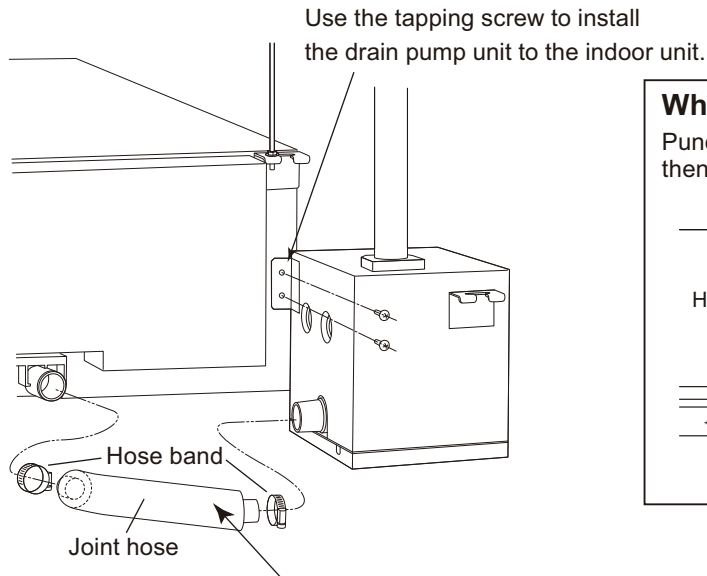


### When there is no screw hole

Unit : mm



Puncture holes at the following position and then install.

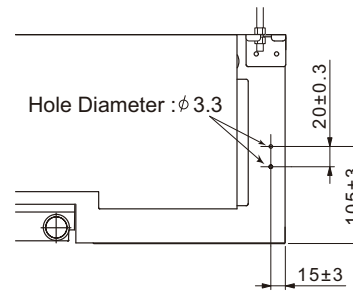




Thread the hose band through the joint hose, and insert it until it touches the drain pump unit and indoor unit.

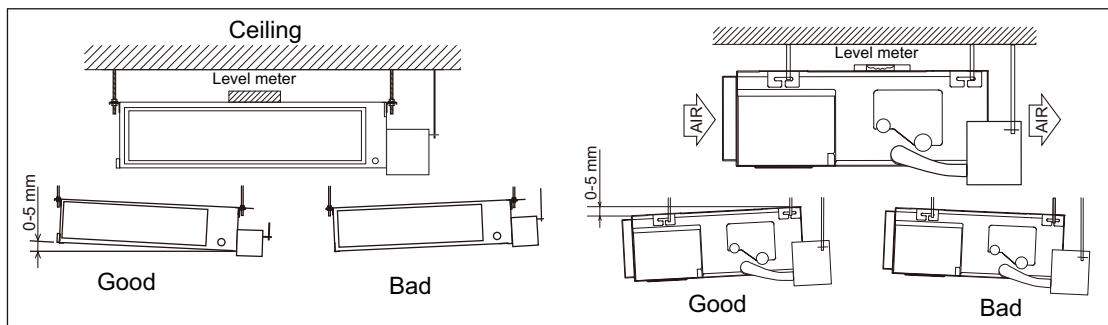

## • Installing hose

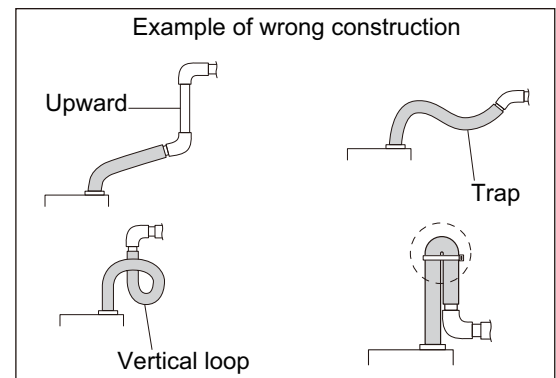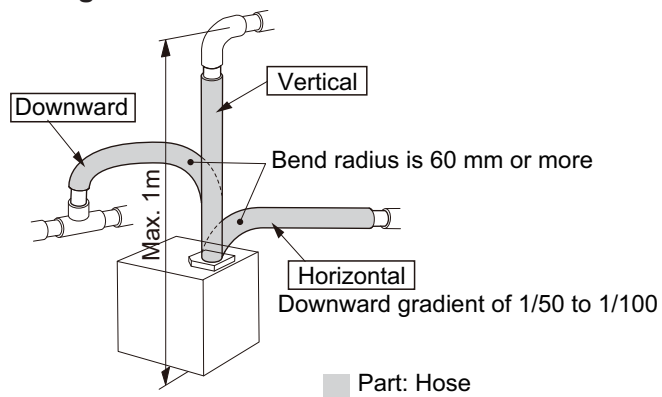

## • Installing pipe

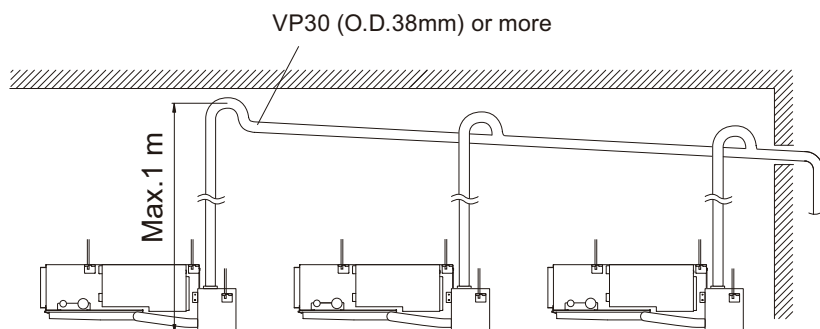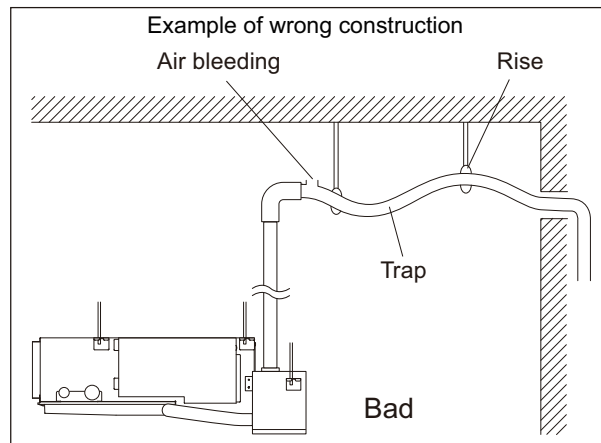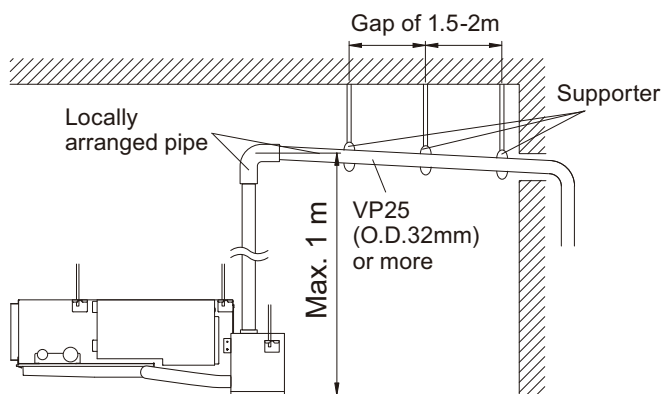


For construct centralized drain pipe fittings, refer to the electrical wiring.

## ● Model: UTZ-PU1NBA

### • Mounting position



Unit: in (mm)

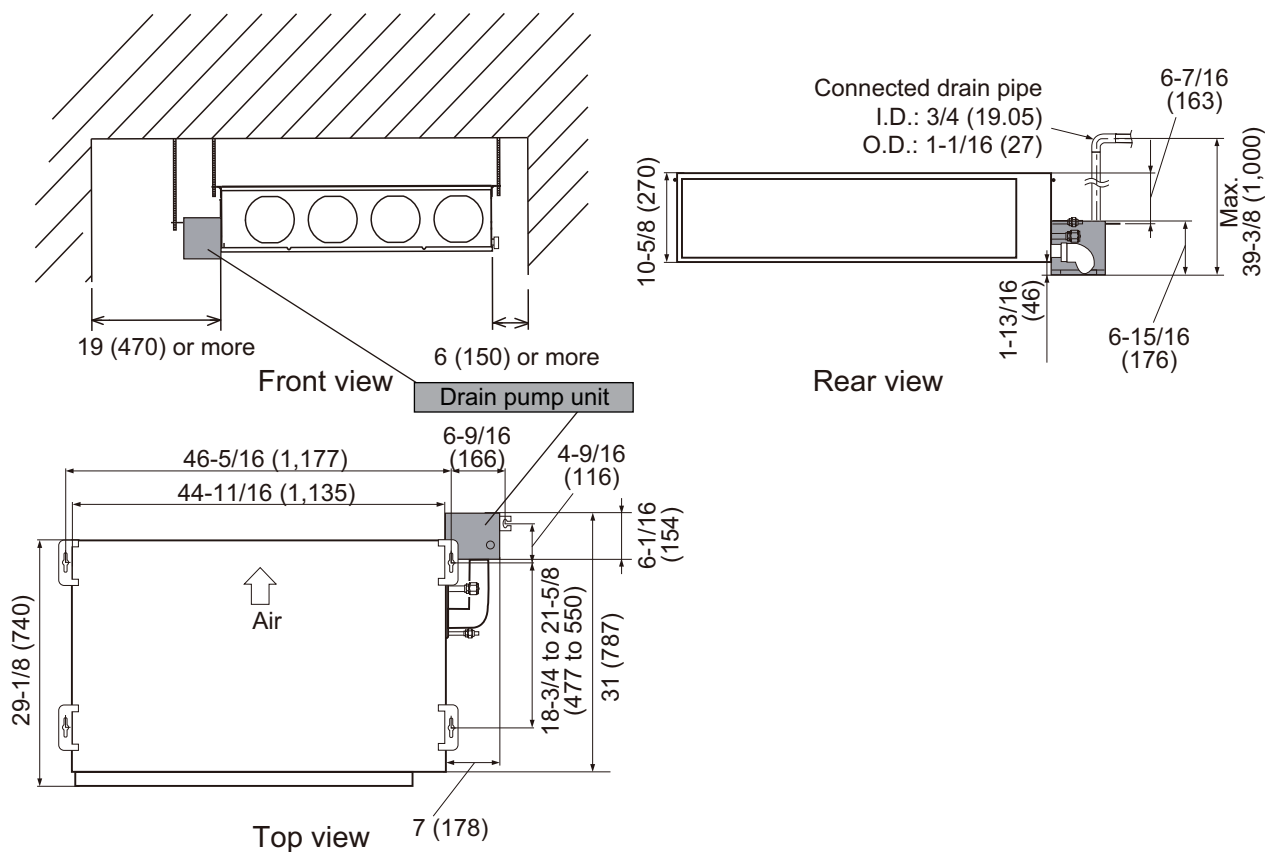



### NOTES:

- Leave the space required to service the unit.
- Set a maintenance hole near the drain pump unit.


## • Installing

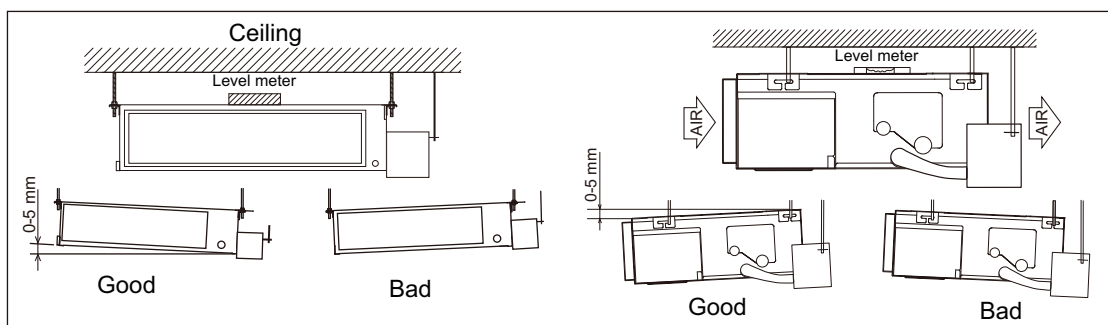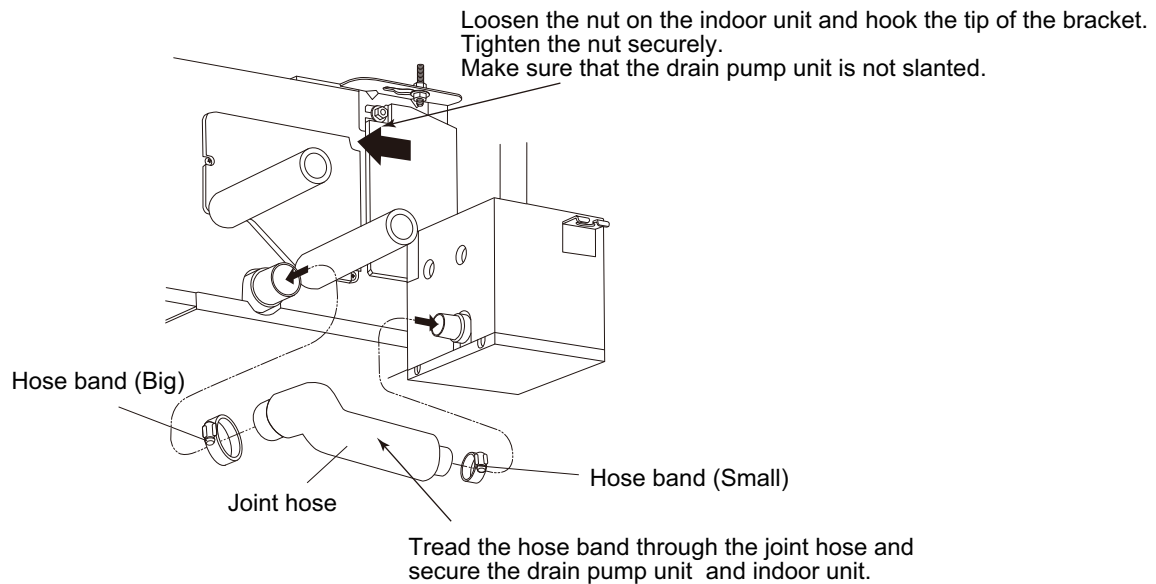

## • Installing hose

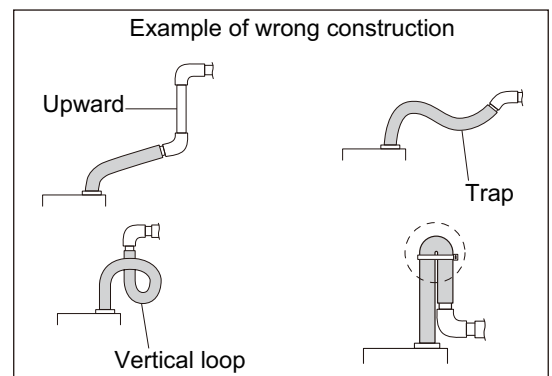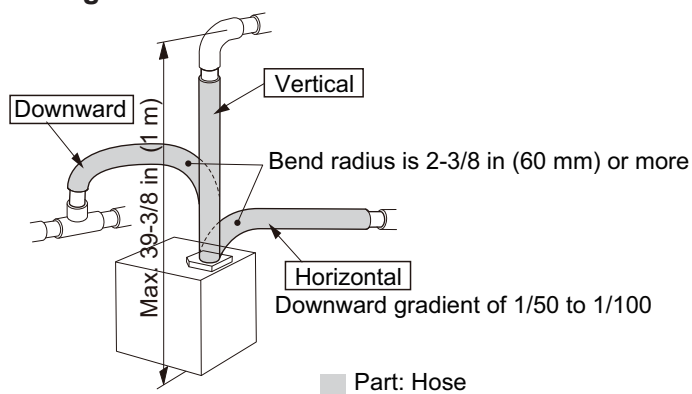


## • Installing pipe

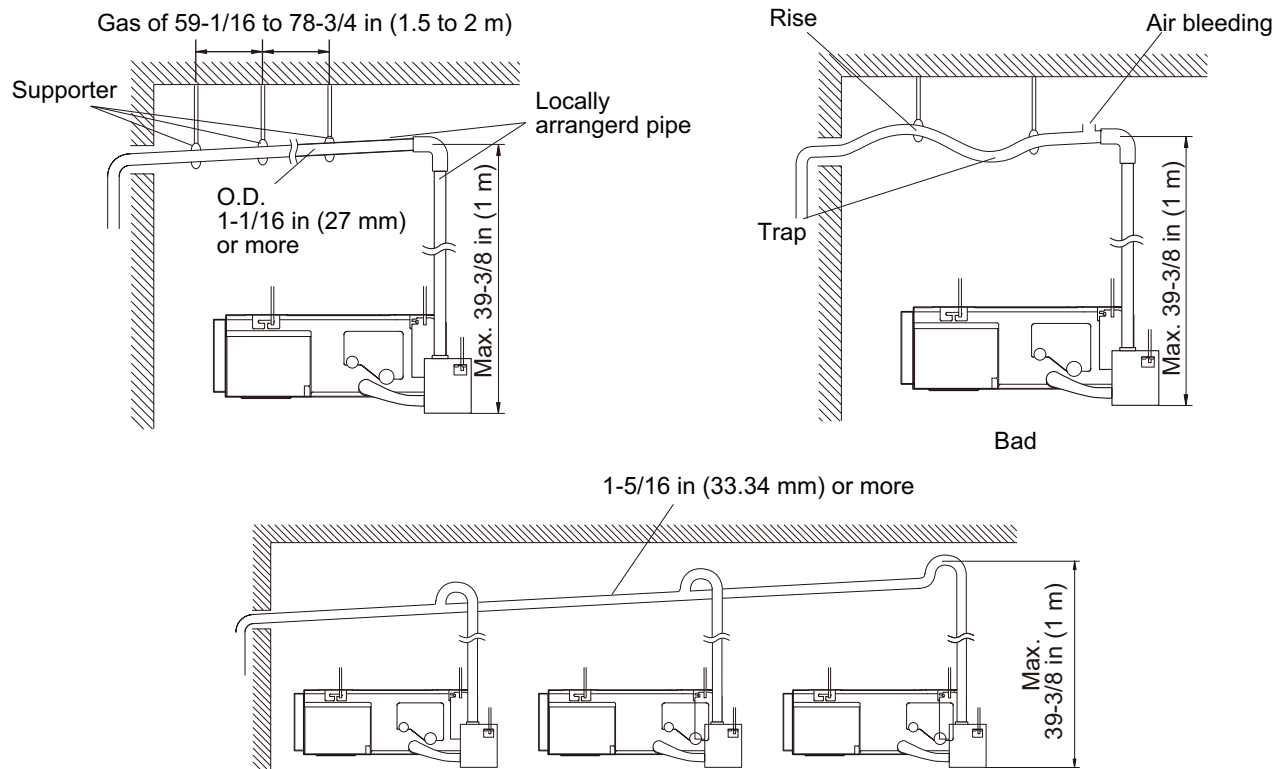

For construct centralized drain pipe fittings, refer to the electrical wiring.


## ■ Electrical wiring

### ● Model: UTZ-PX1BBA

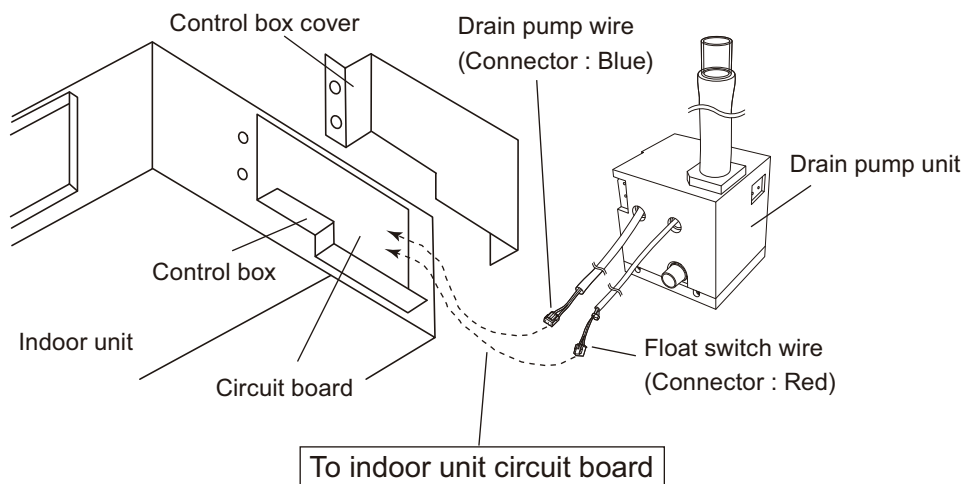



## ● Model: UTZ-PU1NBA

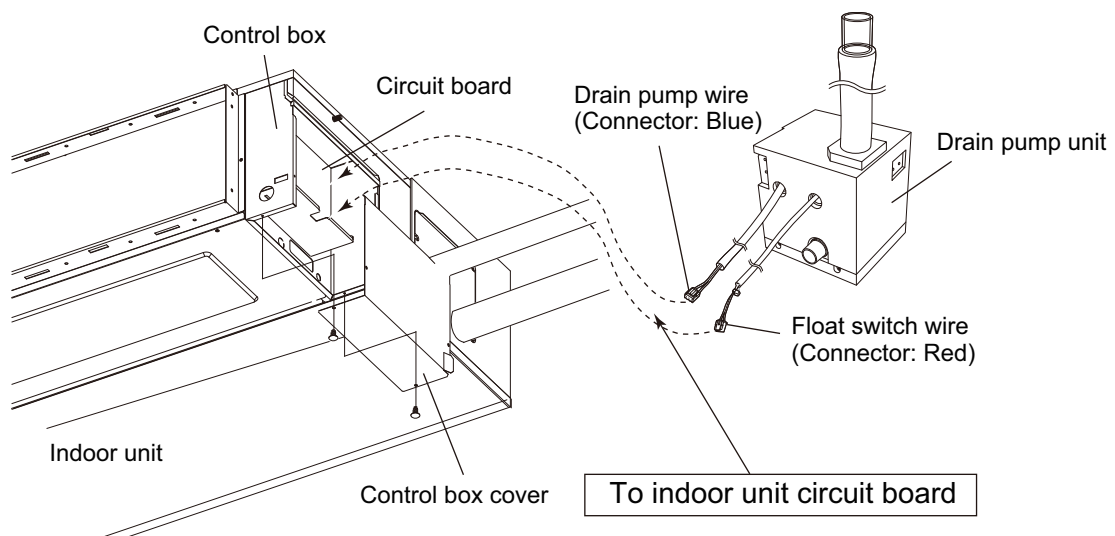


## 8-2. Drain pump unit for Ceiling type

### RELATED LINKS


"Applicable parts" on page 10-24

### ■ Installing drain pump unit and electrical wiring

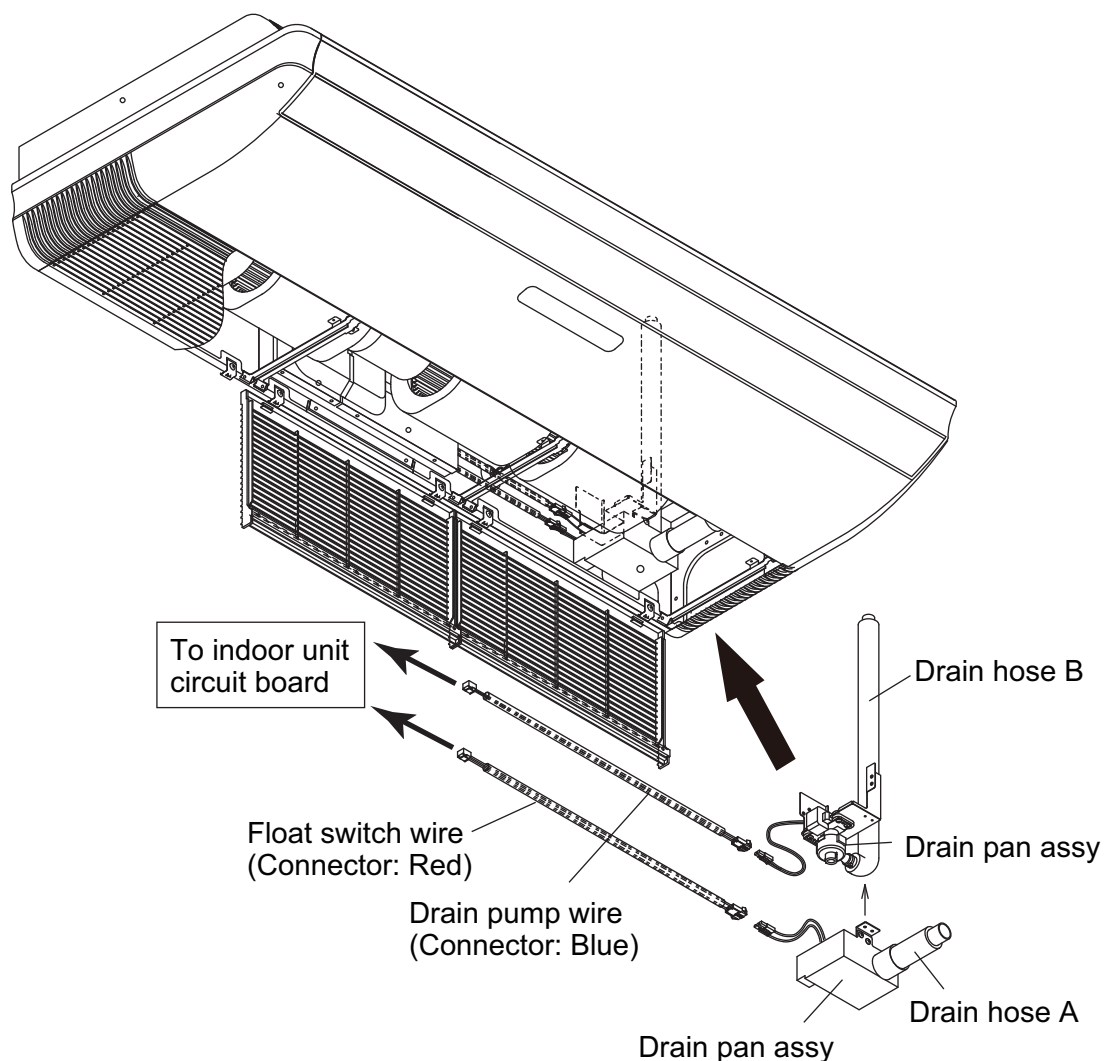

### ■ Installing pipe

- Set up the drain hose for a maximum rise 19-11/16 in (500 mm) and give the drain pipe a downward gradient of 1/25 to 1/100.
- Install the drain pipe so there is no rise, trap, or air bleed.

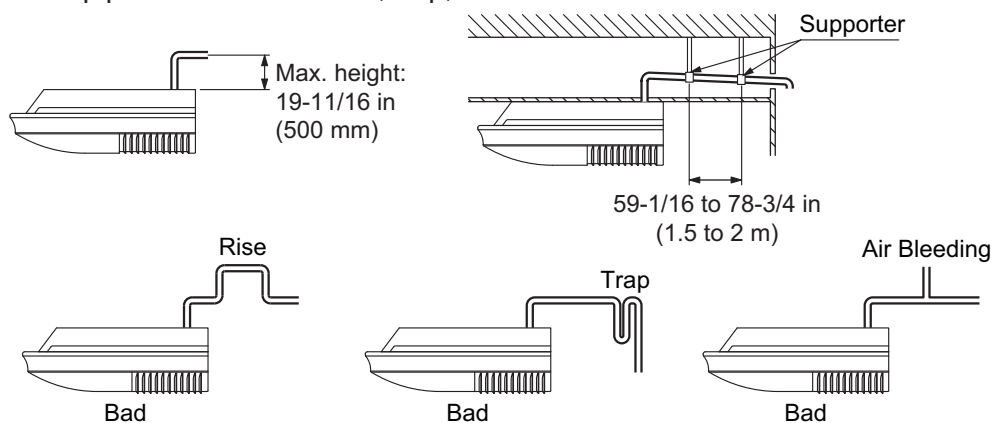

## 8-3. Fresh air intake kit for Compact cassette type

### RELATED LINKS


"Applicable parts" on page 10-24

### Specifications

Model name			UTZ-VXAA
Fresh air intake	Max. fresh air intake volume	% (For High)	10
Connection duct type		in (mm)	Ø3-15/16 (100)
		Pcs	1
Dimensions (H × W × D)	Net	in (mm)	4-3/4 × 22-7/16 × 22-7/16 (120 × 570 × 570)
	Gross		6-1/2 × 23-1/16 × 23-1/16 (165 × 585 × 585)
Weight	Net	lb (kg)	8 (3.5)
	Gross		12 (5.5)


### Dimensions

Unit: in (mm)

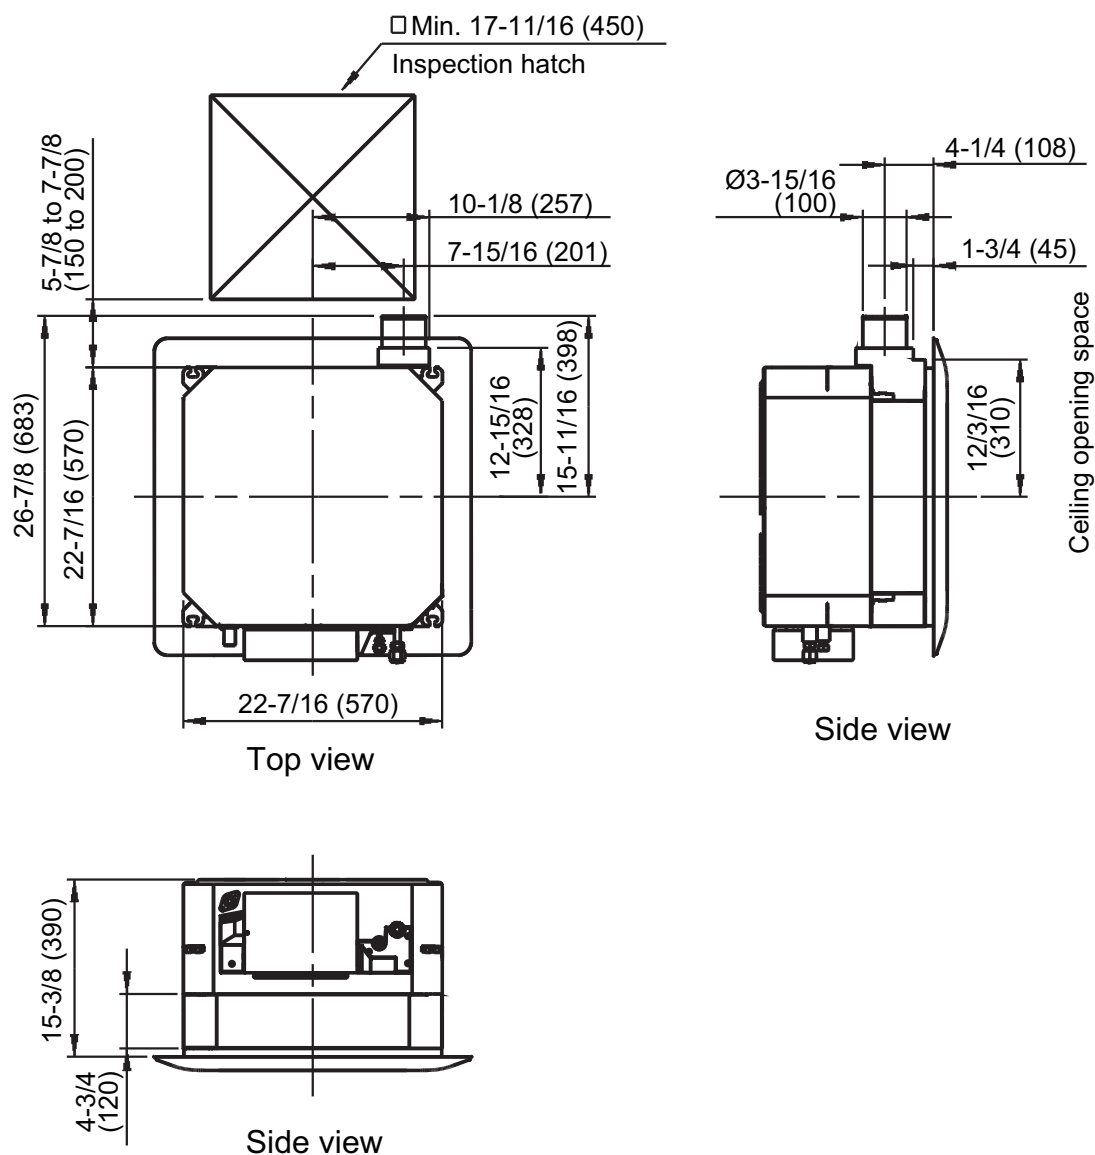


**NOTE:** When installing this kit, inspection hatch is necessary. (It is necessary when servicing.)

## ■ Airflow

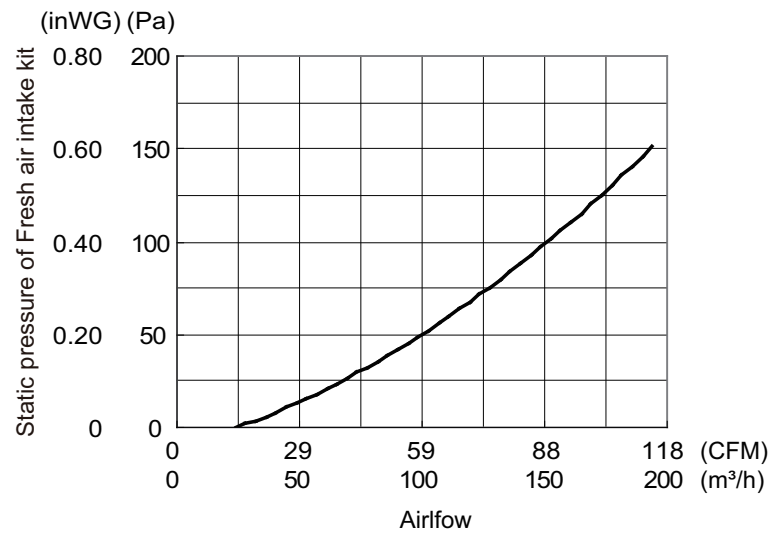

Unit: in (mm)

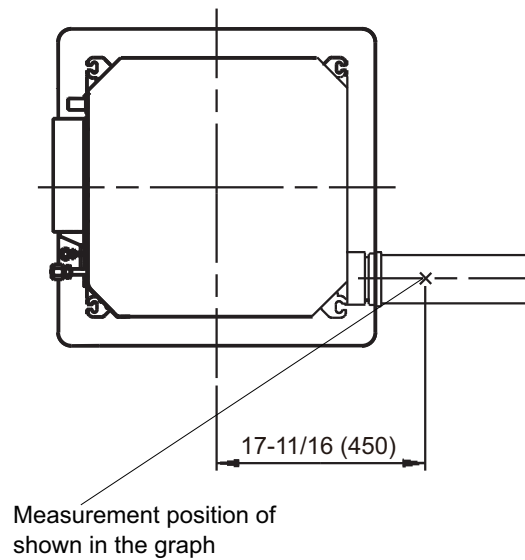

## ■ Fresh air control output


- You can control duct fan by synchronization with fan operation of indoor unit.
- Wire for fresh air control output is supplied with Fresh air intake kit.
- Extended length of the wire: Max. 82 ft (25 m).

### • Connection diagram

For Relay

Output voltage: DC 12<sup>+</sup>2 V


Permissible current: 50 mA

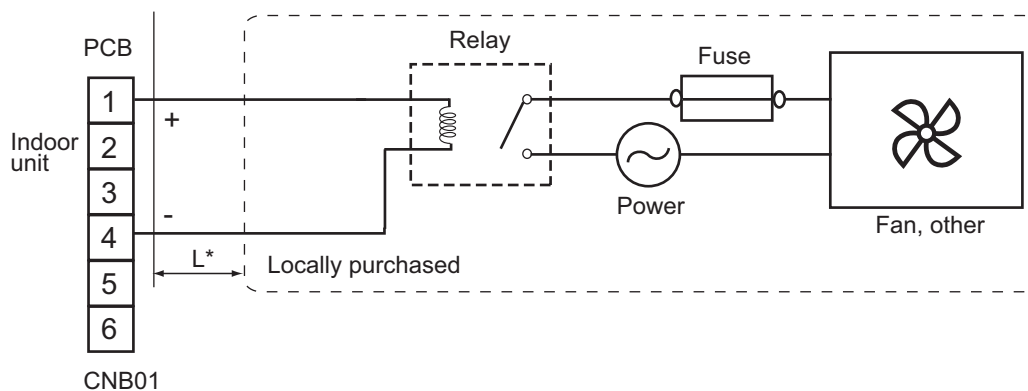


Actual number of pin might be different from the figure above.

L\*: Make the distance from the PCB to the Relay unit within 82 ft (25 m).

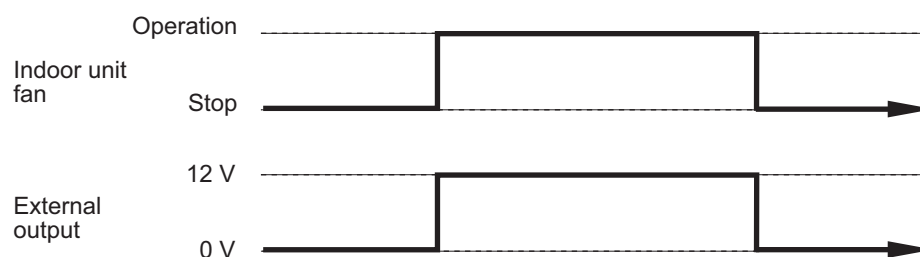











### • Operation status

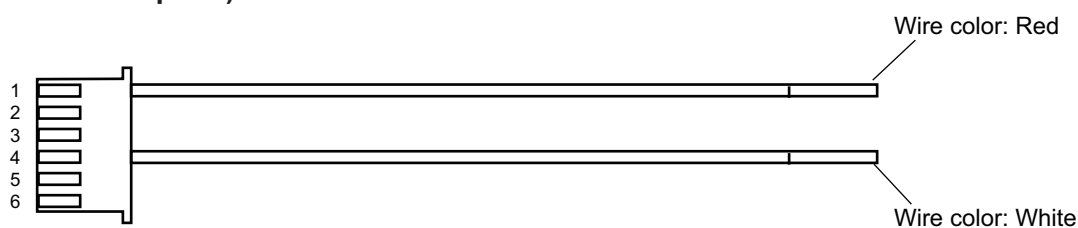

### • Wire (External output 3)



## ■ Accessories

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Wire (External output 1)		1
Chamber		1	Wire (External output 2)		1
Wire cover		1	Wire (External output 3)		1
Screw		4	Bolt		4
Extension wire for louver		1 set	Cable tie		1
Extension wire for receiver kit (For 9-pin receiver wire)		1	Extension wire for receiver kit (For 7-pin receiver wire)		1

## ■ Installation precautions

### • About Fresh air intake kit

- The Fresh air intake kit can be installed onto cassette type air conditioners.
- The volume of ventilated air provided by the Fresh air intake kit may be unable to fulfill ventilation regulations in all countries. On such occasions we ask that this kit be used along with Energy recovery ventilators.
- When intaking outside air, ensure correct air conditioning design as based on air conditioning load calculations. As outside air is not being processing an increase in outside air load can affect air conditioning.

### • Installation location

- Area that generated substances that adversely affect the equipment, such as sulfuric gas, chlorine gas, acid, or alkali it will cause the copper pipes and brazed joints to corrode, which can cause refrigerant leakage.
- Area with high salt content, such as at the seaside. It will deteriorate metal parts, causing the parts to fall or the unit to leak water.
- Be certain to use electric dampers and shutters to avoid infiltration of cold air, wind and fog during shutdown in areas with cold climate, strong winds, or where fogs are common.
- Ensure the product is installed a distance of at least three times the duct diameter away from exterior wall air inlets, or air exhausts for the prevention of short circuits.

### • Temperature conditions

- Condensation may form on the product when outside air temperature is low and the temperature and humidity surrounding the product are high. Do not intake the air of below 32 °F (0 °C) into the Fresh air intake kit.
- Do not take fresh air at a temperature that exceeds the upper limit of the operation temperature range of the outdoor unit.

### • About duct fan

- When installing the duct fan, connect the drive relay (locally purchased) and operate with the indoor unit.
- Ensure the intake air volume is below 10 % of the product's air volume High. When the intake air volume becomes too large there the operating noise may increase and room temperature detection may be affected.

### • About the duct connection


- Purchase a duct with internal diameter that fits the external diameter of the duct flange.
- Note that regulations of some countries may require the use of a nonflammable duct.
- IF the duct penetrates a fire-retarding division or other fire-proofing measures, the installation of fire dampers, or a construction that does not adversely affect fire control measure is a regulatory requirement of some countries.
- When using metallic ducts, ensure metals (i.e., metal lath, wire lath, stainless sheeting) are electrically insulated. (A short occurring by electrical connection can cause fire.)
- Ensure the thermally insulate connected ducts to prevent condensation.
- Make certain that netting or other measures are installed in parts exposed to the outside air to prevent infiltration of small animals such as birds and insects.
- Be certain to install external air filters to parts exposed to the outside air for heat exchanger protection of indoor equipment.
- Avoid the infiltration of rain water by installing outside ducts with an incline of at least 1/30, and fitting hoods on openings.
- Do not branch the connecting duct into multiple rooms.

## ■ Installation

### ● Mounting of indoor unit

- For mounting, refer to the installation manual provided with indoor unit.
- When installing this product to existing indoor units, adjust the installation height of the indoor units to height 9-7/16 to 9-21/32 in (240 to 245 mm) as shown below.

Unit: in (mm)

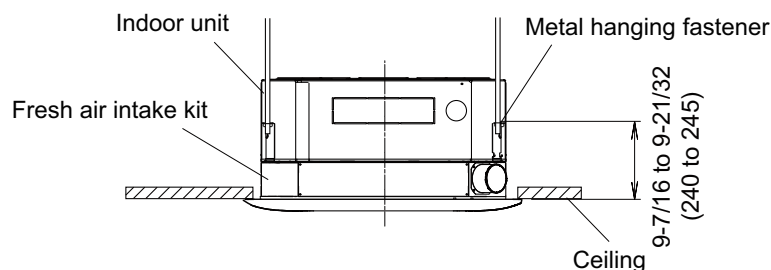


### ● Installation of Fresh air intake kit

#### ⚠ CAUTION

Installing the Fresh air intake kit with wrong direction is a cause of water leakage.


1. Attach the Fresh air intake kit to the main body using the bolts provided as shown below.

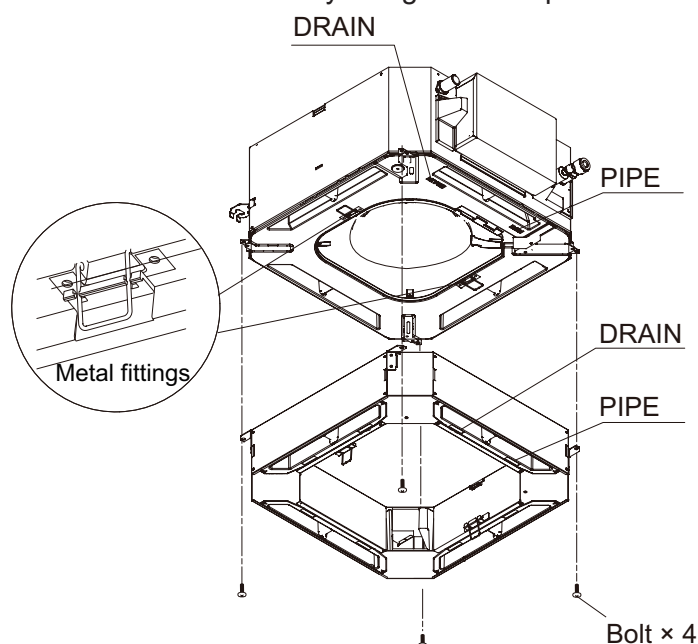




## 2. Install the chamber.

Fit the four-sided holes of the chamber together with the hook fittings of the Fresh air intake kit (in two places), and secure the attached chamber in place with screws provided.

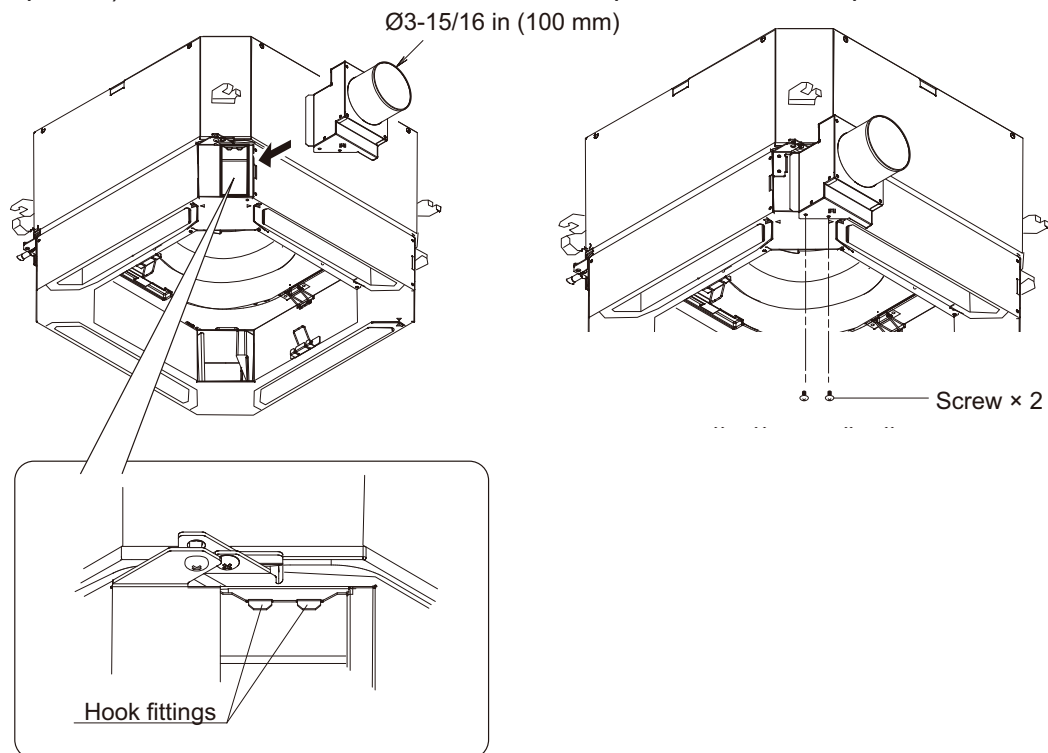

- When using the Insulation kit for high humidity (UTZ-KXGC), first cut off and remove the heat insulation as shown in the figure.
- Install the Insulation kit for high humidity according to the installation instruction sheet provided.

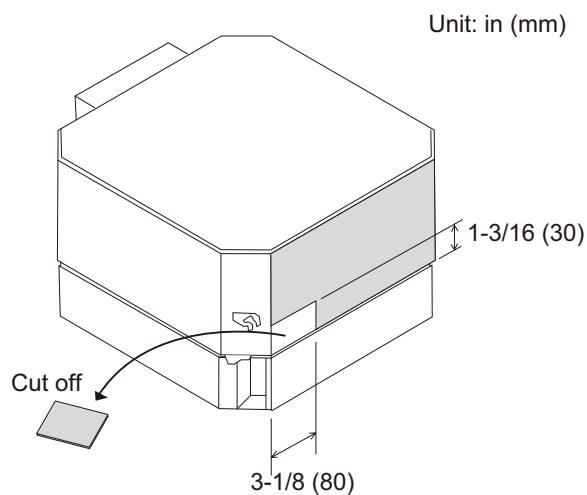


## 3. Install the duct.

Fasten the connecting parts of the ducts with band, and wrap with vinyl tape to ensure no air leaks. (Carry out the work to ensure no air leakage at a pressure of 0.80 inWG [200 Pa].)

**NOTE:** Do not construct the duct in the manner of below.

- Extreme bends
- Highly repetitive bends
- Making the connecting duct diameters smaller


Completion figure

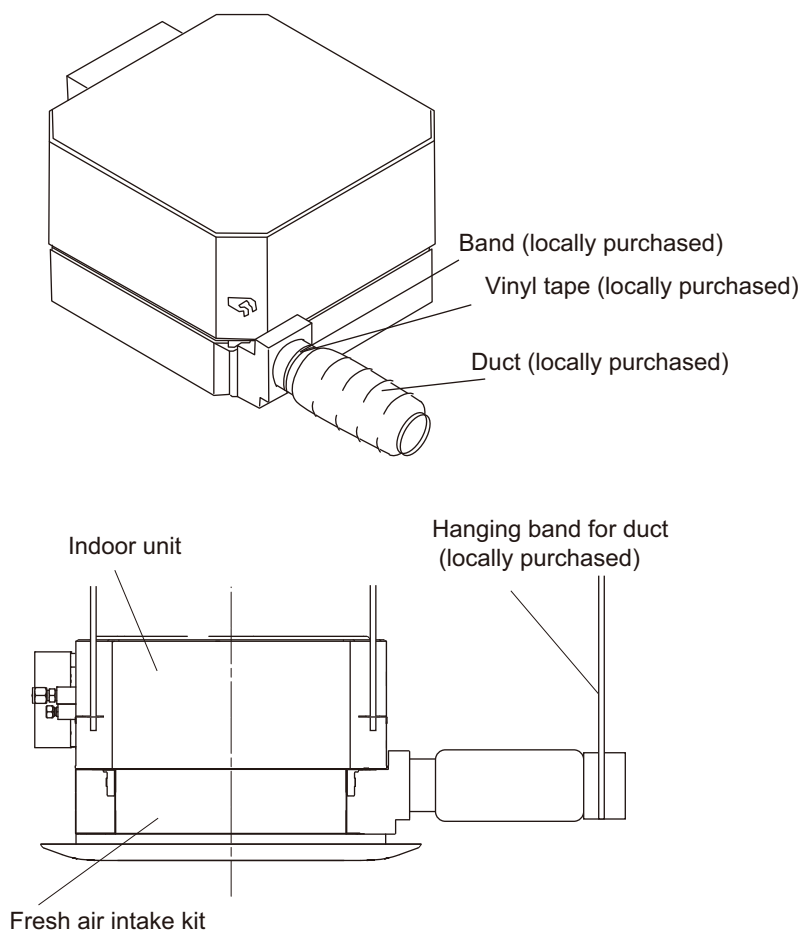

**NOTE:** When wiring of the duct fan is required, refer to ["Fresh air control output"](#) on page 10-37.


## ● Installation of Cassette grille

1. Connect extension wire for use with louvers, or extension wire for optical receiver after provisional attaching of the decoration panel.
2. Tie the wires together with the fasteners provided and insert into the hole of the Fresh air intake kit.
3. Install the wire-cover provided on the Fresh air intake kit.
4. Install decoration panel according to the installation instruction sheet provided.

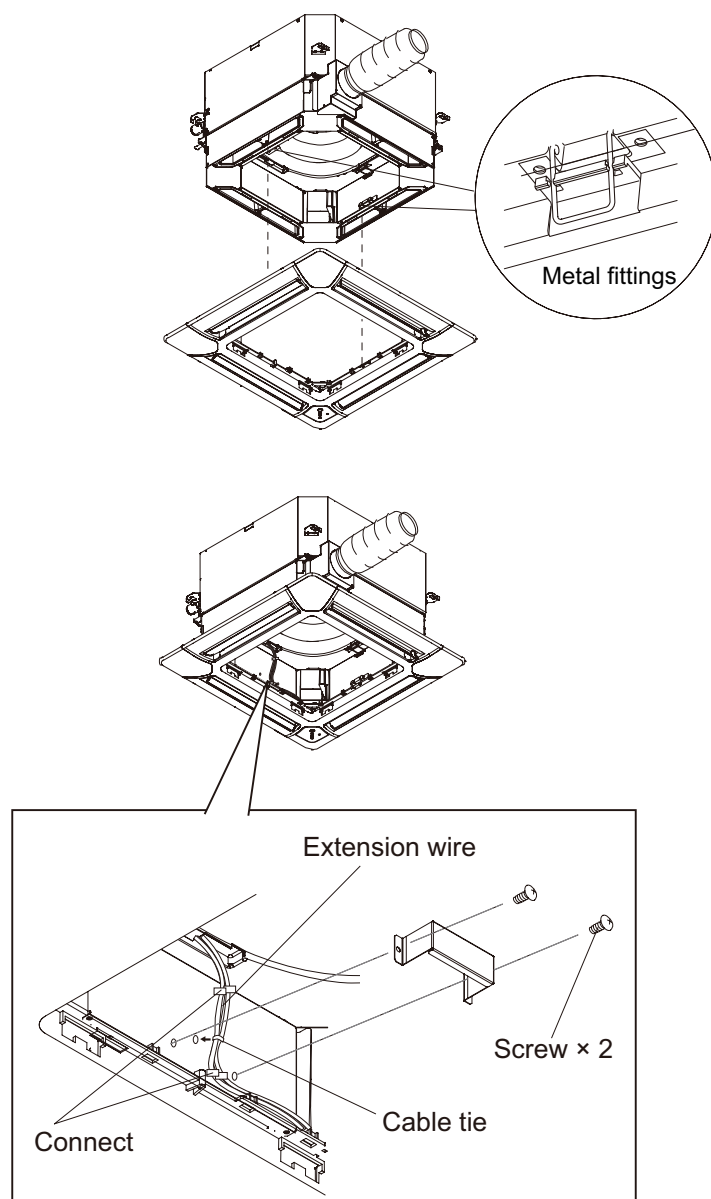


## ■ Installation example


- Standard

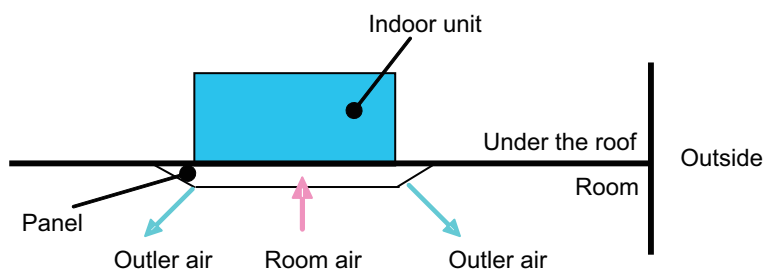

- Case 1: Intake by fan of indoor unit

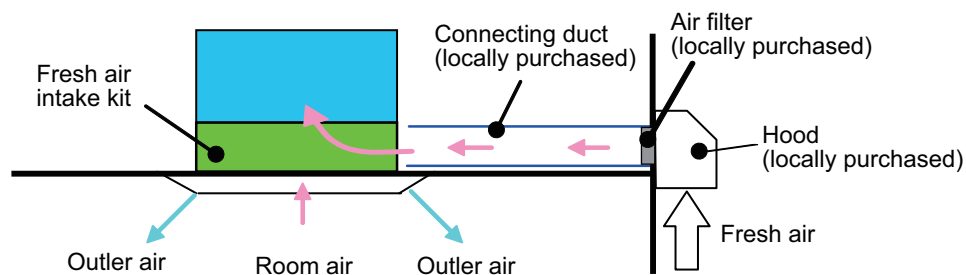

- Case 2: Intake by duct fan

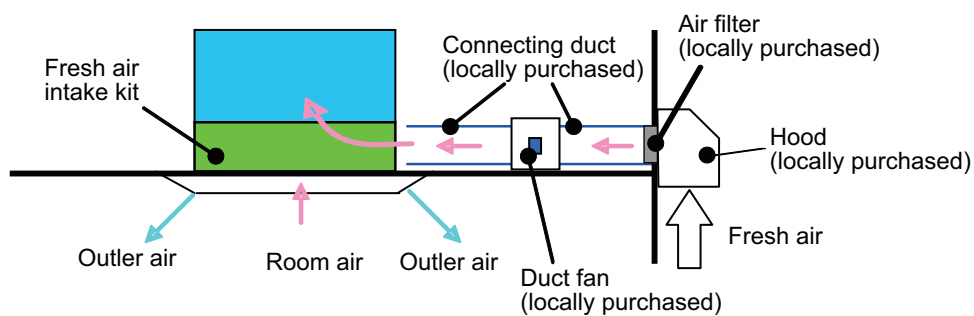

## 8-4. Fresh air intake kit for Circular flow cassette type and 4-way flow cassette type

### RELATED LINKS


"Applicable parts" on page 10-24

### Specifications

Model name				UTZ-VXRA	
Fresh air intake	Max. fresh air intake volume	2-way intake	%	10	
		1-way intake		5	
Connection duct type			in (mm)	Ø3-15/16 (100)	
			Pcs	2	
Dimensions (H × W × D)		Net	in (mm)	4-3/4 × 33-1/16 × 33-1/16 (120 × 840 × 840)	
		Gross		6-1/2 × 33-7/8 × 33-7/8 (165 × 860 × 860)	
Weight		Net	lb (kg)	13.2 (6.0)	
		Gross		20.9 (9.5)	


### Dimensions

Unit: in (mm)


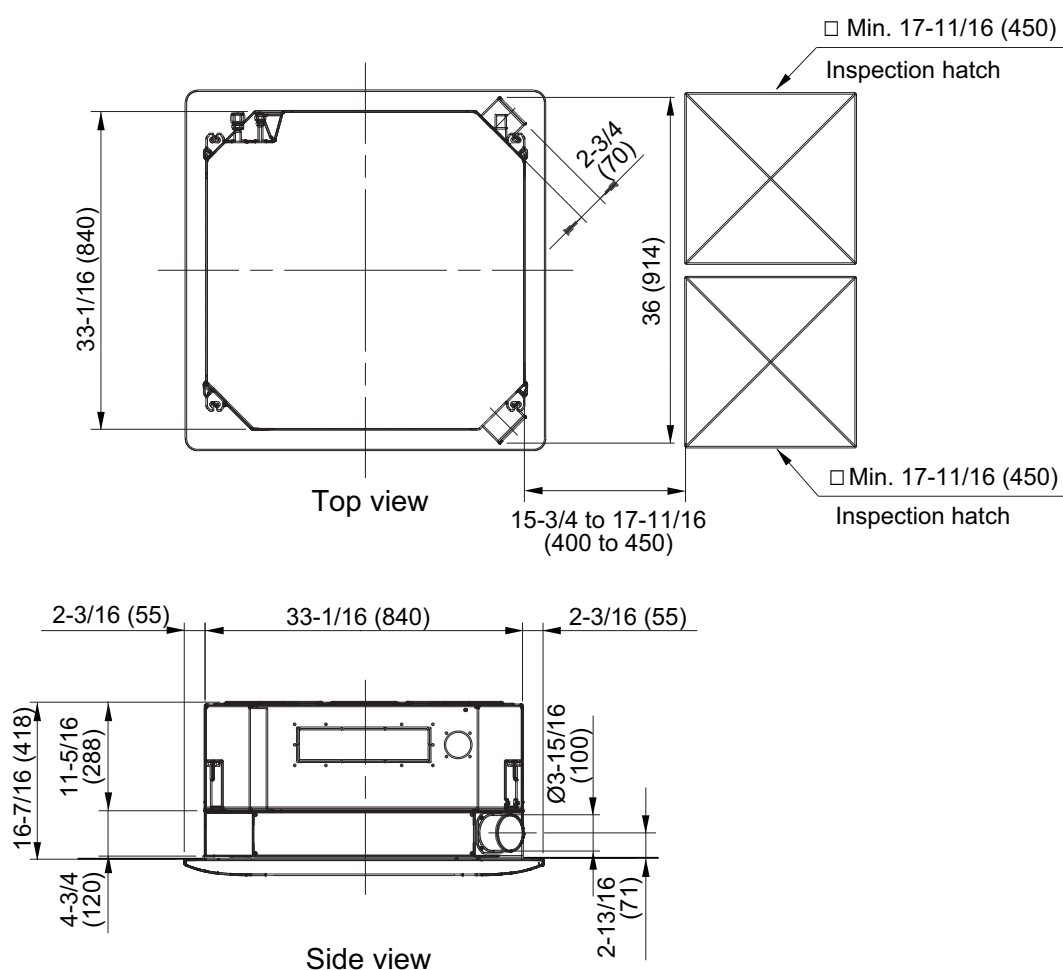


**NOTE:** When installing this kit, inspection hatch is necessary. (It is necessary when servicing.) Either one of inspection hatches must be installed.

## Airflow

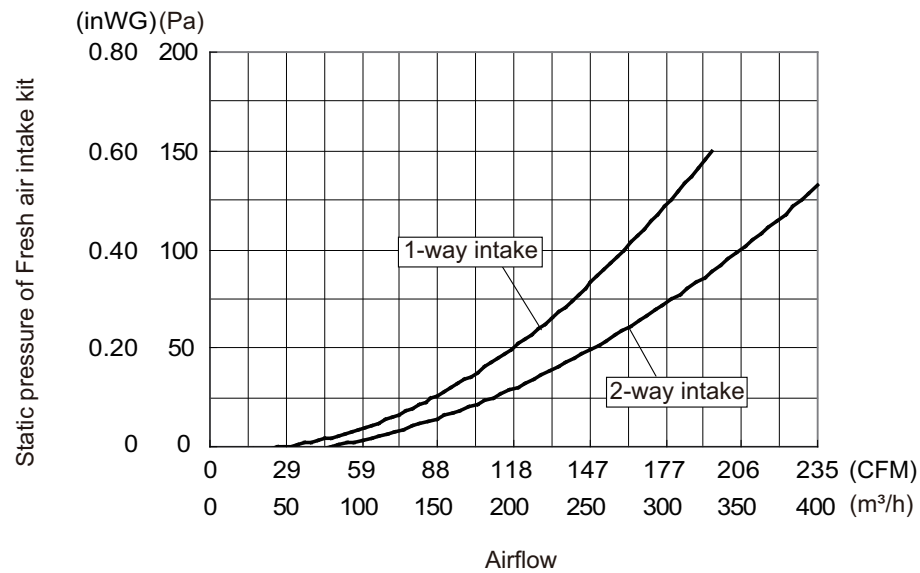

Unit: in (mm)

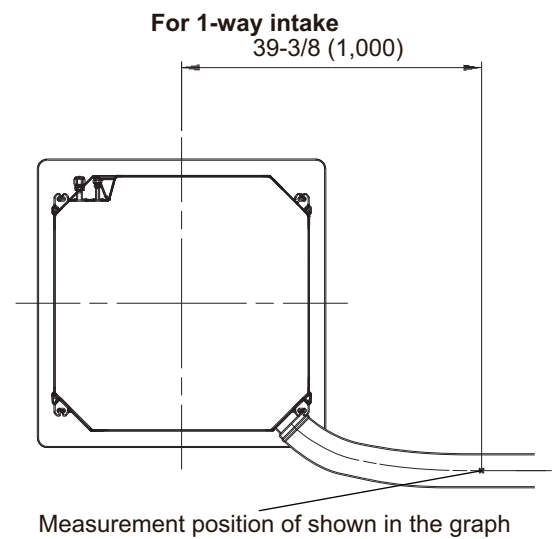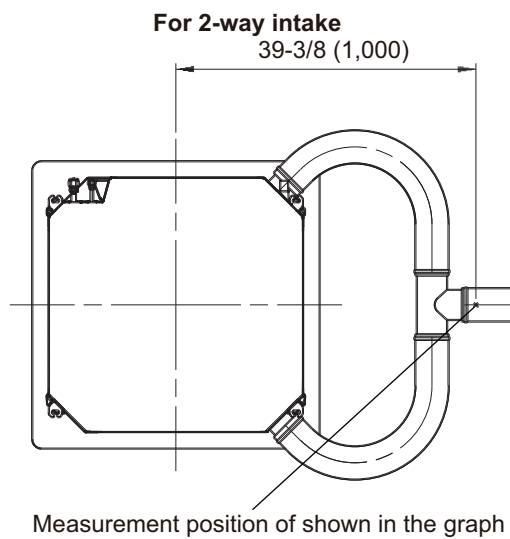

## ■ Fresh air control output


- You can control duct fan by synchronization with fan operation of indoor unit.
- Wire for fresh air control output is supplied with Fresh air intake kit.
- Extended length of the wire: Max. 82 ft (25 m).

### • Connection diagram

For Relay

Output voltage: DC 12<sup>+</sup>2 V


Permissible current: 50 mA

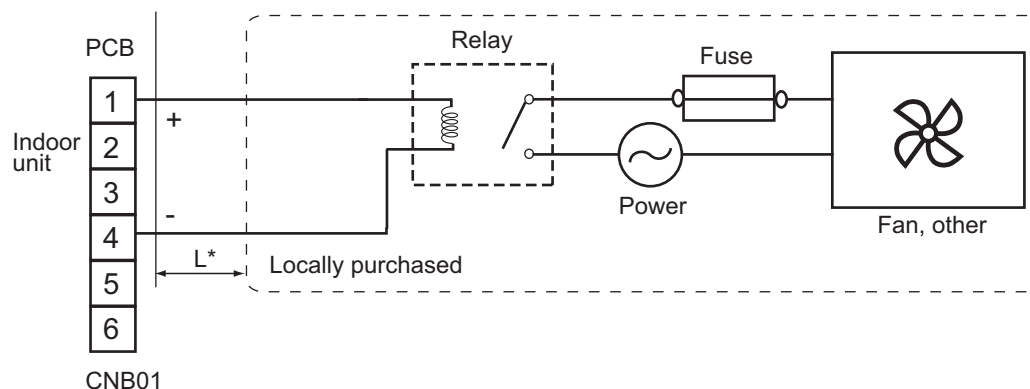


Actual number of pin might be different from the figure above.

L\*: Make the distance from the PCB to the Relay unit within 82 ft (25 m).

### • Operation status

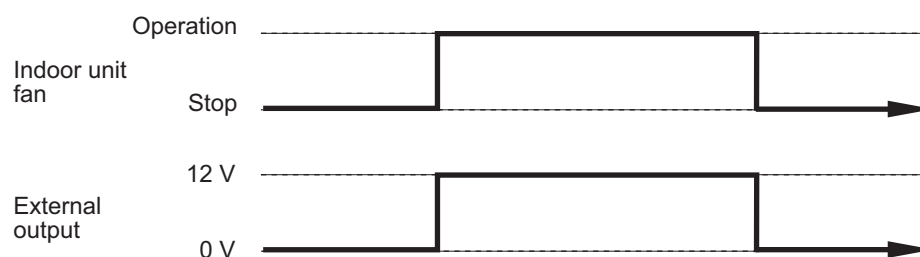



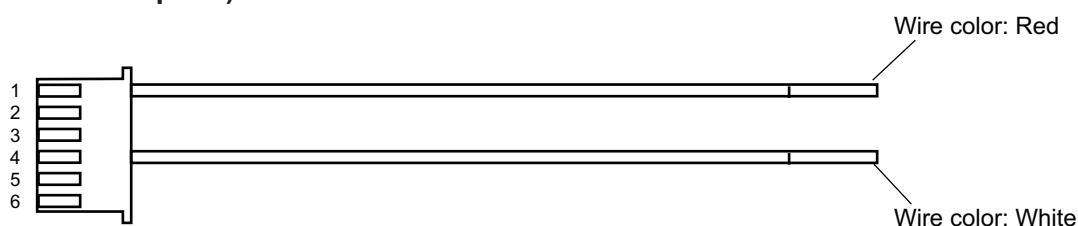















### • Wire (External output 3)




















## ■ Accessories

### ● UTZ-VXRA

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Insulation 3		3
Installation manual (For UTZ-VXGA)		1	Insulation 4		4
Duct flange		2	Cable tie (For UTZ-VXGA)		1
Cover		2	Extension wire for louver (For UTZ-VXGA)		1 set
Screw		16	Extension wire for receiver kit (For UTZ-VXGA)		1
Hook plate		2 set	Wire (External output 1) (For Single split or Multi system)		1
Shutter plate		1	Wire (External output 2) (For UTZ-VXGA)		1
Insulation 1		2	Wire (External output 3)		1
Insulation 2		1	Bolt		4



# ● UTZ-VXGA

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Insulation 4		4
Duct flange		2	Cable tie		1
Cover		2	Extension wire for louver		1 set
Screw		16	Extension wire for receiver kit		1
Hook plate		2 set	Wire (External output 1)		1
Shutter plate		1	Wire (External output 2)		1
Insulation 1		2	Wire (External output 3)		1
Insulation 2		1	Bolt		4
Insulation 3		3			

## ■ Installation precautions

### • About Fresh air intake kit

- The Fresh air intake kit can be installed onto cassette type air conditioners.
- The volume of ventilated air provided by the Fresh air intake kit may be unable to fulfill ventilation regulations in all countries. On such occasions we ask that this kit be used along with Energy recovery ventilators.
- When intaking outside air, ensure correct air conditioning design as based on air conditioning load calculations. As outside air is not being processing an increase in outside air load can affect air conditioning.

### • Installation location

- Area that generated substances that adversely affect the equipment, such as sulfuric gas, chlorine gas, acid, or alkali it will cause the copper pipes and brazed joints to corrode, which can cause refrigerant leakage.
- Area with high salt content, such as at the seaside. It will deteriorate metal parts, causing the parts to fall or the unit to leak water.
- Be certain to use electric dampers and shutters to avoid infiltration of cold air, wind and fog during shutdown in areas with cold climate, strong winds, or where fogs are common.
- Ensure the product is installed a distance of at least three times the duct diameter away from exterior wall air inlets, or air exhausts for the prevention of short circuits.

### • Temperature conditions

- Condensation may form on the product when outside air temperature is low and the temperature and humidity surrounding the product are high. Do not intake the air of below 32 °F (0 °C) into the Fresh air intake kit.
- Do not take fresh air at a temperature that exceeds the upper limit of the operation temperature range of the outdoor unit.

### • About duct fan

- When installing the duct fan, connect the drive relay (locally purchased) and operate with the indoor unit.
- Ensure the intake air volume is below 10 % of the product's air volume High. When the intake air volume becomes too large there the operating noise may increase and room temperature detection may be affected.

### • About the duct connection


- Purchase a duct with internal diameter that fits the external diameter of the duct flange.
- Note that regulations of some countries may require the use of a nonflammable duct.
- IF the duct penetrates a fire-retarding division or other fire-proofing measures, the installation of fire dampers, or a construction that does not adversely affect fire control measure is a regulatory requirement of some countries.
- When using metallic ducts, ensure metals (i.e., metal lath, wire lath, stainless sheeting) are electrically insulated. (A short occurring by electrical connection can cause fire.)
- Ensure the thermally insulate connected ducts to prevent condensation.
- Make certain that netting or other measures are installed in parts exposed to the outside air to prevent infiltration of small animals such as birds and insects.
- Be certain to install external air filters to parts exposed to the outside air for heat exchanger protection of indoor equipment.
- Avoid the infiltration of rain water by installing outside ducts with an incline of at least 1/30, and fitting hoods on openings.
- Do not branch the connecting duct into multiple rooms.

## ■ Installation

### ● Mounting of indoor unit


- For mounting, refer to the installation manual provided with indoor unit.
- When installing this product to existing indoor units, adjust the installation height of the indoor units to height 10-1/4 to 10-7/16 in (260 to 265 mm) as shown below.

Unit: in (mm)

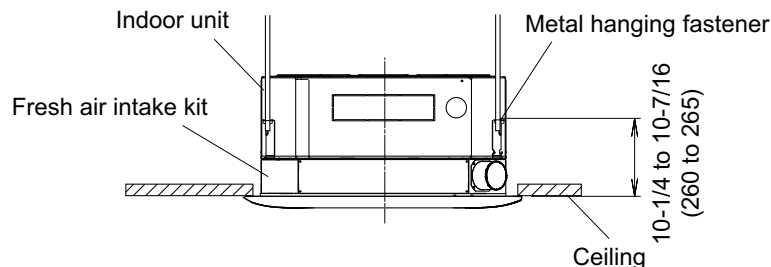


### ● Pre-installation preparations

- Attach the duct flange provided with screws.
- The Fresh air intake kit can be used as an external air intake on just one side. Use included sealed plate to apply for different eye holes.
- Apply insulation 1 to the installed duct flange parts (Do not apply to sealed areas).

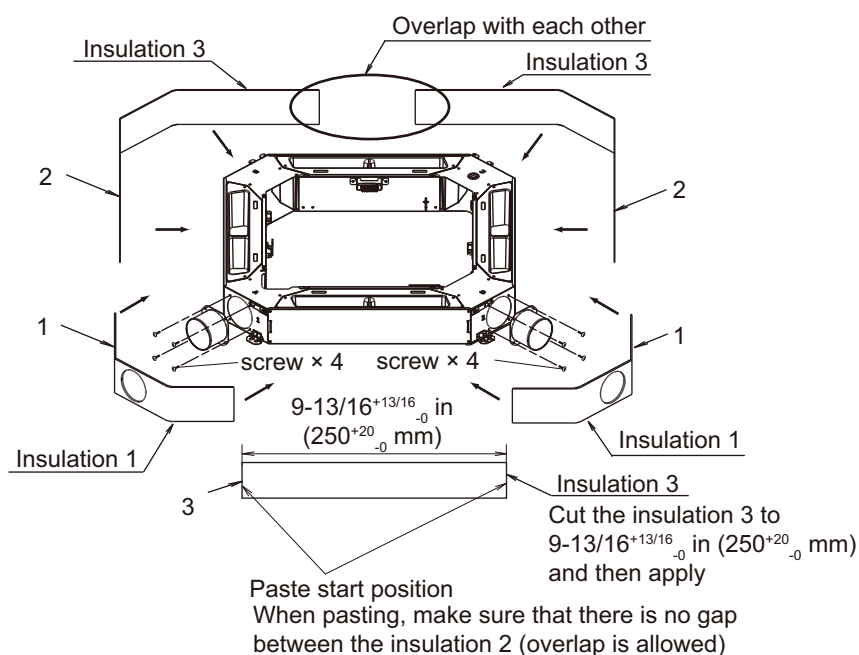


When taking in the air in one side, paste the insulation in the order as shown below.

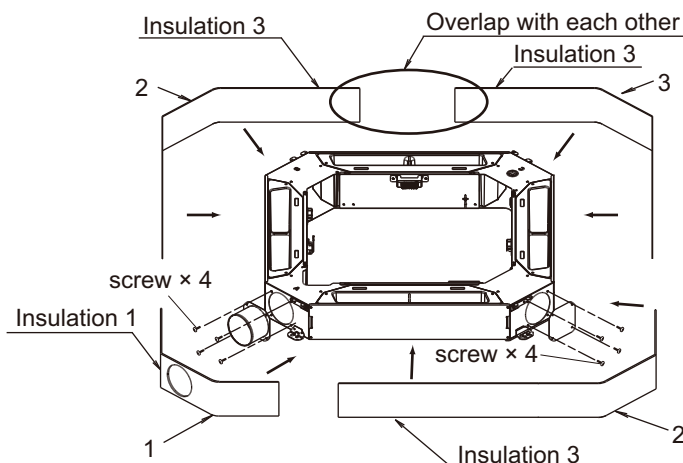


## ● Installation of Fresh air intake kit

1. Attach the Fresh air intake kit to the main body using the bolts provided.

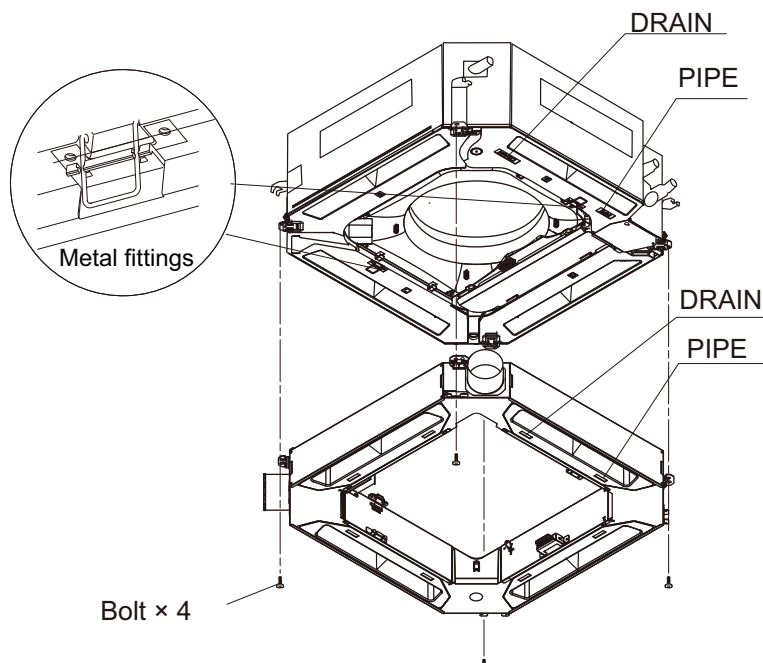


2. Attach the Hook plate by each corner of the Fresh air intake kit. (The attaching screws are attached to the body of the Fresh air intake kit and must be loosened before installing.)

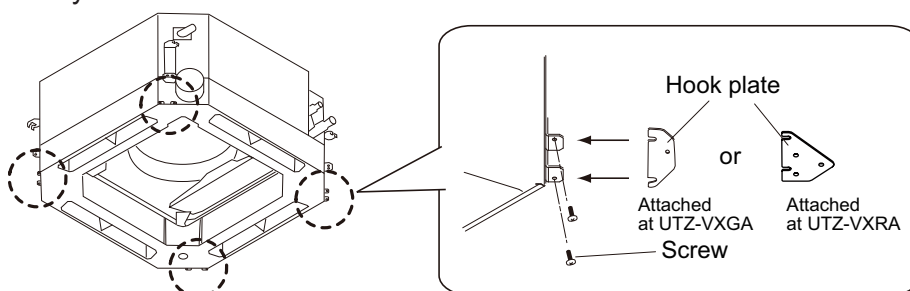


3. Install the cover.

- a. Remove the drain cover attached to the decorative panel and install onto the Fresh air intake kit.

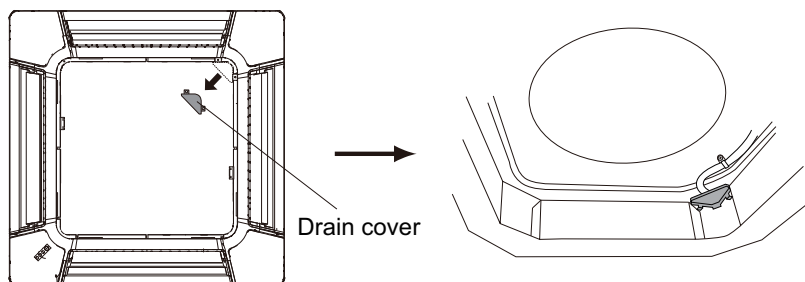

- b. Set the cover in position with screws (2 places) as shown below. Apply the Insulation 4 after installing the cover.

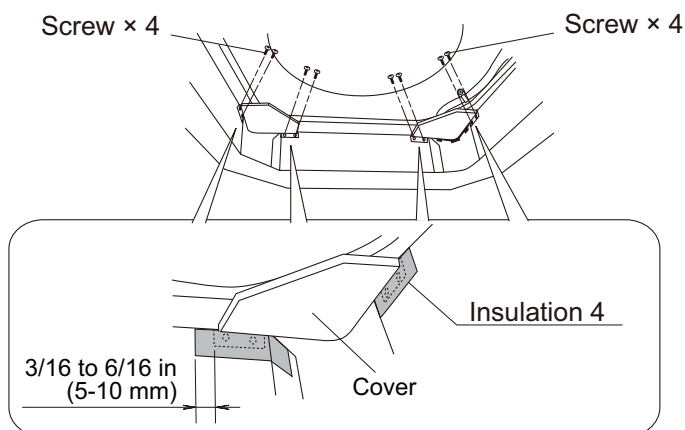

## 4. Install the duct.


- a. Fasten the connecting parts of the ducts with bands, and wrap with vinyl tape to ensure no air leaks. (Carry out the work to ensure no air leakage at a pressure of 0.80 inWG [200 Pa].)

**NOTE:** Do not construct the duct in the manner of below.

- Extreme bends
- Highly repetitive bends
- Making the connecting duct diameters smaller

- b. When using T-shaped pipe, suspend the kit with suspension bands for duct-use to avoid unnecessary load bearing.

Completion figure

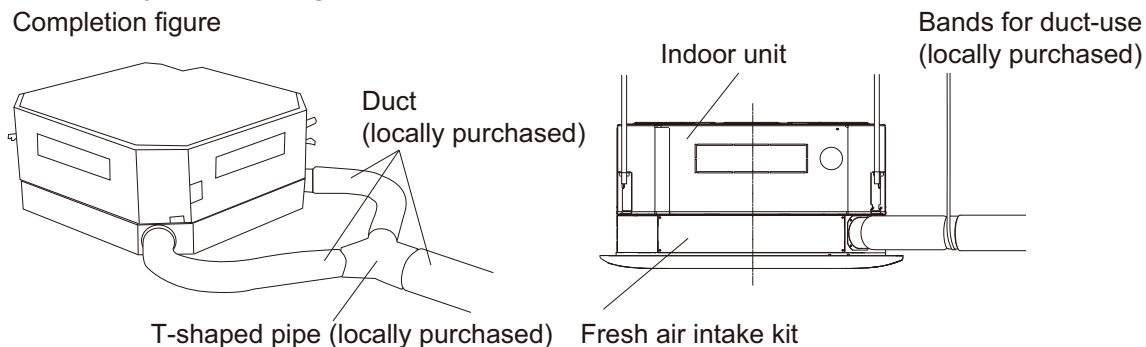


**NOTE:** When wiring of the duct fan is required, refer to "[Fresh air control output](#)" on page 10-47.

## ● Installation of Cassette grille


### Pre-installation preparations:

1. Remove the control box cover.
2. Remove the connector from the existing temperature sensor on the circuit board of the indoor unit.

4-way flow cassette type

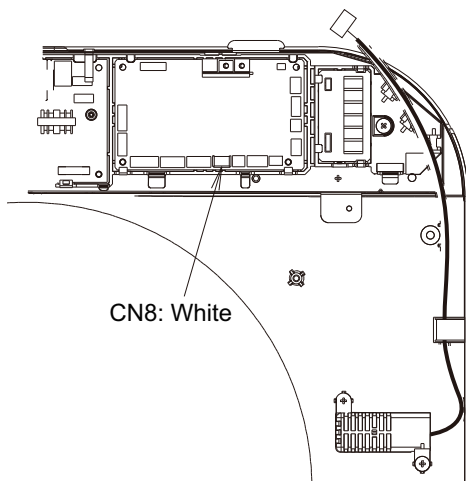

Circular flow cassette type

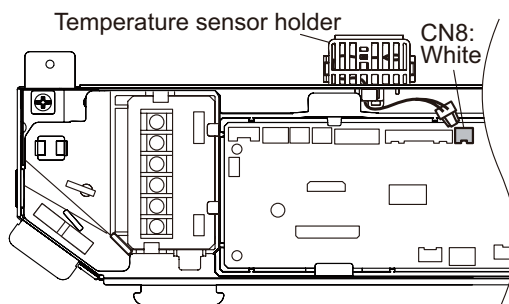


3. The existing temperature sensor will not be used so remove it from the sensor holder, and once more install the empty sensor holder (without sensor) in the control box.


### ⚠ CAUTION

Make sure to install the sensor holder inside the control box, as it is a fire hazard. Otherwise, it may cause fire.

4-way flow cassette type

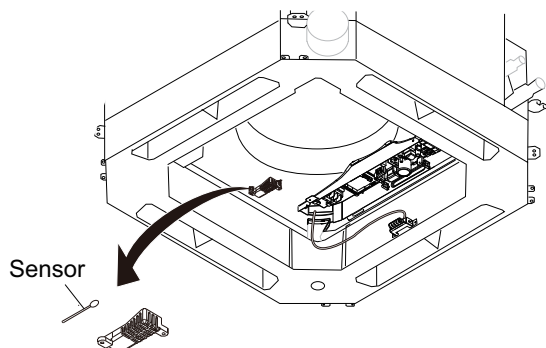


Circular flow cassette type

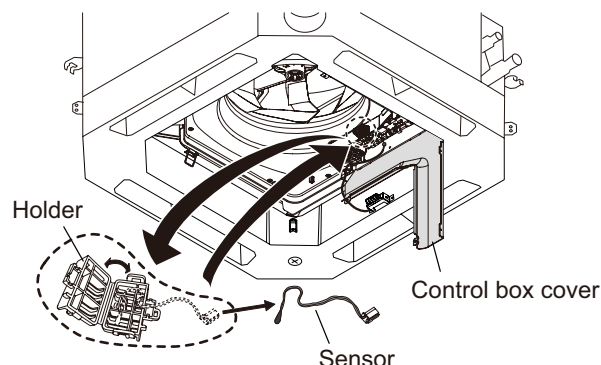


4. Insert the connector of the sensor attached to the Fresh air intake kit onto the substrate board of the indoor unit.

4-way flow cassette type

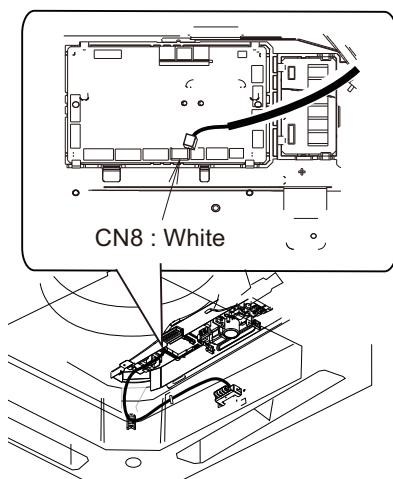

Circular flow cassette type

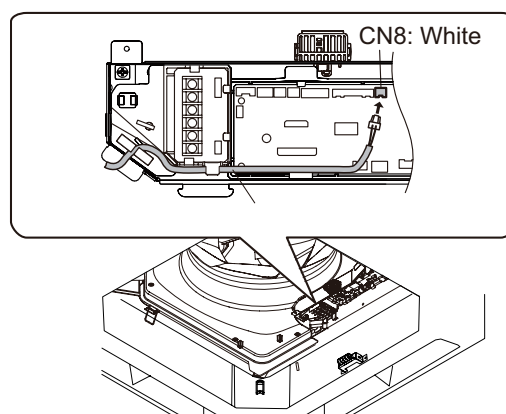


5. Insert the included extension cable for use with louver to the connector.
6. When using the optical receiver unit (option), insert the included extension wire to the indoor unit.
7. Close the control box cover when work is complete.

### Installation procedure:


1. After provisional fixing of a cassette grille, feed the louver extension wire (and optical receiver extension wire) through the penetrating hole.
2. Connect to the connection wires coming out of the cassette grille.

3. Install cassette grille panel according to the installation instruction sheet provided.

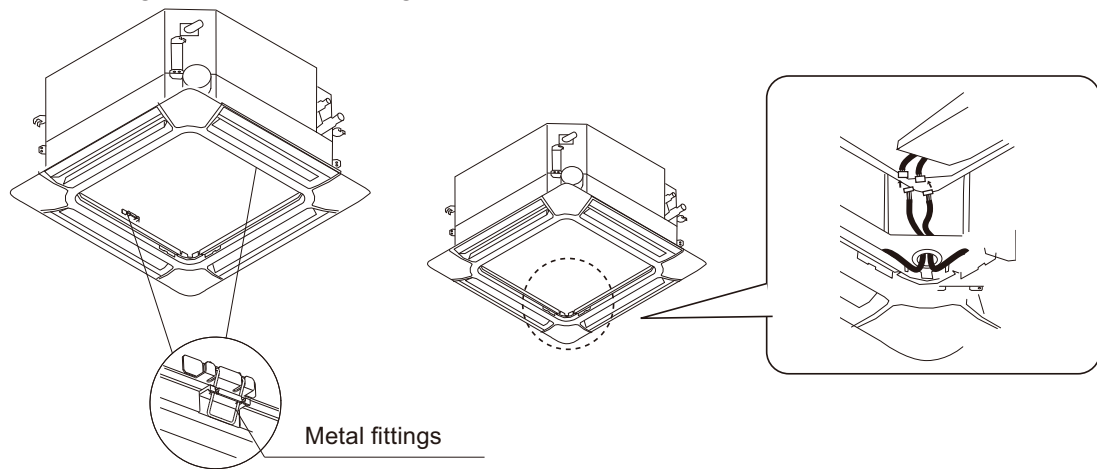


## ■ Installation example


- **Standard**

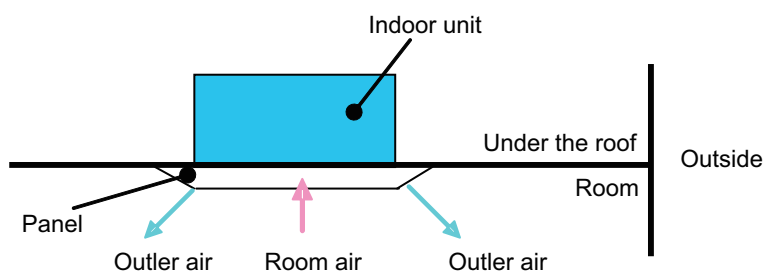

- **Case 1: Intake by fan of indoor unit**

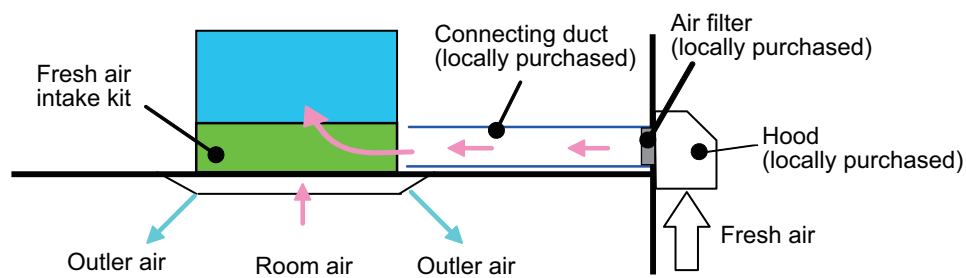

- **Case 2: Intake by duct fan**

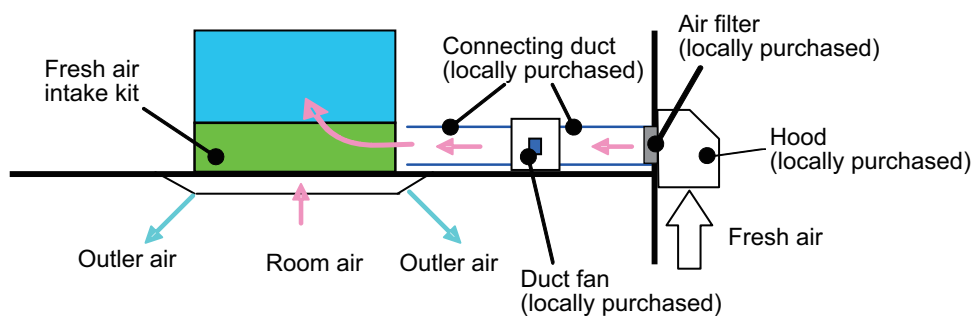

## 8-5. Auto louver grille kit

### RELATED LINKS

"Applicable parts" on page 10-24


### Specifications

Model name			UTD-GXSA-W UTD-GXTA-W	UTD-GXSB-W
Power supply			Connecting with Control box of indoor unit	
Fixing of Auto louver grille			Screw fixing to flange or rectangular duct	
Extension square duct limit			39-3/8 in (1.0 m) Max. duct length between indoor unit and grille	
Dimensions (H × W × D)	Net	in (mm)	7-1/16 × 26-7/8 × [3-5/16 + 3/8] (180 × 683 × [84+9])	7-1/16 × 34-3/4 × [3-5/16 + 3/8] (180 × 883 × [84+9])
	Gross	lb (kg)	4.4 (2.0) 6.7 (3.0)	5.6 (2.5) 7.8 (3.5)
Color			White	
Louver motor			Stepping motor	
Material			Flame retardant ABS	
Accessories			Attachment flame	
Operation range	Cooling	°F (°C)	64 to 90 (18 to 32)	
		%RH	80 % or less	
	Heating	°F (°C)	60 to 88 (16 to 30)	

### Dimension

#### Models: UTD-GXSA-W and UTD-GXTA-W


Unit: in (mm)

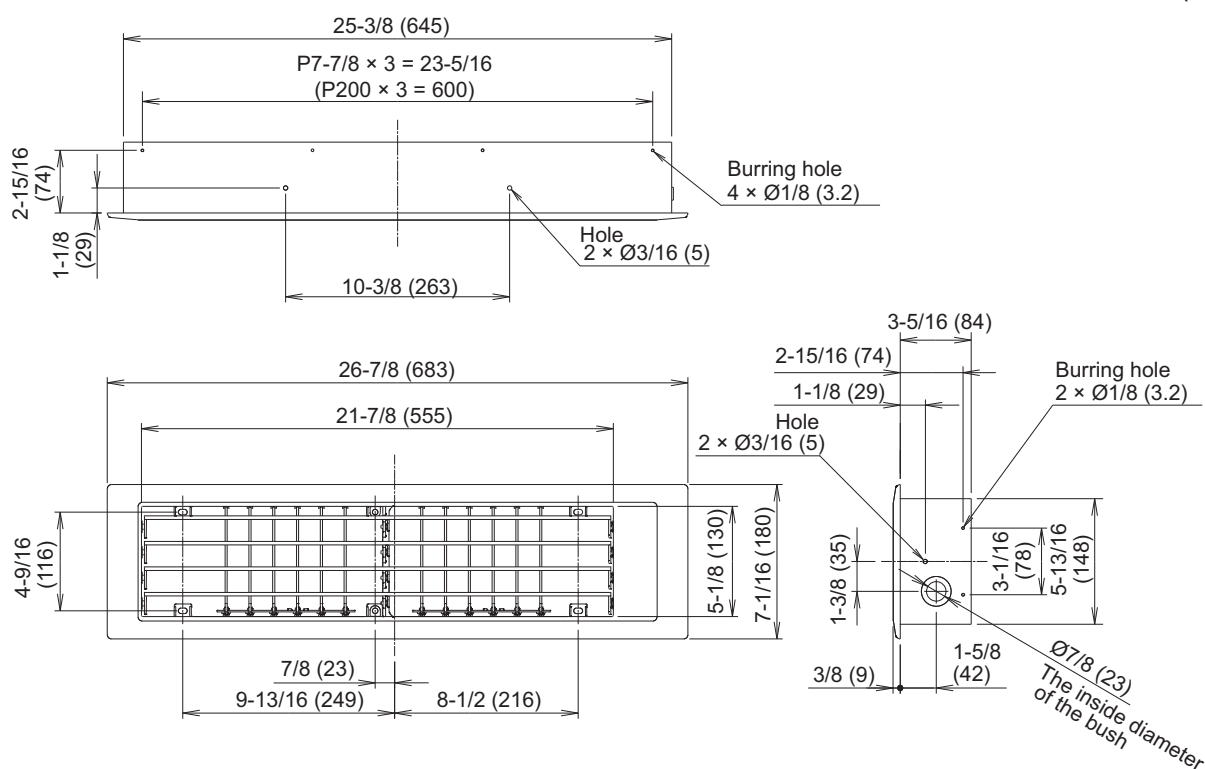












## ● Models: UTD-GXSB-W

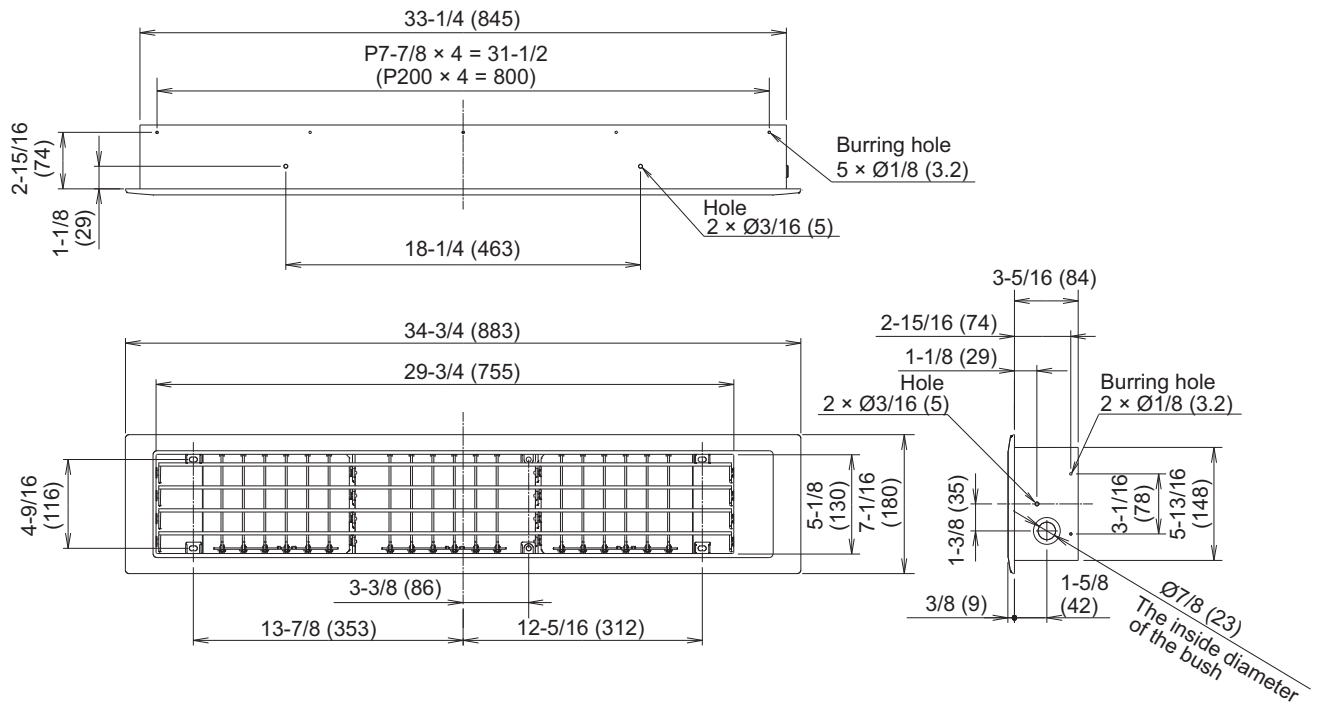Unit: in (mm)




## ■ Accessories

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Screw A	 3/8 in (10 mm)	16
Operating manual		1	Screw B	 3/8 in (10 mm)	6
Grille		1	Cable clip		2
Bracket frame		1	Cable tie		3
Bushing		1			

## ■ Installation precautions

- Select the installation location that meets the following requirement and that is approved by the customer.
  - Cool and warm air should reach the entire room.

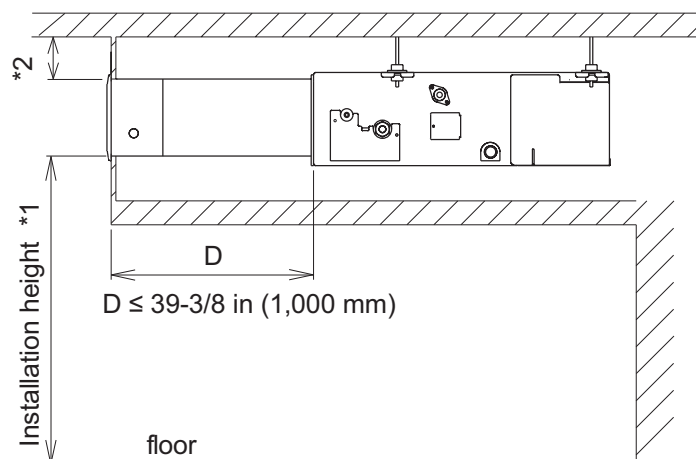

**NOTE:**

- \*1: For air velocity and air temperature distribution during heating, refer to "[Air velocity and temperature distributions](#)" in Chapter 4. INDOOR UNITS on page 04-79.
- \*2: If the distance from the ceiling is not adequate, it may cause mildew stains on the wall or ceiling. Install at least 5-7/8 in (150 mm) away from any surface.

- Do not install the unit in the following areas.
  - The upper part of the vicinity of room entrance  
It may cause condensation on the outlet port.
  - Near a wall surface  
It may cause condensation on the wall during cooling.
  - Area filled with mineral oil or containing a large amount of splashed oil or steam, such as kitchen.
  - The place where it will be exposed to direct sunlight.  
It may cause change in color.
- When the installation area is exposed direct sunlight, take measure to block the light such as covering the grille surface with a sheet. Otherwise, it may cause a change in color.
- Use an appropriate grille that is compatible with the indoor unit. If not used with the correct combination, it may cause condensation.
- Perform heat insulation and field setting according to the Installation manual of indoor unit. Not installing as per the instructions may cause condensation.

## 8-6. External power supply unit

### RELATED LINKS

"Applicable parts" on page 10-24


### Specifications

Model name			UTZ-GXXA
Power supply	V		1 Ø AC 24
Power source frequency	Hz		50/60
Maximum operating current	A		1.13
Maximum power consumption	W		21
Temperature	Operating	°F (°C)	32 to 114.8 (0 to 46)
	Packaged	°F (°C)	14 to 140 (-10 to 60)
Humidity	Packaged	%	0 to 95 (RH) No condensation
Dimensions (H × W × D)	in (mm)		2-9/16 × 8 × 7 (65 × 203 × 178)
Weight	lb (g)		1 (500)


### Dimensions

This product is comprised of a body and cover.

Unit: in (mm)

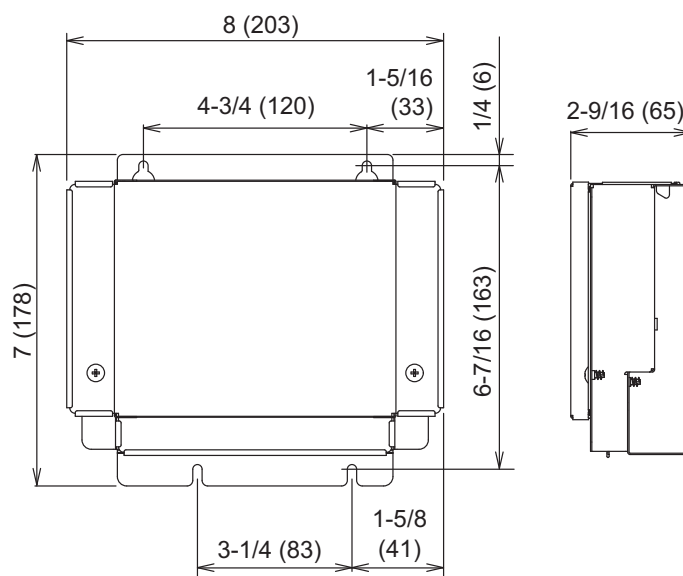

## ■ Wiring diagram

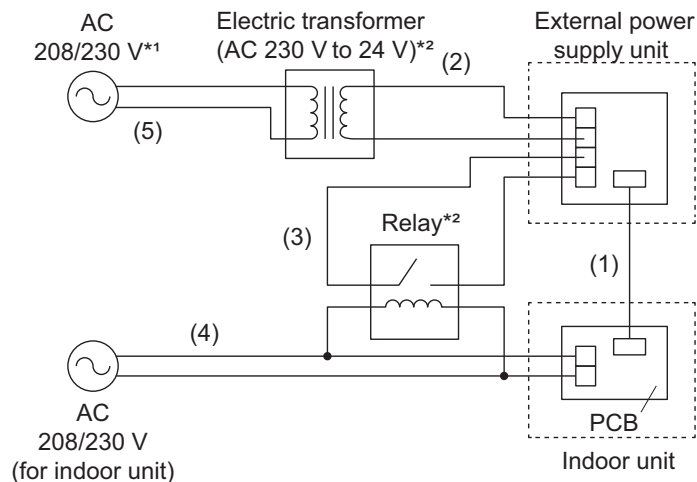

### NOTES:

- \*1: A dedicated power supply that is not shut off even if turned off the indoor units.
- \*2: Locally purchased.

- (1) Connect the external power supply unit and the PCB of the indoor unit with the provided connecting cable. (Depending on the model of the indoor unit, the adapter cable is also used.)
- (2) Connect AC 24 V ( $\pm 20\%$ ) power to the terminal of the external power supply unit.
- (3) Connect the contact side of the relay (with the normally closed contact) to external power supply unit.
- (4) Connect the inner and relay power lines to the circuit breaker.
- (5) Connect the power line of the power transformer primary side to the circuit breaker.










## ■ Electrical requirement

The following items are necessary to install this product. (These items are not included with this product and must be purchased separately.)

Name	Q'ty	Description
Relay	1	Primary side voltage: AC 208/230 V. Secondary side rated current: 3 A or more. Normally Closed contact. IEC61810-1 or 60335-1 Reinforced insulation between primary side and secondary side
Electric transformer	1	AC 24 V $\pm 15\%$ UL Class II

**NOTE:** When connecting multiple units, do not exceed the capacity of the transformer.

## ■ Accessories


Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Adapter cable		1*1
External power supply unit		1	Cable clamp		1*1
Tapping screw		4	Cable tie (large)		3
Connecting cable (5 m)		1	Cable tie (small)		1
EMI core		1*2			

### NOTES:

- \*1: It is used to connect to the following indoor unit type.
  - Circular flow cassette type
- \*2: It is used to connect to the following indoor unit type.
  - Floor/Ceiling type


## ■ Installation precautions

This product can be installed in the following direction.

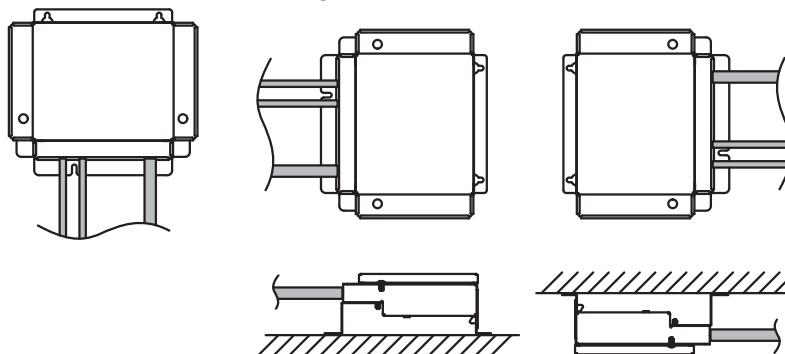

### Prohibited

To prevent water from entering through the cable, do not install this product in the direction shown in the following figure.



## FUJITSU GENERAL LIMITED

3-3-17, Suenaga, Takatsu-ku, Kawasaki 213-8502, Japan  
URL : <http://www.fujitsu-general.com>

- "AIRSTAGE" is a worldwide trademark of FUJITSU GENERAL LIMITED.
- Microsoft, Internet Explorer, Windows, and Windows Vista are either registered trademarks or trademarks of Microsoft Corporation in the United States and/or other countries.
- Adobe and Acrobat Reader are either registered trademarks or trademarks of Adobe Systems Incorporated in the United States and/or other countries.
- Intel is a trademark of Intel Corporation in the U.S. and/or other countries.
- Echelon, LONWORKS, and the Echelon logo are trademarks of Echelon Corporation registered in the United States and other countries.
- BACnet is a registered trademark of the American Society of Heating Refrigeration and Air Conditioning Engineers (ASHRAE).
- Niagara Framework, JACE and the logos used herein including such marks are trademarks of Tridium.
- Google Chrome is a trademark of Google Inc.
- Other company and product names mentioned herein may be registered trademarks, trademarks or trade names of their respective owners.

Copyright © 2020, 2021 Fujitsu General Limited. All rights reserved.