

OPTIONAL ELECTRIC HEAT KIT FOR MULTI-POSITION AIR HANDLER

USE WITH: USE WITH: PVFY-P-NAMU-E/E1; MVZ-A-AA4/7; SVZ-KP-NA; PVA-A-AA4/7

Job Name:

System Reference:

Date:



GENERAL FEATURES

- 208/240V Electric Heat Kits
- Mounts directly to the air outlet connection of the Multi-position Air Handler



CAUTION

- Do not power the Electric Heat Kit from the outdoor unit.
 - A separate power supply must be provided.
 - Air handler must be set on non-combustible floor when using electric heat in the downflow configuration.
 - Maximum external static pressure of 0.60 in WG for all installations with electric heaters.
- For more details, see note on best design practice on page 3.
- This kit must be controlled exclusively through the use of CN24-1 and CN24-2 (2 stage models) connections on the indoor unit control board.

ACCESSORIES

Separate Power Kit for MVZ and PVA models This kit allows the installer to connect power from a source other than the outdoor unit to the air handler. (S2 & S3 still must connect from outdoor unit for communication)	<input type="checkbox"/> SPTB1
Auxiliary Heat Lockout for MVZ, SVZ and PVA models This option prevents the electric heat kit from operating above a set outside temperature.	<input type="checkbox"/> ETC-211020-MIT
Replacement Temp Probe for ETC-211020-MIT	<input type="checkbox"/> 1309007-044

AVAILABLE COMBINATIONS: ELECTRIC HEAT KIT

(See note on best design practice on page 4)



NOTE

No other combination approved.

MODEL PER OUTDOOR UNIT

		Electric Heat Kit													
		EH03-SVZ-S	EH05-SVZ-S	EH08-SVZ-S	EH05-SVZ-M	EH08-SVZ-M	EH10-SVZ-M	EH03-MPA-S(B)	EH05-MPA-S(B)	EH08-MPA-S(B)	EH03-MPA-M(B)	EH05-MPA-M(B)	EH08-MPA-M(B)	EH10-MPA-M(B)	EH10-MPA-L(B)
Stages (1st + 2nd)		3	5	4+4	5	4+4	5+5	3	5	4+4	3	5	4+4	5+5	5+5
Air Handler Model	PVFX-P08NAMU-E1							✓							
	PVFX-P12NAMU-E							✓	✓						
	PVFX-P12NAMU-E1							✓	✓	✓					
	PVFX-P18NAMU-E							✓	✓	✓					
	PVFX-P18NAMU-E1							✓	✓	✓					
	PVFX-P24NAMU-E							✓	✓	✓					
	PVFX-P24NAMU-E1							✓	✓	✓					
	PVFX-P30NAMU-E										✓	✓	✓	✓	
	PVFX-P30NAMU-E1										✓	✓	✓	✓	
	PVFX-P36NAMU-E											✓	✓		
	PVFX-P36NAMU-E1											✓	✓		
	PVFX-P48NAMU-E													✓	✓
	PVFX-P48NAMU-E1													✓	✓
	PVFX-P54NAMU-E													✓	✓
	PVFX-P54NAMU-E1													✓	✓
	MVZ-A12AA4							✓	✓						
	MVZ-A12AA7							✓	✓						
	MVZ-A18AA4							✓	✓	✓					
	MVZ-A18AA7							✓	✓	✓					
	MVZ-A24AA4							✓	✓	✓					
	MVZ-A24AA7							✓	✓	✓					
	MVZ-A30AA4										✓	✓	✓	✓	
	MVZ-A30AA7										✓	✓	✓	✓	
	MVZ-A36AA4											✓	✓		
	MVZ-A36AA7											✓	✓		
	SVZ-KP12NA	✓	✓												
	SVZ-KP18NA	✓	✓	✓											
	SVZ-KP24NA	✓	✓	✓											
	SVZ-KP30NA				✓	✓	✓								
	SVZ-KP36NA				✓	✓	✓								
	PVA-A12AA7							✓	✓						
	PVA-A18AA7							✓	✓	✓					
	PVA-A24AA7									✓	✓	✓	✓		
	PVA-A30AA4									✓	✓	✓	✓		
	PVA-A30AA7									✓	✓	✓	✓		
	PVA-A36AA4													✓	✓
	PVA-A36AA7													✓	✓
	PVA-A42AA4													✓	✓
	PVA-A42AA7													✓	✓

ELECTRICAL SPECIFICATIONS: ELECTRIC HEAT KIT

(See note on best design practice on page 4)

Electric Heat Part Number	Heater kW		Heater Amps ¹	MCA ¹	MOP ¹	Htr & Mtr Amps ²	MCA ²
	208V/240V		208V/240V	208V/240V	208V/ 240V	208V/240V	208V/240V
EH03-SVZ-S	2.3/3.0		10.8/12.5	13.5/15.6	15/20	13.2/14.9	16.5/18.6
EH05-SVZ-S	3.8/5.0		18.1/20.8	22.6/26	25/30	20.5/23.2	25.6/29
EH08-SVZ-S	6.0/8.0		28.9/33.3	36.1/41.7	40/45	31.3/35.7	39.1/44.7
EH05-SVZ-M	3.8/5.0		18.1/20.8	22.6/26	25/30	21.4/24.1	26.7/30.2
EH08-SVZ-M	6.0/8.0		28.9/33.3	36.1/41.7	40/45	32.2/36.6	40.2/45.8
EH10-SVZ-M	7.5/10		36.1/41.7	45.1/52.1	50/60	39.4/45	49.3/56.2
EH03-MPA-S(B)	2.3/3.0		10.8/12.5	13.5/15.6	15/20	13.2/14.9	16.5/18.6
EH05-MPA-S(B)	3.8/5.0		18.1/20.8	22.6/26	25/30	20.5/23.2	25.6/29
EH08-MPA-S(B)	6.0/8.0		28.9/33.3	36.1/41.7	40/45	31.3/35.7	39.1/44.7
EH03-MPA-M(B)	2.3/3.0		10.8/12.5	13.5/15.6	15/20	14.1/15.8	17.7/19.8
EH05-MPA-M(B)	3.8/5.0		18.1/20.8	22.6/26	25/30	21.4/24.1	26.7/30.2
EH08-MPA-M(B)	6.0/8.0		28.9/33.3	36.1/41.7	40/45	32.2/36.6	40.2/45.8
EH10-MPA-M(B)	7.5/10		36.1/41.7	45.1/52.1	50/60	39.4/45	49.3/56.2
EH10-MPA-L(B)	7.5/10		36.1/41.7	45.1/52.1	50/60	40.6/46.2	50.8/57.7
EH15-MPAS-L(B)	11.3/15	Circuit 1	27.1/31.2	33.9/39.1	35/40	31.6/35.8	39.5/44.7
		Circuit 2	27.1/31.2	33.9/39.1	35/40	27.1/31.2	33.9/39.1
EH17-MPAS-L(B)	13.2/17.5	Circuit 1	31.6/36.5	39.5/45.6	40/50	36.1/41	45.1/51.2
		Circuit 2	31.6/36.5	39.5/45.6	40/50	31.6/36.5	39.5/45.6

¹ Heater amps; no motor

² Heater and motor amps (connect air handler power supply to largest circuit breaker)

Voltage and Amperage based on 60Hz

Motor amps are placed on circuit 1 when required

Unit tested at 0.60 in WG external static pressure

Minimum installation clearance to combustible material 0"


Maximum outlet air temperature 200° F

The building power supply circuit breaker must be sized per MOP listed for the provided voltage.

The factory installed circuit breaker in this kit is provided as a disconnect switch only.

ELECTRICAL SPECIFICATIONS: ELECTRIC HEAT KIT

Units: mm (in.)

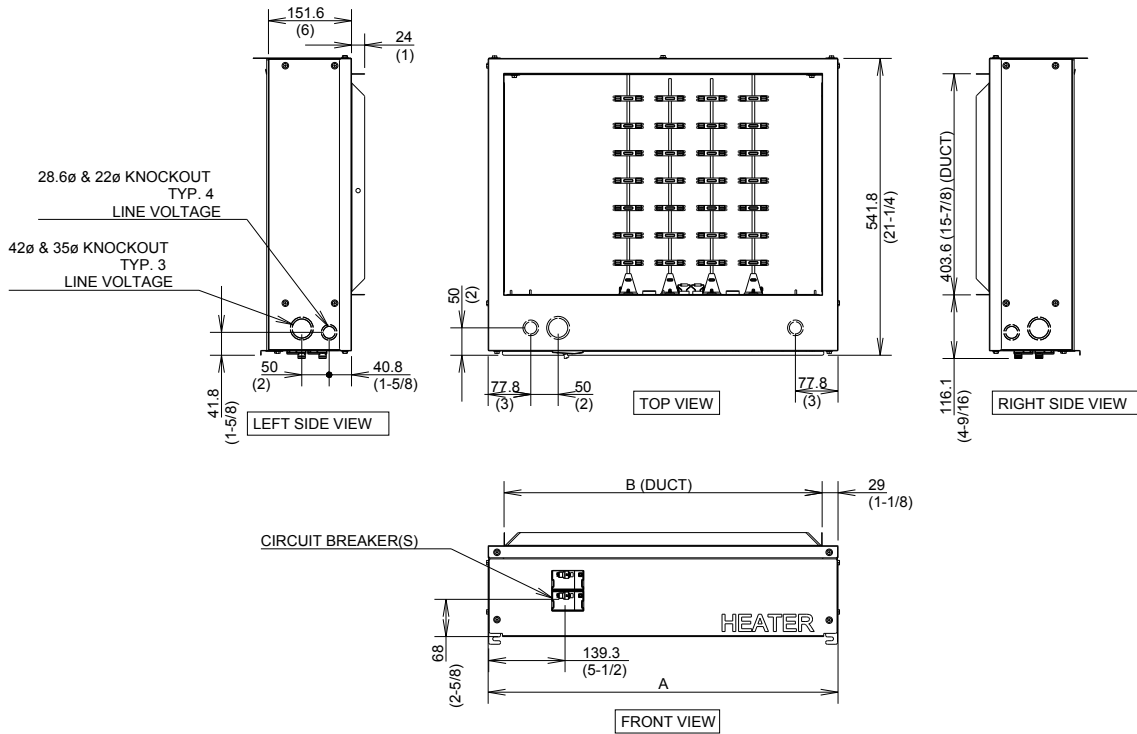

MODEL	A	B
EH03-MPA-S(B)	433 (17)	376 (14-13/16)
EH05-MPA-S(B)		
EH08-MPA-S(B)		
EH03-SVZ-S		
EH05-SVZ-S		
EH08-SVZ-S	534 (21)	477 (18-13/16)
EH03-MPA-M(B)		
EH05-MPA-M(B)		
EH08-MPA-M(B)		
EH10-MPA-M(B)		
EH05-SVZ-M		
EH08-SVZ-M		
EH10-SVZ-M		
EH10-MPA-L(B)	635 (25)	579 (22-13/16)
EH15-MPAS-L(B)		
EH17-MPAS-L(B)		



NOTE

BEST DESIGN PRACTICE TO ASSURE ADEQUATE AIRFLOW

REQUIREMENTS

During electric heater operation the fan is defaulted to high speed to help assure adequate airflow. To maintain adequate airflow required for electric heater operation, it is recommended that an additional 0.20 WG static pressure drop be added to system ductwork design when using the electric heat kit.

Examples:

When air handler is set for 0.50 WG static, the maximum external static pressure for ductwork should not exceed 0.30 WG.

When air handler is set for 0.80 WG static, the maximum external static pressure for ductwork should not exceed 0.60 WG, etc.

1340 Satellite Boulevard. Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com