


ICM2805 WIRING DIAGRAM

For Models G(3,4)R(-) Gas Furnaces with UTEC Control Board #624631

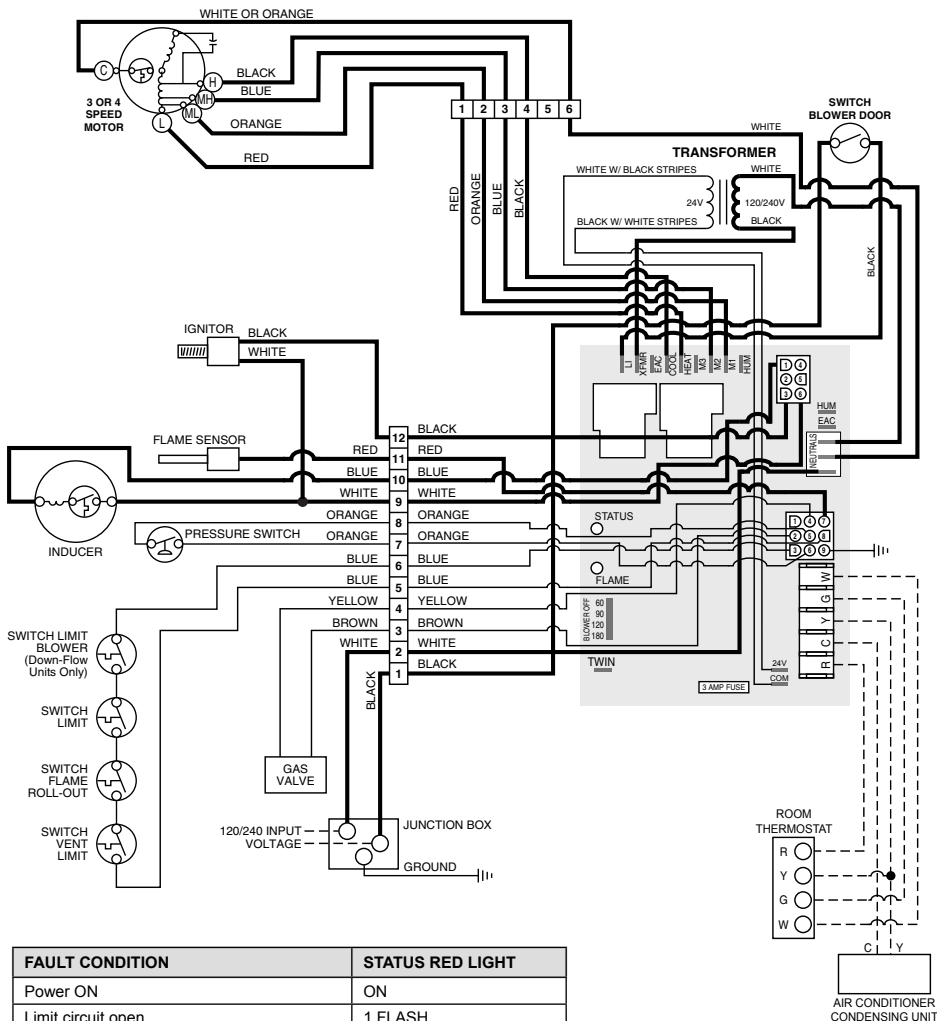

NOTE:

If any of the original wire as supplied with the furnace must be replaced, it must be replaced with wiring material having a temperature rating of at least 105 C.

Use copper conductors only.

LEGEND

• Field Wiring - - - -

Factory Wiring:

• Low Voltage ———

• High Voltage ———