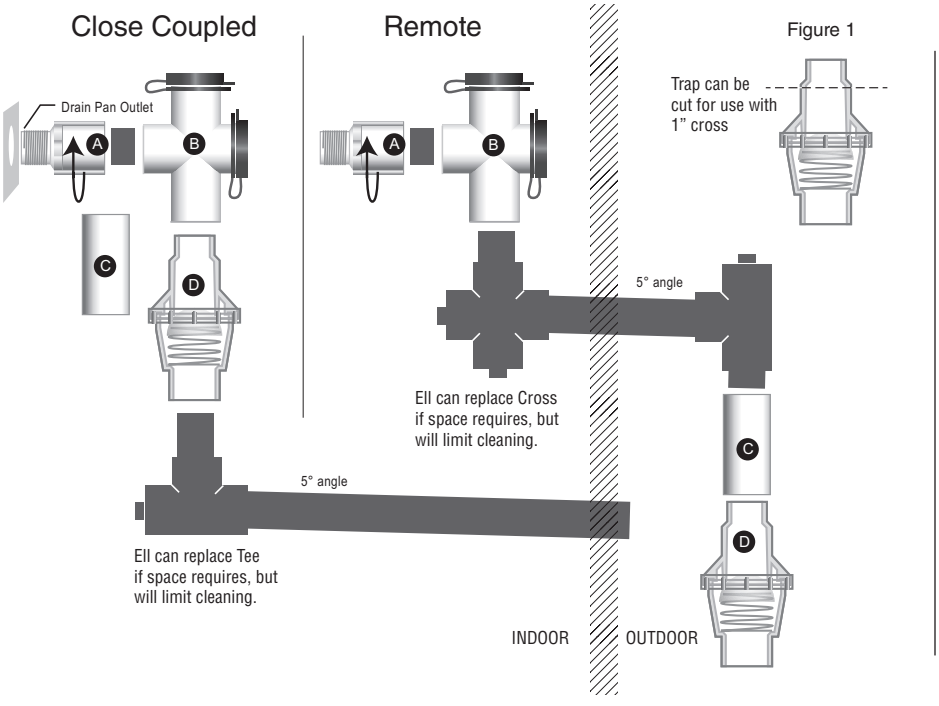


Figure 1

EZ-TRAP®
EZT150

Product Code 83150

Kit Contents

(A) 3/4" Adaptor (1)
(B) 3/4" Inlet Cross (1)
(C) 3/4 Coupler (1)
(D) Clear Ultra Trap (1)
(E) Red Drain Caps (2)
Cleaning Brush (1)
Orange Cleaning Label (1)


Trap Assembly Instructions

1. Screw Adaptor (A) into drain pan.

2. Choose Close Coupled Installation or Remote Installation. Glue together components following the proper diagram above. DO NOT INSTALL HORIZONTALLY. Assembly must be plumb. Trap must be installed vertically only, with float above spring as shown.

3. Choose Close Coupled Installation or Remote Installation. Glue together components following the proper diagram above.

Note: To use the Trap with 1" Cross, cut and remove 3/4" section off the top of the trap as shown in figure 1 above.



Cleaning Maintenance

1. Clean Inlet Cross and drain pan periodically with brush.
2. Clean Trap and Float periodically with soapy water. Unscrew retainer ring and remove bottom section of trap to remove and clean float, spring and chamber.
3. To reassemble, insert Spring and Float into bottom of the trap section, insert into upper half of trap, and secure with retaining ring.

Important:
Install in accordance with RectorSeal® instructions as well as all applicable local plumbing, drainage and electrical codes.

Never connect condensate drain line directly into a sewer line. If connection to a sewer line is required and permitted by code, drain must terminate in an open sewer trap,
(separate from sewer pipe with an air gap).

Note: Insulation is required when trap is installed in unconditioned space where sweating can occur.